

APPLICABLE CODES, REGULATIONS, & STANDARDS

- A. THE 2023 FLORIDA BUILDING CODE, 8TH EDITION
- B. ASCE/SEI 7-22: MINIMUM DESIGN LOADS ON BUILDINGS AND OTHER STRUCTURES
- C. ACI 318-19: BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE
- D. AISC STEEL CONSTRUCTION MANUAL (15TH EDITION)
- E. AWS D1.1: STRUCTURAL WELDING

1. THESE PLANS BELONG EXCLUSIVELY TO THE STRUCTURE, INCLUDING MAIN WIND FORCE RESISTING SYSTEM (MWFERS), COMPONENTS AND CLADDING (C&C), AND BASE RAIL ANCHORAGE. OTHER DESIGN ISSUES, INCLUDING BUT NOT LIMITED TO PROPERTY SET-BACKS, ELECTRICAL, PLUMBING, INGRESS/EGRESS, FINISH FLOOR SLOPES AND ELEVATIONS, OR OTHER LOCAL ZONING REQUIREMENTS ARE THE LIABILITY OF OTHERS.
2. THESE STRUCTURES ARE ENGINEERED AS CAPABLE OF SUPPORTING DEAD LOAD OF THE STRUCTURE AND LIVE AND WIND LOADS. UPGRADES NOT SPECIFICALLY ADDRESSED HEREIN, SUCH AS WINDOWS, DOORS, OR ANOTHER COMPONENT NOT LISTED IN THE FLORIDA BUILDING CODE APPROVED PRODUCT LIST, AND NOT PROVIDED AND INSTALLED BY TUBULAR BUILDING SYSTEMS, WHICH CAUSE ADDITIONAL LOADS ON THE STRUCTURE SHALL BE AT THE OWNER'S RISK. FLORIDA ENGINEERING LLC, SHALL NOT BE RESPONSIBLE FOR FAILURE OR STRUCTURAL DAMAGE DUE TO THE EXTRA LOAD.

3. LOW ULTIMATE WIND SPEED 105 TO 140 MPH (NOMINAL WIND SPEED 81 TO 108 MPH): MAXIMUM RAFTER/POST AND END POST SPACING = 5.0 FEET.

4. HIGH ULTIMATE WIND SPEED 141 TO 170 MPH (NOMINAL WIND SPEED 109 TO 132 MPH): MAXIMUM RAFTER/POST AND END POST SPACING = 4.0 FEET.

5. ALL STEEL TUBING SHALL BE 50 KSI GALVANIZED STEEL. ALL FASTENERS SHALL BE ZINC COATED HARDWARE.

6. SPECIFICATIONS APPLICABLE TO 29 GAUGE METAL PANELS FASTENED DIRECTLY TO 2 1/2" x 2 1/2" - 14 GAUGE TUBE STEEL (TS) FRAMING MEMBERS FOR VERTICAL PANELS, 26 GAUGE METAL PANELS SHALL BE FASTENED TO 18 GAUGE HAT CHANNELS (UNLESS OTHERWISE NOTED).

7. WIND FORCES GOVERN OVER SEISMIC FORCES. SEISMIC PARAMETERS ANALYZED ARE:
 R = 3.5
 Sds = 0.087g
 Sd1 = 0.084g

8. GROUND ANCHORS SHALL BE INSTALLED THROUGH BASE RAIL WITHIN 6" OF EACH RAFTER COLUMN ALONG SIDES.

9. GROUND ANCHOR (SOIL NAILS) CONSIST OF #5 REBAR W/ WELDED NUT X 30" LONG IN SUITABLE SOIL CONDITIONS MAY BE USED FOR LOW (≤ 108 MPH NOMINAL) WIND SPEEDS ONLY. OPTIONAL ANCHORAGE MAY BE USED IN SUITABLE SOILS AND MUST BE USE IN UNSUITABLE SOILS AS NOTED.

10. MIN. LAP REQUIREMENT FOR REBAR IN FOOTER IS 25".

11. SOIL TO BE COMPACTED TO 95% OF ITS MAXIMUM DRY DENSITY, AT OPTIMUM MOISTURE CONTENT, IN ACCORDANCE WITH ASTM D1557-93

12. PRIOR TO PLACING CONCRETE, TREAT THE ENTIRE SUBSURFACE AREA FOR TERMITES IN COMPLIANCE WITH THE FBC. FOR RISK CATEGORY II, III, & IV STRUCTURES ONLY.

13. ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE.

14. A LANDING OF MIN. 36" WIDTH IN THE DIRECTION OF TRAVEL SHALL BE PROVIDED AT THE EXTERIOR DOORS. SLOPE OF LANDING NOT TO EXCEED 1/4"-1". LANDING LEVEL NOT TO BE LOWER THAN 1-1/2" (FOR EGRESS DOORS) & 7-3/4" (FOR OTHER EXTERIOR DOORS) BELOW THE TOP OF THRESHOLD.

DESIGN DATA	
DESIGN CRITERIA :	ASCE/SEI 7
RISK CATEGORY :	II-B
OCCUPANCY CLASSIFICATION :	R3
CONSTRUCTION TYPE :	II-B
DEFLECTION LIMIT =	L/240
ULTIMATE DESIGN WIND SPEED (MPH) VULT =	120
NOMINAL DESIGN WIND SPEED (MPH) VASD =	93
EXPOSURE CATEGORY :	C
MEAN BUILDING HEIGHT (FT) =	14.50
MINIMUM BUILDING PLAN DIMENSION (FT) =	30.00
END ZONE DIMENSION (FT) a =	3.00
ROOF STYLE :	GABLE
ROOF PITCH (IN 12) :	4
OCCUPANCY CLASSIFICATION :	PARTIALLY OPEN
DEAD LOAD (DUE TO SELF-WEIGHT) =	4.8 PSF
ROOF LIVE LOAD =	12 PSF
GROUND SNOW LOAD =	4 PSF
ADJUSTED C & C WIND PRESSURES (ASD) (PSF)	
EFFECTIVE WIND AREA FOR ROOF (SQ. FT) :	75.00
ZONE 1' (POSITIVE) =	NA
ZONE 1' (NEGATIVE) =	NA
ZONE 1' (OVERHANG) =	NA
ZONE 1 (POSITIVE) =	9.3
ZONE 1 (NEGATIVE) =	-20.7
ZONE 1 (OVERHANG) =	-34.2
ZONE 2 (POSITIVE) =	9.3
ZONE 2 (NEGATIVE) =	-27.8
ZONE 2 (OVERHANG) =	-41.4
ZONE 3 (POSITIVE) =	9.3
ZONE 3 (NEGATIVE) =	-35.3
ZONE 3 (OVERHANG) =	-48.8
EFFECTIVE WIND AREA FOR WALLS (SQ. FT) :	60.00
ZONE 4 (POSITIVE) =	16.7
ZONE 4 (NEGATIVE) =	-18.3
ZONE 5 (POSITIVE) =	16.7
ZONE 5 (NEGATIVE) =	-20.9

CONTRACTOR TO PROVIDE BUILDING CODE APPROVED PRODUCTS TO MEET OR EXCEED THE DESIGN PRESSURES AS TABULATED.

ADJUSTED C & C WIND PRESSURES (ASD) (PSF) FOR OPENINGS	
SWING DOOR	
EFFECTIVE WIND AREA (SQ. FT) =	24.00
ZONE 4 (POSITIVE) =	17.8
ZONE 4 (NEGATIVE) =	-19.5
ZONE 5 (POSITIVE) =	17.8
ZONE 5 (NEGATIVE) =	-23.2
ROLL-UP DOOR	
EFFECTIVE WIND AREA (SQ. FT) =	N/A
ZONE 4 (POSITIVE) =	N/A
ZONE 4 (NEGATIVE) =	N/A
ZONE 5 (POSITIVE) =	N/A
ZONE 5 (NEGATIVE) =	N/A
WINDOW	
EFFECTIVE WIND AREA (SQ. FT) =	6.00
ZONE 4 (POSITIVE) =	18.9
ZONE 4 (NEGATIVE) =	-20.5
ZONE 5 (POSITIVE) =	18.9
ZONE 5 (NEGATIVE) =	-25.3

SHEET NO.	DRAWING INDEX
S/01	GENERAL NOTES
S/02	PLAN/ ELEVATIONS
S/03	FOUNDATION PLAN
S/04	DETAILS

THE ENGINEERING ON THESE PLANS IS SITE SPECIFIC FOR (1) STRUCTURE ONLY AT THE PROVIDED ADDRESS(ES).


PROPOSED METAL BUILDING FOUNDATION & SHELL STRUCTURAL DESIGN ONLY. ALL OTHER REQUIRED PERMITS TO BUILD OUT TO A HABITABLE LIVING SPACE ARE TO BE BY OTHERS/ PER SEPERATE CERTIFICATE. INCLUDING BUT NOT LIMITED TO, ELECTRICAL, PLUMBING, ENERGY CALCS., ETC. FOR MORE INFORMATION VISIT:
<https://flengineeringllc.com/order/> OR SCAN QR CODE.




This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

PRODUCT CATEGORY	SUB CATEGORY	MANUFACTURER	APPROVAL No. & DATE
STRUCTURAL COMPONENTS	ROOF DECK	CAPITAL METAL SUPPLY, INC. 26 GA. CAPITAL RIB ROOF PANEL	FL20147.2-R4 01/06/30
STRUCTURAL COMPONENTS	STRUCTURAL WALL	CAPITAL METAL SUPPLY, INC. 29 GA. CAPITAL RIB WALL PANEL	FL20148.2-R4 01/06/30
EXTERIOR DOORS	SWINGING	PLASTPRO INC. / NANYA PLASTICS CORP. K. SMOOTH/WOOD GRAIN SERIES N FIBERGLASS DOOR	FL15220.11-R5 12/31/26
EXTERIOR DOORS	SWINGING	PLASTPRO INC. / NANYA PLASTICS CORP. L. SMOOTH/WOOD GRAIN SERIES N FIBERGLASS DOOR	FL15220.12-R5 12/31/26
EXTERIOR DOORS	SWINGING	PLASTPRO INC. / NANYA PLASTICS CORP. N. SMOOTH/WOOD GRAIN SERIES N FIBERGLASS DOOR	FL15220.14-R5 12/31/26
WINDOWS	SINGLE HUNG	SIERRA PACIFIC WINDOWS ALL WOOD CASEMENT	FL41866.1-R1 05/23/32
WINDOWS	SINGLE HUNG	MI WINDOWS AND DOORS 3500 PW	FL18644.1-R10 04/30/26


CTP = CONTRACTOR TO PROVIDE APPROVED PRODUCTS THAT MEET OR EXCEED WIND DESIGN PRESSURES.

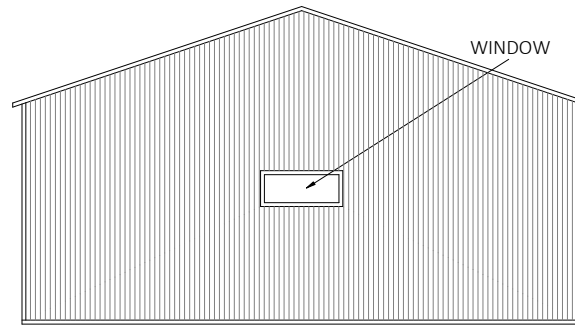


FRONT ELEVATION

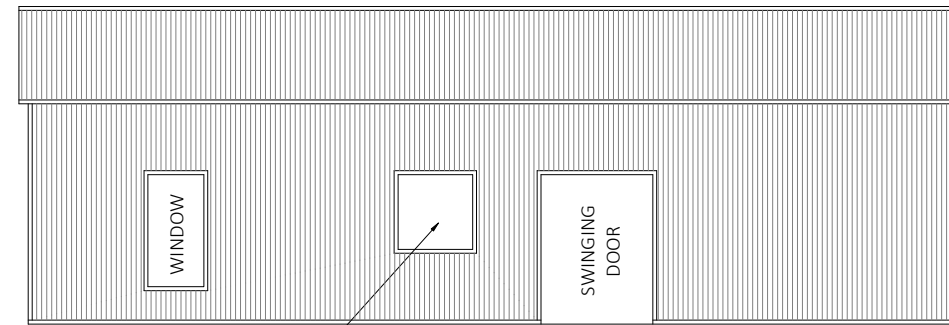

WINDOW RIGHT SIDE ELEVATION

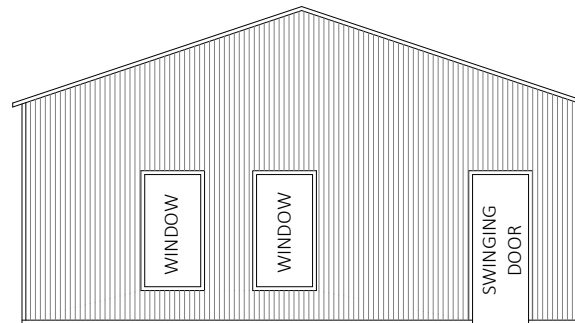

REAR ELEVATION

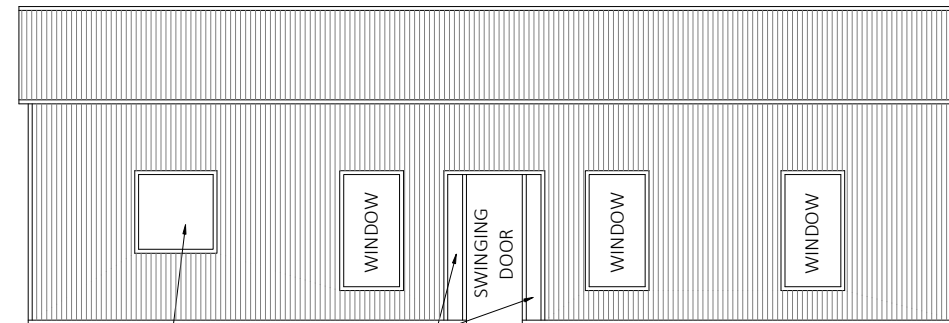

WINDOW WINDOW LEFT SIDE ELEVATION

FLORIDA ENGINEERING LLC
 4161 TAMiami TRAIL, UNIT 101
 PORT CHARLOTTE, FLORIDA 33952
 (941) 391-5980
 FLEng.com
 Orders@FLEng.com

CA CERT. #30782

PROJECT NO. 2530311-R

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
 P.O. BOX. 2254
 LAKE CITY, FL 32056

PROJECT ADDRESS:
GREENLEE
 132 SW EGLIN PL
 LAKE CITY, FL 32024

DESIGN DATE: 11/10/2025

REVISION 1: 11/12/2025



REVISION 2: DATE

DRAWN BY: TCP

SCALE: NTS

SHEET:
01

SIDE PURLIN NOTE:
 CUT PURLINS AS NECESSARY FOR WINDOW AND DOOR OPENINGS. ROLL-UP AND SWINGING DOORS REQUIRE A SECTION OF PURLIN ACROSS THE TOP OF OPENING.
 WINDOWS REQUIRE A SECTION OF PURLIN TOP AND BOTTOM.

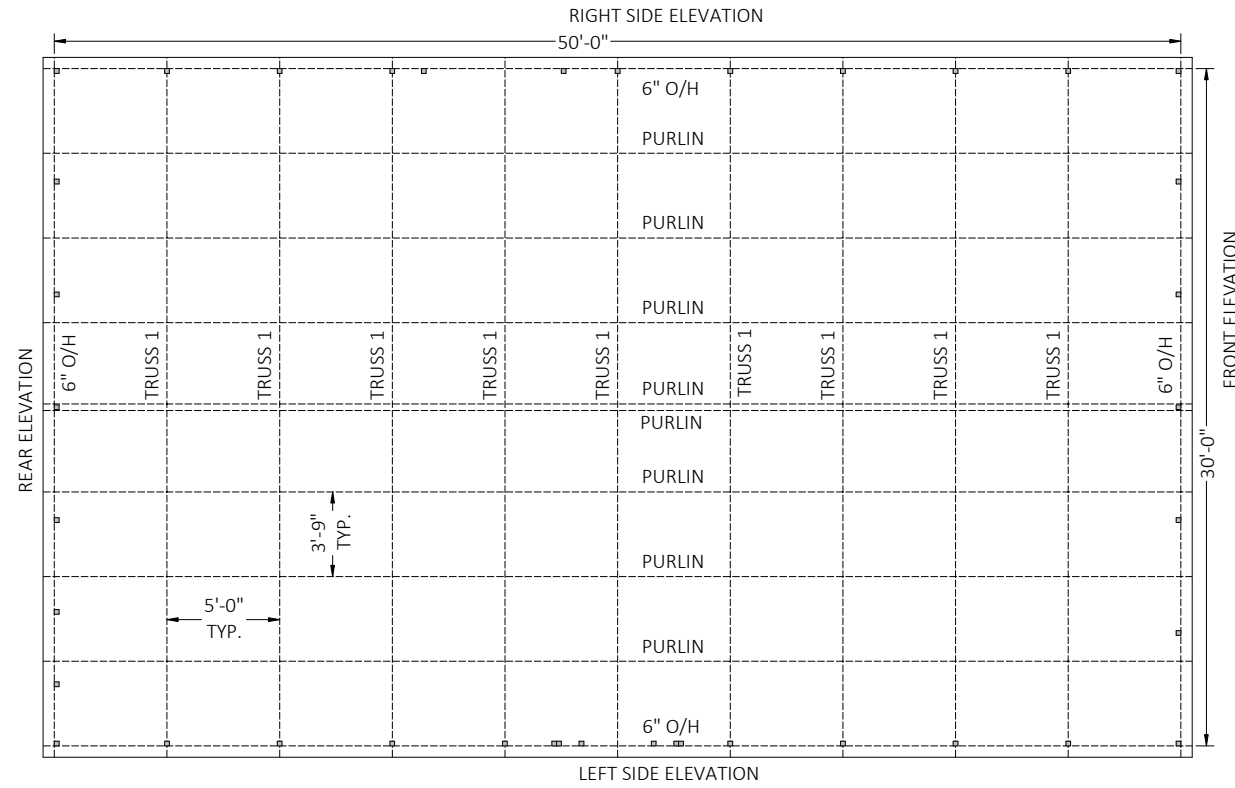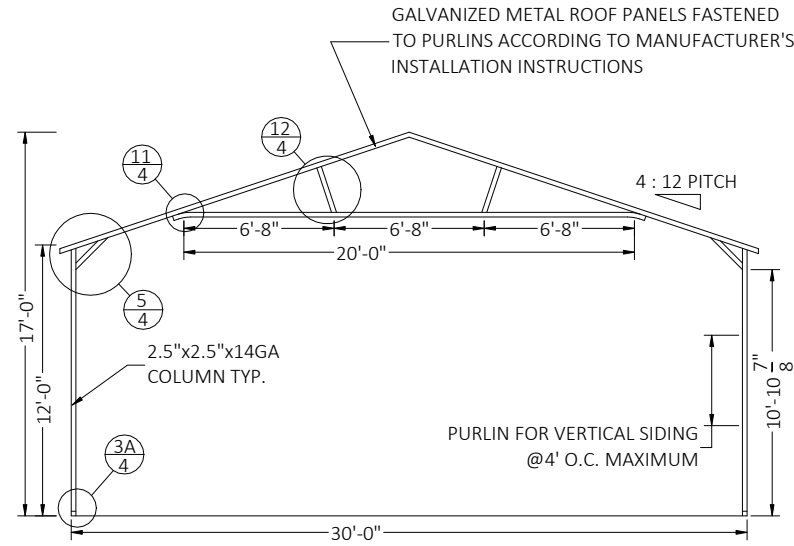

SCOPE OF WORK:
 PROPOSED METAL BUILDING FOUNDATION & EXTERNAL SHELL STRUCTURAL DESIGN ONLY. ALL OTHER REQUIRED PERMITS TO BUILD OUT TO A HABITABLE LIVING SPACE ARE TO BE BY OTHERS, INCLUDING BUT NOT LIMITED TO, ELECTRICAL, PLUMBING, ENERGY CALCULATIONS, ETC.



- FRAMING NOTES:
1. ALL FRAME MEMBERS ARE 2.5"x2.5"x14 GA TS U.N.O.
 2. MAX. RAFTER SPACING = 5'-0"
 3. U-BRACE = 2.5"x2"x18 GA CHANNEL
 4. PURLIN = 1.5" X 18GA HAT CHANNEL
 5. KNEE BRACE = 2.5"x2"x18GA CHANNEL

- - 2.5X2.5X14GA COLUMN
- - (2) 2.5X2.5X14GA COLUMN

FASTENING SCHEDULE	
ROOF PANEL	6"-3"-6"-3"-6"-3"-6" W/ NO SIDE LAP FASTENER
WALL PANEL	6"-3"-6"-3"-6"-3"-6" W/ NO SIDE LAP FASTENER

This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



GALVANIZED METAL WALL PANELS FASTENED TO POSTS ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS

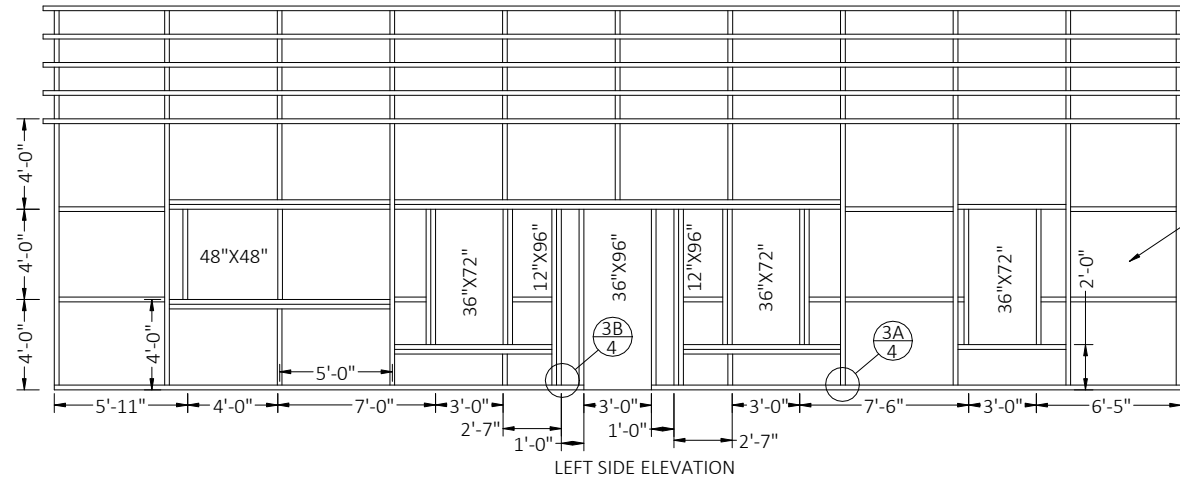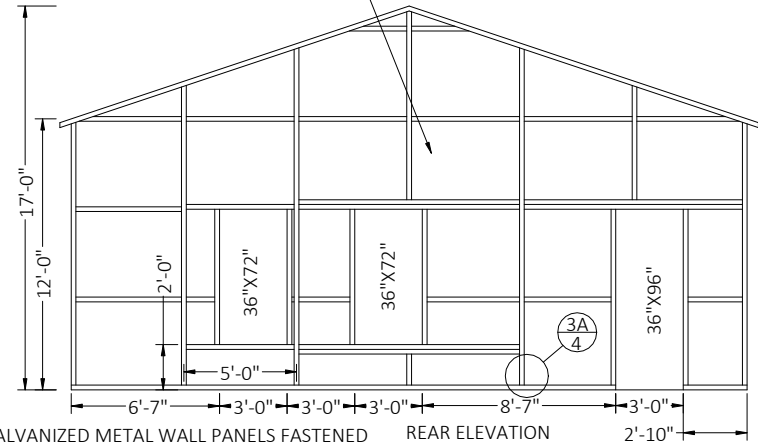

1.5" 18 GAUGE FURRING CHANNEL SPACED AT 4'-0" (MAX.) O.C. AND FASTENED TO EACH RAFTER WITH (2) #12-14 x 3/4" SDF'S


GALVANIZED METAL WALL PANELS FASTENED TO POSTS ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS

GALVANIZED METAL WALL PANELS FASTENED TO POSTS ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS

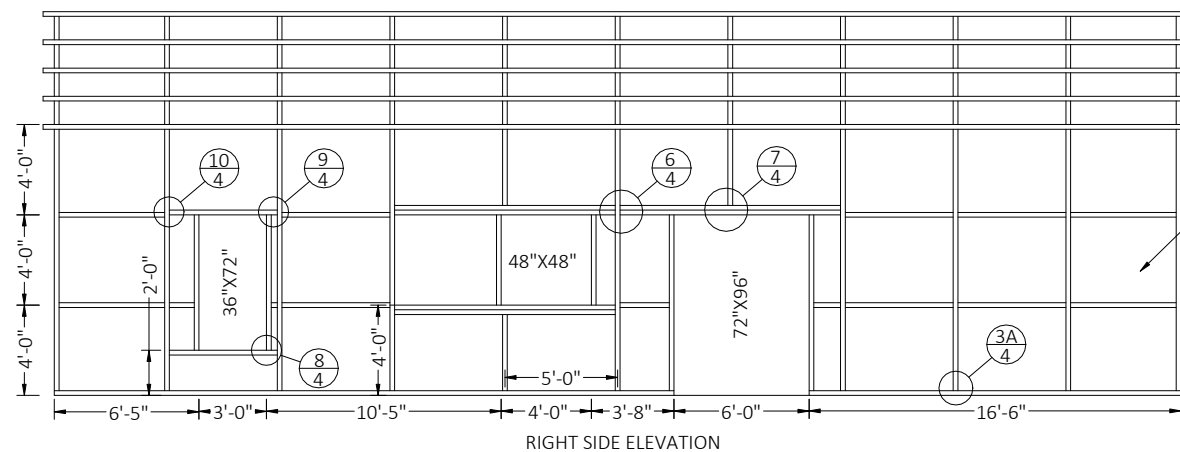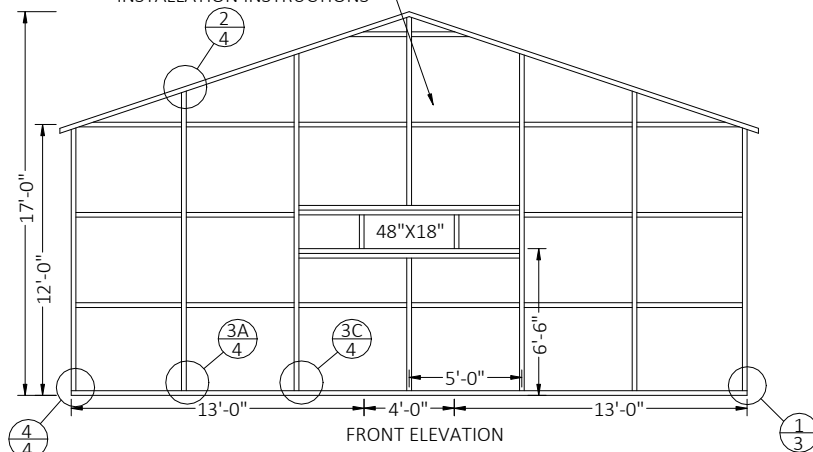

GALVANIZED METAL WALL PANELS FASTENED TO POSTS ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS

FLORIDA ENGINEERING LLC
 4161 TAMiami TRAIL, UNIT 101
 PORT CHARLOTTE, FLORIDA 33952
 (941) 391-5980
 FLEng.com



CA CERT. #30782

PROJECT NO. 2530311-R

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
 P.O. BOX. 2254
 LAKE CITY, FL 32056

PROJECT ADDRESS:
GREENLEE
 132 SW EGLIN PL
 LAKE CITY, FL 32024

DESIGN DATE:	11/10/2025
REVISION 1:	11/12/2025
REVISION 2:	DATE
DRAWN BY:	TCP
SCALE:	NTS

SHEET:
02

GENERAL NOTES

CONCRETE:


1. CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS.
2. CONCRETE MONOLITHIC SLAB DESIGN IS BASED ON A MINIMUM SOIL BEARING CAPACITY OF 2500 PSF.
3. ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE.
4. WHERE CONCRETE SPECIFICATIONS ARE REQUIRED, BY ONE OR MORE REGULATORY AGENCY, THE FOLLOWING SPECIFICATIONS ARE APPLICABLE:
 - a. CONCRETE SHALL CONFORM TO ASTM C94 FOR THE FOLLOWING COMPONENTS:
 - i. PORTLAND CEMENT TYPE 1 - ASTM C 150
 - ii. AGGREGATES - LARGE AGGREGATE 3/4 MAX. - ASTM C 33
 - iii. AIR ENTRAINING +/- 1% - ASTM C 260
 - iv. WATER REDUCING AGENT - ASTM C 494
 - v. CLEAN POTABLE WATER
 - vi. OTHER ADMIXTURES NOT PERMITTED
 - b. CONCRETE SLUMP AT DISCHARGE CHUTE NOT LESS THAN 3" OR MORE THAN 5". WATER ADDED AFTER BATCHING IS NOT PERMITTED.
 - c. PREPARE & PLACE CONCRETE PER AMERICAN CONCRETE INSTITUTE MANUAL OF STANDARD PRACTICE, PART 1, 2, & 3 INCLUDING HOT WEATHER RECOMMENDATIONS.
 - d. MOIST CURE OR POLYETHYLENE CURING PERMITTED.
 - e. PRIOR TO PLACING CONCRETE, TREAT THE ENTIRE SUBSURFACE AREA FOR TERMITES IN COMPLIANCE WITH THE BUILDING CODE (FOR RISK CATEGORY II, III, & IV STRUCTURES ONLY).
 - f. CONCRETE SLAB SHALL BE PLACED OVER A MIN. 6 MIL POLYETHYLENE VAPOR BARRIER (SLAB ONLY).
5. CONTROL JOINTS SHALL BE PROVIDED AT EVERY 12' O.C. OR 18' O.C. FOR 4" THICK OR 6" THICK CONCRETE SLAB RESPECTIVELY.

REINFORCING STEEL:



1. THE REINFORCING STEEL SHALL BE ASTM A615 GRADE 60. THE SLAB REINFORCEMENT SHALL BE WELDED WIRE FABRIC MEETING ASTM A185 OR FIBERGLASS FIBER REINFORCEMENT.
2. REINFORCEMENT MAY BE BENT IN THE FIELD OR SHOP AS LONG AS:
 - a. IT IS BENT COLD;
 - b. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT;
 - c. THE DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS NOT LESS THAN SIX-BAR DIAMETERS.
3. FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE PER ACI-318: 3 INCHES WHERE THE CONCRETE IS POURED AGAINST AND TEMPORARY IN CONTACT WITH THE EARTH OR UNPROTECTED FROM THE EARTH OR WEATHER, OTHERWISE 1-1/2 INCHES.

FROST PROTECTION:

1. FOUNDATION SHALL BE PROTECTED AGAINST FROST USING RIGID FOAM INSULATION (EPS OR EQUIVALENT). FOR NO FROST PROTECTION OPTION, COORDINATE WITH LOCAL BUILDING CODE AND/OR BUILDING OFFICIAL REGARDING REQUIRED FOOTING DEPTH BASED ON FROST LINE DEPTH.

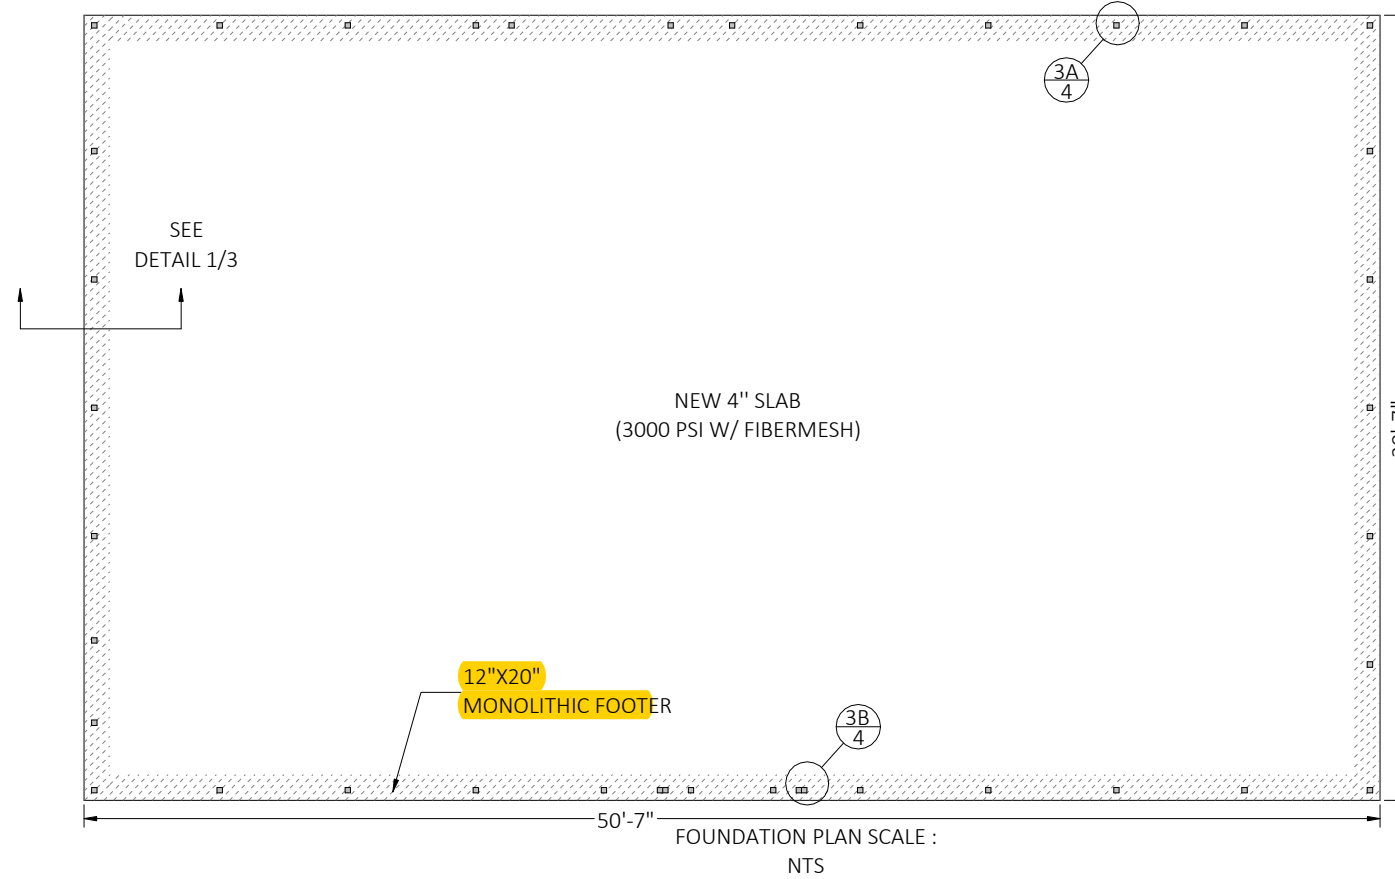


This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

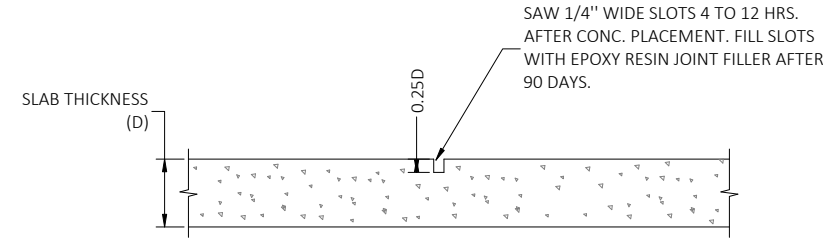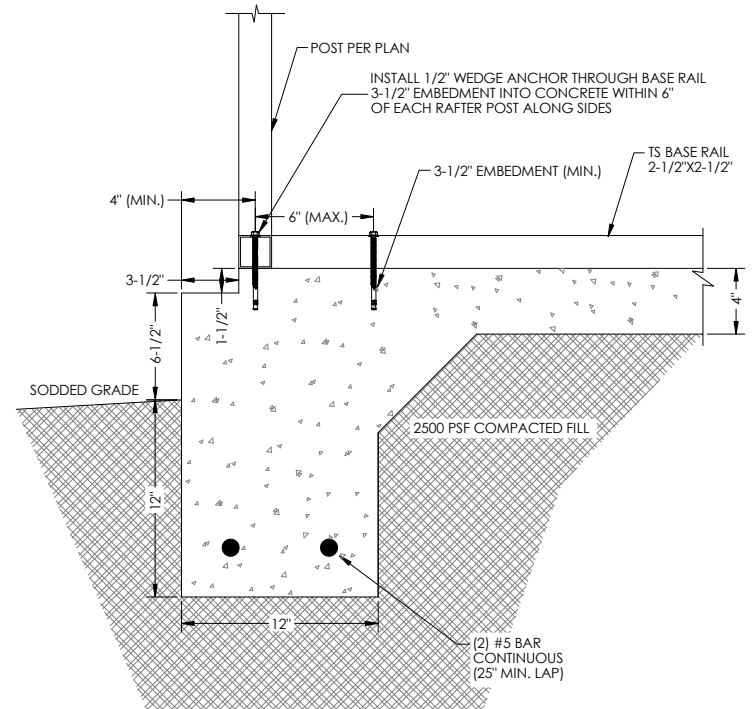

1 12'X20" MONO. FOOTER BASE RAIL ANCHORAGE SCALE: NTS

CONTROL JOINT DETAIL SCALE: NTS

FLORIDA ENGINEERING LLC
 4161 TAMiami TRAIL, UNIT 101
 PORT CHARLOTTE, FLORIDA 33952
 (941) 391-5980
 FLEng.com
 Orders@FLEng.com
 CA CERT. #30782




PROJECT NO. 2530311-R


CONTRACTOR:
TUBULAR BUILDING SYSTEMS
 P.O. BOX. 2254
 LAKE CITY, FL 32056

PROJECT ADDRESS:
GREENLEE
 132 SW EGLIN PL
 LAKE CITY, FL 32024


DESIGN DATE:	11/10/2025
REVISION 1:	11/12/2025
REVISION 2:	DATE
DRAWN BY:	TCP
SCALE:	NTS

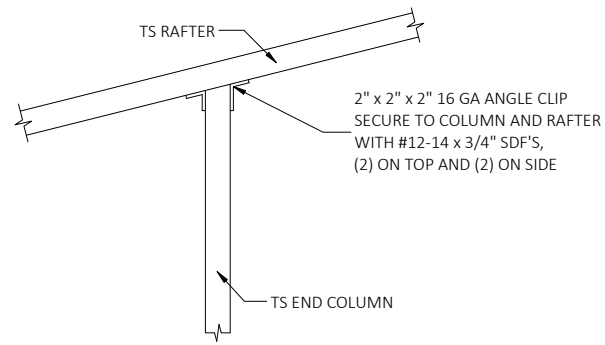

2 END POST/RAFTER CONNECTION DETAIL
SCALE: NTS

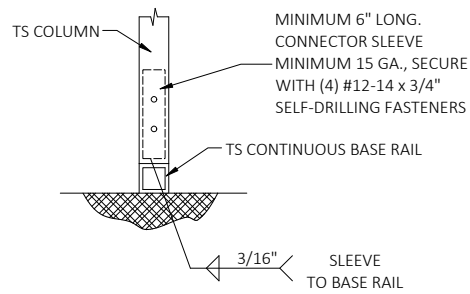


3A RAFTER POST/BASE RAIL CONNECTION DETAIL
SCALE: NTS

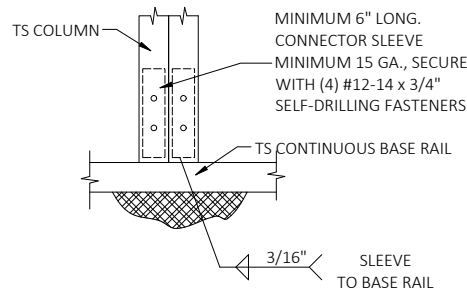


3B RAFTER POST/BASE RAIL CONNECTION DETAIL
SCALE: NTS


This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

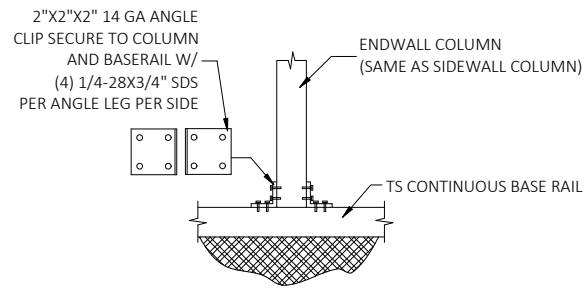


3C ENDWALL COLUMN/BASE RAIL CONNECTION DETAIL
SCALE: NTS

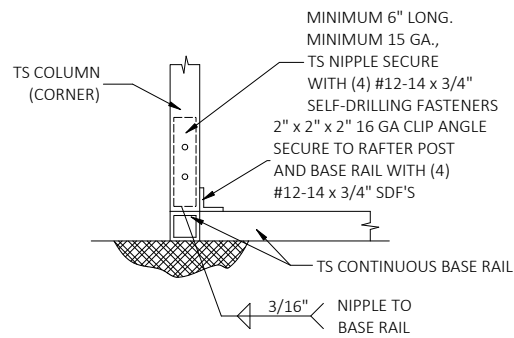


4 END POST/BASE RAIL CONNECTION DETAIL
SCALE: NTS

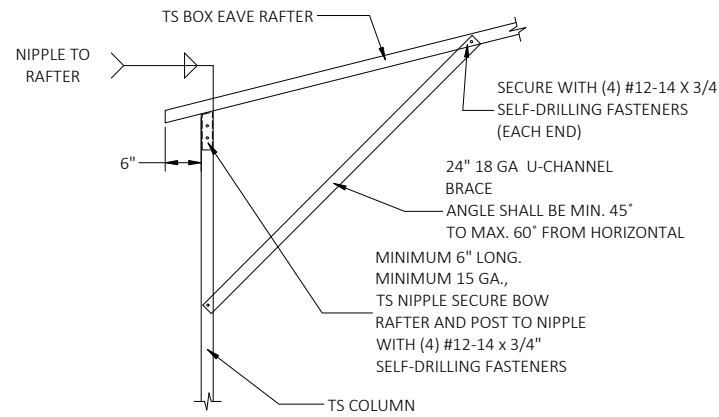


5 BOX EAVE RAFTER/CORNER POST CONNECTION DETAIL
SCALE: NTS

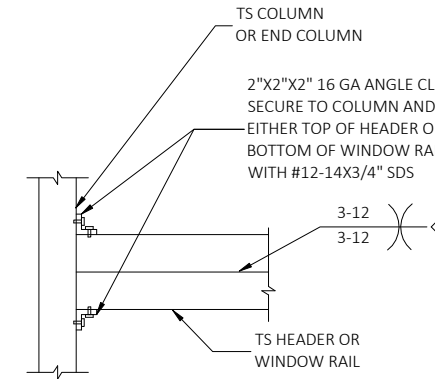


6 DOUBLE HEADER TO COLUMN CONNECTION DETAIL
SCALE: NTS

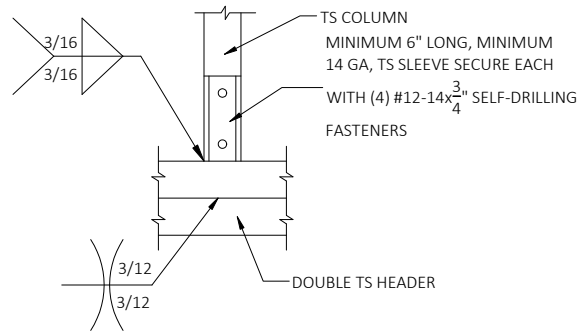


7 COLUMN/DOUBLE HEADER CONNECTION DETAIL
SCALE: NTS

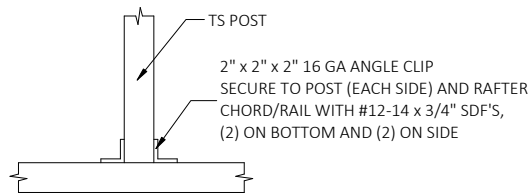


8 POST TO NON-STRUCTURAL HEADER, BASE, RAIL OR WINDOW RAIL CONNECTION DETAIL
SCALE: NTS

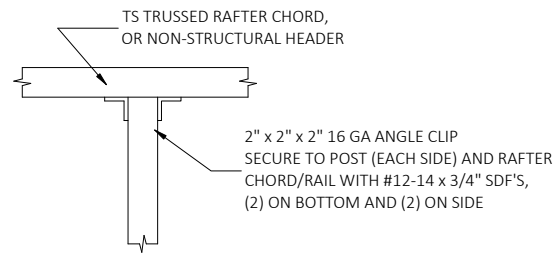


9 POST TO NON-STRUCTURAL HEADER, BASE, RAIL OR WINDOW RAIL CONNECTION DETAIL
SCALE: NTS

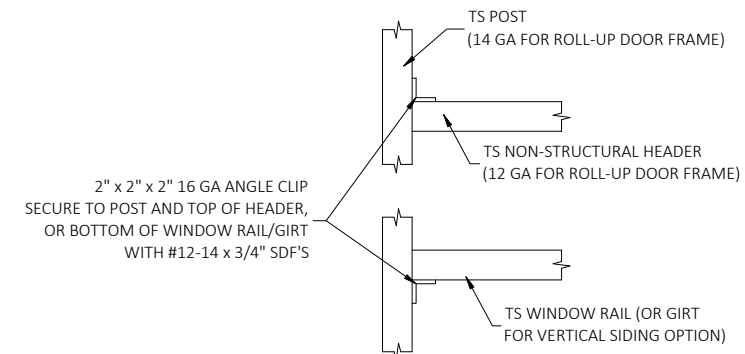


10 NON-STRUCTURAL HEADER OR WINDOW RAIL TO POST CONNECTION DETAIL
SCALE: NTS




11 COLLAR-TIE CONNECTION
SCALE: NTS

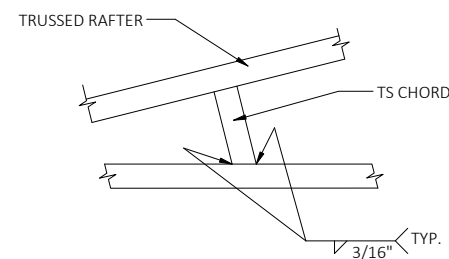

12 CHORD/RAFTER CONNECTION DETAIL
SCALE: NTS

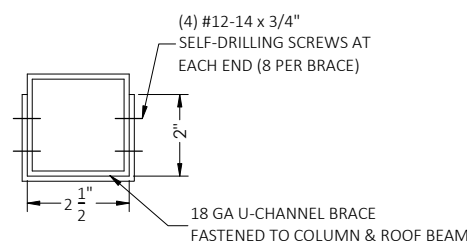


13 BRACE SECTION
SCALE: NTS

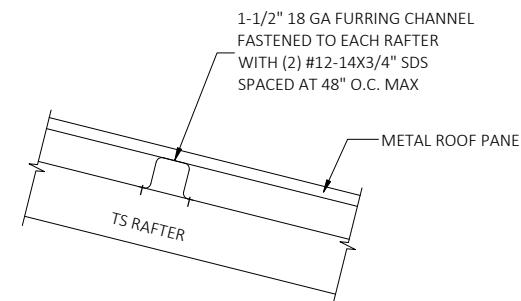

14 PANEL ATTACHMENT (ALTERNATE FOR VERTICAL ROOF PANELS)
SCALE: NTS

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CONTRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

PROJECT ADDRESS:
GREENLEE
132 SW EGLIN PL
LAKE CITY, FL 32024

PROJECT NO. 2530311-R

CA CERT. #30782

DESIGN DATE:	11/10/2025	SHEET:
REVISION 1:	11/12/2025	
REVISION 2:	DATE	04
DRAWN BY:	TCP	
SCALE:	NTS	