

SABO STRUCTURAL ENGINEERING
 CA#32529
 235 9TH AVE N
 JAX BEACH, FL 32250
 904-712-5750
 CHRIS@SABOENG.COM

PLAN NAME	OXLEY RESIDENCE
ISSUE	DATE
PERMIT	XXXXXX
REVISIONS	DATE

ISSUE	DATE
PERMIT	XXXXXX
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR OXLEY RESIDENCE

FIELD ALTERATION
 CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

DESIGN CRITERIA AND GENERAL NOTES

DESIGN SPECIFICATIONS


DESIGN CODE:
 2023 FLORIDA BUILDING CODE - RESIDENTIAL
DESIGN IS VOID ONE YEAR AFTER THE DATE OF THE ORIGINAL PLANS, UNLESS PLANS HAVE BEEN REVIEWED FOR CODE COMPLIANCE.
DESIGN LOADS: ACTUAL AND UNIFORM

ROOF	FLOOR
(per 1225)	(per 1200)
TOP CHORD LIVE LOAD	20 psf
TOP CHORD DEAD LOAD	7 psf (ARCH SHINGLES)
TOP CHORD DEAD LOAD	20 psf (TILE SHINGLES)
BOTTOM CHORD LIVE LOAD	10 psf
BOTTOM CHORD DEAD LOAD	5 psf

WIND LOADING:
 ASCE 7/22 FOR WIND UPLIFT, TRUSSES SHALL BE DESIGNED WITH A MIN. ASCE LOAD CONDITION OF 5 PSF TOP CHORD AND 5 PSF BOTTOM CHORD. REACTIONS CALCULATED FOR THE BEARING POINTS OF ROOF TRUSSES SHALL BE REDUCED, SPECIFICALLY, AT/FLOOR LIVE LOADS COMBINED WITH ROOF LIVE LOADS SHALL BE MULTIPLIED BY 0.75 WHEN COMBINED w/ DEAD LOAD.

TRIBUTARY AREA (sf)	INTERIOR		EDGE STRIP (PSF): 'a' = 5'-6"	
	+25.5	-27.7	+25.5	-34.2
10				
50	+22.9	-25.0	+22.9	-28.8
100	+21.8	-23.2	+21.8	-26.5

THE VALUES ABOVE ARE ALLOWABLE WIND PRESSURE VALUES (ASD). THE ABOVE WIND PRESSURES HAVE BEEN REDUCED BY 0.60 AS PERMITTED BY THE ALLOWABLE STRESS DESIGN METHODOLOGY. NO FURTHER REDUCTION SHALL BE PERMITTED.

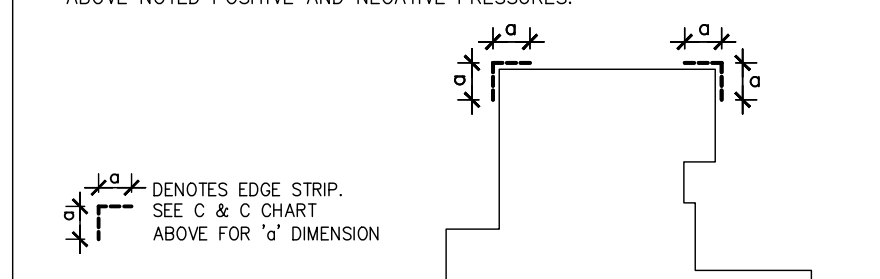

MATERIAL SPECIFICATIONS

HARDWARE AND ANCHORS:
ANCHOR BOLTS & THREADED ROD: SHALL BE IN ACCORDANCE WITH ASTM A 307 OR ASTM F 1554 GRADE 36
WASHERS: SHALL BE IN ACCORDANCE WITH ASTM A 500 (GRADE B)
NUTS: SHALL BE IN ACCORDANCE WITH ASTM A 563 GRADE A HEX
METAL CONNECTORS: ALL METAL CONNECTORS WHICH ARE EXPOSED TO EXTERIOR SHALL BE GALVANIZED.
REINFORCING STEEL: SHALL BE ASTM A 615, GRADE 60.
STRUCTURAL STEEL: SHALL BE ASTM A 992, GRADE 50.
WELDED WIRE FABRIC (W/WF): SHALL BE ASTM A 655.
LAMINATED VENER LUMBER (LVL): ALL LAMINATED VENER LUMBER SHALL MEET OR EXCEED THE FOLLOWING DESIGN PROPERTIES - ELASTIC MODULUS (E): 1,900ksi, BENDING STRESS (Fb) 2600psi

SCOPE OF SERVICE

MEANS AND METHODS:
 THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE FOR ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

GENERAL NOTES & CONSTRUCTION SPECIFICATIONS

FLOOR SHEATHING SPECIFICATIONS:
 23/32" T&G OSB OR PLYWOOD SHEATHING, GLUE AND NAIL WITH 10d COMMON @ 6" O.C. EDGE & FIELD

ROOF SHEATHING SPECIFICATIONS:
 SINGLE - MIN. 15/32", 32/16, APA RATED OSB OR PLYWOOD SHEATHING, NAILED w/ 0.131x2" RING SHANK NAILS @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE).
 TILE - MIN. 15/32" 32/16, APA RATED PLYWOOD SHEATHING, NAILED w/ 0.131x2" RING SHANK @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE).
 METAL - MIN. 1/2", 24/16, APA RATED PLYWOOD SHEATHING, NAILED w/ 0.131x2 1/2" RING SHANK NAILS @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" WITHIN 4'-0" OF ROOF EDGE).

WALL SHEATHING SPECIFICATIONS:
 FLEXIBLE FINISH - MIN. 7/8", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, FASTENED w/ 8d @ 6" O.C. EDGE AND 6" O.C. FIELD. SHEATHING SHALL EXTEND FULL HEIGHT FROM BOTTOM PLATE TO UPPER TOP PLATE. FLEXIBLE FINISH WALLS INCLUDE: WOOD, CEMENT, OR VINYL SIDING, HARDI PANEL & BRICK. ALL OTHER WALL SHALL BE CONSIDERED BRITTLE FINISH.
 STUCCO FINISH - MIN. 7/8", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, FASTENED w/ 8d @ 6" O.C. EDGE AND 6" O.C. FIELD. SHEATHING SHALL ORIENTED WITH THE LONG DIMENSION PERPENDICULAR TO THE STUDS. CONTRACTOR MAY USE 3/8" STRUCTURAL 1 GRADE SHEATHING OR 1/2" OSB SHEATHING AND ORIENT THE PANELS VERTICALLY.

MASONRY SPECIFICATIONS:
 MASONRY HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 530-05, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 531-05. GROUT SHALL BE IN ACCORDANCE WITH ASTM C476 WITH A MINIMUM OF 28 DAY COMPRESSIVE STRENGTH OF 2000 PSI PER ASTM C1019. GROUT SHALL HAVE A MAXIMUM COURSE AGGREGATE SIZE OF 3/8" PLACED AT AN 8" TO 11" SLUMP. MORTAR SHALL CONFORM TO ASTM C270 AND TYPE M OR S. TYPE N MORTAR MAY BE USED IN BRICK VENEER. CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL FLASHING.

CONCRETE MASONRY UNITS (CMU):
 CMU SHALL BE IN ACCORDANCE WITH ASTM C90-75, HOLLOW LOAD-BEARING (CMU), TYPE 1, GRADE N-1, NORMAL WEIGHT, WITH A MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI (f'm=1900 psi). GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT IN 5'-0" MAXIMUM LIFTS PROVIDE CLEANOUTS PER ACI 530.1-02 IN THE BOTTOM OF COURSE OF MASONRY WHEN THE WALL HEIGHT EXCEEDS 5'-0".

MASONRY STEM WALLS: ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90E, E GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. WALL COURSING SHALL BE RUNNING BONDS, STACK BOND SHALL NOT BE USED. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI FEA ROCK CONCRETE GROUT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT WITH #4 @ 4'-0" O.C. MAX. AND AT EACH CORNER, WALL END, AND WALL INTERSECTIONS. PROVIDE CONTINUITY OF PERPENDICULAR MASONRY ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. AT STEM WALL CONSTRUCTED OF 5 OR MORE COURSES, PROVIDE HORIZONTAL JOINT REINFORCEMENT AT 16" O.C. VERTICALLY, (EVERY OTHER COURSE), AND VERTICAL REINFORCING SHALL BE A MINIMUM OF 6".

CONCRETE SPECIFICATIONS:
 ALL CONCRETE HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 318-08, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 301. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS. CONCRETE AT GARAGE AND PORCH SLABS SHALL HAVE A COMPRESSIVE STRENGTH OF 3000 PSI.

GENERAL NOTES:
FOOTING AND FOUNDATIONS: FOOTINGS SHALL BE IN ACCORDANCE WITH LOCAL BUILDING CODES. FOOTING HAVE BEEN DESIGNED WITH A SOIL BEARING (DESIGN MAXIMUM) OF 2000 PSF. A SOILS INVESTIGATION REPORT IS RECOMMENDED TO VERIFY SUITABLE SUBSURFACE CONDITIONS. IF THE FOOTING ELEVATIONS SHOWN OCCUR IN A DISTURBED OR UNSTABLE SOIL, THE ENGINEER SHALL BE NOTIFIED. SOIL SHALL BE FREE OF ORGANIC MATERIAL AND COHESIVE (CLAY) SOILS. SOIL COMPACTION AND FILL SHALL BE COMPACTED TO A MIN. OF 95% MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557.
 FOUNDATION PLAN ONLY CONVEYS STRUCTURAL INFORMATION. FOR GENERAL FEATURES, CONDUITS, ELECTRICAL EMBEES, STEP HEIGHTS, ETC., SEE ARCHITECTURAL PLANS. DO NOT SCALE FOOTING DIMENSIONS AND LOCATION FROM THE FOUNDATION PLAN SHOWN ON S1.0. DO NOT DETERMINE FOOTING LOCATION BASED ON EITHER THE ARCHITECTURAL PLAN OR FRAMING PLAN, BUT BY DIMENSIONS PROVIDED ON FOUNDATION PLAN. IF FOOTING SIZE OR LOCATION IS NOT DETERMINED ON PLAN THEN CONTACT ENGINEER OF RECORD (EOR).
 UNLESS OTHERWISE NOTED ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 3" IN FOOTINGS AND MESH SHALL BE CENTERED IN SLAB ON GRADE. IN ALL CONTINUOUS FOOTINGS PROVIDE #3 @ 48" O.C. OR ROD CHAIRS. PROVIDE CONTINUITY OF REINFORCING AT INTERSECTIONS OF PERPENDICULAR CONCRETE ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS

CONCRETE SLABS ON GRADE:
 SHALL BE INSTALLED OVER MINIMUM 6 MIL POLYETHYLENE VAPOR RETARDER WITH JOINTS LAPPED 6" AND SEALED OVER CLEAN, COMPACTED EARTH OR FILL WITH APPROVED CHEMICAL SOIL TREATMENT FOR PREVENTION OF SUBTERRANEAN TERMITES. SAWCUTS FOR CONTROLLED CRACKING CUT A 1" SAWCUT INTO SLAB IN A 12"x12" GRID WITHIN 12 HOURS OF CONCRETE PLACEMENT, PROVIDE SAWCUTS THROUGH OUT SLAB CALL EOR FOR ALTERNATIVE METHODS.

WOOD FRAMING SPECIFICATIONS:
 ALL WOOD FRAMING HAS BEEN DESIGNED IN ACCORDANCE WITH NATIONAL DESIGN SPECIFICATIONS (NDS) FOR WOOD CONSTRUCTION, LATEST EDITION. ALL WOOD MEMBERS EXPOSED TO WEATHER OR IN CONTACT WITH MASONRY, CONCRETE OR SOIL SHALL BE PRESURE-TREATED TO ACQ OR NON-DOT BORUATE PRESERVATIVE TREATMENT IS USED, ALL ATTACHED FASTENERS SHALL BE HOT DIPPED GALVANIZED. IF AZCA PRESERVATIVE IS USED, ALL ATTACHED FASTENERS SHALL BE STAINLESS STEEL.

PRE-ENGINEERED WOOD TRUSSES:
 SHALL BE THE SELECTION OF AN ENGINEER IN THE STATE WHERE PROJECT IS BEING BUILT AND SHALL COMPLY WITH NPFA, TPI, AND AITC 100. CONTRACTOR SHALL VERIFY THAT ADEQUATE TRUSS BEARING IS INSTALLED AT ALL TRUSSES AS INDICATED IN THE TRUSS SHOP DRAWINGS. ALL TRUSS-TO-TRUSS CONNECTIONS AND TRUSS PROFILES ARE THE RESPONSIBILITY OF THE DELEGATED TRUSS ENGINEER. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER 'COMMENTARY' AND RECOMMENDATION FOR HANDLING, INSTALLING & BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." AT MULTIPLE STRAP CONNECTIONS, SPREAD STRAPS TO AVOID NAILING CONFLICTS THROUGH TRUSS. WHEN USING (2) STRAPS ON SINGLE PLY TRUSSES, PLACE STRAPS DIAGONALLY ACROSS DBL. TOP PLATE FROM EA. OTHER.

WOOD FASTENING SCHEDULE

MEMBERS	CONNECTION TYPE	FASTENER
TOP PLATE TO TOP PLATE	FACE NAIL	2-GUN NAILS @ 12" STAG.
TOP PLATE, LAPS/INTERSECTION	FACE NAIL	(2-16d) 3-GUN NAILS
DBL. TOP PLATE TO STUD	FACE NAIL	(2-16d) 3-GUN NAILS
RIM JOIST TO TOP PLATE	TOE NAIL	(8d @ 6") GUN NAIL @ 6"
CEILING JOIST TO TOP PLATE	TOE NAIL	(3-8d) 5-GUN NAILS
CEILING JOIST, OVER PARTITIONS	FACE NAIL	(3-16d) 4-GUN NAILS
CEILING JOIST TO ROOF RAFTER	FACE NAIL	(6-16d) 8-GUN NAILS
JOIST/TRUSS TO PLATE	TOE NAIL	(2-16d) 3-GUN NAILS
RAFTER TO PLATE	TOE NAIL	(3-8d) 3-GUN NAILS
JACK RAFTER TO HIP	TOE NAIL	(3-10d) 4-GUN NAILS
ROOF RAFTER TO 2x RIDGE BM.	TOE NAIL	(2-16d) 3-GUN NAILS
CONT. HEADER, TWO PIECES	FACE NAIL	16d @ 16" O.C. @ EDGE
CONT. HEADER TO STUD	TOE NAIL	(3-16d) 4-GUN NAILS
STUD TO SOLE PLATE	TOE NAIL	(3-16d) 4-GUN NAILS
SOLE PLATE TO JOIST/BLOCKING	FACE NAIL	(16d @ 16") GUN NAIL @ 8"

BRICK NOTES / LINTEL SCHED

LINTEL DIMENSION	MIN. BRG.	MAX. SPAN
1.3 1/2 x 3 1/2 x 1/4	4"	6'-0"
1.4 x 3 1/2 x 1/4	6"	8'-0"
1.5 x 3 1/2 x 1/4	6"	10'-0"
1.6 x 3 1/2 x 1/4	6"	12'-0"
1.7 x 3 1/2 x 1/4	6"	16'-0"

USP CONNECTORS

CONNECTOR	UPLIFT		FASTENERS	FL# CODE
	SYP	SPF		
USP A35	450	450	(9)10dX1 1/2"	
USP RT7	585	495	(5)8d EA. END	
USP RT8A	775	650	(5)10dX1 1/2" EA. END	
USP MTW12	1195	860	(7)10dX1 1/2" EA. END	
USP HTW20	1450	1245	(12)10dX1 1/2" EA. END	
USP MSTA24	1640	1455	(9)10d EA. END	
USP MSTA36	2065	2065	(13)10d EA. END	
USP LITS208	1105	1105	1/2" ROD TO FTG.	
USP JUS28	1305	1305	(6)10d TO HEADER	
USP HTT16	4290	4290	3/4" ROD TO FTG.	
USP HTT22	5370	5370	3/4" ROD TO FTG.	
USP PAU44	2535		3/4" ROD w/ (12)16d	
USP PAU66	2535		3/4" ROD w/ (12)16d	
USP MSTM24	1545	1455	(5)1/2" x 2-1/4" TAPCONS	

SIMPSON CONNECTORS

CONNECTOR	UPLIFT		FASTENERS	FL# CODE
	SYP	SPF		
A35	450	450	12-8dX1 1/2"	10446.4
H2.5T	600	520	5-8d EA. END	11478.3
HTS16	1150	1085	16-10d EA. END	10456.6
MTS12	1000	860	7-10dX1 1/2" EA. END	10456.3
HTS20	1450	1245	24-10dX1 1/2" EA. END	13872.3
MSTA24	1765	1270	9-10d EA. END	13872.4
MSTA36	2050	1870	13-10d EA. END	13872.8
HTT4	3480	3080	18-16d TO TRUSS/BEAM 1-3/4" ROD TO FTG.	11496.2
HTT5	5250	4670	32-16d TO TRUSS/BEAM 1-3/4" ROD TO FTG.	11496.2
LTS28	930	760	6-10d TO HEADER 4-10d TO JOIST	10655.113
HU410	905	785	14-16d TO HEADER 6-16d TO JOIST	10531.36
ABU44	2200		3/4" ROD EPOKID 6" MIN	10849.6
ABU66	2300		3/4" ROD EPOKID 6" MIN	10849.6
SET	N/A	N/A	SIMPSON EPOXY-TIE	11506.4
LT720B	1675	1675	10-16d TO STUD/BEAM/POST 1-1/2" ROD TO FTG.	11496.3
LSTA12	805	695	10-10d	13872.5
CS16	1705	1705	13-8d	10852.1

LIMITS OF STRUCTURAL ENGINEERING DESIGN RESPONSIBILITIES:
 THE ITEMS SPECIFICALLY DESIGNED BY THE STRUCTURAL ENGINEER ARE LIMITED TO THE FOLLOWING: CONTINUOUS LOAD PATH FOR WIND UPLIFT, WOOD PANEL SHEARWALLS, WALL FRAMING AND REQUIRED SHEATHING AND HEADERS DIRECTLY SUPPORTING ROOF FRAMING. ITEMS NOT DESIGNATED PRE-ENGINEERED WOOD FLOOR AND ROOF TRUSSES, FLOOR FRAMING NOT SPECIFICALLY ADDRESSED, TRUSS-TO-TRUSS CONNECTION, AND ANY ARCHITECTURAL, MECHANICAL OR ELECTRICAL SYSTEM.

CONCRETE MASONRY UNITS (CMU):
 CMU SHALL BE IN ACCORDANCE WITH ASTM C90-75, HOLLOW LOAD-BEARING (CMU), TYPE 1, GRADE N-1, NORMAL WEIGHT, WITH A MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI (f'm=1900 psi). GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT IN 5'-0" MAXIMUM LIFTS PROVIDE CLEANOUTS PER ACI 530.1-02 IN THE BOTTOM OF COURSE OF MASONRY WHEN THE WALL HEIGHT EXCEEDS 5'-0".



MASONRY STEM WALLS: ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90E, E GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. WALL COURSING SHALL BE RUNNING BONDS, STACK BOND SHALL NOT BE USED. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI FEA ROCK CONCRETE GROUT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT WITH #4 @ 4'-0" O.C. MAX. AND AT EACH CORNER, WALL END, AND WALL INTERSECTIONS. PROVIDE CONTINUITY OF PERPENDICULAR MASONRY ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. AT STEM WALL CONSTRUCTED OF 5 OR MORE COURSES, PROVIDE HORIZONTAL JOINT REINFORCEMENT AT 16" O.C. VERTICALLY, (EVERY OTHER COURSE), AND VERTICAL REINFORCING SHALL BE A MINIMUM OF 6".

CONCRETE SPECIFICATIONS:
 ALL CONCRETE HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 318-08, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 301. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS. CONCRETE AT GARAGE AND PORCH SLABS SHALL HAVE A COMPRESSIVE STRENGTH OF 3000 PSI.


GENERAL NOTES:
FOOTING AND FOUNDATIONS: FOOTINGS SHALL BE IN ACCORDANCE WITH LOCAL BUILDING CODES. FOOTING HAVE BEEN DESIGNED WITH A SOIL BEARING (DESIGN MAXIMUM) OF 2000 PSF. A SOILS INVESTIGATION REPORT IS RECOMMENDED TO VERIFY SUITABLE SUBSURFACE CONDITIONS. IF THE FOOTING ELEVATIONS SHOWN OCCUR IN A DISTURBED OR UNSTABLE SOIL, THE ENGINEER SHALL BE NOTIFIED. SOIL SHALL BE FREE OF ORGANIC MATERIAL AND COHESIVE (CLAY) SOILS. SOIL COMPACTION AND FILL SHALL BE COMPACTED TO A MIN. OF 95% MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557.
 FOUNDATION PLAN ONLY CONVEYS STRUCTURAL INFORMATION. FOR GENERAL FEATURES, CONDUITS, ELECTRICAL EMBEES, STEP HEIGHTS, ETC., SEE ARCHITECTURAL PLANS. DO NOT SCALE FOOTING DIMENSIONS AND LOCATION FROM THE FOUNDATION PLAN SHOWN ON S1.0. DO NOT DETERMINE FOOTING LOCATION BASED ON EITHER THE ARCHITECTURAL PLAN OR FRAMING PLAN, BUT BY DIMENSIONS PROVIDED ON FOUNDATION PLAN. IF FOOTING SIZE OR LOCATION IS NOT DETERMINED ON PLAN THEN CONTACT ENGINEER OF RECORD (EOR).
 UNLESS OTHERWISE NOTED ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 3" IN FOOTINGS AND MESH SHALL BE CENTERED IN SLAB ON GRADE. IN ALL CONTINUOUS FOOTINGS PROVIDE #3 @ 48" O.C. OR ROD CHAIRS. PROVIDE CONTINUITY OF REINFORCING AT INTERSECTIONS OF PERPENDICULAR CONCRETE ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS

PLAN LEGEND AND ABBREVIATIONS

INTERIOR LOAD BEARING WALL	BUILT-UP POST IN THE WALL
GABLE X-BRACE. SEE DETAIL 10/SO.1	HEADER SIZE, JACK AND KING STUD QUANTITY.
DESIGNATES SHEARWALL. THE HIDDEN LINE DESIGNATES SIDE OF WALL. THE SHEARWALL SHEATHING TO BE APPLIED. 8d @ 3/8" SPACES AT COMMONS @ 3" O.C. EDGE & 6" O.C. "IN THE FIELD"	
ADJ - ADJACENT	LG - LONG MANUF.
BM - BEAM	MONO - MONOLITHIC
BOT - BOTTOM	OC - ON CENTER
BRG - BEARING	OSB - ORIENTED STRAND BOARD
CMU - CONCRETE MASONRY UNIT	PERP - PERPENDICULAR
DBL - DOUBLE	PRE ENG - PRE ENGINEERED
EA - EACH	PSF - POUNDS PER SQUARE FOOT
EE - EACH END	EQ - EQUAL
EOR - ENGINEER OF RECORD	REIN - REINFORCE
EQ - EQUAL	REIN - REINFORCE
EXT - EXTERIOR	RF - FLORIDA BUILDING CODE
FDN - FOUNDATION	FTN - FOUNDATION
FT - FOOT	FT - FOOTING
HTD - HORIZONTAL	HDR - HEADER
HTD - HORIZONTAL	HORIZ - HORIZONTAL
HTD - HORIZONTAL	VERT - VERTICAL
HTD - HORIZONTAL	WF - WELDED WIRE FABRIC

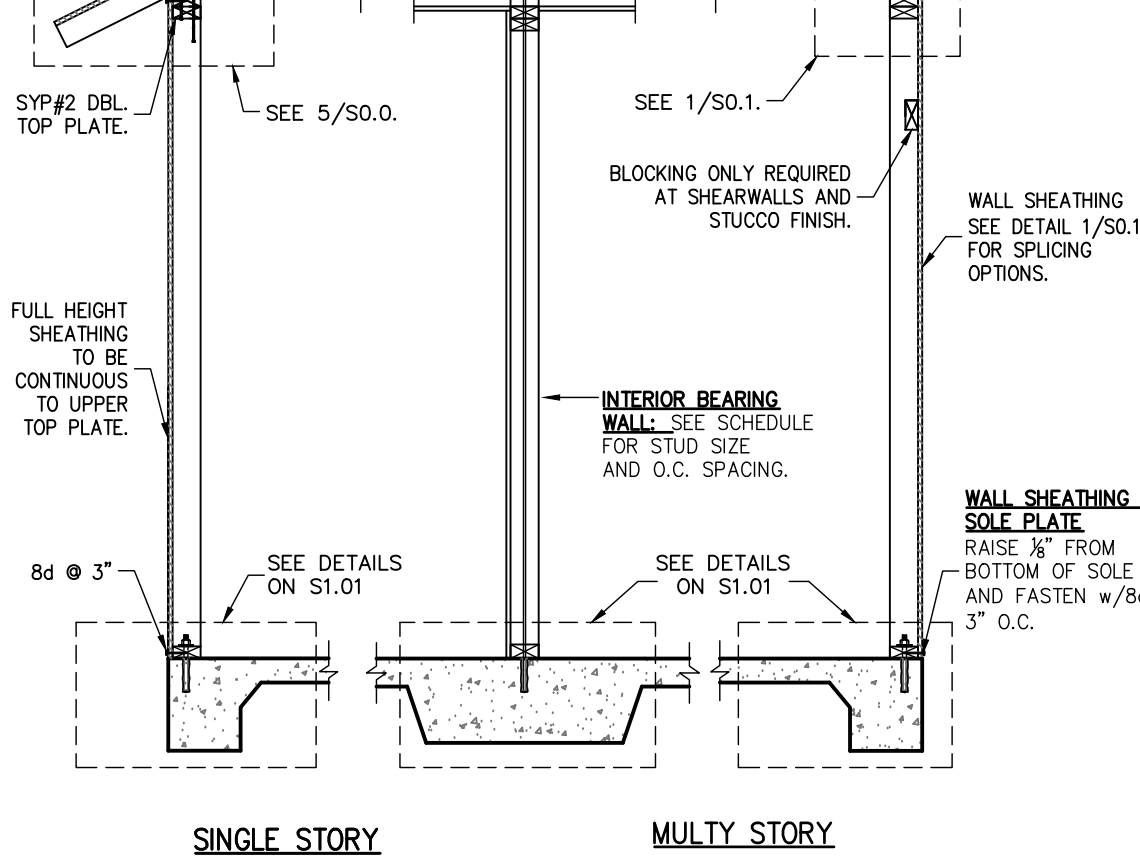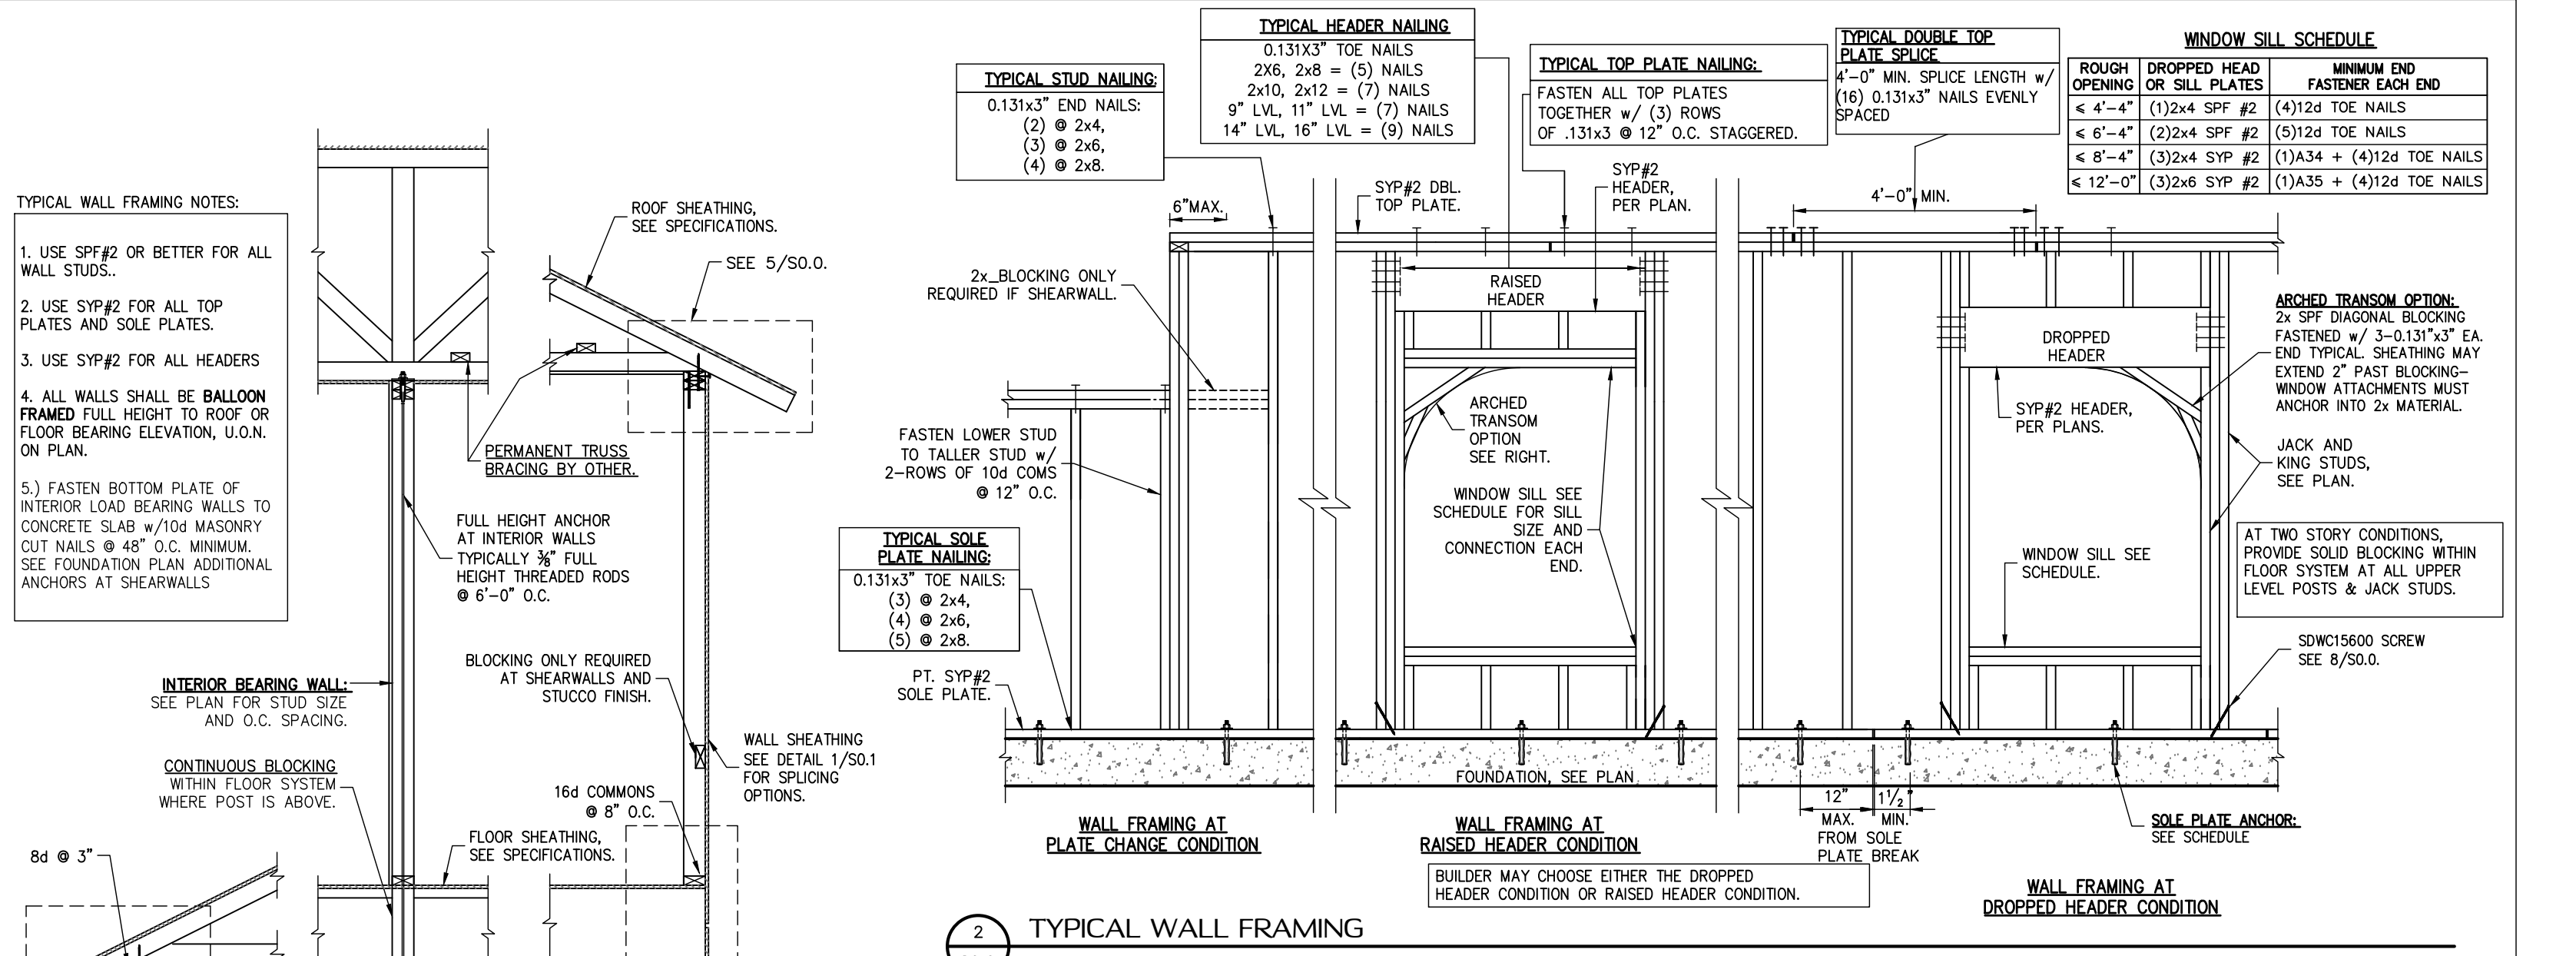


TYP. WALL SECTIONS

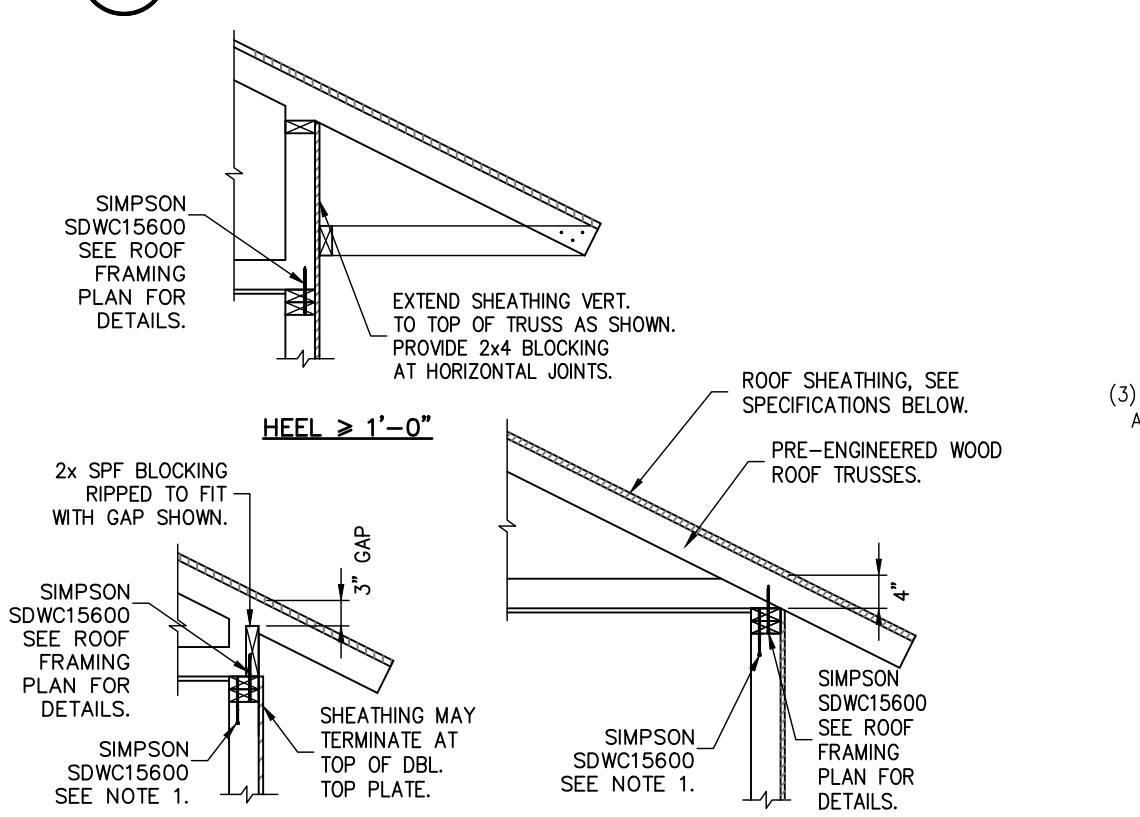


SOLE PLATE ANCHOR DETAIL & SCHEDULE

ANCHOR	EXT. WALL SPACING	SHEARWALLS	WASHER SPEC.	EMBEDMENT DEPTH	MIN. EDGE DISTANCE
TITEN HD	42"	24"	2x2x1/8"	3x3x0.229"	4"
EPOXY	42"	24"	2x2x1/8"	3x3x0.229"	4"
L-BOLT	42"	24"	2x2x1/8"	3x3x0.229"	7"


ROOF TRUSS CONNECTION

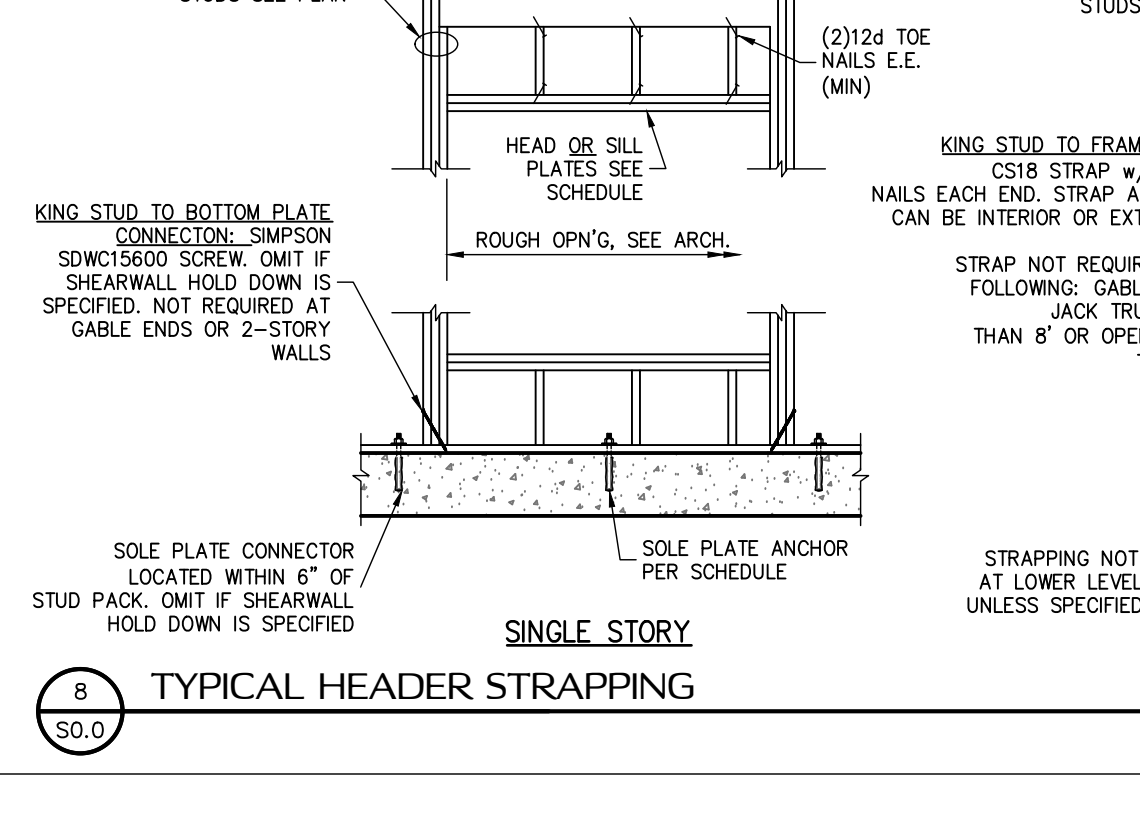


BUILT-UP MEMBER FASTENING

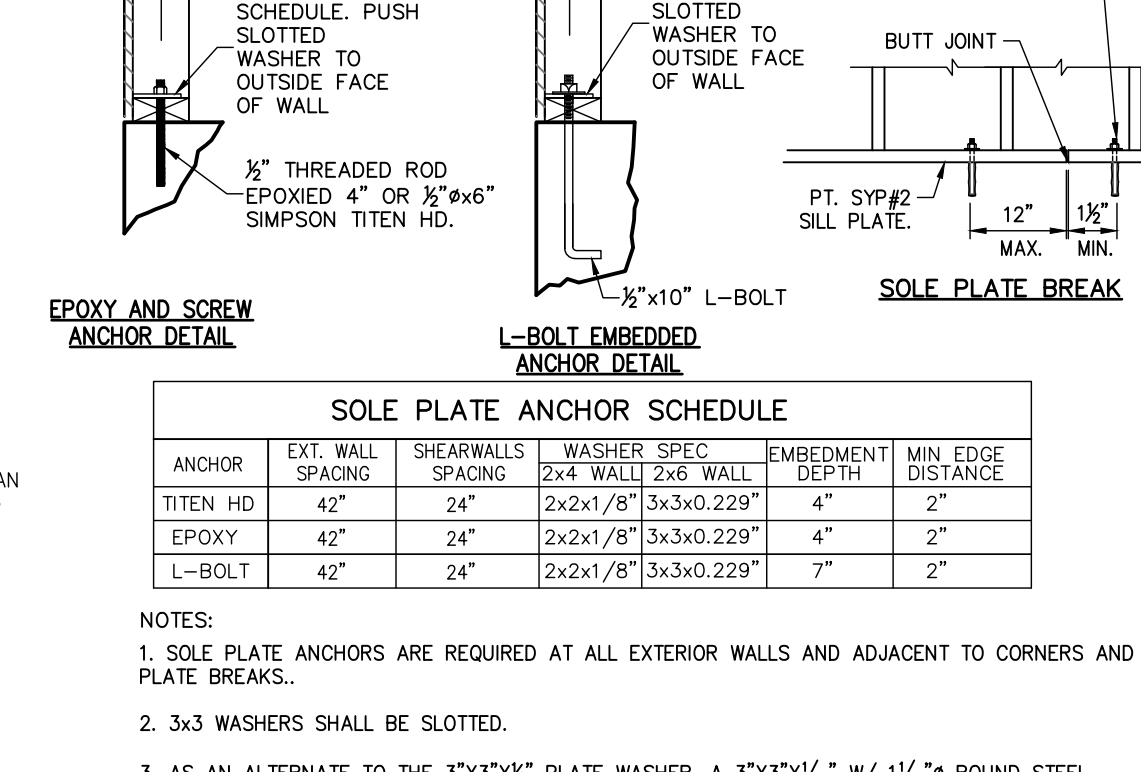


FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

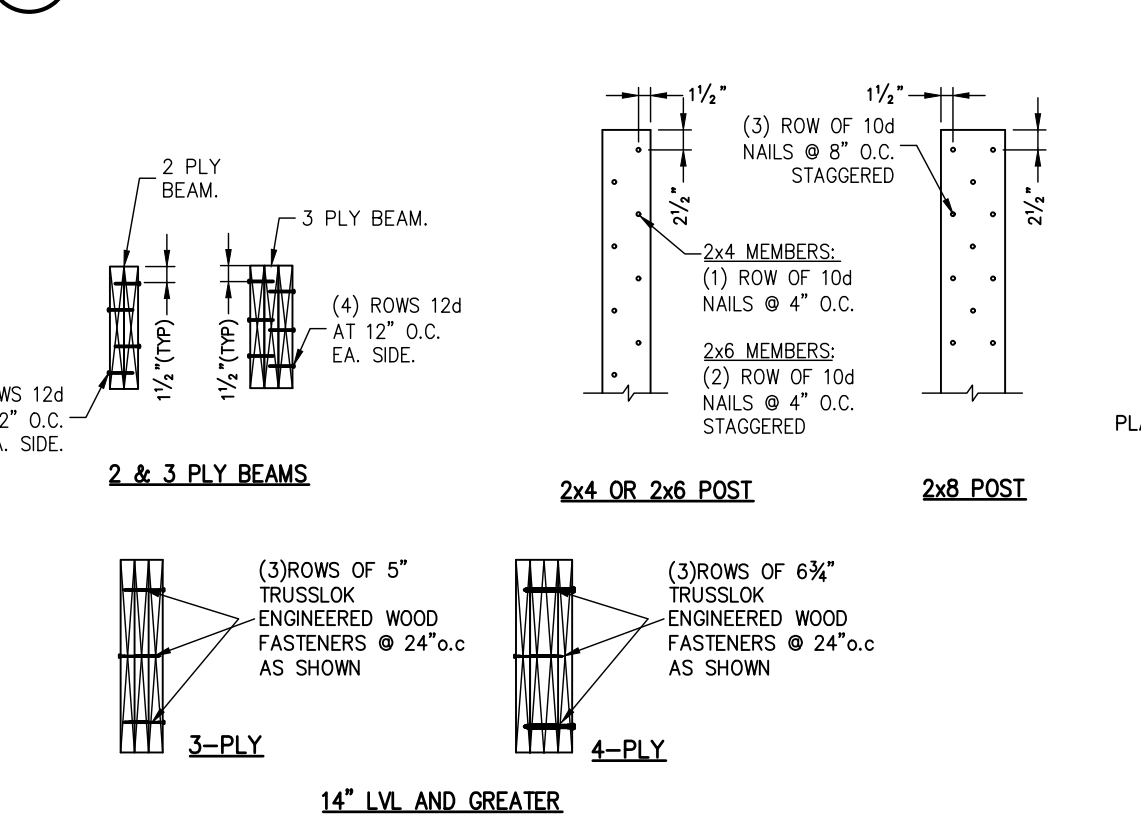


FRAMED WALL CORNER AND INTERSECTIONS STUDS CONFIGURATIONS

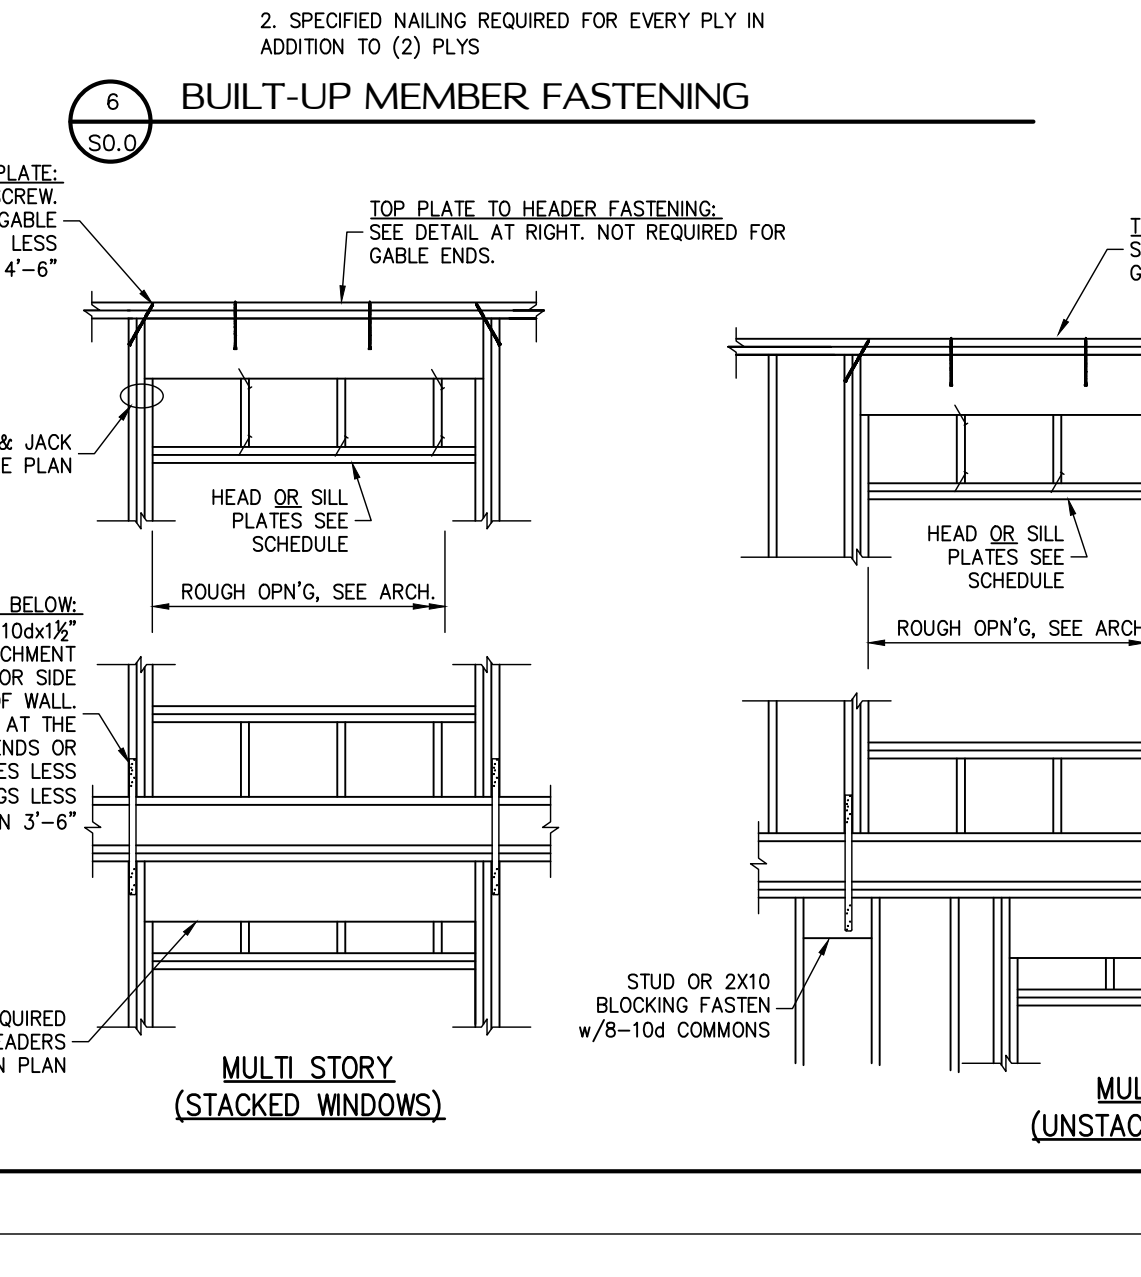


ROOF AND FLOOR SHEATHING NAILING

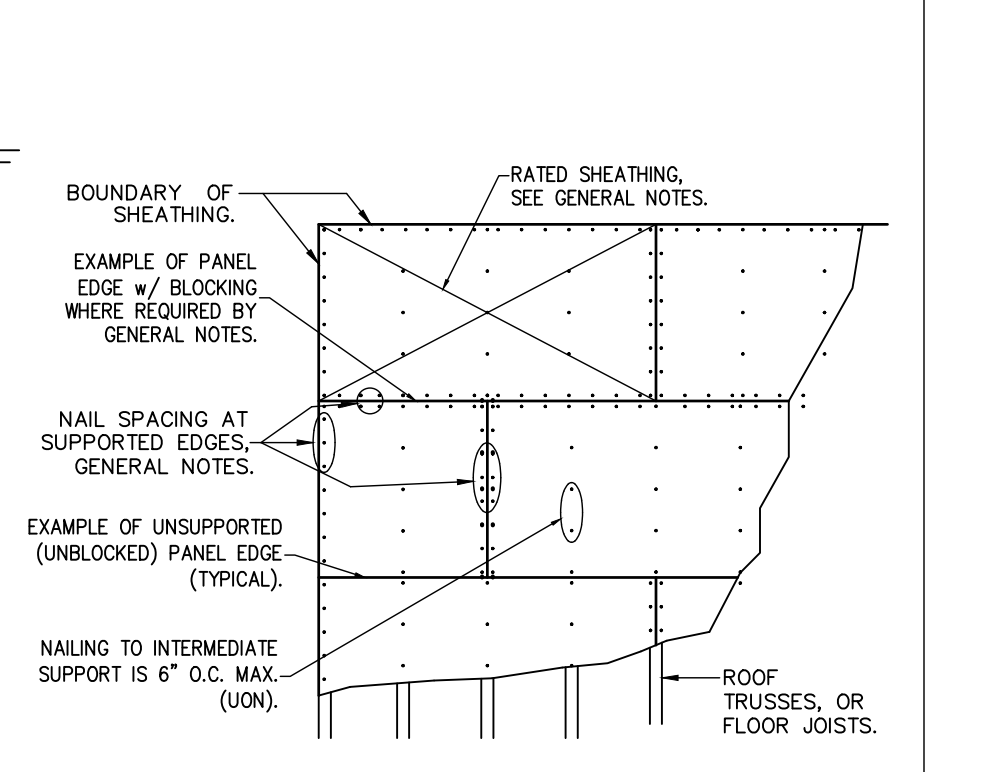


ROOF AND FLOOR SHEATHING NAILING

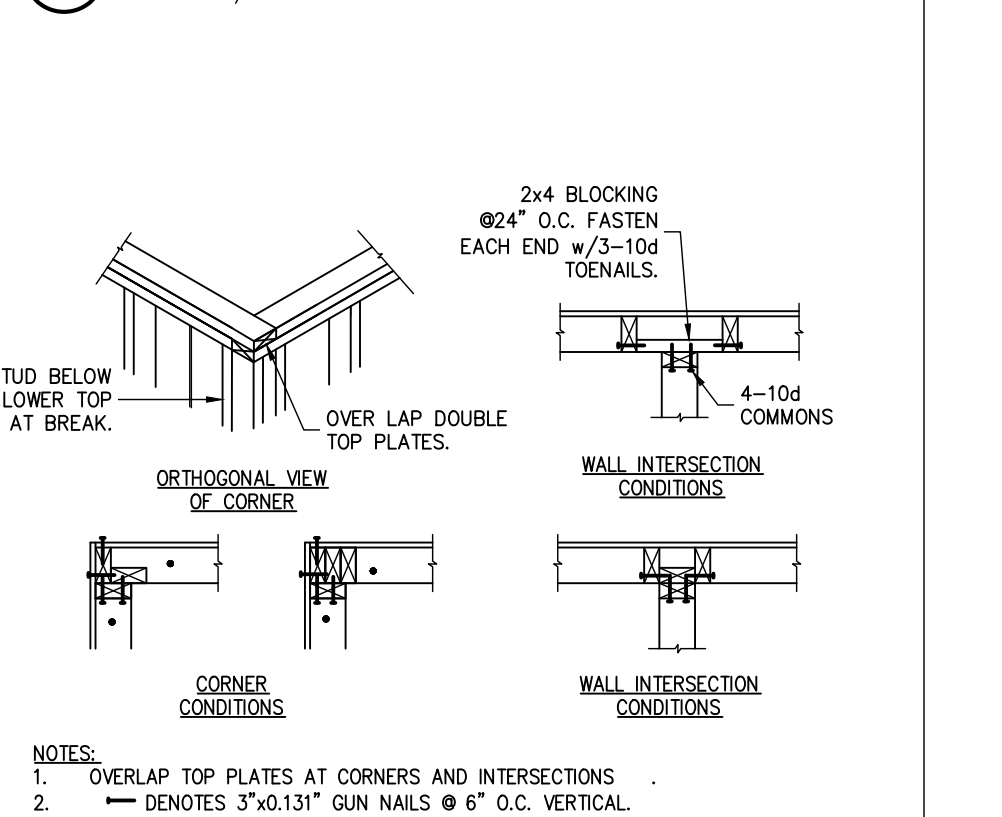

ROOF AND FLOOR SHEATHING NAILING

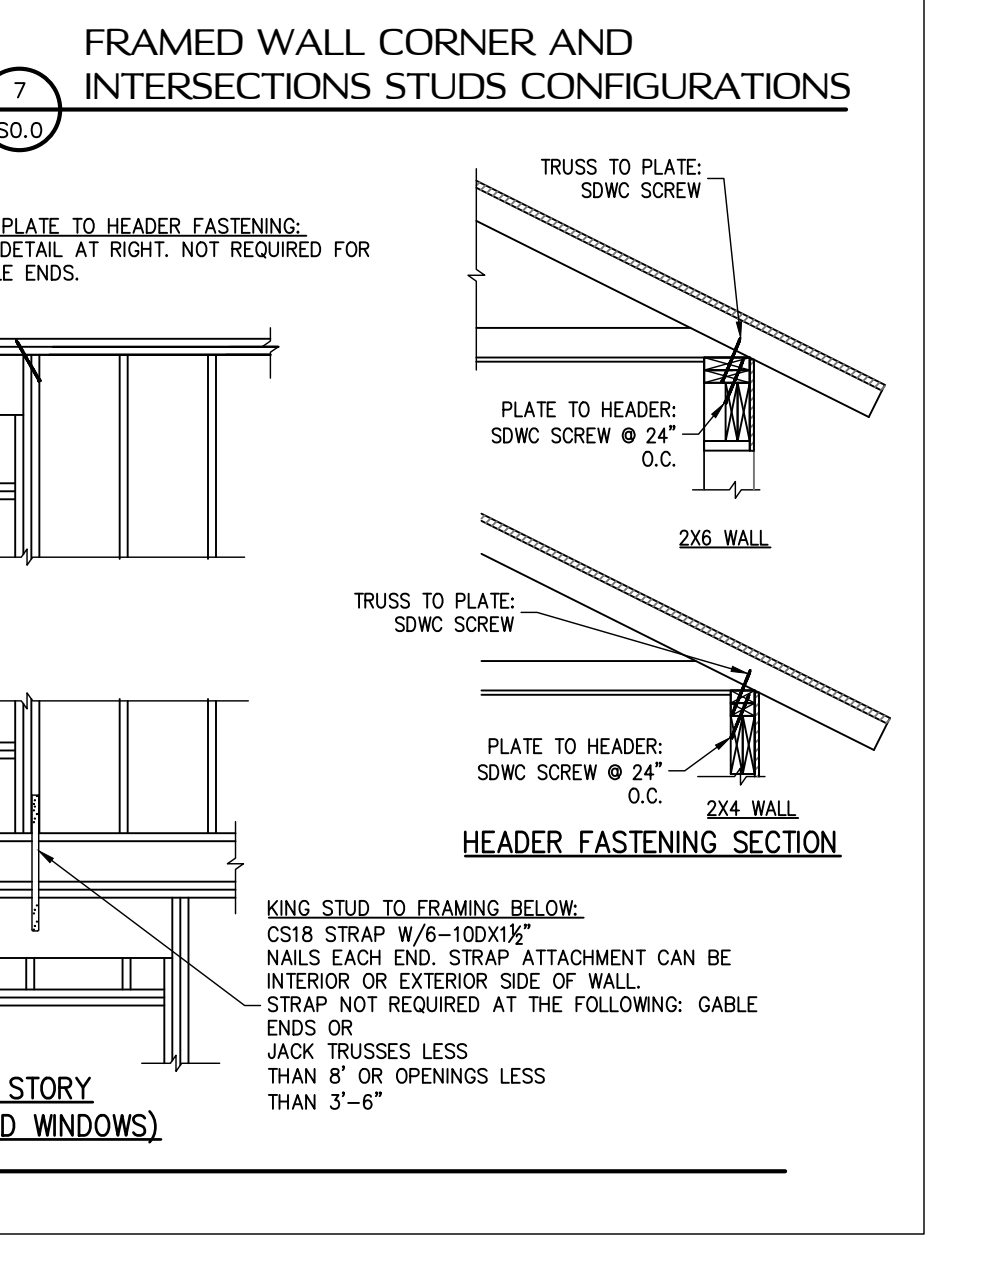

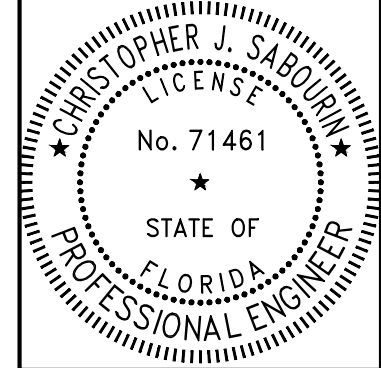

Christopher J. Sabourin
FL PE #71461

CHRISTOPHER J. SABOURIN STATE OF FLORIDA, PROFESSIONAL ENGINEER, LICENSE NO. 71461.

THIS DOCUMENT HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY CHRISTOPHER J. SABOURIN, PE ON 04/17/2025. A SHA AUTHENTICATION CODE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SHA AUTHENTICATION CODE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
OXLEY RESIDENCE
SSE No.
26-0103

ISSUE DATE
PERMIT XXX,XXX
REVISIONS DATE

ISSUE DATE
PERMIT XXX,XXX
REVISIONS DATE


STRUCTURAL ENGINEERING FOR
OXLEY RESIDENCE

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER J. SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE P.E.


TYPICAL FRAMING DETAILS

SHEET
S0.1
SHEET 2 OF 7

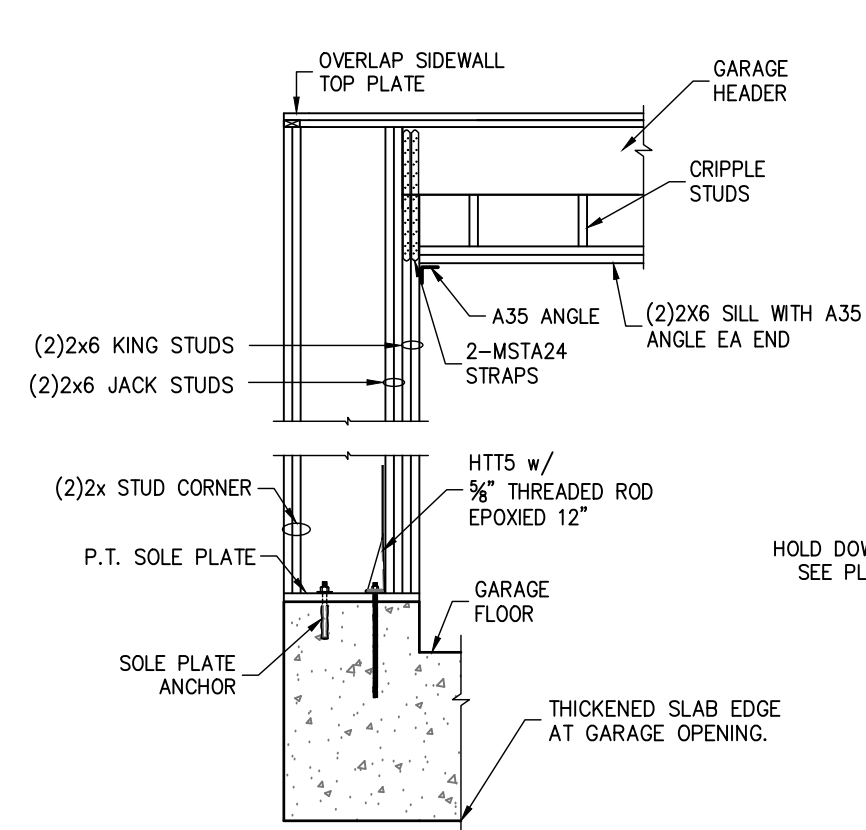


GARAGE WING WALL ELEVATION
GARAGE WING WALL SECTION


1 WHEN NOTED S0.1
GARAGE HEADER FRAMING
SCALE: N.T.S.

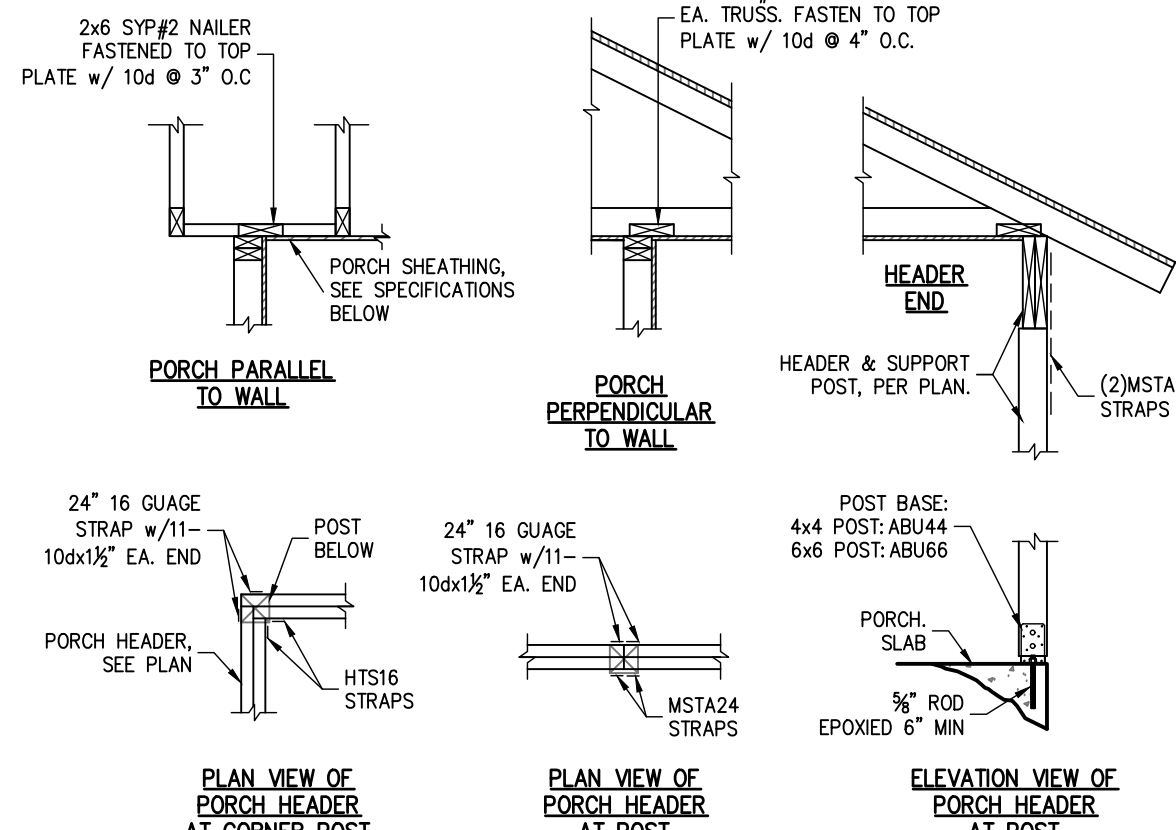







2 TYPICAL PORCH FRAMING DETAILS
SCALE: N.T.S.

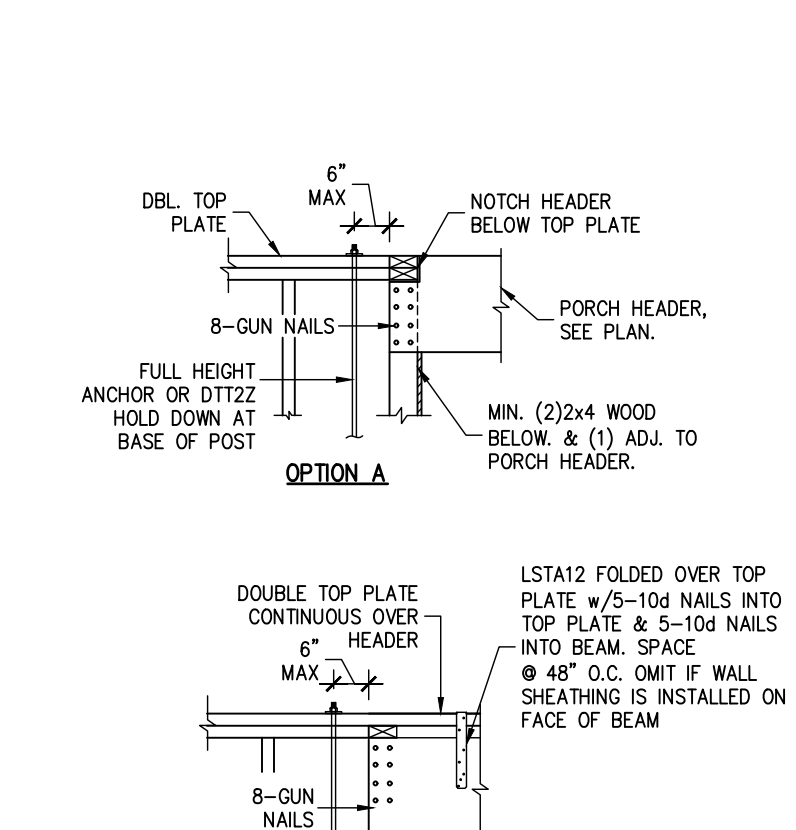



3 TYPICAL PORCH BEAM CONNECTION
SCALE: N.T.S.

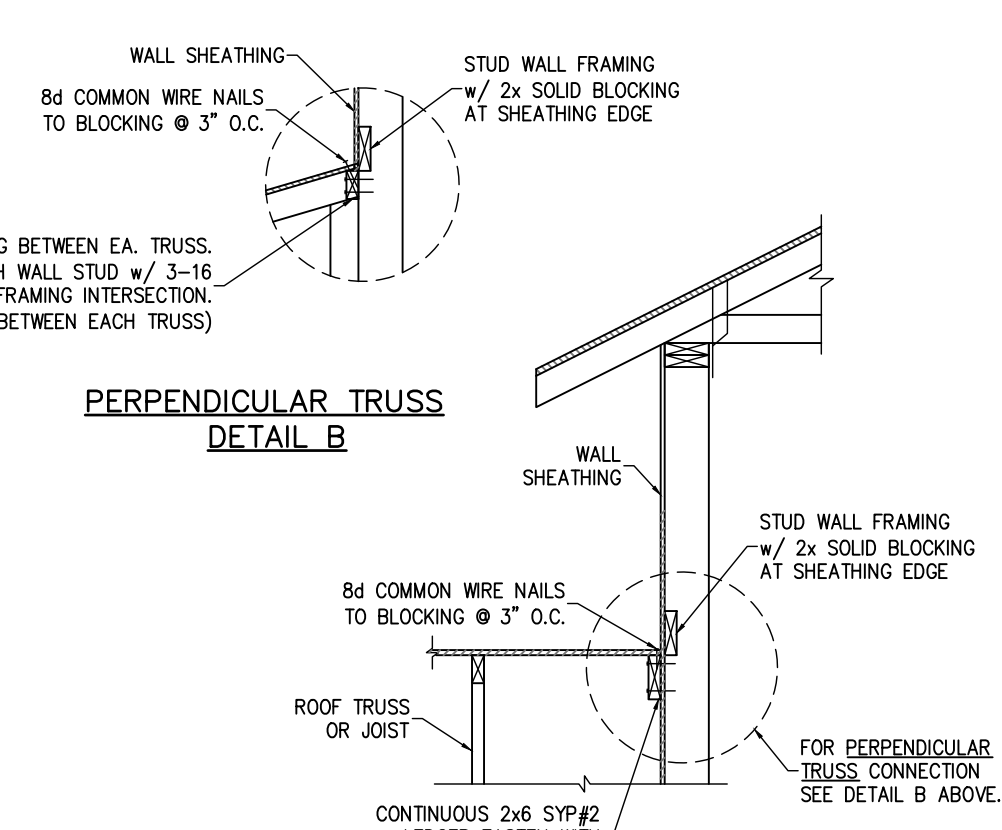


4 WALL ADJ. TO ROOF CONNECTION
SCALE: N.T.S.

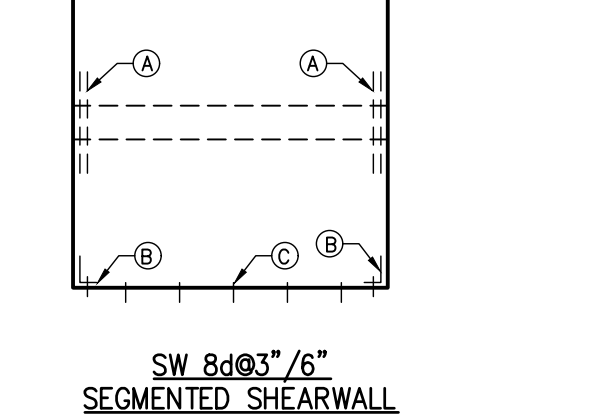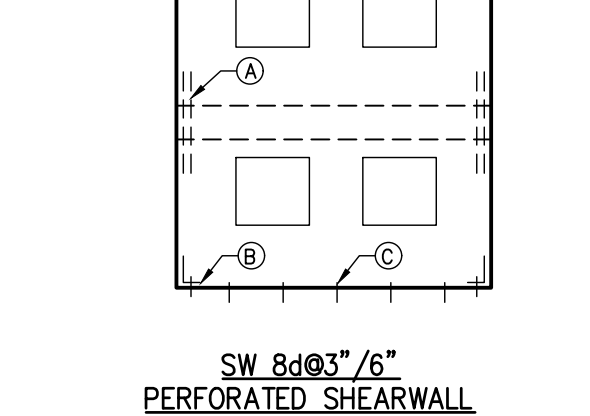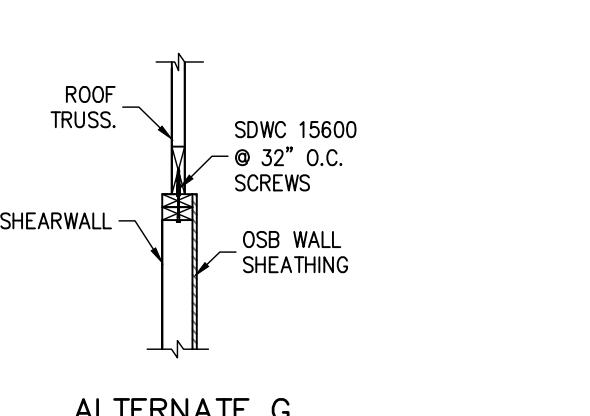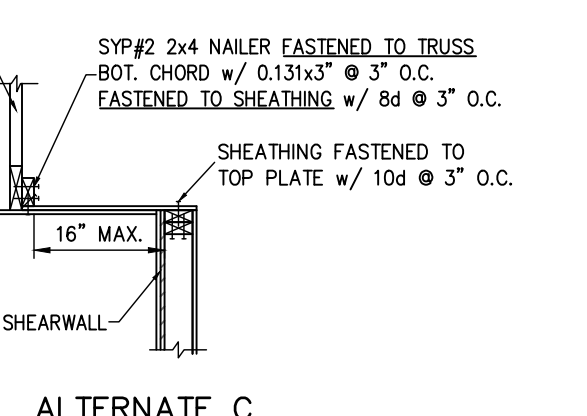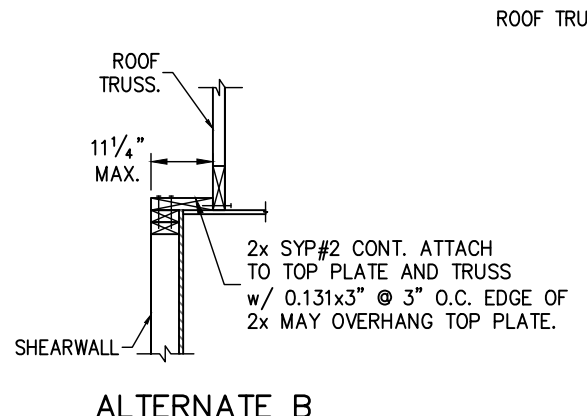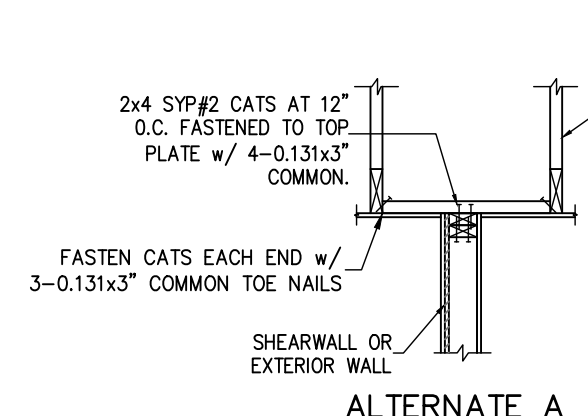


5 SHEARWALL ATTACHMENT AT ROOF & FLOOR
SCALE: N.T.S.

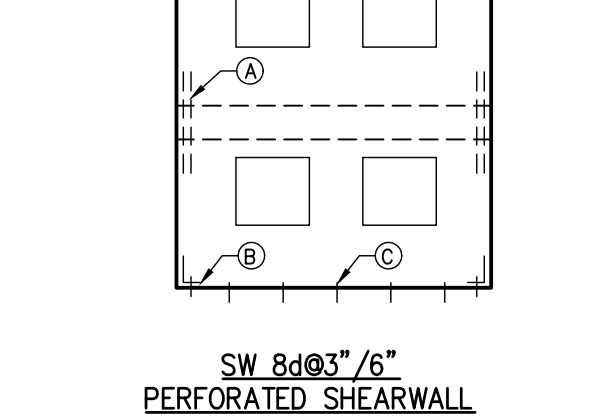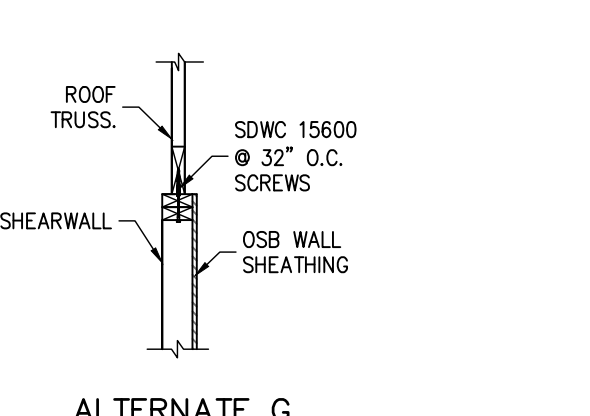


6 TYPICAL SHEARWALL ELEVATION
SCALE: N.T.S.

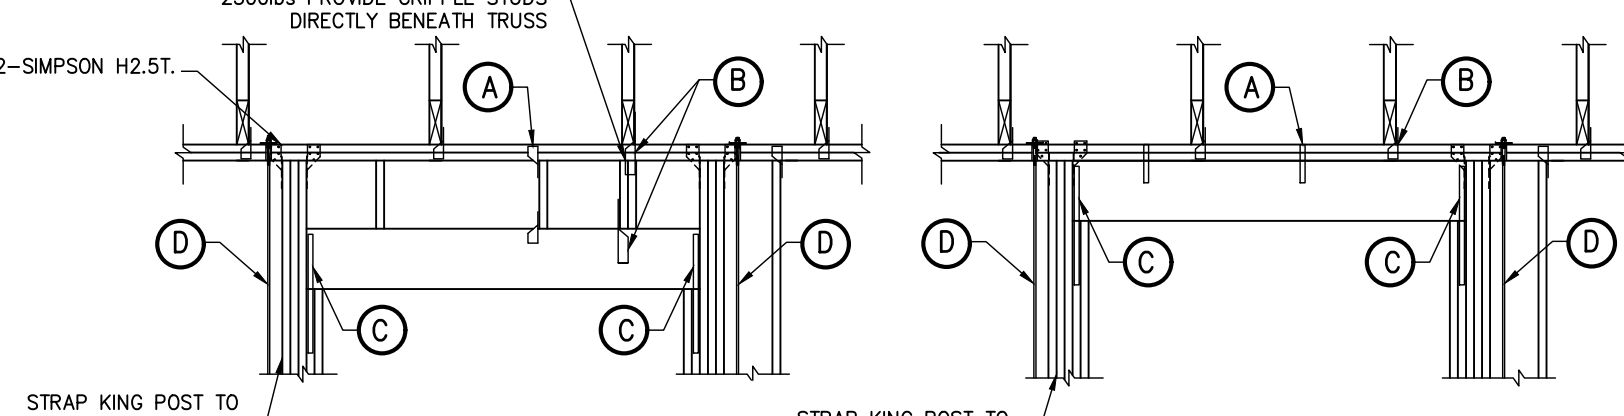


7 HEADER TIE DOWN
SCALE: N.T.S.

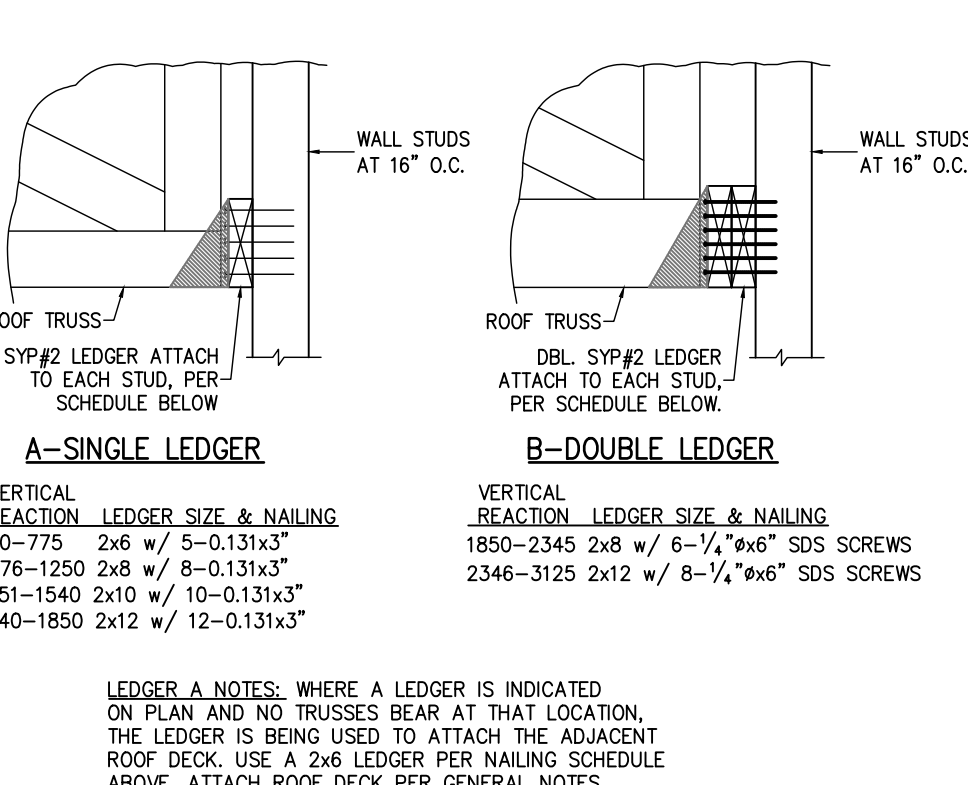


8 LEDGER CONNECTION
SCALE: N.T.S.

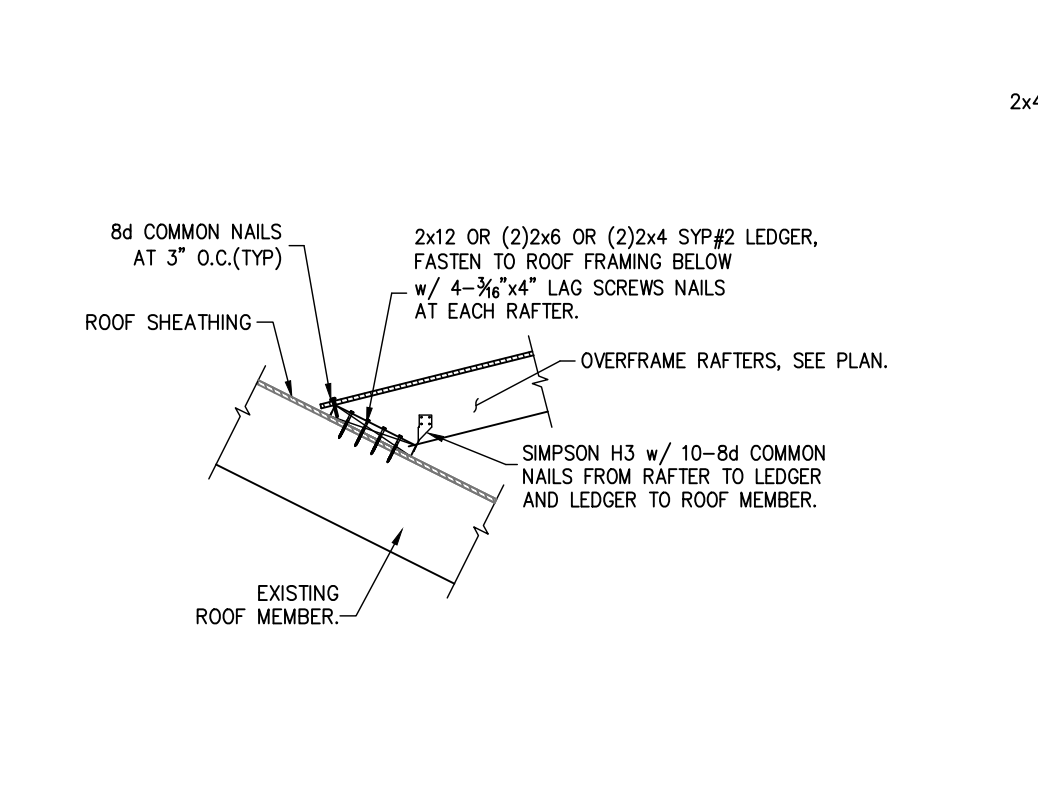


9 DECK LEDGER AT OVERFRAME RAFTERS
SCALE: N.T.S.

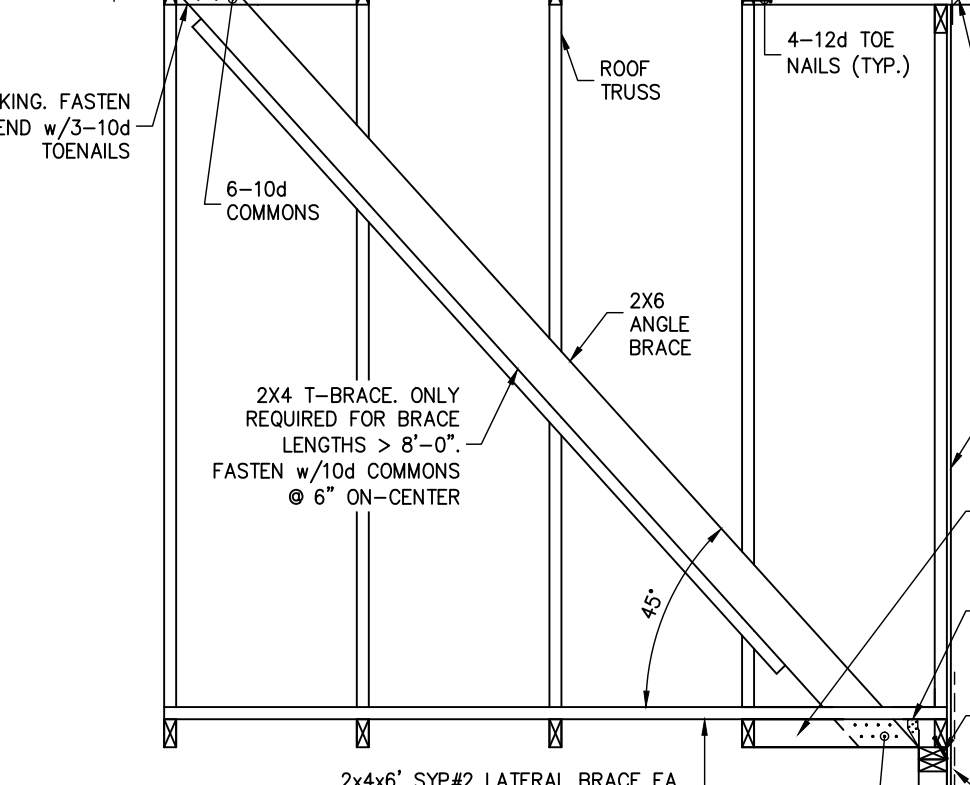


10 GABLE END BRACING
SCALE: N.T.S.

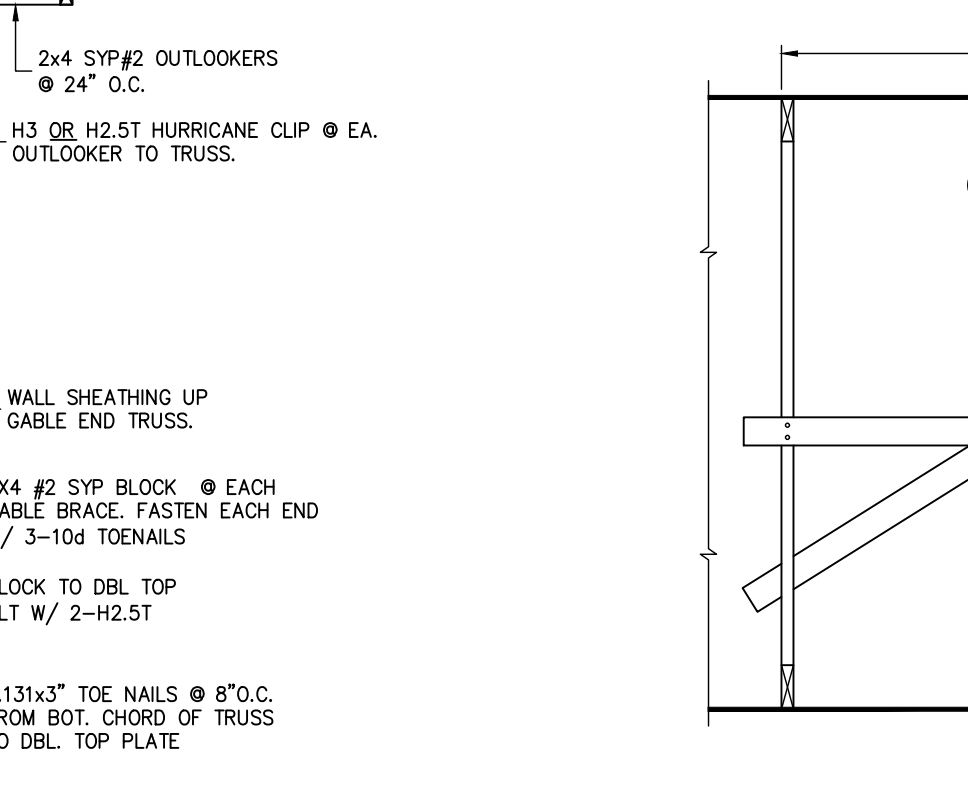


11 PERMANENT TRUSS BRACING
SCALE: N.T.S.

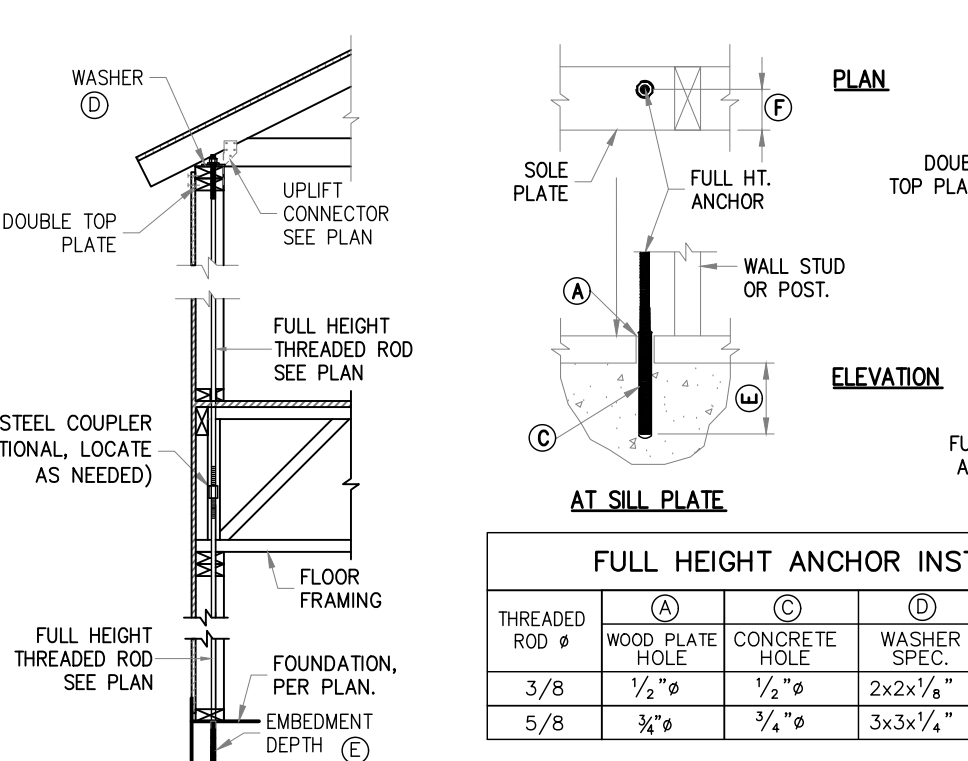


12 FULL HEIGHT WOOD FRAME WALL ANCHORING SYSTEM
SCALE: N.T.S.

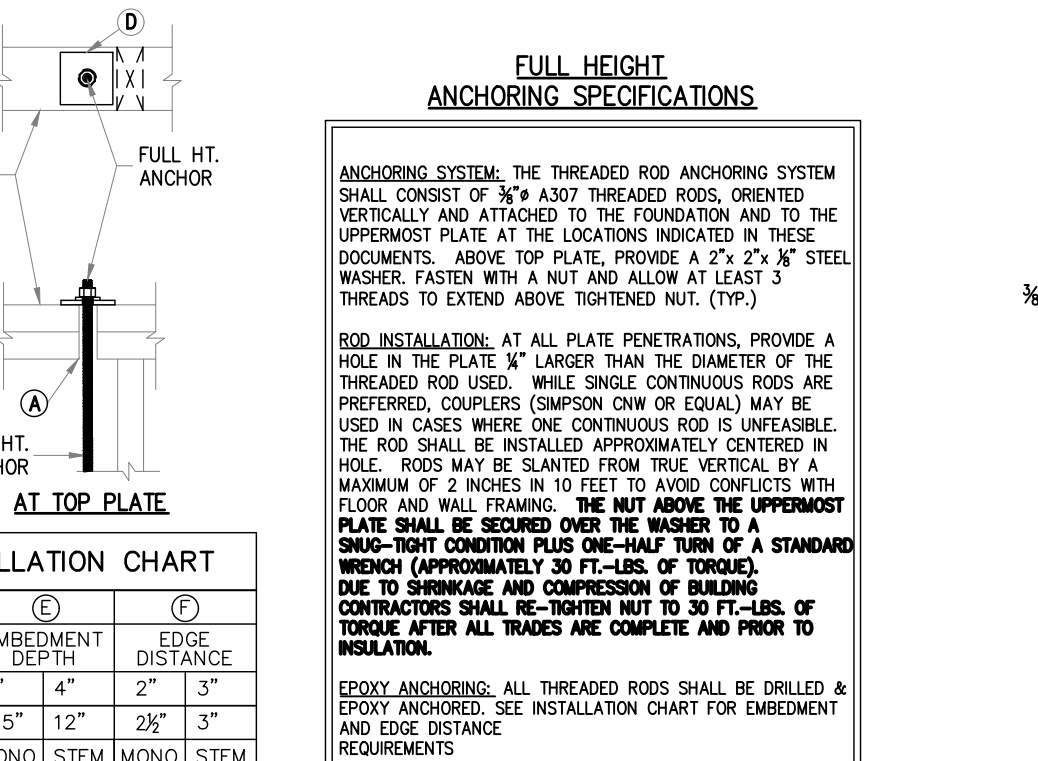


13 FULL HEIGHT ROD ALTERNATE ATTACHMENT
SCALE: N.T.S.

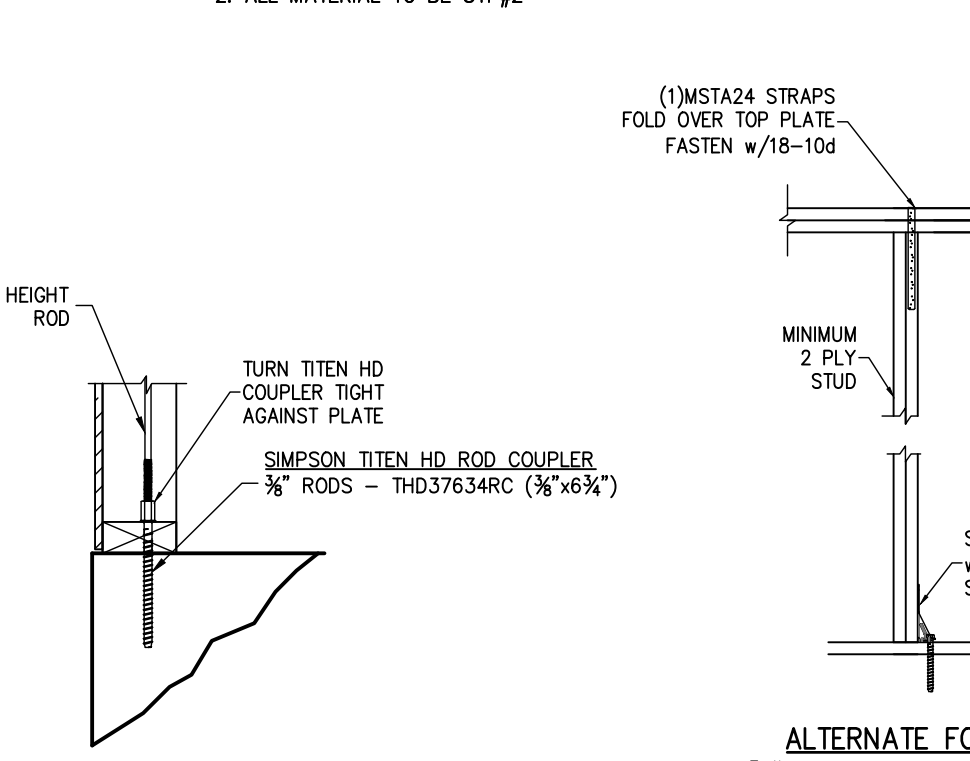


14 FULL HEIGHT THREADED ROD ALTERNATE
SCALE: N.T.S.

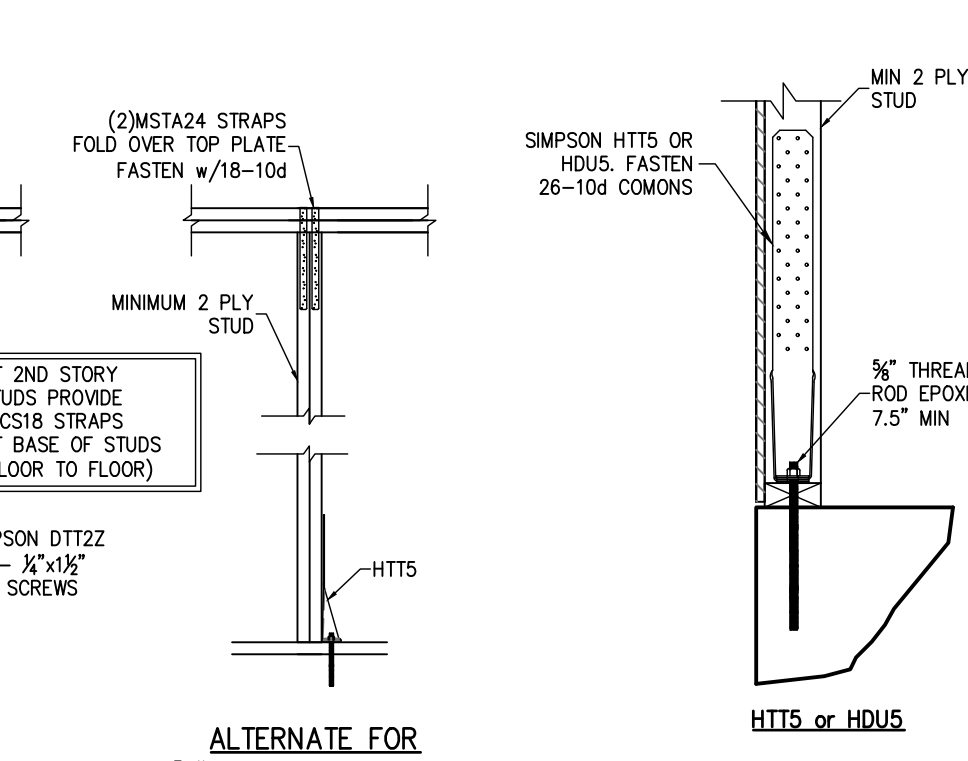


15 HOLD DOWN ATTACHMENT DETAIL
SCALE: N.T.S.

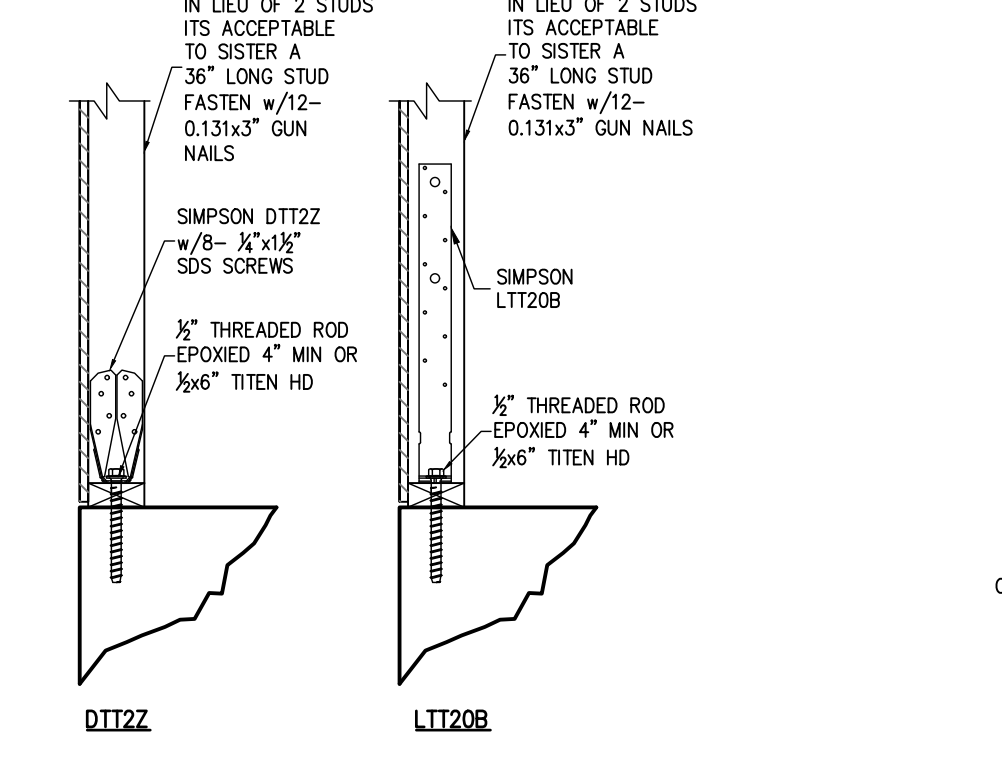


16 DOOR JAMB FASTENING
SCALE: N.T.S.

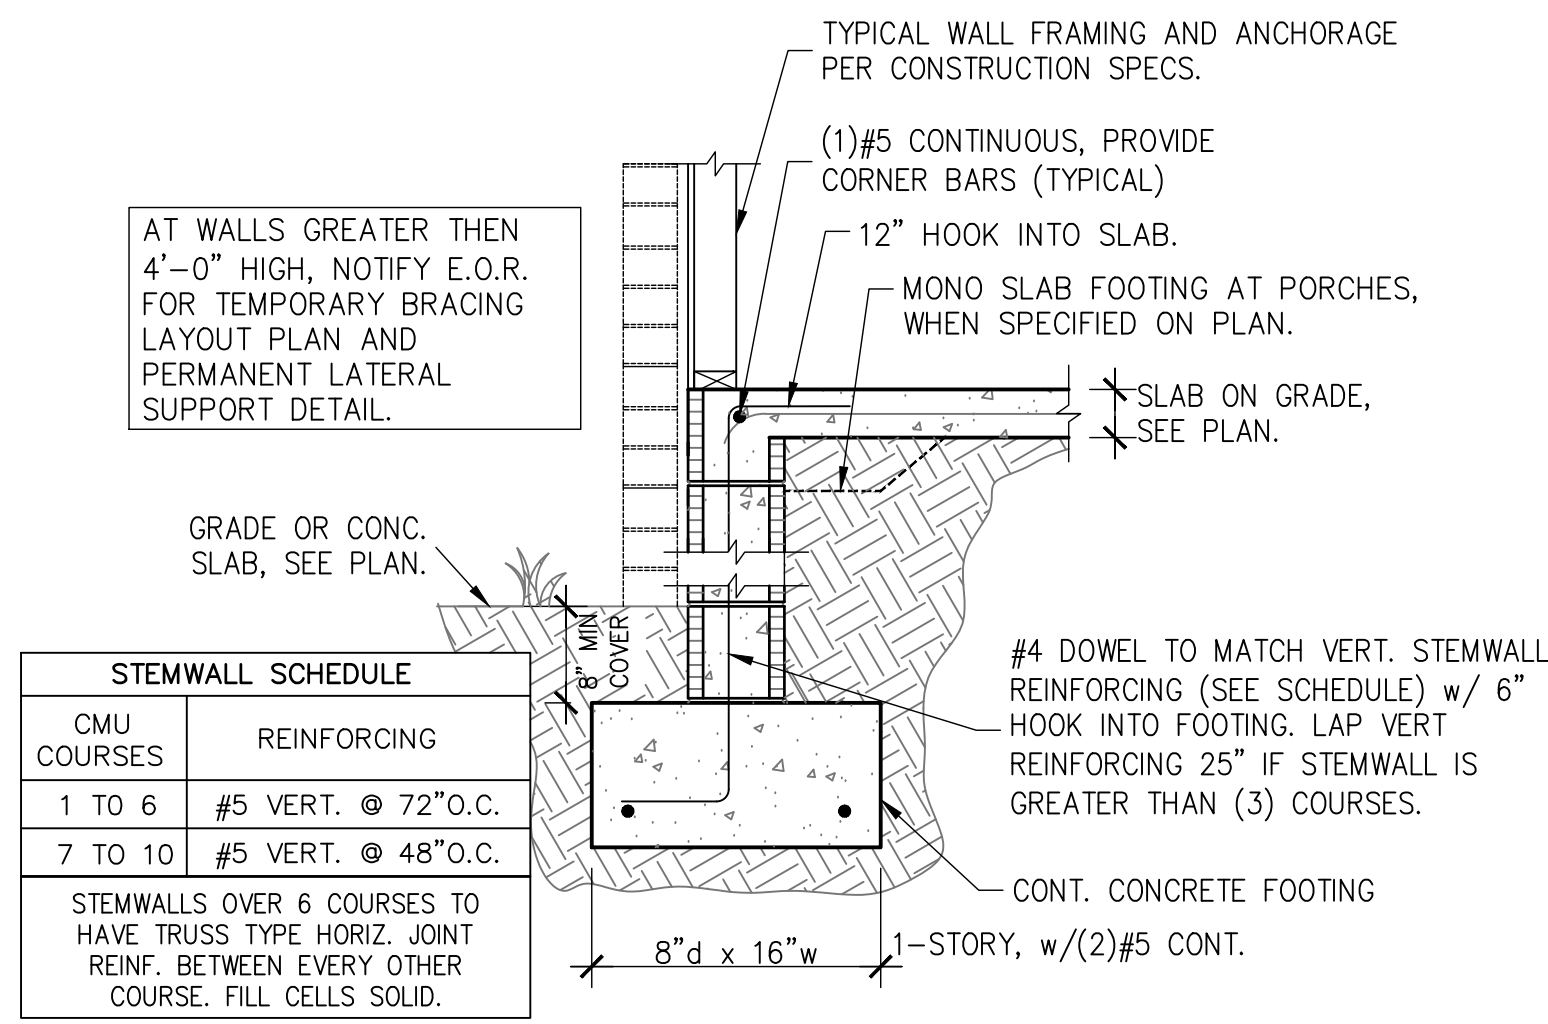


1 STEMWALL FOOTING
S1.01 SCALE: 3/4" = 1'-0"

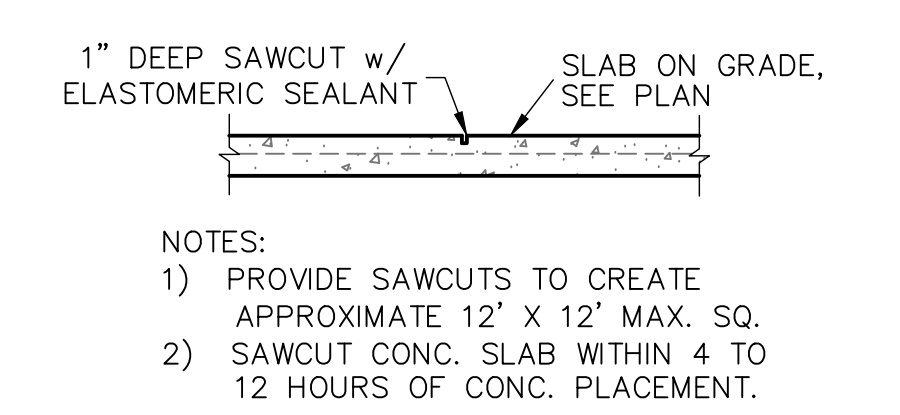


2 SAW CUT DETAIL
S1.01 SCALE: 3/4" = 1'-0"

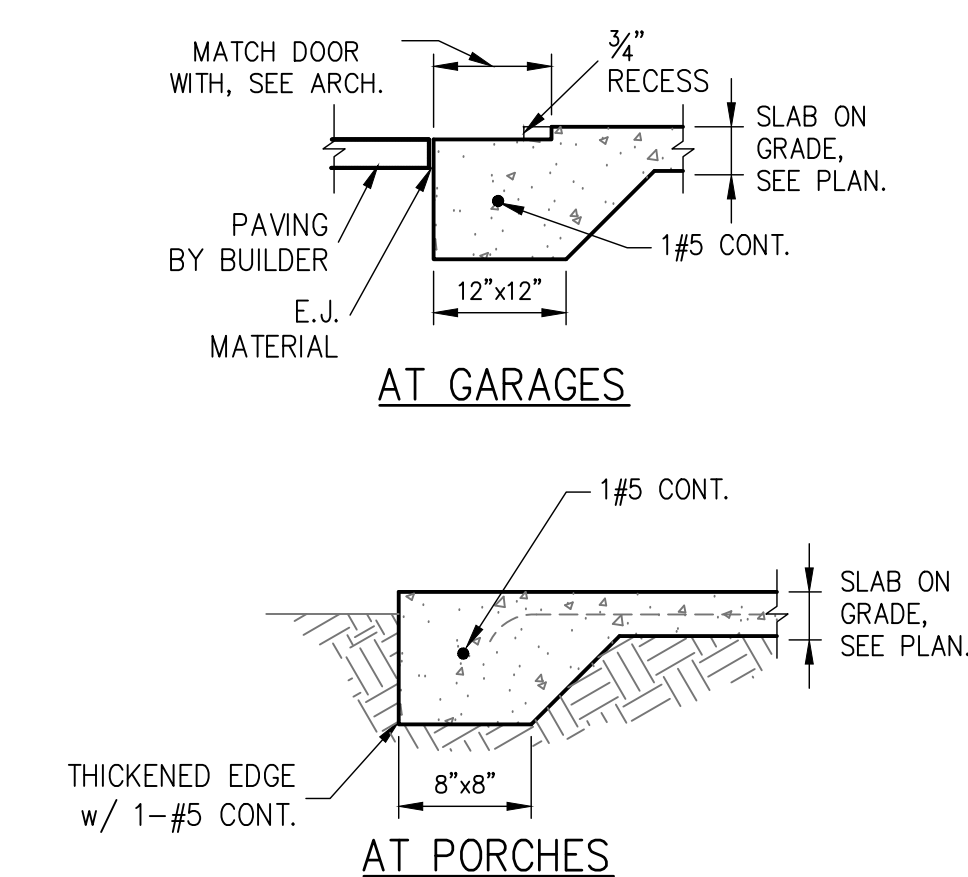


3 THICKENED SLAB
S1.01 SCALE: 3/4" = 1'-0"

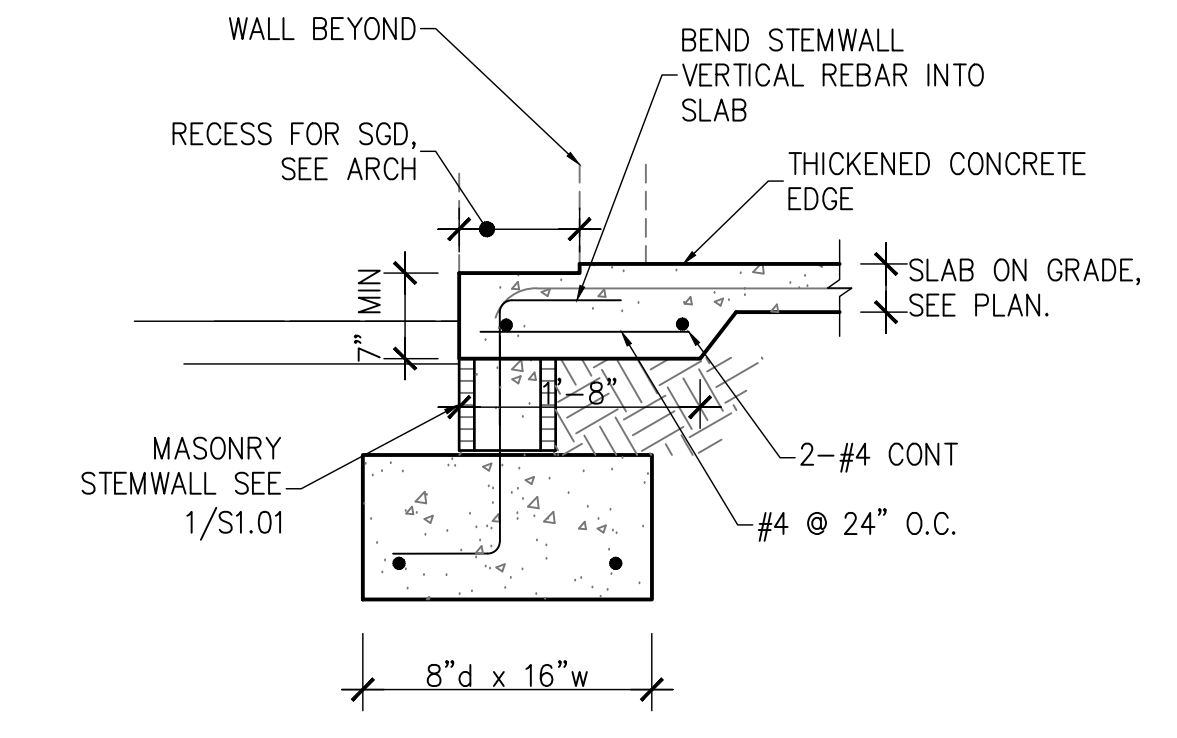


4 STEMWALL FOOTING AT SLIDER
S1.01 SCALE: 3/4" = 1'-0"

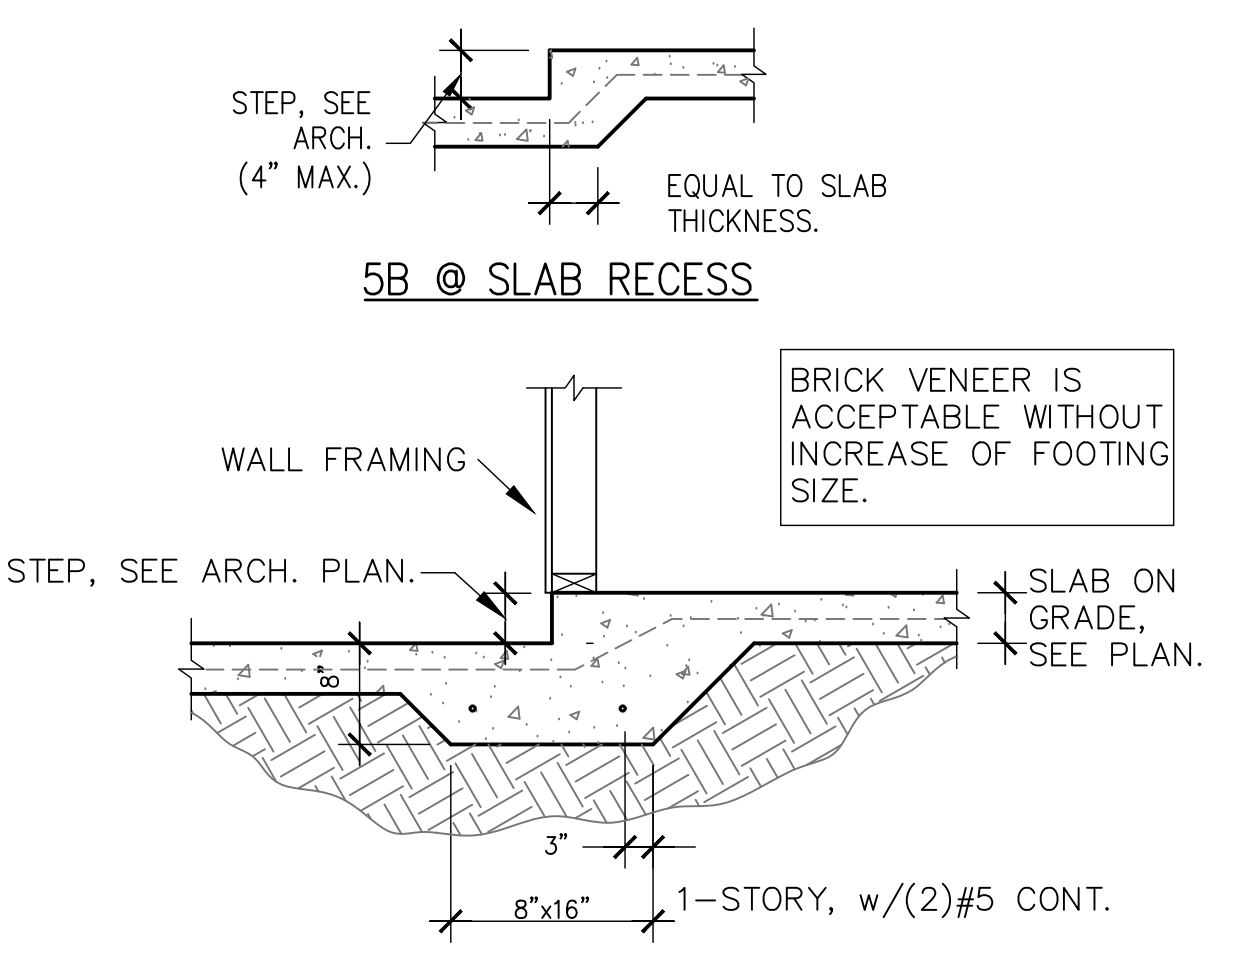


5 MONO. FOOTING AT STEP-DOWN
S1.01 SCALE: 3/4" = 1'-0"

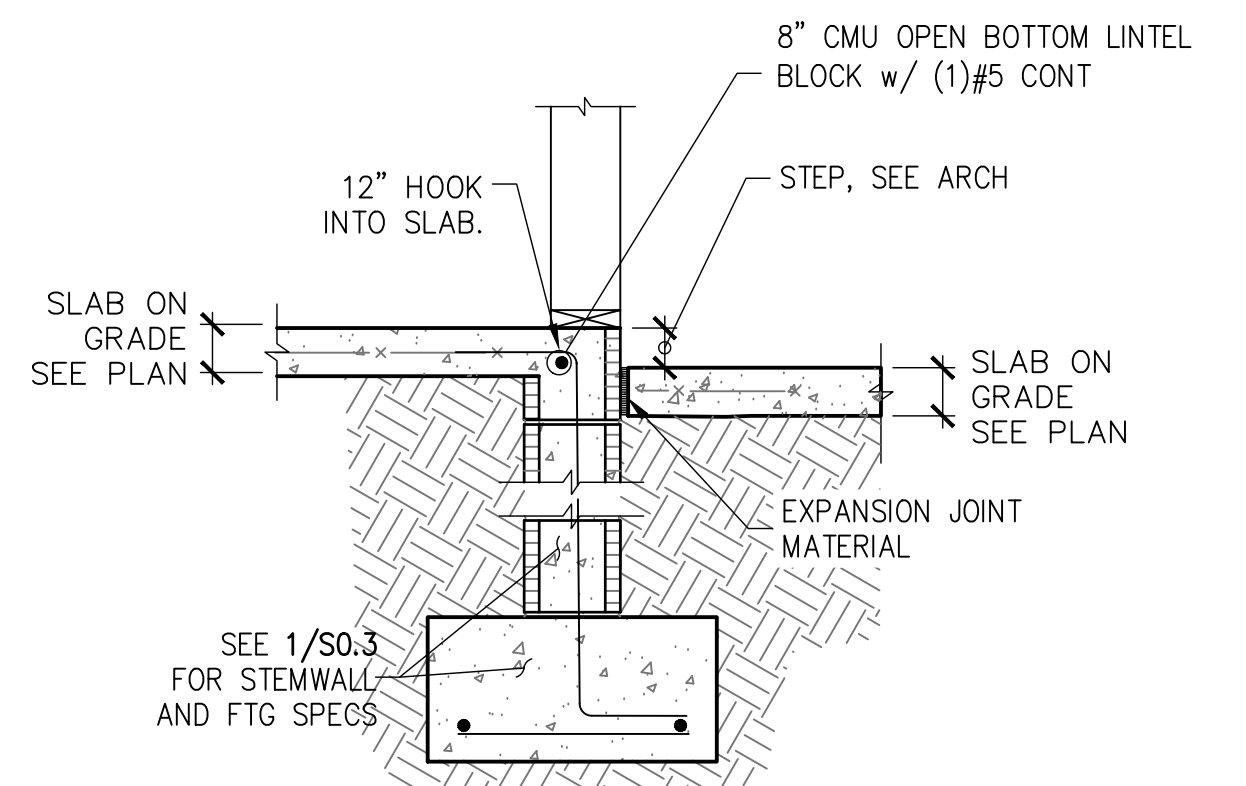


6 STEP AT STEMWALL
S1.01 SCALE: 3/4" = 1'-0"

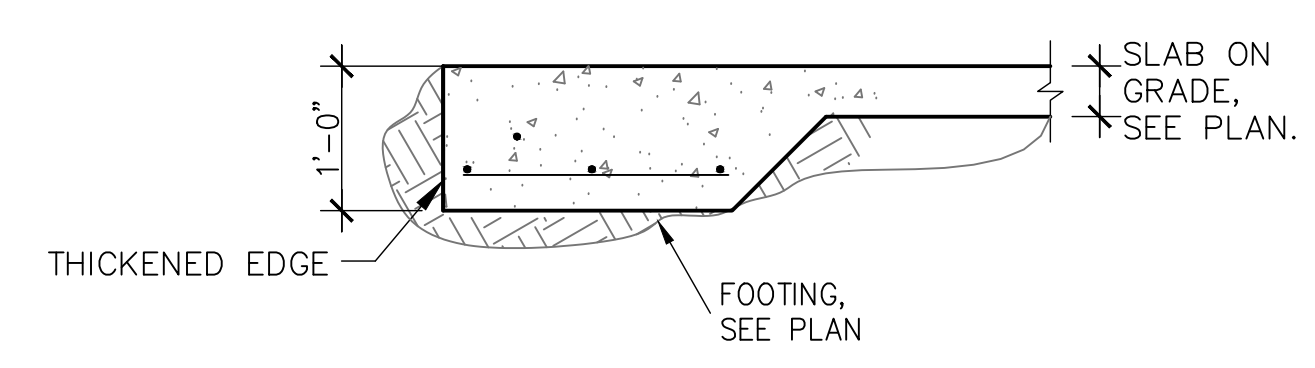


7 PORCH FOOTING
S1.01 SCALE: 3/4" = 1'-0"

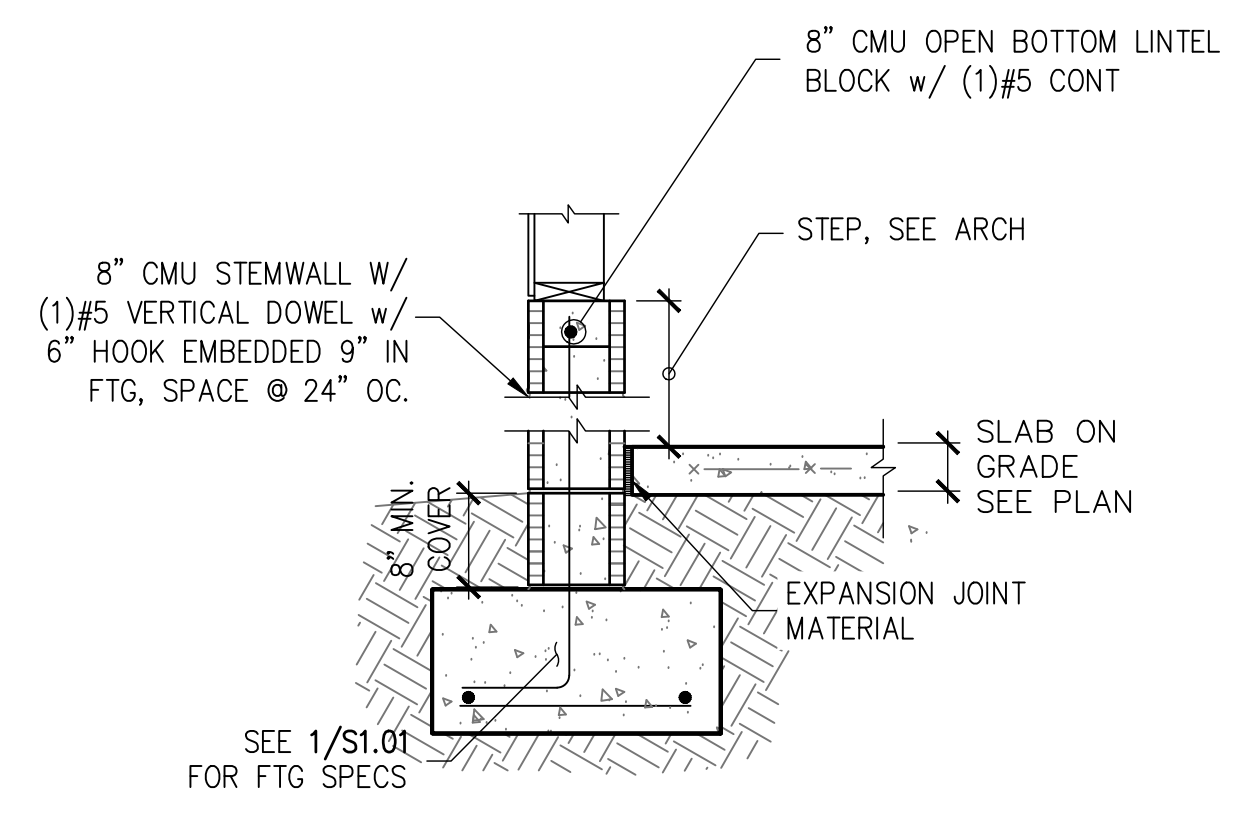


8 GARAGE PERIMETER STEMWALL WITH FLOATING SLAB
S1.01 SCALE: 3/4" = 1'-0"

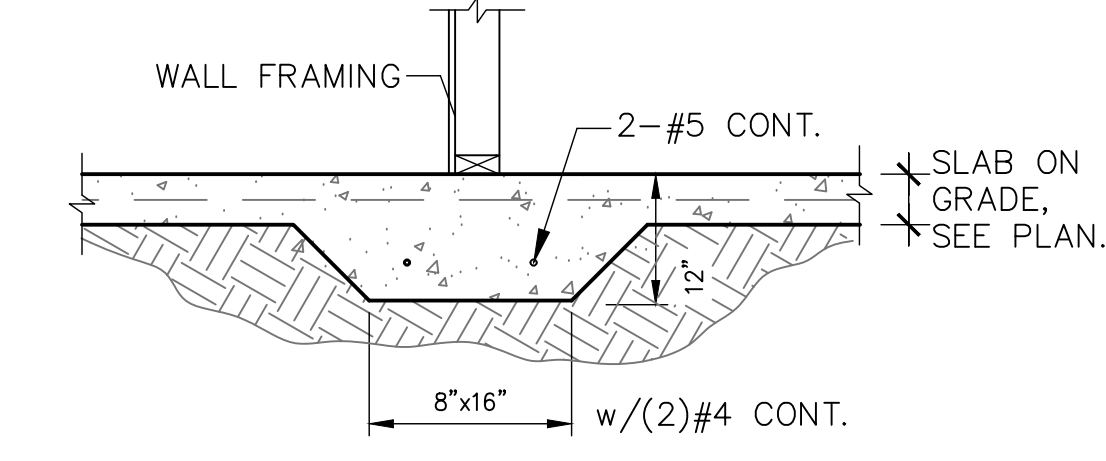

9 BEARING AT INTERIOR
S1.01

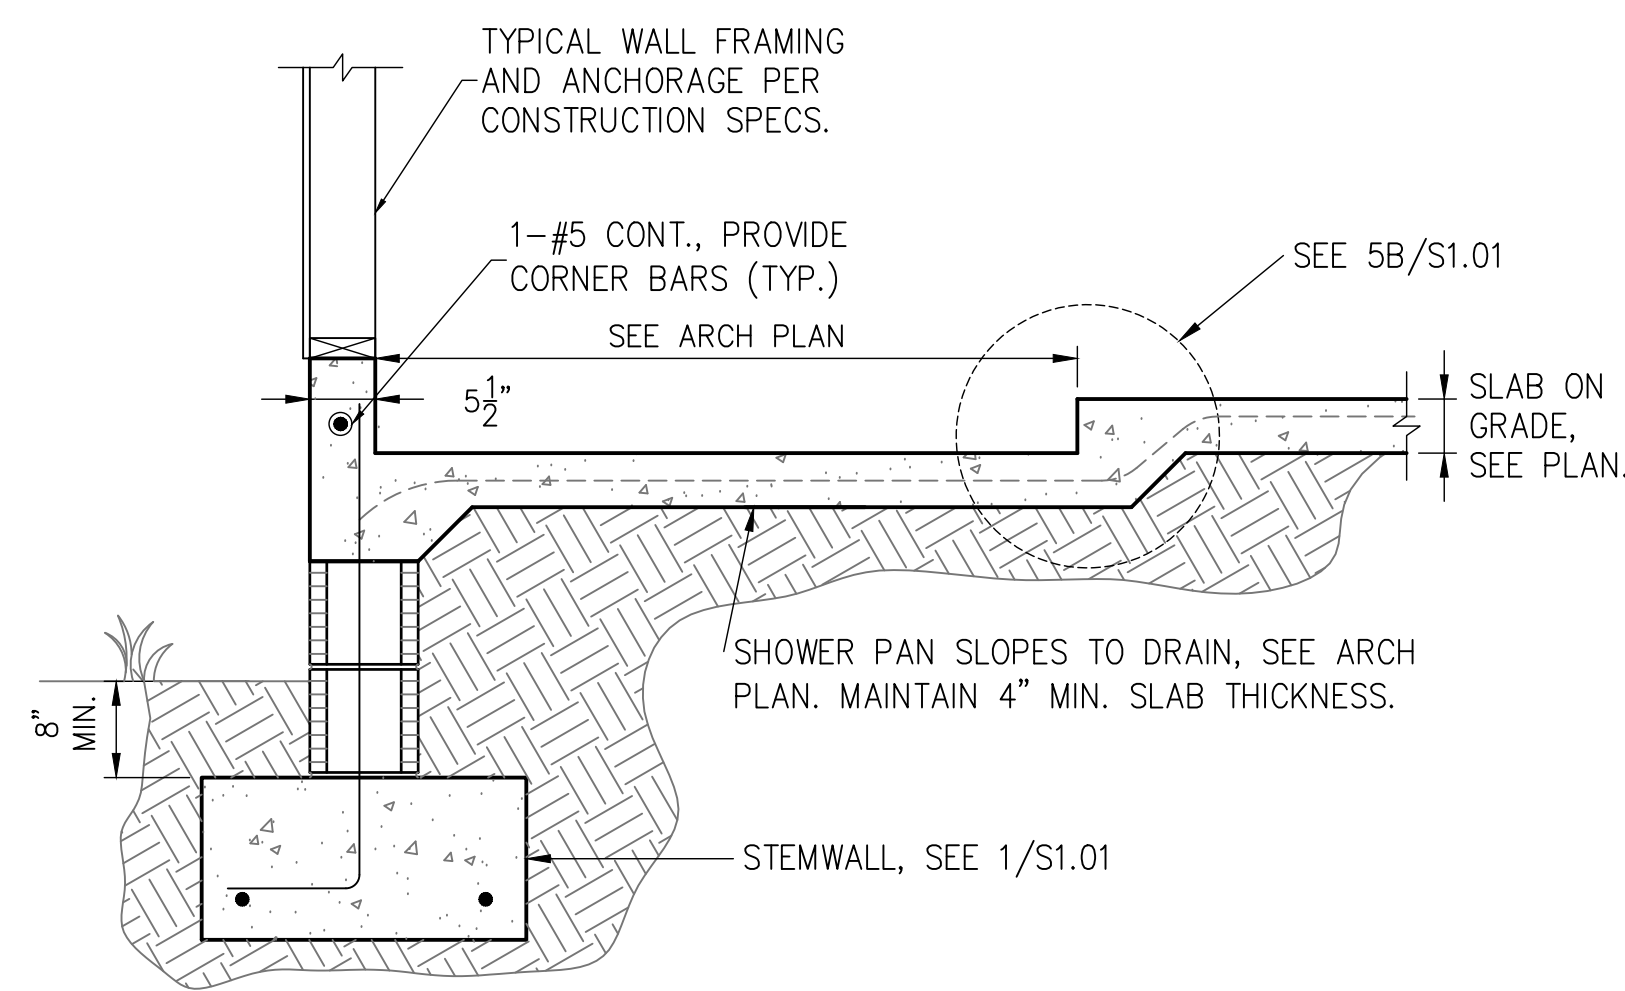

10 FOOTING W/ SHOWER RECESS
S1.01 SCALE: 3/4" = 1'-0"

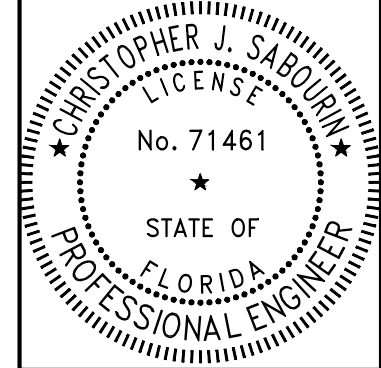

Christopher J. Sabourin
FL PE #71461

THIS DOCUMENT HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY CHRISTOPHER J. SABOURIN, PE ON 04/17/2025. A SHA AUTHENTICATION CODE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SHA AUTHENTICATION CODE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

SABO STRUCTURAL ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
OXLEY RESIDENCE
SSE No.
26-0103


ISSUE	DATE
PERMIT	XXX.XX
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR OXLEY RESIDENCE

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER J. SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.R.

FOUNDATION DETAILS

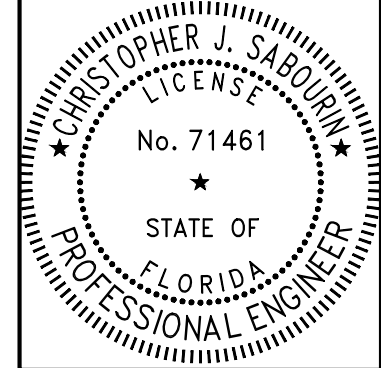

Christopher J. Sabourin
FL PE #71461

THIS DOCUMENT HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY CHRISTOPHER J. SABOURIN, PE ON 04/17/2025. A SHA AUTHENTICATION CODE.
PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SHA AUTHENTICATION CODE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

SABO STRUCTURAL ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
OXLEY RESIDENCE
SSE No.
26-0103

ISSUE	DATE
PERMIT	XX.XX.XX
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR
OXLEY RESIDENCE

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.R.

FIRST LEVEL WALL FRAMING PLAN

SHEET
S1.1
SHEET 5 OF 7

SYMBOLS LEGEND

	DESIGNATES OSB SHEARWALL. THE HIDDEN LINE DESIGNATES SIDE OF WALL THE SHEARWALL SHEATHING TO BE APPLIED. 8d @ 12" O.C. "IN THE FIELD"
	DESIGNATES THE HEADER SIZE, NUMBER OF PLYS & JACKING STUDS NEEDED FOR SUPPORT HEADERS.
	BEAM OR TRUSS, SEE PLAN
	3/8" A307 DIAMETER FULL HEIGHT THREADED ROD, SEE DETAIL 12/SO.1
	5/8" A307 DIAMETER FULL HEIGHT THREADED ROD, SEE DETAIL 12/SO.1
	3/8" A307 DIAMETER THREADED ROD TERMINATES AT FIRST FLOOR TOP PLATE, SEE DETAIL 12/SO.1
	5/8" A307 DIAMETER THREADED ROD TERMINATES AT FIRST FLOOR TOP PLATE, SEE DETAIL 12/SO.1
	SIMPSON HITs SEE DETAIL 15/SO.1
	SIMPSON DT22 SEE DETAIL 15/SO.1
	SIMPSON LIT208 SEE DETAIL 15/SO.1

WALL STUD SCHEDULE

LOCATION	PLATE HEIGHT	STUD SIZE & SPACING
EXTERIOR	9'-1" MAX	2x4 SPF#2 @ 16" O.C.
EXTERIOR	10'-1" MAX	2x6 SPF#2 @ 16" O.C. & 2x4 SPF#2 @ 12" O.C.
EXTERIOR	10'-1" TO 14'-0" MAX	2x6 SPF#2 @ 16" O.C.
INTERIOR	10'-0" MAX	2x4 SPF#2 @ 16" O.C.
INTERIOR	12'-0" MAX	2x6 SPF#2 @ 16" O.C. & 2x4 SPF#2 @ 12" O.C.

STUD NOTES

1. WALL STUDS SPECIFIED ON PLAN SUPERSEDE THIS TABLE
2. MINIMUM STUD SIZE AND SPACING ARE SHOWN. CONTRACTOR MAY INCREASE STUD SIZE TO MEET ARCHITECTURAL REQUIREMENTS.
3. SPF DENOTES SPRUCE PINE FIR. SYP DENOTES SOUTHERN YELLOW PINE.
4. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.
5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB w/16G MASONRY OUT NAILS @ 16" O.C. MINIMUM. SEE 3/SO.0 FOR ADDITIONAL ANCHORS AT SHEARWALLS

COMBINED USE PANEL NOTES

1. EXTERIOR WALL SHEATHING SHALL BE CONTINUOUS FROM BOTTOM PLATE TO UPPER MOST TOP PLATE. SEE DETAIL 1/SO.1 FOR SHEATHING SPLICE LOCATIONS FOR MULTI STORY CONDITIONS
2. SEE SHEET S.O.0 FOR WALL SHEATHING SPECIFICATIONS.
3. UPPER MOST TOP PLATE SUPPORTING ROOF MEMBERS SHALL BE STRAPPED AS SHOWN IN DETAIL 1/SO.0
4. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/SO.0


GENERAL NOTES

1. SEE DETAIL 2/SO.0 FOR WALL FRAMING DETAIL. SEE WALL STUD SCHEDULE THIS SHEET FOR STUD SIZES AND SPACING. AT GIRDERS AND BEAMS, PROVIDE STUDS BELOW TO MATCH BEAM/GIRDER PLES.
2. SEE SHEET S.O.0 FOR ROOF AND FLOOR SHEATHING SPECIFICATIONS.
3. WHERE FRAMING MEMBERS CONSIST OF MULTIPLE PLYS (BEAMS, HEADER, AND STUDS) FASTEN PLYS TOGETHER PER DETAIL 6/SO.0
4. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/SO.0
5. AT SHEARWALLS, PROVIDE DIAPHRAGM ATTACHMENT PER DETAIL 5/SO.1
6. FOR ATTACHMENT OF EXTERIOR WALLS THAT TERMINATE BETWEEN TRUSSES, SEE 5A/SO.1
7. AT PORCHES, SEE DETAIL 2/SO.1 FOR FRAMING AND HOLD DOWNS


SOLE PLATE ANCHOR SPACING SCHED

ALL EXTERIOR WALL UNLESS OTHER NOTED	42" O.C.
SHEARWALLS (SW 8d@8"/6")	24" O.C.
	WHEN NOTED ON PLAN SEE NOTE 2

1. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/SO.0
2. ANCHOR SPACING SHALL BE AS NOTED. FOR EXAMPLE - SOLE PLT @ 36" = 36" ON-CENTER SPACING

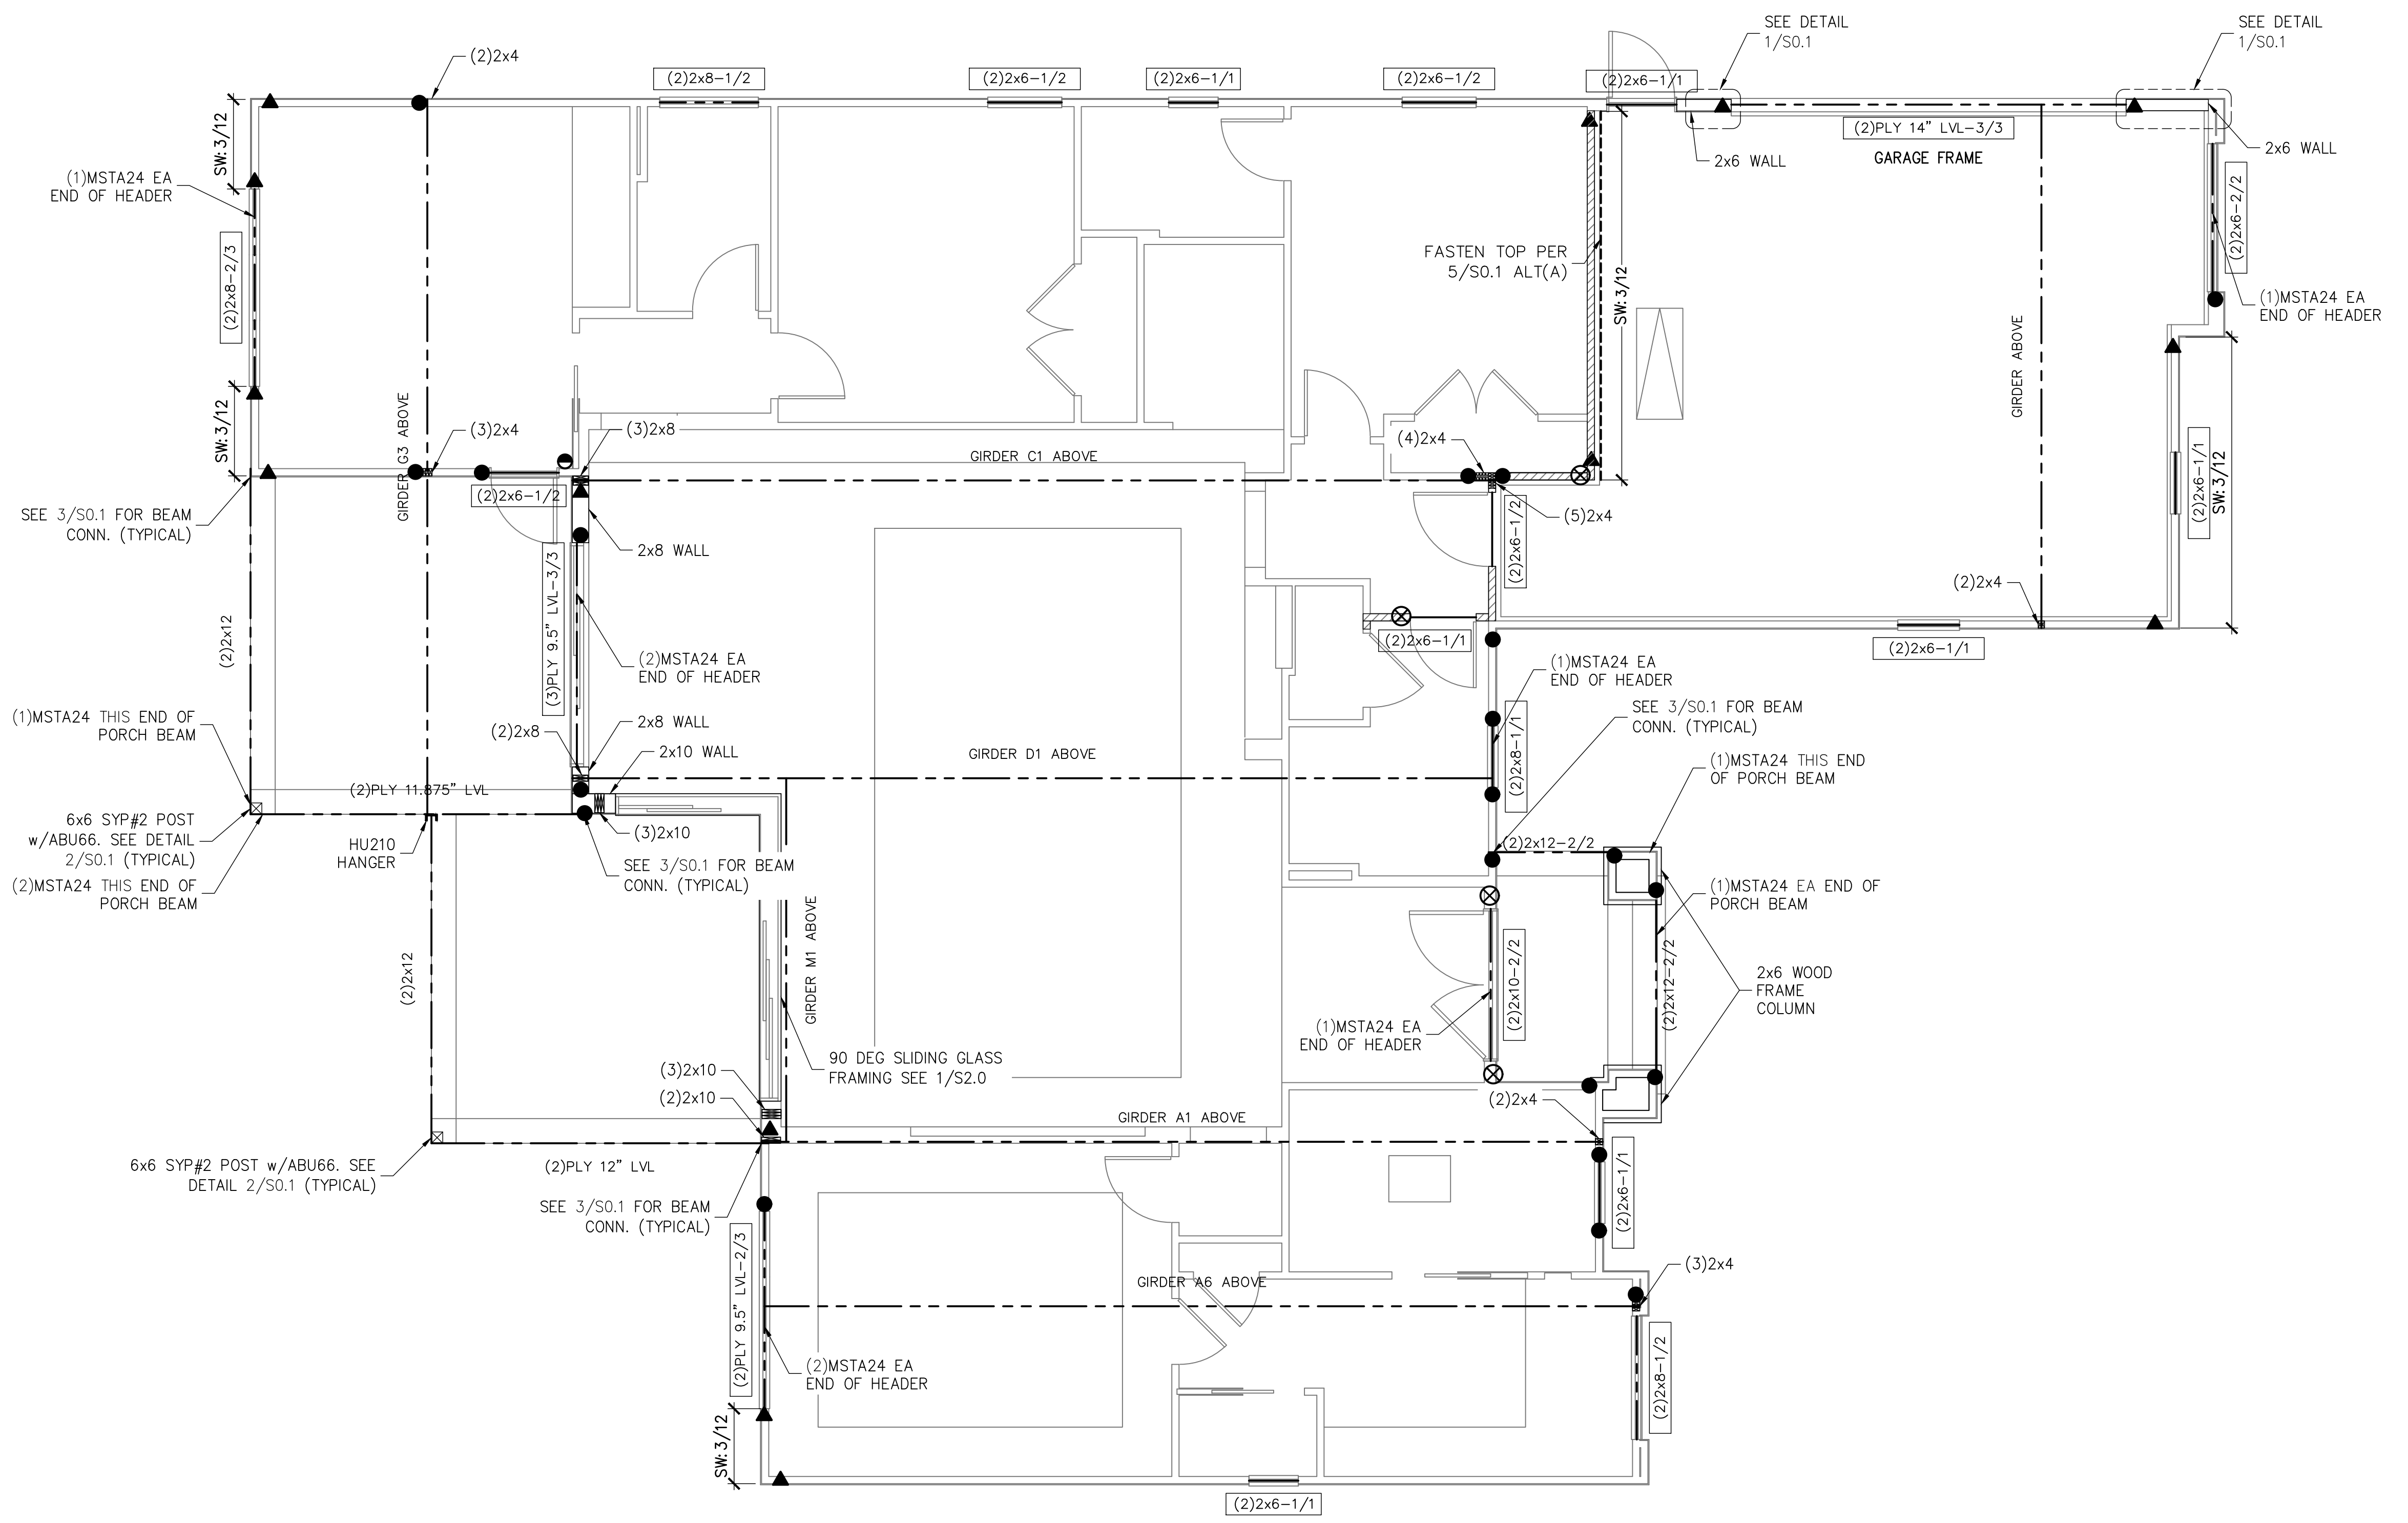

FIRST LEVEL WALL FRAMING PLAN
SCALE: 1/4" = 1'-0"

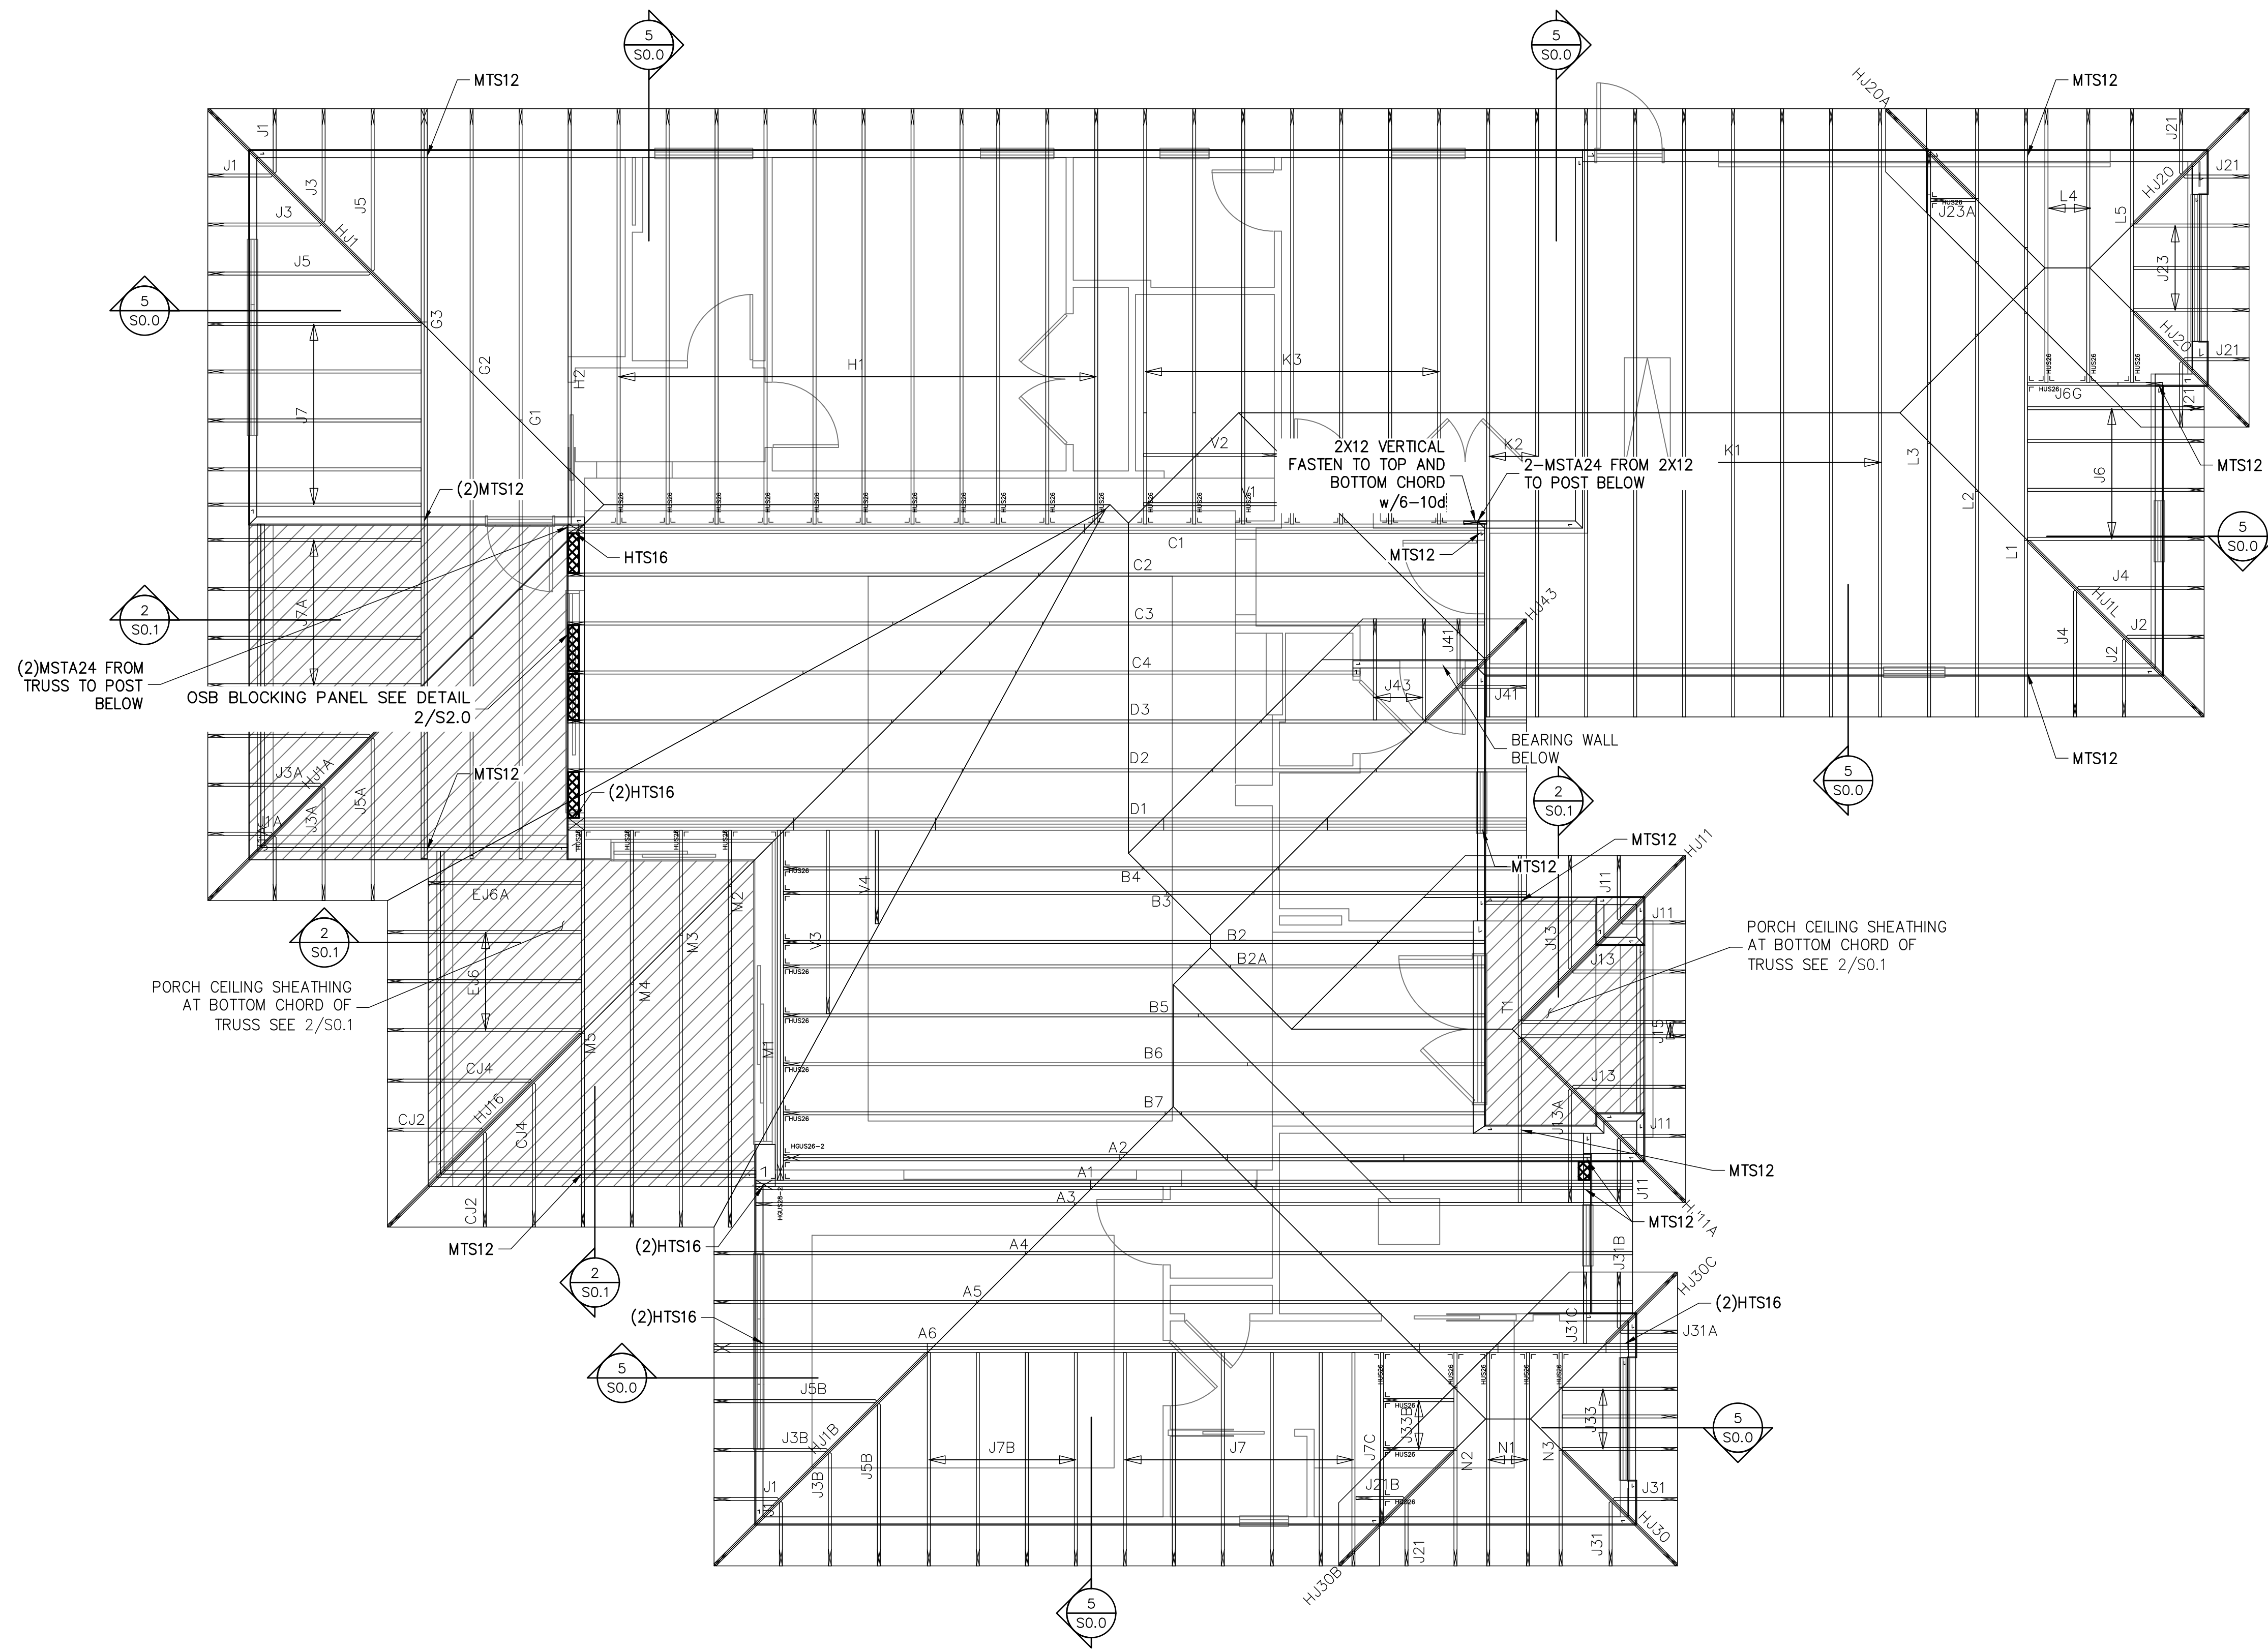

TRUSS / ROOF RAFTER NOTES: STRAPPING NOTES:
 STRAP ROOF TRUSSES AND RAFTERS TO BEARING WITH
 (2)12D TOENAILS & (1)SIMPSON SDWC15600 SCREW UNLESS
 OTHERWISE NOTED.


ROOF TRUSS PLACEMENT PLAN
 SCALE: 1/4" = 1'-0"

SYMBOLS LEGEND


HTS16 DESIGNATES UPLIFT CONNECTION.

FRAMING PLAN NOTES:
 1. FOR TYPICAL ROOF SHEATHING AND FRAMING, SEE SHEET S0.0
 2. FOR SPECIFIC UPLIFT CONNECTIONS, SEE PLAN MIN. (U)SDWC CONNECTOR.
 3. FOR GENERAL DESIGN SPECIFICATIONS SEE SHEET S0.0
 4. WHEN USING (2)H2.5T CLIPS ON 1 1/2" WIDE LUMBER, PLACE CLIPS DIAGONALLY ACROSS DOUBLE TOP PLATE FROM EACH OTHER.


TRUSS FASTENING DETAILS

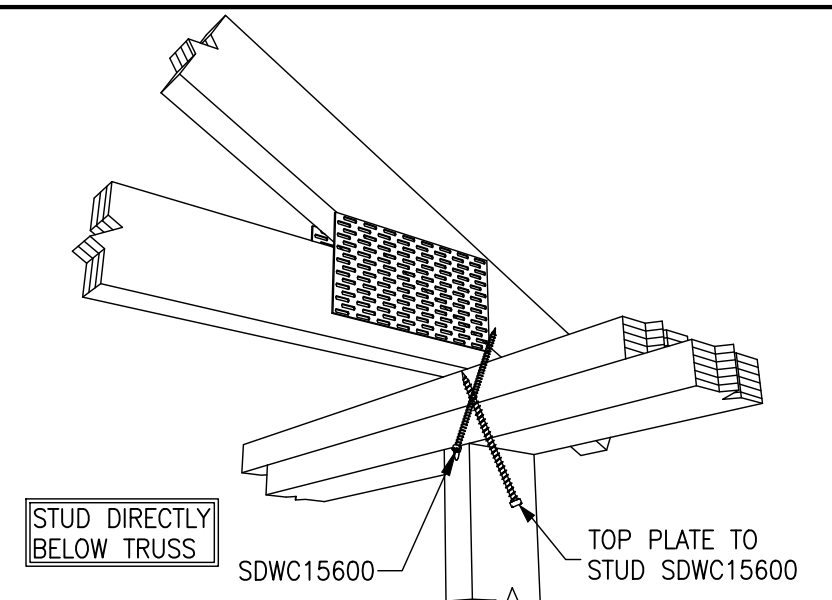


TRUSS TIE DOWN WITH SIMPSON SDWC

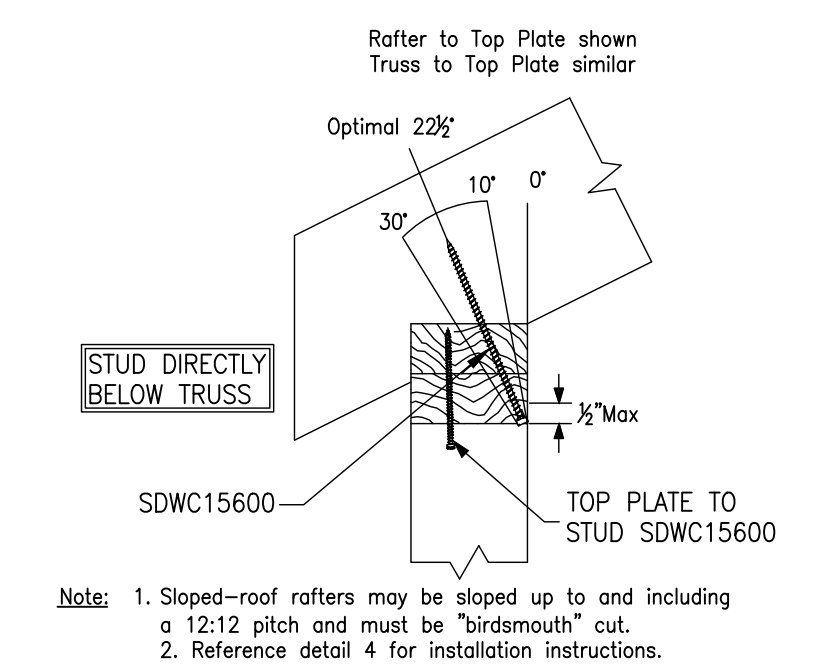


SIMPSON SDWC INSTALLATION RANGE

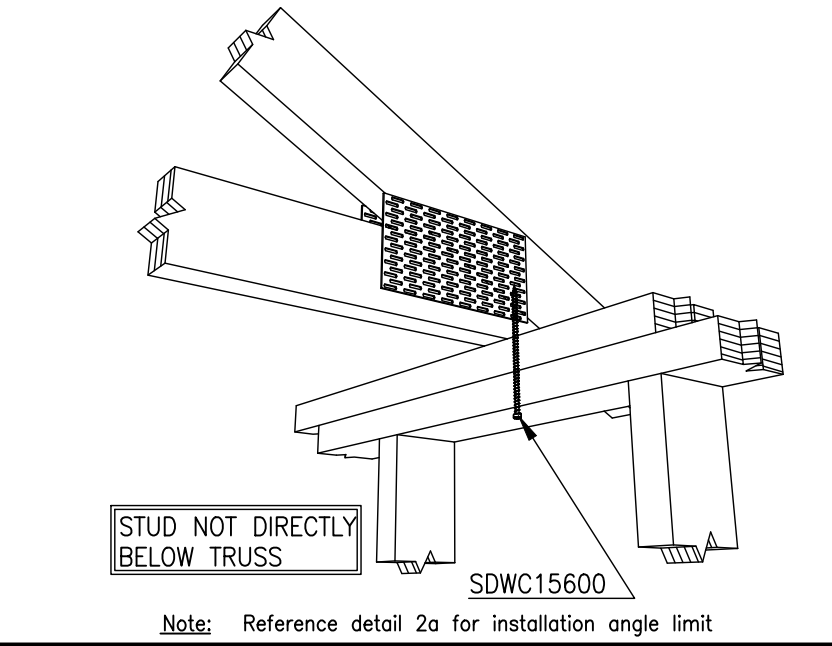


SDWC INSTALLATION

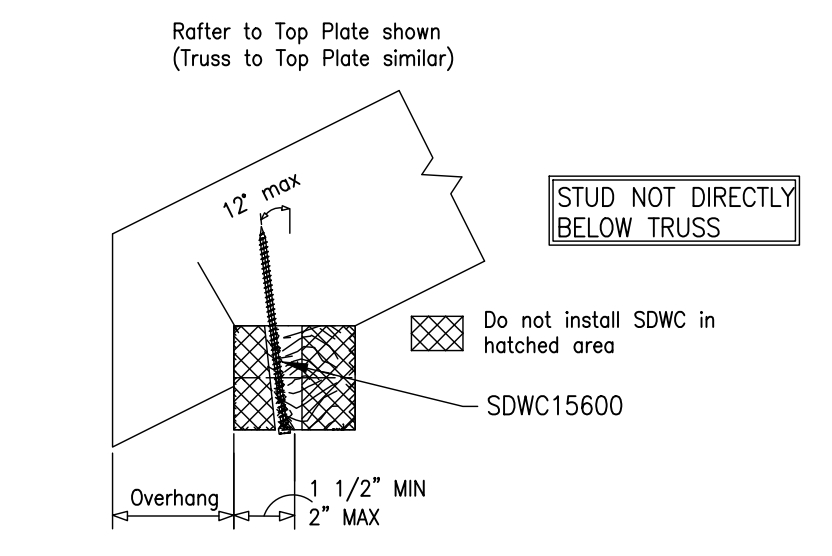

SDWC INSTALLATION RANGE

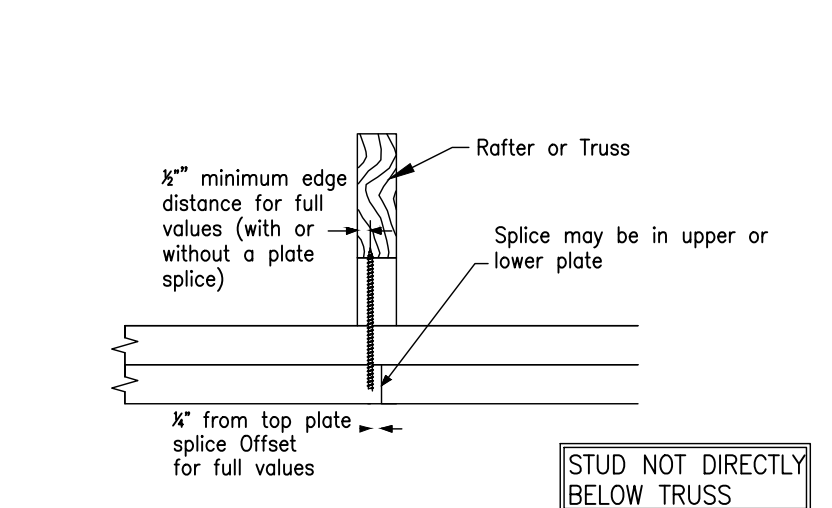

SDWC AT TOP PLATE SPLICE

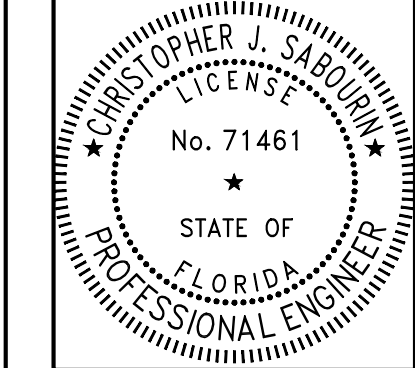

Christopher J. Sabourin
 FL PE#71461

CHRISTOPHER J. SABOURIN STATE OF FLORIDA, PROFESSIONAL ENGINEER, LICENSE NO. 71461.

THIS DOCUMENT HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY CHRISTOPHER J. SABOURIN, PE ON 04/17/2025. A SHA AUTHENTICATION CODE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SHA AUTHENTICATION CODE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

SABO STRUCTURAL ENGINEERING
 CA#32529
 235 9TH AVE N
 JAX BEACH, FL 32250
 904-712-5750
 CHRIS@SABOENG.COM

PLAN NAME
 OXLEY RESIDENCE
 SSE No.
 26-0103


ISSUE	DATE
PERMIT	XXX.XXX
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR OXLEY RESIDENCE


FIELD ALTERATION
 CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
 DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.R.


ROOF TRUSS PLACEMENT PLAN

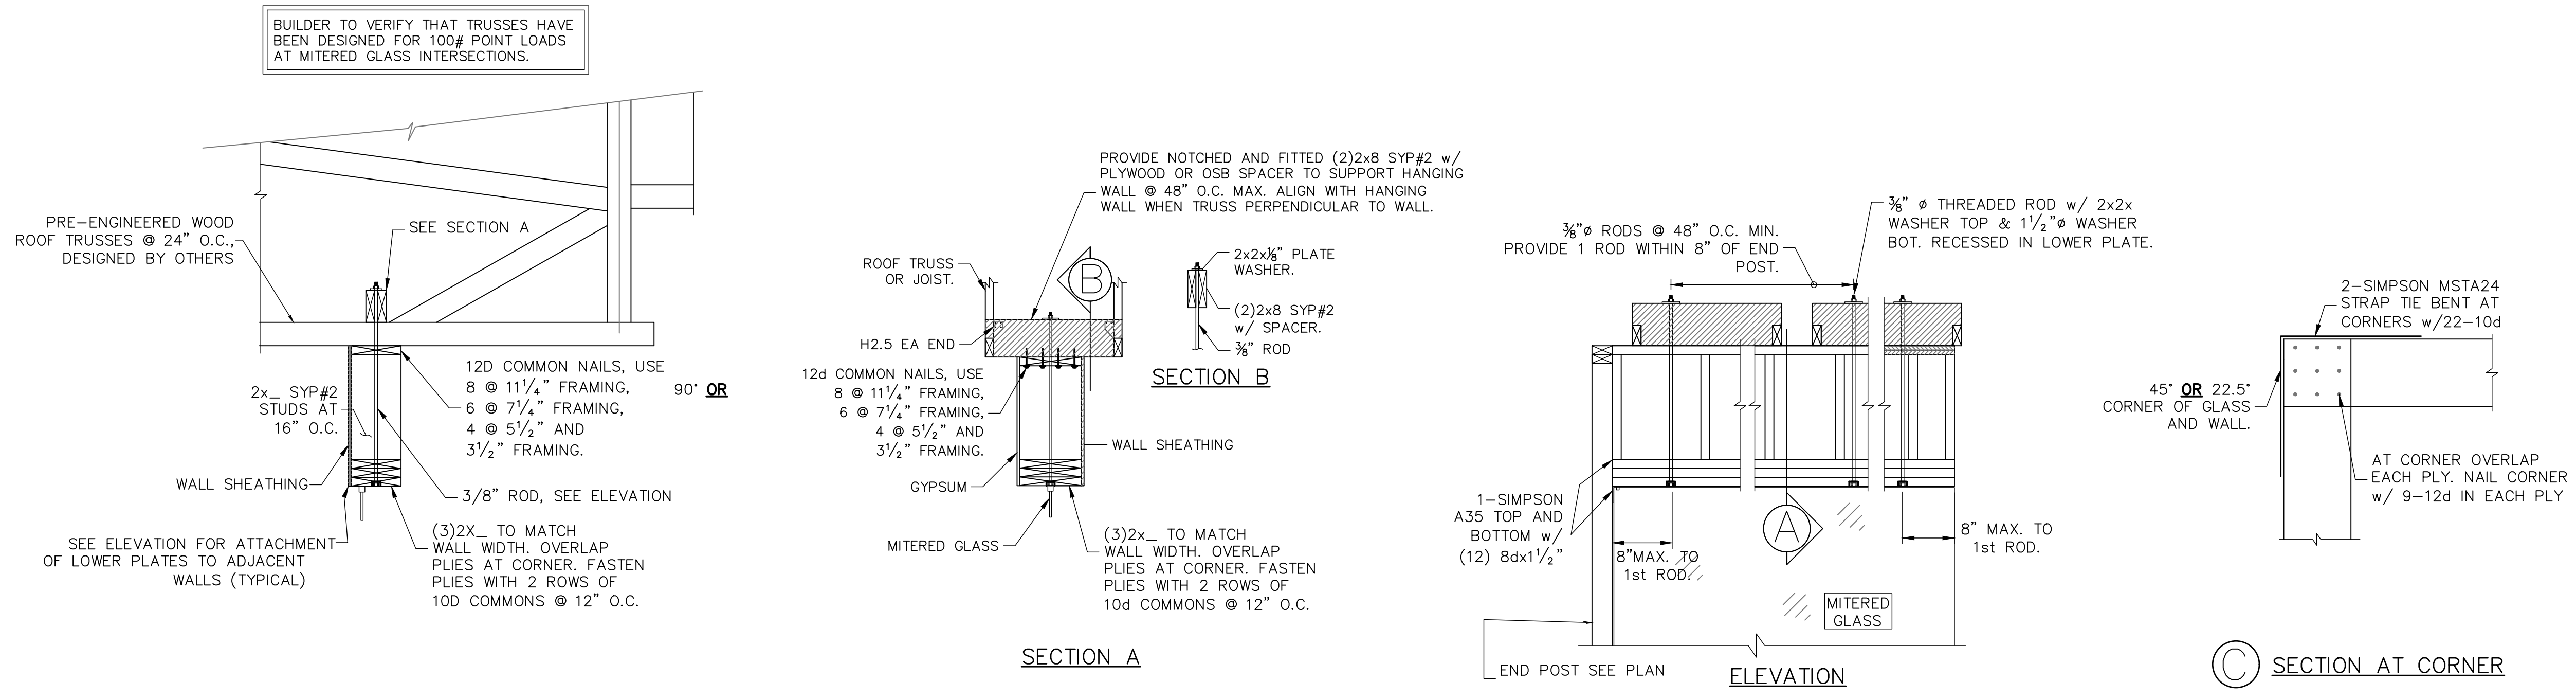

1 MITERED WINDOW HEAD FRAMING
SCALE: N.T.S.

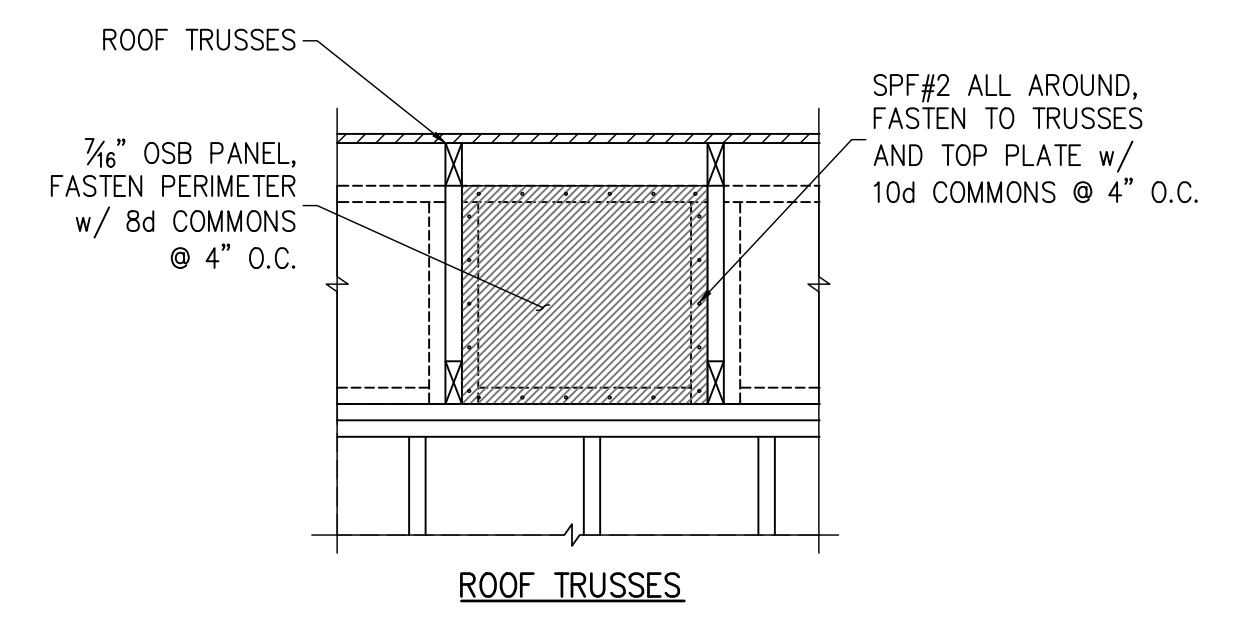

2 ROOF TRUSS OSB BLOCKING PANEL DETAILS

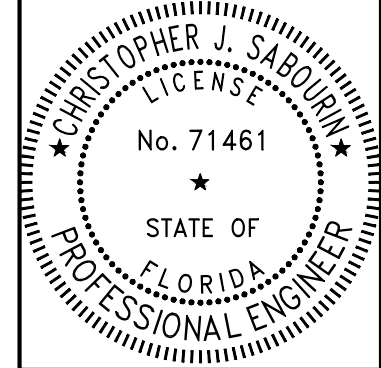

Christopher J. Sabourin
FL PE #71461

CHRISTOPHER J. SABOURIN STATE OF FLORIDA, PROFESSIONAL ENGINEER, LICENSE NO. 71461.

THIS DOCUMENT HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY CHRISTOPHER J. SABOURIN, PE ON 04/17/2025. A SHA AUTHENTICATION CODE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SHA AUTHENTICATION CODE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SABO
STRUCTURAL
ENGINEERING
CA#32529
235 9TH AVE N
JAX BEACH, FL 32250
904-712-5750
CHRIS@SABOENG.COM

PLAN NAME
OXLEY RESIDENCE
SSE No.
26-0103

ISSUE	DATE
PERMIT	XX.XX.XX
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR
OXLEY RESIDENCE

FIELD ALTERATION
CONTRACTOR SHALL CONTACT SABO STRUCTURAL ENGINEERING PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.R.

TYPICAL
SECTIONS
AND
DETAILS