



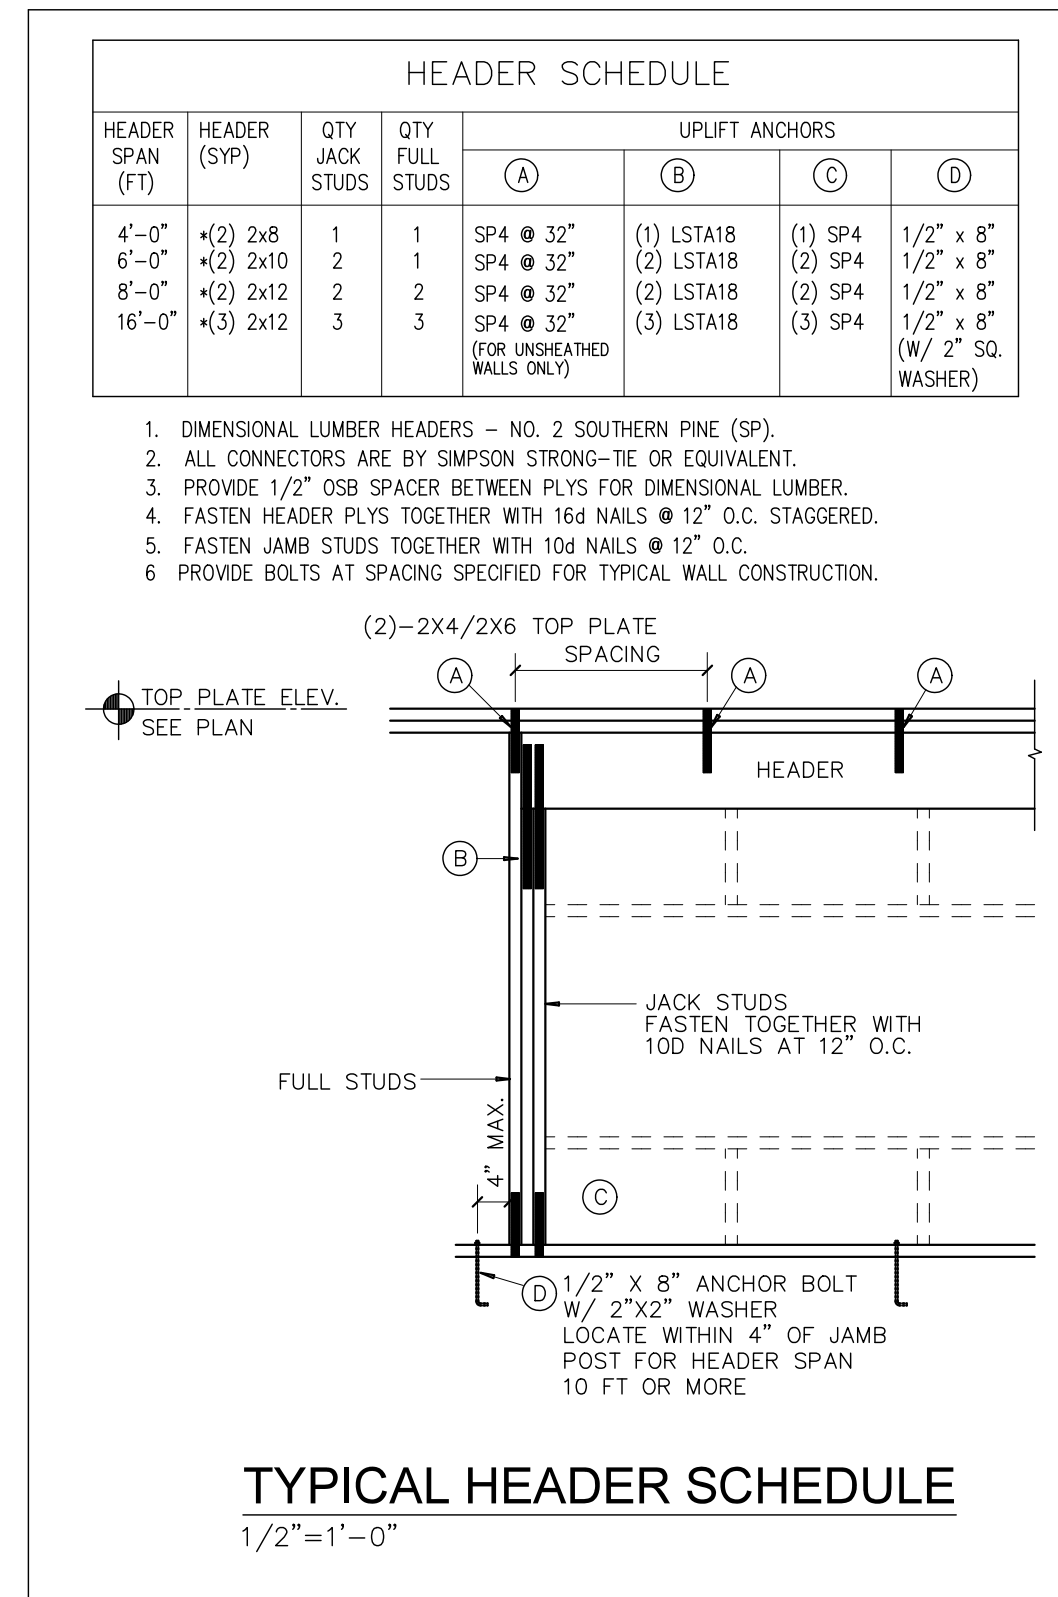

- 5. WINDOWS AND DOORS
 - A. GENERAL: FRAMING ARCHITECTURE IS NOT RESPONSIBLE FOR DESIGN OF CONSTRUCTION OR ATTACHMENT OF WINDOWS OR DOORS. THE BUILDING ENVELOPE IS DESIGNED AS FULLY EXPOSED, THEREFORE WINDOWS AND DOORS MUST BE DESIGNED TO RESIST THE COMPONENT AND CLADDING PRESSURES SHOWN.
 - B. CERTIFICATION: CONTRACTOR SHALL OBTAIN CERTIFICATION FROM MANUFACTURER INDICATING THAT THE WINDOW OR DOOR UNITS ARE CAPABLE OF RESISTING SPECIFIED WIND PRESSURES.
 - C. FASTENING: CONTRACTOR SHALL OBTAIN FASTENING INFORMATION FROM MANUFACTURER INDICATING FASTENER TYPE AND SPACING REQUIRED FOR EACH TYPE OF WINDOW OR DOOR UNIT.
 - D. PROTECTION OF OPENINGS: THIS BUILDING IS NOT LOCATED IN A WIND-BORNE DEBRIS REGION.
- 6. DESIGN SOIL BEARING CAPACITY ~ 2,000 PSF
- 7. COMPACT FILL TO 98% MAXIMUM DENSITY, MODIFIED PROCTOR
- 8. PLACE 10 MIL POLY VAPOR RETARDER OVER TREATED SOIL
- 9. CONCRETE STEEL REINFORCEMENT BAR GRADE 60
- 10. #4 BAR SPLICED 24", #5 BAR SPLICED 30"
- 11. CONCRETE 3000 PSI
- 12. STEEL ASTM A36
- 13. BOLTS ASTM A325

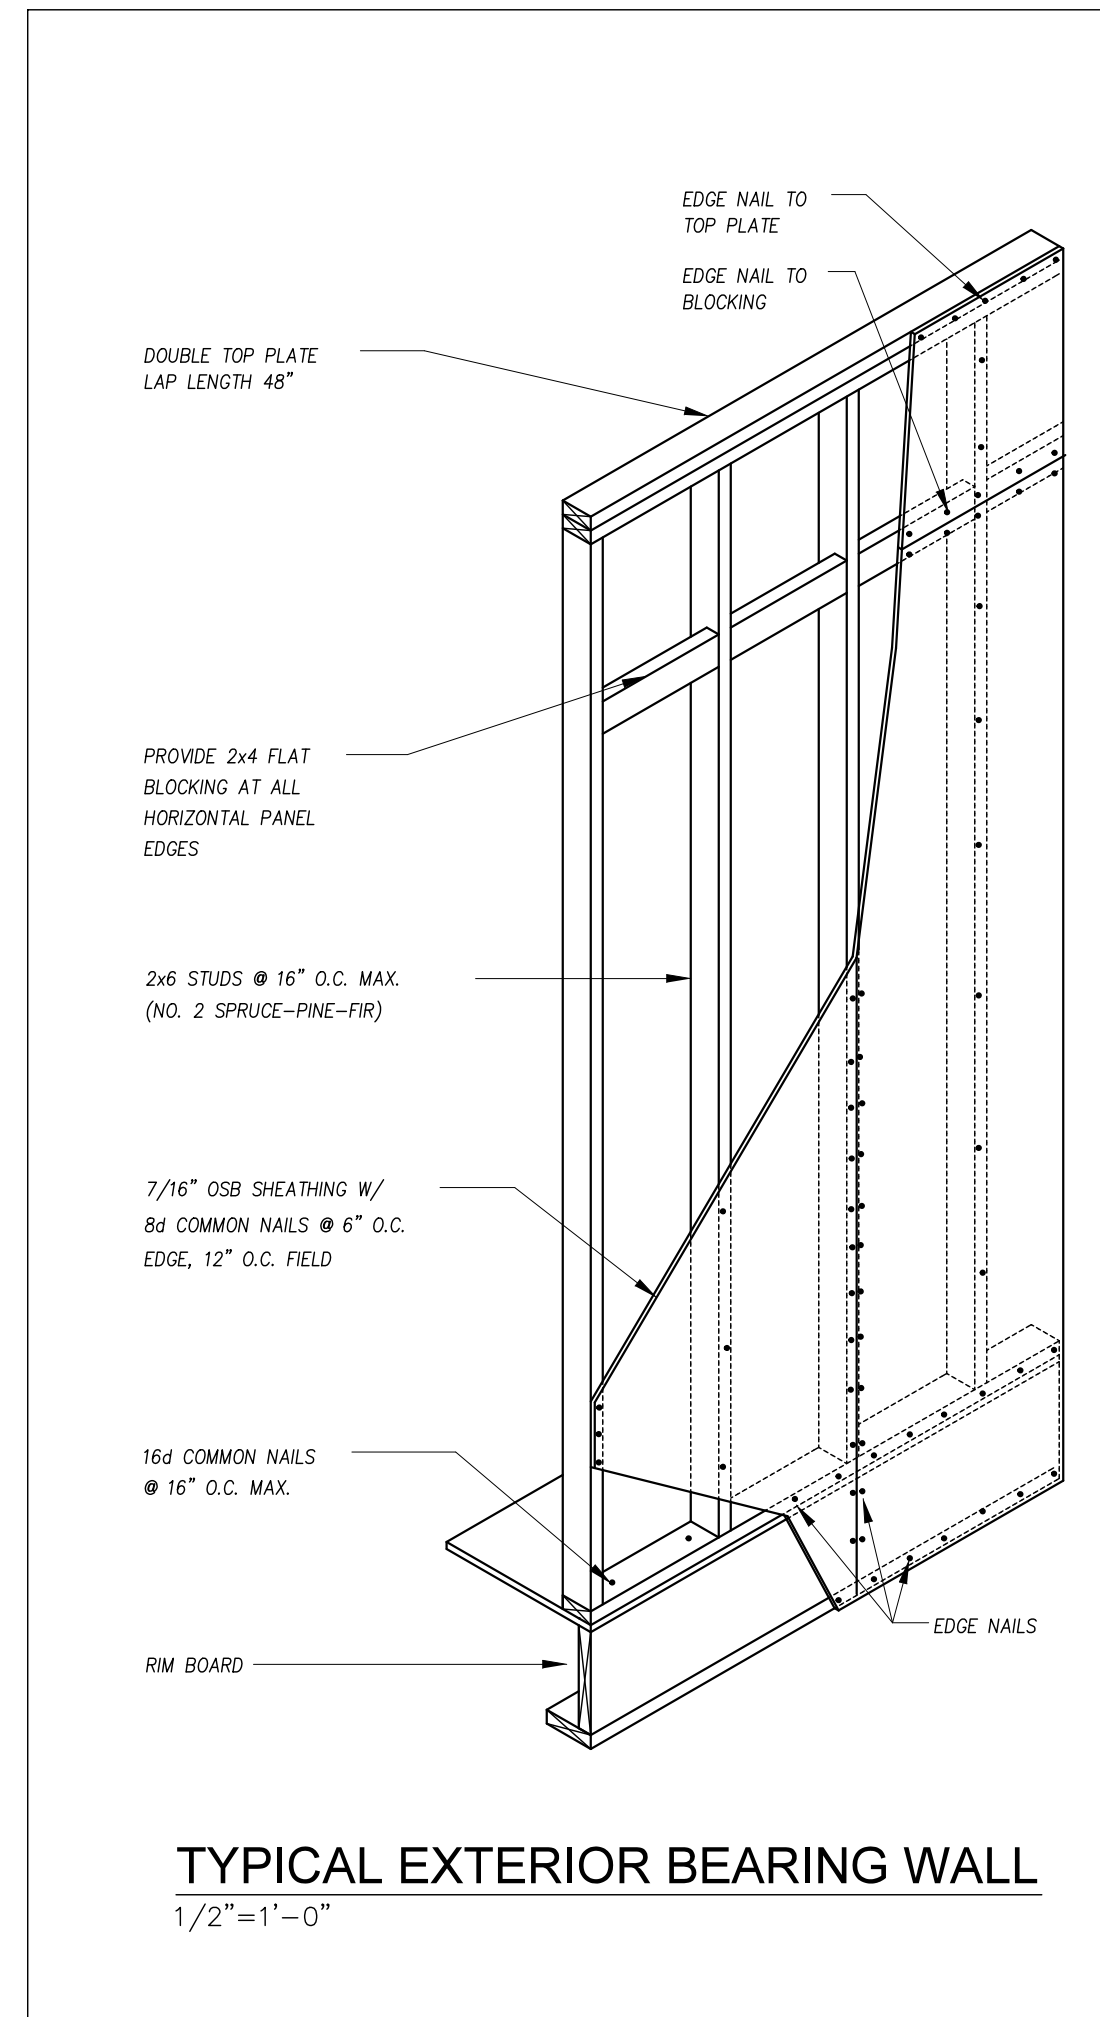