

Wind Load Analysis and Certification

Dubose Residence by GBI Homes

2023 Florida Building Code section 1609 according to ASCE 7-22

Ultimate Design Wind Speed (Vult) = 130 MPH (3 second gust)

Nominal Design Wind Speed (Vasd)) = 101 MPH

Risk Category = II

Exposure Category = B, Enclosed Building

Applicable Internal Pressure Coefficient = .18

Design Wind Pressure for use of External Components (Components and Cladding)= +32.1psf, -43.3psf

Roof Decking

7/16" or 5/8" OSB or 1/2", 5/8" or 3/4" CDX Decking; 48"x96" Sheets, Perpendicular to Roof Framing Members

8d common (.131" dia) or 8d ring-shank (.113" dia.) nails at 4" O.C. on Ends, 8" O.C. in Interior

Trusses or Rafters at 2' O.C. (horizontal distance), No Intermediate Blocking Required

Rafters: 2x6 SYP #2 up to 10' horizontal span, 2x8 SYP #2 up to 14' horizontal span

Shear Wall Segments

7/16" OSB or 1/2" CDX plywood, 48" Wide Sheets - Sheathing Continuous from Top Plate down to Pressure Treated Sole Plate Bearing on Foundation.

8d common (.131" dia) nails at 3" O.C. on Edges and Ends, 8" O.C. in Interior

Transverse Shearwall = 30', Longitudinal Shearwall = 30'

2x4 SPF (No. 1&2) Studs at 16" O.C., up to 12'

2x6 SPF (No. 1&2) Studs at 16" O.C., up to 17'

See attached detail for stud and jack requirements for wall openings

Nail Together Double Top Plate with two (2) 12-d comm nails every 16" O.C. (SYP top plates)

Other Wall Segments - Same as Shear Walls

Gabled End Wall Framing

Balloon Frame (see details) or see attached alternate details.

T-Block (with 2x4's) bottom chord of porch gable trusses at 4' O.C to 4' from gable end-truss (see detail)

Gable overhangs without out-lookers limited to 12" total overhang

Special Notes: All headers and beams to be double 2x12 SP#2. Attach all multiple studs, jacks and corners together with 12d comm at 6" O C staggered.

This structural and windload analysis is based on the attached truss layout. Any deviation from the attached layout invalidates this structural and windload analysis.

Footings and Foundations (Based on Truss Engineering)

20" deep x 14" wide monolithic with 2-#5's, Continuous, 3000 psi Concrete

or: 20" Wide x 10" Deep 3000 psi Concrete Strip Footing with 2-#5's, Continuous

8"x8"x16" Concrete Masonry Stenwall, Minimum 2 Courses, Maximum 4 Courses, Fully Grouted, except sections over 3 courses need only cells with rebar to be grouted. 1-#5 Vertical Dowel at Corners and 6'-0" O.C. (10" hook top and bottom) (min 25" lap all #5 rebar)

(1) #5 continuous top course. All 4" slabs requires 6x6 WWM

Interior footers: 16" wide by 10" deep (including 4" slab) with 2-#5's, Continuous,

Note: It is the contractors responsibility to install all necessary interior footers per truss manufacturers requirements based on the attached truss layouts and any interior shearwalls.

Porch Footers: 16" deep x 14" wide monolithic with 2-#5's, Continuous or see above or: 8" wide by 8" deep bell footing with 1-#5, Continuous with minimum of 30"x30" x 15" pad under each post (w/ 3- #5 each way)

Note: footer design based on continuous bearing of 2000 psf. Movement – The information presented in this document is not calculated or intended for the use or purpose of mitigating or addressing unsuitable soils or subsurface conditions in any way or manner, whatsoever.

Hurricane-Resistance Hardware (Based on Truss Engineering)

Truss Clips/Headers/Girders/Posts/Beams /Top and Bottom of Wall Unit - See Table


Note: regarding strapping of headers and beams, 50% of the strap shall be on the header/beam and 50% of the strap is on the supporting member below it (jacks and posts).

Anchor Bolts- 1/2"Dia. x 10" J Bolts (with min 7.5" embedment) at 48"O.C. (First bolt at 9" from Corner, then 48" O.C.) and at each end of Each Opening (2" round or square washers).

I hereby certify that the accompanying Wind Load Analysis for the **Dubose Residence**, demonstrates compliance with the 2023 FBC section 1609 according to ASCE 7-22, to the best of my knowledge.

Frank J. Sapienza Jr.
License Professional Engineer
Florida License Number 48566

This item has been digitally signed and sealed by FRANK J SAPIENZA JR PE using Digital Signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

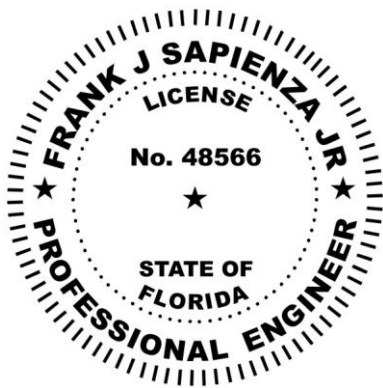

Frank J
Sapienza
Jr

Digitally signed
by Frank J
Sapienza Jr
Date: 2026.07.21
14:25:44 -04'00'

HOLD-DOWN TABLE

Wood Sections

	Uplift Force Lbs	Top Connector Simpson **	Rating Lbs	Bottom Connector Simpson **	Rating Lbs
HEADERS					
	up to 455 lbs	LSTA9	775	H3	455
	up to 910 lbs	LSTA12	970	2-H3	910
	up to 1235 lbs	LSTA18	1235	LTTP2	1680
	up to 1940 lbs	2-LSTA12	1940	LTTP2	2275
	up to 2470 lbs	2-LSTA18	2470	HTT4	3000
	up to 3000 lbs	3-LSTA18	3705	HTT4	3000
	up to 3705 lbs	3-LSTA18	3705	HTT5	4350

To determine uplift force on header at each end, total the uplifts for each truss resting on the header and divide by 2 (assumes uniform load) **Note:** must use proper bolt anchors sufficient to support required load

Trusses/Girders - Uplift

up to 600 lbs - use H2.5A top, no special device required at bottom
over 600 lbs but under 990 lbs use H10 top, no special device required at bottom
up to 1230 lbs use H6 or equivalent at top and LTTP2 at bottom
up to 1680 lbs use 2-H6 or equivalent at top and LTTP2 at bottom
up to 2460 lbs use 2-H6 or equivalent at top and HTT4 bottom
up to 3690 lbs use 3-H6 or equivalent at top and HTT5 bottom
Must Use proper bolt anchors

Note: it is the contractors responsibility to provide a continuous load path from truss/rafter/ridge beam to foundation

Strap rafters to truss or at each end with min uplift resistance of 450 lbs each end

Strap ridge beam at each end with min uplift resistance of 1800 lbs

Note: Three (3) 12d comm toenails (2 on one side, one on the other) required per truss/rafter per bearing point into plate to resist both lateral loads (wall to truss) and transverse loads

Horizontal Resistance (from truss loads) - Note: these devices are in addition to required toe-nails

up to 110 lbs - use H2.5A	Note: hardware to be used must satisfy both
up to 525 lbs use H10	uplift and horizontal resistance, combination
up to 1090 lbs use H10 plus A23	of devices is acceptable

	top		bottom	
BEAM SEATS	LSTA18*	1235	LTTP2*	1680
POSTS	2-LSTA18	2400	ABU44 or ABU66	2200
	* or per truss engineering		Must Use proper bolt anchors	

STUDS

Wall Sheathing Nailing Adequate Exterior Walls bottom (8d nails at 3" O.C.), must cover sill plate

Wall Sheathing Nailing Adequate Exterior Walls Top (8d nails at 3" O.C.), as long as sheathing covers top plate, otherwise use SP2 @32" O.C. in addition to sheathing nailing,

Use SP2 top and SP1 bottom each stud an anchor bolts @ 32" O.C. for all interior load bearing walls that have uplift. Interior anchor bolts to be 1/2" x 10" A307 or 1/2" x 6" Titan HD with 2" washers

Please Note: All Beams must be sheathed or strapped to double top plate (if applicable)

An equivalent device of same or other manufactures can be substituted for any of the devices specified on this page as long as it meets the required load capacities

Note: For nailing into SPF members, multiply table values by .86

Number of Jack and Stud Requirements per Opening Width
2x4 or 2x6 SPF #1&2 Construction – max Wall Height=12'
(based on 16" O.C. Stud Spacing)

Header		
Jacks		
Opening Width	#of Jacks	#of Studs
up to 4'	1	1
up to 6'	2	1
up to 9'	2	2
up to 12'	3	2
up to 14'	3	3
up to 18'	4	3
over 18' must be engineered		
Opening Width		
Studs		

Note – Based on uniform loads. Heavy concentrated loads require engineering review

Acceptable Framing Method for Balloon Framed Gable End-Wall with trusses

Balloon Frame with 2x4 SPF No.1&2 @ 16" O.C. with the Following Conditions:

Up to 12' - Block at 8'

Over 12' but Under 14' - 2x4 SYP #2 at 16" O.C. and Block at 4',8'&12'

Over 14' but Under 17' - Double 2x4 SYP #2 at 16" O.C. and block at 4',8',12'&16'


Over 17' but Under 20' - Triple 2x4 SYP #2 at 16" O.C. and block at 4',8',12'&16'

Over 20' but Under 23' - Quadruple 2x4 SYP #2 at 16" O.C. and block at 4',8',12',16'&20'

Over 23' - Must be Engineered

In all cases a minimum of a double full length stud is
required at each side of openings such as doors and windows

Blocking must be parallel to top and bottom plates with a minimum
of 2-12d comm nails

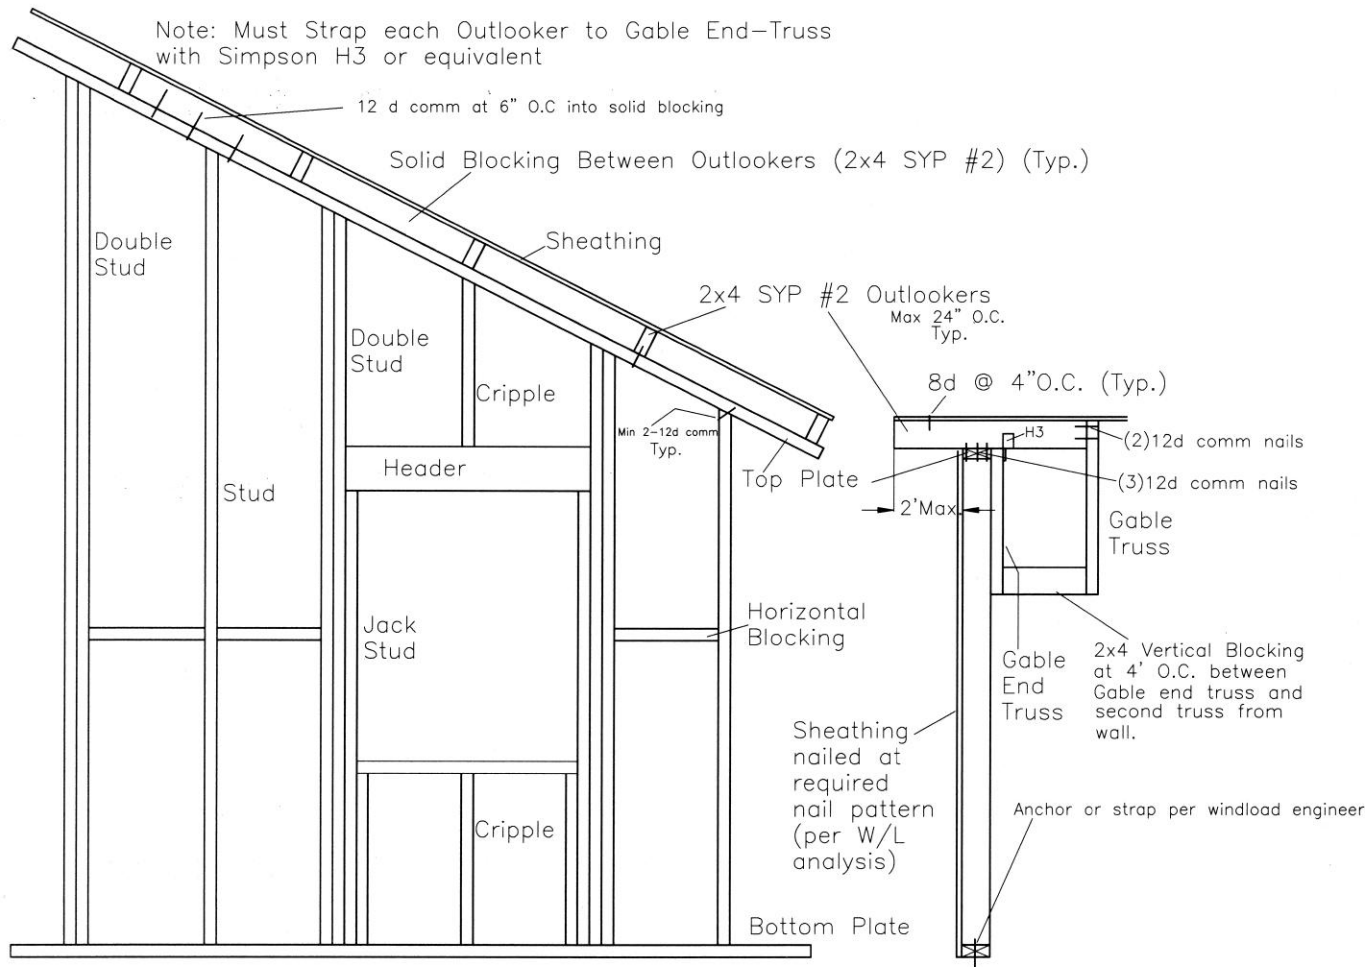

F. Sapienza, P.E.

Acceptable Framing Method for Balloon Framed Gable End-Wall

Balloon Frame with 2x6 SYP No.2 @ 16" O.C. with the Following Conditions:

Up to 18' - Block at 8' and 16'


Over 18' but Under 21' - Double stud and block at 8' & 16'

Over 21' but Under 24' - Triple SYP #2 and block at 4', 8', 12' & 16'

Over 24' - Must be Engineered

In all cases a minimum of a double full length stud is required at each side of openings such as doors and windows


Blocking must be parallel to top and bottom plates with a minimum of 3-12d comm nails

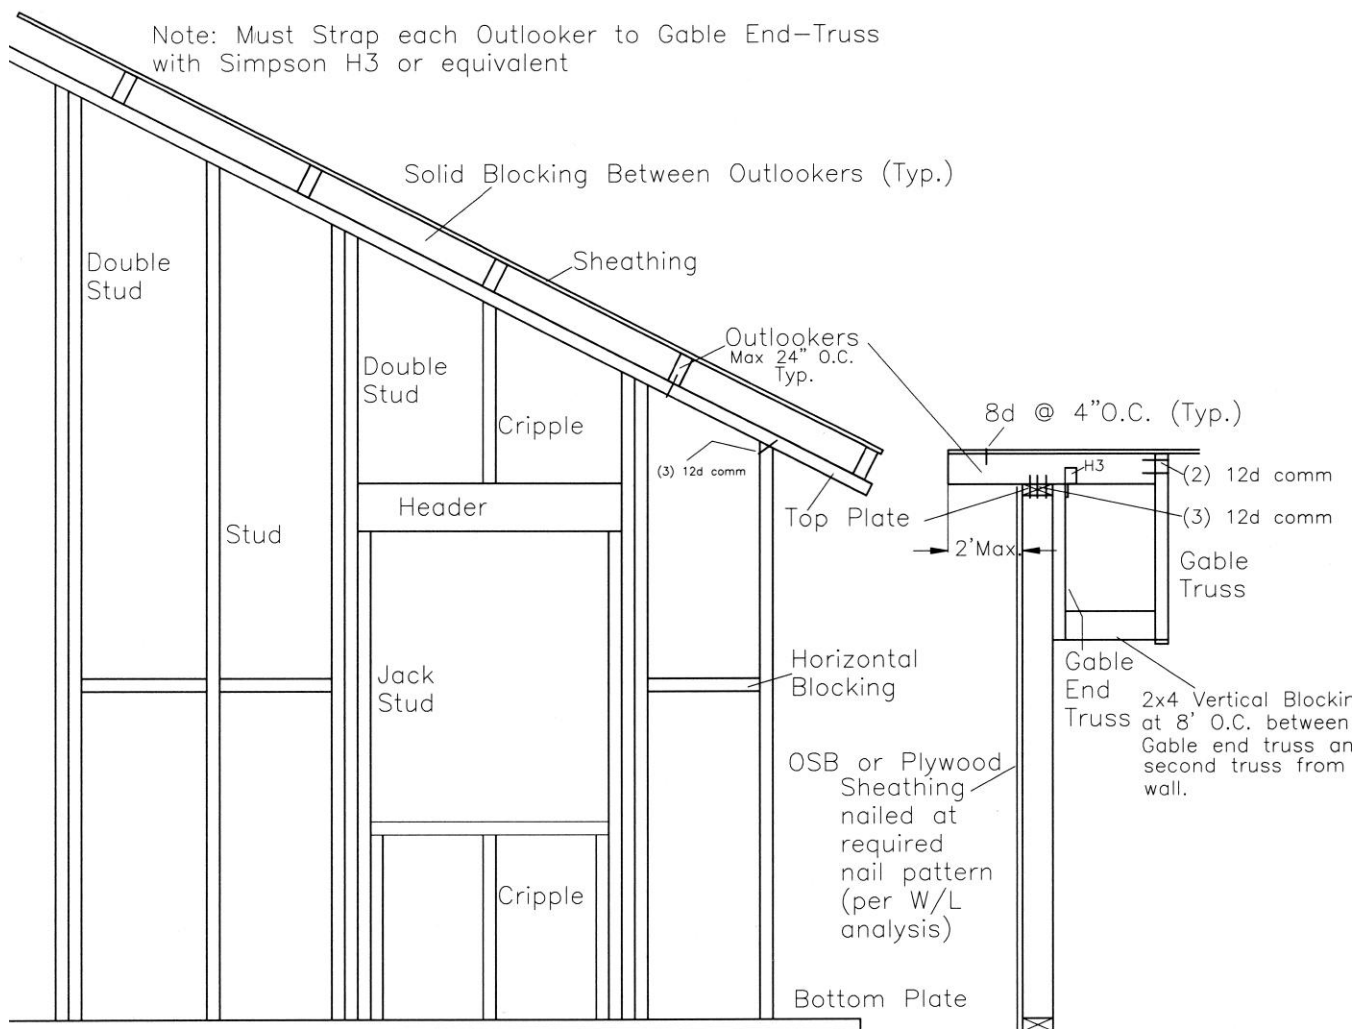


F. Sapienza, P.E.


Gable Endwall Framing with Gable End-Truss

See Balloon Framed Detail for Outlooker framing requirements

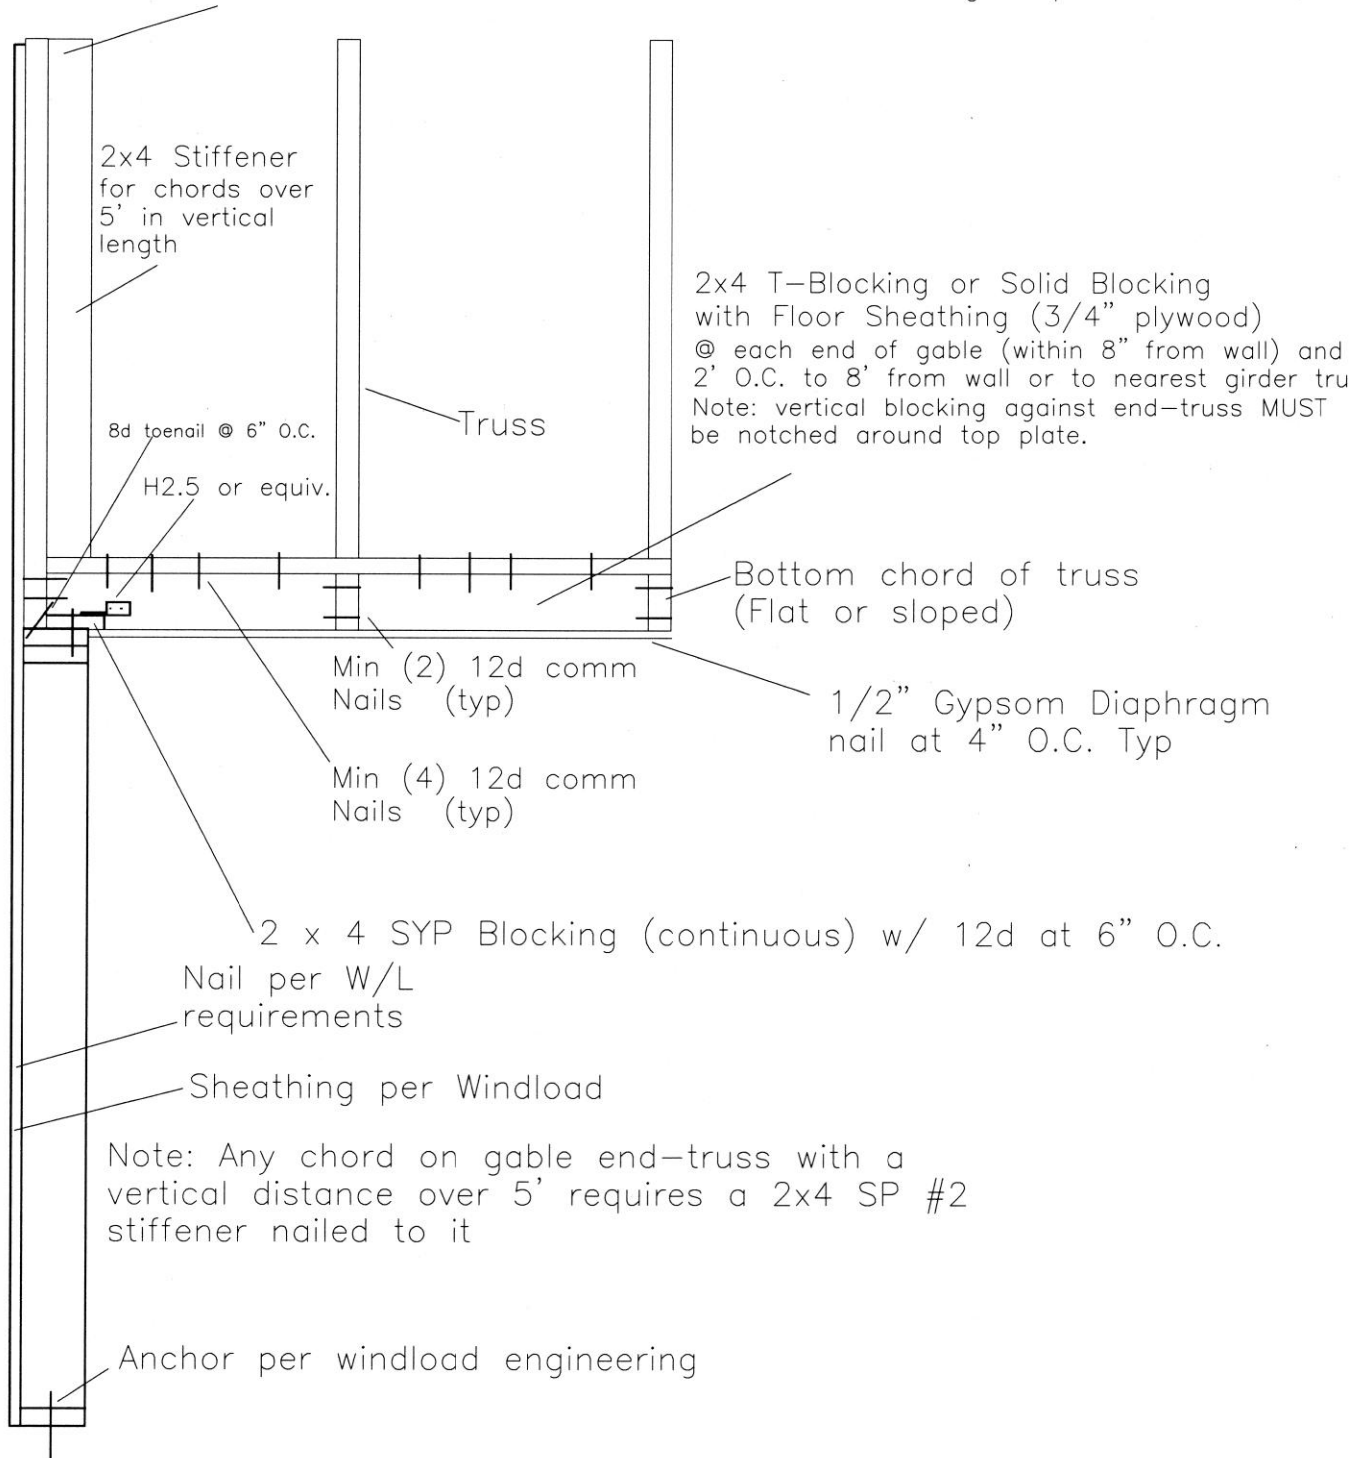


Porch Gable Outlookers and T-Blocking

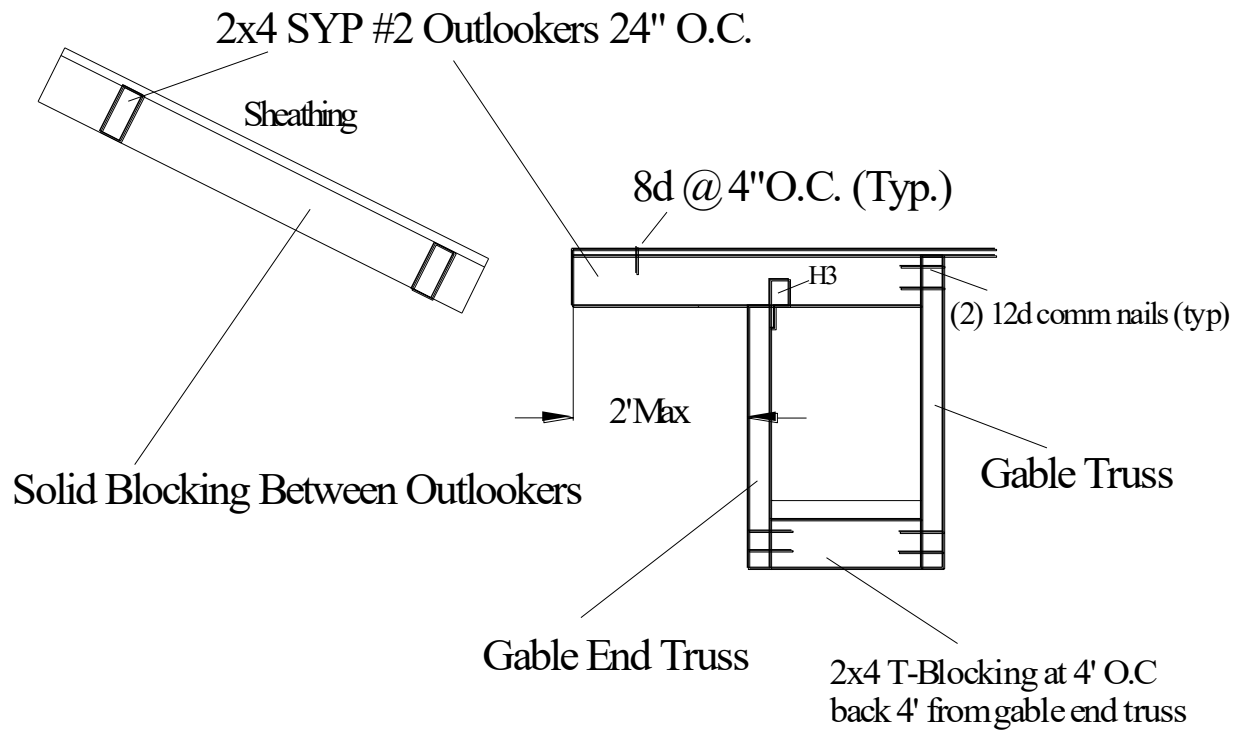



A-4	SHEET:	SCALE: 3/16" = 1'	DATE: 7/10/2026	DRAWINGS PROVIDED BY:	PROJECT DESCRIPTION:	SHEET TITLE: Framing Plan	NO	DESCRIPTION	BY	DATE
				G Buzbee Inc	Dubose Res					
				17774 NW US Hwy 441	TBD S US Hwy 441					
				High Springs, FL 32643	High Springs, FL 32643					

6/12 - 3/12 PITCH - 18" OH

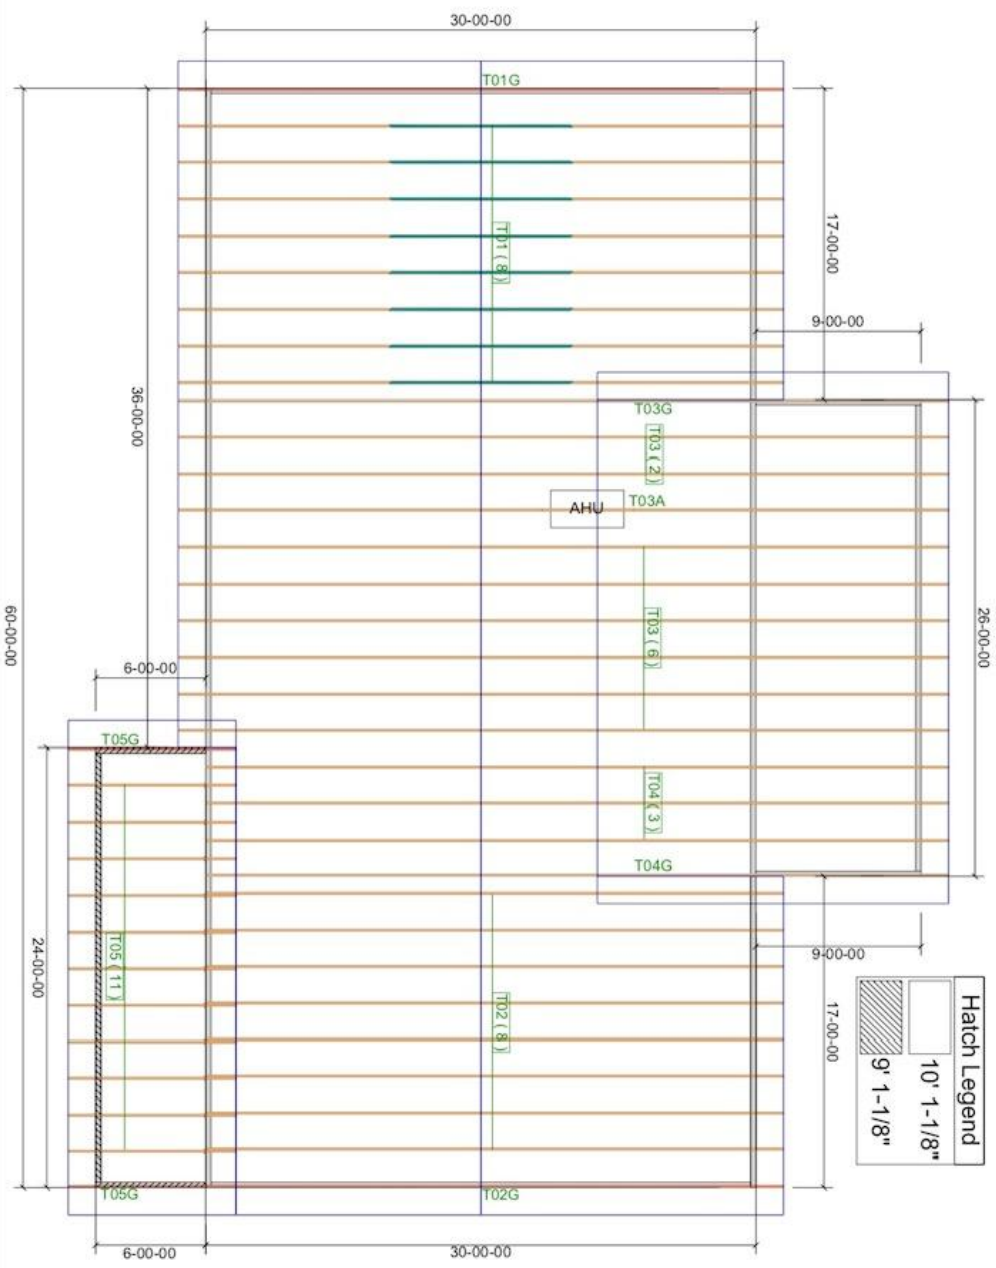

Summaries of limited excerpts of the Code, ANSI/TPI 1-2014, and BCSI, and associated commentary, are provided within the truss submittal package in the Builders FirstSource Component Truss Responsibility and Liability Disclosure. These critical excerpts include, among other elements, critical safety information as well as specific Scope-of-Work assignments (and limitations of the same) for the Owner, Contractor, Building Designer, Truss Designer, and Truss Manufacturer. It is essential that ALL parties to the design and use of the Trusses review and become familiar with the information provided in the Builders FirstSource Component Truss Responsibility and Liability Disclosure, as well as the referenced sources, prior to performing work on the associated project.

WARNING:
Builders FirstSource is not responsible for the design of the truss system. The design of the truss system is the responsibility of the truss designer. Builders FirstSource is not responsible for the design of the truss system. The design of the truss system is the responsibility of the truss designer.

IMPORTANT:
This Drawing Must Be Approved And Sealed Before Production. It is the responsibility of the truss designer to ensure that the truss system is designed in accordance with the applicable code requirements. The truss designer is responsible for the design of the truss system. The design of the truss system is the responsibility of the truss designer.

FINAL LAYOUT FOR PRODUCTION:
The truss designer is responsible for the design of the truss system. The design of the truss system is the responsibility of the truss designer.

TRUSS DATA:
TRUSS TYPE: 6/12 - 3/12
ROOF PITCH: 6/12 - 3/12
CEILING PITCH: FLAT
TOP CHORD SIZE: 2 x 4
BOTTOM CHORD SIZE: 2 x 4
OVERHANG LENGTH: 18"
END CUT: PLUMB
CANTILEVER: NA
TRUSS SPACING: 24"
BUILDING CODE: IRC 2021

BEARING RESIST SCHEDULE:
The truss designer is responsible for the design of the truss system. The design of the truss system is the responsibility of the truss designer.

BUILDERS:
G. Buzbee, Inc.
MODEL:
CUSTOM
ELEV:
GABLE
ADDRESS:
TPO 515 HWY 441
LOT 7, BLOCK: NA
SUBDIVISION: DUBOISE RES.
CITY: Big Spring
COUNTY: HARRIS
STATE: TX
DATE: 1/1/2024
SCALE: N.T.S.

REVISIONS:
The truss designer is responsible for the design of the truss system. The design of the truss system is the responsibility of the truss designer.

