

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

**Product Evaluation Report
FREEDOM METALS, LLC.**

29 Ga. Freedom Tuff Roof Panel over 1x4 Wood Purlins

Florida Product Approval # 33548.3

Florida Building Code 2020
Per Rule 61G20-3
Method: 1 -D

Category: Roofing
Subcategory: Metal Roofing
Compliance Method: 61G20-3.005(1)(d)
NON HVHZ

Product Manufacturer:

Freedom Metals, LLC
18504 SE Highway 19
Cross City, Florida 32628

Engineer Evaluator:

Johnathan Green, P.E. #88223
Florida Evaluation ANE ID: 12901

Validator:

Brian Jaks, P.E. #70159

Contents:

Evaluation Report Pages 1 - 5




OCT 19 2020

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

FL# 33548.3

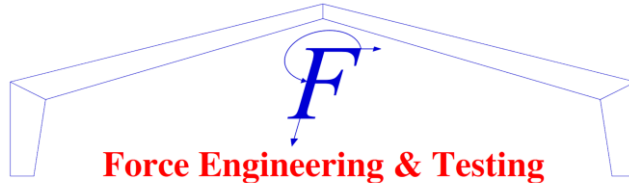

Force Engineering & Testing

19530 Ramblewood Drive
 Humble, Texas 77338
 Phone: (281) 540-6603 FAX: (281) 540-9966
 Website: www.forceengineeringtesting.com


- Compliance Statement:** The product as described in this report has demonstrated compliance with the Florida Building Code 2020, Sections 1504.3.2, 1504.7.
- Product Description:** Freedom Tuff, 29 Ga. Steel, 36" coverage, through fastened roof panel over 1x4 wood purlins over one layer of asphalt shingles (optional) over min. 7/16" OSB decking. Non-Structural Application.
- Panel Material/Standards:** Material: Minimum 29 Ga. Steel conforming to Florida Building Code 2020 Section 1507.4.3.
 Yield Strength: Min. 80.0 ksi
 Corrosion Resistance: Panel Material shall comply with Florida Building Code 2020, Section 1507.4.3.
- Panel Dimension(s):** Thickness: 0.014" min.
 Width: 36" maximum coverage
 Rib Height: 3/4" major rib at 9" O.C.
- Panel Fastener:** #10-16 x 1 1/2" WoodZip HiLo TP-17 with sealing washing or approved equal.
 Corrosion Resistance: Per Florida Building Code 2020, Section 1507.4.4.
- Substrate Description:** Min. 1x4 No. 2 wood purlins over maximum one layer of asphalt shingles/felt paper (optional) over min. 7/16" OSB decking over supports at maximum 24" O.C. The 1x4 wood purlins attached through decking into rafters with (2) #9 x 3" deck screws (Min. 1 1/2" screw penetration into rafters) at 24" O.C. maximum. Substrate must be designed in accordance w/ Florida Building Code.

Allowable Design Uplift Pressures:

Table "A"


Maximum Allowable Uplift Design Pressure:	78.5 psf	127.3 psf	176.0 psf
Fastener Pattern:	9"-9"-9"-6"-3"	9"-9"-9"-6"-3"	9"-9"-9"-6"-3"
Fastener Pattern / 1x4 Purlin Spacing:	24" O.C.	18" O.C.	12" O.C.

*Design Pressure includes a Safety Factor = 2.0.

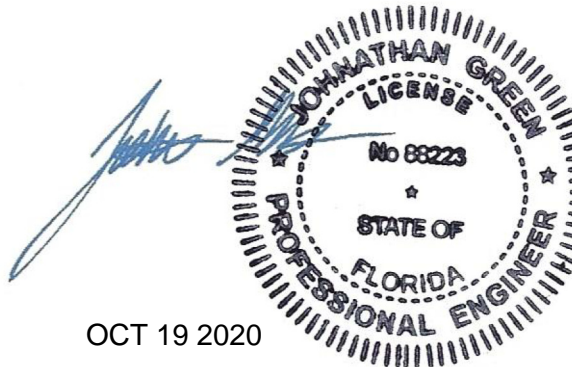

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

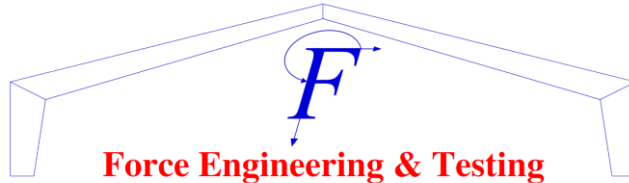

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966


Website: www.forceengineeringtesting.com

- Code Compliance:** The product described herein has demonstrated compliance with The Florida Building Code 2020, Section 1504.3.2, 1504.7.
- Evaluation Report Scope:** The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2020, as relates to Rule 61G20-3.
- Performance Standards:** The product described herein has demonstrated compliance with:
- UL 580-06 - Test for Uplift Resistance of Roof Assemblies
 - UL 1897-2012 - Uplift Test for Roof Covering Systems
 - FM 4471-92 - Foot Traffic Resistance Test
- Reference Data:**
1. UL 580-06 / 1897-2012 Uplift Test
Force Engineering & Testing (FBC Organization # TST-5328)
Report No. 731-0141T-20.
 2. FM 4471-10, Section 4.4 Foot Traffic Resistance Test
Force Engineering & Testing (FBC Organization # TST-5328)
Report No. 731-0141T-20.
 3. Certificate of Independence
By Johnathan Green, P.E. #88223
- Test Standard Equivalency:** The FM 4471-10, Foot Traffic Resistance test standard is equivalent to the FM 4471-92, Foot Traffic Resistance test standard.
- Quality Assurance Entity:** The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
- Minimum Slope Range:** Minimum Slope shall comply with Florida Building Code 2020, including Section 1507.4.2 and in accordance with Manufacturers recommendations. For slopes less than 3:12, lap sealant must be used in the panel side laps.



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

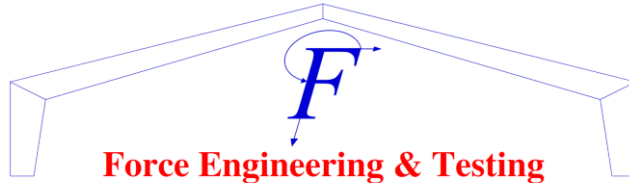

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966

Website: www.forceengineeringtesting.com

- Installation:** Install per manufacturer's recommended details.
- Underlayment:** Per Florida Building Code 2020, Section 1507.1 and manufacturer's installation guidelines.
- Roof Panel Fire Classification:** Fire classification is not part of this evaluation.
- Shear Diaphragm:** Shear diaphragm values are outside the scope of this report.
- Design Procedure:** Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2020 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2020 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.




THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.


OCT 19 2020


FL# 33548.3

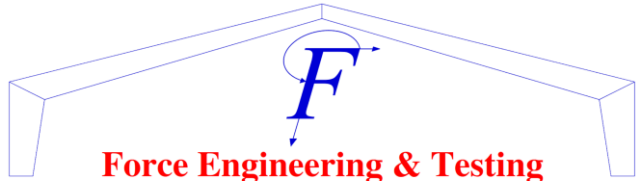


Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

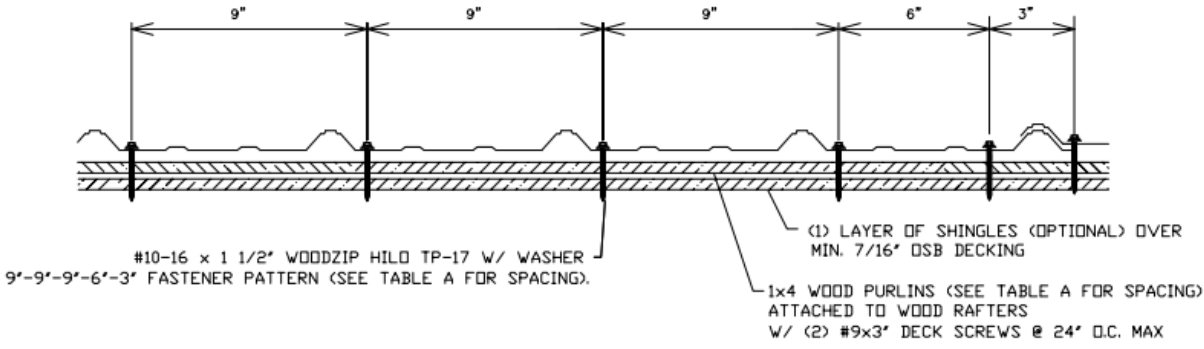


OCT 19 2020

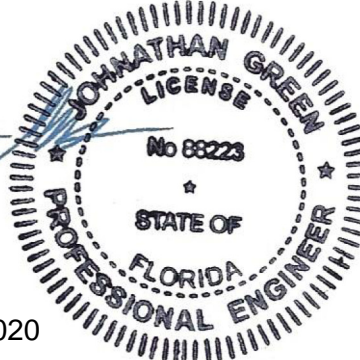

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.