

General Notes

A. CONCRETE & FOUNDATION DESIGN:

1. ALL CONCRETE GRADE BEAMS AND FOOTINGS SHALL BE 3000 PSI MINIMUM.
2. ALL CONCRETE FILLED SUPPORTED SLABS SHALL BE 2500 PSI MINIMUM, 3 1/2" NOMINAL THICKNESS.
3. FIBERMESH (3/4" PER CUBIC YARD MIN.) MEETING APPROPRIATE ACI AND ASTM REQUIREMENTS MAY BE USED IN LIEU OF WELDED WIRE MESH.
4. ALL SLABS ON GRADE SHALL BE 4" THICK WITH FIBERMESH.
5. ALL REINFORCING SHALL CONFORM TO ASTM A615, BE GRADE 60 (60 KSI MIN), DEFORMED BARS, #3 BARS MAY BE GRADE 40 BE 3000 PSI MIN., 2" MINIMUM THICKNESS.
6. ALL OVER POUR CONCRETE FILLED SUPPORTED SLABS SHALL BE 3000 PSI MIN., 2" MINIMUM THICKNESS.
7. SOIL BEARING PRESSURE SHALL BE A MINIMUM OF 1500 PSF.
8. THE CONCRETE SHALL CONFORM TO ASTM C94 FOR THE FOLLOWING:
 - OPC (PORTLAND CEMENT TYPE 1, - ASTM C 150),
 - AGGREGATES - #6 STONE, ASTM C 33 SIZE NO. 67 LESS THAN 3/4"
 - AIR ENTRAINING +/- 1% - ASTM C 260.
 - WATER REDUCING AGENT - ASTM C 494.
 - CLEAN POTABLE WATER.
9. OTHER ADMIXTURES SHALL NOT BE PERMITTED.
10. METAL WELDED WIRE SHALL CONFORM TO ASTM A 185.
11. PREPARE & PLACE CONCRETE ACCORDING TO AMERICAN CONCRETE INSTITUTE MANUAL STANDARD PRACTICE, PART 1, 2, & 3 ALONG WITH HOT WEATHER CONDITIONS RECOMMENDATIONS.
12. IF UTILIZING EXISTING CONCRETE FOR FOUNDATION, CONCRETE SHALL BE A MINIMUM OF 4" IN THICKNESS, VISIBLY FREE OF ANY STRUCTURAL EXCESSIVE CRACKING, SPALLING OR OTHER DETERIORATION.

B. MASONRY:

1. CONCRETE MASONRY UNITS (CMU) SHALL BE STANDARD HOLLOW UNITS AND SHALL BE 1900 PSI MINIMUM BASED ON TYPE M OR S MORTAR.
2. ALL MORTAR SHALL BE OF TYPE M OR S.
3. ALL GROUT SHALL BE 2000 PSI MINIMUM AND HAVE MAXIMUM COARSE AGGREGATE SIZE OF 3/8".
4. PROVIDE CLEAN-OUTS FOR REINFORCED CELLS CONTAINING REINFORCEMENT WHEN GROUT POUR EXCEEDS 5'-0" IN HEIGHT.

C. ALUMINUM:

1. ALL STRUCTURAL ALUMINUM SHALL CONFORM TO THE MINIMUM REQUIREMENTS OF 6005-T5 FOR ALLOY WITH A MINIMUM THICKNESS OF 0.040" FOR SUPPORTING MEMBERS.
2. WHERE KICK PLATES ARE USED A MINIMUM THICKNESS OF 0.024" SHALL APPLY.
3. STRUCTURAL ALUMINUM DESIGN CONFORMS TO "PART 1-A - SPECIFICATIONS FOR ALUMINUM STRUCTURES - ALLOWABLE STRESS DESIGN" OR "PART 1-B - SPECIFICATIONS FOR ALUMINUM STRUCTURES - BUILDING LOAD AND RESISTANCE FACTOR DESIGN" OF THE ALUMINUM DESIGN MANUAL PREPARED BY THE ALUMINUM ASSOCIATION, INC., WASHINGTON D.C., THE *FLORIDA BUILDING CODE 7TH EDITION* (CHAPTER 16 STRUCTURAL DESIGN & CHAPTER 20 ALUMINUM).
4. WHERE ALUMINUM COMES INTO CONTACT WITH STEEL, OR PRESSURE TREATED LUMBER PROVIDE DIELECTRIC SEPARATION.
5. ALUMINUM MEMBERS SHALL BE STITCHED WITH NO LESS THAN #12 SMS 6" FROM THE ENDS AND 12" ON CENTER, IF USING #12 SPACING MAY BE 24" ON CENTER.
6. VINYL AND ACRYLIC PANELS SHALL BE REMOVABLE. THEY SHALL BE IDENTIFIED WITH A DECAL ESSENTIALLY STATING "REMOVABLE PANEL SHALL BE REMOVED WHEN WIND SPEEDS EXCEED 75 MPH". DECAL SHALL BE PLACED SO IT IS VISIBLE WHEN PANEL IS INSTALLED.
7. 1"x2"x0.045" NON-STRUCTURAL MEMBERS SHALL BE ATTACHED TO HOST WITH 1/4"x1.3/4" EMBEDMENT & 24" O.C. MASONRY SCREW FOR CONCRETE & EQUIVALENT SIZE WOOD SCREW WHEN IN WOOD & #10X 1/2" EMBEDMENT SMS OR TEK SCREWS IN ALUMINUM MEMBERS TYPICAL.

D. FASTENERS:

1. ALL LAG BOLTS SHALL CONFORM TO STAINLESS STEEL TYPE 300 18-8, WITH STANDARD FLAT WASHER UNLESS MANUFACTURER GALVANIZES BOLTS SPECIFICS FOR USE WITH ACQ PRESSURE TREATED WOOD.

2. HEX BOLTS HAS TO BE ASTM A 325, PLATED WITH STANDARD FLAT WASHERS AND NUTS.
3. ALL CONCRETE SCREWS SHALL BE SIMPSON, HILTI, RAWL, TAPCON, REDHEAD, DYNABOLT, PORTECT OR APPROVED EQUAL.
4. ALL METAL TIES AND ASSOCIATED ACCESSORIES SHALL BE HOT DIPPED GALVANIZED.
5. ALL LAG BOLTS SHALL HAVE A MINIMUM EMBEDMENT OF 8X BOLT DIAMETER INTO STRUCTURAL FRAMING (G-42 MIN.).
6. LAG BOLTS AND SCREWS INTO WOOD FRAMING SHALL BE PROVIDED WITH PILOT HOLES HAVING A DIAMETER NOT GREATER THAN 70 PERCENT OF THE THREAD DIAMETER OF THE BOLT OR SCREW. ALL LAG BOLTS AND SCREWS SHALL BE INSERTED IN PILOT HOLES BY TURNING AND UNDER NO CIRCUMSTANCES BY DRIVING WITH A HAMMER.
7. ALL EXPANSION ANCHORS SHALL BE DESIGNED IN ACCORDANCE WITH THE SPECIFIC MANUFACTURERS REQUIREMENTS AND ALLOWABLE LOADS AND SHALL ONLY BE APPLIED IN CONDITIONS ACCEPTABLE TO MANUFACTURER. FASTENERS SHALL BE A MINIMUM OF SAE GRADE #5 OR BETTER ZINC PLATED.
8. ALL FASTENERS CONNECTING ALUMINUM COMPONENTS OR PRESSURE TREATED LUMBER ARE STAINLESS STEEL TYPE 300 18-8, UNLESS MANUFACTURER GALVANIZED BOLTS SPECIFICS FOR USE WITH ACQ PRESSURE TREATED WOOD, OR OTHERWISE NOTED ON PLANS.
9. ALL FASTENERS SHALL COMPLY WITH ASTM A153.
10. ALL CONNECTORS SHALL COMPLY WITH ASTM A653 CLASS G-185.
11. FOR SMS, THE MINIMUM CENTER-TO-CENTER SPACING SHALL BE 3/4" AND MINIMUM CENTER-TO-EDGE SHALL BE 1/2" UNLESS NOTED OTHERWISE.

E. REFERENCE STANDARDS:

- ASTM E 119
 - ASTM E 1300
 - CURRENT ASCE 7
 - CURRENT ALUMINUM DESIGN MANUAL-AA ASM35, AND SPEC. FOR ALUMINUM PART 1-A, & 1-B
 - ASTM C94
 - ASTM C150
 - ASTM C33
 - ASTM C260
 - ASTM C494
 - ASTM A615
 - ASTM A185
- FLORIDA BUILDING CODE 7TH EDITION* (CHAPTERS 16, 20 & 23).

F. ABBREVIATIONS:

- THE FOLLOWING LIST OF ABBREVIATIONS IS NOT INTENDED TO REPRESENT ALL THOSE USED ON THESE DRAWINGS, BUT TO SUPPLEMENT THE MORE COMMON ABBREVIATIONS.
1. TYP -- TYPICAL
 2. SIM -- SIMILAR
 3. UN -- UNLESS OTHERWISE NOTED
 4. CONT -- CONTINUOUS
 5. VIF -- VERIFY IN FIELD

G. RESPONSIBILITY:

1. ALL SITE WORK SHALL BE PERFORMED BY A LICENSED CONTRACTOR IN ACCORDANCE WITH APPLICABLE BUILDING CODES, LOCAL ORDINANCES, ETC.
2. CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND DETAILS, NOTIFYING ENGINEER OF ANY DISCREPANCIES BETWEEN DRAWINGS, FABRICATED ITEMS, OR ACTUAL FIELD CONDITIONS.
3. THESE DRAWINGS REPRESENT THE ACCEPTABILITY OF THE "SUNROOM ROOM ADDITION ELEMENTS AS PROVIDED BY THE CONTRACTOR.
4. ALL DETAILS ON THESE DRAWINGS ARE ENGINEERED BASED ON INFORMATION PROVIDED BY THE CONTRACTOR AND MANUFACTURER.
5. ANY DETAILS NOT SHOWN ARE TO BE ENGINEERED BY A LICENSED P.E. IN ACCORDANCE WITH STANDARD ENGINEERING PRACTICES.

H. MISCELLANEOUS:

1. ALUMINUM ADDITIONS ARE NOT TO BE INSTALLED ON A MANUFACTURED HOME, TRAILER HOME, OR PRE-FAB HOME, IF THE EXISTING STRUCTURE IS ONE OF THESE, A SEPARATE 4TH WALL SUPPORT SYSTEM MUST BE ENGINEERED SO THAT NO


- ADDITIONAL LOADING IS PLACED ON THE MANUFACTURED HOME.
2. IF ENCLOSURE CONTAINS A SWIMMING POOL OR SPA, THE ENCLOSURE SHALL COMPLY WITH RESIDENTIAL SWIMMING BARRIER REQUIREMENTS OF *THE IRC 7TH EDITION* R-4501.17 IN ITS ENTIRETY.
 3. DOOR LOCATIONS MAY BE DETERMINED IN THE FIELD BY CONTRACTOR.
 4. IF PAVERS ARE UNDER ALUMINUM MEMBERS THEY SHALL HAVE EPOXY ADHESIVE TO CONCRETE OR IF USING GROUT, ENSURE BONDING AGENT IS USED FIRST AND ADHERED WITH MINIMUM 3000 PSI GROUT.
 5. SCREENING MATERIAL SHALL BE 18X14X0.013 OR EQUIVALENT DENSITY SCREEN MESH ONLY UNLESS NOTED ON DRAWING S-2.

DESIGN DATA:

1. ULTIMATE DESIGN WIND SPEED v_{ult} , (3 SECOND GUST): 130 MPH
2. NOMINAL DESIGN WIND SPEED v_{sd} : 101 MPH
3. RISK CATEGORY: 1
4. WIND EXPOSURE: B
5. WIND LOADS:
 - SCREEN ROOF: 6 PSF
 - SCREEN WALLS: 23 PSF
 - SOLID ROOF (SCREEN WALL): 20 PSF
6. FACTOR APPLIED TO SCREEN WIND LOADS FOR 18X14X0.013 OR EQUIVALENT DENSITY SCREEN MESH: 0.88
7. FACTOR APPLIED TO SCREEN WIND LOADS FOR ALLOWABLE STRESS DESIGN: 0.6
8. LIVE LOAD: 0.88
9. 300 lb. VERTICAL DOWNLOAD ON PRIMARY SCREEN ENCLOSURE MEMBERS.
10. 200 lb. VERTICAL DOWNLOAD ON SCREEN ENCLOSURE PURLINS, 10 PSF VERTICAL DOWNLOAD ON SOLID ROOF.
11. EXISTING SLAB AND OR FOOTING (MIN. 8"X8" FOOTING W/ 4" SLAB) MEETS THE REQUIREMENTS TO RESIST THE UPLIFTS FOR THE PROPOSED STRUCTURE.
12. SCREEN ROOF TYPE: MANSARD
13. SOLID ROOF TYPE: 3"X48"X0.024" ELITE EPS COMPOSITE PANEL ROOF 1LB FOAM DENSITY, FLORIDA PRODUCT APPROVAL, FL 7561-R5.

ALUMINUM STRUCTURAL MEMBERS

SECTION	MEMBER	INDEX:
HOLLOW SECTIONS	2" x 2": 2" x 2" x 0.044"	S-1 GENERAL NOTES
	2" x 3": 2" x 3" x 0.050"	S-2 DRAWING
	2" x 4": 2" x 4" x 0.050"	S-3 DETAILS
	2" x 5": 2" x 5" x 0.050"	S-4 DETAILS
	3" x 3": 3" x 3" x 0.125"	S-5 DETAILS
OPEN BACK SECTIONS	1" x 2": 1" x 2" x 0.040"	
	1" x 3": 1" x 3" x 0.045"	
	2" x 2" SMS: 2" x 2" x 0.045"	
SNAP SECTIONS	2" x 3" SMS: 2" x 3" x 0.072"	
	2" x 4" SMS: 2" x 4" x 0.045"	
	3" x 3" SMS: 3" x 3" x 0.090"	
SELF MATING (SMB)	2" x 4" SMB: 2" x 4" x 0.044" x 0.100"	
	2" x 5" SMB: 2" x 5" x 0.050" x 0.118"	
	2" x 6" SMB: 2" x 6" x 0.050" x 0.120"	
	2" x 7" SMB: 2" x 7" x 0.057" x 0.120"	
	2" x 8" SMB: 2" x 8" x 0.072" x 0.224"	
	2" x 9" SMB: 2" x 9" x 0.072" x 0.224"	
	2" x 10" SMB: 2" x 10" x 0.092" x 0.374"	
	2" x 2": 2" x 2" x 0.090"	
	TUBE SECTIONS	

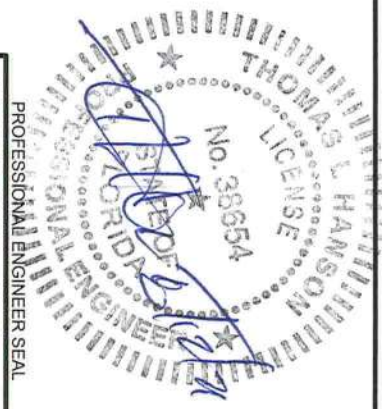

ENGINEER OF RECORD:
 David W. Smith P.E.
 FLORIDA LICENSE: 53608
 Thomas L. Hanson P.E.
 FLORIDA LICENSE: 38654
 Myron Max Neal P.E.
 FLORIDA LICENSE: 86663
 Joel Falardeau P.E.
 FLORIDA LICENSE: 70667
 Erik Stuart P.E.
 FLORIDA LICENSE: 77605

FBC Plans & Engineering Services, Inc.
 6272 Abbott Station Dr. Unit 101
 Zephyrhills, FL 33542
 Ph# (813)788-5314
 Fax# 1-(866)824-7894
 E-mail: erb@fbcpplans.com
 Website: www.fbcpplans.com
 C.O.A.-#29054


DATE: 08/10/2021
 DRAWN BY: ST
 REVISION: DATE:
 RO 1
 RO 2
 RO 3
 RO 4

Job# 21_0810_130
 PROJECT ADDRESS:
KALB
 614 NW HARRIS LAKE DR
 LAKE CITY, FL 32055

CONTRACTOR:
 LAKESIDE ALUMINUM, INC.

NOTES
S-1

DOOR LOCATION MAY BE DETERMINED
IN THE FIELD BY THE CONTRACTOR.

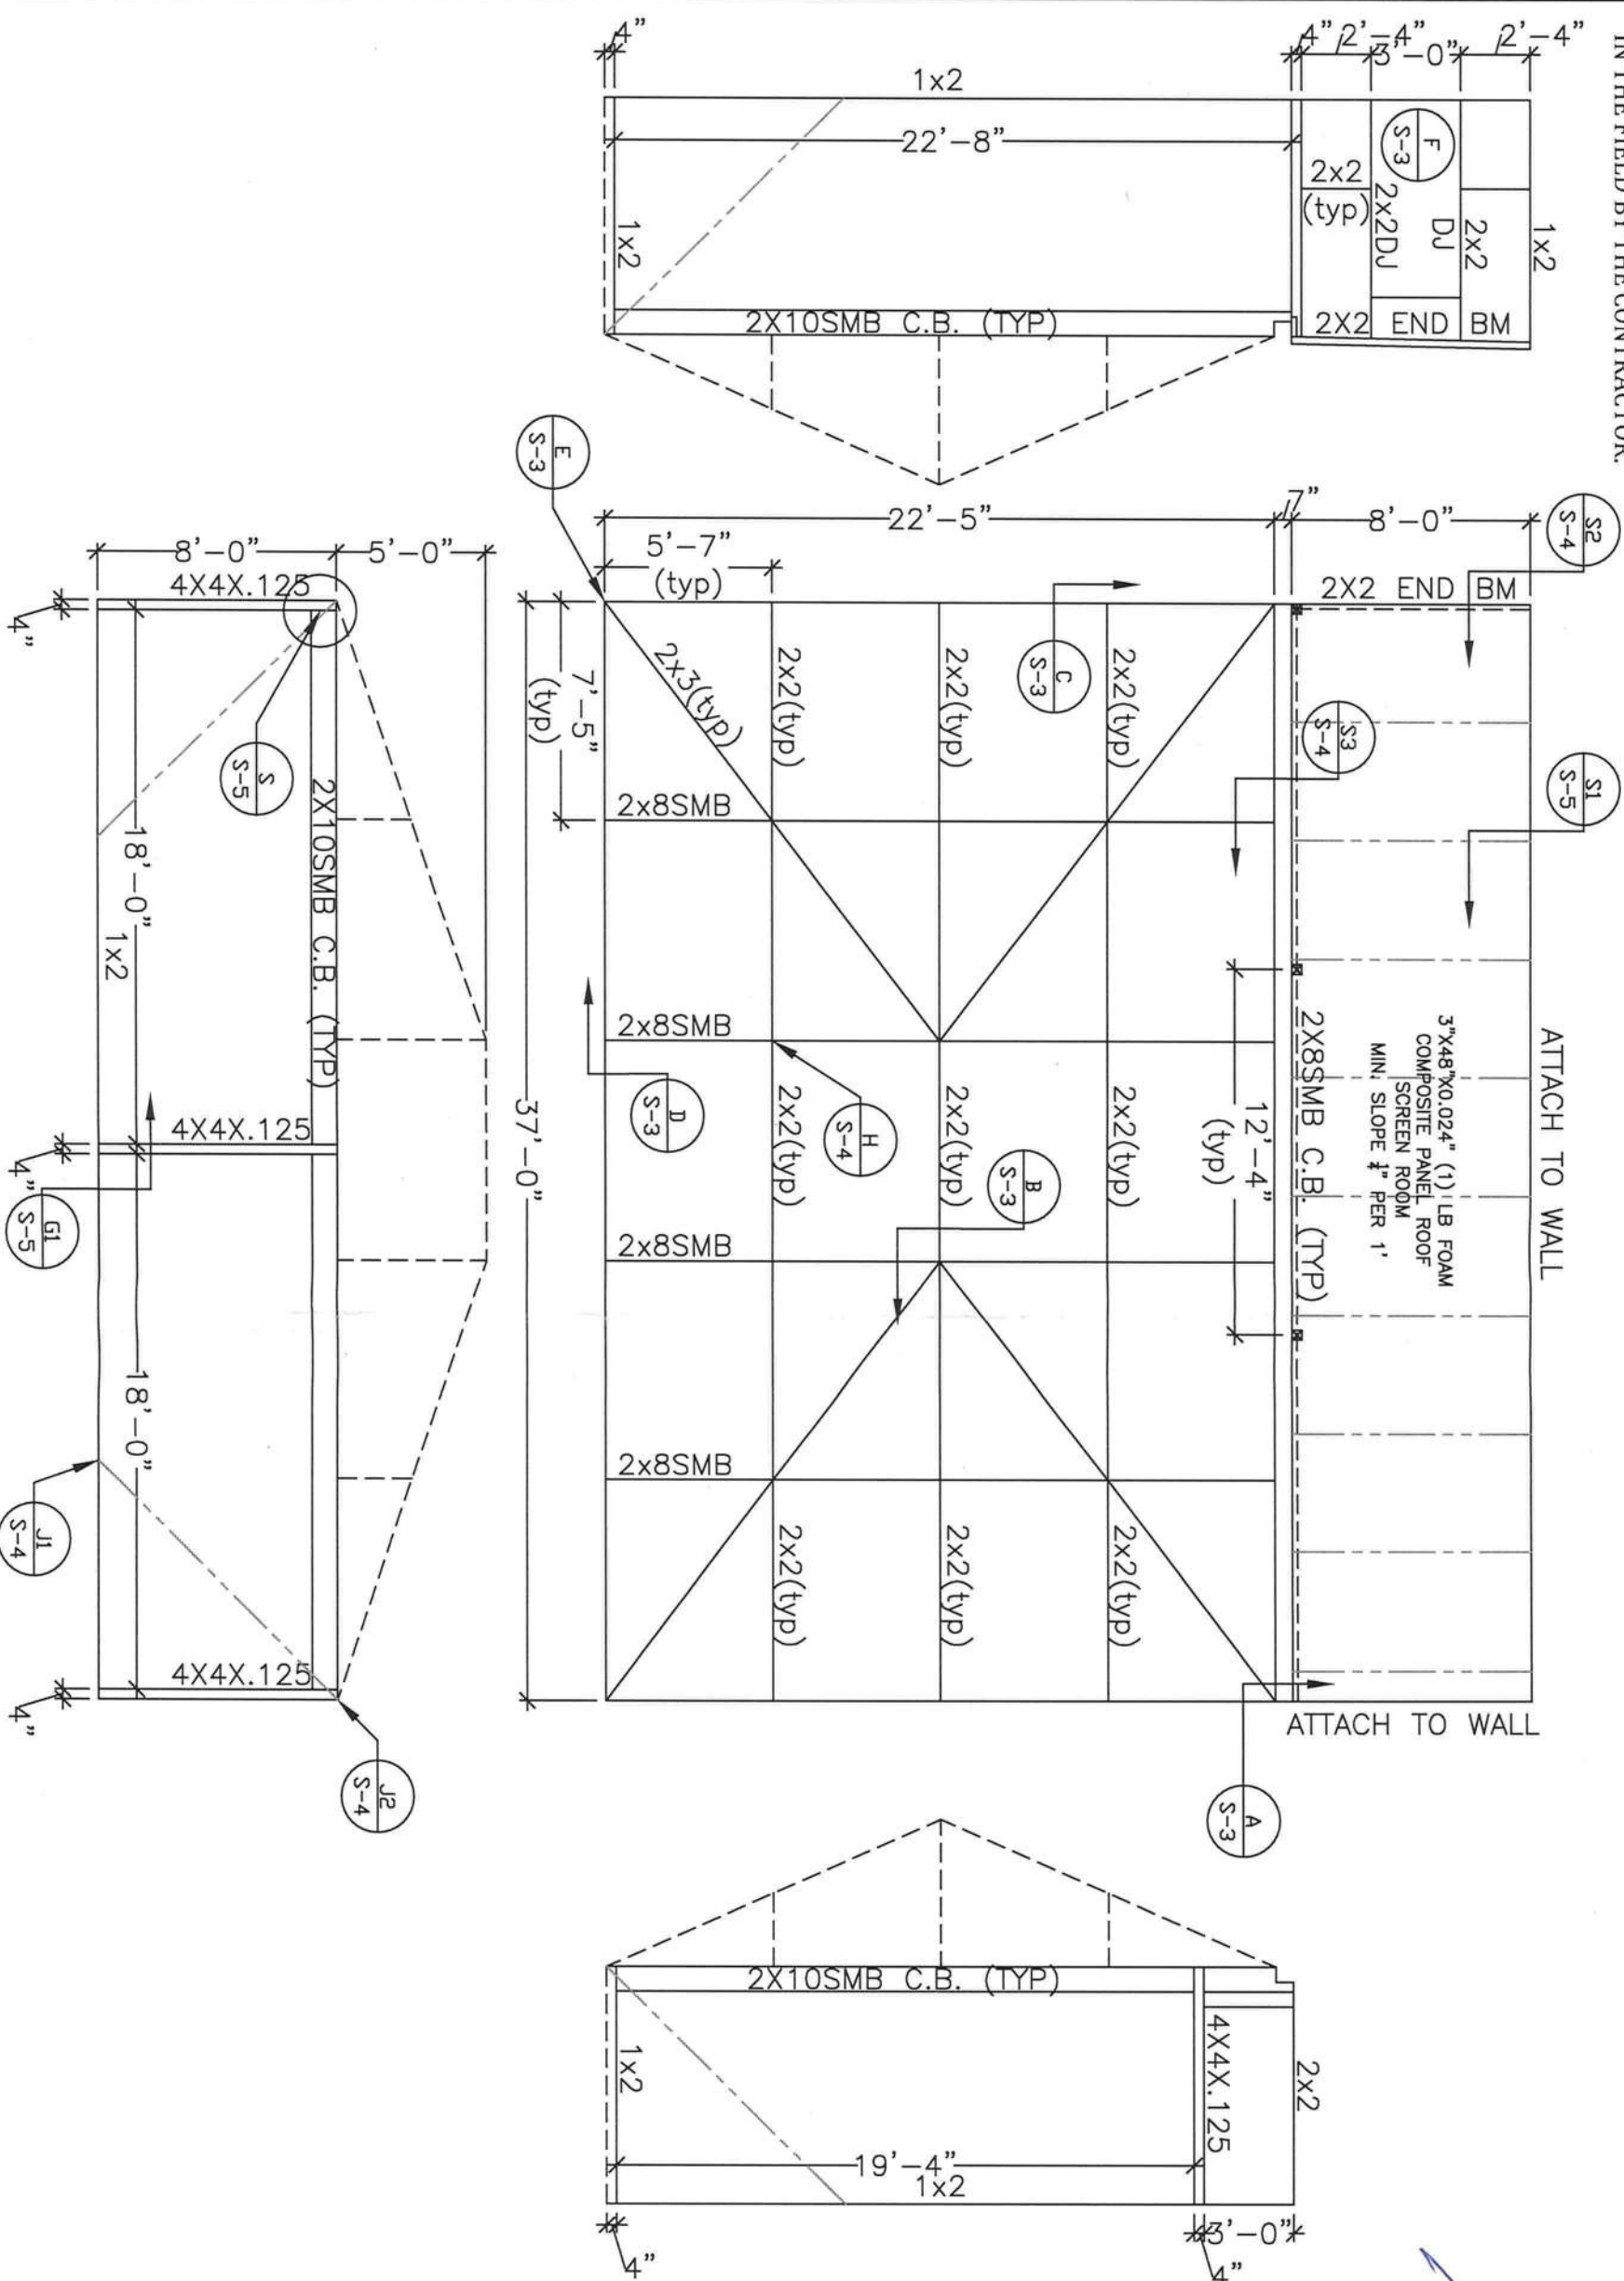

ENGINEER OF RECORD:

David W. Smith P.E.

FLORIDA LICENSE: 53608

Thomas L. Hanson P.E.

FLORIDA LICENSE: 38654

Myron Max Neal P.E.

FLORIDA LICENSE: 86663

Joel Falardeau P.E.

FLORIDA LICENSE: 70667

Erik Stuart P.E.

FLORIDA LICENSE: 77605

FBC Plans & Engineering Services, Inc.

6272 Abbott Station Dr. Unit 101

Zephyrhills, FL 33542

Ph# (813)788-5314

Fax# 1-(866)824-7894

E-mail: erb@fbcpplans.com

Website: www.fbcpplans.com

C.O.A.#29054

DATE: 08/10/2021

DRAWN BY: ST

REVISION: DATE:

RO 1

RO 2

RO 3

RO 4

Job# 21_0810_130

PROJECT ADDRESS:

KALB

614 NW HARRIS LAKE DR




LAKE CITY, FL 32055

CONTRACTOR:

LAKEVILLE ALUMINUM, INC.




FLOOR PLAN

S-2

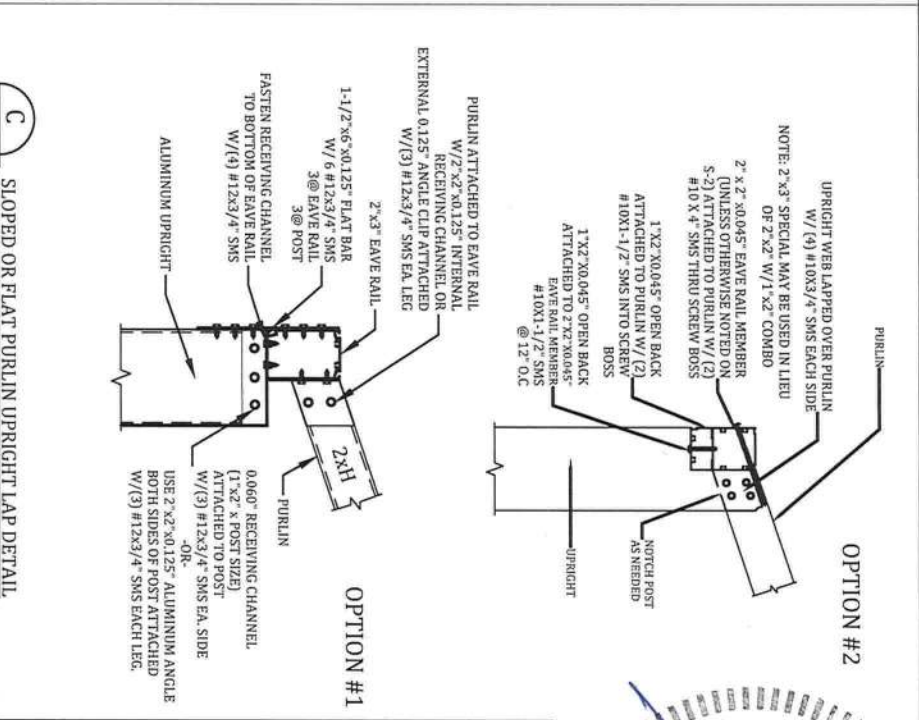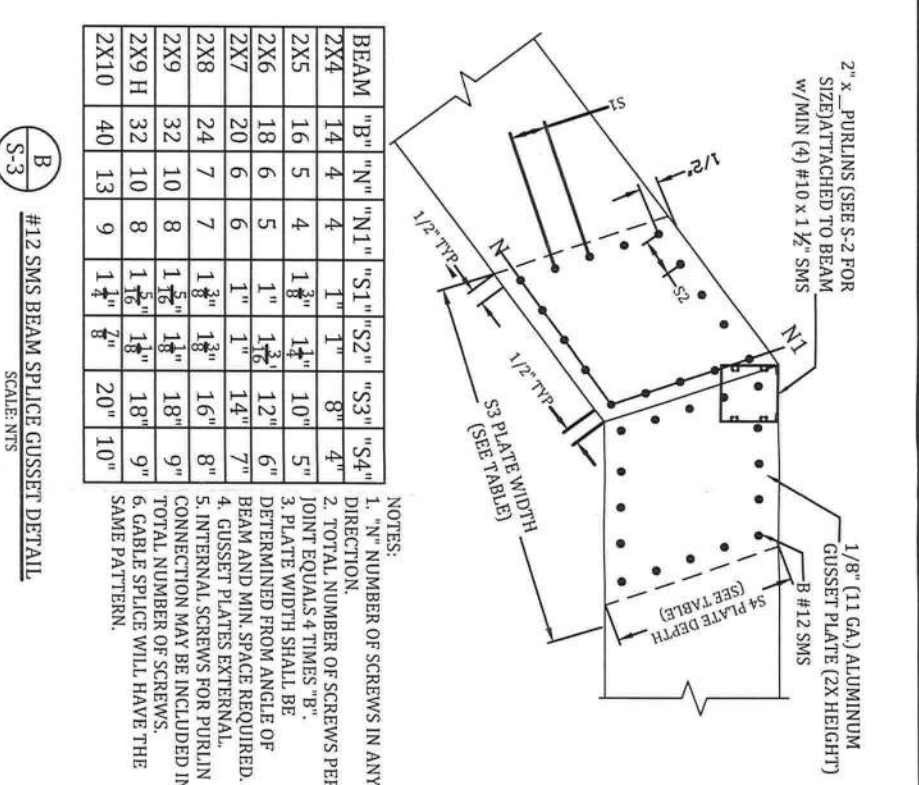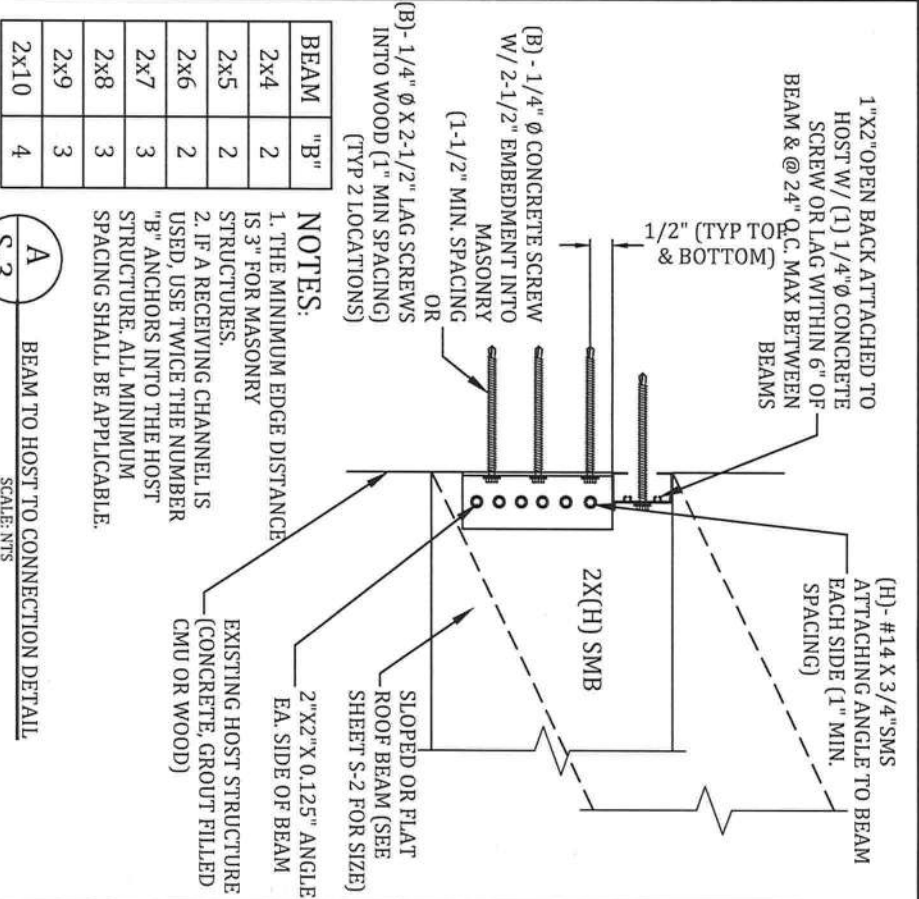

PROFESSIONAL ENGINEER SEAL
 ENGINEER OF RECORD:
 David W. Smith P.E.
 FLORIDA LICENSE: 53608
 Thomas L. Hanson P.E.
 FLORIDA LICENSE: 38654
 Myron Max Neal P.E.
 FLORIDA LICENSE: 86663
 Joel Falardeau P.E.
 FLORIDA LICENSE: 70667
 Erik Stuart P.E.
 FLORIDA LICENSE: 77605

FBC Plans & Engineering Services, Inc.
 6272 Abbott Station Dr. Unit 101
 Zephyrhills, FL 33542
 Ph# (813)788-5314
 Fax# 1-(866)824-7894
 E-mail: erth@fbcpplans.com
 Website: www.fbcpplans.com
 C.O.A.#29054

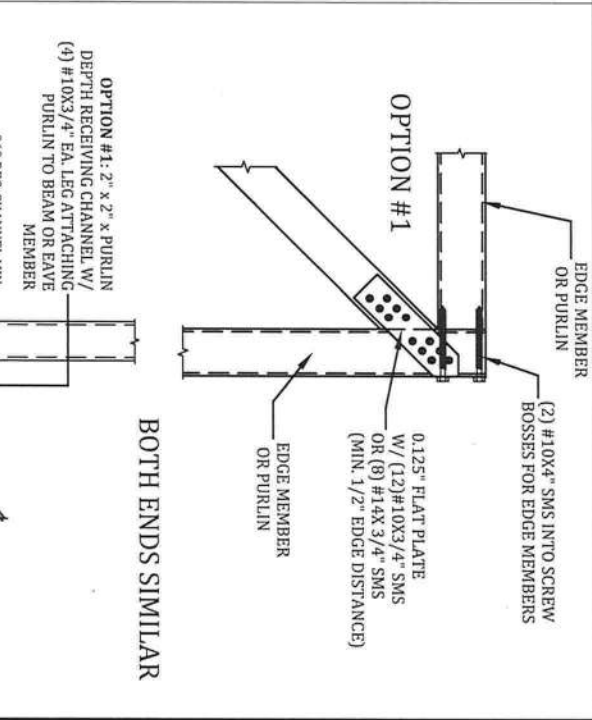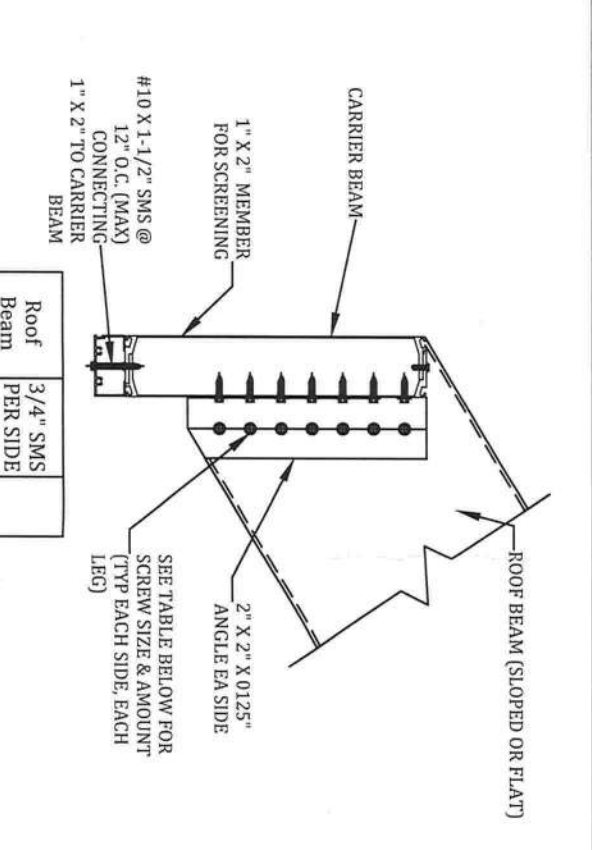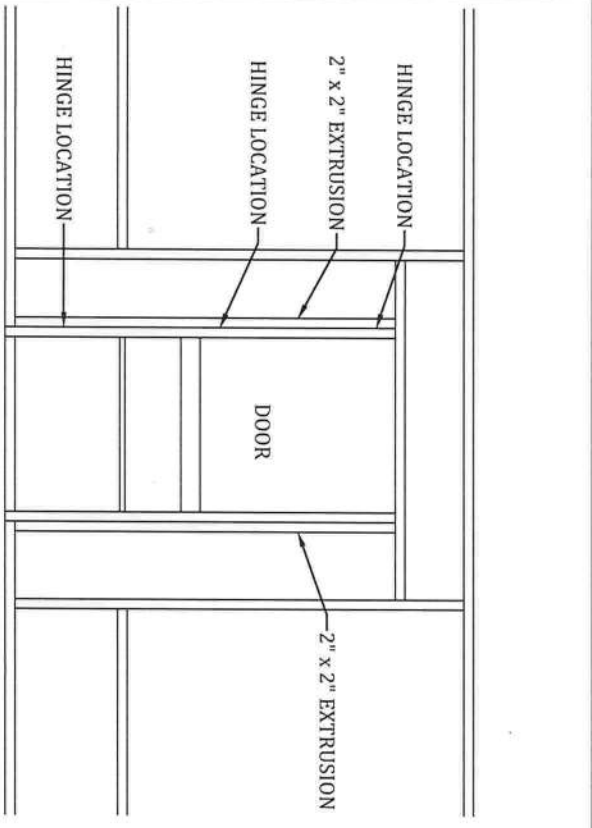

DATE: 08/10/2021
 DRAWN BY: ST
 REVISION: DATE:
 RO 1
 RO 2
 RO 3
 RO 4

Job# 21_0810_130
 PROJECT ADDRESS:
 KALB
 614 NW HARRIS LAKE DR
 LAKE CITY, FL 32055



CONTRACTOR:
 LAKESIDE ALUMINUM, INC.

S-3
 TYPICAL SCREEN DOOR CONNECTION DETAIL
 SCALE: NTS

S-3
 BEAM TO CARRIER BEAM CONNECTION DETAIL
 SCALE: NTS

S-3
 ROOF BRACING CONNECTION DETAIL
 SCALE: NTS

S-3
 DETAILS

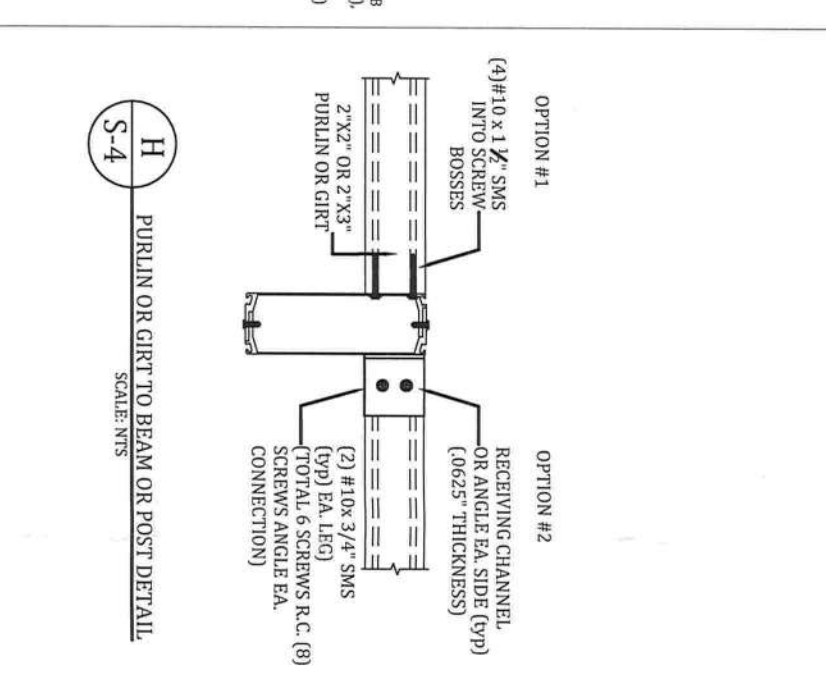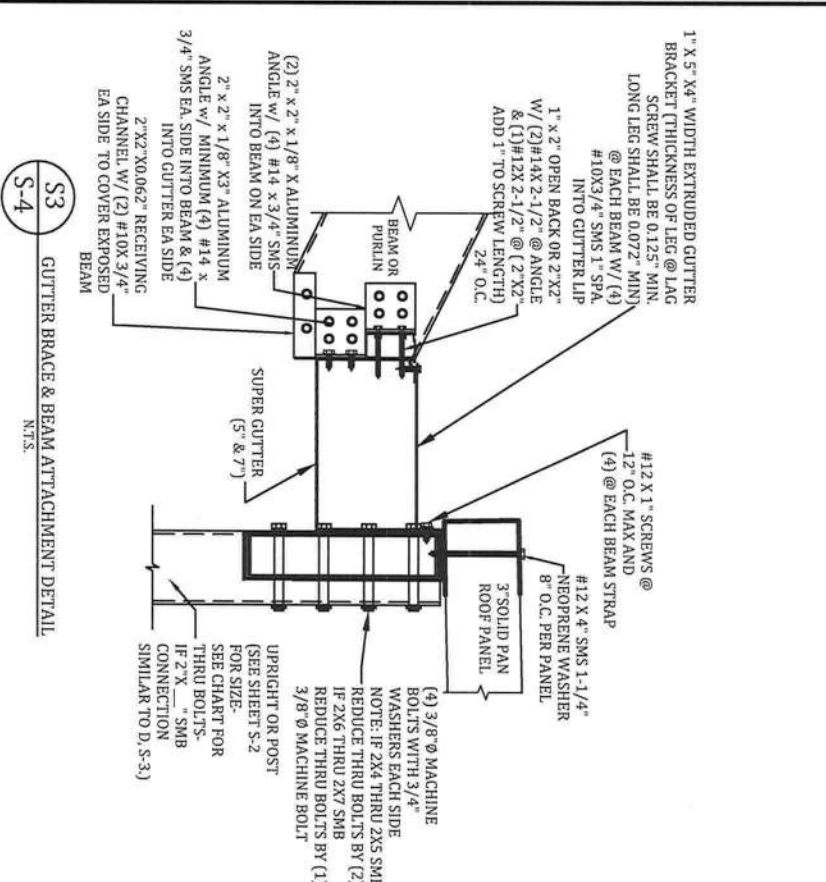

Column Size	Anchor	B	Min. Spa
2x3-1/4"	0	0"	0"
2x4-1/4"	1	3"	3"
2x5-1/4"	1	3"	3"
2x6-3/8"	1	4"	4"
2x7-3/8"	1	5"	5"
2x8-3/8"	2	3"	3"
2x9-3/8"	2	4"	4"
2x10-3/8"	2	4.5"	4.5"

NOTES:
 1. NUMBER OF ANCHORS "B" IS EACH SIDE INTO THE SECONDARY ANGLE AND DOES NOT INCLUDE THE ANCHOR INTO THE 1X2. 2. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL UPRIGHT LOCATIONS. ALL SCREW LENGTHS AT UPRIGHT CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVEN DECK IS PRESENT.
 3. CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON THOSE LISTED BY ENGINEER.
 4. 2X3W/1X2 CORNER POST SHALL REQUIRE SAME BASE CONNECTIONS AS 2X4 SHOWN IN TABLE.
 5. IF FOR AN IN-FILL, TOP OF COLUMN CONNECTION SIMILAR IF CONCRETE LINTEL. IF WOOD LINTEL SUBSTITUTE 1/4" Ø X 3" LAG SCREW FOR 3/8" Ø LPT FOR BOTH PRIMARY & SECONDARY ANGLES.
 6. 2X2X 0.45 DOOR JAMB MEMBER SHALL CONNECT SIMILAR TO 2X3 MEMBER.




UPRIGHT
 SECONDARY ANGLE MIN 0.125" THICK (NOT REQUIRED FOR 2X3 MEMBER)
 PRIMARY 2" X 2" X 0.125" ANGLE
 (2) #10 X 3/4" SMS FASTENING COLUMN TO PRIMARY ANGLE (TYP EACH SIDE)
 1" X 2" BASE MEMBER (TYP EACH SIDE)
 ANCHOR SPA (MIN) (TYP) (SEE TABLE)
 (1) - CONCRETE SCREW (SEE TABLE) ANCHOR INTO PRIMARY ANGLE AND @ 1/4" Ø CONCRETE SCREW ANCHOR @ 24" O.C. BETWEEN COLUMNS (TYP EACH SIDE)
 (4) #10 X 3/4" SMS FASTENING SECONDARY ANGLE TO COLUMN (TYP EACH SIDE)
 (B) - CONCRETE SCREW ANCHOR INTO SECONDARY ANGLE (TYP EACH SIDE) (SEE TABLE)
 (1) - CONCRETE SPA (MIN) (TYP) (SEE TABLE)





Column Size	Anchor	B	Min. Spa
2x3-1/4"	0	0"	0"
2x4-1/4"	1	3"	3"
2x5-1/4"	1	3"	3"
2x6-3/8"	1	4"	4"
2x7-3/8"	1	5"	5"
2x8-3/8"	2	3"	3"
2x9-3/8"	2	4"	4"
2x10-3/8"	2	4.5"	4.5"

NOTES:
 1. NUMBER OF ANCHORS "B" IS EACH SIDE INTO THE SECONDARY ANGLE AND DOES NOT INCLUDE THE ANCHOR INTO THE 1X2. 2. MINIMUM EMBEDMENT OF ANCHORS INTO CONCRETE FOOTING SHALL BE 2-3/4" AT ALL UPRIGHT LOCATIONS. ALL SCREW LENGTHS AT UPRIGHT CONNECTIONS SHALL BE OF SUFFICIENT LENGTH FOR REQUIRED EMBEDMENT INTO CONCRETE FOOTING WHEN A PAVEN DECK IS PRESENT.
 3. CONCRETE SCREW ANCHOR DESIGNS ARE BASED ON THOSE LISTED BY ENGINEER.
 4. 2X3W/1X2 CORNER POST SHALL REQUIRE SAME BASE CONNECTIONS AS 2X4 SHOWN IN TABLE.
 5. IF FOR AN IN-FILL, TOP OF COLUMN CONNECTION SIMILAR IF CONCRETE LINTEL. IF WOOD LINTEL SUBSTITUTE 1/4" Ø X 3" LAG SCREW FOR 3/8" Ø LPT FOR BOTH PRIMARY & SECONDARY ANGLES.
 6. 2X2X 0.45 DOOR JAMB MEMBER SHALL CONNECT SIMILAR TO 2X3 MEMBER.

UPRIGHT
 SECONDARY ANGLE MIN 0.125" THICK (NOT REQUIRED FOR 2X3 MEMBER)
 PRIMARY 2" X 2" X 0.125" ANGLE
 (2) #10 X 3/4" SMS FASTENING COLUMN TO PRIMARY ANGLE (TYP EACH SIDE)
 1" X 2" BASE MEMBER (TYP EACH SIDE)
 ANCHOR SPA (MIN) (TYP) (SEE TABLE)
 (1) - CONCRETE SCREW (SEE TABLE) ANCHOR INTO PRIMARY ANGLE AND @ 1/4" Ø CONCRETE SCREW ANCHOR @ 24" O.C. BETWEEN COLUMNS (TYP EACH SIDE)
 (4) #10 X 3/4" SMS FASTENING SECONDARY ANGLE TO COLUMN (TYP EACH SIDE)
 (B) - CONCRETE SCREW ANCHOR INTO SECONDARY ANGLE (TYP EACH SIDE) (SEE TABLE)
 (1) - CONCRETE SPA (MIN) (TYP) (SEE TABLE)

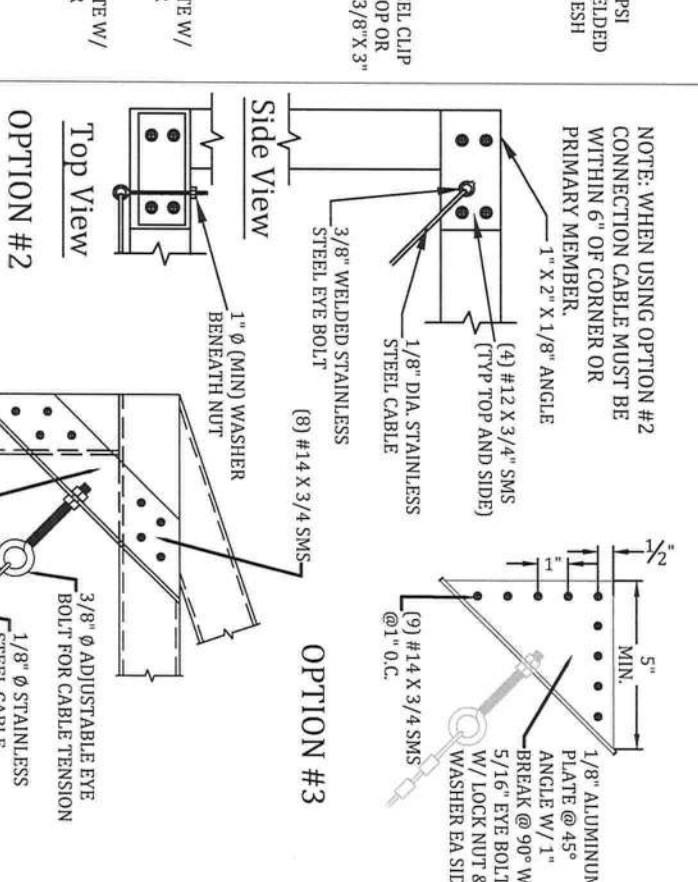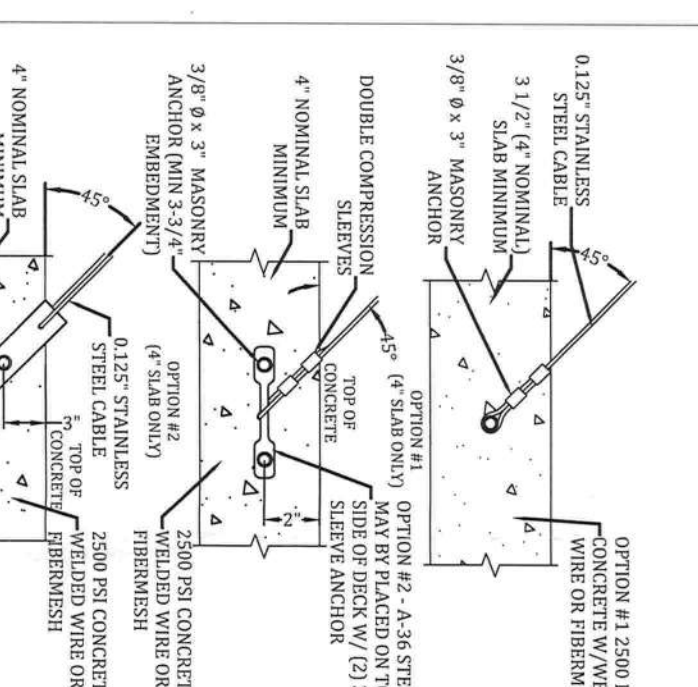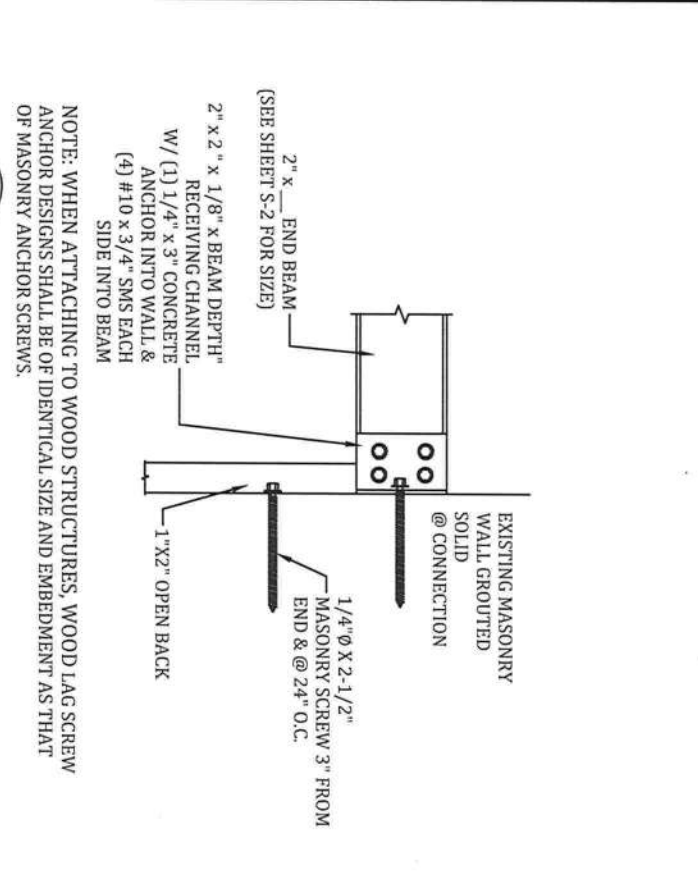

UPRIGHT
 SECONDARY ANGLE MIN 0.125" THICK (NOT REQUIRED FOR 2X3 MEMBER)
 PRIMARY 2" X 2" X 0.125" ANGLE
 (2) #10 X 3/4" SMS FASTENING COLUMN TO PRIMARY ANGLE (TYP EACH SIDE)
 1" X 2" BASE MEMBER (TYP EACH SIDE)
 ANCHOR SPA (MIN) (TYP) (SEE TABLE)
 (1) - CONCRETE SCREW (SEE TABLE) ANCHOR INTO PRIMARY ANGLE AND @ 1/4" Ø CONCRETE SCREW ANCHOR @ 24" O.C. BETWEEN COLUMNS (TYP EACH SIDE)
 (4) #10 X 3/4" SMS FASTENING SECONDARY ANGLE TO COLUMN (TYP EACH SIDE)
 (B) - CONCRETE SCREW ANCHOR INTO SECONDARY ANGLE (TYP EACH SIDE) (SEE TABLE)
 (1) - CONCRETE SPA (MIN) (TYP) (SEE TABLE)

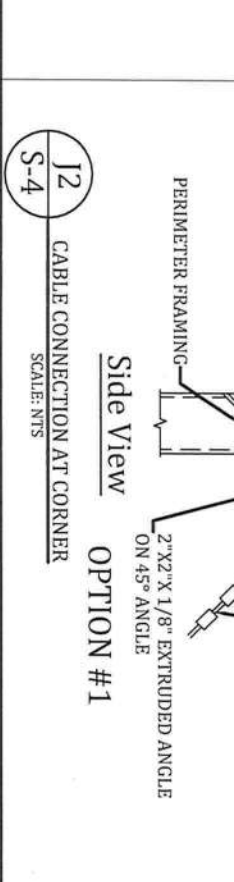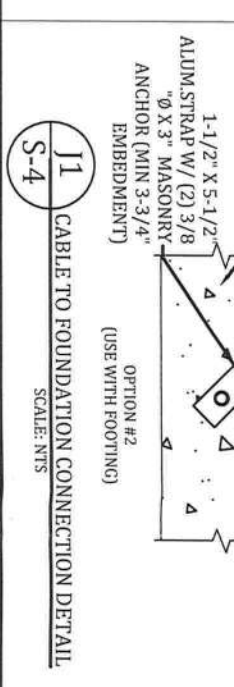

UPRIGHT
 SECONDARY ANGLE MIN 0.125" THICK (NOT REQUIRED FOR 2X3 MEMBER)
 PRIMARY 2" X 2" X 0.125" ANGLE
 (2) #10 X 3/4" SMS FASTENING COLUMN TO PRIMARY ANGLE (TYP EACH SIDE)
 1" X 2" BASE MEMBER (TYP EACH SIDE)
 ANCHOR SPA (MIN) (TYP) (SEE TABLE)
 (1) - CONCRETE SCREW (SEE TABLE) ANCHOR INTO PRIMARY ANGLE AND @ 1/4" Ø CONCRETE SCREW ANCHOR @ 24" O.C. BETWEEN COLUMNS (TYP EACH SIDE)
 (4) #10 X 3/4" SMS FASTENING SECONDARY ANGLE TO COLUMN (TYP EACH SIDE)
 (B) - CONCRETE SCREW ANCHOR INTO SECONDARY ANGLE (TYP EACH SIDE) (SEE TABLE)
 (1) - CONCRETE SPA (MIN) (TYP) (SEE TABLE)



PROFESSIONAL ENGINEER SEAL
 ENGINEER OF RECORD:
 David W. Smith P.E.
 FLORIDA LICENSE: 53608
 Thomas L. Hanson P.E.
 FLORIDA LICENSE: 38654
 Myron Max Neal P.E.
 FLORIDA LICENSE: 86663
 Joel Falardeau P.E.
 FLORIDA LICENSE: 70667
 Erik Stuart P.E.
 FLORIDA LICENSE: 77605


FBC Plans & Engineering Services, Inc.
 6272 Abbott Station Dr. Unit 101
 Zephyrhills, FL 33542
 Ph# (813) 788-5314
 Fax# 1-(866)824-7894
 E-mail: erh@fbcpplans.com
 Website: www.fbcpplans.com
 C.O.A.-#29054

DATE: 08/10/2021
 DRAWN BY: ST
 REVISION: DATE:
 RO 1
 RO 2
 RO 3
 RO 4


Job# 21_0810_130
 PROJECT ADDRESS:
KALB
 614 NW HARRIS LAKE DR
 LAKE CITY, FL 32055

CONTRACTOR:
 LAKESIDE ALUMINUM, INC.







DETAILS
S-4

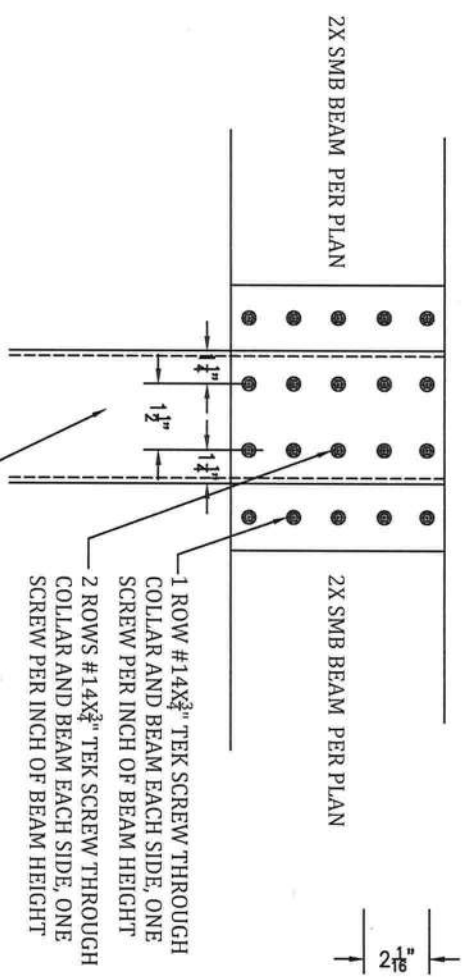

POST TO CARRIER BEAM COLLAR CONNECTION DETAIL
SCALE: NTS

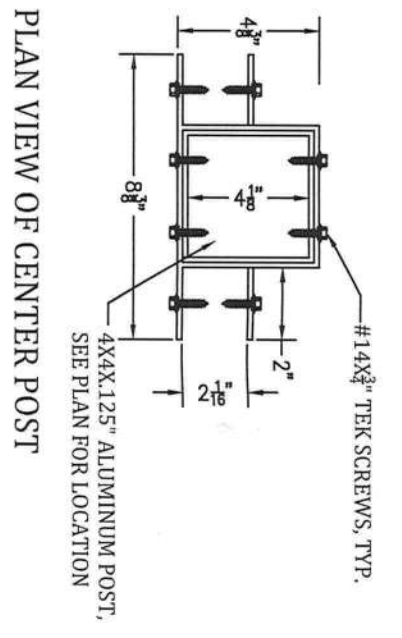

PLAN VIEW OF CORNER POST
SCALE: NTS

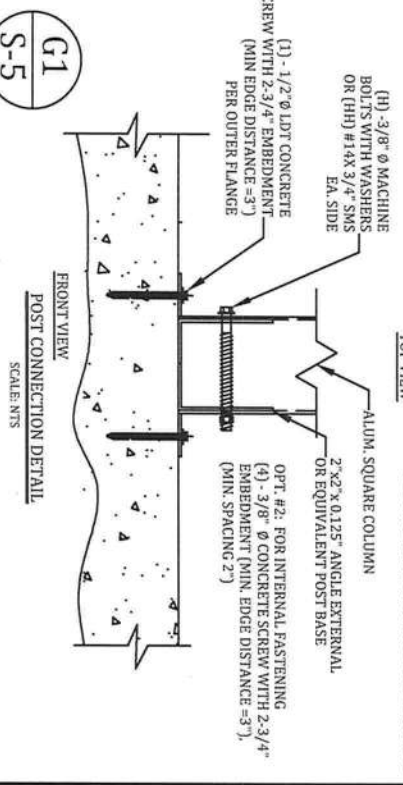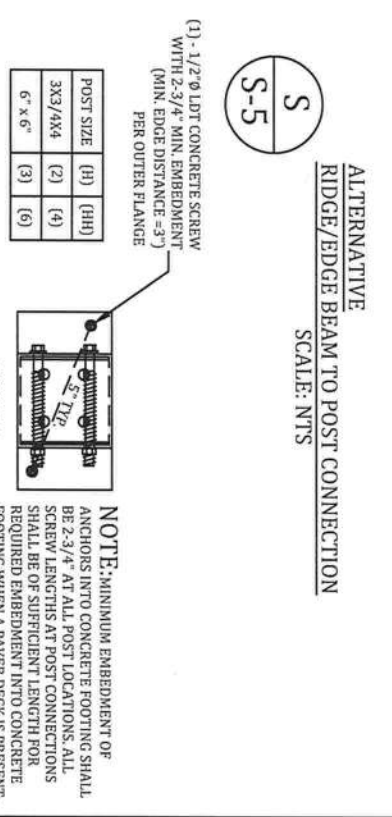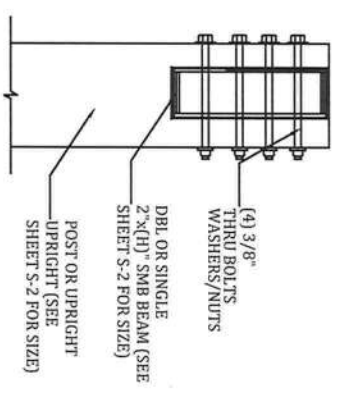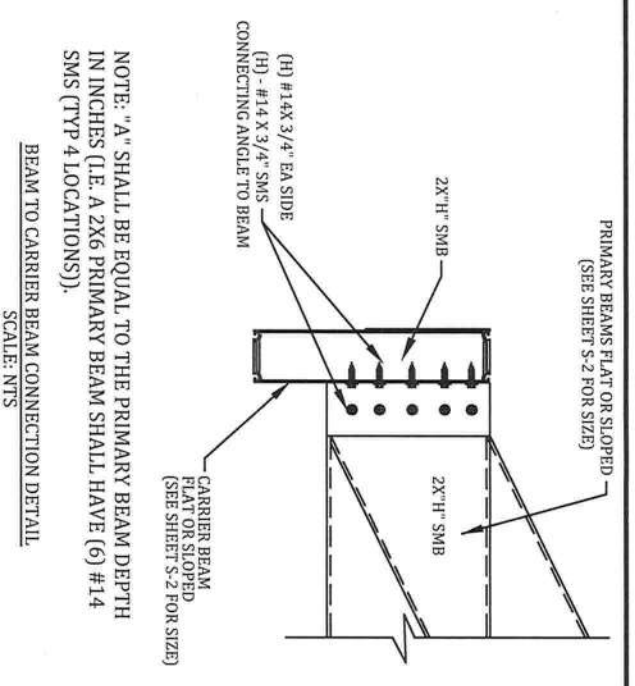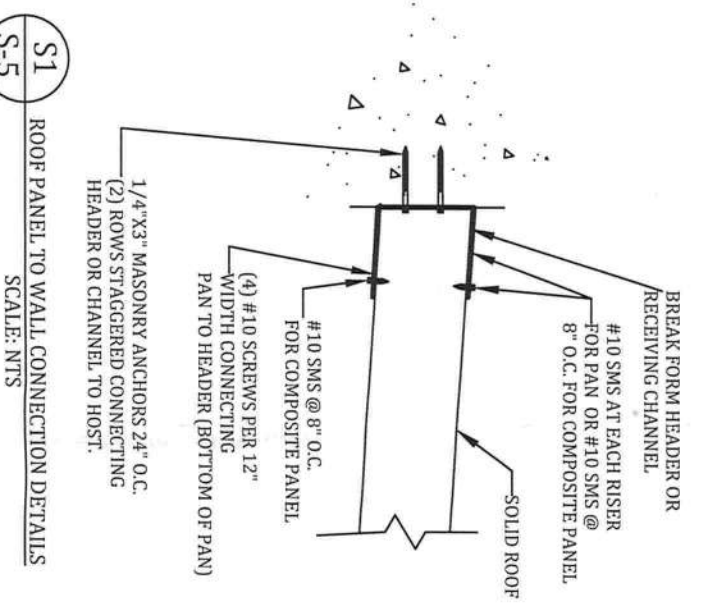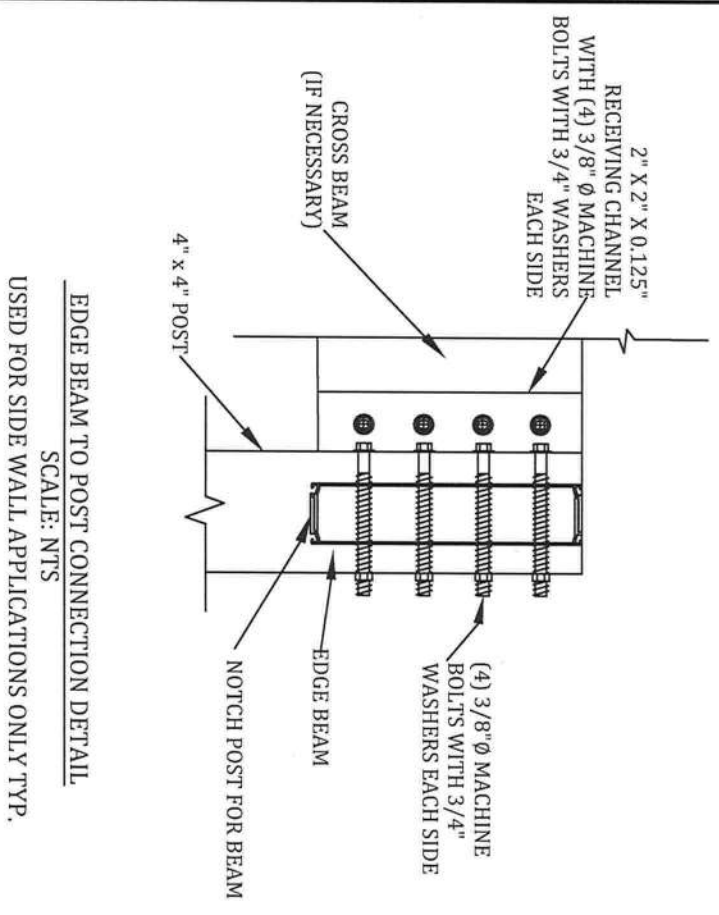

ENGINEER OF RECORD:
David W. Smith P.E.
FLORIDA LICENSE: 53608

Thomas L. Hanson P.E.
FLORIDA LICENSE: 38654

Myron Max Neal P.E.
FLORIDA LICENSE: 86663

Joel Falardeau P.E.
FLORIDA LICENSE: 70667

Erik Stuart P.E.
FLORIDA LICENSE: 77605

FBC Plans & Engineering Services, Inc.
6272 Abbott Station Dr. Unit 101
Zephyrhills, FL 33542
Ph# (813) 788-5314
Fax# 1-(866) 824-7894
E-mail: erb@fbcplans.com
Website: www.fbcplans.com
C.O.A. - #29054

DATE: 08/10/2021

DRAWN BY: ST

REVISION:	DATE:
RO 1	
RO 2	
RO 3	
RO 4	

Job# 21_0810_130

KALB
PROJECT ADDRESS:
614 NW HARRIS LAKE DR
LAKE CITY, FL 32055

CONTRACTOR:
LAKE SIDE ALUMINUM, INC.

DETAILS
S-5