



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: P06023-112726 - Nagle Residence

MiTek, Inc.

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: Jaron Nagle Project Name: . Model: 2nd Flr roof
Lot/Block: . Subdivision: .
Address: 351 NW Heritage Dr., .
City: Lake City State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 25.4
Wind Code: ASCE 7-22 Wind Speed: 130 mph
Roof Load: 45.0 psf Floor Load: N/A psf


This package includes 18 individual, Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date
1	T41921570	T6	7/20/26
2	T41921571	T9	7/20/26
3	T41921572	T8	7/20/26
4	T41921573	TE5	7/20/26
5	T41921574	T5	7/20/26
6	T41921575	TG2	7/20/26
7	T41921576	TG4	7/20/26
8	T41921577	V1	7/20/26
9	T41921578	V2	7/20/26
10	T41921579	TG1	7/20/26
11	T41921580	JH1	7/20/26
12	T41921581	J2	7/20/26
13	T41921582	J1	7/20/26
14	T41921583	TG3	7/20/26
15	T41921584	T7	7/20/26
16	T41921585	T4	7/20/26
17	T41921586	T6B	7/20/26
18	T41921587	T3	7/20/26

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc.
under my direct supervision based on the parameters
provided by 84 Lumber 1387 (Winter Haven, FL).

Truss Design Engineer's Name: Velez, Joaquin
My license renewal date for the state of Florida is February 28, 2027.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

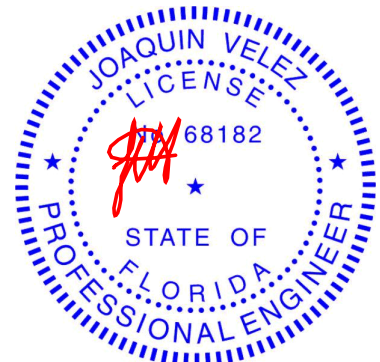

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

Velez, Joaquin


1 of 1

Job	Truss	Truss Type	Qty	Ply	Nagle Residence	T41921570
P06023-112726	T6	Common	3	1	Job Reference (optional)	

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42
ID:X9x?HiflRk42G8UIRSPX8Oyy849-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

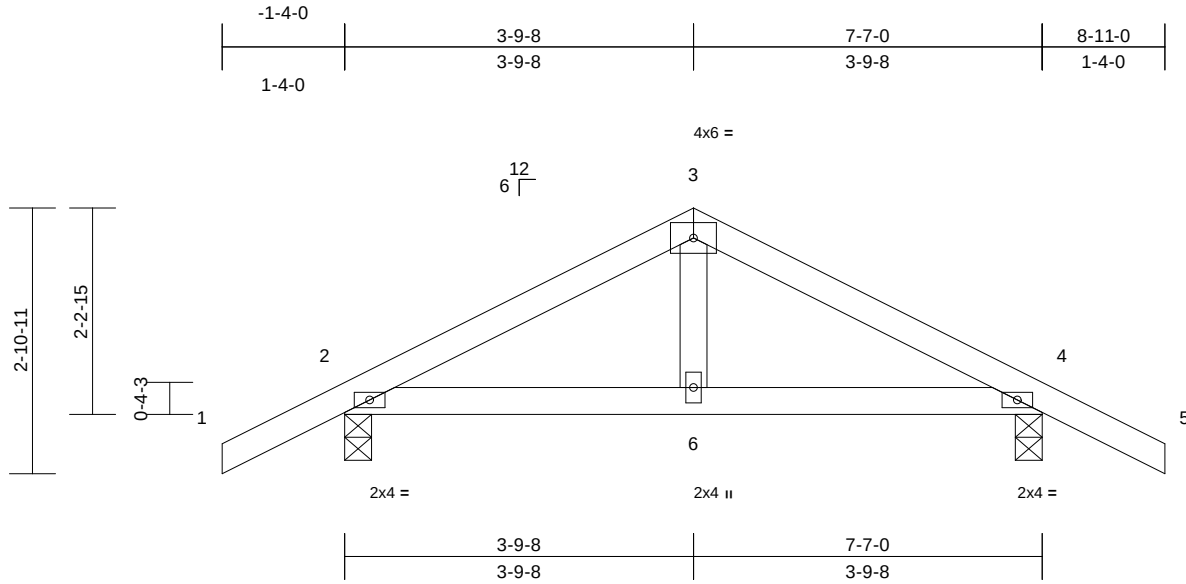

Scale = 1:25

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.20	0.01	6-12	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.18	Vert(CT)	-0.02	6-9	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	4	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP						Weight: 31 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4=0-3-8

Max Horiz 2=-43 (LC 17)
Max Uplift 2=-107 (LC 12), 4=-107 (LC 13)
Max Grav 2=435 (LC 1), 4=435 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/42, 2-3=-424/263, 3-4=-424/261, 4-5=0/42
BOT CHORD 2-6=-86/328, 4-6=-86/328
WEBS 3-6=-36/181

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 107 lb uplift at joint 2 and 107 lb uplift at joint 4.

LOAD CASE(S) Standard

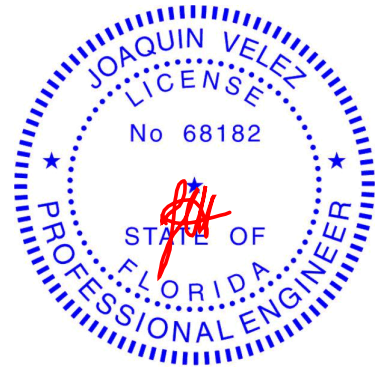

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	T9	Common	1	1	T41921571
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43

Page: 1

ID:i7wc3JD1YleNwRpx41amky8Qf-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRCDoi7J4zJC?i

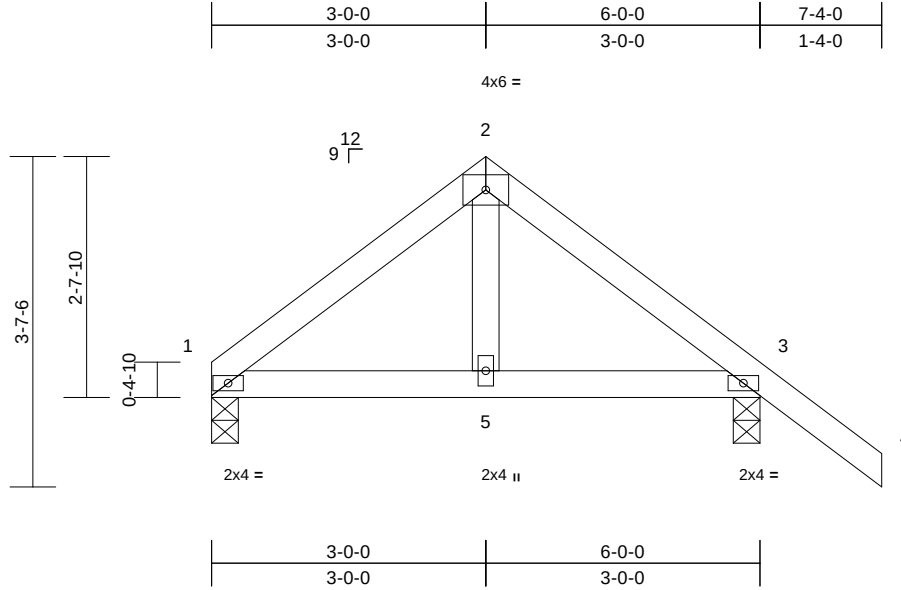

Scale = 1:25.2

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.20	Vert(LL)	0.01	5-8	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.15	Vert(CT)	-0.01	5-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 26 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 1 and 92 lb uplift at joint 3.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-3-8, 3=0-3-8


Max Horiz 1=-72 (LC 8)
Max Uplift 1=-50 (LC 12), 3=-92 (LC 13)
Max Grav 1=260 (LC 1), 3=374 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-280/170, 2-3=-285/177, 3-4=0/56
BOT CHORD 1-5=-28/197, 3-5=-13/197
WEBS 2-5=-52/145

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

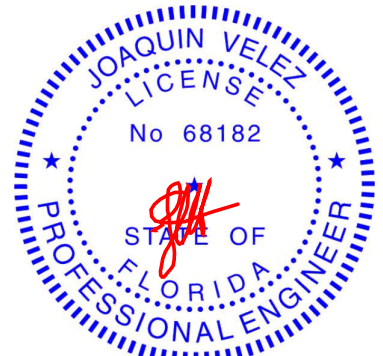

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	T8	Common	3	1	T41921572
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42
ID:O8VWolM4PvnVjcTifLFRfeyxXtA-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

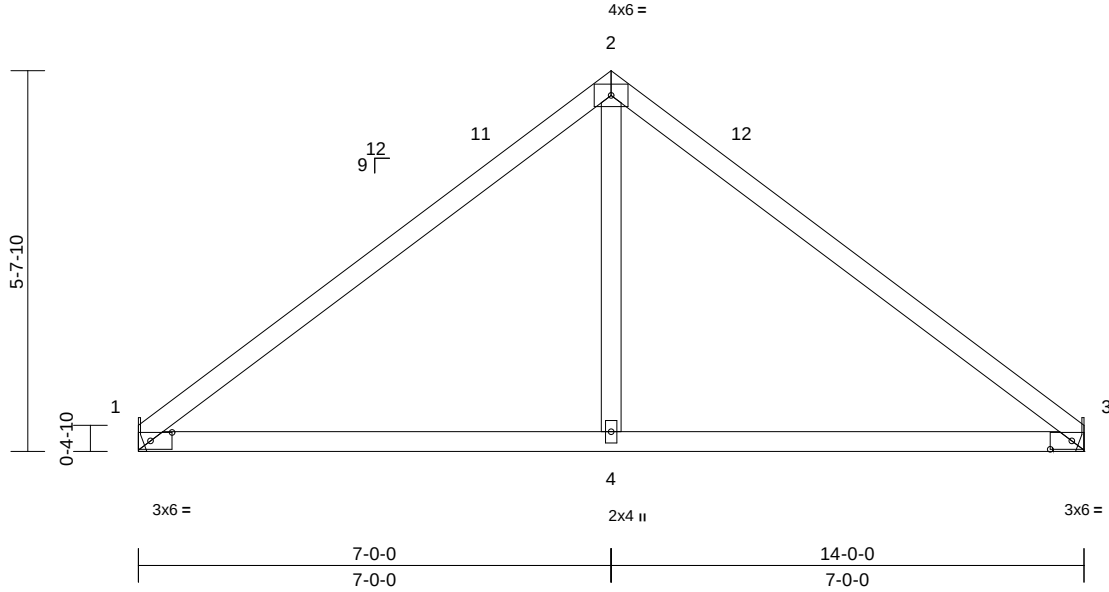

Scale = 1:34.1

Plate Offsets (X, Y): [1:0-3-13,0-1-8], [3:0-3-13,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.72	Vert(LL)	0.10	4-7	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.61	Vert(CT)	-0.17	4-10	>985	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 55 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-3-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1= Mechanical, 3= Mechanical
Max Horiz 1=-130 (LC 8)
Max Uplift 1=-124 (LC 12), 3=-124 (LC 13)
Max Grav 1=630 (LC 1), 3=630 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-747/286, 2-3=-747/265
BOT CHORD 1-4=-114/490, 3-4=-121/490
WEBS 2-4=-55/354

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 0-0-0 to 5-4-13, Zone1 5-4-13 to 7-0-0, Zone3 7-0-0 to 14-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 124 lb uplift at joint 1 and 124 lb uplift at joint 3.

LOAD CASE(S) Standard

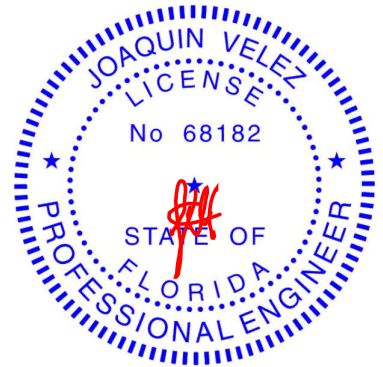

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	TE5	Common Supported Gable	1	1	T41921573
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43

Page: 1

ID:8dyFt_mTQegFR0M2h1hfdVyxXh1-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

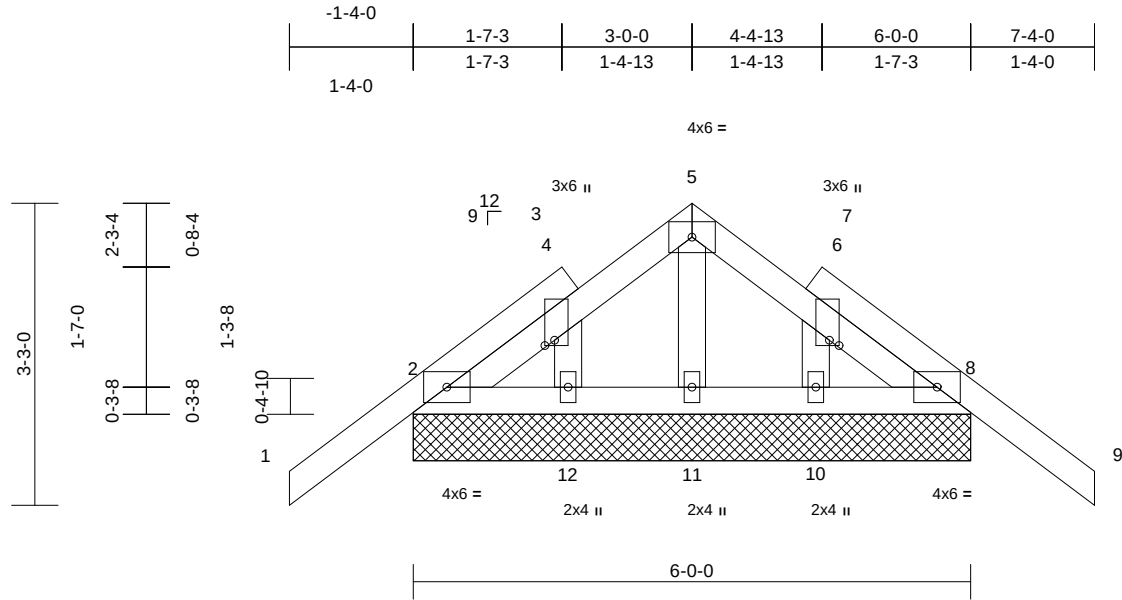

Scale = 1:24.8

Plate Offsets (X, Y): [3:0-0-11,0-1-4], [7:0-0-11,0-1-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	15.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	16	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							
										Weight: 35 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=6-0-0, 8=6-0-0, 10=6-0-0, 11=6-0-0, 12=6-0-0
Max Horiz 2=-71 (LC 10)
Max Uplift 2=-58 (LC 12), 8=-67 (LC 13), 10=-46 (LC 13), 12=-45 (LC 12)
Max Grav 2=201 (LC 1), 8=201 (LC 1), 10=122 (LC 20), 11=102 (LC 1), 12=120 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/56, 2-3=-66/43, 3-5=-39/97, 5-7=-48/95, 7-8=-61/33, 8-9=0/56

BOT CHORD 2-12=-43/132, 11-12=-41/132, 10-11=-41/132, 8-10=-53/143

WEBS 5-11=-69/1, 3-12=-122/135, 7-10=-121/134

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- 3) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 4) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 1-4-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 2, 67 lb uplift at joint 8, 45 lb uplift at joint 12, 46 lb uplift at joint 10, 58 lb uplift at joint 2 and 67 lb uplift at joint 8.

LOAD CASE(S) Standard



Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job P06023-112726	Truss T5	Truss Type Common	Qty 1	Ply 1	Nagle Residence Job Reference (optional)	T41921574
----------------------	-------------	----------------------	----------	----------	---	-----------

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42

Page: 1

ID:q8DWw1iMomF6w9Xis40F_yyy85N-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

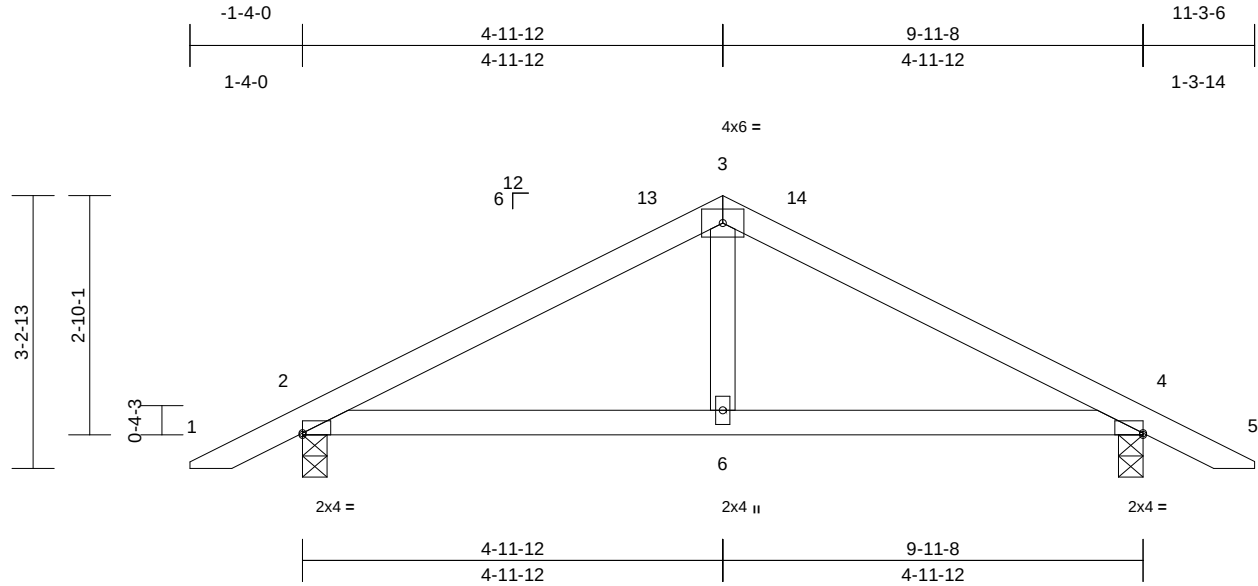

Scale = 1:27.3

Plate Offsets (X, Y): [2:Edge,0-0-4], [4:Edge,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.29	Vert(LL)	0.02	6-12	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.04	6-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 39 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4=0-3-8

Max Horiz 2=51 (LC 16)
Max Uplift 2=-122 (LC 12), 4=-122 (LC 13)
Max Grav 2=524 (LC 1), 4=524 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/34, 2-3=-619/333, 3-4=-619/323, 4-5=0/34
BOT CHORD 2-6=-154/495, 4-6=-154/495
WEBS 3-6=-35/239

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 -1-1-0 to 4-3-12, Zone1 4-3-12 to 4-11-12, Zone3 4-11-12 to 11-0-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 122 lb uplift at joint 2 and 122 lb uplift at joint 4.

LOAD CASE(S) Standard

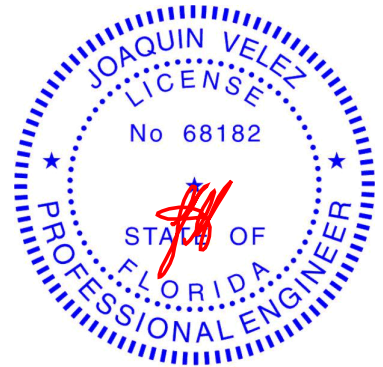

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	TG2	Common Girder	1	1	T41921575
Job Reference (optional)					

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43

Page: 1

ID:Kxk8nBDHVtnzjjRs_DfK6yy80r-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?r

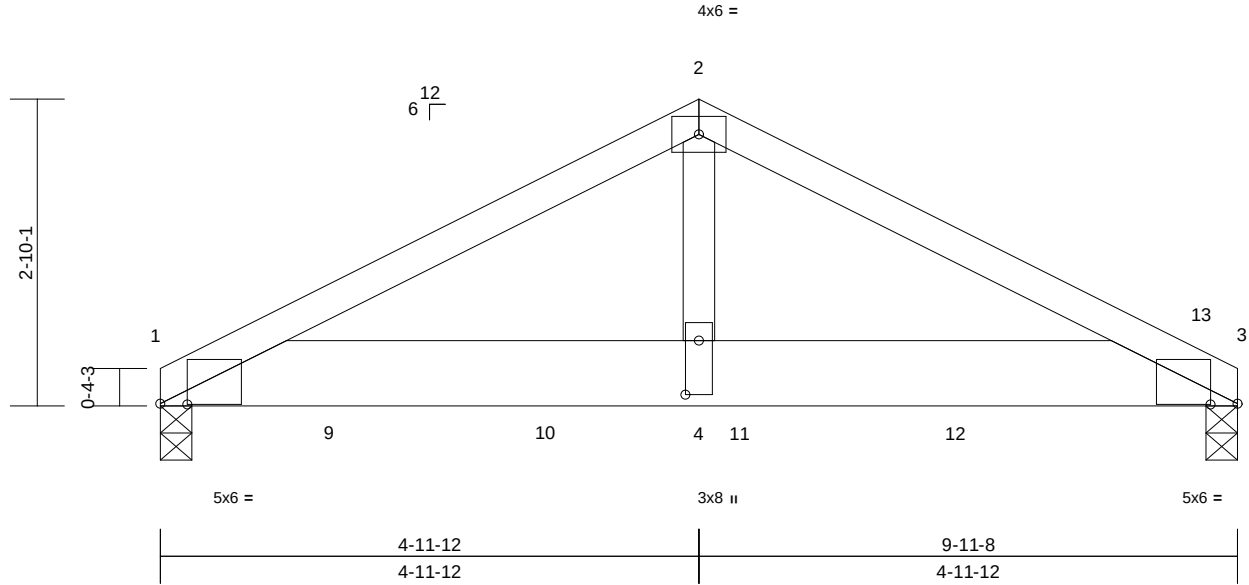

Scale = 1:21.3

Plate Offsets (X, Y): [1:0-3-0,0-0-1], [3:0-3-0,0-0-1], [4:0-6-0,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	-0.03	4-6	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.36	Vert(CT)	-0.08	4-6	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.45	Horz(CT)	0.02	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 50 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x8 SP DSS
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-4-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=0-3-8, 3=0-3-8
Max Horiz 1=-40 (LC 9)
Max Uplift 1=-385 (LC 8), 3=-444 (LC 9)
Max Grav 1=1815 (LC 1), 3=2105 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-2616/555, 2-3=-2629/556
BOT CHORD 1-4=-460/2302, 3-4=-460/2302
WEBS 2-4=-401/2014


NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 385 lb uplift at joint 1 and 444 lb uplift at joint 3.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 610 lb down and 130 lb up at 1-6-12, 610 lb down and 130 lb up at 3-6-12, 610 lb down and 130 lb up at 5-4-4, and 607 lb down and 129 lb up at 7-4-4, and 613 lb down and 127 lb up at 9-4-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 1-3=-20
Concentrated Loads (lb)
Vert: 9=-610 (B), 10=-610 (B), 11=-610 (B), 12=-607 (B), 13=-613 (B)

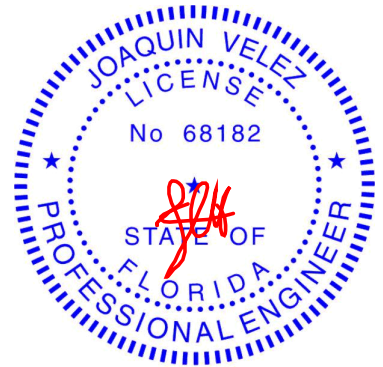

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	TG4	Common Girder	1	1	Job Reference (optional)
					T41921576

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43

Page: 1

ID:GWHcVRdX2pcwKCS1UBqmFmyy81c-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCDoi7J4zJC?f

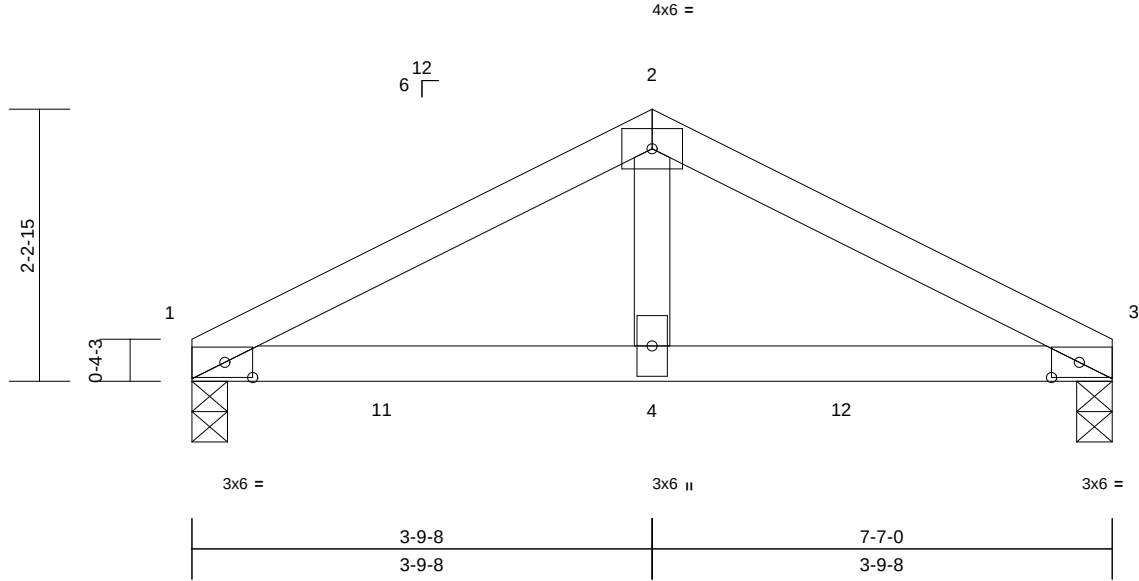

Scale = 1:19

Plate Offsets (X, Y): [1:0-2-12,0-1-8], [3:0-2-12,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.49	Vert(LL)	-0.04	4-10	>999	240	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.96	Vert(CT)	-0.09	4-10	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.32	Horz(CT)	0.01	3	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							
										Weight: 27 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.1
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-3-8, 3=0-3-8
Max Horiz 1=32 (LC 27)
Max Uplift 1=-278 (LC 8), 3=-255 (LC 9)
Max Grav 1=1310 (LC 1), 3=1203 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-1941/408, 2-3=-1945/408
BOT CHORD 1-4=-338/1714, 3-4=-338/1714
WEBS 2-4=-279/1423


NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 278 lb uplift at joint 1 and 255 lb uplift at joint 3.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 610 lb down and 130 lb up at 1-6-12, and 610 lb down and 130 lb up at 3-6-12, and 610 lb down and 130 lb up at 5-4-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 5-8=-20
Concentrated Loads (lb)
Vert: 4=-610 (F), 11=-610 (F), 12=-610 (F)

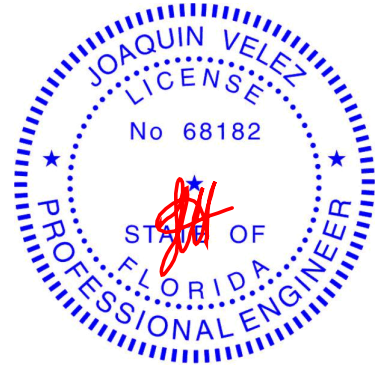

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence	T41921577
P06023-112726	V1	Valley	1	1	Job Reference (optional)	

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43
ID:P?P5UB78dE773rikfWKIZeyy8J1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

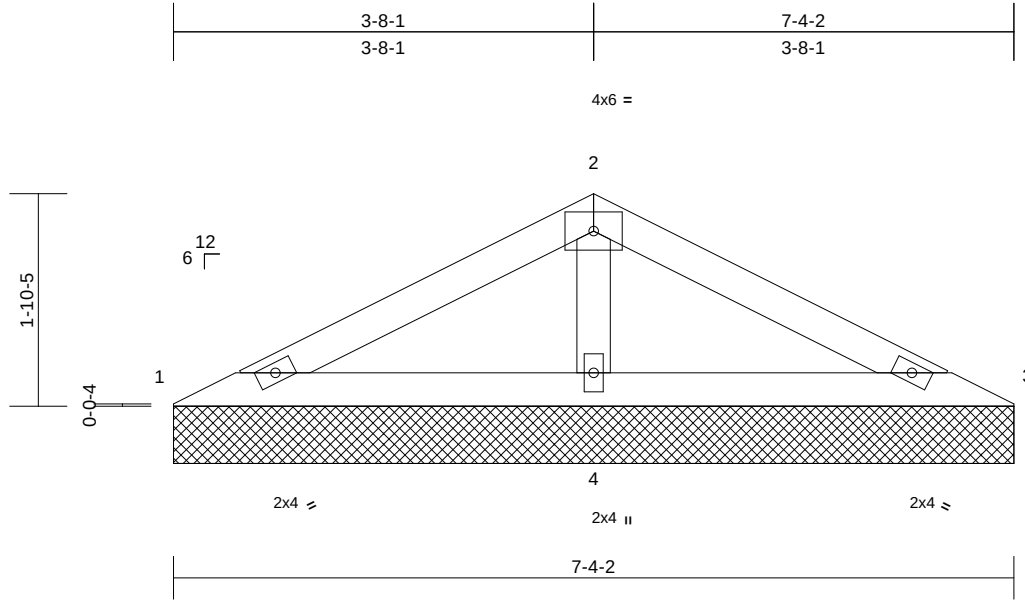

Scale = 1:20.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.16	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.18	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 23 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 7-4-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size) 1=7-4-2, 3=7-4-2, 4=7-4-2
Max Horiz 1=28 (LC 12)
Max Uplift 1=-18 (LC 12), 3=-24 (LC 13), 4=-105 (LC 12)
Max Grav 1=85 (LC 25), 3=85 (LC 26), 4=536 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-163/252, 2-3=-163/252
BOT CHORD 1-4=-197/231, 3-4=-197/231
WEBS 2-4=-370/308

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1, 24 lb uplift at joint 3 and 105 lb uplift at joint 4.

LOAD CASE(S) Standard

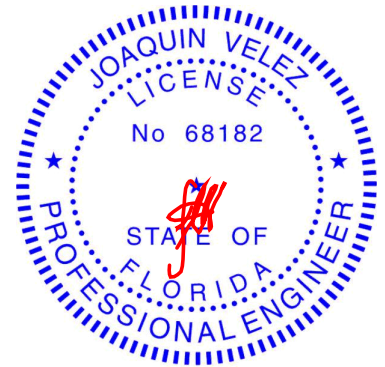

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	V2	Valley	1	1	T41921578
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43

Page: 1

ID:O8VWolM4PvnVjcTifLFRfeyxXIA-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

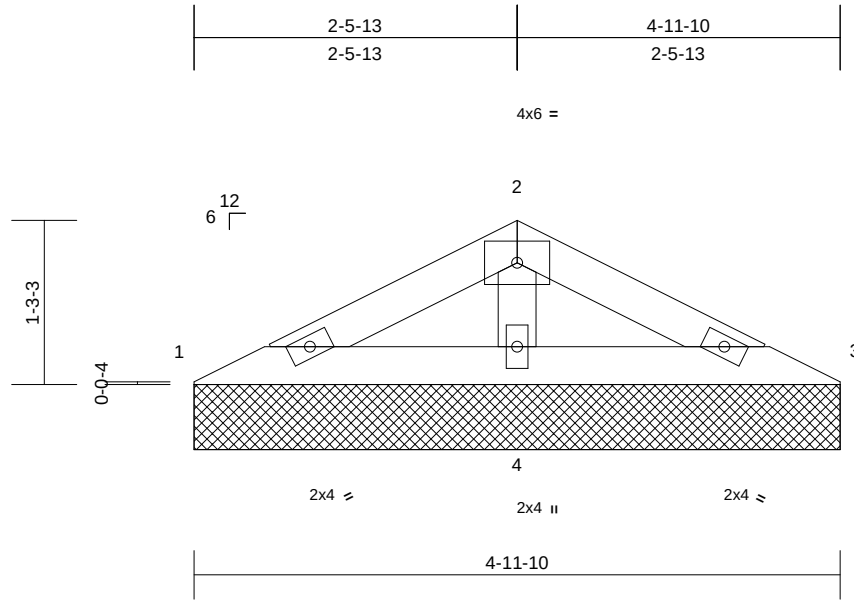

Scale = 1:17.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	15.0	Lumber DOL	1.25	BC	0.08	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	4	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 15 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-11-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size) 1=4-11-10, 3=4-11-10, 4=4-11-10
Max Horiz 1=18 (LC 12)
Max Uplift 1=18 (LC 12), 3=22 (LC 13), 4=60 (LC 12)
Max Grav 1=74 (LC 25), 3=74 (LC 26), 4=321 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-74/119, 2-3=-74/119
BOT CHORD 1-4=-90/130, 3-4=-90/130
WEBS 2-4=-188/167

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1, 22 lb uplift at joint 3 and 60 lb uplift at joint 4.

LOAD CASE(S) Standard

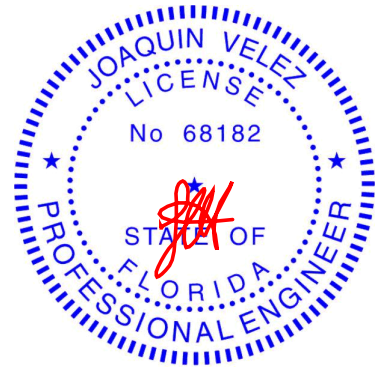

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence	T41921579
P06023-112726	TG1	Hip Girder	1	1	Job Reference (optional)	

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43

Page: 1

ID:ZJ8PqCicPWCib2urP0rQf4yy821-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

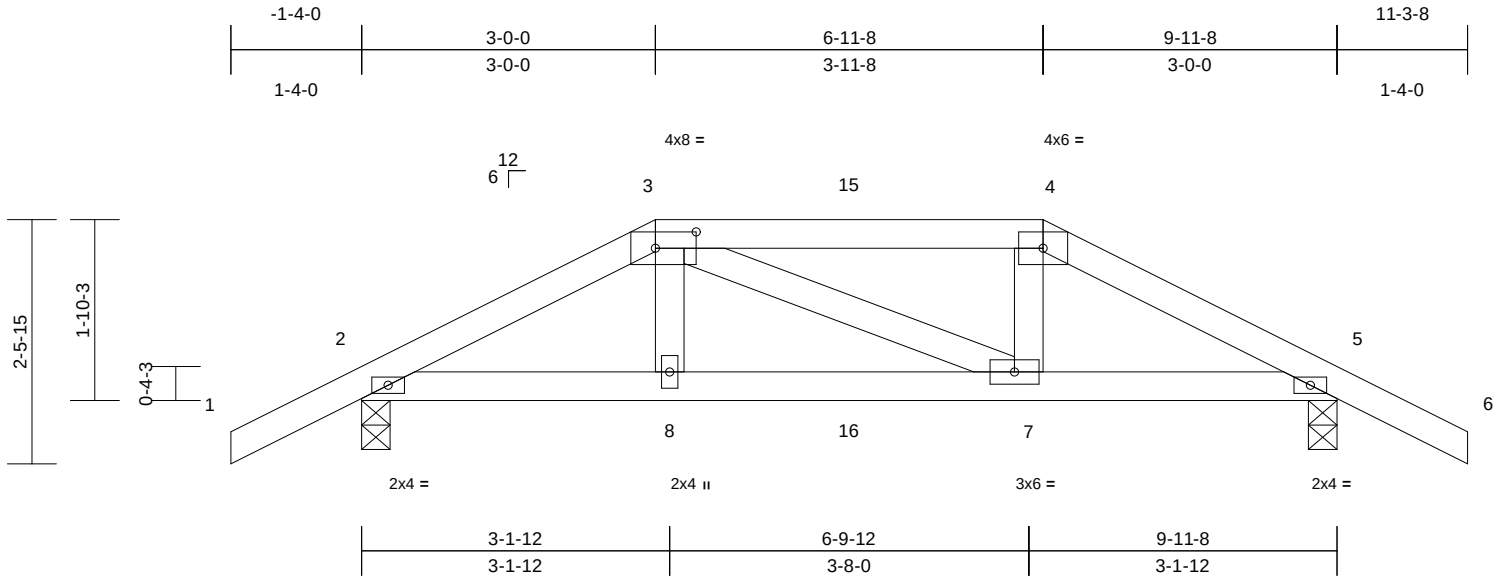

Scale = 1:23.5

Plate Offsets (X, Y): [3:0-5-0,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.29	Vert(LL)	-0.01	7-8	>999	240	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.25	Vert(CT)	-0.03	7-8	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.04	Horz(CT)	0.01	5	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
										Weight: 45 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 5=0-3-8
Max Horiz 2=36 (LC 12)
Max Uplift 2=-152 (LC 8), 5=-152 (LC 9)
Max Grav 2=582 (LC 1), 5=582 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/42, 2-3=-792/182, 3-4=-685/175, 4-5=-793/181, 5-6=0/42
BOT CHORD 2-8=-142/690, 7-8=-139/701, 5-7=-127/681
WEBS 3-8=0/164, 3-7=-18/20, 4-7=0/164


NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 152 lb uplift at joint 2 and 152 lb uplift at joint 5.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 138 lb down and 81 lb up at 3-0-0, and 42 lb down and 41 lb up at 4-11-12, and 138 lb down and 81 lb up at 6-11-8 on top chord, and 67 lb down at 3-0-0, and 27 lb down at 4-11-12, and 67 lb down at 6-10-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 9-12=-20
Concentrated Loads (lb)
Vert: 3=-10 (F), 4=-10 (F), 8=-20 (F), 7=-20 (F), 15=-8 (F), 16=-13 (F)

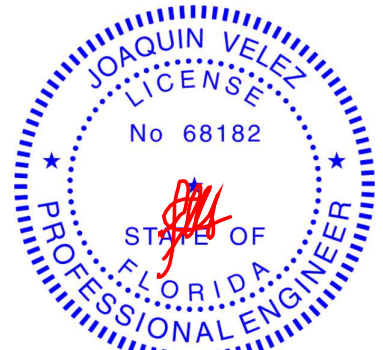

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job P06023-112726	Truss JH1	Truss Type Diagonal Hip Girder	Qty 4	Ply 1	Nagle Residence Job Reference (optional)	T41921580
----------------------	--------------	-----------------------------------	----------	----------	---	-----------

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42
ID:J229pVndXJnsxR5aNUaLQ0yy82i-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

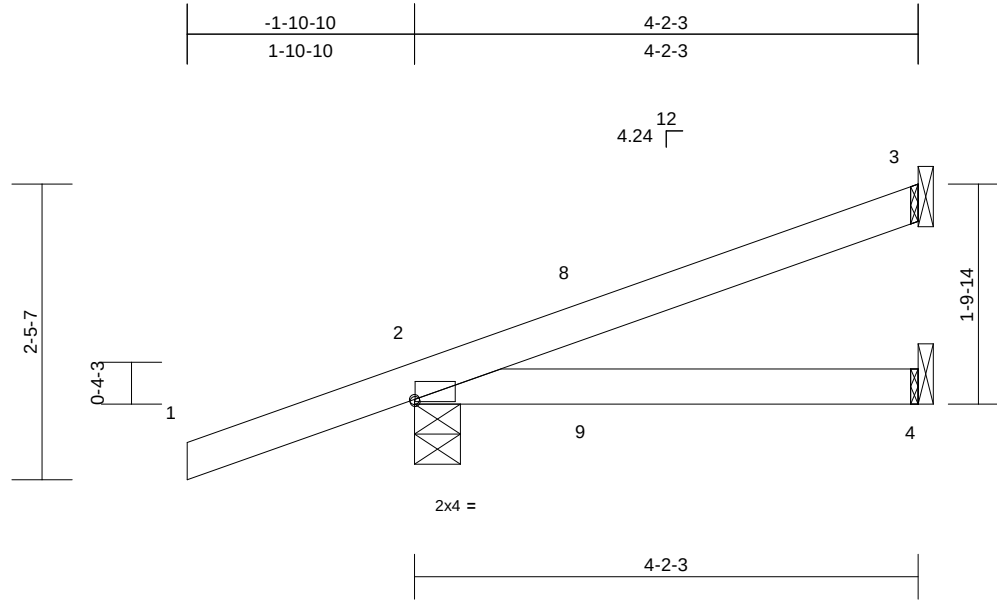

Scale = 1:19.1

Plate Offsets (X, Y): [2:0-0-1,0-0-3]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.30	Vert(LL)	-0.02	4-7	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.12	Vert(CT)	-0.02	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 16 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-2-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-4-9, 3= Mechanical, 4= Mechanical
Max Horiz 2=91 (LC 4)
Max Uplift 2=-89 (LC 4), 3=-34 (LC 8)
Max Grav 2=305 (LC 1), 3=101 (LC 1), 4=60 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-156/155
BOT CHORD 2-4=-149/129


NOTES

- 1) Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone; cantilever left exposed ; end vertical left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 3 and 89 lb uplift at joint 2.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 66 lb down and 60 lb up at 1-4-8, and 66 lb down and 60 lb up at 1-4-8 on top chord, and 6 lb down and 47 lb up at 1-4-8, and 6 lb down and 47 lb up at 1-4-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 9=64 (F=32, B=32)

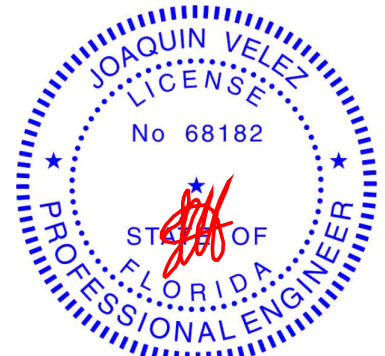

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	J2	Jack-Open	8	1	T41921581
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42
ID:BHEpWFQpb506KqppdB1JChyy83A-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?i

Page: 1

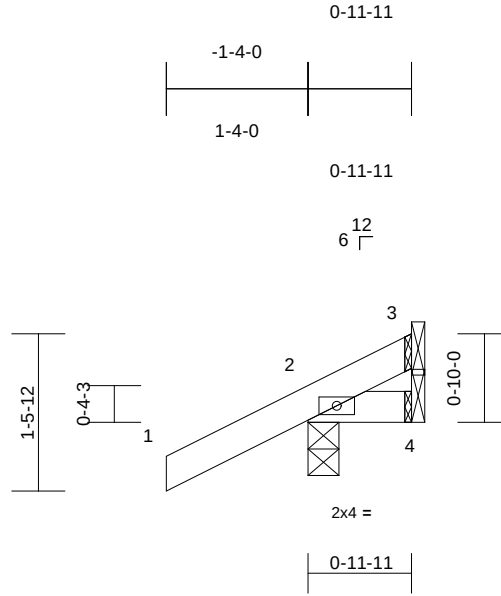

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.14	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.03	Vert(CT)	0.00	7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 6 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2 lb uplift at joint 3, 69 lb uplift at joint 2 and 19 lb uplift at joint 4.

BRACING

TOP CHORD Structural wood sheathing directly applied or 0-11-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

LOAD CASE(S) Standard

REACTIONS

(size) 2=0-3-8, 3= Mechanical, 4= Mechanical
Max Horiz 2=41 (LC 12)
Max Uplift 2=-69 (LC 12), 3=-2 (LC 1), 4=-19 (LC 1)
Max Grav 2=201 (LC 1), 3=7 (LC 8), 4=12 (LC 8)


FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/42, 2-3=-66/43
BOT CHORD 2-4=-47/69

NOTES

- 1) Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever left exposed ; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.

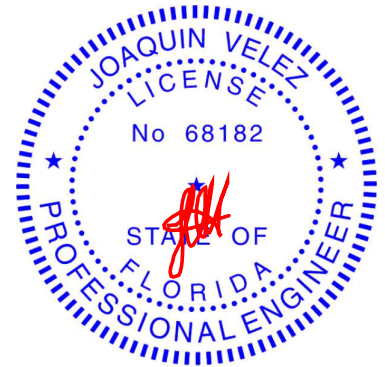

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	J1	Jack-Open	5	1	T41921582
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:41
ID:4myunoFf5NyGqJJMyJGAxy83N-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

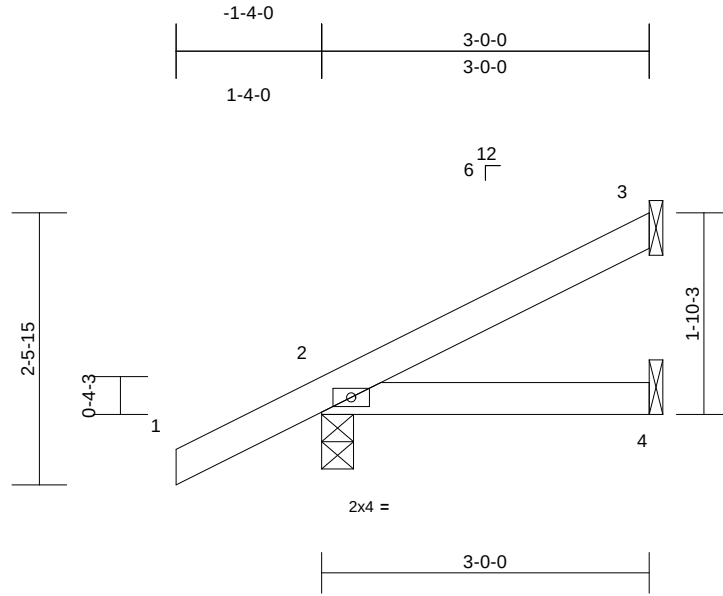

Scale = 1:21.1												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.14	Vert(LL)	0.00	4-7	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.08	Vert(CT)	-0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 12 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 41 lb uplift at joint 3 and 63 lb uplift at joint 2.

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

LOAD CASE(S) Standard


REACTIONS (size) 2=0-3-8, 3= Mechanical, 4= Mechanical
Max Horiz 2=79 (LC 12)
Max Uplift 2=-63 (LC 12), 3=-41 (LC 12)
Max Grav 2=247 (LC 1), 3=78 (LC 1), 4=52 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/42, 2-3=-100/31
BOT CHORD 2-4=-28/56

NOTES

- 1) Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever left exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.

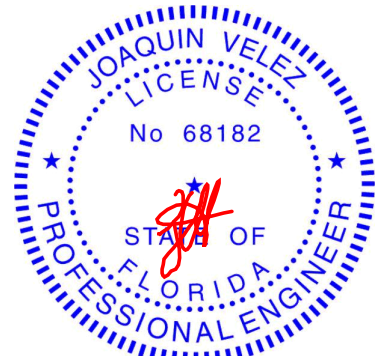

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	TG3	Hip Girder	1	1	T41921583
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:43
ID: C4p5Dh1oamRtygCc6PSGmRyy82N-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

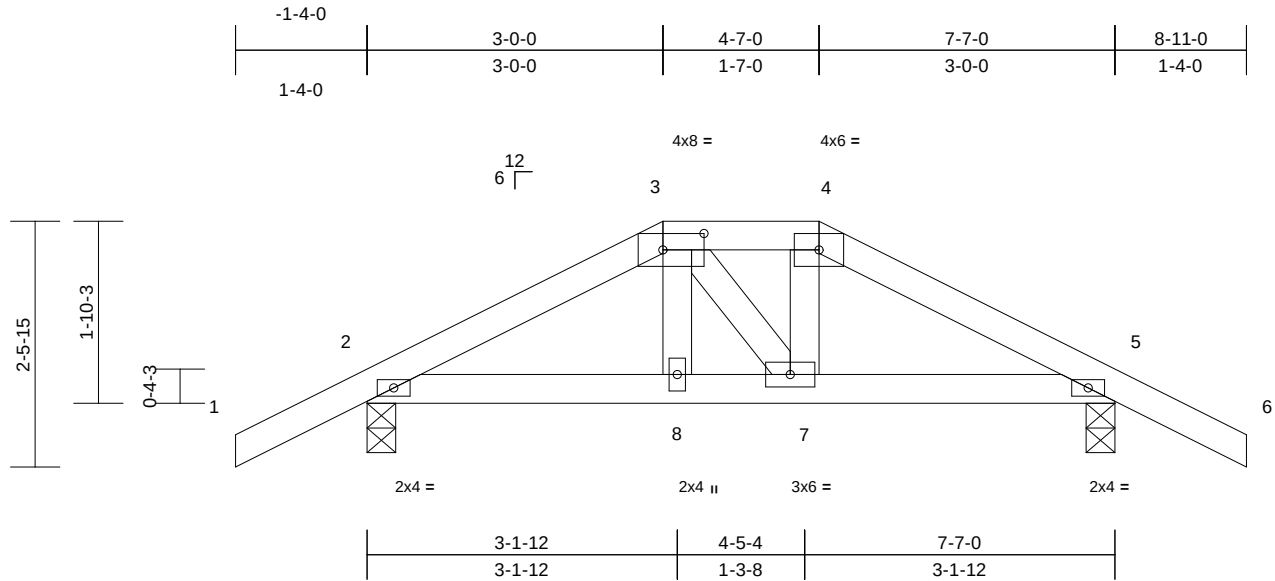

Scale = 1:23.4

Plate Offsets (X, Y): [3:0-5-0,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.15	Vert(LL)	0.00	8	>999	240	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.15	Vert(CT)	-0.01	8-11	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.02	Horz(CT)	0.00	5	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							
										Weight: 35 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 5=0-3-8
Max Horiz 2=-36 (LC 13)
Max Uplift 2=-129 (LC 8), 5=-129 (LC 9)
Max Grav 2=464 (LC 1), 5=464 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/42, 2-3=-530/129, 3-4=-448/127, 4-5=-531/129, 5-6=0/42
BOT CHORD 2-8=-85/474, 7-8=-84/482, 5-7=-83/469
WEBS 3-8=0/104, 3-7=-15/18, 4-7=0/106


NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 2 and 129 lb uplift at joint 5.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 138 lb down and 81 lb up at 3-0-0, and 138 lb down and 81 lb up at 4-7-0 on top chord, and 67 lb down at 3-0-0, and 67 lb down at 4-6-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 9-12=-20
Concentrated Loads (lb)
Vert: 3=-10 (B), 4=-10 (B), 8=-20 (B), 7=-20 (B)

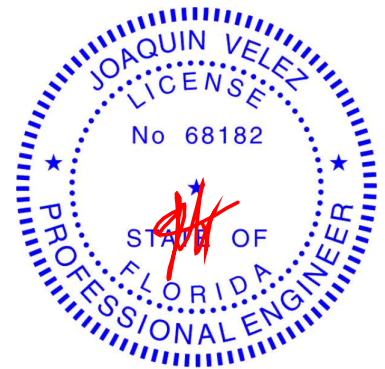

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	T7	Common	2	1	T41921584
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42
ID:P?P5UB78dE773rikfWKIzEyy8J1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

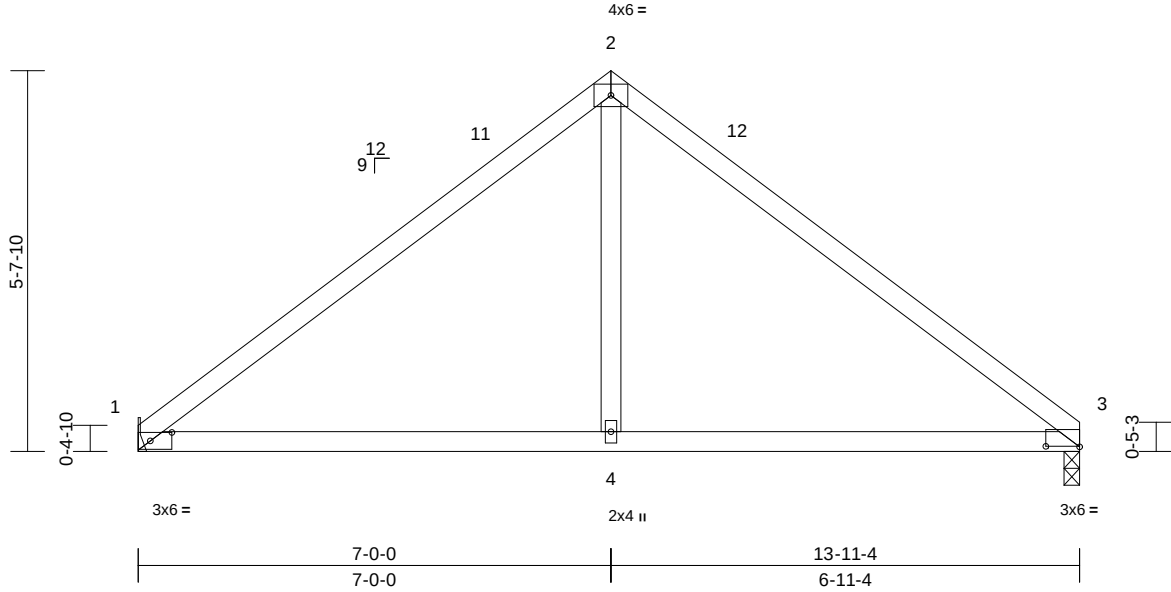

Scale = 1:34.1

Plate Offsets (X, Y): [1:0-3-13,0-1-8], [3:0-6-0,0-0-2]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.73	Vert(LL)	0.11	4-7	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.61	Vert(CT)	-0.17	4-7	>971	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 55 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-3-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1= Mechanical, 3=0-2-12
Max Horiz 1=130 (LC 9)
Max Uplift 1=-123 (LC 12), 3=-123 (LC 13)
Max Grav 1=627 (LC 1), 3=627 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-741/285, 2-3=-742/264
BOT CHORD 1-4=-115/485, 3-4=-166/485
WEBS 2-4=-53/350

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 0-0-0 to 5-4-13, Zone1 5-4-13 to 7-0-0, Zone3 7-0-0 to 13-11-4 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 3.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 1 and 123 lb uplift at joint 3.

LOAD CASE(S) Standard

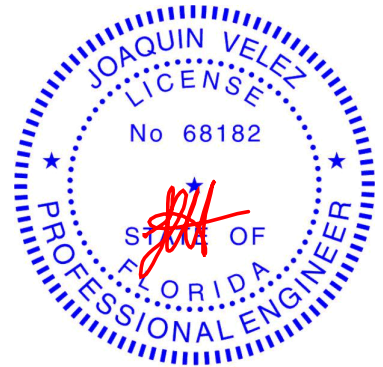

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence	T41921585
P06023-112726	T4	Common	1	1	Job Reference (optional)	

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.40 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42

Page: 1

ID:q8DWw1iMomF6w9Xis40F_yyy85N-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

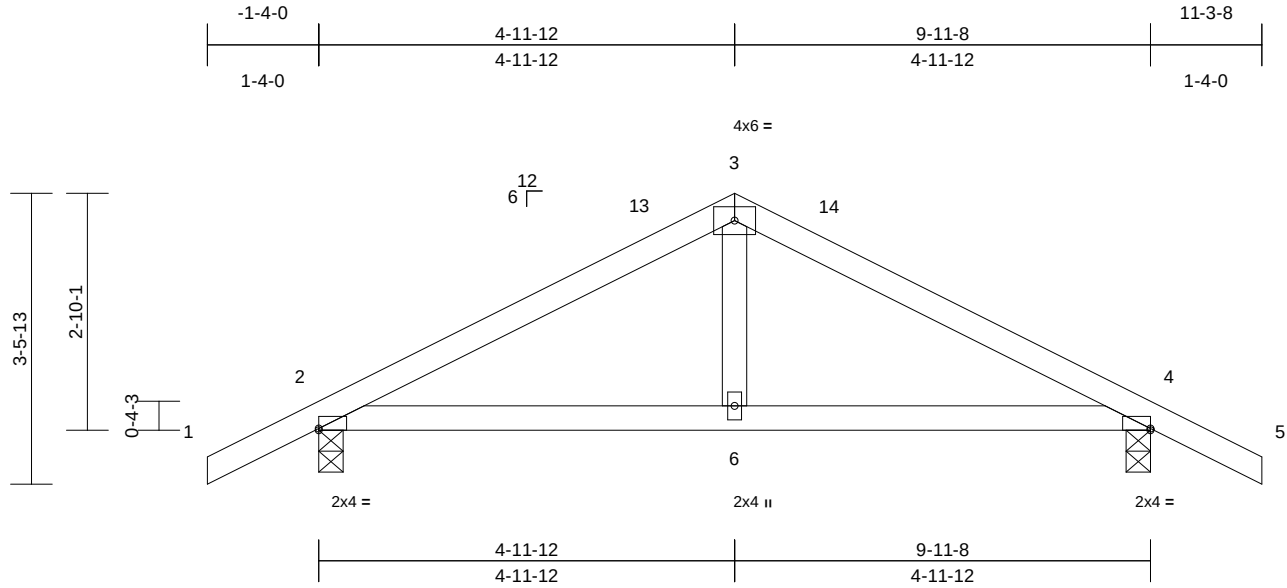

Scale = 1:27.6

Plate Offsets (X, Y): [2:Edge,0-0-4], [4:Edge,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.28	Vert(LL)	0.02	6-12	>999	240	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.04	6-12	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.01	4	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
										Weight: 40 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4=0-3-8

Max Horiz 2=-53 (LC 13)
Max Uplift 2=-129 (LC 12), 4=-129 (LC 13)
Max Grav 2=541 (LC 1), 4=541 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/42, 2-3=-607/313, 3-4=-607/300, 4-5=0/42
BOT CHORD 2-6=-125/483, 4-6=-125/483
WEBS 3-6=-26/236

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 -1-4-0 to 4-0-13, Zone1 4-0-13 to 4-11-12, Zone3 4-11-12 to 11-3-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 2 and 129 lb uplift at joint 4.

LOAD CASE(S) Standard

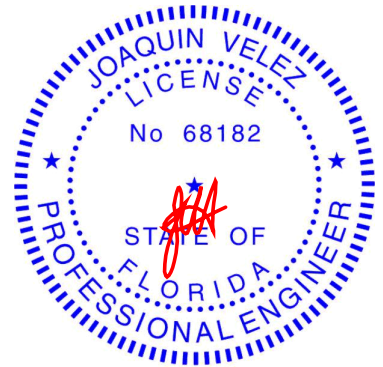

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	T6B	Common	1	1	T41921586
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42
ID:X9x?HiflRk42G8UIRSPX8Oyy849-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

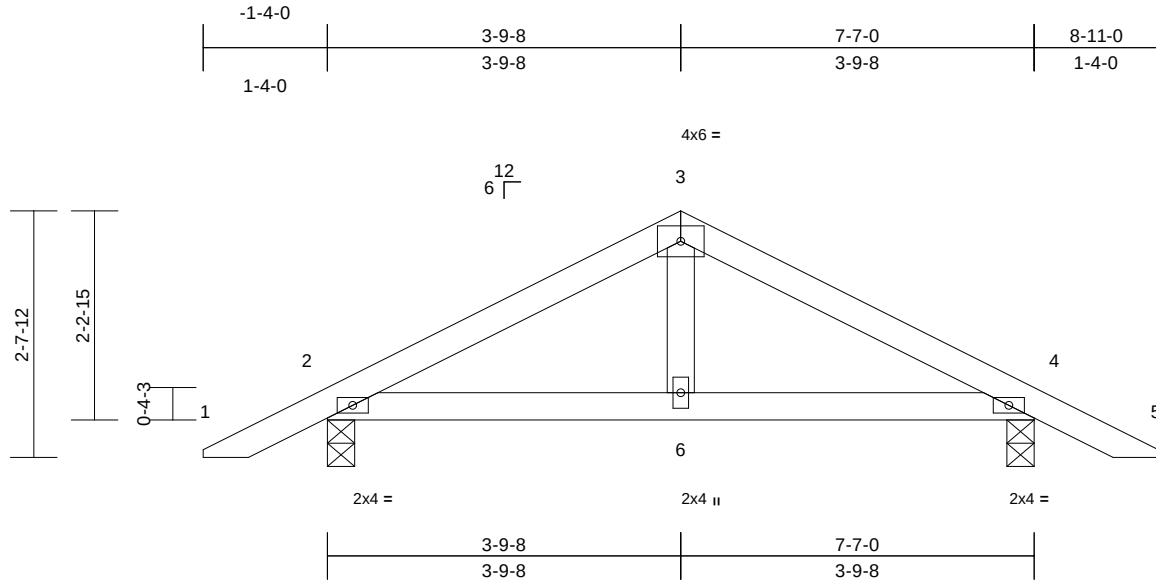

Scale = 1:24.7											
Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.21	0.01	6-12	>999	240	MT20	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.21	Vert(CT)	-0.02	6-9	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	4	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP						Weight: 31 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 4=0-3-8
Max Horiz 2=41 (LC 12)
Max Uplift 2=-100 (LC 12), 4=-100 (LC 13)
Max Grav 2=418 (LC 1), 4=418 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/34, 2-3=-438/283, 3-4=-438/282, 4-5=0/34
BOT CHORD 2-6=-114/342, 4-6=-114/342
WEBS 3-6=-50/185

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 2 and 100 lb uplift at joint 4.

LOAD CASE(S) Standard

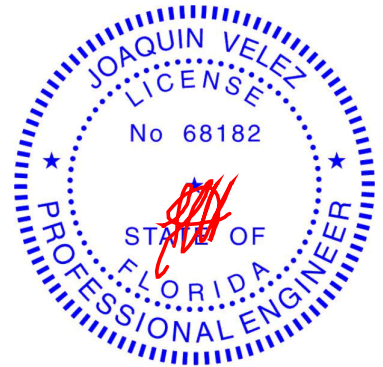

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Nagle Residence
P06023-112726	T3	Common	2	1	T41921587
					Job Reference (optional)

84 Lumber-1387 (Winter Haven, FL), Winter Haven, FL - 33880,

Run: 25.40 S Jul 9 2026 Print: 25.4.0 S Jul 9 2026 MiTek Industries, Inc. Mon Jul 20 11:37:42

Page: 1

ID:?4gwYr?q3uEat67cR79ZTdyxXpm-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

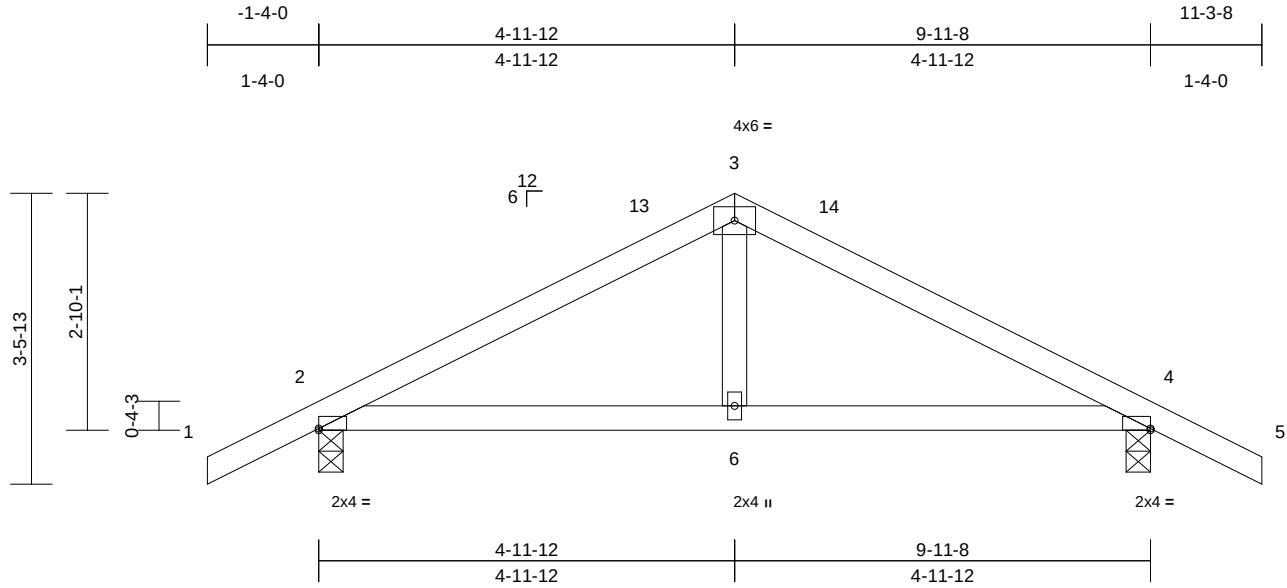

Scale = 1:27.6

Plate Offsets (X, Y): [2:Edge,0-0-4], [4:Edge,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.28	Vert(LL)	0.02	6-12	>999	240	244/190
TCDL	15.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.04	6-12	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.01	4	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
										Weight: 40 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4=0-3-8

Max Horiz 2=-53 (LC 13)
Max Uplift 2=-129 (LC 12), 4=-129 (LC 13)
Max Grav 2=541 (LC 1), 4=541 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/42, 2-3=-607/313, 3-4=-607/300, 4-5=0/42
BOT CHORD 2-6=-125/483, 4-6=-125/483
WEBS 3-6=-26/236

NOTES

- Unbalanced roof live loads have been considered for this design.
- Designed to ASCE 7-22 basic load combinations for allowable stress design unless otherwise noted.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior (2) zone and C-C Zone3 -1-4-0 to 4-0-13, Zone1 4-0-13 to 4-11-12, Zone3 4-11-12 to 11-3-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 2 and 129 lb uplift at joint 4.

LOAD CASE(S) Standard

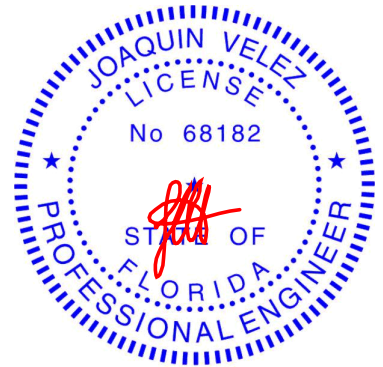

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 20,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols


PLATE LOCATION AND ORIENTATION

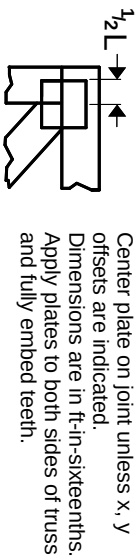

0- $\frac{1}{16}$ "

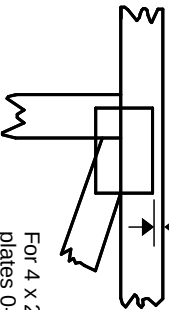

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.



* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

1 2 3 Joint ID typ.

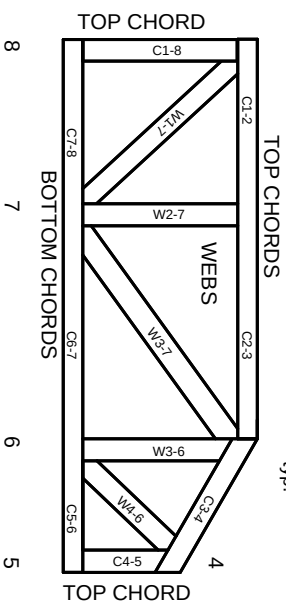

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/12/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.