

APPLICABLE CODES, REGULATIONS, & STANDARDS

- A. THE 2023 FLORIDA BUILDING CODE, 8TH EDITION
B. ASCE/SEI 7 22 MINIMUM DESIGN LOADS ON BUILDINGS AND OTHER STRUCTURES
C. ACI 318-19 BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE
D. AISC STEEL CONSTRUCTION MANUAL (15TH EDITION)
E. AWS D1.1. STRUCTURAL WELDING

1. THESE PLANS BELONG EXCLUSIVELY TO THE STRUCTURE, INCLUDING MAIN WIND FORCE RESISTING SYSTEM (MWFERS), COMPONENTS AND CLADDING (C&C), AND BASE RAIL ANCHORAGE. OTHER DESIGN ISSUES, INCLUDING BUT NOT LIMITED TO PROPERTY SET BACKS, ELECTRICAL, PLUMBING, INGRESS/EGRESS, FINISH FLOOR SLOPES AND ELEVATIONS, OR OTHER LOCAL ZONING REQUIREMENTS ARE THE LIABILITY OF OTHERS.

2. THESE STRUCTURES ARE ENGINEERED AS CAPABLE OF SUPPORTING DEAD LOAD OF THE STRUCTURE AND LIVE AND WIND LOADS. UPGRADES NOT SPECIFICALLY ADDRESSED HEREIN, SUCH AS WINDOWS, DOORS, OR ANOTHER COMPONENT NOT LISTED IN THE FLORIDA BUILDING CODE APPROVED PRODUCT LIST, AND NOT PROVIDED AND INSTALLED BY TUBULAR BUILDING SYSTEMS, WHICH CAUSE ADDITIONAL LOADS ON THE STRUCTURE SHALL BE AT THE OWNER'S RISK. FLORIDA ENGINEERING LLC, SHALL NOT BE RESPONSIBLE FOR FAILURE OR STRUCTURAL DAMAGE DUE TO THE EXTRA LOAD

3. LOW ULTIMATE WIND SPEED 105 TO 140 MPH (NOMINAL WIND SPEED 81 TO 108 MPH). MAXIMUM RAFTER/POST AND END POST SPACING = 5.0 FEET

4. HIGH ULTIMATE WIND SPEED 141 TO 170 MPH (NOMINAL WIND SPEED 109 TO 132 MPH). MAXIMUM RAFTER/POST AND END POST SPACING = 4.0 FEET

5. ALL STEEL TUBING SHALL BE 50 KSI GALVANIZED STEEL. ALL FASTENERS SHALL BE ZINC COATED HARDWARE

6. SPECIFICATIONS APPLICABLE TO 26 GAUGE METAL PANELS FASTENED DIRECTLY TO 2 1/2" x 2 1/2" 14 GAUGE TUBE STEEL (TS) FRAMING MEMBERS FOR VERTICAL PANELS, 26 GAUGE METAL PANELS SHALL BE FASTENED TO 16 GAUGE HAT CHANNELS (UNLESS OTHERWISE NOTED)

7. WIND FORCES GOVERN OVER SEISMIC FORCES. SEISMIC PARAMETERS ANALYZED ARE
R 3.5
Sds = 0.087g
Sd1 0.084g

8. GROUND ANCHORS SHALL BE INSTALLED THROUGH BASE RAIL WITHIN 6 OF EACH RAFTER COLUMN ALONG SIDES.

9. GROUND ANCHOR (SOIL NAILS) CONSIST OF #5 REBAR W/ WELDED NUT X 30' LONG IN SUITABLE SOIL CONDITIONS MAY BE USED FOR LOW (≤ 108 MPH NOMINAL) WIND SPEEDS ONLY. OPTIONAL ANCHORAGE MAY BE USED IN SUITABLE SOILS AND MUST BE USE IN UNSUITABLE SOILS AS NOTED

10. MIN LAP REQUIREMENT FOR REBAR IN FOOTER IS 25

11. SOIL TO BE COMPACTED TO 95% OF ITS MAXIMUM DRY DENSITY. AT OPTIMUM MOISTURE CONTENT IN ACCORDANCE WITH ASTM D1557-93

12. PRIOR TO PLACING CONCRETE, TREAT THE ENTIRE SUBSURFACE AREA FOR TERMITES IN COMPLIANCE WITH THE FBC. FOR RISK CATEGORY II, III & IV STRUCTURES ONLY

13. ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE.

14. A LANDING OF MIN. 36" WIDTH IN THE DIRECTION OF TRAVEL SHALL BE PROVIDED AT THE EXTERIOR DOORS. SLOPE OF LANDING NOT TO EXCEED 1/4" 1. LANDING LEVEL NOT TO BE LOWER THAN 1 1/2" (FOR EGRESS DOORS) & 7 3/4" (FOR OTHER EXTERIOR DOORS) BELOW THE TOP OF THRESHOLD.

DESIGN DATA		
DESIGN CRITERIA	ASCE/SEI 7	II
RISK CATEGORY		R3
OCCUPANCY CLASSIFICATION		II-B
CONSTRUCTION TYPE		L/240
DEFLECTION LIMIT =		120
ULTIMATE DESIGN WIND SPEED (MPH) VULT =		93
NOMINAL DESIGN WIND SPEED (MPH) VASD =		C
EXPOSURE CATEGORY		19.50
MEAN BUILDING HEIGHT (FT) =		24.00
MINIMUM BUILDING PLAN DIMENSION (FT) =		3.00
END ZONE DIMENSION (FT) a =		GABLE
ROOF STYLE		3
ROOF PITCH (IN 12)		PARTIALLY ENCLOSED
OCCUPANCY CLASSIFICATION		8.1 PSF
DEAD LOAD (DUE TO SELF-WEIGHT) =		12 PSF
ROOF LIVE LOAD =		4 PSF
GROUND SNOW LOAD =		

ADJUSTED C & C WIND PRESSURES (ASD) (PSF)		
EFFECTIVE WIND AREA FOR ROOF (SQ. FT)		60.00
ZONE 1 (POSITIVE) =		NA
ZONE 1 (NEGATIVE) =		NA
ZONE 1' (OVERHANG) =		NA
ZONE 1 (POSITIVE) =		16.4
ZONE 1 (NEGATIVE) =		29.7
ZONE 1 (OVERHANG) =		-44.3
ZONE 2 (POSITIVE) =		16.4
ZONE 2 (NEGATIVE) =		-37.7
ZONE 2 (OVERHANG) =		-52.3
ZONE 3 (POSITIVE) =		16.4
ZONE 3 (NEGATIVE) =		-46.4
ZONE 3 (OVERHANG) =		-61.0

EFFECTIVE WIND AREA FOR WALLS (SQ. FT)		108.00
ZONE 4 (POSITIVE) =		23.1
ZONE 4 (NEGATIVE) =		24.8
ZONE 5 (POSITIVE) =		23.1
ZONE 5 (NEGATIVE) =		26.8

CONTRACTOR TO PROVIDE BUILDING CODE APPROVED PRODUCTS TO MEET OR EXCEED THE DESIGN PRESSURES AS TABULATED





ADJUSTED C & C WIND PRESSURES (ASD) (PSF) FOR OPENINGS		
SWING DOOR		
EFFECTIVE WIND AREA (SQ. FT) =		20.00
ZONE 4 (POSITIVE) =		25.3
ZONE 4 (NEGATIVE) =		27.0
ZONE 5 (POSITIVE) =		25.3
ZONE 5 (NEGATIVE) =		-31.1

ROLL-UP DOOR		
EFFECTIVE WIND AREA (SQ. FT) =		N/A
ZONE 4 (POSITIVE) =		N/A
ZONE 4 (NEGATIVE) =		N/A
ZONE 5 (POSITIVE) =		N/A
ZONE 5 (NEGATIVE) =		N/A

WINDOW		
EFFECTIVE WIND AREA (SQ. FT) =		4.50
ZONE 4 (POSITIVE) =		26.2
ZONE 4 (NEGATIVE) =		27.9
ZONE 5 (POSITIVE) =		26.2
ZONE 5 (NEGATIVE) =		-32.9

PRODUCT CATEGORY	SUB CATEGORY	MANUFACTURER	APPROVAL No. & DATE
STRUCTURAL COMPONENTS	ROOF DECK	CAPITAL METAL SUPPLY, INC. 26 GA. CAPITAL RIB ROOF PANEL	FL20147.2 R4 01/06/30
STRUCTURAL COMPONENTS	STRUCTURAL WALL	CAPITAL METAL SUPPLY, INC. 26 GA. CAPITAL RIB WALL PANEL	FL20148.2 R4 01/06/30
EXTERIOR DOORS	SWINGING	MI WINDOWS AND DOORS 1615/1617 SGD	FL26012.6-R13 03/23/27
EXTERIOR DOORS	SWINGING	ODL, INC. E. ODL FIBERGLASS DOOR	FL46120.5-R1 06/04/34
EXTERIOR DOORS	SWINGING	ODL, INC. A. ODL FIBERGLASS DOOR	FL46117.1-R1 06/04/34
WINDOWS	SINGLE HUNG	MI WINDOWS AND DOORS 3500 PW	FL18644.1 R10 04/30/26
WINDOWS	SINGLE HUNG	MI WINDOWS AND DOORS 3540 SH	FL41886.1-R10 04/12/27



CTP = CONTRACTOR TO PROVIDE APPROVED PRODUCTS THAT MEET OR EXCEED WIND DESIGN PRESSURES.

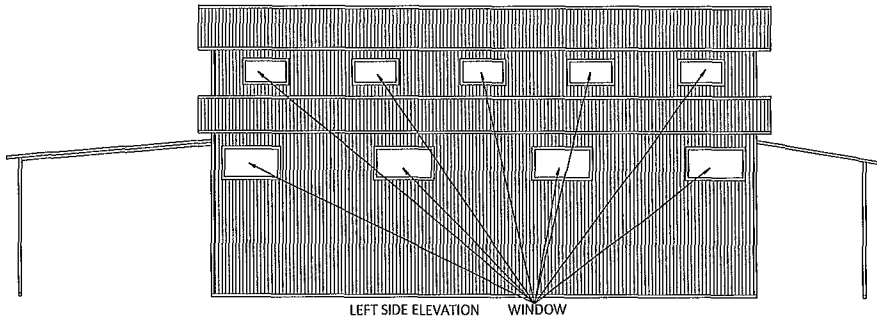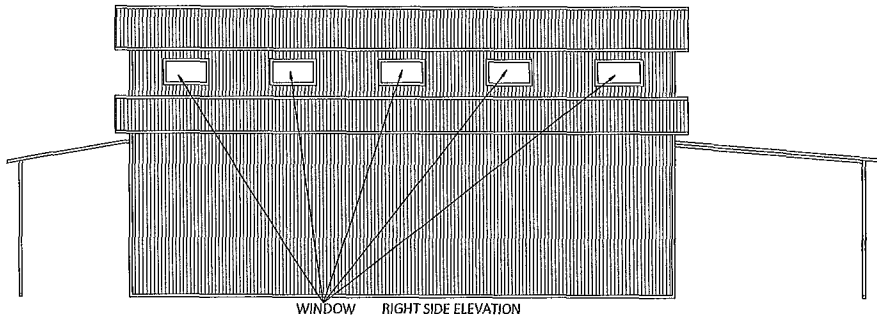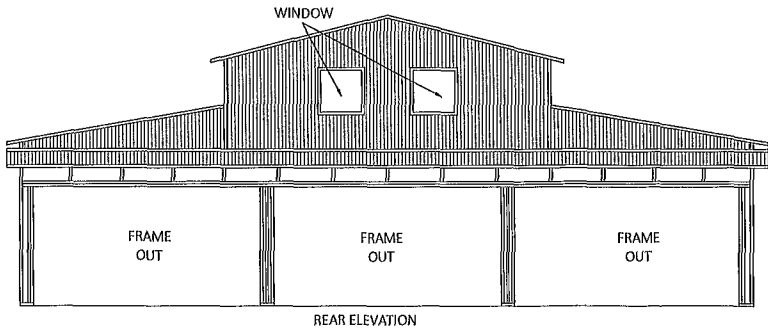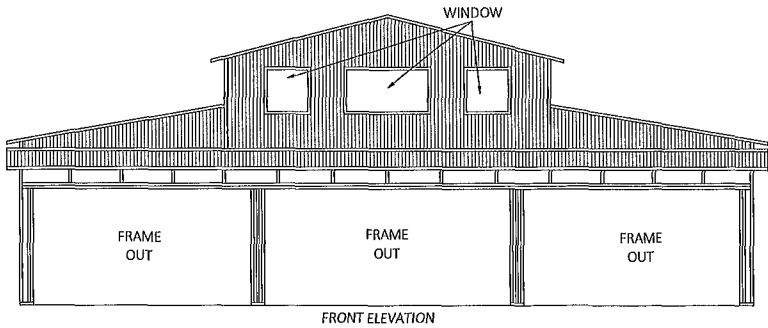

SHEET NO.	DRAWING INDEX
S/01	GENERAL NOTES
S/02	PLAN/ ELEVATIONS
S/03	FOUNDATION PLAN
S/04	DETAILS


THE ENGINEERING ON THESE PLANS IS SITE SPECIFIC FOR (1) STRUCTURE ONLY AT THE PROVIDED ADDRESS(ES)

PROPOSED METAL BUILDING FOUNDATION & SHELL. STRUCTURAL DESIGN ONLY. ALL OTHER REQUIRED PERMITS TO BUILD OUT TO A HABITABLE LIVING SPACE ARE TO BE BY OTHERS/ PER SEPERATE CERTIFICATE INCLUDING BUT NOT LIMITED TO ELECTRICAL, PLUMBING, ENERGY CALCS. ETC. FOR MORE INFORMATION VISIT- <https://flengineeringllc.com/order/> OR SCAN QR CODE.

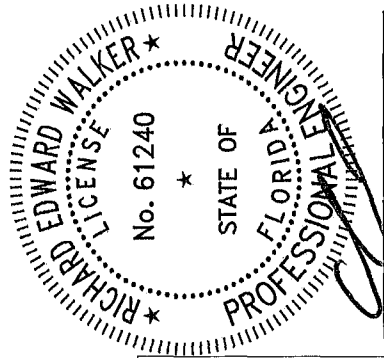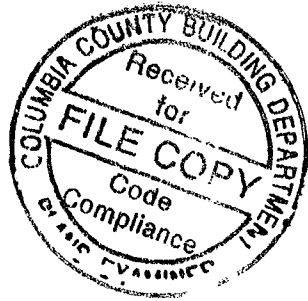

Richard E. Walker, P.E. #61240
DATE 04/09/2026

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2607835

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

PROJECT ADDRESS:

WILHELM
348 SW TALL PINE CT
LAKE CITY, FL 32024

DESIGN DATE 04/10/2026

REVISION 1 DATE

REVISION 2 DATE

DRAWN BY TCP

SCALE NTS

SHEET

01



DATE 04/09/2026

INLOU, L
(941) 391-5980

FLEng.com
Orders@FLEng.com

CA CERT. #30782

PROJECT NO. 2607835



PROJECT ADDRESS.

WILHELM
348 SW TALL PINE CT
LAKE CITY, FL 32024

DESIGN DATE	04/10/2026
-------------	------------


REVISION 1 DATE

REVISION 2	DATE
------------	------

DRAWN BY TCP

SHEET

02

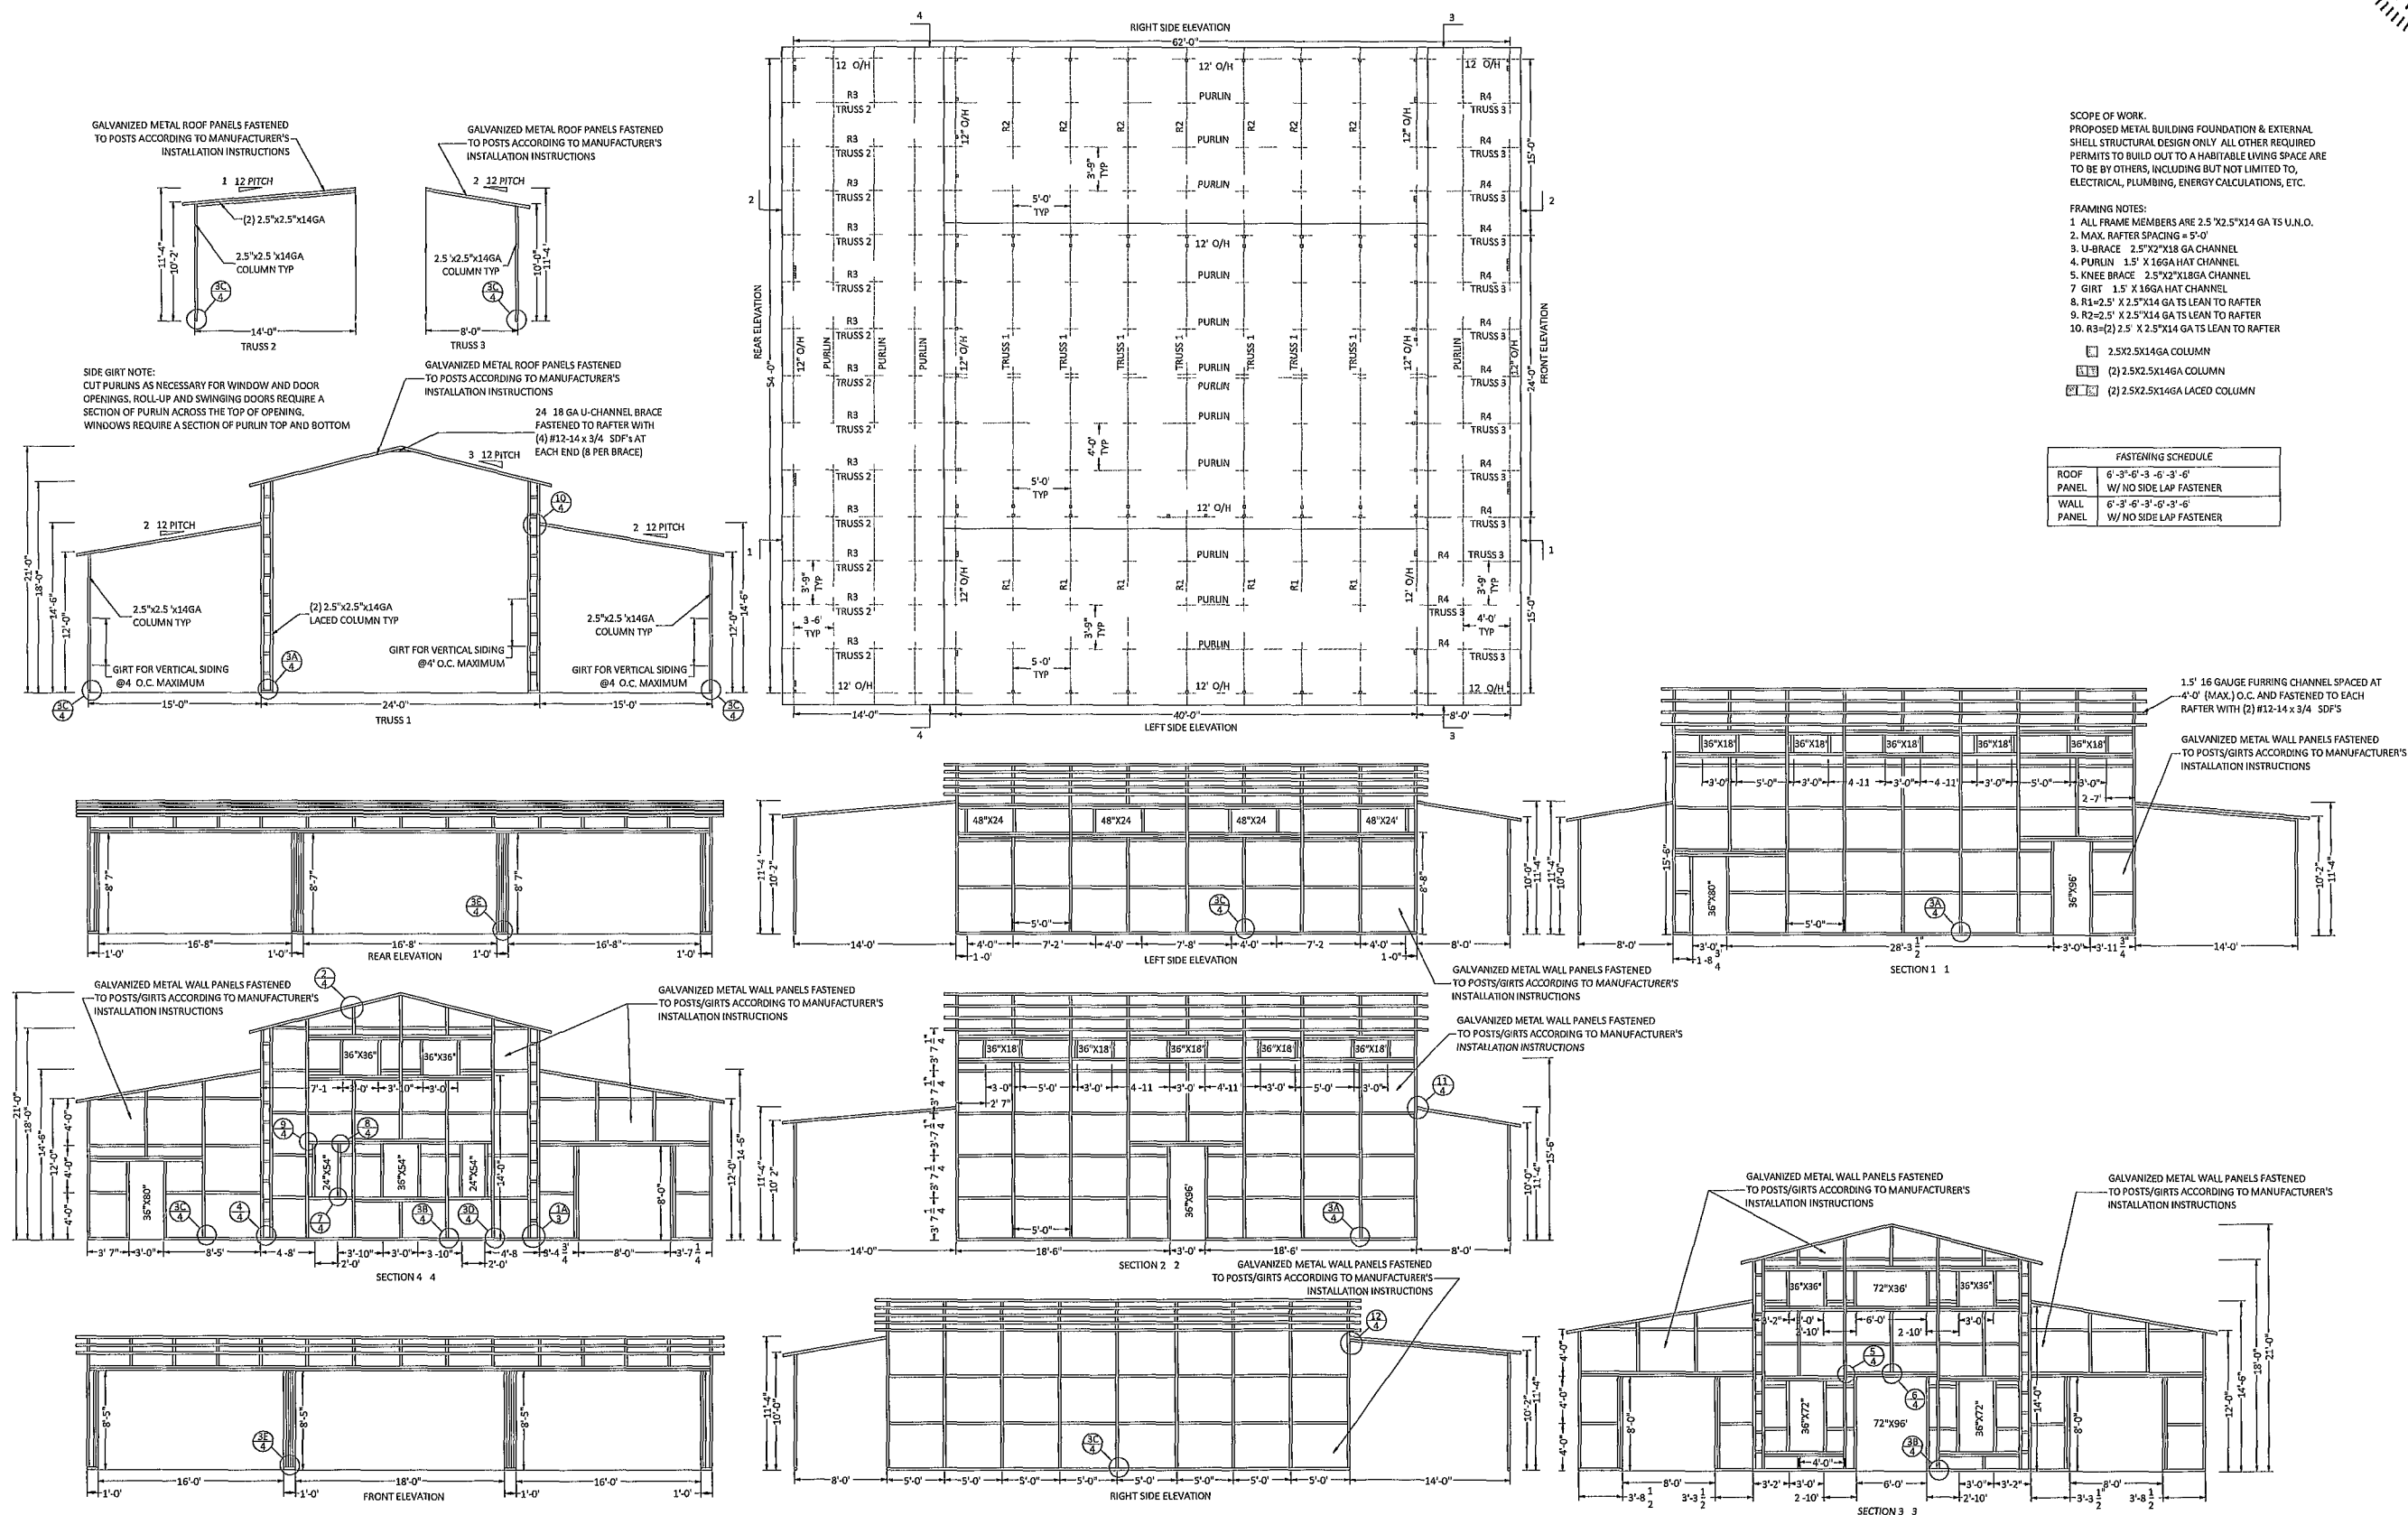

GENERAL NOTES

CONCRETE MONOLITHIC SLAB DESIGN IS BASED ON A MINIMUM SOIL BEARING CAPACITY OF 2500 PSF

CONCRETE


- 1 CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS
- 2 ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE
- 3 CONCRETE SLAB FOR GARAGES/CARPORTS (PARKING OF AUTOMOBILES OR OTHER VEHICLES) SHALL BE SLOPED TOWARD THE DRAIN LINE OR THE MAIN VEHICLE ENTRY DOORWAY WITH A MINIMUM PITCH OF 1/4 INCH PER FOOT TO ENSURE PROPER DRAINAGE
- 4 WHERE CONCRETE SPECIFICATIONS ARE REQUIRED, BY ONE OR MORE REGULATORY AGENCY, THE FOLLOWING SPECIFICATIONS ARE APPLICABLE
 - a CONCRETE SHALL CONFORM TO ASTM C94 FOR THE FOLLOWING COMPONENTS
 - i PORTLAND CEMENT TYPE 1 - ASTM C 150
 - ii AGGREGATES - LARGE AGGREGATE 3/4 MAX - ASTM C 33
 - iii AIR ENTRAINING +/- 1 % - ASTM C 260
 - iv WATER REDUCING AGENT ASTM C 494
 - v CLEAN POTABLE WATER
 - vi OTHER ADMIXTURES NOT PERMITTED
 - b CONCRETE SLUMP AT DISCHARGE CHUTE NOT LESS THAN 3" OR MORE THAN 5" WATER ADDED AFTER BATCHING IS NOT PERMITTED
 - c PREPARE & PLACE CONCRETE PER AMERICAN CONCRETE INSTITUTE MANUAL OF STANDARD PRACTICE, PART 1, 2, & 3 INCLUDING HOT WEATHER RECOMMENDATIONS
 - d MOIST CURE OR POLYETHYLENE CURING PERMITTED
 - e PRIOR TO PLACING CONCRETE, TREAT THE ENTIRE SUBSURFACE AREA FOR TERMITES IN COMPLIANCE WITH THE BUILDING CODE (FOR RISK CATEGORY II, III, & IV STRUCTURES ONLY)
 - f CONCRETE SLAB SHALL BE PLACED OVER A MIN 6 MIL POLYETHYLENE VAPOR BARRIER (SLAB ONLY)
- 5 CONTROL JOINTS SHALL BE PROVIDED AT EVERY 12' O C OR 18' O C FOR 4" THICK OR 6" THICK CONCRETE SLAB RESPECTIVELY

REINFORCING STEEL

- 1 THE REINFORCING STEEL SHALL BE ASTM A615 GRADE 60 THE SLAB REINFORCEMENT SHALL BE WELDED WIRE FABRIC MEETING ASTM A185 OR FIBERGLASS FIBER REINFORCEMENT
- 2 REINFORCEMENT MAY BE BENT IN THE FIELD OR SHOP AS LONG AS
 - a IT IS BENT COLD,
 - b REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT,
 - c THE DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS NOT LESS THAN SIX-BAR DIAMETERS
- 3 FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE PER ACI 318 3 INCHES WHERE THE CONCRETE IS POURED AGAINST AND TEMPORARY IN CONTACT WITH THE EARTH OR UNPROTECTED FROM THE EARTH OR WEATHER, OTHERWISE 1-1/2 INCHES



FROST PROTECTION

- 1 FOUNDATION SHALL BE PROTECTED AGAINST FROST USING RIGID FOAM INSULATION (EPS OR EQUIVALENT) FOR NO FROST PROTECTION OPTION, COORDINATE WITH LOCAL BUILDING CODE AND/OR BUILDING OFFICIAL REGARDING REQUIRED FOOTING DEPTH BASED ON FROST LINE DEPTH

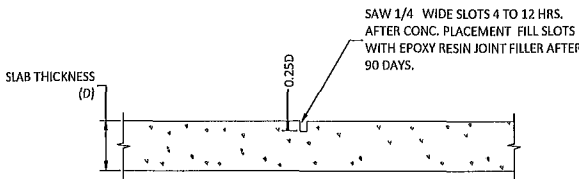


JOINTS TO BE SPACED 20 (IN FEET) MINIMUM BUT NO MORE THAN 2.5D (IN FEET) O.C.


CONTROL JOINT DETAIL
SCALE: NTS

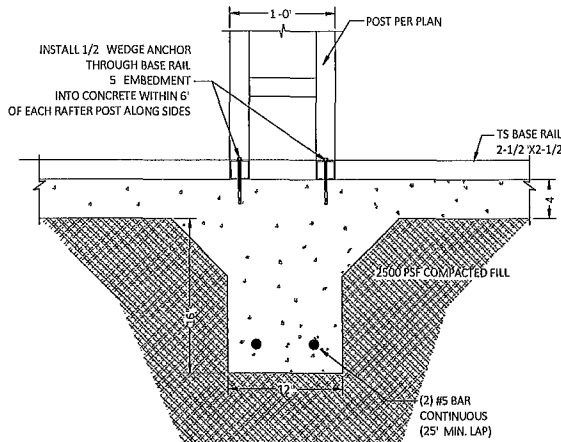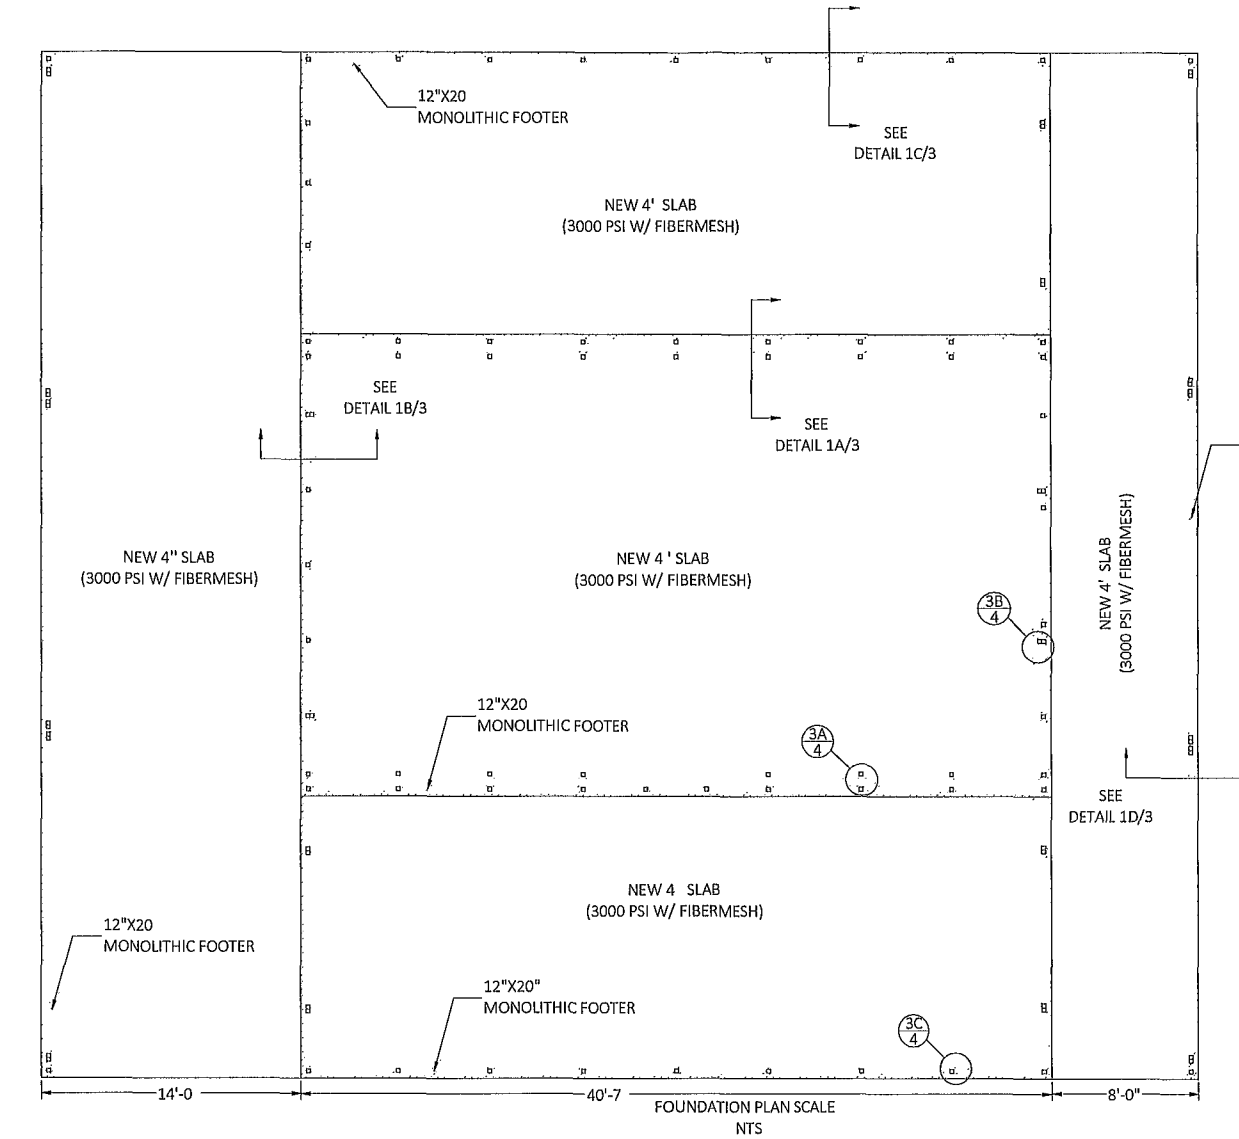


1A 12"x20" MONO. FOOTER BASE RAIL ANCHORAGE
SCALE: NTS

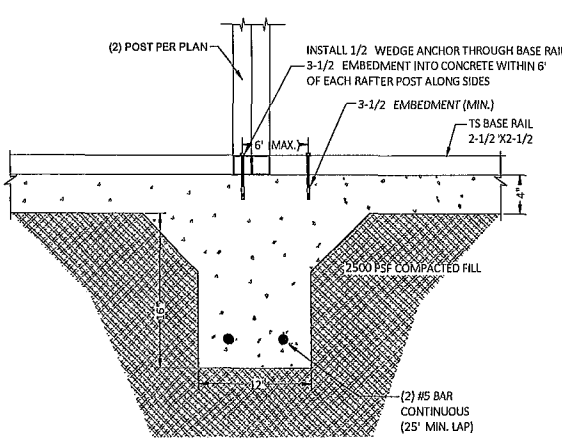


1B 12"x20" MONO. FOOTER BASE RAIL ANCHORAGE
SCALE: NTS

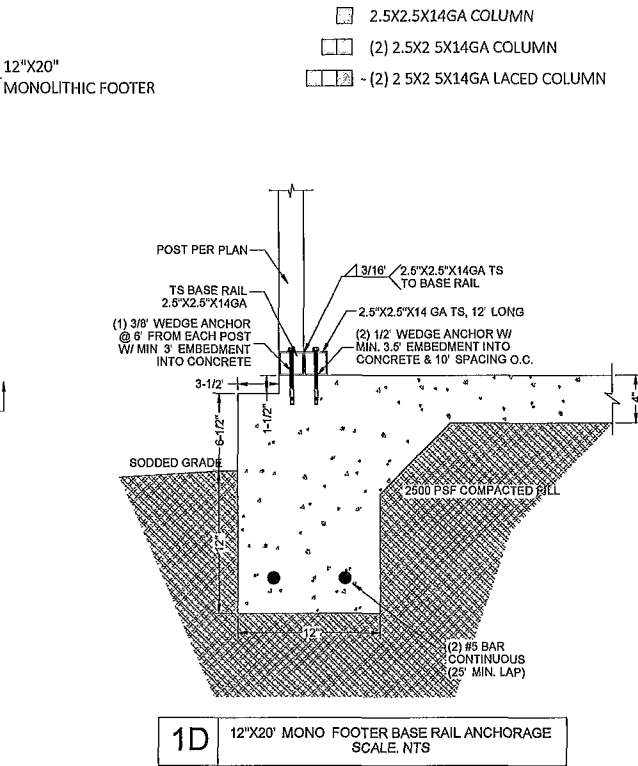

1D 12"x20" MONO. FOOTER BASE RAIL ANCHORAGE
SCALE: NTS

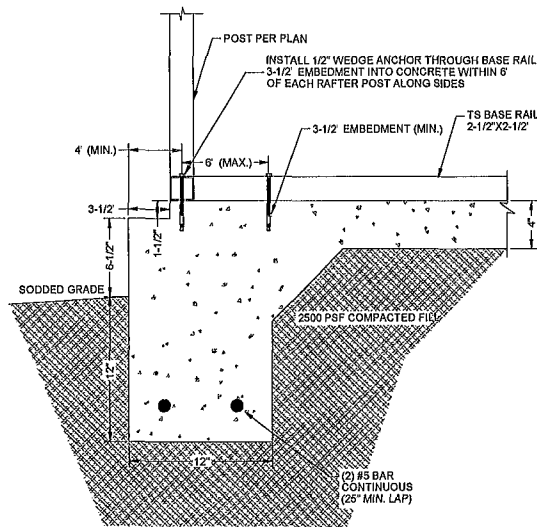

1C 12"x20" MONO. FOOTER BASE RAIL ANCHORAGE
SCALE: NTS

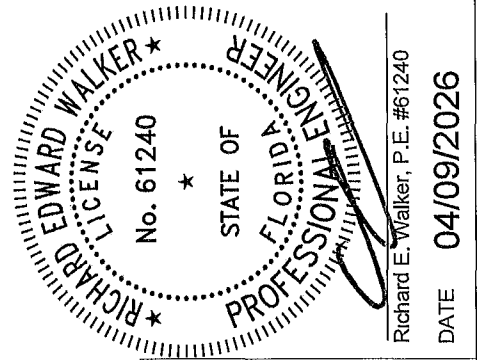

Richard E. Walker, P.E. #61240
DATE 04/09/2026



FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com

CA CERT. #30782

PROJECT NO. 2607835


CONTRACTOR:

TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056


PROJECT ADDRESS:

WILHELM
348 SW TALL PINE CT
LAKE CITY, FL 32024


DESIGN DATE	04/10/2026	
REVISION 1	DATE	
REVISION 2	DATE	SHEET
DRAWN BY	TCP	
SCALE	NTS	03

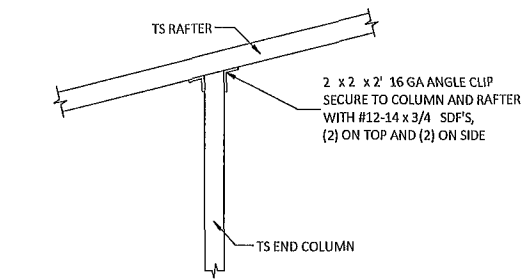


2 END POST/RAFTER CONNECTION DETAIL SCALE: NTS

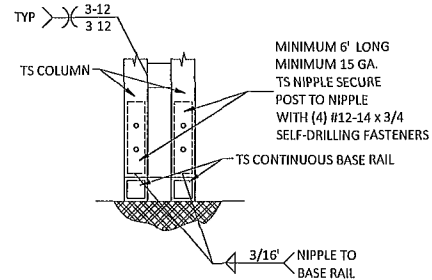


3A RAFTER POST/BASE RAIL CONNECTION DETAIL SCALE: NTS

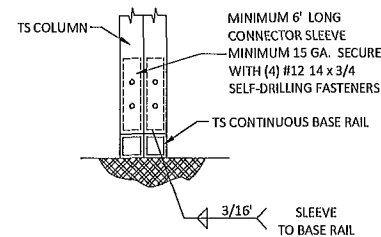



3B RAFTER POST/BASE RAIL CONNECTION DETAIL SCALE: NTS

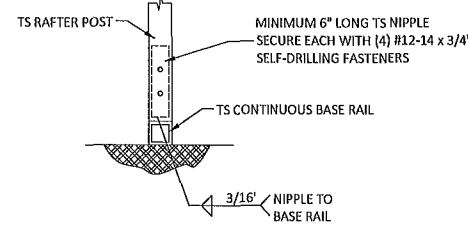



3C RAFTER POST/BASE RAIL CONNECTION DETAIL SCALE: NTS

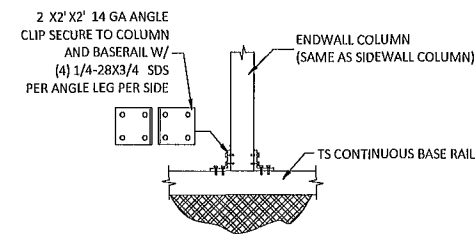


3D ENDWALL COLUMN/BASE RAIL CONNECTION DETAIL SCALE: NTS

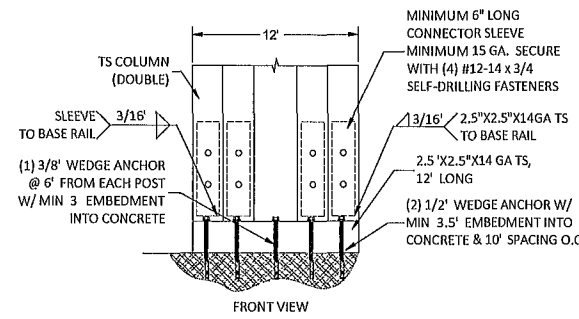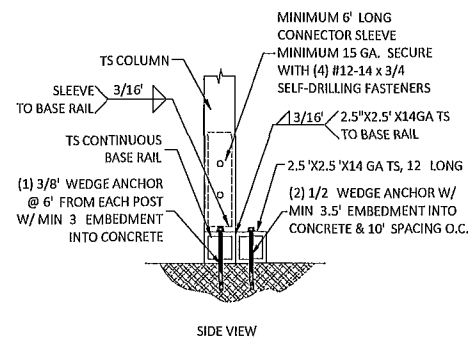


3E POST/BASE RAIL CONNECTION DETAIL SCALE: NTS

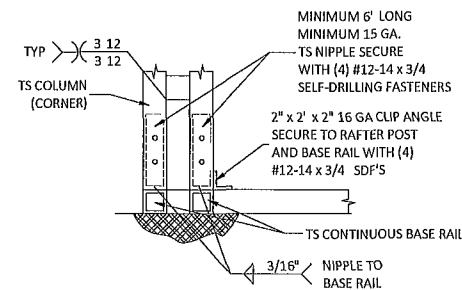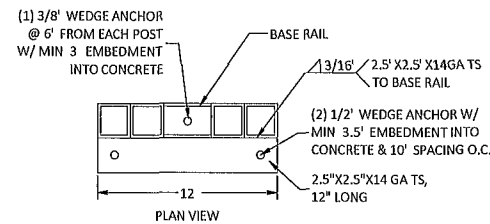


4 END POST/BASE RAIL CONNECTION DETAIL SCALE: NTS

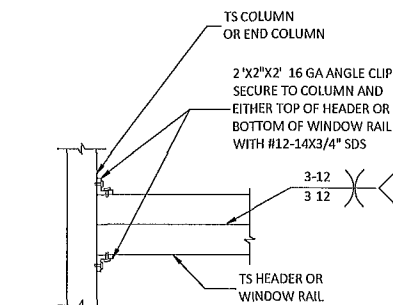


5 DOUBLE HEADER TO COLUMN CONNECTION DETAIL SCALE: NTS

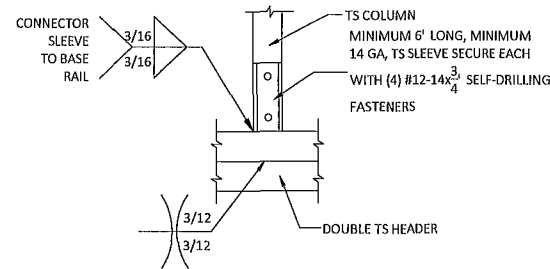


6 COLUMN/DOUBLE HEADER CONNECTION DETAIL SCALE: NTS

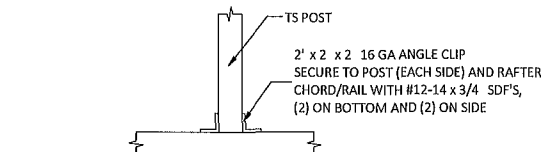


7 POST TO NON-STRUCTURAL HEADER, BASE, RAIL OR WINDOW RAIL CONNECTION DETAIL SCALE: NTS

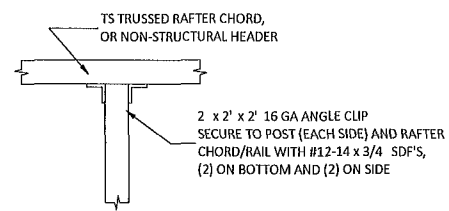


8 POST TO NON-STRUCTURAL HEADER, BASE, RAIL OR WINDOW RAIL CONNECTION DETAIL SCALE: NTS

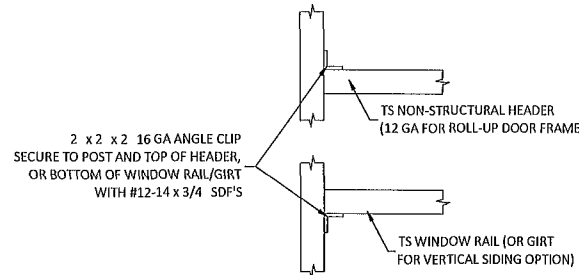


9 NON-STRUCTURAL HEADER OR WINDOW RAIL TO POST CONNECTION DETAIL SCALE: NTS

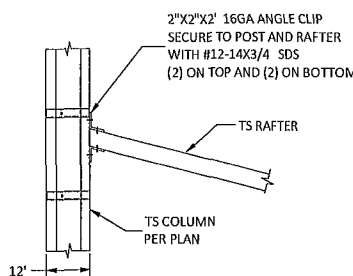


10 LEAN TO RAFTER/COLUMN CONNECTION DETAIL SCALE: NTS

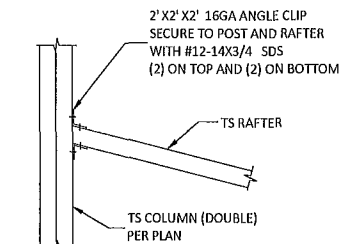


11 LEAN TO RAFTER/COLUMN CONNECTION DETAIL SCALE: NTS

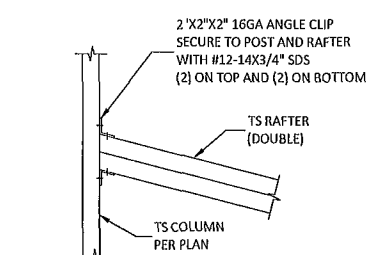


12 LEAN TO RAFTER/COLUMN CONNECTION DETAIL SCALE: NTS

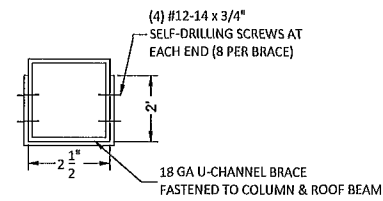

12 LEAN TO RAFTER/COLUMN CONNECTION DETAIL SCALE: NTS

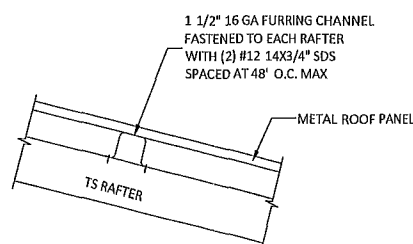

12 LEAN TO RAFTER/COLUMN CONNECTION DETAIL SCALE: NTS

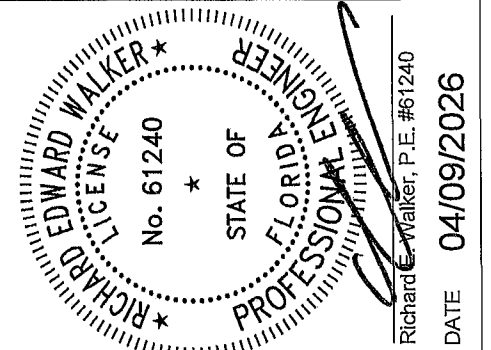

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

PROJECT ADDRESS
WILHELM
348 SW TALL PINE CT
LAKE CITY, FL 32024

DESIGN DATE	04/10/2026	SHEET 04
REVISION 1	DATE	
REVISION 2	DATE	
DRAWN BY	TCP	
SCALE	NTS	

PROJECT NO. 2607835

CA CERT. #30782

DATE 04/09/2026