


ITW Building Components Group, Inc.

1950 Marley Drive Haines City, FL 33844
 Florida Engineering Certificate of Authorization Number 0 278
 Florida Certificate of Product Approval # FL1999
 Page 1 of 1 Document ID:1V8X215-Z0414143604

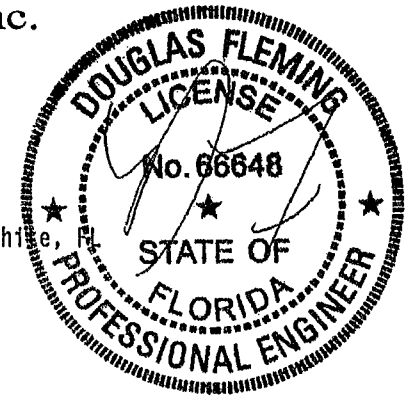

Truss Fabricator W.B. Howland
 Job Identification 8740-/FT. WHITE ASSISTED LIV FA /S&S CONSTRUCTION -- Ft. White, FL
 Truss Count 29
 Model Code Florida Building Code 2010
 Truss Criteria FBC2010Com/TPI-2007(STD)
 Engineering Software Alpine Software, Version 13.02.
 Structural Engineer of Record The identity of the structural EOR did not exist as of the seal date per section 61G15-31.003(5a) of the FAC
 Address
 Minimum Design Loads Roof - 40.0 PSF @ 1.25 Duration
 Floor - N/A
 Wind - 130 MPH ASCE 7-10 -Closed

08/14/2014

Douglas Fleming
 -Truss Design Engineer-


1950 Marley Drive
 Haines City, FL 33844

Notes

1. Determination as to the suitability of these truss components for the structure is the responsibility of the building designer/engineer of record, as defined in ANSI/TPI 1
2. The drawing date shown on this index sheet must match the date shown on the individual truss component drawing.
3. As shown on attached drawings; the drawing number is preceded by: HCUSR215

Details: BRCLBSUB-14015EC1-GBLLETIN-PB16010-

#	Ref	Description	Drawing#	Date
1	18382--A01		14226118	08/14/14
2	18383--A02		14226108	08/14/14
3	18384--A03		14226109	08/14/14
4	18385--A04		14226110	08/14/14
5	18386--A05		14226111	08/14/14
6	18387--A06		14226112	08/14/14
7	18388--A07		14226113	08/14/14
8	18389--A08		14226114	08/14/14
9	18390--A09		14226115	08/14/14
10	18391--A10		14226116	08/14/14
11	18392--A11		14226117	08/14/14
12	18393--A12		14226090	08/14/14
13	18394--A13		14226091	08/14/14
14	18395--A14		14226092	08/14/14
15	18396--A15		14226093	08/14/14
16	18397--A16		14226094	08/14/14
17	18398--A17		14226095	08/14/14
18	18399--B01		14226096	08/14/14
19	18400--B02		14226097	08/14/14
20	18401--PB1		14226098	08/14/14
21	18402--PB2		14226099	08/14/14
22	18403--J01		14226100	08/14/14
23	18404--J02		14226101	08/14/14
24	18405--J03		14226102	08/14/14
25	18406--J04		14226103	08/14/14
26	18407--J05		14226104	08/14/14
27	18408--J08		14226105	08/14/14
28	18409--J09		14226106	08/14/14
29	18410--J10		14226107	08/14/14

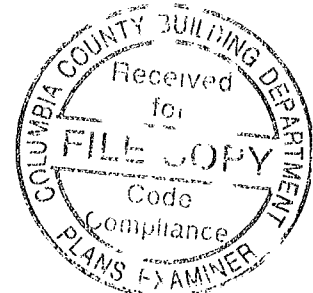

Top chord 2x6 SP M-31
 Bot chord 2x6 SP M-31
 Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50


The overall height of this truss excluding overhang is 5-1-3

MFRS loads based on trusses located at least 7 50 ft from roof edge.

130 mph wind, 15 00 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 8 50 ft from roof edge, RISK CAT III OR IV, Exp C, wind TC DL=5 0 psf, wind BC DL=5.0 psf 6Cpi(+/-)-0 18

Wind loads and reactions based on MFRS with additional C&C member design
 In lieu of structural panels use purlins to brace all flat TC @ 24"

WARNING Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and untrained people to install trusses See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing

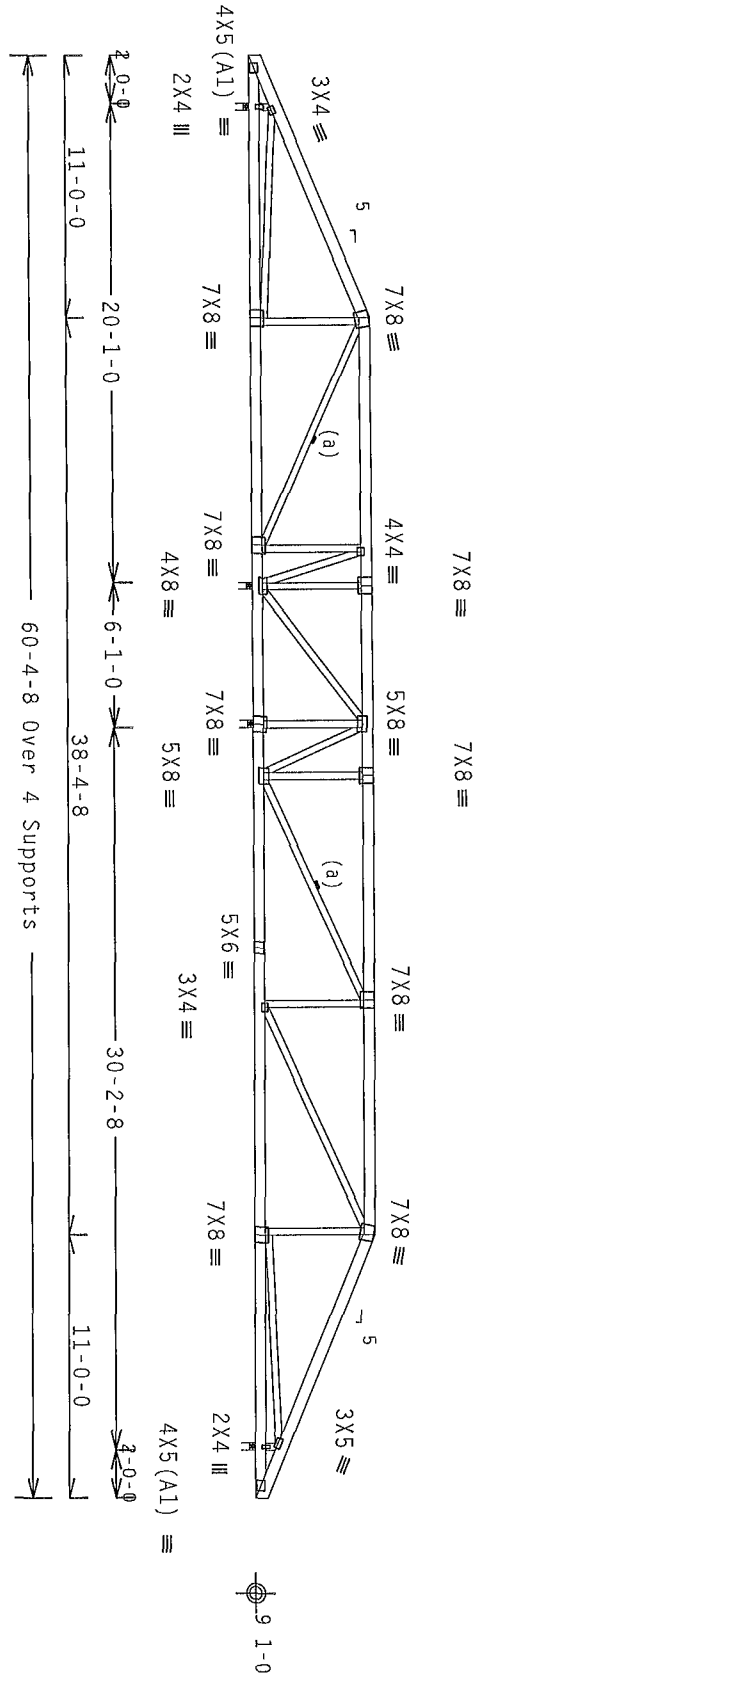

R=900 U=134 W=3.5" (1 5" min)
 R=123/-123
 R=1718 U=307 W=3 5" (1 5" min)
 R=1181 U=219 W=3.5" (1 5" min)
 R=1299 U=220 W=3 5" (1 5" min)

PLT TYP. Wave Design Crft: FBC2010COM/TPI-2007 (STD) FT/RT=20%(%) /10(0) 13.02.05 0809.13 QTY:2 FL/-/1/-/ R/- Scale = .125"/Ft.

ALPINE


TM Building Components Group Inc.
 Orlando FL, 32837
 FL COA #0278

****IMPORTANT**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS SHEET

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to follow the latest edition of BCSI (Building Components Safety Information by TPI and WTC) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or webs shall have bracing installed per BCSI sections 89 87 or 810 as applicable.

TM Building Components Group Inc. (TMBCG) shall not be responsible for any deviation from this design or any failure to build the truss in conformance with ANSI/TPI 1 or for handling, shipping, installing, or bracing of trusses. Apply plates to each face of truss and position as shown above and on the joint details unless noted otherwise. Refer to drawings 100A Z for standard plate positions. A seal on the drawing or cover page listing this drawing indicates acceptance of professional engineering responsibility solely for the design shown. The seal, title, and use of this design for any structure is the responsibility of the user. This design is not to be used for any other structure without the express written consent of TMBCG. TMBCG, 11111 W. 11th St, WTC, Miami, FL 33156. www.tmbcg.com



TC LL	20.0 PSF	REF	R215--	18383
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCSR215	14226108
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT.LD.	40.0 PSF	SEQN-	423228	
DUR.FAC.	1.25	FROM	CDM	
SPACING	24.0"	JREF-	1V8X215	Z04

Top chord 2x6 SP M-31
Bot chord 2x6 SP M-31
Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 5' 11-3"


MWFRS loads based on trusses located at least 7' 50" from roof edge.

130 mph wind, 15' 00" ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 8' 50" ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf GCPI (+/-)=0.18

Wind loads and reactions based on MWFRS with additional C&C member design

In lieu of structural panels use purlins to brace all flat TC @ 24" OC

WARNING: Furnish a copy of this DWG to the installation contractor. Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries. Do not permit inexperienced and untrained people to install trusses. See "WARNING" note below. BCSI recommends retaining a registered professional engineer for the design of temporary bracing.

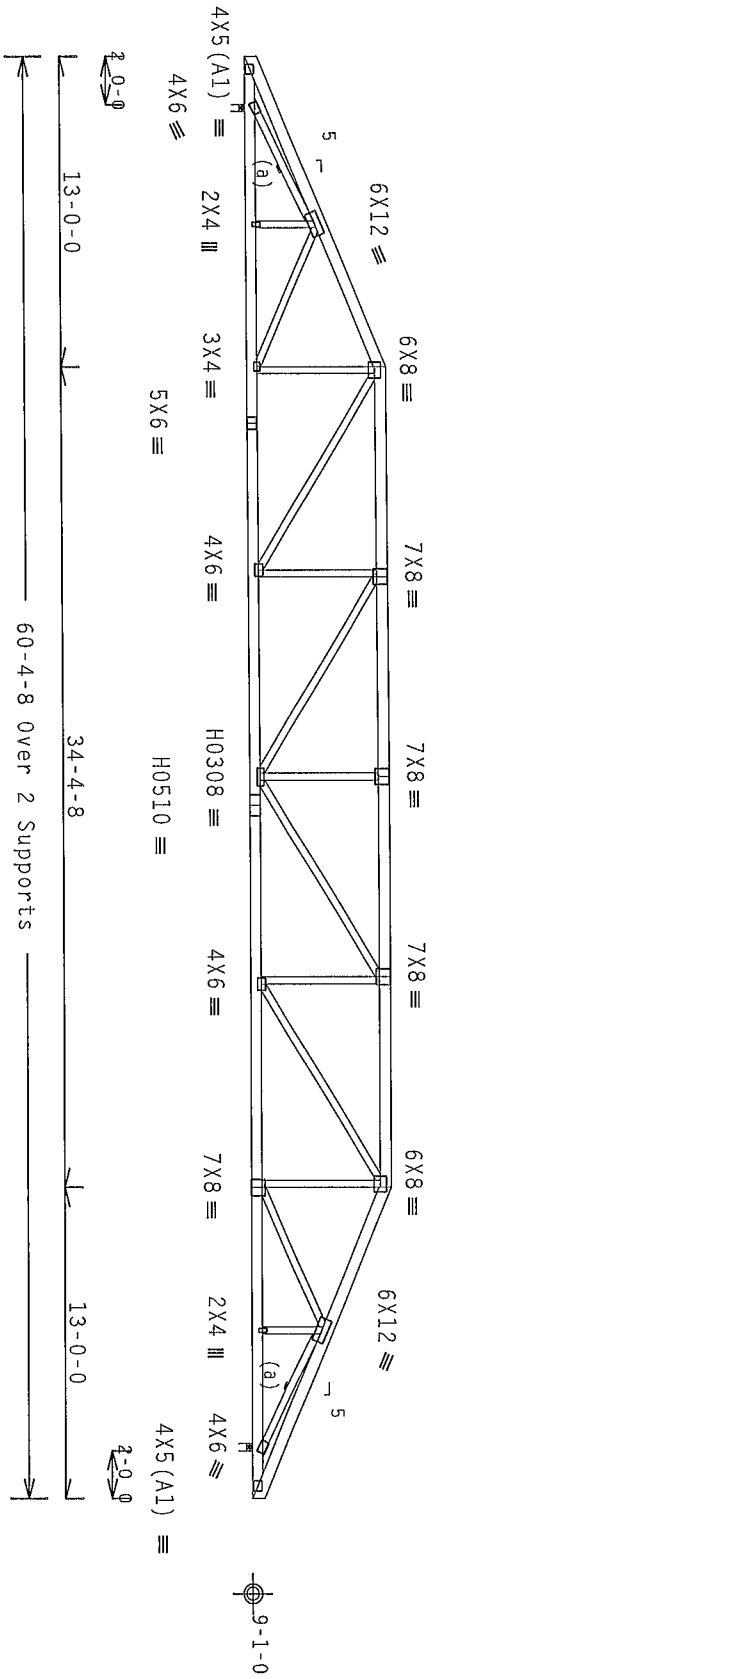

R=2467 U=438 W=3 5" (1 668" min.)
RL=146/ 146

Design Cr1t: FBC2010Com/TPI-2007 (STD)
FT/RT=20%(0%)/10(0)


PLT TYP. 20 Gauge HS, Wave

13.02.00

QTY: 2

FL/-/1/-/1/-/1/-

Scale = .125" / Ft.

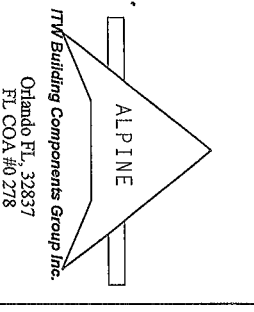


ITW Building Components Group Inc.
Orlando FL, 32837
FL COA #0278

****WARNING** READ AND FOLLOW ALL NOTES ON THIS SHEET!**
FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI (Building Component Safety Information) by TPI and MTC for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Trusses shall be braced from the top chord and bottom chord. Trusses shall have bracing installed per BCSI sections 991.01 or B10 as applicable.

ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any dev. action from this design. Any failure to build the truss in accordance with this design shall be the responsibility of the contractor. ITWBCG shall not be responsible for any failure to follow the design. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this design for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec 2. For more information see the general notes page. ITW BCG www.itwbcg.com TPI www.tpiinst.org MTC www.sciindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF R215-- 18384
TC DL	10.0 PSF	DATE 08/14/14
BC DL	10.0 PSF	DRW HCUR215 14226109
BC LL	0.0 PSF	HC-ENG GA/DF
TOT. LD.	40.0 PSF	SE0N- 423231
DUR. FAC.	1.25	FROM CDM
SPACING	24.0"	JREF- 1V8X215_Z04

Top chord 2x6 SP M-31
Bot chord 2x6 SP M-31
Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind


In lieu of structural panels use purlins to brace all flat TC @ 24" OC

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 6-9-3

MWFRS loads based on trusses located at least 15 00 ft from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements
130 mph wind, 15 00 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 8 50 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf GCpl(+/-)=0.18
Wind loads and reactions based on MWFRS with additional C&C member design
WARNING Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and untrained people to install trusses. See "WARNING" note below. BCSI recommends retaining a registered professional engineer for the design of temporary bracing

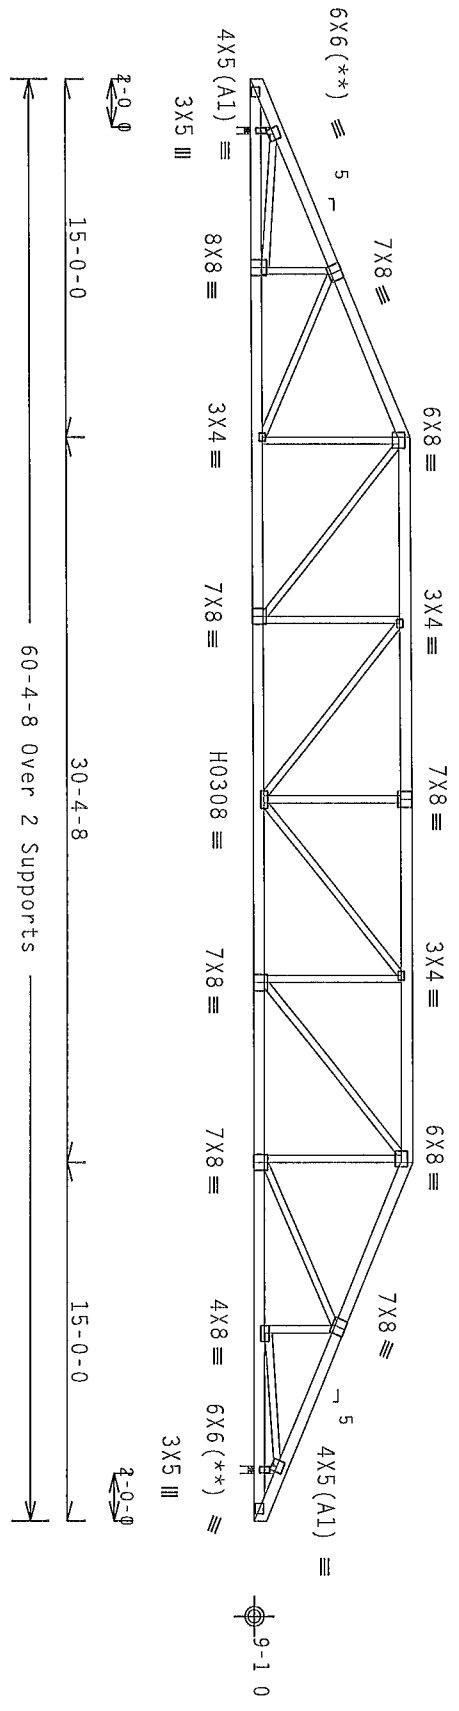

R=2467 U=53 W=3 5" (1 668" min)
RL=169/-169

R=2467 U=53 W=3 5" (1 668" min)


PLT TYP. 20 Gauge HS, Wave

Design Crit: FBC2010COM/TPI-2007 (STD)
FT/RT=20% (0%)/10(0)

13.02.08


QTY: 2 FL/-/1/-/1/-/1/-

Scale = .125"/Ft.



ITW Building Components Group Inc.
Orlando FL 32837
FL COA #0 278

WARNING READ AND FOLLOW ALL NOTES ON THIS SHEET!
FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
Trusses require extreme care in fabricating handling shipping installing and bracing Refer to and follow the latest edition of BCSI (Building Component Safety Information by TPI and WTA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections B9 B7 or B10 as applicable
ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design any failure to build the truss in conformance with ANSI/TPI 1 or for handling shipping installation or bracing of trusses. Apply plates to each face of truss and position as shown above and on the joint details unless noted otherwise. Refer to drawings, load table or standard plate positions. The responsibility of the Building Designer per ANSI/TPI 1 Sec 2 For more information see this job's general notes page. ITW BCG www.tbcbg.com TPI www.tpiinst.org WTA www.stcindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF R215--	18385
TC DL	10.0 PSF	DATE	08/14/14
BC DL	10.0 PSF	DRW HCUSR215	14226110
BC LL	0.0 PSF	HC-ENG GA/DF	
TOT. LD.	40.0 PSF	SEON-	423234
DUR. FAC.	1.25	FROM	CDM
SPACING	24.0"	JREF-	1V8X215_Z04

Top chord 2x6 SP M-31
Bot chord 2x6 SP M-31
Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

In lieu of structural panels use purlins to brace all flat TC @ 24" OC.

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 7-7-3


MWFRS loads based on trusses located at least 15 00 ft from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements

130 mph wind, 15.00 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17 00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf GCpl(+/-)-0 18

Wind loads and reactions based on MWFRS with additional C&C member design

WARNING Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and untrained people to install trusses See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing

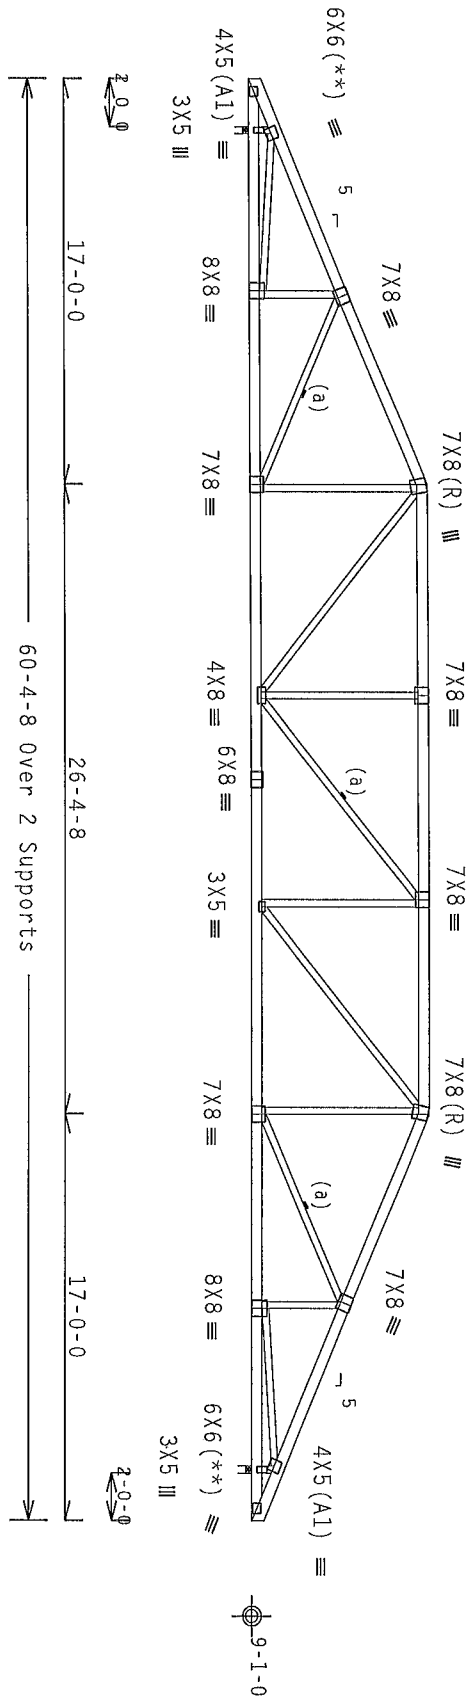

R=2467 U=51 W=3 5" (1.668" min)
RL=191/-191

R=2467 U=51 W=3 5" (1.668" min)

PLT TYP. Wave

Design Crit: FBC2010Com/TPI-2007(STD)
FT/RT=20%(0%)/10(0)

13.02.2013

QTY: 2

FL/-/1/-/1/-/1/-


Scale = .125"/ft.

ITW Building Components Group Inc.
Orlando FL, 32837
FL COA #0 278

****WARNING** READ AND FOLLOW ALL NOTES ON THIS SHEET**
****WARNING** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI (Building Component Safety) Performance. Do not use temporary bracing per BCSI practices prior to performing these functions. Insulators shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of web shall have bracing installed per BCSI sections 89, 87 or 810 as applicable.

ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design or any failure to build the truss in conformance with ANSI/TPI 1 or for handling, shipping, installation, bracing of trusses. Apply plates to each face of truss and position as shown above and on the joint details unless noted otherwise. Refer to drawings 180A, Z for standard plate positions. A seal on the drawing or cover page listing this drawing indicates acceptance or professional engineering details of the design. The use of this design for any structure is the responsibility of the building designer. The use of this design for any structure is the responsibility of the building designer. TPI www.tpinet.org NCA www.stcindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF	R215-- 18386
TC DL	10.0 PSF	DATE	08/14/14
BC DL	10.0 PSF	DRW	HCUR215 14226111
BC LL	0.0 PSF	HC-ENG	GA/DF
TOT. LD.	40.0 PSF	SEQN-	423237
DUR. FAC.	1.25	FROM	CDM
SPACING	24.0"	JREF-	1V8X215_Z04

Top chord 2x6 SP M-31
 Bot chord 2x6 SP M-31
 Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

In lieu of structural panels use purlins to brace all flat TC @ 24" OC

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 8-5-3


MWFRS loads based on trusses located at least 15 00 ft. from roof edge.

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements

130 mph wind, 15 00 ft mean hgt, ASCE 7 10, CLOSED bldg, not located within 17 00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf GCpl(+/-)=0.18



Wind loads and reactions based on MWFRS with additional C&C member design

WARNING Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and un instructed people to install trusses See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing.

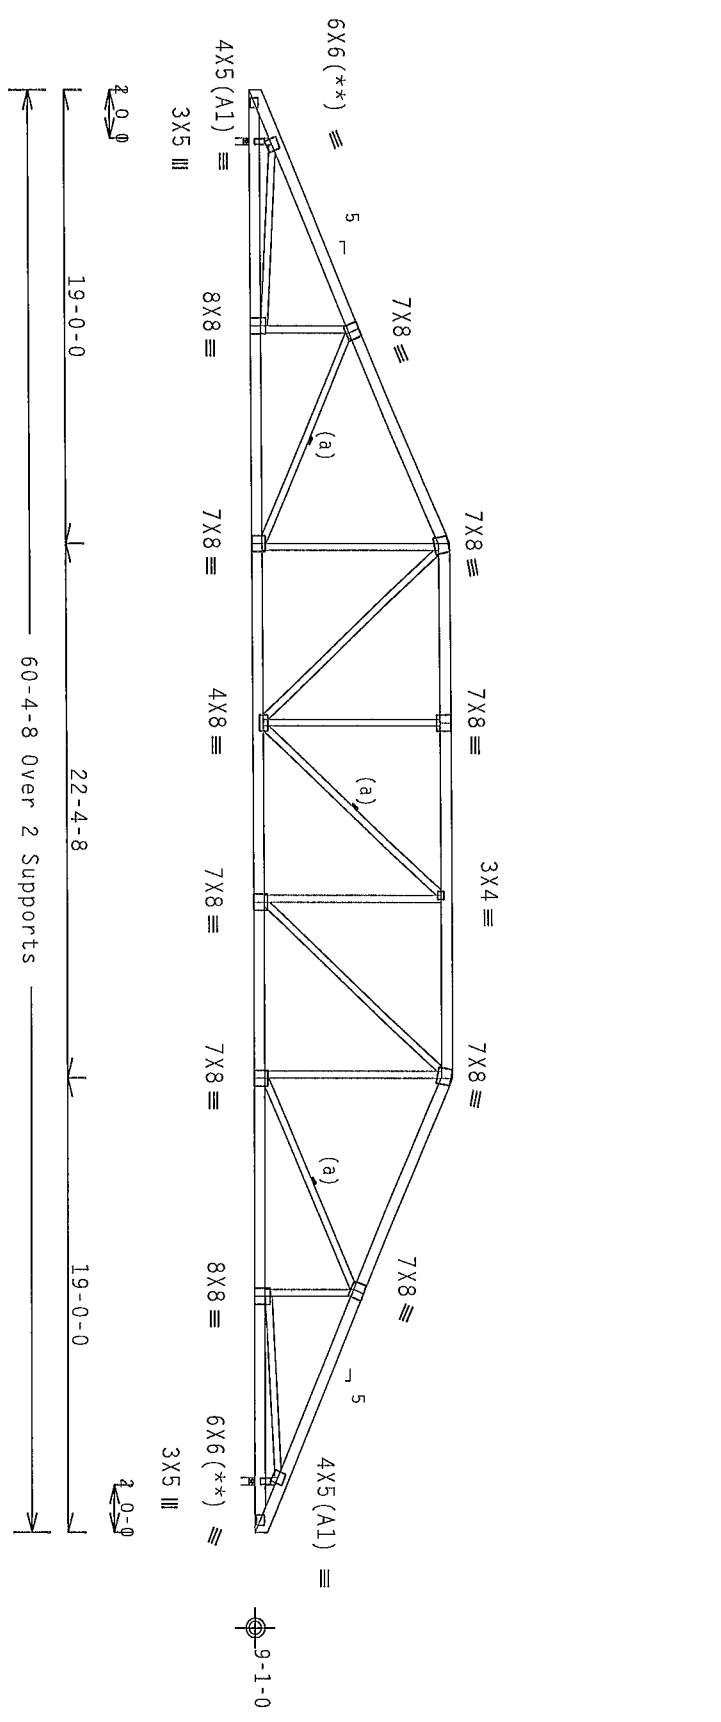

PLT TYP. Wave Design Crit: FBC2010Com/TPI-2007(STD) FT/RT=20%(0%)/10(0) 13.02.09 13 QTY:2 FL/-/1/-/1/-/1/- Scale =.125"/Ft.

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS SHEET
 FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI Building Component Safety Information by TPI and WCA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections 83, 87 or 810 as applicable.
 ITW Building Components Group Inc (ITWBCG) shall not be responsible for any deviation from this design or any failure of trusses. Apply plates to each face of truss and position as shown above and on the joint details unless noted otherwise. Refer to drawings 1506.2 for standard plate positions. A seal on the drawing or cover page listing this drawing indicates acceptance of professional engineering design. This drawing is the property of ITW Building Components Group Inc. It is to be used only for the structure it is designed for. The responsibility of the Building Designer per ANSI/TPI 1 Sec 2 For more information see the general notes page. ITW BCG www.itwbcg.com TPI www.tpinet.org WCA www.sciindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF R215-- 18387
TC DL	10.0 PSF	DATE 08/14/14
BC DL	10.0 PSF	DRW HCURS215 14226112
BC LL	0.0 PSF	HC-ENG GA/DF
TOT. LD.	40.0 PSF	SEON- 423240
DUR. FAC.	1.25	FROM CDM
SPACING	24.0"	JREF- 1V8X215_Z04

Top chord 2x6 SP M 31
 Bot chord 2x6 SP M 31
 Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

In lieu of structural panels use purlins to brace all flat TC @ 24" OC

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50.

The overall height of this truss excluding overhang is 9-3-3


MWFRS loads based on trusses located at least 15 00 ft from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements.

130 mph wind, 15 00 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17.00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5 0 psf. GCpl(+/-)=0 18

Wind loads and reactions based on MWFRS with additional C&C member design

WARNING Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and untrained people to install trusses See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing

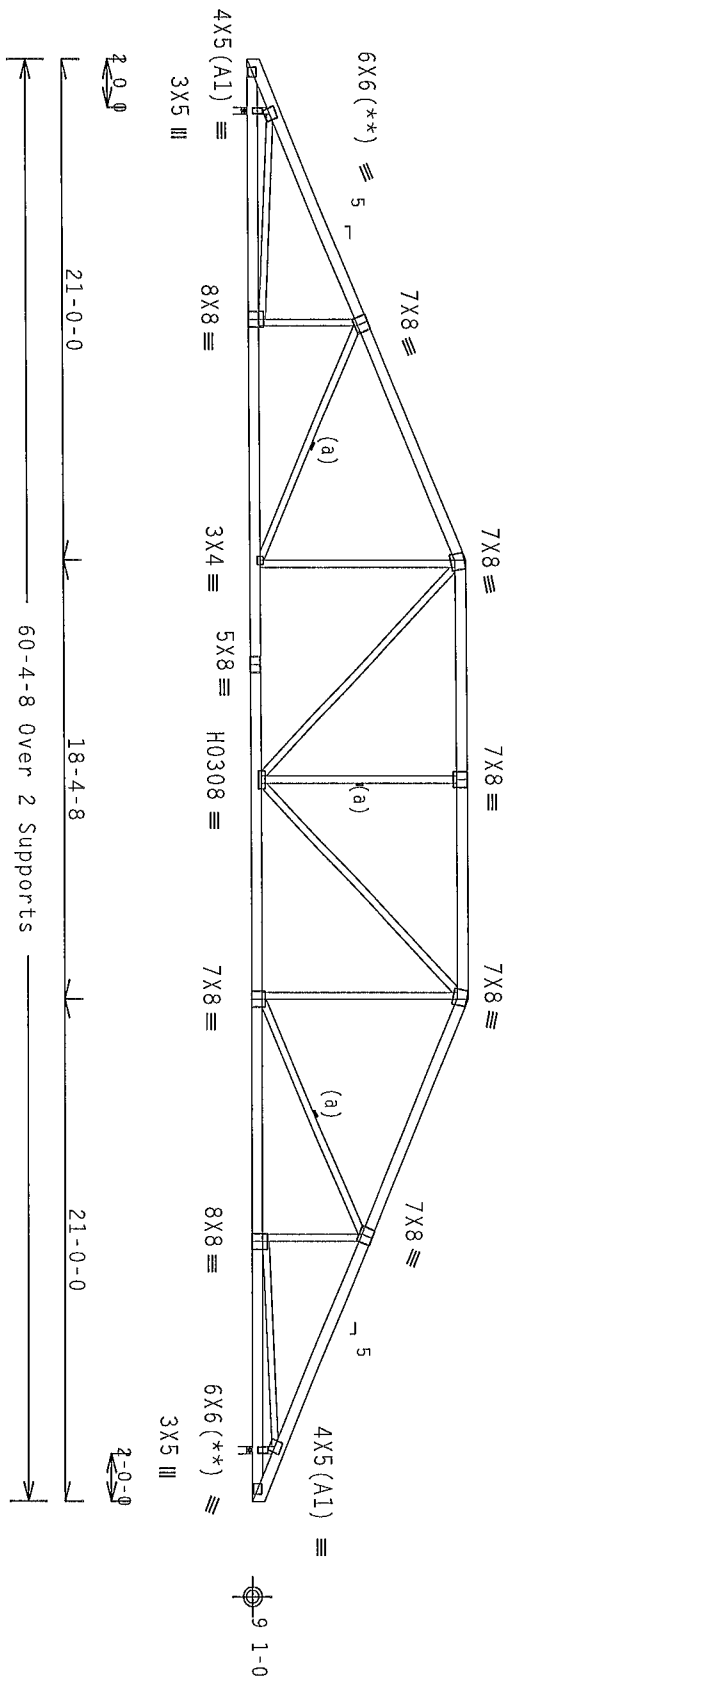


PLT TYP. 20 Gauge HS, Wave

Design Crit: FBC2010Com/TPI-2007 (STD)
 FT/RT=20%(0%)/10(0)


13.02.09

QTY:2 FL/-/1/-/1/-/1/-

Scale = .125"/Ft.



****WARNING**** READ AND FOLLOW ALL NOTES ON THIS SHEET!
 FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
****IMPORTANT**** Trusses require extreme care in fabricating handling shipping installing and bracing Refer to follow the latest edition of BCSI (Building Component Safety Information by TPI and WTA) for safety practices prior to performing these functions Installers shall provide temporary bracing per BCSI unless noted otherwise Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling Locations shown for permanent lateral restraint or we shall have Bracing installed per BCSI sections 83 87 or 810 as applicable
 ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from the design any failure of trusses Apply plates to each brace of truss and position as shown above and on the joint
 Detailing or changes noted shall be indicated on drawings and stamped with position and initials on the drawing or notes provided with this drawing The suitability and use of this design for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec 2 For more information see This Job's general notes page ITW BCG www.tbcbg.com TPI www.tpiast.org WTA www.steelindustry.com ICC www.iccsafe.org

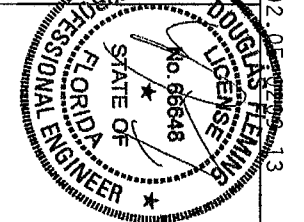

TC LL	20.0 PSF	REF	R215--	18388
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCSR215	14226113
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEON-	423243	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	DREF-	1V8X215_Z04	

Top chord 2x6 SP M-31
Bot chord 2x6 SP M-31
Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member.

In lieu of structural panels use purlins to brace all flat TC @ 24" OC

Deflection meets L/240 Tive and L/180 total Load Creep increase factor for dead load is 1.50.

The overall height of this truss excluding overhang is 10-1-3


MWFRS loads based on trusses located at least 15.00 ft from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements.

130 mph wind, 15 00 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17 00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf GCPI(+/-)=0 18

Wind loads and reactions based on MWFRS with additional C&C member design

WARNING: Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and un instructed people to install trusses See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing

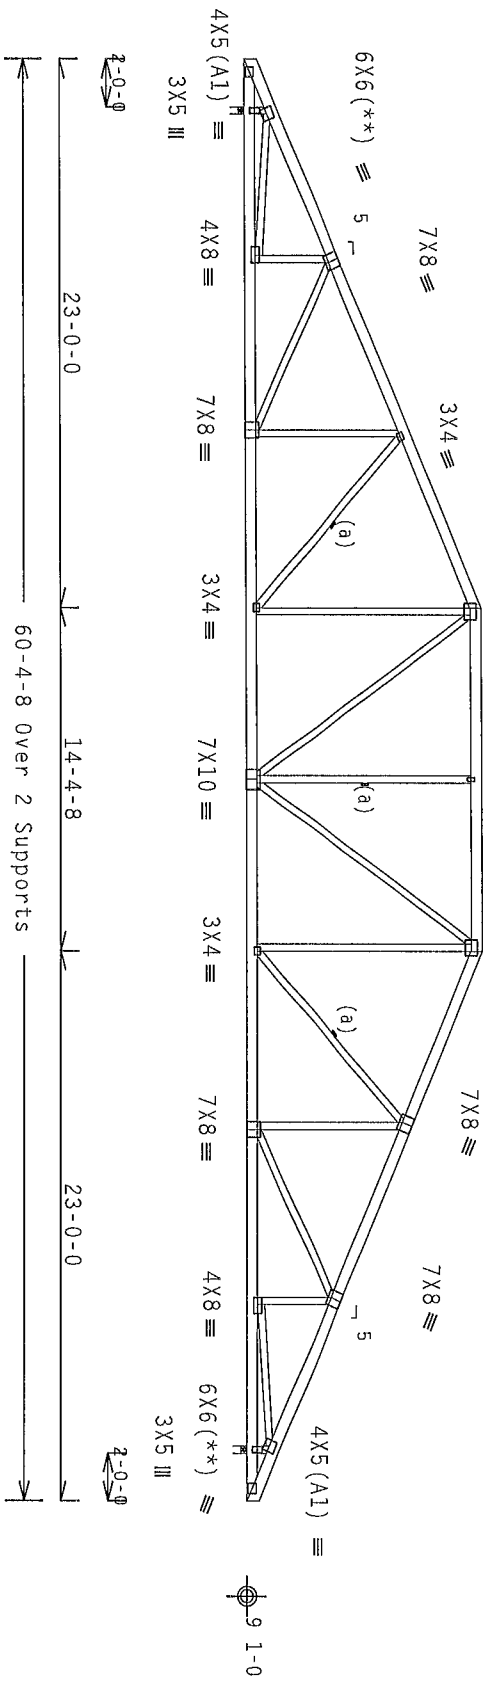


PLT TYP. Wave

Design Crit: FBC2010Com/TPI-2007 (STD)
FT/RT=20% (0%) /10(0)


13.02.00

QTY: 2 FL/-/1/-/1/-/1/-

Scale = .125"/Ft.



****IMPORTANT**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
Trusses require extreme care in fabricating handling shipping installing and bracing Refer to any follow the latest edition of BCSI (Building Component Safety Information by TPI and WTA) for safety practices prior to performing these functions Installers shall provide temporary bracing per BCSI unless noted otherwise Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections 89 97 or 910 as applicable
ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design any failure to build the truss in conformance with ANSI/TPI 1 or for handling shipping installation or details unless noted otherwise Refer to drawings J604 2 for standard plate positions A seal on this drawing or cover page listing this drawing Indicates acceptance of professional engineering the responsibility of the Building Designer per ANSI/TPI 1 Sec 2 For more information see the general notes page ITW BCG www fbcbg com TPI www tpiinst org WTA www sbctindustry com ICC www iccsafe org



TC LL	20.0 PSF	REF	R215--	18389
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCSR215	14226114
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEON-	423246	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	JREF-	1V8X215_204	

Top chord 2x6 SP M-31
Bot chord 2x6 SP M-31
Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

In lieu of structural panels use purlins to brace all flat TC @ 24" OC

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 10 11-3


MWFRS loads based on trusses located at least 15 00 ft from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements

130 mph wind, 15.00 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17 00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf GCPI (+/-)=0 18

Wind loads and reactions based on MWFRS with additional C&C member design

WARNING Furnish a copy of this DWG to the installation contractor. Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries. Do not permit inexperienced and untrained people to install trusses. See "WARNING" note below. BCSI recommends retaining a registered professional engineer for the design of temporary bracing

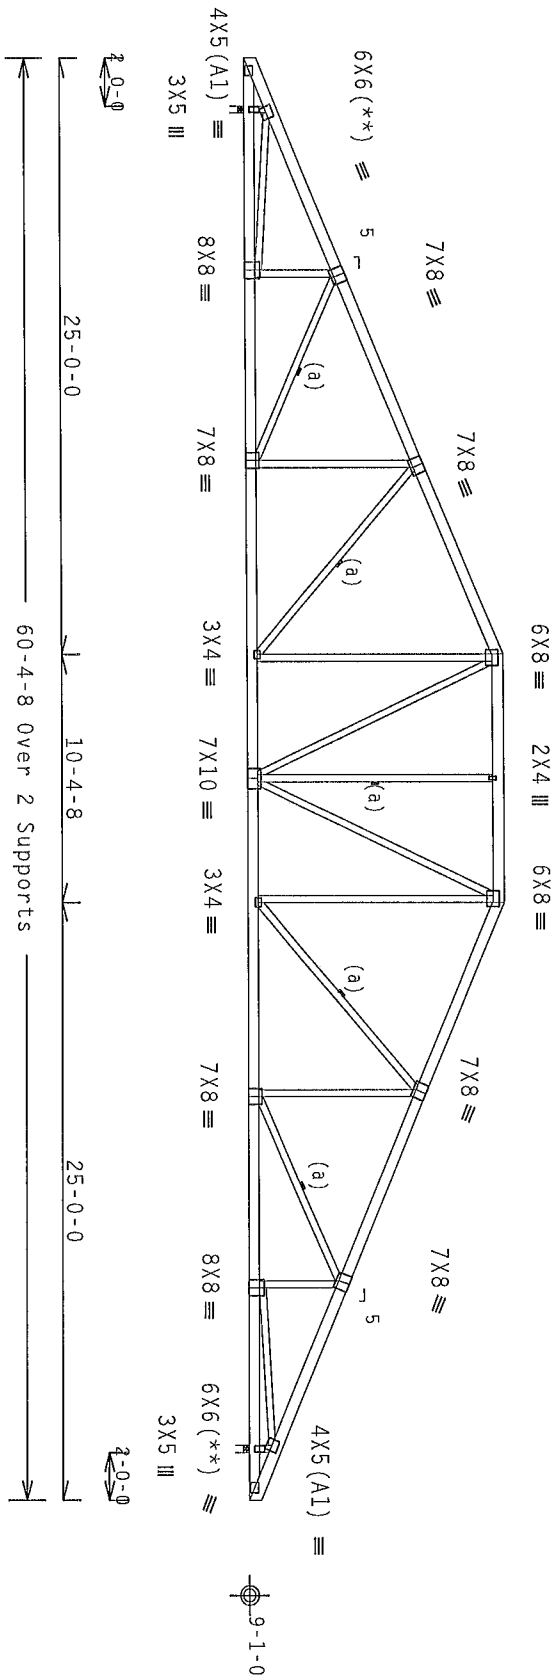

R=2467 U=45 W=3 5" (1.668" min)
RL=282/-282

Design Crit: FBC2010Com/TPI-2007(STD)
FT/RT=20%(0%)/10(0)

PLT TYP. Wave

13.02

QTY:2

FL/-/1/-/1/-/1/-

Scale = .125"/Ft.

ALPINE


ITW Building Components Group Inc.
Orlando FL 32837
FL COA #0 278

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS SHEET!
****IMPORTANT**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS

Trusses require extreme care in fabricating handling shipping installing and bracing. Refer to the latest edition of BCSI (Building Component Safety Information by TPI and WCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections 83 B7 or 810 as applicable.

ITW Building Components Group Inc. (ITWBCGI) shall not be responsible for any deviation from this design or any failure to build the truss in conformance with ANSI/TPI 1 or for handling shipping installation or bracing of trusses. Apply plates to each face of truss and position as shown above and on the detail.

Details unless noted otherwise refer to drawings. Load & for standard plate positions. Responsibility of the Building Designer per ANSI/TPI 1 Sec 2. For more information see this job's general notes page. ITW BCG www.itwbog.com TPI www.tpinst.org WCA www.steelindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF	R215--	18390
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCSR215	14226115
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEON-	423249	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	DEFF-	1V8X215_Z04	

Top chord 2x6 SP M-31
 Bot chord 2x6 SP M-31
 Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind

(a) Continuous lateral restraint equally spaced on member

In lieu of structural panels use purlins to brace all flat TC @ 24" OC

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50.

The overall height of this truss excluding overhang is 11-9-3.


MMFRS loads based on trusses located at least 15.23 ft. from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements

130 mph wind, 15.23 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17.00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf GCpl(+/-)=0.18


Wind loads and reactions based on MMFRS with additional C&C member design

WARNING Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries Do not permit inexperienced and untrained people to install trusses See "WARNING" note below. BCSI recommends retaining a registered professional engineer for the design of temporary bracing

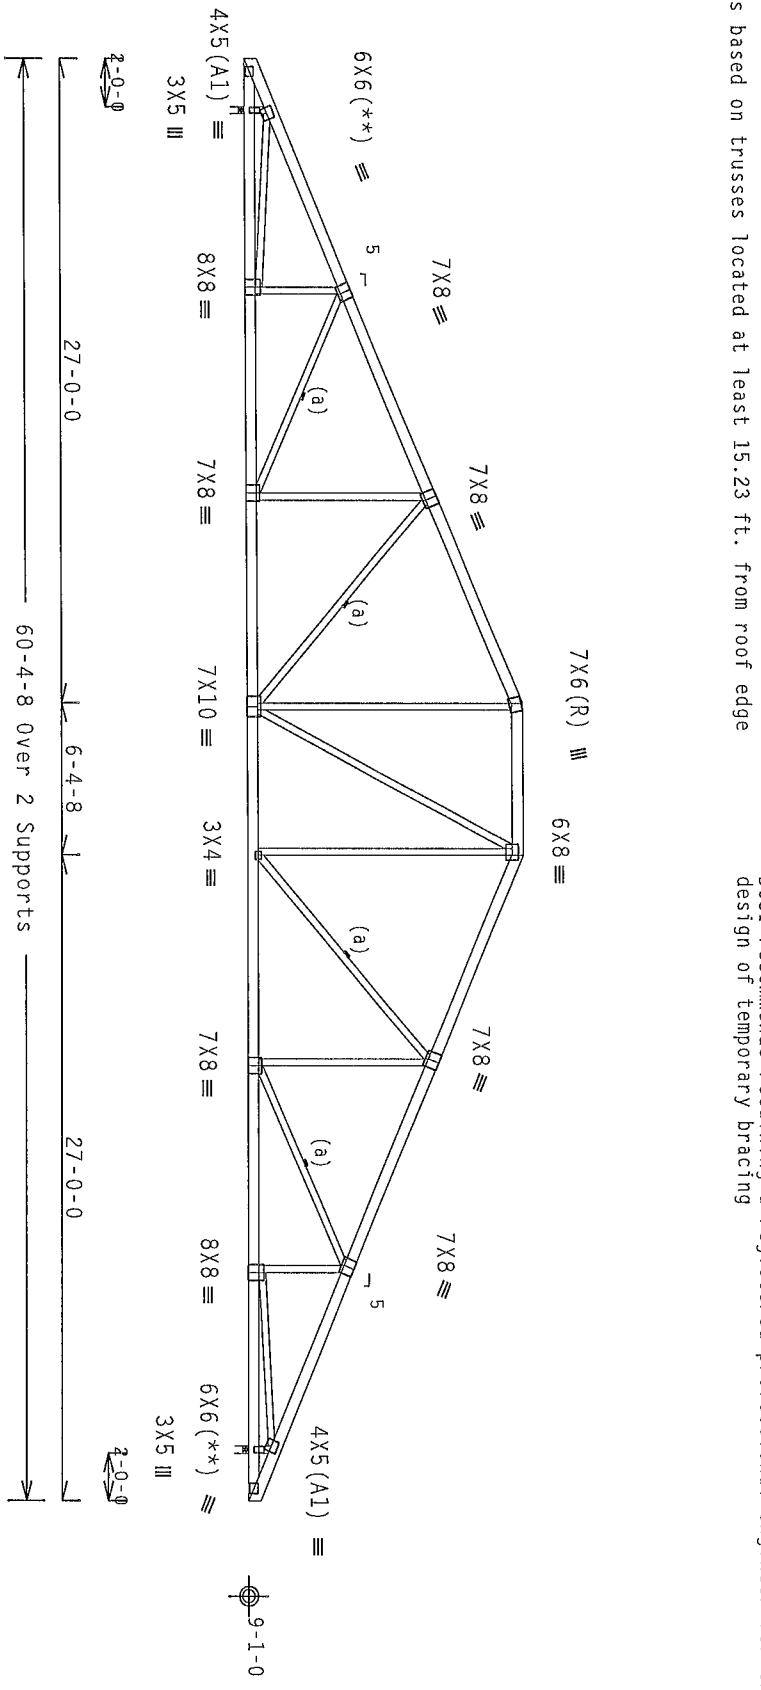


PLT TYP. Wave Design Crit: FBC2010Com/TPI-2007(STD) FT/RT=20%(0%)/10(0) 13.02.00.00 (E) QTY:2 FL/-/1/-/1/-/RT/- Scale = .125"/ft.

****WARNING** READ AND FOLLOW ALL NOTES ON THIS SHEET!**
 FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI (Building Component Safety) Information by TPI and WFA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections 93 B7 or 810 as applicable.
 ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design or any failure of trusses in conformance with ANSI/TPI 1 or for handling, shipping, installation, bracing of trusses. Apply plates to each trace of truss and position as shown above and on the detail. Details unless noted otherwise. Refer to drawings 1800.2 for standard plate positions. A seal on this design is required for the design of temporary bracing. The design of temporary bracing is the responsibility of the Building Designer per ANSI/TPI 1 Sec 2. For more information see the general notes page. ITW BCG www.itwbcg.com TPI www.tpiinst.org WFA www.structure.com ICC www.iccsafe.org



ITW Building Components Group Inc.
 Orlando FL 32837
 FL COA #0 278



TC LL	20.0 PSF	REF	R215--	18391
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCSR215	14226116
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEON-	423252	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	JREF-	1V8X215_Z04	

Top chord 2x6 SP M-31
 Bot chord 2x6 SP M-31
 Webs 2x4 SP M-31

Left cantilever is exposed to wind

(a) Continuous lateral restraint equally spaced on member

In lieu of structural panels use purtins to brace all flat TC @ 24" OC

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 11 9'-3".


(**) 1 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements

130 mph wind, 15 22 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 13.00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf GCPI(+/-)=0 18

Wind loads and reactions based on MWFRS with additional C&C member design

WARNING: Furnish a copy of this DWG to the installation contractor Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below

MWFRS loads based on trusses located at least 30 45 ft. from roof edge

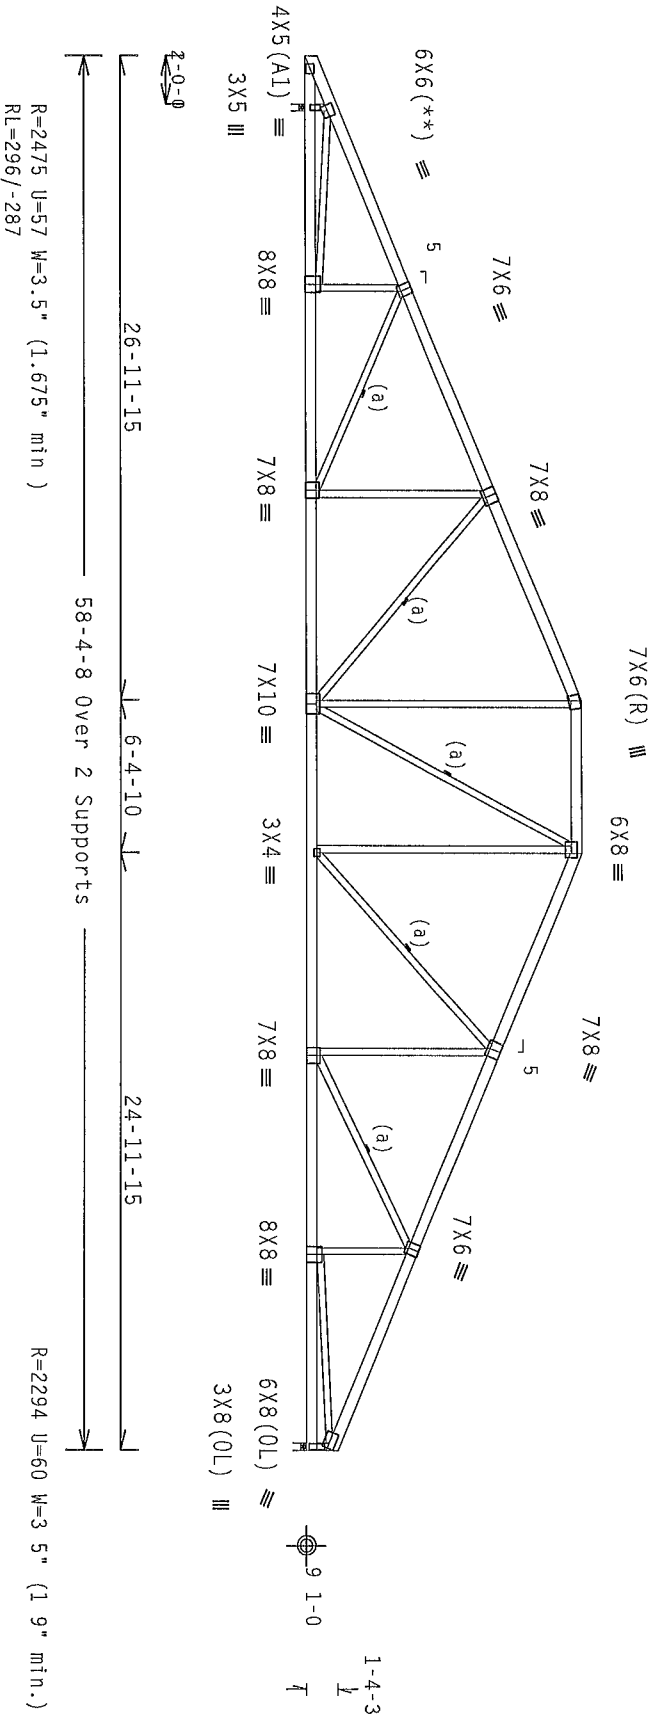

PLT TYP. Wave


Design Crit: FBC2010Com/TPI-2007(STD)
 FT/RT=20%(0%)/10(0)

13.02.05.09.13


QTY:2 FL/-/1/-/1/-/

Scale = .125"/Ft.

****WARNING** READ AND FOLLOW ALL NOTES ON THIS SHEET!**
 FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
 Trusses require extreme care in fabricating handling shipping installing and bracing. Refer to the latest edition of BCSI (Building Component Safety Information) by TPI and WTA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections B3 B7 or B10 as applicable.
 ITW Building Components Group Inc (ITWBCG) shall not be responsible for any deviation from this design or any failure to build the truss in conformance with ANSI/TPI 1 or for handling shipping installing or bracing on trusses. Apply plates to each trace of truss and position as shown above and on the joint. Drawing or cover page listing this drawing indicates specific responsibilities for the structure. It is the responsibility of the Building Designer per ANSI/TPI 1 Sec 2 For more information see the general notes page ITW BCG www.itwbcg.com TPI www.tpinst.org MTCA www.sbcindustry.com ICC www.iccsafe.org



ITW Building Components Group Inc.
 Orlando FL, 32837
 FL COA #0278



TC LL	20.0 PSF	REF	R215 - 18394
TC DL	10.0 PSF	DATE	08/14/14
BC DL	10.0 PSF	DRW	HCSR215 14226091
BC LL	0.0 PSF	HC-ENG	GA/DF
TOT.LD.	40.0 PSF	SEQN-	423268
DUR.FAC.	1.25	FROM	CDM
SPACING	24.0"	JREF-	1V8X215_Z04


Top chord 2x6 SP M-31
Bot chord 2x6 SP M-31
Webs 2x4 SP M-31

Left and right cantilevers are exposed to wind
Calculated horizontal deflection is 0.13" due to live load and 0.21" due to dead load.

(a) Continuous lateral restraint equally spaced on member
Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 11-9-3
MWFRS loads based on trusses located at least 30 45 ft from roof edge

(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements
130 mph wind, 15 22 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17 00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf GCpr (+/-)-0 18
Wind loads and reactions based on MWFRS with additional C&C member design
In lieu of structural panels use purlins to brace all flat TC @ 24" OC
WARNING: Furnish a copy of this DWG to the installation contractor. Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries. Do not permit inexperienced and untrained people to install trusses. See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing

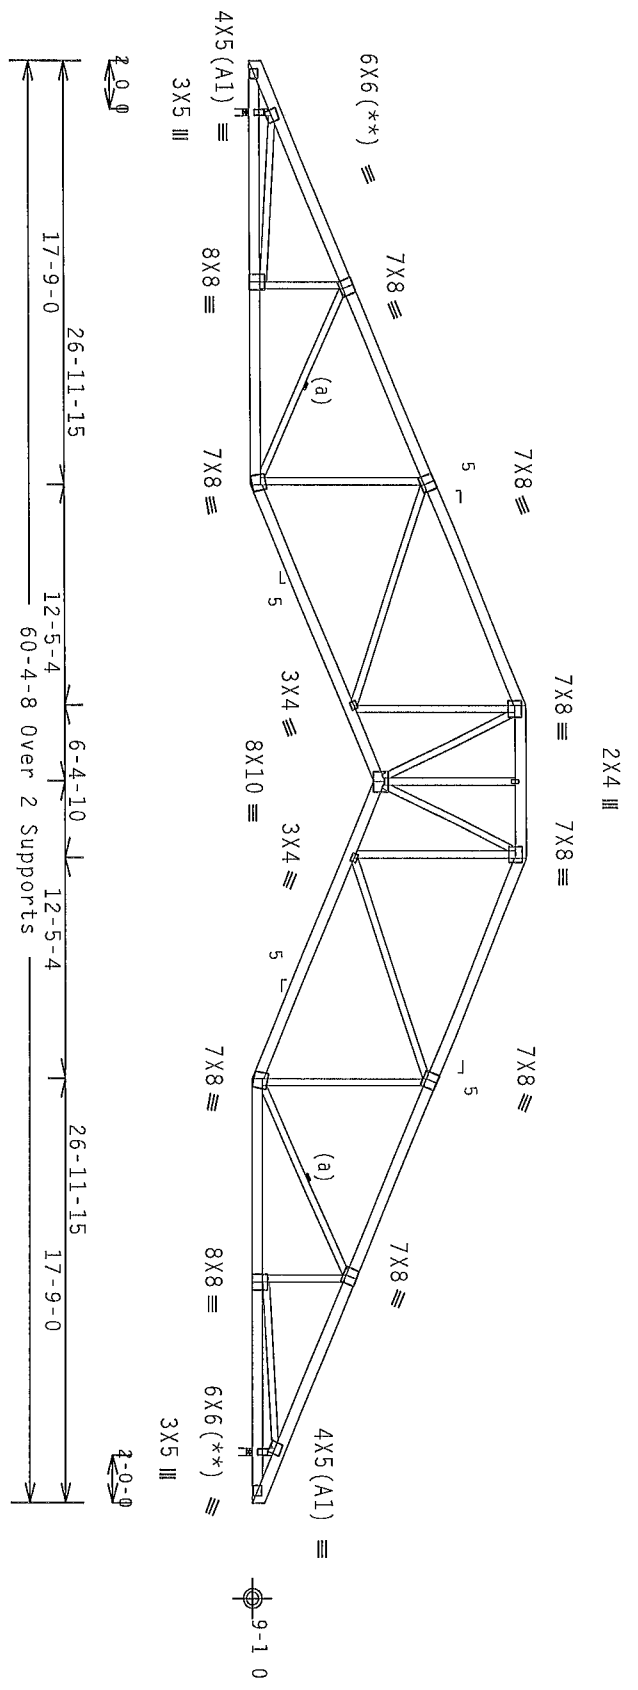

PLT TYP. Wave

Design Crit: FBC2010Com/TPI-2007(STD)
FT/RT=20%(0%)/10(0)

13.02.06


OTY:12 FL/-/1/-/1/-/1/-

Scale = .125"/ft.

ALPINE

ITW Building Components Group Inc.
Orlando FL 32837
FL COA #0278

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS SHEET.
****WARNING**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS.
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI Building Component Safety Information by TPI and WFA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI Units noted otherwise. Top chord shall have properly attached structural sheathing and bottom chords shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or shall have bracing installed per BCSI sections 83 B7 or B10 as applicable.
ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this drawing or failure of trusses in conformance with ANSI/TPI 1 or for handling, shipping, installing, or bracing of trusses. Apply plates to each face of truss and position as shown above and on the details unless noted otherwise. Refer to drawings 160A 2 for standard plate positions. A seal on the drawing or cover page listing this drawing indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this design for any structure is the responsibility of the building Designer per ANSI/TPI 1 Sec 2 WFA. For more information see general notes on page 2 of ITW BCG www.itwbcg.com TPI www.tpiusa.org WFA www.structure.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF	R215--	18396
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HOURS215	14226093
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEQN-	423255	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	JREF-	1V8X215_Z04	

Top chord 2x6 SP M-31
 Bot chord 2x6 SP M 31
 Webs 2x4 SP M-31 . M18 2x4 SP 2400f-2 OE

Left and right cantilevers are exposed to wind

Calculated horizontal deflection is 0.12" due to live load and 0.19" due to dead load.

(a) Continuous lateral restraint equally spaced on member

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 11-9-3

MWFRS loads based on trusses located at least 30.45 ft from roof edge


(**) 2 plate(s) require special positioning Refer to scaled plate plot details for special positioning requirements

130 mph wind, 15.22 ft mean hgt, ASCE 7-10, CLOSED bldg, not located within 17.00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf. GCPI (+/-)=0.18

Wind loads and reactions based on MWFRS with additional C&C member design

In lieu of structural panels use purlins to brace all flat TC @ 24' OC

WARNING: Furnish a copy of this DWG to the installation contractor Failure to follow provisions of BCSI in handling and installation of trusses can result in serious injuries. Do not permit inexperienced and untrained people to install trusses. See "WARNING" note below BCSI recommends retaining a registered professional engineer for the design of temporary bracing

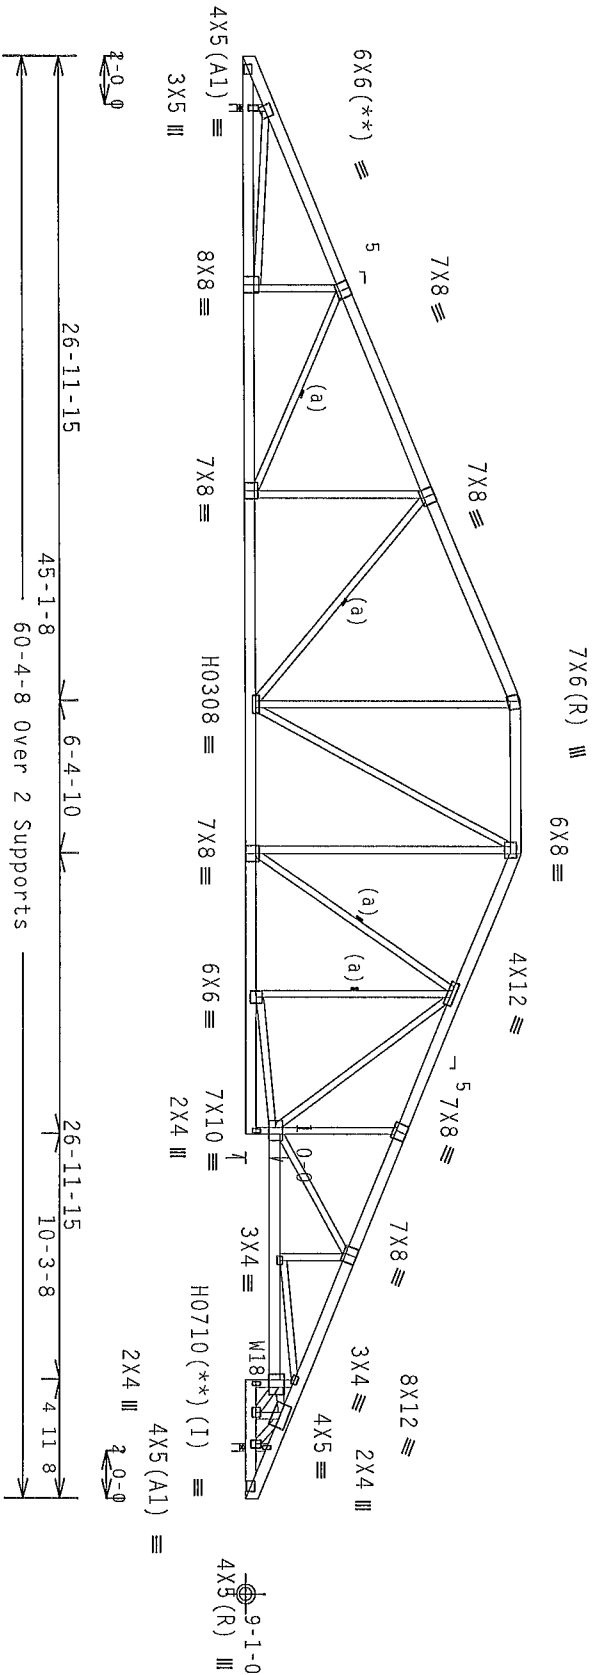

R=2461 U=56 W=3.5" (1.663" min)
 RL=305/-305

R=2473 U=54 W=3.5" (1.674" min)

PLT TYP. 20 Gauge HS.Wave

Design Crit: FBC2010Com/TPI-2007 (STD)
 FT/RT=20%(0%)/10(0)

13.02.2008

QTY. 1

FL/-/1/-/R/-

Scale = .125"/Ft.

ALPINE


ITW Building Components Group Inc.
 Orlando FL, 32837
 FL COA #0278

****IMPORTANT**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS SHEET!

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI Building Component Safety Information by TPI and WTA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections 83, 87 or 810 as applicable.

ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design or any failure of trusses. Apply plates to each face of truss and position as shown above and on the joint details in covers noted otherwise. Refer to drawings 1604.2 for standard plate positions. A seal on this drawing or cover page listing this design indicates acceptance of professional engineers for any structure. It is the responsibility of the installer to use this design for any structure. This 300's general notes page ITW BCG www.itwbcg.com TPI www.tpiinst.org WTA www.sbcindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF	R215--	18398
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCURS215	14226095
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEQN-	423283	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	UREF-	1V8X215_Z04	

Top chord 2x4 Sp M-31
 Bot chord 2x4 Sp M-31
 Webs 2x4 Sp M-31

Gable end supports 8" max rake overhang

See DWGS A14015ENC100212 & GBLETTIN0212 for gable wind bracing requirements



Fasten rated sheathing to one face of this frame

130 mph wind, 15.00 ft mean hgt, ASCE 7-10; CLOSED bldg, located anywhere in roof, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf Gcpi (+/-)=0.18

Wind loads and reactions based on MWFRS with additional C&C member design

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50

The overall height of this truss excluding overhang is 3-7-1.

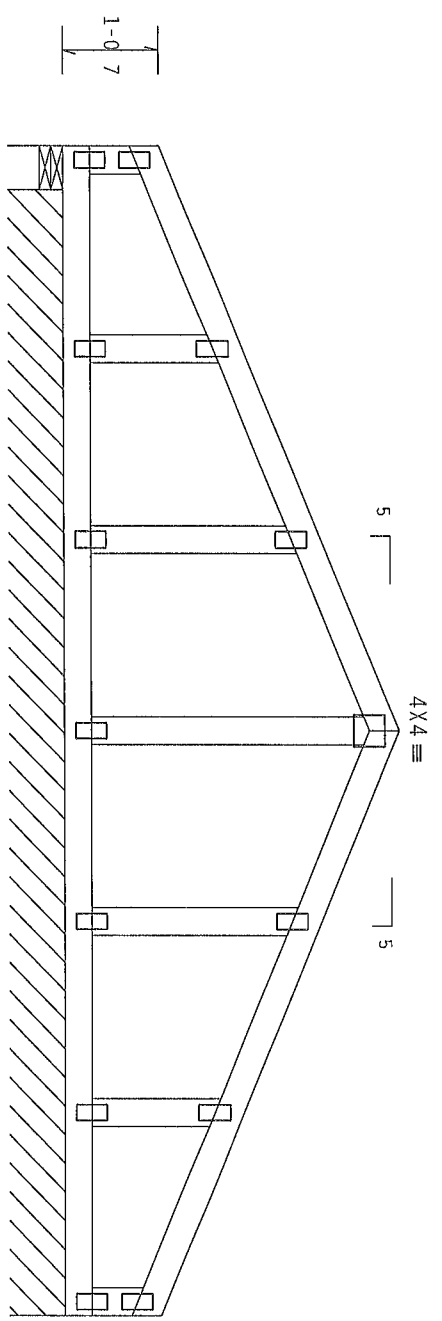

R=72 U=14 W=5.5" (1.5" min.)
 R=79 PLF W=11.9.8

Note: A11 Plates Are 2x4 Except As Shown.

PLT TYP. Wave

Design Crit: FBC2010Com/TPI-2007(STD)

FT/RT=20%(0%)/10(0)

13.02.2012

OTY:2 FL/-/1/-/1/-/1/-


Scale = .5"/Ft.

ITW Building Components Group Inc.
 Orlando FL, 32837
 FL COA #0278

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS SHEET!
 FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS

****WARNING**** Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI Building Component Safety Information by TPI and WTA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections 83.87 or 810 as applicable.

ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design or any failure to build the truss in conformance with ANSI/TPI 1 or for handling, shipping, installation, bracing or trusses. Apply plates to each face of truss and position as shown above and on the joint details. ITWBCG shall not be responsible for professional engineering or professional inspection. A seal on this drawing is required to indicate acceptance of professional engineering or professional inspection. The drawing is not to be used for any other purpose. For more information see the responsibility of the Building Designer per ANSI/TPI 1 Sec 2. For more information see the general notes page ITW BCG www.tbdcg.com TPI www.tpinst.org WTA www.structindustry.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF R215--	18399
TC DL	10.0 PSF	DATE	08/14/14
BC DL	10.0 PSF	DRW HCURS215	14226096
BC LL	0.0 PSF	HC-ENG GA/DF	
TOT.LD.	40.0 PSF	SEQN-	423209
DUR.FAC.	1.25	FROM	CDM
SPACING	24.0"	REF-	1V8X215_Z04


Top chord 2x4 SP M-31
 Bot chord 2x4 SP M-31
 Webs 2x4 SP M-31

130 mph wind, 15.00 ft mean hgt, ASCE 7-10, CLOSED bldg, Located anywhere in roof, RISK CAT III OR IV, EXP C, wind TC DL=5.0 psf, wind BC DL=5.0 psf GCpl(+/-)=0.18

Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50.

Wind loads and reactions based on MWFRS with additional C&C member design.

The overall height of this truss excluding overhang is 3-10 13

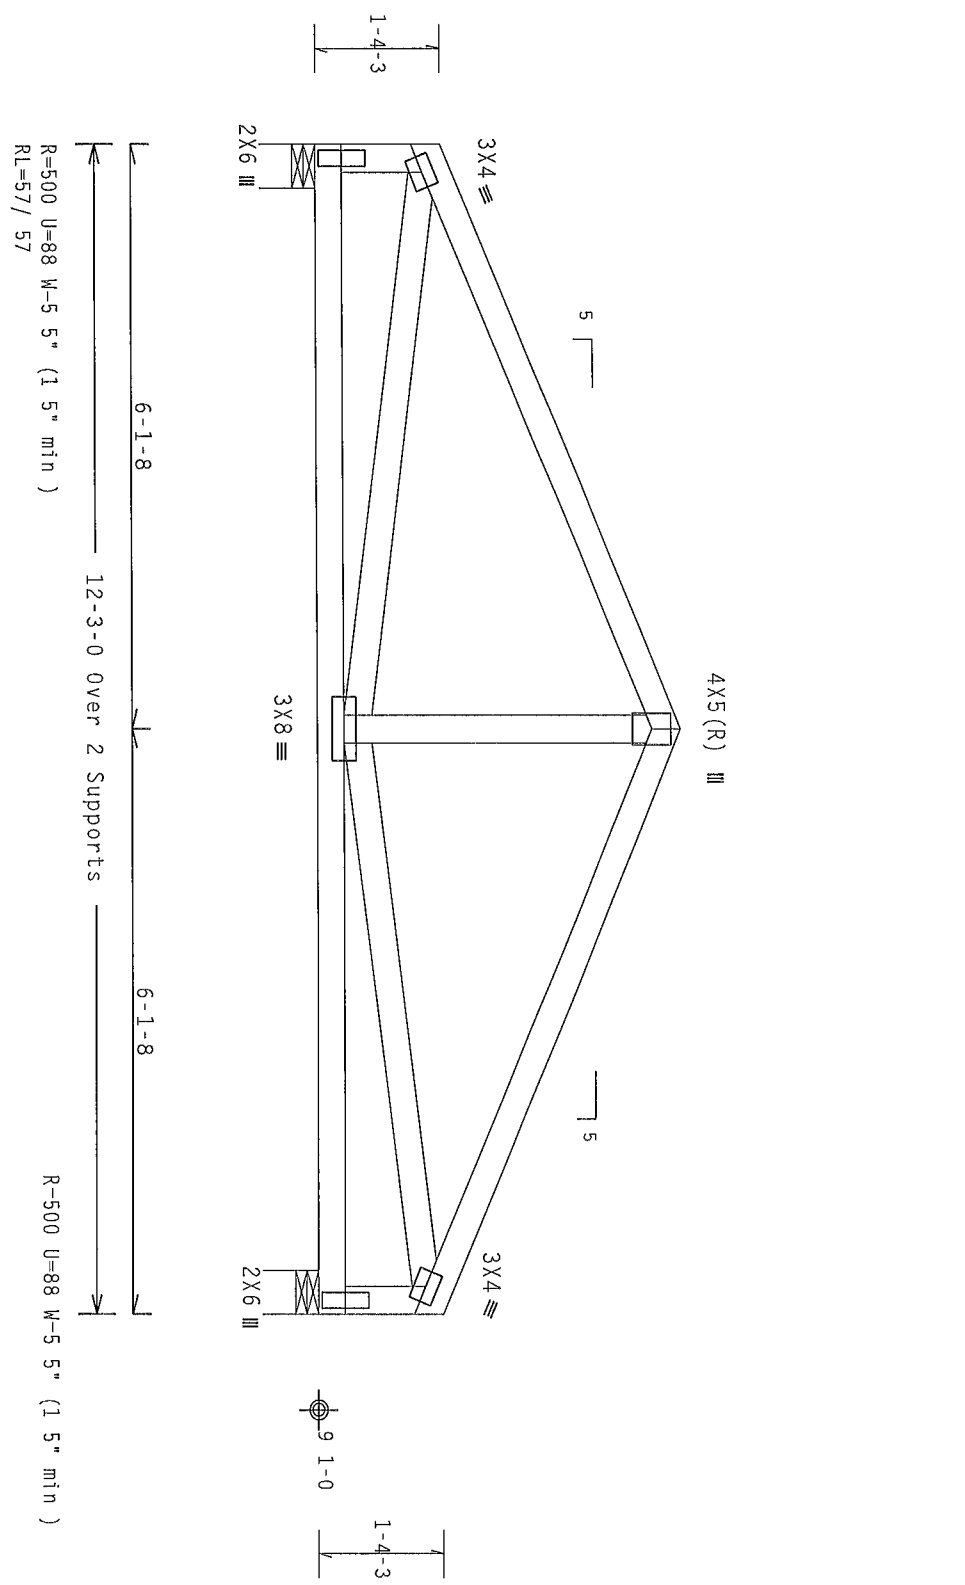

PLT TYP. Wave

Design Crit: FBC2010Com/TPI-2007(STD)
 FT/RT=20%(0%)/10(0)

13.02.2014

QTY: 2


FL/-/1/-/1/-/1/-

Scale = .5"/Ft.

ALPINE

ITW Building Components Group Inc.
 Orlando FL 32837
 FL COA #0278

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS SHEET.
 FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS.
 Trusses require extreme care in fabricating handling shipping installing and bracing. Refer to the latest edition of BCSI Building Component Safety Information by TPI and WFA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI notes noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3 B7 or B10 as applicable.
 ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design any failure to build the truss in conformance with ANSI/TPI 1 or for handling shipping installation or bracing of trusses. Apply plates to each face of truss and position as shown above and on the joint details unless noted otherwise. Refer to drawings 160A Z for standard plate positions. A seal on this drawing or cover page listing this drawing indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this design for any structure is the responsibility of the building owner. For more information see general notes page of ITW BCG www.tbcbg.com TPI www.tpinet.org WFA www.structure.com ICC www.iccsafe.org

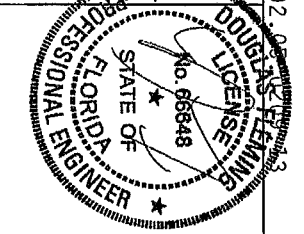

TC LL	20.0 PSF	REF	R215--	18400
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCSR215	14226097
BC LL	0.0 PSF	HC-ENG	GA/DF	
TOT. LD.	40.0 PSF	SEQN-	423205	
DUR. FAC.	1.25	FROM	CDM	
SPACING	24.0"	UREF-	1V8X215_Z04	

Top chord 2x4 Sp M-31
Bot chord 2x4 Sp M-31

130 mph wind, 21.28 ft mean hgt, ASCE 7-10, CLOSED bldg, located anywhere in roof, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=2.0 psf. Gcpi(+/-)=0 18

Wind loads and reactions based on MMFRS with additional C&C member design

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1 50

MMFRS loads based on trusses located at least 21 28 ft from roof edge


Refer to DWG PB160100212 for piggyback details

Special Loads

TC- From	Dur	Fac	=1 25 /	Plate	Dur	Fac	=1 25)
TC- From	62 p/f	at	-1 11 to	62 p/f	at	0 85	
TC- From	62 p/f	at	0 85 to	62 p/f	at	3 22	
TC- From	62 p/f	at	3 22 to	62 p/f	at	5 18	
BC- From	4 p/f	at	-1 11 to	4 p/f	at	5 18	

In lieu of structural panels or rigid ceiling use purlins to brace all flat TC @ 24" OC, all BC @ 24" OC

The overall height of this truss excluding overhang is 0-10-0

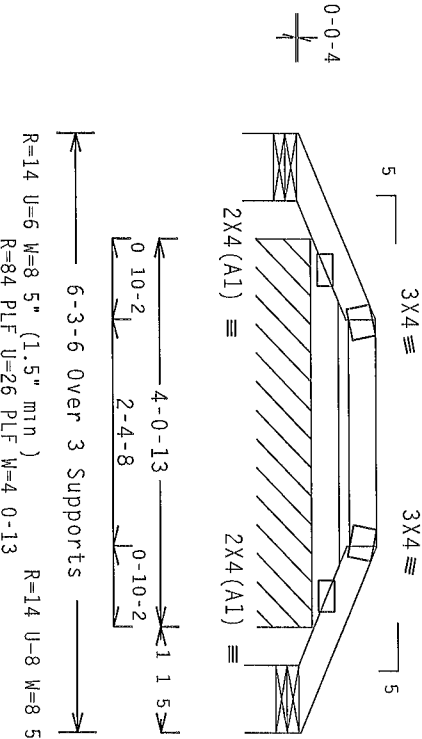

PLT TYP. Wave



Design Crit: FBC2010Com/TPI-2007 (STD)
FT/RT=20% (0%) / 10 (0)

13.02.2013

QTY:2 FL/-/1/-/1/-/1/-

Scale = .5"/Ft.

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS SHEET
FURNISH TRUSS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI (Building Component Safety Information) by TPI and WCA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections B3 B7 or B10 as applicable.
ITM Building Components Group Inc (ITMBCG) shall not be responsible for any deviation from this design or any failure to build the truss in conformance with ANSI/TPI 1 or for handling, shipping, installation, bracing or trusses. Apply plates to each face of truss and position as shown above and on the joint details unless noted otherwise. Refer to drawings 1804 2 for standard plate positions. A seal on the drawing or cover page listing this drawing indicates acceptance of professional engineering responsibility by the BCSI design team. This design is for use of this design for any structure is the responsibility of the BCSI design team. Refer to drawings 1804 2 for standard plate positions. A seal on the general notes page. ITM BCG www.tbcbg.com TPI www.tpi.net.org WCA www.structure.com ICC www.iccsafe.org



TC LL	20.0 PSF	REF	R215-- 18401
TC DL	10.0 PSF	DATE	08/14/14
BC DL	10.0 PSF	DRW	HCUSR215 14226098
BC LL	0.0 PSF	HC-ENG	GA/DF
TOT.LD.	40.0 PSF	SEQN-	423260
DUR.FAC.	1.25	FROM	CDM
SPACING	24.0"	JREF-	1V8X215_Z04

Top chord 2x4 Sp M-31
 Bot chord 2x4 Sp M-31
 Webs 2x4 Sp M-31


130 mph wind, 15 00 ft mean hgt, ASCE 7-10, CLOSED bldg, Located anywhere in roof, RISK CAT III OR IV, EXP C, wind TC DL=5 0 psf, wind BC DL=5 0 psf Gcpl (+/-)=0 18

Left cantilever is exposed to wind

Wind loads and reactions based on MWFRS with additional C&C member design.

Deflection meets L/240 Tive and L/180 total load Creep increase factor for dead load is 1 50

The overall height of this truss excluding overhang is 1-9-3.

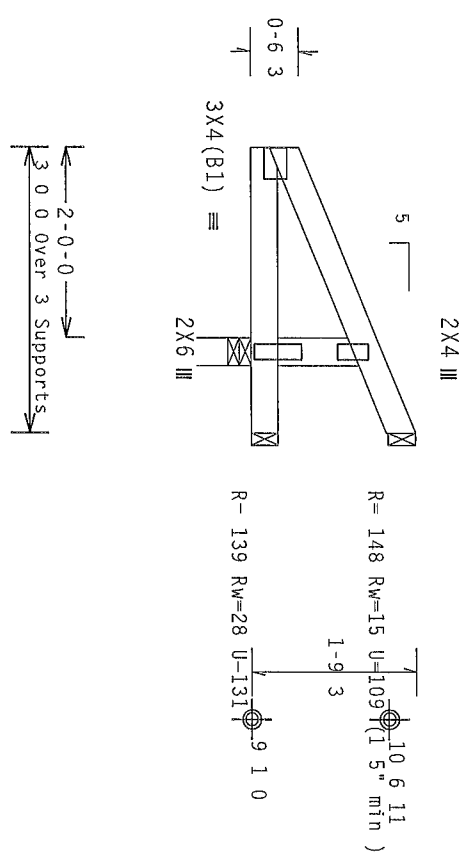

R=519 U=68 W=3 5" (1 5" min)
 RL=35

PLT TYP. Wave


Design Crit: FBC2010Com/TPI-2007(STD)
 FT/RT=20%(0%)/10(0)

13.02.02


OTY:8

FL/-/1/-/1/-/R/-

Scale =.5"/Ft.



****IMPORTANT**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
****WARNING**** READ AND FOLLOW ALL NOTES ON THIS SHEET!
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to the latest edition of BCSI Building Component Safety Information by TPI and WFA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or web shall have bracing installed per BCSI sections B3 B7 or B10 as applicable.
 ITW Building Components Group Inc. (ITWBCG) shall not be responsible for any deviation from this design drawing or cover page listing this drawing. Indicates acceptance of professional engineering details of trusses. Apply plates to each face of truss and position as shown above and on the joint. Drawing or cover page listing this drawing. Indicates acceptance of professional engineering details of trusses. Apply plates to each face of truss and position as shown above and on the joint. The responsibility for the building design and use of this design for any structure is the responsibility of the building owner. This design is for information only. This job is the responsibility of the building owner. This design is for information only. This job is the responsibility of the building owner. This design is for information only. This job is the responsibility of the building owner.
 ICC www.iccsafe.org
 WFA www.wfa.com
 TPI www.tpiinst.org
 WFA www.wfa.com
 WFA www.wfa.com



TC LL	20.0 PSF	REF R215-- 18404
TC DL	10.0 PSF	DATE 08/14/14
BC DL	10.0 PSF	DRW HCURS215 14226101
BC LL	0.0 PSF	HC-ENG GA/DF
TOT. LD.	40.0 PSF	SEQN- 423200
DUR. FAC.	1.25	FROM CDM
SPACING	24.0"	UREF- 1V8X215_Z04

(8740 /FT WHITE ASSISTED LIV FA /S&S CONSTRUCTION FT White, FL 305)

THIS DWG PREPARED FROM COMPUTER INPUT (LOADS & DIMENSIONS) SUBMITTED BY TRUSS MFR

Top chord 2x4 SP M-31
 Bot chord 2x4 SP M-31
 Webs 2x4 SP M-31

Left cantilever is exposed to wind


Deflection meets L/240 live and L/180 total load Creep increase factor for dead load is 1.50

MWFRS loads based on trusses located at least 7 50 ft from roof edge.

130 mph wind, 15 00 ft mean hgt, ASCE 7 10, CLOSED bldg, not located within 9 00 ft from roof edge, RISK CAT III OR IV, EXP C, wind TC DL-5 0 psf, wind BC DL-5 0 psf GCpl (+/-)=0 18

Wind loads and reactions based on MWFRS with additional C&C member design

The overall height of this truss excluding overhang is 4-3-3

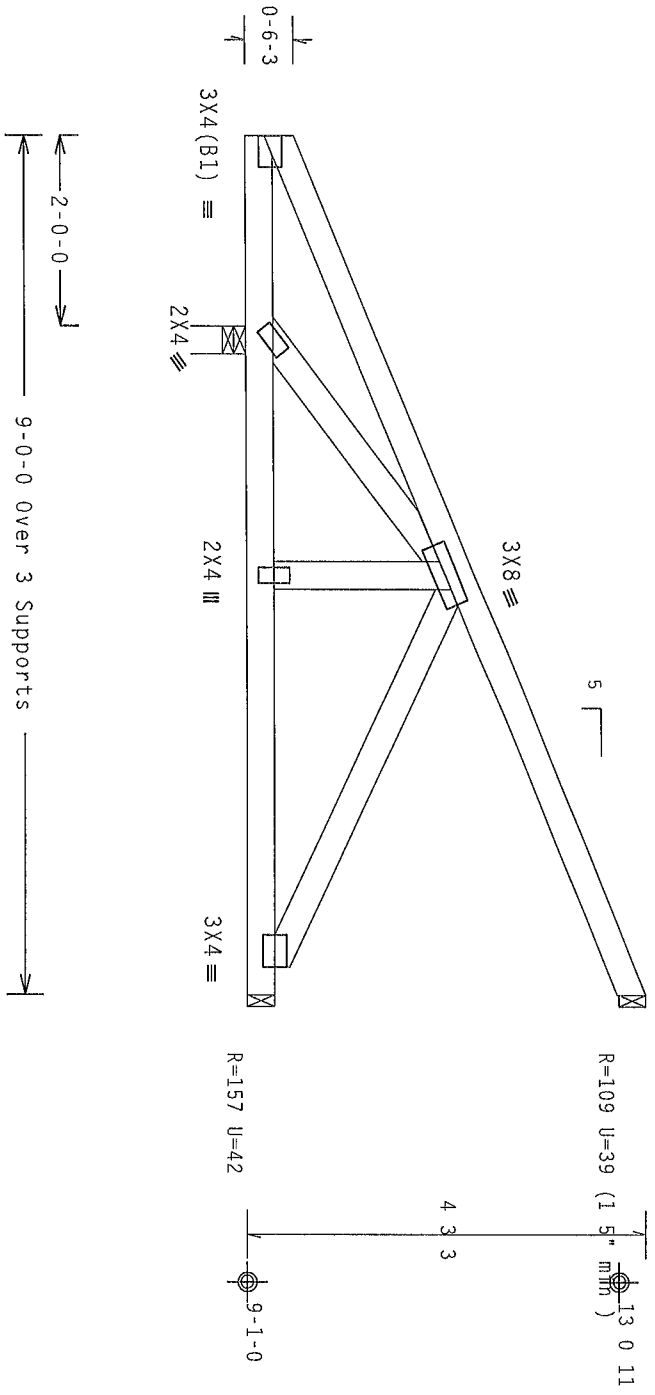

Design Crit: FBC2010Com/TPI-2007 (STD)
 FT/RT=20% (0%)/10(0)


PLT TYP. Wave

13.02.09


QTY:20 FL/-/1/-/1/-/1/-

Scale = .5"/Ft.

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS SHEET!
****IMPORTANT**** FURNISH THIS DESIGN TO ALL CONTRACTORS INCLUDING INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to follow the latest edition of BCSI (Building Component Safety Information by TPI and WCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI unless noted otherwise. Top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint or we shall have bracing installed per BCSI sections 93 97 or 910 as applicable.
 ITW Building Components Group Inc (ITWBCG) shall not be responsible for any deviation from this design any failure of trusses. Apply plates to each face of truss and position as shown above and on the joint details. Unites noted otherwise. Refer to drawings 1600 Z for standard plate positions. A seal on the drawing or cover page listing this drawing indicates acceptance of professional engineering. This structure is the responsibility of the Building Designer per ANSI/SPRI 1 Sec 2 For more information on this job's general notes page. ITW BCG www.itwbog.com TPI www.tpinet.org WCA www.structure.com ICC www.iccsafe.org



ITW Building Components Group Inc.
 Orlando FL, 32837
 FL COA #0 278



TC LL	20.0 PSF	REF	R215--	18407
TC DL	10.0 PSF	DATE	08/14/14	
BC DL	10.0 PSF	DRW	HCUSR215	14226104
BC LL	0 0 PSF	HC-ENG	GA/DF	
TOT.LD.	40.0 PSF	SEON-	423197	
DUR.FAC.	1.25	FROM	CDM	
SPACING	24.0"	JREF-	1V8X215_Z04	

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.


Web Member Size	Specified CLR Restraint	Alternative Reinforcement T- or L- Reinf.	Scab Reinf.
2x3 or 2x4	1 ROW 2 ROWS	2x4 2x6	1-2x4 2-2x4
2x6	1 ROW 2 ROWS	2x4 2x6	1-2x6 2-2x4(Ø)
2x8	1 ROW 2 ROWS	2x6 2x6	1-2x8 2-2x6(Ø)

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.

Ø Center scab on wide face of web. Apply (1) scab to each face of web.


T-Reinforcement
or
L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128"x3.0" min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

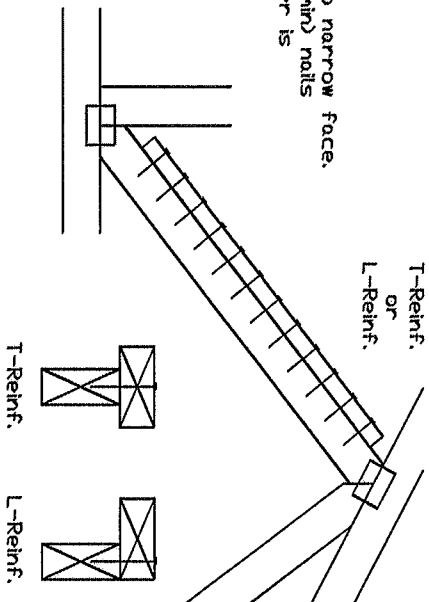

Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128"x3.0" min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

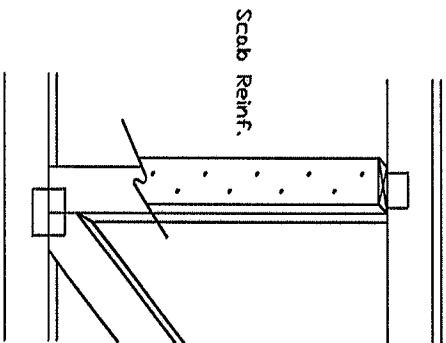

Building Components Group Inc.

Earth City, MO 63045

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING AND/OR PARTIAL FINISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI Building Component Safety Information, by TPI and SERA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI specifications. Trusses shall be braced in accordance with the specifications and drawings. Trusses shall have bracing installed per BCSI sections 82, 87 or 100, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise.

Refer to drawings 1804-2 for standard plate positions.

If bracing components are not shown, they shall be installed in accordance with the specifications and drawings. Components shall be installed in accordance with the specifications and drawings. Components shall be installed in accordance with the specifications and drawings.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ASCE/TP 1 Sect. 4.1.1.1.

ITWBG www.itwbg.com TPI www.tpi.com SERA www.sera.com




TC LL	PSF	REF	CLR Subst.
TC DL	PSF	DATE	8/15/13
BC DL	PSF	DRWG	BRCLBSUB0813
BC LL	PSF		
TDT. L.D.	PSF		
DUR. FAC.			
SPACING			

Gable Stud Reinforcement Detail

ASCE 7-10: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Dr: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00
 Dr: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00
 Dr: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Gable Vertical Spacing		2x4 Species	Grade	No Braces	Group A		Group B		Group A		Group B	
					(D) 1x4 1" Brace	(D) 2x4 1" Brace	(D) 2x4 1" Brace	(D) 2x4 1" Brace	(D) 2x6 1" Brace	(D) 2x6 1" Brace		
12" o.c.	SPF	#1 / #2	4' 3"	7' 3"	8' 7"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"	
			4' 1"	7' 2"	8' 6"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	
			4' 1"	7' 2"	8' 6"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	
	HF	Standard	4' 4"	7' 4"	8' 8"	10' 3"	10' 8"	13' 7"	14' 0"	14' 0"	14' 0"	
			4' 4"	7' 4"	8' 8"	10' 3"	10' 8"	13' 7"	14' 0"	14' 0"	14' 0"	
			4' 4"	7' 4"	8' 8"	10' 3"	10' 8"	13' 7"	14' 0"	14' 0"	14' 0"	
SP	Standard	4' 1"	7' 1"	8' 5"	10' 1"	10' 6"	13' 3"	14' 0"	14' 0"	14' 0"		
		4' 1"	7' 1"	8' 5"	10' 1"	10' 6"	13' 3"	14' 0"	14' 0"	14' 0"		
		4' 1"	7' 1"	8' 5"	10' 1"	10' 6"	13' 3"	14' 0"	14' 0"	14' 0"		
SPF	#1 / #2	4' 11"	8' 4"	9' 8"	12' 1"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"		
		4' 8"	8' 1"	9' 5"	11' 8"	11' 8"	13' 2"	14' 0"	14' 0"	14' 0"		
		4' 8"	8' 1"	9' 5"	11' 8"	11' 8"	13' 2"	14' 0"	14' 0"	14' 0"		
HF	Standard	4' 8"	8' 2"	9' 6"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
		4' 8"	8' 2"	9' 6"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
		4' 8"	8' 2"	9' 6"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
SP	Standard	4' 11"	8' 4"	9' 10"	12' 2"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"		
		4' 8"	7' 3"	8' 8"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
		4' 8"	7' 3"	8' 8"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
DFL	Standard	4' 8"	8' 2"	9' 6"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
		4' 8"	8' 2"	9' 6"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		
		4' 8"	8' 2"	9' 6"	11' 7"	11' 7"	13' 1"	14' 0"	14' 0"	14' 0"		

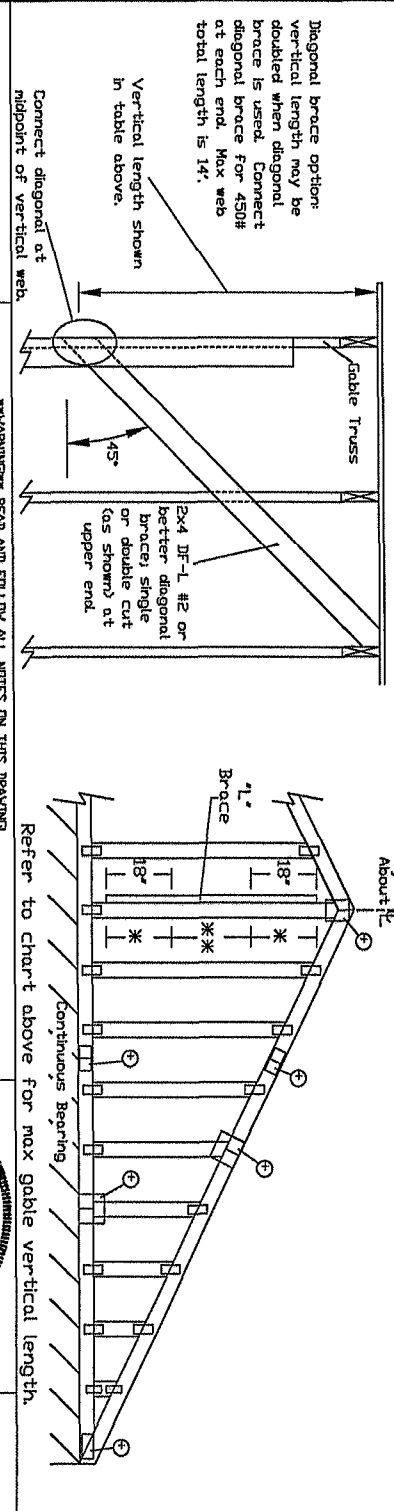

Diagonal brace option: vertical length may be doubled when diagonal brace is used. Connect diagonal brace for 450# at each end. Max web total length is 14'.

Vertical length shown in table above.


Connect diagonal at midpoint of vertical web.

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING AND INSTANTLY FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the notes on the drawing for proper bracing. Trusses shall be braced in accordance with the safety notes noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCST sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 1004-2 for standard plate positions.

ITV Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The use of ANSI/TPI 1 Seal. For more information see this job's general notes page and these web sites: www.itvbcg.com www.itvbcg.com www.itvbcg.com

Earth City, MO 63045



MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCE7-10-GABI4015

DATE 2/14/12

DRWG A14015ENC100212

Bracing Group Species and Grades:

Group A:		Group B:	
Species-Grade	Species-Grade	Species-Grade	Species-Grade
#1 / #2 Standard Stud	#2 Standard Stud	#1 / #2 Standard Stud	#2 Standard Stud

1x4 Braces shall be S8B Stress-Rated Board.

For 1x4 So. Pine use only Industrial S5 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Group A: Hem-Fir #1 & Btr #1

Group B: Southern Pine #1 #2

Gable Truss Detail Notes:

Wind Load deflection criterion is L/240.

Provide uplift connections for SS pnf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12" plywood overhang.

So. Pine lumber design values based on the ASCE January, 2012 ratings.

Attach 1" x 1" braces with 10d (128x30) nlp nails.

For (D) 1" brace: space nails at 2' o.c. in 18" end zones and 4' o.c. between zones.


For (E) 1" braces: space nails at 3' o.c. in 18" end zones and 6' o.c. between zones. 1" bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes	
Vertical Length	No Splice
Less than 4' 0"	1X4 or 2X3
Greater than 4' 0", but less than 11' 6"	25X4
Greater than 11' 6"	3X4

+ Refer to common truss design for peak, splice, and heel plates.



Refer to the Building Designer for conditions not addressed by this detail.

Gable Detail For Let-in Verticals

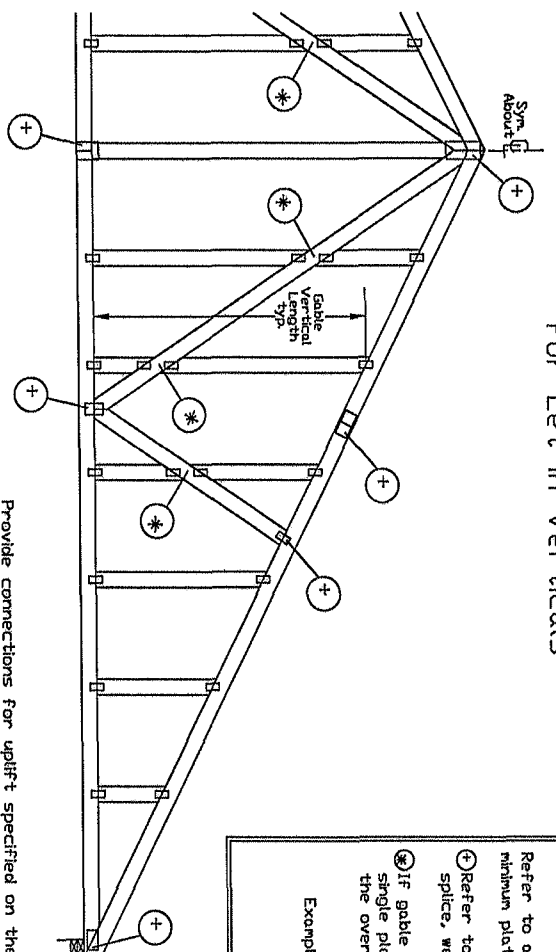

Gable Truss Plate Sizes

- Refer to appropriate ITV gable detail for minimum plate sizes for vertical studs.
- Refer to Engineered truss design for peak, splice, web, and heel plates.
- If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.

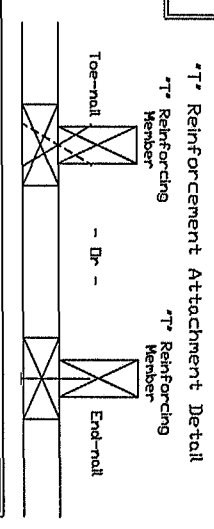

To convert from 'L' to '*T*' reinforcing members, multiply '*T*' increase by length (based on appropriate ITV gable detail).

Maximum allowable '*T*' reinforced gable vertical length is 14' from top to bottom chord.

T reinforcing member material must match size, specie, and grade of the 'L' reinforcing member.

Web Length Increase w/ '*T*' Brace

Example:

T Reinf. Mem. Size	*T* Increase
2x4	30 %
2x6	20 %

ASCE 7-10 Wind Speed = 120 mph
 Mean Roof Height = 30 ft, Kz = 1.00
 Gable Vertical = 24' o.c. SP #3
 T Reinforcing Member Size = 2x4
 T Brace Increase (From Above) = 30% = 1.20
 (D) 2x4 'L' Brace Length = 8' 7"
 Maximum *T* Reinforced Gable Vertical Length
 1.20 x 8' 7" = 11' 2"

This detail to be used with the appropriate ITV gable detail for ASCE wind load.

Attach each '*T*' reinforcing member with
 End Driver Nails:
 10d Common (0.148"x3.4"min) Nails at 4' o.c. plus
 (4) nails in the top and bottom chords.

Toenailed Nails:
 10d Common (0.148"x3.4"min) Toenails at 4' o.c. plus
 (4) toenails in the top and bottom chords.


- ASCE 7-98 Gable Detail Drawings
- A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109
 - A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109
 - A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109
 - A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109
 - A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109, A1001S980109

See appropriate ITV gable detail for maximum unreinforced gable vertical length.

IMPORTANT: READ AND FILL IN ALL NOTES IN THIS DRAWING



Earth City, MO 63045



REF	LET-IN VERT
DATE	2/16/12
DRWG	GBLETTIND212
MAX. TOT. LD.	60 PSF
DUR. FAC.	ANY
MAX. SPACING	24.0"


Piggyback Detail - ASCE 7-10: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kz+1.00

160 mph Wind, 30,000 Ft Mean Hgt, ASCE 7-10, Enclosed Bldg, located anywhere in roof, Exp C, Wind DL = 50 psf (mph), Kz+1.0, Dr 140 mph wind, 30,000 Ft Mean Hgt, ASCE 7-10, Enclosed Bldg, located anywhere in roof, Exp D, Wind DL = 50 psf (mph), Kz+1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends. Maximum truss spacing is 24' o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

** Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.


Detail A : Purlin Spacing = 24" o.c. or less

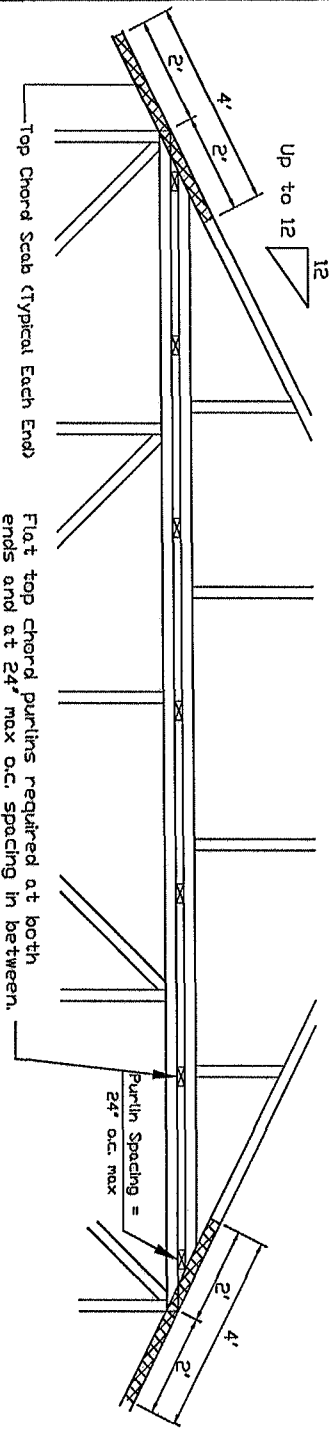

The top chord #3 grade 2x4 scab may be replaced with either of the following: (1) 3X8 Trulox plate attached with (2) 0120"x1375" nails, (4) into base truss TC or (1) 28PB wave piggyback plate attached to the piggyback truss TC and attached to the base truss TC with (4) 0120"x1375" nails. Note Nailing thru holes of wave plate is acceptable.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0135"x3.5").

Detail B : Purlin Spacing > 24" o.c.

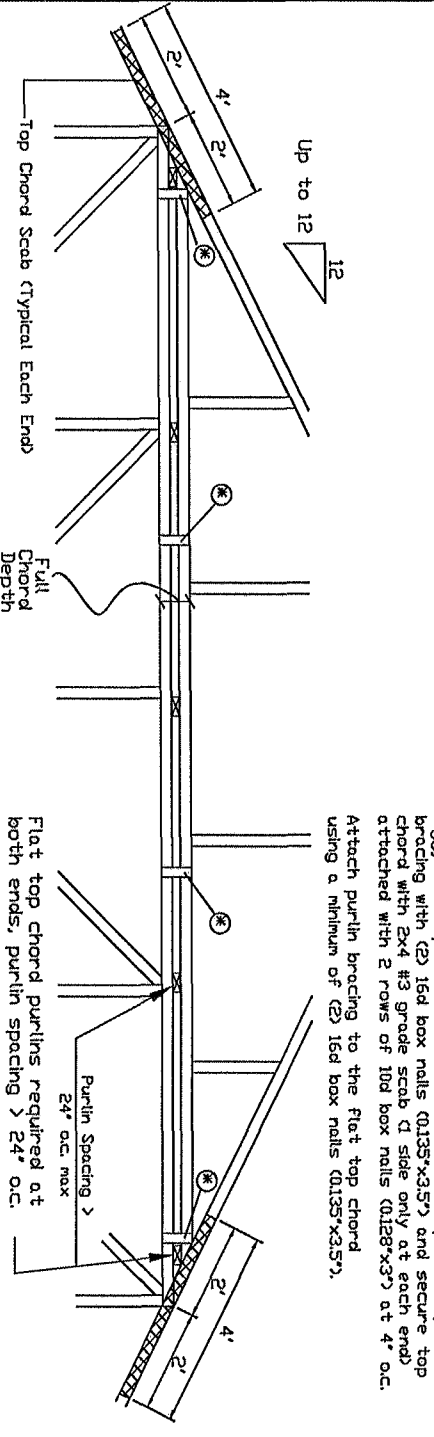

Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0128"x3") at 4' o.c. Attach purlin bracing to the flat top chord using a minimum of (2) 16d box nails (0135"x3.5").

Flat top chord purlins required at both ends, purlin spacing > 24' o.c.

* In addition, provide connection with one of the following methods:

- Trulox**
Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0120"x1375" nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces.
- APA Rated Gussset**
8"x8"x7/16" (min) APA rated sheathing gusssets (each face). Attach @ 8' o.c. with (8) 6d common (0113"x2") nails per gussset; (4) in cap bottom chord and (4) in base truss top chord. Gusssets may be staggered 4' o.c. front to back faces.
- 2x4 Vertical Scabs**
2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.
- 28PB Wave Piggyback Plate**
The 28PB wave piggyback plate to each face @ 8' o.c. Attach with to piggyback at time of fabrication. Attach to supporting truss with (4) 0120"x1375" nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces.


IMPORTANT: READ AND FILL IN ALL SPACES ON THIS DRAWING. CONTRACTOR SHALL FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the manufacturer's instructions for proper installation. Trusses shall be installed in accordance with the manufacturer's instructions. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed on beam above and on the Job Details, unless noted otherwise. Refer to drawings 104-2 for standard plate positions.

ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses. A seal on this drawing or cover page listing the drawing title as acceptable for use in the construction of the building is the responsibility of the Building Inspector per ANSI/TPI 1 Sect. 11V.01G. For more information see this job's general notes page and these web sites: ITW/BCG www.itwbcg.com TPI www.tpi.org VTDK www.vtdk.com ID www.idcsa.org



Earth City, MO 63045



REF	PIGGYBACK
DATE	2/14/12
DRWG	PB160100212
SPACING	24.0'