PLAN KEY	
PV-1	COVER PAGE
PV-1.1	ATTACHMENT DETAIL
PV-2	ROOF LAYOUT
PV-3	ELECTRICAL
PV-3.1	ELECTRICAL CONT.
PV-3.2	EQUIPMENT LABELS

HANWHA Q.PEAK DUO BLK ML-G9+ 380
380 WATT MODULE
72.44'' X 40.5'' X 1.26''
(SEE DATASHEET)

BILL OF MATERIALS	
MODULES	28
INVERTERS	28
CLAMP ASSEMBLY	87
COUPLING ASSEMBLY	56
BONDING CLIP	22
SKIRTS	13
ENPHASE COMBINER BOX	1
EATON 60A FUSIBLE AC DISCONNECT	1
45A FUSES	2
125A LINE TAPS	2

SYSTEM INFORMATION	
MODULE	HANWHA Q.PEAK DUO BLK ML-G9+ 380
INVERTER	ENPHASE IQ7PLUS-72-2-US
RACKING	ECOFASTEN ROCK-IT & ESUNMODO EZ GRIP
SYSTEM SIZE (DC)	10.64 KW
LOCATION	29.8761140,-82.6673043

GENERAL NOTES:

THIS PV SYSTEM HAS BEEN DESIGNED TO MEET THE MINIMUM DESIGN STANDARDS FOR BUILDING AND OTHER STRUCTURES OF THE ASCE 7-16, 7TH EDITION 2020 FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 FLORIDA BUILDING CODE, 7TH EDITION 2020 FLORIDA FIRE PREVENTION CODE, NEC 2017 AND ALL LOCAL CODES & ORDINANCES.

ROOF SHALL HAVE NO MORE THAN TWO LAYERS OF COVERING IN ADDITION TO THE SOLAR EQUIPMENT.

INSTALLATION OF SOLAR EQUIPMENT SHALL BE FLUSH MOUNTED, PARALLEL TO AND NO MORE THAN 6-INCHES ABOVE THE SURFACE OF THE ROOF.

ANY PLUMBING VENTS ARE NOT TO BE CUT OR COVERED FOR SOLAR EQUIPMENT INSTALLATION. ANY RELOCATION OR MODIFICATION OF THE VENT REQUIRES A PLUMBING PERMIT AND INSPECTION.

ALL DESIGN, CALCULATIONS ARE PERFORMED BY DANIEL DUNZIK REGISTERED ARCHITECT. FLORIDA STATE STATUTE 471.003(3) PROVIDES THAT LICENSED ARCHITECTS ARE EXEMPTED FROM THE PROVISIONS OF CHAPTER 471 ENGINEERING AND NOT PRECLUDED FROM PERFORMING ENGINEERING SERVICES FOR INTEGRATED SYSTEMS AND SERVICES THAT ARE INCIDENTAL TO BUILDINGS AND STRUCTURES.

INVERTER PLACEMENT:

SYSTEM UTILIZES "ENPHASE" MICRO-INVERTERS WITH RAPID SHUTDOWN CONTROL LOCATED ON THE BACK SIDE OF EACH MODULE.

STRUCTURAL STATEMENT:

THE EXISTING STRUCTURE IS ADEQUATE TO SUPPORT THE NEW LOADS IMPOSED BY THE PHOTOVOLTAIC MODULE SYSTEM INCLUDING UPLIFT & SHEAR.EXISTING RAFTER SIZES & DIMENSIONS CONFORM TO 7TH EDITION 2020 FLORIDA RESIDENTIAL CODE

MOUNTING BRACKETS AND HARDWARE MEET OR EXCEED FLORIDA CODE REQUIREMENTS FOR THE DESIGN CRITERIA OF THE TOWN.

FSEC CERTIFICATION STATEMENT:

PER FL. STATUE 377.705 , I, MINA A. MAKAR PE# 86753, CERTIFICATE OF AUTHORIZATION #33404, AN ENGINEER LICENSED PURSUANT TO CHAPTER 471,CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 2020

CLIMATIC & GEOGRAPHIC DESIGN CRITERIA TABLE R301.2(1)	
SPEED (MPH)	130
TOPOGRAPHIC EFFECTS	B
SPECIAL WIND REGION	NO
WIND BORNE DEBRIS ZONE	2
SEISMIC DESIGN CATEGORY	C
CLIMATE ZONE	2A
WIND EXPOSURE CATETORY	B

FBC, RESIDENTIAL 2020

TABLE R301.2.1.3

WIND SPEED CONVERSIONS[a]

V_{ult}	110	115	120	130	140	150	160	170	180	190	200
V_{asd}	85	89	93	101	108	116	124	132	139	147	155

For SI: 1 mile per hour = 0.447 m/s.

a. Linear interpolation is permitted.

momentum SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

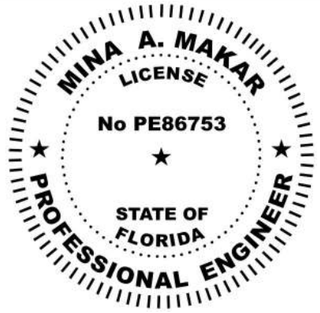

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2021.04.29 09:04:27 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

MJ JOWERS - MS76358
308 SW SPIRIT AVE
FT WHITE, FL 32038
3525626976

PV SYSTEM INFORMATION

SYSTEM SIZE (DC): 10.64 KW
28 MODULES: HANWHA Q.PEAK DUO BLK ML-G9+ 380
28 INVERTERS: ENPHASE IQ7PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 4/29/2021	DESIGNER: HK
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

COVER PAGE

PV-1

1. ALL WIND DESIGN CRITERIA ARE FOR LOW SLOPE ROOFS, GABLE AND HIP ROOFS CONSIDERED FROM AN ANGLE OF MIN. 9.5 ° ($\frac{2}{12}$) TO MAX. 45° ($\frac{12}{12}$) NOT TO EXCEED 30' MEAN ROOF HEIGHT ATTACHED WITH FASTENERS AS SPECIFIED BY THE MANUFACTURER.
2. SPAN TABLES ARE DERIVED FROM MECHANICAL LOAD TESTS PERFORMED BY THE MANUFACTURERS INDEPENDENT TESTING AGENCIES ON BEHALF OF THE MANUFACTURER.
3. ROOF SEALANTS SHALL CONFORM TO ASTMC920 AND ASTM 6511
4. ALL ATTACHMENTS SHALL BE INSTALLED IN STRICT COMPLIANCE WITH MANUFACTURERS PRINTED INSTRUCTIONS.

ATTACHMENT SPACING EXCEED MANUFACTURERS SPECIFICATIONS FOR WIND LOADS AS PER ASCE 07-10. RISK CATEGORY II TOPOGRAPHIC EFFECTS B,C, & D AND ROOF WIND ZONES 1,2,& 3. ROOF ZONES 2 & 3 ARE WITHIN 48" OF ANY OUTER EDGE, HIP, RIDGE, OR GUTTER LINE FOR STRUCTURES 30'- 0" OR LESS MEAN ROOF HEIGHT.

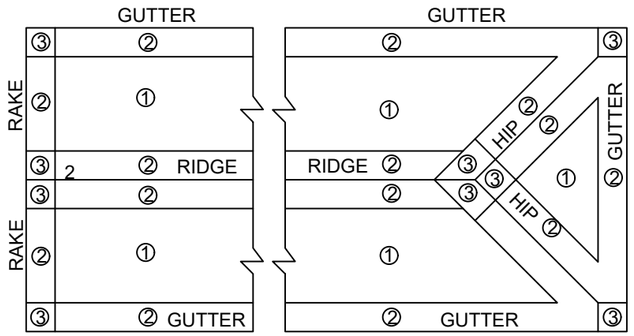

ROOF WIND ZONES AS PER IRC R301.2(7)
ROOF ZONES 2 & 3 ARE 48" FROM OUTER ROOF EDGES, RIDGES, HIPS, RAKES, AND GUTTER EDGES FOR STRUCTURES BELOW 30'-0" MEAN ROOF HT.

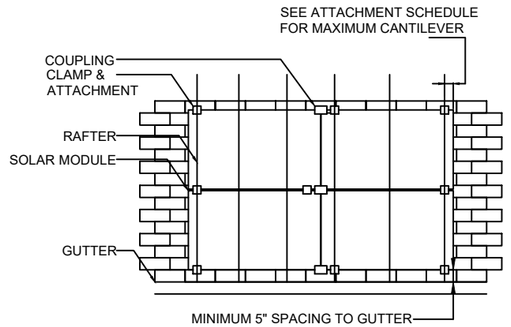

ECOFASTEN SOLAR ROCK-IT 4.0 MOUNTING DETAIL
ECOFASTEN SOLAR ROCK-IT 4.0 RAIL-LESS MOUNTING SYSTEM INTEGRATED WITH FLASHING, COUPLINGS AND ADJUSTABLE CLAMP ATTACHMENTS

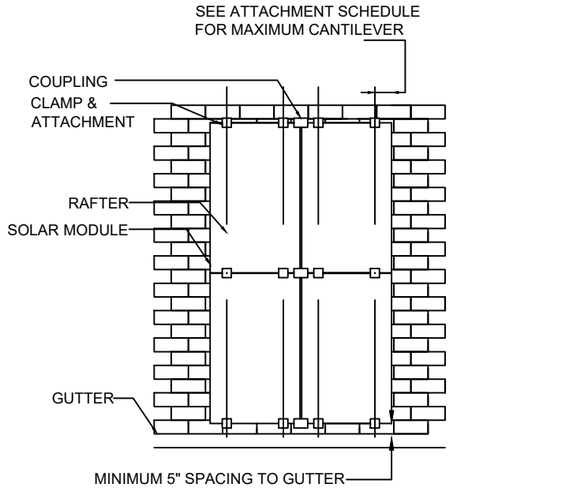

ECOFASTEN SOLAR ROCK-IT 4.0 MOUNTING DETAIL
ECOFASTEN SOLAR ROCK-IT 4.0 RAIL-LESS MOUNTING SYSTEM INTEGRATED WITH FLASHING, COUPLINGS AND ADJUSTABLE CLAMP ATTACHMENTS

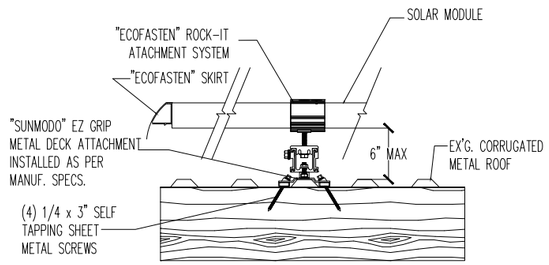

ALL COMPONENTS SHALL BE AS MANUFACTURED BY "ECOFASTEN SOLAR" AND INSTALLED IN STRICT COMPLIANCE WITH MANUFACTURERS PRINTED SPECIFICATIONS.

REVISIONS			
REV	DESCRIPTION	BY	DATE
A	INITIAL RELEASE	LWF	10/4/2018
B	ADD B15019-001	LWF	10/16/2018

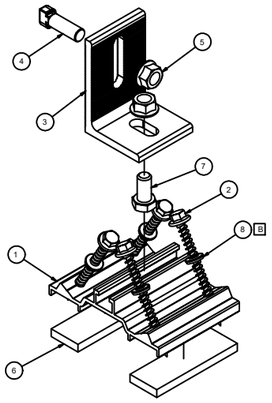

IN 1/2" PLYWOOD		
LOAD DIRECTION	FOS=2	FOS=3
UPLIFT	345	230
LATERAL PERP. TO SLOT	140	95
LATERAL PARALLEL TO SLOT	265	175
IN 7/16" OSB		
LOAD DIRECTION	FOS=2	FOS=3
UPLIFT	190	125
LATERAL PERP. TO SLOT	125	85
LATERAL PARALLEL TO SLOT	135	90

NOTES
* Factor of Safety as shown
* Torque at 3/8" T-Bolt = 15ft.lbs (20 N.m)
* All loads in pounds force
* Values valid only for conditons equal or better than test conditions
* Values valid only when product is used in accordance with SunModo installation instruction and other technical documentation
* The kit as shown in the BOM. For alternative configurations, contact SunModo
4 1/4" Deck Screws in Min 7/16" OSB

ITEM	PART NUMBER	DESCRIPTION	QTY
B	8	B15019-001	SEALING WASHER .26 ID X .50 X .125	4
	7	B15018-001	HEX CAP SCREW 3/8-16 X 3/4	1
	6	C50001-001	GASKET, EPDM, WITH ADHESIVE	2
	5	B15003-001	FLANGE NUT 3/8-16	2
	4	B20007-002	T-BOLT 3/8-16X1.0", 304 SS	1
	3	A20062-001	L FOOT	1
	2	B15039-001	HEX WASHER HEAD LAG BOLT 1/4X3	4
	1	A50224-001	METAL ROOF DECK MOUNT	1

MATERIAL: SEE NOTES
Third Angle Projection
GENERAL SPECIFICATIONS: DIMENSIONS: Inches [millimeters]
TOLERANCES: X ±0.125 [3.20mm] X.X ±0.02 [0.50mm] X.XX ±0.010 [0.25mm] Unless otherwise specified
Break all sharp edges Ø.005 min. unless otherwise specified
DRAWN BY: LWF
DATE: 10/16/2018
CHECKED BY
APPROVALS

SunModo Corp.
14800 NE 65TH STREET, VANCOUVER WA 98682

TITLE: METAL ROOF DECK MOUNT KIT
DRAWING NUMBER: B K50532-001 STRUCTURE
SCALE: NONE SHEET 1 of 1

THIS DRAWING IS CONFIDENTIAL PROPERTY OF SUNMODO AND ITS CONTENTS MAY NOT BE DISCLOSED WITHOUT THE PRIOR WRITTEN CONSENT OF SUNMODO CORP.

SUNMODO

EZ GRIP METAL DECK MOUNT



Make your next metal roof attachment without the daunting task of locating the truss. SunModo's EZ Grip Metal Deck Mount installs into 26 gauge sheet metal, 1/2 plywood or 7/16 OSB roof decking material.

SunModo's EZ Grip Metal Deck Mount installs in just minutes into sheet metal, plywood or OSB roof decking. The four included 1/4 x 3" Hex Washer Head Self-tapping Screws have the length to penetrate though 1-1/2 inches of insulation while still piercing completely through the roof decking. And since the four screws are guided by the aluminum extruded base to penetrate at a 30-degree angle, the Metal Roof Deck Mount Kit offers superior attachment performance. 1/4-20 Self-drilling screws can be used for attachments into 26 gauge minimum thickness metal roofs.

The EZ Grip Metal Deck Mount is designed to fit on the most popular R-Panel and U-Panel trapezoidal types of metal roofs. The aluminum extruded base easily clears roof profiles 7/16" tall by 1-1/2" wide. The EPDM gaskets on the washers and on the aluminum extruded base combine to provide a water tight seal at the roof penetration site.



Features and Benefits

- Attaches into 1/2 plywood or 7/16 OSB roof decking material using four 1/4 x 3" Hex Washer Head Self-tapping Screws
- Attaches into 26 gauge minimum thickness sheet metal using four 1/4 x 2" Hex Washer Head Self-drilling Screws
- Angled penetrations provide superior attachment performance
- A wide variety of L-feet and attachment options are available
- Passed the High-Velocity Hurricane Zone (HVHZ) –TAS 100(a) Wind-Driven Rain Test

SunModo Corp | Vancouver, WA | 360-844-0048
Document Number D10153-V003 | ©2019 – SunModo Corp.

momentum SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

MINA A. MAKAR
LICENSE
No PE86753
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar. Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2021.04.29 09:04:27 -05:00

SOLAR CONTRACTOR
CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION
MJ JOWERS - MS76358
308 SW SPIRIT AVE
FT WHITE, FL 32038
3525626976

PV SYSTEM INFORMATION
SYSTEM SIZE (DC): 10.64 KW
28 MODULES: HANWHA Q.PEAK DUO BLK ML-G9+ 380
28 INVERTERS: ENPHASE IQ7PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 4/29/2021	DESIGNER: HK
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

ATTACHMENT DETAIL

PV-1.1

SCALE: 1/16" = 1'-0"

ROOF	PANEL COUNT	TILT	AZIMUTH	SHADING	LANDSCAPE MAX SPAN (ROOF AREA 1/2/3)	PORTRAIT MAX SPAN (ROOF AREA 1/2/3)	LANDSCAPE MAX CANTILEVER	PORTRAIT MAX CANTILEVER
R1	8	20°	270°	81%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10
R2	4	20°	180°	79%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10
R3	5	18°	0°	78%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10
R4	5	20°	0°	87%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10
R5	6	20°	90°	76%	48 /32 /32	48 /32 /32	16 /10 /10	16 /10 /10

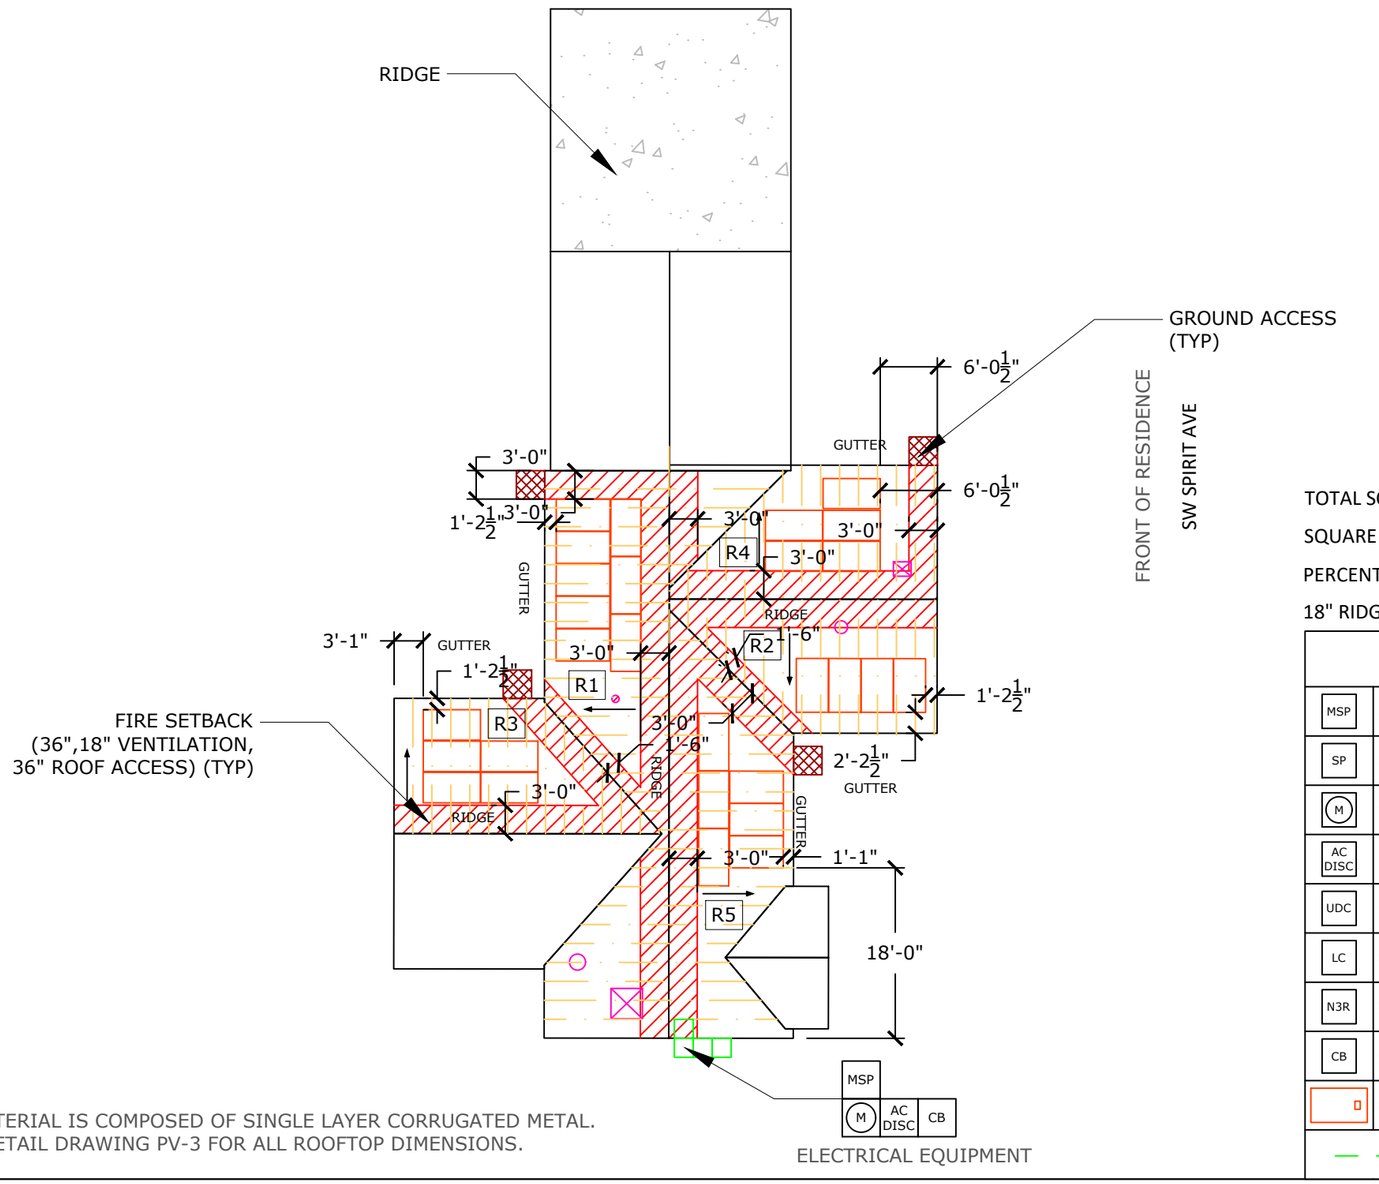

NOTE:
1. ROOF COVERING MATERIAL IS COMPOSED OF SINGLE LAYER CORRUGATED METAL.
2. REFER TO LAYOUT DETAIL DRAWING PV-3 FOR ALL ROOFTOP DIMENSIONS.

TOTAL SQUARE FOOTAGE OF ROOF: 3101 SQFT

SQUARE FOOTAGE OF SOLAR ARRAY:784 SQFT

PERCENTAGE OF SOLAR ROOF COVERAGE: 18.4%

18" RIDGE SETBACK SHALL BE REQUIRED

SYMBOL LEGEND

MSP	MAIN SERVICE PANEL		CHIMNEY
SP	SUB-PANEL		SKYLIGHT
M	UTILITY METER		VENT
AC DISC	AC DISCONNECT		PIPE VENT
UDC	UTILITY DISCONNECT		FAN
LC	LOAD CENTER		SATELLITE DISH
N3R	NEMA 3R BOX W/ ENVOY-S		FIRE SETBACKS
CB	COMBINER BOX		MIN 3'x3' GROUND ACCESS POINT
	MODULE		PITCH DIRECTION
			WIND PRESSURE ZONE LINES. REFER TO PV-2.2 FOR ADDITIONAL INFO

momentum SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

MINA A. MAKAR LICENSE No PE86753 STATE OF FLORIDA PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2021.04.29 09:04:27 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

MJ JOWERS - MS76358
308 SW SPIRIT AVE
FT WHITE, FL 32038
3525626976

PV SYSTEM INFORMATION

SYSTEM SIZE (DC): 10.64 KW
28 MODULES: HANWHA Q.PEAK DUO BLK ML-G9+ 380
28 INVERTERS: ENPHASE IQ7PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 4/29/2021	DESIGNER: HK
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

ROOF LAYOUT

PV-2

PV MODULE RATINGS	
MODULE MAKE	HANWHA
MODEL	Q.PEAK DUO BLK ML-G9+ 380
MAX POWER	380W
OPEN CIRCUIT VOLTAGE	45.04V
MPP VOLTAGE	37.85V
SHORT CIRCUIT CURRENT	10.5A
MPP CURRENT	10.04A
NUMBER OF MODULES	28
UL1703 COMPLIANT	YES

INVERTER RATINGS	
INVERTER MAKE	ENPHASE
MODEL	IQ7PLUS-72-2-US
MAX OUTPUT POWER	290W
OPEN DC VOLTAGE	60V
NOMINAL AC VOLTAGE	240V
MAX AC CURRENT	1.21A
CEC INVERTER EFFICIENCY	97%
NUMBER OF INVERTERS	28
UL1703 COMPLIANT	YES

VOLTAGE DROP CALCULATIONS

FORMULA USED PER NEC HANDBOOK 215.2(A)(4) WHERE APPLICABLE

WIRE RUN	V_{mp}	I_{mp}	R	L (FT)	V_o	% V_o	WIRE SIZE
BRANCH TO J-BOX	240.00	12.1	1.98	65.83	3.154	1.31%	12 AWG
J-BOX TO LOAD CENTER	240.00	33.88	1.24	50.00	4.201	1.75%	10 AWG
LOAD CENTER TO AC DISCONNECT	240.00	42.35	0.778	3.00	0.198	0.08%	08 AWG
AC DISCONNECT TO INTERCONNECTION	240.00	42.35	0.491	10.00	0.416	0.17%	06 AWG

SUB PANEL BREAKER SIZE	# OF MODULES	PV BREAKER PER BRANCH
	UP TO 16	20A

THIS SOLAR PHOTOVOLTAIC SYSTEM COMPLIES WITH THE 2020 FLORIDA BUILDING CODE AND THE 2017 NATIONAL ELECTRICAL CODE

28 HANWHA Q.PEAK DUO BLK ML-G9+ 380 380W MODULES PAIRED WITH

28 ENPHASE IQ7PLUS-72-2-US MICRO-INVERTERS

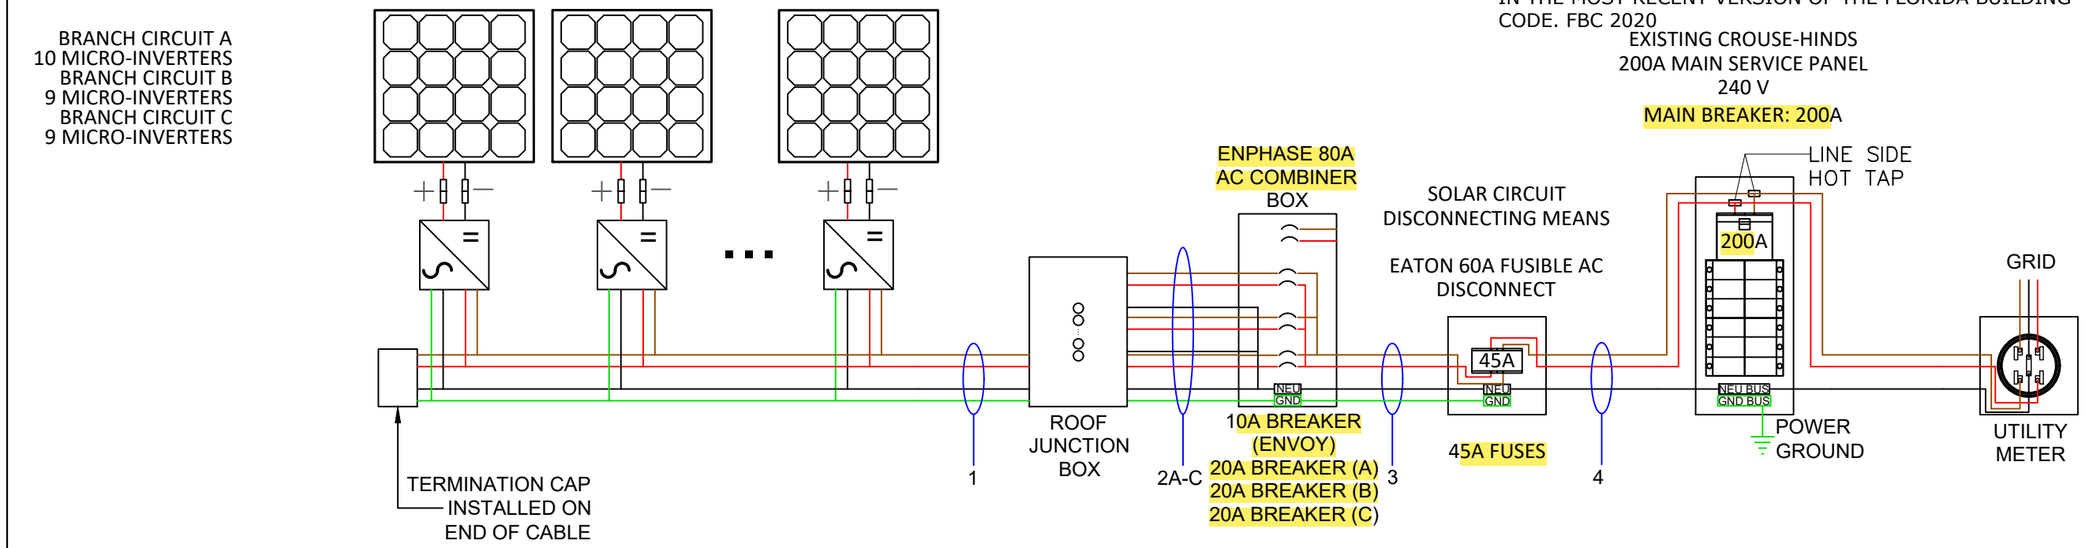

FSEC CERTIFICATION STATEMENT:

PER FL. STATUE 377.705 , I, MINA A. MAKAR PE# 86753, CERTIFICATE OF AUTHORIZATION #33404, AN ENGINEER LICENSED PURSUANT TO CHAPTER 471,CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 2020

Wire Tag	Conduit	Wire Qty	Wire Gauge	Wire Type	Temp. Rating	Wire Ampacity (A)	Temp. Derate	Conduit Fill Derate	Derated Ampacity (A)	Inverter Qty	NOC (A)	NEC Correction	Design Current (A)	Ground Size	Ground Wire Type
1	OPEN AIR	3	12 AWG	Trunk Cable	90°C	30	0.96	1	28.80	10	1.21	1.25	15.13	12 AWG	Trunk Cable
2A	1" PVC	2	10 AWG	THWN-2	75°C	35	0.96	0.8	26.88	10	1.21	1.25	15.13	08 AWG	THWN-2
2B	1" PVC	2	10 AWG	THWN-2	75°C	35	0.96	0.8	26.88	9	1.21	1.25	13.61	08 AWG	THWN-2
2C	1" PVC	2	10 AWG	THWN-2	75°C	35	0.96	0.8	26.88	9	1.21	1.25	13.61	08 AWG	THWN-2
3	1" PVC	3 + G	08 AWG	THWN-2	75°C	50	0.96	1	48.00	28	1.21	1.25	42.35	08 AWG	THWN-2
4	1" PVC	3	06 AWG	THWN-2	75°C	65	0.96	1	62.40	28	1.21	1.25	42.35		THWN-2

NOTE: LETTER "G" IN WIRE QTY TAB STANDS FOR GROUNDING CONDUCTOR.

momentum SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

MINA A. MAKAR LICENSE No PE86753 STATE OF FLORIDA PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2021.04.29 09:04:27 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

MJ JOWERS - MS76358
308 SW SPIRIT AVE
FT WHITE, FL 32038
3525626976

PV SYSTEM INFORMATION

SYSTEM SIZE (DC): 10.64 KW
28 MODULES: HANWHA Q.PEAK DUO BLK ML-G9+ 380
28 INVERTERS: ENPHASE IQ7PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 4/29/2021	DESIGNER: HK
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

THREE LINE DIAGRAM

PV-3

ELECTRICAL NOTES:

1. ALL CALCULATIONS FOR VOC, VMAX, IMP AND ISC HAVE BEEN CALCULATED USING THE MANUFACTURED STRING CALCULATOR BASED ON ASHRAE 2% HIGH AND EXTREME MINIMUM TEMPERATURE COEFFICIENTS.
2. THE ENTIRE ARRAY IS BONDED ACCORDING TO (NEC 690.46 - 250.120 PARAGRAPH C). THE GROUND IS CARRIED AWAY FROM THE GROUNDING LUG USING #6 BARE COPPER WIRE OR #8 THWN-2 COPPER WIRE.
3. THIS SYSTEM COMPLIES WITH NEC 2017
4. BRANCH CIRCUIT CALCULATION FOR WIRE TAG 1 DISPLAYS THE LARGEST BRANCH CIRCUIT IN SYSTEM. OTHER BRANCH CIRCUITS SHALL HAVE LOWER DESIGN CURRENT THAN THE ONE SHOWN. IN ADDITION, VOLTAGE DROP CALCULATIONS FROM PANELS TO THE COMBINER BOX SHALL BE SHOWN IN A SIMILAR FASHION
5. ALL CONDUCTORS ARE SIZED BASED ON NEC 2017 ARTICLE 310
6. ALL EQUIPMENT INSTALLED IS RATED AT 75°C
7. INVERTER NOC (NOMINAL OPEN CURRENT) OBTAINED FROM EQUIPMENT DATASHEET
8. CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH ALL LOCAL AND NATIONAL CODE REQUIREMENTS.
9. EACH MODULE MUST BE GROUNDED ACCORDING TO USER INSTRUCTIONS
10. ALL EQUIPMENT SHALL BE LISTED PER NEC 690.4(B)
11. PER NEC 690.13, 690.15, PROVIDE A WARNING SIGN AT ALL LOCATIONS WHERE TERMINALS OF THE DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION> SIGN SHALL READ *WARNING - ELECTRIC SHOCK HAZARD - DO NOT TOUCH TERMINALS - OR EQUIVALENT.
12. PER NEC 705.10, PROVIDE A PERMANENT PLAQUE OR DIRECTORY SHOWING ALL ELECTRIC POWER SOURCES ON THE PREMISES AT SERVICE ENTRANCE.
13. INTERCONNECTION METHOD SHALL COMPLY WITH NEC 705.12
14. AND OPTION FOR A SINGLE CIRCUIT BRANCH TO BE SPLIT INTO TWO SUB-CIRCUIT BRANCHES IS ACCEPTABLE.
15. ALL CONDUCTORS MUST BE COPPER.
16. NEUTRAL AND EQUIPMENT GROUNDING CONDUCTOR BONDED AS PER NEC 250.24(C).
17. EQUIPMENT GROUNDING CONDUCTOR IS CONNECTED TO A GROUNDING ELECTRODE SYSTEM PER 250.54(D).
18. FUSES FOR PV DISCONNECT HAVE AIC RATINGS OF 200KA AC AND 20KA DC.
19. SUPPLY SIDE CONNECTION SHALL BE MADE USING ILSCO INSULATION PIERCING CONNECTORS (IPC). MAKE, MODEL, AND RATING OF INTERCONNECTION CAN BE SEEN ON TABLE 1 BELOW.
20. METHOD OF INTERCONNECTION CAN BE SEEN IN FIGURE 1.
21. UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
22. WORKING CLEARANCES AROUND THE EXISTING AND NEW ELECTRICAL EQUIPMENT WILL BE MAINTAINED IN ACCORDANCE WITH NEC ARTICLE 110.26.
23. CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C)(1) AND ARTICLE 310.8 (D).
24. CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).
25. TOTAL AREA OF ALL CONDUCTORS, SPLICES, AND TAPS INSTALLED AT ANY CROSS SECTION OF THE WIRING DOES NOT EXCEED 75% OF THE CROSS SECTIONAL AREA OF THE SPACE. NEC 312.8(A)(2).
26. SYSTEM IS CONSIDERED AN AC MODULE SYSTEM. NO DC CONDUCTORS ARE PRESENT IN CONDUIT, COMBINER, JUNCTION BOX, DISCONNECT. AND COMPLIES WITH 690.6 - NO DC DISCONNECT AND ASSOCIATED DC LABELING ARE REQUIRED.
27. SYSTEM COMPLIES WITH 690.12 RAPID SHUTDOWN AND ASSOCIATED LABELING AS PER 690.56(C). AC VOLTAGE AND SYSTEM OPERATING CURRENT SHALL BE PROVIDED 690.52.
28. CONDUCTORS IN CONDUIT ARE AC CONDUCTORS BRANCH CIRCUITS AND NOT PV SOURCE CIRCUITS. 690.6.
29. ALL GROUNDING SHALL COMPLY WITH 690.47(A) IN THAT THE AC MODULES WILL COMPLY WITH 250.64.
30. NO TERMINALS SHALL BE ENERGIZED IN THE OPEN POSITION IN THIS AC MODULE SYSTEM 690.13, 690.15, 690.6.
31. WHERE APPLICABLE: INTERCONNECTION SHALL COMPLY WITH 705.12(A) OR 705.12(B)
32. ALL WARNING SIGN(S) OR LABEL(S) SHALL COMPLY WITH 2017 NEC ARTICLE 110.21(B). LABEL WARNINGS SHALL ADEQUATELY WARN OF THE HAZARD. LABELS SHALL BE PERMANENTLY AFFIXED TO THE EQUIPMENT, AND LABELS REQUIRED SHALL BE SUITABLE FOR THE ENVIRONMENT.
33. PV POWER CIRCUIT LABELS SHALL APPEAR ON EVERY SECTION OF THE WIRING SYSTEM THAT IS SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS.

TABLE 1:

MAKE	MODEL	VOLTAGE RATING	CONDUCTOR RANGE MAIN	CONDUCTOR RANGE TAP
ILSCO	IPC 4006	600 V	4/0-4 AWG	6-14 AWG
ILSCO	IPC 4020	600 V	4/0-2 AWG	2/0-6 AWG

INSTRUCTIONS FOR LINE TAPS

FIGURE 1:

1. ADJUST THE CONNECTOR NUT TO SUITABLE LOCATION
2. PUT THE BRANCH WIRE INTO THE CAP SHEATH FULLY
3. INSERT THE MAIN WIRE, IF THERE ARE TWO LAYS OF INSULATED LAY IN THE MAIN CABLE, SHOULD STRIP A CERTAIN LENGTH OF THE FIRST INSULATED LAY FROM INSERTED END
4. TURN THE NUT BY HAND, AND FIX THE CONNECTOR IN SUITABLE LOCATION.
5. SCREW THE NUT WITH THE SLEEVE SPANNER.
6. SCREW THE NUT CONTINUALLY UNTIL THE TOP PART IS CRACKED AND DROPPED DOWN

momentum SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

MINA A. MAKAR LICENSE No PE86753 STATE OF FLORIDA PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2021.04.29 09:04:27 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

MJ JOWERS - MS76358
308 SW SPIRIT AVE
FT WHITE, FL 32038
3525626976

PV SYSTEM INFORMATION

SYSTEM SIZE (DC): 10.64 KW
28 MODULES: HANWHA Q.PEAK DUO BLK ML-G9+ 380
28 INVERTERS: ENPHASE IQ7PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 4/29/2021	DESIGNER: HK
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

ELECTRICAL CONT.

PV-3.1

ALL WARNING SIGN(S) OR LABEL(S) SHALL COMPLY WITH NEC ARTICLE 110.21(B). LABEL WARNINGS SHALL ADEQUATELY WARN OF THE HAZARD. LABELS SHALL BE PERMANENTLY AFFIXED TO THE EQUIPMENT, AND LABELS REQUIRED SHALL BE SUITABLE FOR THE ENVIRONMENT.

TAG	LABEL	QUANTITY	LOCATION	NOTE
Ⓐ	**CAUTION** AC SOLAR VOLTAGE	12	AC CONDUITS	1 AT EVERY SEPARATION BY ENCLOSURES / WALLS / PARTITIONS / CEILINGS / FLOORS OR NO MORE THAN 10'
Ⓑ	WARNING: PHOTOVOLTAIC POWER SOURCE PHOTOVOLTAIC SYSTEM EQUIPPED WITH RAPID SHUTDOWN	1	COMBINER BOX	1 AT ANY COMBINER BOX
Ⓒ	**WARNING** ELECTRICAL SHOCK HAZARD TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION	1	JUNCTION BOX	1 AT ANY JUNCTION BOX
Ⓓ Ⓔ	PHOTOVOLTAIC SYSTEM AC DISCONNECT RATED AC OUTPUT CURRENT A NOMINAL OPERATING AC VOLTAGE 240 V **WARNING** ELECTRICAL SHOCK HAZARD TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION **CAUTION** POWER TO THIS SERVICE IS ALSO SUPPLIED FROM ON-SITE SOLAR GENERATION AC SYSTEM DISCONNECT RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM PHOTOVOLTAIC SYSTEM INSTALLED BY MOMENTUM SOLAR 3096 B HAMILTON BLVD S. PLAINFIELD, NJ 07080 PHONE NUMBER:732-902-6224	1	AC DISCONNECT (RSD SWITCH)	1 OF EACH AT FUSED AC DISCONNECT COMPLETE VOLTAGE AND CURRENT VALUES ON DISCONNECT LABEL
Ⓕ	**WARNING** DUAL POWER SUPPLY SECOND SOURCE IS PHOTOVOLTAIC SYSTEM REVENUE METER	1	UTILITY METER	1 AT UTILITY METER AND ONE DIRECTORY PLACARD
Ⓖ	SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUTDOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN ARRAY **WARNING** DUAL POWER SUPPLY SECOND SOURCE IS PHOTOVOLTAIC SYSTEM	1	INTERCONNECTION POINT	1 OF EACH AT BUILDING INTERCONNECTION POINT AND ONE DIRECTORY PLACARD
	WARNING POWER SOURCE OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE	1	BACKFEED PANEL	
Ⓗ	NOMINAL OPERATING AC VOLTAGE : 240V NOMINAL OPERATING AC FREQUENCY : 60HZ MAXIMUM AC POWER : VA MAXIMUM AC CURRENT : A MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION : 20A	1	AC CURRENT PV MODULES	

EXAMPLES

Ⓐ

Ⓑ

Ⓒ

Ⓓ

Ⓕ

Ⓖ BACKFEED

momentum SOLAR

PRO CUSTOM SOLAR LLC D.B.A. MOMENTUM SOLAR
325 HIGH STREET, METUCHEN, NJ 08840
(732) 902-6224
MOMENTUMSOLAR.COM

PROFESSIONAL ENGINEERING

MINA A. MAKAR
LICENSE
No PE86753
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Digitally signed by Mina A Makar.
Reason : This item has been electronically signed and sealed by [Mina A. Makar, PE 86753, COA # 33404] on the Date and Time Stamp shown using a digital signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies
Date: 2021.04.29 09:04:27 -05:00

SOLAR CONTRACTOR

CAMERON CHRISTENSEN
CERTIFIED SOLAR CONTRACTOR LICENSE NUMBER: CVC57036
MOMENTUM SOLAR
5728 MAJOR BLVD. SUITE 307, ORLANDO FL. 32819

CUSTOMER INFORMATION

MJ JOWERS - MS76358
308 SW SPIRIT AVE
FT WHITE, FL 32038
3525626976

PV SYSTEM INFORMATION

SYSTEM SIZE (DC): 10.64 KW
28 MODULES: HANWHA Q.PEAK DUO BLK ML-G9+ 380
28 INVERTERS: ENPHASE IQ7PLUS-72-2-US

PROJECT INFORMATION

INITIAL	DATE: 4/29/2021	DESIGNER: HK
REV:	DATE:	DESIGNER:
REV:	DATE:	DESIGNER:

EQUIPMENT LABELS

PV-3.2