



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 6252885 -

MiTek, Inc.

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: Strait Line Construction Project Name: 6252885 Model: Schockley
Lot/Block: . Subdivision: .
Address: 631 W Unity Court, .
City: Fort White State: Florida

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.8
Wind Code: ASCE 7-22 Wind Speed: 140 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 3 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date
1	T40188846	T01	2/19/26
2	T40188847	T02	2/19/26
3	T40188848	T03	2/19/26




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Tibbetts Lumber Co., LLC.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2027.


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

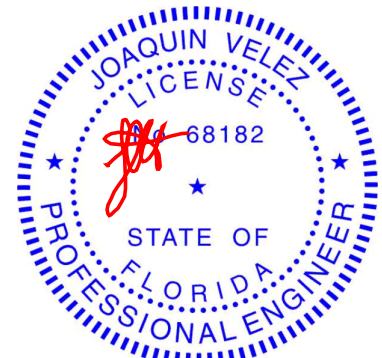

Joaquin Velez PE No. 68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

February 19, 2026


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, Run: 8.83 S Jan 22 2026 Print: 8.830 S Jan 22 2026 MiTek Industries, Inc. Thu Feb 19 04:51:18 Page: 1
ID:o3qE654j8y4?XBx99I0iyMyEfZZ-RfC?PsB70Hg3NSaPanL8w3uITxbGKWCrD0i7J4zJC?f



LUMBER		2) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=30ft; B=55ft; L=36ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -1-1-0 to 2-6-3, Zone1 2-6-3 to 12-0-0, Zone2 12-0-0 to 17-1-2, Zone1 17-1-2 to 25-1-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
TOP CHORD	2x4 SP No.2	
BOT CHORD	2x4 SP No.2	
WEBS	2x4 SP No.2	
OTHERS	2x4 SP No.2	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 2-8-6 oc purlins.	
BOT CHORD	Rigid ceiling directly applied or 6-11-12 oc bracing.	
JOINTS	1 Brace at Jt(s): 15, 16	3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
REACTIONS	(size) 2=0-5-8, 10=0-5-8 Max Horiz 2=-111 (LC 10) Max Uplift 2=-222 (LC 12), 10=-222 (LC 12) Max Grav 2=942 (LC 1), 10=942 (LC 1)	4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
FORCES	(lb) - Maximum Compression/Maximum Tension	5) Gable studs spaced at 2-0-0 oc.
TOP CHORD	1-2=0/30, 2-4=-3377/800, 4-5=-2338/507, 5-6=-2307/537, 6-7=-2306/528, 7-8=-2338/491, 8-10=-3377/814, 10-11=0/30	6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
BOT CHORD	2-14=-678/3148, 13-14=-683/3158, 12-13=-709/3158, 10-12=-703/3148	7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
WEBS	6-13=-319/1770, 13-16=-1012/392, 8-16=-1015/394, 8-12=0/212, 4-15=-1015/395, 13-15=-1012/394, 4-14=0/212, 5-15=-144/87, 7-16=-144/87	8) Bearing at joint(s) 2, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
		9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 222 lb uplift at joint

NOTES

1) Unbalanced roof live loads have been considered for this design.

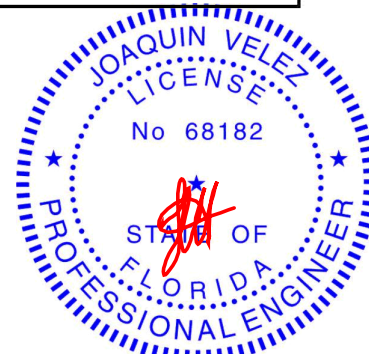

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

February 19, 2026



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DS-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek[®]
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	
6252885	T02	Scissor	21	1	T40188847
Job Reference (optional)					

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

Run: 8.83 S Jan 22 2026 Print: 8.830 S Jan 22 2026 MiTek Industries, Inc. Thu Feb 19 04:51:19

Page: 1

ID:WkpaZCToKPXHnO9uiigptWyEfeD-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?i

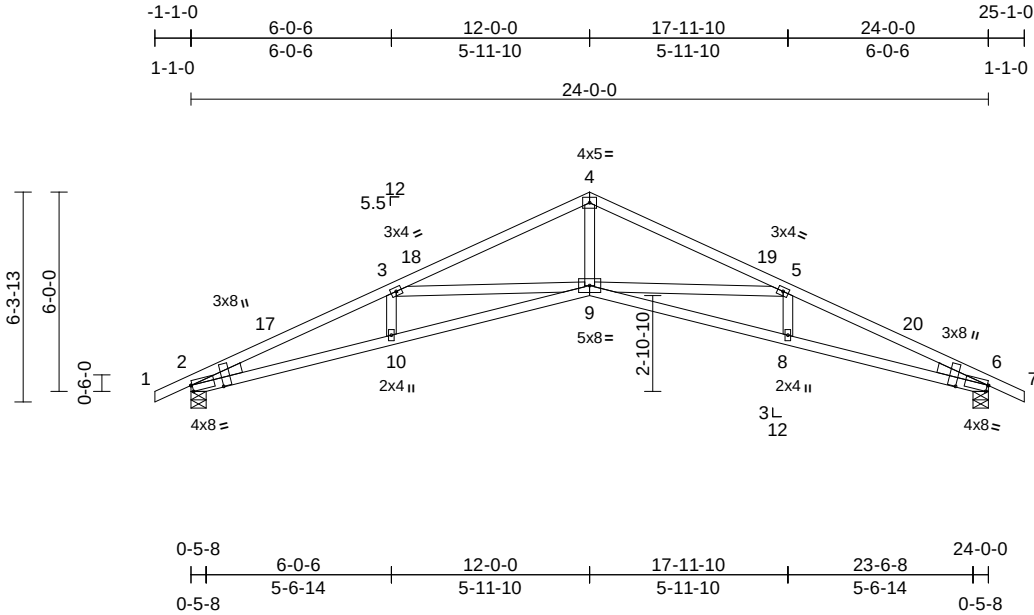

Scale = 1:69.4

Plate Offsets (X, Y): [2:0-0-7,Edge], [2:0-3-3,0-11-7], [6:0-0-7,Edge], [6:0-3-3,0-11-7]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.67	Vert(LL)	-0.25	8-9	>999	360	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.95	Vert(CT)	-0.50	9-10	>574	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.31	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS		Wind(LL)	0.20	8-9	>999	240	Weight: 109 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
WEDGE	Left: 2x4 SP No.2 Right: 2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 2-10-9 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS

(size)	2=0-5-8, 6=0-5-8
Max Horiz	2=117 (LC 11)
Max Uplift	2=-216 (LC 12), 6=-216 (LC 12)
Max Grav	2=947 (LC 1), 6=947 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/24, 2-3=-2863/688, 3-4=-2208/509, 4-5=-2208/490, 5-6=-2863/703, 6-7=0/24
BOT CHORD	2-10=-550/2622, 9-10=-560/2642, 8-9=-591/2642, 6-8=-580/2622
WEBS	4-9=-214/1443, 5-9=-697/301, 5-8=0/178, 3-9=-697/304, 3-10=0/178

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=30ft; B=55ft; L=36ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 -1-1-0 to 2-6-3, Zone1 2-6-3 to 12-0-0, Zone2 12-0-0 to 17-1-2, Zone1 17-1-2 to 25-1-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.


- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 2, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 216 lb uplift at joint 2 and 216 lb uplift at joint 6.

LOAD CASE(S) Standard

REVIEWED
For Code Compliance in accordance with Section 553.791, F.S.

Reviewer: **Mike Tripp**
Michael S. Tripp
PX3645, RPX360
Date: 2/23/2026

Qualifier: **Spencer Moore**
Spencer Moore
PE 99007
Date: 2/23/2026

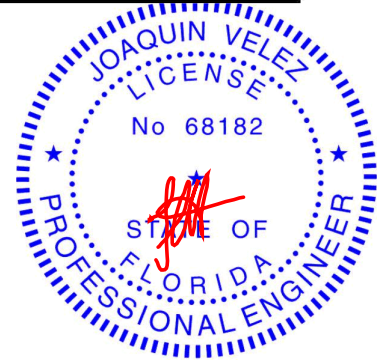

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

February 19,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	T40188848
6252885	T03	Attic	4	1	Job Reference (optional)

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

Run: 8.83 S Jan 22 2026 Print: 8.830 S Jan 22 2026 MiTek Industries, Inc. Thu Feb 19 04:51:19
ID:WkpaZCToKPXHnO9uiigptWyEfeD-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?I

Page: 1

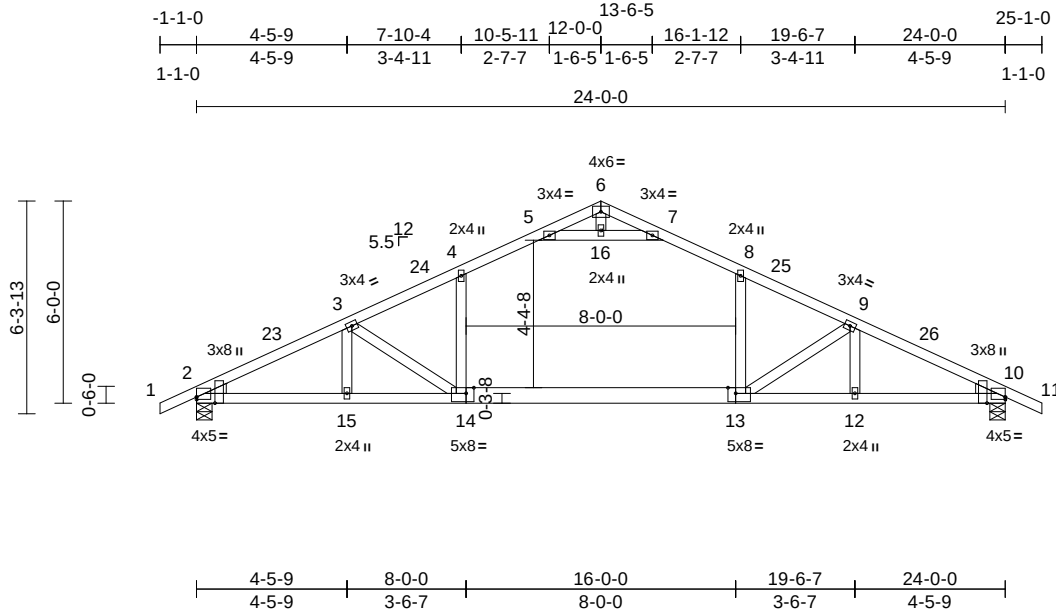

Scale = 1:68.4

Plate Offsets (X, Y): [2:Edge,0-0-13], [2:0-2-2,Edge], [10:Edge,0-0-13], [10:0-2-2,Edge], [13:0-2-12,Edge], [14:0-2-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.95	Vert(LL)	-0.35	13-14	>812	360	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.56	Vert(CT)	-0.61	13-14	>475	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.19	Horz(CT)	0.04	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS		Wind(LL)	0.14	13-14	>999	240	Weight: 121 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP M 31 or 2x4 SP SS
BOT CHORD 2x4 SP M 31 or 2x4 SP SS *Except*
13-14:2x6 SP DSS
WEBS 2x4 SP No.2
WEDGE Left: 2x4 SP No.2
Right: 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
3-0-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (size) 2=0-5-8, 10=0-5-8
Max Horiz 2=117 (LC 11)
Max Uplift 2=67 (LC 12), 10=67 (LC 12)
Max Grav 2=1273 (LC 18), 10=1273 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum
Tension
TOP CHORD 1-2=0/24, 2-3=-2396/110, 3-4=-2155/56,
4-5=-1843/80, 5-6=-43/656, 6-7=-43/656,
7-8=-1843/80, 8-9=-2155/56,
9-10=-2397/110, 10-11=0/24
BOT CHORD 2-15=-25/2236, 12-15=-41/2236,
10-12=-41/2148
WEBS 8-13=0/666, 4-14=0/666, 5-16=-2621/157,
7-16=-2621/157, 6-16=0/131, 3-15=-140/107,
9-12=-140/107, 3-14=-504/174,
9-13=-504/174

NOTES

1) Unbalanced roof live loads have been considered for
this design.

- Wind: ASCE 7-22; Vult=140mph (3-second gust)
Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=30ft;
B=55ft; L=36ft; eave=5ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-1-0 to 2-6-3,
Zone1 2-6-3 to 12-0-0, Zone2 12-0-0 to 17-1-2, Zone1
17-1-2 to 25-1-0 zone; cantilever left and right
exposed ;C-C for members and forces & MWFRS for
reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8,
5-16, 7-16
- Bottom chord live load (40.0 psf) and additional bottom
chord dead load (5.0 psf) applied only to room. 13-14
- Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 67 lb uplift at joint
2 and 67 lb uplift at joint 10.
- Load case(s) 1 has/have been modified. Building
designer must review loads to verify that they are correct
for the intended use of this truss.
- Hanger(s) or other connection device(s) shall be
provided sufficient to support concentrated load(s) 75 lb
down at 10-0-0, and 75 lb down at 14-0-0 on top chord.
The design/selection of such connection device(s) is the
responsibility of others.
- Attic room checked for L/360 deflection.
- In the LOAD CASE(S) section, loads applied to the face
of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard


- Dead + Roof Live (balanced): Lumber Increase=1.25,
Plate Increase=1.25

Uniform Loads (lb/ft)

Vert: 1-4=-54, 4-5=-74, 5-6=-54, 6-7=-54, 7-8=-74,
8-11=-54, 14-17=-20, 13-14=-30, 13-20=-20,
5-16=-20, 7-16=-20

Concentrated Loads (lb)

Vert: 5=-75 (F), 7=-75 (F)

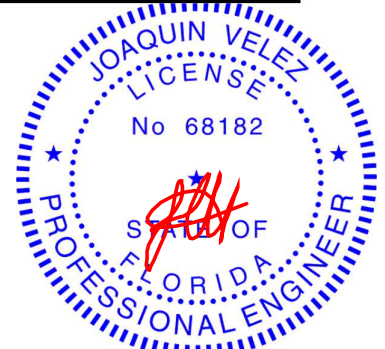

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

February 19,2026

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

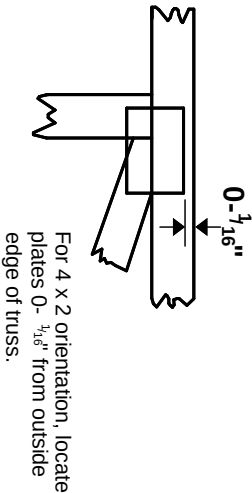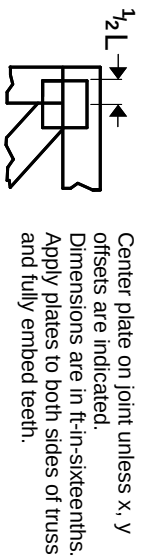

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

PLATE SIZE


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

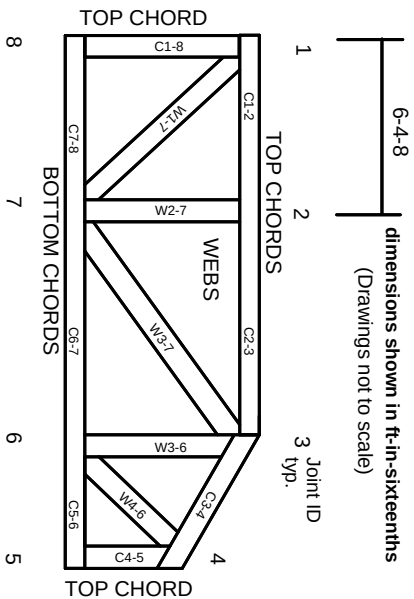

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TPI 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek®

Mitek Engineering Reference Sheet: MII-7473 rev. 1/12/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

- Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
- Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
- Never exceed the design loading shown and never stack materials on inadequately braced trusses.
- Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
- Cut members to bear tightly against each other.
- Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
- Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
- Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
- Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
- Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
- Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
- Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
- Top chords must be sheathed or purlins provided at spacing indicated on design.
- Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- Connections not shown are the responsibility of others.
- Do not cut or alter truss member or plate without prior approval of an engineer.
- Install and load vertically unless indicated otherwise.
- Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
- Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
- Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
- The design does not take into account any dynamic or other loads other than those expressly stated.

My Amelia Inc DBA
Inspected.com

REVIEWED
For Code Compliance
in accordance with
Section 553.791, F.S.

Reviewer: Mike Tripp
Michael S. Tripp
PX3645, RPX360

Qualifier: Spencer Moore
PE 99007

Date: 2/23/2026

Date: 2/23/2026