

Autodesk Docs\\C09414.003 - FFL
Columbia Warehouses
Building/C09414003_A_FFL-B_2023_CENTRAL.rvt
3/30/2026 3:29:25 PM

E

DESCRIPTION OF WORK	
THE PROJECT IS FOR BUILDING E FOR THE FLORIDA POWER AND LIGHT AT THE COLUMBIA STORM PROCESSING FACILITY. THE NEW ISC STORES WAREHOUSE (BUILDING E) IS FOR THE STORAGE AND DISTRIBUTION OF MATERIAL USED FOR FFL. THE BUILDING IS A ONE STORY BUILDING WITH MEZZANINE IT'S A TYPE IIB CONSTRUCTION, SPRINKLERED. CONCRETE TILT WALL, STEEL FRAME CONSTRUCTION ROOF NON-COMBUSTIBLE MATERIALS.	

D

BUILDING DATA	
A. OCCUPANCY TYPE	STORAGE, GROUP S-1, MIXED USE, NON-SEPARATE
B. CONSTRUCTION TYPE	TYPE IIB
C. AUTOMATIC SPRINKLER	YES
D. BUILDING AREA	GROUND FLOOR: 13,019 SF MEZZANINE: 900 SF TOTAL: 13,919 SF
E. BUILDING HEIGHT	25 FEET (1-STORY)
F. OCCUPANT LOAD:	SEE SHEET e-LS101
FOR MORE INFORMATION SEE SHEETS:	
CODE SUMMARY	e-LS100
FLOOR PLAN-LIFE SAFETY	e-LS101

C

VICINITY MAP	
	

B

LOCATION MAP	
	


A

ENGINEERS & CONSULTANTS			
OWNER / DEVELOPER FLORIDA POWER & LIGHT 700 UNIVERSE BLVD., MS. B2B/UB JUNO BEACH, FL 33408 561-339-5349 JOEL JONES Joel.Jones@fpl.com	STRUCTURAL ENGINEER JEZERINAC GROUP 480 HIBISCUS STREET SUITE 107 WEST PALM BEACH, FL 33401 561-323-7426 ANDY TOMICZEK atomick@jezerinacgroup.com WWW.JEZERINACGROUP.COM	ARCHITECT/ MECHANICAL / ELECTRICAL / PLUMBING BRPH 5700 NORTH HARBOR BOULEVARD SUITE 400 MELBOURNE, FL 32940 321-751-3125 THOMAS WOOD twood@brph.com WWW.BRPH.COM	FIRE PROTECTION BOWMAN FIRE & LIFE SAFETY, INC. 10475 MEDLOCK BRIDGE ROAD SUITE 520 JOHNS CREEK, GA 30097 770-495-7770 JEREMY JOHN jeremy.john@bowman.com www.bowman.com

FLORIDA POWER AND LIGHT COMPANY

COLUMBIA STORM PROCESSING FACILITY ISC STORES/PGD WAREHOUSE

COLUMBIA COUNTY, FLORIDA

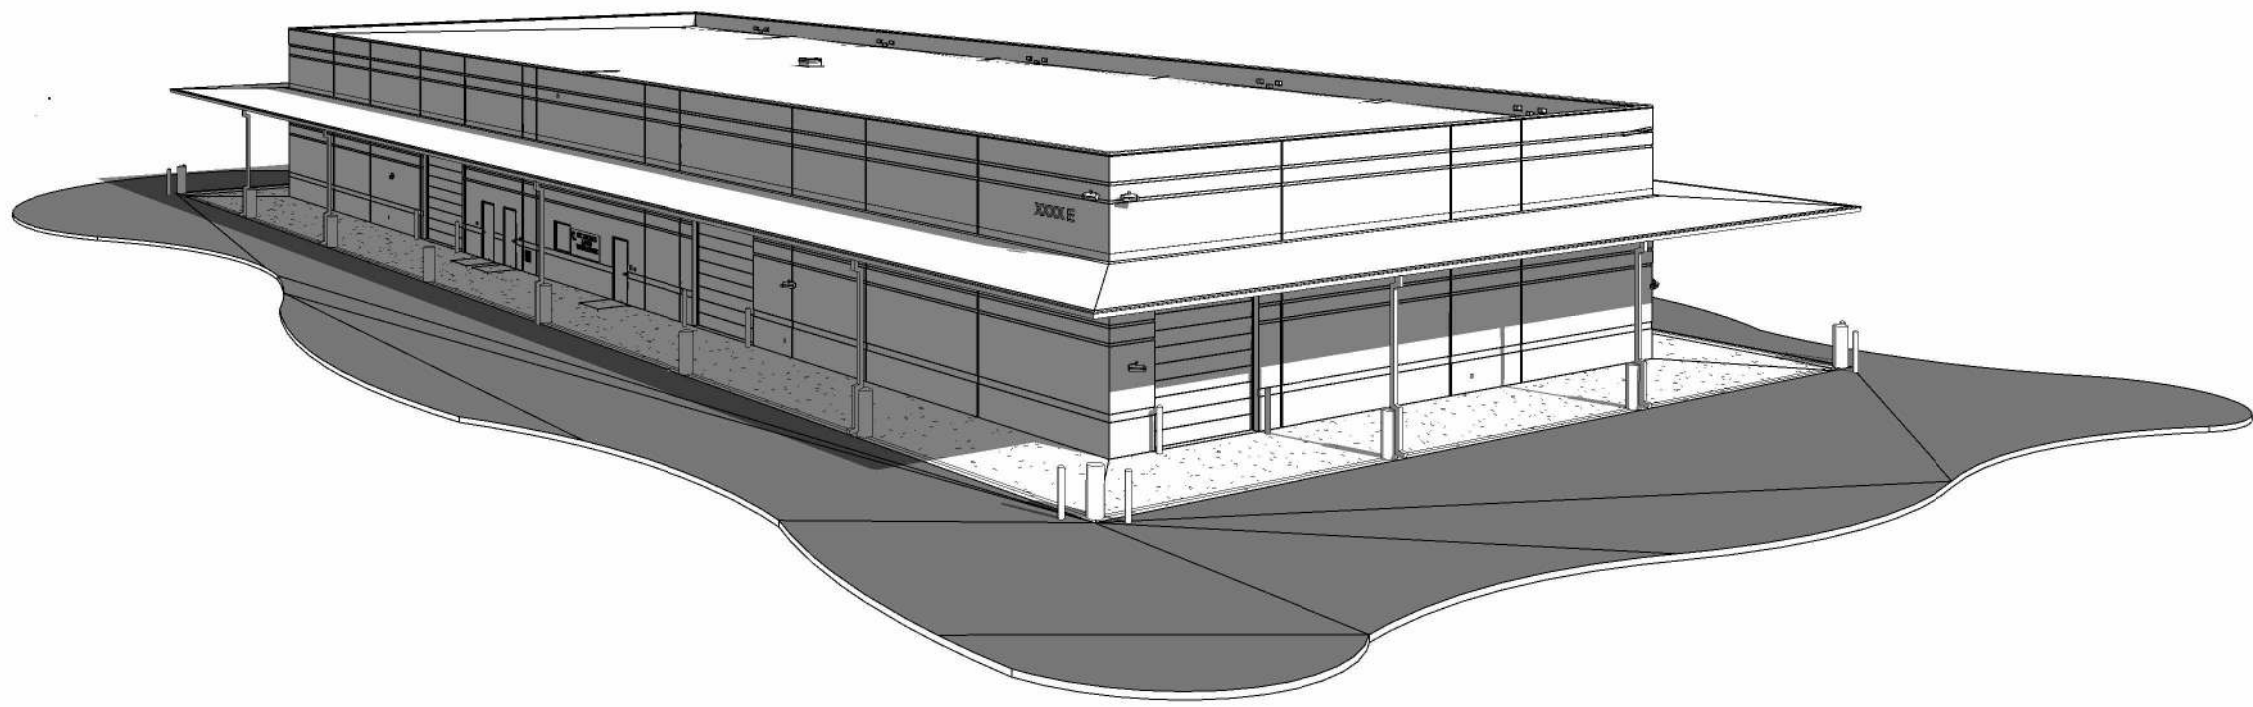

PERSPECTIVE

GENERAL DRAWING INDEX											
SHEET NUMBER	SHEET NAME										
e-G001	COVER SHEET					■					
e-G002	ABBREVIATIONS, SYMBOLS, GENERAL NOTES					■					
LIFE SAFETY DRAWING INDEX											
e-LS100	CODE SUMMARY					■					
e-LS101	FIRST FLOOR PLAN - LIFE SAFETY					■					
e-LS102	MEZZANINE FLOOR PLAN - LIFE SAFETY					■					
STRUCTURAL DRAWING INDEX											
e-S001	GENERAL NOTES					■					
e-S002	GENERAL NOTES					■					
e-S003	GENERAL SCHEDULES					■					
e-S004	SPECIAL INSPECTION PLAN					■					
e-S101	FOUNDATION PLAN					■					
e-S201	MEZZANINE FRAMING PLAN					■					
e-S202	ROOF FRAMING PLAN					■					
e-S301	FOUNDATION SECTIONS & DETAILS					■					
e-S302	FOUNDATION SECTIONS & DETAILS					■					
e-S303	FOUNDATION SECTIONS & DETAILS					■					
e-S401	FRAMING SECTIONS & DETAILS					■					
e-S402	FRAMING SECTIONS & DETAILS					■					
e-S403	FRAMING SECTIONS & DETAILS					■					
e-S404	FRAMING SECTIONS & DETAILS					■					
ARCHITECTURAL DRAWING INDEX											
e-A100	OVERALL SITE PLAN					■					
e-A101	FLOOR PLANS					■					
e-A102	MEZZANINE FLOOR PLAN					■					
e-A103	REFLECTED CEILING PLAN					■					
e-A104	REFLECTED CEILING PLAN					■					
e-A105	ROOF PLAN					■					
e-A106	STRIPING PLAN					■					
e-A107	STRIPING PLAN					■					
e-A201	BUILDING ELEVATIONS					■					
e-A301	BUILDING SECTIONS					■					
e-A310	WALL SECTIONS					■					
e-A311	STAIR SECTION & PLAN					■					
e-A390	WALL TYPES					■					
e-A391	UL DETAILS					■					
e-A401	ENLARGED TOILET PLAN, ELEVATIONS					■					
e-A501	ROOF DETAILS					■					
e-A530	DETAILS					■					
e-A531	DETAILS					■					
e-A601	DOOR & WINDOW SCHEDULE & DETAILS					■					
e-A620	FINISH SCHEDULE, SIGNAGE & MOUNTING					■					
FIRE PROTECTION DRAWING INDEX											
e-FX001	DETAILS - FIRE PROTECTION					■					
e-FX101	OVERALL FLOOR PLAN - FIRE PROTECTION					■					
e-FX102	MEZZANINE PLAN - FIRE PROTECTION					■					
MECHANICAL DRAWING INDEX											
e-M001	LEGENDS, NOTES AND ABBREVIATIONS					■					
e-M101	HVAC PLAN					■					
e-M102	HVAC MEZZANINE PLAN					■					
e-M501	HVAC SCHEDULE/ DETAIL					■					
e-M601	MECHANICAL SCHEDULES					■					
e-M701	MECHANICAL CONTROLS					■					
ELECTRICAL DRAWING INDEX											
e-E001	ELECTRICAL LEGEND					■					
e-E002	LIGHTING FIXTURE SCHEDULE					■					
e-E003	LIGHTING CONTROLS					■					
e-E101	FIRST FLOOR POWER PLAN					■					
e-E102	MEZZANINE POWER PLAN					■					
e-EG101	LIGHTNING PROTECTION AND GROUNDING PLAN					■					
e-EL101	FIRST FLOOR LIGHTING PLAN					■					
e-EL102	MEZZANINE LIGHTING PLAN					■					
e-E501	DETAILS					■					
e-E502	DETAILS					■					
e-E503	DETAILS					■					
e-E601	ELECTRICAL ONE-LINE DIAGRAM					■					
PLUMBING DRAWING INDEX											
e-P001	ABBREVIATIONS, LEGEND AND GENERAL NOTES					■					
e-P100	PLUMBING SITE PLAN - NEW					■					
e-P101	FIRST FLOOR PLUMBING PLAN					■					
e-P102	MEZZANINE PLUMBING PLAN					■					
e-P401	PLUMBING ENLARGED PLANS					■					
e-P501	PLUMBING DETAILS					■					
e-P601	PLUMBING SCHEDULES					■					
e-PD100	PLUMBING SITE PLAN - DEMO					■					
SYSTEMS DRAWING INDEX											
e-T101	FIRST FLOOR SYSTEMS PLAN					■					
e-T102	MEZZANINE SYSTEMS PLAN					■					



www.brph.com Copyright © 2026

Architects Engineers, Inc.
5700 North Harbor City Blvd | Suite 400
Melbourne | Florida | 32940
T 321-254-7666 | F 321-259-4703


Offices in Melbourne, Orlando, Boca Raton,
Atlanta, Lynnwood, Charleston and Huntsville

Florida Architectural Business Qualifier #AR97690
Board of Professional Engineers License #1439

These plans are protected by Federal Copyright protection. Unauthorized use may result in an infringement action.

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

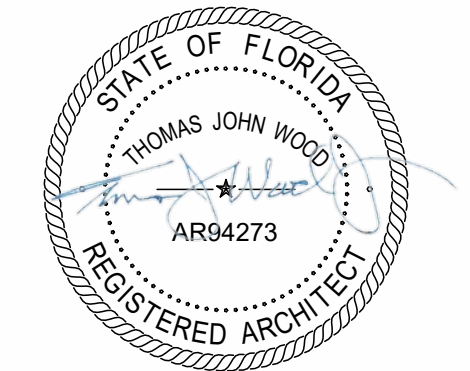

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH

DRAWN BY
LOTHMAN

PROJECT NUMBER
C09414.003

DATE
03/15/2026

TITLE

COVER SHEET

DRAWING NO.

e-G001


Offices in Melbourne, Orlando, Boca Raton,
Atlanta, Lynnwood, Charleston and Huntsville

Florida Architectural Business Qualifier #AR9768
Board of Professional Engineers License #1439

These plans are protected by Federal Copyright protection. Unauthorized use may result in an infringement action.

[illegible]

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

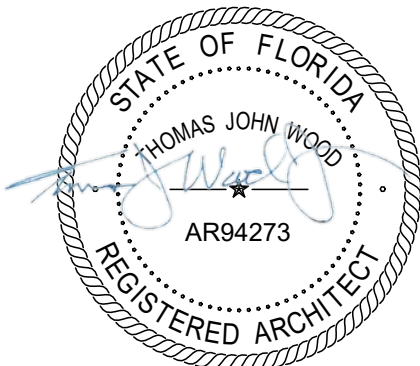

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

BLANCHARD
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003

DATE
03/15/2026
TITLE

ABBREVIATIONS, SYMBOLS, GENERAL NOTES

DRAWING NO.


e-G002

SYMBOLS LEGEND

NOTE : THIS LIST MAY NOT BE ALL INCLUSIVE.

DRAWING TITLE DRAWING TITLE _____ DRAWING NUMBER _____ DRAWING SCALE _____ FLOOR PLAN 1/8" = 1'-0"	LOUVER TAG 105
SECTION MARKER SECTION NUMBER ON SHEET _____ SHEET NUMBER ON WHICH SECTION IS DRAWN _____	CURTAIN WALL / WINDOW WALL SYSTEM TAG S1
SECTION MARKER SECTION NUMBER ON SHEET _____ SHEET NUMBER ON WHICH SECTION IS DRAWN _____	KEYNOTE TAGS 03
EXTERIOR ELEVATION MARKER SECTION NUMBER ON SHEET _____ SHEET NUMBER ON WHICH SECTION IS DRAWN _____	REVISION CLOUDS CLOUDED REVISION _____ REVISION EVENT _____
INTERIOR ELEVATION MARKER SECTION NUMBER ON SHEET _____ SHEET NUMBER ON WHICH SECTION IS DRAWN _____	FIRE RATED PARTITION 1 HOUR SEPARATION ASSEMBLY OR FIRE PARTITION 2 HOUR SEPARATION ASSEMBLY OR FIRE PARTITION
DETAIL CALLOUT MARKER SECTION NUMBER ON SHEET _____ SHEET NUMBER ON WHICH SECTION IS DRAWN _____	TYPICAL MASONRY WALL TYPICAL METAL STUD PARTITION OPENING INSULATION (LOOSE OR BATT)
FLOOR ELEVATION SYMBOL	RIGID INSULATION WOOD-FINISHED WOOD-ROUGH PLYWOOD-LARGE SCALE
SPOT ELEVATION SYMBOL	METAL-LARGE SCALE CONCRETE MARBLE EARTH
STRUCTURAL GRID MARKER 1 NEW 1 EXISTING A A	
PARTITION TAG 0-S6A	
ROOM TAG ROOM NAME 101A ROOM NAME 101A	
DOOR NUMBER TAG 101 101	
GLASS TYPE TAG G2	

DIMENSION STANDARDS

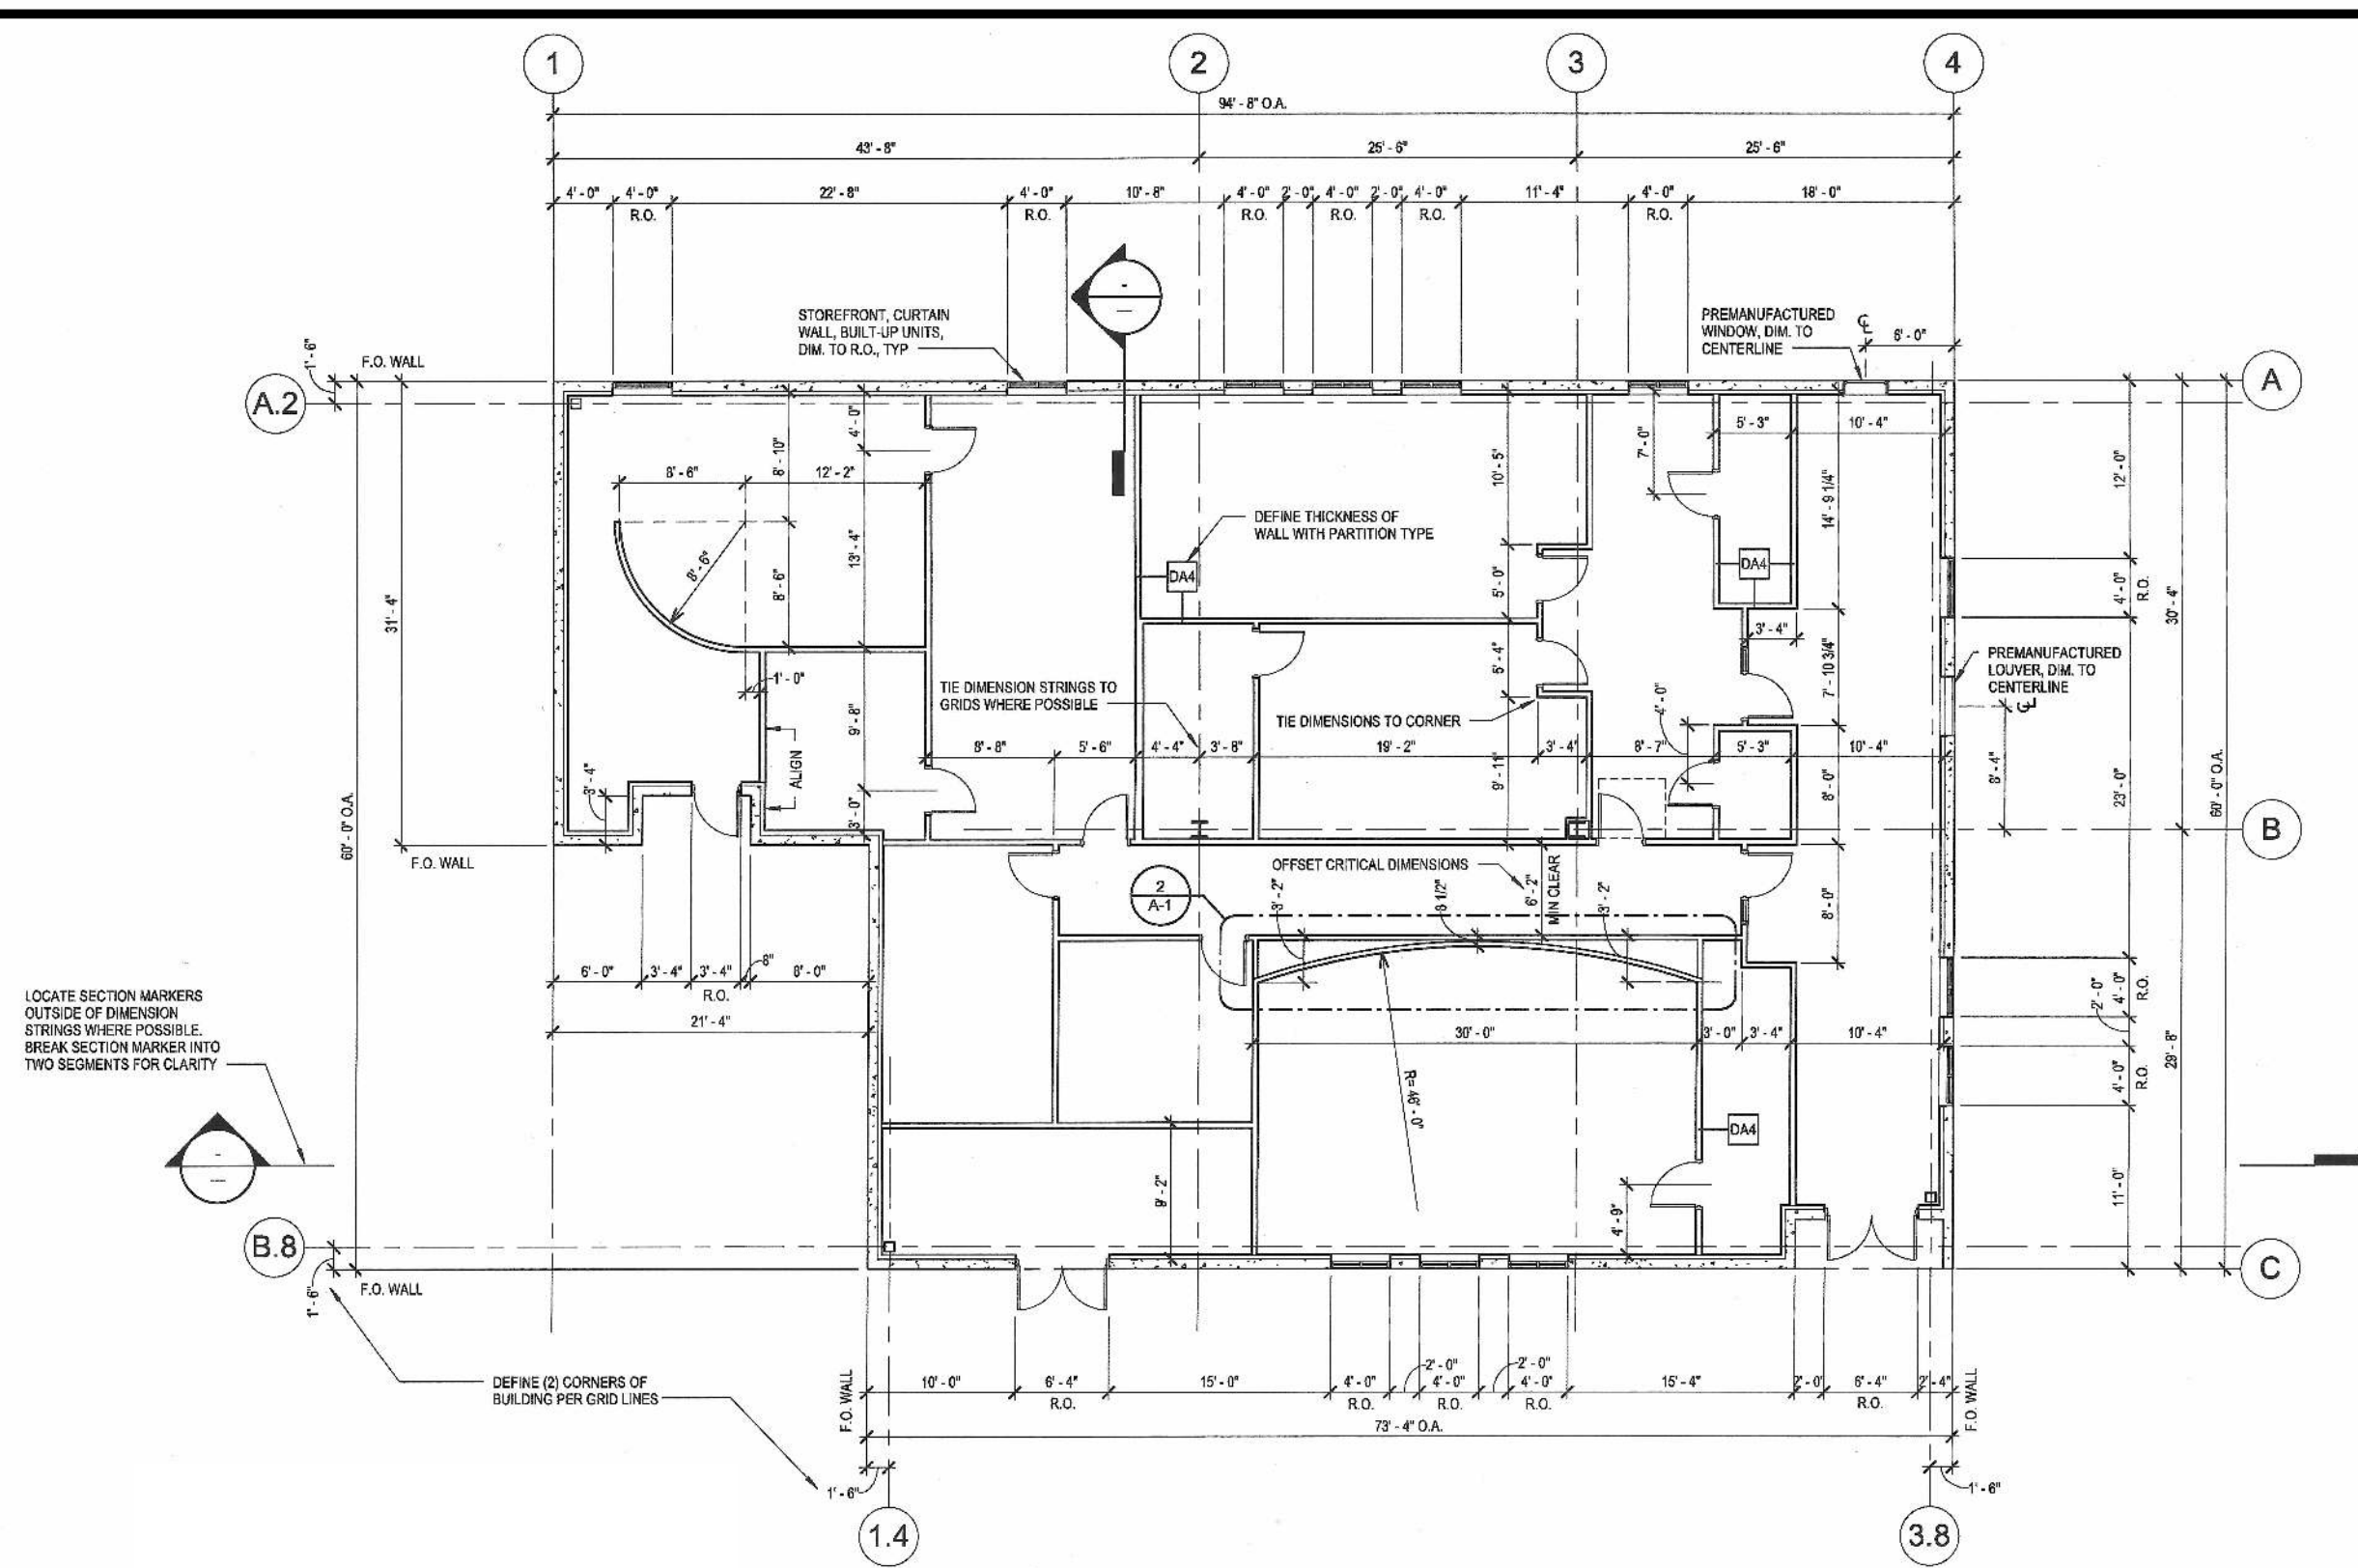


DIMENSIONING

1. THE DRAWING SHOWN IS AN EXAMPLE OF TYPICAL BRPH ARCHITECTURAL DRAFTING PRACTICES.
2. DIMENSIONS TO BE PLACED FROM FACE OF DRYWALL, CMU OR CONCRETE.
3. REFER TO LARGER PLAN OR DRAWINGS FOR ADDITIONAL DIMENSIONS.
4. ROUGH OPENINGS FOR MASONRY OR CONCRETE, CONTRACTOR TO ALLOW FOR TOLERANCES REQUIRED FOR ALL OPENINGS AS REQUIRED FOR DOOR FRAMES, WINDOWS AND OTHER INFILL ITEMS.

LIFE SAFETY ROOM TAG	
ROOM NAME _____	
ROOM NUMBER _____	
ROOM AREA _____	
OCCUPANT LOAD FACTOR _____	
NUMBER OF OCCUPANTS _____	
LIFE SAFETY EXIT TAG	
EXIT CAPACITY REQUIRED _____	
EXIT WIDTH REQUIRED _____	
EXIT WIDTH PROVIDED _____	
EGRESS ROUTE	
SEGMENT LENGTH _____	
EGRESS PATH ORIGIN _____	
EGRESS PATH EXIT _____	
FIRE RATED PARTITION	
1 HOUR SEPARATION ASSEMBLY _____	
2 HOUR SEPARATION ASSEMBLY _____	
FIRE PROTECTION	
FIRE EXTINGUISHER, BRACKET-MOUNTED _____	FE
FIRE EXTINGUISHER CABINET, SEMI-RECESSED _____	FE

[illegible]

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

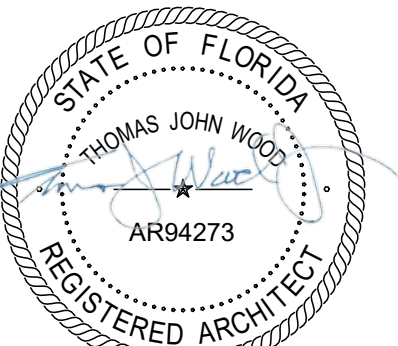

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
Designer

DRAWN BY
Author

PROJECT NUMBER
C09414.003

DATE _____

07/03/24


TITLE

FIRST FLOOR PLAN - LIFE SAFETY

DRAWING NO.

e-LS101

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

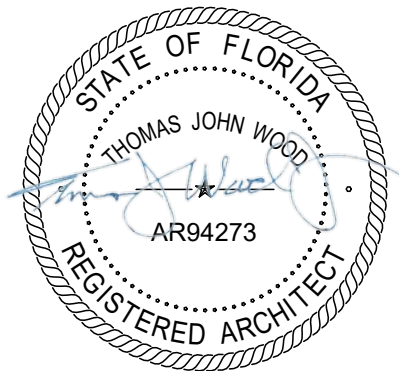

e-LS102

OCCUPANCY SCHEDULE					
ROOM NUMBER	ROOM NAME	OCCUPANCY CLASSIFICATION	SQF/PERSON	OCCUPANT LOAD	AREA
105	IDF	ACCESSORY	300	1	104 SF
201	MECH ROOM	ACCESSORY	300	1	119 SF
111	ELEC	ACCESSORY	300	1	86 SF
202	BDA CLOSET	ACCESSORY	300	1	17 SF
112	FIRE RISER	ACCESSORY	300	1	97 SF
				5	421 SF
104	BREAKROOM	ASSEMBLY	15	16	225 SF
				16	225 SF
102	OFFICE	BUSINESS	150	1	123 SF
110	HUDDLE	BUSINESS	30	4	104 SF
109	CREW ROOM	BUSINESS	15	35	517 SF
103	WORKSPACE	BUSINESS	30	9	262 SF
				49	1006 SF
106	JANITOR'S CLOSET	NON-OCCUPIED	0		64 SF
107	UNISEX	NON-OCCUPIED	0		48 SF
108	UNISEX	NON-OCCUPIED	0		49 SF
				0	161 SF
100	MEZZANINE	STORAGE	500	7	3348 SF
	STORAGE	STORAGE	500	2	757 SF
101	STORAGE	STORAGE	500	15	7449 SF
				24	11553 SF

LIFE SAFETY ROOM TAG

ROOM NAME _____ ➔ ROOM NAME _____

ROOM NUMBER _____ ➔ 101

ROOM AREA _____ ➔ Area

OCCUPANT LOAD FACTOR _____ ➔ 1/100 SF

NUMBER OF OCCUPANTS _____ ➔ 51

LIFE SAFETY EXIT TAG

EXIT CAPACITY REQUIRED	50
EXIT WIDTH REQUIRED	0' - 10"
EXIT WIDTH PROVIDED	2' - 10"

EGRESS ROUTE

Diagram illustrating the segment length and egress path:

- SEGMENT LENGTH: 30'-0"
- EGRESS PATH ORIGIN: Indicated by a black dot.
- EGRESS PATH EXIT: Indicated by a dashed line ending in an arrow.

FIRE RATED PARTITION


1 HOUR SEPARATION ASSEMBLY

2 HOUR SEPARATION ASSEMBLY

FIRE PROTECTION

FIRE EXTINGUISHER, BRACKET-MOUNTED

FIRE EXTINGUISHER CABINET, SEMI-RECESSED

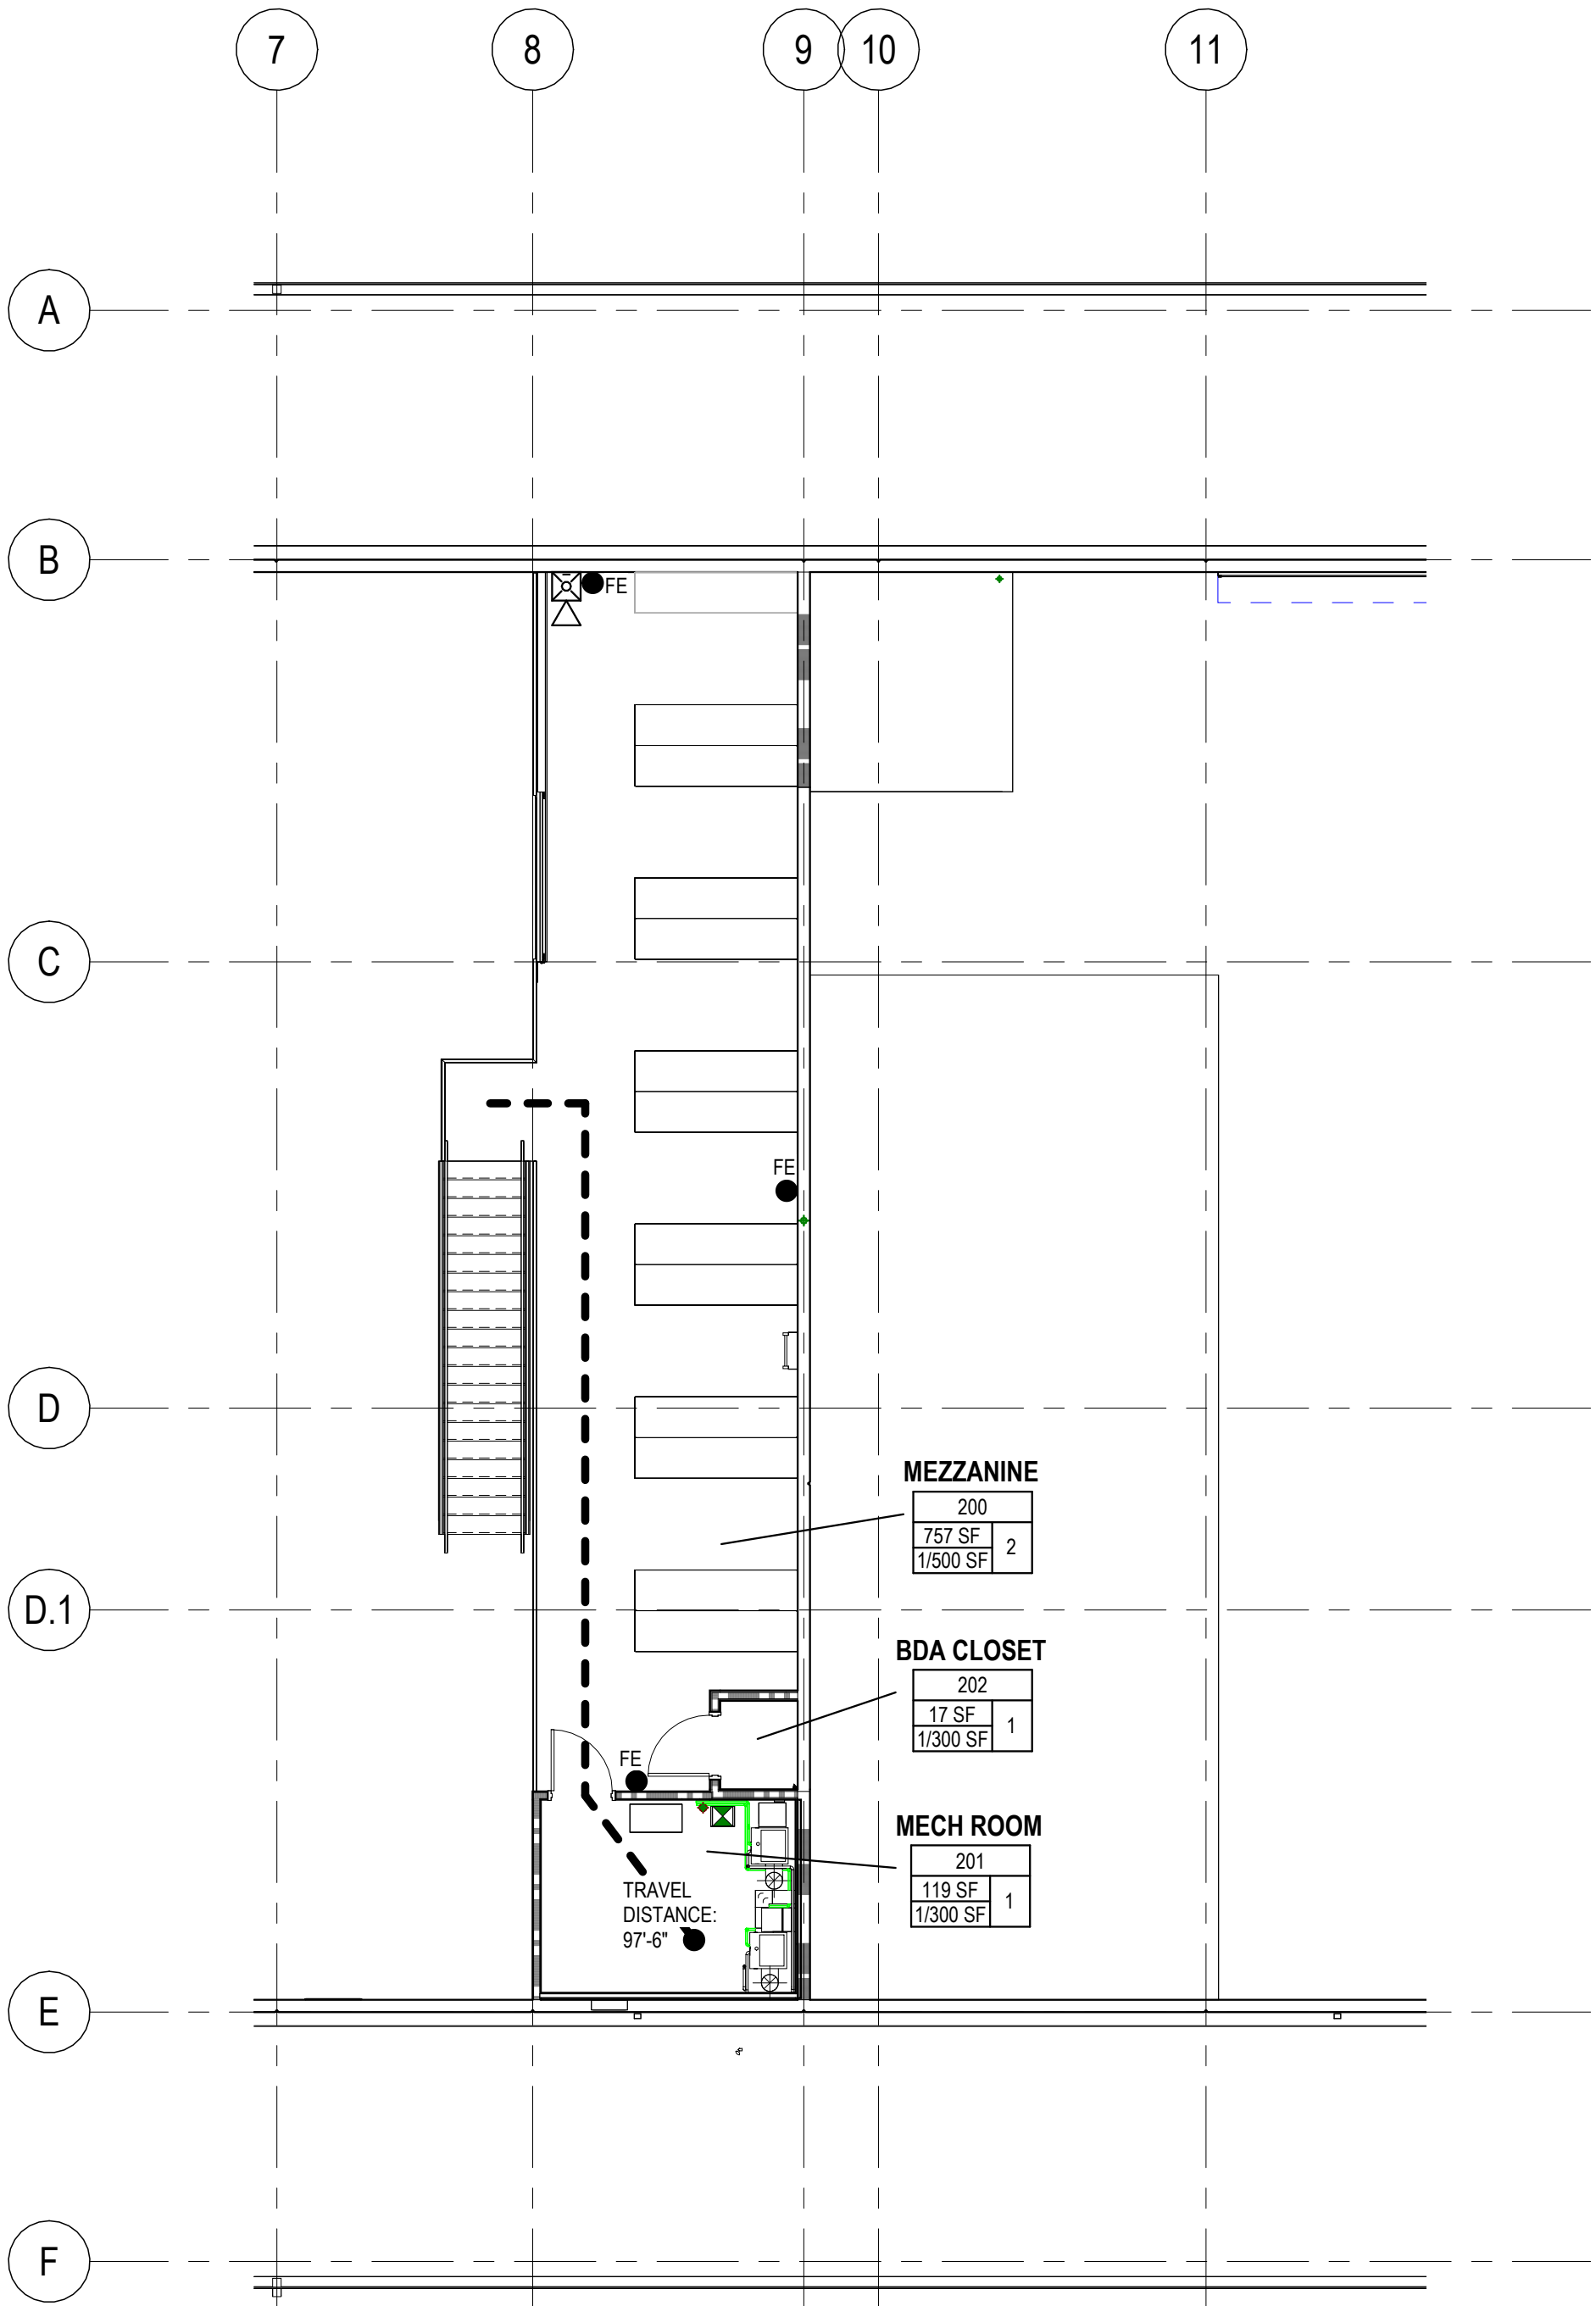


1 MEZZANINE FLOOR PLAN - LIFE SAFETY

$$1/8'' = 1'-0''$$

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

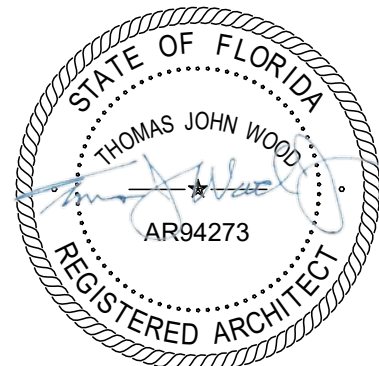

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
Designer

DRAWN BY
Author

PROJECT NUMBER
C09414.003

DATE
06/26/2024

TITLE


OVERALL SITE
PLAN

DRAWING NO.



e-A100

LEGEND

-
- LIMIT OF CONSTRUCTION AND LAYDOWN AREA. ASPHALT
SHALL BE REMOVED AND PROVIDED NEW TO MATCH
EXISTING GRADES AND MAINTAIN A SLOPE OF NO MORE
THAN 2% UNLESS OTHERWISE NOTED.
-
- AREA SHALL BE PROVIDED WITH CONCRETE DUE TO
EXCESSIVE SLOPES REQUIRED TO MATCH EXISTIN
GRADES AND ELECTRICAL EQUIPMENT LOCATED IN THE
AREA.

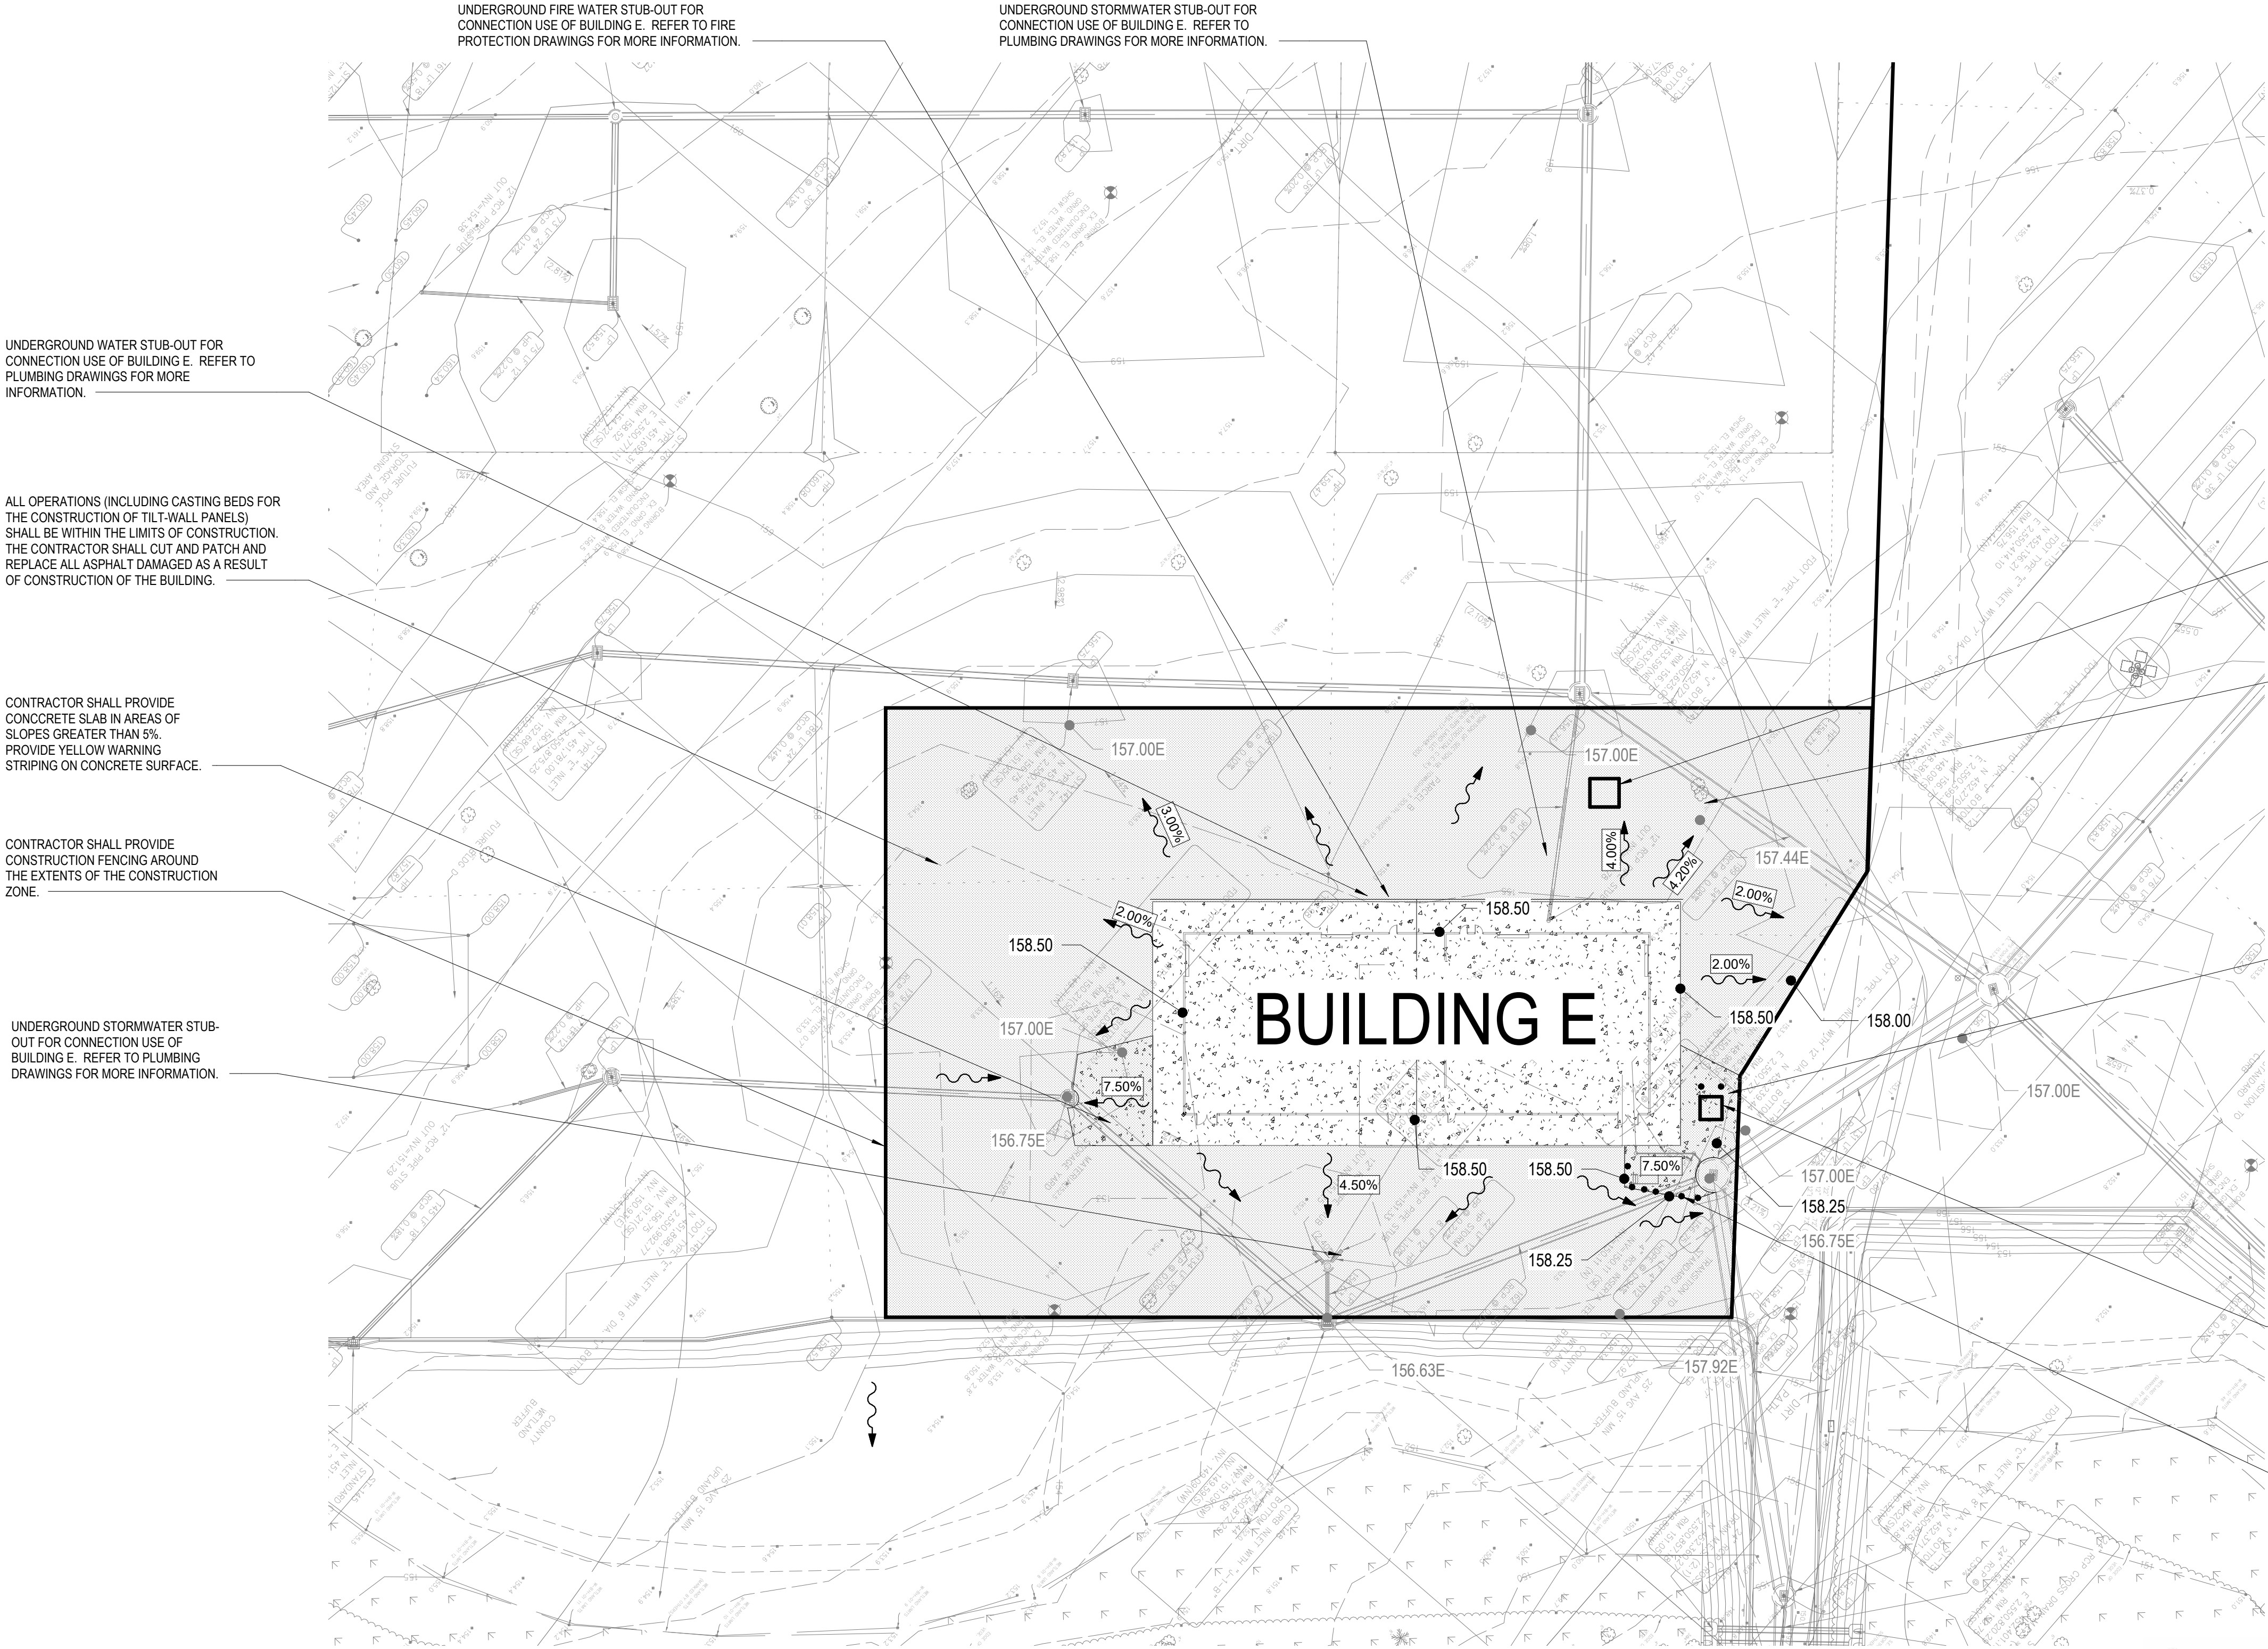


OVERALL SITE PLAN

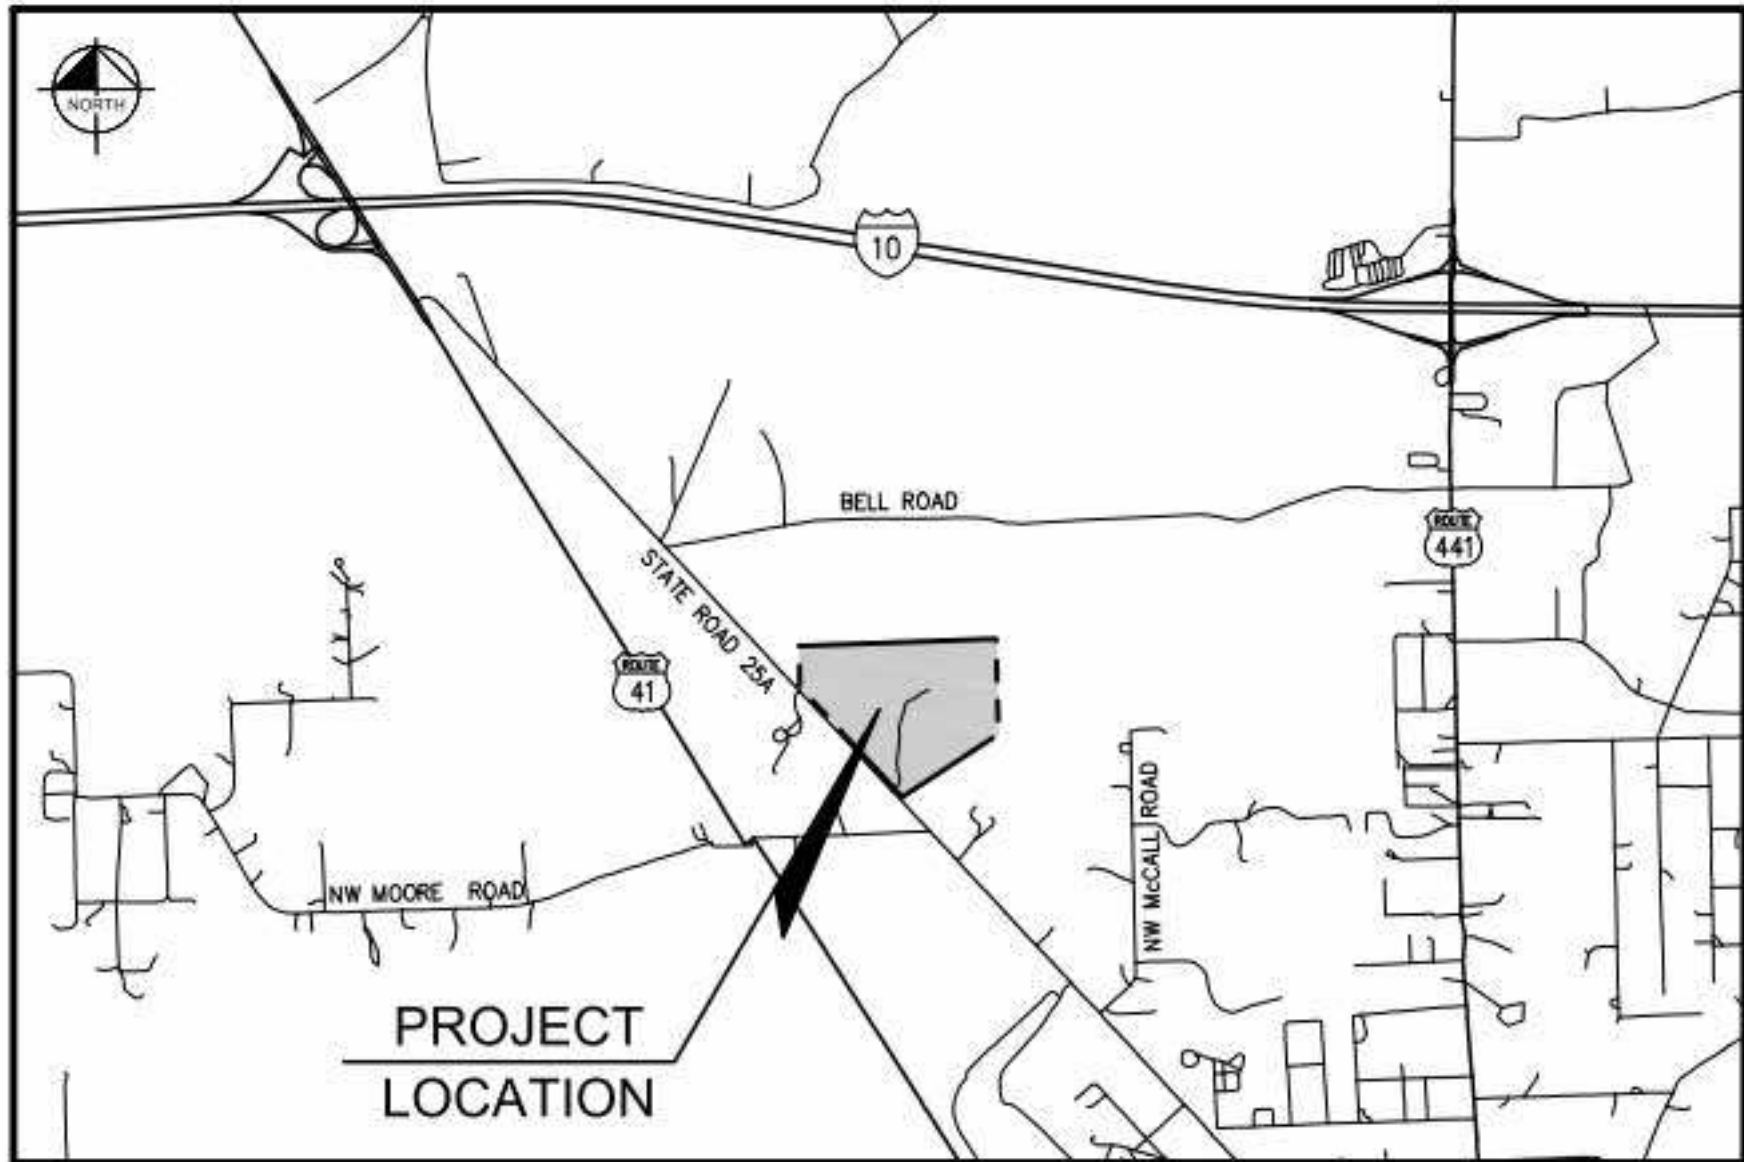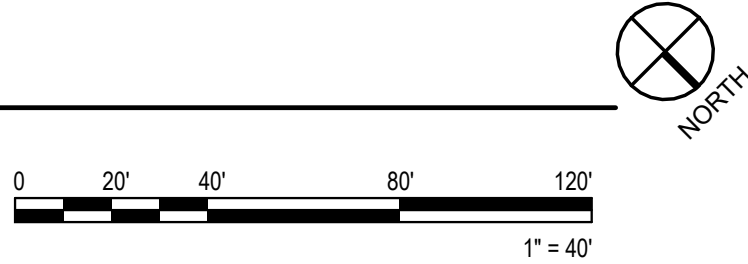

KEY PLAN

[illegible]

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

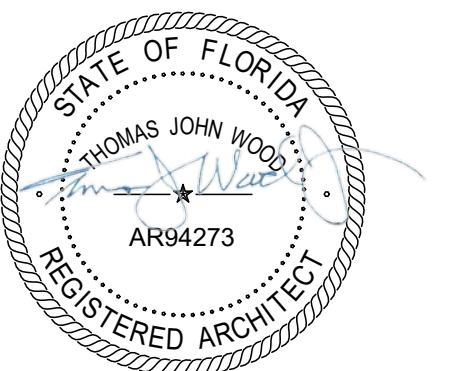

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273


DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003

DATE
03/15/2026
TITLE

FLOOR PLANS

DRAWING NO.

e-A101

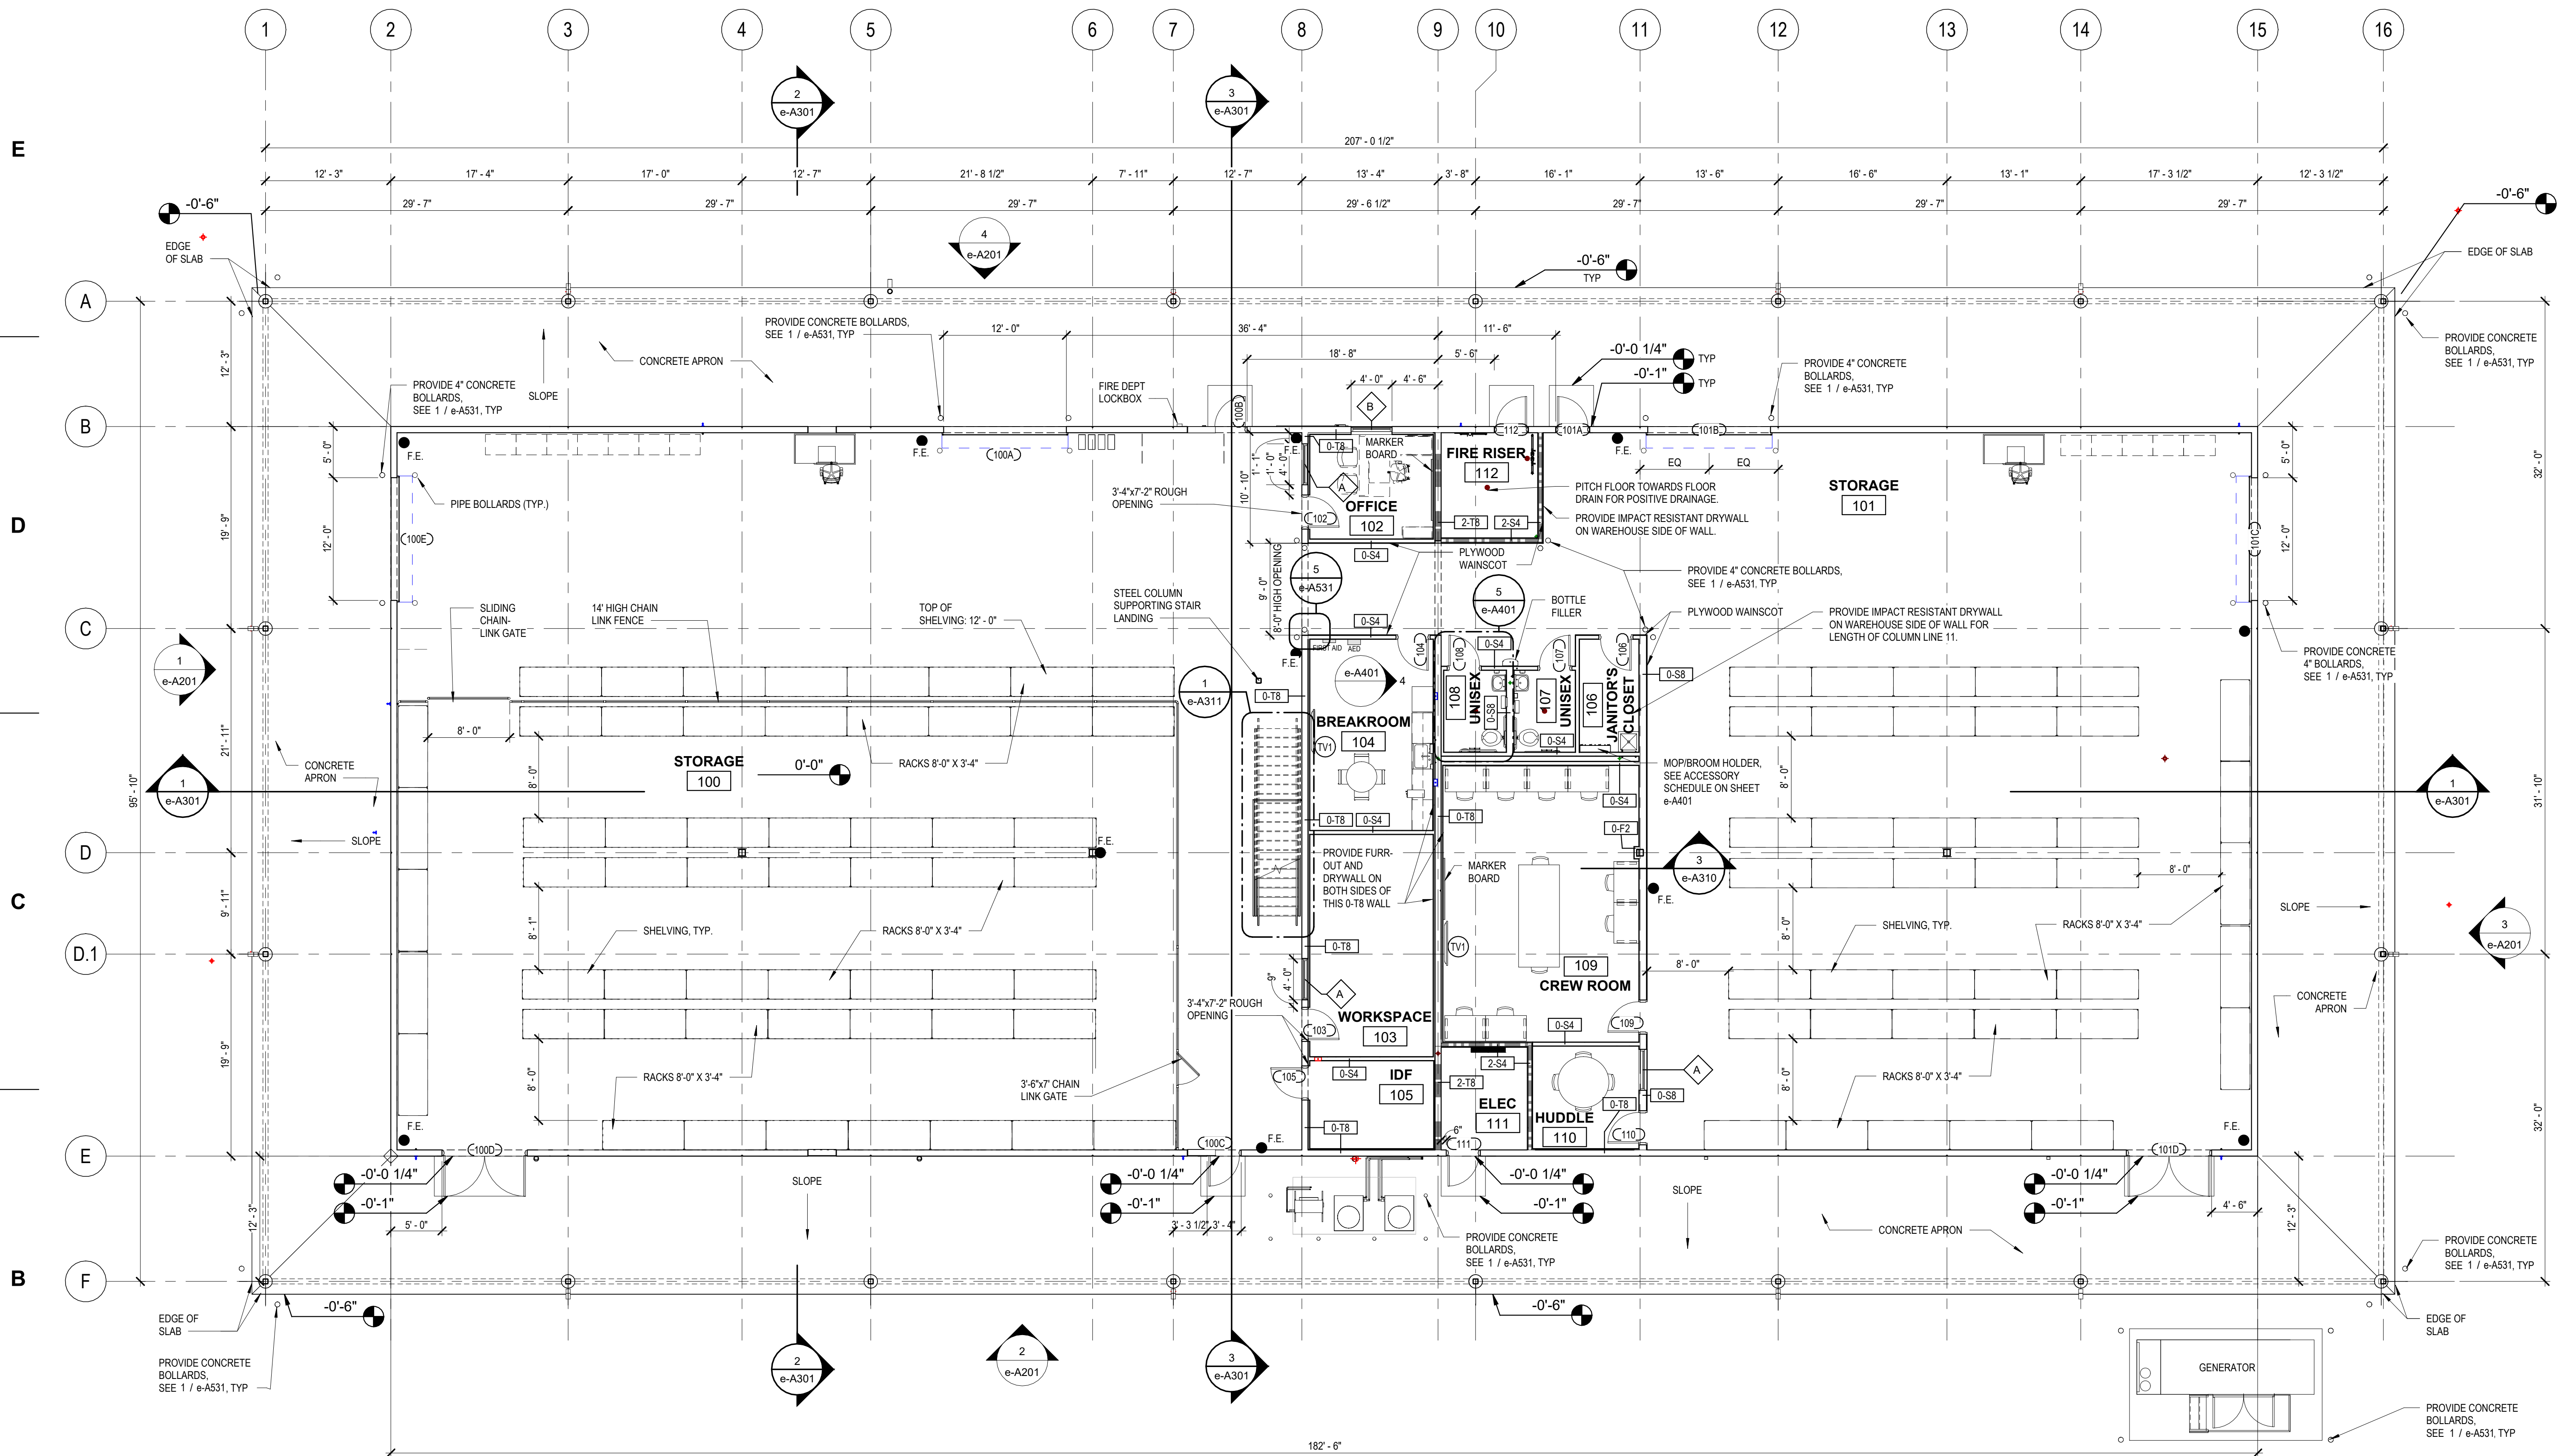


1 FIRST FLOOR PLAN
1/8" = 1'-0"

- FLAT SCREEN TV LEGEND:**
- | | |
|---|--------|
|  | 65" TV |
|---|--------|
1. PROVIDE FIRE TREATED PLYWOOD BACKING AND BLOCKING PER 4 / e-A531 FOR FUTURE TV. COORDINATE LOCATION WITH OWNER.
 2. SEE 3 / e-A531 FOR TV MOUNTING HEIGHTS.
 3. ALL DISPLAYS ARE TO BE PROVIDED AND INSTALLED BY OWNER'S AV VENDOR.



[illegible]

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

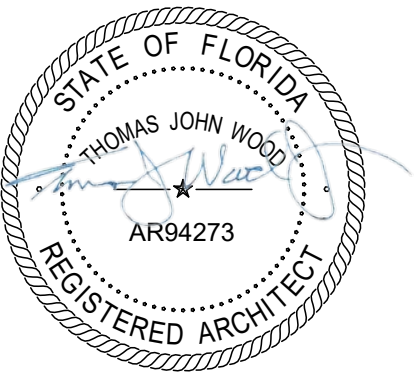

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPHDRAWN BY
LOTHMAN

PROJECT NUMBER
C09414.003


DATE
03/15/2026

TITLE

MEZZANINE FLOOR PLAN

DRAWING NO.


e-A102

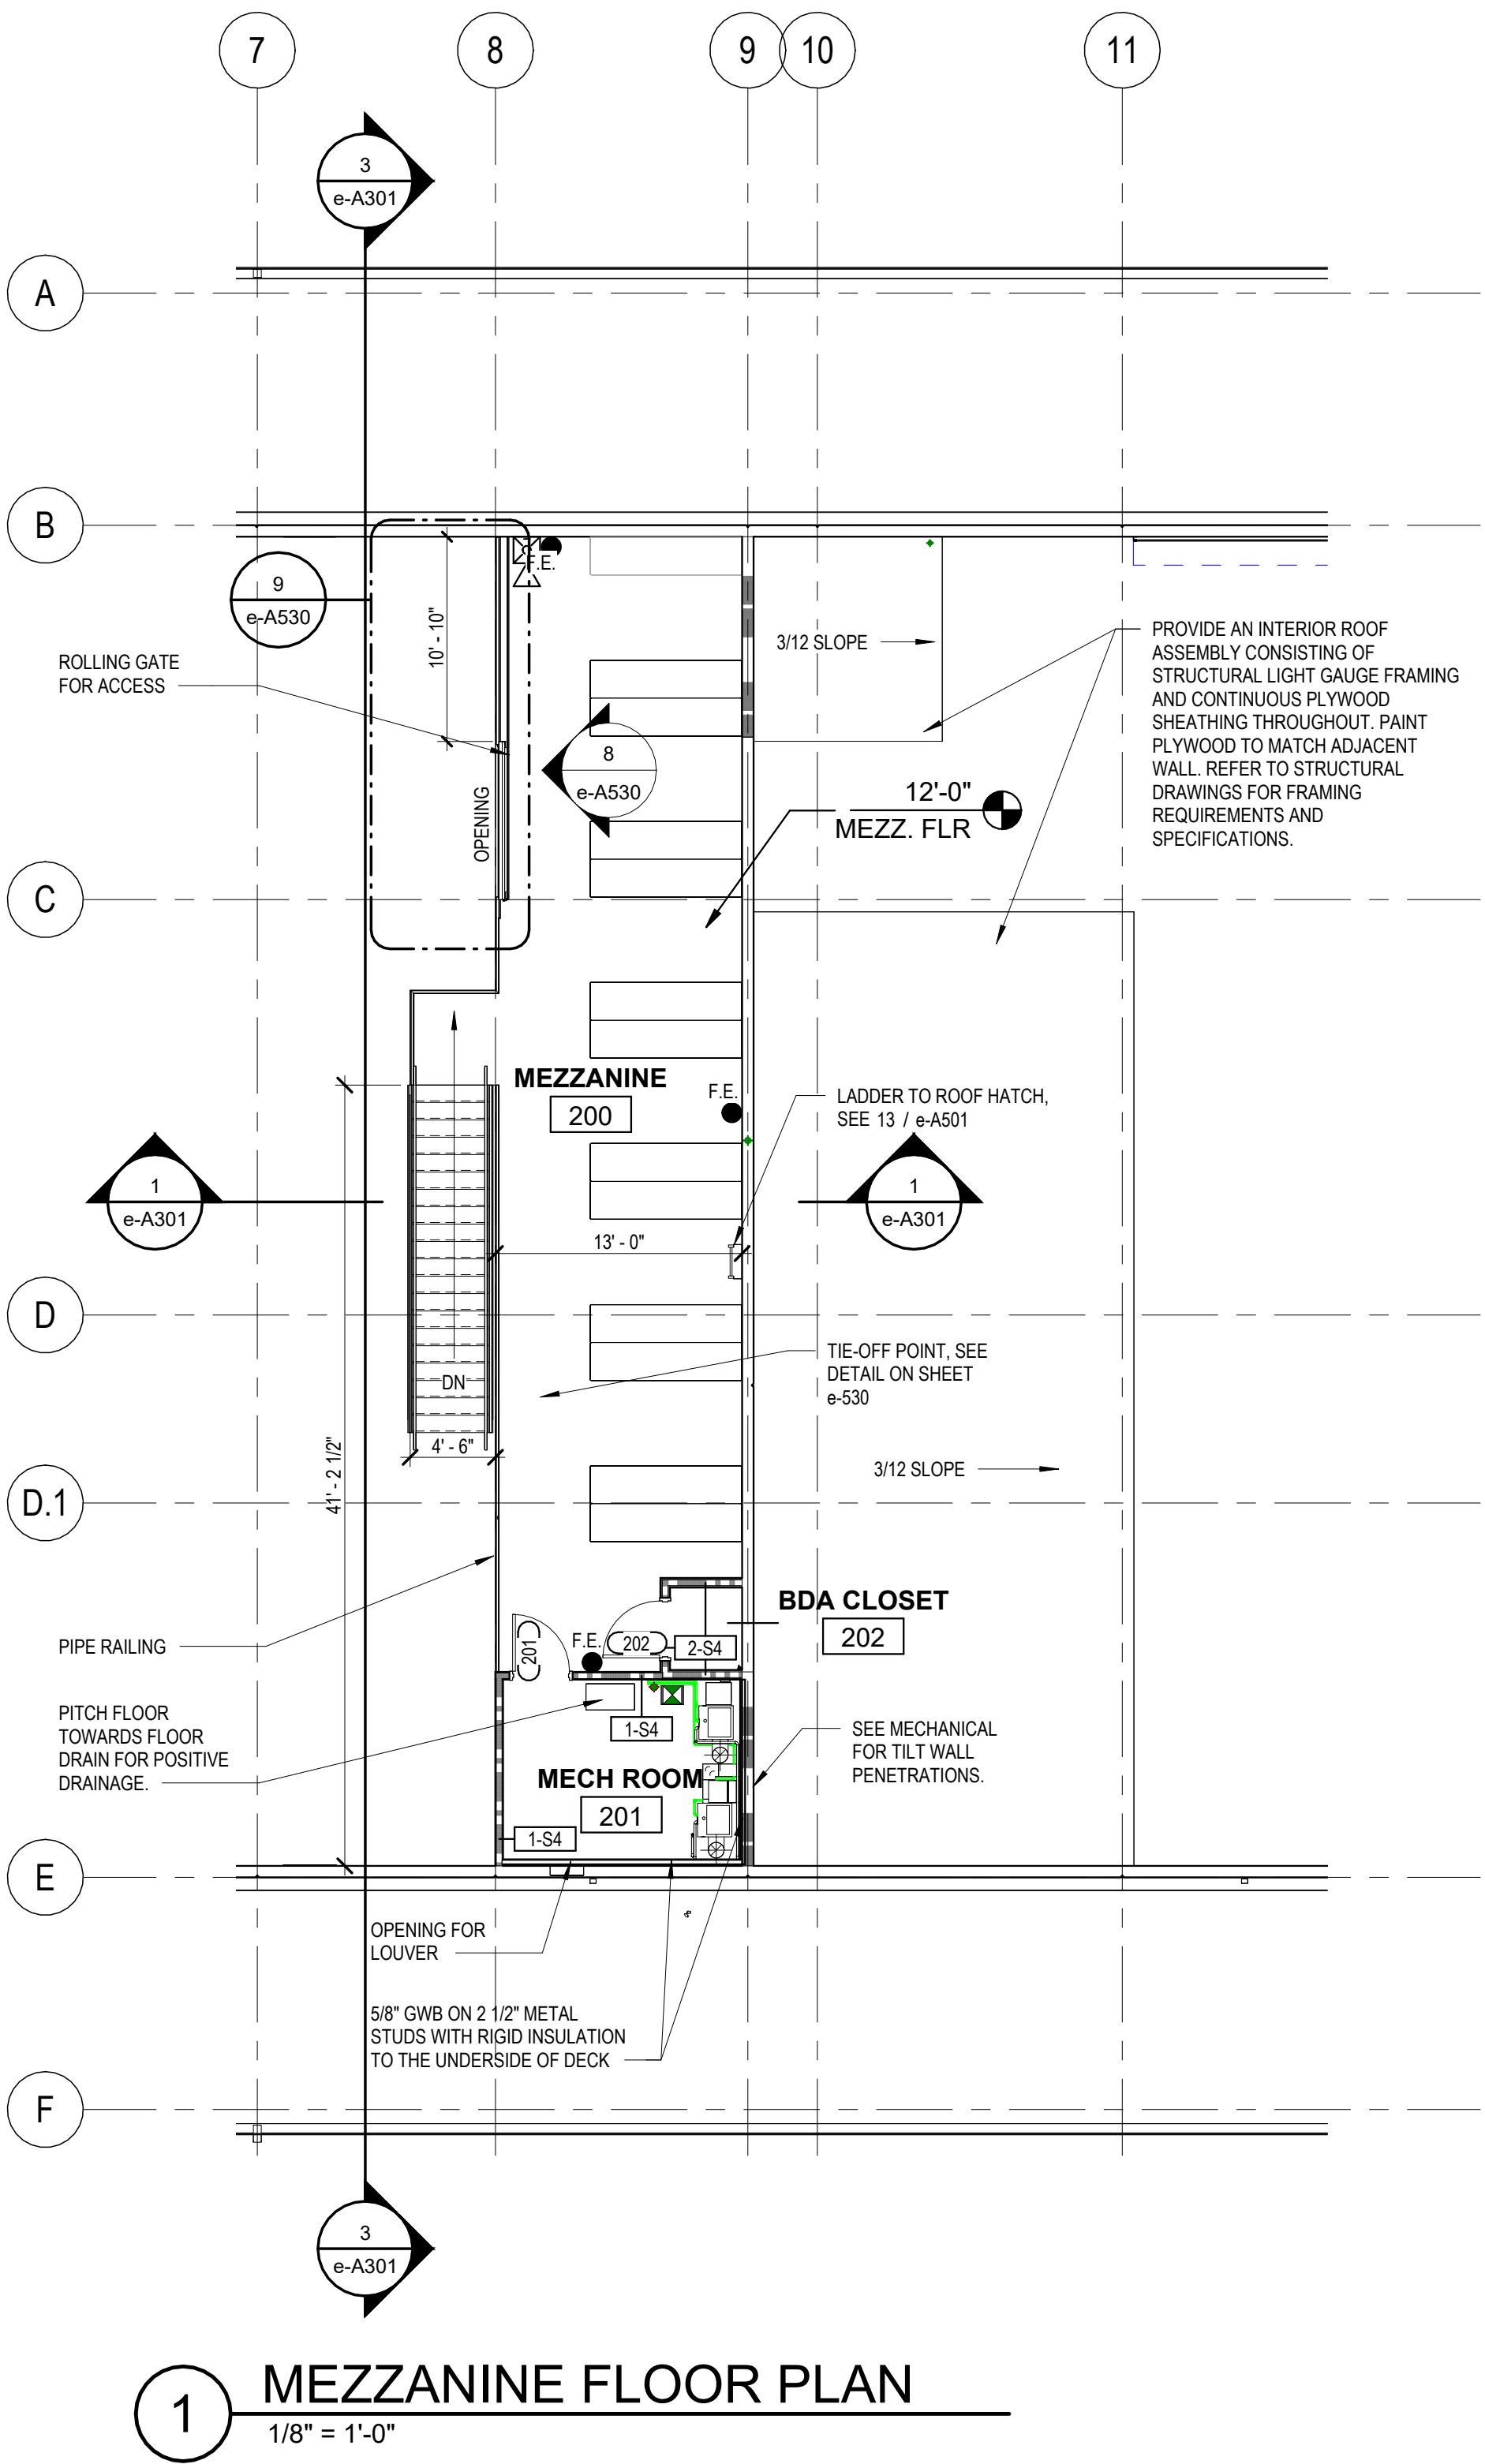

DOCUMENT HISTORY

REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

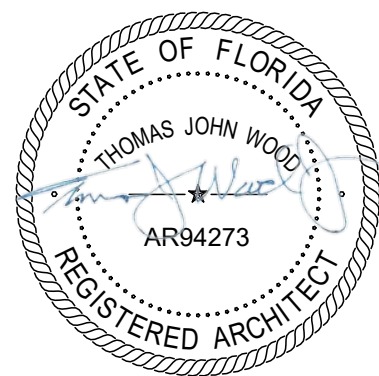

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHITECT OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY

BRPH

DRAWN BY

LOTHMAN

PROJECT NUMBER

C09414.003

DATE


03/15/2026

TITLE

REFLECTED
CEILING PLAN

DRAWING NO.

e-A103

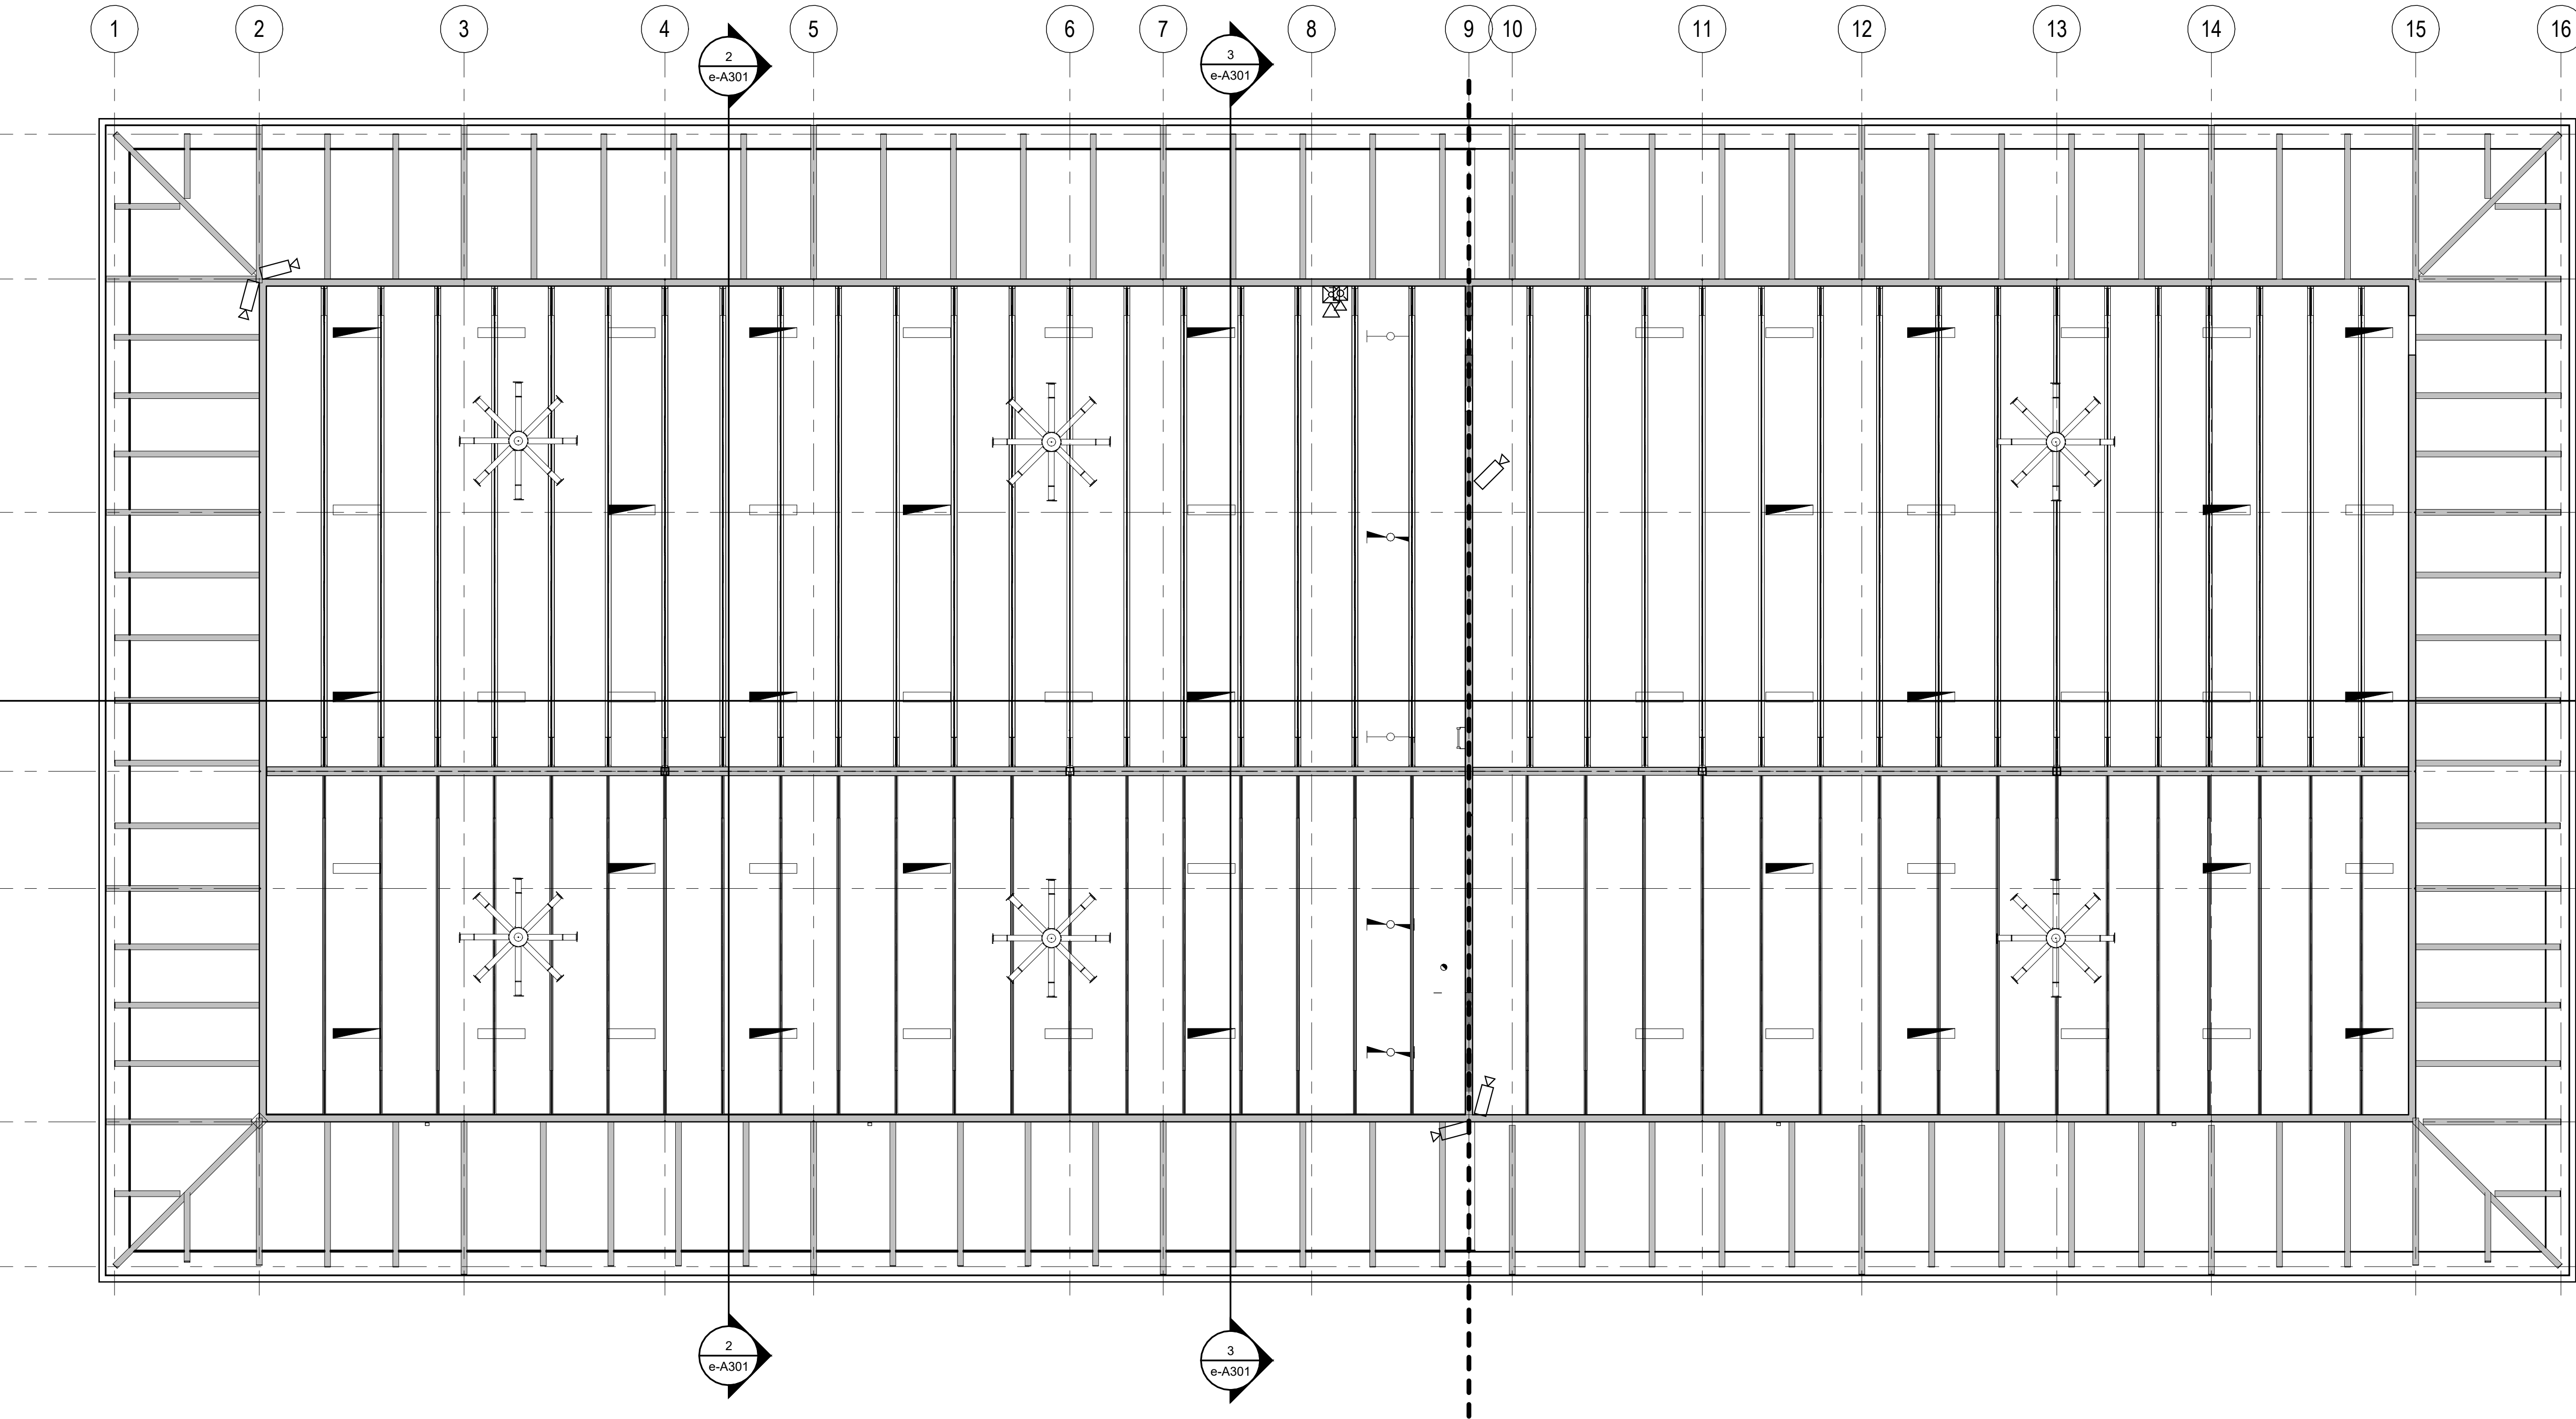


1 REFLECTED CEILING PLAN
1/8" = 1'-0"



DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

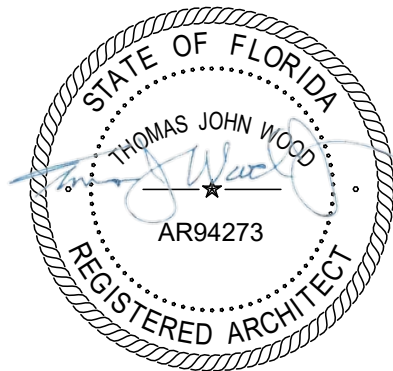

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHITECT OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN

PROJECT NUMBER
C09414.003


DATE
03/15/2026

TITLE


REFLECTED
CEILING PLAN

DRAWING NO.

e-A104

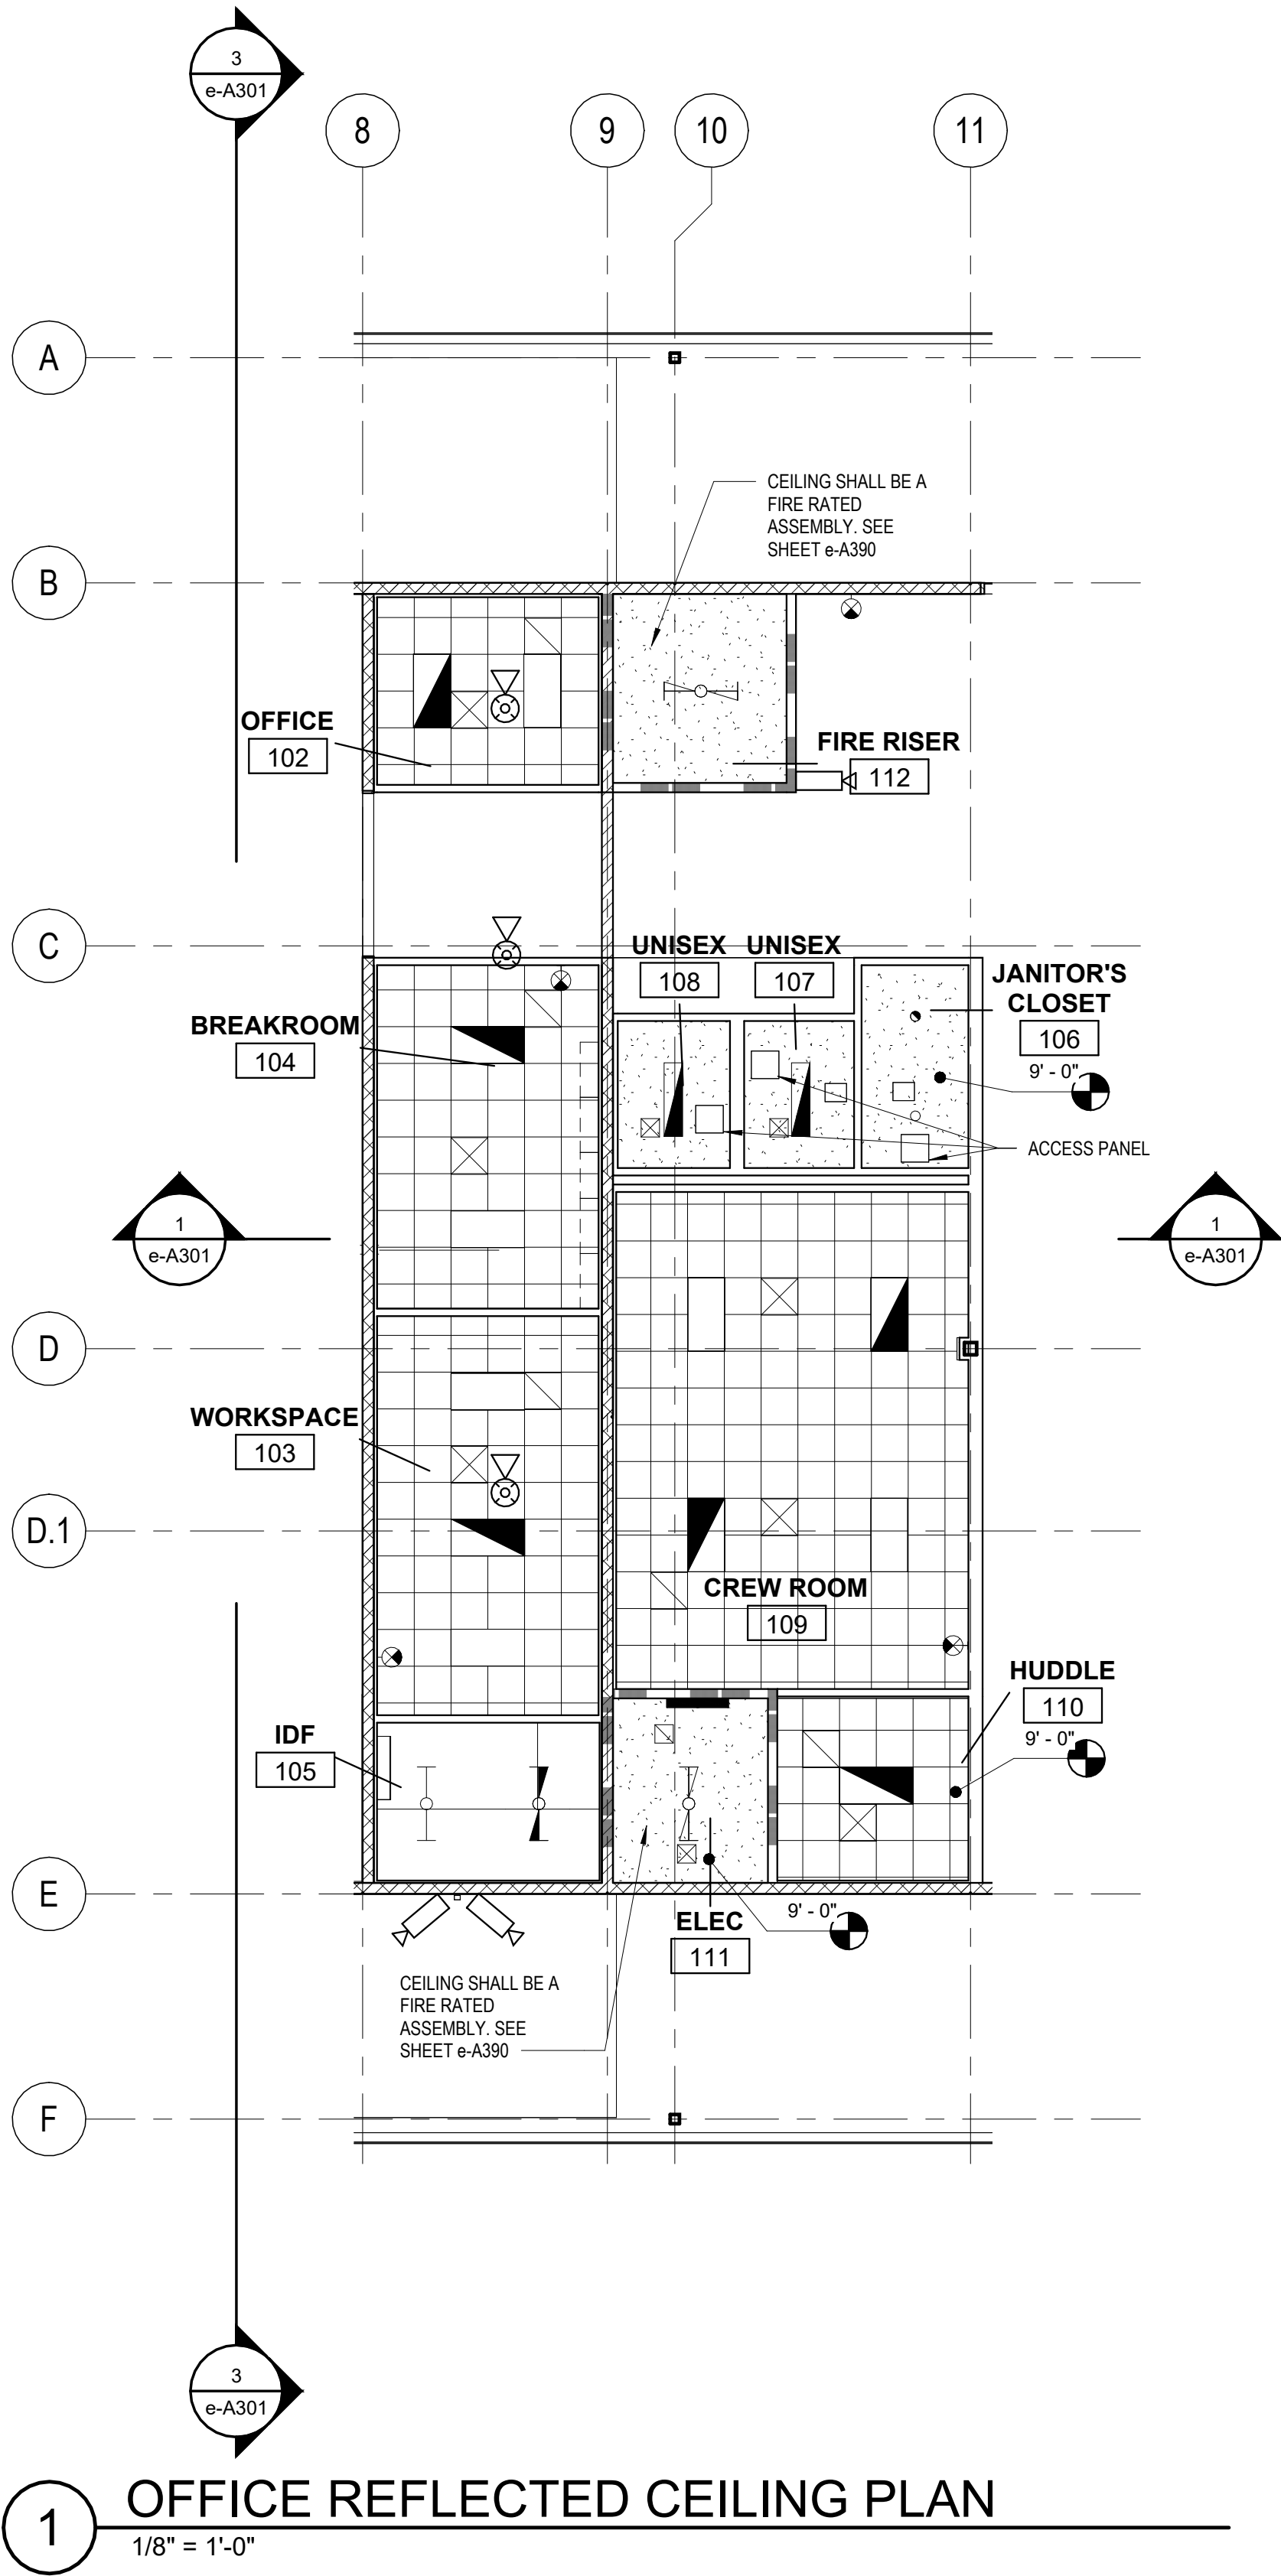


1 OFFICE REFLECTED CEILING PLAN
1/8" = 1'-0"



[illegible]

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

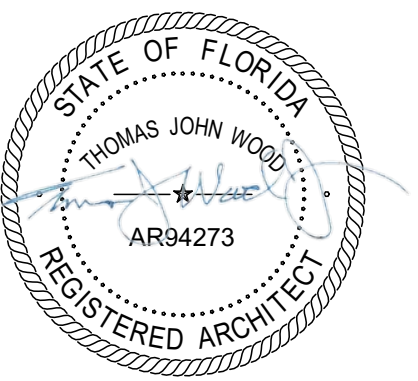

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.


ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003
DATE
03/15/2026
TITLE

ROOF PLAN

DRAWING NO.

e-A105

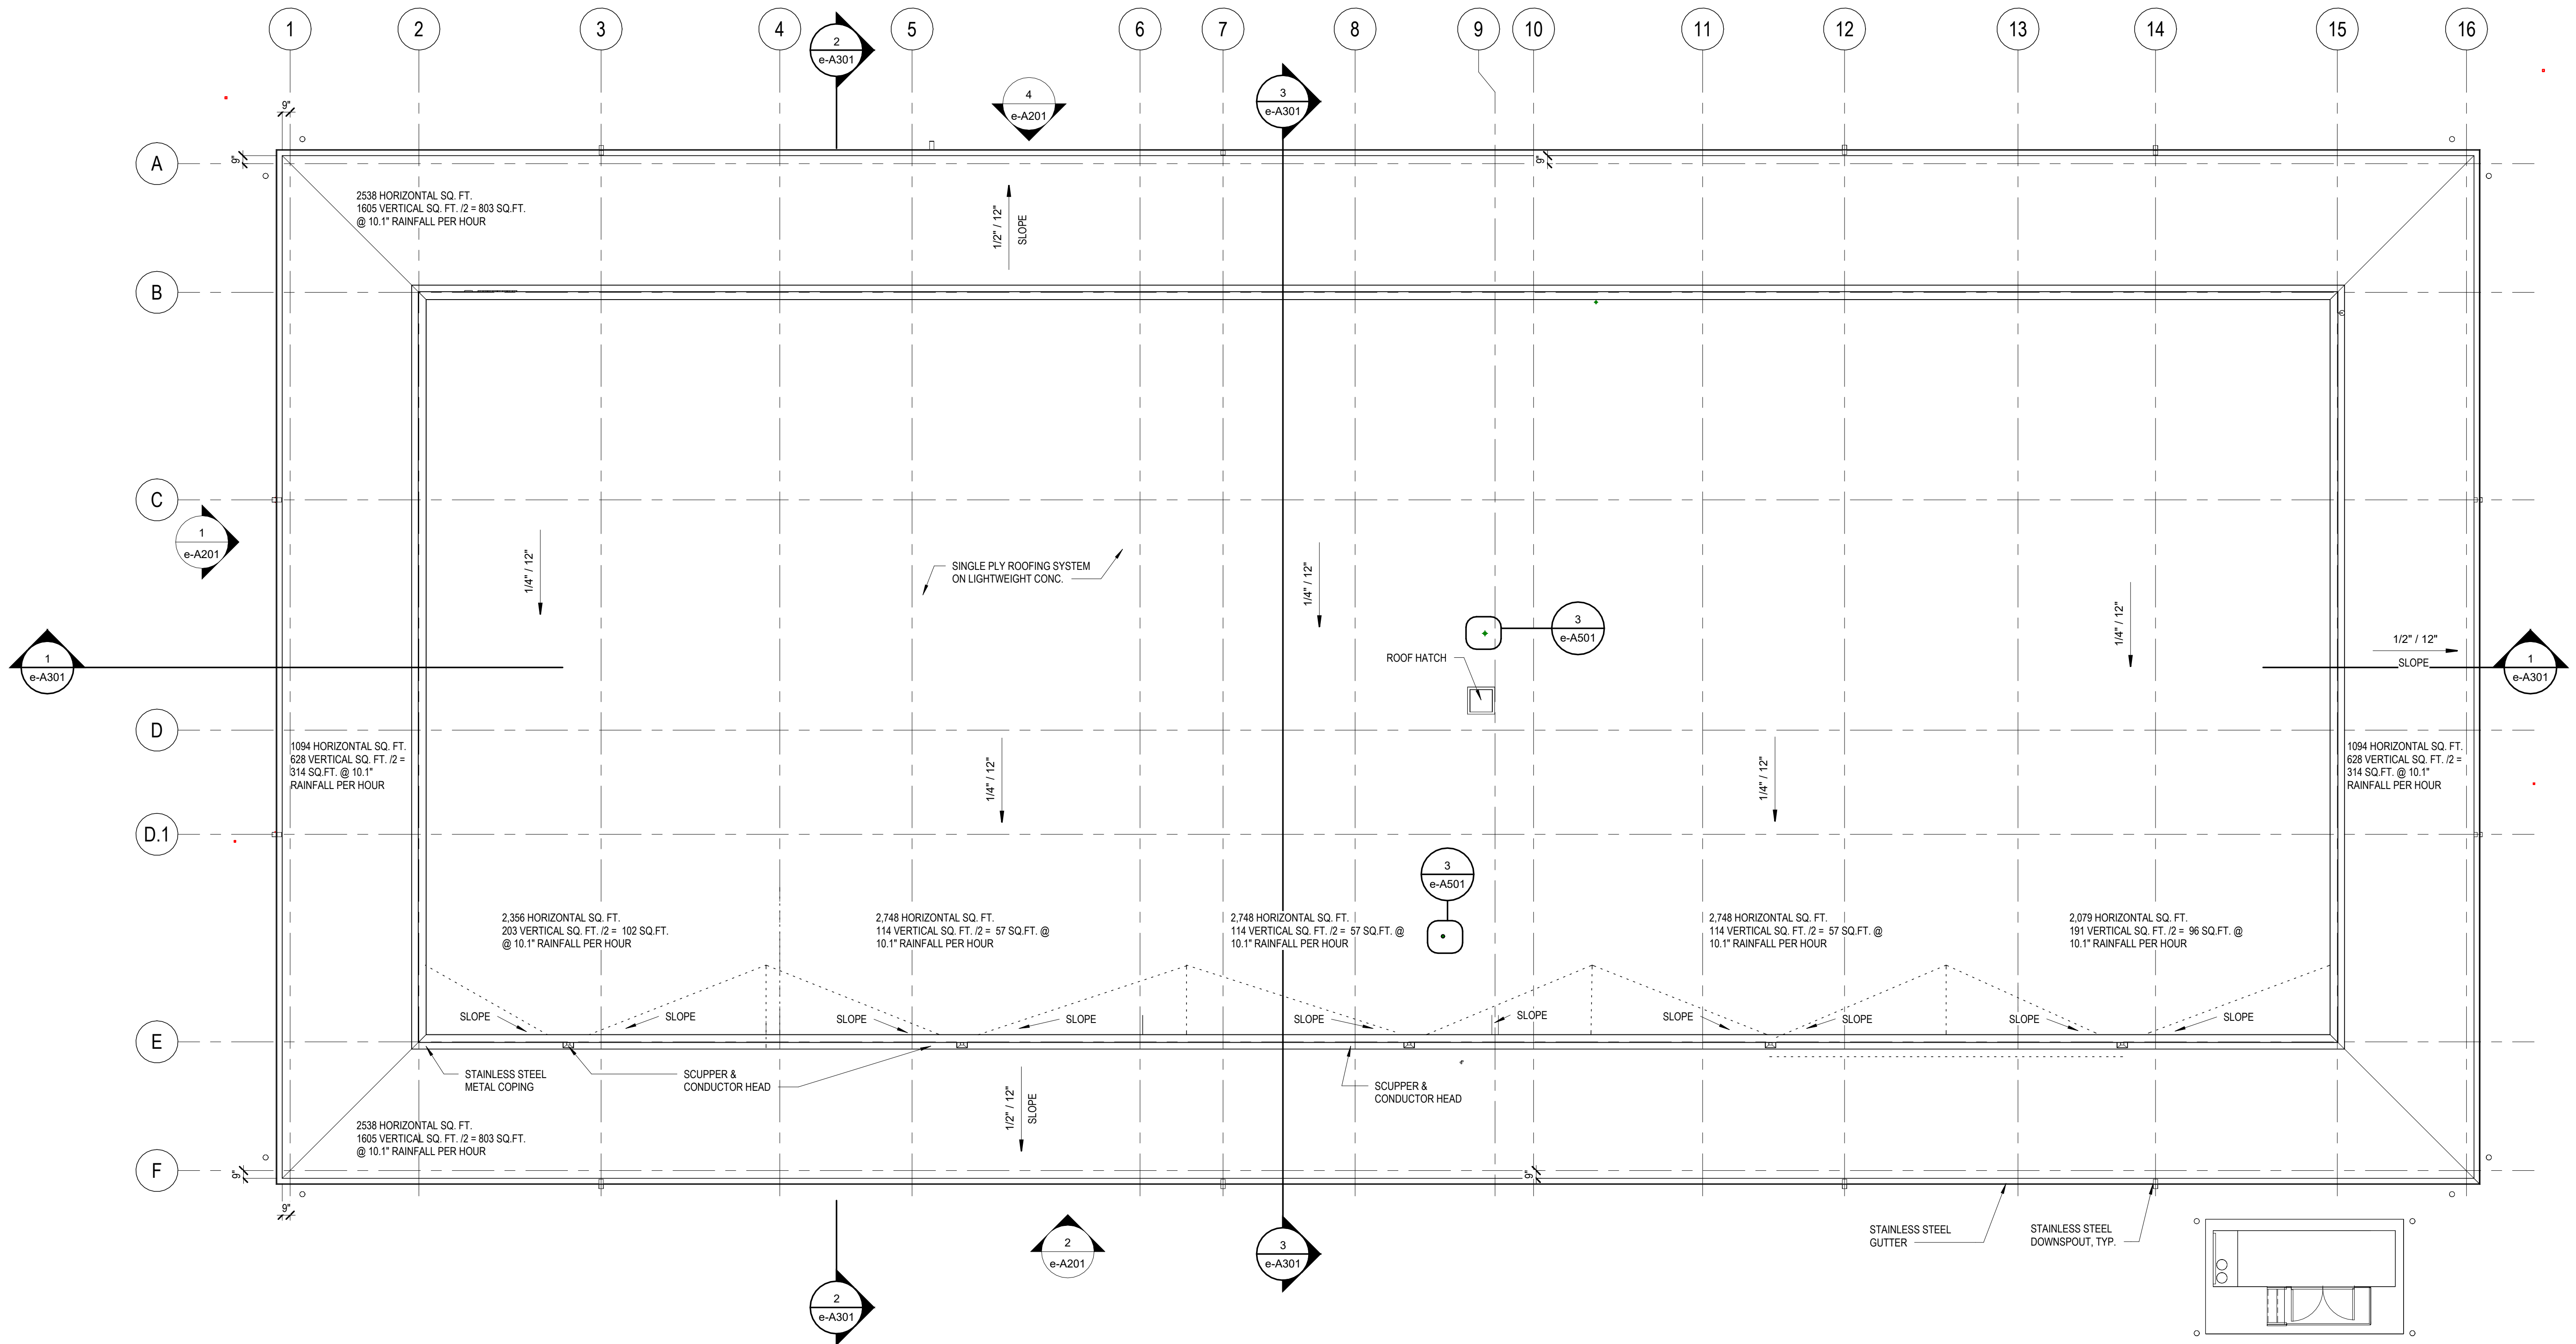


1 ROOF PLAN
1/8" = 1'-0"



DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

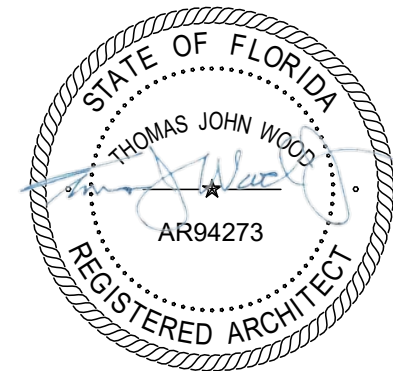

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHENGR OF RECORD

THOMAS J WOOD
AR FL #94273

DESIGNED BY

BRPH

DRAWN BY

LOTHMAN

PROJECT NUMBER

C09414.003

DATE



03/15/2026

TITLE

STRIPING PLAN

DRAWING NO.

e-A106

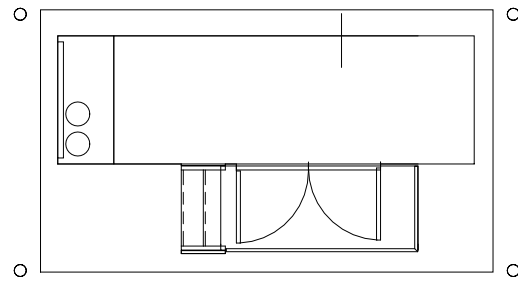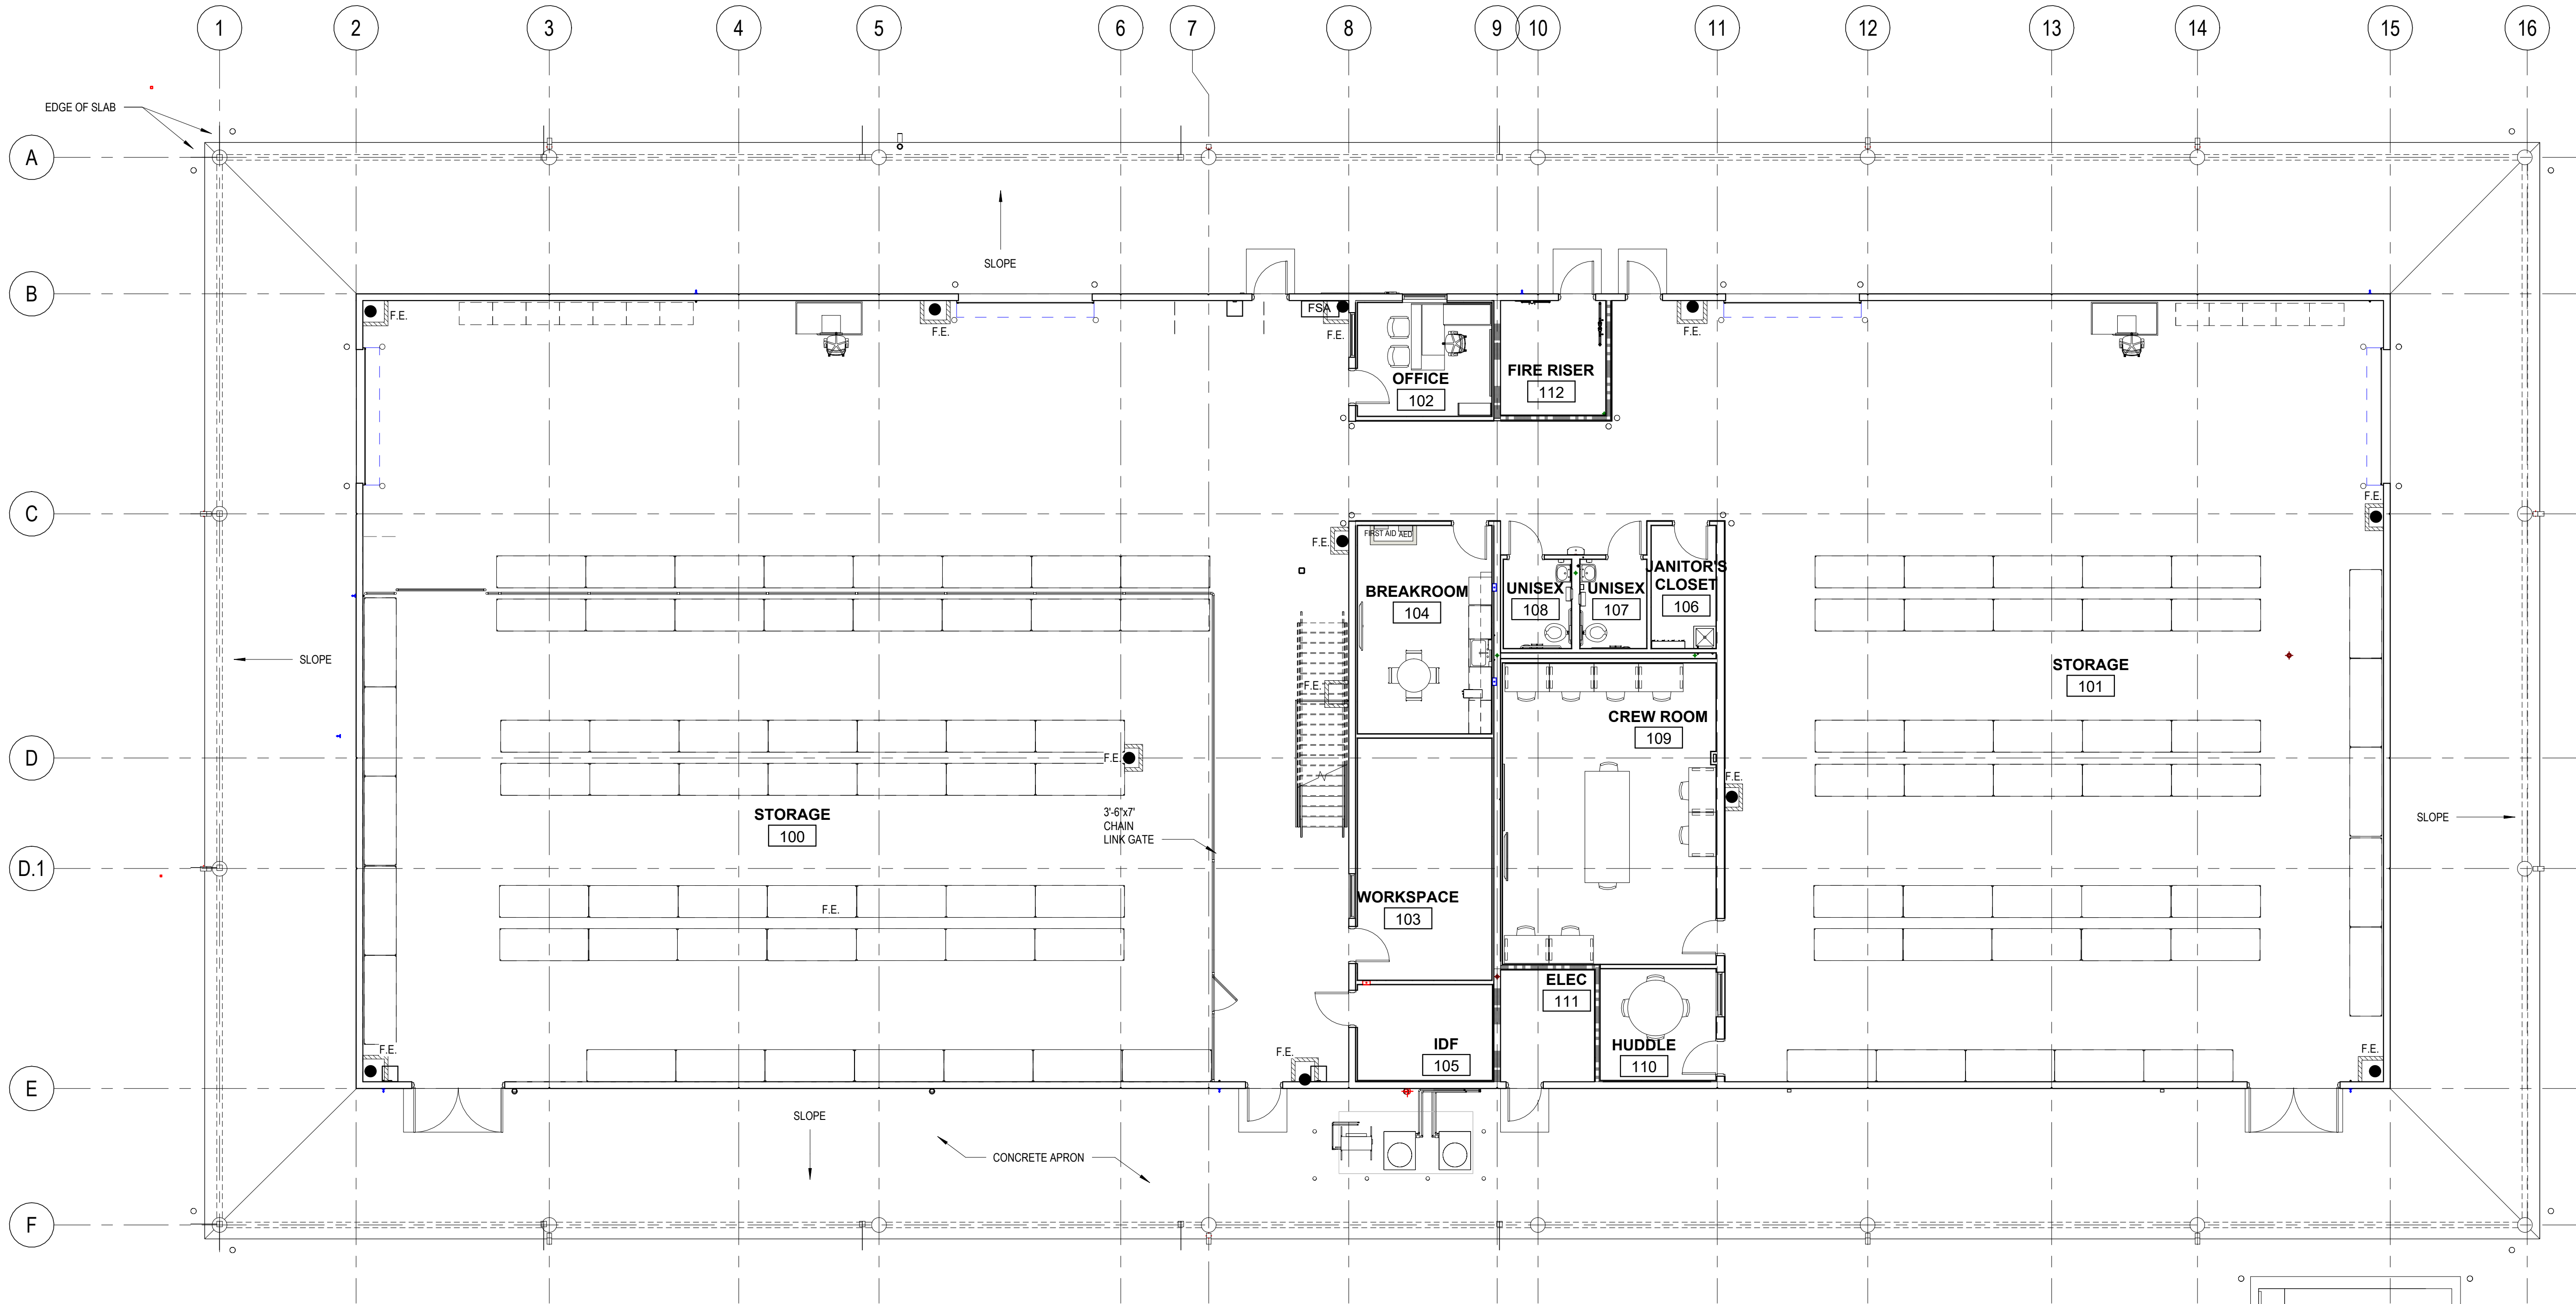


1 STRIPING PLAN
1/8" = 1'-0"

NOTE:
PROVIDE FLOOR STRIPING AROUND
WALL MOUNTED DEVICES AS
SHOWN ON PLAN

STRIPING LEGEND	
	AED / FIRST AID
	FIRE EXTINGUISHER



Autodesk Docs\\C09414.003 - FFL
Columbia Warehouses
Building\\C09414003_A_FFL-B_2023_CENTRAL.rvt
3/30/2026 3:29:55 PM

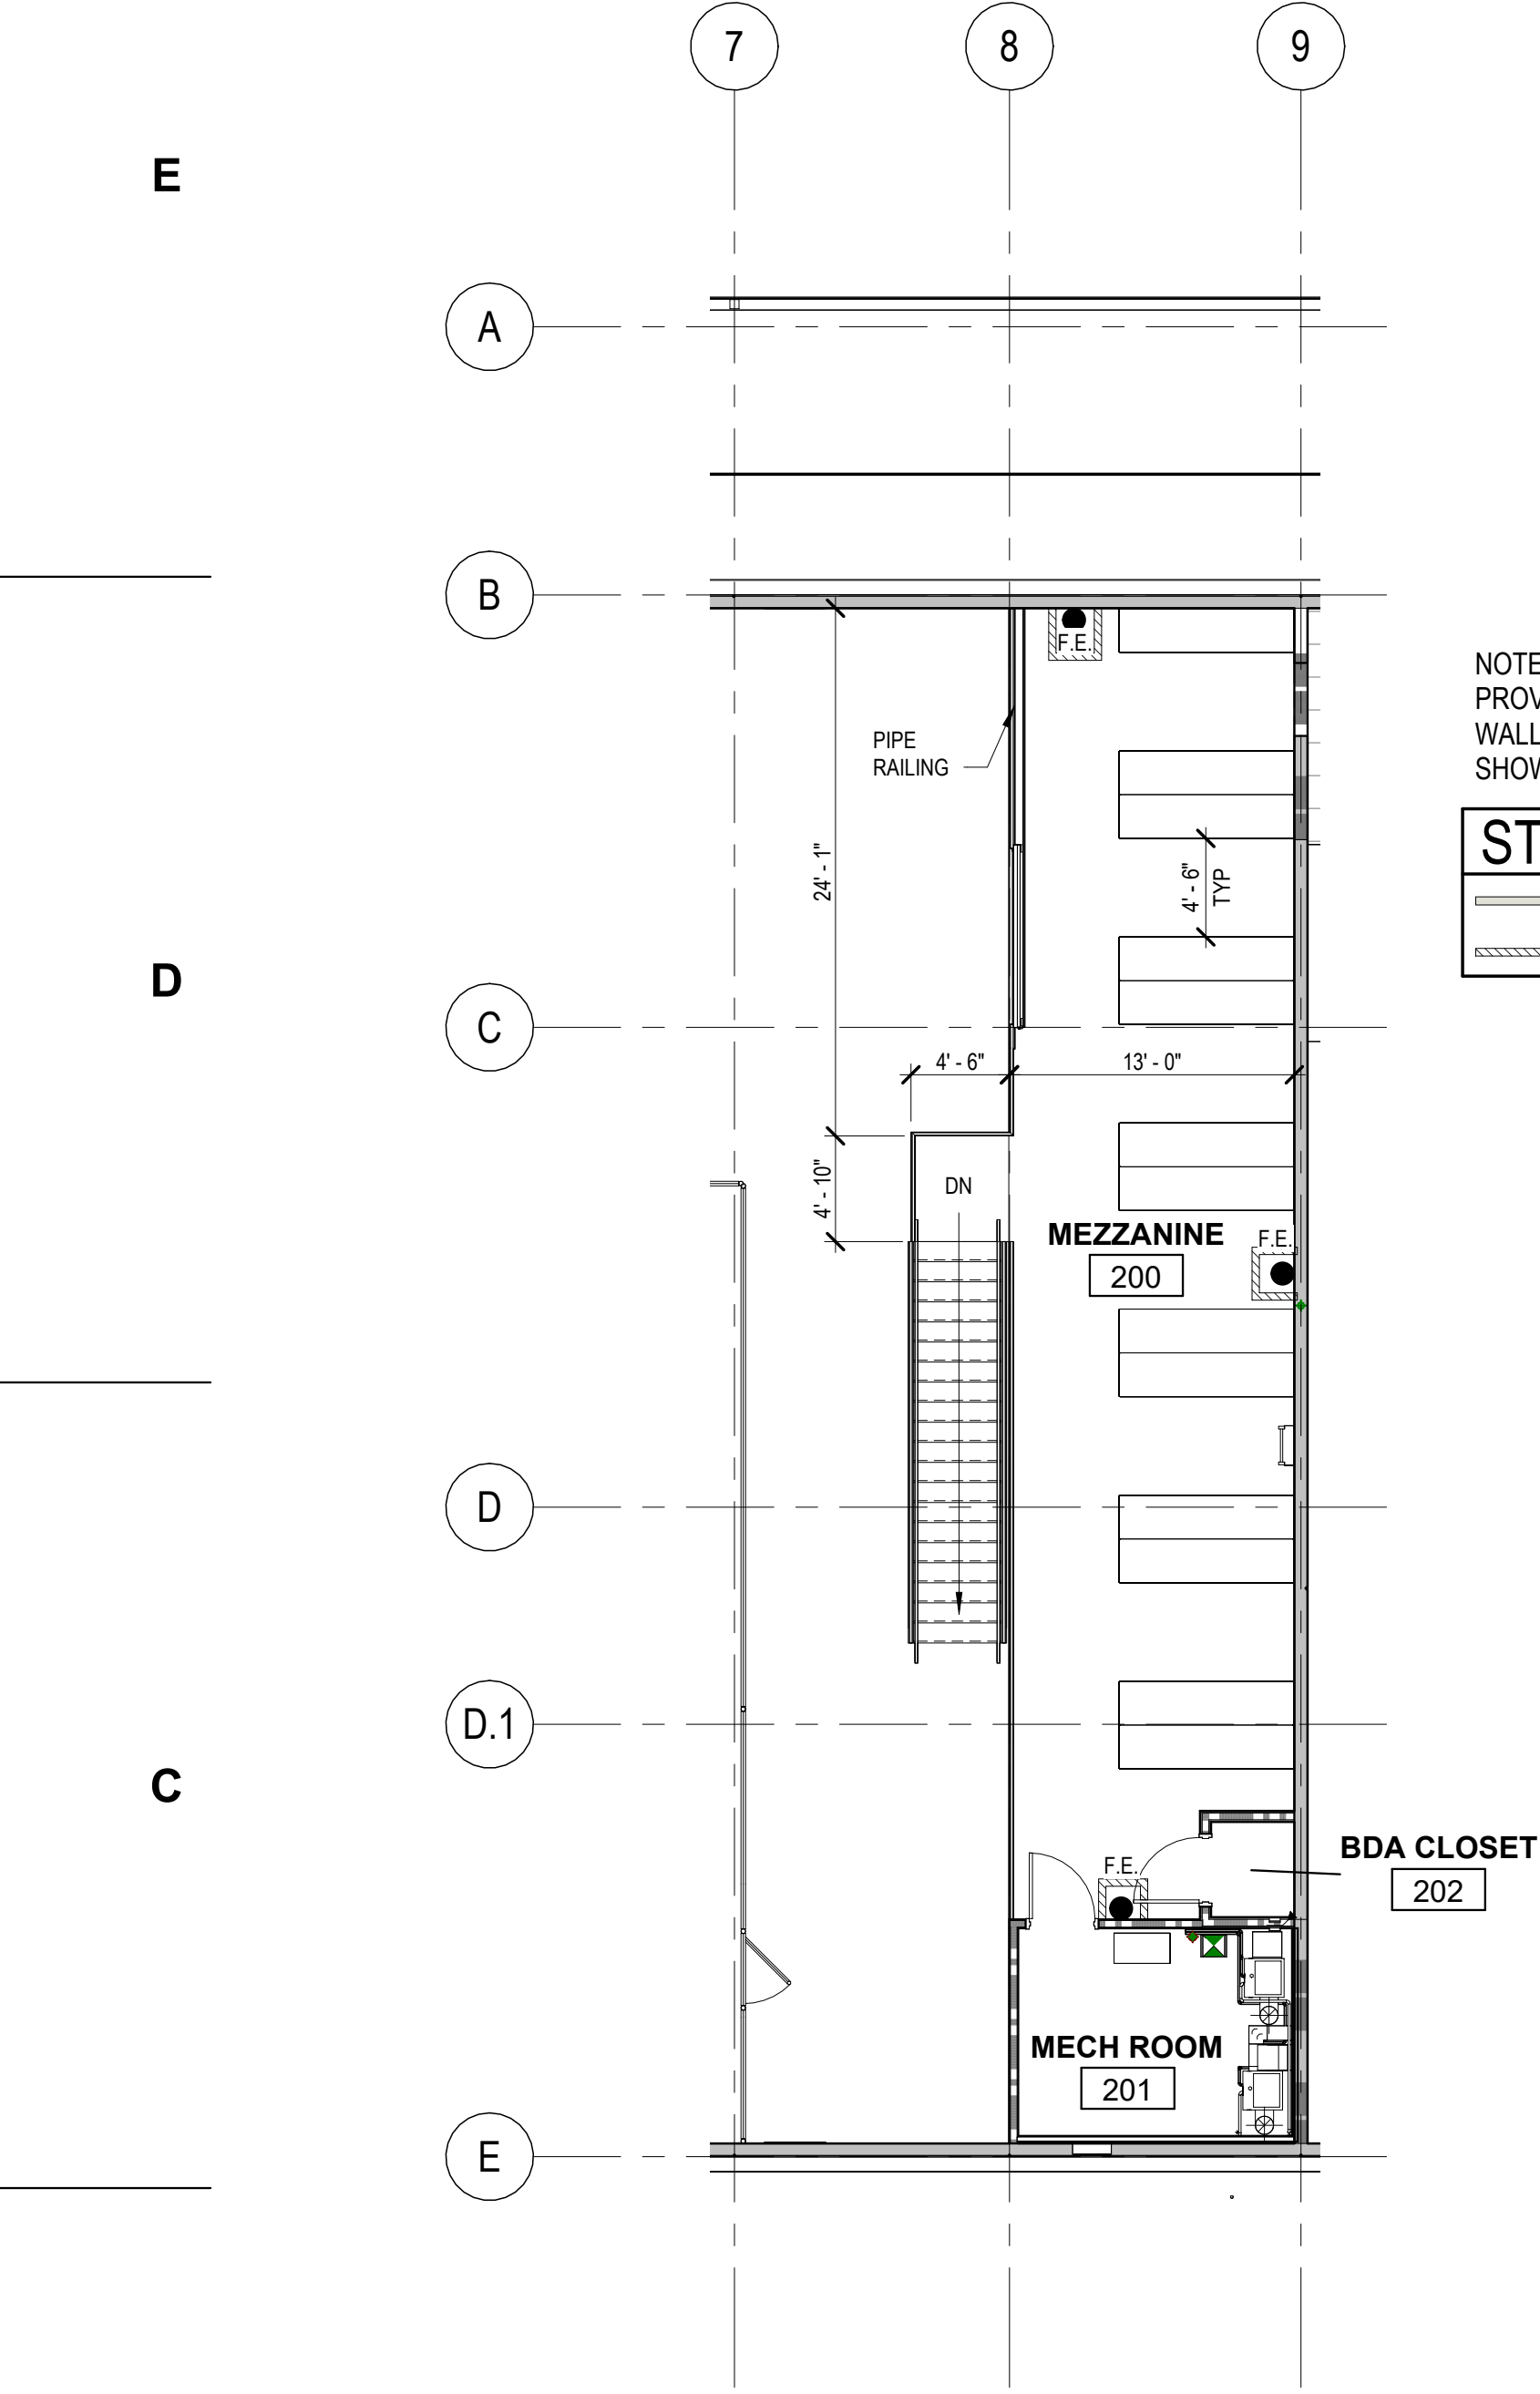

1 MEZZANINE STRIPING PLAN
1/8" = 1'-0"

Architects Engineers, Inc.
5700 North Harbor City Blvd | Suite 400
Melbourne | Florida | 32940
T 321-254-7666 | F 321-259-4703


Offices in Melbourne, Orlando, Boca Raton,
Atlanta, Lynnwood, Charleston and Huntsville

Florida Architectural Business Qualifier #AR97690
Board of Professional Engineers License #1439

These plans are protected by Federal Copyright
protection. Unauthorized use may result in an
infringement action.

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

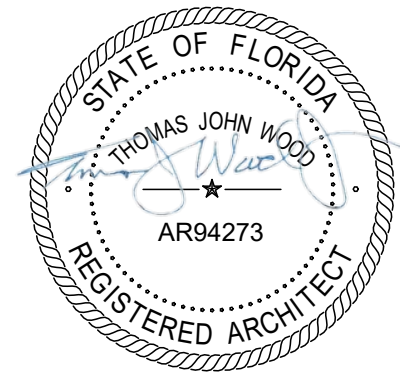

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN

PROJECT NUMBER
C09414.003

DATE
03/15/2026

TITLE

STRIPING PLAN


DRAWING NO.

e-A107


COLOR LEGEND

			TOTAL PER BUILDING	
COLOR	PAINT NAME	MANUFACTURER	AREA SF	%
	COLOR 1- OFF WHITE	SW 6385 DOVER WHITE	415	3.1%
	COLOR 2- LIGHT GRAY	SW 7015 REPOSE GRAY	8,850	67.4%
	COLOR 3- DARK GRAY	SW 7087 CITYSCAPE	3,859	29.4%


NOTE: SEE DETAIL 6/e-A530 FOR WALL COLOR APPLICATION

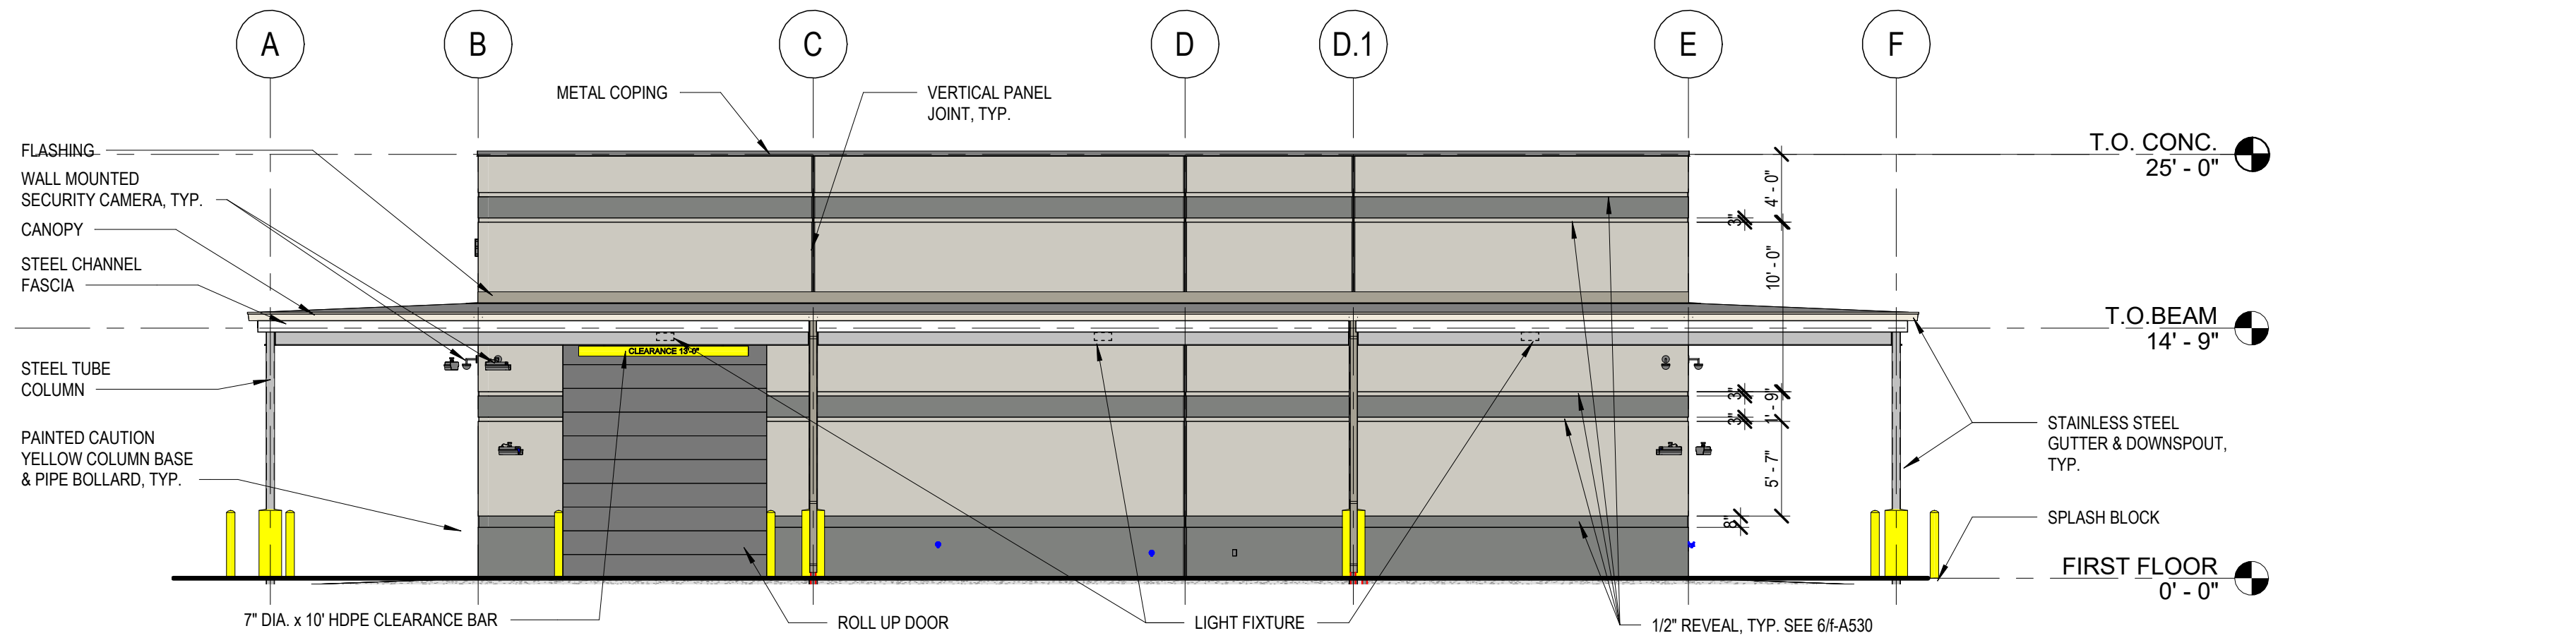


1 SOUTHEAST ELEVATION
1/8" = 1'-0"

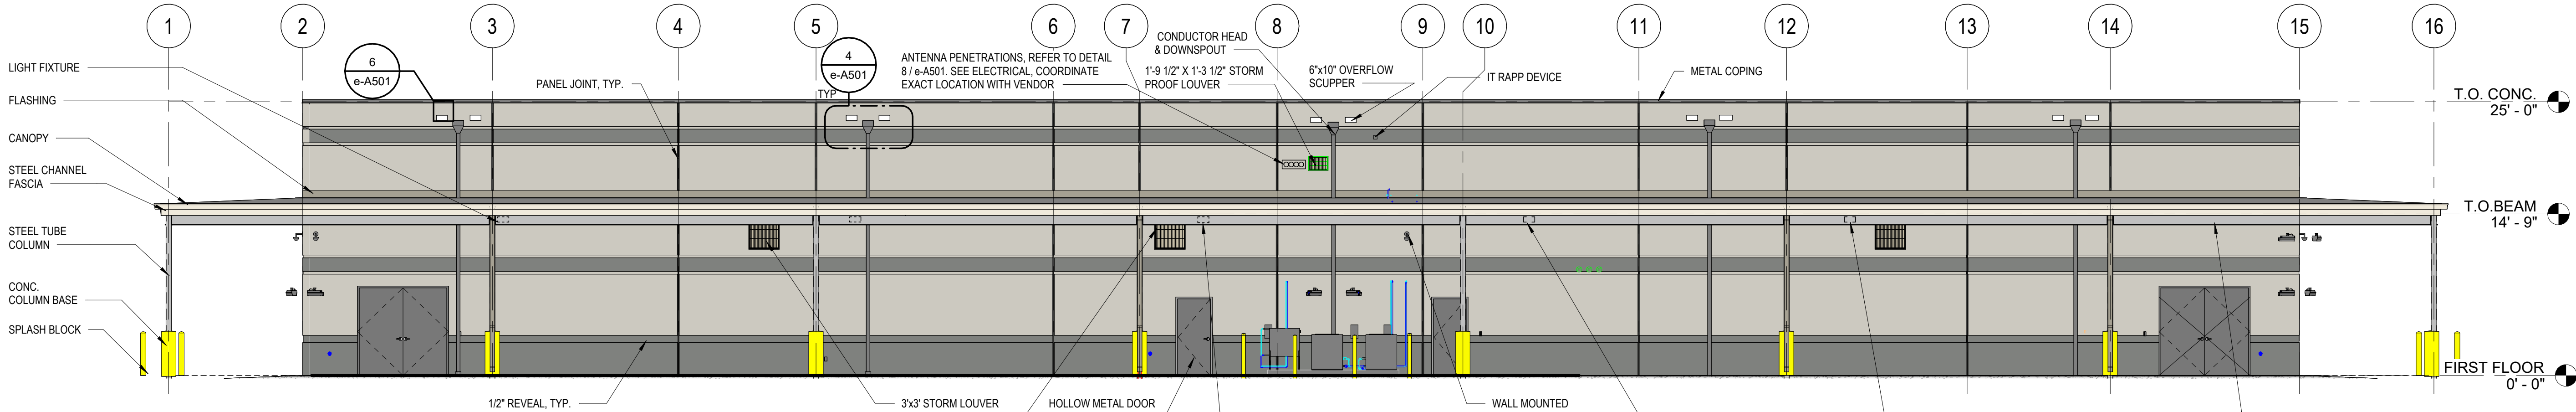

2 NORTHEAST ELEVATION
1/8" = 1'-0"

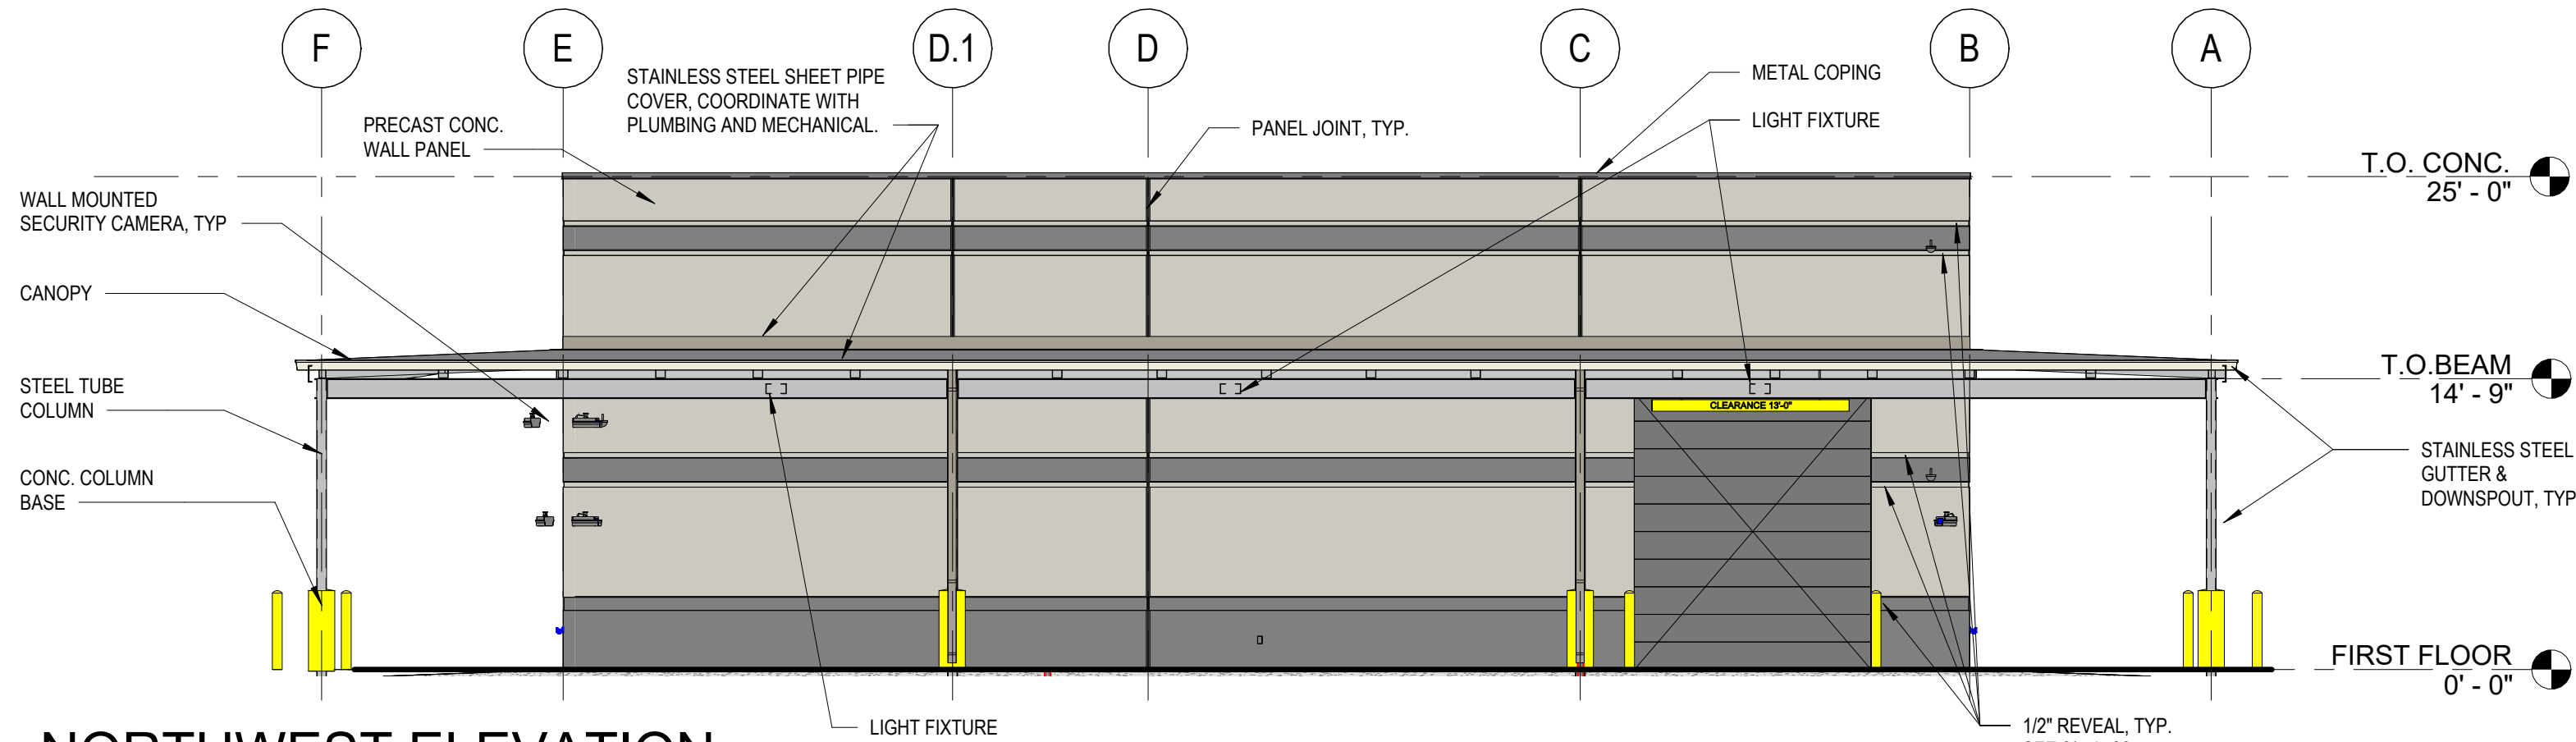

3 NORTHWEST ELEVATION
1/8" = 1'-0"

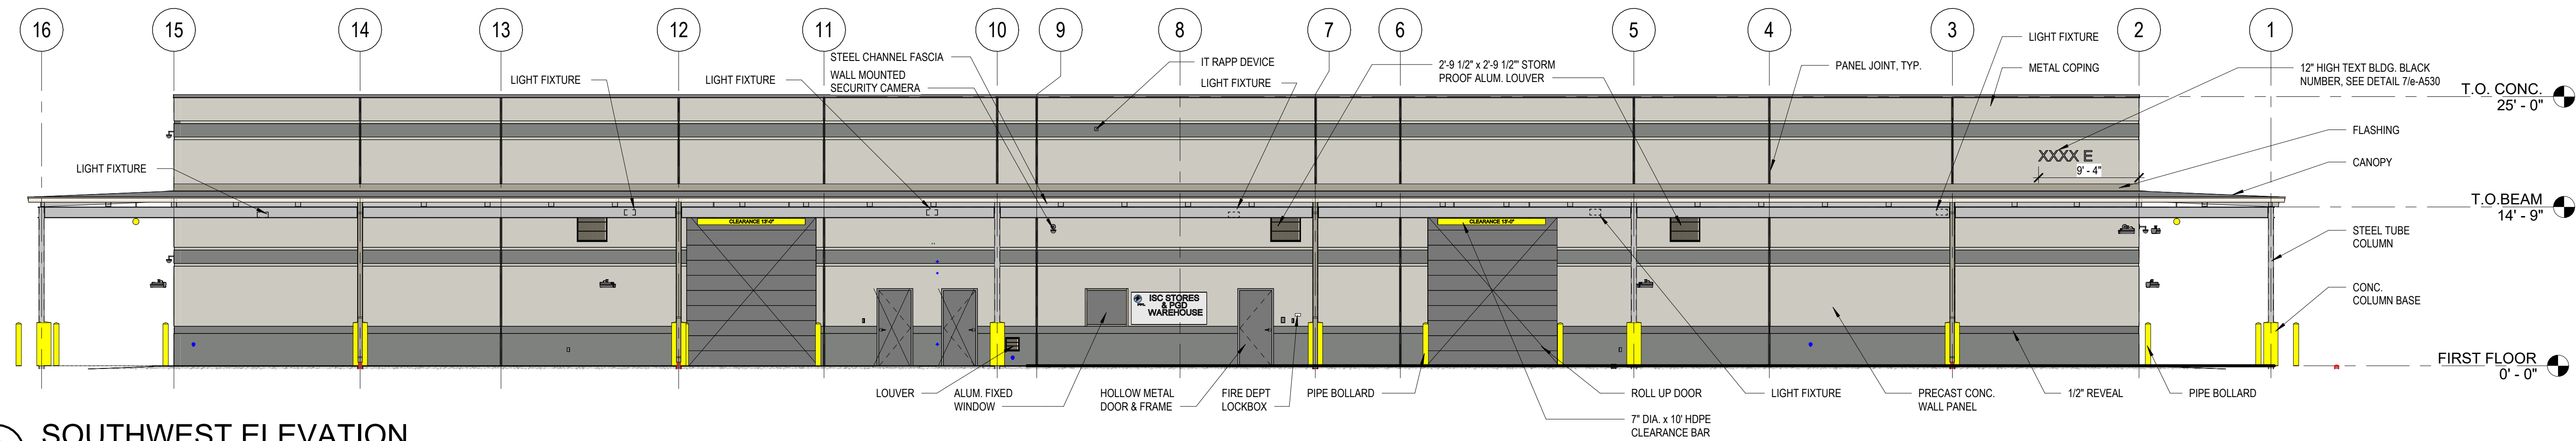


4 SOUTHWEST ELEVATION
1/8" = 1'-0"



DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

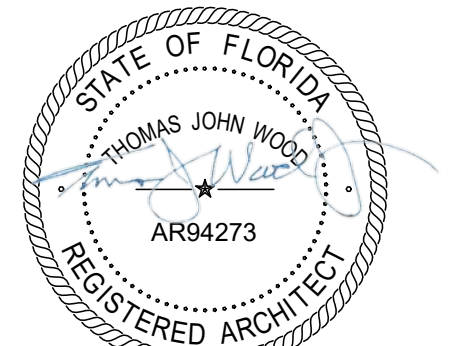

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003
DATE
03/15/2026
TITLE


BUILDING ELEVATIONS

DRAWING NO.

e-A201

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

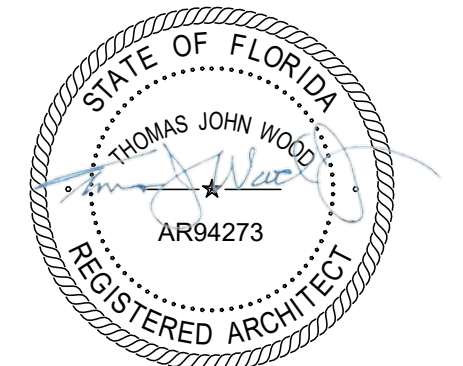

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHITECT OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN


PROJECT NUMBER
C09414.003

DATE
03/15/2026


TITLE
**BUILDING
SECTIONS**

DRAWING NO.


e-A301

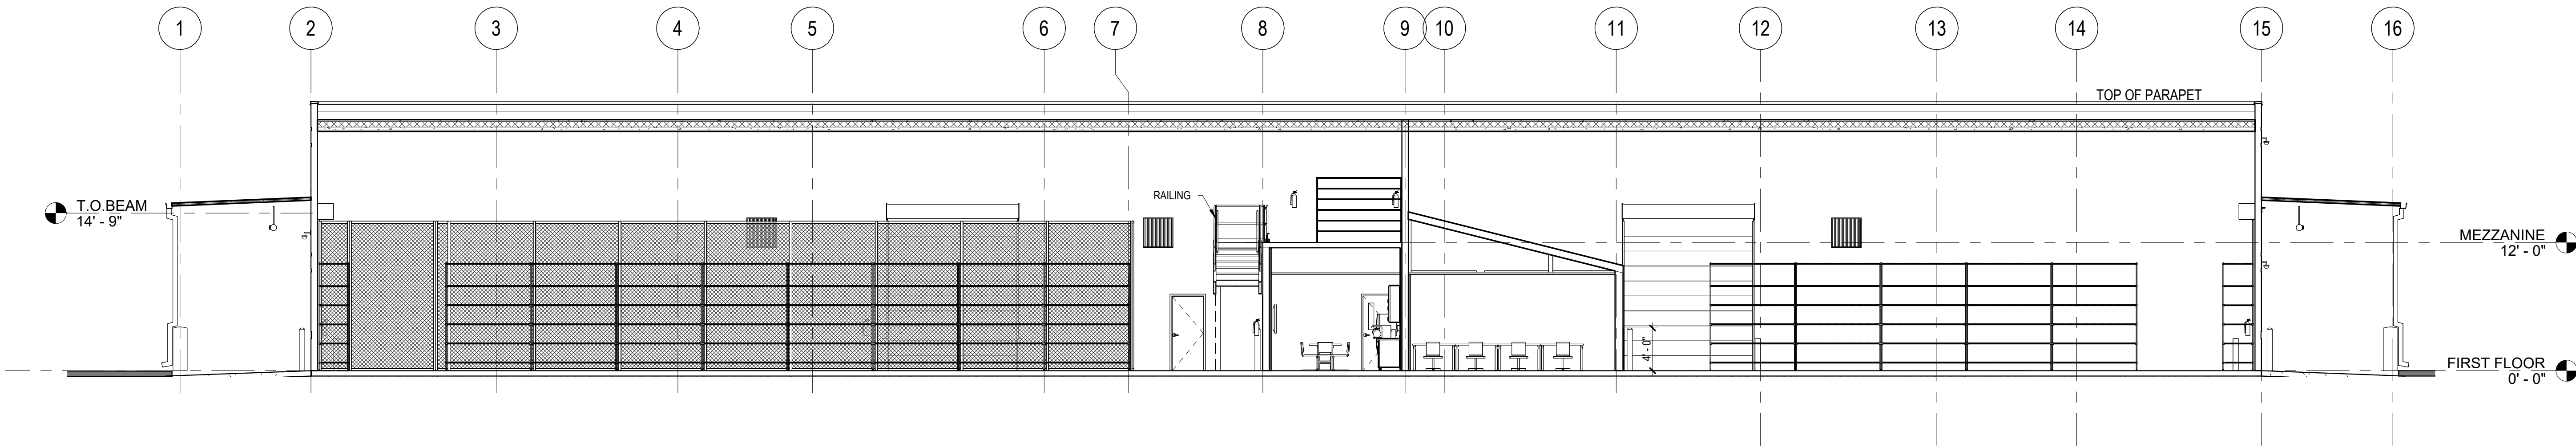

1 BUILDING SECTION S/W
1/8" = 1'-0"

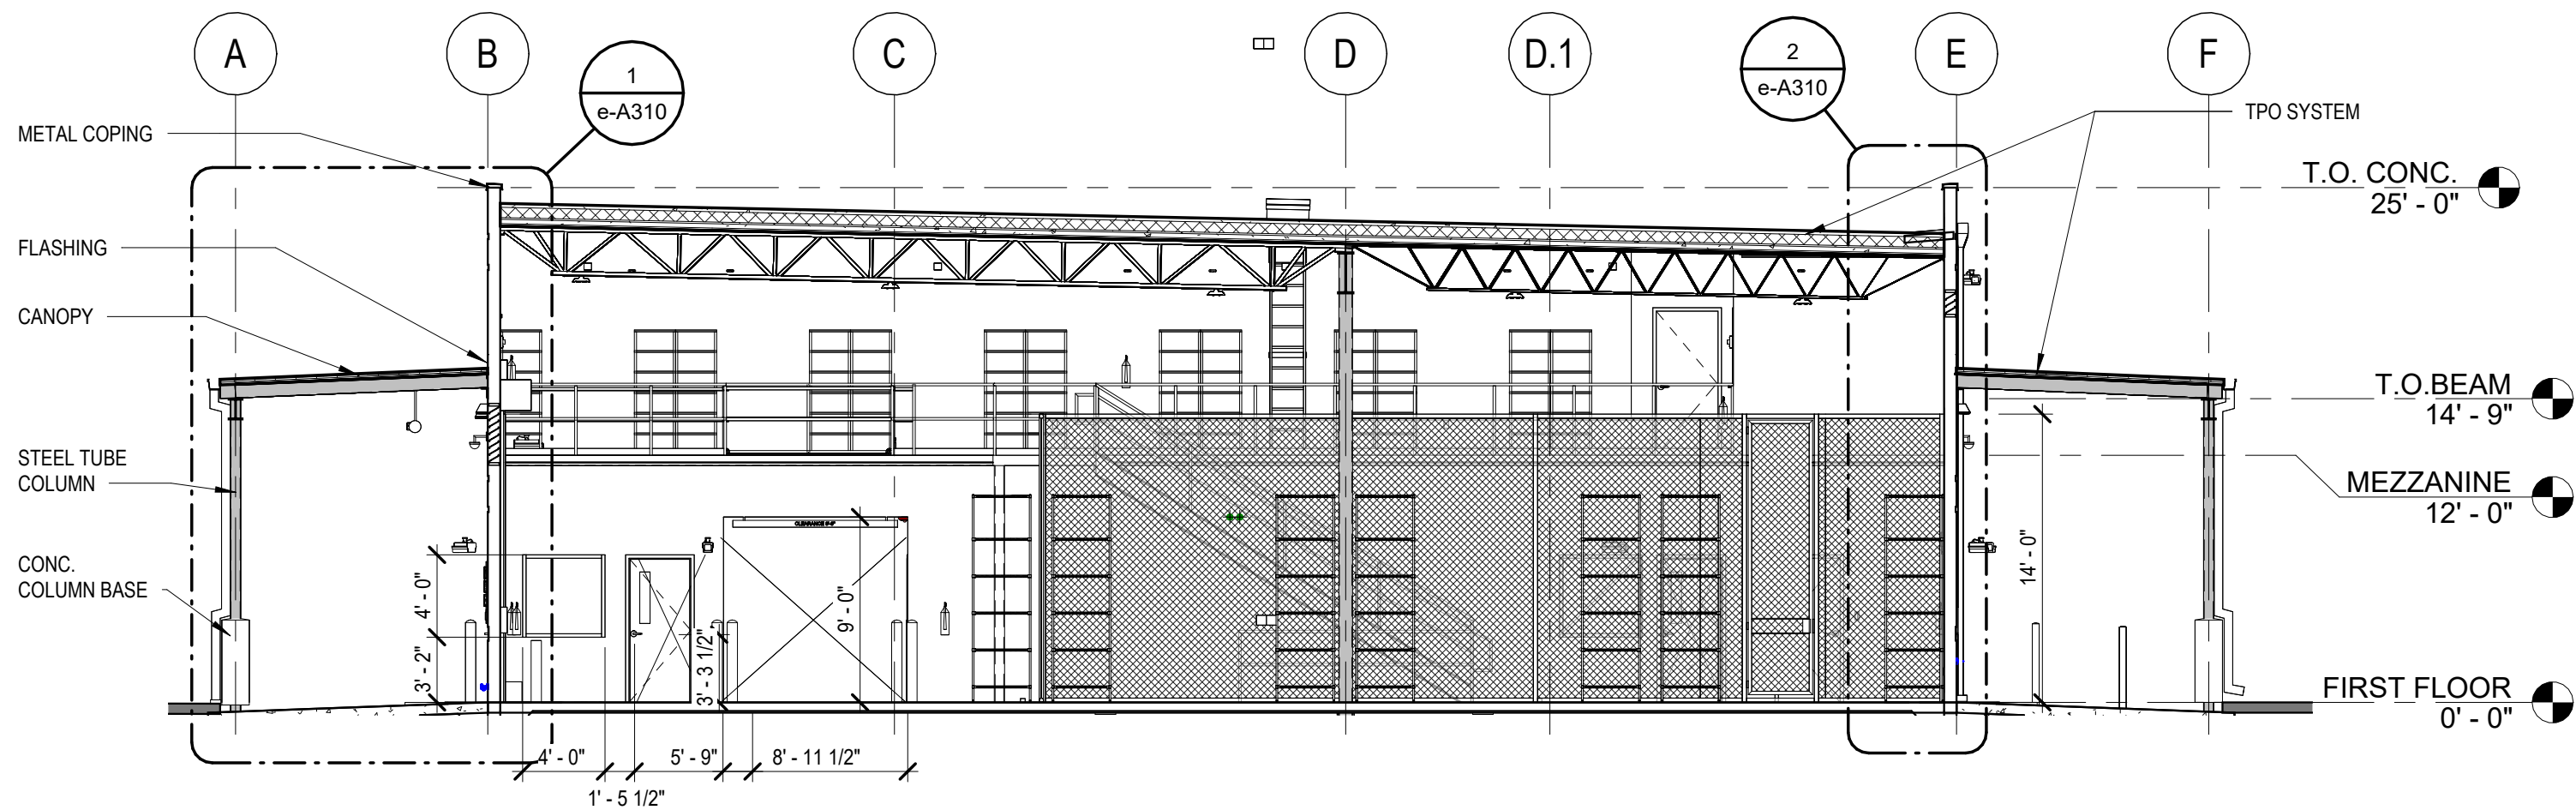

2 BUILDING SECTION W/W
1/8" = 1'-0"

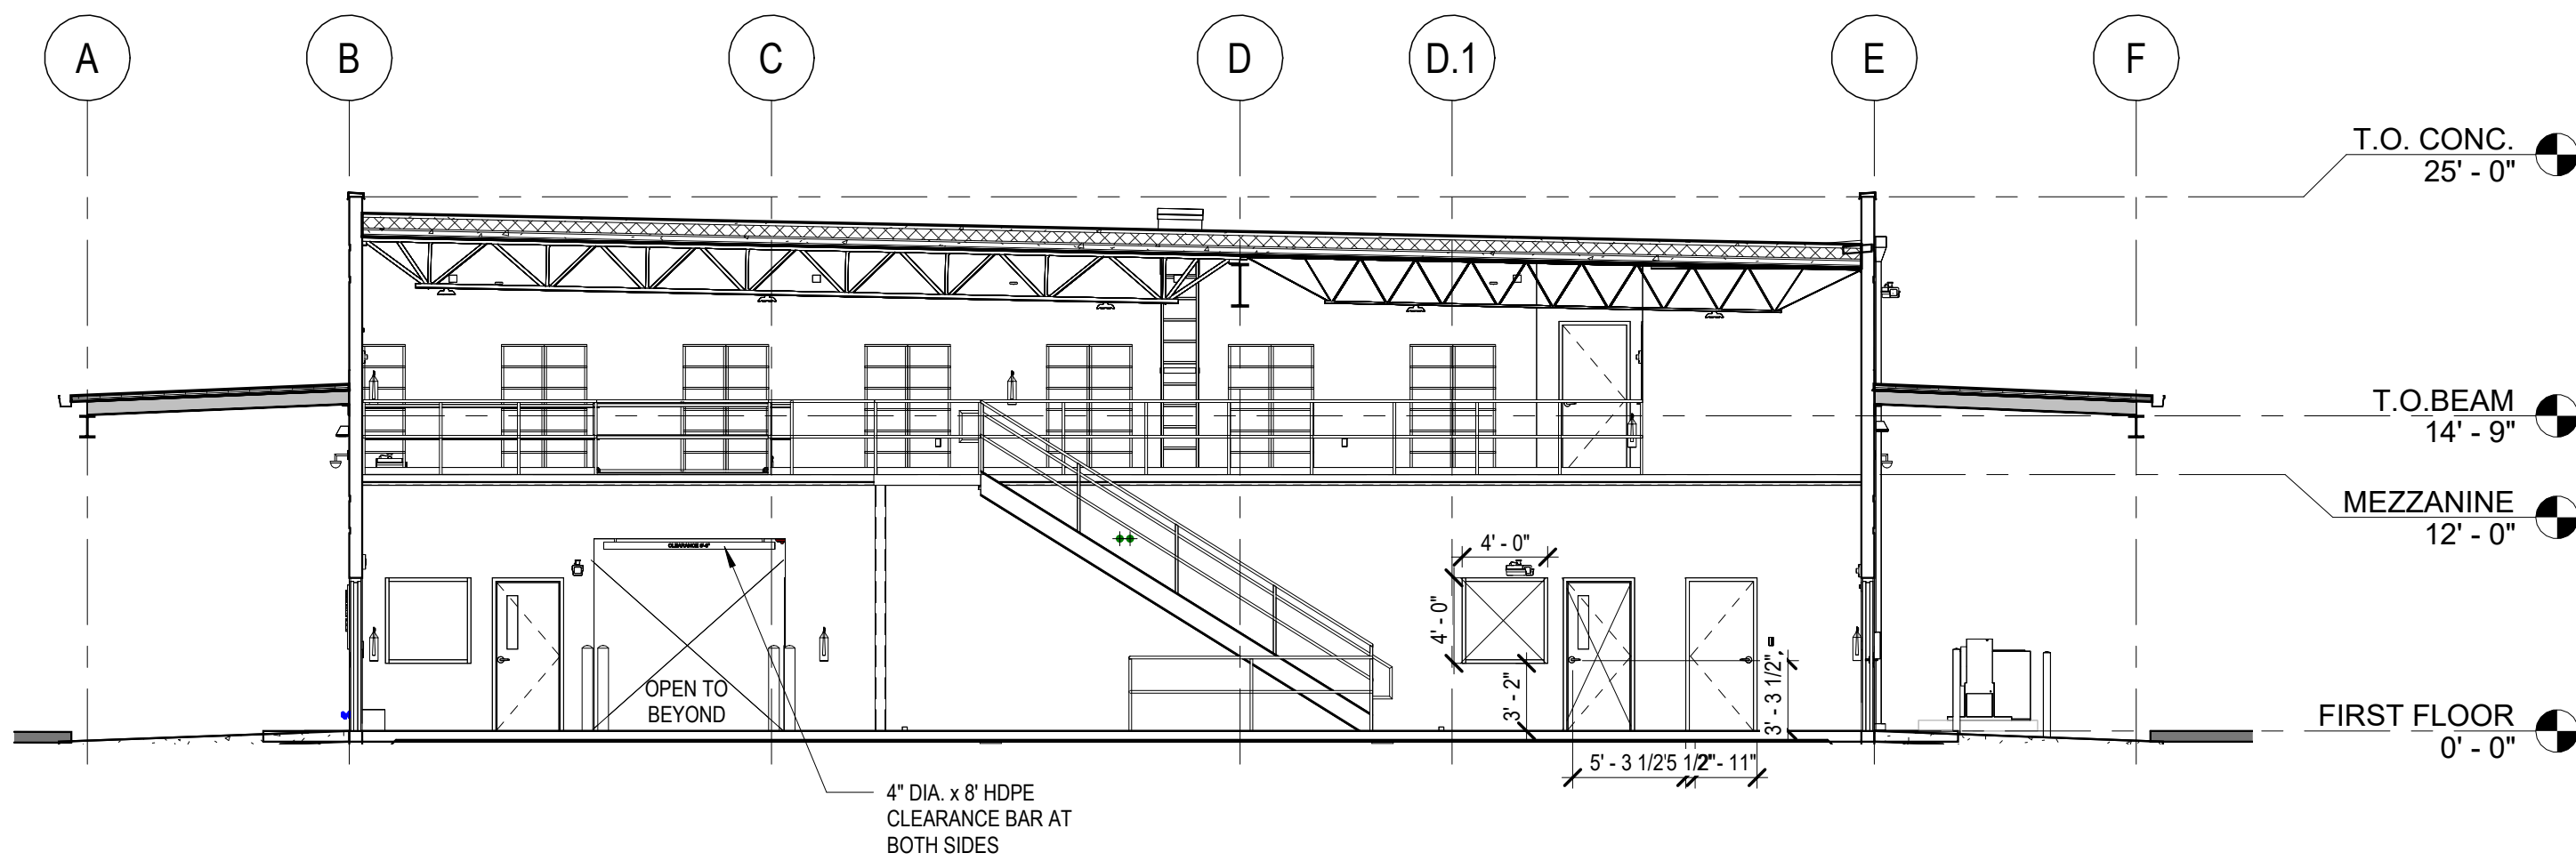


3 BUILDING SECTION W/W 1
1/8" = 1'-0"



DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

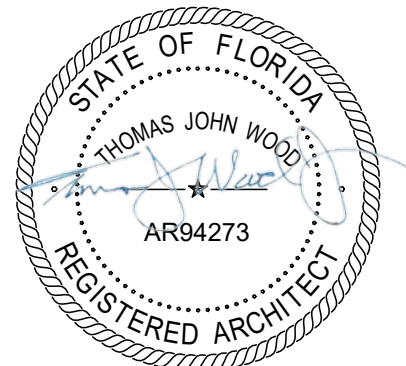

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.


ARCHITECT OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003
DATE
03/15/2026
TITLE


WALL SECTIONS

DRAWING NO.


e-A310

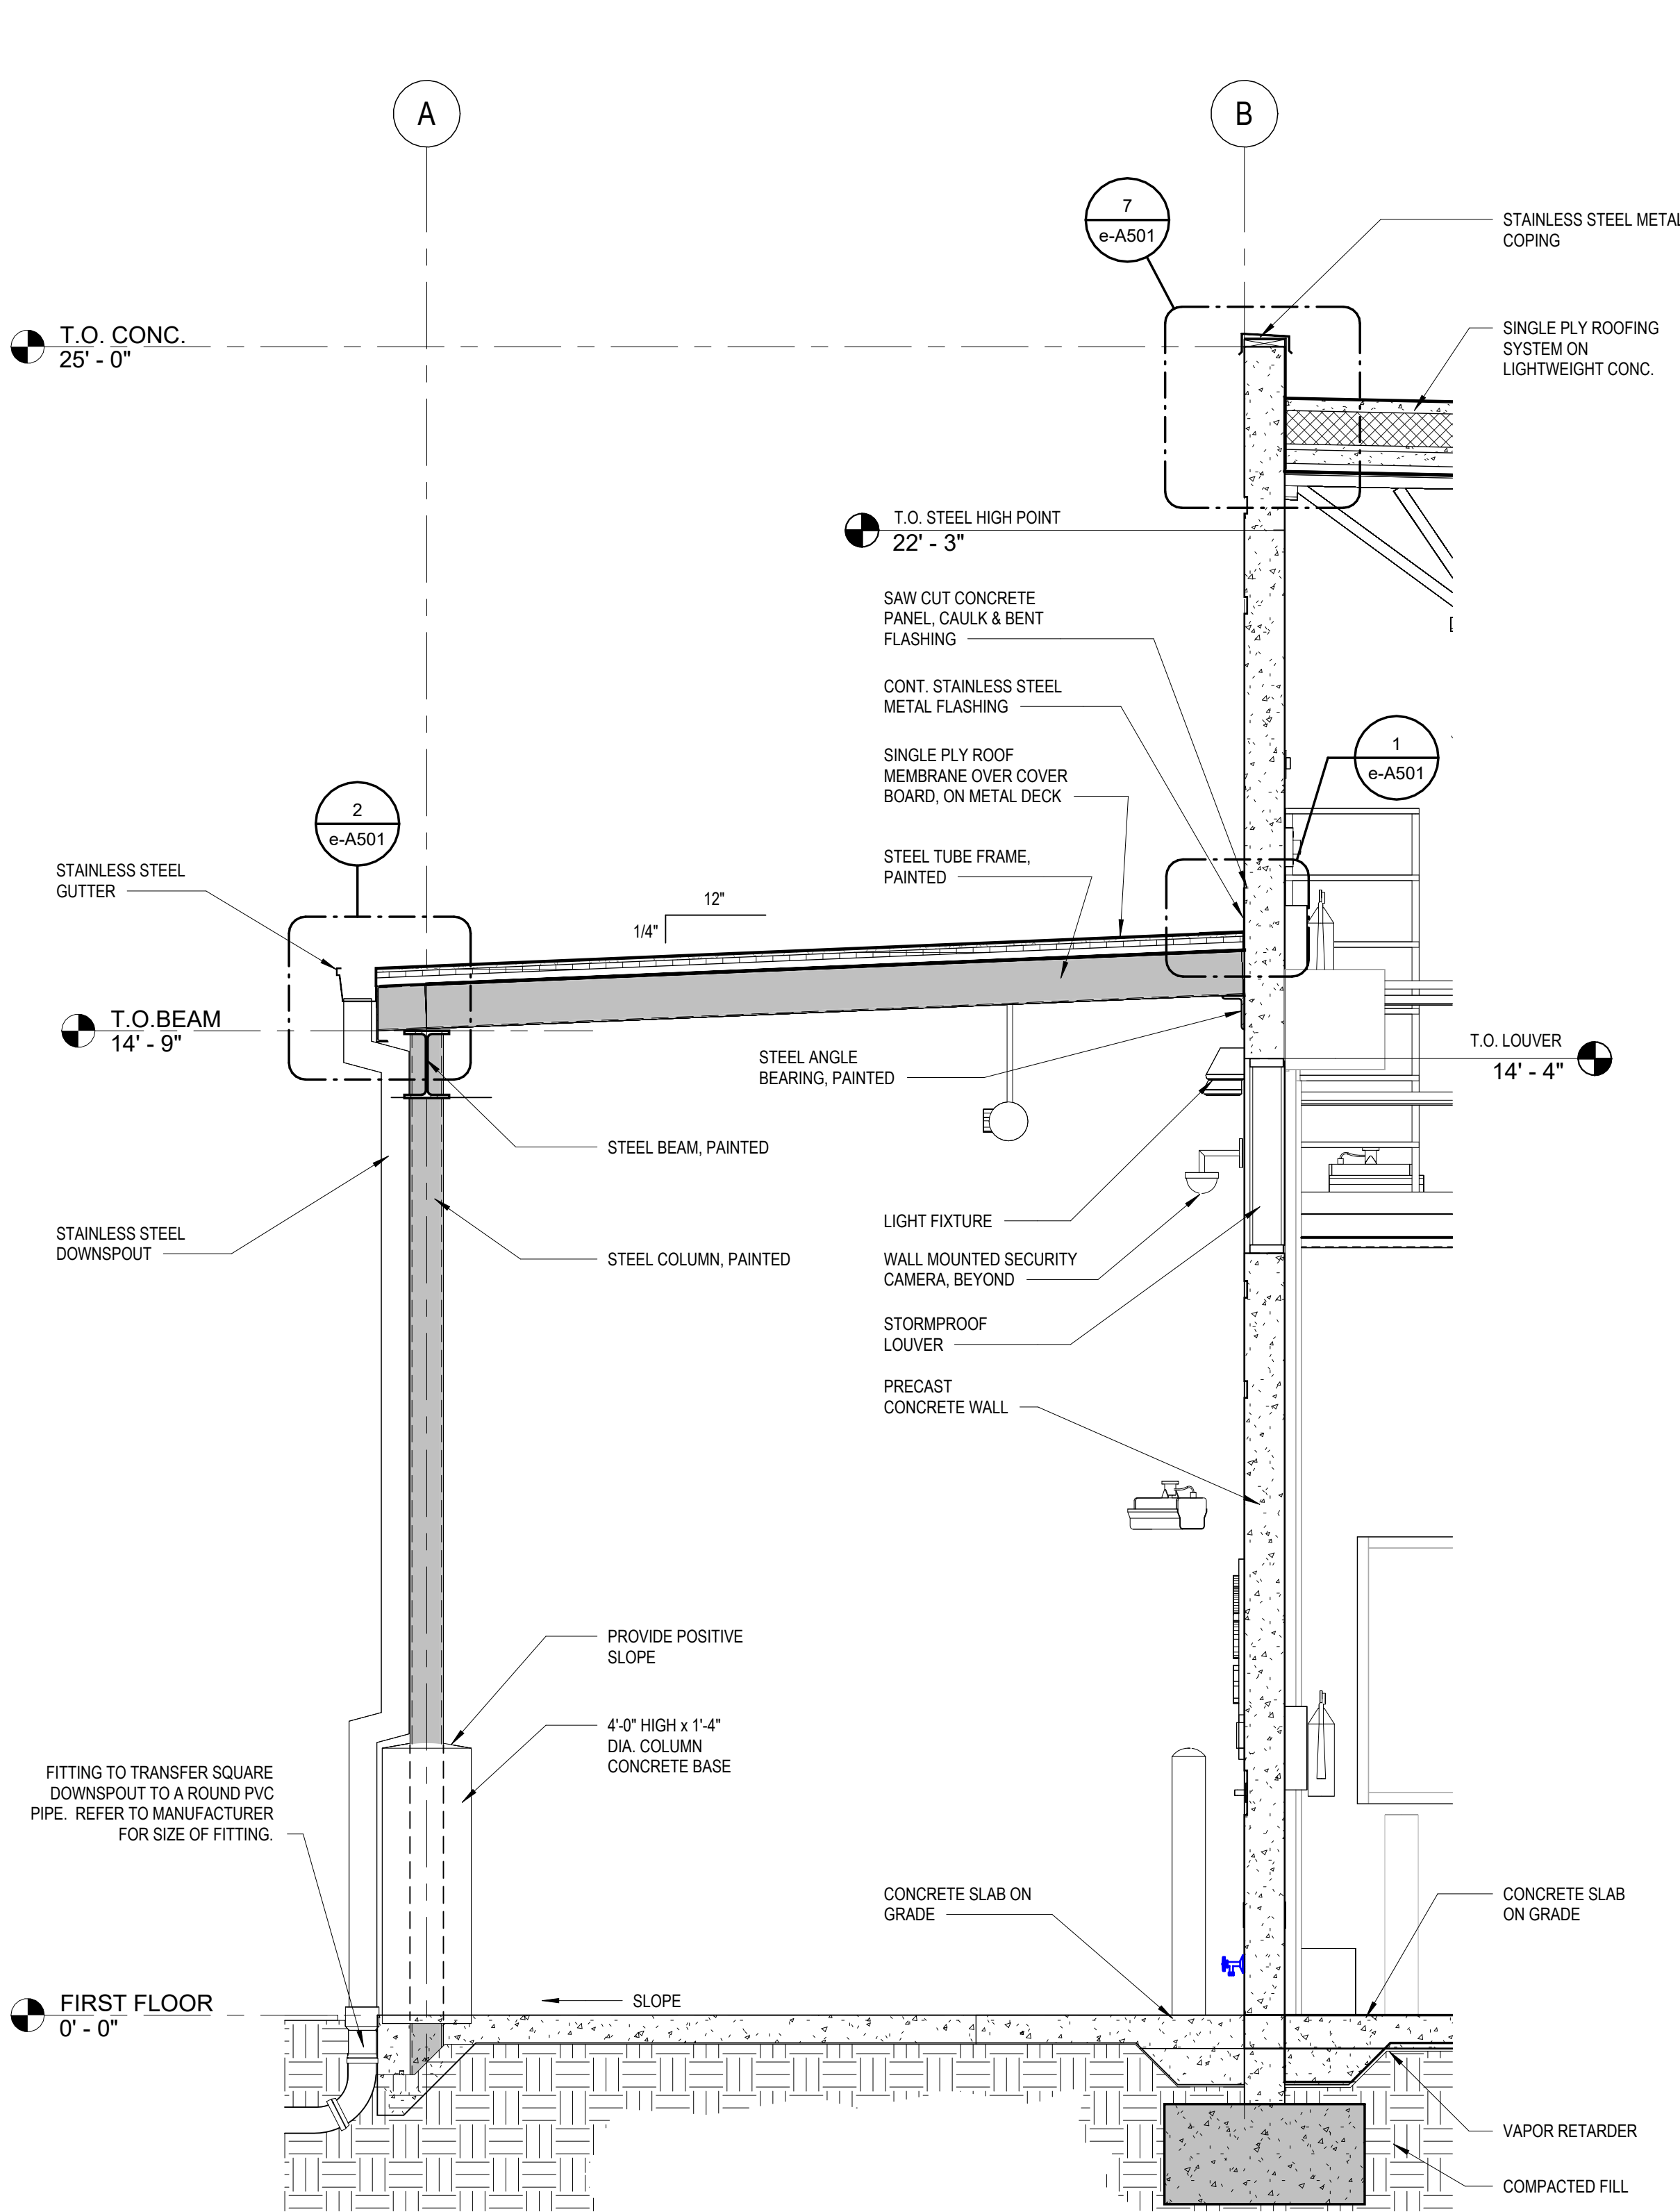

1 WALL SECTION - A
1/2" = 1'-0"

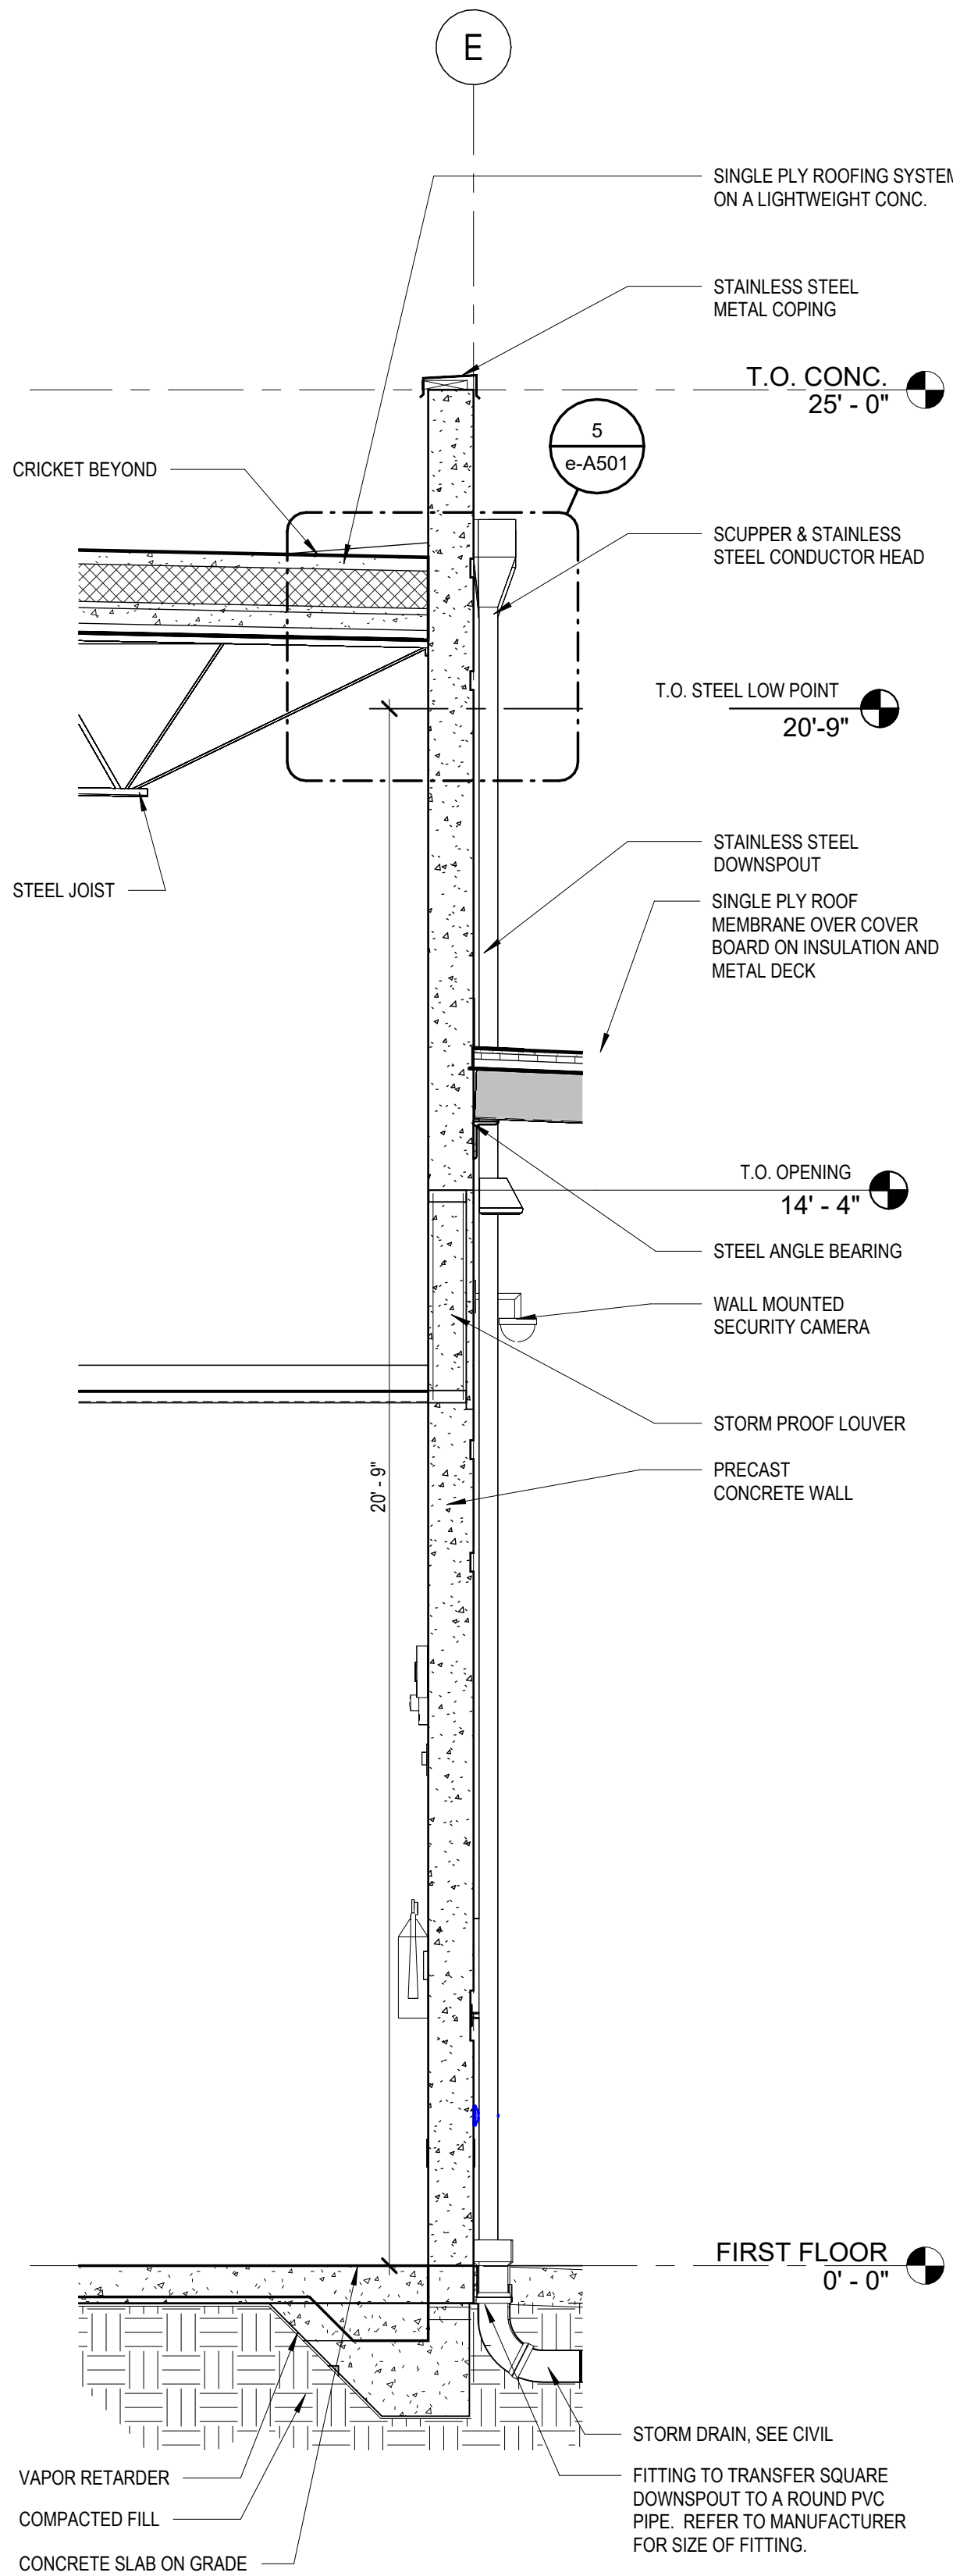

2 WALL SECTION - B
1/2" = 1'-0"

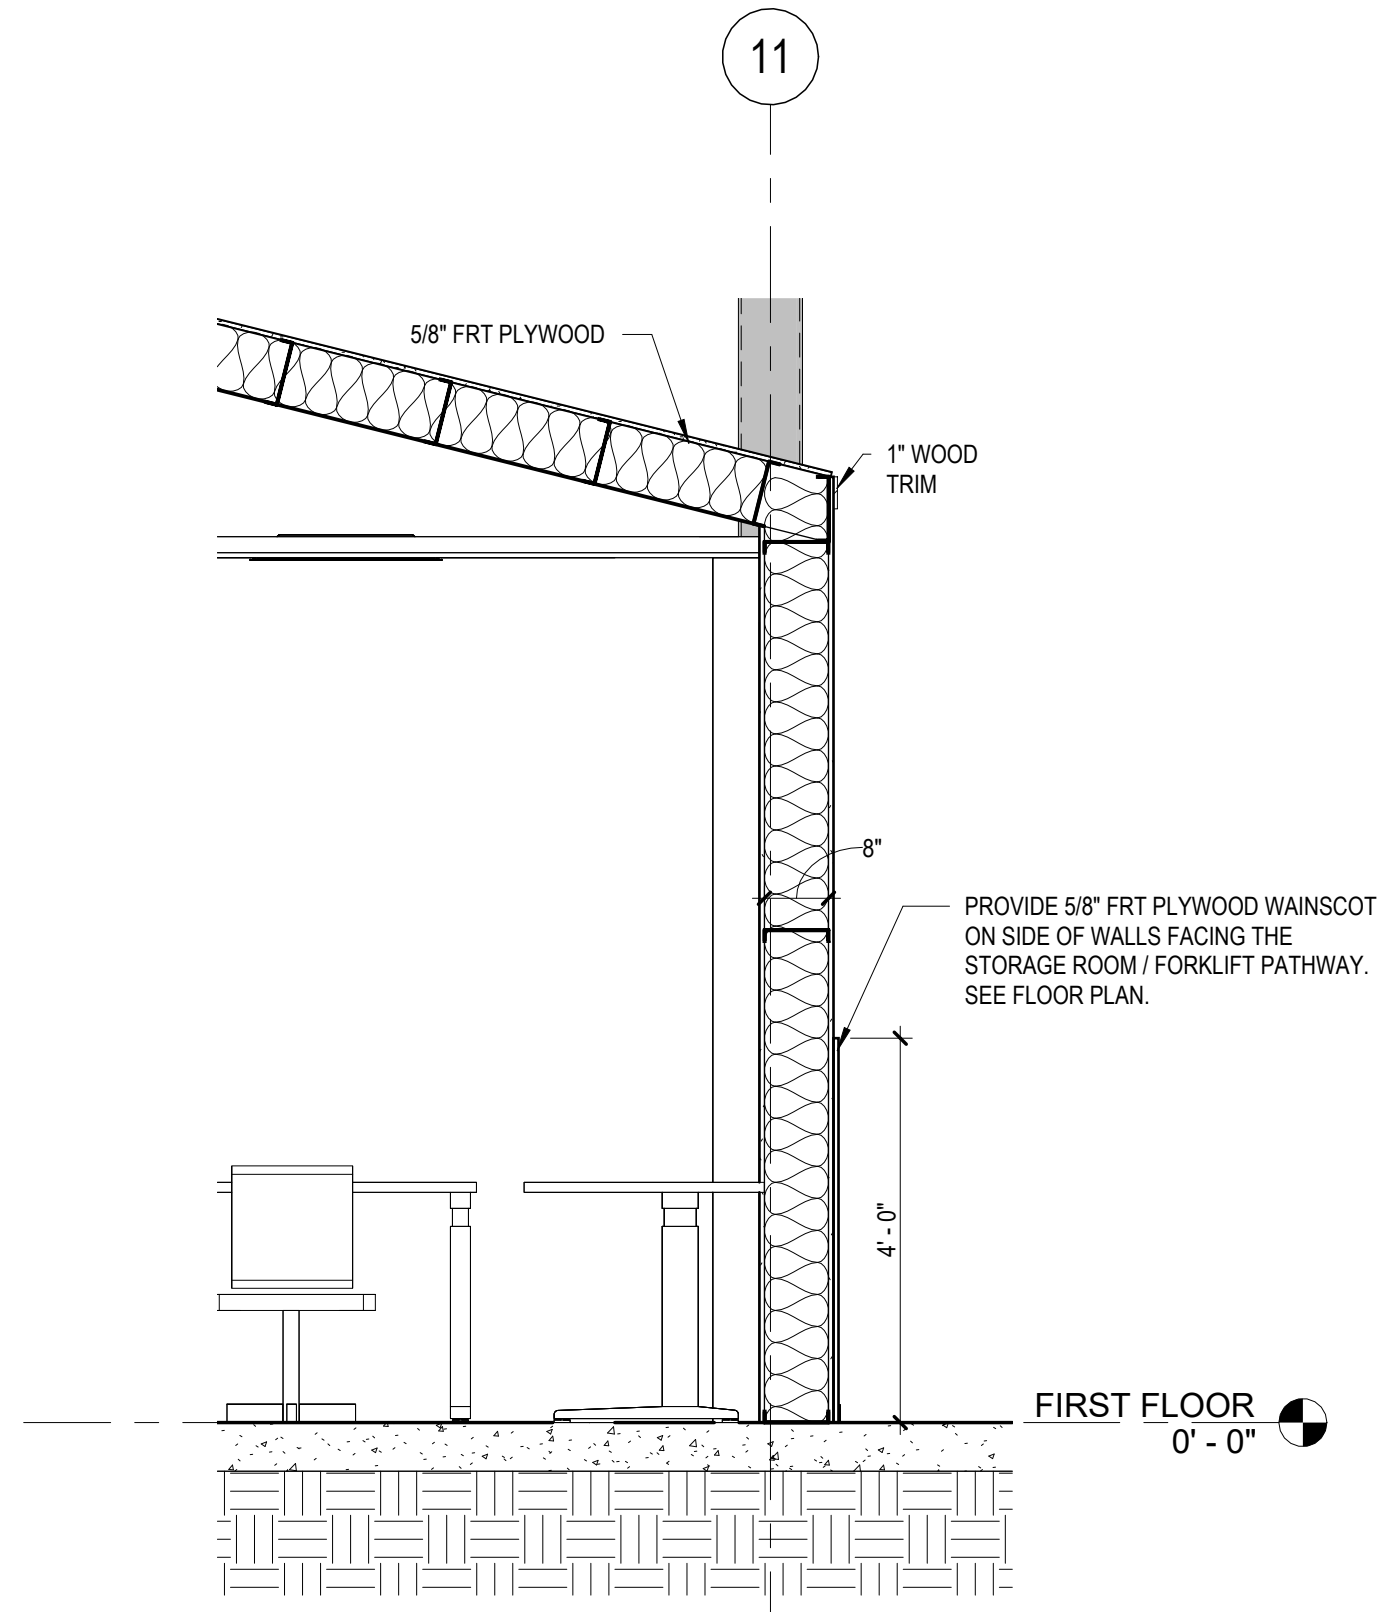

3 SECTION @ OFFICE
1/2" = 1'-0"



Autocad Desc:\C09414.003 - FFL
Columbia Warehouses
Building\C09414003_A_FFL-B_2023_CENTRAL.rvt
3/30/2026 3:30:43 PM

E


D

C



B

A

1 ENLARGED STAIR PLAN
1/4" = 1'-0"

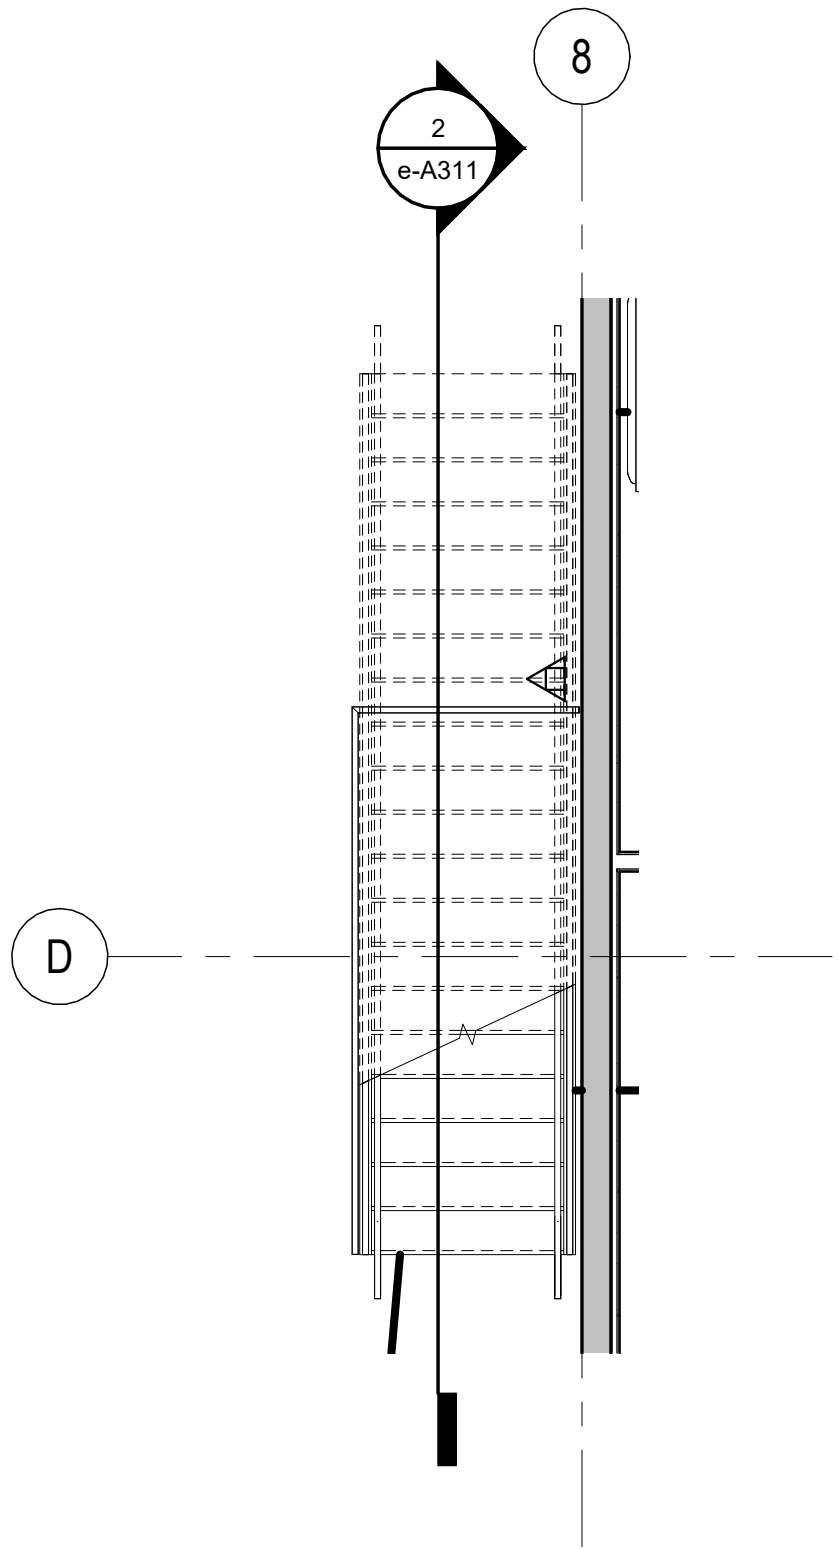


2 STAIR SECTION
1/2" = 1'-0"

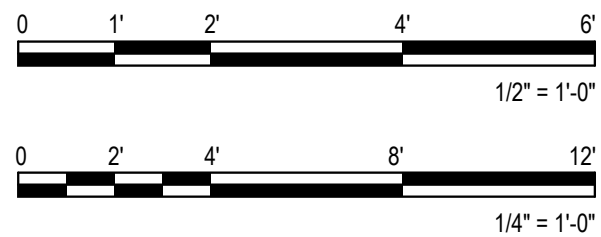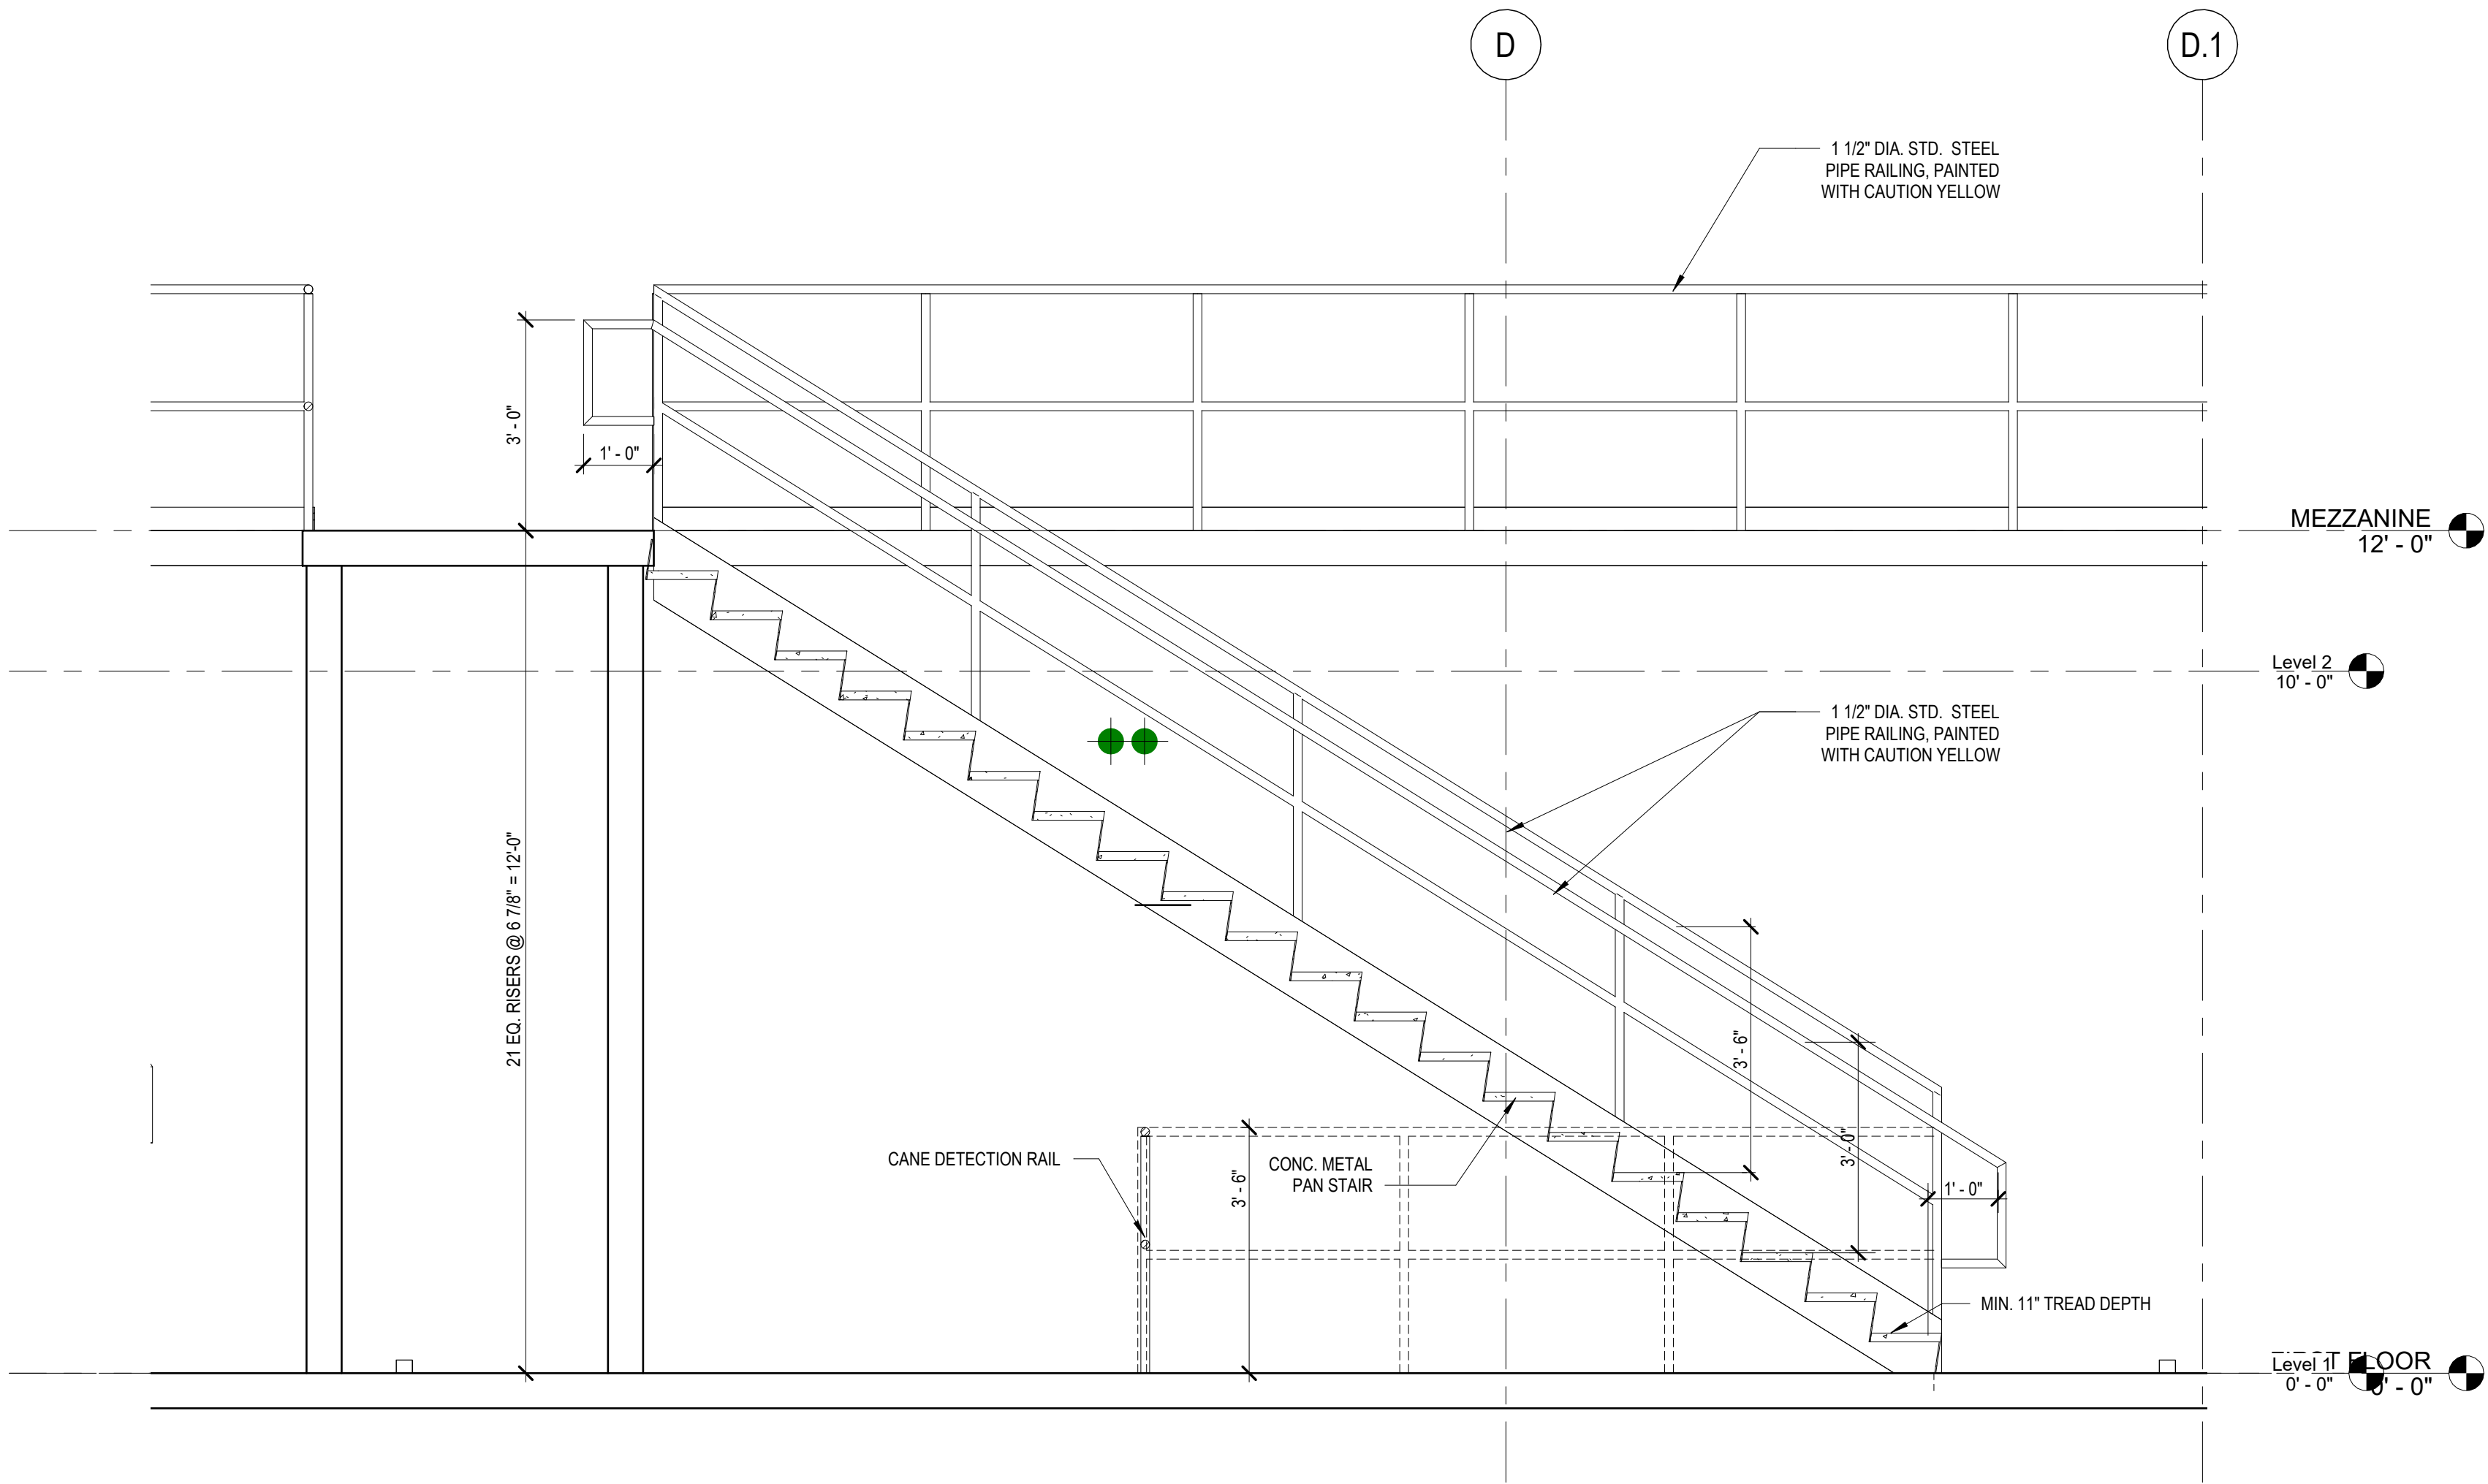

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

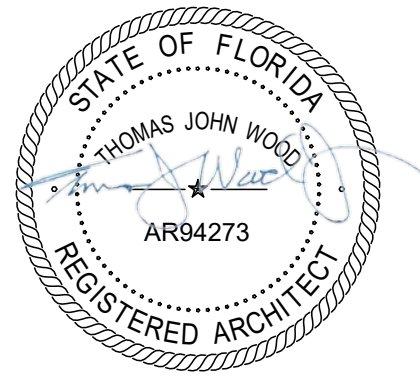

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHITECT OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN

PROJECT NUMBER
C09414.003

DATE
03/15/2026

TITLE

STAIR SECTION &
PLAN

DRAWING NO.

e-A311

RATED WALL U419




BXIV,U419

Fire Resistance Ratings - ANSIUL 263

Design No. U419

April 09, 2013

Nonbearing Wall Ratings — 1, 2, 3 or 4 Hr (See Items 4 & 5)

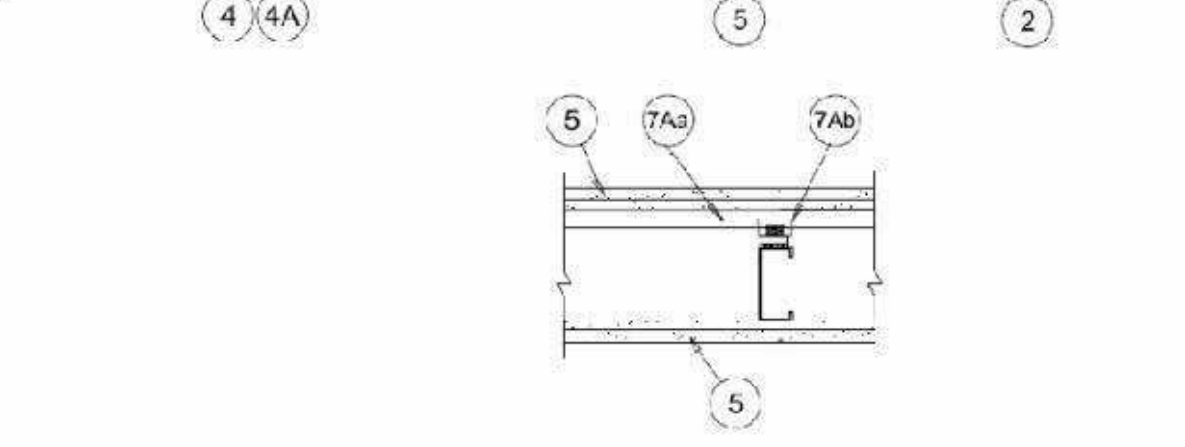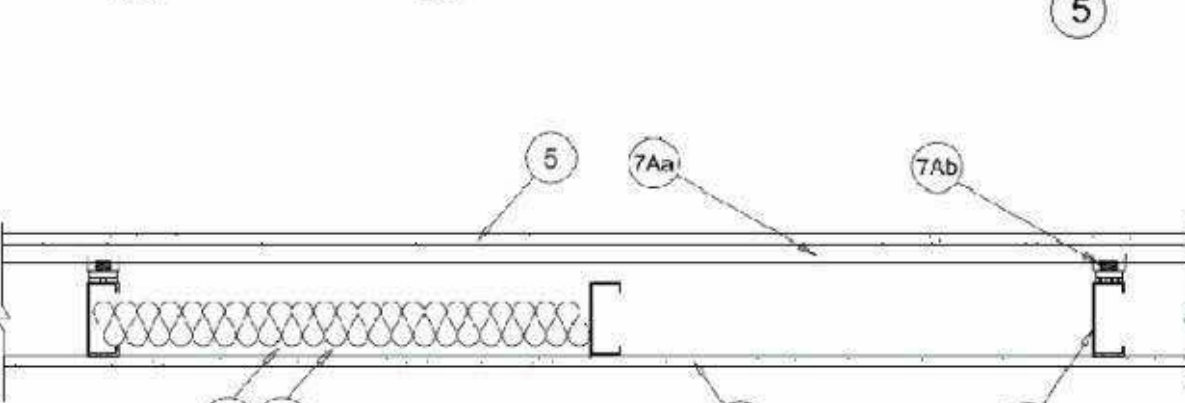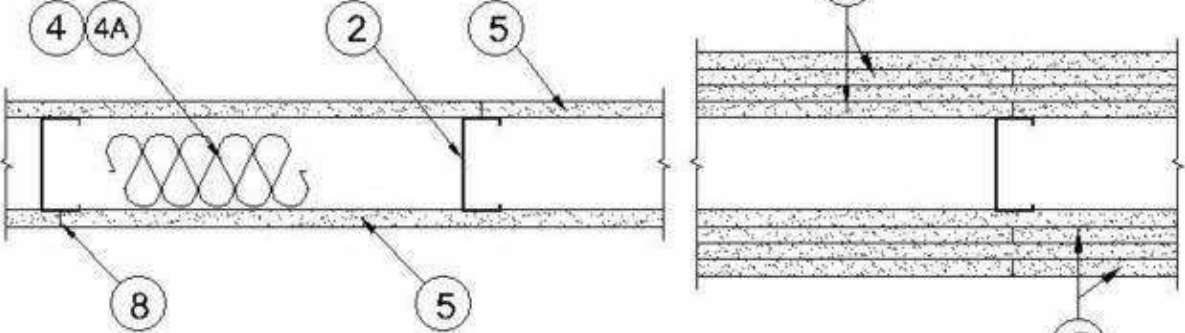

1. **Floor and Ceiling Runners** — (Not shown) — For use with Item 2 - Channel shaped, fabricated from min 25 MSG corrosion-protected steel, min depth to accommodate stud size, with min 1-1/4 in. long legs, attached to floor and ceiling with fasteners 24 in. OC.

1A. **Framing Members* - Floor and Ceiling Runner** — (Not shown - In lieu of Item 1) — For use with Item 2B, proprietary channel shaped runners, 3-5/8 in. deep attached to floor and ceiling with fasteners 24 in. OC max.
CALIFORNIA EXPANDED METAL PRODUCTS CO — Viper25™ Track
CRACO MFG INC — SmartTrack™
MARINOWARE, DIV OF WARE INDUSTRIES INC — Viper25™ Track
PHILLIPS MFG CO L L C — Viper25™ Track
1B. **Framing Members* - Floor and Ceiling Runner** — (Not shown - In lieu of Item 1) — For use with Item 2C, proprietary channel shaped runners, 1-1/4 in. wide by 3-5/8 in. deep fabricated from min 0.020 in. thick galv steel, attached to floor and ceiling with fasteners spaced 24 in. OC max.
CALIFORNIA EXPANDED METAL PRODUCTS CO — Viper20™ Track
MARINOWARE, DIV OF WARE INDUSTRIES INC — Viper20™ Track
PHILLIPS MFG CO L L C — Viper20™ Track
1C. **Framing Members* - Floor and Ceiling Runners** — (Not shown) — In lieu of Item 1 - Channel shaped, attached to floor and ceiling with fasteners 24 in. OC. max.
ALLSTEEL & GYPSUM PRODUCTS INC — Type SUPREME Framing System
CONSOLIDATED FABRICATORS CORP. BUILDING PRODUCTS DIV — Type SUPREME Framing System
QUAIL RUN BUILDING MATERIALS INC — Type SUPREME Framing System
SCAFCO STEEL STUD MANUFACTURING CO — Type SUPREME Framing System
STEEL CONSTRUCTION SYSTEMS INC — Type SUPREME Framing System
UNITED METAL PRODUCTS INC — Type SUPREME Framing System

1D. **Floor and Ceiling Runners** — (Not shown) — For use with Item 2A, Channel shaped, fabricated from min 20 MSG corrosion-protected or galv steel, min depth to accommodate stud size, with min 1 in. long legs, attached to floor and ceiling with fasteners spaced max 24 in. OC.

1E. **Framing Members* - Floor and Ceiling Runners** — (Not shown, As an alternate to Item 1) — For use with Items 2E, 5F or 5G or 5I only, channel shaped, fabricated from min. 0.015 in. (min bare metal thickness) galvanized steel, attached to floor and ceiling with fasteners 24 in. OC. max.

CLARKDIETRIK BUILDING SYSTEMS — CD ProTRAK
DMFCWBS L L C — ProTRAK
MBA BUILDING SUPPLIES — ProTRAK
RAM SALES L L C — Ram ProTRAK
SOUTHEASTERN STUD & COMPONENTS INC — ProTRAK
STEEL STRUCTURAL SYSTEMS L L C — Tri-S ProTRAK
1F. **Framing Members* - Floor and Ceiling Runner** — (Not shown - In lieu of Item 2F, proprietary channel shaped runners, minimum width to accommodate stud size, with 1 - 1/8 in. long legs fabricated from min 0.015 in. (min bare metal thickness) galv steel, attached to floor and ceiling with fasteners spaced 24 in. OC. max.
SUPER STEEL BUILDING PRODUCTS — The Edge
1G. **Framing Members* - Floor and Ceiling Runner** — (Not shown - In lieu of Item 2G, proprietary channel shaped runners, minimum width to accommodate stud size attached to floor and ceiling with fasteners 24 in. OC. max.

STUCCO BUILDING SYSTEMS — CROCSTUD
1H. **Floor and Ceiling Runners** — (Not shown) — Channel shaped, fabricated from min 0.02 in. galv steel, min width to accommodate stud size, with min 1 in. long legs, for use with studs specified below and fabricated from min 0.02 in. galv steel or thicker, attached to floor and ceiling with fasteners spaced max 24 in. OC.

MARINOWARE, DIV OF WARE INDUSTRIES INC — Viper20™ Track VT100.
1I. **Framing Members* - Floor and Ceiling Runners** — (Not shown, As an alternate to Item 1) — For use with Items 2H, channel shaped, fabricated from min. 0.015 in. (min bare metal thickness) galvanized steel, attached to floor and ceiling with fasteners 24 in. OC. max.

TELLING INDUSTRIES L L C — TRUE-TRACK™
1J. **Framing Members* - Floor and Ceiling Runner** — (Not shown - In lieu of Item 2I, proprietary channel shaped runners, 3-5/8 in. deep attached to floor and ceiling with fasteners 24 in. OC. max.
TELLING INDUSTRIES L L C — Viper25™ Track

1K. **Framing Members* - Floor and Ceiling Runner** — (Not shown - In lieu of Item 1) — For use with Item 2J, proprietary channel shaped runners, 1-1/4 in. wide by 3-5/8 in. deep fabricated from min 0.020 in. thick galv steel, attached to floor and ceiling with fasteners spaced 24 in. OC. max.

TELLING INDUSTRIES L L C — Viper20™ Track
2. **Steel Studs** — Channel shaped, fabricated from min 25 MSG corrosion-protected steel, min depth as indicated under Item 5, spaced a max of 24 in. OC. Studs to be cut 3/8 to 3/4 in. less than assembly height.

2A. **Steel Studs** — (As an alternate to Item 2, For use with Items 5B, 5E, 5H and 5J) Channel shaped, fabricated from min 20 MSG corrosion-protected or galv steel, 3-1/2 in. min depth, spaced a max of 16 in. OC. Studs friction-fit into floor and ceiling runners. Studs to be cut 5/8 to 3/4 in. less than assembly height.

2B. **Framing Members* - Steel Studs** — (As an alternate to Item 2, For use with Items 5C or 5I) - Proprietary channel shaped studs, 3-5/8 in. deep spaced a max of 24 in. OC. Studs to be cut 3/4 in less than the assembly height and installed with a ½ in. gap between the end of the stud and track at the bottom of the wall. For direct attachment of gypsum board only.

CALIFORNIA EXPANDED METAL PRODUCTS CO — Viper25™ Track
CRACO MFG INC — SmartStud™
MARINOWARE, DIV OF WARE INDUSTRIES INC — Viper25™ Track
PHILLIPS MFG CO L L C — Viper25™ Track

2C. **Framing Members* - Steel Studs** — (Not shown - In lieu of Item 2 — proprietary channel shaped steel studs, min depth as indicated under Item 5, spaced a max if 24 in. OC, fabricated from min 0.020 in. thick galv steel. Studs cut 3/8 in. to 3/4 in. less in lengths than assembly heights.

CALIFORNIA EXPANDED METAL PRODUCTS CO — Viper20™ Track
MARINOWARE, DIV OF WARE INDUSTRIES INC — Viper20™ Track
PHILLIPS MFG CO L L C — Viper20™ Track

2D. **Framing Members* - Steel Studs** — (Not shown - In lieu of Item 2 - Channel shaped studs, min depth as indicated under Item 5, spaced a max of 24 in. OC. Studs to be cut 3/4 in. less than assembly height.

ALLSTEEL & GYPSUM PRODUCTS INC — Type SUPREME Framing System
CONSOLIDATED FABRICATORS CORP. BUILDING PRODUCTS DIV — Type SUPREME Framing System
QUAIL RUN BUILDING MATERIALS INC — Type SUPREME Framing System
SCAFCO STEEL STUD MANUFACTURING CO — Type SUPREME Framing System
STEEL CONSTRUCTION SYSTEMS INC — Type SUPREME Framing System
UNITED METAL PRODUCTS INC — Type SUPREME Framing System

2E. **Framing Members* - Steel Studs** — (Not shown, As an alternate to Item 2) —For use with Items 5F or 5G or 5I only, channel shaped studs, min depth as indicated under Item 5F, 5G or 5I, fabricated from min. 0.015 in. (min bare metal thickness) galvanized steel, spaced a max of 24 in. OC. Studs to be cut 3/4 in. less than assembly height.

CLARKDIETRIK BUILDING SYSTEMS — CD ProSTUD
DMFCWBS L L C — ProSTUD
MBA BUILDING SUPPLIES — ProSTUD
RAM SALES L L C — Ram ProSTUD
SOUTHEASTERN STUD & COMPONENTS INC — ProSTUD
STEEL STRUCTURAL SYSTEMS L L C — Tri-S ProSTUD

2F. **Framing Members* - Steel Studs** — (Not shown - In lieu of Item 2 — proprietary channel shaped steel studs, minimum width indicated under Item 5, 1-1/4 in. deep fabricated from min 0.015 in. (min bare metal thickness) galvanized steel. Studs 3/8 in. to 3/4 in. less in lengths than assembly heights.

SUPER STUD BUILDING PRODUCTS — The Edge
2G. **Framing Members* - Steel Studs** — (Not shown - In lieu of Item 2 - proprietary channel shaped studs, minimum width indicated under Item 5, Studs to be cut 3/8 to 3/4 in less than the assembly height.

STUCCO BUILDING SYSTEMS — CROCSTUD
2H. **Framing Members* - Steel Studs** — (Not shown, As an alternate to Item 2) — Fabricated from min. 0.015 in. (min bare metal thickness) galvanized steel, spaced a max of 24 in. OC. Studs to be cut 3/4 in. less than assembly height.

TELLING INDUSTRIES L L C — TRUE-STUD™
2I. **Framing Members* - Steel Studs** — (As an alternate to Item 2, For use with Items 5C or 5L) - Proprietary channel shaped studs, 3-5/8 in. deep spaced a max of 24 in. OC. Studs to be cut 3/4 in less than the assembly height and installed with a ½ in. gap between the end of the stud and track at the bottom of the wall. For direct attachment of gypsum board only.

TELLING INDUSTRIES L L C — Viper25™ Track
2J. **Framing Members* - Metal Studs** — (Not shown - In lieu of Item 2 — proprietary channel shaped steel studs, min depth as indicated under Item 5, Studs spaced a max if 24 in. OC, fabricated from min 0.020 in. thick galv steel. Studs cut 3/8 in. to 3/4 in. less in lengths than assembly heights

TELLING INDUSTRIES L L C — Viper20™ Track
3. **Wood Structural Panel Sheathing** — (Optional. For use with Item 5 Only.) - (Not Shown) - 4 ft wide, 7/16 in. thick oriented strand board (OSB) or 15/32 in. thick structural 1 sheathing (plywood) complying with DOC P51 or PS2, or APA Standard PRP-108, manufactured with exterior glue, applied horizontally or vertically to the steel studs. Vertical joints centered on studs, and staggered one stud space from wallboard joints. Attached to studs with flat-head self-drilling tapping screws with a min. head diam. of 0.292 in. at maximum 6 in. OC. in the perimeter and 12 in. OC. in the field. When used, fastener lengths for gypsum panels increased by min. 1/2 in.

4. **Batts and Blankets*** — (Required as indicated under Item 5) — Mineral wool batts, friction fitted between studs and runners. Min nom thickness as indicated under Item 5. See **Batts and Blankets (BKNV or BJIZ) Categories** for names of Classified companies.

4A. **Batts and Blankets*** — (Optional) — Placed in stud cavities, any glass fiber or mineral wool insulation bearing the UL Classification Marking as to Surface Burning Characteristics and/or Fire Resistance. See **Batts and Blankets (BKNV or BJIZ) Categories** for names of Classified companies.

2I. **Framing Members* - Steel Studs** — (As an alternate to Item 2, For use with Items 5C or 5L) - Proprietary channel shaped studs, 3-5/8 in. deep spaced a max of 24 in. OC. Studs to be cut 3/4 in less than the assembly height and installed with a ½ in. gap between the end of the stud and track at the bottom of the wall. For direct attachment of gypsum board only.

TELLING INDUSTRIES L L C — Viper25™ Track

2J. **Framing Members* - Metal Studs** — (Not shown - In lieu of Item 2 — proprietary channel shaped steel studs, min depth as indicated under Item 5, spaced a max if 24 in. OC, fabricated from min 0.020 in. thick galv steel. Studs cut 3/8 in. to 3/4 in. less in lengths than assembly heights

TELLING INDUSTRIES L L C — Viper20™ Track

3. **Wood Structural Panel Sheathing** — (Optional. For use with Item 5 Only.) - (Not Shown) - 4 ft wide, 7/16 in. thick oriented strand board (OSB) or 15/32 in. thick structural 1 sheathing (plywood) complying with DOC P51 or PS2, or APA Standard PRP-108, manufactured with exterior glue, applied horizontally or vertically to the steel studs. Vertical joints centered on studs, and staggered one stud space from wallboard joints. Attached to studs with flat-head self-drilling tapping screws with a min. head diam. of 0.292 in. at maximum 6 in. OC. in the perimeter and 12 in. OC. in the field. When used, fastener lengths for gypsum panels increased by min. 1/2 in.

4. **Batts and Blankets*** — (Required as indicated under Item 5) — Mineral wool batts, friction fitted between studs and runners. Min nom thickness as indicated under Item 5. See **Batts and Blankets (BKNV or BJIZ) Categories** for names of Classified companies.

4A. **Batts and Blankets*** — (Optional) — Placed in stud cavities, any glass fiber or mineral wool insulation bearing the UL Classification Marking as to Surface Burning Characteristics and/or Fire Resistance. See **Batts and Blankets (BKNV or BJIZ) Categories** for names of Classified companies.

Gypsum Board* — Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Vertical joints in adjacent layers (multilayer systems) staggered one stud cavity. Horizontal joints need not be backed by steel framing. Horizontal edge joints and horizontal butt joints on opposite sides of studs need not be staggered. Horizontal edge joints and horizontal butt joints in adjacent layers (multilayer systems) staggered a min of 12 in. The thickness and number of layers for the 1 hr, 2 hr, 3 hr and 4 hr ratings are as follows:

Gypsum Board Protection on Each Side of Wall				
Rating, Hr	Min Stud Depth, in. Item 2E	No. of Layers & Thkns of Panel	Min Thkns of Insulation (Item 4)	
1	2	3-1/2	1 layer, 5/8 in. thick	Optional
1	2-1/2	1 layer, 1/2 in. thick	1-1/2 in.	
1	1-5/8	1 layer, 3/4 in. thick	Optional	
1	1-5/8	2 layers, 1/2 in. thick	Optional	
2	1-5/8	2 layers, 5/8 in. thick	Optional	
2	3-1/2	1 layer, 3/4 in. thick	3 in.	
3	1-5/8	3 layers, 1/2 in. thick	Optional	
3	1-5/8	2 layers, 3/4 in. thick	Optional	
3	1-5/8	3 layers, 5/8 in. thick	Optional	
4	1-5/8	4 layers, 5/8 in. thick	Optional	
4	1-5/8	4 layers, 1/2 in. thick	Optional	
4	2-1/2	2 layers, 3/4 in. thick	2 in.	

CGC INC — 1/2 in. thick Type C, IP-X2 or IPC-AR; 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRX or WRX or 3/4 in. thick Types IP-X3 or ULTRACODE
UNITED STATES GYPSUM CO — 1/2 in. thick Type C, IP-X2, IPC-AR or WRC; 5/8 in. thick Type SCX, SGX, SHX, WRX, IP-X1, AR, C, WRC, FRX-G, IP-AR, IP-X2, IPC-AR; 3/4 in. thick Types IP-X3 or ULTRACODE
USG MEXICO S A DE C V — 1/2 in. thick Type C, IP-X2, IPC-AR or WRC; 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRX, WRC or; 3/4 in. thick Types IP-X3 or ULTRACODE
When Item 7B, Steel Framing Members* is used, Nonbearing Wall Rating is limited to 1 Hr. Min. stud depth is 3-1/2 in., min. thickness of insulation (Item 4) is 3 in., and two layers of gypsum board (Item 5) shall be attached to furring channels as described in Item 6. One layer of gypsum board panels (1/2 in. or 5/8 in. thick) attached to opposite side of stud without furring channels as described in Item 6.

5A. **Gypsum Board*** — (As an alternate to Item 5) — 5/8 in. thick, 24 to 54 in. wide, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 6.

CGC INC — Type SHX
UNITED STATES GYPSUM CO — Type FRX-G, SHX.
USG MEXICO S A DE C V — Type SHX.

5B. **Gypsum Board*** — (Not Shown) - As an alternate to Item 5 when used as the base layer on one or both sides of wall when 5/8 in or ¾ in. thick products are specified. For direct attachment only to steel studs Item 2A, (not to be used with Item 3) - Nom 5/8 in. or ¾ in. may be used as alternate to all 5/8 in. or ¾ in. shown in Item 5. Wallboard Protection on Each Side of Wall table. Nom 5/8 in. or ¾ in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over studs and staggered min 1 stud cavity on opposite sides of studs. Gypsum board secured to 20 MSG steel studs Item 2A with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. To be used with Lead Batten Strips (see Item 11) or Lead Discs or Tabs (see Item 12).

RAY-BAR ENGINEERING CORP. — Type RB-LBG
5C. **Gypsum Board*** — (For Use With Item 2B) Rating Limited to 1 Hour. 5/8 in. thick, 48 in. wide, Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. (Vertical Application) - The gypsum board is to be installed on each side of the studs with 1 in. long Type S coated steel screws spaced 8 in. OC starting 4 in. from the edge of the board at the vertical edges and 12 in. OC starting 6 in. from the edge of the board at the center of each board. Gypsum boards are to be secured to the top and bottom track with screws spaced 8 in. OC starting 4 in. from the board edge. Fasteners shall not penetrate through both the stud and the track at the same time. Vertical joints are to be centered over studs and staggered one stud cavity on opposite sides of studs. (Horizontal Application) - The gypsum board is to be installed on each side of the studs with 1 in. long Type S coated steel screws spaced 8 in. OC starting 4 in. from the edge of the board at the vertical edges and 12 in. OC starting 6 in. from the edge of the board at the center of each board. Gypsum boards are to be secured to the top and bottom track with screws spaced 8 in. OC starting 4 in. from the board edge. Fasteners shall not penetrate through both the stud and the track at the same time. All horizontal joints are to be backed as outlined under section VI of Volume 1 in the Fire Reastive Directory.

CGC INC — Type SCX.
UNITED STATES GYPSUM CO — Type SCX, SGX.
USG MEXICO S A DE C V — Type SCX.

5D. **Gypsum Board*** — (As an alternate to Item 5) — 5/8 in. thick, 48 in. wide, applied vertically or horizontally. Secured as described in Item 6. For use with Items 1 and 2 only.

UNITED STATES GYPSUM CO — Type USGX.
5E. **Gypsum Board*** — (Not Shown) - (As an alternate to Item 5 when used as the base layer on one or both sides of wall when 1/2 in. or 5/8 in thick products are specified. For direct attachment only to steel studs Item 2A, not to be used with Item 3). Nominal 5/8 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over studs and staggered min 1 stud cavity on opposite sides of studs. Wallboard secured to studs with 1-1/4 in. long Type S-12 (or No. 6 by 1-1/4 in. long bugle head fine driller) steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field.

NEW ENGLAND LEAD BURNING CO INC, DBA NELCO — Nelco
5F. **Gypsum Board*** — (As an alternate to Item 5) — For use with Items 1E and 2E and limited to 1 Hour Rating only, Gypsum panels with beveled, square or tapered edges, applied vertically, and fastened to the steel studs with 1 in. long Type S screws spaced 8 in. OC along vertical and bottom edges and 12 in. OC in the field. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Steel stud depth shall be a minimum 3-5/8 in.

UNITED STATES GYPSUM CO — 5/8 in. thick Type SCX, SGX.
5G. **Gypsum Board*** — (As an alternate to Item 5) — For use with Items 1E and 2E only, Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally, as specified in the table below and fastened to the steel studs as described in Item 6. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Vertical joints in adjacent layers (multilayer systems) staggered one stud cavity. Horizontal joints need not be backed by steel framing. Horizontal edge joints and horizontal butt joints on opposite sides of studs need not be staggered. Horizontal edge joints and horizontal butt joints in adjacent layers (multilayer systems) staggered a min of 12 in. The thickness and number of layers for the 2 hr, 3 hr and 4 hr ratings are as follows:

Gypsum Board Protection on Each Side of Wall				
Rating, Hr	Min Stud Depth, in. Item 2E	No. of Layers & Thickness of Panel	Min Thkns of Insulation (Item 4)	
2	1-5/8	2 layers, 1/2 in. thick	Optional	
2	1-5/8	2 layers, 5/8 in. thick	Optional	
3	1-5/8	3 layers, 1/2 in. thick	Optional	
3	1-5/8	3 layers, 5/8 in. thick	Optional	
4	1-5/8	4 layers, 5/8 in. thick	Optional	
4	1-5/8	4 layers, 1/2 in. thick	Optional	

CGC INC — 1/2 in. thick Type C, IP-X2 or IPC-AR; 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, or; 3/4 in. thick Types IP-X3 or ULTRACODE
5H. **Gypsum Board*** — (Not Shown) - (As an alternate to Item 5 when used as the base layer on one or both sides of wall when 5/8 or 3/4 in thick products are specified. For direct attachment only to steel studs Item 2A, (not to be used with Item 3) - Nom 5/8 or 3/4 in. may be used as alternate to all 5/8 or 3/4 in. shown in Item 5. Wallboard Protection on Each Side of Wall table. Nom 5/8 or 3/4 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over 20 MSG steel studs and staggered min 1 stud cavity on opposite sides of studs. Wallboard secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. Gypsum board secured to 20 MSG steel studs Item 2B with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. For Joint Compound see Item 5. To be used with Lead Batten Strips (see Item 11A) or Lead Discs (see Item 12A).

MAYCO INDUSTRIES INC — Type X-Ray Shielded Gypsum
5I. **Gypsum Board*** — (As an alternate to Item 5) — Nom. 5/8 in. thick gypsum panels with beveled, square or tapered edges installed as described in Item 5. Steel stud minimum depth shall be as indicated in Item 5.

CGC INC — Type ULX
UNITED STATES GYPSUM CO — Type ULX
USG MEXICO S A DE C V — Type ULX

5J. **Gypsum Board*** — (Not Shown) - (As an alternate to Item 5 when used as the base layer on one or both sides of wall when 1/2 in. or 5/8 in thick products are specified. For direct attachment only to steel studs Item 2A, not to be used with Item 3). Nom 5/8 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over studs and staggered min 1 stud cavity on opposite sides of studs. Wallboard secured to studs with 1-1/4 in. long Type S-12 steel screws gypsum panel steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. Lead batten strips required behind vertical joints of lead backed gypsum wallboard and optional at remaining stud locations. Lead batten strips, min 2 in. wide, max 8 ft long with a max thickness of 0.14 in. placed on the face of studs and attached to the stud with construction adhesive and two 1 in. long Type S-12 pan head steel screws, one at the top of the strip and one at the bottom of the strip. Lead discs, nominal 3/8 in. diam by max 0.085 in. thick. Compression fitted or adhered over the screw heads. Lead batten strips and discs to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grade "C".

RADIATION PROTECTION PRODUCTS INC — Type RPP - Lead Lined Drywall
6. **Fasteners** — (Not shown) — For use with Items 5 and 2F. Type S or S-12 steel screws used to attach panels to studs (Item 2) or furring channels (Item 7). **Single layer systems:** 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 8 in. OC when panels are applied horizontally, or 8 in. OC along vertical and bottom edges and 12 in. OC in the field when panels are applied vertically. **Two layer systems:** First layer: 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC. Second layer: 1-5/8 in. long for 1/2 in., 5/8 in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC with screws offset 8 in. from first layer. **Three-layer systems:** First layer: 1 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Second layer: 1-5/8 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Third layer: 2-1/4 in. long for 1/2 in., 5/8 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below. **Four-layer systems:** First layer: 1 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Second layer: 1-5/8 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Third layer: 2-1/4 in. long for 1/2 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels, spaced 24 in. OC. Fourth layer: 2-5/8 in. long for 1/2 in. thick panels or 3 in. long for 5/8 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below.

7. **Furring Channels** — (Optional, not shown, for single or double layer systems) — Resilient furring channels fabricated from min 25 MSG corrosion-protected steel, spaced vertically a max of 24 in. OC. Flange portion attached at each intersecting stud with 1/2 in. long Type S-12 steel screws. Not for use with Item 5A and 5E.

7A. **Framing Members*** — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 7, furring channels and Steel Framing Members as described below.

a. **Furring Channels** — Formed of No. 25 MSG galv steel, 2-9/16 in. or 2-23/32 in. wide by 7/8 in. deep, spaced max. 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Gypsum board attached to furring channels as described in Item 6. Not for use with Item 5A and 5E.

b. **Steel Framing Members*** — Used to attach furring channels (Item 7Aa) to studs (Item 2). Clips spaced max. 48 in. OC. RSIC-1 and RSIC-1 (2.75) clips secured to studs with No. 8 x 1-1/2 in. minimum self-drilling, S-12 steel screw through the center grommet. RISK-V and RISK-V (2.75) clips secured to studs with No. 8 x 9/16 in. minimum self-drilling, S-12 steel screw through the center hole. Furring channels are friction fitted into clips. RSIC-1 and RISK-V clips for use with 2-9/16 in. wide furring channels. RSIC-1 (2.75) and RISK-V (2.75) clips for use with 2-23/32 in. wide furring channels.

7B. **Framing Members*** — (Optional, Not Shown) — As an alternate to Item 7, for single or double layer systems, furring channels and Steel Framing Members on only one side of studs as described below.

a. **Furring Channels** — Formed of No. 25 MSG galv steel, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Batts and Blankets placed in stud cavity as described in Item 5. Two layers of gypsum board attached to furring channels as described in Item 5. Not for use with Item 5A and 5E.

b. **Steel Framing Members*** — Used to attach furring channels (Item 7Ba) to one side of studs (Item 2) only. Clips spaced 48 in. OC, and secured to studs with two No. 8 x 2-1/2 in. coarse drywall screws, one through the hole at each end of the clip. Furring channels are friction fitted into clips.

KINETICS NOISE CONTROL INC — Type IsoMax
7C. **Framing Members*** — (Optional - Not Shown - Used as an alternate method to attach resilient channels (Item 7). Clips attached at each intersection of the resilient channel and the steel studs (Item 2). Resilient channels are friction fitted into clips, and then clips are secured to the steel stud with min. 1 in. long Type S-12 steel screws through the center hole of the clip and the resilient channel flange.

KEENE BUILDING PRODUCTS CO INC — Type RC Assurance.
7D. **Framing Members*** — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 7, furring channels and Steel Framing Members as described below.

a. **Furring Channels** — Formed of No. 25 MSG galv steel, 2-9/16 in. or 2-23/32 in. wide by 7/8 in. deep, spaced max. 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Gypsum board attached to furring channels as described in Item 6. Not for use with Item 5A and 5E.

b. **Steel Framing Members*** — Used to attach furring channels (Item 7Aa) to studs (Item 2). Clips spaced max. 48 in. OC. GENIECLIPS secured to studs with No. 8 x 1-1/2 in. minimum self-drilling, S-12 steel screw through the center grommet. Furring channels are friction fitted into clips.

7E. **Framing Members*** — (Optional, Not Shown) — As an alternate to Item 7, for single or double layer systems, furring channels and Steel Framing Members on only one side of studs as described below.


a. **Furring Channels** — Formed of No. 25 MSG galv steel, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Batts and Blankets placed in stud cavity as described in Item 5. Two layers of gypsum board attached to furring channels as described in Item 5. Not for use with Item 5A and 5E.

b. **Steel Framing Members*** — Used to attach furring channels (Item 7Ba) to one side of studs (Item 2) only. Clips spaced 48 in. OC, and secured to studs with two No. 8 x 2-1/2 in. coarse drywall screws, one through the hole at each end of the clip. Furring channels are friction fitted into clips.

DOCUMENT HISTORY

REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

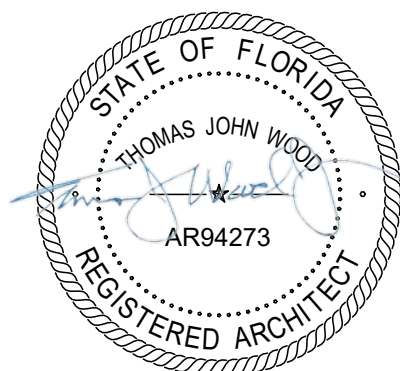

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD

THOMAS J WOOD
AR FL #94273

DESIGNED BY
Designer

DRAWN BY
LOTHMAN

PROJECT NUMBER
C09414.003

DATE
03/15/2026

TITLE



ENLARGED TOILET
PLAN,
ELEVATIONS

DRAWING NO.

e-A401



RESTROOM ACCESSORIES				
TAG	DESCRIPTION	MANUFACTURER	MODEL	COMMENTS
A	TOILET PAPER DISPENSER, SURFACE MOUNTED, 2 ROLL, EXPOSED SPINDLES	TBD		OWNER FURNISHED, CONTRACTOR INSTALLED
B	MANUAL SOAP DISPENSER	COASTWIDE PROFESSIONAL	J SERIES # COWJAS U-SA112-21-2000	OWNER FURNISHED, CONTRACTOR INSTALLED
C	<varies>	<varies>	<varies>	<varies>
D	TOILET SEAT COVER DISPENSER, SURFACE MOUNTED	BOBRICK	B-301	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
F	FRAMED MIRROR, 18"W x 30"H W/ CONCEALED MOUNTING	BOBRICK	B-165 1830	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
G	SANITARY NAPKIN DISPOSAL, SURFACE-MOUNTED	BOBRICK	B-254	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
H	24" WIDE MOP-BROOM HOLDER W/ (3) HOLDER	BOBRICK	B-223X24	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
J	36" GRAB BAR, 1-1/2" DIA, CONCEALED MOUNTING	BOBRICK	B-6806x36	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
K	42" GRAB BAR, 1-1/2" DIA, CONCEALED MOUNTING	BOBRICK	B-6806x42	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
M-1	STAINLESS STEEL MICROWAVE 1200 WATT, SIZE VARIES DEPENDING ON SPACE AVAILABLE			CONTRACTOR FURNISHED, CONTRACTOR INSTALLED

CONTRACTOR FURNISHED BUILDING EQUIPMENT		
TAG	DESCRIPTION	COMMENTS
R-1	STAINLESS STEEL REFRIGERATOR 25 CUFT 36" WIDE SIDE BY SIDE DOORS, WITH FREEZER ON BOTTOM. ICE AND WATER DISPENSER IN THE DOOR	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED
M-1	STAINLESS STEEL MICROWAVE 1200 WATT, 2 CUFT	CONTRACTOR FURNISHED, CONTRACTOR INSTALLED

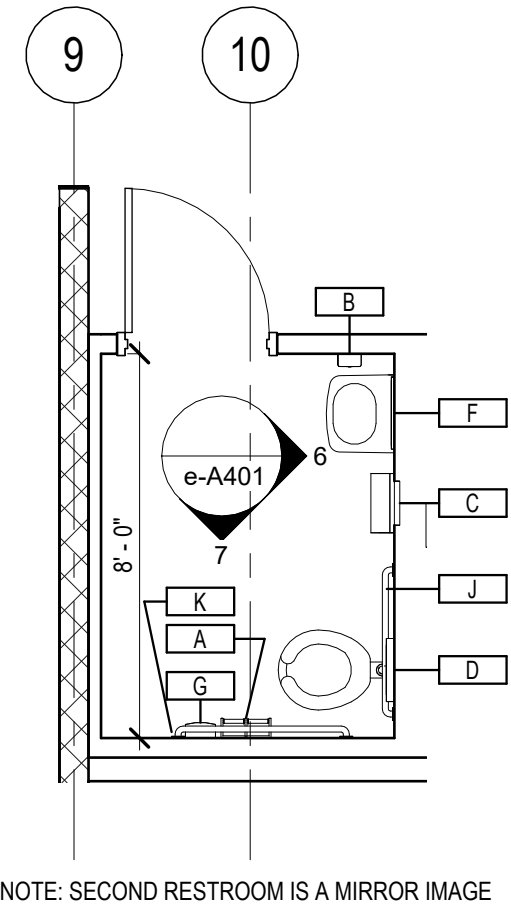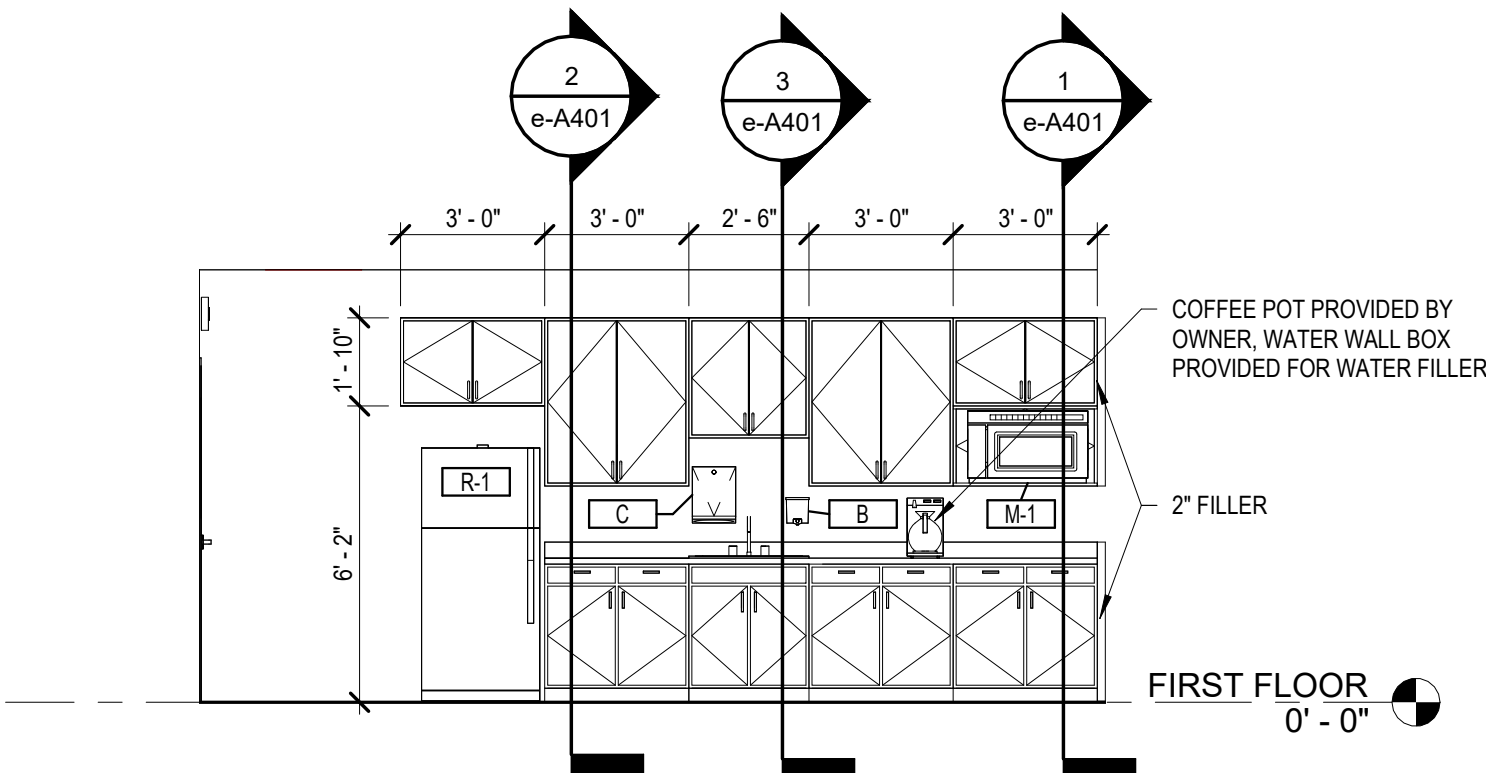


4 BREAKROOM ELEVATION
1/4" = 1'-0"

5 ENLARGED RESTROOM PLAN
1/4" = 1'-0"

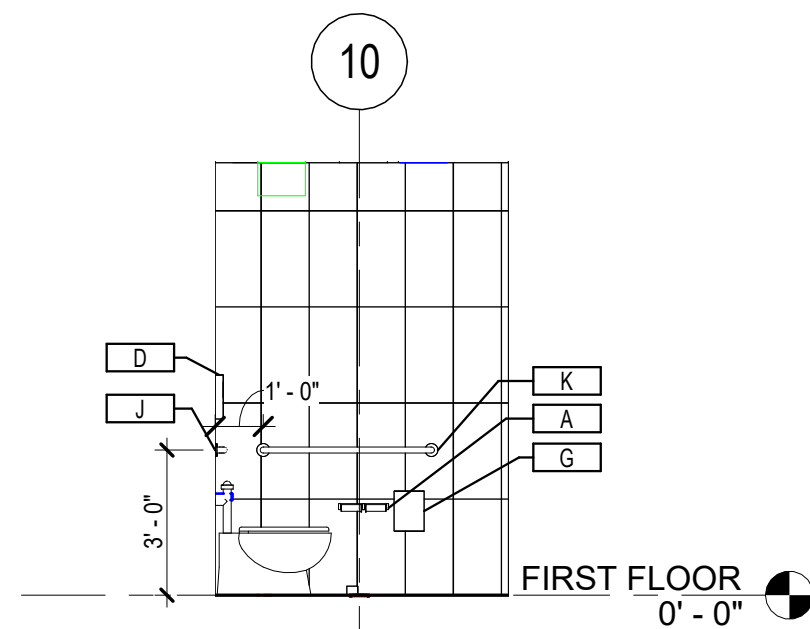
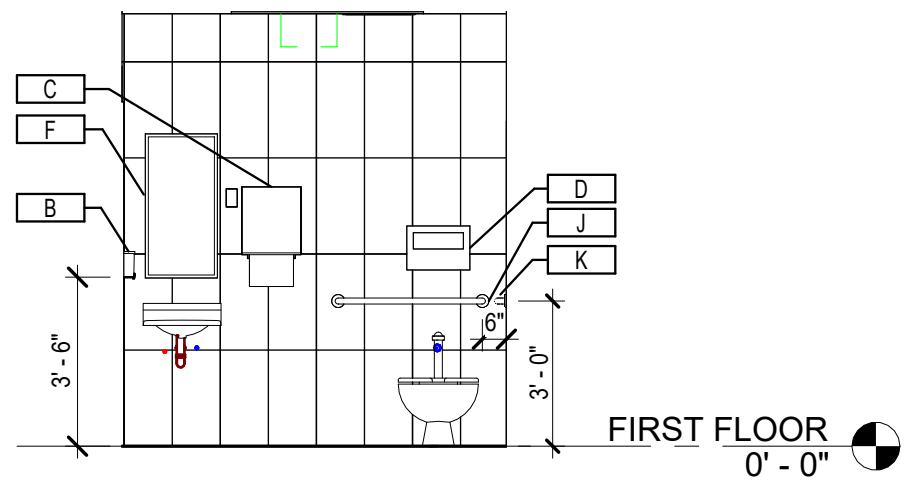


6 RESTROOM ELEVATION 1
1/4" = 1'-0"


7 RESTROOM ELEVATION 2
1/4" = 1'-0"

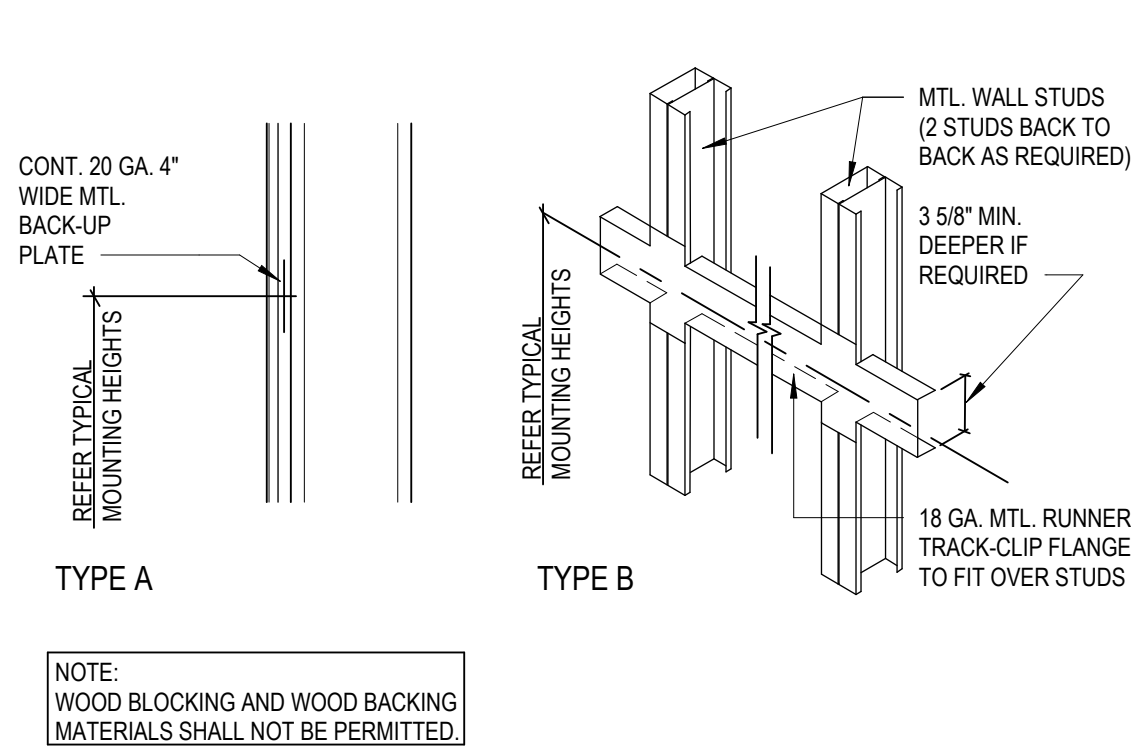


8 ACCESSORY/ EQUIPMENT MOUNTING DETAILS
1/4" = 1'-0"

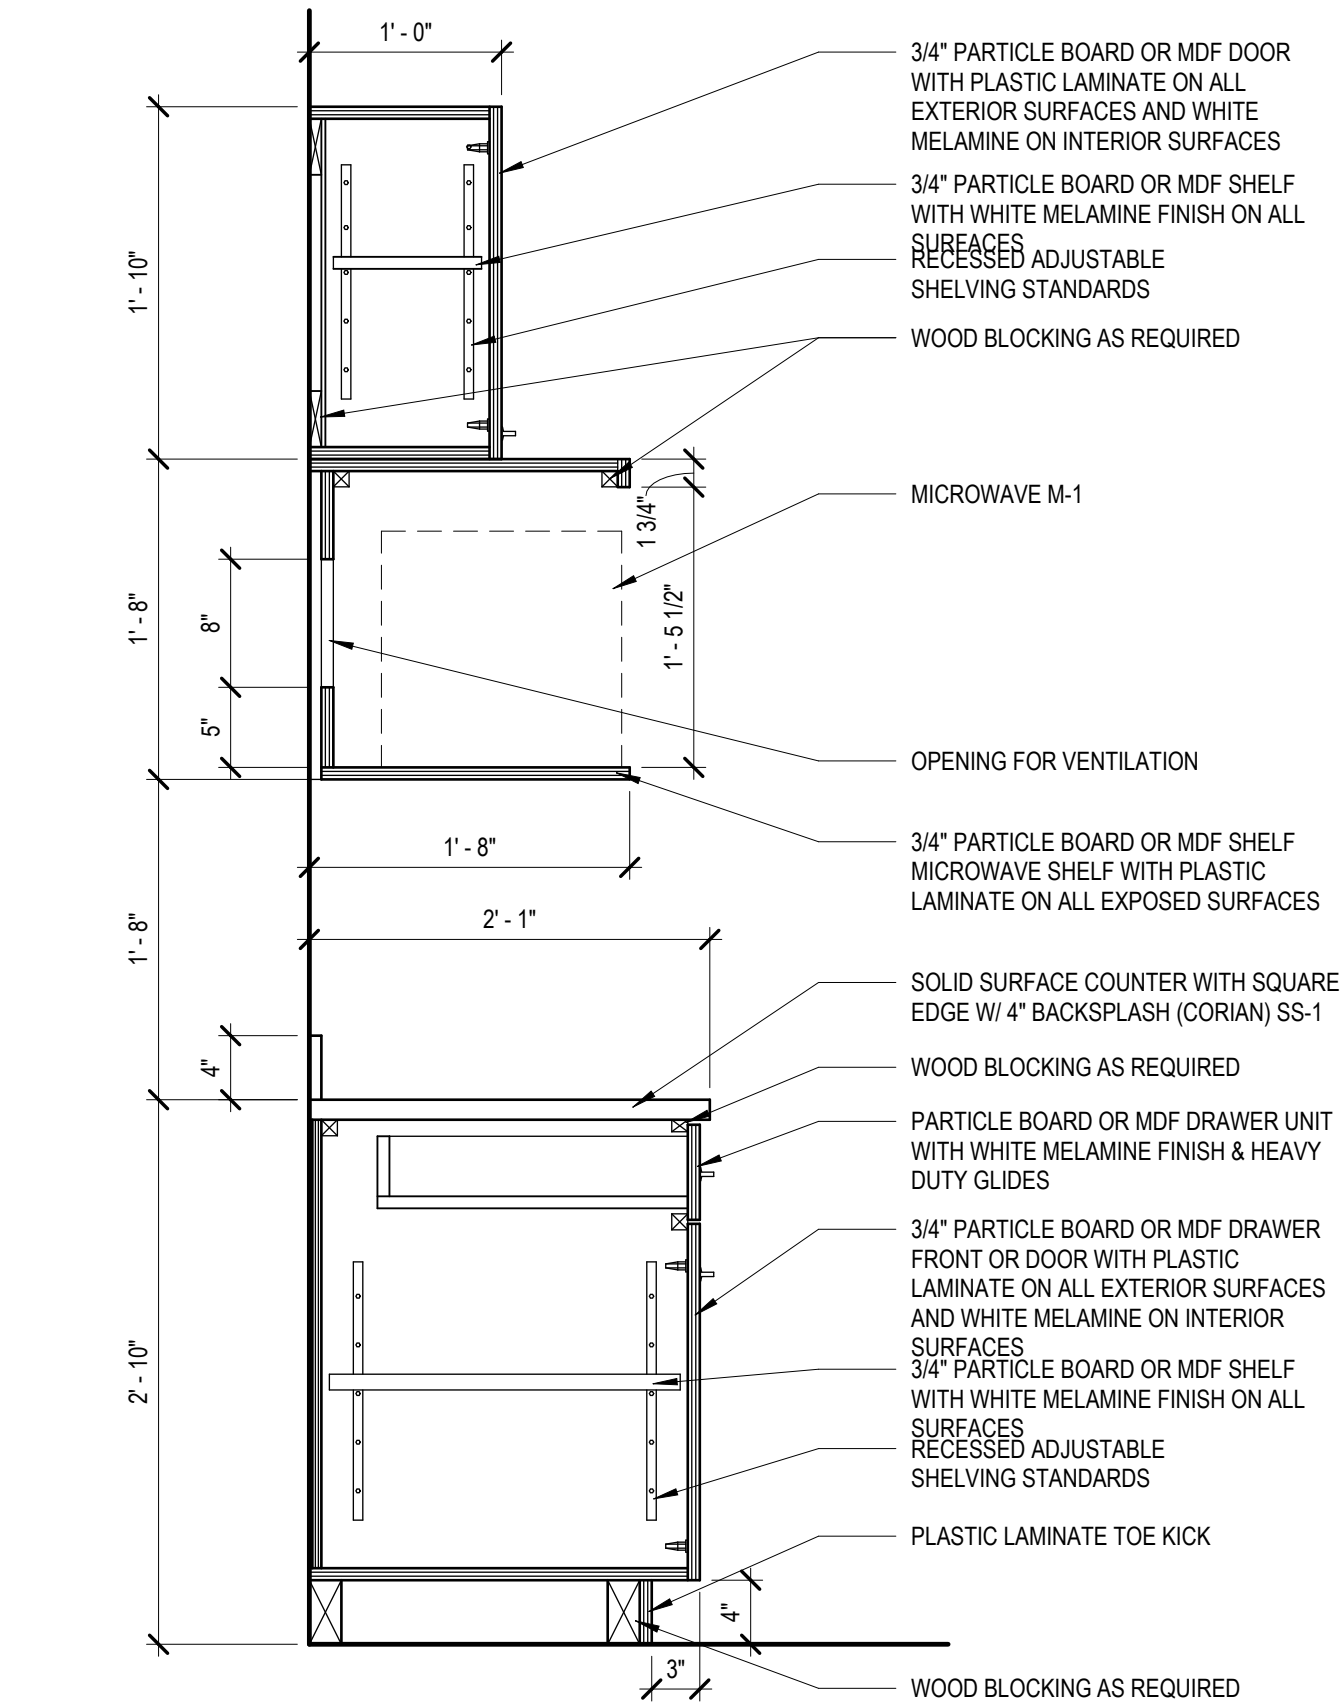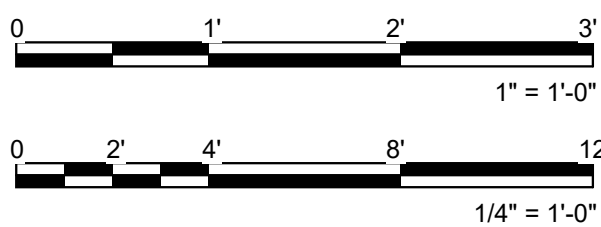

1 TYP. BASE/UPPER CABINET W/ MICROWAVE STATION
1" = 1'-0"

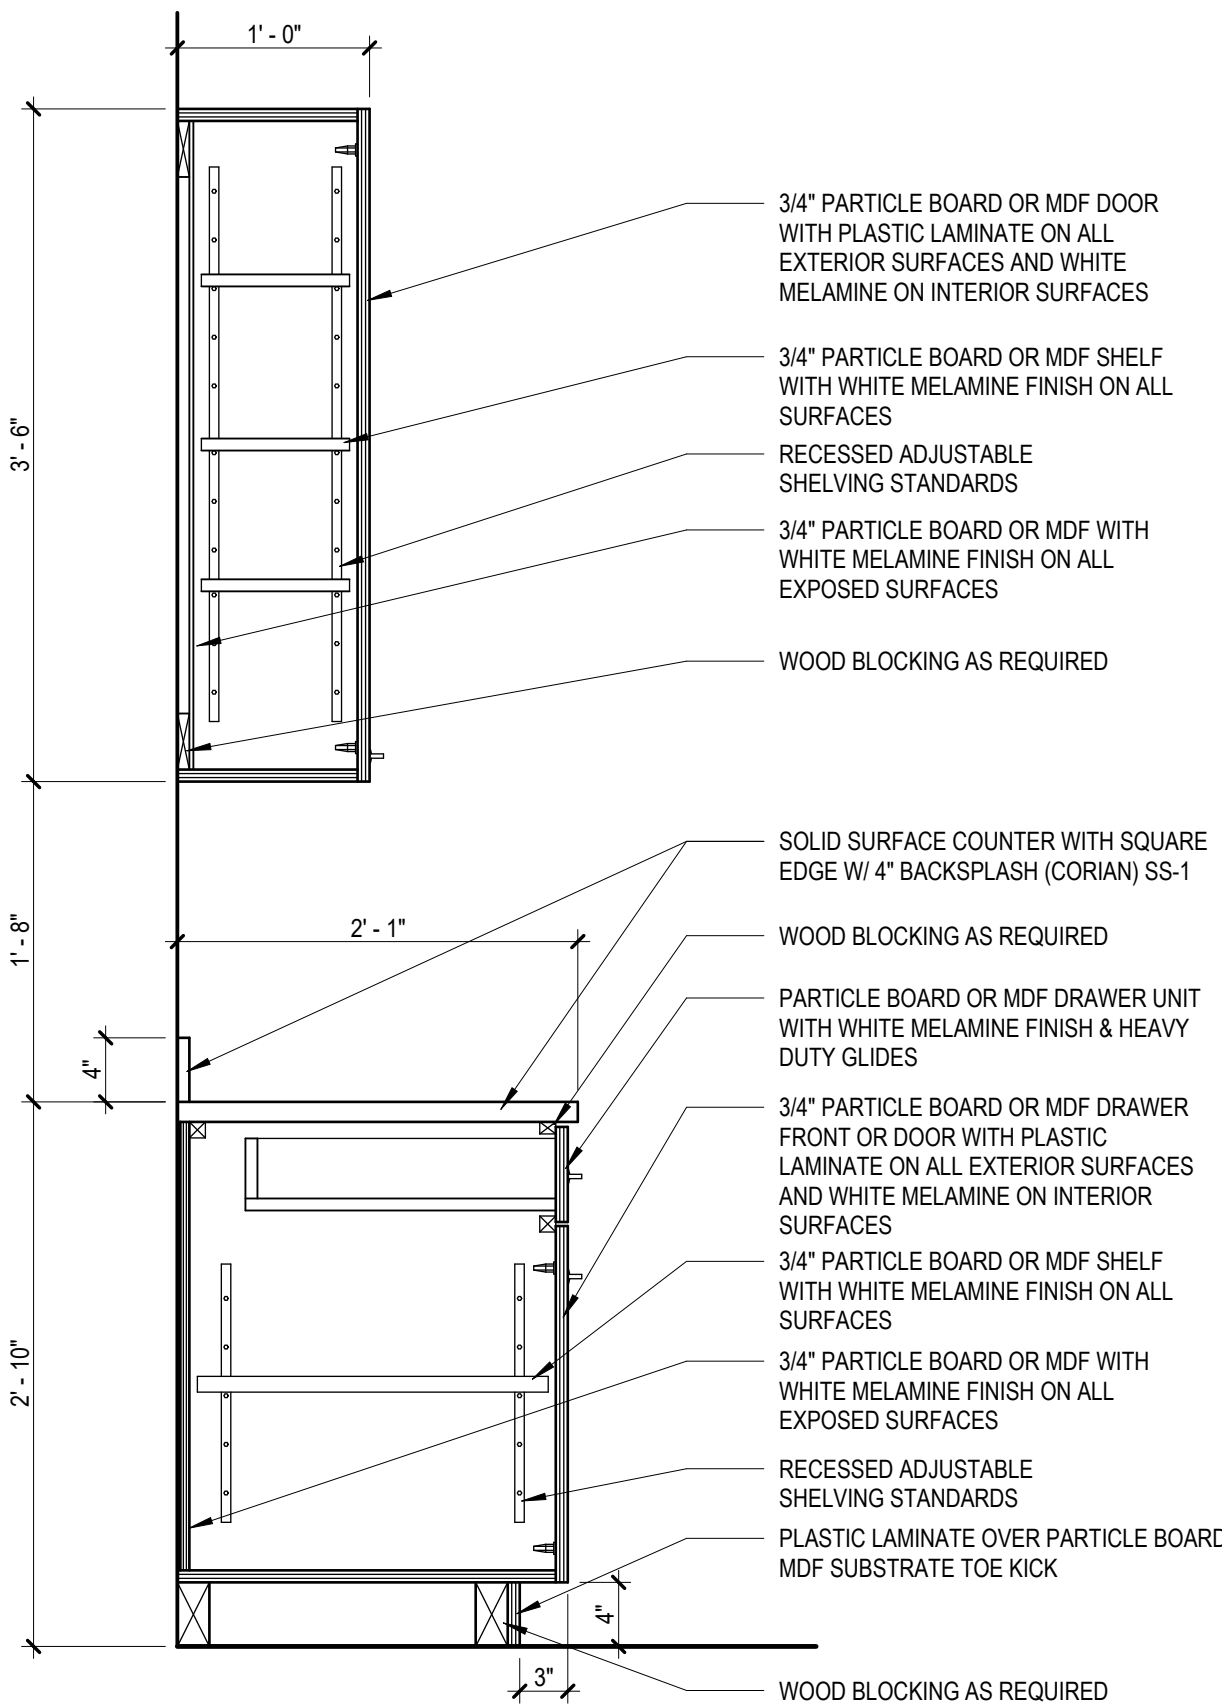


2 TYP. BASE/UPPER CABINET W/ DRAWER
1" = 1'-0"

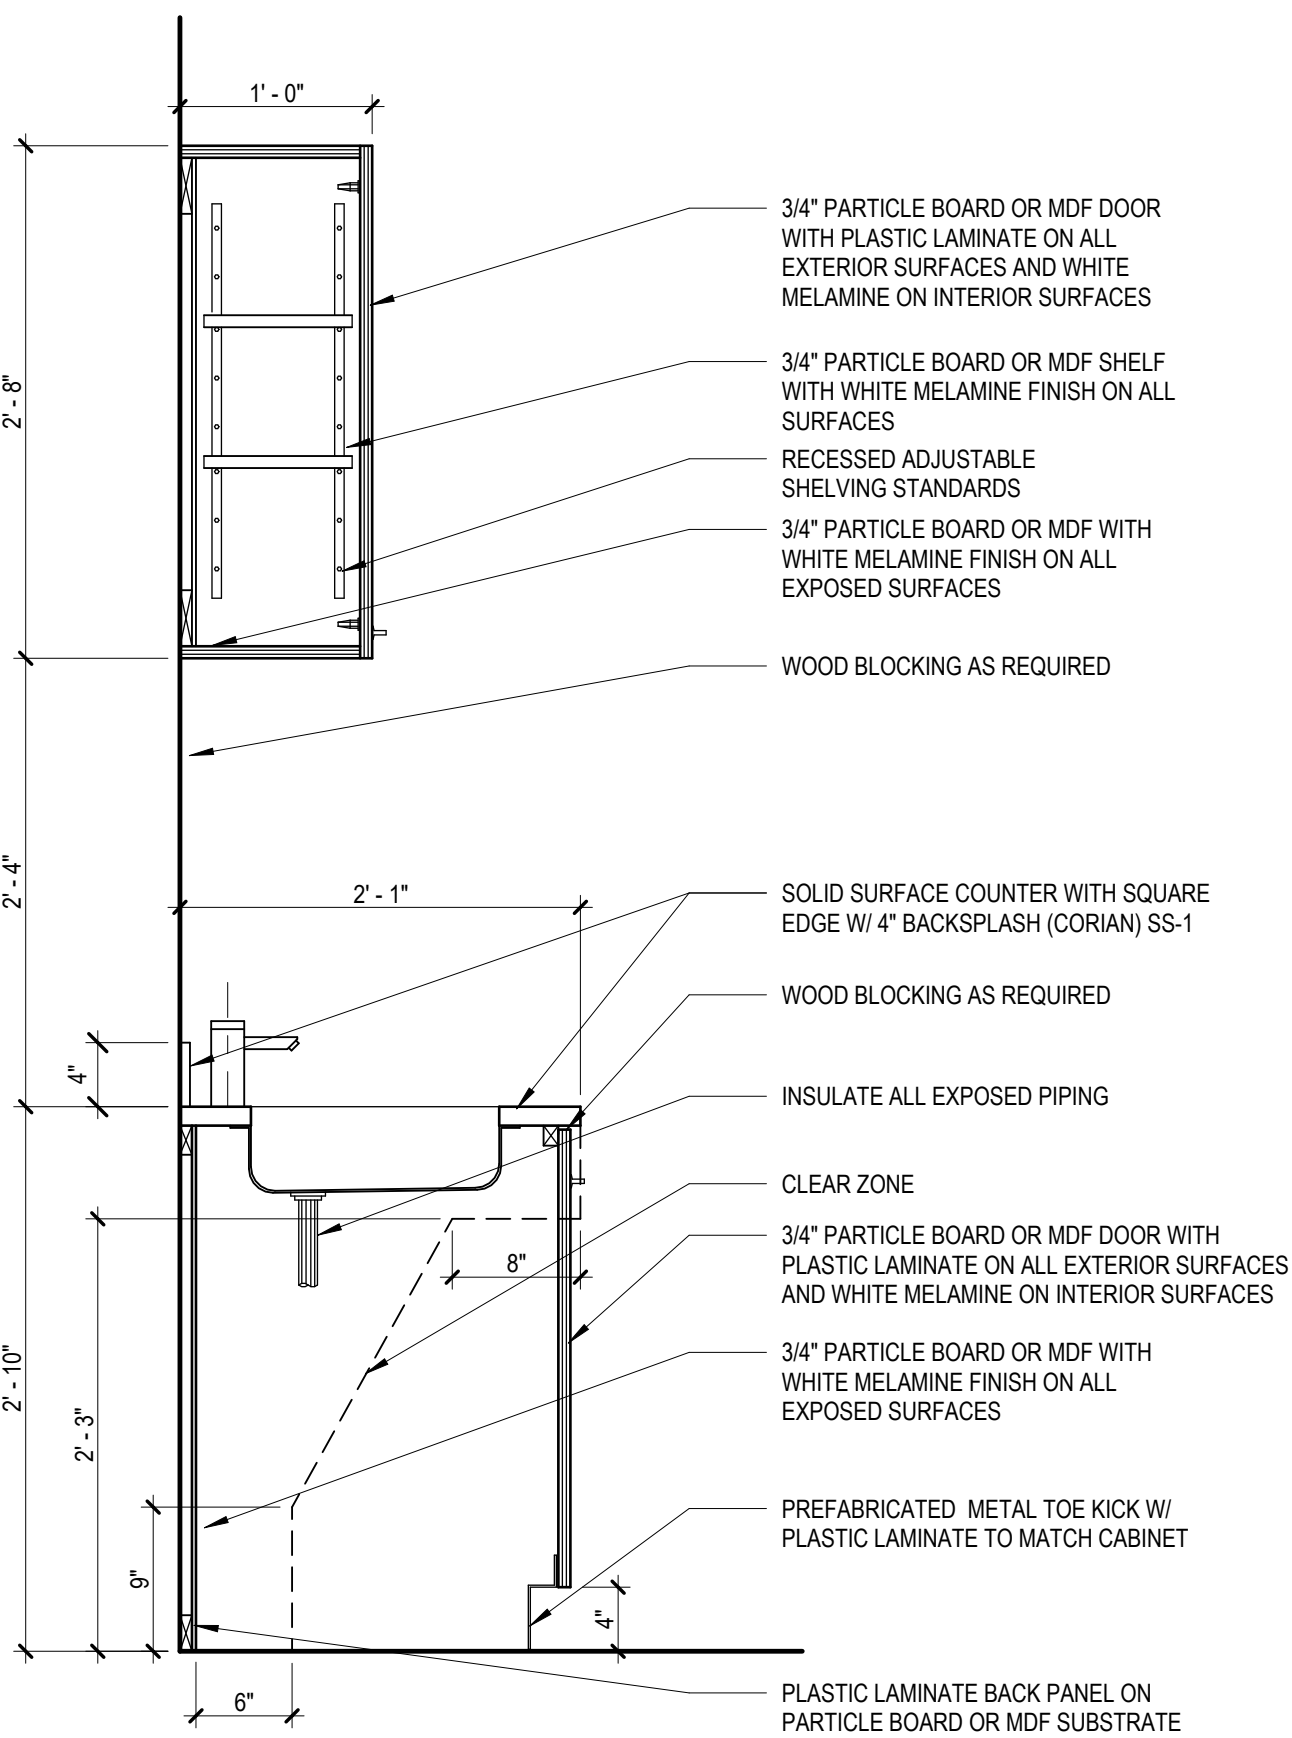

3 TYP. BASE/UPPER CABINET W/ SINK
1" = 1'-0"

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

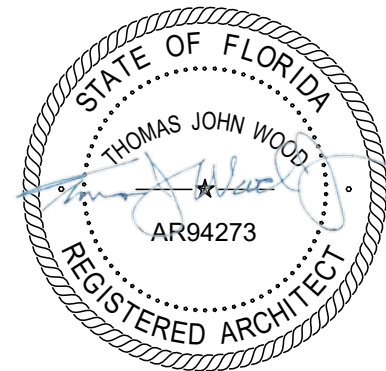

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273


DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003

DATE
03/15/2026
TITLE


ROOF DETAILS

DRAWING NO.


e-A501

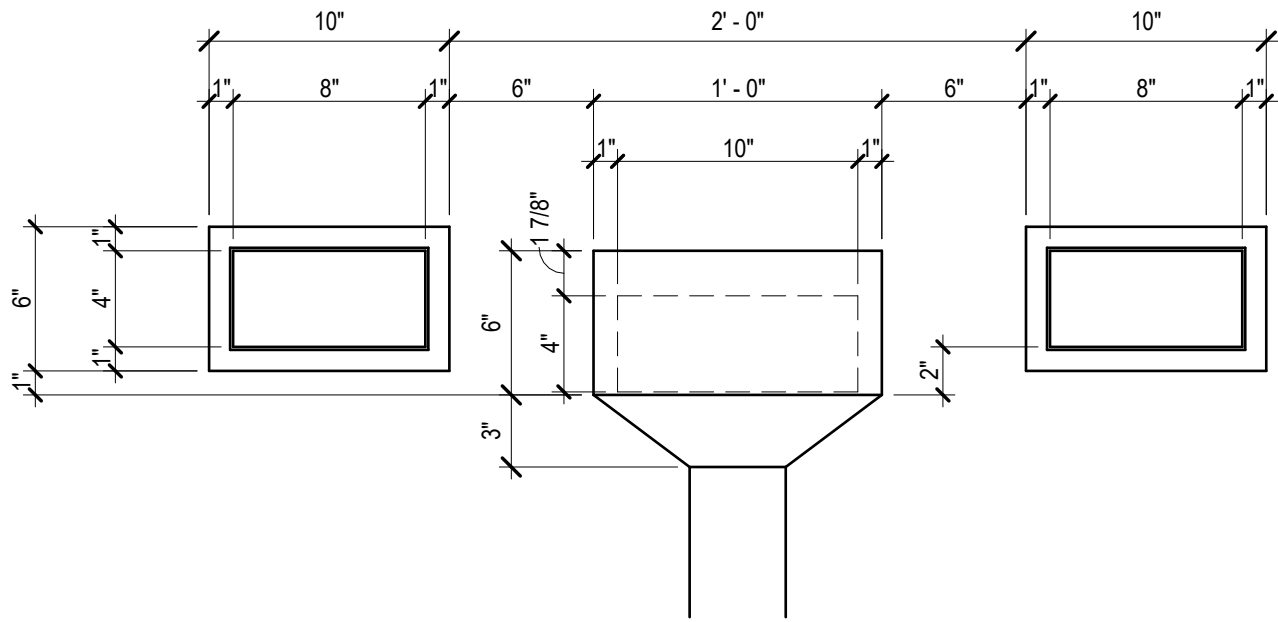


4 SCUPPER AND CONDUCTOR HEAD ELEVATION
1 1/2" = 1'-0"

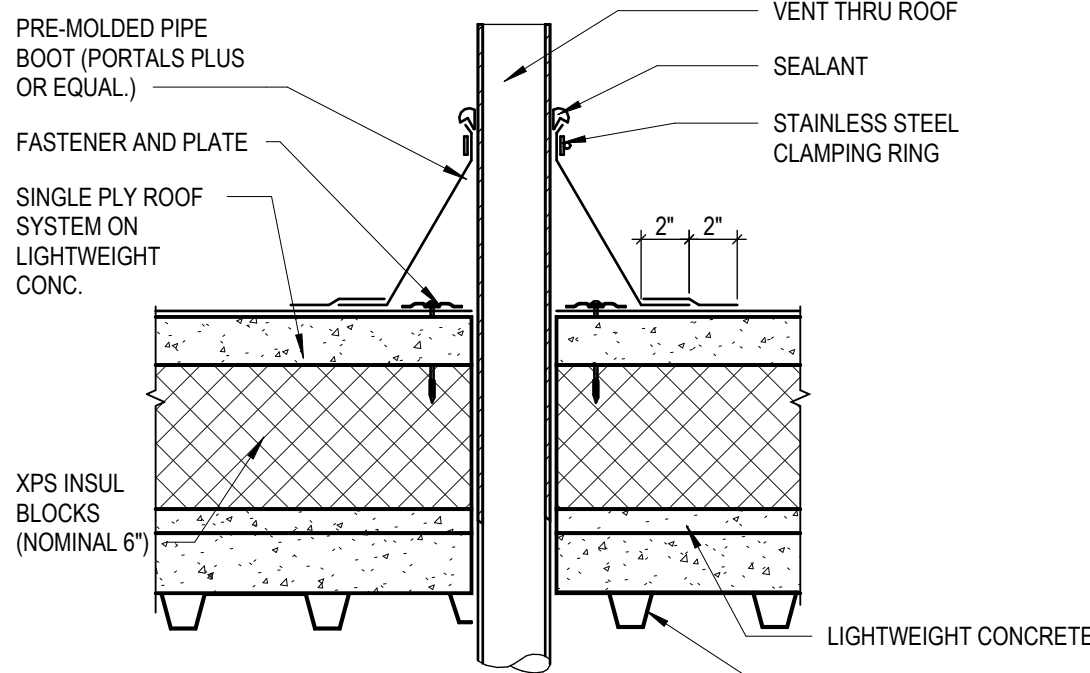


3 PIPE PENETRATION
1 1/2" = 1'-0"

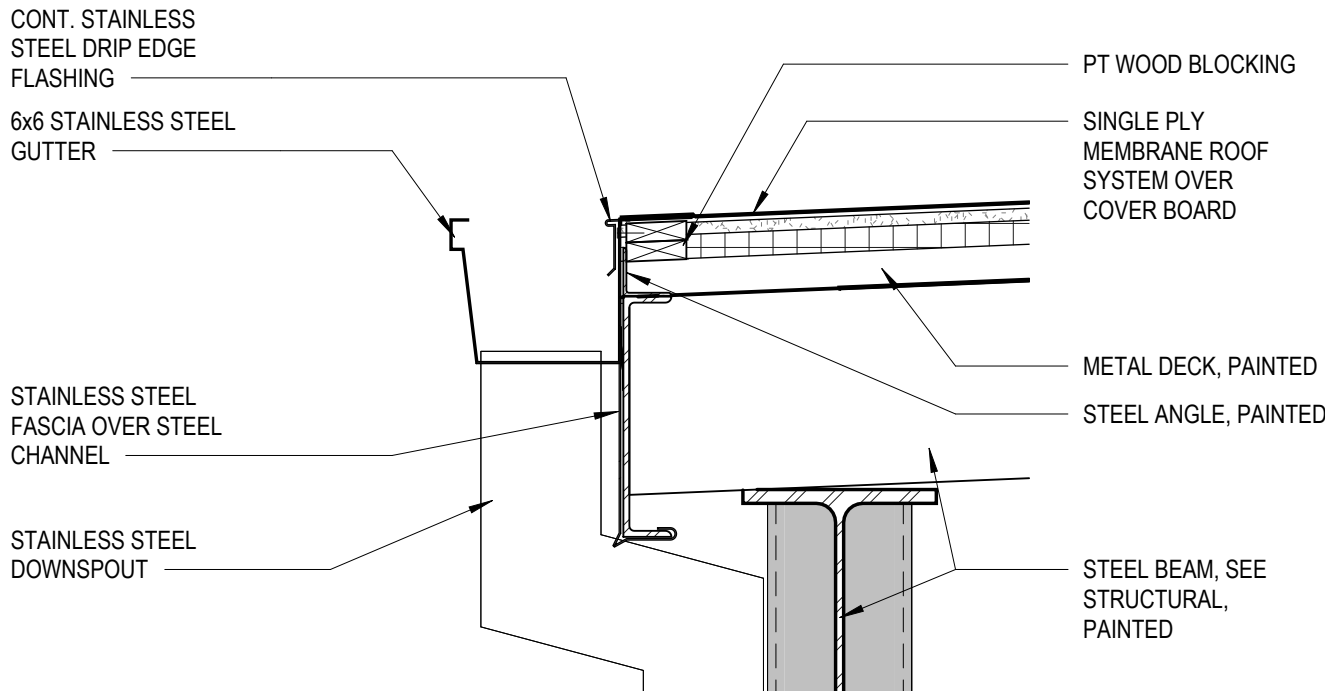


2 SECTION DETAIL 2
1 1/2" = 1'-0"

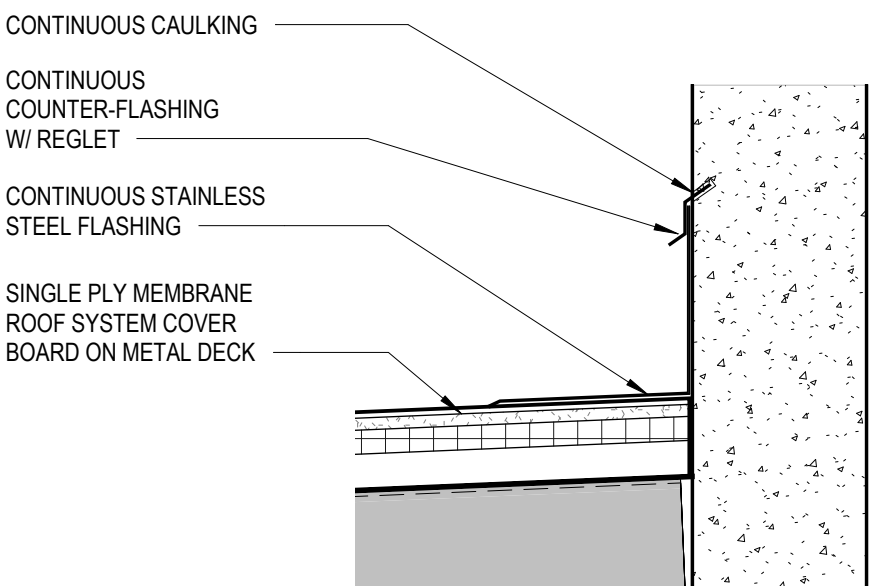


1 SECTION DETAIL 1
1 1/2" = 1'-0"

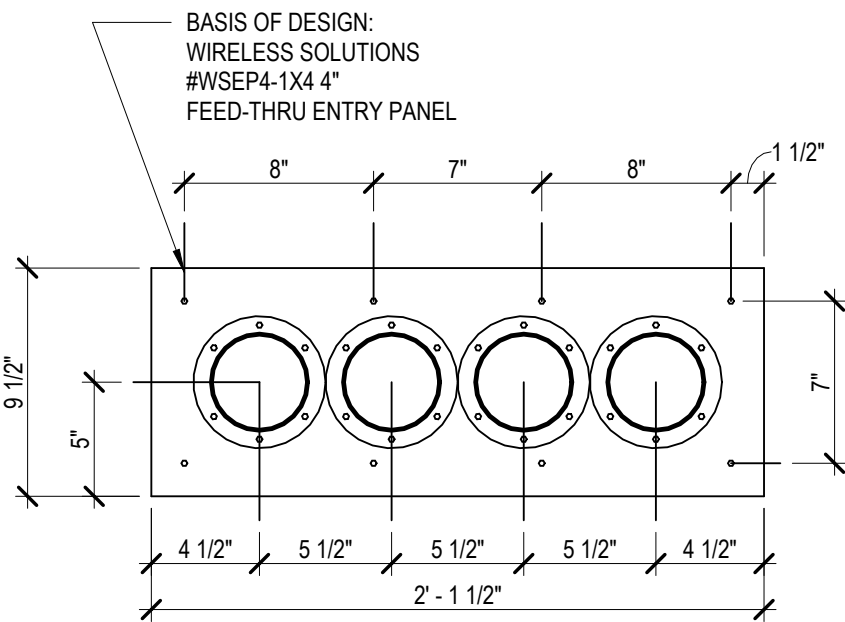


8 ANTENNA SLEEVE DETAIL
1 1/2" = 1'-0"

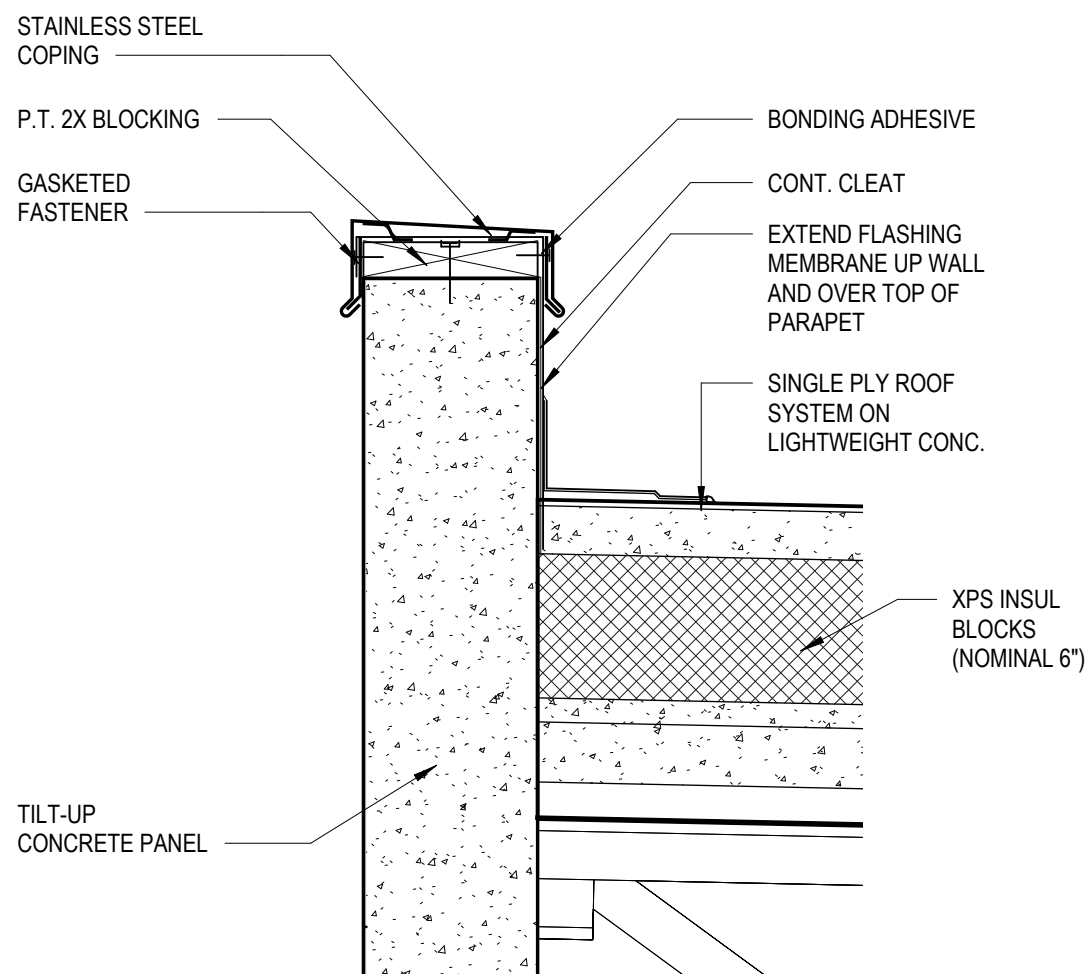


7 PARAPET DETAIL
1 1/2" = 1'-0"

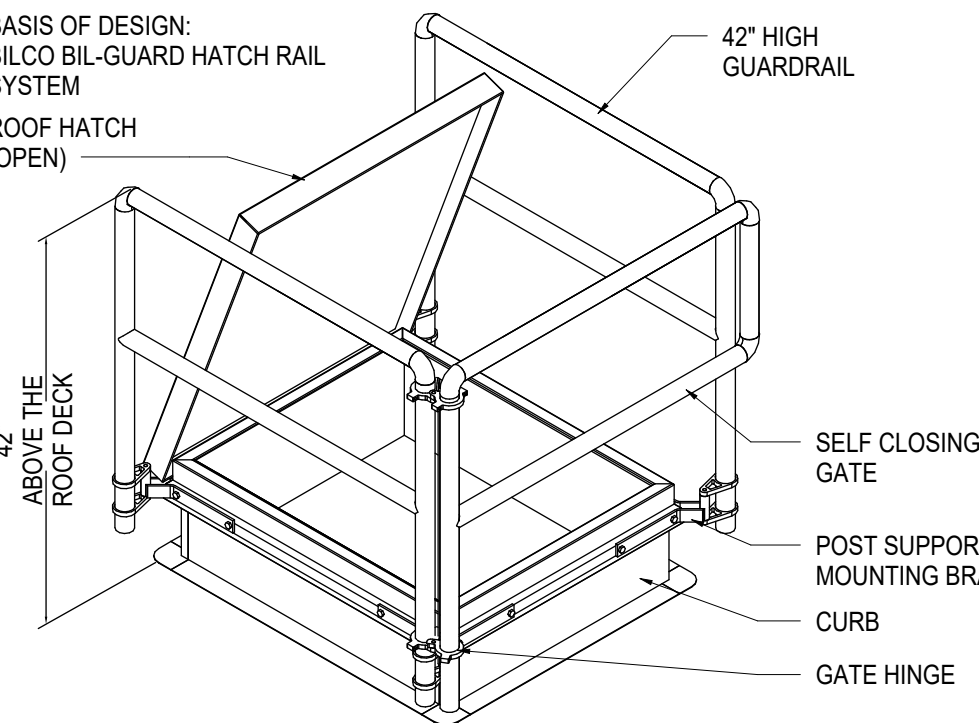


9 ROOF HATCH GUARDRAIL
1" = 1'-0"

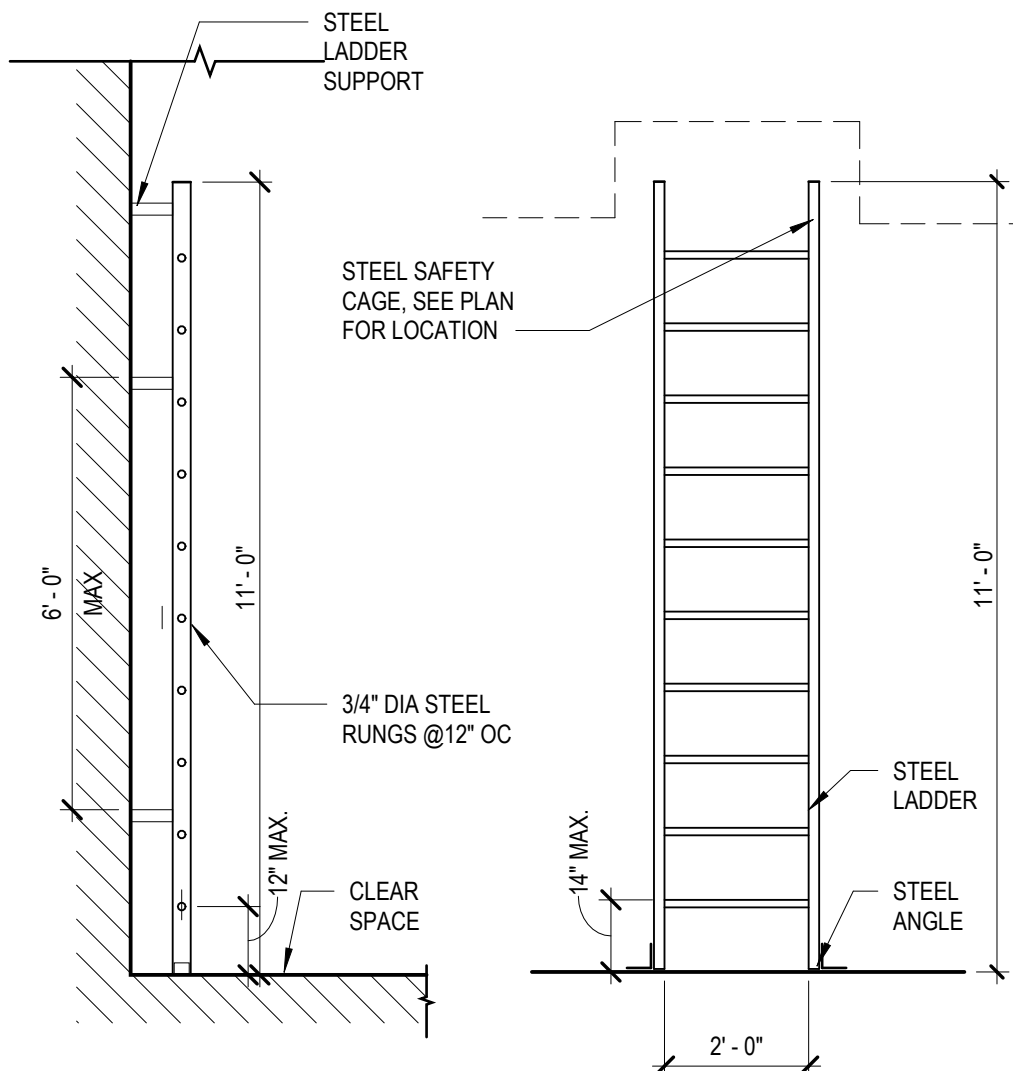


13 LADDER DETAIL
3/8" = 1'-0"

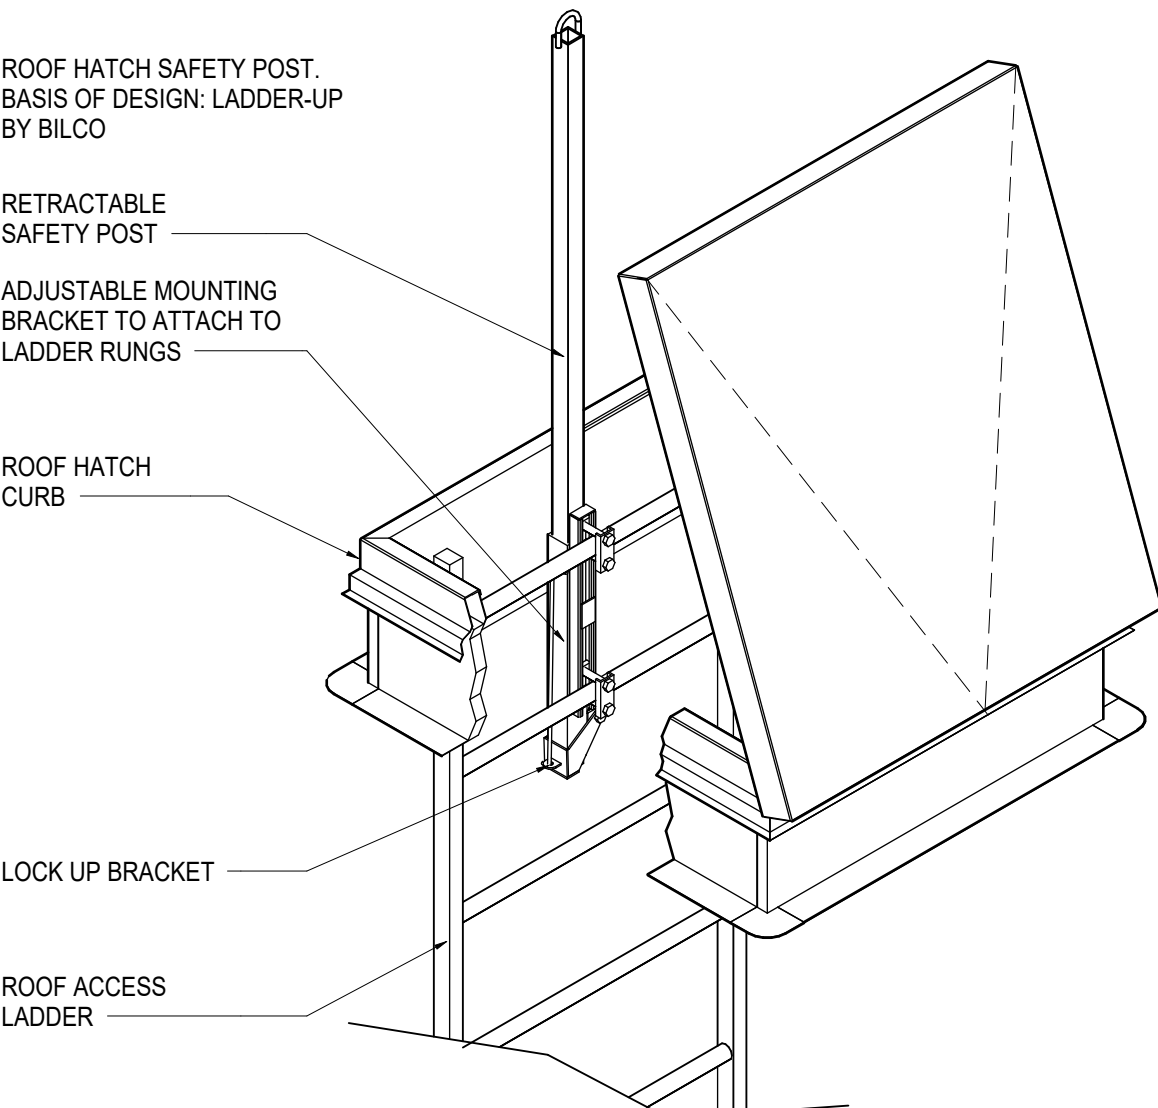


10 ROOF HATCH SAFETY POST
1 1/2" = 1'-0"

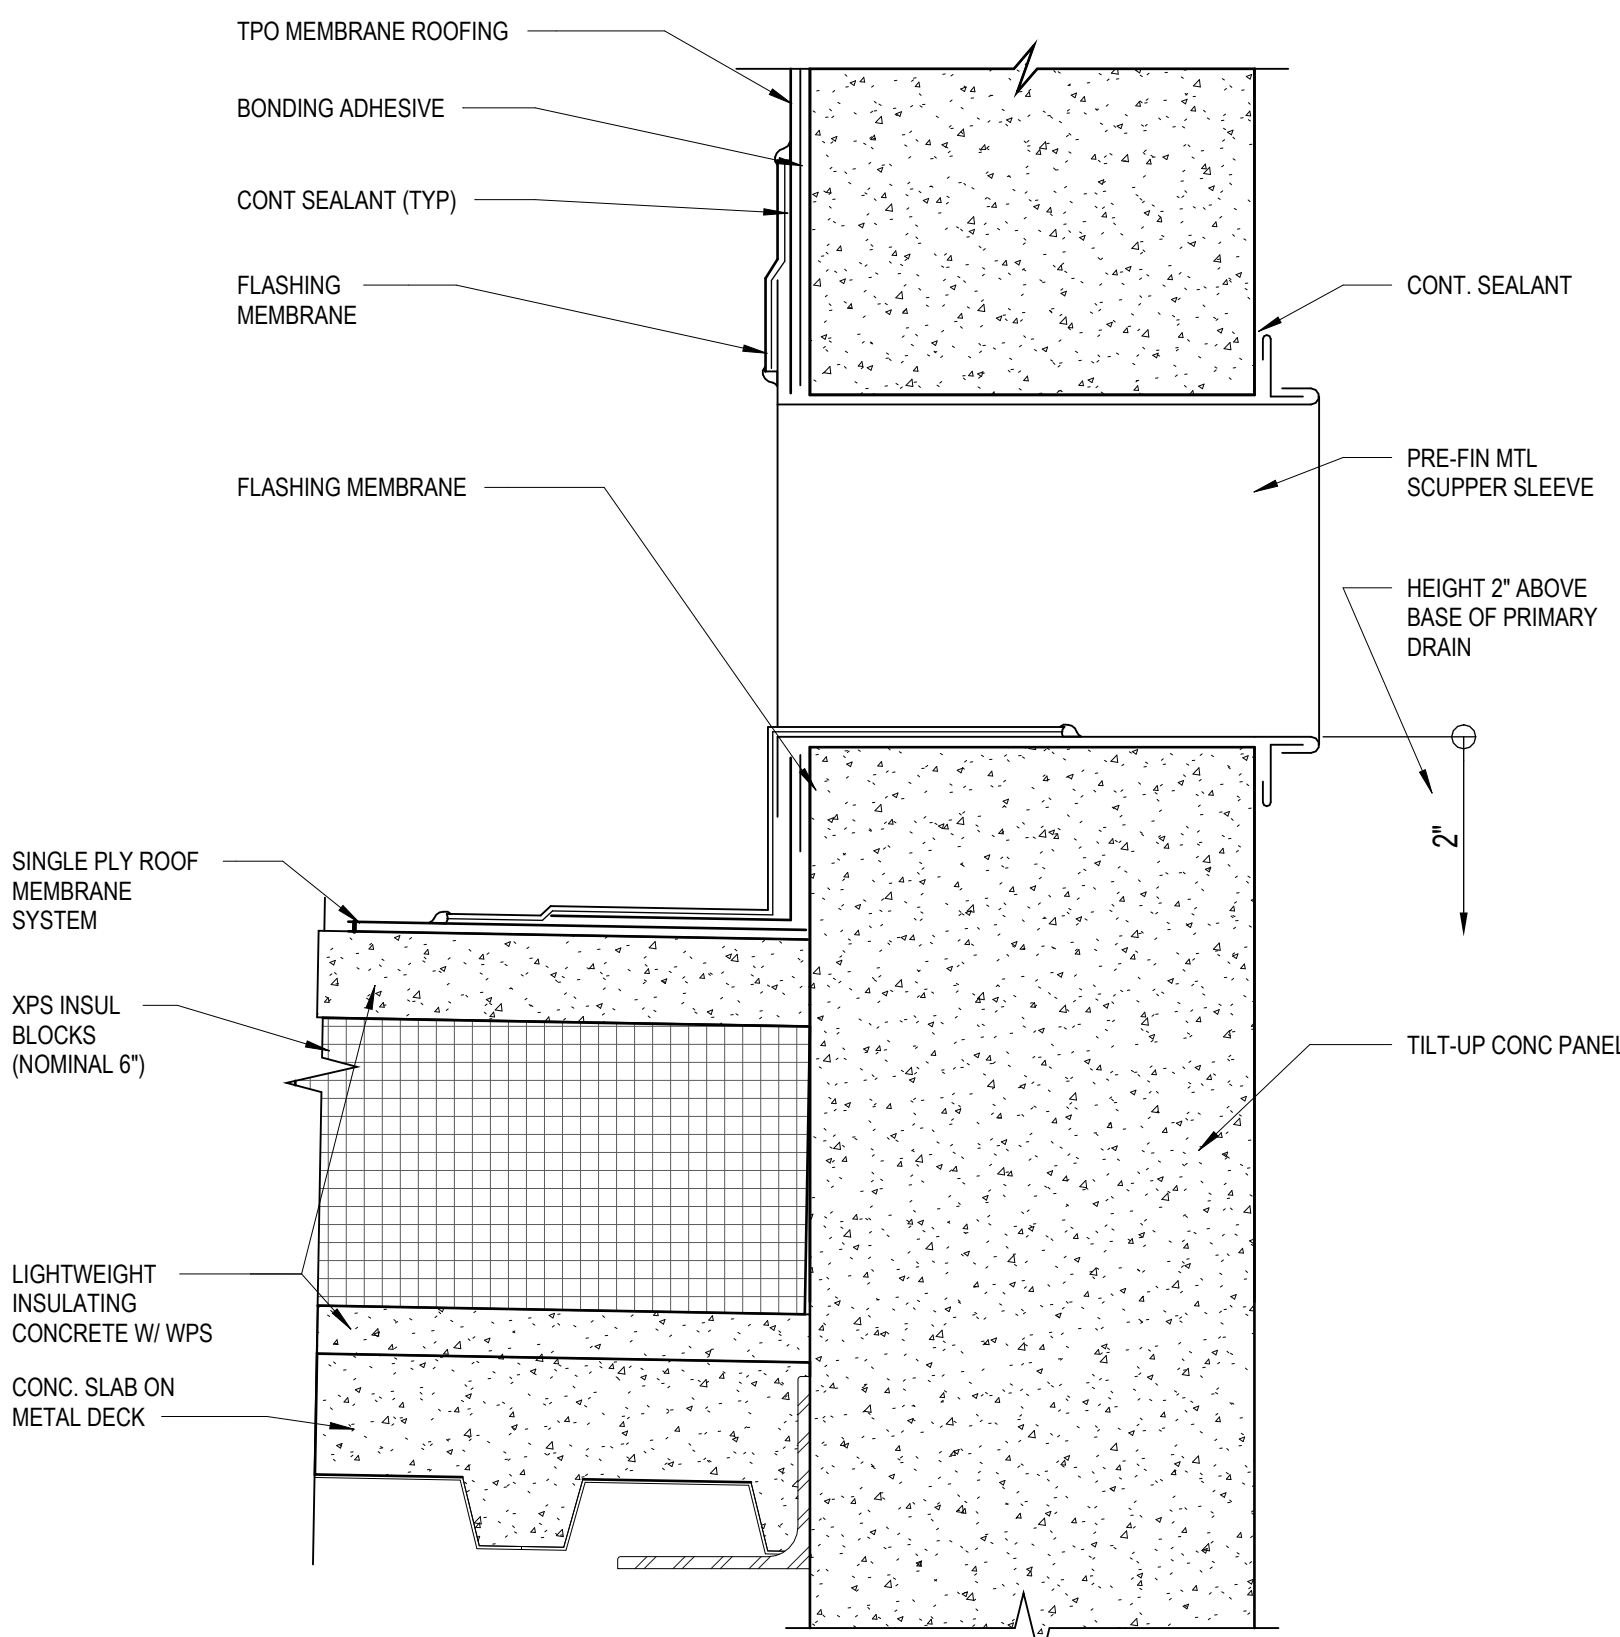


6 OVERFLOW SCUPPER
3" = 1'-0"

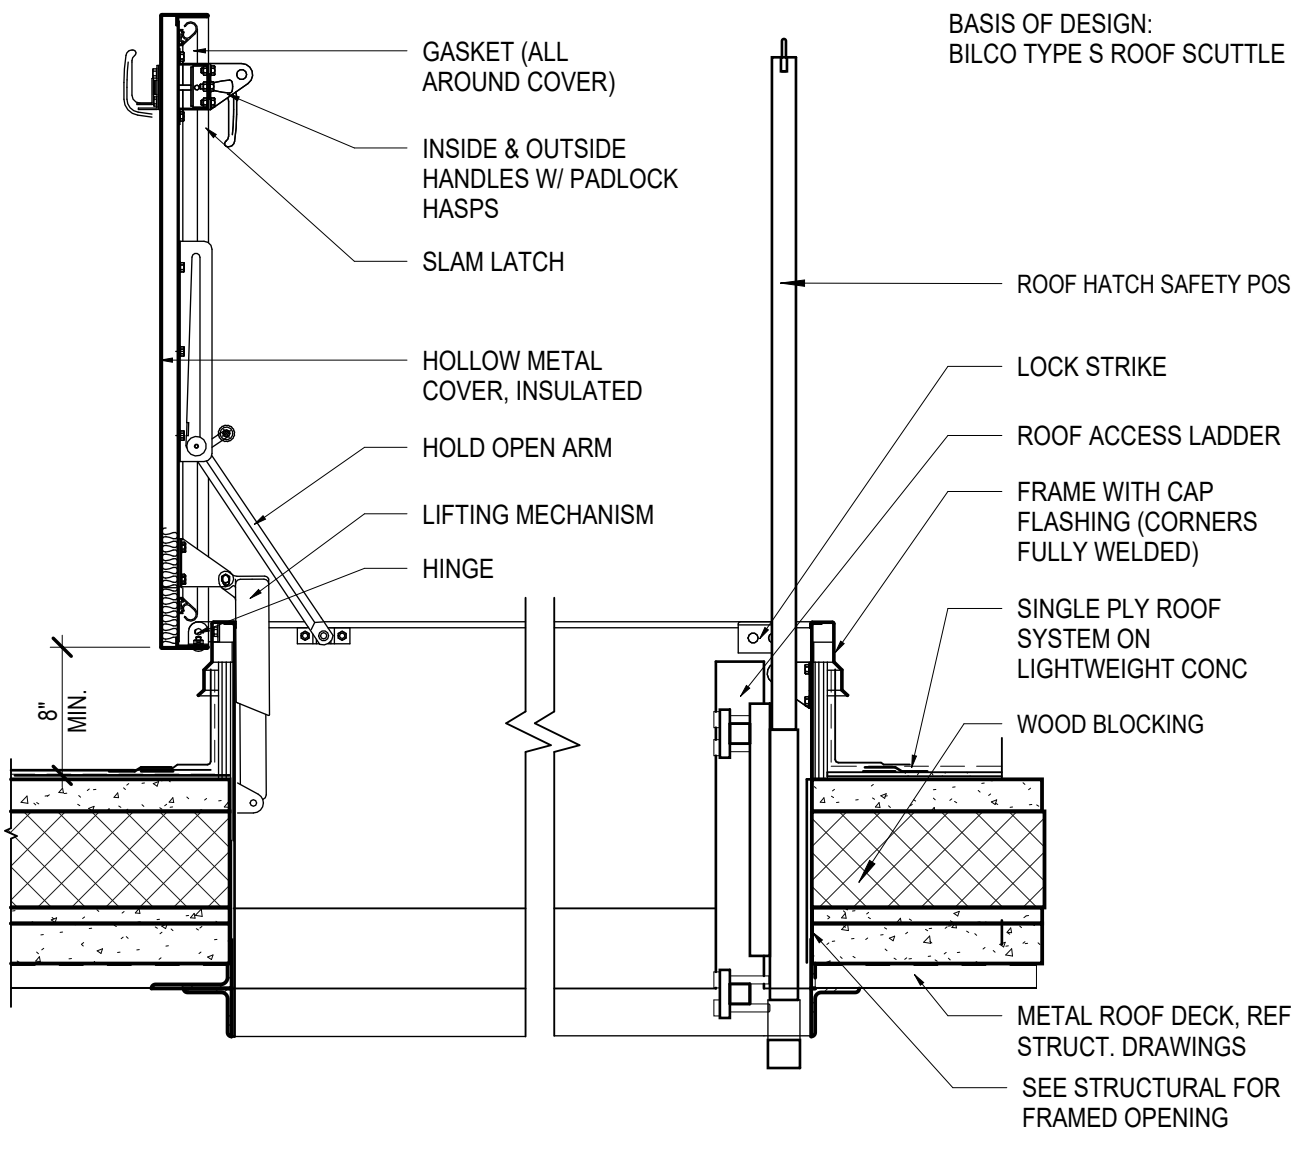


11 LADDER ROOF HATCH
1" = 1'-0"

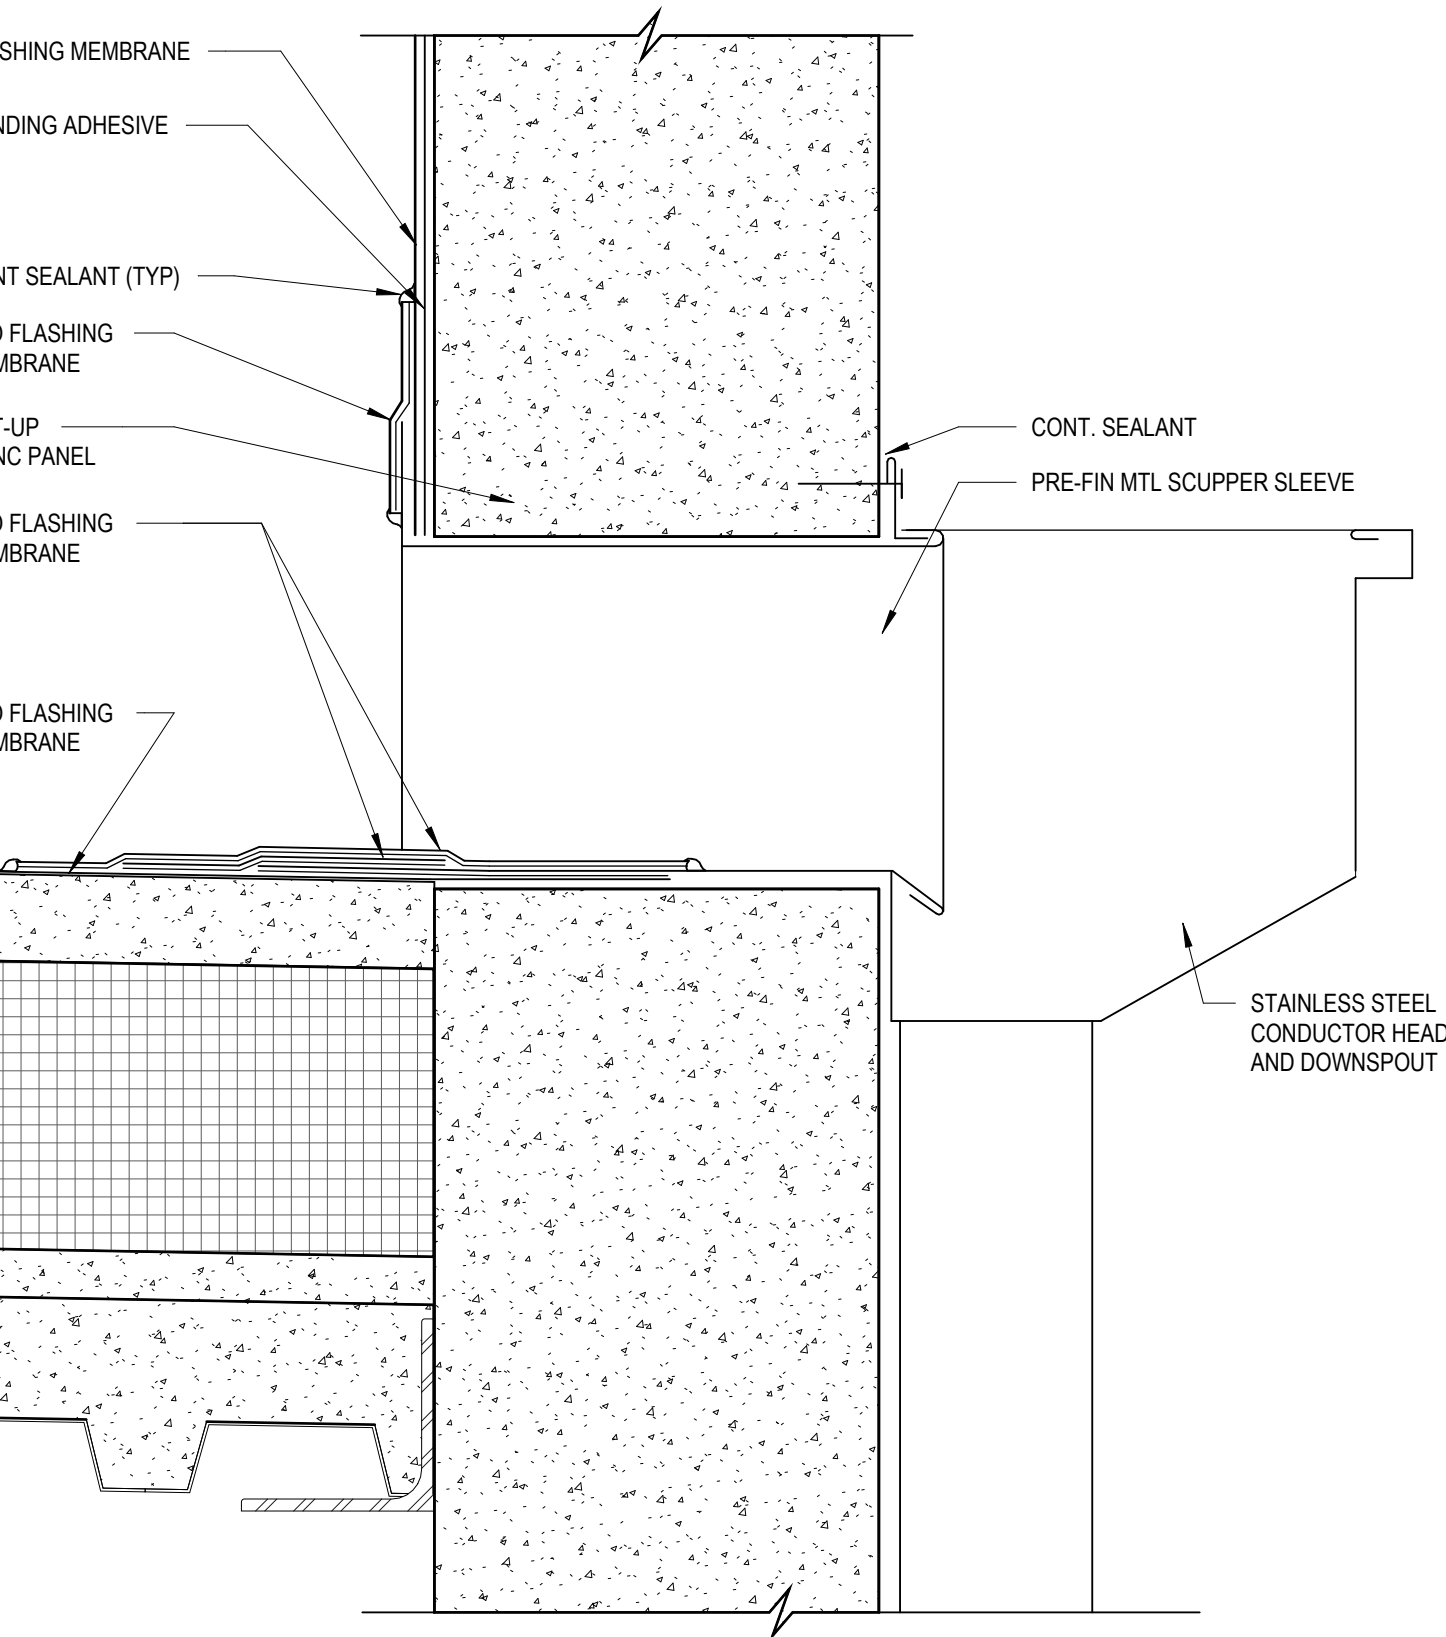

5 SCUPPER WITH CONDUCTOR
3" = 1'-0"

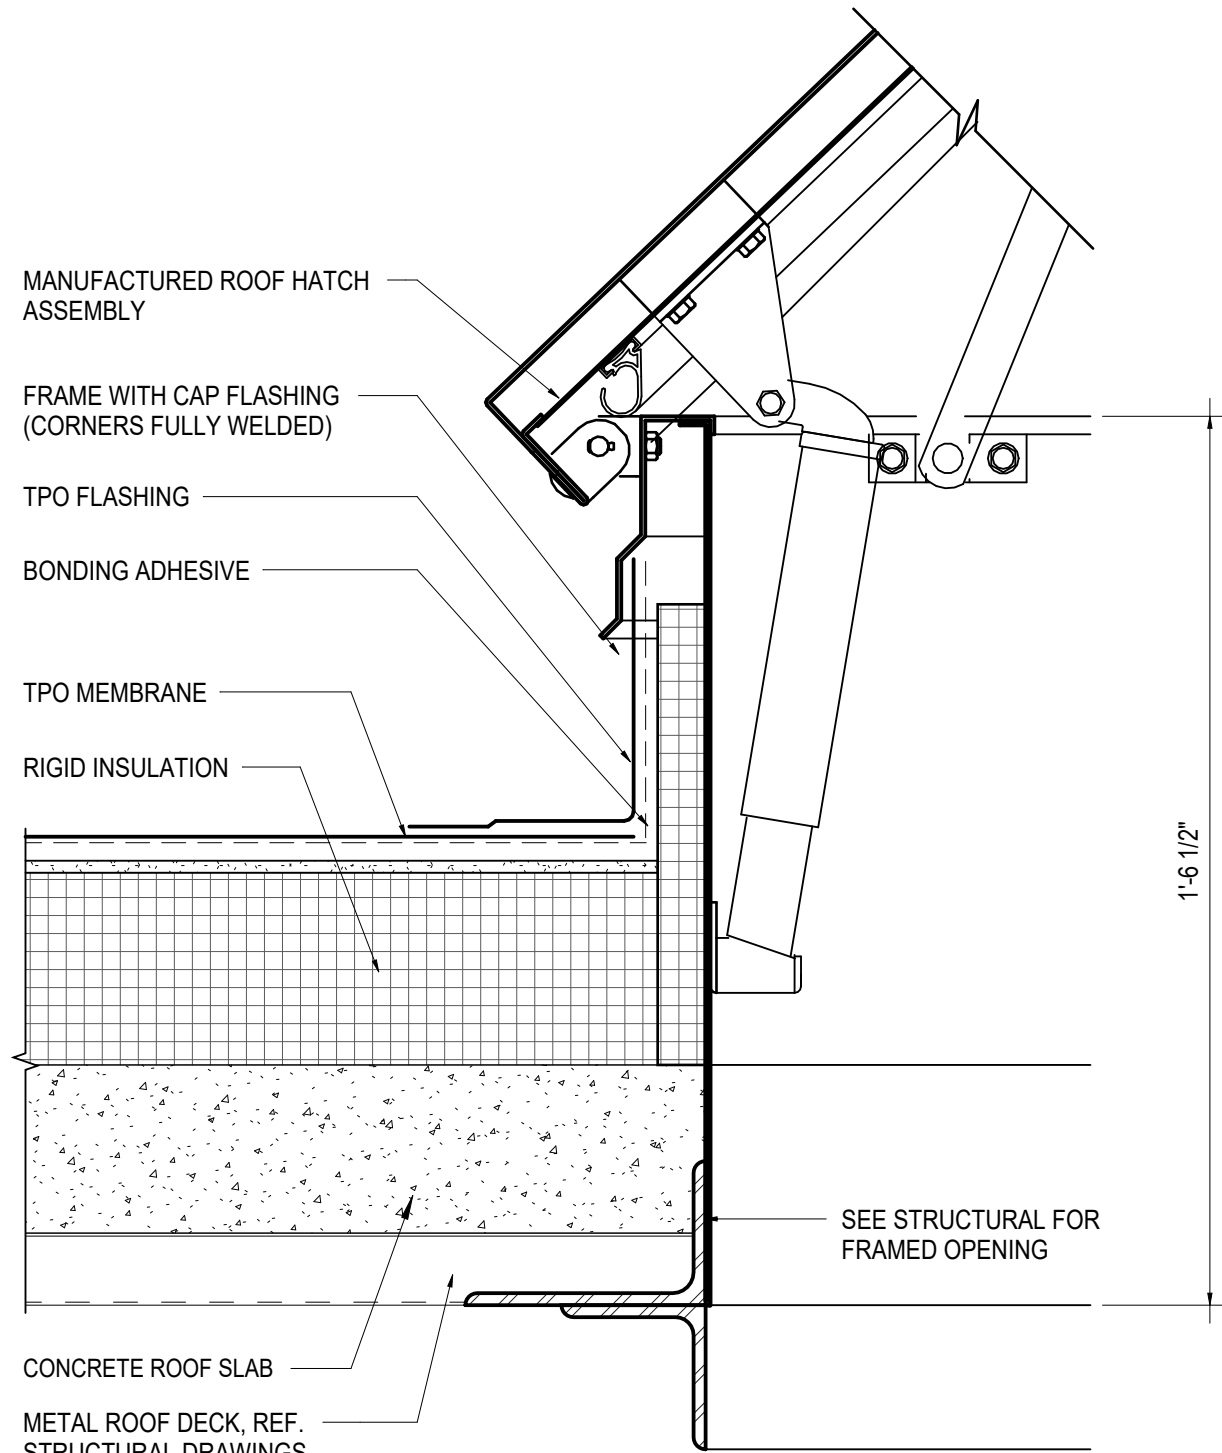


12 ROOF HATCH DETAIL
3" = 1'-0"

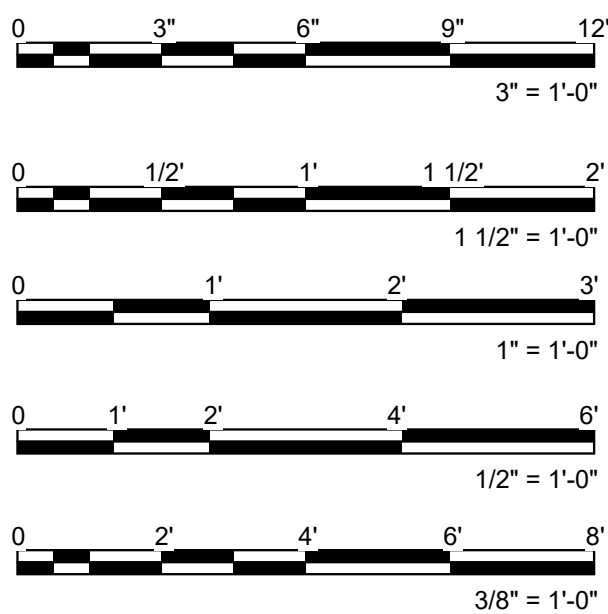

[illegible]

**FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA**

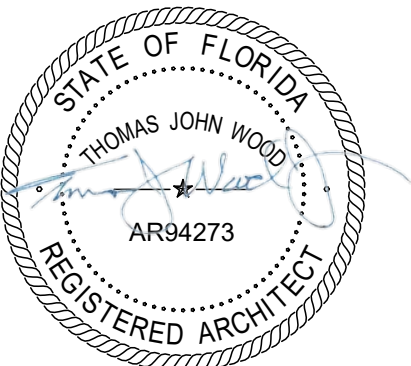

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273




DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003

DATE
03/15/2026
TITLE

DETAILS

DRAWING NO.

e-A530

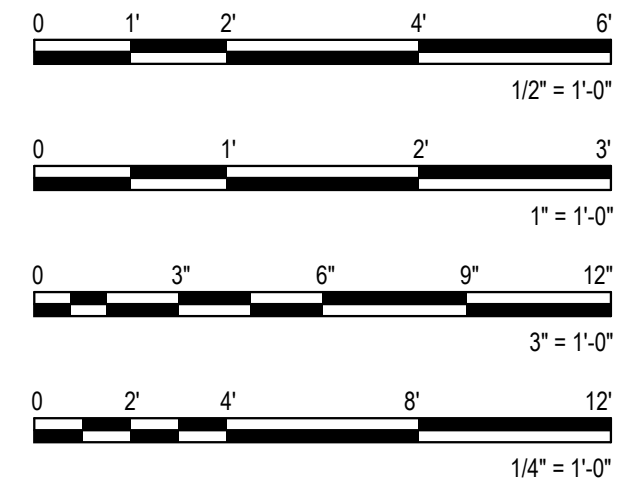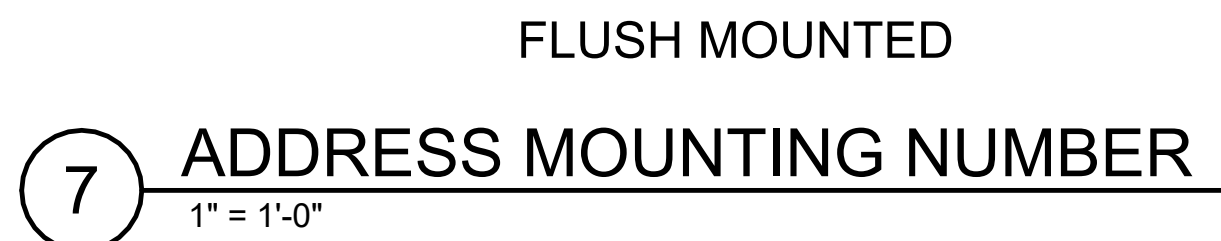

Autocad Descs\\C09414.003 - FFL
Columbia Warehouses
Building\\C09414003_A_FFL-B_2023_CENTRAL.rvt
3/30/2026 3:30:51 PM


A

B


C

D


E

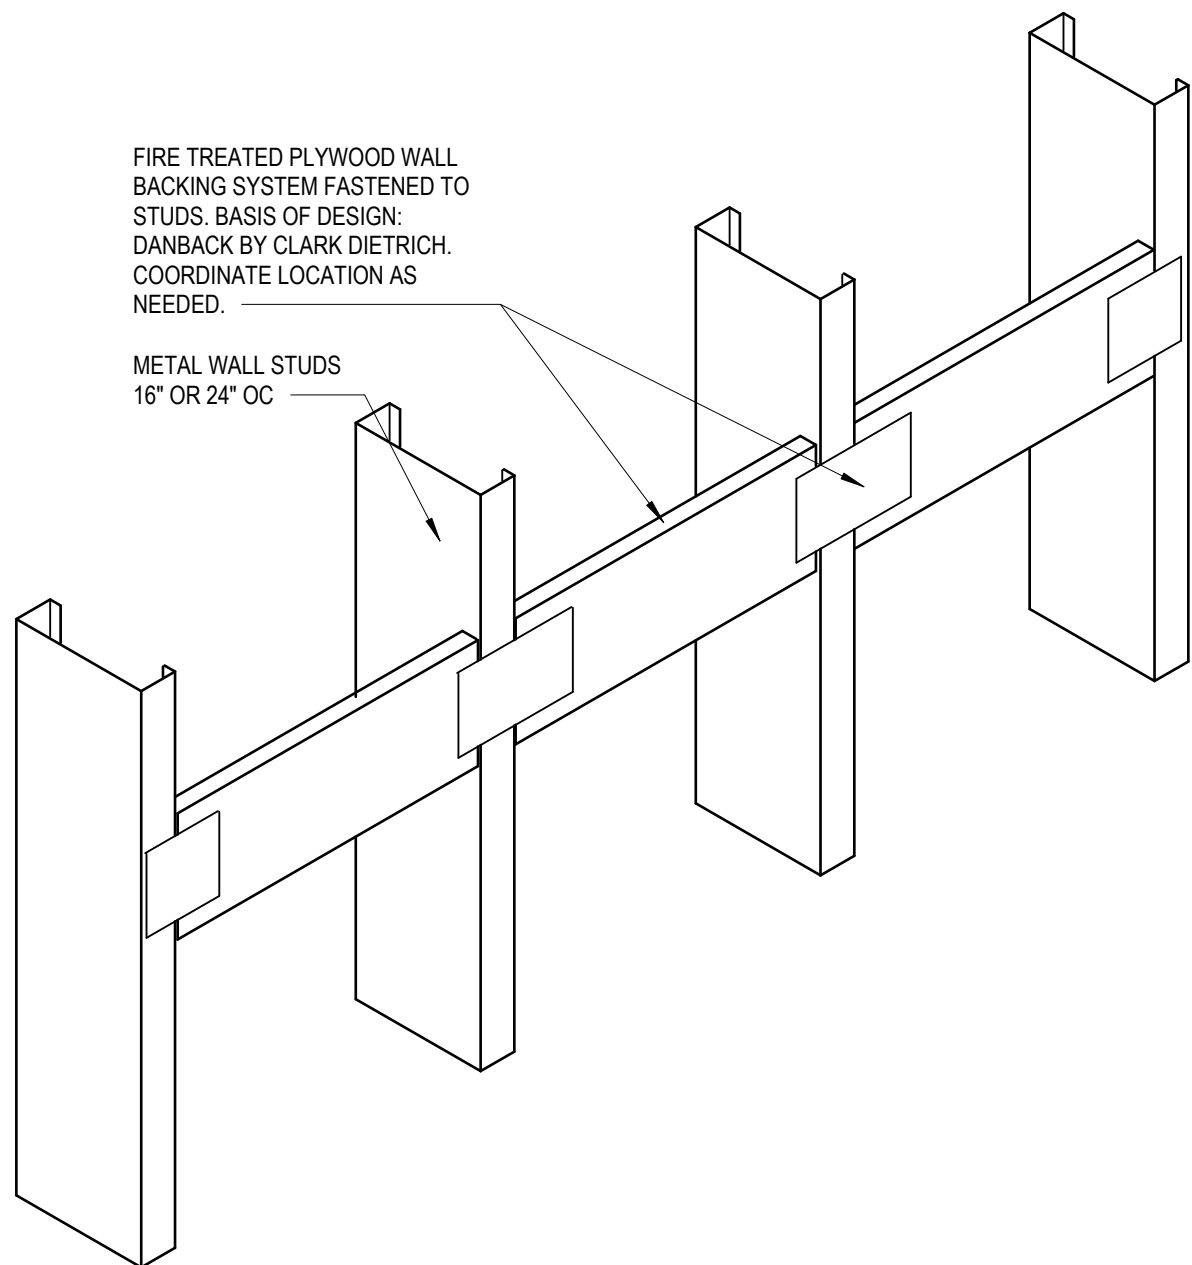


4 ACCESSORY/ EQUIPMENT MOUNTING DETAILS
N.T.S.

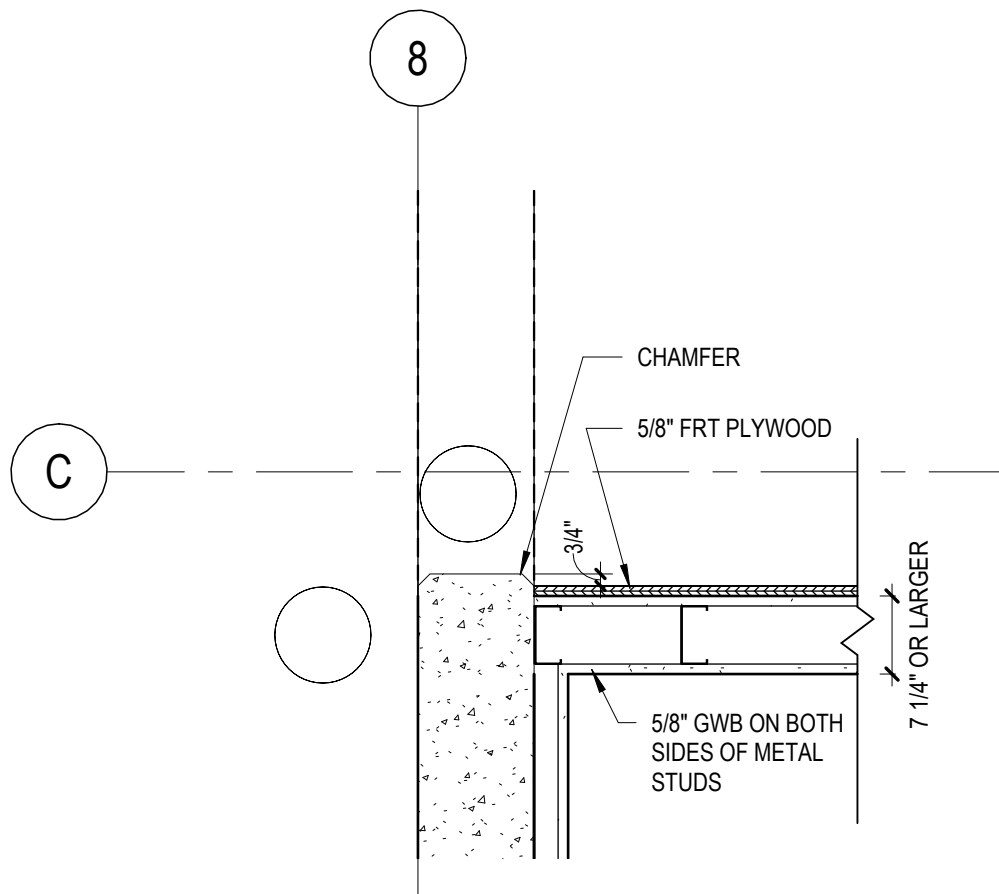


5 PLAN DETAIL @ PANEL EDGE
1" = 1'-0"

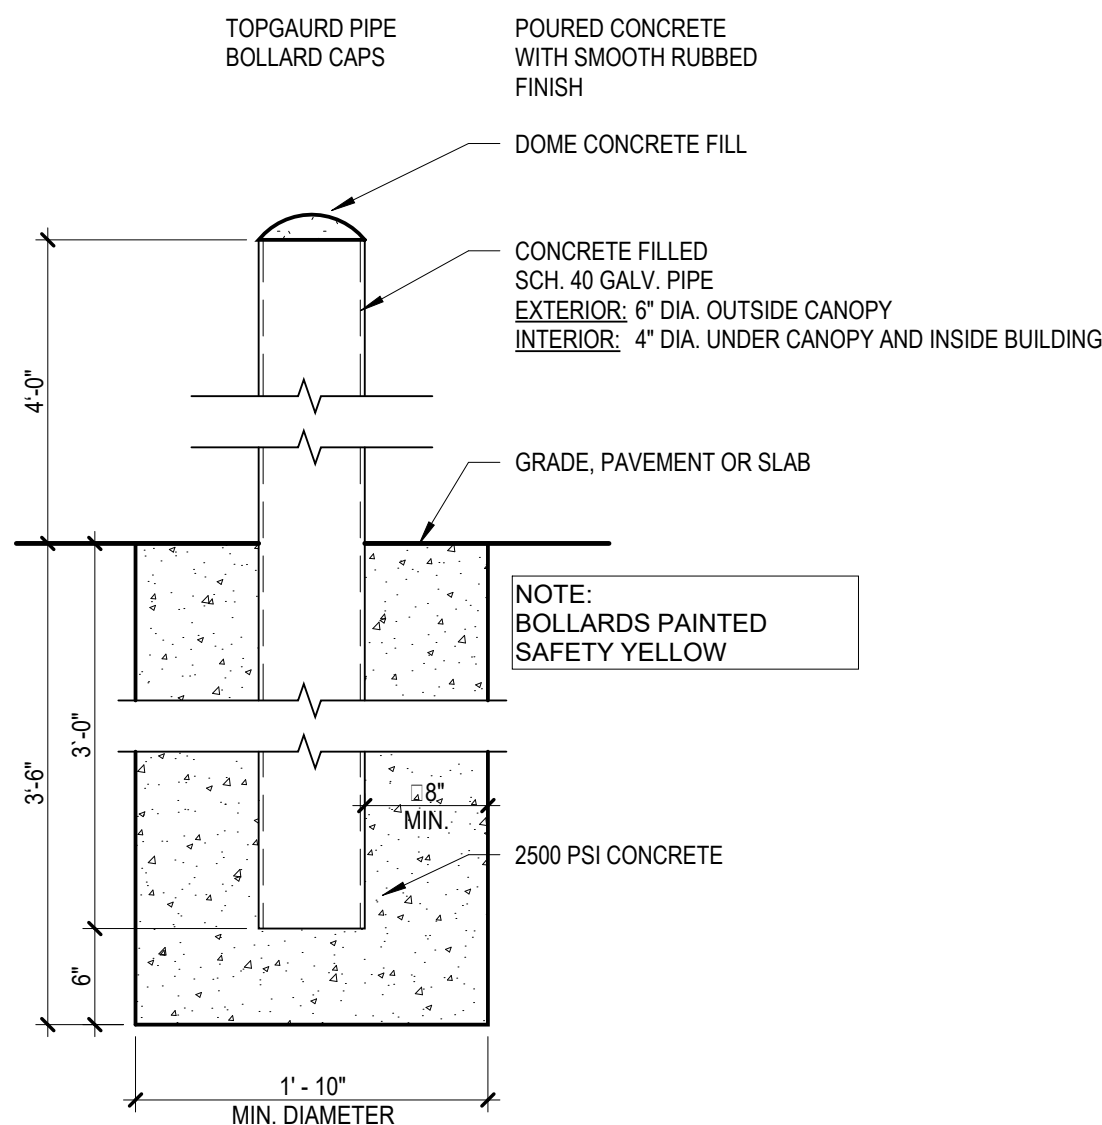

1 CONCRETE-FILLED STEEL BOLLARD
1" = 1'-0"

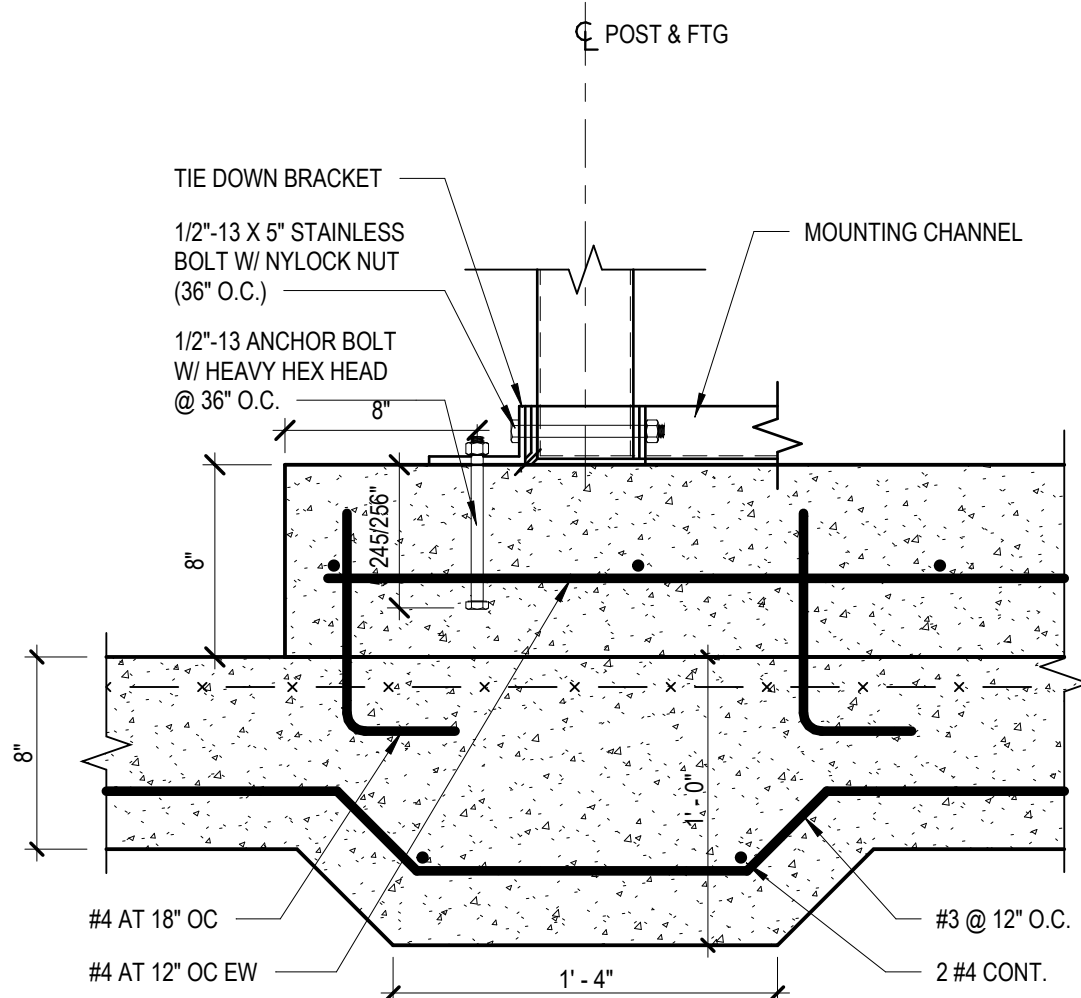


2 GENERATOR ATTACHMENT DETAIL
1 1/2" = 1'-0"

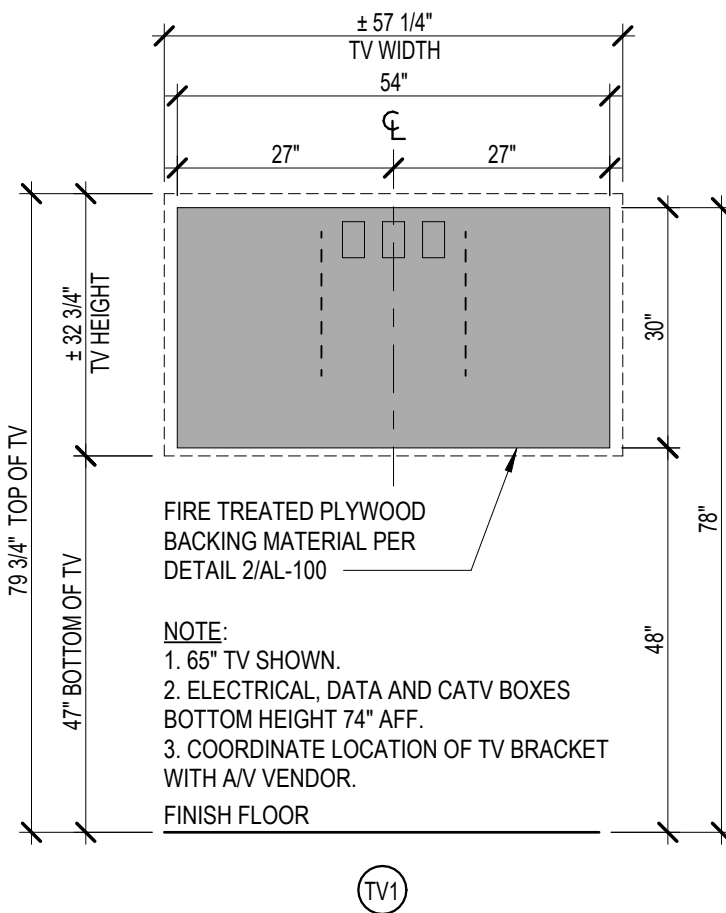

3 TV MOUNTING HEIGHT
1/2" = 1'-0"

DOCUMENT HISTORY		
REV	DATE	DESCRIPTION

FLORIDA POWER & LIGHT COMPANY
COLUMBIA STORM PROCESSING FACILITY
ISC STORES / PGD WAREHOUSE
BUILDING E
COLUMBIA COUNTY, FLORIDA

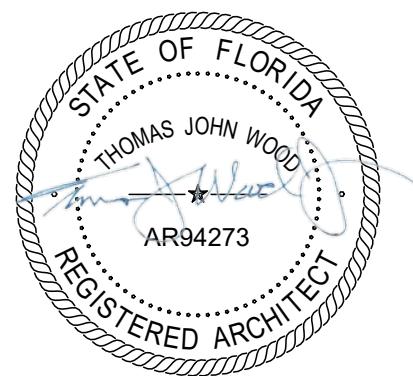

If this item has been electronically signed and sealed by
the licensed professional named above using a digital
signature and date. Printed copies of this document are
not considered signed and sealed, and the signature
must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY
BRPH
DRAWN BY
LOTHMAN
PROJECT NUMBER
C09414.003

DATE
03/15/2026
TITLE

DETAILS

DRAWING NO.

e-A531

DOOR SCHEDULE															
REV	NUMBER	DOOR						FIRE RATING	FRAME						COMMENTS
		TYPE	SIZE			MATL	UNDER CUT		TYPE	MATL	DETAIL				
			WIDTH	HEIGHT	THICK						HEAD	JAMB	SILL		
	100A	OHC	12'-0"	14'-0"		STL		-	STL	H2	J2	S2	BMS		
	100B	F	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1	CARD READER		
	100C	F	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1	BMS		
	100D	F	8'-0"	8'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1	CARD READER		
	100E	OHC	12'-0"	14'-0"		STL		-	STL	H2	J2	S2	BMS		
	101A	F	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1	CARD READER		
	101B	OHC	12'-0"	14'-0"		STL		-	STL	H2	J2	S2	BMS		
	101C	OHC	12'-0"	14'-0"		STL		-	STL	H2	J2	S2	BMS		
	101D	F	8'-0"	8'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1	CARD READER		
	102	N	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1			
	103	N	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1			
	104	N	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H3	J3	S3			
	105	F	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H1	J1	S1	CARD READER		
	106	F	3'-0"	7'-0"	0'-1 3/4"	HM	3/4"	1	HM	H3	J3	S3			
	107	F	3'-0"	7'-0"	0'-1 3/4"	HM	3/4"	1	HM	H3	J3	S3			
	108	F	3'-0"	7'-0"	0'-1 3/4"	HM	3/4"	1	HM	H3	J3	S3			
	109	N	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H3	J3	S3			
	110	N	3'-0"	7'-0"	0'-1 3/4"	HM		1	HM	H3	J3	S3			
	111	F	3'-0"	7'-0"	0'-1 3/4"	HM	90 MIN	1	HM	H1	J1	S1	CARD READER		
	112	F	3'-0"	7'-0"	0'-1 3/4"	HM	90 MIN	1	HM	H1	J1	S1	CARD READER		
	201	F	3'-0"	7'-0"	0'-1 3/4"	HM	45MIN	1	HM	H3	J3	S3			
	202	F	3'-0"	7'-0"	0'-1 3/4"	HM	90 MIN	1	HM	H4	J4	S4			

WINDOW SCHEDULE								
TYPE MARK	R.O.		DESCRIPTION	FINISH	SILL	GLAZING TYPE	HEAD HEIGHT	COMMENTS
	WIDTH	HEIGHT						
A	4'-0"	4'-0"	FIXED ALUM.	MILL	WS1	GL-01	7'-2"	PROVIDE WITH WINDOW SHADE
B	4'-0"	3'-6"	FIXED ALUM.	MILL	WS1	GL-01	7'-2"	PROVIDE FLORIDA PRODUCT APPROVAL. PROVIDE WITH WINDOW SHADE

Diagram showing two window type elevations, A and B, with dimensions:

- Elevation A: Height 7'-0", Width 4'-0"
- Elevation B: Height 7'-0", Width 4'-0"

WINDOW TYPE ELEVATIONS

The image contains three cross-sectional diagrams of window and door thresholds, labeled LH1, LJ1, and LS1.

LH1: This diagram shows a threshold for a horizontal opening. It features a precast concrete panel on top, with a continuous stainless steel drip and a continuous sealant below it. A prefinished louver is shown below the sealant. The entire assembly is supported by an aluminum attachment angle around the perimeter. Labels include: REFER TO WALL TYPES FOR LOCATION OF FINISHES, PRECAST CONCRETE PANEL, CONT. S.S. DRIP, CONT. SEALANT, PREFINISHED LOUVER (REF. MECH.), and ALUMINUM ATTACHMENT ANGLE AROUND PERIMETER.

LJ1: This diagram shows a threshold for a vertical opening. It features a precast concrete panel on top, with a continuous sealant below it. A prefinished louver is shown below the sealant. The entire assembly is supported by an aluminum attachment angle around the perimeter. Labels include: REFER TO WALL TYPES FOR LOCATION OF FINISHES, PRECAST CONCRETE PANEL, CONT. S.S. DRIP, CONT. SEALANT, PREFINISHED LOUVER (REF. MECH.), and ALUMINUM ATTACHMENT ANGLE AROUND PERIMETER.

LS1: This diagram shows a threshold for a vertical opening. It features a tilt-up concrete wall on top, with a continuous sealant below it. A continuous stainless steel flashing is shown below the sealant. The entire assembly is supported by an aluminum attachment angle around the perimeter. Labels include: REFER TO WALL TYPES FOR LOCATION OF FINISHES, TILT-UP CONCRETE WALL, CONT. SEALANT, and CONT. S.S. FLASHING.

NOTE: SEE BUILDING ELEVATIONS FOR
SIZE AND MOUNTING HEIGHT AND
LOCATION

LOUVER DETAILS

1

PER WALL TYPE, 5/8" GYP. BD. 1-5/8" FURRING W/ 1-1/2" POLYISO. INSUL.

CORNER BEAD

WINDOW SHADE (SEE A-641)

PRECAST CONCRETE WALL

CONT. ALUMINUM DRIP

CONT. SEALANT BOTH SIDES

CURTAIN WALL HEAD PROFILE

WH1

CURTAIN WALL JAMB PROFILE

CONT. SEALANT BOTH SIDES

WJ1

FLASHING BACK DAM

SS-2

CURTAIN WALL SILL PROFILE

CONT. SEALANT BOTH SIDES

FLASHING END DAM

CONT. ALUMINUM FLASHING

PRECAST CONCRETE WALL

WS1


WINDOW DETAIL

The diagram illustrates five different door and frame types used in industrial applications:

- HM (Hood Motor):** A simple rectangular frame with a single vertical line indicating the door's position.
- FLUSH:** A rectangular frame with a dashed diagonal line from the bottom-left corner to the top-right corner, indicating a flush door.
- NARROW LT (Narrow Lift):** A rectangular frame with a dashed diagonal line and a small rectangular inset on the right side, indicating a narrow lift door.
- WM (Wire Mesh Swing Gate):** A rectangular frame with a grid pattern, indicating a wire mesh swing gate.
- OHC (Insulated Slat Overhead Coiling Door):** A detailed diagram of an overhead door with horizontal slats. It includes labels for:
 - DOOR HOOD
 - DOOR MOTOR
 - DOOR CURTAIN
 - DOOR GUIDE
 - DS7/A353b (a small component at the bottom right)
 - SEE SCHED OPENING WIDTH (a dimension line at the top)
 - INSULATED SLAT OVERHEAD COILING DOOR (the main title for this type)

H1	H2	H3	H4
J1	J2	J3	J4
S1	S2	S3	S4

DOOR DETAILS

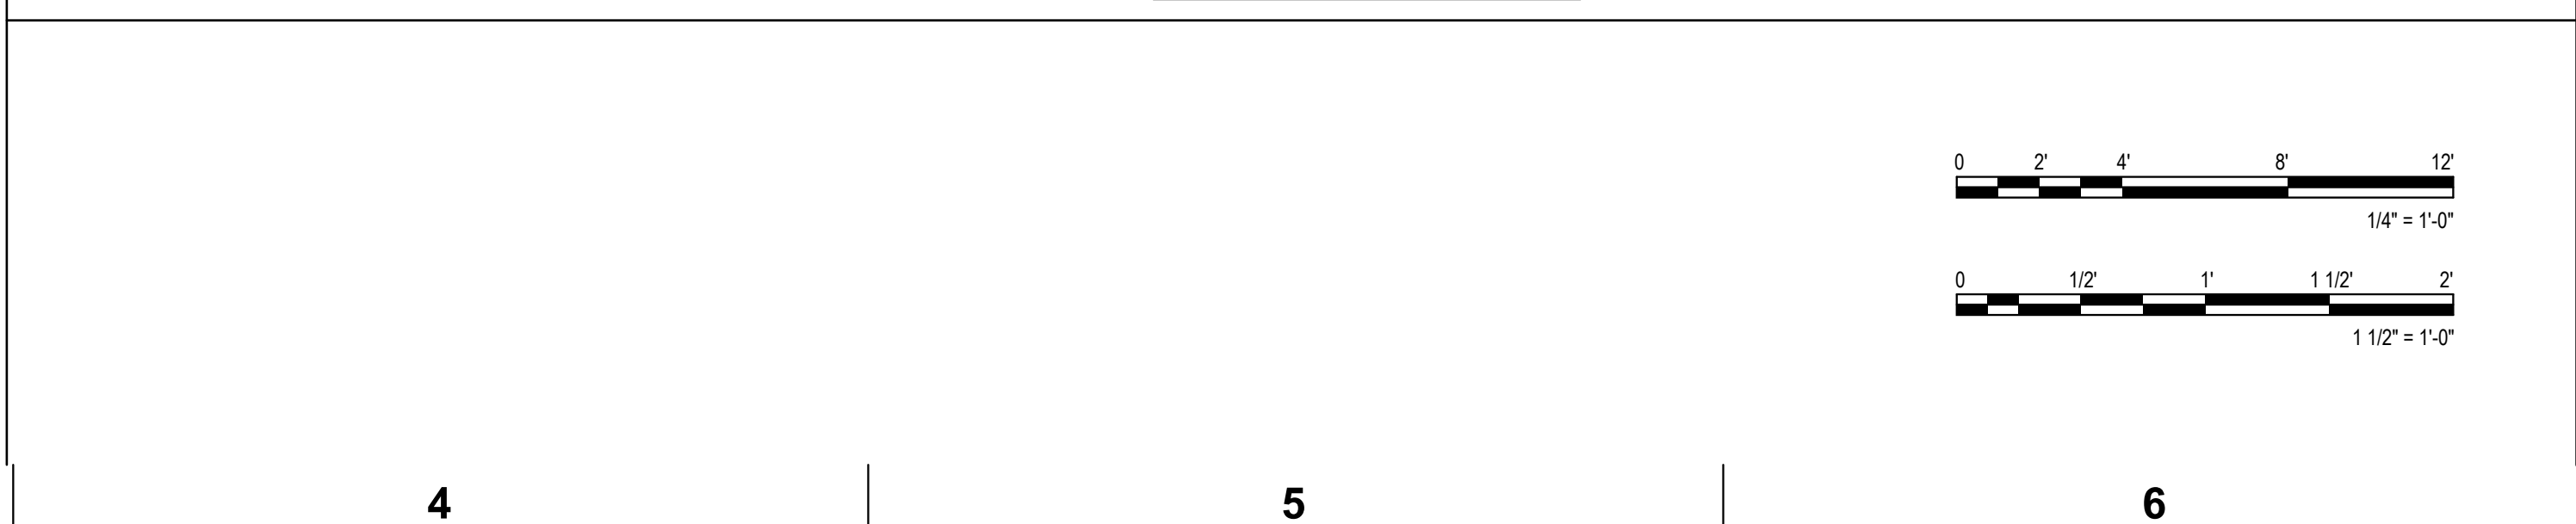

Audcast Docs\\C09414.003 - FFL
Columbia Warehouses
Building\\C09414003_A_FFL-B_2023_CENTRAL.rvt
3/30/2026 3:30:54 PM

03/15/2026

E

D

C

B


A

NAME	DESCRIPTION	MANUFACTURER	MODEL	COLOR	SIZE	COMMENTS
APC	ACOUSTICAL PANEL CEILING	ARMSTRONG	ULTIMA 1911 BEVELED TEGULAR	WHITE	2'x2'	15/16" GRID, BEVELED TEGULAR, NRC RATING 70, LIGHT REFLECTANCE 90, FIRE RESISTANCE: CLASS A
EXP	EXPOSED CONCRETE FLOOR	SIKA	DRY SHAKE HARDENER w/ SEALER			INTEGRAL SHAKE HARDENER PLACED IN THE CONC FLOOR AND SEALER
EFC	EPOXY FLOOR COATING	VERSITILE	ROCK ON ROCK	GRAPHITE - 39		PROVIDE MOISTURE MITIGATION
SDT-1	STATIC DISSIPATIVE TILE	ARMSTRONG	EXCELON SDT	FOSSIL GRAY	12"x12"	PROVIDE MOISTURE MITIGATION
B-1	RUBBER BASE	JOHNSONITE		20 CHARCOAL	4" COVE	PROVIDE MOISTURE MITIGATION
PTB	PORCELAIN TILE BASE	TRINITY TILE	ARGONITE	GREEN (GRAY IN COLOR, BUT CALLED GREEN)	3" x 12", S-43C9 BULLNOSE	GROUT: 1/16" JOINT, COLOR LACTICRETE, SPECTRALOCK PRO GROUT: EPOXY GROUT #27 SILVER
PFT	PORCELAIN TILE	DALTILE	HAUT MONDE	EMPIRE BLACK, UNPOLISHED	12"x 24"	GROUT: 1/16" JOINT, COLOR LACTICRETE, SPECTRALOCK PRO GROUT: EPOXY GROUT #27 SILVER
PWT-1	PORCELAIN WALL TILE	DALTILE	HAUT MONDE	ELITE GRAY LIGHTLY POLISHED	12"x 24"	GROUT: 1/16" JOINT, COLOR LACTICRETE, SPECTRALOCK PRO GROUT: EPOXY GROUT 24 NATURAL GRAY
PWT-2	PORCELAIN TILE TRIM	SCHLUTER	QUADEC SQUARE SHAPED PROFILE	BRUSHED STAINLESS STEEL		GROUT: 1/16" JOINT, COLOR LACTICRETE, SPECTRALOCK PRO GROUT: EPOXY GROUT 24 NATURAL GRAY
PL-1	PLASTIC LAMINATE	WILSONART	FINE VELVET FINISH	NORDIC LINEN 5015-38		BASE CABINETS - REFER TO ELEVATIONS
PL-2	PLASTIC LAMINATE	WILSONART	FINE VELVET FINISH	NORDIC LINEN 5015-38		WALL CABINETS - REFER TO ELEVATIONS
SS-1	SOLID SURFACE	CORIAN		CARBON CONCRETE	3/4" THICK	COUNTER & BACKSPLASH - REFER TO ELEVATIONS, QUARTER ROUND-TOP EDGE AND INTEGRATED SOLID SURFACE 4" COVE AS BACKSPLASH
SS-2	ACRYLIC SOLID SURFACE	AVONITE	STRUCTURE SERIES	KOKOURA F1-9117	1/2" THICKNESS, SQ. EDGE	SEE NOTES FOR MORE INFORMATION (WINDOW SILLS)
PT-1	PAINT	SHERWIN WILLIAMS	WALLS - WAINSCOT	SW625 SERIOUS GRAY		WAINSCOT TO 4' AFF
PT-2	PAINT	SHERWIN WILLIAMS	WALLS	SNOWFALL #6000		ABOVE WAINSCOT, FINISH: LATEX EGGSHELL
PT-3	PAINT	SHERWIN WILLIAMS	RESTROOM CEILINGS	7005 PURE WHITE		
PT-4	NOT USED					
PT-5	PAINT	SHERWIN WILLIAMS	DRY FALL (HIGH BAY)	SNOWFALL #6000		
PT-6	PAINT	SHERWIN WILLIAMS	DOORS & FRAMES	SW625 SERIOUS GRAY (INTERIOR SIDE)		
WS-1	WINDOW SHADES INC.	MECHO SYSTEM SOLAR SHADE...		MATERIAL SWATCH		5% - 9% OPENNESS, INCLUDE HEADRAIL FASCIA


GENERAL FINISH NOTES

- GENERAL CONTRACTOR TO PROVIDE MOCK UPS PRIOR TO INSTALLATION.
- GENERAL CONTRACTOR SHALL PREPARE SUBMITTALS OF ALL INTERIOR FINISHES FOR APPROVAL BY ARCHITECT PRIOR TO APPLICATION. SAMPLES SHALL BE OBTAINED AND SUBMITTED IN A TIMELY MANNER.
- GENERAL CONTRACTOR AND SUB-CONTRACTOR TO REVIEW AND DIRECT PROPER INSTALLATION SEQUENCING OF ALL APPLIED FINISH MATERIALS PRIOR TO INSTALLATION.
- ALL WALLS SHALL BE PROPERLY PREPARED, SPACKLED, SANDED, ETC. TO PROVIDE A SMOOTH FINISH. SURFACE PAINT DRIPS MUST BE REMOVED.
- UPON COMPLETION OF PAINTING, CONTRACTOR SHALL REMOVE ALL PAINT FROM SURFACES WHERE IT WAS SPILLED, SPLASHED, OR SPLATTERED; INCLUDING SWITCH PLATES AND HARDWARE.
- GENERAL CONTRACTOR TO PROVIDE FLOOR SURFACES THAT ARE INSTALLED FLUSH AND EVEN. ALL ADJACENT FLOOR AREAS TO HAVE LEVEL TRANSITIONS. ALL DOOR AND SILL TRANSITIONS MUST BE TAKEN INTO ACCOUNT PRIOR TO INSTALLATION.
- FLOORING CONTRACTOR TO ADJUST ALL TILE LAYOUTS PER ACTUAL BUILT OUT CONDITIONS.
- ALL GROUT TO BE LATICRETE, SPECTRALOCK PRO. KEEP ALL JOINTS AS MINIMAL AS POSSIBLE, SEE PRODUCT RECOMMENDATIONS.
- ALL GROUT AND SEALANTS TO BE CAREFULLY CLEANED OFF OF TILES, ACCENT TILE, AND SURROUNDING METAL DOOR AND ELEVATOR JAMBS.
- FOR ALL TILE AND BASE AT INSIDE CORNER CONDITIONS, CUT TILE ON AN ANGLE TO FORM NEAT, CLEAN AND ALIGNED MATERIALS. FORM SMOOTH, CONSISTENT FINISH EDGES AND CORNERS THROUGHOUT. NO JAGGED PIECES WILL BE ALLOWED.
- FLOORING CONTRACTOR TO FURNISH AND INSTALL FLOOR TRANSITION MATERIALS WHICH WILL BE METAL SCHLUTER STRIP UNLESS OTHERWISE NOTED. FIELD CONDITIONS TO BE VERIFIED BEFORE ORDERING APPROPRIATE PROFILES.
- ALL CEILINGS TO BE PAINTED PT-1 UNLESS OTHERWISE NOTED ON ROOM FINISH SCHEDULE OR RCP.
- ALL MILLWORK DIMENSIONS TO BE FIELD VERIFIED PRIOR TO SHOP DRAWINGS AND FABRICATION.
- ALL DOOR AND MILLWORK SHOP DRAWINGS TO BE SUBMITTED TO ARCHITECT WITH SAMPLE MATERIALS, PRIOR TO PURCHASE AND FABRICATION OF MATERIALS.
- ALL WOOD MILLWORK AND VENEER SAMPLES TO MATCH ARCHITECTS CONTROL SAMPLE SPECIES, COLOR, AND STAIN.
- INSTALLATION METHOD FOR ALL SMALL AND MEDIUM TILE TO BE LATICRETE MODIFIED THIN SET.
- PROVIDE ADDITIONAL METAL WALL BLOCKING AS NECESSARY FOR ARTWORK, TV'S, WALL SHELVING, LIGHT FIXTURES, COUNTERTOPS, ETC.
- REFERENCE INTERIOR FINISH PLANS, FINISH LEGENDS, FINISH SCHEDULE, INTERIOR ELEVATIONS AND SECTIONS FOR ADDITIONAL INFORMATION.
- ALL FLOOR TILES WILL START WITH FULL TILES, CENTERED ON DOORWAY AND ENTRYWAYS UNLESS NOTED OTHERWISE.
- RECESS SLAB IN RESTROOMS TO ACCOMMODATE SPECIFIED TILE AND SLOPE TO DRAINS.
- COORDINATE WITH STRUCTURAL.
- GENERAL CONTRACTOR TO PRICE AND ORDER ATTIC STOCK FOR FLOORING AND HARD MATERIALS PER OWNER'S DIRECTION.
- ALL FINISH MATERIALS SHALL COMPLY WITH FBC SECTION 803, TABLE 803.11.

ROOM FINISH SCHEDULE					
NUMBER	ROOM NAME	FLOOR	BASE	CEILING	WALL
100	STORAGE	EXP	B-1	EXP. STRUCT.	PT-5
101	STORAGE	EXP	B-1	EXP. STRUCT.	PT-5
102	OFFICE	EFC	B-1	APC	PT-2
103	WORKSPACE	EFC	B-1	APC	PT-2
104	BREAKROOM	EFC	B-1	APC	PT-2
105	IDF	SDT-1	B-1	EXP. STRUCT.	PT-2
106	JANITOR'S CLOSET	EXP	B-1	PT-2	PT-2
107	UNISEX	PFT	PTB	PT-3	PWT-1
108	UNISEX	PFT	PTB	PT-3	PWT-1
109	CREW ROOM	EFC	B-1	APC	PT-2
110	HUDDLE	EFC	B-1	APC	PT-2
111	ELEC	EXP	B-1	PT-2	PT-2
112	FIRE RISER	EXP	B-1	PT-2	PT-2
200	MEZZANINE	EXP	B-1	EXP. STRUCT.	PT-2
201	MECH ROOM	EXP	B-1	EXP. STRUCT.	PT-2
202	BOA CLOSET	EXP	B-1	EXP. STRUCT.	PT-2

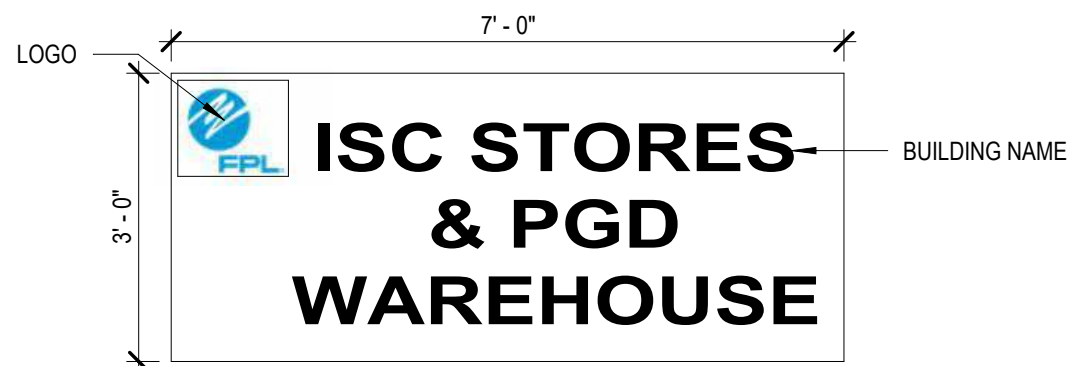


11 EXTERIOR BUILDING SIGN
1/2" = 1'-0"

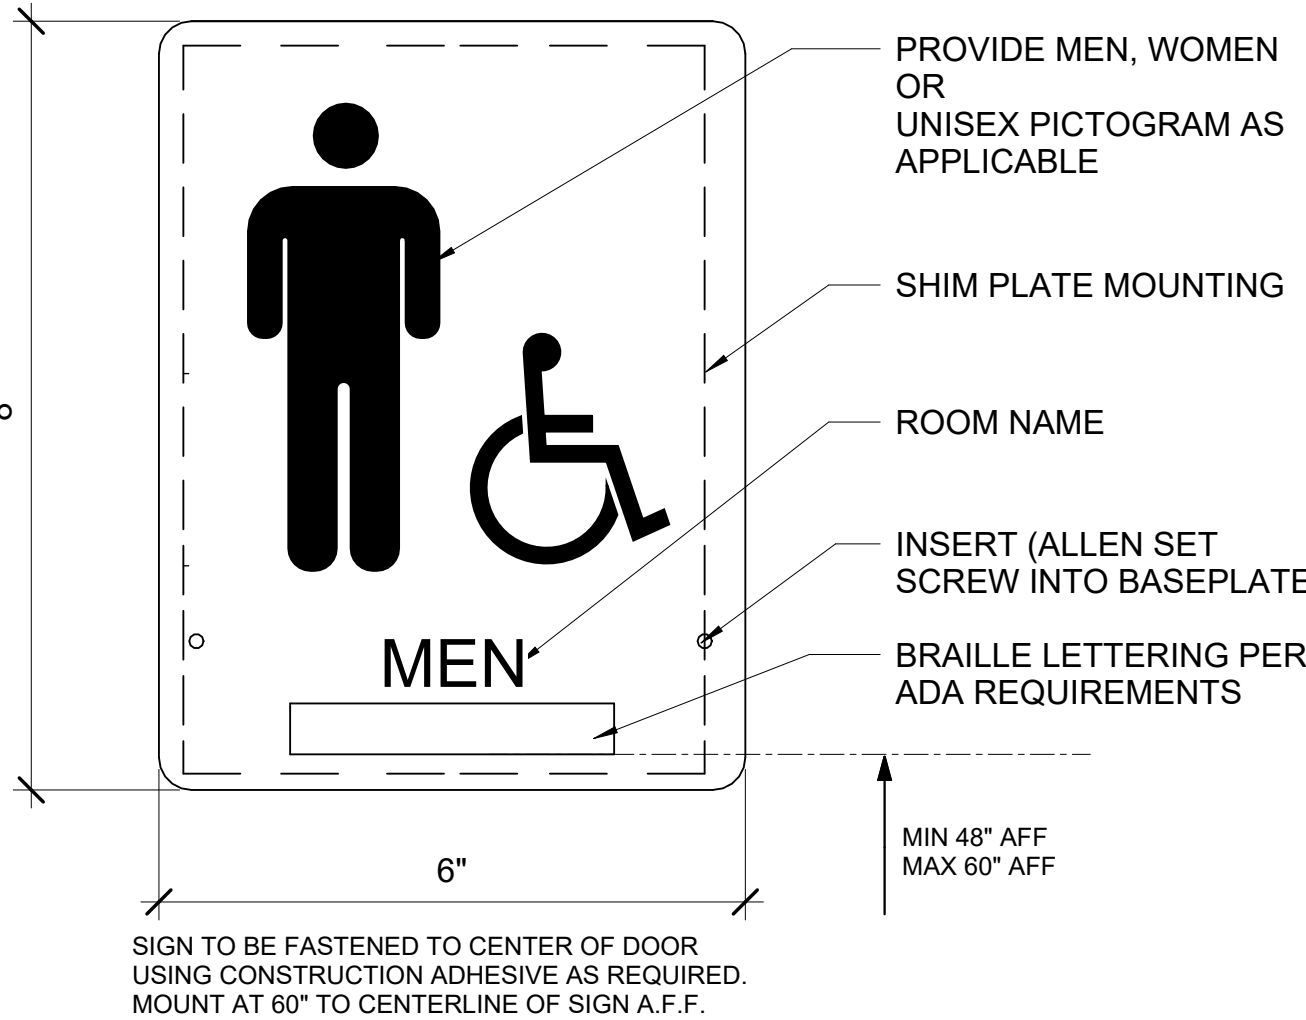


3 RESTROOM DOOR SIGNAGE
6" = 1'-0"

SIGN SCHEDULE			
NUMBER	SIGN TYPE	TEXT ON SIGN FACE	SIGN NOTES
100A	5	100 STORAGE	(3) LOCATIONS
100B	8	EXIT	
100C	8	EXIT	
100D	8	EXIT	
101A	8	EXIT	
101B	5	101 STORAGE	(3) LOCATIONS
101D	8	EXIT	
102	5	102 OFFICE	
103	5	103 WORKSPACE	
104	5	106 BREAK ROOM	
105	5	105 IDF	
106	5	106 JANITOR'S CLOSET	
107	3	UNISEX (GRAPHICS UNISEX + HDCP)	ACCESSIBLE
108	3	UNISEX (GRAPHICS UNISEX + HDCP)	ACCESSIBLE
109	5	109 CREW ROOM	
110	5	110 HUDDLE	
111	5	111 ELEC	
112	5	112 FIRE RISER	


NOTE: FINAL ROOM NUMBERING TO BE COORDINATED WITH AND APPROVED BY FPL AND THE ARCHITECT

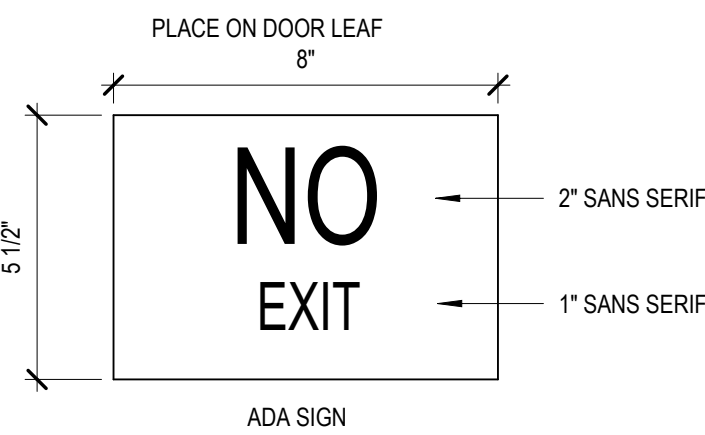


4 NO EXIT
3" = 1'-0"

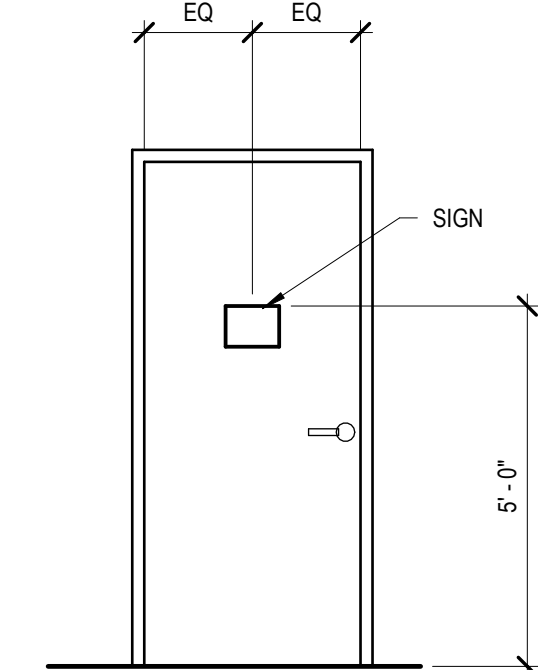

9 SIGN ON DOOR
3/8" = 1'-0"

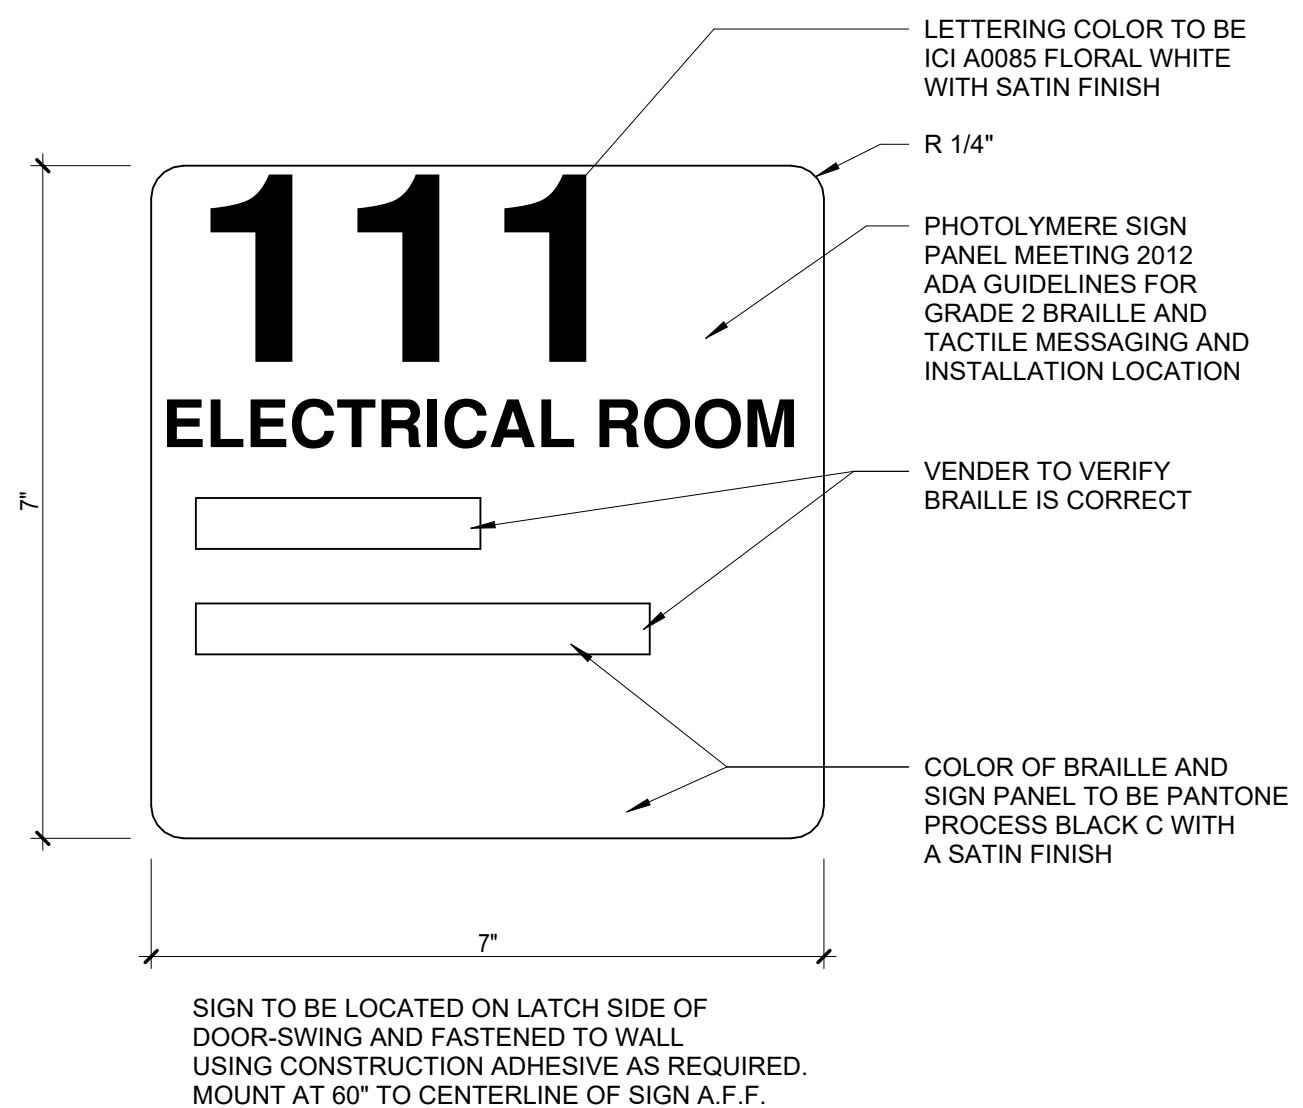


5 TYP. SIGNAGE TYPE
6" = 1'-0"

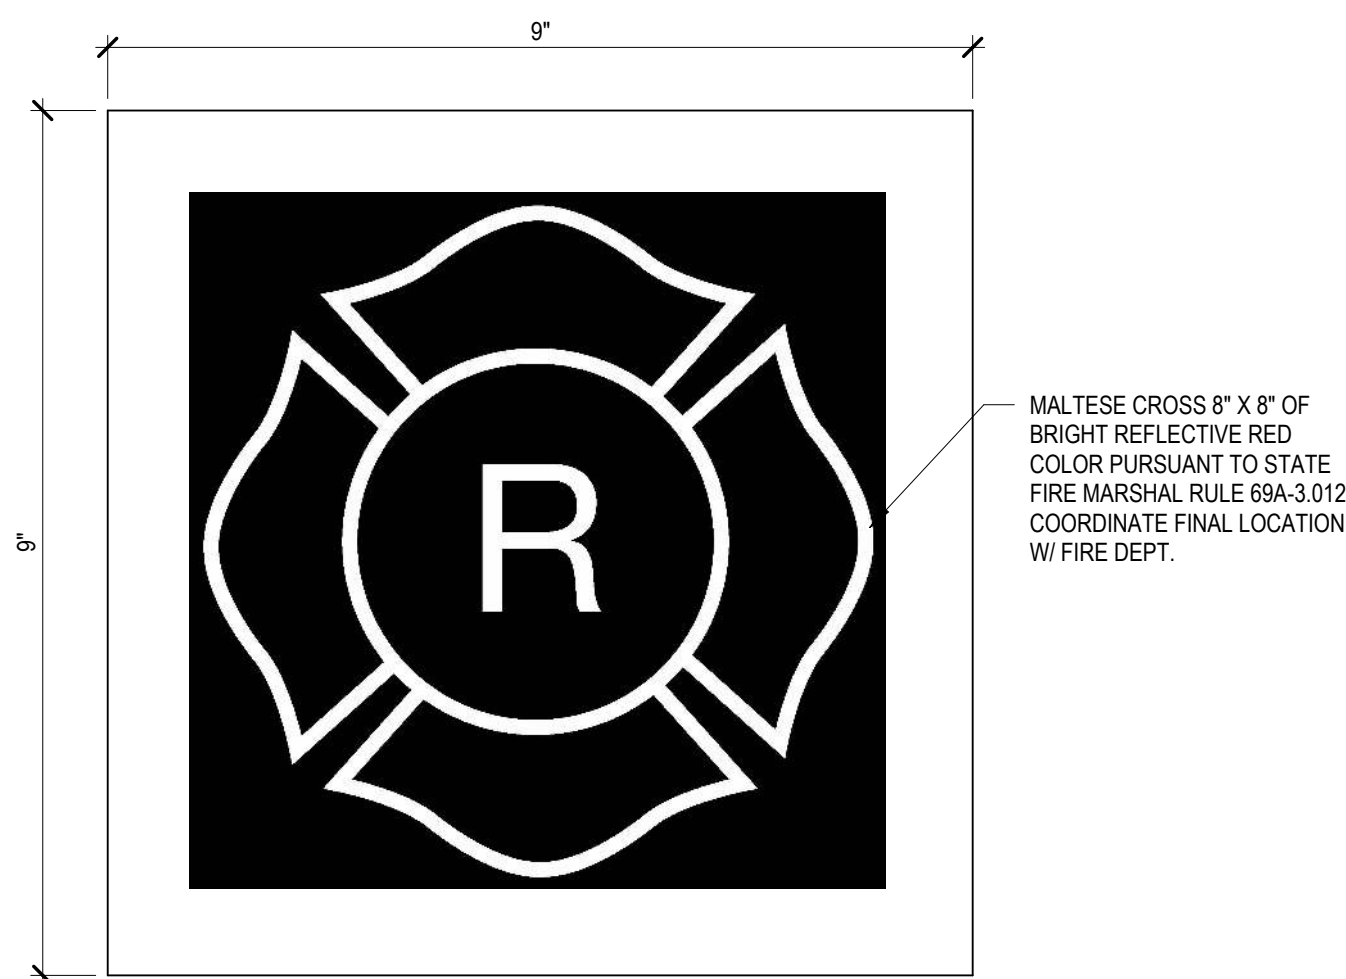


10 LIGHT FRAME ROOF SIGNAGE
6" = 1'-0"

1 ARROW FIRE EXTINGUISHER
3" = 1'-0"

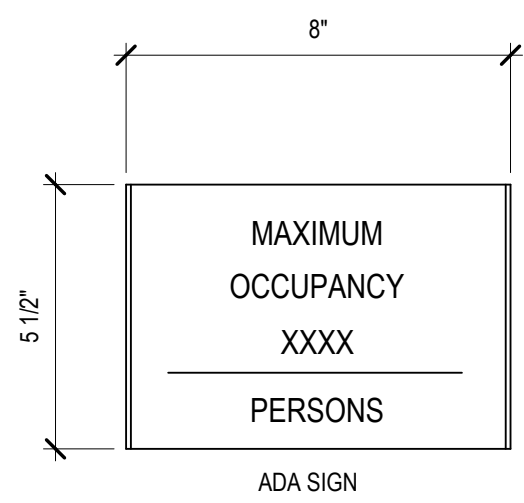


6 OCCUPANCY
3" = 1'-0"

2 EXIT ONLY
3" = 1'-0"

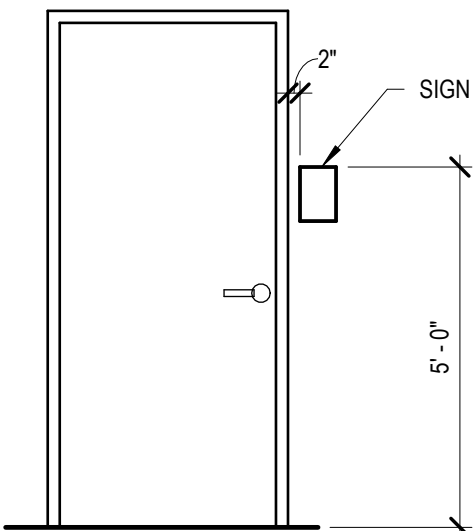


7 SIGN MOUNTING
3/8" = 1'-0"

703.4.1 HEIGHT ABOVE FINISH FLOOR OR GROUND. TACTILE CHARACTERS ON SIGNS SHALL BE LOCATED 48 INCHES (1220 MM) MINIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASELINE OF THE LOWEST TACTILE CHARACTER AND 60 INCHES (1525MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASELINE OF THE HIGHEST TACTILE CHARACTER. (FROM FBC 2003)

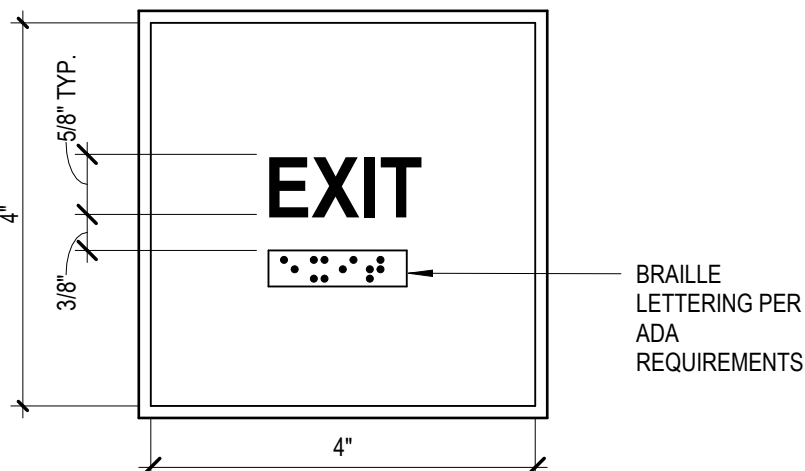

8 SIGN TYPE - EXIT
6" = 1'-0"

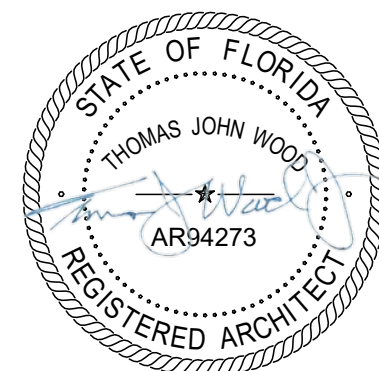

If this item has been electronically signed and sealed by the licensed professional named above using a digital signature and date. Printed copies of this document are not considered signed and sealed, and the signature must be verified on electronic copies.

ARCHENGR OF RECORD
THOMAS J WOOD
AR FL #94273

DESIGNED BY

BRPH

DRAWN BY

LOTHMAN

PROJECT NUMBER

C09414.003

DATE

03/15/2026

TITLE

FINISH SCHEDULE,
SIGNAGE &
MOUNTING

DRAWING NO.

e-A620