




**ONE STORY WALL SECTION**  
SCALE: 3/4" = 1'-0"

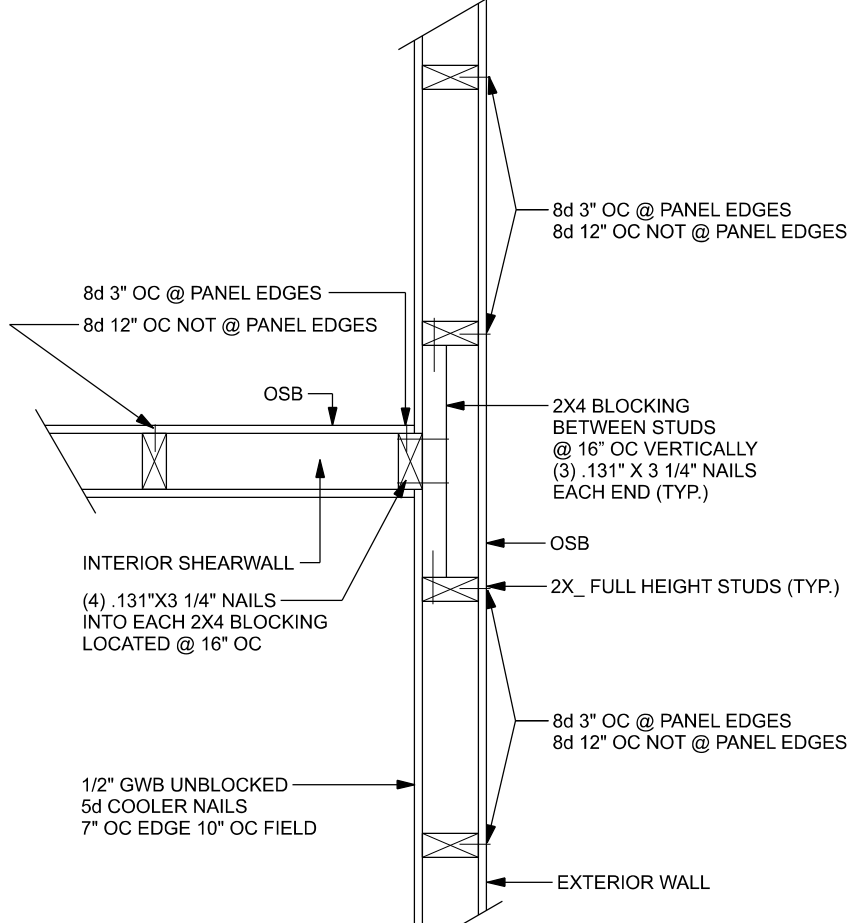


**(TYP.) GABLE BRACING DETAIL**  
WOOD FRAME

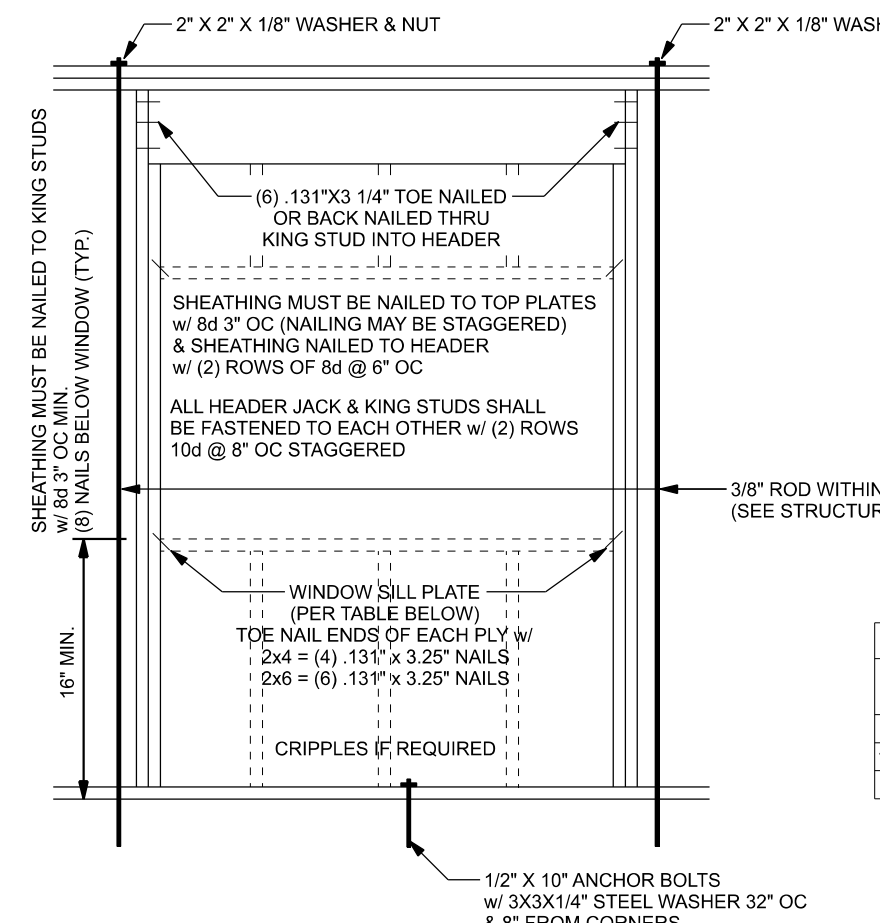


**(TYP.) GABLE WALL w/ VAULTED CEILING**  
WOOD FRAME

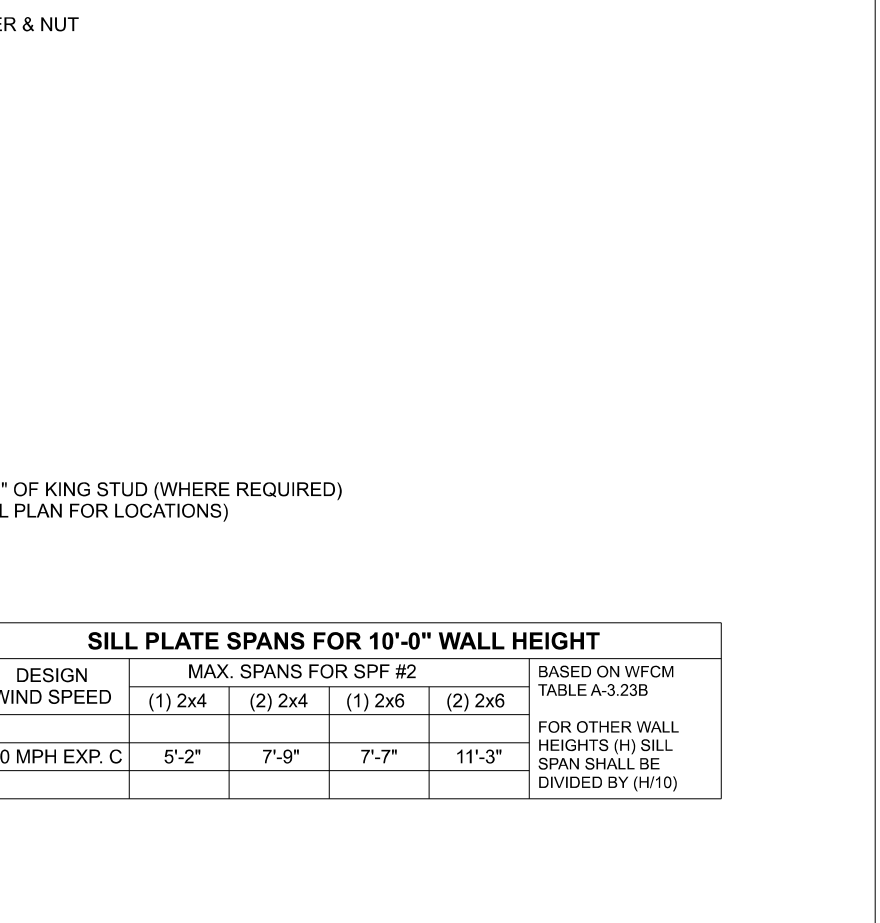


**(TYP.) PORCH POST**  
ONE STORY WOOD

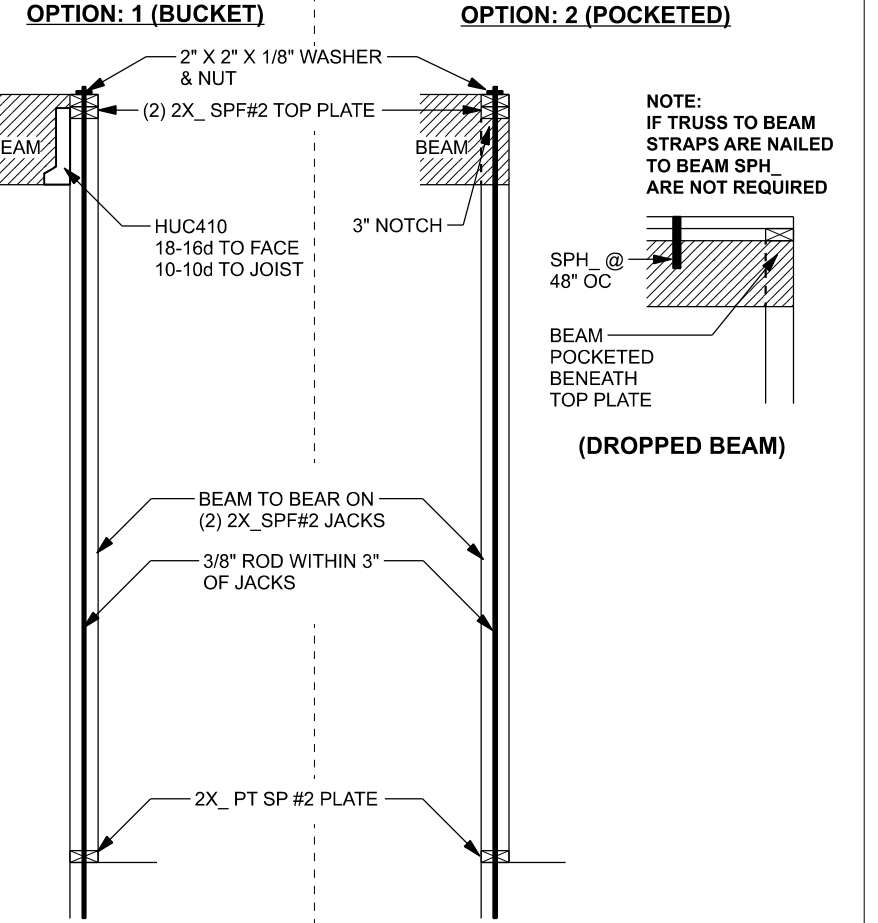

**(TYP.) BEAM TO WALL**  
WOOD FRAME w/ RODS




**(TYP.) INTERIOR BEARING WALL**  
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS




**(TYP.) INTERIOR BEARING WALL w/ SCREW OPTION**  
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS




**(TYP.) INTERSECTING WALL FRAMING**  
WOOD FRAME

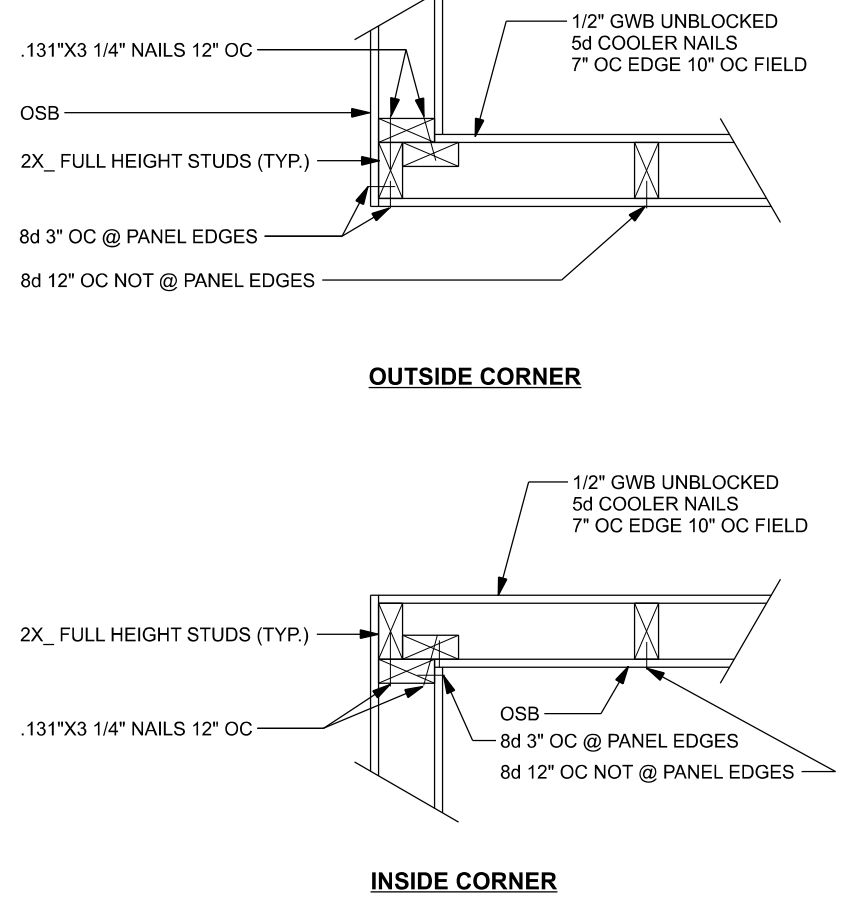


**TYPICAL HEADER STRAPPING DETAIL**  
ONE STORY WOOD FRAME

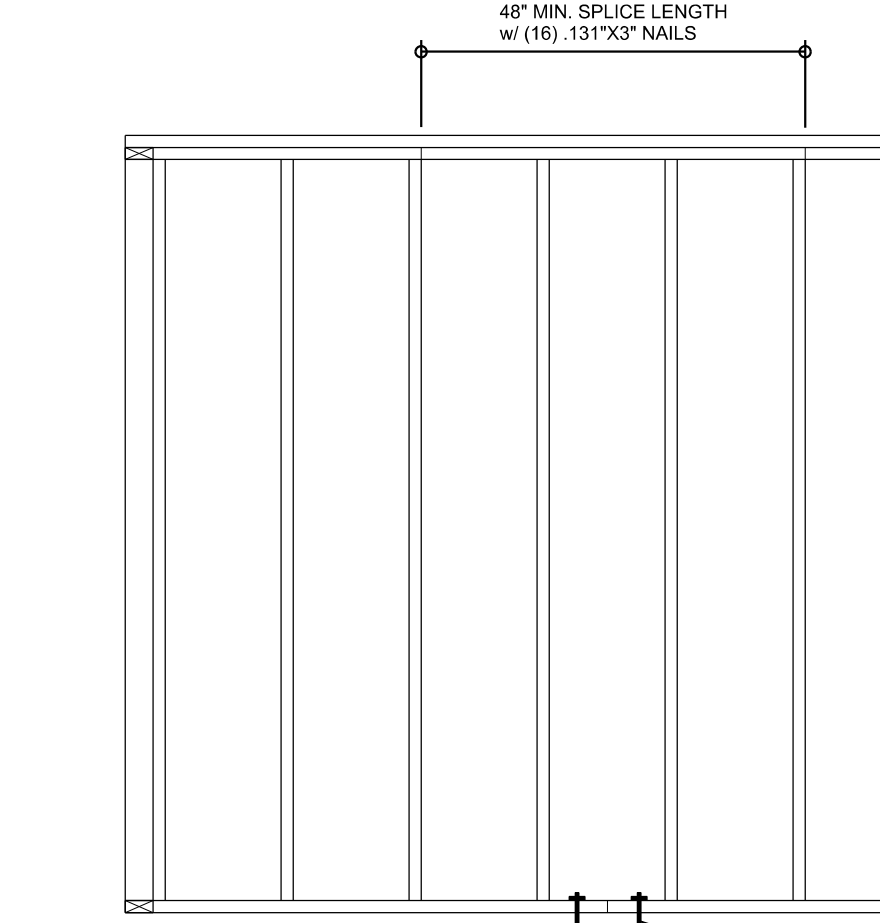


**(TYP.) CORNER FRAMING**  
WOOD FRAME

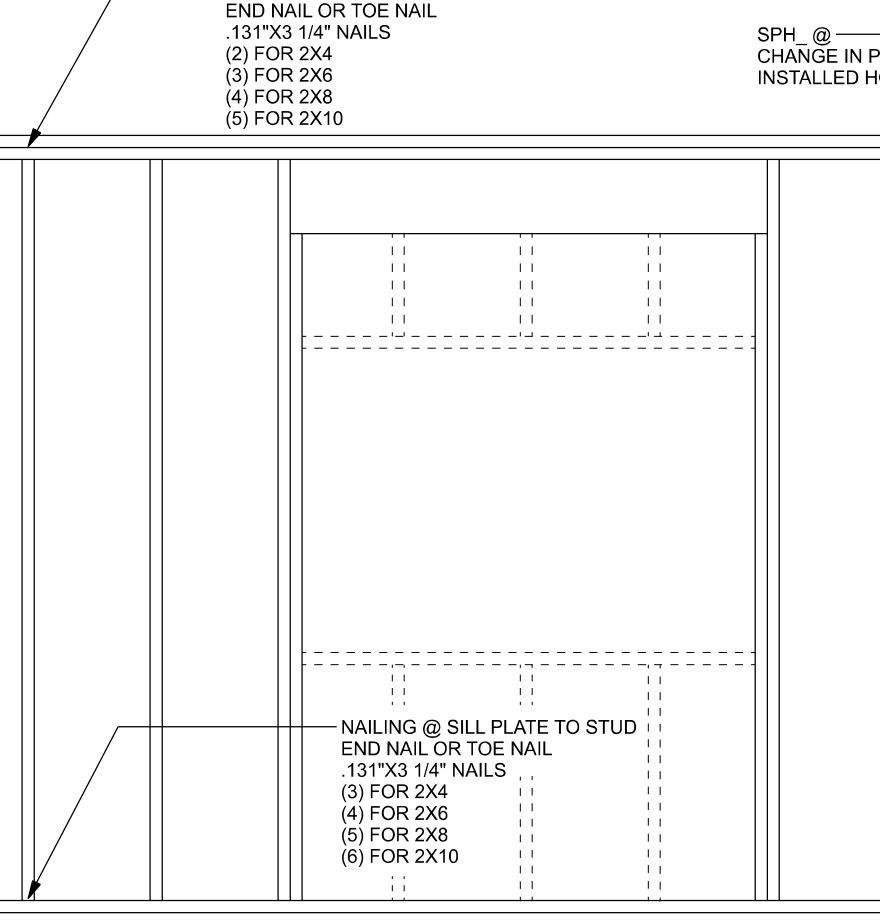


**(TYP.) WALL CONNECTIONS**  
ONE STORY WOOD FRAME

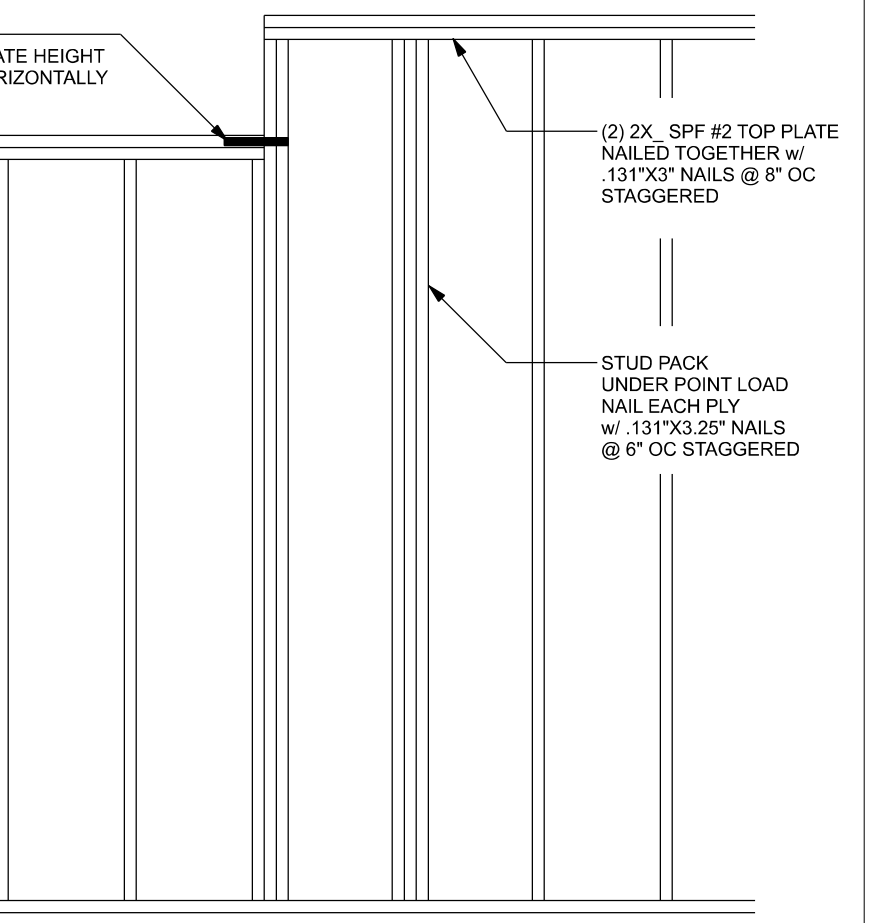

**(TYP.) GARAGE DOOR BUCK ATTACHMENT**  
WOOD FRAME



**(TYP.) GARAGE DOOR BUCK INSTALLATION**  
WOOD FRAME

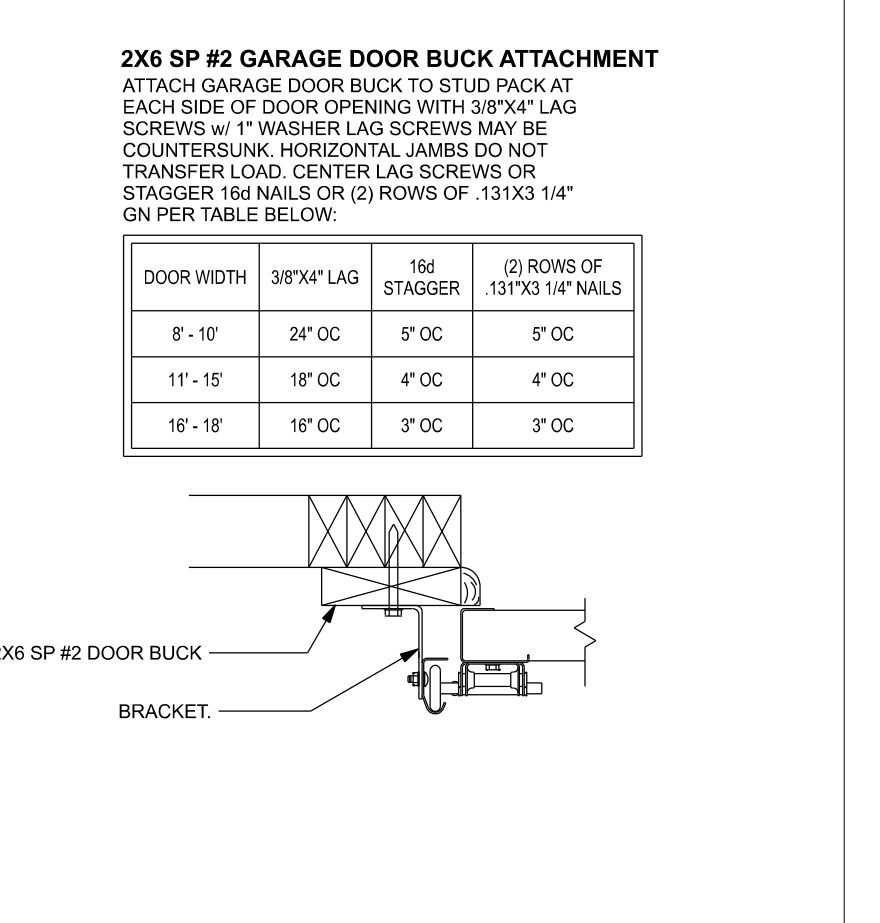

**CONNECTOR TABLE**

Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
605	505	SDWC15600		
400	290	H3	4-131'X1 1/4"	4-131'X1 1/2"
625	540	H2 SA	5-131'X1 1/2"	5-131'X1 1/2"
1040	1015	H10A	9-148'X1 1/2"	9-148'X1 1/2"
645	515	LTS12-20	6-148'X1 1/2"	6-148'X1 1/2"
990	850	MTS12-30	7-148'X1 1/2"	7-148'X1 1/2"
1415	1215	HTS16-30	8-148'X1 1/2"	8-148'X1 1/2"
Uplift SP	Uplift SPF	Strap Ties	To One Member	To Other Member
1235	1235	LSTA21	8-148'X1 1/2"	8-148'X1 1/2"
1840	1460	MSTA24	9-148'X1 1/2"	9-148'X1 1/2"
1030	1030	CS20	7-148'X1 1/2"	7-148'X1 1/2"
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate
555	535	SP1	4-148'X3"	4-148'X3"
1010	605	SP2	6-148'X3"	6-148'X3"
1280	1100	SPH46	12-148'X1 1/2"	wrap under or over plate
771	771	LSTA24	10-148'X1 1/2"	wrap under or over plate
1235	1235	LSTA24	14-148'X1 1/2"	wrap under or over plate
Uplift SP	Uplift SPF	Holdowns @ Stenwall	To Stud / Post	Anchor
2145	1835	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	3640	HTT4	18-162'X2 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor
2145	1835	DTT22	8-SDS 1/4"x1 1/2"	1/2"x6" Titen HD
4235	3640	HTT4	18-162'X2 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Post Bases @ Stenwall	To Post	Anchor
1900	1900	ABU44Z	12-162'X3 1/2"	5/8"x12" Drill & Epoxy
2475	1900	ABU66Z	12-162'X3 1/2"	5/8"x12" Drill & Epoxy
Uplift SP	Uplift SPF	Post Bases @ Mono	To Post	Anchor
1900	1900	ABU44Z	12-162'X3 1/2"	5/8"x7" Drill & Epoxy
2475	1900	ABU66Z	12-162'X3 1/2"	5/8"x7" Drill & Epoxy

**GENERAL NOTES:**

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER'S FULLY SATISFIED ALL REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTION LOADS ON BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END. 2X6 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN. FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F<sub>c</sub> = 2500 PSI. WELDED WIRE REINFORCED SLAB 6" x 6" w/ 4" x 1/4" FB = 60KSI. WELDED WIRE REINFORCEMENT FABRIC (W.W.F.) CONFORMING TO ASTM A185. LOCATED IN MIDDLE OF THE SLAB. SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH 12 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1119. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH/WIDTH RATIOS OF SLAB JOINTS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CONTROL JOINTS SHALL BE 12 FT. DO NOT CUT W/WM OR REINFORCING STEEL (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A615, GRADE 40, DEFORMED BARS, F<sub>y</sub> = 40 KSI. ALL LAP SPACES 40" DB (25" FOR #5 BARS). UNO. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 305.2. UNO.

ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS. SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.


STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.


**BUILDER'S RESPONSIBILITY:**  
THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK:  
CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.  
PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FIBER REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.  
PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.  
VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS REACTION PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

**ROOF SYSTEM DESIGN:**  
THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR, IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FIBER REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.


Gibraltar Contracting, LLC  
Moore Residence  
229 SW Legacy Glen Lake City, FL 32025  
FL PE 53915  
This item has been digitally signed and sealed by Mark Disoway P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature will not be verified on any electronic copies.  
3/2/2026  
DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway P.E. for resolution. Do not proceed without clarification.  
COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property rights in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.  
CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2023) to the best of my knowledge.  
LIMITATION: This design is valid for one building, at specified location.  
Mark Disoway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.754.5419  
disowaydesign@gmail.com  
JOB NUMBER:  
260042  
S-1  
OF 3 SHEETS

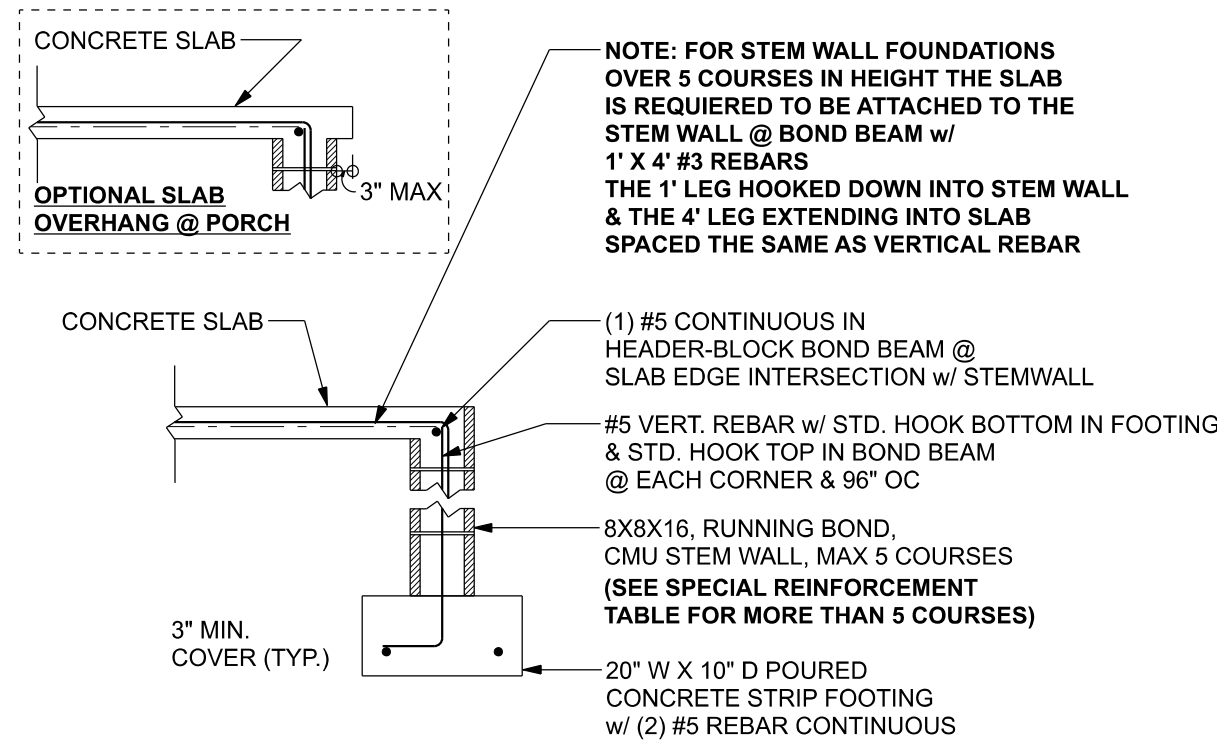


**F1 S-2** STEM WALL FOOTING  
SCALE: 1/2" = 1'-0"

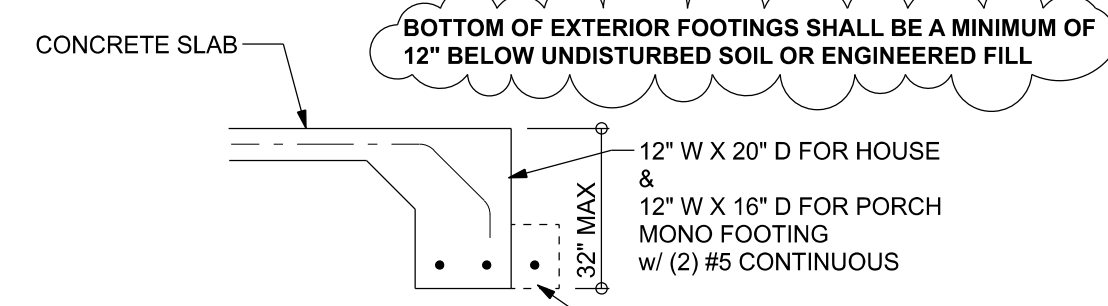


**F1 S-2** OPTIONAL MONOLITHIC FOOTING  
SCALE: 1/2" = 1'-0"

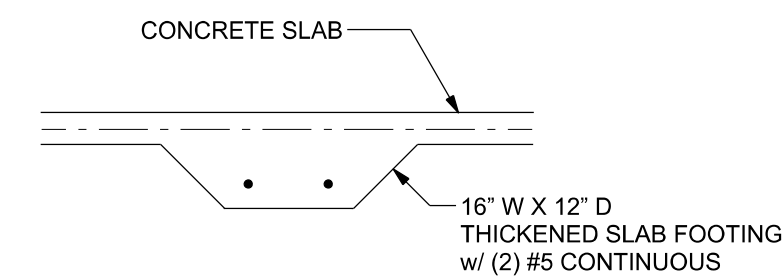


**F2 S-2** INTERIOR BEARING FOOTING  
SCALE: 1/2" = 1'-0"

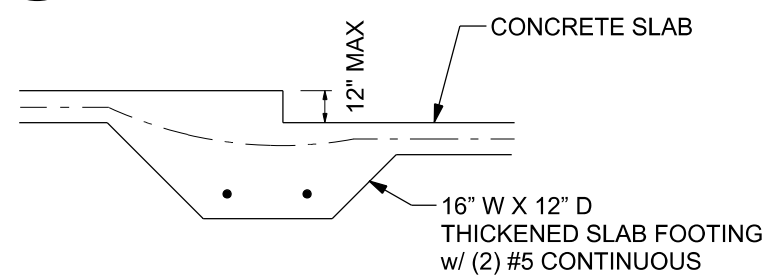


**F3 S-2** INTERIOR BEARING STEP FOOTING  
SCALE: 1/2" = 1'-0"

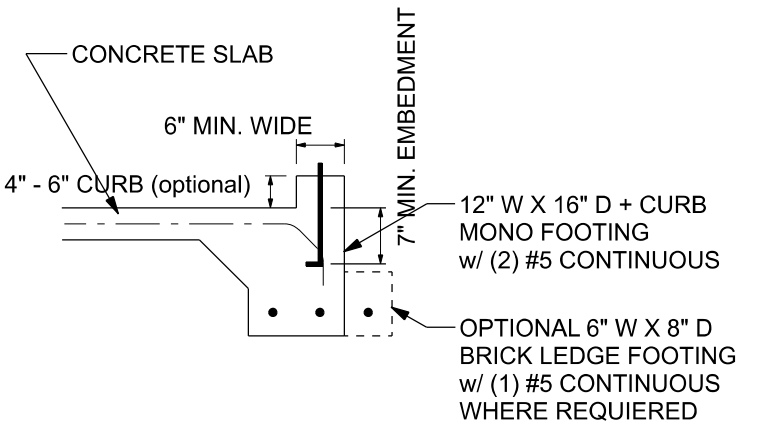

**F4 S-2** OPTIONAL MONOLITHIC CURB FOOTING  
SCALE: 1/2" = 1'-0"

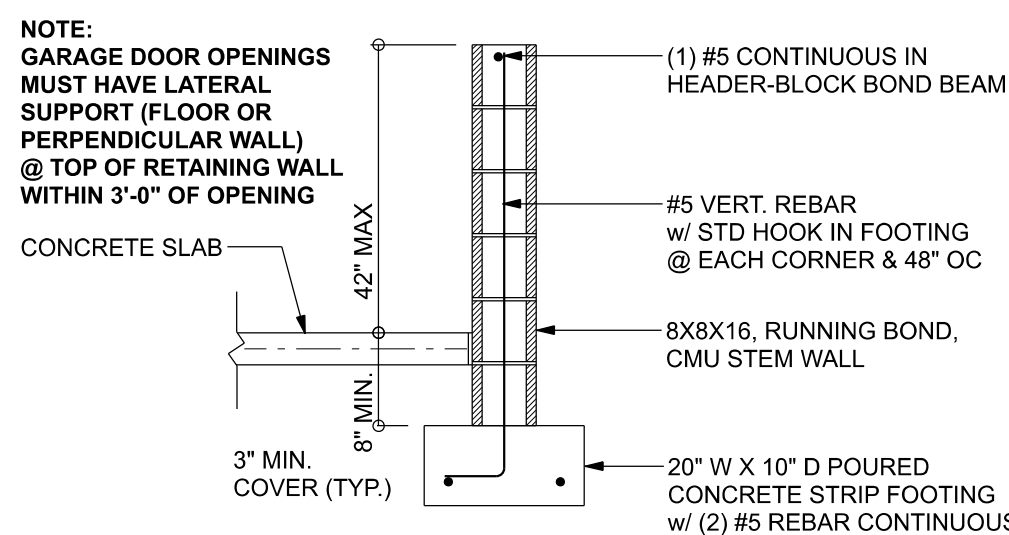

**F4 S-2** STEM WALL CURB FOOTING  
SCALE: 1/2" = 1'-0"

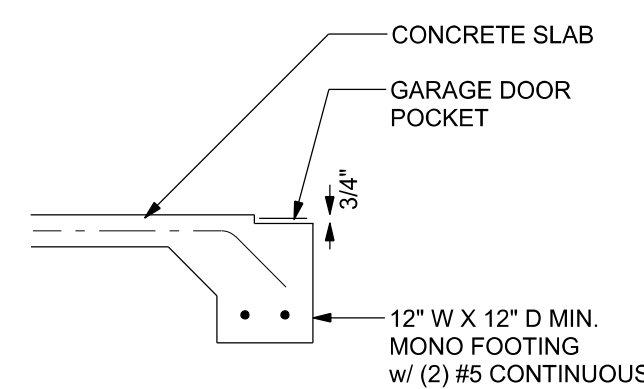

**F5 S-2** GARAGE DOOR POCKET FOOTING  
SCALE: 1/2" = 1'-0"

**TALL STEM WALL TABLE:**  
The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall).

STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96

**THIS FOUNDATION DESIGN IS FOR RELATIVELY FLAT GRADE ONLY. IF FOUNDATION IS ON A STEEP SLOPE THAT EXCEEDS 1' IN 12". CONTACT ENGINEER BEFORE CONSTRUCTION FOR ADDITIONAL ENGINEERING**

**MASONRY NOTE: MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.**


ACI 530.1-02 Section	Specific Requirements
1.4A Compressive strength	8" block bearing walls F <sub>m</sub> = 1500 psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM 615, Grade 40, F <sub>y</sub> = 40 ksi, Lap splices min 48 bar dia. (25" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class 080, 0.60 to 0.72 or 304SS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class 02, 1.50 to 0.72 or 304SS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.

**FOUNDATION PLAN**

SCALE: 1/4" = 1'-0"

**FOUNDATION NOTES**

- DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS. RECESSES IN SLAB, STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
- CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
- THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ #6-1.4/1.4 WELDED WIRE MESH PLACED ON CHAIRS @ 1" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITES-TREATED & COMPACTED FILL.

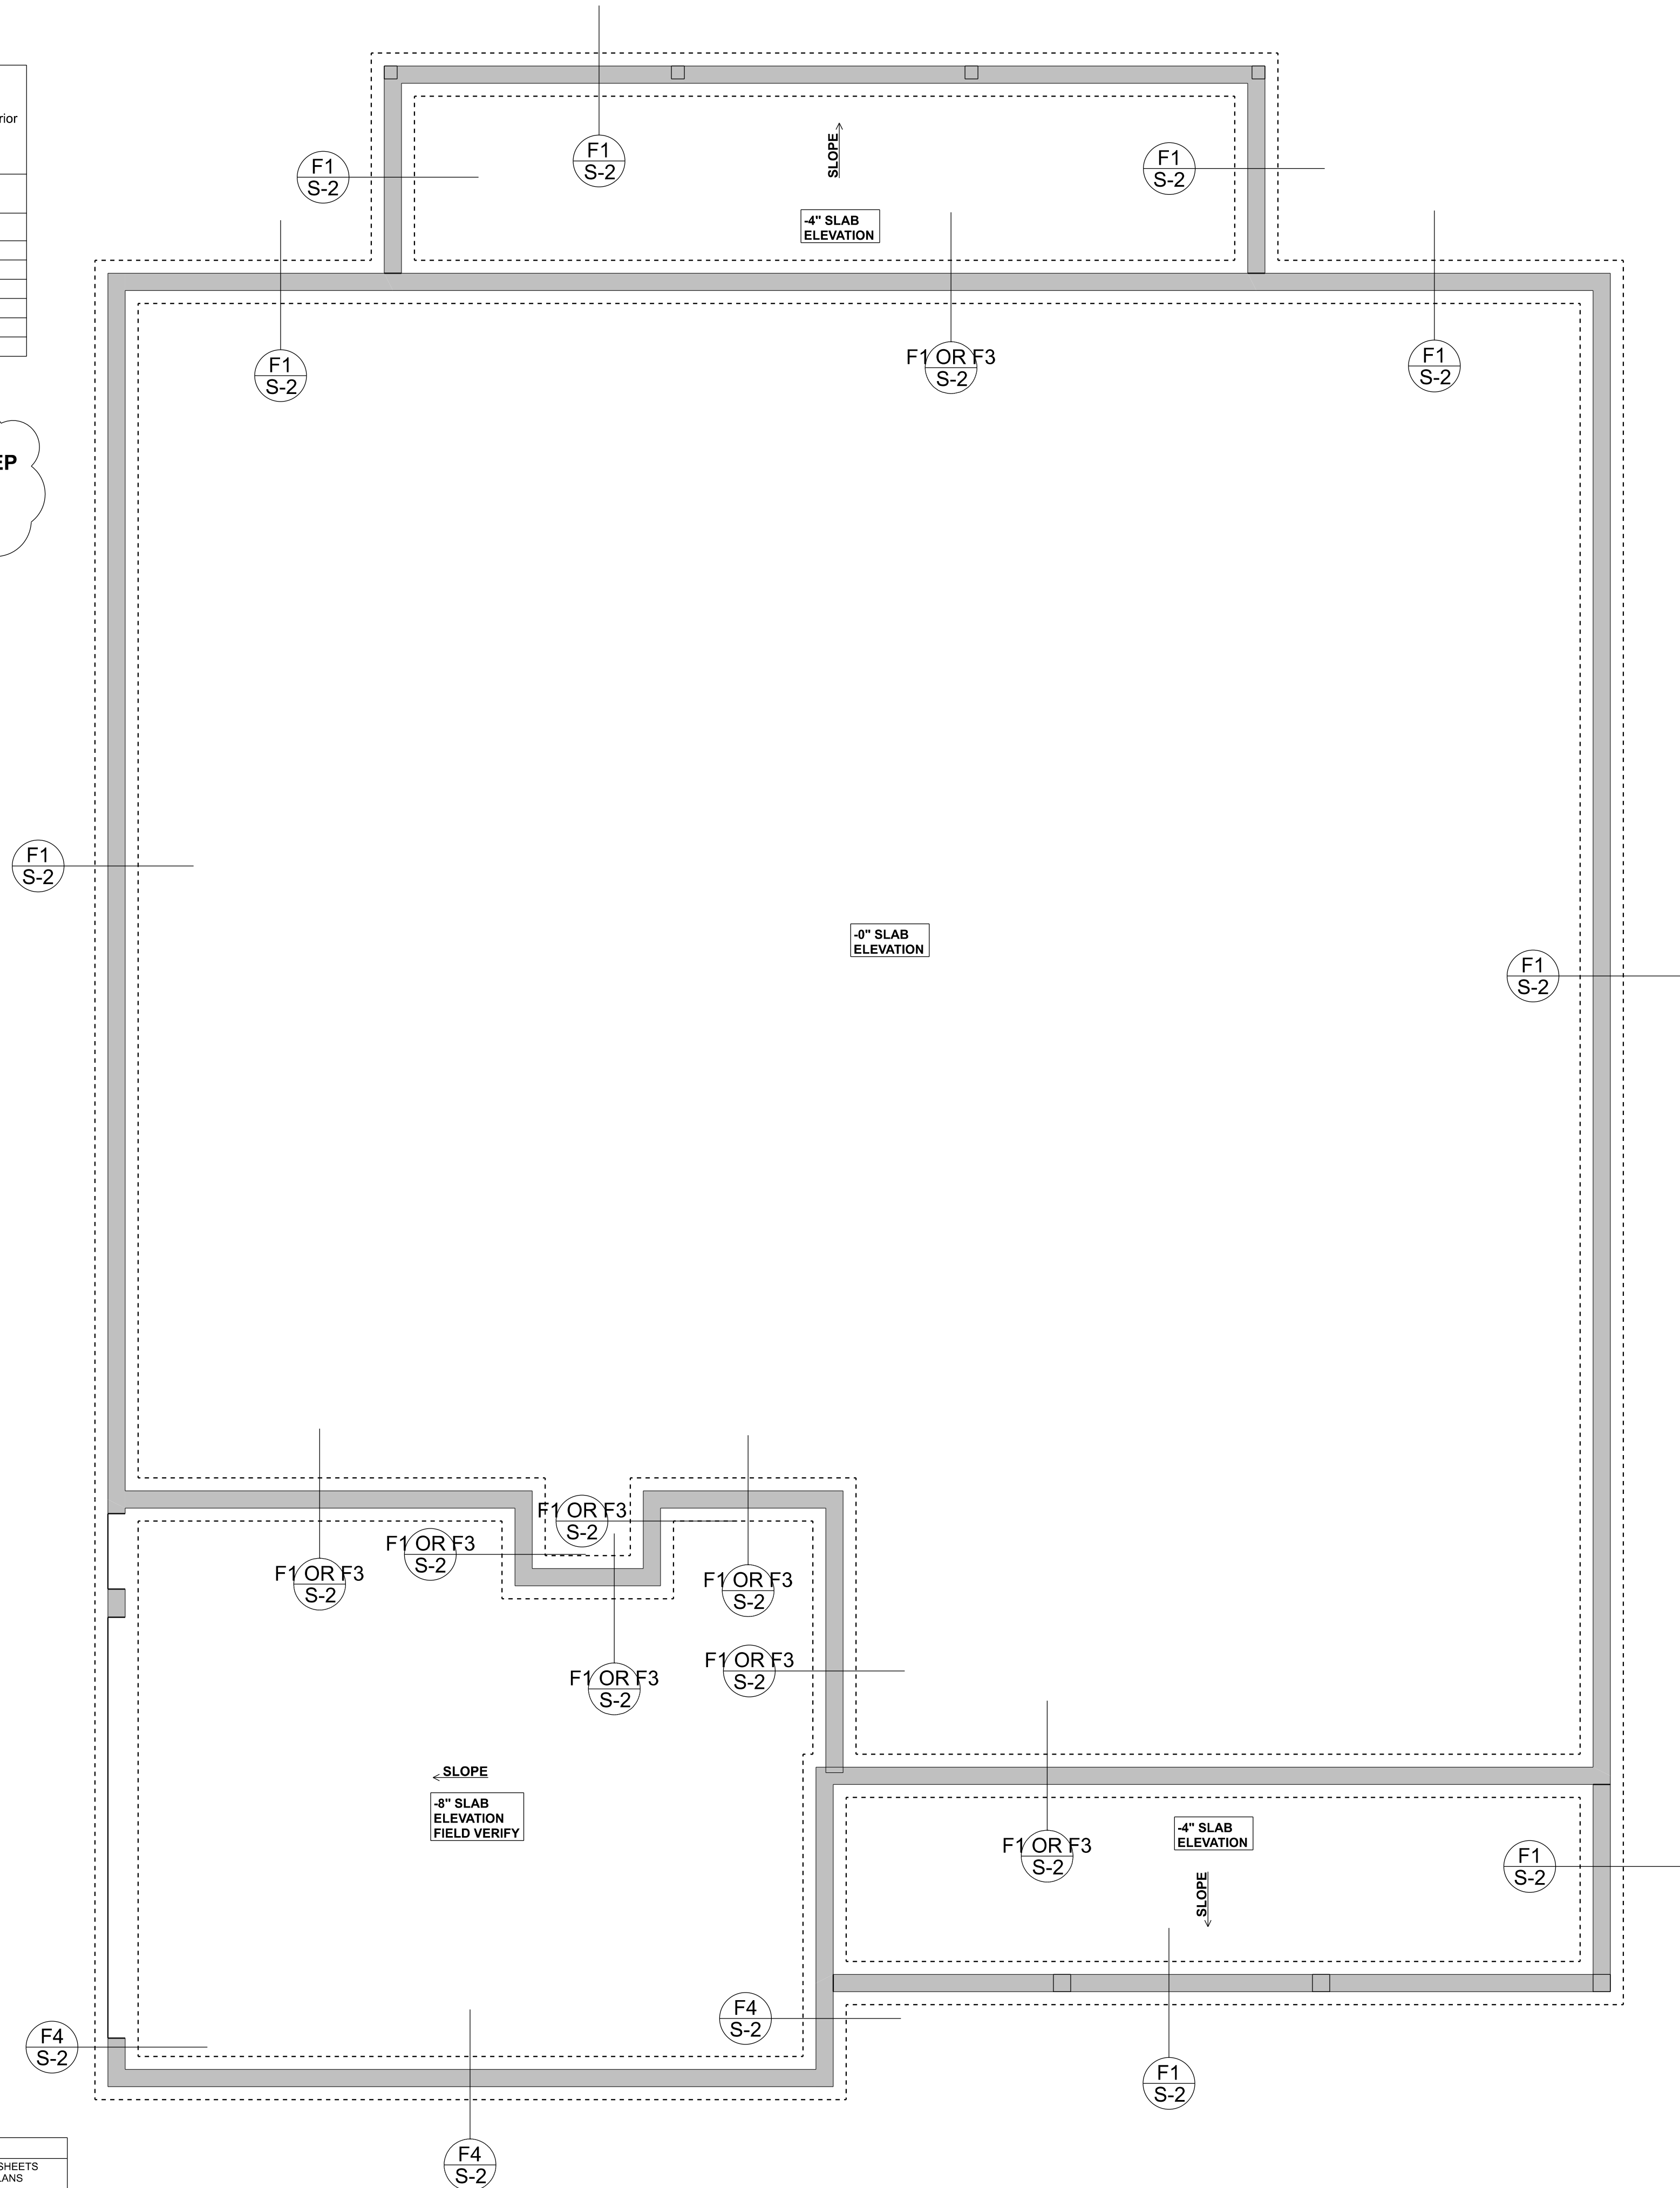

Gibraltar Contracting, LLC

Moore Residence

PROJECT ADDRESS:  
229 SW Legacy Glen Lake City, FL 32025

FL PE 53915  
This item has been digitally signed and sealed by Mark Disosway PE on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

3/2/2026

**DIMENSIONS:** Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

**COPYRIGHTS AND PROPERTY RIGHTS:** Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

**CERTIFICATION:** I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2023) to the best of my knowledge.



**LIMITATION:** This design is valid for one building, at specified location.

**Mark Disosway P.E.**  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.754.5419  
disoswaydesign@gmail.com

**JOB NUMBER:**  
260042

**S-2**  
OF 3 SHEETS

LUMBER SIZE & GRADE MINIMUM REQUIREMENTS	
RIDGE BOARD	2X6 SYP #2
RAFTER SPANS 20'-0" OR LESS	2X4 SYP #2
PURLINS / LATERAL BRACING	2X4 SPF #2
SLEEPERS	2X4 SYP #2 OR 2X4 PARALLEL 2X4 SPF #3
CRIPPLES & BLOCKING	2X4 SPF #2 OR BETTER
TRUSS BELOW	SEE TRUSS DESIGN - SOUTHERN PINE MATERIAL

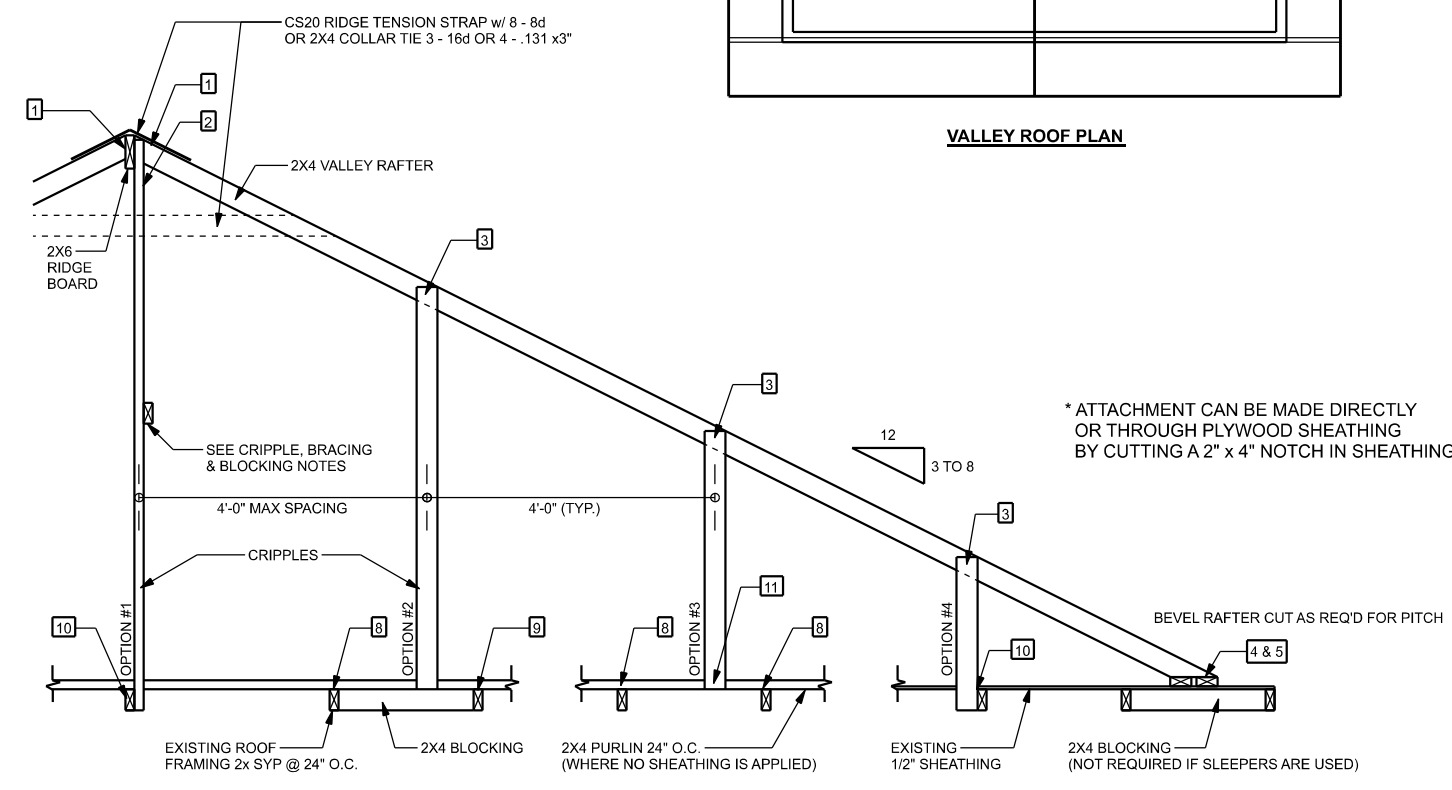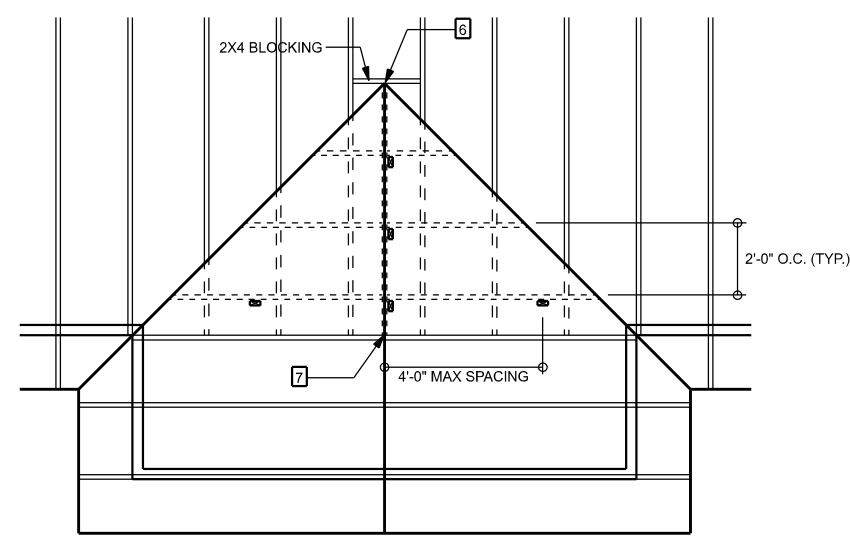

SECTION CUT PARALLEL TO VALLEY RAFTER

VALLEY ROOF PLAN MEMBER LEGEND

- TRUSS
- TRUSS UNDER VALLEY FRAMING
- VALLEY RAFTER OR RIDGE
- CRIPPLE


CRIPPLES 4'-0" O.C. FOR 20' (TL) AND 10' (TD) (TYP. SHINGLE ROOF) MAX

CONNECTION REQUIREMENT NOTES

1. 2X4 RAFTERS TO RIDGE	3-16d OR 6 - 13d x 3" TOE NAILS
2. CRIPPLE TO RIDGE	3-16d OR 6 - 13d x 3" FACE NAILS
3. CRIPPLE TO RAFTERS	3-16d OR 6 - 13d x 3" FACE NAILS
4. RAFTER TO SLEEPER OR BLOCKING	6-16d OR 12 - 13d x 3" TOE NAILS
5. SLEEPER TO TRUSS	4-16d OR 8 - 13d x 3" FACE NAILS EACH TRUSS
6. RIDGE BOARD TO ROOF BLOCK	3-16d OR 6 - 13d x 3" TOE NAILS
7. RIDGE BOARD TO TRUSS	3-16d OR 6 - 13d x 3" TOE NAILS
8. PURLIN TO TRUSS (TYP)	4-16d OR 8 - 13d x 3" NAILS
9. PURLIN TO TRUSS IF CRIPPLES ATTACHED TO PURLIN	4-16d OR 8 - 13d x 3" NAILS
10. TRUSS TO BLOCKING	3-16d OR 6 - 13d x 3" END NAILS
11. CRIPPLE TO TRUSS	3-16d OR 6 - 13d x 3" FACE NAILS
12. CRIPPLE TO PURLIN	3-16d OR 6 - 13d x 3" FACE NAILS

ROOF OVER FRAMING & BRACING DETAIL

SCALE: N.T.S.

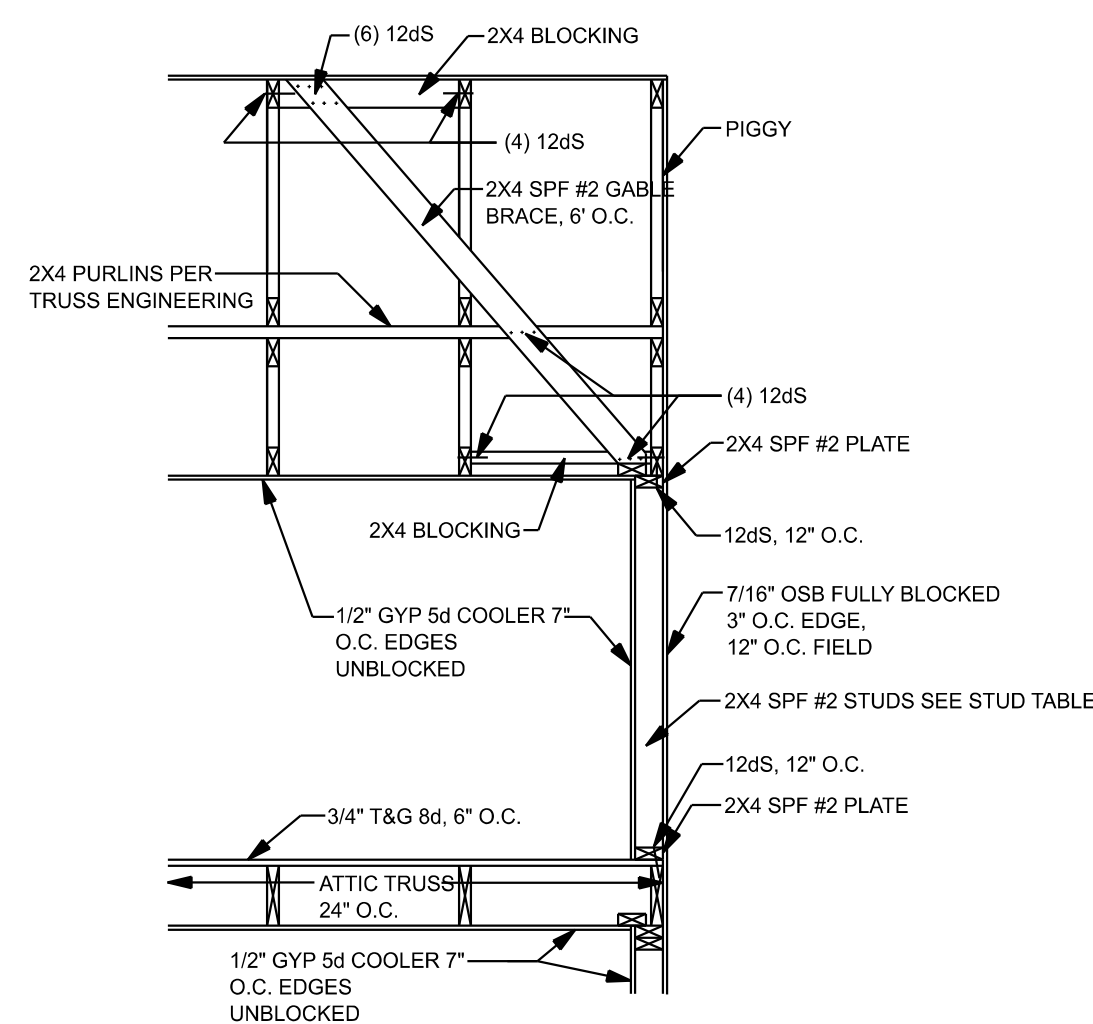

BONUS ROOM / GABLE END BRACING

SCALE: 1/2"=1'-0"

GENERAL NOTES

MAXIMUM RAFTER SPANS

MAXIMUM ROOF ANGLE FOR SUPPORT

16d IN ZONES 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

16d IN ZONE 2 & 3 - 20d IN ZONE 1 (EXAMPLE: 4'-0" O.C. x 4'-0" SPAN)

STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 USE ONE JACK STUD GIRDER SUPPORT PER 2500 LB LOAD
- SN-4 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-5 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCS1-03, BCS1-B1, BCS1-B2, & BCS1-B3. BCS1-B1, BCS1-B2, & BCS1-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND


- (2) 2X6X0', 1J 1K - HEADER/BEAM CALL-OUT (U.N.O.)
- NUMBER OF KING STUDS (FULL LENGTH)
- NUMBER OF JACK STUDS (UNDER HEADER)
- SPAN OF HEADER
- SIZE OF HEADER MATERIAL
- NUMBER OF PLYS IN HEADER

THREADED ROD LEGEND

- INDICATES LOCATION OF: 3/8" A307 ALL THREADED ROD

ACTUAL vs REQUIRED SHEARWALL

	TRANSVERSE	LONGITUDINAL
ACTUAL	24618 LBF	19996 LBF
REQUIRED	23163 LBF	15034 LBF

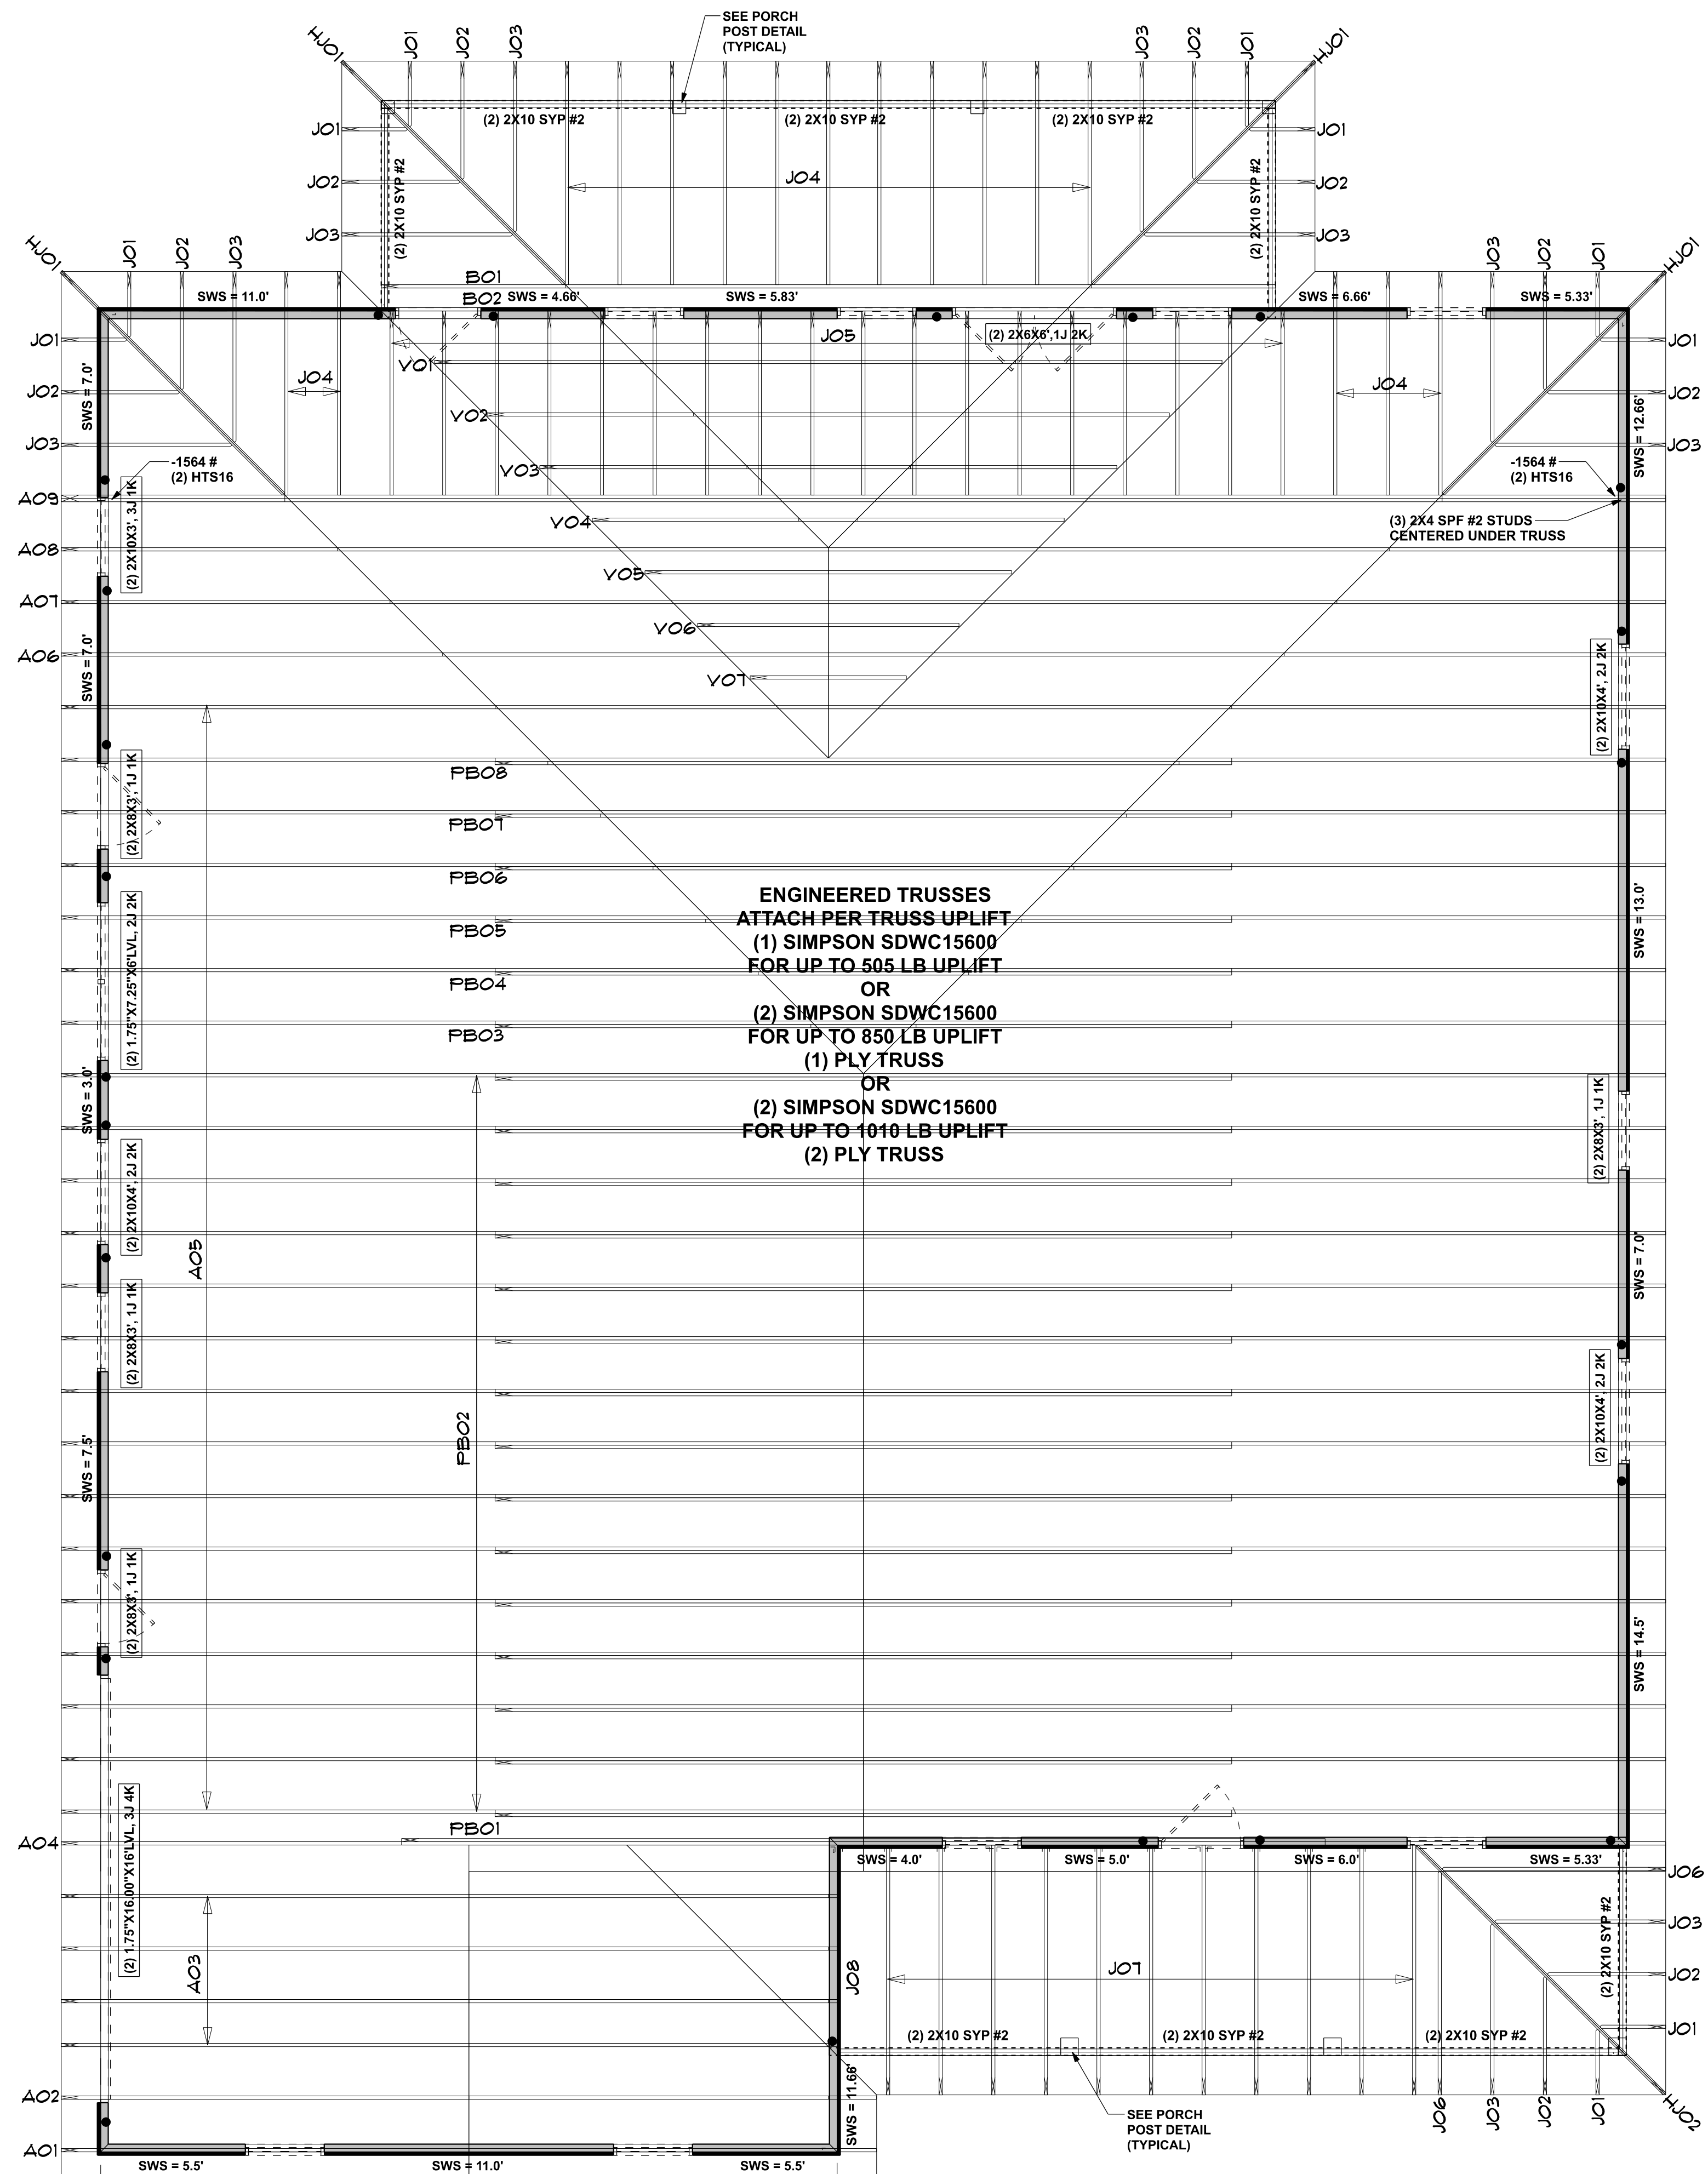

STRUCTURAL PLAN

SCALE: 1/4" = 1'-0"

CONNECTIONS, WALL & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER, W.B. HOWLAND TRUSS CO. JOB #26-3432

Gibraltar Contracting, LLC

Moore Residence

PROJECT ADDRESS: 229 SW Legacy Glen Lake City, FL 32025

FL PE 53915

This item has been digitally signed and sealed by Mark Discoway P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

3/2/2026

DIMENSIONS: State dimensions supersede scaled dimensions. Refer all questions to Mark Discoway P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Discoway P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Discoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2023) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Discoway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.754.5419  
discowaydesign@gmail.com

JOB NUMBER:  
260042

S-3  
OF 3 SHEETS