


PROJECT NUMBER: 03091288S
SIGNATURE & SEAL


REVISIONS:
12/08/05
12/16/05
01/13/06

S&S FOOD STORE **SITE PLAN** **LAKE CITY, FL**

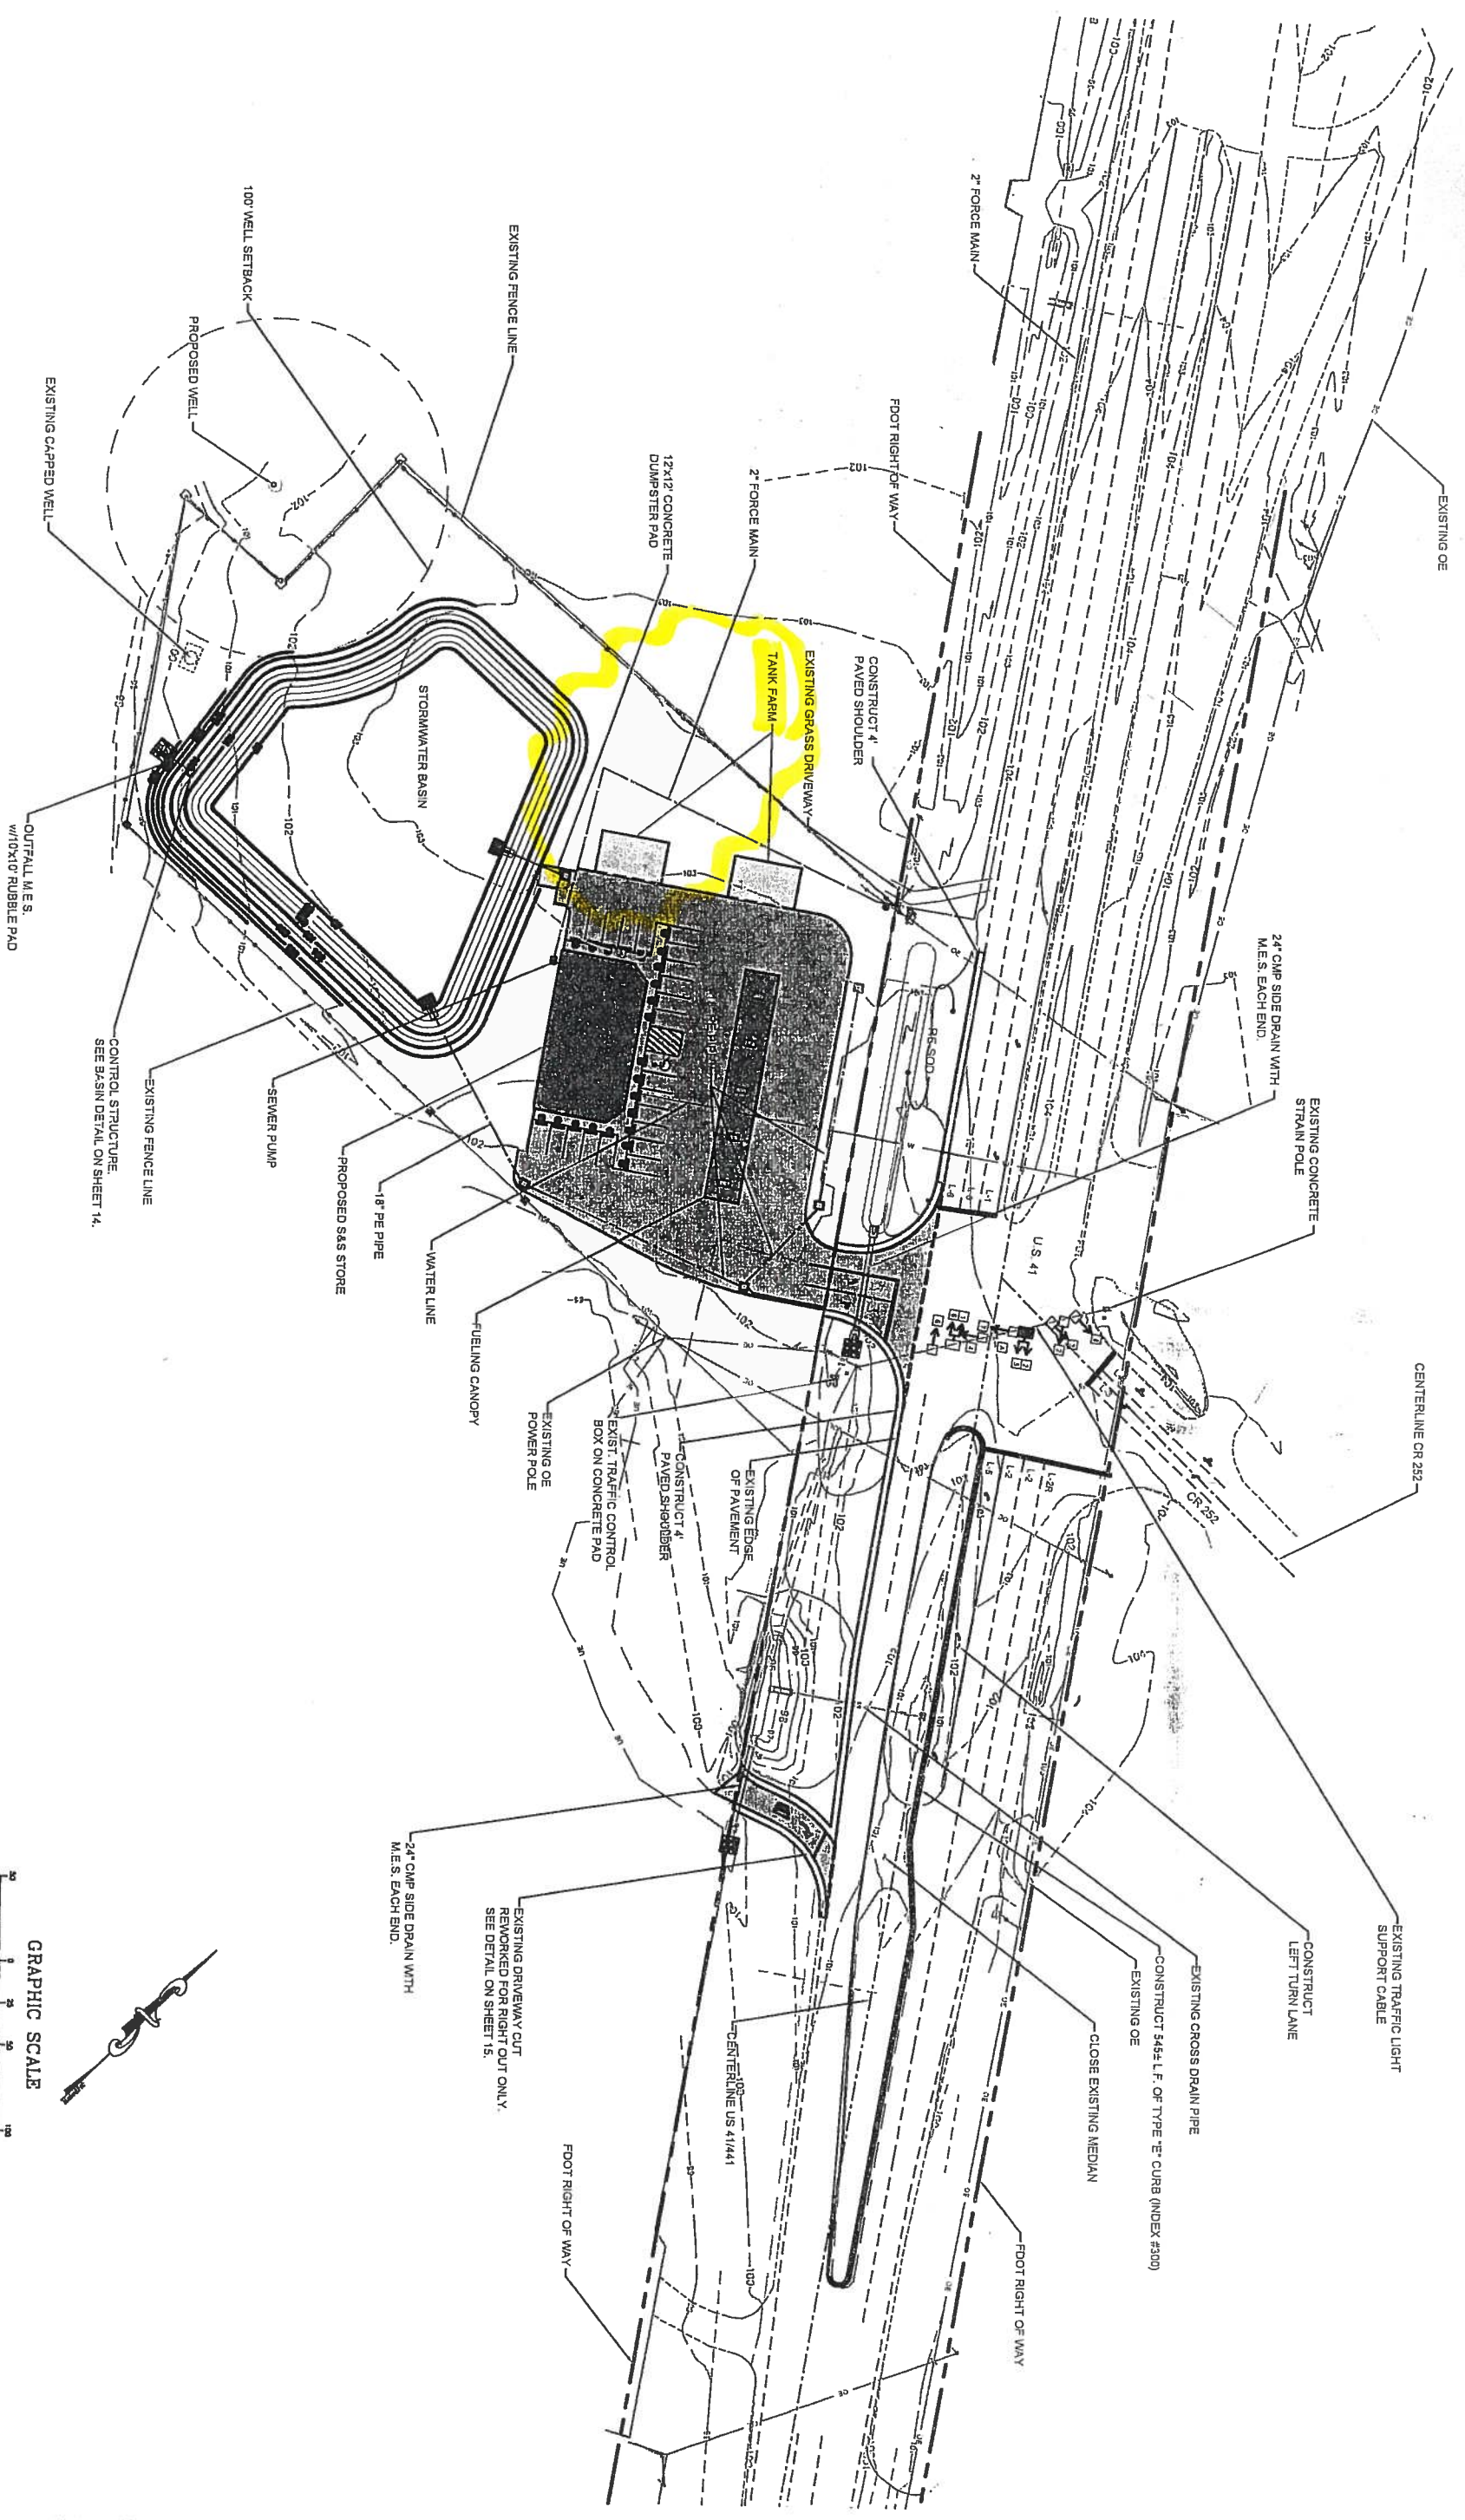

Bailey Bishop & Lane, Inc.
P.O. Box 371
Lake City, FL
Ph. 386-752-
Eng. Lic. 7362

P.O. Box 814
Port St. Joe, FL 32457
Ph. 850-227-9449
Survey Lic. LB-0006685

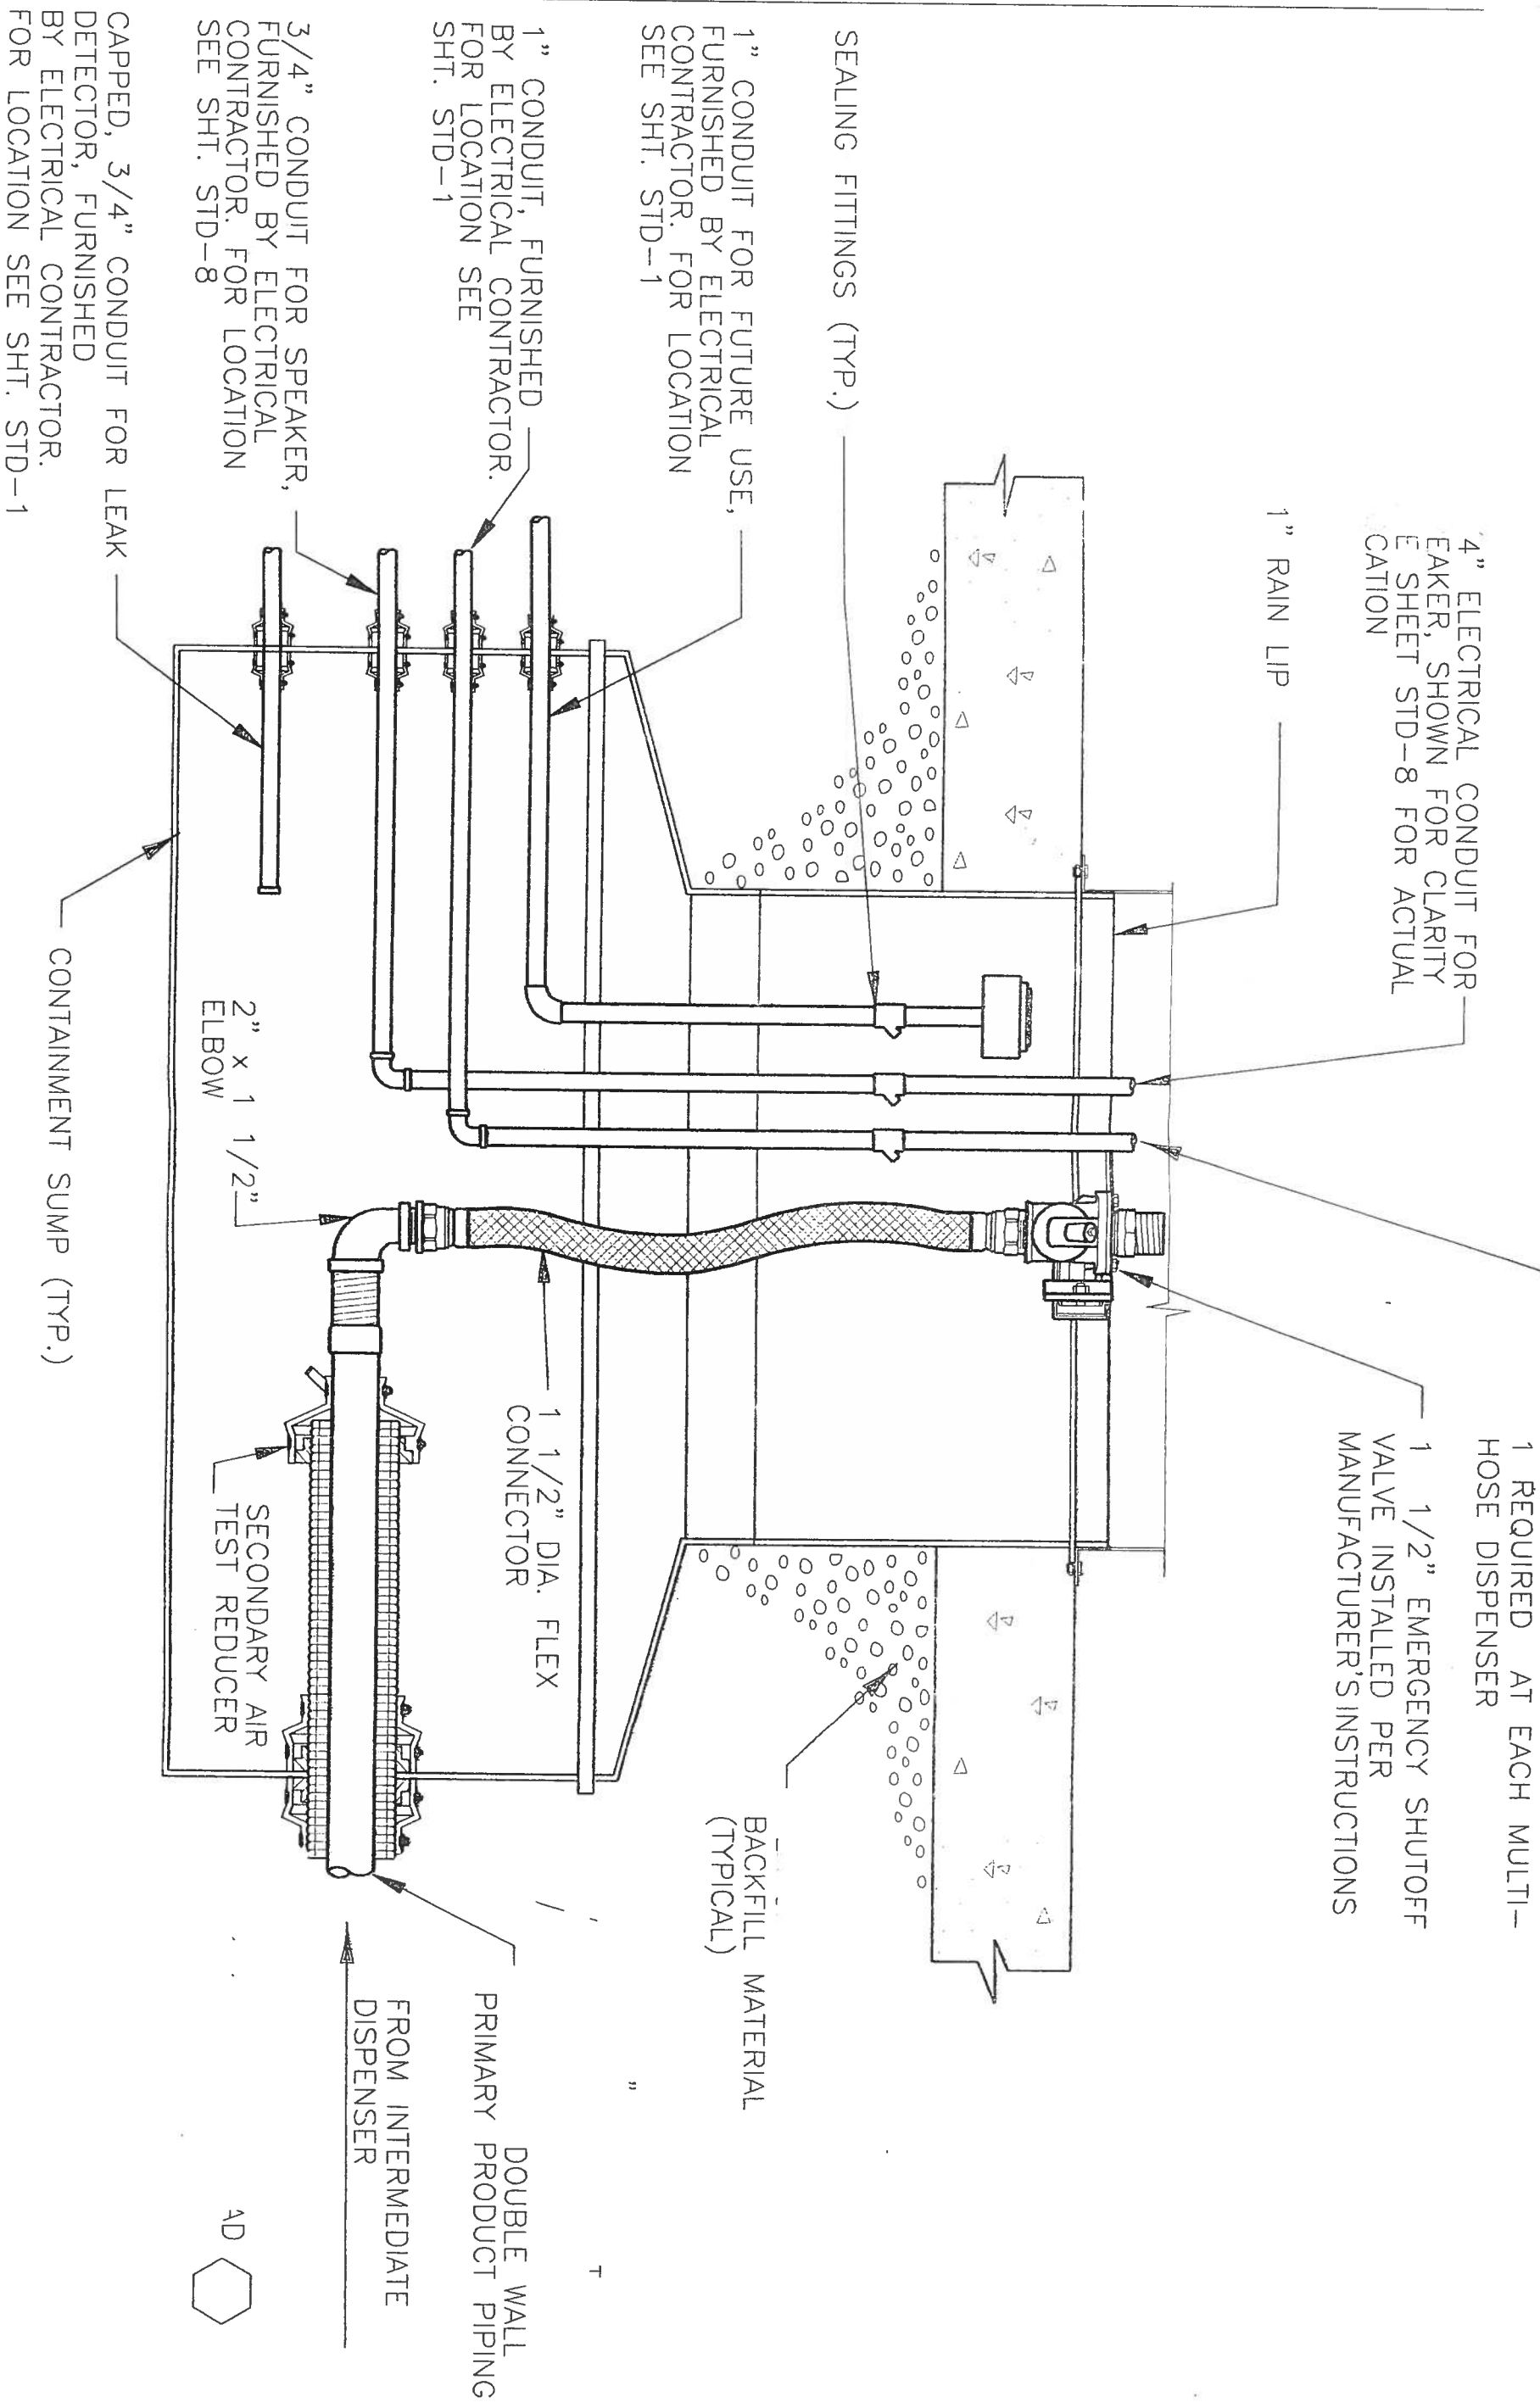

SUMP SECTION AT END GASOLINE DISPENSER

NOT TO SCALE

42 5/16"

42" HANWAY & COVER,
SEE "MATERIAL & EQUIPMENT
SCHEDULE" THIS SHEET

6"
(TYP.)

13/16"

2"

60"

CONTAINMENT SUMP

EXPLOSION PROOF, WEATHER PROOF J-BOX. MIN.
16 CU IN. WITH 3/4" NPT OPENINGS. (AS
REQUIRED) INSTALLED SUCH THAT IT IS EASILY
ACCESSIBLE (TYP.)

SEALING FITTING (TYP.)

3/4" CONDUIT TO ELECTRICAL ROOM

3/4" CONDUIT TO
PROBE

DOUBLE WALL
PRIMARY PRODUCT PIPING

ENTRY
FITTING (TYP.) SEE NOTE 2

TOP OF TANK

SPARE BUNG

FLEX CONNECTOR, SEE
MATERIAL AND EQUIPMENT
SCHEDULE ON THIS SHEET

1 1/2" GALV.
ELL

1 1/2" GALV.
NIPPLE
BALL VALVE

60" CABLE (2 WIRE)
SUPPLIED WITH LEAK
SENSOR

2 HP, VARIABLE SPEED
F.L. PETRO SUB-PUMP &
LEAK DETECTOR

2" Ø PVC LIQUID SENSOR
SLEEVE, SUPPLIED BY G.C.
TO BE HUNG FROM CONDUIT
& SECURED WITH STAINLESS
STEEL STRAPS

3/4" CONDUIT
FROM INTERSTICE


SKIRT API COLOR CODED FRP
OR GALVANIZED

LEAK
SENSOR

2" Ø P.V.C.
SLEEVE


-1" W x 1/2" H
LOTS IN SLEEVE

TYPICAL
SUBMERGED
Pump
sump

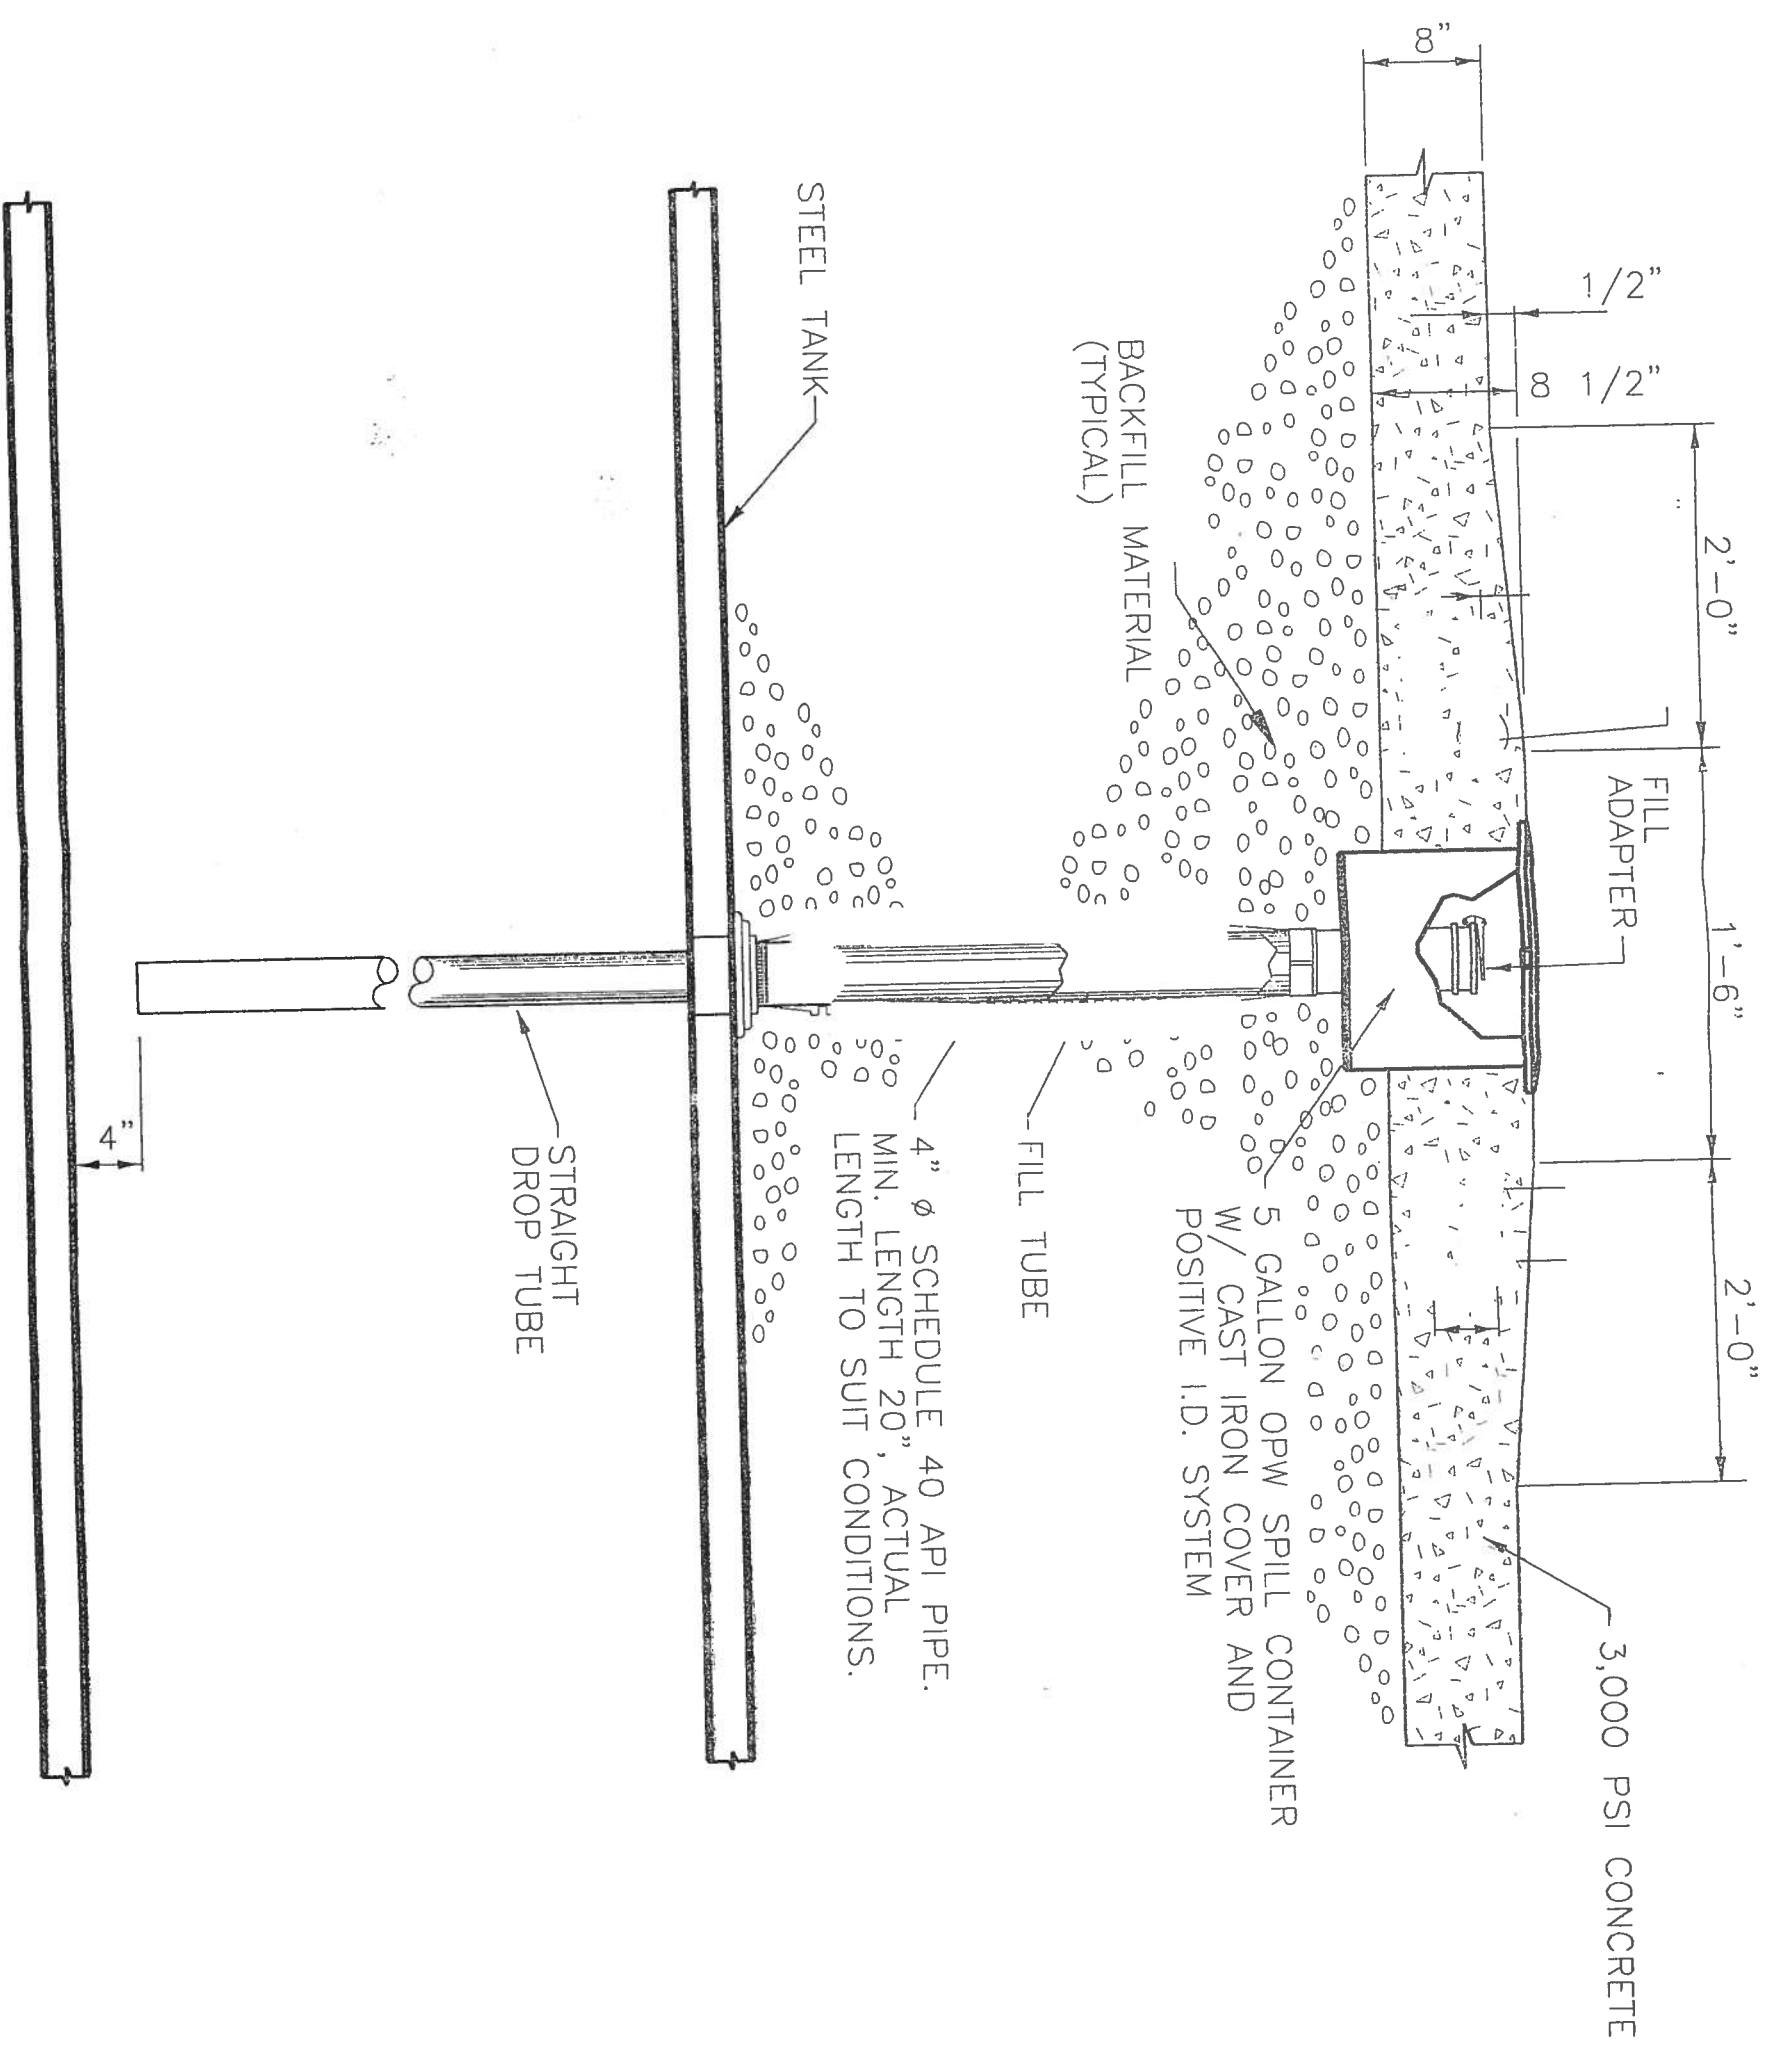

TANK FILL DETAIL

NOT TO SCALE

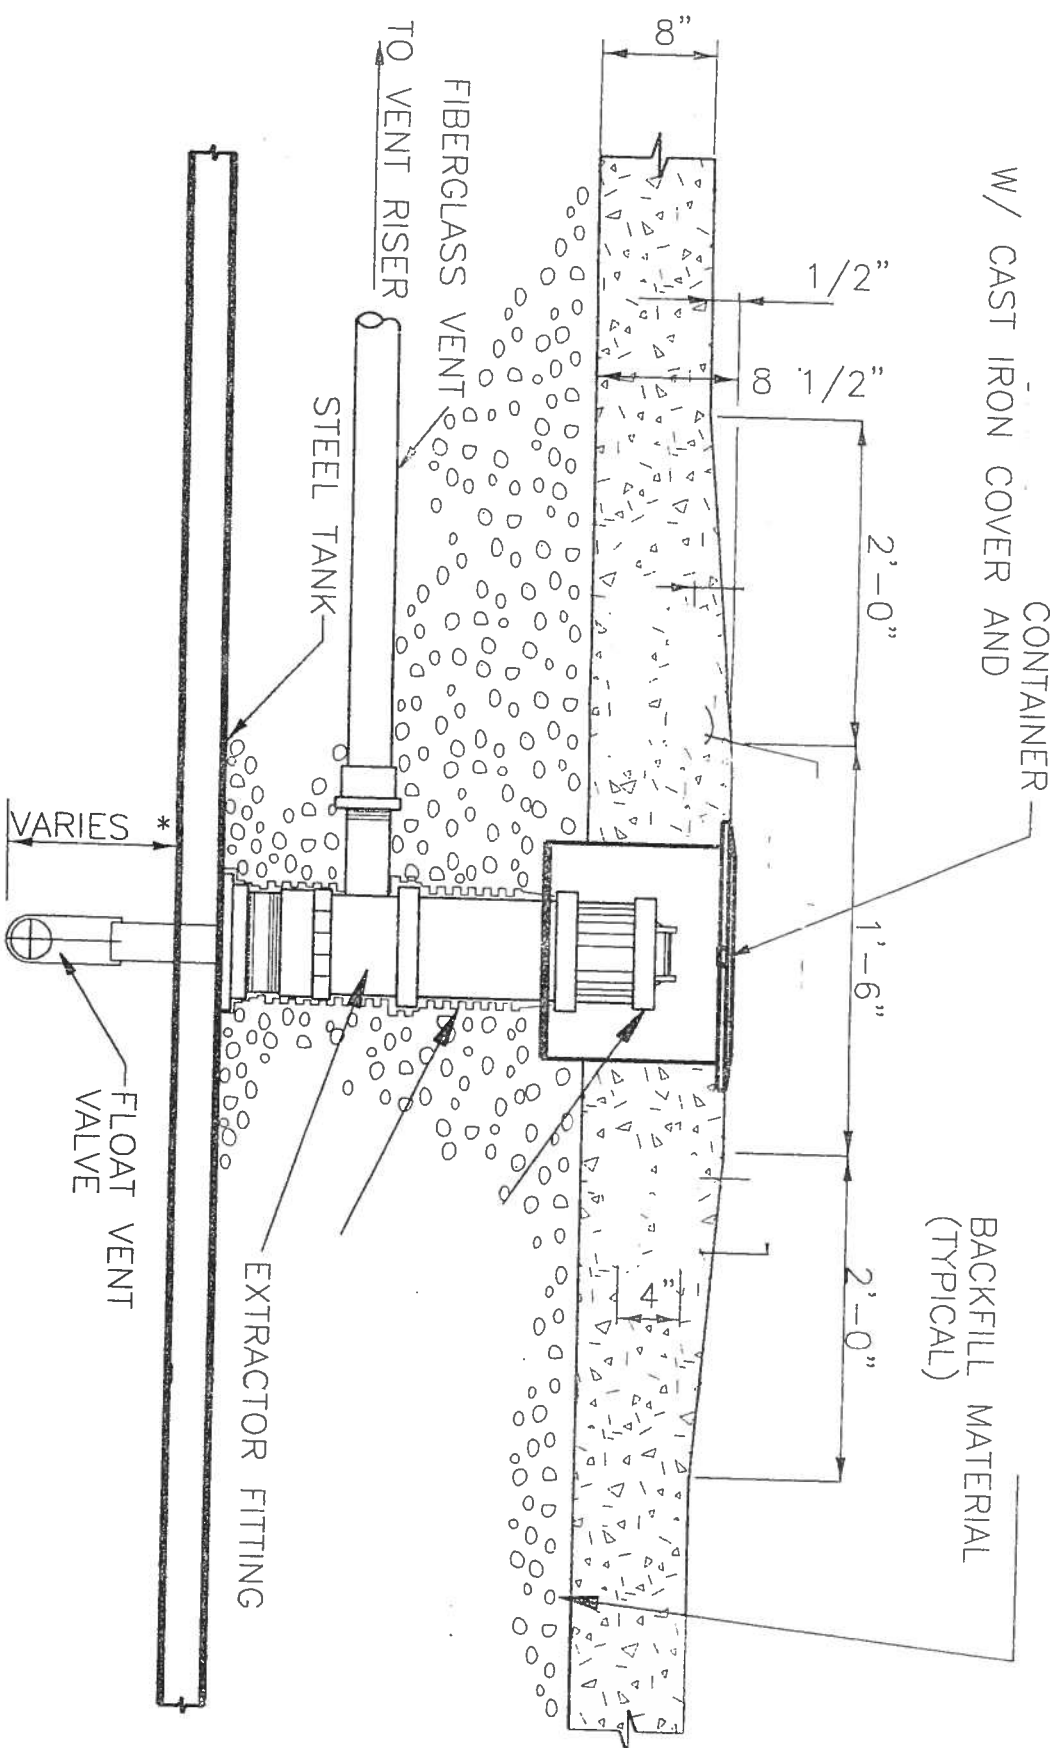

* FOR EXACT VALVE DEPTH FOR EACH TANK, SEE CHART BELOW.

