



Product Approval
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

OFFICE OF THE
SECRETARY

FL #	FL239-R30
Application Type	Revision
Code Version	2023
Application Status	Approved
	*Approved by DBPR. Approvals by DBPR shall be reviewed and ratified by the POC and/or the Commission if necessary.
Comments	
Archived	☐
Product Manufacturer	PGT Industries
Address/Phone/Email	1070 Technology Drive North Venice, FL 34275 (941) 486-0100 Ext 21140 jrosowski@pgtindustries.com
Authorized Signature	Jens Rosowski jrosowski@pgtindustries.com
Technical Representative	Lynn Miller, P.E.
Address/Phone/Email	1070 Technology Dr N Venice, FL 34275 (941) 486-0100 Ext 21142 lmiller@pgtindustries.com
Quality Assurance Representative	
Address/Phone/Email	
Category	Windows
Subcategory	Single Hung
Compliance Method	Certification Mark or Listing
Certification Agency	Miami-Dade BCCO - CER
Validated By	Steven M. Urich, PE
	☒ Validation Checklist - Hardcopy Received
Referenced Standard and Year (of Standard)	<u>Standard</u> TAS 201, 202, 203
	<u>Year</u> 1994
Equivalence of Product Standards Certified By	
Product Approval Method	Method 1 Option A

Date Submitted
Date Validated
Date Pending FBC Approval
Date Approved

06/16/2025
06/17/2025

06/18/2025

Summary of Products

FL #	Model, Number or Name	Description
239.1	SH5400 (Non-Impact)	Vinyl Single Hung Window
Limits of Use Approved for use in HVHZ: Yes Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: N/A Other: Please see Miami-Dade County Notice of Acceptance (NOA) for product performance information, anchorage details, and anchor type, size, and spacing information.		Certification Agency Certificate FL239_R30_C_CAC_25-0520.02.pdf Quality Assurance Contract Expiration Date 07/30/2030 Installation Instructions FL239_R30_II_25-0520.02.pdf Verified By: Miami-Dade BCCO - CER Created by Independent Third Party: Evaluation Reports Created by Independent Third Party:
239.2	SH5500 (Large Missile Impact)	Vinyl Single Hung Window
Limits of Use Approved for use in HVHZ: Yes Approved for use outside HVHZ: Yes Impact Resistant: Yes Design Pressure: N/A Other: Please see Miami-Dade County Notice of Acceptance (NOA) for product performance information, anchorage details, and anchor type, size, and spacing information.		Certification Agency Certificate FL239_R30_C_CAC_25-0520.01.pdf Quality Assurance Contract Expiration Date 07/30/2030 Installation Instructions FL239_R30_II_25-0520.01.pdf Verified By: Miami-Dade BCCO - CER Created by Independent Third Party: Evaluation Reports Created by Independent Third Party:
239.3	SH7600 (Non-Impact)	Aluminum Single Hung Window
Limits of Use Approved for use in HVHZ: Yes Approved for use outside HVHZ: Yes Impact Resistant: No Design Pressure: N/A Other: Please see Miami-Dade County Notice of Acceptance (NOA) for product performance information, anchorage details, and anchor type, size, and spacing information.		Certification Agency Certificate FL239_R30_C_CAC_23-0707.11.pdf Quality Assurance Contract Expiration Date 08/23/2028 Installation Instructions FL239_R30_II_23-0707.11.pdf Verified By: Miami-Dade BCCO - CER Created by Independent Third Party: Evaluation Reports Created by Independent Third Party:
<u>239.4</u>	SH7700 (Large Missile Impact)	Aluminum Single Hung Window
Limits of Use Approved for use in HVHZ: Yes Approved for use outside HVHZ: Yes Impact Resistant: Yes Design Pressure: N/A Other: Please see Miami-Dade County Notice of Acceptance (NOA) for product performance information, anchorage details, and anchor type, size, and spacing information.		Certification Agency Certificate FL239_R30_C_CAC_23-0707.10.pdf Quality Assurance Contract Expiration Date 08/23/2028 Installation Instructions FL239_R30_II_23-0707.10.pdf Verified By: Miami-Dade BCCO - CER Created by Independent Third Party: Evaluation Reports Created by Independent Third Party:

[Back](#)


[Next](#)

Contact Us :: 2601 Blair Stone Road, Tallahassee FL 32399 Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. *Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:





DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES
(RER)

BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

PGT Industries, Inc.
1070 Technology Drive
North Venice, FL 34275

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.-

DESCRIPTION: Series "SH7700A" Aluminum Single Hung Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. 7700NOA-1 Rev B, titled "Aluminum Single Hung Install (LM)", sheets 1 through 11 of 11, dated 04/01/18 and last revised on 06/06/23, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews** NOA # 20-0401.11 and consists of this page 1 and evidence pages E-1, E-2, E-3, E-4 and E-5, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



Ishaq I. Chanda

NOA No. 23-0707.10
Expiration Date: August 23, 2028
Approval Date: July 27, 2023
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Submitted under NOA # 18-0430.06

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **7700NOA-1**, titled "Aluminum Single Hung Install (LM), sheets 1 through 11 of 11, dated 04/01/18, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-18-7835.1**, dated 04/03/18, signed and sealed by Idalmis Ortega, P.E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-18-7835.2**, dated 05/04/18, signed and sealed by Idalmis Ortega, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 6th Edition (2017)**, dated 04/23/18, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 23-0707.10
Expiration Date: August 23, 2028
Approval Date: July 27, 2023

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **17-1114.14** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**” dated 01/18/18, expiring on 07/08/19.
2. Notice of Acceptance No. **17-0808.02** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 12/28/17, expiring on 07/04/23.

F. STATEMENTS

1. Statement letter of conformance to **FBC 6th Edition (2017)**, dated April 24, 2018, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest, dated April 24, 2018, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
3. Proposal No. **18-0005R** issued by the Product Control Section, dated 01/16/18, signed by Manuel Perez, P.E

G. OTHERS

1. None.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No. 23-0707.10
Expiration Date: August 23, 2028
Approval Date: July 27, 2023

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. Evidence Submitted previous approval

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **7700NOA-1**, titled "Aluminum Single Hung Install (LM)", sheets 1 through 11 of 11, dated 04/01/18, with revision A dated 03/11/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F588 and TAS 202-94
along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.:
FTL-7897, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14
FTL-20-2107.1, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal)
FTL-20-2107.2, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal)
FTL-20-2107.3, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and
FTL-20-2107.4, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal)
dated 07/13/20, all signed and sealed by Idalmis Ortega, P.E

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 6th Edition (2017)** and **FBC 7th Edition (2020)**, dated 03/13/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

D. QUALITY ASSURANCE

1. Miami- Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 23-0707.10
Expiration Date: August 23, 2028
Approval Date: July 27, 2023

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)** and **FBC 7th Edition (2020)**, dated March 10, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest, dated March 10, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
3. Proposal No. **19-1155 TP** issued by the Product Control Section, dated January 10, 2020, signed by Ishaq Chanda, P.E.

G. OTHERS

1. Notice of Acceptance No. **18-0430.06** issued to PGT Industries, Inc. for their “Series “SH7700A” Aluminum Single Hung Window – L.M.I.” approved on 08/23/18 and expiring on 08/23/23.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 23-0707.10
Expiration Date: August 23, 2028
Approval Date: July 27, 2023

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. New Evidence Submitted

A. DRAWINGS

1. Drawing No. **7700NOA-1 Rev B**, titled “Aluminum Single Hung Install (LM)”, sheets 1 through 11 of 11, dated 04/01/18 and last revised on 06/06/23, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS (submitted under previous approval)

1. None.

C. CALCULATIONS (submitted under previous approval)

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)** and the **FBC 8th Edition (2023)**, dated 06-06-23, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of conformance, complying with **FBC 6th Edition (2017)** and the **FBC 7th Edition (2020)**, dated March 10, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E. (submitted under previous approval)

G. OTHERS

1. This NOA **revises & renews NOA # 20-0401.11**, expiring 08/23/28.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 23-0707.10
Expiration Date: August 23, 2028
Approval Date: July 27, 2023

SERIES SH7700A IMPACT RESISTANT SINGLE HUNG WINDOW

1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).

2) SHUTTERS ARE NOT REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS. FOR INSULATED GLASS INSTALLATIONS ABOVE 30" IN THE HVHZ, THE OUTBOARD LITE (CAP) MUST BE TEMPERED. USE ONLY GLASS TYPES 3, 7, 12, 13 OR 15.

3) FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.

4) ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND SECURED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER, (EOR) OR ARCHITECT OF RECORD, (AOR).

5) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE REQUIRED MIN. EMBEDMENT. INSTALLATION ANCHORS SHOULD BE SEALED. OVERALL SEALING & FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.

6) 1/4" MAX. SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS.

7) DESIGN PRESSURES:
A. NEGATIVE DESIGN LOADS BASED ON STRUCTURAL & CYCLE TESTING AND GLASS PER ASTM E1300.
B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL & CYCLE TESTING AND GLASS PER ASTM E1300.
C. DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.


8) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.

9) METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION.

10) REFERENCES: TEST REPORTS FTL 18-7835.1 & 18-7835.2; ELCO ULTRACON NOA; DEWALT ULTRACON NOA; DEWALT ULTRACON + NOA; NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, ANSI/APA NDS & ALUMINUM DESIGN MANUAL.


11) APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY BUILDING OFFICIAL.

12) FRAME FLANGES OR INTEGRAL FINS MAY BE TRIMMED IN-FIELD TO CREATE AN EQUAL-LEG FRAME. THE EXPOSED ALUMINUM EDGE MUST BE PAINTED TO PROTECT AGAINST CORROSION.

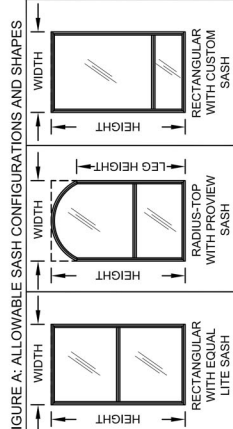


ALL SHAPES WITH ALL SASH CONFIGURATIONS ARE APPROVED. SHAPES MAY BE USED BY INSCRIBING THE SHAPE IN A BLOCK AND OBTAINING DESIGN PRESSURES AND ANCHORAGE FOR THAT BLOCK SIZE FROM THE TABLES ON THE FOLLOWING SHEETS.

DESIGN PRESSURE RATING	IMPACT RATING
VARIABLES PER GLASS TYPE, SEE SHEETS 2-5	LARGE & SMALL MISSILE IMPACT RESISTANT

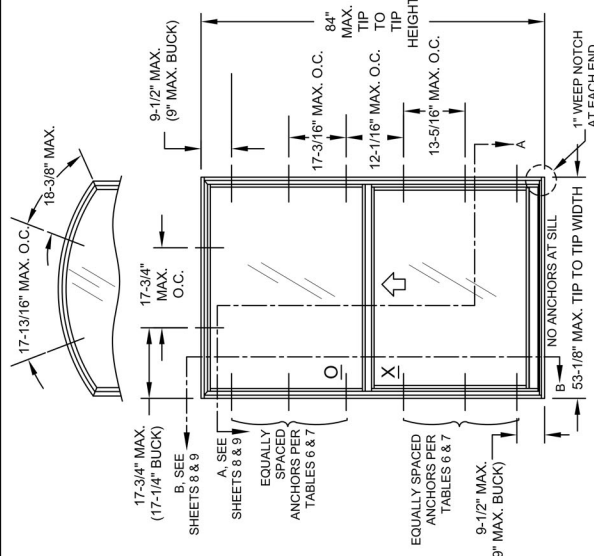

ELEVATION FOR TYP. FLANGE FRAME SHOWN WITH EQUAL-LITE CONFIGURATION

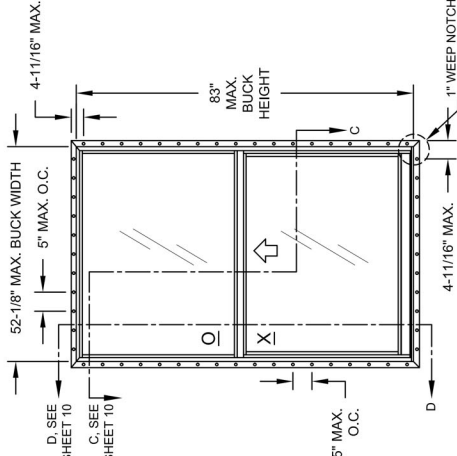

ELEVATION FOR TYP. FIN FRAME SHOWN WITH EQUAL-LITE CONFIGURATION

TABLE 1: ALLOWABLE GLASS TYPES

Glass Type	Description (Listed from Exterior to Interior)	DP Table #
1	1/8\" AN, .090\" PVB, 1/8\" AN	2
2	13/16\" LG: 1/8\" AN CAP, AIRSPACE, 1/8\" AN, .090\" PVB, 1/8\" AN	2
3	13/16\" LG: 1/8\" TP CAP, AIRSPACE, 1/8\" AN, .090\" PVB, 1/8\" AN	3
4	1/8\" HS, .090\" PVB, 1/8\" HS	4
5	3/16\" AN, .090\" PVB, 3/16\" AN	4
6	13/16\" LG: 3/16\" AN CAP, AIRSPACE, 1/8\" AN, .090\" PVB, 1/8\" AN	4
7	13/16\" LG: 3/16\" TP CAP, AIRSPACE, 1/8\" AN, .090\" PVB, 1/8\" AN	4
8	3/16\" AN, .090\" SG, 3/16\" AN	5
9	3/16\" HS, .090\" SG, 3/16\" HS	5
10	13/16\" LG: 1/8\" AN CAP, AIRSPACE, 1/8\" HS, .090\" SG, 1/8\" HS	5
11	13/16\" LG: 1/8\" AN CAP, AIRSPACE, 3/16\" AN, .090\" SG, 3/16\" AN	5
12	13/16\" LG: 1/8\" TP CAP, AIRSPACE, 1/8\" HS, .090\" SG, 1/8\" HS	5
13	13/16\" LG: 1/8\" TP CAP, AIRSPACE, 3/16\" AN, .090\" SG, 3/16\" AN	5
14	13/16\" LG: 3/16\" AN CAP, AIRSPACE, 1/8\" HS, .090\" SG, 1/8\" HS	5
15	13/16\" LG: 3/16\" TP CAP, AIRSPACE, 1/8\" HS, .090\" SG, 1/8\" HS	5

CODES / STANDARDS USED:

- 2023 FLORIDA BUILDING CODE (FBC), 8TH EDITION
- 2020 FLORIDA BUILDING CODE (FBC), 7TH EDITION
- ASTM E1300-09
- ANSI/APA NDS-2018 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2020
- AISI S100-16
- AISI 360-16

SG = KURARAY SENTRYGLAS® INTERLAYER BY KURARAY AMERICA, INC.

- PVB = KURARAY THOSIFOL® PVB INTERLAYER BY KURARAY AMERICA, INC.
- AN = ANNEAL
- HS = HEAT-STRENGTHENED
- TP = TEMPERED

GENERAL NOTES:	1
ELEVATIONS:	1
DESIGN PRESSURES / GLAZING DETAILS:	2-4
ANCHOR QUANTITIES:	5-6
INSTALLATION, FLANGE:	7
INSTALLATION, EQUAL LEG:	8
INSTALLATION, INTEGRAL FIN:	9
EXTRUSION PROFILES:	10
ASSEMBLY & PARTS LIST:	11

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **23-0707.10**
Expiration Date **08/23/2028**
By **Isang I. Lim**
Miami-Dade Product Control

B) UPDATED TO FBC
2023.
LY - 06/06/23

Prepared by A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	DATE 04/01/18	DESIGNED BY JENS ROSOWSKI	NO. 7700NOA-LM	SHEET 1 OF 11	DATE 04/01/18
--	---------------------	------------------	------------------------------	-------------------	------------------	------------------




TABLE 2:

Bottom Sash Description for Given Range		Design Pressure (lbs/ft ²) for Glass Types 1 & 2											
		Tip to Tip Width											
		18"	25"	33"	41"	45"	48"	53-1/8"					
24"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
31"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
36-3/8"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
45"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
49"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
50-5/8"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
63"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
76"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
84"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0					

* MINIMUM SASH HEIGHT FOR FLANGED WINDOWS IS: TIP TO TIP HEIGHT - 49.391

MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG WINDOWS IS: BUCK HEIGHT - 48.391

MINIMUM SASH HEIGHT FOR FLANGED, RADIUS TOP WINDOWS IS: TIP TO TIP HEIGHT - 49.806


MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG, RADIUS TOP WINDOWS IS: BUCK HEIGHT - 48.806

1) TIP TO TIP DIMENSIONS SHOWN. FOR INTEGRAL FIN AND EQUAL-LEG WINDOWS, SUBTRACT 1" FROM THE TIP TO TIP DIMENSION IN THE TABLE TO DETERMINE THE WINDOW SIZE.


2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE.

3) FOR RADII TOP WINDOWS, FIND THE SMALLEST WINDOW SIZE IN THE TABLE ABOVE WHICH THE RADIUS TOP WINDOW WILL COMPLETELY FIT WITHIN.

4) WINDOWS WITH THE LOW SILL OPTION ARE LIMITED TO A MAXIMUM POSITIVE DESIGN PRESSURE OF +65 PSF. NEGATIVE DESIGN PRESSURES ARE UNAFFECTED.

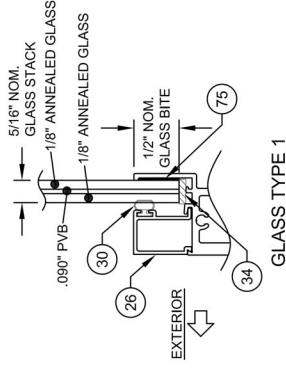

GLASS TYPE 1

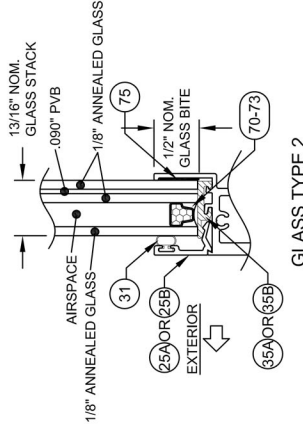

GLASS TYPE 2

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **23-0707.10**
Expiration Date **08/23/2028**

By *Isang I. Lim*
Miami-Dade Product Control

**NO CHANGES THIS
SHEET.**

Revision:
LY - 06/06/23

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		CUSTOM WINDOWS AND DOORS 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
ALUMINUM SINGLE HUNG INSTALL (LM)		DP TABLE	
REGISTRATION #29296		JENS ROSOWSKI	
Date	04/01/18	Drawn By	7700NOA-LM
Sheet		2 OF 11	
DWG		No.	
Title		B	



TABLE 3:

Bottom Sash Description for Given Range		Design Pressure (lbs/ft ²) for Glass Type 3											
		Tip to Tip Width											
		18"	24"	32"	37"	41"	45"	49"	53-1/8"				
24"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
31"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
36-3/8"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
45"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
49"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
50-5/8"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
63"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
76"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
84"	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Equalite	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Standard Proview	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				
	Shortest	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0	+65.0 -80.0				

* MINIMUM SASH HEIGHT FOR FLANGED WINDOWS IS: TIP TO TIP HEIGHT - 49.391

MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG WINDOWS IS: BUCK HEIGHT - 48.391

MINIMUM SASH HEIGHT FOR FLANGED, RADIUS TOP WINDOWS IS: TIP TO TIP HEIGHT - 49.806


MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG, RADIUS TOP WINDOWS IS: BUCK HEIGHT - 48.806

1) TIP TO TIP DIMENSIONS SHOWN. FOR INTEGRAL FIN AND EQUAL-LEG WINDOWS, SUBTRACT 1" FROM THE TIP TO TIP DIMENSION IN THE TABLE TO DETERMINE THE WINDOW SIZE.

2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE.

3) FOR RADII TOP WINDOWS, FIND THE SMALLEST WINDOW SIZE IN THE TABLE ABOVE WHICH THE RADIUS TOP WINDOW WILL COMPLETELY FIT WITHIN.

4) WINDOWS WITH THE LOW SILL OPTION ARE LIMITED TO A MAXIMUM POSITIVE DESIGN PRESSURE OF +65 PSF. NEGATIVE DESIGN PRESSURES ARE UNAFFECTED.

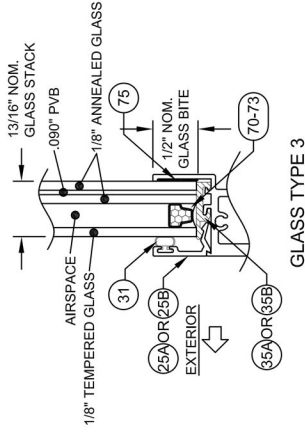

GLASS TYPE 3

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **23-0707.10**
Expiration Date **08/23/2028**

By *Isang I. Llanza*
Miami-Dade Product Control

**NO CHANGES THIS
SHEET.**

Revision:
LY - 06/06/23

Prepared By A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 33425 (941) 480-1600		CUSTOM WINDOWS AND DOORS 1070 TECHNOLOGY DRIVE N. VENICE, FL 33425 (941) 480-1600		Title ALUMINUM SINGLE HUNG INSTALL (LM)		Date 04/01/18		Drawn By JENS ROSOWSKI		Sheet 3 OF 11		DWG No. 7700NOA-LM		Tab. B	
--	--	--	--	--	--	------------------	--	---------------------------	--	------------------	--	-----------------------	--	-----------	--



TABLE 4:

Design Pressure (lbs/ft ²) for Glass Types 4-7				
Bottom Sash Description for Given Range	Sash Height Range (in)	Tip To Tip Width	53-1/8"	
24"	Equal-Lite	12,464	+65.0	-80.0
	Equal-Lite	15,964	+65.0	-80.0
31"	Standard Proview	12,994 - 15,963	+65.0	-80.0
	Shortest	12,464 - 12,993	+65.0	-80.0
	Equal-Lite	19,652	+65.0	-80.0
38-3/8"	Standard Proview	15,944 - 19,651	+65.0	-80.0
	Custom Size	15,131 - 15,943	+65.0	-80.0
	Shortest	14,131 - 15,130	+65.0	-80.0
	Equal-Lite	22,964	+65.0	-80.0
	Custom Size	20,131 - 22,963	+65.0	-80.0
45"	Standard Proview	18,594 - 20,130	+65.0	-80.0
	Custom Size	16,131 - 18,593	+65.0	-80.0
	Custom Size	15,131 - 16,130	+65.0	-80.0
	Custom Size	14,131 - 15,130	+65.0	-80.0
	Shortest	12,464 - 14,130	+65.0	-80.0
	Equal-Lite	24,964	+65.0	-80.0
	Custom Size	22,131 - 24,963	+65.0	-80.0
49"	Standard Proview	20,194 - 22,130	+65.0	-80.0
	Custom Size	18,131 - 20,193	+65.0	-80.0
	Custom Size	16,131 - 18,130	+65.0	-80.0
	Custom Size	14,131 - 16,130	+65.0	-80.0
	Shortest	12,464 - 14,130	+65.0	-80.0
	Equal-Lite	25,777	+65.0	-80.0
	Custom Size	24,131 - 25,776	+65.0	-80.0
50-5/8"	Standard Proview	20,844 - 24,130	+65.0	-80.0
	Custom Size	20,131 - 20,843	+65.0	-80.0
	Custom Size	18,131 - 20,130	+65.0	-80.0
	Custom Size	16,131 - 18,130	+65.0	-80.0
	Custom Size	14,131 - 16,130	+65.0	-80.0
	Shortest	12,464 - 14,130	+65.0	-80.0
	Equal-Lite	31,964	+65.0	-80.0
	Custom Size	28,131 - 31,963	+65.0	-80.0
63"	Standard Proview	25,794 - 28,130	+65.0	-80.0
	Custom Size	24,131 - 25,793	+65.0	-80.0
	Custom Size	22,131 - 24,130	+65.0	-80.0
	Custom Size	20,131 - 22,130	+65.0	-80.0
	Custom Size	18,131 - 20,130	+65.0	-80.0
	Custom Size	16,131 - 18,130	+65.0	-80.0
	Shortest	13,194 - 16,130	+65.0	-80.0
	Equal-Lite	38,464	+65.0	-80.0
	Custom Size	36,131 - 38,463	+65.0	-80.0
76"	Standard Proview	34,131 - 36,130	+65.0	-80.0
	Custom Size	30,994 - 34,130	+65.0	-80.0
	Custom Size	30,131 - 30,993	+65.0	-80.0
	Custom Size	28,131 - 30,130	+65.0	-80.0
	Shortest	26,194 - 28,130	+65.0	-80.0
	Equal-Lite	42,464	+65.0	-80.0
84"	Standard Proview	34,194 - 38,130	+65.0	-80.0

* MINIMUM SASH HEIGHT FOR FLANGED WINDOWS IS: TIP TO TIP HEIGHT - 49.391










MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL-LEG WINDOWS IS: BUCK HEIGHT - 48.391

MINIMUM SASH HEIGHT FOR FLANGED, RADIUS TOP WINDOWS IS: TIP TO TIP HEIGHT - 49.806

MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG, RADIUS TOP WINDOWS IS: BUCK HEIGHT - 48.806

TABLE 5:

Design Pressure for Glass Types 8-15				
Bottom Sash Description for Given Range	Sash Height Range (in)	Tip To Tip Width	53-1/8"	
24"	Equal-Lite	12,464	+80.0	-110.0
	Equal-Lite	15,964	+80.0	-110.0
31"	Standard Proview	12,994 - 15,963	+80.0	-110.0
	Shortest	12,464 - 12,993	+80.0	-110.0
	Equal-Lite	19,652	+80.0	-110.0
38-3/8"	Standard Proview	15,944 - 19,651	+80.0	-110.0
	Custom Size	15,131 - 15,943	+80.0	-110.0
	Custom Size	14,131 - 15,130	+80.0	-110.0
	Shortest	12,464 - 14,130	+80.0	-110.0
	Equal-Lite	22,964	+80.0	-110.0
	Custom Size	20,131 - 22,963	+80.0	-110.0
45"	Standard Proview	18,594 - 20,130	+80.0	-110.0
	Custom Size	16,131 - 18,593	+80.0	-110.0
	Custom Size	15,131 - 16,130	+80.0	-110.0
	Custom Size	14,131 - 15,130	+80.0	-110.0
	Shortest	12,464 - 14,130	+80.0	-110.0
	Equal-Lite	24,964	+80.0	-110.0
	Custom Size	22,131 - 24,963	+80.0	-110.0
49"	Standard Proview	20,194 - 22,130	+80.0	-110.0
	Custom Size	18,131 - 20,193	+80.0	-110.0
	Custom Size	16,131 - 18,130	+80.0	-110.0
	Custom Size	14,131 - 16,130	+80.0	-110.0
	Shortest	12,464 - 14,130	+80.0	-110.0
	Equal-Lite	25,777	+80.0	-110.0
	Custom Size	24,131 - 25,776	+80.0	-110.0
50-5/8"	Standard Proview	20,844 - 24,130	+80.0	-110.0
	Custom Size	20,131 - 20,843	+80.0	-110.0
	Custom Size	18,131 - 20,130	+80.0	-110.0
	Custom Size	16,131 - 18,130	+80.0	-110.0
	Custom Size	14,131 - 16,130	+80.0	-110.0
	Shortest	12,464 - 14,130	+80.0	-110.0
	Equal-Lite	31,964	+80.0	-110.0
	Custom Size	28,131 - 31,963	+80.0	-110.0
63"	Standard Proview	25,794 - 28,130	+80.0	-110.0
	Custom Size	24,131 - 25,793	+80.0	-110.0
	Custom Size	22,131 - 24,130	+80.0	-110.0
	Custom Size	20,131 - 22,130	+80.0	-110.0
	Custom Size	18,131 - 20,130	+80.0	-110.0
	Custom Size	16,131 - 18,130	+80.0	-110.0
	Shortest	13,194 - 16,130	+80.0	-110.0
	Equal-Lite	38,464	+80.0	-110.0
	Custom Size	36,131 - 38,463	+80.0	-110.0
76"	Standard Proview	34,131 - 36,130	+80.0	-110.0
	Custom Size	30,994 - 34,130	+80.0	-110.0
	Custom Size	30,131 - 30,993	+80.0	-110.0
	Custom Size	28,131 - 30,130	+80.0	-110.0
	Shortest	26,194 - 28,130	+80.0	-110.0
	Equal-Lite	42,464	+80.0	-110.0
84"	Standard Proview	34,194 - 38,130	+80.0	-110.0

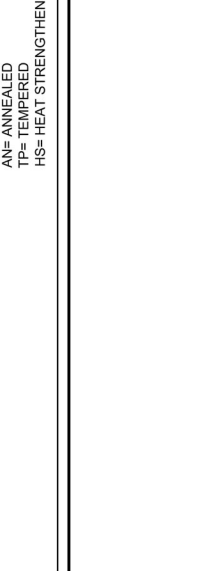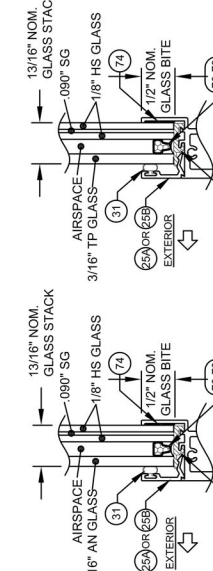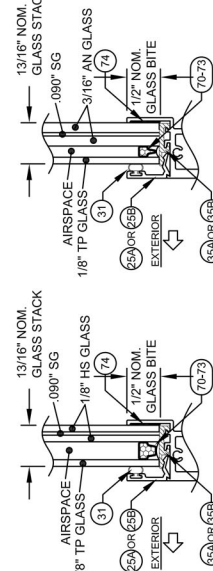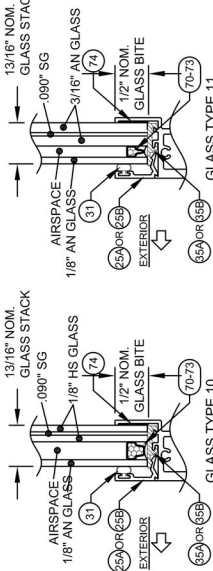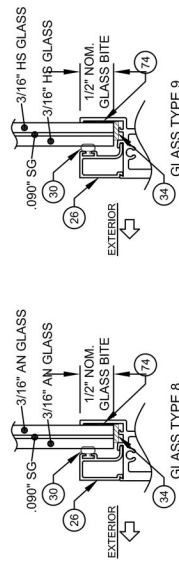

ANF= ANNEALED
TP= TEMPERED
HS= HEAT STRENGTHENED

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **23-0707.10**
Expiration Date **08/23/2028**
By *Isayng I. Llanza*
Miami-Dade Product Control

B) NO CHANGES THIS SHEET.
LY - 06/06/23

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

Custom Windows and Doors
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

ALUMINUM SINGLE HUNG INSTALL (LM)
04/01/18

REGISTRATION #29296

DP TABLE
JENS ROSOWSKI
4 OF 11
7700NOA-LM
B

ANTHONY LYNN MILLER
LICENSE
No. 58705
06/06/23
STATE OF FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

TABLE 7:

Anchor Quantities Required for
"Through-Frame" Installation
using Glass Types 8-15

	Bottom Sash Description for Given Range	Sash Height Range (in)	Tip to Tip Height												
			Header	Below MR	Header	Below MR	Header	Below MR	Header	Below MR	Header	Below MR	Header	Below MR	
24"	Equal-Lite	12,464	1	2	1	1	2	1	2	1	2	1	2	1	2
	Equal-Lite	15,964	1	2	1	1	2	1	2	1	2	1	2	1	2
	Standard Preview	12,994 - 15,963	2	2	1	2	2	2	2	2	2	2	2	2	2
31"	Shortest	12,464 - 12,993	2	2	1	2	2	2	2	2	2	2	2	2	2
	Equal-Lite	19,652	2	2	1	2	2	2	2	2	2	2	2	2	2
	Standard Preview	15,944 - 19,651	2	2	1	2	2	2	2	2	2	2	2	2	2
38-3/8"	Custom Size	15,131 - 15,943	2	2	1	2	2	2	2	2	2	2	2	2	2
	Custom Size	14,131 - 15,130	2	2	1	2	2	2	2	2	2	2	2	2	2
	Shortest	12,464 - 14,130	2	2	1	2	2	2	2	2	2	2	2	2	2
45"	Equal-Lite	22,964	2	2	1	2	2	2	2	2	2	2	2	2	2
	Custom Size	20,131 - 22,963	2	2	1	2	2	2	2	2	2	2	2	2	2
	Standard Preview	18,594 - 20,130	2	2	1	2	2	2	2	2	2	2	2	2	2
49"	Custom Size	16,131 - 18,593	2	2	1	2	2	2	2	2	2	2	2	2	2
	Custom Size	15,131 - 16,130	2	2	1	2	2	2	2	2	2	2	2	2	2
	Custom Size	14,131 - 15,130	2	2	1	2	2	2	2	2	2	2	2	2	2
50-5/8"	Shortest	12,464 - 14,130	3	2	1	3	2	1	3	2	1	3	2	1	3
	Equal-Lite	25,777	2	2	1	2	2	1	2	2	1	2	2	1	2
	Custom Size	24,131 - 25,776	2	2	1	2	2	1	2	2	1	2	2	1	2
63"	Standard Preview	20,844 - 24,130	2	2	1	2	2	1	2	2	1	2	2	1	2
	Custom Size	20,131 - 20,843	2	2	1	2	2	1	2	2	1	2	2	1	2
	Custom Size	18,131 - 20,130	3	2	1	3	2	1	3	2	1	3	2	1	3
63"	Custom Size	16,131 - 18,130	3	2	1	3	2	1	3	2	1	3	2	1	3
	Custom Size	14,131 - 16,130	3	2	1	3	2	1	3	2	1	3	2	1	3
	Shortest	12,464 - 14,130	3	2	1	3	2	1	3	2	1	3	2	1	3
76"	Equal-Lite	31,964	2	3	1	3	2	1	3	2	1	3	2	1	3
	Custom Size	28,131 - 31,963	3	3	1	3	3	1	3	3	1	3	3	1	3
	Standard Preview	25,794 - 28,130	3	3	1	3	3	1	3	3	1	3	3	1	3
76"	Custom Size	24,131 - 25,793	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	22,131 - 24,130	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	20,131 - 22,130	3	3	1	3	3	1	3	3	1	3	3	1	3
84"	Custom Size	18,131 - 20,130	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	16,131 - 18,130	3	3	1	3	3	1	3	3	1	3	3	1	3
	Shortest	13,194 - 16,130	4	2	1	4	2	1	4	2	1	4	2	1	4
84"	Equal-Lite	38,464	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	36,131 - 38,463	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	34,131 - 36,130	3	3	1	3	3	1	3	3	1	3	3	1	3
84"	Standard Preview	30,994 - 34,130	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	30,131 - 30,993	3	3	1	3	3	1	3	3	1	3	3	1	3
	Custom Size	28,131 - 30,130	3	3	1	3	3	1	3	3	1	3	3	1	3
84"	Shortest	26,194 - 28,130	4	2	1	4	2	1	4	2	1	4	2	1	4
	Equal-Lite	42,464	3	4	1	3	4	1	3	4	1	3	4	1	3
	Custom Size	38,131 - 42,463	3	4	1	3	4	1	3	4	1	3	4	1	3
84"	Standard Preview	34,194 - 38,130	4	3	1	4	3	1	4	3	1	4	3	1	4
	Custom Size	30,994 - 34,193	4	3	1	4	3	1	4	3	1	4	3	1	4
	Custom Size	28,131 - 30,993	4	3	1	4	3	1	4	3	1	4	3	1	4

* MINIMUM SASH HEIGHT FOR FLANGED WINDOWS IS: TIP TO TIP HEIGHT - 49.391

MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG WINDOWS IS: BUCK HEIGHT - 48.391

MINIMUM SASH HEIGHT FOR FLANGED, RADIUS TOP WINDOWS IS: TIP TO TIP HEIGHT - 49.806

MINIMUM SASH HEIGHT FOR INTEGRAL FIN AND EQUAL LEG, RADIUS TOP WINDOWS IS: BUCK HEIGHT - 48.806

TABLE 7B:

Glass Type	Description (Listed from Exterior to Interior)
8	3/16" AN, .090" SG, 3/16" AN
9	3/16" HS, .090" SG, 3/16" HS
10	13/16" LG, 1/8" AN CAP, AIRSPACE, 1/8" HS, .090" SG, 1/8" HS
11	13/16" LG, 1/8" AN CAP, AIRSPACE, 3/16" AN, .090" SG, 3/16" AN
12	13/16" LG, 1/8" TP CAP, AIRSPACE, 1/8" HS, .090" SG, 1/8" HS
13	13/16" LG, 1/8" TP CAP, AIRSPACE, 3/16" AN, .090" SG, 3/16" AN
14	13/16" LG, 3/16" AN CAP, AIRSPACE, 1/8" HS, .090" SG, 1/8" HS
15	13/16" LG, 3/16" TP CAP, AIRSPACE, 1/8" HS, .090" SG, 1/8" HS

B) NO CHANGES THIS
SHEET.

LY - 06/06/23

Revision:

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. 23-0707.10
Expiration Date 08/23/2028By
1509g I. Lhank
Miami-Dade Product Control


ANCHOR QUANTITY TABLE		By JENS ROSOWSKI		Date 04/01/18	
ALUMINUM SINGLE HUNG INSTALL (LM)		REGISTRATION #29296		Title ANCHOR QUANTITY TABLE	
PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		CUSTOM WINDOWS AND DOORS 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		Sheet 6 OF 11	
DWG No.		7700NOA-LM		Tab B	



INSTALLATION DETAILS FOR FLANGE FRAMES


INSTALLATION OPTION 1

ANCHORED THROUGH FRAME INTO 2X WOOD BUCKSTRIP. SEE NOTE 2, THIS SHEET.

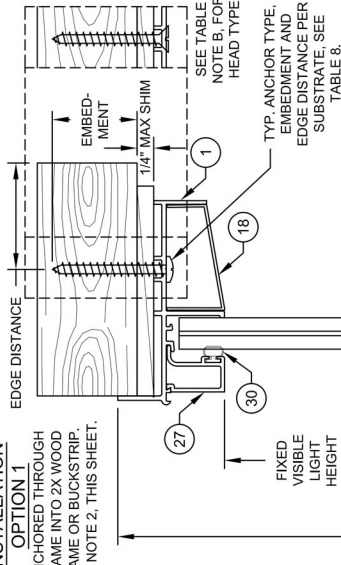


INSTALLATION OPTION 2

ANCHORED THROUGH FRAME DIRECTLY INTO CONCRETE/CMU. SEE NOTE 2, THIS SHEET.

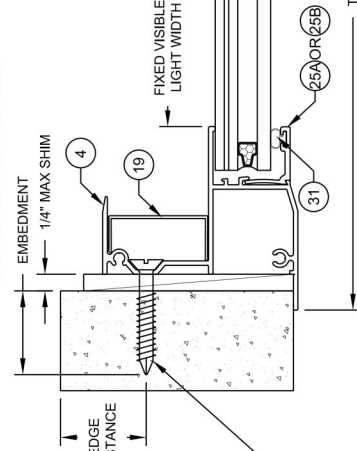


INSTALLATION OPTION 3

ANCHORED THROUGH FRAME AND 1X BUCKSTRIP INTO CONCRETE/CMU. SEE NOTE 2, THIS SHEET.

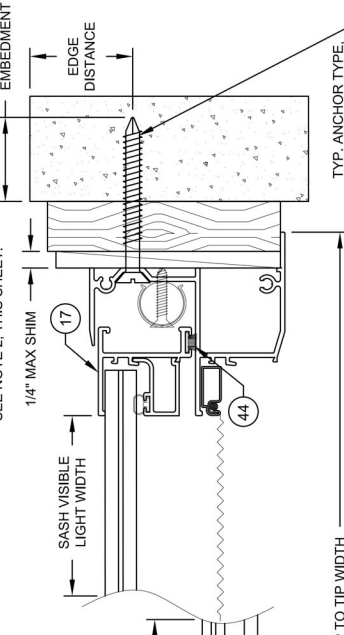

HORIZONTAL SECTION A-A

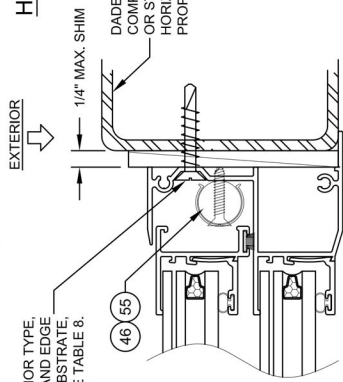

TYP. ANCHOR TYPE, EMBEDMENT AND EDGE DISTANCE PER SUBSTRATE, SEE TABLE 8.

VISIBLE LIGHT FORMULAS:
(SHOWN FOR HI-RISE SILL: SEE SHEET 9 FOR STANDARD SILL)

WIDTH	@ SASH & FIXED LITE: TIP TO TIP WIDTH - 5.12"
HEIGHT (PROVIEW)	TIP TO TIP HEIGHT/2 - 3.73"
@ FIXED LITE: TIP TO TIP HEIGHT/2 + 3.78"	
@ SASH: TIP TO TIP HEIGHT/2 - 11.93"	
HEIGHT (CUSTOM SASH)	
@ FIXED LITE: TIP TO TIP HEIGHT - SASH HEIGHT - 3.55"	
@ SASH: SASH HEIGHT - 4.80"	

INSTALLATION OPTION 4


ANCHORED THROUGH FRAME INTO METAL

TABLE 8:

Anchor	Substrate	Min. Edge Distance	Min. Embedment
#12 Steel, 18-8 or 410 SS Screw	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
	Aluminum, 6063-T5 min.	3/8"	0.063"
	A36 Steel	3/8"	0.063"
	Steel Stud, Gr. 33 min.	3/8"	0.045" (18 Ga)
	Concrete (min. 3,35 ksi)	1"	1-3/4"
1/4" 410 SS CreteFlex	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
1/4" Steel Ultracon +	Ungrouted CMU, (ASTM C-90)	1-1/2"	1-1/4"
	P.T. Southern Pine (SG=0.55)	1"	1-3/8"

- A) MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE.
- B) USE ONLY FLAT-HEAD ANCHORS IN JAMBS. PAN/HEX/FLAT HEAD TYPE IS ALLOWABLE FOR ANCHORS IN THE HEAD.
- C) "UNGROUTED CMU" VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.

VERTICAL SECTION B-B

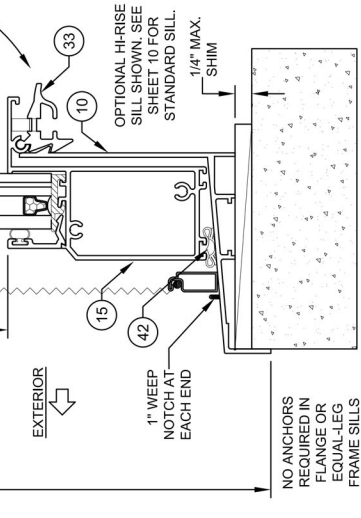

NO ANCHORS REQUIRED IN FLANGE OR EQUAL-LEG FRAME SILLS

PRODUCT RENEWED
as complying with the Florida Building Code
NOA-No. 23-0707.10
Expiration Date 08/23/2028
By *Isang I. Lhank*
Miami-Dade Product Control

B) REVISED ANCHOR TYPE TABLE.
LY - 06/06/23

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

Custom Windows and Doors

REGISTRATION #29296

04/01/18

ALUMINUM SINGLE HUNG INSTALL (LM)

FLANGE X-SECTION

JEENS ROSOWSKI

7 OF 11

7700NOA-LM

Sheet

7700

ANTHONY LYNN MILLER

PROFESSIONAL ENGINEER

No. 58705

06/06/23

STATE OF FLORIDA


A. LYNN MILLER, P.E.

P.E.# 58705

INSTALLATION DETAILS FOR EQUAL-LEG FRAMES


INSTALLATION OPTION 1

ANCHORED THROUGH FRAME INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, THIS SHEET.

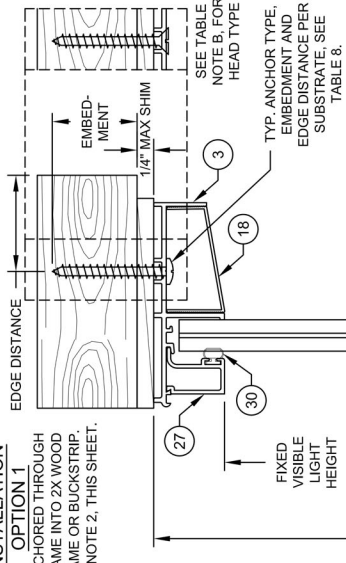


INSTALLATION OPTION 2

ANCHORED THROUGH FRAME DIRECTLY INTO CONCRETE/CMU. SEE NOTE 2, THIS SHEET.

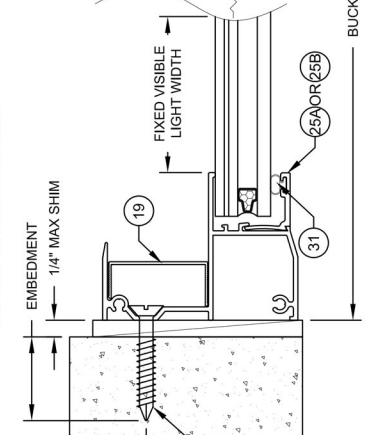


INSTALLATION OPTION 3

ANCHORED THROUGH FRAME AND 1X BUCKSTRIP INTO CONCRETE/CMU. SEE NOTE 2, THIS SHEET.

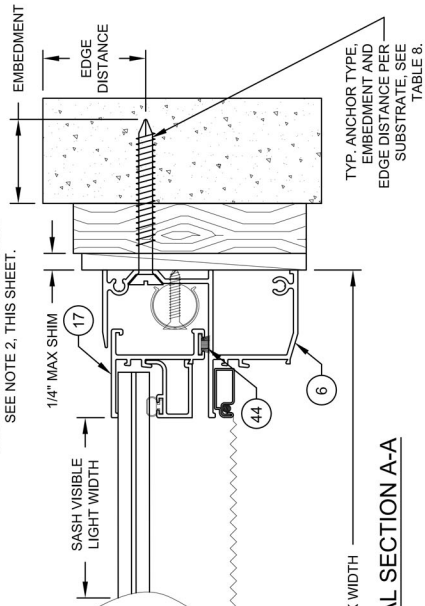

HORIZONTAL SECTION A-A

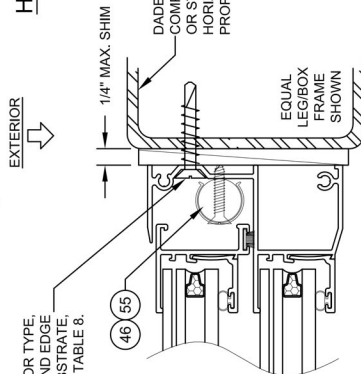

VISIBLE LIGHT FORMULAS:
(SHOWN FOR HIRSE SILL: SEE SHEET 9 FOR STANDARD SILL)

WIDTH	@ SASH & FIXED LITE: BUCK WIDTH - 4.12"
HEIGHT (EQUAL-LITE)	BUCK HEIGHT/2 - 3.23"
HEIGHT (PROVIEW)	@ FIXED LITE: BUCK HEIGHT/2 + 4.28"
	@ SASH: BUCK HEIGHT/2 - 11.43"
HEIGHT (CUSTOM SASH)	@ FIXED LITE: BUCK HEIGHT - SASH HEIGHT - 2.55"
	@ SASH: SASH HEIGHT - 4.60"

INSTALLATION OPTION 4

ANCHORED THROUGH FRAME INTO METAL

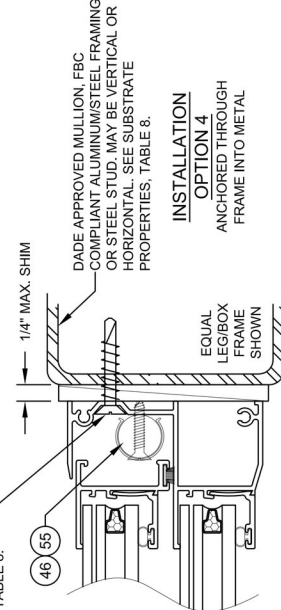


TABLE 9:

Anchor	Substrate	Min. Embedment Distance	Min.
#12 Steel, 18-8 or 410 SS Screw	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
	Aluminum, 6063-T5 min.	3/8"	0.063"
	A36 Steel	3/8"	0.063"
	Steel Stud, Gr. 33 min.	3/8"	0.045" (18 Ga)
	Concrete (min. 3,350 psi)	1"	1-3/4"
1/4" 410 SS CretexFlex	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
1/4" Steel Ultracon +	Ungrouted CMU, (ASTM C-90)	1-3/16"	1-1/4"
	P.T. Southern Pine (SG=0.55)	1"	1-3/8"


NOTES:

- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 9. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE WINDOW.
- 2) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 8. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
- 3) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.

- A) MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE.
- B) USE ONLY FLAT-HEAD ANCHORS IN JAMBS. PAN/HEX/FLAT HEAD TYPE IS ALLOWABLE FOR ANCHORS IN THE HEAD.
- C) "UNGROUTED CMU" VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.

VERTICAL SECTION B-B

NO ANCHORS REQUIRED IN FLANGE OR EQUAL-LEG FRAME SILLS

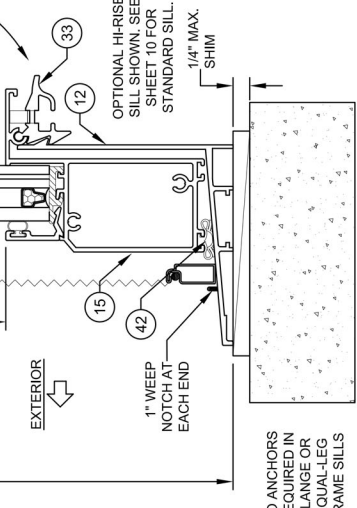

PRODUCT RENEWED
as complying with the Florida Building Code
NOA-No. 23-0707.10
Expiration Date 08/23/2028
By *Isang I. Lim*
Miami-Dade Product Control

B) REVISED ANCHOR TYPE TABLE.
LY - 06/06/23

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

Custom Windows and Doors

REGISTRATION #29296

ALUMINUM SINGLE HUNG INSTALL (LM)

04/01/18

JENS ROSOWSKI

7700NOA-LM

8 OF 11

SH7700A

ANTHONY LYNN MILLER

PROFESSIONAL ENGINEER

No. 58705


06/06/23

STATE OF FLORIDA

A. LYNN MILLER, P.E.

P.E.# 58705

INSTALLATION DETAILS FOR INTEGRAL FIN FRAMES

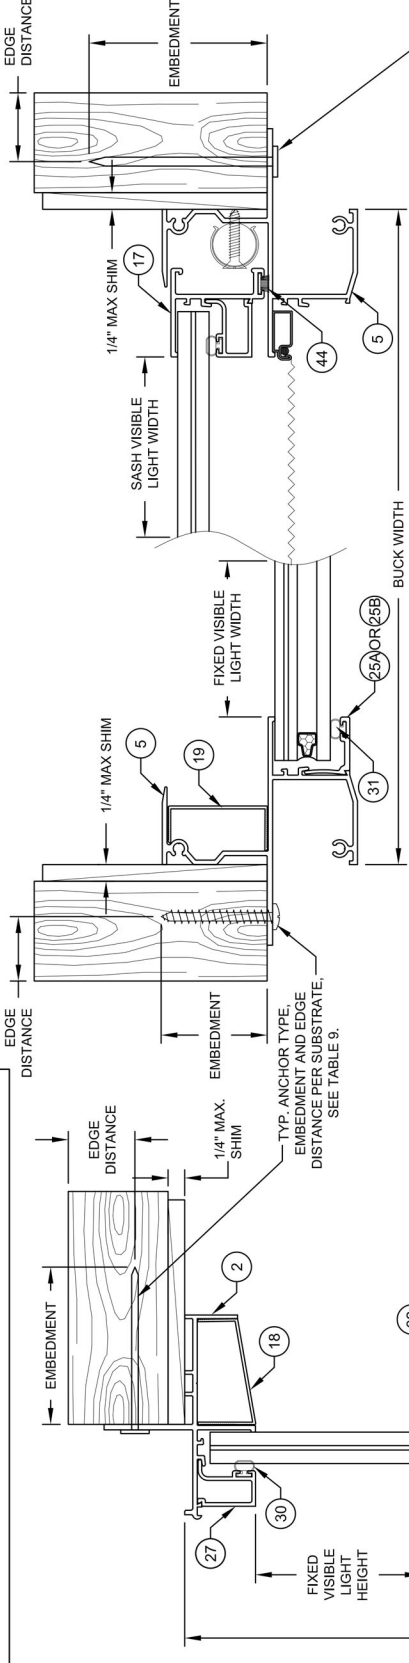

HORIZONTAL SECTION C-C

DADE APPROVED MULLION, FBC COMPLIANT ALUMINUM/STEEL FRAMING OR STEEL STUD, MAY BE VERTICAL OR HORIZONTAL. SEE SUBSTRATE PROPERTIES, TABLE 9.

1/4" MAX. SHIM

#10 OR #12 STEEL SELF-DRILLING SMS (G5), SEE TABLE 9.

INSTALLATION OPTION 7

ANCHORED THROUGH INTEGRAL FIN INTO METAL


INSTALLATION OPTION 4 (FLANGE FRAME), ALLOWED WITH MULLION INSTALLATION, SEE SHEET 7 FOR DETAILS.

MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE.

TABLE 10:

Anchor	Substrate	Min. Edge Distance	Min. Embedment
2-1/2" x .113" Box Nail	P.T. Southern Pine (SG=0.55)	5/16"	2.438
2-1/2" x .131" Common Nail	P.T. Southern Pine (SG=0.55)	3/8"	2.438
2-1/2" x .145" Roofing Nail	P.T. Southern Pine (SG=0.55)	3/8"	2.438
2-1/2" x .145" Roofing Nail	P.T. Southern Pine (SG=0.55)	3/8"	2.438
#10 Steel Trusshead Screw or #12 Steel, 18-8 or 410 SS Screw	0.125" Aluminum, 6063-T5 min. 0.050" A36 Steel	1/2"	1.375
	0.045" (18 Ga) Steel Stud, Gr. 33 min.	5/16"	0.125
		5/16"	0.045

VERTICAL SECTION D-D

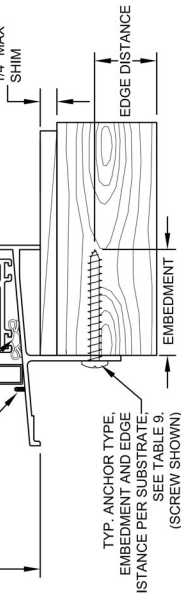

USE EITHER 1 SWEEP LATCH @ MIDSPAN OR 2 BOTTOM LOCKS

STANDARD SILL SHOWN. SEE PREVIOUS SHEET FOR OPTIONAL HI-RISE SILL.

1/4" MAX SHIM

EDGE DISTANCE

EMBEDMENT

TYP. ANCHOR TYPE, EMBEDMENT AND EDGE DISTANCE PER SUBSTRATE, SEE TABLE 9. (SCREW SHOWN)

EXTERIOR

1" WEEP NOTCH AT EACH END

SASH VISIBLE LIGHT HEIGHT

PRODUCT RENEWED
as complying with the Florida Building Code
NOA-No. 23-0707.10
Expiration Date 08/23/2028
By *Isang I. Llanza*
Miami-Dade Product Control

B) ADDED ANCHOR HEAD TYPES AND FLANGE FRAME NOTES.
LY - 06/06/23

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

Custom Windows and Doors
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

ALUMINUM SINGLE HUNG INSTALL (LM)
04/01/18

INTEGRAL FIN X-SECTION
JENS ROSOWSKI

7700NOA-LM
9 OF 11

ANTHONY LYNN MILLER
No. 58705
06/06/23
STATE OF FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

VISIBLE LIGHT FORMULAS:

(SHOWN FOR STANDARD SILL; SEE SHEETS 7 OR 8 FOR HI-RISE SILL)

WIDTH @ SASH & FIXED LITE: BUCK WIDTH - 4.12"

HEIGHT (EQUAL-LITE) BUCK HEIGHT/2 - 3.23"

HEIGHT (PROVIEW) @FIXED LITE: BUCK HEIGHT/2 + 4.28"


@SASH: BUCK HEIGHT/2 - 11.43"

HEIGHT (CUSTOM SASH) @FIXED LITE: BUCK HEIGHT - SASH HEIGHT - 2.55"

@SASH: SASH HEIGHT - 4.60"

NOTES:

- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 9. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE WINDOW.
- 2) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.
- 3) ALL ANCHOR HEAD TYPES ARE ACCEPTABLE.

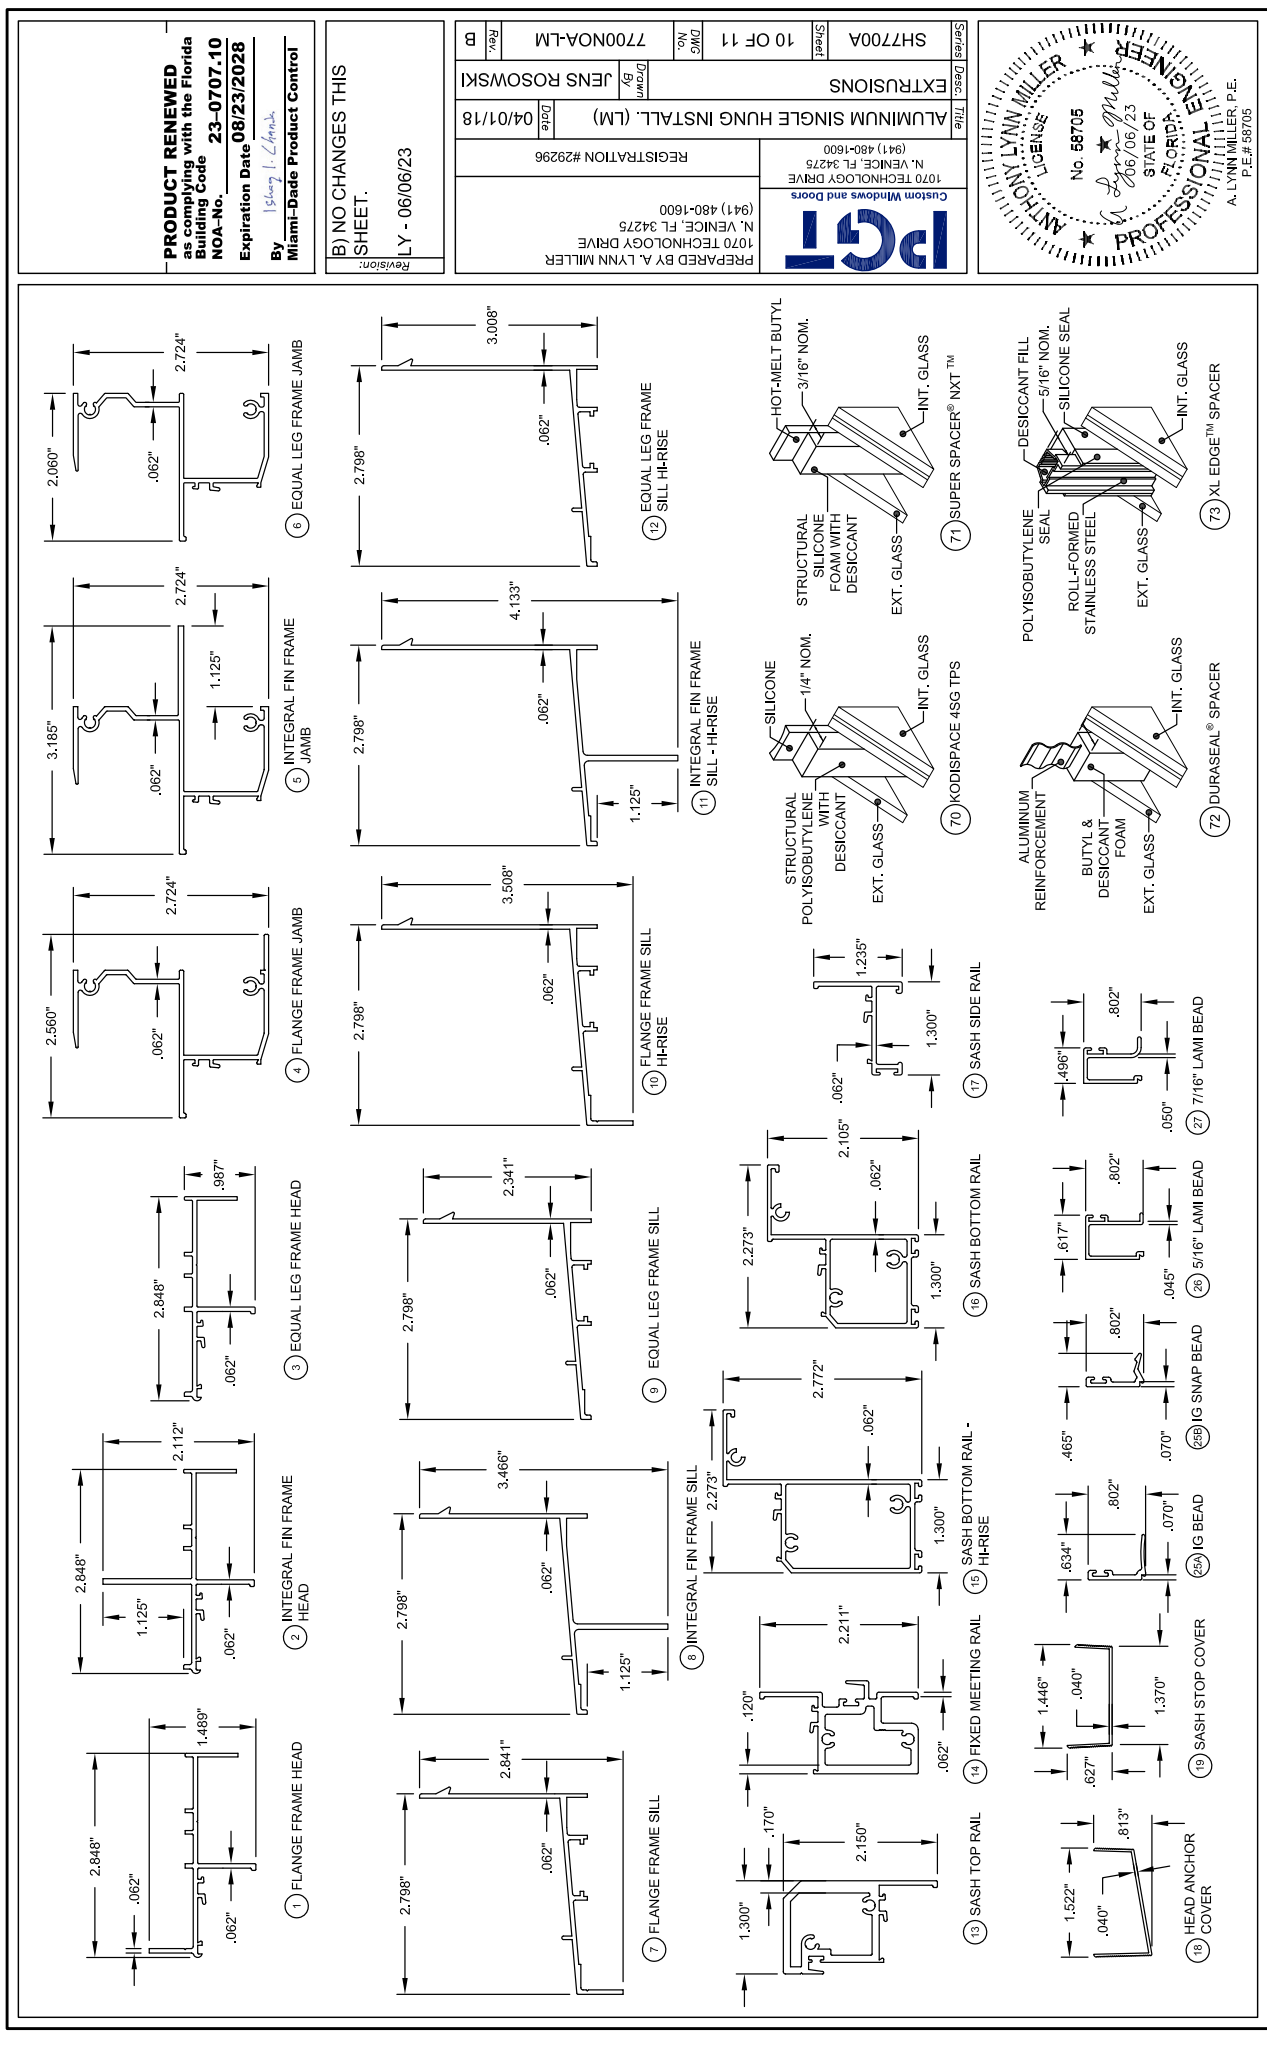

PRODUCT RENEWED
as complying with the Florida
Building Code **23-0707.10**
NOA-No. **08/23/2028**
By *Isang I. Llanza*
Miami-Dade Product Control

B) NO CHANGES THIS SHEET.
LY - 06/06/23
Revision:

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		CUSTOM WINDOWS AND DOORS 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296		Date 04/01/18		Title ALUMINUM SINGLE HUNG INSTALL (LM)		JENS ROSOWSKI		DWG No. 7700NOA-LM		Sheet 10 OF 11		Series SH7700A	
P&G		EXTRUSIONS		Rev. B													

ANTHONY LYNN MILLER
ENGINEER
No. 58705
06/06/23
STATE OF FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

SH7700A

TABLE 11:

Item #	PGT Part #	Description	Material
1	642001	Head, Flange	Alum. 6063-T6
2	624017	Head, Integral Fin	Alum. 6063-T6
3	624028	Head, Equal-leg	Alum. 6063-T6
4	624004	Jamb, Flange	Alum. 6063-T6
4A		Jamb, Flange (Used For Alternate Radius Top Head)	Alum. 6063-T52
5	624020	Jamb, Integral Fin	Alum. 6063-T6
5A		Jamb, Integral Fin (Used For Alternate Radius Top Head)	Alum. 6063-T52
6	624031	Jamb, Equal-leg	Alum. 6063-T6
6A		Jamb, Equal-leg (Used For Alternate Radius Top Head)	Alum. 6063-T52
7	624002	Sill, Flange	Alum. 6063-T6
8	624018	Sill, Integral Fin	Alum. 6063-T6
9	624029	Sill, Equal-leg	Alum. 6063-T6
10	624003	Sill, Hi-Rise, Flange	Alum. 6063-T6
11	624019	Sill, Hi-Rise, Integral Fin	Alum. 6063-T6
12	624030	Sill, Hi-Rise, Equal-leg	Alum. 6063-T6
13	624006	Sash Top Rail	Alum. 6005A-T61
14	624005	Fixed Meeting Rail	Alum. 6005A-T61
15	624012	Sash Bottom Rail - Hi-Rise	Alum. 6063-T6
16	624068	Sash Bottom Rail	Alum. 6063-T6
17	624007	Sash Side Rail	Alum. 6063-T6
18	624051	Head Anchor Cover	Alum. 6063-T6
19	624015	Sash Stop	Alum. 6063-T6
25A	624009	IG Bead	Alum. 6063-T5
25B	624011	IG Snap Bead	Alum. 6063-T6
26	624010	5/16" Lami Beading	Alum. 6063-T6
27	624026	7/16" Lami Beading	Alum. 6063-T6
30	61P247	Glazing Bead, Bulb Vinyl for #624009 & #624011	Vinyl
31	61P248	Glazing Bead, Bulb Vinyl for #624009 & #624011	Vinyl
32	724046	Sweep Latch (@ Top Rail)	Cast Zinc
33	624049	Bottom Latch (@ Sill)	Alum. 6063-T6
34		Setting Block (1/8" X 1/2" X 4")	Neoprene
35A		IG Setting Block (1/8" X 3/4" X 4")	Vinyl
35B	724014	Bottom Rail Weatherstrip Extension	Polyethylene
36	724044	Sash Top Rail Gasket	Polyethylene
37	724053	Sill Gasket	Polyethylene
38	724054	Sash Top Rail Gasket	Polyethylene
39	724055	Sash Bottom Rail Gasket	Polyethylene
40	724057	Head Gasket	Polyethylene
41	724063	Meeting Rail Gasket	Polyethylene
42	61226D	Sash Bottom Rail Bulb Vinyl	Polyethylene
43		Weatherstrip, .270" x .187", Fin Seal (@ MR)	
44	67S16G	Weatherstrip, .170" X .270", Fin Seal (@ Sash Side Rail)	
45	varies	Weatherstrip, .170" X .187", Fin Seal (@ Top Sash Rail)	
46		Balance with Cover & Trim	Rigid Vinyl
51	781PSGX	#8 X 1" PH SMS (Assembly)	Stainless Steel
55	7834AA	#8 X 3/4" PH, PN SMS (Balance)	Stainless Steel
63	-	Alum. Screen with Fiberglass Mesh	Varies
70	-	Kommerling Kodispacer 4SG IPS	See Sheet
71	-	Quanex Super Spacer nXT	10 for
72	-	Quanex DuraSeal Spacer	Materials
73	-	Cardinal XL Edge Spacer	
74	-	Dow 791, 899, 993 or GE 7700 Backbedding	Silicone

ASSEMBLY DETAILS FOR

FLANGE FRAMES

(OTHER FRAME TYPES SIMILAR).

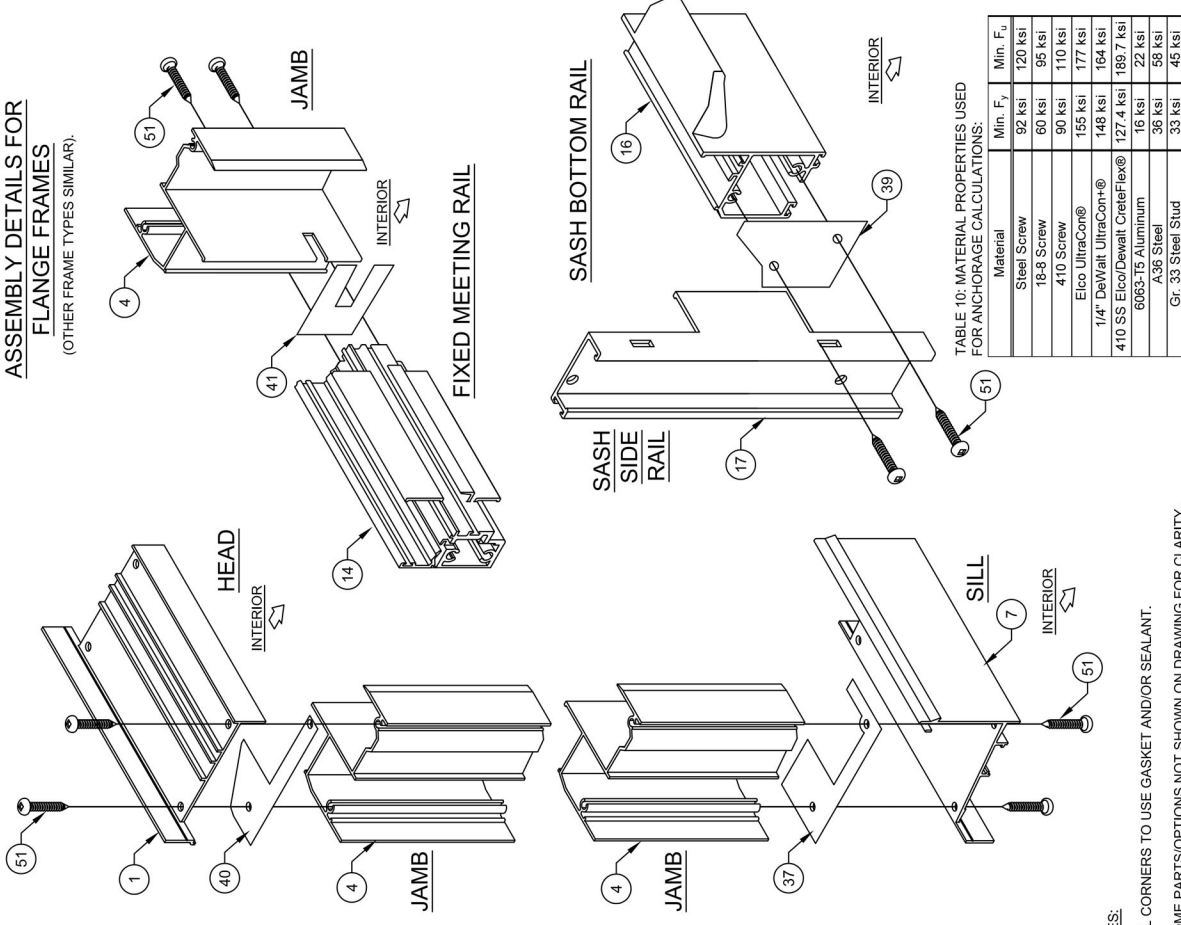


TABLE 10: MATERIAL PROPERTIES USED FOR ANCHORAGE CALCULATIONS:

Material	Min. F _y	Min. F _u
Steel Screw	92 ksi	120 ksi
18-8 Screw	60 ksi	95 ksi
410 Screw	16 ksi	22 ksi
Elco UltraCon®	155 ksi	177 ksi
1/4" DeWalt UltraCon+®	148 ksi	164 ksi
410 SS ElcoDeWalt CreteFlex®	127.4 ksi	189.7 ksi
6063-T6 Aluminum	16 ksi	22 ksi
A36 Steel	36 ksi	58 ksi
Gr. 33 Steel Stud	33 ksi	45 ksi

NOTES:

- 1) ALL CORNERS TO USE GASKET AND/OR SEALANT.
- 2) SOME PARTS/OPTIONS NOT SHOWN ON DRAWING FOR CLARITY.

PRODUCT RENEWED
as complying with the Florida
Building Code **23-0707.10**
NOA-No. **08/23/2028**
By **Isang I. Lhank**
Miami-Dade Product Control

**B) NO CHANGES THIS
SHEET.**

LY - 06/06/23

Revisions:

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
Custom Windows and Doors	
REGISTRATION #29296	
ALUMINUM SINGLE HUNG INSTALL (LM)	04/01/18
BOM & CORNER DETAILS	JENS ROSOWSKI
Sheet	11 OF 11
Drawn	7700NOA-LM
Scale	B

PGT

