

My Favorite Pool Builder

www.myfavoritepoolbuilder.com
steve@mfplb.com
CPC1459058

Cell 386-965-0066


Swimming Pool Specification For:
Alex Littman
401 SW Cook St
Lake City, FL. 32038
617-413-3886



Page 1	Title Page
Page 2	Deck and Equipment
Page 3	Pool Specifications
Page 4	Energy Efficiency Compliance Data/Wet Bond
Page 5	Site Plan information
Page 6	Site and Elevation Detail
Page 7	Survey and Dig Plan

1956 SW Main Blvd.
Lake City, FL. 32025

Toll – Fax 800-286-7929
Lake City 386-269-3307
Gainesville 382-519-3125
Jacksonville 904-248-4697
Valdosta, Ga. 229-469-9525
Tallahassee 850-296-3622

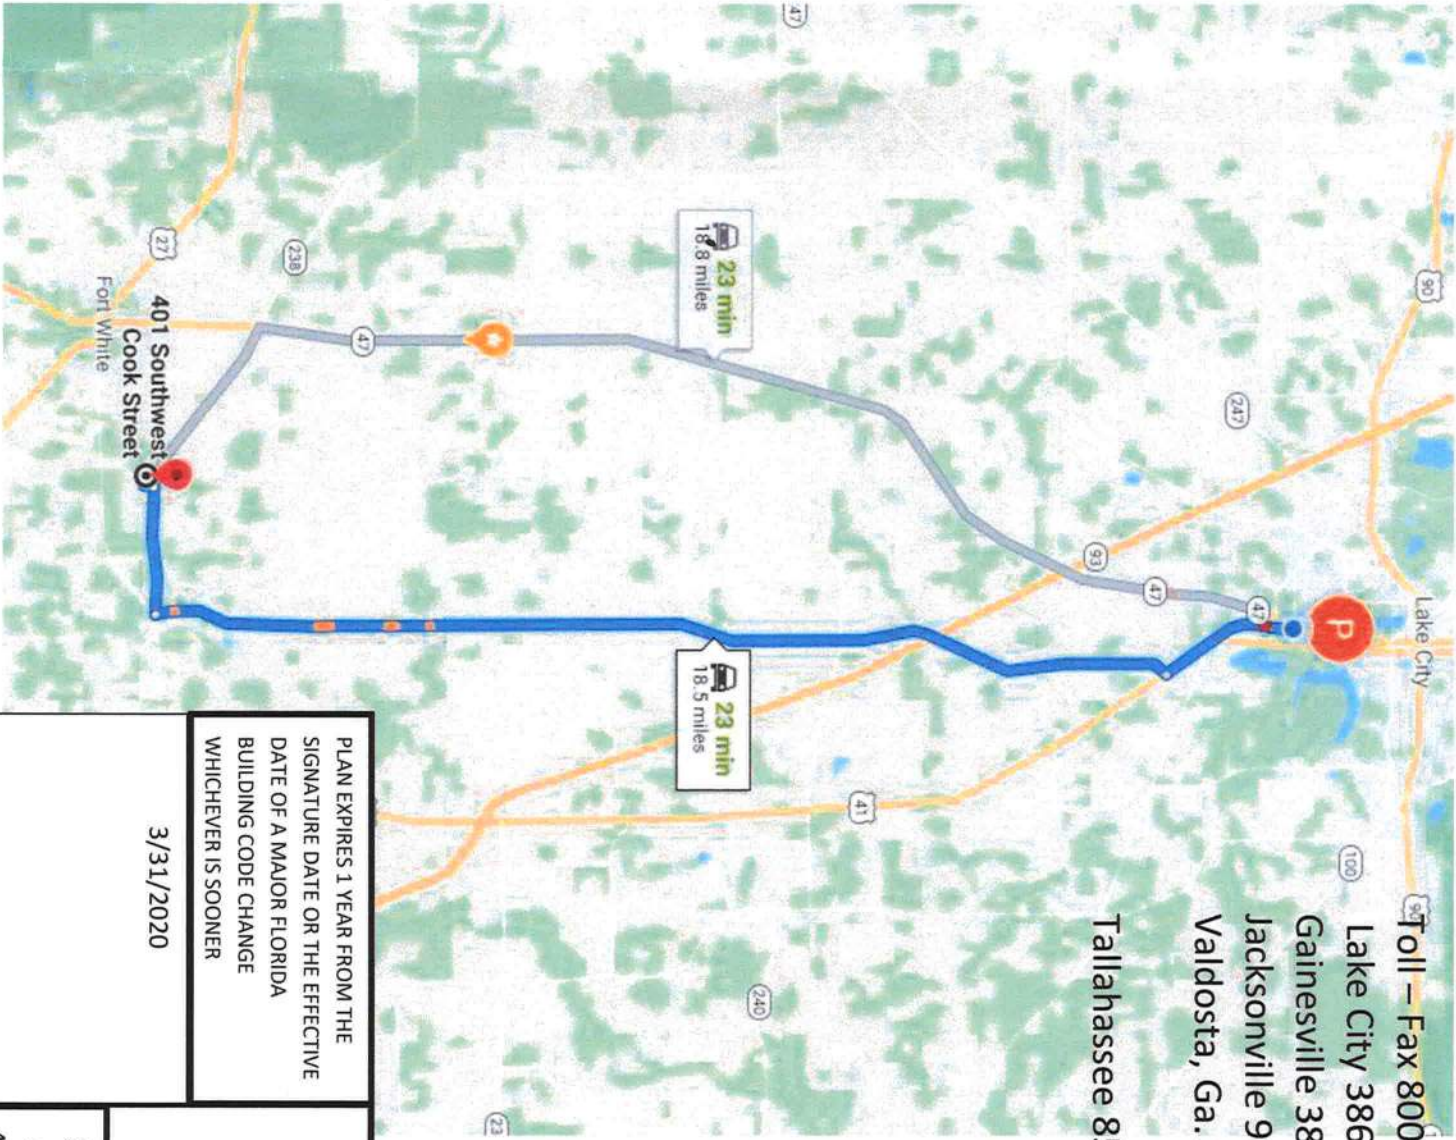

PLAN EXPIRES 1 YEAR FROM THE SIGNATURE DATE OR THE EFFECTIVE DATE OF A MAJOR FLORIDA BUILDING CODE CHANGE WHICHEVER IS SOONER	My Favorite Pool Builder, Inc. 1956 SW Main Blvd. Lake City, FL. 32025 (386) 269-3304 OF (386) 965-0066 Cell CPC1459058
---	--

3/31/2020	Swimming Pool Specification For: Alex Littman 401 SW Cook St Lake City, FL. 32038 617-413-3886
Scale: None Rev Page 1 of 7	

TURNDOWN NOTES

1. Detail is based on NO surcharge behind the Turndown and the Ground away from the Turndown is (>4 to 1). Turndown may about Ribbon Footer and be tied into Footer if Appropriate, with #3 Rebar (24" Min Lap).
2. Turndown shall bear on rock, clean sand or structurally sound soils (1,500 psi) that shall be compacted to provide optimum bearing capacity and prevent settling or shifting
3. All Reinforcing steel is to conform to ASTM 615, Grade 40.
4. Concrete shall contain Fiber mesh and have a 28 day compressive strength of 2,500 PSI.
5. POOL SHALL CONFORM TO REQUIREMENTS OF ISPSC 2015 AND FLORIDA BUILDING CODE, 6TH EDITION, 2017 (FBC) ACCESSIBILITY, FBC BUILDING, FBC RESIDENTIAL, AND ANSI/APSP/ICC-3, ANSI/APSP/ICC-4, ANSI/APSP/ICC-5, ANSI/APSP/ICC-6 AND ANSI/APSP-7, ANSI/APSP-15, AND THE ADOPTED NATIONAL ELECTRIC CODE 2014 (NEC) AND CHAPTER 42 AND CHAPTER 45 OF THE 6TH EDITION OF THE FBC, 2017, RESIDENTIAL.
6. Refer to Contractor's Plan on file with the building department for details on Turn down location.
7. If the base of the turndown does not extend into the old (existing) ground, a 4" Ø plaster will be required every 5' 0" that will be either 2' 0" into the ground or to 6" into the indigenous material, whichever is deeper. The plaster will have a #3 rebar tied to a #5 rebar in the base of the vertical pour.
8. A deck turndown is not intended to be substitute for a retaining wall. If the vertical dimension from the top of the concrete deck to the old (existing) ground reaches 42" for a 12" turndown, for more than 20% of the turndown length or the finished grade slope exceeds (steeper than) 4' horizontally and 1' vertically (1 in 4), a turndown shall not be used.
9. For a paver deck, if the vertical dimension from the top of the deck to the old (existing) ground reaches 30.0" for a 12" turndown, 36.0" for a 18" turndown, for more than 20% of the turndown length or the finished grade slope exceeds (steeper than) 4' horizontally and 1' vertically (1 in 4), a turndown shall not be used.

Footer Notes

1. If a screen enclosure is to be installed, the swimming pool contractor must coordinate the design and construction of any required footer with the screen contractor. Specific details for the footer to be provided by the screen enclosure engineer.
2. Footer shall bear on rock, clean sand or structurally sound soils (1,500 psi) that shall be compacted to provide optimum bearing capacity and prevent settling or shifting
3. Concrete shall contain Fiber mesh and have a 28 day compressive strength of 2,500 PSI.
4. (3) #3 Rebars is equivalent to (1) #5 rebar.
5. #3 - #4 - #5 Rebar lap Minimum lap is 24 inches
6. A footer must be installed with brick paver pool deck if required by the Jurisdiction or the option of the contractor and may be placed over the top Of the footer or abutting the side of the footer.

Pump

Pentair 011018 IntelliFlo 3HP Variable Speed Pool Pump 2" Self-Priming
230 volt Phase 1 16 amp with timer
With Dynamic Head 50
750 RPM-GPM Up to 40 Turn over at this speed 4.16 Hours
2,350 RPM-GPM Up to 140 Turn Over at this speed 1.19 Hours

Filter

Pentair Sand Dollar Filters



Tank Diameter	Filter Area Sq. Ft.	Lbs. of Sand Required	Max Working Pressure (Psi)	Vol. Clearance Required	Design Flow Rate GPM	Max Water Temp
16"	1.40	100	30	45"	35	95°F
19"	1.92	150	35	49"	40	95°F
22"	2.64	250	40	55"	60	95°F
24"	3.15	300	50	58"	70	95°F
26"	3.69	350	50	60"	75	95°F

Pentair Clean and Clear

Residential Maximum Cartridge Flow Rates				Commercial Maximum Cartridge Flow Rates			
Product #	sq. ft.	GPM	GPH	6 hour	8 hour	GPM	GPH
160314	50	50	3,000	18,000	24,000	19	1,140
160315	75	75	4,500	27,000	36,000	28	1,680
160316	100	100	6,000	36,000	48,000	38	2,280
160317	150	150	9,000	54,000	72,000	56	3,360
160318	200	150	9,000	54,000	72,000	75	4,500


(1) One GPM per sq. ft. shown, recommended flow rate for residential is .5 GPM per sq. ft.
(2) Commercial flow rate is a maximum of .375 GPM per sq. ft. of filter area.
NOTE: Actual system flow will depend on plumbing size and other system components.

FILTER SYSTEM

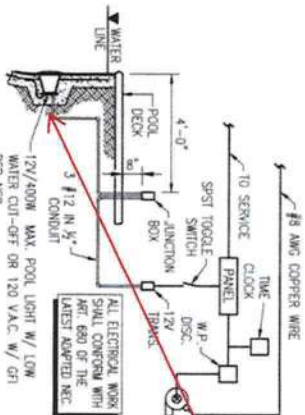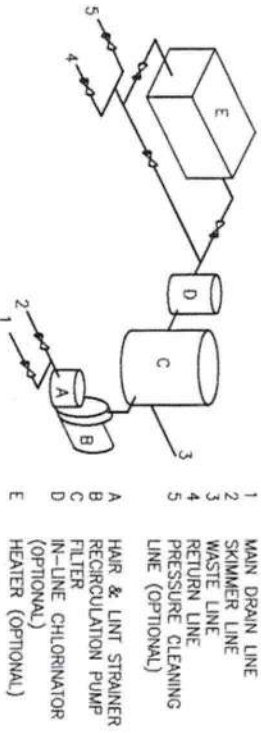


ELECTRICAL DIAGRAM

Light for pool is 12 – Volt LED Color powered by transformer

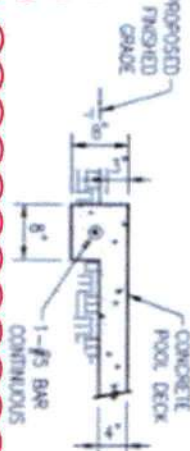


NO FOOTER

FNS® Plus Vertical Grid Filters
FILTER PRESSURE LOSS
FNS-Plus SERIES

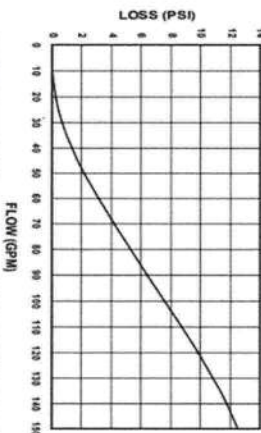


sq.ft.	Height	GPM	GPH	6 hour	8 hour
48	49"	120	7,200	43,200	57,600
60	55"	150	9,000	54,000	72,000

CONCRETE DECK TURNDOWN

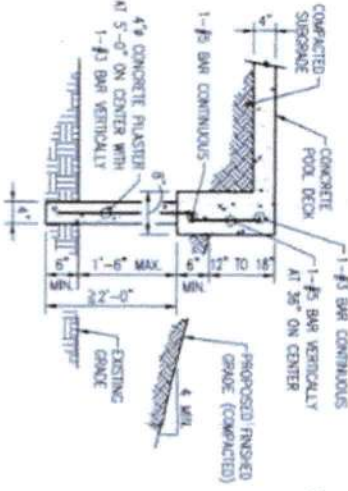

8" x 8" FOOTER
W/ PAVER DECK

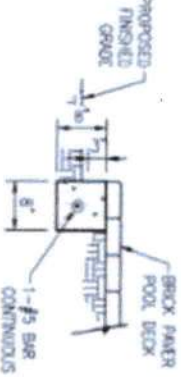

PLAN EXPIRES 1 YEAR FROM THE SIGNATURE DATE OR THE EFFECTIVE DATE OF A MAJOR FLORIDA BUILDING CODE CHANGE WHICHEVER IS SOONER

3/31/2020

Digitally signed by John A Duranko DN: c=US, ou=Unaffiliated, ou=A01410C0000 01710D3828DC00 0151112, cn=John A Duranko Date: 2020.04.01 14:39:45 -0400'



My Favorite Pool Builder, Inc.
1956 SW Main Blvd.
Lake City, FL. 32025
(386) 269-3304 OF
(386) 965-0066 Cell
CPC1459058

Swimming Pool Specification For:
Alex Littman
401 SW Cook St
Lake City, FL. 32038
617-413-3886

Scale: None Rev
Page 2 of 7

2015 ISPSC – SWIMMING POOL CODE ANALYSIS
CHAPTER 8 - PERMANENT IN-GROUND RESIDENTIAL SWIMMING POOL

802.1 MATERIALS OF COMPONENTS AND ACCESSORIES
swimming pool materials shall be suitable for the environment in which they are installed and shall be compatible fulfilling the design, installation and intended use requirement in the International Residential Code (IRC)

The subject pools are compound of fiberglass shells meeting the requirements. See "FIBERGLASS SHELL REQUIREMENTS"

80 2.2 STRUCTURAL DESIGN
The structural design and materials shall be in accordance with the IRC.

The subject pools meet or exceed all loads prescribed and IRC section 301. All Pool installations in flood Hazard A or V zones (as noted in IRC section 322) require additional hold - down features to be designed in a case-by-case basis.

803.1 CONSTRUCTION TOLERANCES
The construction tolerances for dimension for the overall length width and depth of the pool shall be +/- 3 inches. The construction tolerance is for all other dimension shall be +/- 2 inches, unless otherwise specified by the design engineer.

The subject pool meets the noted construction tolerances. Field installation tolerance should be verified during field inspections.

804 Diving Water Envelopes
N/A The subject pools are non-diving.

805 Walls
Walls in the shallow area and deep areas of the pool should have a wall-to-floor transition point that is less than 33 inches below the design water line. Above the transition point, the wall shall be within 11 degrees of vertical

The subject pools have a wall-to-floor transition 41" below the design waterline and the walls are within 6 degrees of vertical.

806.1 OFFSET LEDGES - MAXIMUM WIDTH
Offset ledges shall be not greater than 8 inches in width.

The subject pools have offset ledges equal to 3 ½".

807.1 POOL FLOOR SLOPES

Floor Slopes shall be in accordance with Section 807.1.1 through 807.1.3.

The subject pools have a single 1 unit vertical to 14 unit horizontal slope either meeting or making all the subjects requirements N/A.

807.2 SHALLOW END WATER DEPTHS

The design water depth as measured at the shallowest point in the shallow area shall be not less than 33 inches and not greater than 4 feet. Shallow area designed in accordance with Section 809.6, 809.7, and 809.8 shall be exempt from the minimum depth requirement.

The subject pools have a minimum depth of 3'- 8" (44")

808 DIVING EQUIPMENT

N/A The subject pools are non-diving.

809 SPECIAL FEATURES

809.1 SLIDES

N/A The subject pools do not include integral slides.

809.2 ENTRY AND EXIT

Pool shall have a means of entry and exit in all shallow areas where the design water depth of the shallow area at the shallowest point exceed 24 inches at the shallowest point. Entries and exits shall consist of one or a combination of the following: steps, stairs, ladders, Treads, ramps, Beach entries, underwater seats, benches, swim out and other prove designs. The means of entry and exit shall be located on the shallow side of the first slope change. -

809.2 Cont -

The subject pools have at least one stair at the shallow end of the pool.

809.3 SECONDARY ENTRIES AND EXITS

Where water depth in the Deep area the pool exceeds 5 feet, a means of entry and exit shall be provided in the deep area of the pool.

The subject pools have an underwater seat in the deep end.

809.4 OVER 30 FEET WIDTH

N/A The subject pools are not in excess of 30' in width.

809.5.1 TREAD DIMENSION AND AREA

Treads shall have a minimum of unobstructed horizontal death of 10 inches and a minimum unstructured surface area of 204 square inches.

N/A The subject pools have a minimum of unobstructed horizontal death of 10 inches and a minimum unstructured surface area of 240 square inches.

809.5.2 RISER HEIGHTS

Risers, other than the top and bottom riser shall have a uniform height of not greater than 12 inches (305 mm). The top riser height shall be any dimension not exceeding 12 inches (305 mm). The bottom riser height shall be any dimension not exceeding 12 inches (305 mm). The top and bottom riser heights shall not be required to be equal to each other or equal to the uniform riser height. Riser heights shall be measured at the horizontal centerline of the stairs.

The subject pools have a typical riser height of 12" and top risers of 8".

809.5.3 ADDITIONAL STEPS

In design water depths exceeding 48 inches, additional steps shall not be required.

The subject pools meet this requirement.

809.6 BEACH AND SLOPING ENTRIES

N/A The subject pools do not include beach and sloping entries.

809.7 STEPS AND SLOPING ENTRIES

N/A The subject pools do not include step and sloping entries.

809.8 Architectural Features

N/A The subject pools do not include architectural features.

809.9 MAXIMUM DEPTH

The horizontal surface of the underwater seats, benches and swimouts shall be no greater than 20 inches (508 mm) below the design waterline.

N/A The subject pools meets this criteria.

810.1 TURNOVER RATE

The circulation system equipment shall be sized to provide a turnover of the pool water not less than once every 12 hours. The system shall be designed to provide the required turnover rate based upon the manufacturer's specified flow rate of the filter, with clean media condition of the filter.

The subject pools provide a turnover of the pool water not less than once every 12 hours.


810.2 STRAINER REQUIRED

Pressure filter system shall be provided with a strainer located between the pool and the circulation pump.

The subject pools provides a strainer located between the pool and the circulation pump.

811.1 ROPE AND FLOAT

The subject pools do not have a break in the floor slope.

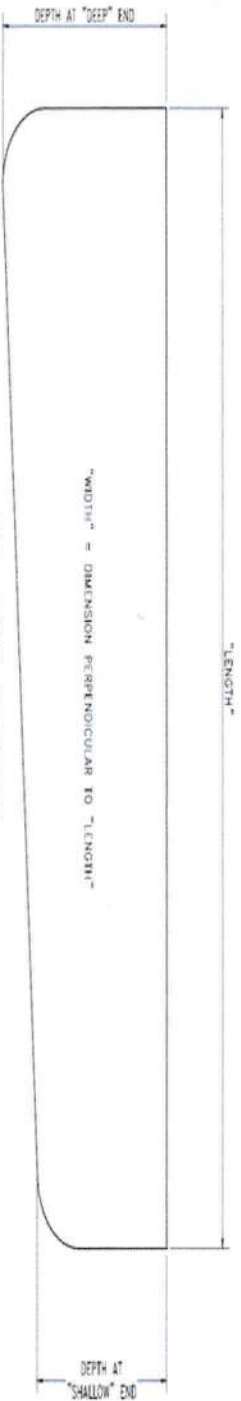

NOTES:

1. THE FIBERGLASS POOL SHELL BE MANUFACTURED BY BARRIER REEF POOLS & INSTALLED BY QUALIFIED & LICENSED POOL CONTRACTOR. THE POOL SHALL BE INSTALLED PER THE "BARRIER REEF INSTALLATION MANUAL," P 2015 AND
2. POOL SHALL CONFORM TO REQUIREMENTS OF ISPSC 2015 AND FLORIDA BUILDING CODE, 6TH EDITION, 2017 (FBC) ACCESSIBILITY, FBC BUILDING: FBC RESIDENTIAL, AND ANSI/APSP/ICC-3, ANSI/APSP/ICC-4, ANSI/APSP/ICC-5, ANSI/APSP/ICC-6 AND ANSI/APSP-7, ANSI/APSP-15, AND THE ADOPTED NATIONAL ELECTRIC CODE 2014 (NEC) AND CHAPTER 42 AND CHAPTER 45 OF THE 6TH EDITION OF THE FBC, 2017, RESIDENTIAL.
3. THE POOL SHELL MAY BE DAMAGED IF THE POOL WATER IS DROPPED BELOW NORMAL OPERATING LEVEL. CONSULT THE MANUFACTURER PRIOR TO EMPTYING THE POOL.
4. POOL SHALL BE BACKFILLED WITH GRANULAR BACKFILL WITH 100% PASSING THE 1" SIEVE AND A MAXIMUM OF 10% PASSING THE #200 SIEVE. BED SHALL BE PLACED ON UNDISTURBED SOIL WITH A MINIMUM BEARING CAPACITY OF 1,500 PSF. WALLS SHALL BE BACKFILLED WITH GRANULAR BACKFILL WITH 100% PASSING THE 1 ½" SIEVE AND A MAXIMUM OF 10% PASSING THE #200 SIEVE. BACKFILL SHALL BE INSTALLED IN 1 FT LIFTS.
5. STEPS AND LADDERS SHALL BE PROVIDED PER CODE. INSTALLATION CONTRACTOR SHALL PROVIDE POOL DECK & POOL BARRIERS AS REQUIRED BY LOCAL CODE. ALL REINFORCING STEEL SHALL HAVE A MINIMUM YIELD STRENGTH OF 60,000 PSI & SHALL BE BONDED TO THE GROUNDING GRID WITH APPROVED UL LISTED CONNECTOR & #8 SOILED COPPER WIRE.
6. CONCRETE SHALL BE MIN. 3,000 PSI AT 28 DAYS.
- 7.
- 8.
- 9.

BARRIER REEF POOLS				
Pool Name	Length	Width	Gallons	X
Atlantic 4 (29)	29'	12'	11,200	
Atlantic 5 (25)	25'	11'8"	8,600	
Coral Sea 1 (40)	40'	15'2"	19,200	
Coral Sea 2 (35)	35'	15'2"	16,000	
Coral Sea 2 Lounger (35)	35'	15'2"	15,800	
Coral Sea 3 (31)	31'2"	15'2"	13,700	
Coral Sea 3 Lounger (31)	31'2"	15'2"	13,400	
Crispin	16'6"	10'	3,100	
Daydream (40)	40'	14'1"	15,400	
Daydream (33)	33'	14'1"	12,200	
Grande 1 (35)	35' 1"	13' 9"	16,200	
Grande 2 (29)	29'	13' 9"	12,200	
Grande 4 (23)	23'	11' 8"	7,400	
Milano	23'	11'	5,500	
Opal	21'2"	11'4"	5,000	
Outback 1 (30)	30'	11'3"	9,800	
Outback 1 Lounger (30)	30'	11'3"	7,300	
Outback 2 (23)	23'	11'3"	7,300	
Outback Dundee	30'	14'	12,400	
Outback Dundee Lounger	30'	14'	12,200	
Outback Escape	17'	8'6"	3,400	
Oyster 1 (30)	30'	14'9"	11,000	
Oyster 2 (27)	27'	13'7"	8,600	
Pacific 1 (38)	37'9"	14'1"	15,800	
Pacific 2.5 (34)	33'9"	14'1"	15,800	
Southport 1 (33)	33'5"	14'1"	14,500	
Southport 2 (28)	28'	14'1"	11,500	
Southport 2 (25)	25'	14'4"	11,800	
Whitsunday Deep (40)	40'	15'8"	23,200	
Whitsunday 1 (40)	40'	15'8"	22,000	
Whitsunday 2 (35)	35'	15'8"	18,000	
Whitsunday 2 Lounger (35)	35'	15'8"	17,800	
Whitsunday 3 (31)	31'2"	15'8"	15,000	
Whitsunday Lounger 3 (31)	31'2"	15'8"	14,700	

PLAN EXPIRES 1 YEAR FROM THE SIGNATURE DATE OR THE EFFECTIVE DATE OF A MAJOR FLORIDA BUILDING CODE CHANGE WHICHEVER IS SOONER

3/31/2020

Digitally signed

by John A

Duranko

DN: c=US,

o=Unaffiliated,

ou=A01410C0000

01710D3828DC00

015112, cn=John

A Duranko

Date: 2020.04.01

14:40:13 -04'00'

My Favorite Pool Builder, Inc.

1956 SW Main Blvd.

Lake City, FL. 32025

(386) 269-3304 OF

(386) 965-0066 Cell

CPC1459058

Swimming Pool Specification For:

Alex Litman

401 SW Cook St

Lake City, FL. 32038

617-413-3886

Scale: None Rev


Page 3 of 7

Swimming Pool Energy Efficiency Compliance Information
NOTE: These Requirements Apply ONLT to Filtration Pumps
ANSI/APSP/ICC-15 2011

Flow Calculations
Pool water volume **13,000** ÷ 360 = **36** GPM - this is the calculated flow rate
NOTE: for pools under 13,000 gals. The calculated flow rate or 36 gpm whichever is greater = filtration flow rate
Is there an Auxiliary load on the filter? ☐ Yes ☒ NO
If so what is the calculated auxiliary flow rate _____ gpm

Velocity - Feet Per Second			
Pipe Size	6 FPS	8 FPS	10 FPS
1.5"	37 gpm	0.08'	50 gpm
2"	62 gpm	0.06'	82 gpm
2.5"	88 gpm	0.05'	117 gpm
3"	136 gpm	0.04'	181 gpm
4"	234 gpm	0.03'	313 gpm
6"	534 gpm	0.02'	712 gpm

SECTION IV. TECHNICAL DATA (cont'd.)
B.F.N.S. PULSIFLOW RATES

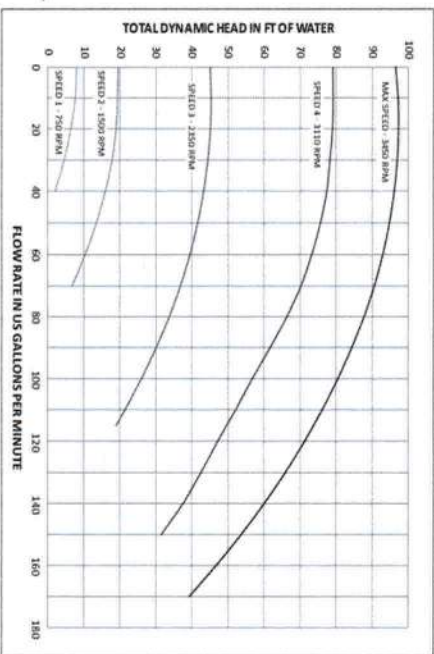

Flow rate (low speed) **40** gpm @ **1.5** in. **750** rpm.
Minimum suction side pipe size @ 6 fps **1.5** in.
Minimum return side branch pipe size @ 8 fps **1.5** in.

Determine Filter Size:
Filter Factors (GPM/SF): _____
Filter Size: **36** (Flow rate) **0** Cartridge (0.375) **0** DE (2.0) **2** Sand (15)
(Filter Fact) (Filter Size)

Pump Controls
Filtration pump has no auxiliary load - standard time clock ☒
Filtration pump with auxiliary load - Control model for low speed default within 24 hr. ☐
Filtration pump with auxiliary load - Control model for low speed default within 24 hr. ☐
Programable controller ☒

Pump Model **Pentair 3hp IntelliFlow VSF**
Heater Model **Pentair 400K Propane Heater**
Gas Heater efficiency rating _____ (No Pilot Light)
Heat Pump efficiency C.O.P. _____

ANSI 5 & ANSI 7 Compliance Work Sheet

Determine Simplified TDH:
1. Distance from pool to pump in feet: **120** Pipe size suction _____ 2in
2. Friction loss (in suction pipe) in (6) **2** Inch pipe per 1 ft. @ **0.06** GPM = **0.12** (from pipe flow/friction loss chart)
3. Friction loss (in return pipe) in (8) **2** Inch pipe per 1 ft. @ **0.10** GPM = **0.2** (from pipe flow/friction loss chart)

Date **3/31/2020**

(Signature)
Digitally signed by Steve Gartin
DN: cn=Steve Gartin, o=APSP,
ou=ANSI 5 & 7 Compliance Work Sheet,
email=steve.gartin@ansi-5and7.com, c=US
Date: 2020.04.01 14:54:32 -0400

Contr. # **CPC1459058**

Contractors Cert # _____

386-965-0066

Contractors Tele# _____

Owner Name **Alex Littman**

401 SW Cook St

Lake City, FL 32038

Address _____



Scale None

TDH in Piping **38.4**

Filter/Heater loss in TDH **Above**

All other losses **7**

Total Dynamic Head (TDH) **45.4**

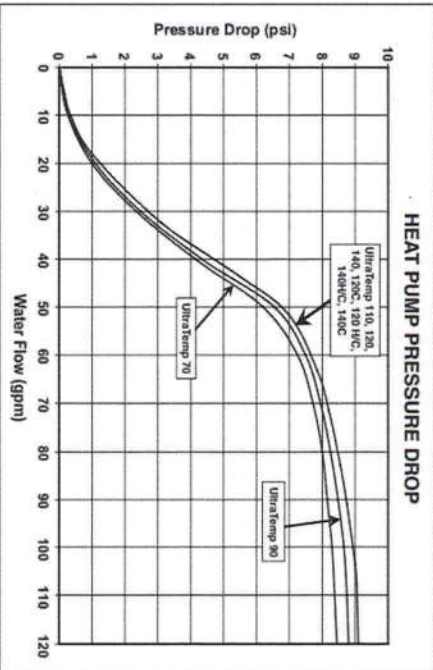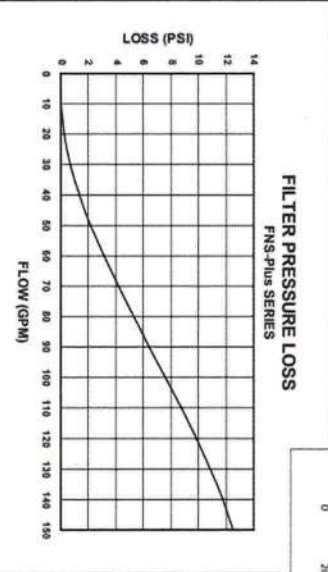

PoolBond PB-2008 Water Bonding Fitting
Follow these Important Safety Instructions

Step 1 Components
UL LISTED 40VZ
A. PoolBond Casting, Part Number PB-2008 with 1" NPT Pipe Thread.
B. Split Bolt Connector, UL rated for Direct Burial.
C. Solid #8 Copper wire, not supplied.

Step 2 Fitting Orientation
● Install in Pool Plumbing using a Plumbing Tee.
● Always install the PoolBond Tee with the fitting in horizontal or vertically down orientation to avoid trapped air in pool plumbing.



Step 3 Where to Install

Installed near Pool Equipment — OR — Installed at Return Fitting
● Install on In-ground & Above Ground Pools, Spas, Tubs, & Fountains.
● DO NOT bury the PoolBond fitting, it should be accessible for periodic inspection. A sprinkler valve box provides good access.
● IMPORTANT - Install PoolBond fitting at least 3" below water level to assure the fitting is contained in the pool water even when equipment is shut down.



Step 4 Installing PoolBond
● First, install the male threaded fitting in the threaded tee (dry fit) until the fitting just starts to tighten on the threaded tee. Count the number of turns it takes to start tightening. Then, install the PoolBond fitting on the threaded tee. Use the same number of turns to tighten the fitting. Do not use Teflon Tape.
● Apply Thread Sealant: Use Plumber Pipe Dope or Teflon Paste, do not use Teflon Tape.
● Reassemble the two parts using the number of turns recorded in the first step and tighten two more turns. Do not over-tighten to avoid damaging plastic pipe.





PLAN EXPIRES 1 YEAR FROM THE SIGNATURE DATE OR THE EFFECTIVE DATE OF A MAJOR FLORIDA BUILDING CODE CHANGE WHICHEVER IS SOONER

My Favorite Pool Builder, Inc.
1956 SW Main Blvd.
Lake City, FL 32025
(386) 269-3304 OF
CPC1459058



Swimming Pool Specification For:
Alex Littman
401 SW Cook St
Lake City, FL 32038
617-413-3886

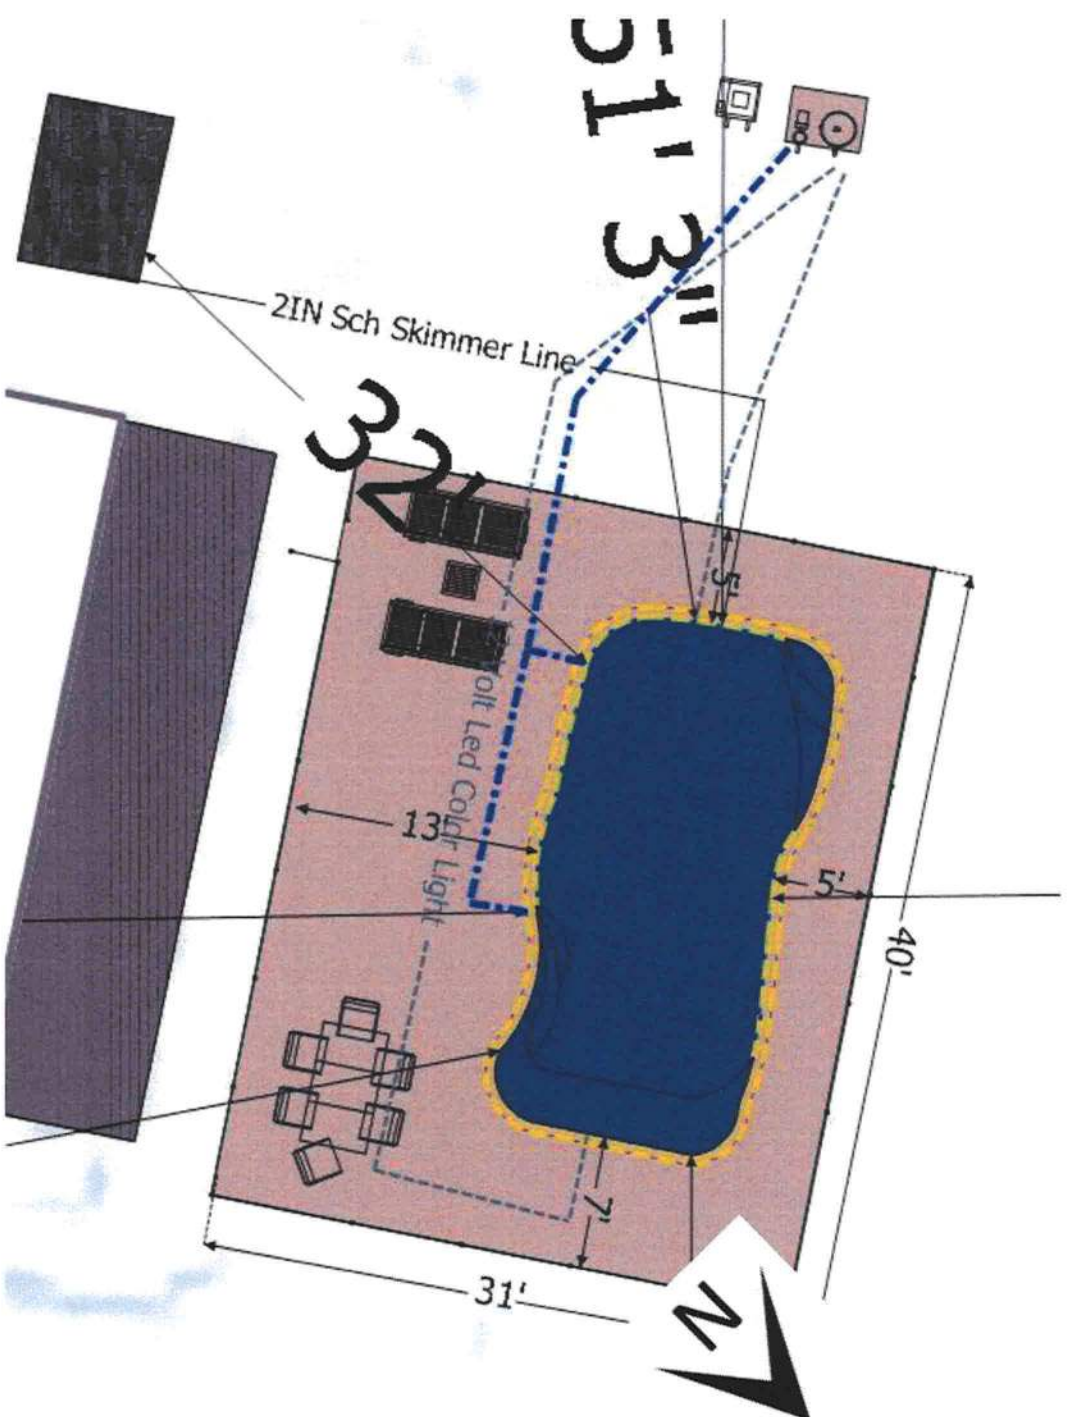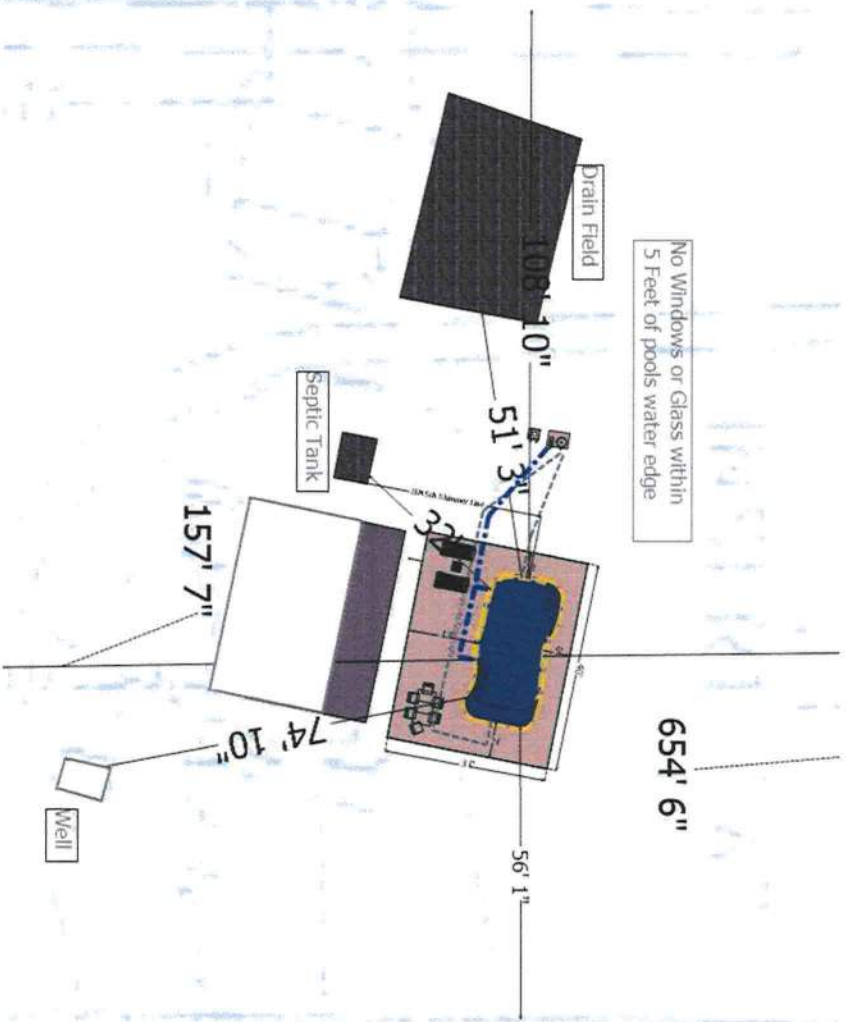

PLAN EXPIRES 1 YEAR FROM THE SIGNATURE DATE OR THE EFFECTIVE DATE OF A MAJOR FLORIDA BUILDING CODE CHANGE WHICHEVER IS SOONER		My Favorite Pool Builder, Inc. 1956 SW Main Blvd. Lake City, FL. 32025 (386) 269-3304 OF CPC1459058	
3/31/2020		Swimming Pool Specification For: Alex Littman 401 SW Cook St Lake City, FL. 32038 617-413-3886	
Scale: None		Rev Page 5 of 7	

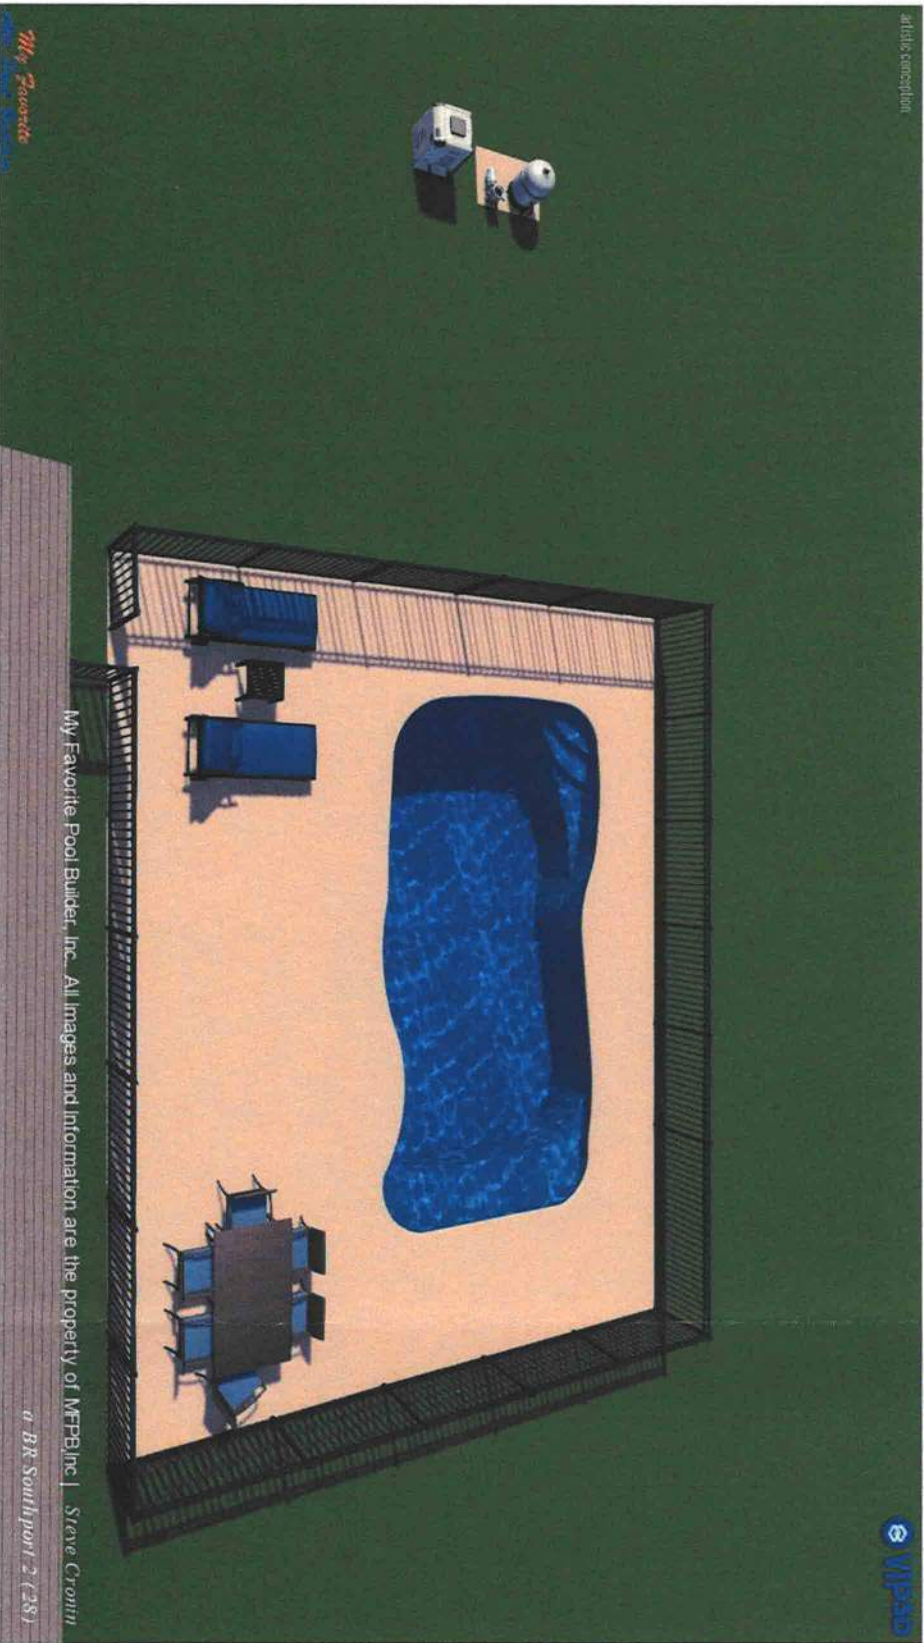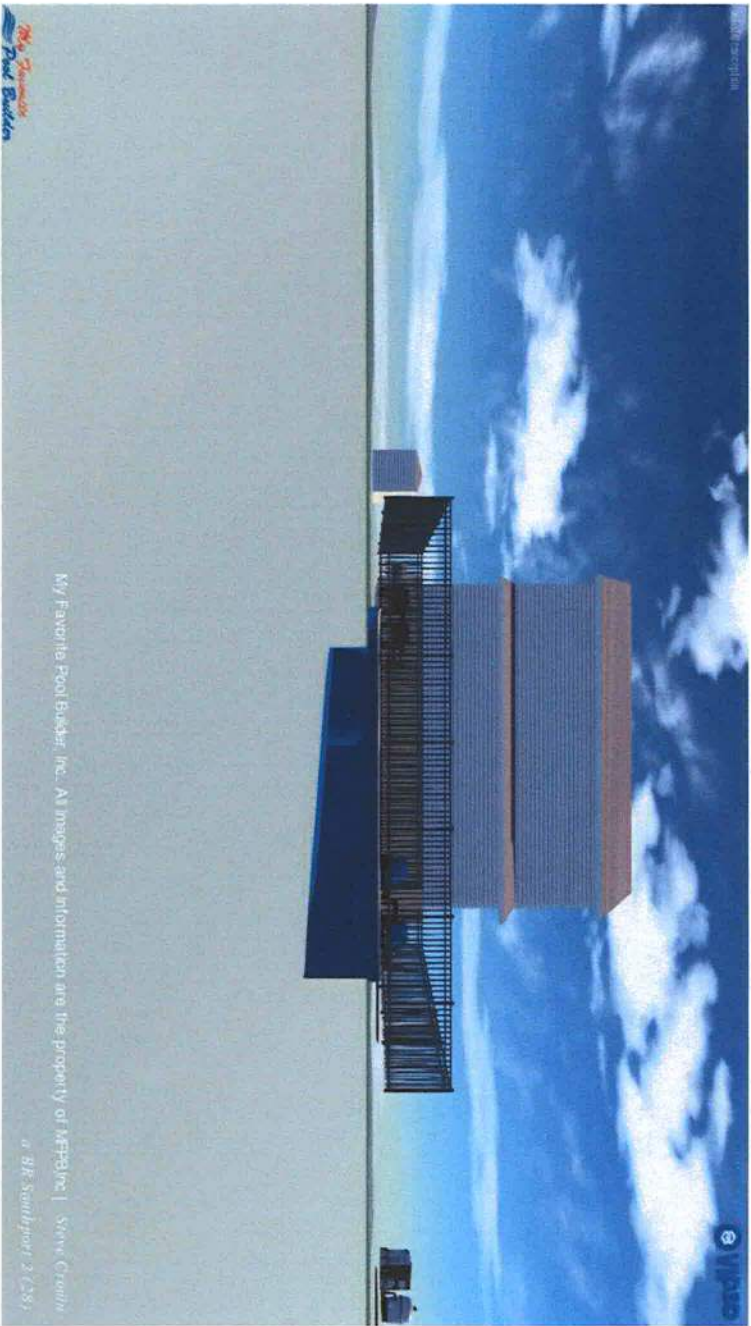

My Favorite Pool Builder, Inc. 1956 SW Main Blvd. Lake City, FL. 32025 (386) 269-3304 OF CPC1459058	
Swimming Pool Specification For: Alex Littman 401 SW Cook St Lake City, FL. 32038 617-413-3886	
PLAN EXPIRES 1 YEAR FROM THE SIGNATURE DATE OR THE EFFECTIVE DATE OF A MAJOR FLORIDA BUILDING CODE CHANGE WHICHEVER IS SOONER	3/31/2020
Scale: None Rev Page 6 of 7	

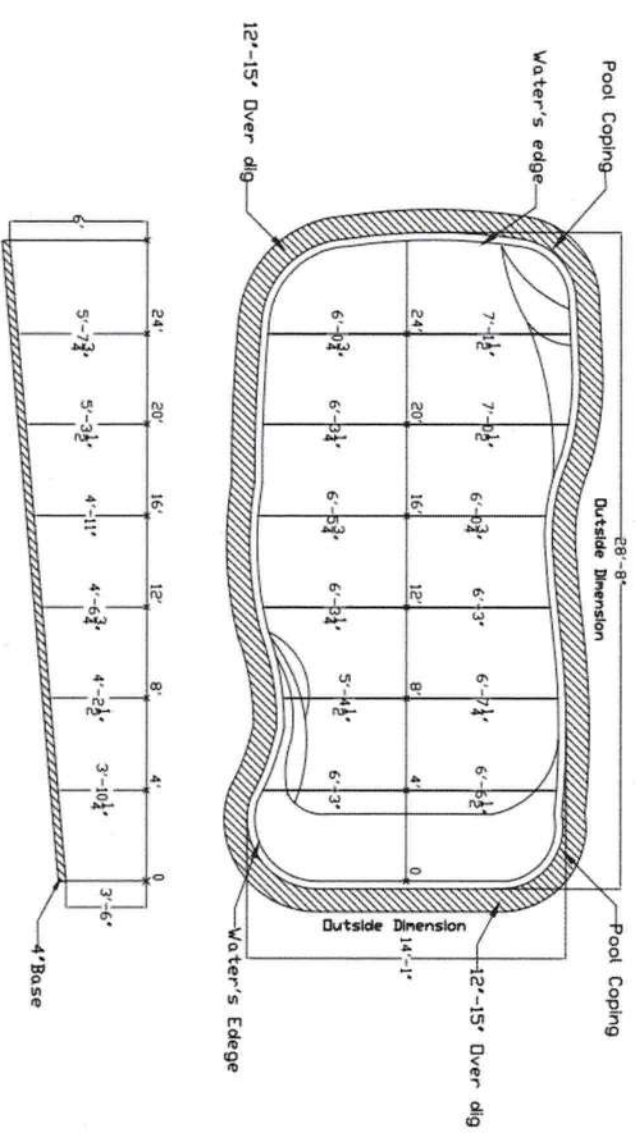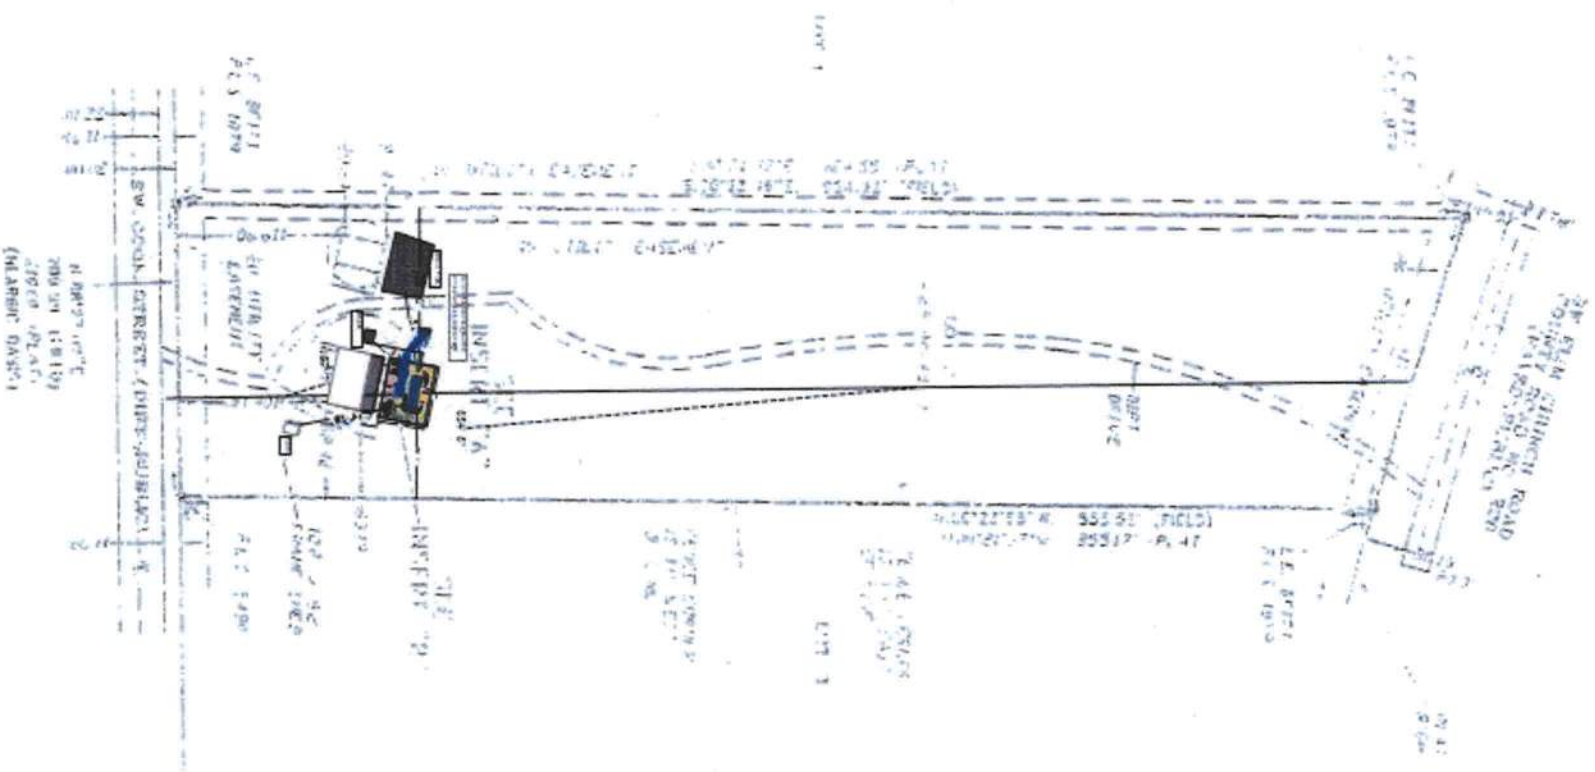

All measurements to water's edge. Add 1' over dig.

BARRIER REEF POOLS USA				
Southport 2 DIG PLAN				
SCALE: NTS	Rev. 1-A	Date:1/27/12	13000 Gallons approx	2500 lbs approx
			349 Sq Ft.	Perimeter=77'-7"

My Favorite Pool Builder, Inc.
1956 SW Main Blvd.
Lake City, FL 32025
(386) 269-3304 OF
CPC1459058

3/31/2020	Swimming Pool Specification Fo
Alex Littman	
401 SW Cook St	
Lake City, FL 32038	
617-413-3886	
Scale: None Rev	
Page 7 of 7	