BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

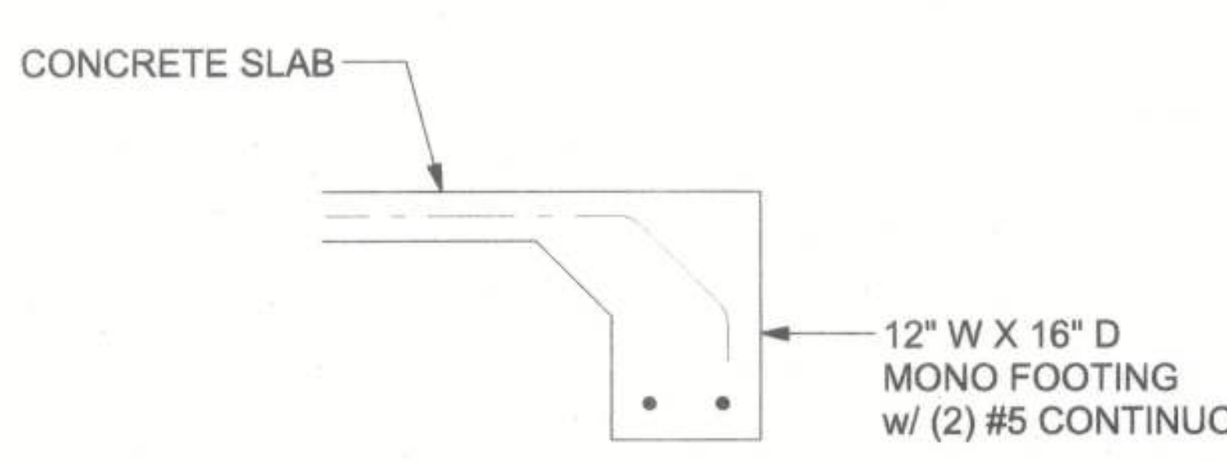

F1 / S-2 MONOLITHIC FOOTING

SCALE: 1/2" = 1'-0"

ROOF SHEATHING FASTENING TABLE (RAFTER / TRUSS SG = 0.49)

Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RSRS-01 (2 3/8" × 0.113")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RSRS-01 (2 3/8" × 0.113")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RSRS-03 (2 1/2" × 0.131") or ASTM F1667 RSRS-04 (3" × 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RSRS-01 (2 3/8" × 0.113")	6" oc	6" oc
130 mph Exp. C	**15/32"**	**ASTM F1667 RSRS-01 (2 3/8" × 0.113")**	**6" oc**	**6" oc**
130 mph Exp. D	19/32"	ASTM F1667 RSRS-03 (2 1/2" × 0.131") or ASTM F1667 RSRS-04 (3" × 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RSRS-01 (2 3/8" × 0.113")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RSRS-03 (2 1/2" × 0.131") or ASTM F1667 RSRS-04 (3" × 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RSRS-03 (2 1/2" × 0.131") or ASTM F1667 RSRS-04 (3" × 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RSRS-03 (2 1/2" × 0.131") or ASTM F1667 RSRS-04 (3" × 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RSRS-03 (2 1/2" × 0.131") or ASTM F1667 RSRS-04 (3" × 0.120")	4" oc	4" oc

Note: For sheathing located a minimum of 4 feet from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

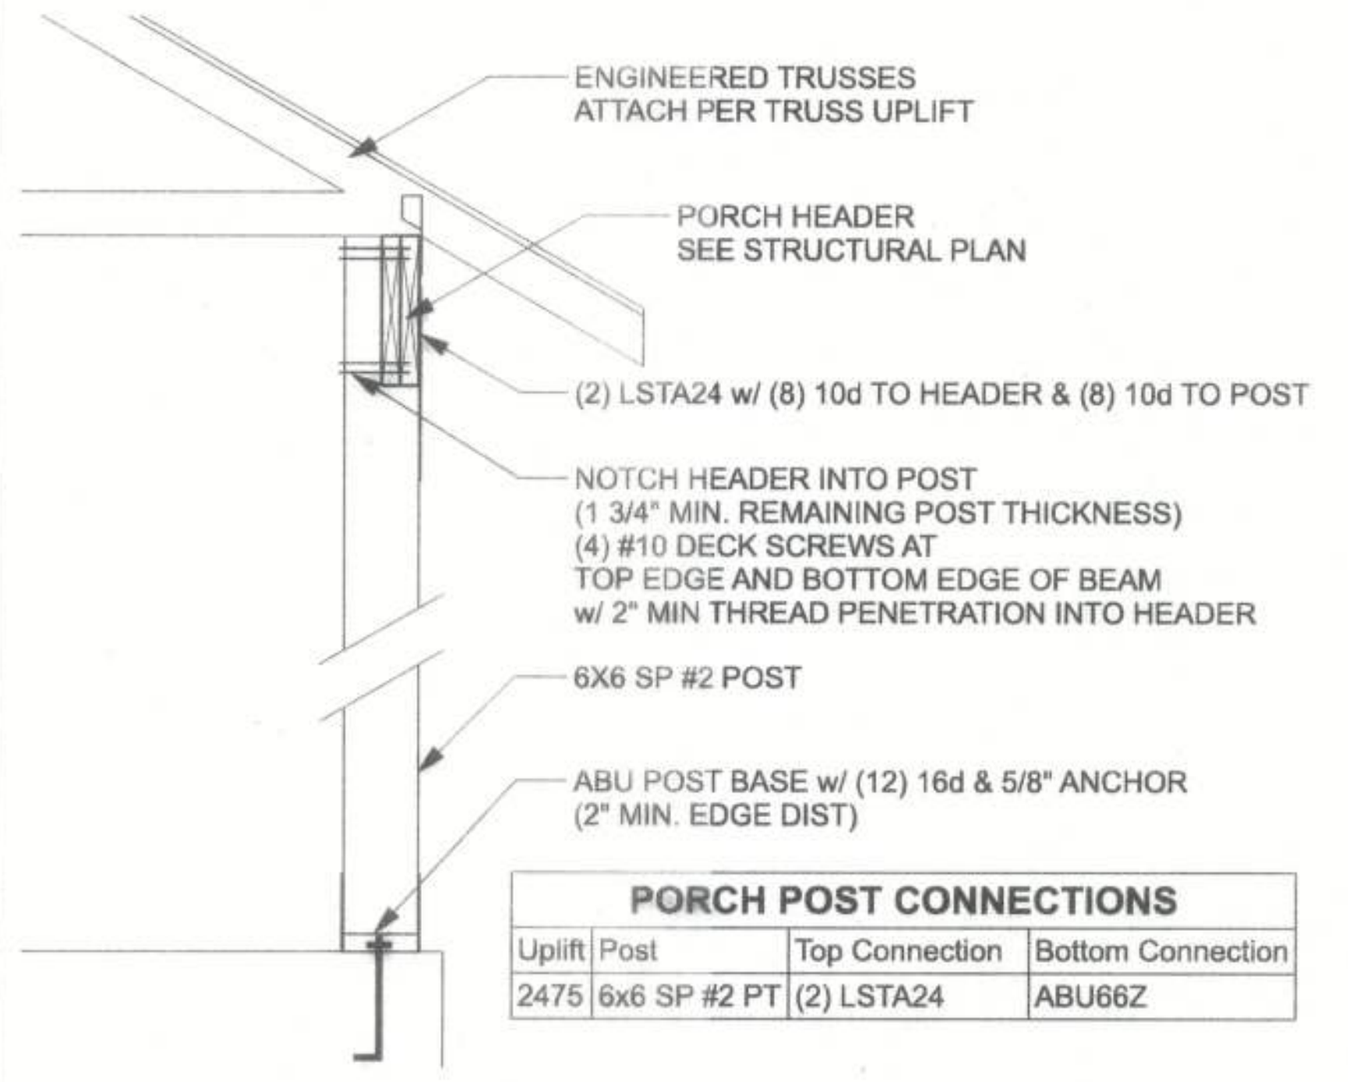

PORCH POST CONNECTIONS

Uplift	Post	Top Connection	Bottom Connection
2475	6x6 SP #2 PT	(2) LSTA24	ABU66Z

POSTS CUT FLUSH WITHOUT NOTCH - BRACE TO PREVENT ROTATION:

EAVE / HIP ROOF:
- STRAP TRUSS w/ H2.5A OR EQUAL TO EACH SIDE OF HEADER (FRONT & BACK)
  USE LONGER STRAP AS NEEDED IF TOP PLATES ARE INSTALLED
- (2) LSTA24 16-10d OR (2) MTS20 14-10d ON FRONT AND REAR OF POST TO HEADER
- ATTACH HEADER TO POST w/ (8) .131" x 3.25" TOE-NAIL

GABLE END:
- EXTEND GABLE SHEATHING TO BOTTOM OF HEADER NAILED WITH 8d NAILS @ 6" MIN. INTO TRUSS BOTTOM CHORD AND INTO BEAM AT 1 1/2" FROM TOP & BOTTOM EDGE
- ATTACH HEADER TO POST w/ (8) .131" x 3.25" TOE-NAIL

(TYP.) PORCH POST

ONE STORY WOOD

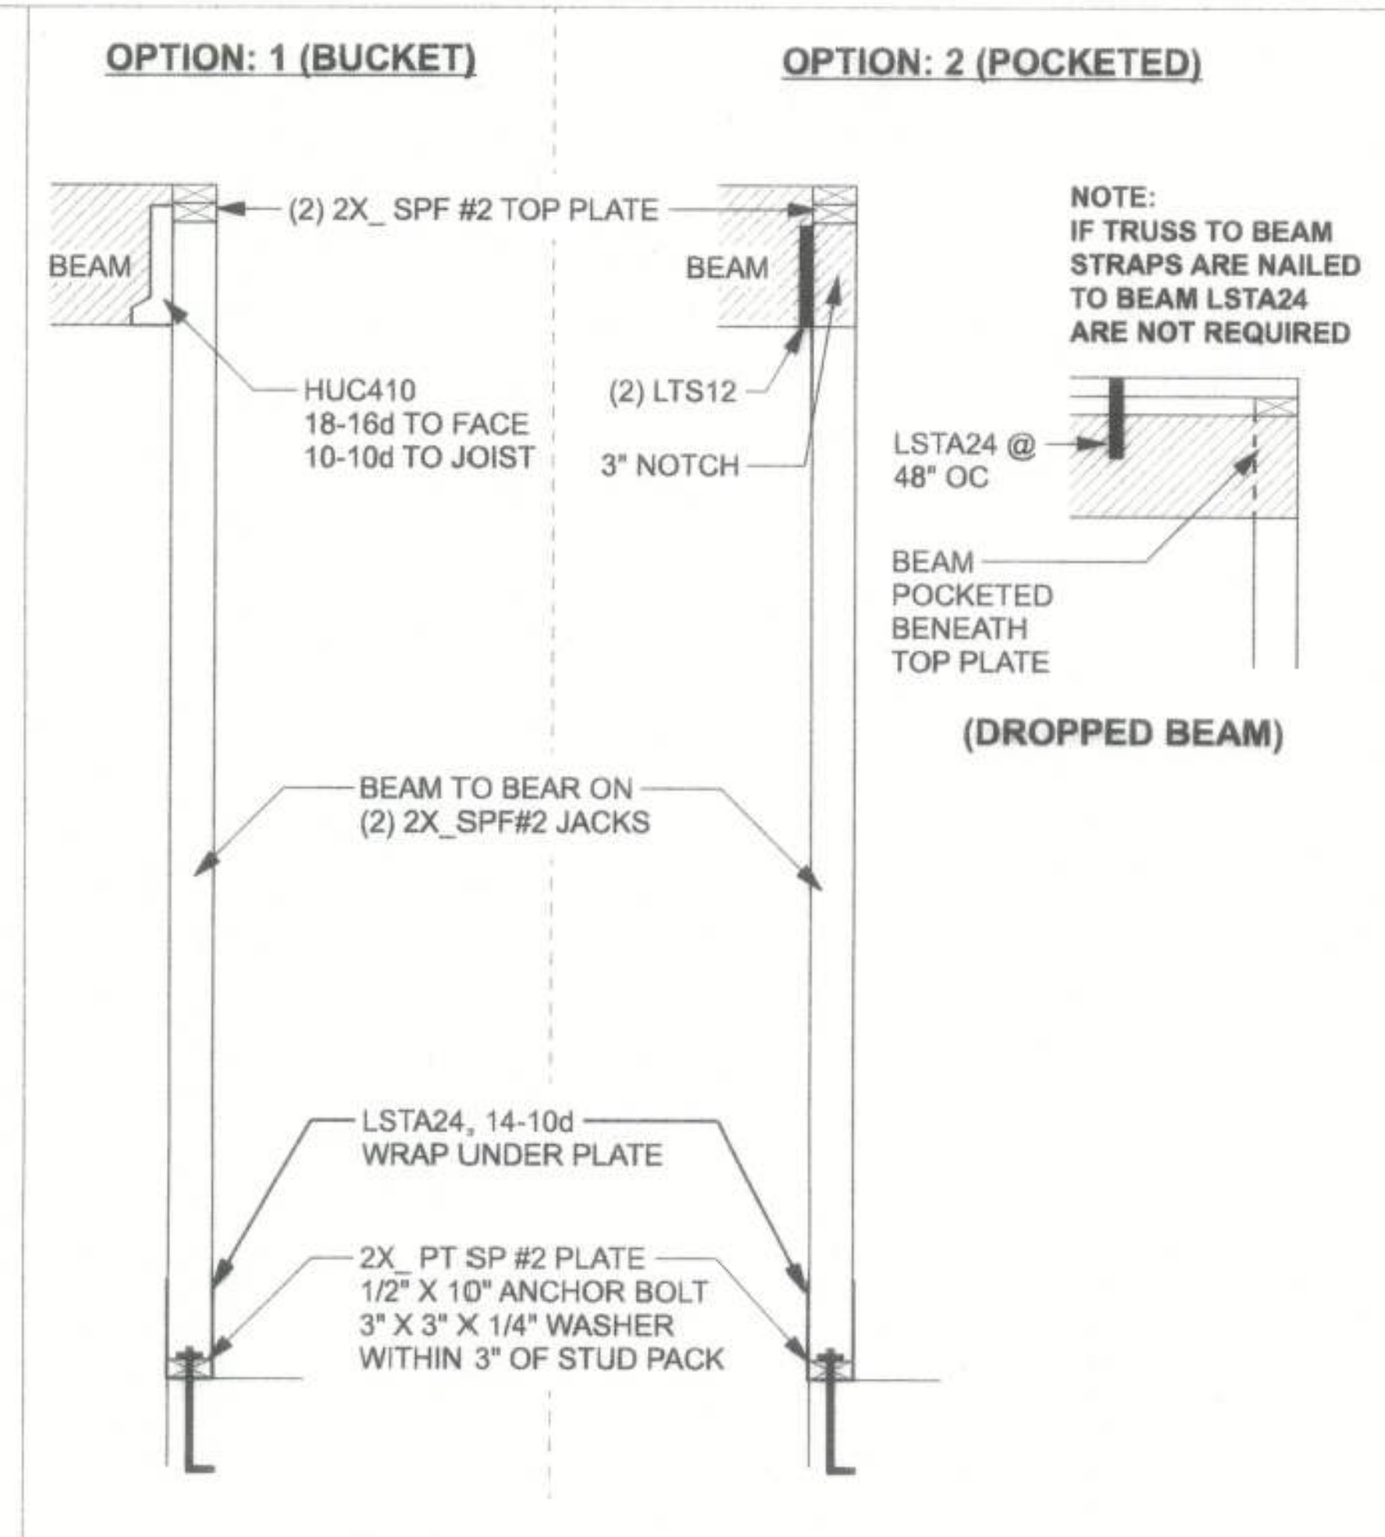

(TYP.) BEAM TO WALL

WOOD FRAME w/ STRAPS & ANCHORS

ALLOWABLE UPLIFT: 1235 LB

1 PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4

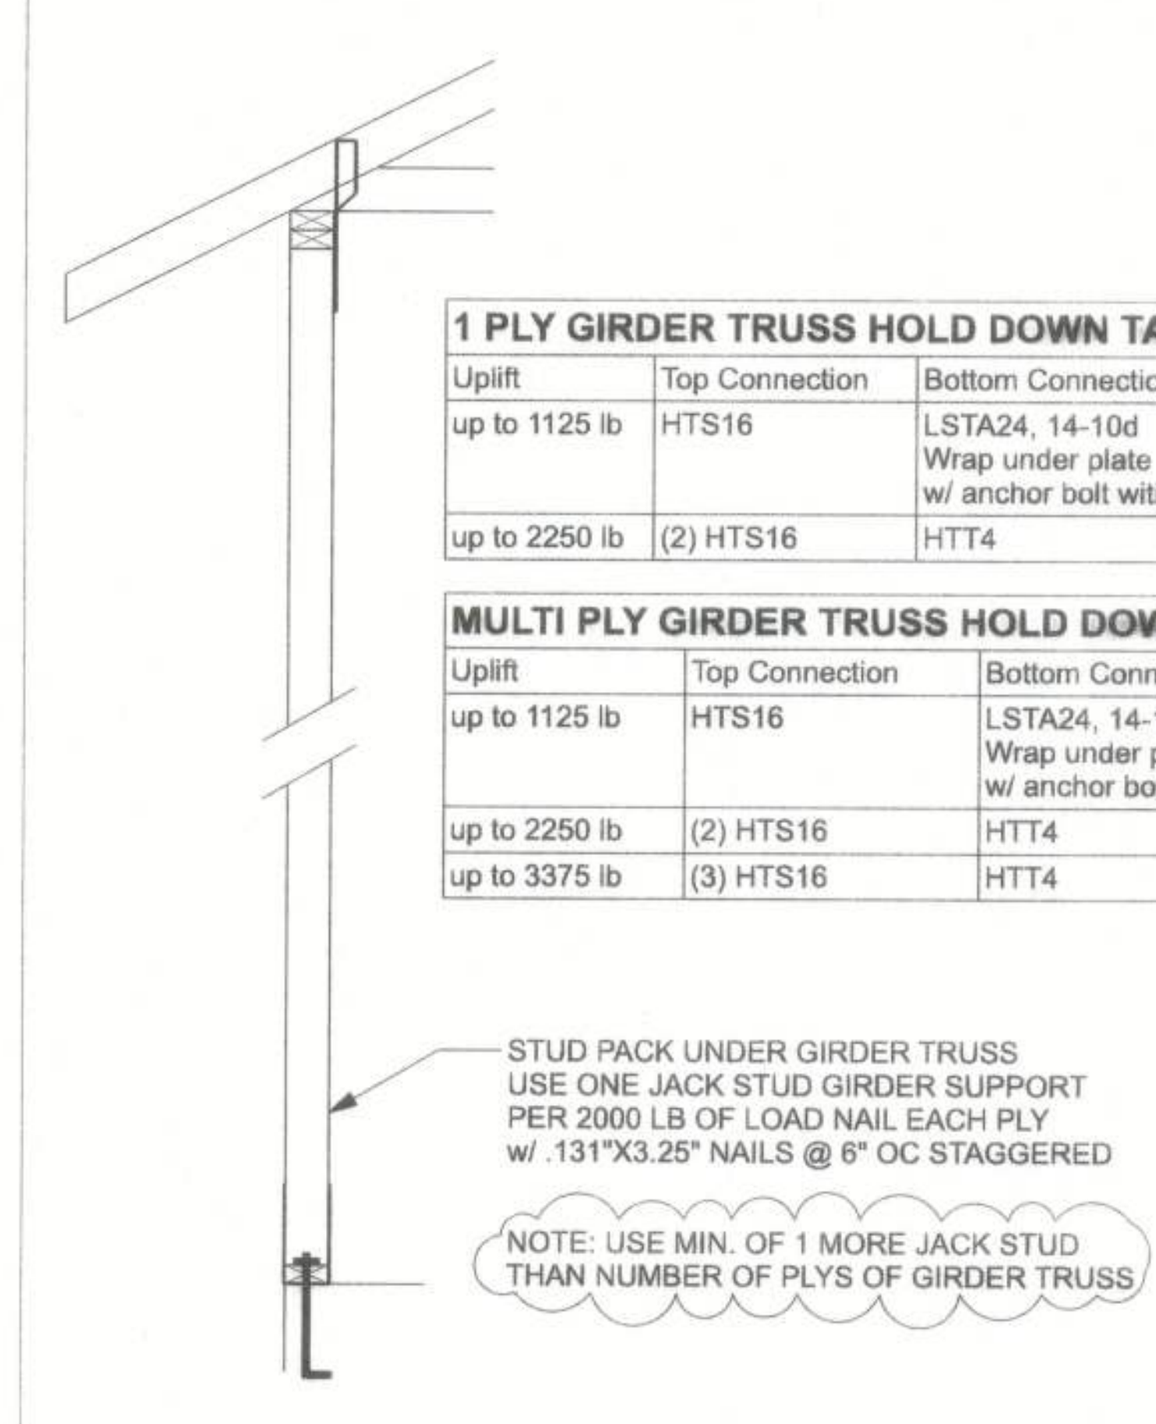

(TYP.) GIRDER TRUSS HOLD DOWN DETAIL

WOOD FRAME w/ STRAPS & ANCHORS

CONNECTOR TABLE

Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
615	485	SDWC15600	-	-
415	290	H3	4-8dx1 1/2"	4-8dx1 1/2"
575	495	H2.5A	5-8dx1 1/2"	5-8dx1 1/2"
1340	1015	H10A	9-10d1 1/2"	9-10d1 1/2"
720	620	LTS12-20	6-10d1 1/2"	6-10d1 1/2"
1000	860	MTS12-30	7-10d1 1/2"	7-10d1 1/2"
1450	1245	HTS20-30	12-10d1 1/2"	12-10d1 1/2"
Uplift SP	**Uplift SPF**	**Strap Ties**	**To One Member**	**To Other Member**
1235	1235	LSTA21	8-10d	8-10d
1640	1455	MSTA24	9-10d	9-10d
1030	1030	CS20	7-10d	7-10d
Uplift SP	**Uplift SPF**	**Stud Plate Ties**	**To Stud**	**To Plate**
585	535	SP1	6-10d	4-10d
1065	605	SP2	6-10d	6-10d
771	771	LSTA24	10-10d	wrap under or over plate
1235	1235	LSTA24	14-10d	wrap under or over plate
Uplift SP	**Uplift SPF**	**Holdowns @ Stemwall**	**To Stud / Post**	**Anchor**
1825	1800	DTT2Z	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	3640	HTT4	18-16dx2 1/2"	1/2"x12" Titen HD
Uplift SP	**Uplift SPF**	**Holdowns @ Mono**	**To Stud / Post**	**Anchor**
1825	1800	DTT2Z	8-SDS 1/4"x1 1/2"	1/2"x6" Titen HD
4235	3640	HTT4	18-16dx2 1/2"	1/2"x12" Titen HD
Uplift SP	**Uplift SPF**	**Post Bases @ Stemwall**	**To Post**	**Anchor**
1900		ABU44Z	12-16d	5/8"x12" Drill & Epoxy
2475		ABU66Z	12-16d	5/8"x12" Drill & Epoxy
Uplift SP	**Uplift SPF**	**Post Bases @ Mono**	**To Post**	**Anchor**
1900		ABU44Z	12-16d	5/8"x7" Drill & Epoxy
2475		ABU66Z	12-16d	5/8"x7" Drill & Epoxy

GRADE & SPECIES TABLE

		Fb	E
2x8	SP #2	925	1.4
2x10	SP #2	800	1.4
2x12	SP #2	750	1.4
GLB	24F-V3 SP	2600	1.9
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PSL	PARALAM	2900	2.0

GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END; 2X8 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN

FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE)

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F'c = 2500 PSI.

WELDED WIRE REINFORCED SLAB: 6" x 6" W1.4 x W1.4, FB = 85KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.M.) CONFORMING TO ASTM A185; LOCATED IN MIDDLE OF THE SLAB; SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH 1/2 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT WWM OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A 615, GRADE 40, DEFORMED BARS, FY = 40 KSI. ALL LAP SPLICES 40 * DB (25" FOR #5 BARS); UNO. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 315-96, U.N.O.

ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS; SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.

BUILDER'S RESPONSIBILITY:
THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.
CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.
PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.
PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.
VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

ROOF SYSTEM DESIGN:

THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR, IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBCR REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

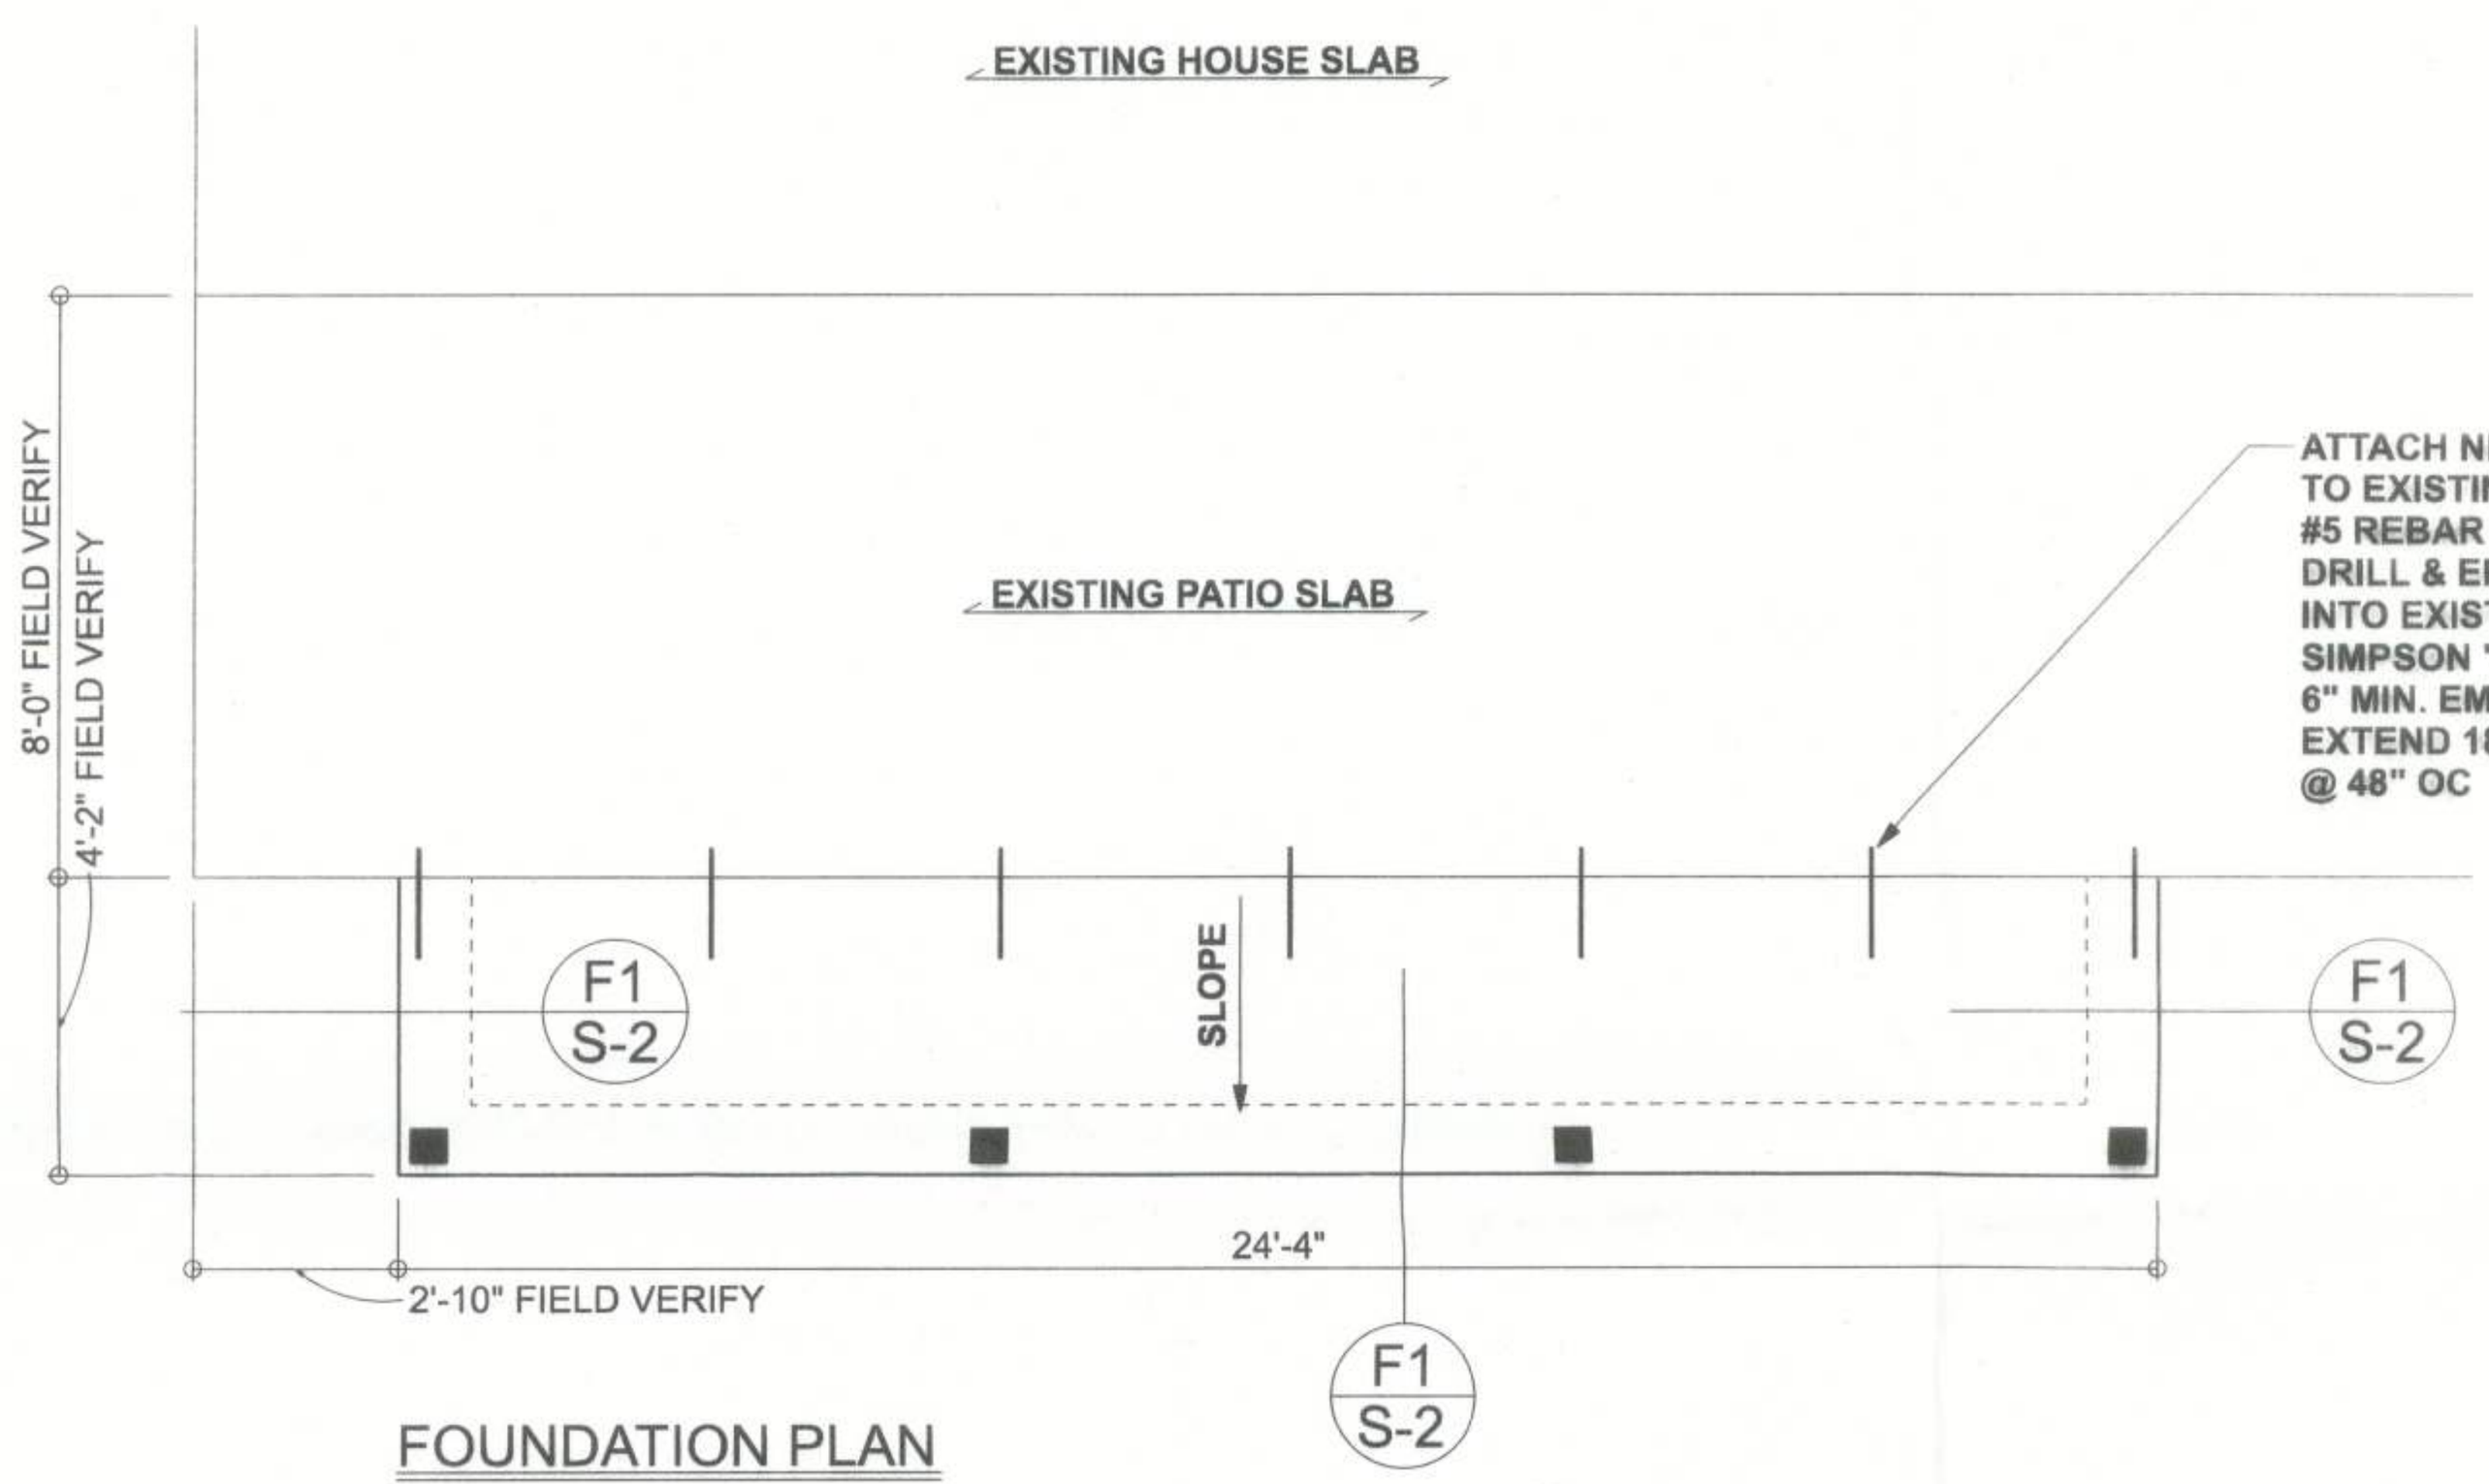

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES

FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, PE IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING IN ALL AREAS BY REVIEWINGTHE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN
FN - 3	THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ 6X6-1.4/1.4 WELDED WIRE MESH PLACED ON CHAIRS @ 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITE-TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED TERMITE-TREATMENT METHOD CAN BE USED INSTEAD)

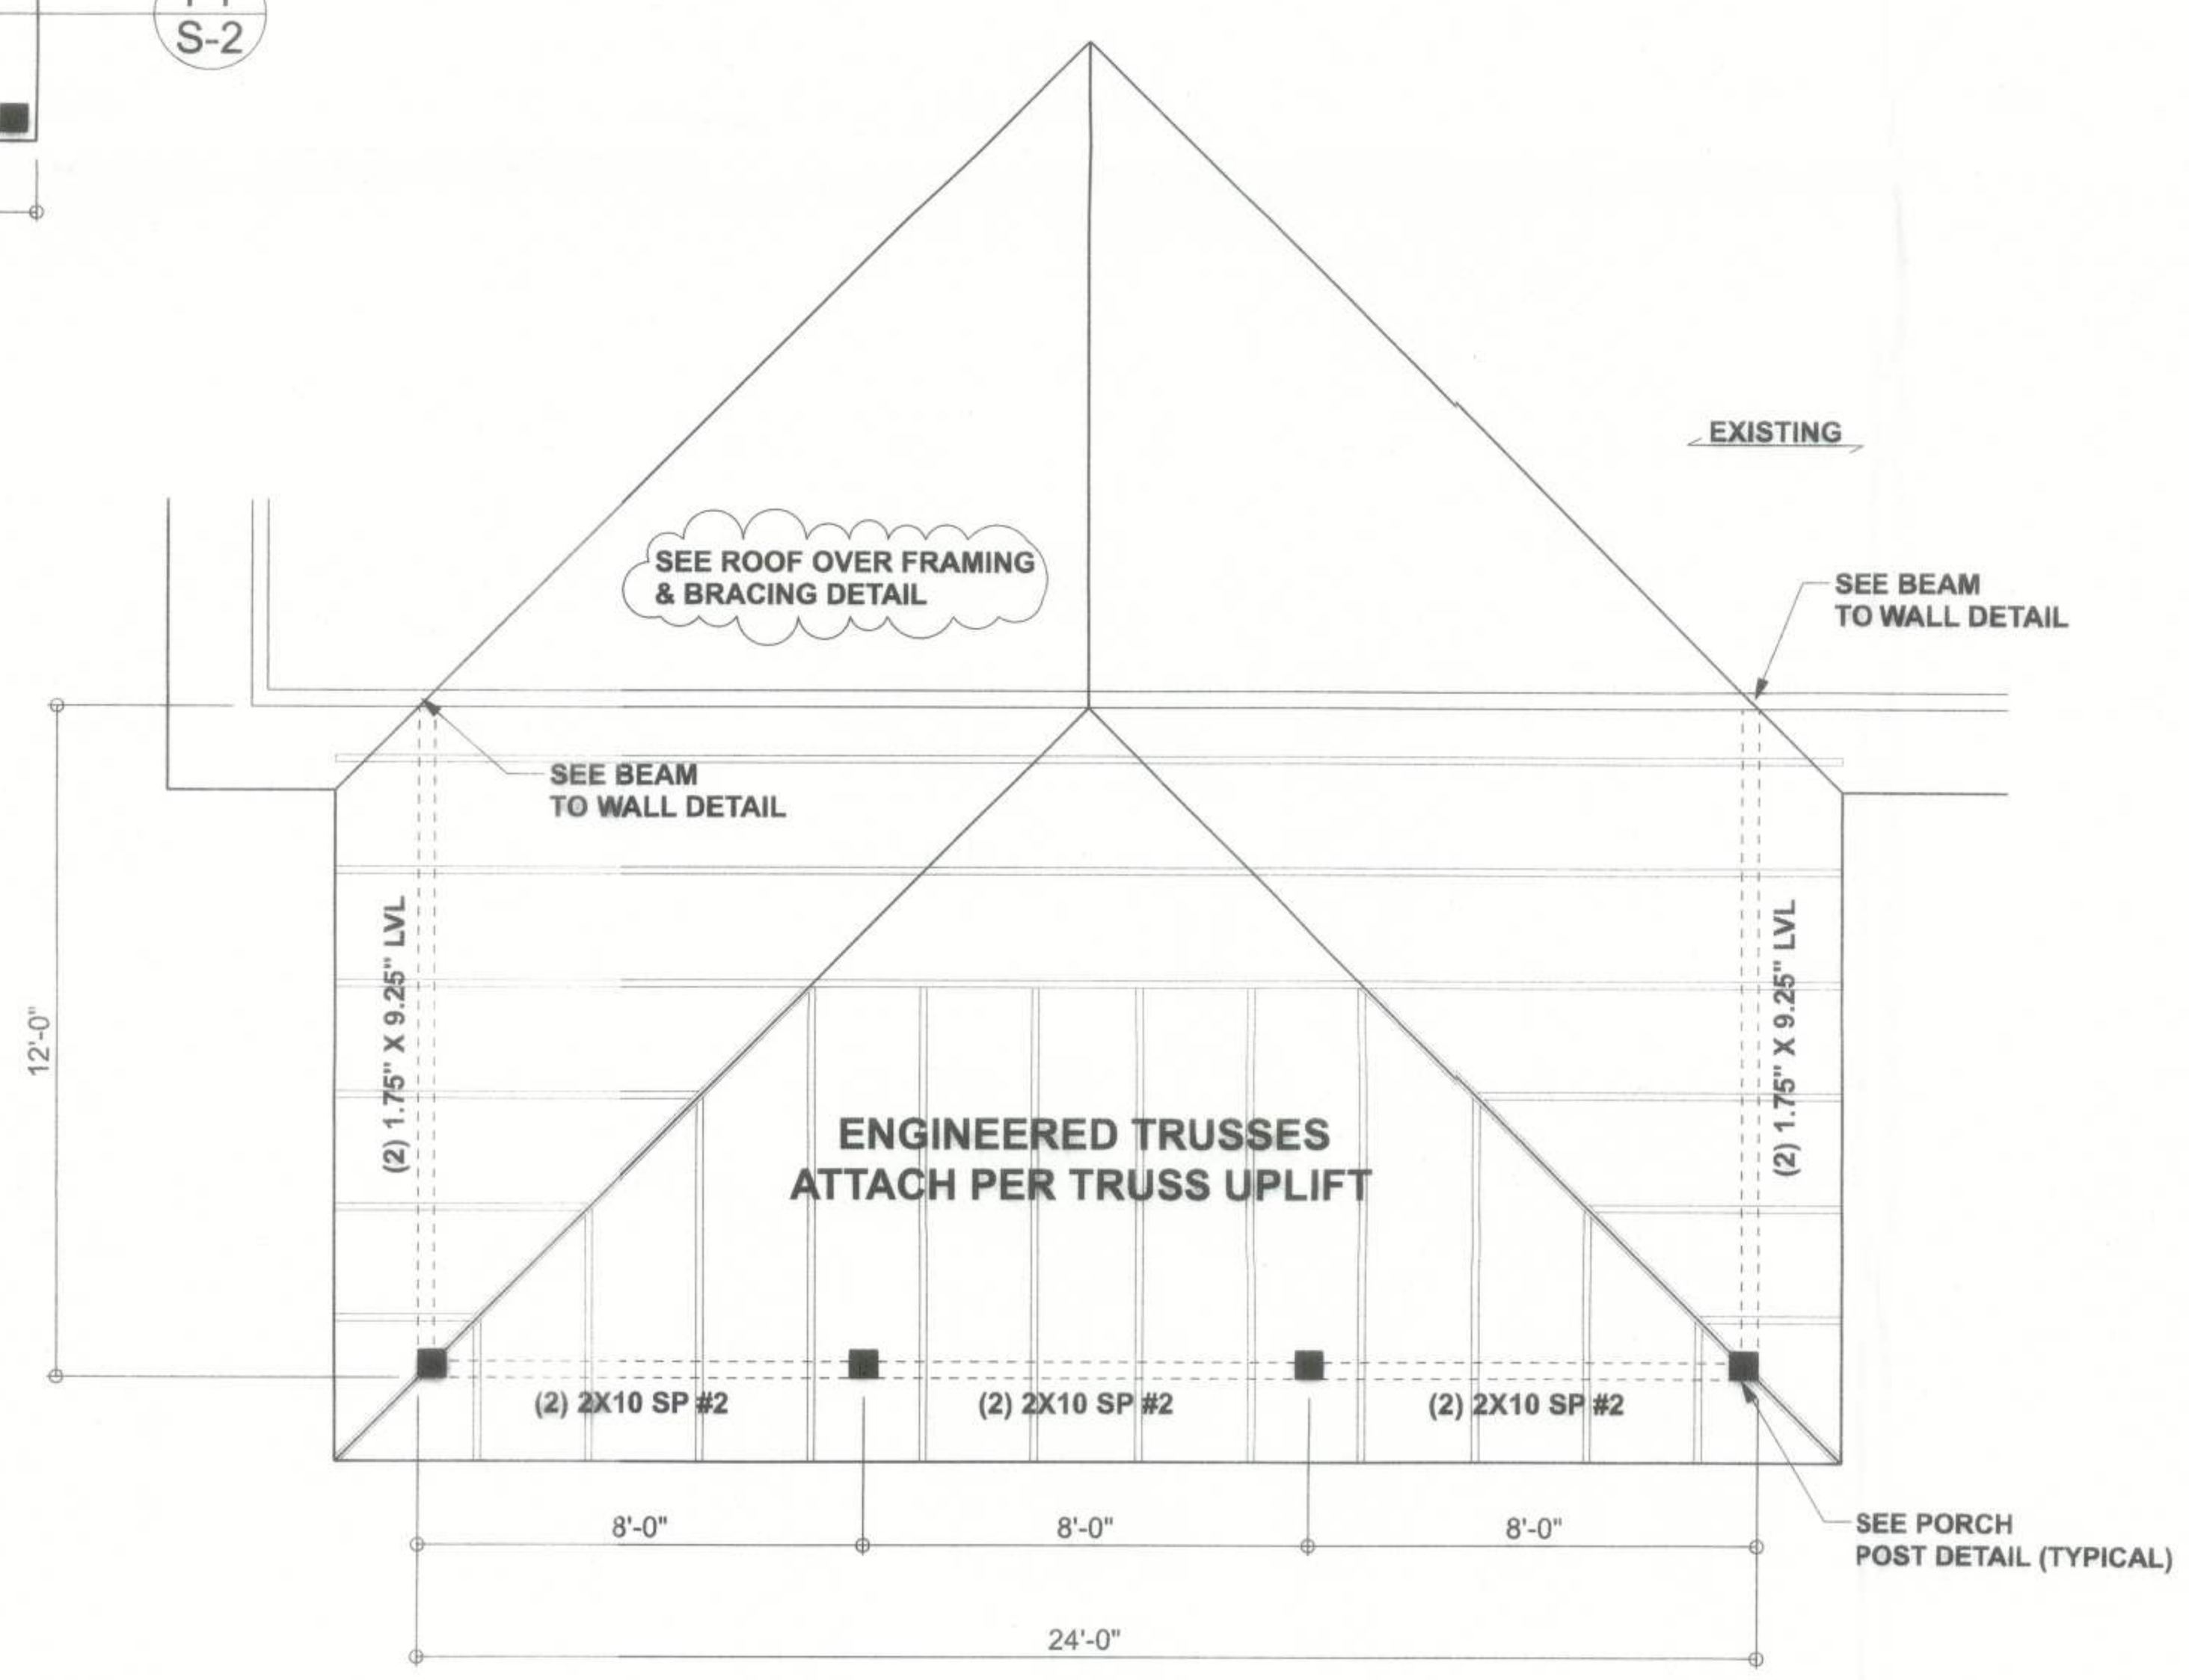

STRUCTURAL PLAN

SCALE: 1/4" = 1'-0"

STRUCTURAL PLAN NOTES

SN-1 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS

SN-2 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI1-03, BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

LUMBER SIZE & GRADE MINUMUM REQUIREMENTS

RIDGE BOARD	2X6 SYP #2
RAFTER SPANS 20'-0" OR LESS	2X4 SYP #2
PURLINS / LATERAL BRACING	2X4 SPF #2
SLEEPERS	2X (WIDTH OF RAFTER SEAT CUT) SPF #3 OR 2 PARALLEL 2X4 SPF #3
CRIPPLES & BLOCKING	2X4 SPF #2 OR BETTER
TRUSS BELOW	SEE TRUSS DESIGN - SOUTHEREN PINE MATERIAL

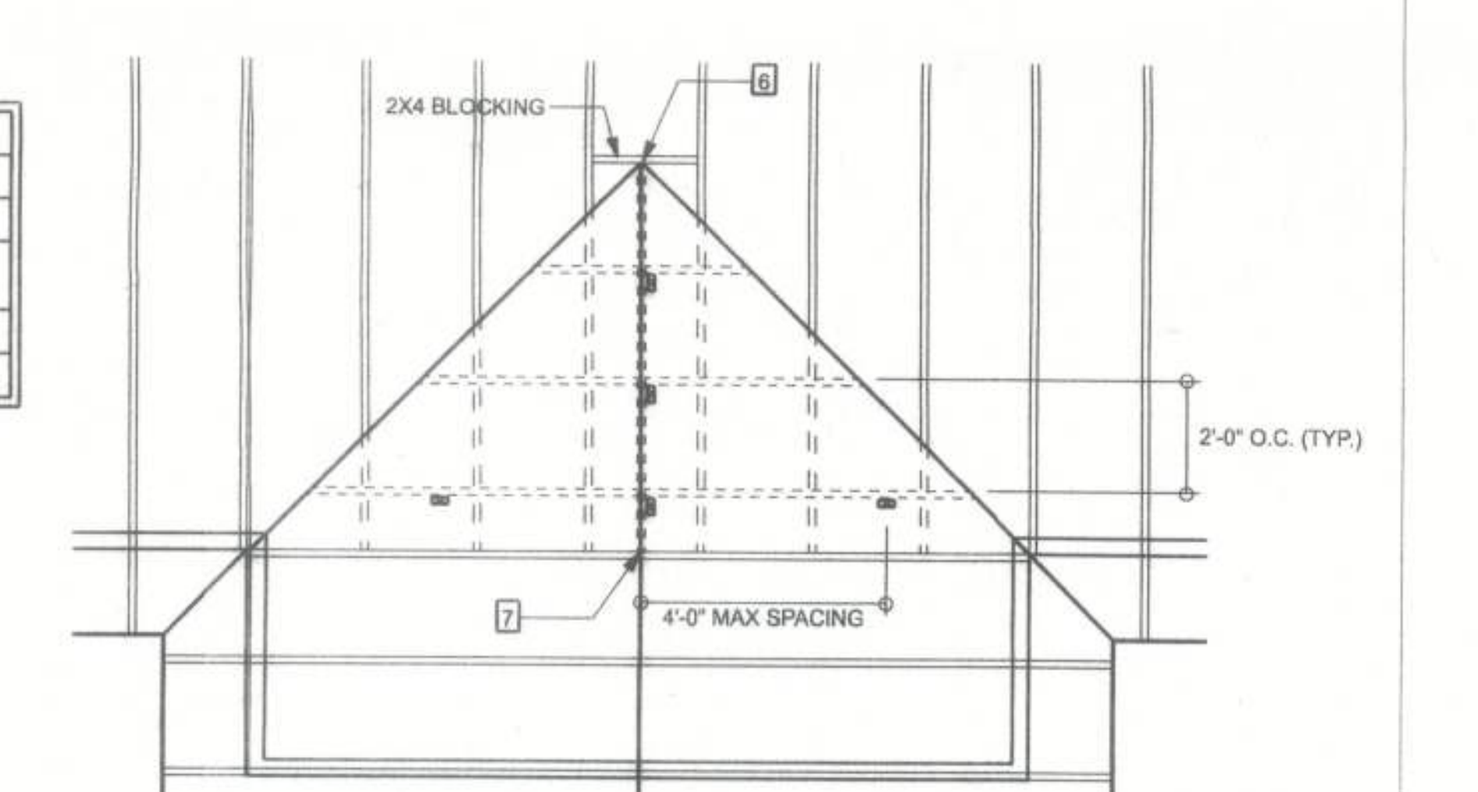

VALLEY ROOF PLAN

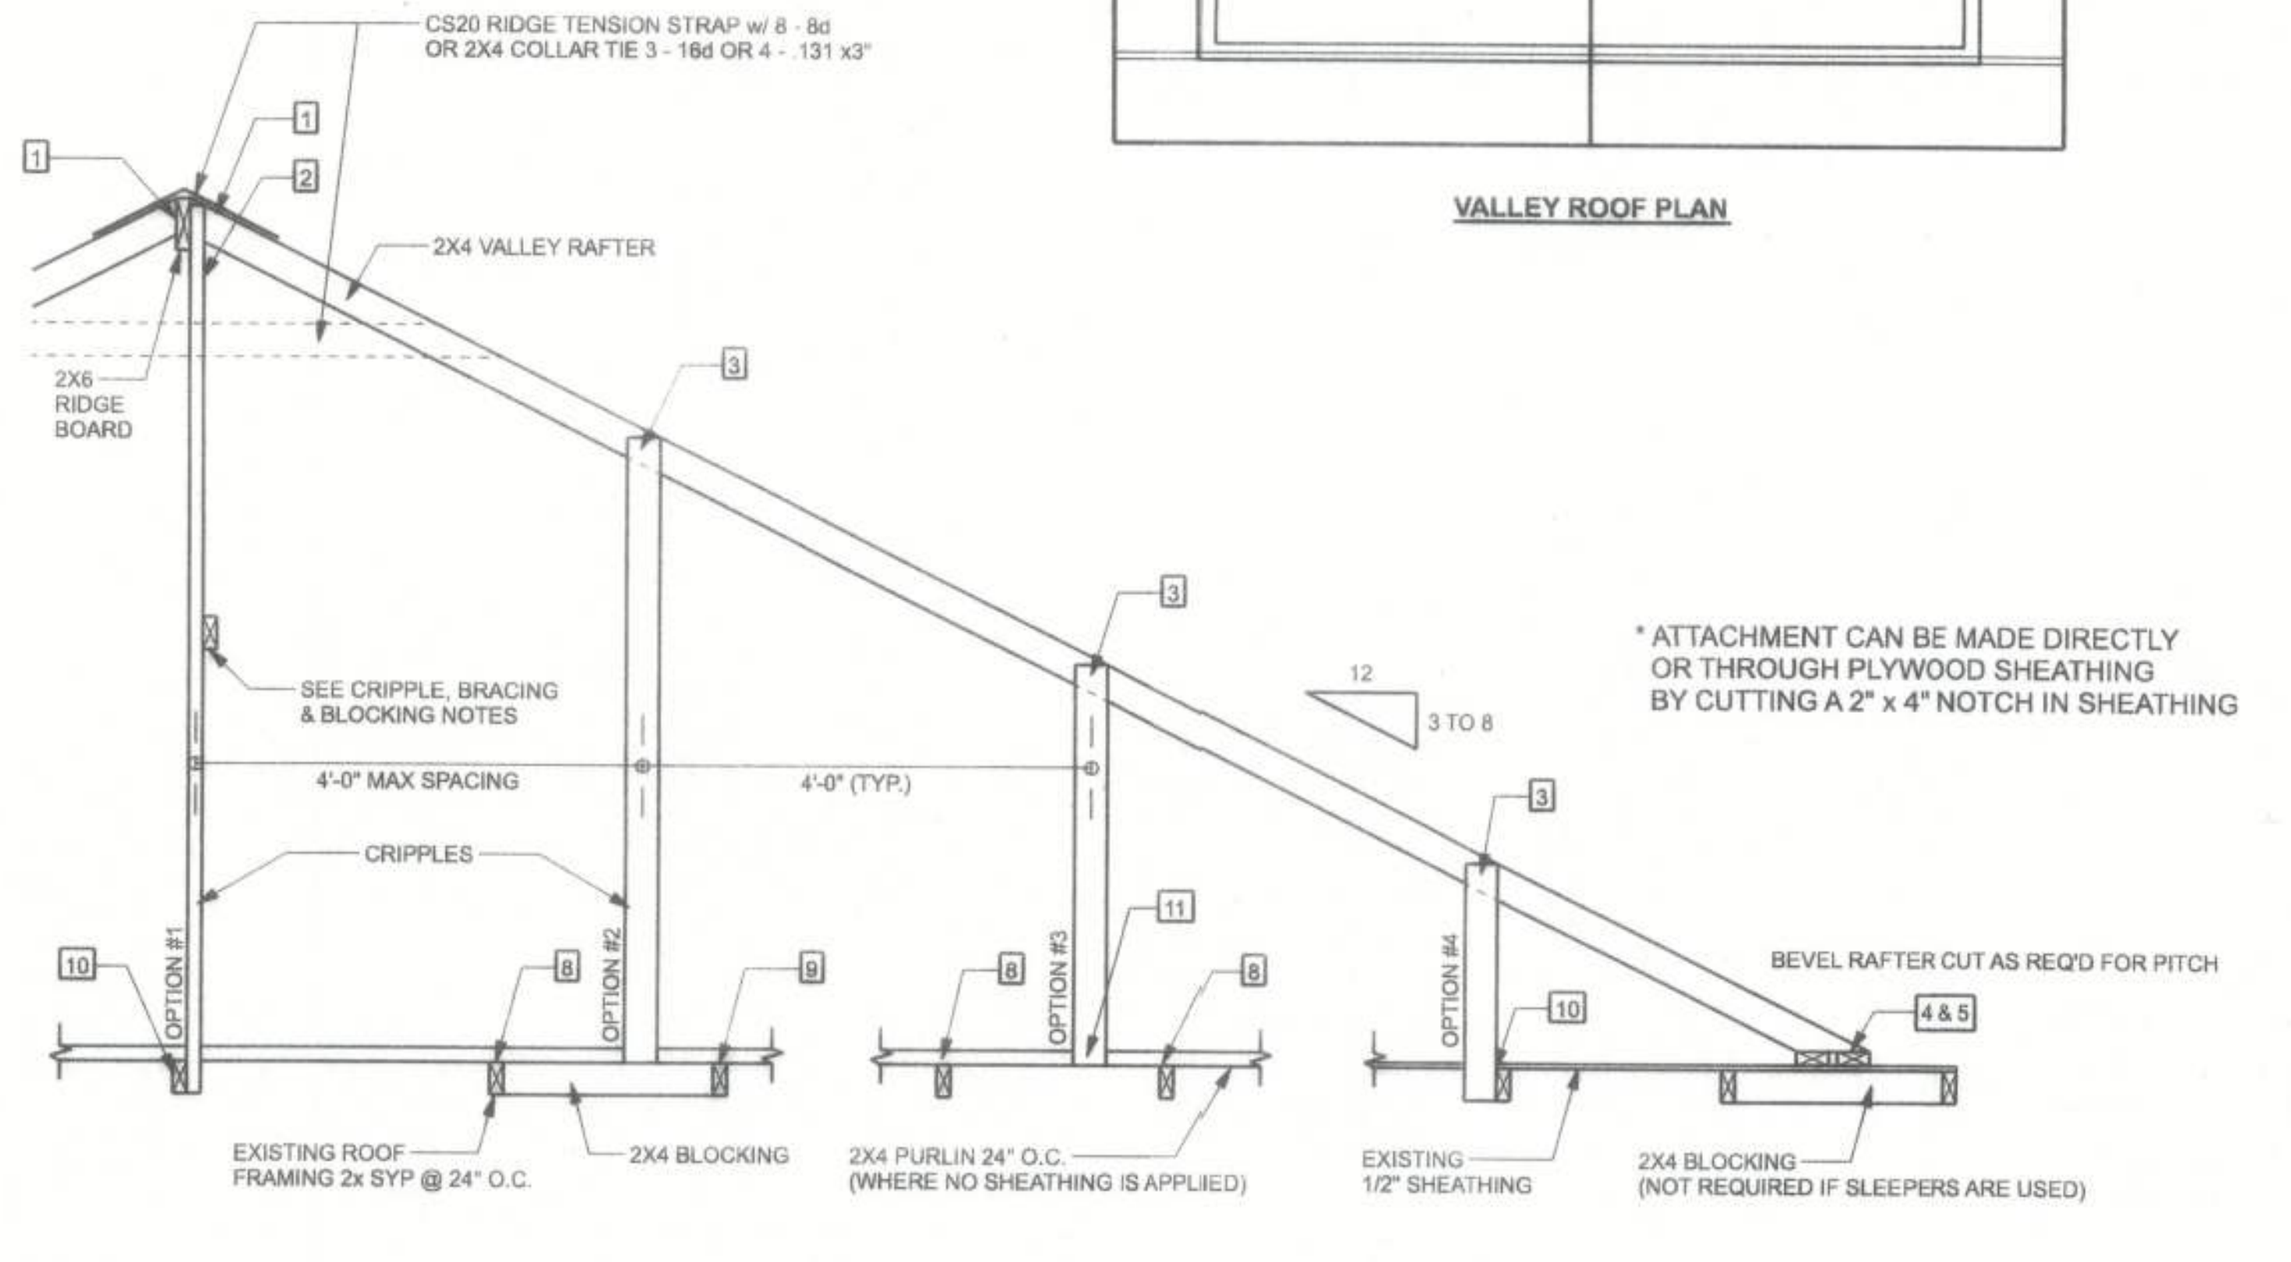

SECTION CUT PARALLEL TO VALLEY RAFTER

VALLEY ROOF PLAN MEMBER LEGEND

- TRUSS
- TRUSS UNDER VALLEY FRAMING
- VALLEY RAFTER OR RIDGE
- CRIPPLE

CRIPPLES 4'-0" O.C. FOR 20 psf (TL) AND 10 psf (TD) (TYP. SHINGLE ROOF) MAX

CONNECTION REQUIREMENT NOTES

1	2X4 RAFTERS TO RIDGE	3 -16d OR 6 - .131 x 3" TOE NAILS
2	CRIPPLE TO RIDGE	3 - 16d OR 6 - .131 x 3" FACE NAILS
3	CRIPPLE TO RAFTERS	3 - 16d OR 6 - .131 x 3" FACE NAILS
4	RAFTER TO SLEEPER OR BLOCKING	6 -16d OR 12 - .131 x 3" TOE NAILS
5	SLEEPER TO TRUSS	4 - 16d OR 8 - .131 x 3" FACE NAILS EACH TRUSS
6	RIDGE BOARD TO ROOF BLOCK	3 -16d OR 6 - .131 x 3" TOE NAILS
7	RIDGE BOARD TO TRUSS	3 -16d OR 6 - .131 x 3" TOE NAILS
8	PURLIN TO TRUSS (TYP.)	3 -16d OR 6 - .131 x 3" NAILS
8	PURLIN TO TRUSS (IF CRIPPLE IS ATTACHED TO PURLIN)	4 -16d OR 8 - .131 x 3" NAILS
9	TRUSS TO BLOCKING	3 -16d OR 6 - .131 x 3" END NAILS
10	CRIPPLE TO TRUSS	3 -16d OR 6 - .131 x 3" FACE NAILS
11	CRIPPLE TO PURLIN	3 -16d OR 6 - .131 x 3" FACE NAILS

GENERAL NOTES

MAXIMUM RAFTER SPANS
6'-0" FOR 2X4, 9'-0" FOR 2X6 SPF #2 OR SYP #2.
MAXIMUM ROOF AREA PER SUPPORT
16ft2 IN ZONES 2 & 3 , 24ft2 IN ZONE 1. (EXAMPLE: 4'-0" O.C. X 4'-0" SPAN = 16ft2 OR 2'-0" X 8'-0" SPAN = 16ft2)
PURLINS REQUIRED 2'-0" O.C. IF EXISTING SHEATHING IS REMOVED.
PURLINS SHOULD OVERLAP SHEATHING ONE TRUSS SPACING MINIMUM.
IN CASES THAT THIS IS IMPRACTICAL, OVERLAP SHEATHING A MINIMUM OF 6", AND NAIL UPWARDS THROUGH SHEATHING INTO PURLIN WITH A MINIMUM OF 8 - 8d COMMON WIRE NAILS.
THIS DRAWING APPLIES TO VALLEYS WITH THE FOLLOWING CONDITIONS:
-SPANS (DISTANCS BETWEEN HEELS) 40'-0" OR LESS
- MAXIMUM VALLEY HEIGHT: 14'-0" OR LESS
-MAXIMUM WIND SPEED: 130 MPH
- MAXIMUM MEAN ROOF HEIGHT: 30 FEET
- MAXIMUM TOTAL LOADING: 40 psf
- MEETS FBC / ASCE 7-16 WIND REQUIREMENTS
- EXPOSURE CATEGORY "C", I = 1.0, Kzt = 1.0
- ENCLOSED BUILDING

CRIPPLE, BRACING, & BLOCKING NOTES

-2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 5'-0" TO 10'-0" LONG NAILED w/ 2 - 10d NAILS OR 2X4 "T" OR SCAB BRACE NAILD TO FLAT EDGE OF CRIPPLE WITH 8d NAILS @ 8" O.C. "T" OR SCAB MUST BE 90% OF CRIPPLE LENGTH. CRIPPLES OVER 10'-0" LONG REQURE TWO CLB's OR BOTH FACES w/ "T" OR SCAB. USE STRESS GRADED LUMBER & BOX OR COMMON NAILS.
- NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER, AS LONG AS THE PROPER NUMBER OF NAILS ARE INSTALLED INTO RIDGE BOARD
- INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED.
- INSTALL BLOCKING UNDER CRIPPLES IF CRIPPLES FALL BETWEEN LOWER TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED.
- APPLY ALL NAILING IN ACCORDANCE TO NDS-1997 SECTION 12. NAILS ARE COMMON WIRE NAILS UNLESS NOTED OTHERWISE.

ROOF OVER FRAMING & BRACING DETAIL

SCALE: N.T.S

DESIGN CRITERIA & LOADS:	
BUILDING CODE	7TH EDITION FLORIDA BUILDING CODE RESIDENTIAL (2020)
CODE FOR DESIGN LOADS	ASCE 7-16
WINDLOADS	
BASIC WIND SPEED (ASCE 7-16, 3S GUST)	130 MPH
WIND EXPOSURE (BUILDER MUST FIELD VERIFY)	C
TOPOGRAPHIC FACTOR (BUILDER MUST FIELD VERIFY)	I
RISK CATEGORY	II
ENCLOSURE CLASSIFICATION	ENCLOSED
INTERNAL PRESSURE COEFFICIENT	0.18
ROOF ANGLE	7-45 DEGREES
MEAN ROOF HEIGHT	30 FT
C&C DESIGN PRESSURES	SEE TABLE
FLOOR LOADING	
ROOMS OTHER THAN SLEEPING ROOM	40 PSF LIVE LOAD
SLEEPING ROOMS	30 PSF LIVE LOAD
ROOF LOADING	
FLAT OR < 4:12	20 PSF LIVE LOAD
4:12 TO < 12:12	16 PSF LIVE LOAD
12:12 & GREATER	12 PSF LIVE LOAD
SOIL BEARING CAPACITY	1500 PSF
FLOOD ZONE	THIS BUILDING IS NOT IN THE FLOOD ZONE

COMPONENT & CLADING DESIGN PRESSURES 130 MPH (EXP C)

EFFECTIVE WIND AREA (FT2)	ZONE 4 INTERIOR		ZONE 5 END 4' FROM ALL OUTSIDE CORNER	
0 - 20	+25.6(Vasd)	-27.8(Vasd)	+25.6(Vasd)	-34.2(Vasd)
0 - 20	+42.6(Vult)	-46.2(Vult)	+42.6(Vult)	-57(Vult)

GARAGE DOOR DESIGN PRESSURES 130 MPH (EXP C)

9x7 GARAGE DOOR	+22.6(Vasd)	-25.5(Vasd)
16x7 GARAGE DOOR	+21.7(Vasd)	-24.1(Vasd)

Milton Builders

Friar Porch Addition

PROJECT ADDRESS:
140 SW Oak Way
Lake City, FL 32025

FL PE 53915

This item has been digitally signed and sealed by Mark Disosway PE on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
230667

S-1

OF 1 SHEETS