

DATE 07/22/2005

Columbia County Building Permit

PERMIT

This Permit Expires One Year From the Date of Issue

000023409

APPLICANT DAVID SIMQUE PHONE 755-7787  
ADDRESS 1890 SW MIDTOWN PLACE LAKE CITY FL 32025  
OWNER WESTFIELD GROUP PHONE 755-0757  
ADDRESS 2929 HIGHWAY 90 WEST LAKE CITY FL 32025  
CONTRACTOR DAVID SIMQUE PHONE 755-0757  
LOCATION OF PROPERTY HIGHWAY 90 WEST, BETWEEN APPLEBEES AND WAFFLE HOUSE  
BUILDING #2  
TYPE DEVELOPMENT COMMERCIAL STORE ESTIMATED COST OF CONSTRUCTION .00  
HEATED FLOOR AREA 8960.00 TOTAL AREA 10033.00 HEIGHT .00 STORIES 1  
FOUNDATION CONC WALLS FRAMED ROOF PITCH 2/12 FLOOR SLAB  
LAND USE & ZONING CG MAX. HEIGHT 27  
Minimum Set Back Requirments: STREET-FRONT 20.00 REAR 15.00 SIDE 5.00  
NO. EX.D.U. 0 FLOOD ZONE X DEVELOPMENT PERMIT NO.

PARCEL ID 35-3S-16-02585-006 SUBDIVISION VILLAGE SQUARE  
LOT BLOCK PHASE 2 UNIT TOTAL ACRES

Culvert Permit No. Culvert Waiver Contractor's License Number CBC056158  
FDOT X05-0095 BK Applicant/Owner/Contractor  
Driveway Connection Septic Tank Number LU & Zoning checked by Approved for Issuance New Resident

COMMENTS: ONE FOOT ABOVE THE ROAD

Check # or Cash 1395

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power date/app. by Foundation date/app. by Monolithic date/app. by  
Under slab rough-in plumbing date/app. by Slab date/app. by Sheathing/Nailing date/app. by  
Framing date/app. by Rough-in plumbing above slab and below wood floor date/app. by  
Electrical rough-in date/app. by Heat & Air Duct date/app. by Peri. beam (Lintel) date/app. by  
Permanent power date/app. by C.O. Final date/app. by Culvert date/app. by  
M/H tie downs, blocking, electricity and plumbing date/app. by Pool date/app. by  
Reconnection date/app. by Pump pole date/app. by Utility Pole date/app. by  
M/H Pole date/app. by Travel Trailer date/app. by Re-roof date/app. by

BUILDING PERMIT FEE \$ 3000.00 CERTIFICATION FEE \$ 50.16 SURCHARGE FEE \$ 50.16  
MISC. FEES \$ .00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ WASTE FEE \$  
FLOOD ZONE DEVELOPMENT FEE \$ CULVERT FEE \$ TOTAL FEE 3150.32  
INSPECTORS OFFICE CLERKS OFFICE

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

This Permit Must Be Prominently Posted on Premises During Construction

PLEASE NOTIFY THE COLUMBIA COUNTY BUILDING DEPARTMENT AT LEAST 24 HOURS IN ADVANCE OF EACH INSPECTION, IN ORDER THAT IT MAY BE MADE WITHOUT DELAY OR INCONVENIENCE, PHONE 758-1008. THIS PERMIT IS NOT VALID UNLESS THE WORK AUTHORIZED BY IT IS COMMENCED WITHIN 6 MONTHS AFTER ISSUANCE.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.



## Columbia County Building Permit Application

Revised 9-23-04

For Office Use Only Application # 0504-06 Date Received 4/4/09 By JW Permit # 23409  
Application Approved by - Zoning Official BLK Date 11.05.05 Plans Examiner \_\_\_\_\_ Date \_\_\_\_\_  
Flood Zone X Development Permit N/A Zoning CG Land Use Plan Map Category COMMERCIAL  
Comments SDP 04-6

Applicants Name David Simgue - Simgue Const. Phone 386-755-7787  
Address 1890 S.W. Midtown Pl. Lake City, FL 32025  
Owners Name Westfield Group Phone 386-755-0557  
911 Address 2929 Hwy 90 Lake City, FL 32025  
Contractors Name David J. Simgue Phone 386-755-7787  
Address P.O. Box 2962 Lake City FL 32080  
Fee Simple Owner Name & Address Westfield Group  
Bonding Co. Name & Address \_\_\_\_\_  
Architect/Engineer Name & Address Bailey Bishop 3 Lane P.O. Box 3719  
Mortgage Lenders Name & Address Mercantile Bank  
Circle the correct power company - FL Power & Light - Clay Elec. - Suwannee Valley Elec. - Progressive Energy  
Property ID Number 35-38-16-02585006 Estimated Cost of Construction \$600,000.00  
Subdivision Name Village Square (#2) Lot \_\_\_\_\_ Block \_\_\_\_\_ Unit \_\_\_\_\_ Phase 2  
Driving Directions Hwy 90 WEST ON E-75 BETWEEN  
WATKINS house at Appleberry  
Type of Construction Retail Center Number of Existing Dwellings on Property 1  
Total Acreage 10 Lot Size \_\_\_\_\_ Do you need a - Culvert Permit or Culvert Waiver or Have an Existing Drive  
Actual Distance of Structure from Property Lines - Front 400' Side 300' Side 200' Rear 60'  
Total Building Height 27 Number of Stories 1 Heated Floor Area 9000 Roof Pitch 12/12

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.

OWNERS AFFIDAVIT: I hereby certify that all the foregoing information is accurate and all work will be done in compliance with all applicable laws and regulating construction and zoning.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

Owner Builder or Agent (Including Contractor) \_\_\_\_\_

STATE OF FLORIDA  
COUNTY OF COLUMBIA



Sworn to (or affirmed) and subscribed before me

this 31 day of March 2009.

Personally known X or Produced Identification \_\_\_\_\_

Contractor Signature \_\_\_\_\_

Contractors License Number CB056158

Competency Card Number \_\_\_\_\_

NOTARY STAMP/SEAL

Notary Signature \_\_\_\_\_



This is a detailed Flood Insurance Rate Map (FIRM) for Columbia County, Florida. The map displays various flood zones, including Zone A (shaded with a stippled pattern) and Zone X (unshaded). Key features include:

- Water Bodies:** Harris Lake and several smaller ponds are shown.
- Roads:** Major roads are labeled with numbers in circles (e.g., 26, 35, 36, 75, 93, 90, 341). A road labeled 'CSX' is also present.
- Zone Labels:** 'ZONE A' and 'ZONE X' are labeled throughout the map, with arrows pointing to specific areas.
- Map Orientation:** A north arrow is located in the top left corner.
- Scale:** A scale bar in the top left indicates distances in feet, with markings for 0, 1000, and 2000.
- Map Title and Information:** The title 'FIRM FLOOD INSURANCE RATE MAP' is prominently displayed. Below it, the location is specified as 'COLUMBIA COUNTY, FLORIDA (UNINCORPORATED AREAS)'. The map is identified as 'PANEL 175 OF 290'.
- Administrative Information:** The map is part of the 'NATIONAL FLOOD INSURANCE PROGRAM' and is managed by the 'Federal Emergency Management Agency'. The 'COMMUNITY-PANEL NUMBER' is 120070 0175 B, and the 'EFFECTIVE DATE' is January 6, 1988.
- Legend:** A legend in the bottom right corner shows a diagram of a building and a shaded area, indicating the flood zone coverage.

This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT Version 1.0. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. Further information about National Flood Insurance Program flood hazard maps is available at [www.fema.gov/nfmit/sd](http://www.fema.gov/nfmit/sd).

Print Date: 7/9/2004 (printed at scale and type A)

cert. copy 4.50

THIS INSTRUMENT WAS PREPARED BY:

TERRY McDAVID  
POST OFFICE BOX 1328  
LAKE CITY, FL 32056-1328

RETURN TO:

TERRY McDAVID  
POST OFFICE BOX 1328  
LAKE CITY, FL 32056-1328

Inst:2004028144 Date:12/17/2004 Time:16:39  
mk DC, P. DeWitt Cason, Columbia County B:1033 P:1502

PERMIT NO. \_\_\_\_\_

TAX FOLIO NOS.: 35-3S-16-02585-006

NOTICE OF COMMENCEMENT

STATE OF FLORIDA  
COUNTY OF COLUMBIA

The undersigned hereby gives notice that improvement will be made to certain real property, and in accordance with Chapter 713, Florida Statutes, the following information is provided in this Notice of Commencement.

1. Description of property:

SEE SCHEDULE "A" ATTACHED HERETO  
FOR LEGAL DESCRIPTION

2. General description of improvement: Construction of a retail shopping center.

3. Owner information:

a. Name and address: WESTFIELD GROUP, LLLP a Florida Limited Liability Limited Partnership, Post Office Box 3566, Lake City, Florida 32056.

b. Interest in property: Fee Simple

c. Name and address of fee simple title holder (if other than Owner):

4. Contractor: SIMQUE CONSTRUCTION, Post Office Box 2962, Lake City, Florida 32056.

5. Surety

a. Name and address: None

6. Lender: MERCANTILE BANK, 187 SW Baya Drive, Lake City, Florida 32025.

7. Persons within the State of Florida designated by Owner upon whom notices or other documents may be served as provided by Section 713.13(1)(a)7., Florida Statutes: None


8. In addition to himself, Owner designates ROBERT W. TURBEVILLE, Sr. Vice President of MERCANTILE BANK, 187 SW Baya Drive, Lake City, Florida 32025, to receive a copy of the Lienor's Notice as provided in Section 713.13(1)(b), Florida Statutes.

STATE OF FLORIDA, COUNTY OF COLUMBIA  
I HEREBY CERTIFY that the above and foregoing  
is a true copy of the original filed in this office.  
P. DeWITT CASON, CLERK OF COURTS  
By Marcel Kien  
Deputy Clerk  
Date Dec 17, 2004




9. Expiration date of notice of commencement (the expiration date is 1 year from the date of recording unless a different date is specified). December 17, 2005.

WESTFIELD GROUP, LLLP, a Florida  
Limited Liability Limited  
Partnership

By: 

Charles S. Sparks  
General Partner

Inst:2004028144 Date:12/17/2004 Time:16:39  
DC,P.DeWitt Cason,Columbia County B:1033 P:1503

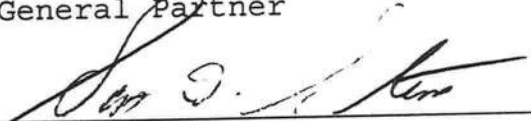By: 

Scott D. Stewart  
General Partner

The foregoing instrument was acknowledged before me this 17th day of December 2004, by CHARLES S. SPARKS and SCOTT D. STEWART, General Partners of WESTFIELD GROUP, LLLP, a Florida Limited Liability Limited Partnership, on behalf of the partnership. They are personally known to me and did not take an oath.



Notary Public  
My commission expires:

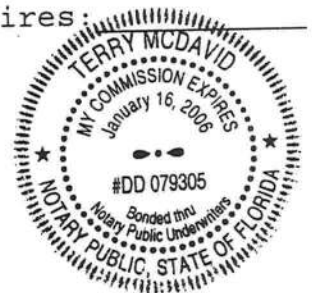




EXHIBIT "A"

TOWNSHIP 3 SOUTH - RANGE 16 EAST

SECTION 35: Part of the SE 1/4, Section 35, Township 3 South, Range 16 East, Columbia County, Florida, being more particularly described as follows:

COMMENCE at the intersection of the East Line of Brookside, a subdivision as recorded in Plat Book 3 at Page 45 of the public records of Columbia County, Florida and the Northerly Right of Way of U.S. Highway 90 (State Road No. 10) and run thence S 84°51'35"E along said Northerly Right of Way, 275.03 feet to the POINT OF BEGINNING; thence N 03°02'38"E 464.44 feet; thence S 84°52'31"E, 342.21 feet; thence S 03°38'27"E 69.55 feet; thence N 84°47'26"W 156.62 feet; thence S 03°35'56"E, 400.33 feet to aforesaid Northerly Right of Way; thence N 84°51'35"W, along said Northerly Right of Way 240.04 feet to the POINT OF BEGINNING. COLUMBIA COUNTY, FLORIDA.

Inst:2004028144 Date:12/17/2004 Time:16:39

\_\_\_\_DC,P.Dewitt Cason,Columbia County B:1033 P:1504



## Cal-Tech Testing, Inc.

- Engineering
- Geotechnical
- Environmental

LABORATORIES

P.O. Box 1625 • Lake City, FL 32056-1625  
6919 Distribution Avenue S., Unit #5 • Jacksonville, FL 32257

Tel. (386) 755-3633 • Fax (386) 752-5456  
Tel. (904) 262-4046 • Fax (904) 262-4047

June 23, 2005

Simque Construction  
P. O. Box 2962  
Lake City, Florida 32056

Attention: David Simque

Reference: Village Square, Building No. 2  
U. S. 90  
Lake City, Florida  
Cal-Tech Project No. 05-291

Dear Mr. Simque,

Cal-Tech Testing, Inc. has completed the subsurface investigation and engineering evaluation of the site for building No. 2 at Village Square on U. S. 90 in Lake City, Florida. Our work was planned in conjunction with and authorized by you.

### Introduction

We understand you will construct a single story, masonry building with lateral dimensions of approximately 50 feet by 150 feet. Support for the structure is to be provided by conventional, shallow spread footings. Anticipated foundation loads were not provided; however, we assume column and wall loads will not exceed 30 kips and 2.5 kips per foot, respectively. The proposed building site appears to have been striped and filled to grade.

The purposes of our investigation were to determine the general subsurface conditions in the proposed building area, and to present recommendations for design and construction as appropriate.

### Site Investigation

The subsurface conditions were investigated by performing three (3) Standard Penetration Test borings advanced to depths of 10 feet. The borings were performed at the approximate locations indicated on the attached Location Plan. These locations were selected by Cal-Tech Testing, Inc.

The Standard Penetration Test (ASTM D-1586) is performed by driving a standard split-barrel sampler into the soil by blows of a 140-pound hammer falling 30 inches. The number of blows required to drive the sampler 1 foot, after seating 6

*"Excellence in Engineering & Geoscience"*



inches, is designated the penetration resistance, or N-value; this value is an index to soil density or consistency.

### Findings

The soil borings encountered generally medium dense, tannish gray, brownish gray, grayish tan or dark gray sand (SP) for the full depth of the borings. Some roots were encountered at a depth of about 6 feet at boring location B-2. The N-values for this layer range from 9 to 36 blows per foot.

Groundwater was encountered at depths of 4.1 to 5.9 feet at the time of our investigation (6/20/05), and we estimate the wet season water table will occur at a depth of about 4 feet.

For a more detailed description of the subsurface conditions encountered, please refer to the attached Boring Logs. Note specifically the transition between soil layers may be gradual and not abrupt as indicated by the logs; therefore, the thickness of soil layers should be considered approximate.

### Discussion and Recommendations

From the results of our investigation, it is our opinion the structure can be supported by the proposed shallow spread footings, and we recommend these footings be sized to exert a maximum soil bearing pressure of 3,000 pounds per square foot. Further, we recommend the foundations have minimum widths of 18 and 24 inches for strip and isolated footings, respectively, even though the allowable soil bearing pressure may not be developed. We recommend the bottoms of foundations be embedded at least 16 inches below the lowest adjacent grade (finished surface grade, for example).

It appears very thorough compaction was performed for the fill materials; therefore, only normal, good practice site preparation procedures should be required to complete the construction.

We recommend bearing soils be proof-compacted to a minimum of 95% of the Modified Proctor maximum dry density to a depth of 1-foot below bearing grade. Fill soils, as required, should consist of relatively clean, fine sand containing less than 10% passing the No. 200 sieve. Fill should be placed in maximum 12-inch, loose lifts, and each lift should be proof-compacted to a minimum of 95% of the Modified Proctor maximum dry density.

Field density testing should be performed in the compacted subgrade, in each lift of fill, and in foundation excavations to verify the recommended compaction has been achieved.

Our recommendations are based upon our findings as described in this report; however, subsurface conditions may exist that were not encountered in the soil test



borings. Cal-Tech Testing, Inc. should be notified if different soil conditions are encountered during construction. It may be necessary to reevaluate this site and revise our recommendations.

We appreciate the opportunity to be of service on this project and look forward to a continued association. Please do not hesitate to contact us should you have questions concerning this report or if we may be of further assistance.

Respectfully submitted,  
Cal-Tech Testing, Inc.



Linda Creamer  
President / C. E. O.



John C. Dorman, Jr., Ph.D., P.E.  
Geotechnical Engineer

6/23/05  
52612

## B-1

Water Table: 5.9 ft.

Depth (ft)	N-value	Soil Description
0		
15		Medium Dense, Tannish Grey Sand (SP)
25		
5	23	
27		Medium Dense, Dark Tannish Grey Sand (SP)
29		Medium Dense, Tannish Grey Sand (SP)
36		Dense, Brownish Grey Sand (SP)
10		

## B-2


Water Table: 4.1 ft.

Depth (ft)	N-value	Soil Description
0		Tannish Grey Sand, Trace Clay (SP)
11		Medium Dense, Light Tannish Grey Sand (SP)
15		Medium Dense, Tannish Grey Sand (SP)
5	11	Medium Dense, Light Tannish Grey Sand (SP)
20		Medium Dense, Tannish Grey Sand with Roots (SP/Pt)
19		Medium Dense, Tannish Grey Sand (SP)
22		Medium Dense, Light Tannish Grey Sand (SP)
10		

## B-3

Water Table: 4.6 ft.

Depth (ft)	N-value	Soil Description
0		Tannish Grey Sand, Trace Clay (SP)
11		Medium Dense, Greyish Tan Sand, Trace Clay (SP)
17		Medium Dense, Light Tannish Grey Sand (SP)
5	9	Loose, Dark Grey Sand with Clay, Trace Organics (SP/SC)
17		Medium Dense, Tannish Grey Sand (SP)
15		
18		Medium Dense, Dark Brownish Grey Sand (SP)
10		

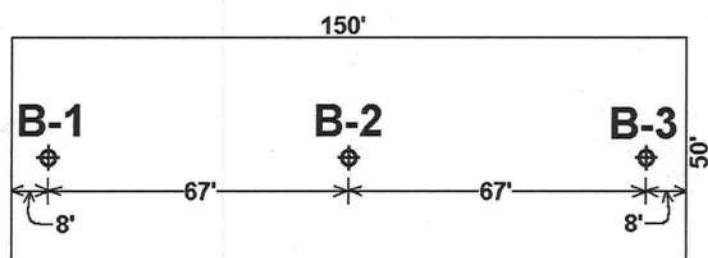

**Boring Logs and Location Plan: Village Square Building No. 2**



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION  
CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01

NORTH

Limited and Special Use Buildings

Climate Zones 1 2 3

Project Name: <u>VILLAGE SQUARE ; BLDG #2-A</u>	Zone:
Address: <u>US-90 WEST</u>	Building Classification:
City, Zip Code: <u>LAKE CITY, FL 32055</u>	Building Permit No.: <u>23409</u>
Builder: <u>SIMQUE CONSTRUCTION</u>	Permitting Office: <u>COLUMBIA COUNTY</u>
Owner: <u>WESTFIELD GROUP</u>	Jurisdiction No.:

BUILDING INFORMATION											
WALLS			ROOF/CEILING			FLOORS			DOORS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15	223	Under Attic	.03	1250	Slab-on-grade	—	1250	Wood		
Wood frame			Single Assembly			Raised Wood			Metal	.40	21
Metal frame	.13	134.3	Other:			Raised Concrete			Insulated		
Insulation R-value			Insulation R-value	30	1250	Insulation R-value			Other		

SYSTEMS INFORMATION													
AIR CONDITIONER						HEATING SYSTEM			HOT WATER				
TYPE	EFFICIENCY	TONS				TYPE	EFFICIENCY	BTUH	TYPE				
Unitary & Heat Pump	10 SEER	3				Central & Heat Pump	6.8 HSPF	37,500	Electric				
<65,000 Btu/h	— EER	— IPLV				<65,000 Btu/h	— COP	—	Resistance				
≥65,000 Btu/h	— EER	— IPLV				≥65,000 Btu/h	— COP	—	Dedicated Heat Pump				
Water cooled	— EER	— IPLV				Water cooled	— COP	—	Gas				
Evaporatively cooled	— EER	—				Evaporatively cooled	— COP	—	Natural				
PTAC	— EER	—				Electric Resistance	— COP	—	LPG				
Chiller	— COP	— IPLV				Gas/Oil (circle one)	—	—	HRU				
Gas heat pump	— COP	—				<225,000/300,000 Btu/h	— AFUE	—	Other:				
Other:	—	—				≥225,000/300,000 Btu/h	— E <sub>1</sub>	—					
LIGHTING						SIZING CALCULATION			DUCTS				
Total Lighting Wattage			1760			1.4			R-value 6				
Total Conditioned Floor Area			1250			Watts/sq. ft.			Location ATTIC				
						Attached							

PRESCRIPTIVE MEASURES (Must be met or exceeded by all buildings.)			
Components	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	✓
Windows & Doors	406.1	Maximum: .3 cfm per sq. ft. of window area; Maximum: 1.2 cfm per sq. ft. of door area.	✓
Joints/Cracks	406.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	✓
Dropped Ceiling Cavity	406.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	✓
Reheat	407.1	Electric resistance reheat prohibited.	✓
Ventilation	408.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	✓
HVAC Efficiency	407.1, 408.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	✓
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	✓
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	✓
Balancing	410.1	HVAC distribution system(s) tested and balanced.	✓
Piping Insulation	411.1	In accordance with Table 4-11.	✓
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+27/V <sub>r</sub> . Gas >75,000, Oil >105,000: E <sub>1</sub> .78, Standby loss ≤ 1.30+114/V <sub>r</sub> . Gas, Oil >155,000: E <sub>1</sub> .78, Standby loss ≤ 1.30+95/V <sub>r</sub> .	✓
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 8' of pipe from a storage tank.	✓
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixtures maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	✓
Lighting	415.1	Ballasts shall have Power Factors no less than .90.	✓

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code.		Registration No.			
ARCHITECT:					
ELECTRICAL SYSTEM DESIGNER:					
LIGHTING SYSTEM DESIGNER:					
MECHANICAL SYSTEM DESIGNER:					
PLUMBING SYSTEM DESIGNER:					
Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:					
Detached Buildings <200 sq. ft.	<input type="checkbox"/>	Convenience stores <5,000 sq. ft.	<input type="checkbox"/>	Office buildings <5,000 sq. ft.	<input type="checkbox"/>
Skyboxes/sports stadiums	<input type="checkbox"/>	Restaurants <5,000 sq. ft.	<input type="checkbox"/>	School buildings <5,000 sq. ft.	<input type="checkbox"/>
Traffic safety control towers	<input type="checkbox"/>	Retail stores <5,000 sq. ft.	<input checked="" type="checkbox"/>	Storage buildings <5,000 sq. ft.	<input type="checkbox"/>
I hereby certify that the plans and specifications covered by the calculation are in compliance with the Florida Energy Code			Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.908, F.S.		
PREPARED BY:	<u>7/10/05</u>	DATE:	<u>2/11/05</u>	BUILDING OFFICIAL:	
I hereby certify that this building is in compliance with the Florida Energy Code					
OWNER AGENT:		DATE:			



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION  
CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01

Limited and Special Use Buildings

NORTH

Climate Zones 1 2 3

Project Name: <u>VILLAGE SQUARE ; BLDG #2-B</u>	Zone:
Address: <u>US-90 WEST</u>	Building Classification:
City, Zip Code: <u>LAKE CITY 32055</u>	Building Permit No.:
Builder: <u>SIMQUE CONSTRUCTION</u>	Permitting Office: <u>COLUMBIA COUNTY</u>
Owner: <u>WESTFIELD GROUP</u>	Jurisdiction No.:

BUILDING INFORMATION											
WALLS			ROOF/CEILING			FLOORS			DOORS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15	220	Under Attic	.03	1232	Slab-on-grade	0	1232	Wood		
Wood frame	.13	1340	Single Assembly			Raised Wood			Metal	.40	21
Metal frame			Other:			Raised Concrete			Insulated		
Insulation R-value			Insulation R-value			Insulation R-value			Other		

SYSTEMS INFORMATION											
AIR CONDITIONING						HEATING SYSTEM			HOT WATER		
TYPE	EFFICIENCY		TONE			TYPE	EFFICIENCY		TYPE		
Unitary & Heat Pump	10 SEER		3			Central & Heat Pump	6.8 HSPF		Electric		
<65,000 Btu/h						<65,000 Btu/h			Resistance		
≥65,000 Btu/h	EER		IPLV			≥65,000 Btu/h	COP		Dedicated Heat Pump		
Water cooled	EER		IPLV			Water cooled	COP		Gas		
Evaporatively cooled	EER					Evaporatively cooled	COP		Natural		
PTAC	EER					Electric Resistance	COP		LPG		
Chiller	COP		IPLV			Gas/Oil (circulo one)			HRU		
Gas heat pump	COP					<225,000/300,000 Btu/h	AFUE		Other:		
Other:						≥225,000/300,000 Btu/h	E <sub>t</sub>				

LIGHTING	Total Lighting Wastage	1760	1.4	SIZING CALCULATION		DUCTS	R-value	6
	Total Conditioned Floor Area	1232	Watts/sq. ft.	Attached	<input type="checkbox"/>		Location	ATTIC

PRESCRIPTIVE MEASURES (Must be met or exceeded by all buildings.)			
Component	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	✓
Windows & Doors	408.1	Maximum: .5 cfm per sq. ft. of window area; Maximum: 1.2 cfm per sq. ft. of door area.	✓
Joints/Cracks	408.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	✓
Dropped Ceiling Cavity	408.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	✓
Reheat	407.1	Electric resistance reheat prohibited.	✓
Ventilation	409.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	✓
HVAC Efficiency	407.1, 409.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	✓
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	✓
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	✓
Balancing	410.1	HVAC distribution system(s) tested and balanced.	✓
Piping Insulation	411.1	In accordance with Table 4-11.	✓
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+27/V <sub>t</sub> . Gas >75,000, Oil >105,000: E <sub>t</sub> .78, Standby loss ≤ 1.30+114/V <sub>t</sub> . Gas, Oil >155,000: E <sub>t</sub> .78, Standby loss ≤ 1.30+95/V <sub>t</sub> .	✓
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spas & pool heaters must have a minimum thermal efficiency of 78%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 8' of pipe from a storage tank.	✓
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixture maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	✓
Lighting	415.1	Ballasts shall have Power Factors no less than .80.	✓

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code. Registration No. \_\_\_\_\_

ARCHITECT: \_\_\_\_\_

ELECTRICAL SYSTEM DESIGNER: \_\_\_\_\_

LIGHTING SYSTEM DESIGNER: \_\_\_\_\_

MECHANICAL SYSTEM DESIGNER: \_\_\_\_\_

PLUMBING SYSTEM DESIGNER: \_\_\_\_\_

Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:

Detached Buildings <200 sq. ft.	<input type="checkbox"/>	Convenience stores <5,000 sq. ft.	<input type="checkbox"/>	Office buildings <5,000 sq. ft.	<input type="checkbox"/>
Skyboxes/sports stadiums	<input type="checkbox"/>	Restaurants <5,000 sq. ft.	<input type="checkbox"/>	School buildings <5,000 sq. ft.	<input type="checkbox"/>
Traffic safety control towers	<input type="checkbox"/>	Retail stores <5,000 sq. ft.	<input checked="" type="checkbox"/>	Storage buildings <5,000 sq. ft.	<input type="checkbox"/>

I hereby certify that the plans and specifications created by the calculation are in compliance with the Florida Energy Code. PREPARED BY: [Signature] DATE: 2/11/05

I hereby certify that this building is in compliance with the Florida Energy Code. OWNER AGENT: \_\_\_\_\_ DATE: \_\_\_\_\_

Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.908, F.S.

BUILDING OFFICIAL: \_\_\_\_\_ DATE: \_\_\_\_\_



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION  
CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01

Limited and Special Use Buildings

NORTH

Climate Zones 1 2 3

Project Name: <u>VILLAGE SQUARE ; BLDG # 2 - C</u>	Zone:
Address: <u>US-90 WEST</u>	Building Classification:
City, Zip Code: <u>LAKE CITY 32055</u>	Building Permit No.:
Builder: <u>SIMQUE CONSTRUCTION</u>	Permitting Office: <u>COLUMBIA COUNTY</u>
Owner: <u>WEST FIELD GROUP</u>	Jurisdiction No.:

BUILDING INFORMATION											
WALLS			ROOF/CEILING			FLOORS			DOORS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15	237	Under Slab	.03	1325	Slab-on-grade	0	1325	Wood		
Wood frame	.13	1357	Single Assembly			Raised Wood			Metal	.40	21
Metal frame			Other:			Raised Concrete			Insulated		
Insulation R-value			Insulation R-value	30		Insulation R-value			Other		
									Double, wall	.87	167
									Single, roof		
									Double, roof		

SYSTEMS INFORMATION											
AIR CONDITIONER				HEATING SYSTEM				HOT WATER			
TYPE	EFFICIENCY	TONS		TYPE	EFFICIENCY	BTU/H		TYPE			
Unitary & Heat Pump	10.0	SEER	3	Central & Heat Pump	6.8	HSPF	37,500	Electric			
<65,000 Btu/h	—	EER	—	<65,000 Btu/h	—	COP	—	Resistance			<input checked="" type="checkbox"/>
≥65,000 Btu/h	—	EER	—	≥65,000 Btu/h	—	COP	—	Dedicated Heat Pump			<input type="checkbox"/>
Water cooled	—	EER	—	Water cooled	—	COP	—	Gas			
Evaporatively cooled	—	EER	—	Evaporatively cooled	—	COP	—	Natural			<input type="checkbox"/>
PTAC	—	EER	—	Electric Resistance	—	COP	—	LPG			<input type="checkbox"/>
Chiller	—	COP	—	Gas/Oil (circle one)	—	AFUE	—	HRU			<input type="checkbox"/>
Gas heat pump	—	COP	—	<225,000/300,000 Btu/h	—	E <sub>1</sub>	—	Other:			<input type="checkbox"/>
Other:	—	—	—	≥225,000/300,000 Btu/h	—	E <sub>1</sub>	—				
LIGHTING				SIZING CALCULATION				DUCTS			
Total Lighting Wattage			1760	Attached			<input type="checkbox"/>	R-value			0
Total Conditioned Floor Area			1325	Watts/sq. ft.				Location			ATTIC

PRESCRIPTIVE MEASURES (Must be met or exceeded by all buildings.)			
Component	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	<input checked="" type="checkbox"/>
Windows & Doors	408.1	Maximum: .3 cfm per sq.ft. of window area; Maximum: 1.2 cfm per sq.ft. of door area.	<input checked="" type="checkbox"/>
Joints/Seals	408.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	<input checked="" type="checkbox"/>
Dropped Ceiling Cavity	408.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	<input checked="" type="checkbox"/>
Reheat	407.1	Electric resistance reheat prohibited.	<input checked="" type="checkbox"/>
Ventilation	409.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	<input checked="" type="checkbox"/>
HVAC Efficiency	407.1, 409.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	<input checked="" type="checkbox"/>
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	<input checked="" type="checkbox"/>
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	<input checked="" type="checkbox"/>
Sealing	410.1	HVAC distribution system(s) tested and balanced.	<input checked="" type="checkbox"/>
Piping Insulation	411.1	In accordance with Table 4-11.	<input checked="" type="checkbox"/>
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+27/V <sub>T</sub> . Gas >75,000, Oil >105,000: E <sub>1</sub> , .78, Standby loss ≤ 1.30+114/V <sub>T</sub> . Gas, Oil >155,000: E <sub>1</sub> , .78, Standby loss ≤ 1.30+95/V <sub>T</sub> .	<input checked="" type="checkbox"/>
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 6' of pipe from a storage tank.	<input checked="" type="checkbox"/>
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixture maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	<input checked="" type="checkbox"/>
Lighting	415.1	Ballasts shall have Power Factors no less than .80.	<input checked="" type="checkbox"/>

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code.		Registration No.
ARCHITECT:		
ELECTRICAL SYSTEM DESIGNER:		
LIGHTING SYSTEM DESIGNER:		
MECHANICAL SYSTEM DESIGNER:		
PLUMBING SYSTEM DESIGNER:		
Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:		
Detached Buildings <200 sq. ft.	<input type="checkbox"/>	Convenience stores <5,000 sq. ft.
Skyboxes/sports stadiums	<input type="checkbox"/>	Restaurants <5,000 sq. ft.
Traffic safety control towers	<input type="checkbox"/>	Retail stores <5,000 sq. ft.
		Office buildings <5,000 sq. ft.
		School buildings <5,000 sq. ft.
		Storage buildings <5,000 sq. ft.
I hereby certify that the plans and specifications covered by the calculation are in compliance with the Florida Energy Code.		Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.908, F.S.
PREPARED BY: <u>[Signature]</u>	DATE: <u>2/11/05</u>	BUILDING OFFICIAL: _____
I hereby certify that this building is in compliance with the Florida Energy Code.	DATE: _____	DATE: _____
OWNER AGENT: _____	DATE: _____	



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION  
CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01  
Limited and Special Use Buildings

NORTH  
Climate Zones 1 2 3

Project Name: VILLAGE SQUARE ; BLDG # 2 - D

Zone:

Address: US-90 WEST

Building Classification:

City, Zip Code: LAKE CITY 32055

Building Permit No.:

Builder: SIMQUE CONSTRUCTION

Permitting Office: COLUMBIA COUNTY

Owner: WEST FIELD GROUP

Jurisdiction No.:

BUILDING INFORMATION											
WALLS			ROOF/CEILING			FLOORS			DOORS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15	240	Under Attic	.03	1344	Slab-on-grade	0	1344	Wood		
Wood frame	.13	1360	Single Assembly			Raised Wood			Metal	.48	21
Metal frame			Other:			Raised Concrete			Insulated		
Insulation R-value			Insulation R-value	30		Insulation R-value			Other		

AIR CONDITIONING

TYPE

EFFICIENCY

TONS

HEATING SYSTEM

TYPE

EFFICIENCY

BTUH

HOT WATER

TYPE

Unitary & Heat Pump

10.0 SEER

3

Central & Heat Pump

6.8 HSPF

37,500

Electric

<65,000 Btu/h

— EER

— IPLV

<65,000 Btu/h

— COP

—

Resistance

☒

≥65,000 Btu/h

— EER

— IPLV

≥65,000 Btu/h

— COP

—

Dedicated Heat Pump

☐

Water cooled

— EER

— IPLV

Water cooled

— COP

—

Gas

☐

Evaporatively cooled

— EER

—

Evaporatively cooled

— COP

—

Natural

☐

PTAC

— EER

—

Electric Resistance

— COP

—

LPG

☐

Chiller

— COP

— IPLV

Gas/Oil (circle one)

— AFUE

—

HRU

☐

Gas heat pump

— COP

—

<225,000/300,000 Btu/h

— E<sub>t</sub>

—

Other:

☐

Other:

—

—

>225,000/300,000 Btu/h

—

—

☐

LIGHTING

Total Lighting Wattage

1760

1.3

SIZING CALCULATION

DUCTS

R-value

0

Total Conditioned Floor Area

1344

Watts/sq. ft.

Attached

☐

Location

ATTIC

PRESCRIPTIVE MEASURES (Must be met or exceeded by all buildings.)			
Component	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	<input checked="" type="checkbox"/>
Windows & Doors	408.1	Maximum: .3 cfm per sq. ft. of window area; Maximum: 1.2 cfm per sq. ft. of door area.	<input checked="" type="checkbox"/>
Joint/Cracks	408.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	<input checked="" type="checkbox"/>
Dropped Ceiling Cavity	408.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	<input checked="" type="checkbox"/>
Reheat	407.1	Electric resistance reheat prohibited.	<input checked="" type="checkbox"/>
Ventilation	408.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	<input checked="" type="checkbox"/>
HVAC Efficiency	407.1, 408.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	<input checked="" type="checkbox"/>
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	<input checked="" type="checkbox"/>
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	<input checked="" type="checkbox"/>
Balancing	410.1	HVAC distribution system(s) tested and balanced.	<input checked="" type="checkbox"/>
Piping Insulation	411.1	In accordance with Table 4-11.	<input checked="" type="checkbox"/>
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+27/V <sub>t</sub> . Gas >75,000, Oil >105,000: E <sub>t</sub> , 78. Standby loss ≤ 1.30+114/V <sub>t</sub> . Gas, Oil >155,000: E <sub>t</sub> , 78. Standby loss ≤ 1.30+95/V <sub>t</sub> .	<input checked="" type="checkbox"/>
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 6' of pipe from a storage tank.	<input checked="" type="checkbox"/>
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixture maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	<input checked="" type="checkbox"/>
Lighting	415.1	Ballasts shall have Power Factors no less than .80.	<input checked="" type="checkbox"/>

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code.

Registration No.

ARCHITECT:

ELECTRICAL SYSTEM DESIGNER:

LIGHTING SYSTEM DESIGNER:

MECHANICAL SYSTEM DESIGNER:

PLUMBING SYSTEM DESIGNER:

Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:

Detached Buildings <200 sq. ft. ☐

Convenience stores <5,000 sq. ft. ☐

Office buildings <5,000 sq. ft. ☐

Stadiums/sports stadiums ☐

Restaurants <5,000 sq. ft. ☐

School buildings <5,000 sq. ft. ☐

Traffic safety control towers ☐

Retail stores <5,000 sq. ft. ☒

Storage buildings <5,000 sq. ft. ☐

I hereby certify that the plans and specifications covered by the calculation are in compliance with the Florida Energy Code

PREPARED BY: [Signature]

DATE: 2/11/05

I hereby certify that this building is in compliance with the Florida Energy Code

OWNER AGENT:

DATE:

Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.908, F.S.

BUILDING OFFICIAL:

DATE:



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION  
CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01  
Limited and Special Use Buildings

NORTH  
Climate Zones 1 2 3

Project Name: VILLAGE SQUARE ; BLDG # 2 - E

Zone:

Address: US-90 WEST

Building Classification:

City, Zip Code: LAKE CITY 32055

Building Permit No.:

Builder: SIMQUE CONSTRUCTION

Permitting Office: COLUMBIA COUNTY

Owner: WEST FIELD GROUP

Jurisdiction No.:

BUILDING INFORMATION											
WALLS			ROOF/CEILING			FLOORS			DOORS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15		Under Attic	.03	1325	Slab-on-grade		1325	Wood		
Wood frame	.13		Single Assembly			Raised Wood			Metal	.40	21
Metal frame			Other:			Raised Concrete			Insulated		57
Insulation R-value			Insulation R-value	30		Insulation R-value			Other		167

AIR CONDITIONER

TYPE

EFFICIENCY

TONS

HEATING SYSTEM

TYPE

EFFICIENCY

BTUH

HOT WATER

TYPE

Unitary & Heat Pump

10.0

SEER

3

Central & Heat Pump

6.8

HSPF

37,500

Electric

<65,000 Btu/h

—

EER

—

IPLV

—

>65,000 Btu/h

—

COP

—

Resistance

Water cooled

—

EER

—

IPLV

—

Water cooled

—

COP

—

Dedicated Heat Pump

Evaporatively cooled

—

EER

—

—

Evaporatively cooled

—

COP

—

Gas

PTAC

—

EER

—

—

Electric Resistance

—

COP

—

Natural

Chiller

—

COP

—

IPLV

—

Gas/Oil (choose one)

—

AFUE

—

LPG

Gas heat pump

—

COP

—

—

<225,000/300,000 Btu/h

—

—

HRU

Other:

—

—

—

>225,000/300,000 Btu/h

—

E<sub>t</sub>

Other:

LIGHTING

Total Lighting Wattage

1760

1.3

SIZING CALCULATION

DUCTS

R-value

0

Total Conditioned Floor Area

1325

Watts/sq. ft.

Attached

Location

ATTIC

PRESCRIPTIVE MEASURES (Must be met or exceeded by all buildings.)			
Component	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	✓
Windows & Doors	408.1	Maximum: .3 cfm per sq.ft. of window area; Maximum: 1.2 cfm per sq.ft. of door area.	✓
Joint/Cracks	408.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	✓
Dropped Ceiling Cavity	408.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	✓
Reheat	407.1	Electric resistance reheat prohibited.	✓
Ventilation	408.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	✓
HVAC Efficiency	407.1, 408.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	✓
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	✓
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	✓
Balancing	410.1	HVAC distribution system(s) tested and balanced.	✓
Piping Insulation	411.1	In accordance with Table 4-11.	✓
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+27/V <sub>t</sub> . Gas >75,000, Oil >105,000: E <sub>t</sub> .78, Standby loss ≤ 1.30+114/V <sub>t</sub> . Gas, Oil >155,000: E <sub>t</sub> .78, Standby loss ≤ 1.30+95/V <sub>t</sub> .	✓
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 76%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 6' of pipe from a storage tank.	✓
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixture maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	✓
Lighting	415.1	Ballasts shall have Power Factors no less than .80.	✓

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code.

Registration No.

ARCHITECT:

ELECTRICAL SYSTEM DESIGNER:

LIGHTING SYSTEM DESIGNER:

MECHANICAL SYSTEM DESIGNER:

PLUMBING SYSTEM DESIGNER:

Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:

Detached Buildings <200 sq. ft. ☐

Convenience stores <5,000 sq. ft. ☐

Office buildings <5,000 sq. ft. ☐

Stadiums/sports stadiums ☐

Restaurants <5,000 sq. ft. ☐

School buildings <5,000 sq. ft. ☐

Traffic safety control towers ☐

Retail stores <5,000 sq. ft. ☒

Storage buildings <5,000 sq. ft. ☐

I hereby certify that the plans and specifications covered by the calculation are in compliance with the Florida Energy Code

PREPARED BY: [Signature]

DATE: 2/11/05

I hereby certify that this building is in compliance with the Florida Energy Code

OWNER AGENT: [Signature]

DATE:

Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.008, F.S.

BUILDING OFFICIAL:

DATE:



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01

Limited and Special Use Buildings

NORTH

Climate Zones 1 2 3

Project Name: VILLAGE SQUARE ; BLDG # 2-F

Zone:

Address: US-90 WEST

Building Classification:

City, Zip Code: LAKE CITY 32055

Building Permit No.:

Builder: SIMQUE CONSTRUCTION

Permitting Office: COLUMBIA COUNTY

Owner: WESTFIELD GROUP

Jurisdiction No.:

BUILDING INFORMATION

WALLS			ROOF/CEILING			FLOORS			DOORS			GLASS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15	220	Under Attic	.03	1232	Slab-on-grade	0	1232	Wood			Single, wall		
Wood frame	.13	1340	Single Assembly			Raised Wood			Metal	.40	21	Double, wall	.87	167
Metal frame			Other:			Raised Concrete			Insulated			Single, roof		
Insulation R-value			Insulation R-value			Insulation R-value			Other			Double, roof		

SYSTEMS INFORMATION

AIR CONDITIONER			HEATING SYSTEM			HOT WATER		
TYPE	EFFICIENCY	TONS	TYPE	EFFICIENCY	BTU/H	TYPE		
Unitary & Heat Pump			Central & Heat Pump			Electric		
<65,000 Btu/h	10 SEER	3	<65,000 Btu/h	6.8 HSPF	37,500	Resistance		<input checked="" type="checkbox"/>
>65,000 Btu/h	EER	IPLV	>65,000 Btu/h	COP		Dedicated Heat Pump		<input type="checkbox"/>
Water cooled	EER	IPLV	Water cooled	COP		Gas		
Evaporatively cooled	EER		Evaporatively cooled	COP		Natural		<input type="checkbox"/>
PTAC	EER		Electric Resistance	COP		LPG		<input type="checkbox"/>
Chiller	COP	IPLV	Gas/Oil (circle one)			HRU		<input type="checkbox"/>
Gas heat pump	COP		<225,000/300,000 Btu/h	AFUE		Other:		<input type="checkbox"/>
Other:			>225,000/300,000 Btu/h	E <sub>t</sub>				

LIGHTING

Total Lighting Wattage = 1760

Total Conditioned Floor Area = 1232

Watts/sq. ft. = 1.4

SIZING CALCULATION

Attached ☐

DUCTS R-value = 0

Location = ATTIC

PREScriptive MEASURES (Must be met or exceeded by all buildings.)

Components	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	<input checked="" type="checkbox"/>
Windows & Doors	408.1	Maximum: .3 cfm per sq.ft. of window area; Maximum: 1.2 cfm per sq.ft. of door area.	<input checked="" type="checkbox"/>
Joints/Cracks	408.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	<input checked="" type="checkbox"/>
Dropped Ceiling Cavity	408.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	<input checked="" type="checkbox"/>
Reheat	407.1	Electric resistance reheat prohibited.	<input checked="" type="checkbox"/>
Ventilation	408.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	<input checked="" type="checkbox"/>
HVAC Efficiency	407.1, 408.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	<input checked="" type="checkbox"/>
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	<input checked="" type="checkbox"/>
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	<input checked="" type="checkbox"/>
Balancing	410.1	HVAC distribution system(s) tested and balanced.	<input checked="" type="checkbox"/>
Piping Insulation	411.1	In accordance with Table 4-11.	<input checked="" type="checkbox"/>
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+27/V <sub>t</sub> . Gas >75,000, Oil >105,000: E <sub>t</sub> .78, Standby loss ≤ 1.30+114/V <sub>t</sub> . Gas, Oil >155,000: E <sub>t</sub> .78, Standby loss ≤ 1.30+98/V <sub>t</sub> .	<input checked="" type="checkbox"/>
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spas & pool heaters must have a minimum thermal efficiency of 78%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 6' of pipe from a storage tank.	<input checked="" type="checkbox"/>
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixture maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	<input checked="" type="checkbox"/>
Lighting	415.1	Ballasts shall have Power Factors no less than .80.	<input checked="" type="checkbox"/>

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code.

ARCHITECT: \_\_\_\_\_

ELECTRICAL SYSTEM DESIGNER: \_\_\_\_\_

LIGHTING SYSTEM DESIGNER: \_\_\_\_\_

MECHANICAL SYSTEM DESIGNER: \_\_\_\_\_

PLUMBING SYSTEM DESIGNER: \_\_\_\_\_

Registration No. \_\_\_\_\_

Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:

Detached Buildings <200 sq. ft. ☐

Convenience stores <5,000 sq. ft. ☐

Office buildings <5,000 sq. ft. ☐

Skyboxes/sports stadiums ☐

Restaurants <5,000 sq. ft. ☐

School buildings <5,000 sq. ft. ☐

Traffic safety control towers ☐

Retail stores <5,000 sq. ft. ☒

Storage buildings <5,000 sq. ft. ☐

I hereby certify that the plans and specifications covered by the calculation are in compliance with the Florida Energy Code.

PREPARED BY: [Signature] DATE: 2/11/05

I hereby certify that this building is in compliance with the Florida Energy Code.

OWNER AGENT: \_\_\_\_\_ DATE: \_\_\_\_\_

Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.008, F.S.

BUILDING OFFICIAL: \_\_\_\_\_

DATE: \_\_\_\_\_



FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

CHAPTER 4 — Commercial Building Compliance Methods

FORM 400C-01

Limited and Special Use Buildings

NORTH

Climate Zones 1 2 3

Project Name: VILLAGE SQUARE ; BLDG #2 - G

Zone:

Address: US-90 WEST

Building Classification:

City, Zip Code: LAKE CITY, FL 32055

Building Permit No.:

Builder: SIMQUE CONSTRUCTION

Permitting Office: COLUMBIA COUNTY

Owner: WESTFIELD GROUP

Jurisdiction No.:

BUILDING INFORMATION											
WALLS			ROOF/CEILING			FLOORS			DOORS		
TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA	TYPE	U	AREA
Concrete (CBS)	.15	223	Under Attic	.03	1250	Slab-on-grade	—	1250	Wood		
Wood frame			Single Assembly			Raised Wood			Metal	.40	21
Metal frame	.13	1343	Other:			Raised Concrete			Insulated		
Insulation R-value			Insulation R-value	20	1250	Insulation R-value			Other		

AIR CONDITIONER

TYPE

EFFICIENCY

TONS

Unitary & Heat Pump

<65,000 Btu/h

10 SEER

3

>65,000 Btu/h

— EER

— IPLV

—

Water cooled

— EER

— IPLV

—

Evaporatively cooled

— EER

—

—

PTAC

— EER

—

—

Chiller

— COP

— IPLV

—

Gas heat pump

— COP

—

—

Other:

—

—

—

HEATING SYSTEM

TYPE

EFFICIENCY

BTUH

Central & Heat Pump

<65,000 Btu/h

6.8 HSPF

37,500

>65,000 Btu/h

— COP

—

—

Water cooled

— COP

—

—

Evaporatively cooled

— COP

—

—

Electric Resistance

— COP

—

—

Gas/Oil (circle one)

— AFUE

—

—

<225,000/300,000 Btu/h

— E<sub>1</sub>

—

—

>225,000/300,000 Btu/h

—

—

—

HOT WATER

TYPE

Electric

Resistance

☒

Gas

Dedicated Heat Pump

☐

Natural

LPG

☐

HRU

Other:

☐

LIGHTING

Total Lighting Wattage

1760

Total Conditioned Floor Area

1250

Watts/sq. ft.

1.4

SIZING CALCULATION

Attached

☐

DUCTS

R-value

6

Location

ATTIC

PRESCRIPTIVE MEASURES (Must be met or exceeded by all buildings.)			
Components	Section	Requirements	Check
Operations Manual	102.1	Operations manual will be provided to owner.	<input checked="" type="checkbox"/>
Windows & Doors	406.1	Maximum: .3 cfm per sq.ft. of window area; Maximum: 1.2 cfm per sq.ft. of door area.	<input checked="" type="checkbox"/>
Joints/Cracks	406.1	To be caulked, gasketed, weatherstripped or otherwise sealed.	<input checked="" type="checkbox"/>
Dropped Ceiling Cavity	406.1	Vented: seal and insulate ceiling (no T-bar ceilings). Unvented, no ceiling air barrier: seal and insulate roof and side walls.	<input checked="" type="checkbox"/>
Reheat	407.1	Electric resistance reheat prohibited.	<input checked="" type="checkbox"/>
Ventilation	409.1	Supplied with readily accessible switch for shut-off and/or volume reduction when ventilation is not required.	<input checked="" type="checkbox"/>
HVAC Efficiency	407.1, 408.1	Minimum efficiencies — Heating: Tables 4-7, 4-8, 4-9. Cooling: Tables 4-3, 4-4, 4-5, 4-6.	<input checked="" type="checkbox"/>
HVAC Controls	407.1	Separate readily accessible manual or automatic thermostat for each system.	<input checked="" type="checkbox"/>
HVAC Ducts	410.1	Air ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated and installed in accordance with the criteria of section 410.1.	<input checked="" type="checkbox"/>
Balancing	410.1	HVAC distribution system(s) tested and balanced.	<input checked="" type="checkbox"/>
Piping Insulation	411.1	In accordance with Table 4-11.	<input checked="" type="checkbox"/>
Water Heaters	412.1	Automatic electric storage water heaters ≤120 gallons and gas & oil fired storage water heaters ≤75,000 Btu/h shall meet performance requirements in Table 4-12. Electric >120 gallons: standby loss ≤.30+.27/V <sub>r</sub> . Gas >75,000, Oil >105,000: E <sub>1</sub> .78, Standby loss ≤ 1.30+114/V <sub>r</sub> . Gas, Oil >155,000: E <sub>1</sub> .78, Standby loss ≤ 1.30+95/V <sub>r</sub> .	<input checked="" type="checkbox"/>
Swimming Pools & Spas	412.1	Spas & heated pools must have covers. Non-commercial pools must have pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%.	N/A
Hot Water Pipe Insulation	412.1	Piping heat loss is limited to the levels in Table 4-11 for circulating systems and the first 8' of pipe from a storage tank.	<input checked="" type="checkbox"/>
Water Fixtures	412.1	Shower head water flow restricted to maximum of 2.5 gpm at 80 psi. Toilets meet 42CFR 6295(k). Public lavatory fixture maximum flow of .5 gpm; or if self-closing valve, .25 gallon circulating, .5 gallon non-circulating.	<input checked="" type="checkbox"/>
Lighting	415.1	Ballasts shall have Power Factors no less than .90.	<input checked="" type="checkbox"/>

If required by Florida law, I hereby certify that the system design is in compliance with the Florida Energy Code.

Registration No.

ARCHITECT:

ELECTRICAL SYSTEM DESIGNER:

LIGHTING SYSTEM DESIGNER:

MECHANICAL SYSTEM DESIGNER:

PLUMBING SYSTEM DESIGNER:

Compliance with Chapter 4 was demonstrated by a Prescriptive Measures methodology:

Detached Buildings <200 sq ft. ☐

Convenience stores <5,000 sq.ft. ☐

Office buildings <5,000 sq.ft. ☐

Skyboxes/sports stadiums ☐

Restaurants <5,000 sq.ft. ☒

School buildings <5,000 sq.ft. ☐

Traffic safety control towers ☐

Retail stores <5,000 sq.ft. ☒

Storage buildings <5,000 sq.ft. ☐

I hereby certify that the plans and specifications covered by the calculation are in compliance with the Florida Energy Code

PREPARED BY: [Signature]

DATE: 2/11/05

I hereby certify that this building is in compliance with the Florida Energy Code

OWNER AGENT: [Signature]

DATE:

Review of plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed, this building will be inspected for compliance in accordance with Section 553.908, F.S.

BUILDING OFFICIAL:

DATE:



PRESCRIPTIVE REQUIREMENTS LIST\*

\*All Basic Prescriptive Requirements, designated in the Code by ".1.ABCD" and summarized on the front of this form, must also be met.

CLIMATE ZONES 1 2 3

FORM 400C-01  
METHOD C

CHECK

Detached Commercial Buildings Less than 200 sq.ft.

Table 4C-1

Glass Area: No limit.  
Overhang: Minimum 1 foot if not under another structure; or  
No overhang with a glazing Solar Heat Gain Coefficient of 0.48 or less.  
Walls: Minimum insulation level  
Frame walls – R-11.  
Masonry walls – R-5.  
Roofs/Ceilings: Minimum insulation level – R-19.  
Floors: Minimum insulation level – None.  
Cooling System: Code minimums as per section 407.1.ABCD.3.  
Heating System: Code minimums as per section 408.1.ABCD.3.

Skyboxes or Sports Stadiums

Table 4C-2

Glass: No limit with glazing Solar Heat Gain Coefficient of 0.48 or less.  
Overhang: None required.  
Walls: Minimum insulation level  
Frame walls – R-11.  
Masonry walls – R-5.  
Roofs/Ceilings: Minimum insulation level – R-19.  
Floors: Minimum insulation level  
Frame floor – R-19.  
Concrete floor – None.  
Cooling System: Minimum equipment efficiency requirements  
Air cooled – 10.0 EER or 10.5 SEER.  
Water cooled – 11.0 EER.  
Heating System: Code minimums as per section 408.1.ABCD.3.  
Air Distribution: A programmable setback shall be installed for in-season use;  
At least one humidistat control per zone shall be installed for off-season use.  
EXCEPTION: Installation of a central energy management system.  
Lighting: Total connected wattage shall not exceed 1.8 watts per square foot of conditioned space.

Traffic Safety Control Towers

Table 4C-3

Glass: No limit.  
Overhang: Minimum 1 foot if not under another structure; or  
No overhang with a glazing Solar Heat Gain Coefficient of 0.48 or less.  
Walls: Minimum insulation level  
Frame walls – R-11.  
Masonry walls – R-5.  
Roofs/Ceilings: Minimum insulation level – R-19.  
Floors: Minimum insulation level – None.  
Cooling System: Code minimums as per section 407.1.ABCD.3.  
Heating System: Code minimums as per section 408.1.ABCD.3.  
Lighting: Total connected wattage shall not exceed 2.1 watts per square foot of conditioned space.

General Requirements for Building Packages <5,000 sq.ft.

Table 4C-4

FLOOR: Slab-on-Grade R-0  
Raised Wood R-19  
Raised Concrete R-7  
WALL: Masonry R-7 (exterior, adjacent and common)  
Wood Frame R-11 (exterior, adjacent and common)  
Metal Frame R-13 (exterior, adjacent and common)  
ROOF: Insulation above Deck R-19  
Insulation In Attic or Dropped Ceiling Cavity R-19  
INFILTRATION: Code minimums in section 406.1.ABCD.1  
DUCTS: Code minimums in section 410.1.ABCD.2  
DOMESTIC HOT WATER: Code minimums in section 412.1.ABCD.3  
LIGHTING CONTROLS: Each space must have the lights divided into at least two "banks" — each one with a manual On/Off switch;  
OR Each space must have one occupancy sensor (or other automatic control) to turn the lights on and off.



FORM 400C-01

HVAC, GLASS AREA, AND LIGHTING: See Chart below. Select and circle the desired combination of glass-to-wall area percentage (GL AREA %) and lighting level (W/SF) based on the type of HVAC system and efficiency. Report the levels installed on the front of the form.

Table 4C-5CONVENIENCE BUILDING < 5,000 SF									
MAXIMUM ALLOWABLE GLASS AREA % AND ALLOWABLE LIGHTING W/SF									
Cooling Equipment Capacity ≥85,000 Btu/h, Room Units, PTACs								Capacity <85,000 Btu/h	
EER: 8.9-9.0		EER: 9.1-10.0		EER: 10.1-11.0		EER: 11.1-UP		SEER: 10.0-UP	
GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF
15	2.7	15	2.7	15	3.1	15	3.5	15	3.5
25	2.4	25	2.9	25	2.9	25	3.1	25	3.1
				35	2.4	35	2.7	35	2.7
						45	2.1	45	2.1
						And Heat Pump		And Heat Pump	
						COP: ≥ 3.0		HSPF: ≥ 6.8	
						55	3.9	55	3.9

Glazing:  
Solar Heat Gain Coefficient ≤0.87

Table 4C-6RESTAURANT BUILDING < 5,000 SF									
MAXIMUM ALLOWABLE GLASS AREA % AND ALLOWABLE LIGHTING W/SF									
Cooling Equipment Capacity ≥85,000 Btu/h, Room Units, PTACs								Capacity <85,000 Btu/h	
EER: 8.9-9.0		EER: 9.1-10.0		EER: 10.1-11.0		EER: 11.1-UP		SEER: 10.0-UP	
GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF
30	1.0	30	1.2	30	1.4	30	1.6	30	1.6
35	0.8	35	1.0	35	1.2	35	1.4	35	1.4
		40	0.8	40	1.0	40	1.2	40	1.2
				45	0.8	45	1.0	45	1.0
				50	0.6	50	0.8	50	0.8
						And Heat Pump		And Heat Pump	
						COP: ≥ 3.0		HSPF: ≥ 6.8	
						65	1.8	65	1.8

Glazing:  
Solar Heat Gain Coefficient ≤0.77 or  
Double Pane

Table 4C-7RETAIL BUILDING < 5,000 SF									
MAXIMUM ALLOWABLE GLASS AREA % AND ALLOWABLE LIGHTING W/SF									
Cooling Equipment Capacity ≥85,000 Btu/h, Room Units, PTACs								Capacity <85,000 Btu/h	
EER: 8.9-9.0		EER: 9.1-10.0		EER: 10.1-11.0		EER: 11.1-UP		SEER: 10.0-UP	
GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF
35	2.2	35	2.4	35	2.5	35	2.8	35	2.8
45	2.0	45	2.2	45	2.3	45	2.4	45	2.4
		55	2.0	55	2.1	55	2.2	55	2.2
						And Heat Pump		And Heat Pump	
						COP: ≥ 3.0		HSPF: ≥ 6.8	
						65	3.0	65	3.0

Glazing:  
Solar Heat Gain Coefficient ≤0.87



FORM 400C-97

CLIMATE ZONES 1 2 3

HVAC, GLASS AREA, AND LIGHTING: See Chart below. Select and circle the desired combination of glass-to-wall area percentage (GL AREA %) and lighting level (W/SF) based on the type of HVAC system and efficiency. Report the levels installed on the front of the form.

Table 4C-8 OFFICE BUILDING < 5,000 SF									
MAXIMUM ALLOWABLE GLASS AREA % AND ALLOWABLE LIGHTING W/SF									
Cooling Equipment Capacity ≥65,000 Btu/h, Room Units, PTACs								Capacity <65,000 Btu/h	
EER: 8.9-9.0		EER: 9.1-10.0		EER: 10.1-11.0		EER: 11.1-UP		SEER: 10.0-UP	
GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF
20	2.0	20	2.2	30	2.2	25	2.4	25	2.4
25	1.8	30	2.0	40	2.0	35	2.2	35	2.2
		35	1.8	45	1.8	45	2.0	45	2.0
						50	1.8	50	1.8
						And Heat Pump		And Heat Pump	
						COP: ≥ 3.0		HSPF: ≥ 6.8	
						75	2.2	75	2.2

Glazing:  
Solar Heat Gain Coefficient ≤0.61

Table 4C-9 SCHOOL BUILDING < 5,000 SF									
MAXIMUM ALLOWABLE GLASS AREA % AND ALLOWABLE LIGHTING W/SF									
Cooling Equipment Capacity ≥65,000 Btu/h, Room Units, PTACs								Capacity <65,000 Btu/h	
EER: 8.9-9.0		EER: 9.1-10.0		EER: 10.1-11.0		EER: 11.1-UP		SEER: 10.0-UP	
GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF
20	1.6	20	1.8	20	2.0	20	2.2	20	2.2
25	1.4	25	1.6	25	1.8	25	2.0	25	2.0
		30	1.4	30	1.6	30	1.8	30	1.8
				35	1.4	35	1.6	35	1.6
						40	1.2	40	1.2
						And Heat Pump		And Heat Pump	
						COP: ≥ 3.0		HSPF: ≥ 6.8	
						60	2.6	60	2.6

Glazing:  
Solar Heat Gain Coefficient ≤0.87

Table 4C-10 STORAGE BUILDING < 5,000 SF									
MAXIMUM ALLOWABLE GLASS AREA % AND ALLOWABLE LIGHTING W/SF									
Cooling Equipment Capacity ≥65,000 Btu/h, Room Units, PTACs								Capacity <65,000 Btu/h	
EER: 8.9-9.0		EER: 9.1-10.0		EER: 10.1-11.0		EER: 11.1-UP		SEER: 10.0-UP	
GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF	GL AREA %	LIGHTING W/SF
5	0.6	5	0.74	5	0.85	5	0.85	5	0.85
		15	0.1	15	0.35	15	0.47	15	0.47
				25	0.10	25	0.37	25	0.37
						And Heat Pump		And Heat Pump	
						COP: ≥ 3.0		HSPF: ≥ 6.8	
						40	1.25	40	1.25

Glazing:  
Solar Heat Gain Coefficient ≤0.77 or  
Insulated





# Cal-Tech Testing, Inc.

- Engineering
- Geotechnical
- Environmental

Laboratories

P.O. Box 1625 • Lake City, FL 32056-1625 • Tel(386)755-3633 • Fax(386)752-5456

6919 Distribution Ave. S., Unit #5, Jacksonville, FL 32257 • Tel(904)262-4046 • Fax(904)4047

JOB NO.: 05-010

DATE TESTED: 5/25/2005

DATE REPORTED: 6/1/2005

## REPORT OF IN-PLACE DENSITY TEST

PROJECT: Village Square @ US - 90  
CLIENT: Simque Construction, PO Box 2962, Lake City, FL 32056  
GENERAL CONTRACTOR: Simque Construction  
EARTHWORK CONTRACTOR: Simque Construction  
INSPECTOR: T. Hygema

### ASTM METHOD

(D-2922) Nuclear

### SOIL USE

BUILDING FILL

SPECIFICATION REQUIREMENTS: 95%

TEST NO.	TEST LOCATION	TEST DEPTH	WET DENSITY (lb/ft <sup>3</sup> )	MOISTURE PERCENT	DRY DENSITY (lb/ft <sup>3</sup> )	PROCTOR TEST NO.	PROCTOR VALUE	% MAXIMUM DENSITY
PAD								
1	25'W x 12'N from SE Corner	0 - 12"	123.2	8.3	113.8	1	114.8	99.1%
2	Center of Pad	0 - 12"	122.7	9.0	112.6	1	114.8	98.1%
3	24'E x 20'S from NW Corner	0 - 12"	122.3	8.7	112.5	1	114.8	98.0%
4	20'E x 10'N from SW Corner	0 - 12"	121.5	7.5	113.0	1	114.8	98.5%

REMARKS: The Above Tests Meet Specification Requirements.

### PROCTORS

TEST NO.	SOIL DESCRIPTION	MAXIMUM DRY UNIT WEIGHT (lb/ft <sup>3</sup> )	OPT. MOIST.	TYPE
1	Gray Sand w/ Trace Clay	114.8	12.0	MODIFIED (ASTM D-1557)

Respectfully Submitted,  
CAL-TECH TESTING, INC.

*Linda M. Creamer*

Linda M. Creamer  
President - CEO

ta

Reviewed By:

*John C. Dorman*


John C. Dorman, P.E., PhD  
Florida Registration No.: 52612

Date: 6/1/05

The test results presented in this report are specific only to the samples tested at the time of testing. The tests were performed in accordance with generally accepted methods and standards. Since material conditions can vary between test locations and

"Excellence in Engineering & Geoscience"





# Cal-Tech Testing, Inc.

- Engineering
- Geotechnical
- Environmental Laboratories


P.O. Box 1625 • Lake City, FL 32056-1625 • Tel(386)755-3633 • Fax(386)752-5456  
6919 Distribution Ave. S., Unit #5, Jacksonville, FL 32257 • Tel(904)262-4046 • Fax(904)4047

## REPORT OF LABORATORY COMPACTION TEST

Client:  
Project Name:  
Project Location:  
Contractor:

Simque Construction, PO Box 2962, Lake City, FL 32056  
Village Square @ US - 90  
Lake City, Florida  
Simque Construction

File No: 05-010  
Date: 6/1/2005  
Lab No: 7552

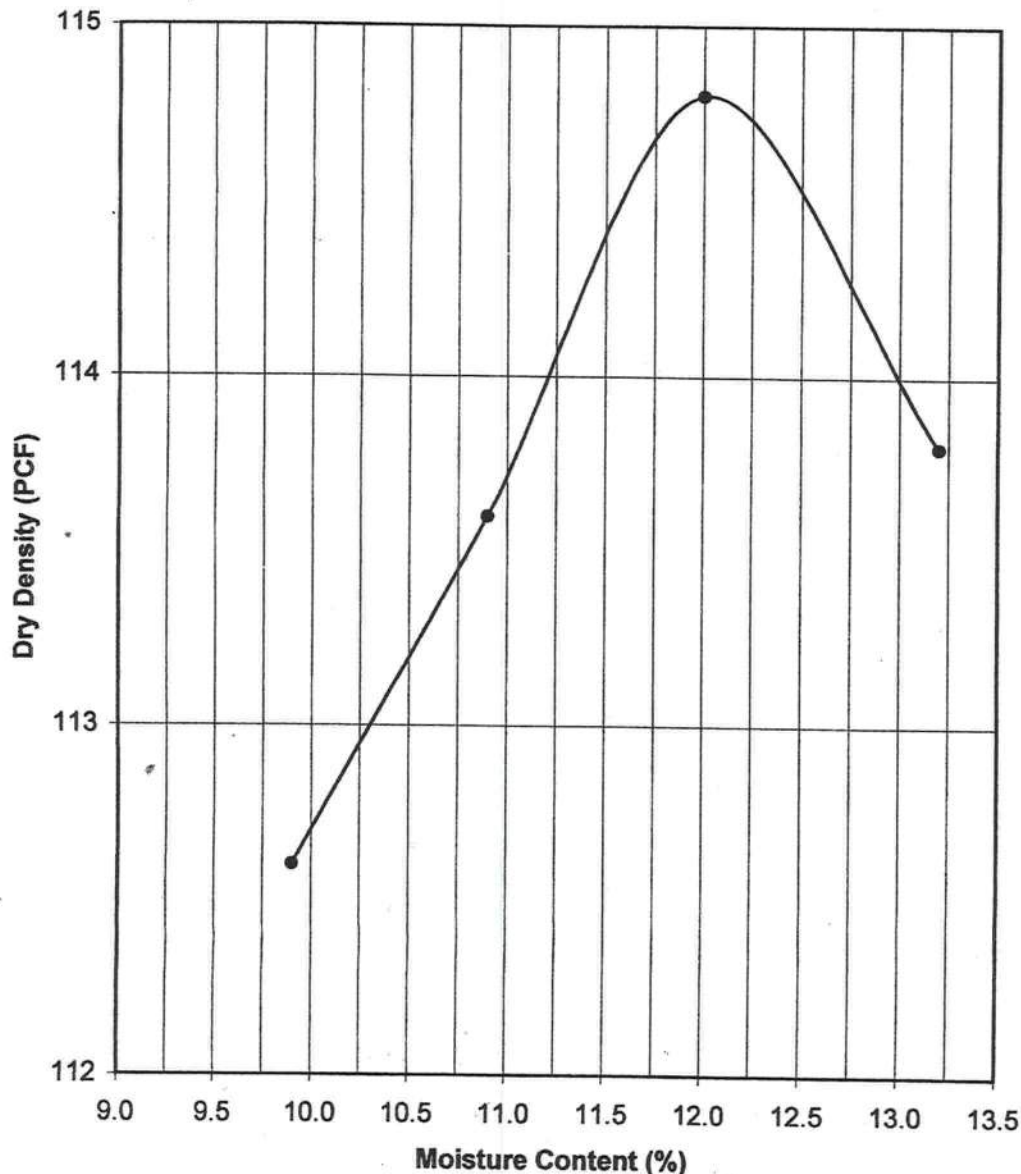

### PROCTOR DATA

Proctor No.: 1

Modified Proctor ☒  
(ASTM D-1557)

Standard Proctor ☐  
(ASTM D-698)

Maximum Dry  
Dens. Pcf: 114.8

Optimum Moisture  
Percent: 12.0

The test results presented in this report specific only to the samples tested at the time testing. The tests were performed accordance with generally accepted methods and standards. Since material conditions vary between test locations and change over time, sound judgement should be exercised in regard to the use and interpretation of the data.

Sample Description: Gray Sand w/ Trace Clay

Sample Location: Existing Material

Proposed Use: Building Fill

Sampled By: T. Hygema

Date: 5/25/2005

Tested By: W. McCollum

Date: 5/26/2005

Remarks:

1cc: Client

1cc: File

Linda M. Creamer

President - CEO

Reviewed By:

Date: 6/1/05

FL Registration No: 52612



# New Construction Subterranean Termite Soil Treatment Record

OMB Approval No. 2502-0525  
(exp. 10/31/2005)

This form is completed by the licensed Pest Control Company.

**Public reporting burden** for this collection of information is estimated to average 15 minutes per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. This information is mandatory and is required to obtain benefits. HUD may not collect this information, and you are not required to complete this form, unless it displays a currently valid OMB control number.

Section 24 CFR 200.926d(b)(3) requires that the sites for HUD insured structures must be free of termite hazards. This information collection requires the builder to certify that an authorized Pest Control company performed all required treatment for termites, and that the builder guarantees the treated area against infestation for one year. Builders, pest control companies, mortgage lenders, homebuyers, and HUD as a record of treatment for specific homes will use the information collected. The information is not considered confidential.

This report is submitted for informational purposes to the builder on proposed (new) construction cases when soil treatment for prevention of subterranean termite infestation is specified by the builder, architect, or required by the lender, architect, FHA, or VA.

All contracts for services are between the Pest Control Operator and builder, unless stated otherwise.

# 23409

## Section 1: General Information (Treating Company Information)

Company Name: Aspen Pest Control, Inc.  
Company Address: 301 NW Cole Terrace City Lake City State FL Zip 32055  
Company Business License No. JB109476 Company Phone No. 386-755-3611  
FHA/VA Case No. (if any) \_\_\_\_\_

## Section 2: Builder Information

Company Name: David Simons Construction Company Phone No. \_\_\_\_\_

## Section 3: Property Information

Location of Structure(s) Treated (Street Address or Legal Description, City, State and Zip) Village Square  
U.S. Hwy 90 Lake City, FL

Type of Construction (More than one box may be checked) ☒ Slab ☐ Basement ☐ Crawl ☐ Other \_\_\_\_\_  
Approximate Depth of Footing: Outside 0 Inside 0 Type of Fill D.I.T

## Section 4: Treatment Information

Date(s) of Treatment(s) 7-25-05  
Brand Name of Product(s) Used Draxl  
EPA Registration No. 19713-516  
Approximate Final Mix Solution % 0.5%  
Approximate Size of Treatment Area: Sq. ft. 8960 Linear ft. 0 Linear ft. of Masonry Voids 0  
Approximate Total Gallons of Solution Applied 900  
Was treatment completed on exterior? ☐ Yes ☒ No  
Service Agreement Available? ☒ Yes ☐ No

Note: Some state laws require service agreements to be issued. This form does not preempt state law.

Attachments (List) \_\_\_\_\_

Comments \_\_\_\_\_

Name of Applicator(s) Steve Brannan Certification No. (if required by State law) JF104376

The applicator has used a product in accordance with the product label and state requirements. All treatment materials and methods used comply with state and federal regulations.

Authorized Signature Steve Brannan Date 7-25-05

**Warning:** HUD will prosecute false claims and statements. Conviction may result in criminal and/or civil penalties. (18 U.S.C. 1001, 1010, 1012; 31 U.S.C. 3729, 3802)

Form NPCA-99-B may still be used

form HUD-NPCA-99-B (04/2003)

Reorder Product #2581 • From Crown Graphics, Inc. • 1-800-252-4011





Alphonso Wilson  
Fire Chief

## LAKE CITY / COLUMBIA COUNTY FIRE - RESCUE

225 NW Main Blvd., Suite 101, Lake City, FL 32055  
Phone: 386-752-3312 Fax: 386-758-5424  
e-mail: lcfd@se.rr.com  
alwilson@se.rr.com (Fire Chief)

### Inspection Division

#### **Firesafety Inspectors**

Carlton A. Tunsil  
Assistant Fire Chief

Frank E. Armijo  
Captain

Nathiel L. Williams, Sr.  
Driver/Engineer


To: Columbia County Building Department

FROM: Frank E. Armijo, Captain  
State Fire Inspector License #112877

DATE: December 14, 2005

SUBJECT: Fire Safety Inspection

A fire safety inspection was performed today at Village Square suite 102, 104, 106, 114, located at 90 west, Lake City, FL. This business meets all requirements of Chapter 38 of the Florida Fire Prevention Code, 2004 Edition. No violations were noted. I recommend approval.

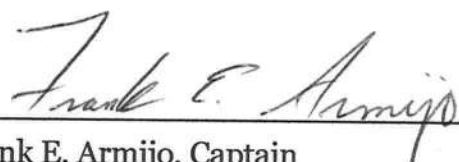  
Frank E. Armijo, Captain  
State Fire Inspector License #112877



**CERTIFICATES OF OCCUPANCY**

**OCCUPANCY**

**COLUMBIA COUNTY, FLORIDA**

## Department of Building and Zoning Inspection

*This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.*

Parcel Number 35-3S-16-02585-006

Building permit No. 000023409

Use Classification COMMERCIAL STORE

Fire: 619.50

Permit Holder DAVID SIMQUE

Waste: \_\_\_\_\_

Owner of Building WESTFIELD GROUP

Total: 619.50

Location: 2929 HIGHWAY 90 WEST

Date: 12/20/2005

*John D. Perce*

Building Inspector

**POST IN A CONSPICUOUS PLACE**  
**(Business Places Only)**

*called 12/29/05*

