



**Vent Detail**  
SCALE: NONE

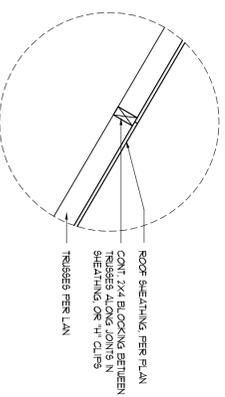


**Joint Detail**  
SCALE: NONE

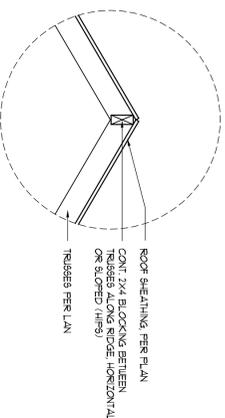

**Ridge Detail**  
SCALE: NONE




**MULTIPLE GANG LAM. DETAIL**  
NOT TO SCALE

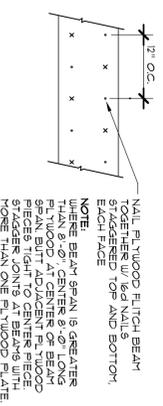

**PLYWOOD FITCH BEAM DETAIL**  
NOT TO SCALE


**Beam Details**  
SCALE: NONE

ROOF SHEATHING FASTENINGS		
NAILING ZONE	SHEATHING TYPE	FASTENER
1	1/4" OSB	8d COPPER OR 8d GALVANIZED BOX NAILS
2	OR 5/8" CDX	6 x 6 OSB EDGE OR 6 x 6 OSB FIELD
3		4 x 6 OSB GABLE END OR 6 x 6 OSB GABLE END

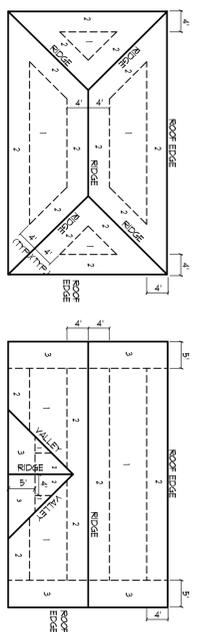


**Roof Nail Pattern Det.**  
SCALE: NONE


HEADER SPANS FOR EXTERIOR BEARING WALLS			
HEADERS SUPPORTING:	BUILDING WIDTH (FT)		
	20'	28'	36'
2x2x4	3'-6"	3'-2"	2'-10"
2x2x6	5'-5"	4'-8"	4'-2"
2x2x8	8'-10"	5'-11"	5'-4"
2x2x10	8'-5"	7'-3"	6'-6"
2x2x12	9'-9"	8'-5"	7'-6"
3x2x8	8'-4"	7'-5"	6'-8"
3x2x10	10'-6"	9'-11"	8'-2"
3x2x12	12'-2"	10'-1"	9'-5"
4x2x8	9'-2"	8'-4"	9'-2"
4x2x10	11'-8"	10'-6"	9'-5"
4x2x12	14'-1"	12'-2"	10'-11"

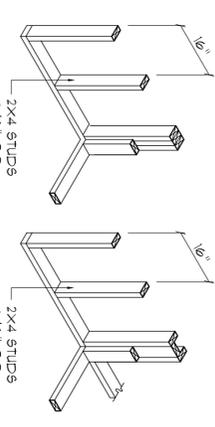

**WALL CORNER**  
**WALL INTERSECTION**

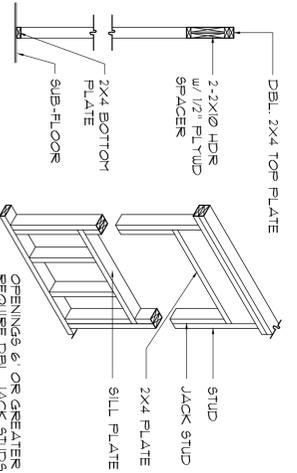


**TYPICAL WINDOW HEADER**

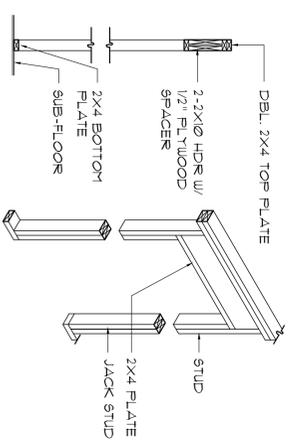


**NON-BEARING WALL HEADER**

**BEARING WALL HEADER**


**Wall Framing/Header Details**  
SCALE: NONE

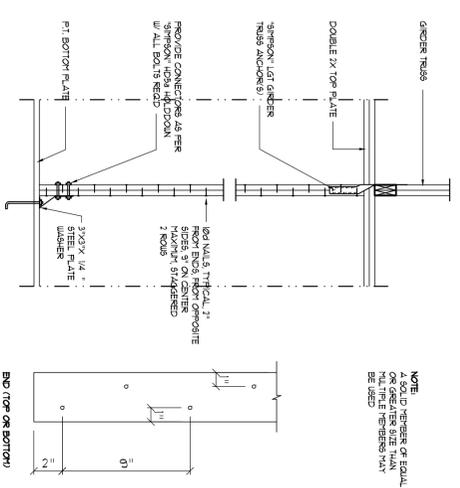

**Girder Truss Column Det.**  
SCALE: 1/2" = 1'-0"

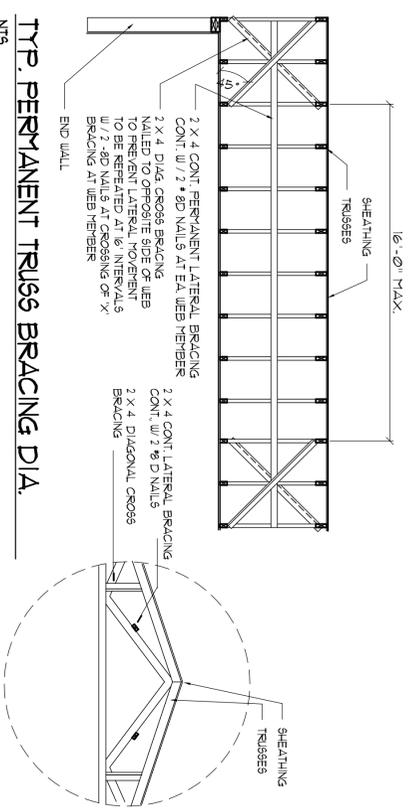

**Truss Bracing Details**  
SCALE: AS NOTED

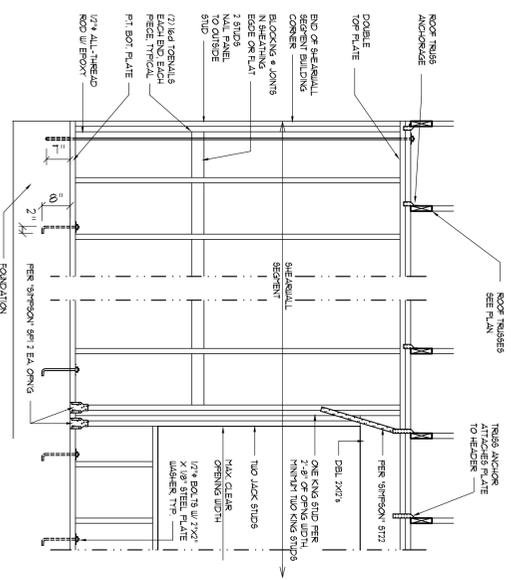

**Shear Wall Details**  
SCALE: NONE

**SHEARWALL NOTES:**

- ALL SHEARWALLS SHALL BE TYPE 3 SHEARWALLS AS DEFINED BY 817.01-16000 309.4.3
- THE WALL SHALL BE ENTIRELY SHEATHED AND BELOW OPENINGS
- ALL SHEATHING SHALL BE ATTACHED TO FRAMING MEMBERS WITH 16D NAILS. SHEATHING PANELS OCCURRING OVER COMMON RUNNING MEMBERS OR ALONG BLOCKING
- NAIL SPACING SHALL BE 4" OC EDGES AND 8" OC IN THE FIELD.
- TYPE 3 SHEARWALLS ARE DERIVED FROM THE OPENING 5/8" TIES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHTS (OR 8'-0" MINIMUM).

OPENING WIDTH	WALL PLATE	16D TOP WALLS EACH END
0" TO 6'-0"	(1) 2x4 OR (1) 2x6	1
6' 0" TO 9'-0"	(1) 2x4 OR (1) 2x6	2
9' 0" TO 12'-0"	(1) 2x4 OR (1) 2x6	3

