

Name: Sellers Residence (LIVE D
Owner: TRADEMARK CONSTRUCTION
Dgner: Bill Eklund
ADDRESS:
ESMAN: DB
<Not Found>


JOB NO:
22-6857

PAGE NO:
1 OF 1

This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.



Alpine, an ITW Company
6750 Forum Drive, Suite 305
Orlando, FL 32821
Phone: (800)755-6001
www.alpineitw.com

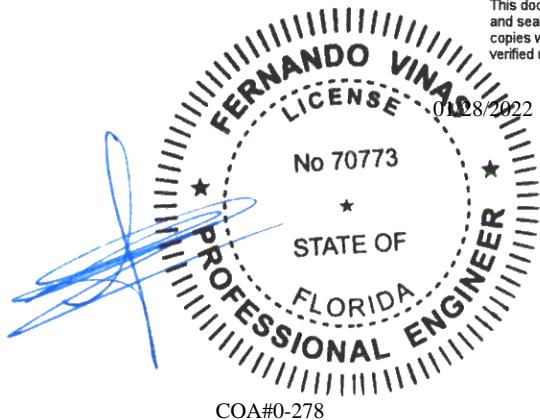

Site Information:	Page 1:
Customer: W. B. Howland Company, Inc.	Job Number: 22-6857
Job Description: Sellers Residence (LIVE DORMER)	
Address: LAKE CITY	

Job Engineering Criteria:		
Design Code: FBC 2017 RES	IntelliVIEW Version: 20.02.01A through 21.01.01A	JRef #: 1XcL2150006
Wind Standard: ASCE 7-10	Wind Speed (mph): 130	Design Loading (psf): 40.00
Building Type: Closed		

This package contains general notes pages, 46 truss drawing(s) and 6 detail(s).

Item	Drawing Number	Truss
1	028.22.1004.51625	A01
3	028.22.1004.53092	A03
5	028.22.1004.53186	A05
7	028.22.1004.53233	A07
9	028.22.1004.52983	A09
11	028.22.1004.51426	B01
13	028.22.1004.52124	B03
15	028.22.1004.52436	C01
17	028.22.1004.51859	C03
19	028.22.1004.52092	C05
21	028.22.1004.51093	D01
23	028.22.1004.52968	D03
25	028.22.1004.51797	E02
27	028.22.1004.51765	J01
29	028.22.1004.51923	J02A
31	028.22.1004.51425	J04
33	028.22.1004.52500	J06HJ
35	028.22.1004.51671	PB02
37	028.22.1004.51983	PB04
39	028.22.1004.53139	V02
41	028.22.1004.53045	V04
43	028.22.1004.51047	V07
45	028.22.1004.51422	V09
47	A14015ENC101014	
49	BRCLBSUB0119	
51	PB160101014	

Item	Drawing Number	Truss
2	028.22.1004.53264	A02
4	028.22.1004.53061	A04
6	028.22.1004.53295	A06
8	028.22.1004.51421	A08
10	028.22.1004.51921	A10
12	028.22.1004.51828	B02
14	028.22.1004.51952	B04
16	028.22.1004.51718	C02
18	028.22.1004.52014	C04
20	028.22.1004.52501	C06
22	028.22.1004.51890	D02
24	028.22.1004.51594	E01
26	028.22.1004.53235	FTG01
28	028.22.1004.51686	J02
30	028.22.1004.51424	J03
32	028.22.1004.52468	J05HJ
34	028.22.1004.51423	PB01
36	028.22.1004.51639	PB03
38	028.22.1004.53077	V01
40	028.22.1004.53202	V03
42	028.22.1004.53014	V05
44	028.22.1004.51733	V08
46	028.22.1004.52046	V10
48	A14030ENC101014	
50	GBLLETIN0118	
52	VAL160101014	

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

General Notes (continued)

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

CL = Certified lumber.

Des Ld = total of TCLL, TCDL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.

Max Web CSI= Maximum bending and axial Combined Stress Index for Webs for of all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCLL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 514 Earth City Expressway, Suite 242, Earth City, MO 63045; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpininst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcacomponents.com.

SEQN: 344121 / FROM: CDM	GABL Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A01	Cust: R 215 JRef: 1XcL2150006 T4 DrwNo: 028.22.1004.51625 KD / FV 01/28/2022
-----------------------------	--------------------------	--	--

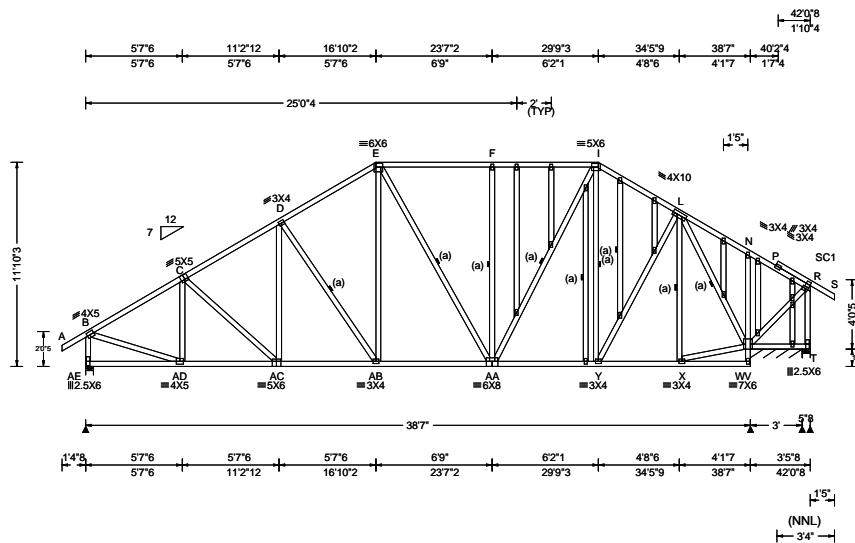

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL: 20.00		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL: 10.00		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.074 H 999 240	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.152 H 999 180	AE	1669	/ -	/ 1077	/ 211 / 336
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.027 X - -	V*	697	/ -	/ 420	/ 40 / -
Des Ld: 40.00		EXP: C Kzt: NA		HORZ(TL): 0.056 X - -	T	33	/ -164	/ -67	/ 111 / -
NCBCLL: 10.00		Mean Height: 17.60 ft	Building Code:	Creep Factor: 2.0	Wind reactions based on MWFRS				
Soffit: 2.00		TCDL: 5.0 psf	FBC 2017 RES	Max TC CSI: 0.493	AE	Brg Width = 5.5	Min Req = 2.0		
Load Duration: 1.25		BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.510	V	Brg Width = 36.0	Min Req = -		
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h	Rep Fac: Yes	Max Web CSI: 0.602	T	Brg Width = 5.5	Min Req = 1.5		
		C&C Dist a: 4.20 ft	FT/RT:20(0)/10(0)		Bearings AE, V, & T are a rigid surface.				
		Loc. from endwall: not in 13.00 ft	Plate Type(s):		Members not listed have forces less than 375#				
		GCpi: 0.18	WAVE		Maximum Top Chord Forces Per Ply (lbs)				
		Wind Duration: 1.60			Chords	Tens.Comp.	Chords	Tens. Comp.	

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

Purlins

In lieu of structural panels use purlins to brace TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

See DWGS A14030ENC101014 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in noticable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in noticable area using 3x6.

The overall height of this truss excluding overhang is 11-10-3.

VIEW Ver: 20.02.01A.1209.11

Maximum Reactions (lbs), or *=PLF

Gravity	Non-Gravity
---------	-------------

Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL
-------------	------	------	-----	------

AE	1669	/ -	/ -	/ 1077 / 211 / 336
----	------	-----	-----	--------------------

V*	697	/ -	/ -	/ 420 / 40 / -
----	-----	-----	-----	----------------

T	33	/ -164	/ -	/ 67 / 111 / -
---	----	--------	-----	----------------

Wind reactions based on MWFRS

AE Brg Width = 5.5 Min Req = 2.0

V Brg Width = 36.0 Min Req = -

T Brg Width = 5.5 Min Req = 1.5

Bearings AE, V, & T are a rigid surface.

Members not listed have forces less than 375#

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
--------	------------	--------	-------------

B - C	239 - 1853	E - F	302 - 1235
-------	------------	-------	------------

C - D	273 - 1854	F - I	302 - 1235
-------	------------	-------	------------

D - E	265 - 1583	I - L	143 - 1088
-------	------------	-------	------------

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
--------	------------	--------	-------------

AE - AD	240 - 391	AB - AA	1293 - 225
---------	-----------	---------	------------

AD - AC	1545 - 441	AA - Y	882 - 61
---------	------------	--------	----------

AC - AB	1519 - 341	Y - X	557 0
---------	------------	-------	-------

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
------	------------	------	-------------


B - AE	259 - 1621	AA - I	782 - 215
--------	------------	--------	-----------

B - AD	1581 - 125	Y - L	698 - 133
--------	------------	-------	-----------

D - AB	209 - 408	I - Y	106 - 389
--------	-----------	-------	-----------

E - AB	511 - 154	L - V	114 - 1585
--------	-----------	-------	------------

F - AA	93 - 421	X - V	587 0
--------	----------	-------	-------

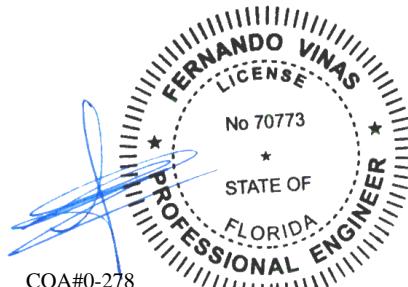

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 35636 / FROM: CDM	COMM Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A02	Cust: R 215 JRef:1XcL2150006 T28 / DrwNo: 028.22.1004.53264 AK / FV 01/28/2022
----------------------------	--------------------------	--	--

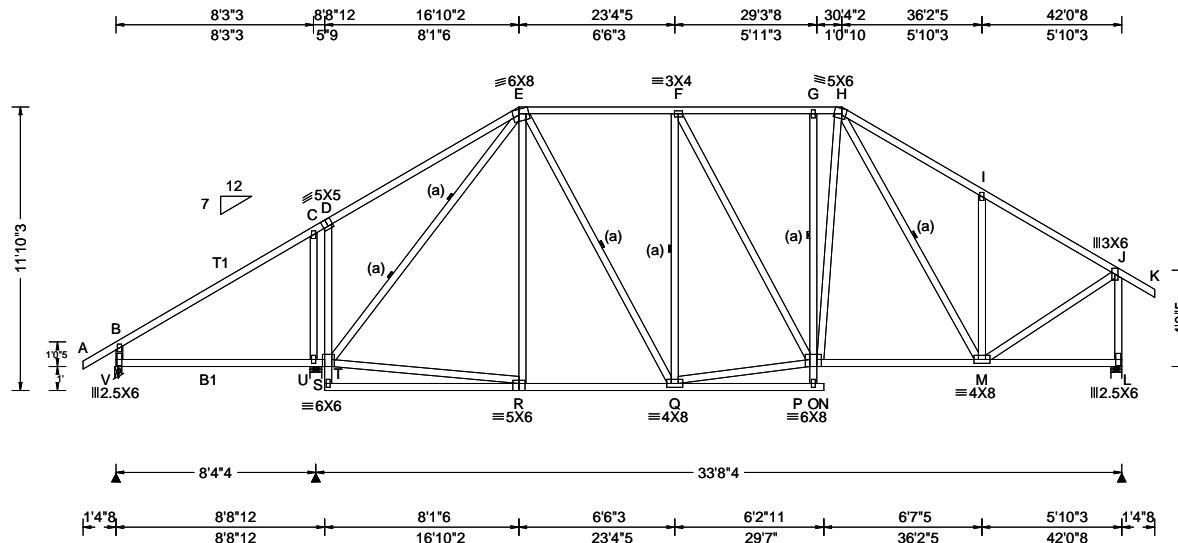

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-10		Pg: NA	Ct: NA	CAT: NA		Loc	R+	/ R-	/ Rh	Gravity	Non-Gravity	
TCDL: 10.00		Speed: 130 mph		Pf: NA		Ce: NA						/ Rw	/ U	/ RL
BCLL: 0.00		Enclosure: Closed		Lu: NA	Cs: NA			V	452	/ -	/ -	/313	/50	/286
BCDL: 10.00		Risk Category: II		Snow Duration: NA				U	2059	/ -	/ -	/1002	/65	/-
Des Ld: 40.00		EXP: C Kzt: NA						L	1652	/ -	/ -	/872	/55	/-
NCBCLL: 10.00		Mean Height: 15.63 ft												
		TCDL: 5.0 psf												
Soffit: 2.00		BCDL: 5.0 psf												
Load Duration: 1.25		MWFRS Parallel Dist: h to 2h												
Spacing: 24.0 "		C&C Dist a: 4.20 ft												
		Loc. from endwall: not in 13.00 ft												
		GCpi: 0.18												
		Wind Duration: 1.60												
Lumber								VIEW Ver: 20.02.01A.1209.11						

Loc	R+	/ R-	/ Rh	Gravity	Non-Gravity
V	452	/ -	/ -	/313	/50
U	2059	/ -	/ -	/1002	/65
L	1652	/ -	/ -	/872	/55

Wind reactions based on MWFRS
V Brg Wid = 3.0 Min Req = 1.5
U Brg Wid = 6.0 Min Req = 1.7
L Brg Wid = 5.5 Min Req = 1.9
Bearings V, U, & L are a rigid surface.
Members not listed have forces less than 375#

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
C - D	323	-431	G - H	444	-1231
E - F	447	-1163	H - I	484	-1403
F - G	443	-1229	I - J	357	-1387

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Bottom Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Bottom Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Bottom Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S - E	91	-1369	M - I	202	-405
S - R	841	-144	M - J	1328	-249
E - Q	526	-99	J - L	427	-1623
Q - F	146	-499			


Maximum Bottom Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.		
R - Q	904	-153	O - M	1176	-190

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.		
B - V	224	-376	Q - O	1204	-203
C - U	298	-942	O - H	503	-141
S -					

SEQN: 353634 / COMN Ply: 1 Job Number: 22-6857 Cust: R 215 JRef:1XcL2150006 T34 /
FROM: CDM Qty: 5 Sellers Residence (LIVE DORMER) DrwNo: 028.22.1004.53092
Truss Label: A03 AK / FV 01/28/2022

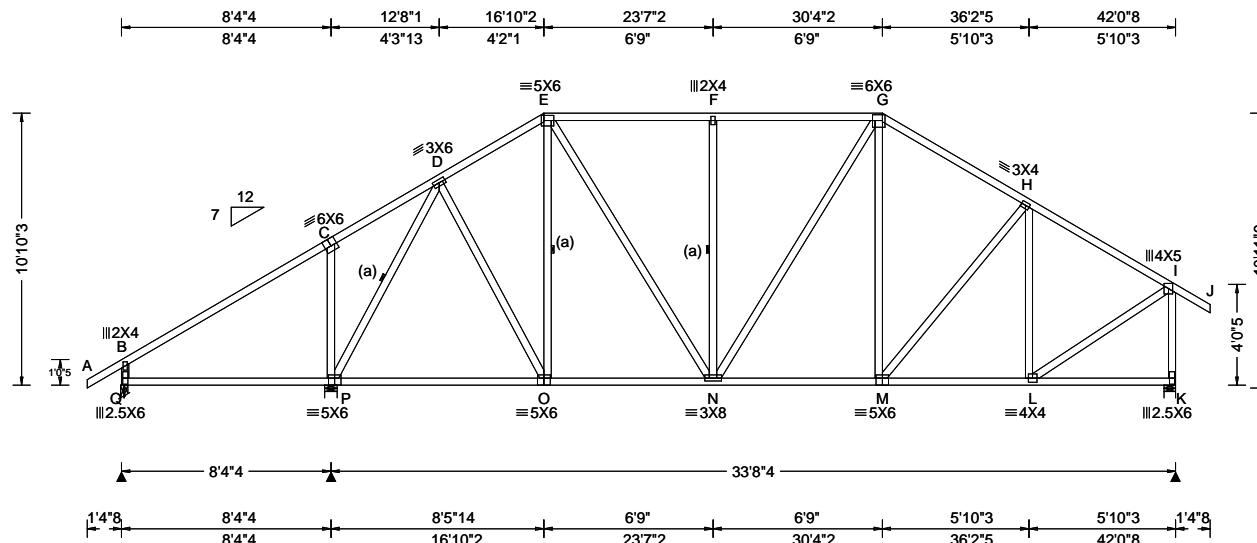

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria				▲ Maximum Reactions (lbs)									
				Pg: NA	Ct: NA	CAT: NA	PP Deflection in	loc	L/defl	L/#	Gravity			Non-Gravity					
				Pf: NA			VERT(LL):	0.066	F	999	240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL	
TCLL:	20.00	Wind Std: ASCE 7-10		Lu: NA	Cs: NA		VERT(CL):	0.117	F	999	180	Q	483	/ -	/ -	/352	/59	/286	
TCDL:	10.00	Speed: 130 mph		Snow Duration: NA		HORZ(LL):		0.028	K	-	-	P	2183	/ -	/ -	/961	/53	/ -	
BCLL:	0.00	Enclosure: Closed		Building Code:		HORZ(TL):		0.050	K	-	-	K	1735	/ -	/ -	/870	/57	/ -	
BCDL:	10.00	Risk Category: II		FBC 2017 RES		Creep Factor: 2.0		Wind reactions based on MWFRS											
Des Ld:	40.00	EXP: C Kzt: NA		TPI Std: 2014		Max TC CSI: 0.827		Q Brg Wid = 3.0 Min Req = 1.5											
NCBCLL:	10.00	Mean Height: 15.63 ft		Rep Fac: Yes		Max BC CSI: 0.762		P Brg Wid = 6.0 Min Req = 2.6											
Soffit:	2.00	BCDL: 5.0 psf		FT/RT:20(0)/10(0)		Max Web CSI: 0.700		K Brg Wid = 5.5 Min Req = 2.0											
Load Duration: 1.25	MWFRS Parallel Dist: h to 2h		Plate Type(s):		WAVE		Bearings Q, P, & K are a rigid surface.												
Spacing: 24.0 "	C&C Dist a: 4.20 ft		VIEW Ver: 20.02.01A.1209.11		Members not listed have forces less than 375#		Maximum Top Chord Forces Per Ply (lbs)												
	Loc. from endwall: not in 13.00 ft		GCpi: 0.18				Chords Tens.Comp.		Chords Tens. Comp.										
	Wind Duration: 1.60																		

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 10-10-3.

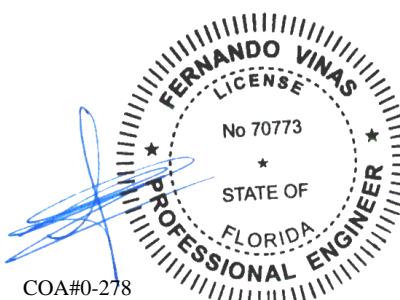

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpinetw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 353610 / FROM: CDM	COMM Ply: 1 Qty: 3	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A04	Cust: R 215 JRef:1XcL2150006 T31 / DrwNo: 028.22.1004.53061 AK / FV 01/28/2022
-----------------------------	--------------------------	--	--

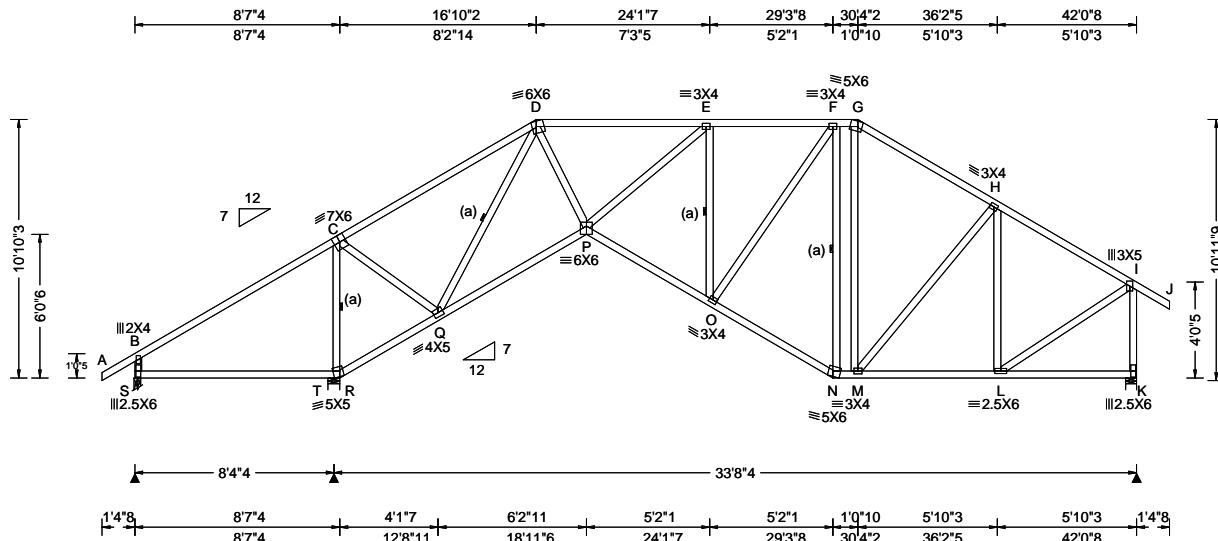

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL: 20.00		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+ / R-	/ Rh	Non-Gravity / Rw	/ U / RL
TCDL: 10.00		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.118 E 999 240	S	381	/-	/304	/115 /285
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.247 E 999 180	T	1881	/-	/1070	/230 /-
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.114 K - -	K	1486	/-	/883	/265 /-
Des Ld: 40.00		EXP: C Kzt: NA		HORZ(TL): 0.239 K - -					
Mean Height: 15.00 ft		Building Code:	Creep Factor: 2.0						
NCBCLL: 0.00		FBC 2017 RES	Max TC CSI: 0.985						
Soffit: 2.00		TPI Std: 2014	Max BC CSI: 0.533						
Load Duration: 1.25		Rep Fac: Yes	Max Web CSI: 0.699						
Spacing: 24.0 "		FT/RT:20(0)/10(0)							
Loc. from endwall: not in 13.00 ft		Plate Type(s):							
GCpi: 0.18		WAVE							
Wind Duration: 1.60				VIEW Ver: 20.02.01A.1209.11					

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C
member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is
10'-10-3".

▲ Maximum Reactions (lbs)


Loc	R+ / R-	/ Rh	Gravity / Rw	Non-Gravity / U	/ RL
S	381	/-	/304	/115	/285
T	1881	/-	/1070	/230	/-
K	1486	/-	/883	/265	/-
Wind reactions based on MWFRS					
S	Brg Wid = 3.0	Min Req = 1.5			
T	Brg Wid = 6.0	Min Req = 2.2			
K	Brg Wid = 5.5	Min Req = 1.8			
Bearings S, T, & K are a rigid surface.					
Members not listed have forces less than 375#					
Maximum Top Chord Forces Per Ply (lbs)					
Chords	Tens.Comp.	Chords	Tens. Comp.		
C - D	434 - 1066	F - G	420 - 1032		
D - E	597 - 2160	G - H	442 - 1286		
E - F	524 - 1557	H - I	341 - 1191		

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
Q - P	1770 - 285	N - M	1028 - 174
P - O	1862 - 310	M - L	970 - 201
O - N	1233 - 206		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
C - R	381 - 1691	O - F	943 - 187
C - Q	1027 - 99	F - N	148 - 703
Q - D	186 - 1575	H - L	153 - 508
D - P	1555 - 214	L - I	1128 - 231
P - E	772 - 155	I - K	413 - 1434
E - O	229 - 956		

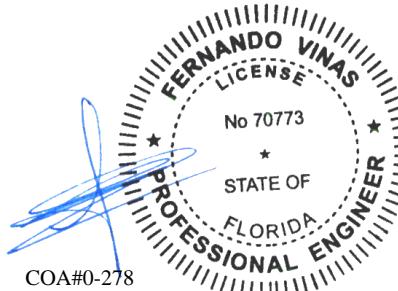

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 418001 / FROM: CDM	COMM Ply: 2 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A05	Cust: R 215 JRef:1XcL2150006 T37 / DrwNo: 028.22.1004.53186 AK / FV 01/28/2022
-----------------------------	--------------------------	--	--

2 Complete Trusses Required

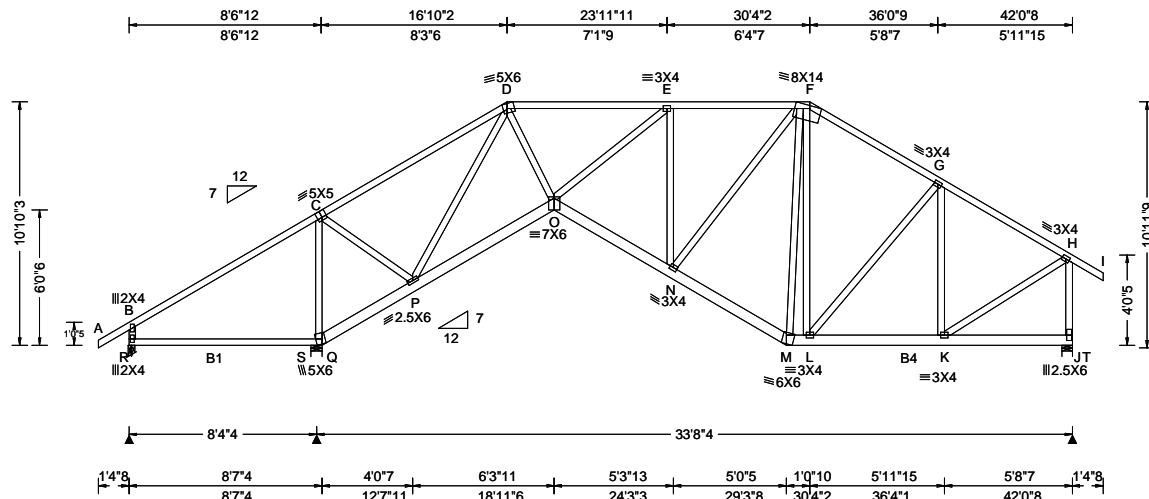

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL: 20.00		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc R+ / R-	/ Rh	Non-Gravity / Rw	/ U	/ RL	
TCDL: 10.00		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.079 O 999 240	R 435	/ -	/ -	/ 74	/ -	
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.155 O 999 180	S 2576	/ -	/ -	/ 430	/ -	
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.078 J - -	T 1793	/ -	/ -	/ 312	/ -	
Des Ld: 40.00		EXP: C Kzt: NA		HORZ(TL): 0.154 J - -						
Mean Height: 15.63 ft				Creep Factor: 2.0						
NCBCLL: 0.00		TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.575						
Soffit: 2.00		BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.446						
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.911						
Spacing: 24.0 "		C&C Dist a: 4.20 ft	Rep Fac: No							
		Loc. from endwall: not in 13.00 ft	FT/RT:20(0)/10(0)							
		GCpi: 0.18	Plate Type(s):							
		Wind Duration: 1.60	WAVE							
				VIEW Ver: 21.01.01A.0521.20						

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP #2; B1 2x4 SP #2;
B4 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;

Nailnote

Nail Schedule: 0.131" x 3", min. nails

Top Chord: 1 Row @ 12.00" o.c.

Bot Chord: 1 Row @ 12.00" o.c.

Webs : 1 Row @ 4" o.c.

Use equal spacing between rows and stagger nails in each row to avoid splitting.

Special Loads


----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 63 plf at -1.38 to 63 plf at 43.42
 BC: From 5 plf at -1.38 to 5 plf at 0.00
 BC: From 20 plf at 0.00 to 20 plf at 8.60
 BC: From 23 plf at 8.60 to 23 plf at 29.29
 BC: From 20 plf at 29.29 to 20 plf at 42.04
 BC: From 5 plf at 42.04 to 5 plf at 43.42
 PLB: From 40 plf at 5.32 to 40 plf at 8.31
 PLB: From 40 plf at 33.50 to 40 plf at 36.05
 BC: 775 lb Conc. Load at 18.82

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

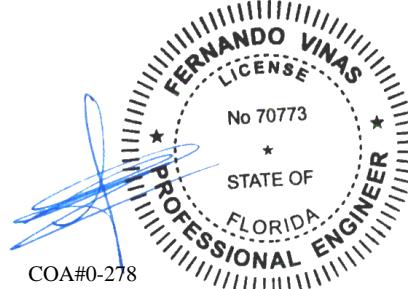

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 417997 / FROM: CDM	MONO Ply: 1 Qty: 3	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A06	Cust: R 215 JRef:1Xcl2150006 T38 / DrwNo: 028.22.1004.53295 AK / FV 01/28/2022
-----------------------------	--------------------------	--	--

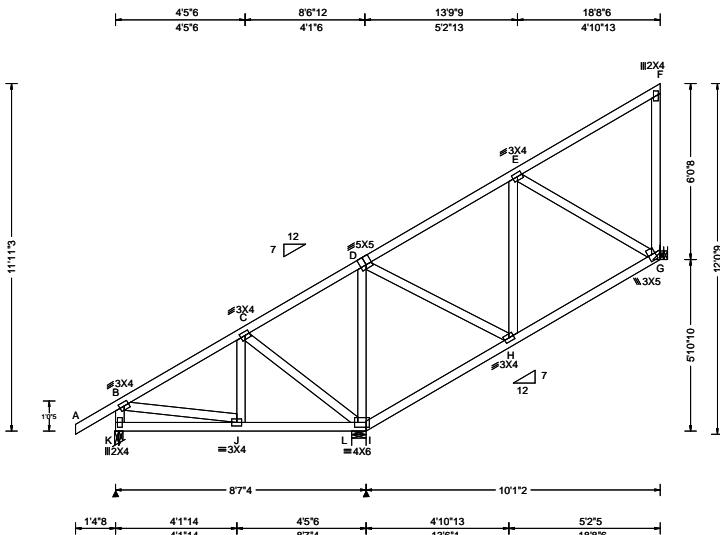

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Loc	R+	/R-	Gravity / Rh	Non-Gravity / Rw	/ U / RL	
TCDL: 10.00		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.004 E 999 240	K	396	/-	/	/244	/-	/266
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.008 E 999 180	L	902	/-	/	/634	/32	/-
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): -0.003 E - -	G	406	/-	/	/289	/93	/-
Des Ld: 40.00		EXP: C Kzt: NA		HORZ(TL): 0.004 H - -							
NCBCLL: 10.00		Mean Height: 16.17 ft		Creep Factor: 2.0							
Soffit: 2.00		TCDL: 5.0 psf		Max TC CSI: 0.439							
Load Duration: 1.25		BCDL: 5.0 psf		Max BC CSI: 0.312							
Spacing: 24.0 "		MWFRS Parallel Dist: h to 2h		Max Web CSI: 0.364							
		C&C Dist a: 3.00 ft									
		Loc. from endwall: not in 9.00 ft									
		GCpi: 0.18									
		Wind Duration: 1.60									
					Maximum Bot Chord Forces Per Ply (lbs)						
					Chords	Tens.	Comp.				

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Hangers / Ties

(J) Hanger Support Required, by others

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

Shim all supports to solid bearing.


The overall height of this truss excluding overhang is 11-11-3.

K - J 142 - 424

Maximum Web Forces Per Ply (lbs)

Web Tens. Comp.

D - I 152 - 570

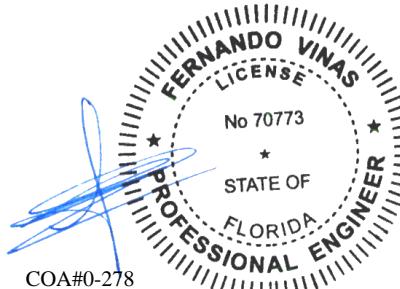

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 353631 / FROM: CDM	COMM Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A07	Cust: R 215 JRef: 1Xcl2150006 T8 / DrwNo: 028.22.1004.53233 AK / FV 01/28/2022
-----------------------------	--------------------------	--	--

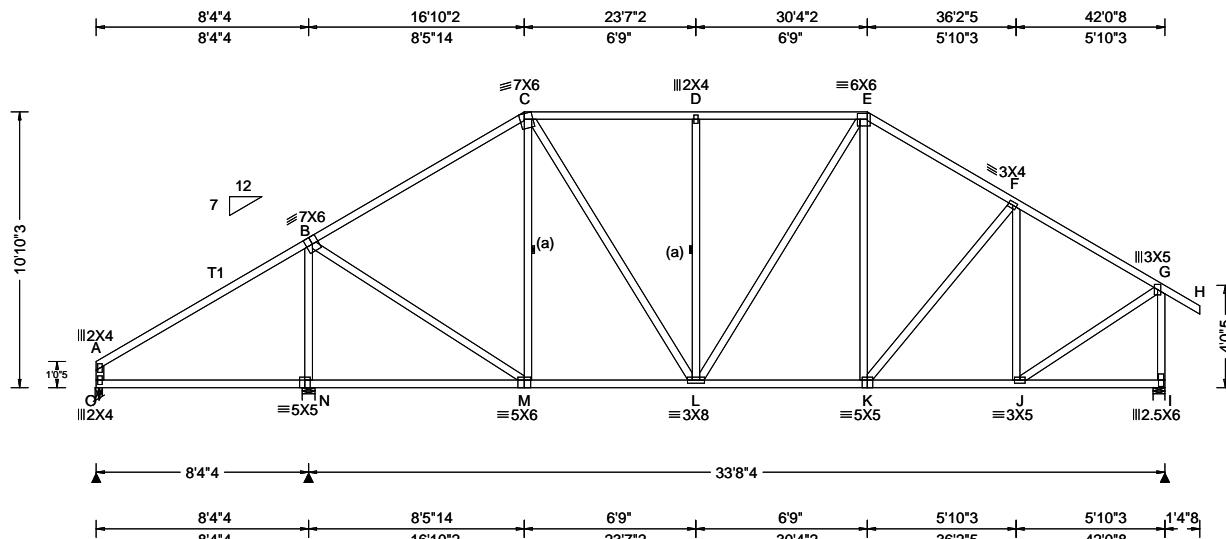

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL: 20.00		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL: 10.00		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.050 D 999 240	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.101 D 999 180	O	382	/ -	/ 244	/ 40	/ 367
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.017 I - -	N	1741	/ -	/ 1006	/ -	/ -
Des Ld: 40.00		EXP: C Kzt: NA		HORZ(TL): 0.034 I - -	I	1497	/ -	/ 884	/ 31	/ -
NCBCLL: 10.00		Mean Height: 18.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS					
Soffit: 2.00		TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.920	O	Brg Wid = 3.0	Min Req = 1.5			
Load Duration: 1.25		BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.612	N	Brg Wid = 6.0	Min Req = 2.1			
Spacing: 24.0 "		MWFRS Parallel Dist: h to 2h	TPI Std: 2014	Max Web CSI: 0.968	I	Brg Wid = 5.5	Min Req = 1.8			
		C&C Dist a: 4.20 ft	Rep Fac: Yes		Bearings O, N, & I are a rigid surface.					
		Loc. from endwall: not in 13.00 ft	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#					
		GCpi: 0.18	Plate Type(s):		Maximum Top Chord Forces Per Ply (lbs)					
		Wind Duration: 1.60	WAVE		Chords	Tens.Comp.	Chords	Tens. Comp.		
					VIEW Ver: 20.02.01A.1209.11					

Lumber

Top chord: 2x4 SP #2; T1 2x4 SP M-31;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 10-10-3.

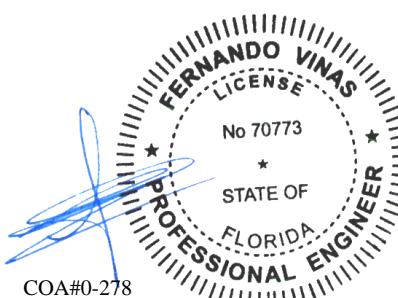

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344127 / FROM: CDM Page 1 of 2	COMM Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A08	Cust: R 215 JRef:1XcL2150006 T9 / DrwNo: 028.22.1004.51421 KD / WHK 01/28/2022
--	--------------------------	--	--

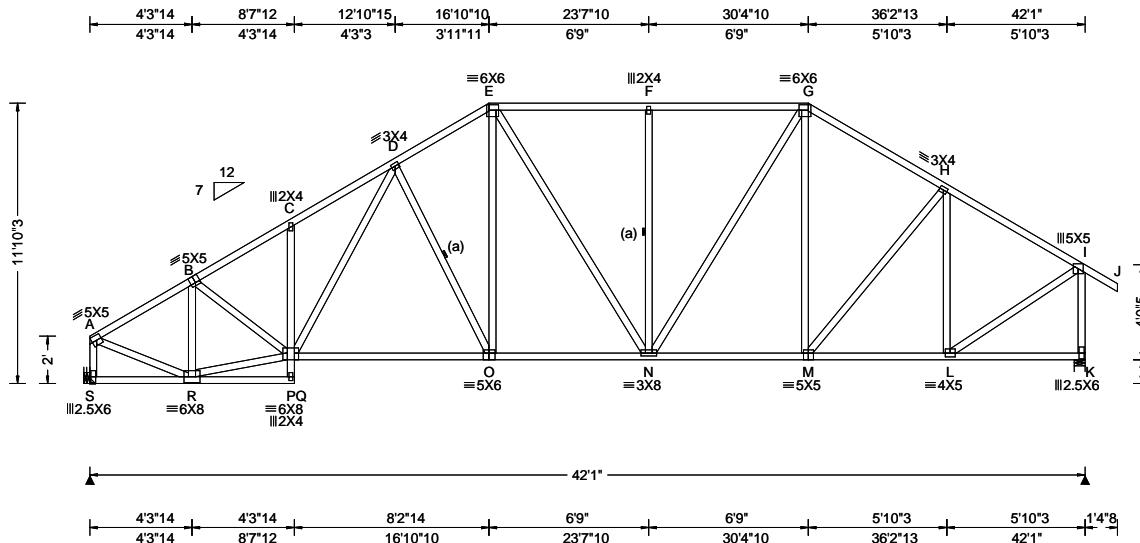

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)									
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity								
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.139 O 999 240	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL					
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.256 O 999 180	S 1921	/ -	/ -	/ 1043	/ 287 / 368					
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.068 K - -	K 2121	/ -	/ -	/ 1050	/ 315 / -					
Des Ld:	40.00	EXP: C Kzt: NA	Building Code:	HORZ(TL): 0.125 K - -	Wind reactions based on MWFRS									
NCBCLL:	10.00	Mean Height: 17.99 ft	FBC 2017 RES	Creep Factor: 2.0	S Brg Width = -	Min Req = -								
Soffit:	2.00	TCDL: 5.0 psf	TPI Std: 2014	Max TC CSI: 0.633	C Brg Width = 5.5	Min Req = 2.5								
Load Duration: 1.25	BCDL: 5.0 psf	MWFRS Parallel Dist: h/2 to h	Rep Fac: Yes	Max BC CSI: 0.876	Bearing K is a rigid surface.									
Spacing: 24.0 "	C&C Dist a: 4.21 ft	FT/RT:20(0)/10(0)	FT/RT:20(0)/10(0)	Max Web CSI: 0.761	Members not listed have forces less than 375#									
	Loc. from endwall: not in 13.00 ft	Plate Type(s):	WAVE	VIEW Ver: 20.02.01A.1209.11	Maximum Top Chord Forces Per Ply (lbs)									
	GCpi: 0.18				Chords	Tens. Comp.	Chords	Tens. Comp.						
	Wind Duration: 1.60				A - B	340 - 2163	E - F	522 - 2070						
					C - B	489 - 2886	F - G	522 - 2070						
					C - D	572 - 2894	G - H	394 - 2056						
					D - E	461 - 2353	H - I	298 - 1795						

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' uses the following support conditions: 0'

Bearing S (0', 91/2") HUS26

Supporting Member: (2)2x6 SP 2400f-2.0E

(14) 0.148"x3" nails into supporting member,

(4) 0.148"x3" nails into supported member.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.
P - O	2199 - 300	N - M	1693 - 147
O - N	1982 - 201	M - L	1501 - 178

Maximum Web Forces Per Ply (lbs)

Web	Tens. Comp.	Web	Tens. Comp.
A - S	291 - 1881	E - O	682 - 169
A - R	1930 - 263	F - N	98 - 452
R - B	203 - 1105	N - G	698 - 137
R - P	1871 - 382	H - L	131 - 760
B - P	754 - 60	L - I	1752 - 204
P - D	507 - 217	I - K	347 - 2078
D - O	223 - 486		

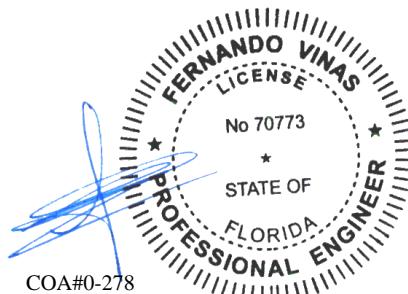

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344127 / FROM: CDM Page 2 of 2	COMM Qty: 2	Ply: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A08	Cust: R 215 JRef:1XcL2150006 T9 / DrwNo: 028.22.1004.51421 KD / WHK 01/28/2022
--	----------------	--------	--	--

Additional Notes

The overall height of this truss excluding overhang is
11-10-3.

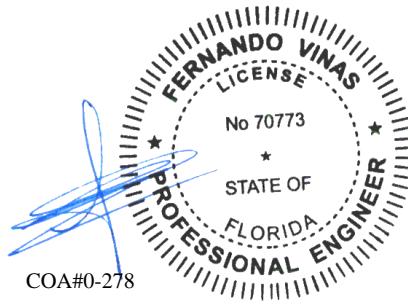

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 406368 / FROM: CDM	COMM Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A09	Cust: R 215 JRef:1Xcl2150006 T12 / DrwNo: 028.22.1004.52983 / YK 01/28/2022
-----------------------------	--------------------------	--	---

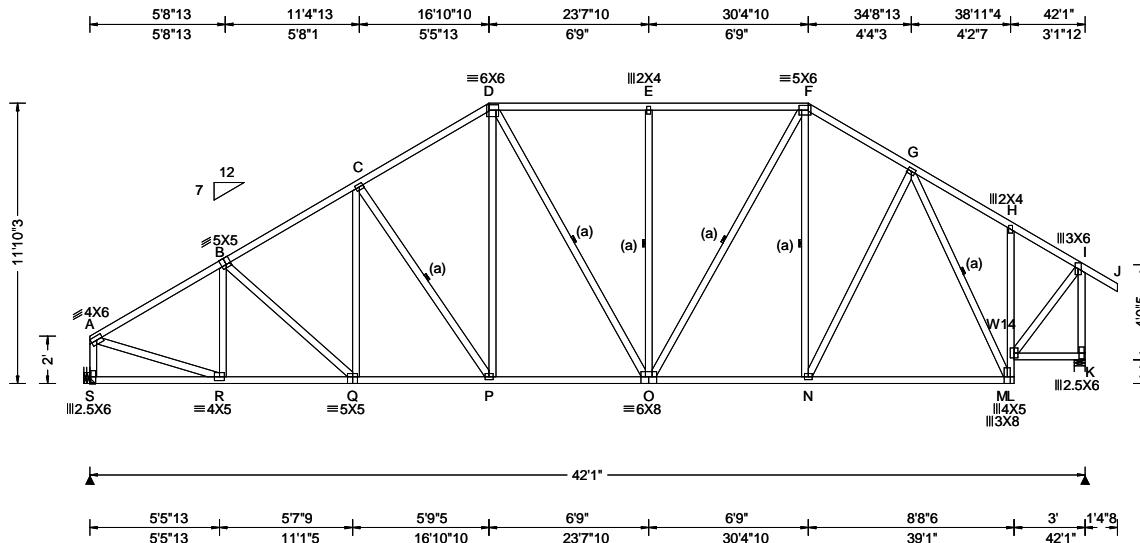

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	R+	R-	/ Rh	Gravity	Non-Gravity
TCDL:	10.00	Speed:	130 mph	Pf: NA	Ce: NA	Lu: NA	VERT(LL): 0.127 E 999 240	R-	/ -	/ -	/ Rh	/304	/273
BCLL:	0.00	Enclosure:	Closed	Cs: NA	Snow Duration:	NA	VERT(CL): 0.262 E 999 180	K	1844	/ -	/ -	/1034	/338
BCDL:	10.00	Risk Category:	II				HORZ(LL): 0.161 K - -						
Des Ld:	40.00	EXP: C	Kzt: NA				HORZ(TL): 0.333 K - -						
Mean Height: 16.02 ft		Building Code:					Creep Factor: 2.0						
NCBCLL: 10.00		FBC 2017 RES					Max TC CSI: 0.590						
Soffit: 2.00		TPI Std: 2014					Max BC CSI: 0.669						
Load Duration: 1.25		Rep Fac: Yes					Max Web CSI: 0.909						
Spacing: 24.0 "		FT/RT:20(0)/10(0)											
GCpi: 0.18		Plate Type(s):											
Wind Duration: 1.60		WAVE											
VIEW Ver: 21.01.01A.0521.20													

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3; W14 2x4 SP M-31;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 3X4 except as noted.

Hangers / Ties

(J) Hanger Support Required, by others

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 11-10-3.

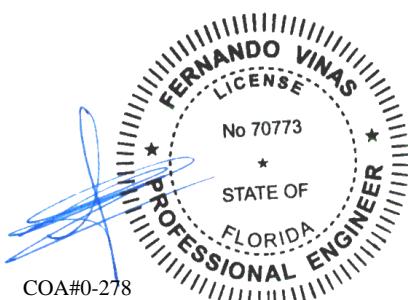

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344129 / FROM: CDM Page 1 of 2	GABL Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A10	Cust: R 215 JRef: 1Xcl2150006 T6 / DrwNo: 028.22.1004.51921 KD / WHK 01/28/2022
--	--------------------------	--	---

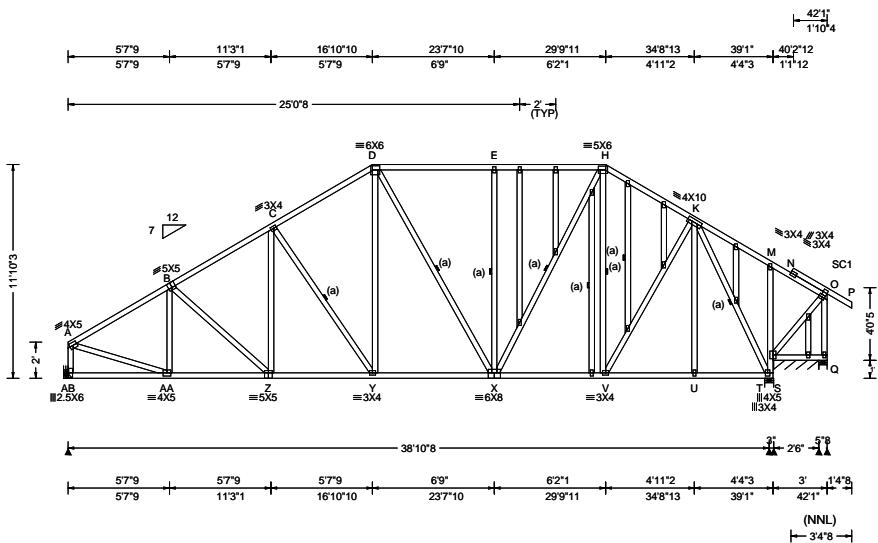

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.078 G 999 240	Loc	R+	/ R-	/ Rh	/ Rw / U / RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.160 G 999 180	Wind reactions based on MWFRS				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.031 T - -	AB	1607	/ -	/ -	/1015 /195 /322
Des Ld:	40.00	EXP: C Kzt: NA	Building Code:	HORZ(TL): 0.064 T - -	T	1796	/ -	/ -	/1077 /67 /-
NCBCLL: 10.00	Mean Height: 17.99 ft	FBC 2017 RES	Creep Factor: 2.0	Creep Factor: 2.0	S*	47	/ -	/ -	/35 / - / -
Soffit: 2.00	TCDL: 5.0 psf	TPI Std: 2014	Max TC CSI: 0.529	Max TC CSI: 0.529	Q	172	/ -	/ -	/131 /57 / -
Load Duration: 1.25	BCDL: 5.0 psf	Rep Fac: Yes	Max BC CSI: 0.519	Max BC CSI: 0.519	Bridging Width = - Min Req = -				
Spacing: 24.0 "	MWFRS Parallel Dist: h/2 to h	FT/RT:20(0)/10(0)	Max Web CSI: 0.698	Max Web CSI: 0.698	A	Brg Width = -	Min Req = -		
	C&C Dist a: 4.21 ft	Plate Type(s):			T	Brg Width = 6.0	Min Req = 2.1		
	Loc. from endwall: not in 13.00 ft	WAVE			S	Brg Width = 30.0	Min Req = -		
	GCpi: 0.18				Q	Brg Width = 5.5	Min Req = 1.5		
	Wind Duration: 1.60				Bearings T, S, & Q are a rigid surface.				
Members not listed have forces less than 375#									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.

Purlins

In lieu of structural panels use purlins to brace TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.


End verticals not exposed to wind pressure.

Additional Notes

See DWGS A14030ENC101014 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

The overall height of this truss excluding overhang is 11-10-3.

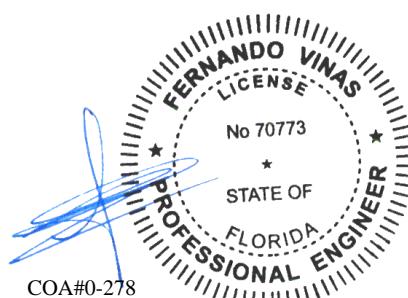

01/28/2022

Maximum Web Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.
AA-Z	1603 - 462	X - V	965 - 78
Z - Y	1573 - 355	V - U	658 - 21
Y - X	1344 - 237	U - T	657 - 21

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.
A - B	247 - 1915	D - E	317 - 1302
B - C	285 - 1918	E - H	317 - 1302
C - D	278 - 1643	H - K	163 - 1187

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens. Comp.	Chords	Tens. Comp.
AA-Z	1603 - 462	X - V	965 - 78
Z - Y	1573 - 355	V - U	658 - 21
Y - X	1344 - 237	U - T	657 - 21

Maximum Web Forces Per Ply (lbs)

Webs	Tens. Comp.	Webs	Tens. Comp.
A - AB	202 - 1558	E - X	94 - 420
A - AA	1632 - 156	X - H	746 - 209
C - Y	211 - 410	V - K	628 - 117
D - Y	512 - 156	K - T	74 - 1649

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344129 / FROM: CDM Page 2 of 2	GABL Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: A10	Cust: R 215 JRef:1XcL2150006 T6 / DrwNo: 028.22.1004.51921 KD / WHK 01/28/2022
--	----------------	--	--

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.


Bearing at location x=0' uses the following support conditions: 0'

Bearing AB (0', 9'1"2) HUS26

Supporting Member: (2)2x6 SP 2400f-2.0E

(14) 0.148"x3" nails into supporting member,

(4) 0.148"x3" nails into supported member.

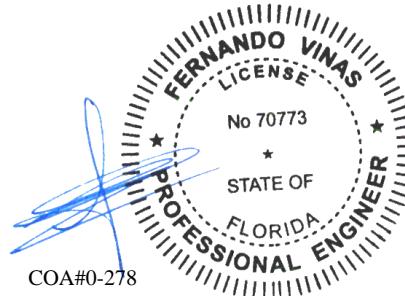

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344130 / FROM: CDM	GABL Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: B01	Cust: R 215 JRef: 1XcL2150006 T5 / DrwNo: 028.22.1004.51426 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

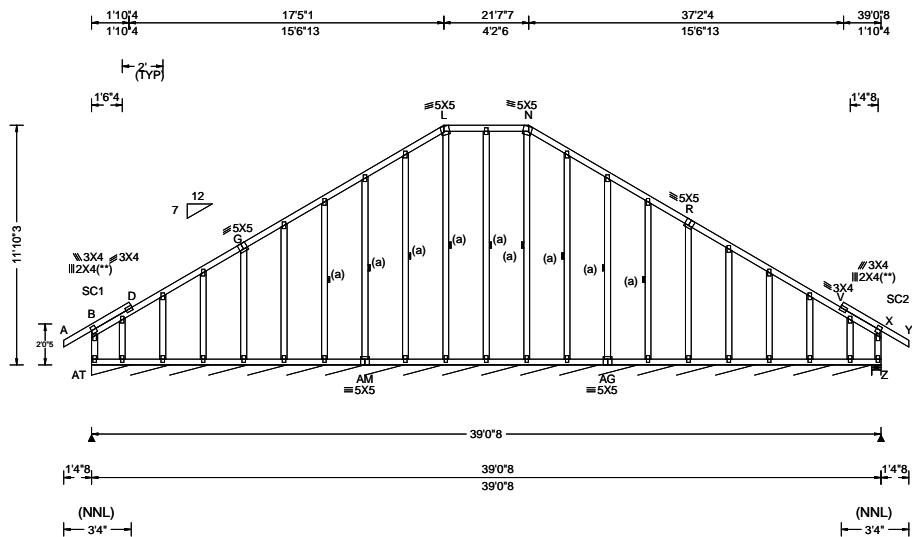

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.002 D 999 240	Loc	R+ / R-	/ Rh	/ Rw	/ U / RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.003 M 999 180	Wind reactions based on MWFRS				
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.055 M - -	AT	Brg Width = 463	Min Req = -		
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.081 M - -	Z	Brg Width = 5.5	Min Req = 1.5		
NCBCLL:	10.00	Mean Height: 16.41 ft		Creep Factor: 2.0					
Soffit:	2.00	TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.151					
Load Duration:	1.25	BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.059					
Spacing:	24.0 "	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.120					
		C&C Dist a: 3.90 ft	Rep Fac: Yes						
		Loc. from endwall: Any	FT/RT:20(0)/10(0)						
		GCpi: 0.18	Plate Type(s):						
		Wind Duration: 1.60	WAVE						
VIEW Ver: 20.02.01A.1209.11									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;
Stack Chord: SC2 2x4 SP #2;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Fasten rated sheathing to one face of this frame.

Additional Notes

See DWGS A14030ENC101014 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

The overall height of this truss excluding overhang is 11-10-3.

Plating Notes

All plates are 2X4 except as noted.

(**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.


Purlins

In lieu of structural panels use purlins to brace TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

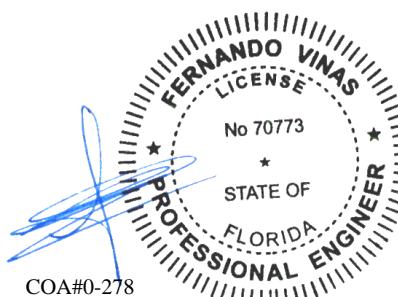

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344131 / COMN Ply: 1 Job Number: 22-6857 Cust: R 215 JRef:1XcL2150006 T33 /
FROM: CDM Qty: 5 Sellers Residence (LIVE DORMER) DrwNo: 028.22.1004.51828
Truss Label: B02 KD / WHK 01/28/2022

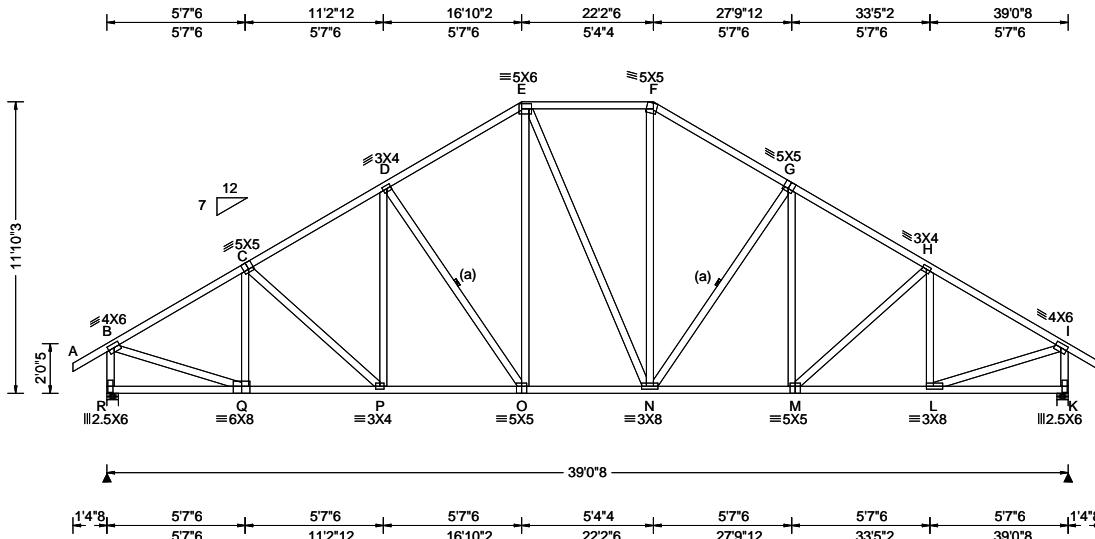

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)											
			Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity			Non-Gravity								
		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.122 O 999 240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL					
TCLL: 20.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.217 O 999 180	R	2001	/ -	/ -	/1017	/295	/345					
TCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.049 K - -	K	2002	/ -	/ -	/1017	/295	/ -					
BCLL: 0.00		EXP: C Kzt: NA		HORZ(TL): 0.088 K - -	Wind reactions based on MWFRS											
BCDL: 10.00		Mean Height: 16.41 ft		Building Code: Creep Factor: 2.0	R	Brg Width = 5.5	Min Req = 2.4									
Des Ld: 40.00		TCDL: 5.0 psf		FBC 2017 RES	K	Brg Width = 5.5	Min Req = 2.4									
NCBLL: 10.00		BCDL: 5.0 psf		TPI Std: 2014	Bearings R & K are a rigid surface.											
Soffit: 2.00		MWFRS Parallel Dist: 0 to h/2		Rep Fac: Yes	Members not listed have forces less than 375#											
Load Duration: 1.25		C&C Dist a: 3.90 ft		FT/RT:20(0)/10(0)	Maximum Top Chord Forces Per Ply (lbs)											
Spacing: 24.0 "		Loc. from endwall: Any		Plate Type(s):	Chords	Tens.Comp.	Chords		Tens. Comp.							
		GCpi: 0.18		WAVE	VIEW Ver: 20.02.01A.1209.11											
		Wind Duration: 1.60			B - C	554 -2280	F - G		620	-2063						
					C - D	692 -2281	G - H		692	-2064						

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3:

Bracing

(a) Continuous lateral restraint equally spaced on member

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design

End verticals not exposed to wind pressure.

Additional Notes

The overall height

11-10-3.

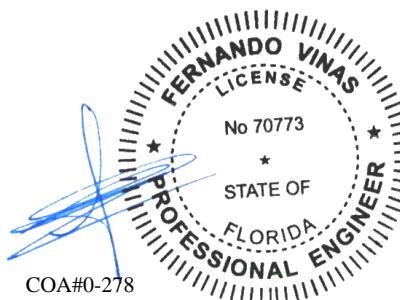

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TP1 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TP1 1 Sec.2.


For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org.

The logo for ALPINE, an ITW company. It features the word "ALPINE" in a bold, sans-serif font, with a stylized mountain peak graphic integrated into the letter "A". Below "ALPINE" is the tagline "AN ITW COMPANY" in a smaller, all-caps font. At the bottom, the company address is listed: "6750 Forum Drive", "Suite 305", and "Orlando FL, 32821".

SEQN: 344314 / FROM: CDM	GABL Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: B03	Cust: R 215 JRef:1XcL2150006 T14 / DrwNo: 028.22.1004.52124 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

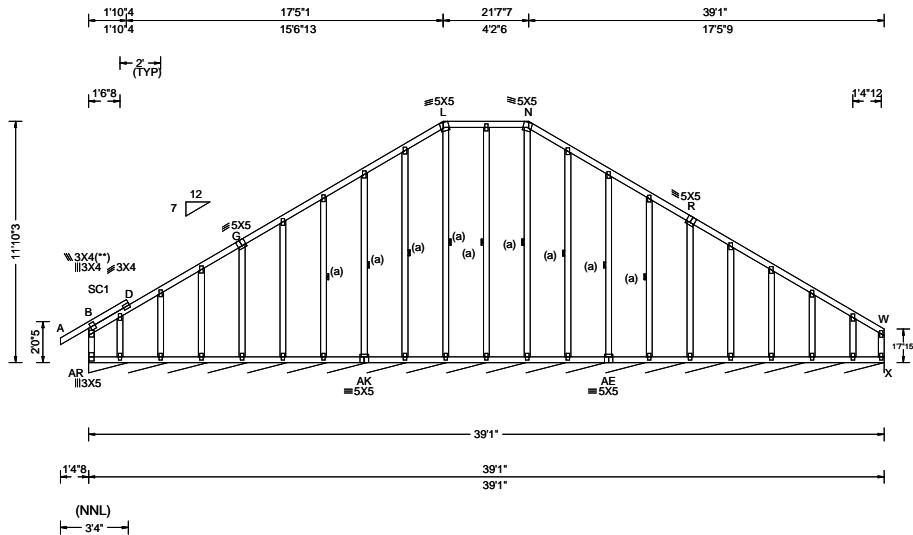

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF								
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity							
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): -0.005 D 999 240	Loc	R+	/R-	/Rh	/Rw /U /RL				
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): -0.008 D 999 180	Wind reactions based on MWFRS								
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.138 Q - -	X	X Brg Width = 469 Min Req = -							
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.193 Q - -	Bearing AR is a rigid surface.								
NCBCLL:	10.00	Mean Height: 15.63 ft		Creep Factor: 2.0	Members not listed have forces less than 375#								
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.158									
Load Duration: 1.25		BCDL: 5.0 psf		Max BC CSI: 0.151									
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.365									
		C&C Dist a: 3.91 ft											
		Loc. from endwall: Any											
		GCpi: 0.18											
		Wind Duration: 1.60											
Lumber		Additional Notes											
Top chord: 2x4 SP #2;		See DWGS A14030ENC101014 & GBLLETIN0118 for gable wind bracing and other requirements.											
Bot chord: 2x4 SP #2;		Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.											
Webs: 2x4 SP #3;													
Stack Chord: SC1 2x4 SP #2;		The overall height of this truss excluding overhang is 11-10-3.											
Bracing													
(a) Continuous lateral restraint equally spaced on member.													
Fasten rated sheathing to one face of this frame.													
Plating Notes													
All plates are 2X4 except as noted.													
(***) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.													
Purlins													
In lieu of structural panels use purlins to brace TC @ 24" oc.													
Wind													
Wind loads based on MWFRS with additional C&C member design.													
End verticals not exposed to wind pressure.													

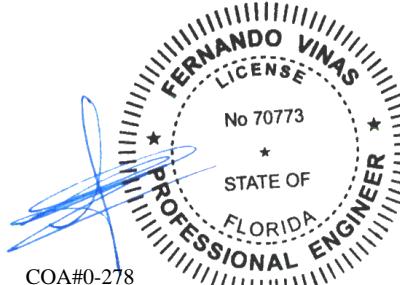

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344133 / FROM: CDM Page 1 of 2	COMM Ply: 1 Qty: 5	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: B04	Cust: R 215 JRef: 1XcL2150006 T1 / DrwNo: 028.22.1004.51952 KD / WHK 01/28/2022
--	--------------------------	--	---

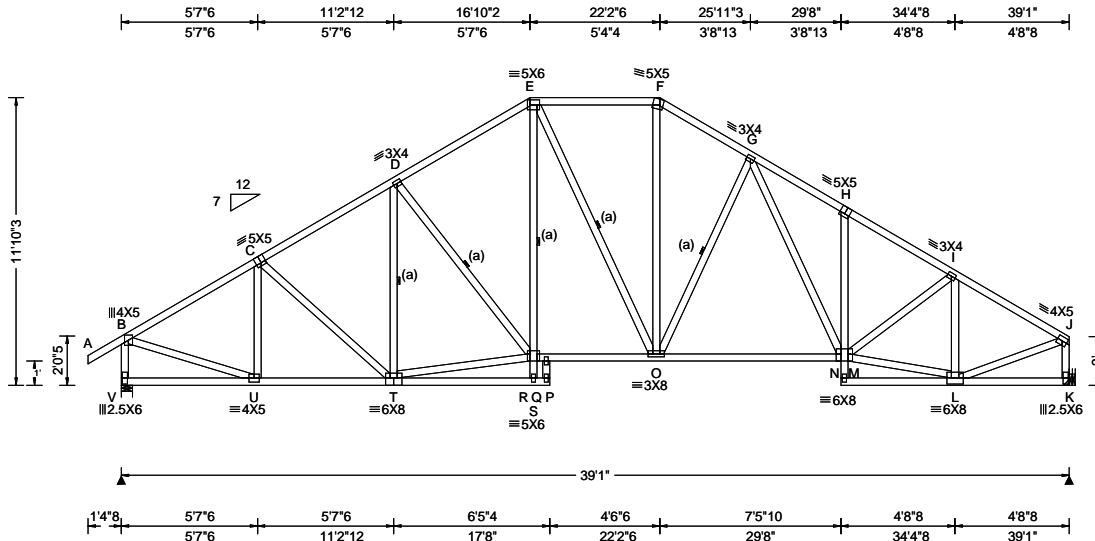

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+ / R-	/ Rh	Non-Gravity / Rw	/ U / RL		
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.101 R 999 240	V	1720	/ -	/ -	/1018 /294 /330		
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.209 R 999 180	K	1623	/ -	/ -	/939 /270 /-		
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.054 K - -	Wind reactions based on MWFRS						
Des Ld:	40.00	EXP: C Kzt: NA	Building Code:	HORZ(TL): 0.111 K - -	V	Brg Width = 5.5	Min Req = 2.0				
NCBCLL:	10.00	Mean Height: 16.41 ft	FBC 2017 RES	Creep Factor: 2.0	K	Brg Width = -	Min Req = -				
Soffit:	2.00	TCDL: 5.0 psf	TPI Std: 2014	Max TC CSI: 0.394	Bearing V is a rigid surface.						
Load Duration: 1.25	BCDL: 5.0 psf	MWFRS Parallel Dist: 0 to h/2	Rep Fac: Yes	Max BC CSI: 0.758	Members not listed have forces less than 375#						
Spacing: 24.0 "	C&C Dist a: 3.91 ft	C&C Dist a: Any	FT/RT:20(0)/10(0)	Max Web CSI: 0.624	Maximum Top Chord Forces Per Ply (lbs)						
	Loc. from endwall: Any	GCpi: 0.18	Plate Type(s):		Chords	Tens.Comp.	Chords	Tens. Comp.			
	Wind Duration: 1.60	WAVE			VIEW Ver: 20.02.01A.1209.11						

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C
member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is
11-10-3.

Note: Laterally brace bottom chord above filler at
20" O.C. Max. including a lateral brace at chord
ends.

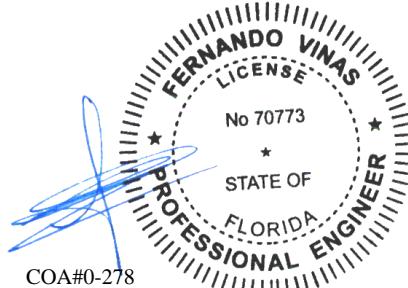

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344133 / FROM: CDM Page 2 of 2	COMM Qty: 5	Ply: 1 Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: B04	Cust: R 215 JRef:1XcL2150006 T1 / DrwNo: 028.22.1004.51952 KD / WHK 01/28/2022
--	----------------	--	--

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.


Bearing at location x=38'10" uses the following support conditions: 38'10"

Bearing K (38'10", 9'1") HUS26

Supporting Member: (2)2x6 SP 2400f-2.0E

(14) 0.148"x3" nails into supporting member,

(4) 0.148"x3" nails into supported member.

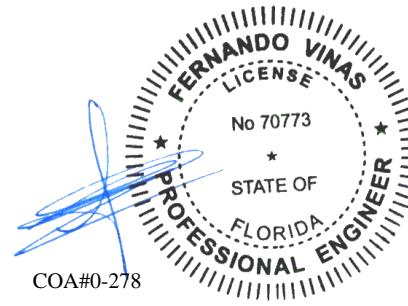

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 398223 / FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: C01	Cust: R 215 JRef:1XcL2150006 T21 / DrwNo: 028.22.1004.52436 / YK 01/28/2022
-----------------------------	--------------------------	--	---

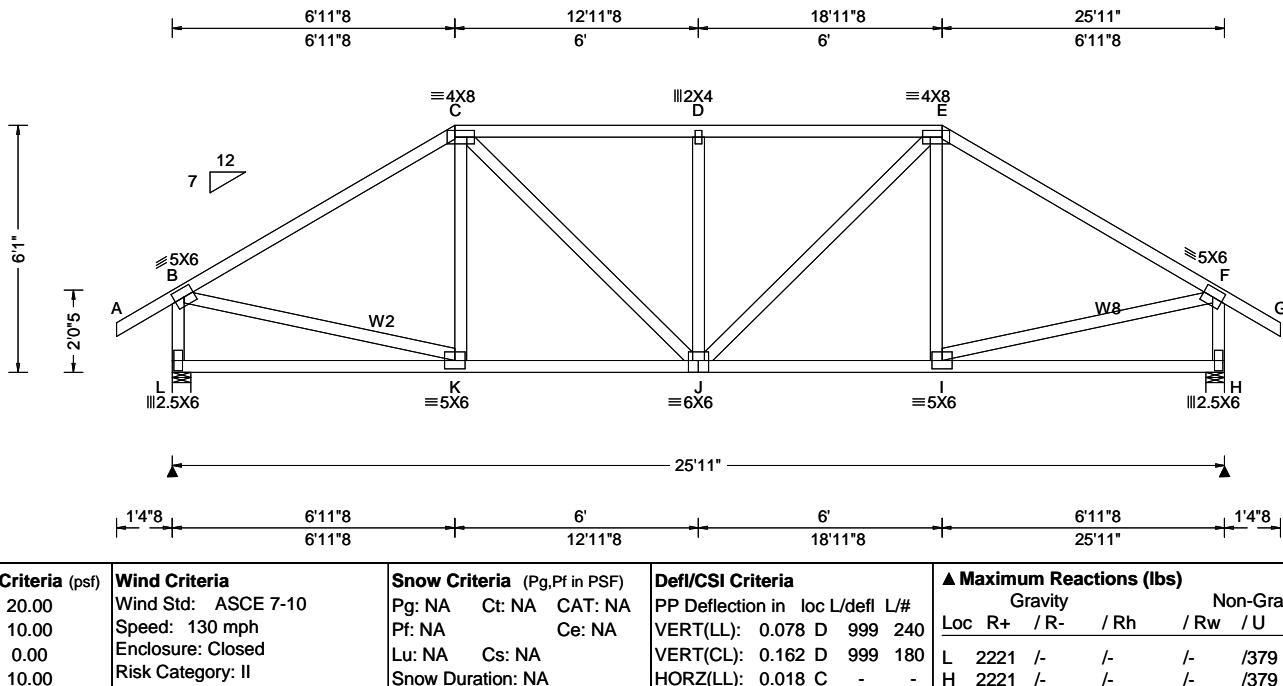

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)						
TCLL: 20.00		Wind Std: ASCE 7-10		Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	R+	/R-	/Rh	/Rw	/U	/RL
TCDL: 10.00		Speed: 130 mph		Pf: NA		Ce: NA	VERT(LL): 0.078 D 999 240	L	2221	/-	/-	/379	/-	
BCLL: 0.00		Enclosure: Closed		Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL): 0.162 D 999 180	H	2221	/-	/-	/379	/-	
BCDL: 10.00		Risk Category: II					HORZ(LL): 0.018 C - -							
Des Ld: 40.00		EXP: C Kzt: NA					HORZ(TL): 0.037 C - -							
NCBCLL: 0.00		Mean Height: 15.00 ft					Creep Factor: 2.0							
Soffit: 2.00		TCDL: 5.0 psf					Max TC CSI: 0.407							
Load Duration: 1.25		BCDL: 5.0 psf					Max BC CSI: 0.463							
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2					Max Web CSI: 0.522							
		C&C Dist a: 3.00 ft												
		Loc. from endwall: NA												
		GCpi: 0.18												
		Wind Duration: 1.60												
Lumber								▲ Maximum Reactions (lbs)						
Top chord: 2x4 SP M-31;								Gravity						
Bot chord: 2x4 SP M-31;								Non-Gravity						
Webs: 2x4 SP #3; W2,W8 2x4 SP #2;								Loc R+ /R- /Rh /Rw /U /RL						
								L 2221 /- /- /- /379 /-						
								H 2221 /- /- /- /379 /-						
								Wind reactions based on MWFRS						
								L Brg Width = 5.5 Min Req = 1.8						
								H Brg Width = 5.5 Min Req = 1.8						
								Bearings L & H are a rigid surface.						
								Members not listed have forces less than 375#						
								Maximum Top Chord Forces Per Ply (lbs)						
								Chords Tens.Comp. Chords Tens. Comp.						
								B - C 460 -2736 D - E 458 -2836						
								C - D 458 -2836 E - F 460 -2736						

Lumber

Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;
Webs: 2x4 SP #3; W2,W8 2x4 SP #2;

Loading

#1 hip supports 6-11-8 jacks W/2 panel TC and no end vert.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads and reactions based on MWFRS.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 6-1-0.



01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160-A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344135 / FROM: CDM	HIPS Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: C02	Cust: R 215 JRef: 1Xcl2150006 T26 / DrwNo: 028.22.1004.51718 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	--

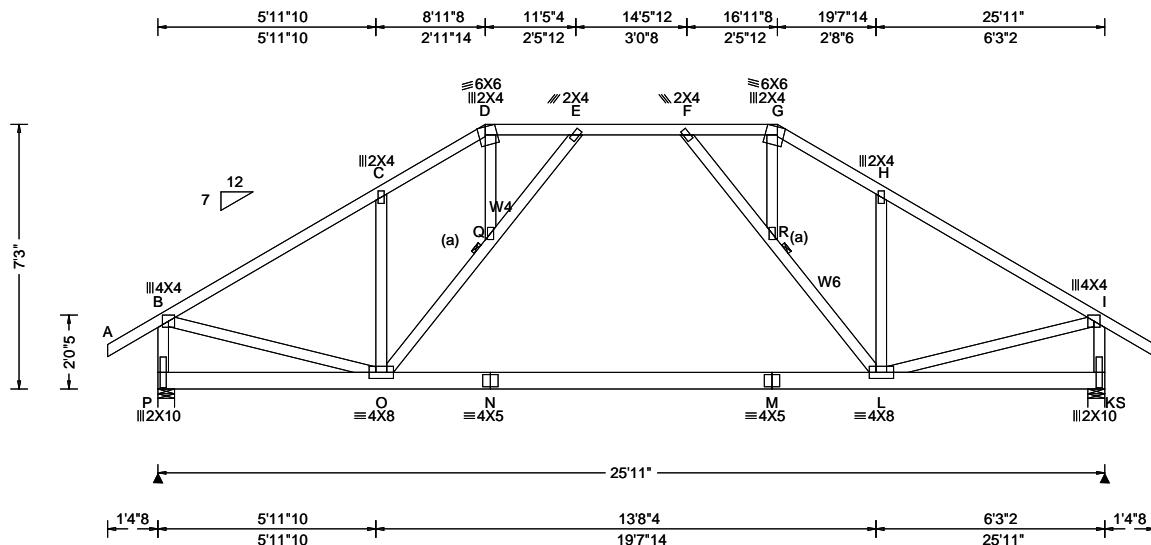

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+ / R-	/ Rh	Non-Gravity / Rw	/ U / RL
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.133 F 999 240	P	1319	/ -	/ 684	/ 208 / 175
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.293 F 999 180	S	1319	/ -	/ 684	/ 208 / -
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.091 C - -	Wind reactions based on MWFRS				
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.167 C - -	P	Brg Width = 5.5	Min Req = 1.5		
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	S	Brg Width = 5.5	Min Req = 1.5		
Soffit:	2.00	TCDL: 5.0 psf	Building Code: FBC 2017 RES	Max TC CSI: 0.949	Bearings P & S are a rigid surface.				
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.377	Members not listed have forces less than 375#				
Loc. from endwall: not in 9.00 ft		MWFRS Parallel Dist: h/2 to h	Rep Fac: Yes	Max Web CSI: 0.785	Maximum Top Chord Forces Per Ply (lbs)				
GCpi: 0.18		C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)		Chords	Tens.Comp.	Chords	Tens. Comp.	
Wind Duration: 1.60		Loc. from endwall: not in 9.00 ft	Plate Type(s): WAVE		B - C	304 - 1527	F - G	361 - 1240	
					C - D	374 - 1396	G - H	374 - 1397	
					D - E	361 - 1239	H - I	304 - 1528	
					E - F	346 - 1106			

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3; W4,W6 2x4 SP #2;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24° oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 7-3-0.

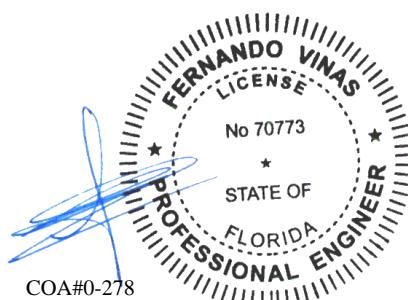

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344136 / FROM: CDM	HIPS Qty: 2	Ply: 1 Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: C03	Cust: R 215 JRef:1Xcl2150006 T29 / DrwNo: 028.22.1004.51859 KD / WHK 01/28/2022
-----------------------------	----------------	--	---

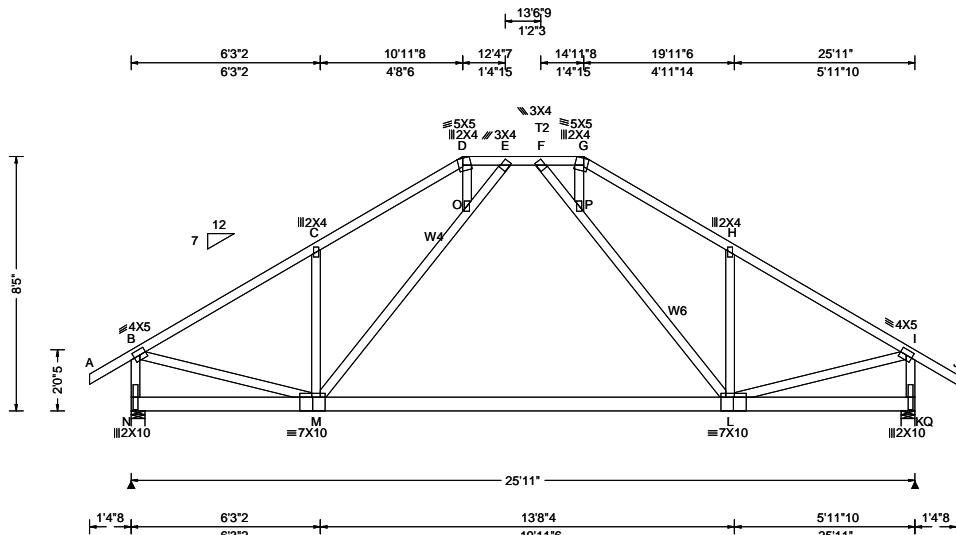

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA C: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+ / R-	/ Rh	Non-Gravity / Rw	/ U	/ RL
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.110 H 999 240	N	1503	/ -	/ -	/ 686	/ 371 / 204
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.181 H 999 180	Q	1516	/ -	/ -	/ 686	/ 381 / -
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.064 C - -	Wind reactions based on MWFRS					
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.107 C - -	N	Brg Width = 5.5	Min Req = 1.5			
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	Q	Brg Width = 5.5	Min Req = 1.5			
Soffit:	2.00	TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.818	Bearings N & Q are a rigid surface.					
Load Duration: 1.25	BCDL: 5.0 psf	MWFRS Parallel Dist: h/2 to h	FBC 2017 RES	Max BC CSI: 0.649	Members not listed have forces less than 375#					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: Varies by Ld Case	TPI Std: 2014	Max Web CSI: 0.610	Maximum Top Chord Forces Per Ply (lbs)					
	Loc. from endwall: not in 36.00 ft	FT/RT:20(0)/10(0)			Chords	Tens.Comp.	Chords	Tens. Comp.		
	GCpi: 0.18	Plate Type(s):			B - C	497 - 1889	F - G	417 - 1583		
	Wind Duration: 1.60	WAVE			C - D	488 - 1849	G - H	505 - 1868		
					D - E	402 - 1565	H - I	514 - 1910		
					E - F	321 - 1116				
VIEW Ver: 20.02.01A.1209.11										

Lumber

Top chord: 2x4 SP #2; T2 2x4 SP M-31;
Bot chord: 2x6 SP 2400f-2.0E;
Web: 2x4 SP #3; W4, W6 2x4 SP #2;

Special Loads

----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 63 plf at -1.38 to 63 plf at 27.29
BC: From 5 plf at -1.38 to 5 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 8.62
BC: From 60 plf at 8.62 to 60 plf at 9.25
BC: From 100 plf at 9.25 to 100 plf at 16.75
BC: From 60 plf at 16.75 to 60 plf at 18.06
BC: From 20 plf at 18.06 to 20 plf at 25.92
BC: From 5 plf at 25.92 to 5 plf at 27.29

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24° oc.

Wind


Wind loads based on MWFRS with additional C&C
member design.

End verticals not exposed to wind pressure.

Additional Notes

WARNING: 20 psf additional bottom chord live load
check has been modified

The overall height of this truss excluding overhang is
8-5-0.

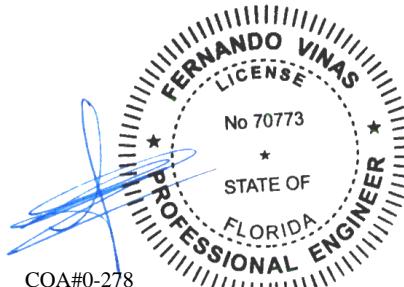

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344137 / FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: C04	Cust: R 215 JRef:1Xcl2150006 T30 / DrwNo: 028.22.1004.52014 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

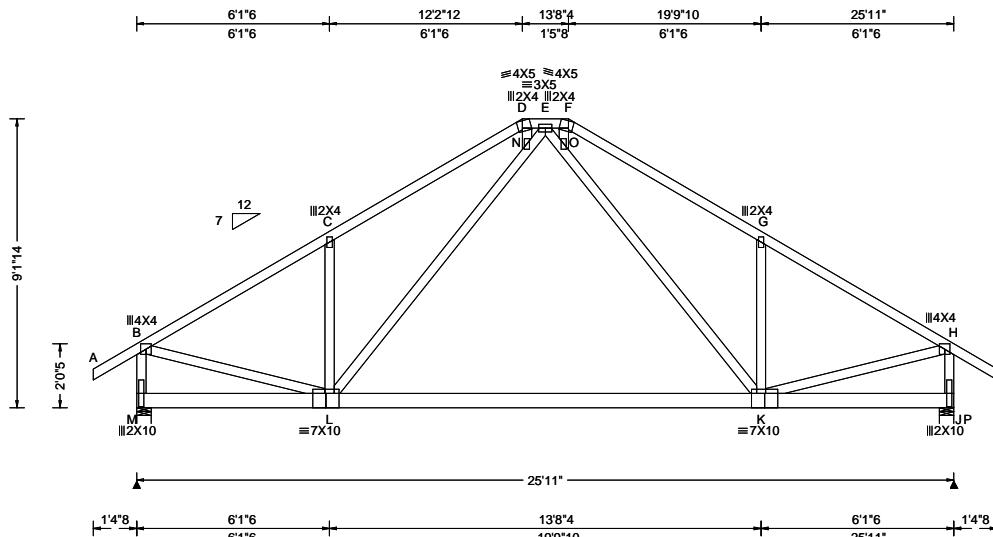

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)				
TCLL: 20.00		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Loc	R+	/R-	/Rh	Gravity
TCDL: 10.00		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.056 C 999 240					Non-Gravity
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.099 C 999 180	M	1340	/-	/	/685 /359 /223
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.025 C - -	P	1340	/-	/	/685 /359 /-
Des Ld: 40.00		EXP: C Kzt: NA		HORZ(TL): 0.046 C - -	Wind reactions based on MWFRS				
NCBCLL: 10.00		Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0	M	Brg Width = 5.5			Min Req = 1.5
Soffit: 2.00		TCDL: 5.0 psf	FBC 2017 RES	Max TC CSI: 0.689	P	Brg Width = 5.5			Min Req = 1.5
Load Duration: 1.25		BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.401	Bearings M & P are a rigid surface.				
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h	Rep Fac: Varies by Ld Case	Max Web CSI: 0.513	Members not listed have forces less than 375#				
		C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)		Maximum Top Chord Forces Per Ply (lbs)				
		Loc. from endwall: not in 36.00 ft	Plate Type(s):		Chords	Tens.Comp.	Chords	Tens. Comp.	
		GCpi: 0.18	WAVE						
		Wind Duration: 1.60			VIEW Ver: 20.02.01A.1209.11				

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Web: 2x4 SP #3;

Special Loads

----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 63 plf at -1.38 to 63 plf at 27.29
 BC: From 5 plf at -1.38 to 5 plf at 0.00
 BC: From 20 plf at 0.00 to 20 plf at 8.71
 BC: From 60 plf at 8.71 to 60 plf at 17.19
 BC: From 20 plf at 17.19 to 20 plf at 25.92
 BC: From 5 plf at 25.92 to 5 plf at 27.29

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24° oc.


Wind

Wind loads based on MWFRS with additional C&C
member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is
9'-11".

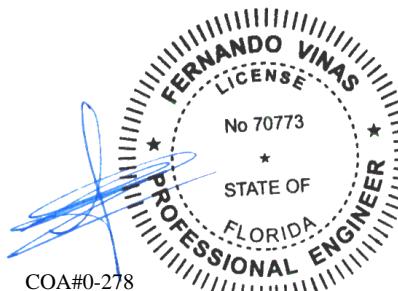

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344138 / FROM: CDM	SPEC Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: C05	Cust: R 215 JRef:1Xcl2150006 T2 / DrwNo: 028.22.1004.52092 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	--

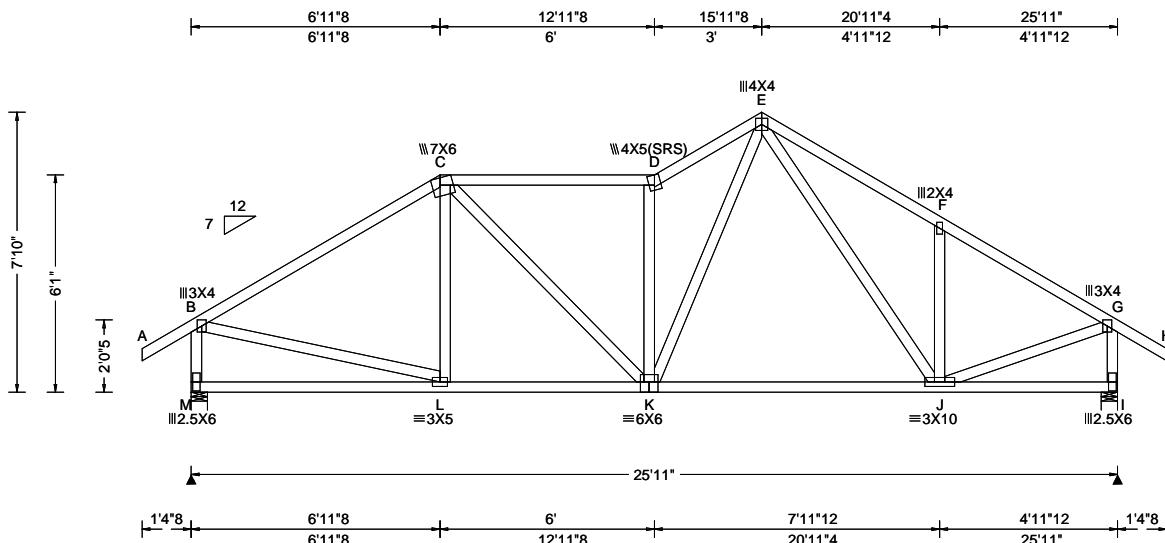

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	Gravity R+	/ R-	/ Rh	Non-Gravity / Rw	/ U	/ RL
TCDL:	10.00	Speed:	130 mph	Pf: NA		Ce: NA	VERT(LL): 0.056 D 999 240	M	1171	/ -	/ -	/674	/68	/189
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL): 0.115 D 999 180	I	1171	/ -	/ -	/679	/44	/-
BCDL:	10.00	Risk Category:	II				HORZ(LL): 0.015 C - -							
Des Ld:	40.00	EXP: C	Kzt: NA				HORZ(TL): 0.031 C - -							
NCBCLL:	10.00	Mean Height:	15.00 ft				Creep Factor: 2.0							
		TCDL:	5.0 psf				Max TC CSI: 0.592							
Soffit:	2.00	BCDL:	5.0 psf				Max BC CSI: 0.559							
Load Duration:	1.25	MWFRS Parallel Dist:	h to 2h				Max Web CSI: 0.635							
Spacing:	24.0 "	C&C Dist a:	3.00 ft											
		Loc. from endwall:	not in 9.00 ft											
		GCpi:	0.18											
		Wind Duration:	1.60											
Lumber								VIEW Ver: 20.02.01A.1209.11						

Lumber
Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Purlins
In lieu of structural panels use purlins to brace all flat
TC @ 24° oc.

Wind
Wind loads based on MWFRS with additional C&C
member design.
End verticals not exposed to wind pressure.

Additional Notes
The overall height of this truss excluding overhang is
7-10-0.

Maximum Bot Chord Forces Per Ply (lbs)			
Chords	Tens.Comp.	Chords	Tens. Comp.
L - K	995 - 191	K - J	872 - 136

Maximum Web Forces Per Ply (lbs)			
Web	Tens.Comp.	Web	Tens. Comp.
B - M	343 - 1109	K - E	959 - 312
B - L	985 - 179	J - G	1025 - 196
K - D	351 - 968	G - I	330 - 1138

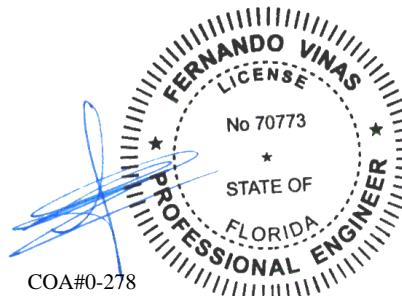

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 398225 / FROM: CDM	SPEC Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: C06	Cust: R 215 JRef: 1Xcl2150006 T19 / DrwNo: 028.22.1004.52501 / YK 01/28/2022
-----------------------------	--------------------------	--	--

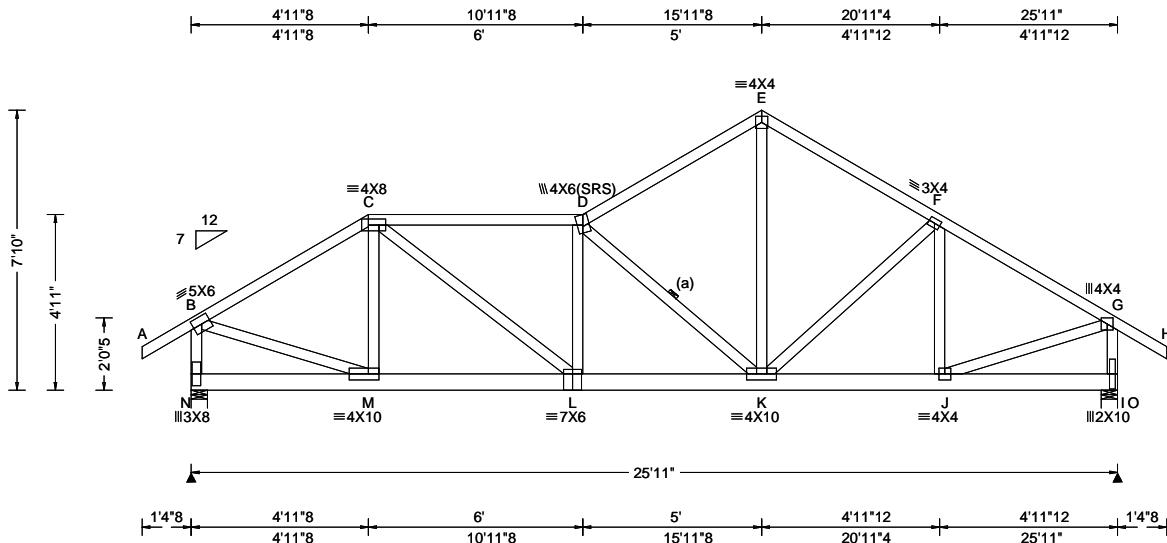

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity Loc	R+ / R-	/ Rh	Non-Gravity / Rw	/ U	/ RL
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.081 D 999 240	N	2295	/-	/	/314	/-
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.164 D 999 180	O	1480	/-	/	/256	/-
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.022 C - -	Wind reactions based on MWFRS					
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.045 C - -	N	Brg Width = 5.5	Min Req = 1.9			
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	O	Brg Width = 5.5	Min Req = 1.5			
Soffit:	2.00	TCDL: 5.0 psf	Building Code: FBC 2017 RES	Max TC CSI: 0.707	Bearings N & O are a rigid surface.					
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.364	Members not listed have forces less than 375#					
C&C Dist a: 3.00 ft		MWFRS Parallel Dist: 0 to h/2	Rep Fac: Varies by Ld Case	Max Web CSI: 0.905	Maximum Top Chord Forces Per Ply (lbs)					
Loc. from endwall: not in 9.00 ft		FT/RT:20(0)/10(0)			Chords	Tens. Comp.	Chords	Tens. Comp.		
GCpi: 0.18		Plate Type(s):			B - C	341 - 2700	E - F	256 - 1597		
Wind Duration: 1.60		WAVE			C - D	347 - 2563	F - G	258 - 1577		
					D - E	257 - 1596				
VIEW Ver: 21.01.01A.0521.20										

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Special Loads

-----Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 63 plf at -1.38 to 63 plf at 27.29
BC: From 5 plf at -1.38 to 5 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 4.99
BC: From 10 plf at 4.99 to 10 plf at 5.94
BC: From 20 plf at 5.94 to 20 plf at 25.92
BC: From 5 plf at 25.92 to 5 plf at 27.29
TC: 358 lb Conc. Load at 4.99
BC: 179 lb Conc. Load at 4.99
BC: 905 lb Conc. Load at 5.94

Purlins


In lieu of structural panels use purlins to brace all flat
TC @ 24° oc.

Wind

Wind loads and reactions based on MWFRS.
End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is
7-10-0.

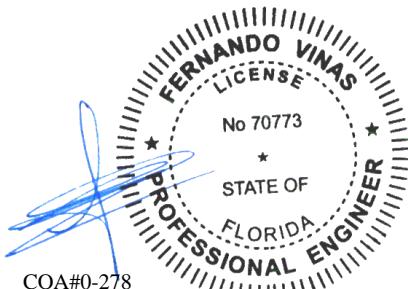

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344140 / FROM: CDM	COMM Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: D01	Cust: R 215 JRef:1XcL2150006 T16 / DrwNo: 028.22.1004.51093 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

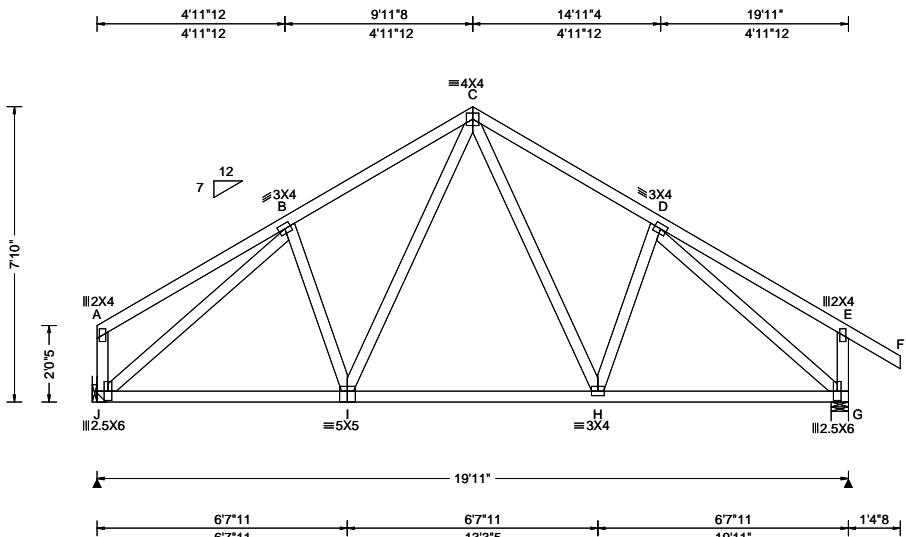

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.023 I 999 240	Loc R+ / R- / Rh / Rw / U / RL					
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.044 I 999 180	J 888 /- /- /462 /10 /174					
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.013 E - -	G 988 /- /- /540 /15 /-					
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.025 E - -	Wind reactions based on MWFRS					
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	J Brg Width = - Min Req = -					
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.296	G Brg Width = 5.5 Min Req = 1.5					
Load Duration: 1.25		BCDL: 5.0 psf		Max BC CSI: 0.469	Bearing G is a rigid surface.					
Spacing: 24.0 "		MWFRS Parallel Dist: h to 2h		Max Web CSI: 0.867	Members not listed have forces less than 375#					
		C&C Dist a: 3.00 ft			Maximum Top Chord Forces Per Ply (lbs)					
		Loc. from endwall: not in 9.00 ft			Chords Tens.Comp. Chords Tens. Comp.					
		GCpi: 0.18			B - C 283 - 945 C - D 275 - 940					
		Wind Duration: 1.60								

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' uses the following support conditions: 0'

Bearing J (0, 9'11") LUS26

Supporting Member: (1)2x6 SP 2400f-2.0-E
(4) 0.148"x3" nails into supporting member,
(3) 0.148"x3" nails into supported member.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes


The overall height of this truss excluding overhang is 7'-10-0".

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
J - I	771 - 104	H - G	762 - 104
I - H	618 - 30		

Maximum Web Forces Per Ply (lbs)

webs	Tens.Comp.	webs	Tens. Comp.
J - B	166 - 1026	D - G	140 - 1023

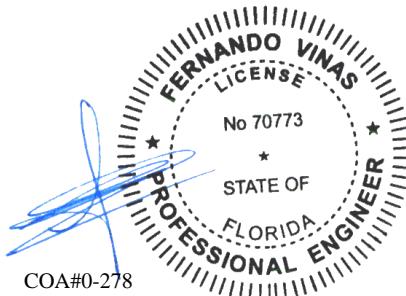

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344141 / FROM: CDM	COMM Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: D02	Cust: R 215 JRef:1XcL2150006 T13 / DrwNo: 028.22.1004.51890 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

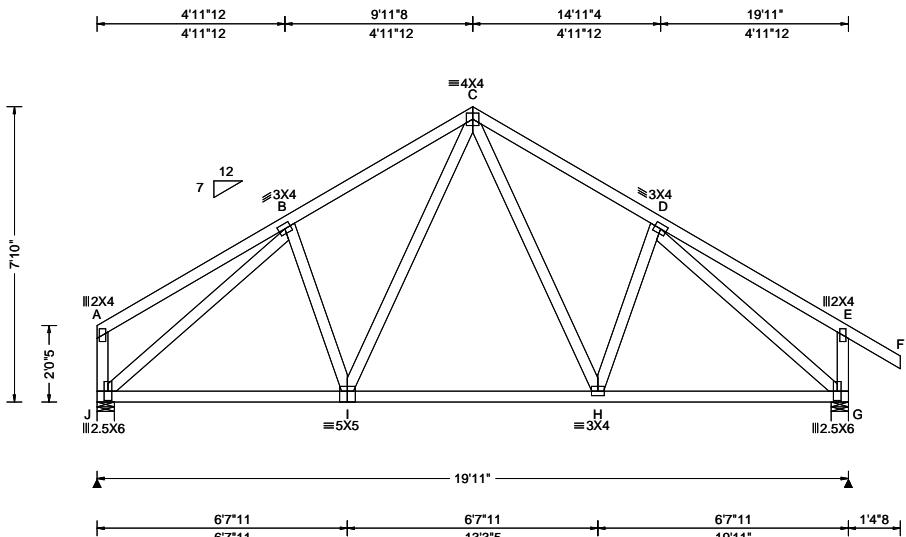

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	Gravity R+	/ R-	/ Rh	Non-Gravity / Rw	/ U / RL
TCDL:	10.00	Speed:	130 mph	Pf: NA		Ce: NA	VERT(LL):	825	/ -	/ -	/462	/10	/174
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL):	924	/ -	/ -	/540	/15	/ -
BCDL:	10.00	Risk Category:	II				HORZ(LL):						
Des Ld:	40.00	EXP: C	Kzt: NA				HORZ(TL):						
NCBCLL:	10.00	Mean Height:	15.00 ft				Creep Factor: 2.0						
Soffit:	2.00	TCDL:	5.0 psf				Max TC CSI: 0.297						
Load Duration:	1.25	BCDL:	5.0 psf				Max BC CSI: 0.456						
Spacing:	24.0 "	MWFRS Parallel Dist:	h to 2h				Max Web CSI: 0.776						
		C&C Dist a:	3.00 ft										
		Loc. from endwall:	not in 9.00 ft										
		GCpi:	0.18										
		Wind Duration:	1.60										
								VIEW Ver: 20.02.01A.1209.11					

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 7'-10-0".

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
--------	------------	--------	-------------


J - I 694 - 104 H - G 685 - 104

I - H 555 - 30

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
------	------------	------	-------------

J - B 166 - 918 D - G 140 - 914

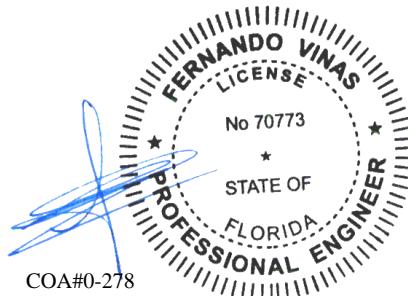

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 406376 / FROM: CDM	COMM Ply: 2 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: D03	Cust: R 215 JRef:1Xcl2150006 T15 / DrwNo: 028.22.1004.52968 / YK 01/28/2022
-----------------------------	--------------------------	--	---

2 Complete Trusses Required

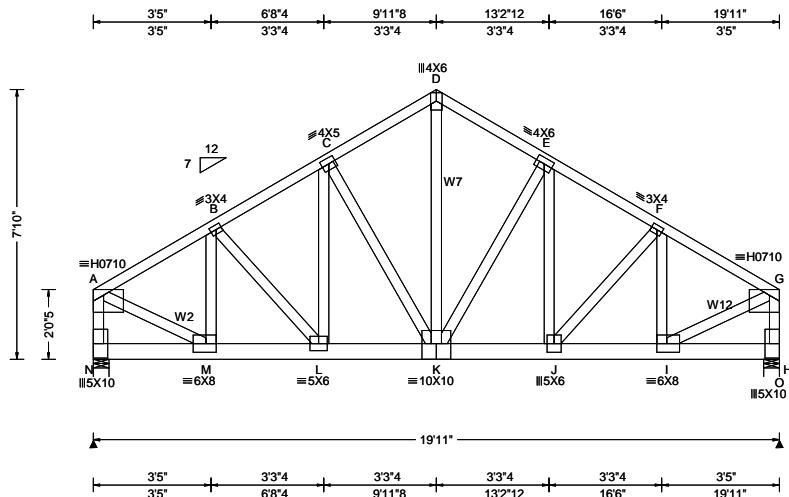

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)						
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/defl L/#	Loc	Gravity R+	Non-Gravity R-	/ Rh	/ Rw	/ U	/ RL
TCDL:	10.00	Speed:	130 mph	Pf: NA		Ce: NA	VERT(LL): 0.092 J 999 240	N	8089	/-	/-	/	1395	/-
BCLL:	0.00	Enclosure:	Closed	Lu: NA	Cs: NA	Snow Duration: NA	VERT(CL): 0.183 J 999 180	O	8680	/-	/-	/	1436	/-
BCDL:	10.00	Risk Category:	II				HORZ(LL): 0.034 B - -							
Des Ld:	40.00	EXP: C	Kzt: NA				HORZ(TL): 0.067 B - -							
NCBCLL: 0.00	Mean Height: 15.00 ft	TCDL: 5.0 psf	Building Code:	Creep Factor: 2.0			Creep Factor: 2.0							
Soffit: 2.00	BCDL: 5.0 psf	MWFRS Parallel Dist: 0 to h/2	FBC 2017 RES	Max TC CSI: 0.389			Max TC CSI: 0.389							
Load Duration: 1.25	C&C Dist a: 3.00 ft	Rep Fac: No	TPI Std: 2014	Max BC CSI: 0.357			Max BC CSI: 0.357							
Spacing: 24.0 "	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)		Max Web CSI: 0.920			Max Web CSI: 0.920							
	GCpi: 0.18	Plate Type(s):												
	Wind Duration: 1.60	HS, WAVE												
VIEW Ver: 21.01.01A.0521.20														

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3; W2,W7,W12 2x4 SP #2;

Nailnote

Nail Schedule: 0.131" x 3", min. nails
Top Chord: 1 Row @ 12.00" o.c.
Bot Chord: 2 Rows @ 4.00" o.c. (Each Row)
Webs: 1 Row @ 4" o.c.
Use equal spacing between rows and stagger nails
in each row to avoid splitting.

Special Loads


----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 63 plf at 0.00 to 63 plf at 19.92
BC: From 10 plf at 0.00 to 10 plf at 19.92
BC: 1623 lb Conc. Load at 2.02, 4.02, 6.02, 8.02
10.02
BC: 1607 lb Conc. Load at 12.06
BC: 1748 lb Conc. Load at 14.06
BC: 1921 lb Conc. Load at 16.06, 18.06

Wind

Wind loads and reactions based on MWFRS.
End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 7'-10-0.

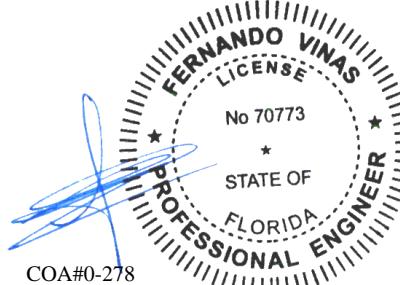

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344143 / FROM: CDM	MONO Ply: 1 Qty: 17	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: E01	Cust: R 215 JRef:1XcL2150006 T41 / DrwNo: 028.22.1004.51594 KD / WHK 01/28/2022
-----------------------------	---------------------------	--	---

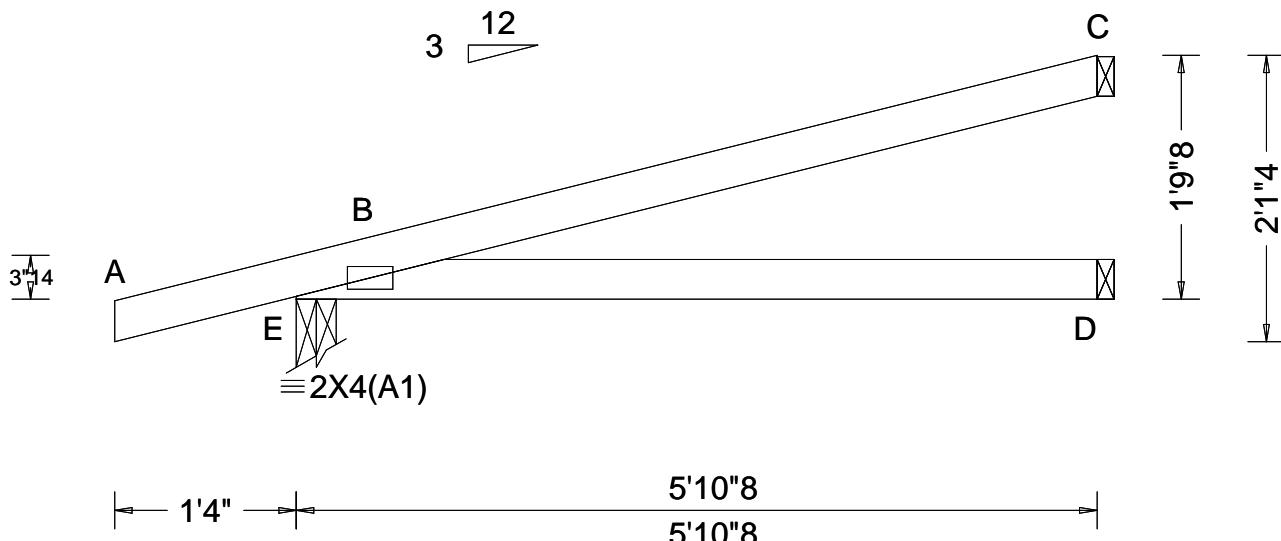

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)								
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity	/ Rh	/ Rw	/ U	/ RL	
TCDL:	10.00	Speed:	130 mph	Lu: NA	Cs: NA				VERT(LL): NA	E	341	/-	/-	/187	/83	/51
BCLL:	0.00	Enclosure:	Closed	Snow Duration:	NA				VERT(CL): NA	D	104	/-	/-	/70	/-	/-
BCDL:	10.00	Risk Category:	II						HORZ(LL): 0.009 D	-	-					
Des Ld:	40.00	EXP: C	Kzt: NA						HORZ(TL): 0.017 D	-	-					
Mean Height: 15.00 ft									Creep Factor: 2.0							
NCBCLL: 10.00		TCDL: 5.0 psf		Building Code:					Max TC CSI: 0.432							
Soffit: 2.00		BCDL: 5.0 psf		FBC 2017 RES					Max BC CSI: 0.318							
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2		TPI Std: 2014					Max Web CSI: 0.000							
Spacing: 24.0 "		C&C Dist a: 3.00 ft		Rep Fac: Yes												
Loc. from endwall: Any		FT/RT:20(0)/10(0)		FT/RT:20(0)/10(0)												
GCpi: 0.18		Plate Type(s):		Plate Type(s):												
Wind Duration: 1.60		WAVE		WAVE												
VIEW Ver: 20.02.01A.1209.11																

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

The overall height of this truss excluding overhang is 1-9-8.

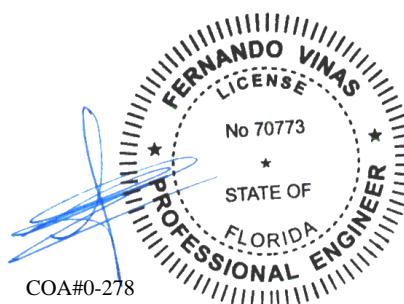

01/28/2022


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

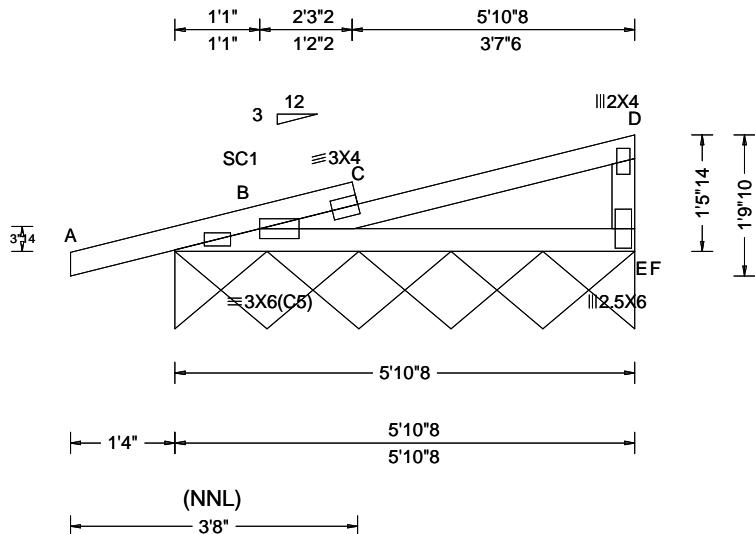

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF					
		Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity			Non-Gravity		
		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.049 C 999 240	Loc	R+	/ R-	/ Rh	/ Rw	/ U
TCLL:	20.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.094 C 710 180			/	/51	/19	/9
TCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.007 D - -						
BCLL:	0.00	EXP: C Kzt: NA		HORZ(TL): 0.013 D - -						
BCDL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0						
Des Ld:	40.00	Building Code:		FBC 2017 RES						
NCBCLL:	10.00	TCDL: 5.0 psf		TPI Std: 2014						
Soffit:	2.00	BCDL: 5.0 psf		Rep Fac: Yes						
Load Duration:	1.25	MWFRS Parallel Dist: 0 to h/2		FT/RT:20(0/10/0)						
Spacing:	24.0 "	C&C Dist a: 3.00 ft		Plate Type(s):						
		Loc. from endwall: Any		WAVE						
		GCpi: 0.18								
		Wind Duration: 1.60								
					VIEW Ver: 20.02.01A.1209.11					

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;

Plating Notes

All plates are 2X4(C5) except as noted.

Purlins

In lieu of structural panels use purlins to brace TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.


Right end vertical not exposed to wind pressure.

Additional Notes

See DWGS A14015ENC101014 & GBLLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 2x6.

The overall height of this truss excluding overhang is 15.11.

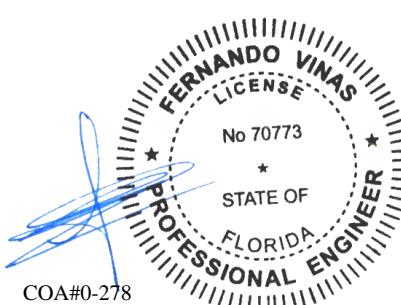

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org.

SEQN: 417999 / FROM: CDM Page 1 of 2	FLAT Ply: 2 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: FTG01	Cust: R 215 JRef:1XcL2150006 T48 / DrwNo: 028.22.1004.53235 AK / FV 01/28/2022
--	--------------------------	--	--

2 Complete Trusses Required

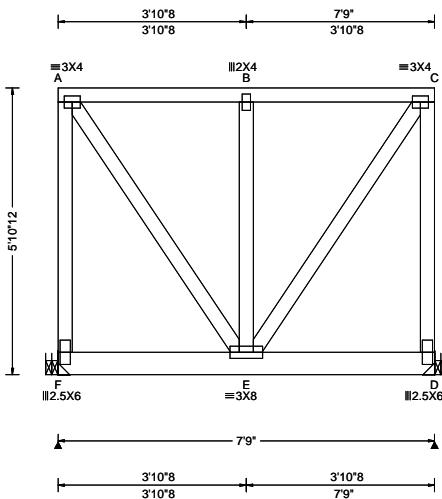

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.005 B 999 240	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL: 0.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.009 B 999 180	F 775 /- /- /- /190 /-		D 755 /- /- /- /186 /-			
BCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): 0.001 A - -	Wind reactions based on MWFRS		HORZ(TL): 0.001 A - -			
Des Ld: 40.00		EXP: C Kzt: NA	Building Code:	Creep Factor: 2.0	F Brg Wid = -		Max TC CSI: 0.058			
NCBCLL: 0.00		Mean Height: 22.03 ft	FBC 2017 RES	Max BC CSI: 0.166	D Brg Wid = -		Max Web CSI: 0.128			
Soffit: 2.00		BCDL: 5.0 psf	TPI Std: 2014	Plate Type(s):	Members not listed have forces less than 375#		VIEW Ver: 21.01.01A.0521.20			
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2	Rep Fac: No							
Spacing: 24.0 "		C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)							
Loc. from endwall: not in 9.00 ft		Loc. from endwall: not in 9.00 ft	WAVE							
GCpi: 0.18		Wind Duration: 1.60								

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP #2;
Webs: 2x4 SP #3;

Nailnote

Nail Schedule: 0.131" x 3", min. nails
Top Chord: 1 Row @ 12.00" o.c.
Bot Chord: 1 Row @ 9.75" o.c.
Webs : 1 Row @ 4" o.c.
Use equal spacing between rows and stagger nails
in each row to avoid splitting.

Special Loads

----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 30 plf at 0.00 to 30 plf at 7.75
BC: From 10 plf at 0.00 to 10 plf at 7.75
BC: 406 lb Conc. Load at 1.81, 3.81, 5.81

Purlins


The TC of this truss shall be braced with attached spans at 24" oc in lieu of structural sheathing.

Wind

Wind loads and reactions based on MWFRS.
End verticals not exposed to wind pressure.

Additional Notes

Truss must be installed as shown with top chord up.
The overall height of this truss excluding overhang is 5-10-12.

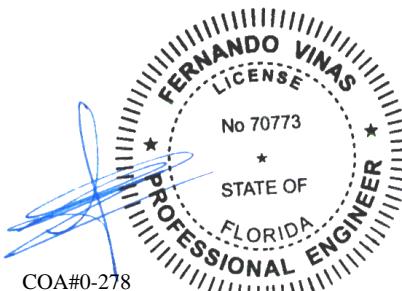

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 417999 / FROM: CDM Page 2 of 2	FLAT Qty: 1	Ply: 2 Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: FTG01	Cust: R 215 JRef:1XcL2150006 T48 / DrwNo: 028.22.1004.53235 AK / FV 01/28/2022
--	----------------	--	--

Hangers / Ties

Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Hanger specified assumes connection to supporting chord is located a minimum of five times the depth of the supporting chord from any unsupported end, unless unsupported chord end has 85% plating coverage.

Bearing at location x=0' uses the following support conditions: 0'

Bearing F (0', 16'1"8) LUS26-2

Supporting Member: (2)2x6 SP #2
(4) 0.148"x3" nails into supporting member,


(3) 0.148"x3" nails into supported member.

Bearing D (7'6", 16'1"8) LUS26-2

Supporting Member: (2)2x6 SP #2

(4) 0.148"x3" nails into supporting member,

(3) 0.148"x3" nails into supported member.

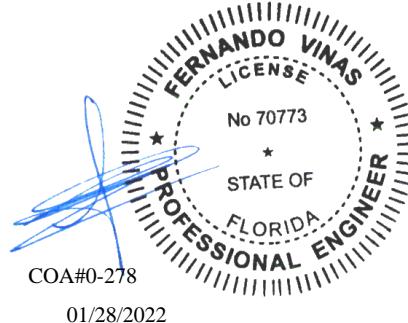

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbacacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344147 / FROM: CDM	EJAC Ply: 1 Qty: 7	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: J01	Cust: R 215 JRef:1XcL2150006 T22 / DrwNo: 028.22.1004.51765 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

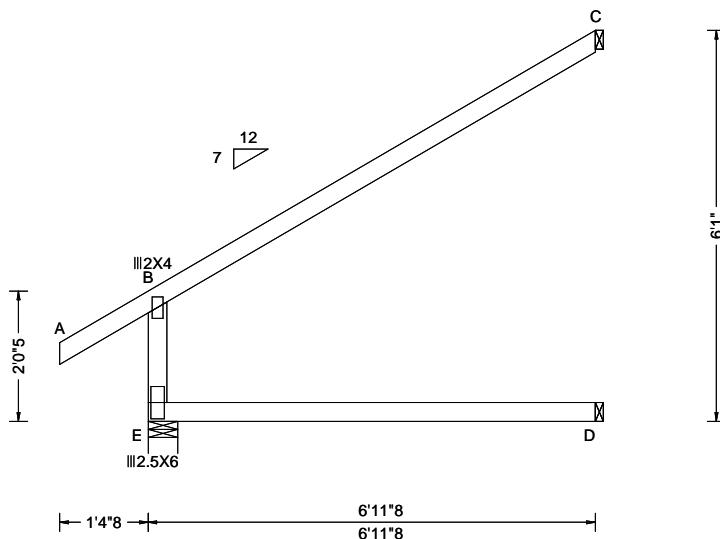

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)							
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity						
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.001 B 999 240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.001 B 999 180	E	423	/ -	/ -	/304	/120	/ -	
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 B - -	D	170	/ -	/ -	/93	/ -	/ -	
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.001 B - -	C	211	/ -	/ -	/83	/9	/138	
NCBCLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	Wind reactions based on MWFRS							
Soffit:	2.00	TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.905	E	Brg Width = 5.5 Min Req = 1.5						
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.600	D	Brg Width = 1.5 Min Req = -						
Loc. from endwall: not in 4.50 ft		MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max Web CSI: 0.080	C	Brg Width = 1.5 Min Req = -						
GCpi: 0.18		C&C Dist a: 3.00 ft	Rep Fac: Yes		Bearing E is a rigid surface.							
Wind Duration: 1.60		Loc. from endwall: not in 4.50 ft	FT/RT:20(0)/10(0)		Members not listed have forces less than 375#							
			Plate Type(s):		VIEW Ver: 20.02.01A.1209.11							
			WAVE									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.


Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 6-1-0.

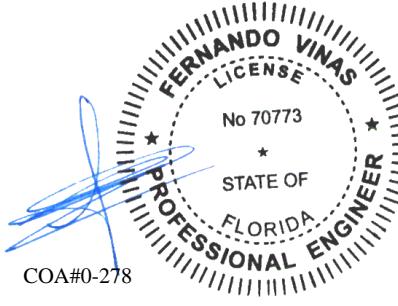

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344148 / FROM: CDM	JACK Ply: 1 Qty: 5	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: J02	Cust: R 215 JRef:1XcL2150006 T18 / DrwNo: 028.22.1004.51686 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

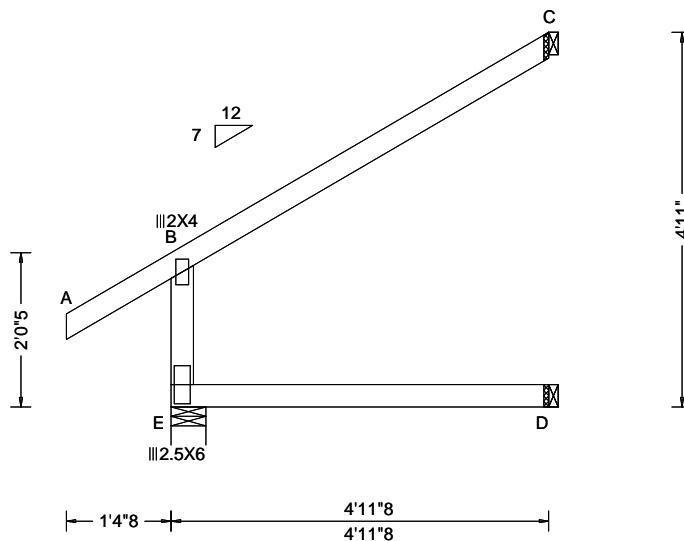

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)							
Loc	R+	Loc	R-	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in loc L/defl L/#	VERT(LL):	B	999	240	Gravity	Non-Gravity
TCLL:	20.00	Wind Std:	ASCE 7-10						VERT(CL):	0.001	B	999	180	E	312
TCDL:	10.00	Speed:	130 mph						HORZ(LL):	-0.001	B	-	-	D	99
BCLL:	0.00	Enclosure:	Closed						HORZ(TL):	0.001	B	-	-	C	144
BCDL:	10.00	Risk Category:	II						Creep Factor:	2.0					
Des Ld:	40.00	EXP: C	Kzt: NA						Max TC CSI:	0.398					
NCBLL:	10.00	Mean Height:	15.00 ft						Max BC CSI:	0.293					
Soffit:	2.00	TCDL:	5.0 psf						Max Web CSI:	0.073					
Load Duration:	1.25	BCDL:	5.0 psf												
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2												
		C&C Dist a:	3.00 ft												
		Loc. from endwall:	not in 4.50 ft												
		GCpi:	0.18												
		Wind Duration:	1.60												
										VIEW Ver: 20.02.01A.1209.11					

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 4-11-0.

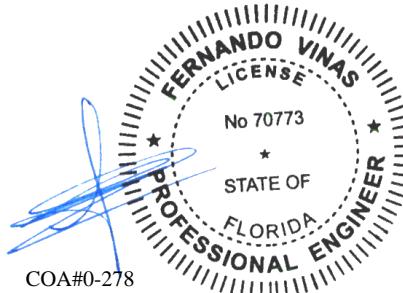

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344149 / FROM: CDM	JACK Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: J02A	Cust: R 215 JRef:1Xcl2150006 T42 / DrwNo: 028.22.1004.51923 KD / WHK 01/28/2022
-----------------------------	----------------	---	---

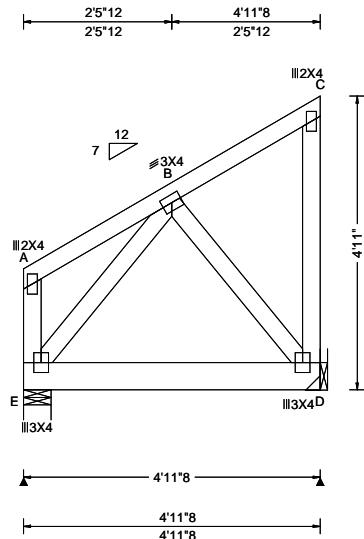

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.001 B 999 240	Loc R+ / R-	/ Rh	/ Rw	/ U	/ RL	
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.001 B 999 180	E 1233 /- /- /- /63 /-		D 905 /- /- /- /59 /-			
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.000 B - -	Wind reactions based on MWFRS		HORZ(TL): 0.000 B - -			
Des Ld:	40.00	EXP: C Kzt: NA	Building Code:		Creep Factor: 2.0		E Brg Width = 5.5 Min Req = 1.5			
NCBLL: 10.00	Mean Height: 15.00 ft	TCDL: 5.0 psf	FBC 2017 RES	Max TC CSI: 0.111	D Brg Width = - Min Req = -		Bearing E is a rigid surface.			
Soffit: 2.00	BCDL: 5.0 psf	MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max BC CSI: 0.671	Members not listed have forces less than 375#		Max Web CSI: 0.158			
Load Duration: 1.25	Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: Varies by Ld Case	FT/RT:20(0)/10(0)	VIEW Ver: 20.02.01A.1209.11					
Des Ld: 40.00	Loc. from endwall: not in 9.00 ft	GCpi: 0.18	Plate Type(s):	WAVE						
NCBLL: 10.00	Wind Duration: 1.60									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;

Special Loads

----(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
TC: From 63 plf at 0.00 to 63 plf at 4.96
BC: From 10 plf at 0.00 to 10 plf at 4.96
BC: 888 lb Conc. Load at 1.02, 3.02

Hangers / Ties

(J) Hanger Support Required, by others


Wind

Wind loads and reactions based on MWFRS.

End verticals not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 4-11-0.

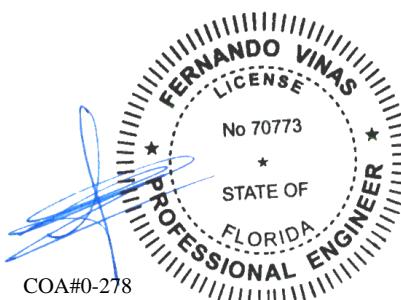

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344150 / FROM: CDM	JACK Ply: 1 Qty: 6	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: J03	Cust: R 215 JRef:1XcL2150006 T17 / DrwNo: 028.22.1004.51424 KD / WHK 01/28/2022
-----------------------------	--------------------------	--	---

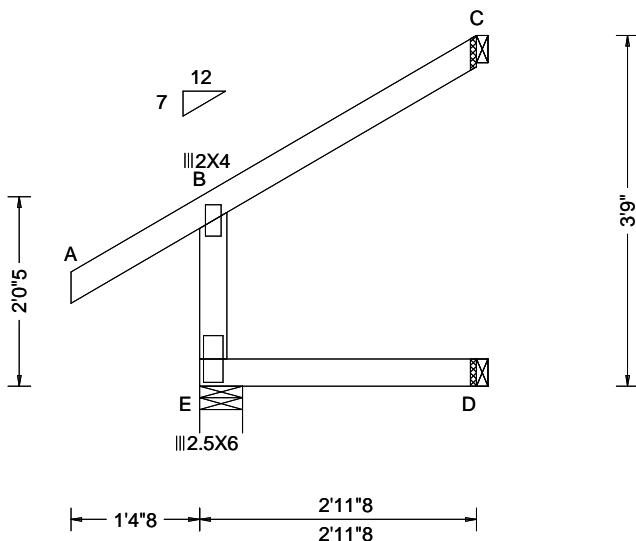

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in loc L/defl L/#	VERT(LL):	0.000 B 999 240	Gravity	Non-Gravity
TCDL:	10.00	Speed:	130 mph	Lu: NA	Cs: NA				VERT(CL):	0.001 B 999 180		E 238 /- /- /198 /77 /-	
BCLL:	0.00	Enclosure:	Closed	Snow Duration:	NA				HORZ(LL):	-0.000 B - -		D 59 /- /- /40 /- /-	
BCDL:	10.00	Risk Category:	II						HORZ(TL):	0.000 B - -		C 72 /- /- /48 /8 /72	
Des Ld:	40.00	EXP: C	Kzt: NA						Creep Factor:	2.0			
NCBCLL:	10.00	Mean Height:	15.00 ft						Max TC CSI:	0.143			
Soffit:	2.00	TCDL:	5.0 psf						Max BC CSI:	0.096			
Load Duration:	1.25	BCDL:	5.0 psf						Max Web CSI:	0.065			
Spacing:	24.0 "	MWFRS Parallel Dist:	0 to h/2										
		C&C Dist a:	3.00 ft										
		Loc. from endwall:	Any										
		GCpi:	0.18										
		Wind Duration:	1.60										
								VIEW Ver: 20.02.01A.1209.11					

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 3'-9-0.

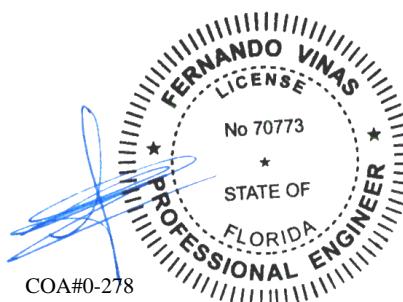

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344151 / FROM: CDM	JACK Qty: 6	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: J04	Cust: R 215 JRef:1XcL2150006 T3 / DrwNo: 028.22.1004.51425 KD / WHK 01/28/2022
-----------------------------	----------------	--	--

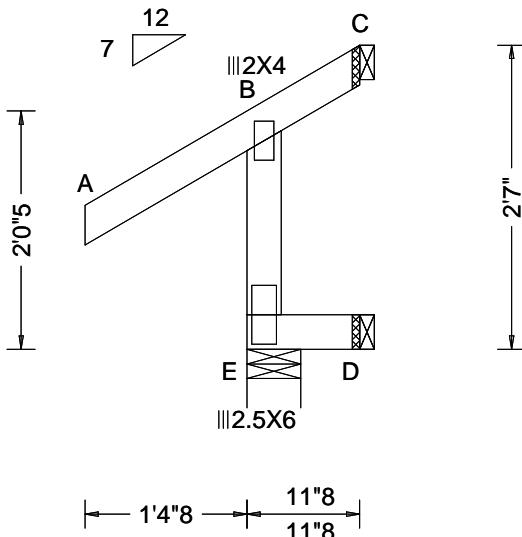

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Left end vertical not exposed to wind pressure.

Additional Notes

The overall height of this truss excluding overhang is 2-7-0.

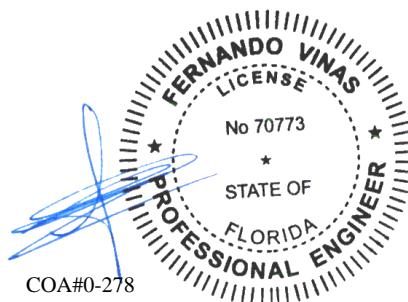

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org.

SEQN: 398219 / FROM: CDM	HIP_ Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: J05HJ	Cust: R 215 JRef:1XcL2150006 T25 / DrwNo: 028.22.1004.52468 / YK 01/28/2022
-----------------------------	----------------	--	---

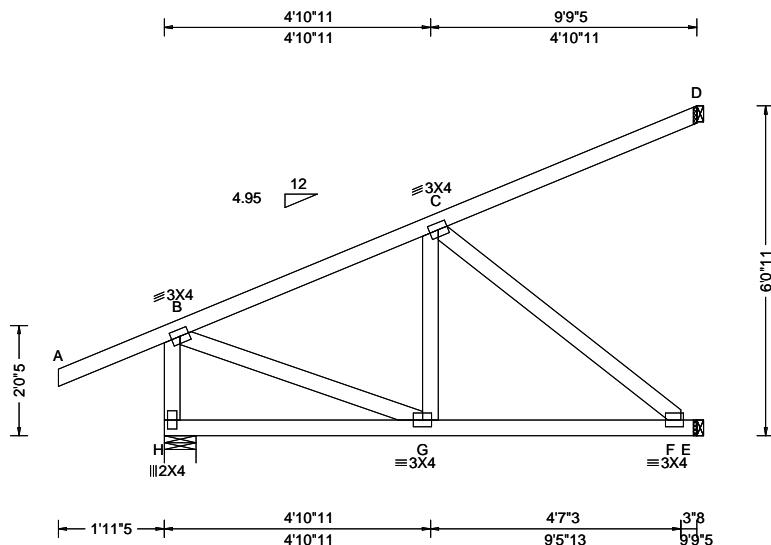

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)					
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity				
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.010 F 999 240	Loc	R+	/ R-	/ Rh	/ Rw	/ U
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.021 F 999 180	/ RL					
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.005 C - -	H	435	/ -	/ -	/ -	/ 86
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.009 C - -	E	359	/ -	/ -	/ -	/ 4
NCBCLL: 0.00	Mean Height: 15.00 ft	Building Code:	Creep Factor: 2.0		D	261	/ -	/ -	/ -	/ 97
Soffit: 2.00	TCDL: 5.0 psf	FBC 2017 RES	Max TC CSI: 0.681		Wind reactions based on MWFRS					
Load Duration: 1.25	BCDL: 5.0 psf	TPI Std: 2014	Max BC CSI: 0.457		H	Brg Width = 7.0	Min Req = 1.5			
Spacing: 24.0 "	MWFRS Parallel Dist: 0 to h/2	Rep Fac: No	Max Web CSI: 0.317		E	Brg Width = 1.5	Min Req = -			
	C&C Dist a: 3.00 ft	FT/RT:20(0)/10(0)			D	Brg Width = 1.5	Min Req = -			
	Loc. from endwall: NA	Plate Type(s):			Bearing H is a rigid surface.					
	GCpi: 0.18	WAVE			Members not listed have forces less than 375#					
	Wind Duration: 1.60				Maximum Top Chord Forces Per Ply (lbs)					
					Chords	Tens. Comp.				

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Loading

Hipjack supports 6-11-0 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Left end vertical not exposed to wind pressure.


Additional Notes

The overall height of this truss excluding overhang is 6-0-11.

B - C 65 - 406

Maximum Web Forces Per Ply (lbs)

Webs	Tens. Comp.	Webs	Tens. Comp.
H - B	89 - 436	C - F	77 - 459

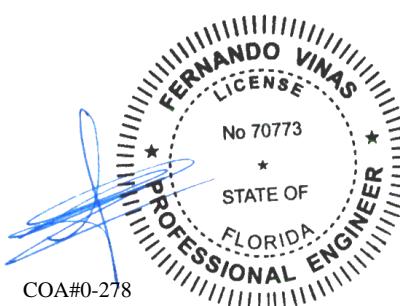

01/28/2022


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

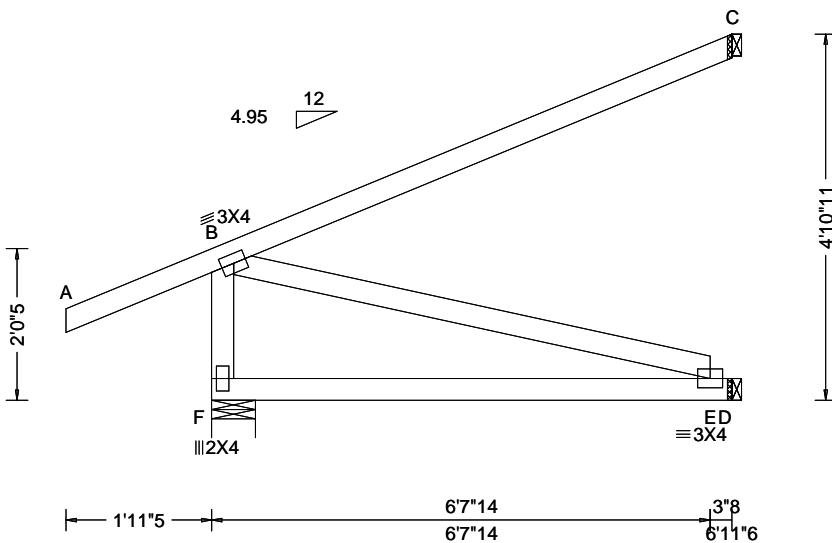

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Loading


Hipjack supports 4-11-0 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.
Left end vertical not exposed to wind pressure

Additional Notes

The overall height of this truss excluding overhang is 4-10-11.

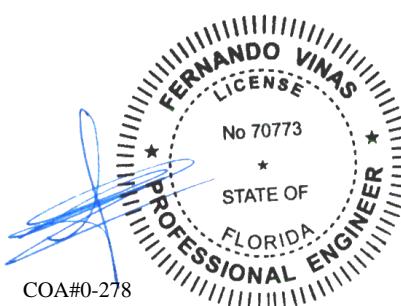

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 353615 / FROM: CDM	COMM Ply: 1 Qty: 16	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: PB01	Cust: R 215 JRef:1XcL2150006 T7 / DrwNo: 028.22.1004.51423 KD / WHK 01/28/2022
-----------------------------	---------------------------	---	--

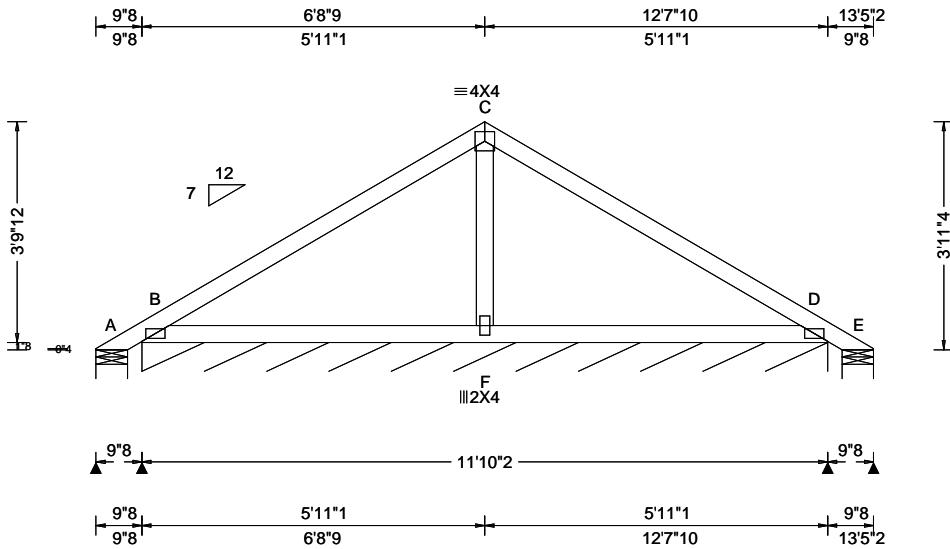

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or =PLF								
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity							
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.006 F 999 240	Loc R+ / R- / Rh / Rw / U / RL								
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.013 F 999 180	A - /-308 /- /99 /208 /104								
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.004 F - -	B* 171 /- /- /59 /24 /-								
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.009 F - -	E - /-308 /- /88 /157 /-								
NCBCLL:	10.00	Mean Height: 17.99 ft		Creep Factor: 2.0	Wind reactions based on MWFRS								
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.424	A Brg Width = 6.5 Min Req = 1.5								
Load Duration: 1.25		BCDL: 5.0 psf		Max BC CSI: 0.362	B Brg Width = 142 Min Req = -								
Spacing: 24.0 "		MWFRS Parallel Dist: h/2 to h		Max Web CSI: 0.024	E Brg Width = 6.5 Min Req = 1.5								
		C&C Dist a: 3.00 ft			Bearings A, B, & E are a rigid surface.								
		Loc. from endwall: not in 13.00 ft			Members not listed have forces less than 375#								
		GCpi: 0.18			Wind Duration: 1.60								
					VIEW Ver: 20.02.01A.1209.11								

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4(A1) except as noted.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Negative reaction(s) of -308# MAX. from a non-wind load case requires uplift connection. See Maximum Reactions.

Refer to DWG PB160101014 for piggyback details.

The overall height of this truss excluding overhang is 3'-11-4.

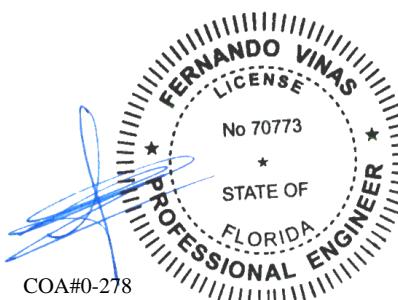

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344157 / FROM: CDM	COMM Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: PB02	Cust: R 215 JRef:1XcL2150006 T43 / DrwNo: 028.22.1004.51671 KD / WHK 01/28/2022
-----------------------------	--------------------------	---	---

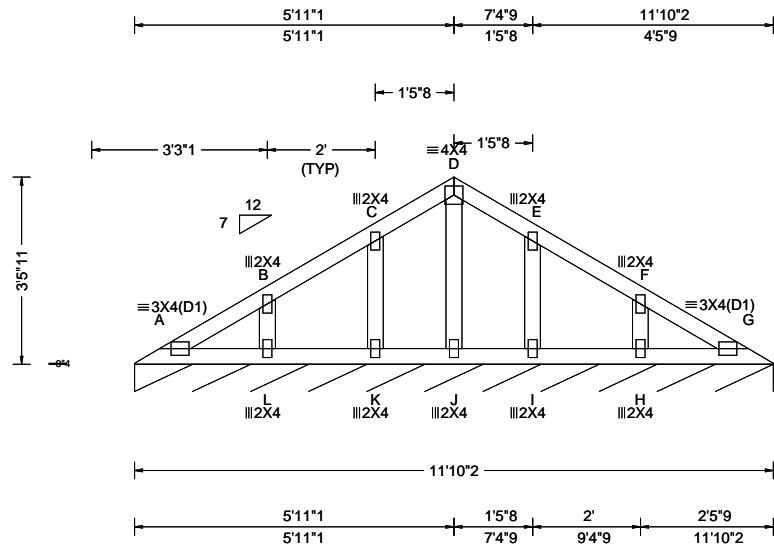

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.002 H 999 240	Loc	R+	/ R-	/ Rh	/ Rw
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.004 H 999 180	/ U				/ RL
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.001 H - -	/ A				/ -
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.002 H - -	Wind reactions based on MWFRS				
Mean Height: 17.99 ft				Creep Factor: 2.0	A Brg Width = 142 Min Req = -				
NCBCLL: 10.00		TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.079	Bearing A is a rigid surface.				
Soffit: 2.00		BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.059	Members not listed have forces less than 375#				
Load Duration: 1.25		MWFRS Parallel Dist: h/2 to h	TPI Std: 2014	Max Web CSI: 0.027					
Spacing: 24.0 "		C&C Dist a: 3.00 ft	Rep Fac: Yes						
Loc. from endwall: not in 13.00 ft		Loc. from endwall: not in 13.00 ft	FT/RT:20(0)/10(0)						
GCpi: 0.18		GCpi: 0.18	Plate Type(s):						
Wind Duration: 1.60		Wind Duration: 1.60	WAVE		VIEW Ver: 20.02.01A.1209.11				

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins


In lieu of rigid ceiling use purlins to brace BC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.
The overall height of this truss excluding overhang is 3-7-3.

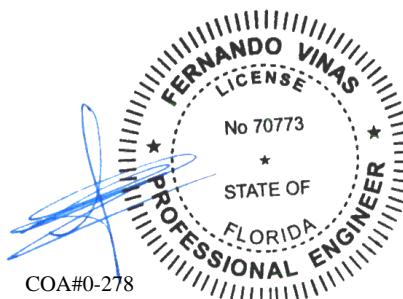

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344158 / FROM: CDM	COMM Ply: 1 Qty: 10	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: PB03	Cust: R 215 JRef:1XcL2150006 T24 / DrwNo: 028.22.1004.51639 KD / WHK 01/28/2022
-----------------------------	---------------------------	---	---

9'8" 2'7"11 4'5"14 5'3"6
9'8" 1'10"3 1'10"3 9'8"

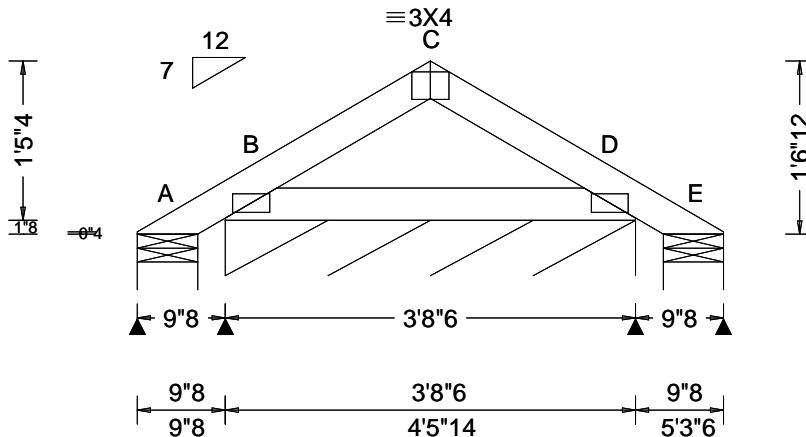

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs), or *=PLF							
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in loc L/defl L/#	VERT(LL):	0.001	999	240	Gravity	Non-Gravity
TCDL:	10.00	Speed:	130 mph	Lu: NA	Cs: NA	Snow Duration: NA	Building Code:		VERT(CL):	0.002	999	180			
BCLL:	0.00	Enclosure:	Closed				FBC 2017 RES		HORZ(LL):	-0.001	-	-			
BCDL:	10.00	Risk Category:	II				TPI Std: 2014		HORZ(TL):	0.001	-	-			
Des Ld:	40.00	EXP: C	Kzt: NA	Rep Fac: Yes			Rep Fac: Yes		Creep Factor: 2.0						
Mean Height: 16.41 ft		TCDL: 5.0 psf		FT/RT:20(0)/10(0)			FT/RT:20(0)/10(0)		Max TC CSI:	0.040					
NCBCLL: 10.00		BCDL: 5.0 psf		Plate Type(s):			Plate Type(s):		Max BC CSI:	0.123					
Soffit: 2.00		MWFRS Parallel Dist: 0 to h/2		WAVE			WAVE		Max Web CSI:	0.000					
Load Duration: 1.25		C&C Dist a: 3.00 ft													
Spacing: 24.0 "		Loc. from endwall: Any													
		GCpi: 0.18													
		Wind Duration: 1.60													
VIEW Ver: 20.02.01A.1209.11															

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;

Plating Notes

All plates are 2X4(A1) except as noted.

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

The overall height of this truss excluding overhang is 1-6-12.

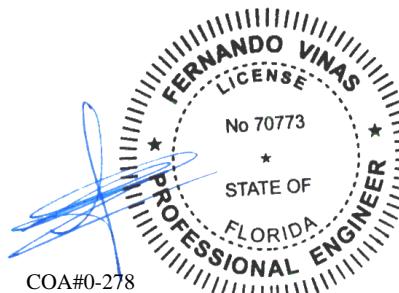

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344159 / FROM: CDM	COMM Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: PB04	Cust: R 215 JRef:1Xcl2150006 T10 / DrwNo: 028.22.1004.51983 KD / WHK 01/28/2022
-----------------------------	--------------------------	---	---

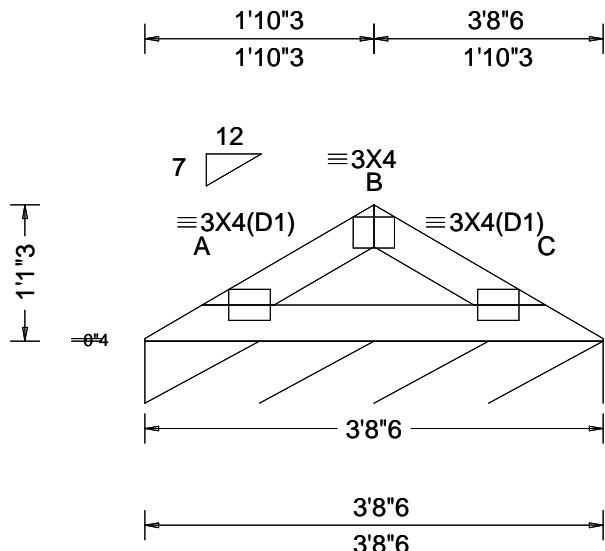

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs), or *=PLF								
TCLL:	20.00	Wind Std:	ASCE 7-10	Pg: NA	Ct: NA	CAT: NA	Pf: NA	Ce: NA	PP Deflection in loc L/defl L/#	Gravity / R+	Non-Gravity / Rh	Gravity / R-	Non-Gravity / Rw	Gravity / U	Non-Gravity / RL	
TCDL:	10.00	Speed:	130 mph	Lu: NA	Cs: NA				VERT(LL): 0.004 999 240							
BCLL:	0.00	Enclosure:	Closed	Snow Duration:	NA				VERT(CL): 0.009 999 180							
BCDL:	10.00	Risk Category:	II						HORZ(LL): -0.001 - -							
Des Ld:	40.00	EXP: C	Kzt: NA						HORZ(TL): 0.003 - -							
Mean Height:	16.41 ft	Building Code:							Creep Factor: 2.0							
NCBLL:	10.00	FBC 2017 RES							Max TC CSI: 0.104							
Soffit:	2.00	TPI Std: 2014							Max BC CSI: 0.137							
Load Duration:	1.25	Rep Fac: Yes							Max Web CSI: 0.000							
Spacing:	24.0 "	FT/RT:20(0)/10(0)														
C&C Dist a:	3.00 ft	Plate Type(s):														
Loc. from endwall:	Any	WAVE														
GCpi:	0.18															
Wind Duration:	1.60															
VIEW Ver: 20.02.01A.1209.11																

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;

Loading

Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Purlins

In lieu of rigid ceiling use purlins to brace BC @ 24" oc.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to DWG PB160101014 for piggyback details.

The overall height of this truss excluding overhang is 1-2-11.

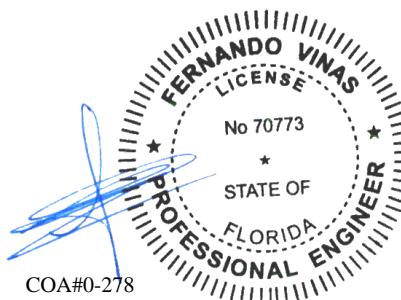

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 353638 / FROM: CDM	VAL Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: V01	Cust: R 215 JRef:1XcL2150006 T36 / DrwNo: 028.22.1004.53077 AK / FV 01/28/2022
-----------------------------	-------------------------	--	--

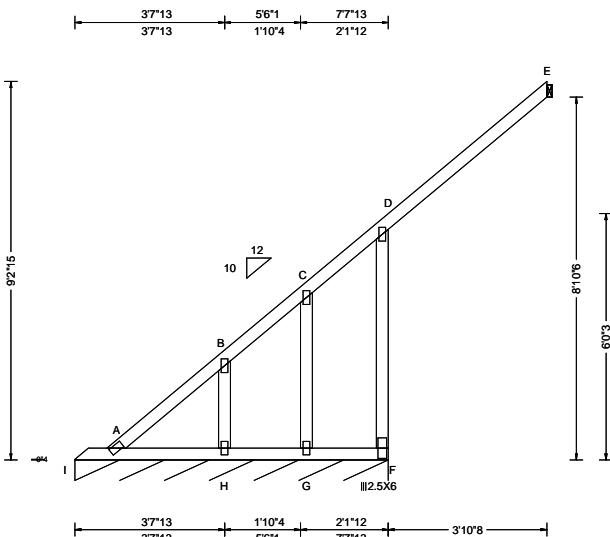

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF								
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity							
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.001 D 999 240									
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.003 D 999 180									
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.007 D - -									
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.008 D - -									
NCBLL:	10.00	Mean Height: 18.96 ft		Creep Factor: 2.0									
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.206									
Load Duration: 1.25	Spacing: 24.0 "	BCDL: 5.0 psf		Max BC CSI: 0.068									
C&C Dist a: 3.00 ft	Loc. from endwall: Any	MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.160									
GCpi: 0.18		Rep Fac: Yes											
Wind Duration: 1.60		FT/RT:20(0)/10(0)											
		Plate Type(s):											
		WAVE			VIEW Ver: 20.02.01A.1209.11								
Lumber													
Top chord: 2x4 SP #2;													
Bot chord: 2x4 SP #2;													
Webs: 2x4 SP #3;													
Plating Notes													
All plates are 2X4 except as noted.													
Wind													
Wind loads based on MWFRS with additional C&C member design.													
Additional Notes													
See DWG VAL160101014 for valley details.													
The overall height of this truss excluding overhang is 9'-2 1/2".													
See DWGS A16030ENC101014 & GBLLETIN0118 for more requirements.													

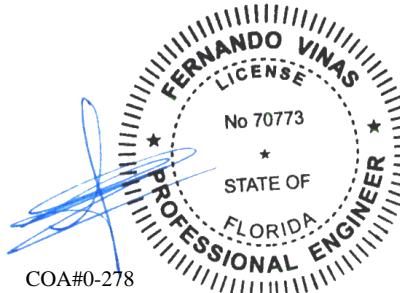

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 353620 / FROM: CDM	VAL Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: V02	Cust: R 215 JRef:1XcL2150006 T35 / DrwNo: 028.22.1004.53139 AK / FV 01/28/2022
-----------------------------	-------------------------	--	--

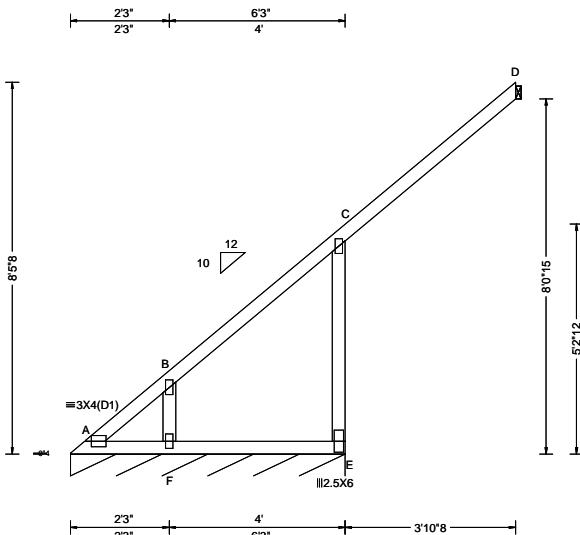

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF									
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity		Non-Gravity							
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.001 C 999 240	Loc R+ / R- / Rh			/ Rw / U / RL						
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.003 C 999 180	E* 111 /- /- /74 /19 /45			/ /66 /68 /-						
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.007 C - -	D 99 /- /- / /68 /			Wind reactions based on MWFRS						
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.008 C - -	E Brg Wid = 75.0 Min Req = -			D Brg Wid = 1.5						
NCBCLL:	10.00	Mean Height: 19.74 ft		Creep Factor: 2.0	Bearing A is a rigid surface.			Members not listed have forces less than 375#						
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.267	Maximum Top Chord Forces Per Ply (lbs)			Chords Tens.Comp.						
Load Duration: 1.25		BCDL: 5.0 psf		Max BC CSI: 0.133										
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2		Max Web CSI: 0.143										
		C&C Dist a: 3.00 ft												
		Loc. from endwall: Any												
		GCpi: 0.18												
		Wind Duration: 1.60												
VIEW Ver: 20.02.01A.1209.11														
A - B 119 -422														

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 8'-5 1/8".

See DWGS A16030ENC101014 & GBLLETIN0118 for more requirements.

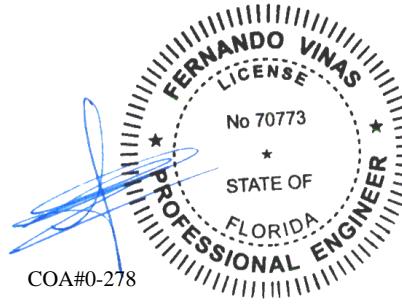

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacompnents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 353622 / FROM: CDM	VAL Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: V03	Cust: R 215 JRef:1XcL2150006 T32 / DrwNo: 028.22.1004.53202 AK / FV 01/28/2022
-----------------------------	-------------------------	--	--

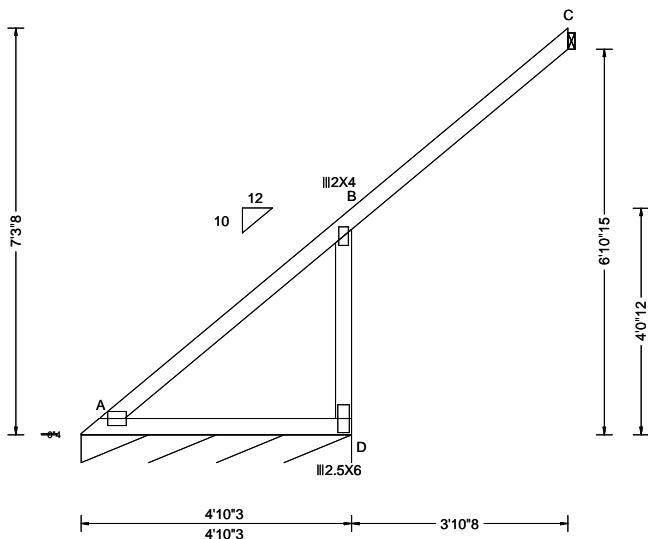

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	D*	119	/-	/-	/78	/21	/50
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.005 A - -	C	92	/-	/-	/62	/70	/-
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.009 A - -							
Mean Height: 20.32 ft				Creep Factor: 2.0							
NCBCLL: 10.00		TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.341							
Soffit: 2.00		BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.209							
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.084							
Spacing: 24.0 "		C&C Dist a: 3.00 ft	Rep Fac: Yes								
Loc. from endwall: not in 4.50 ft		Loc. from endwall: not in 4.50 ft	FT/RT:20(0)/10(0)								
GCpi: 0.18		GCpi: 0.18	Plate Type(s):								
Wind Duration: 1.60		Wind Duration: 1.60	WAVE								
VIEW Ver: 20.02.01A.1209.11											

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 3X4(D1) except as noted.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 7'-3-8".

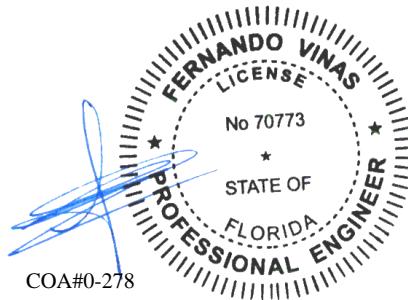

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 353624 / VAL Ply: 1 Job Number: 22-6857 Cust: R 215 JRef:1XcL2150006 T27 i
FROM: CDM Qty: 2 Sellers Residence (LIVE DORMER) DrwNo: 028.22.1004.53045
Truss Label: V04 AK / FV 01/28/2022

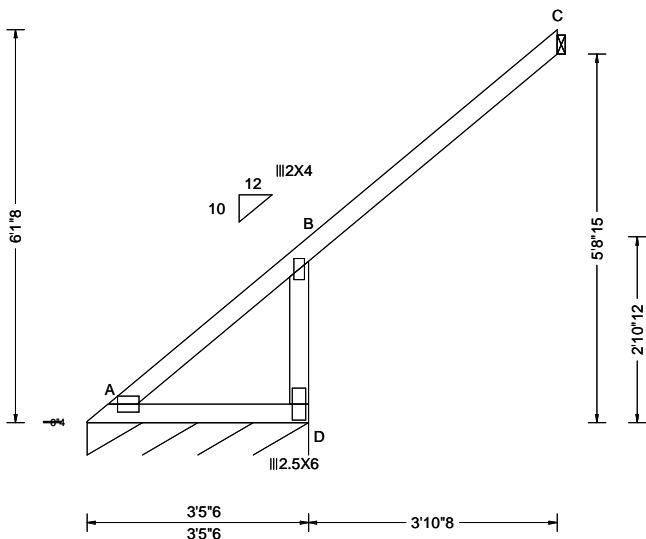

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria			▲ Maximum Reactions (lbs), or *=PLF											
				Pg: NA	Ct: NA	CAT: NA	PP Deflection in	loc	L/defl	L/#	Gravity			Non-Gravity						
				Pf: NA			Vert(LL):	NA				Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL		
TCLL:	20.00	Wind Std: ASCE 7-10		Lu: NA	Cs: NA		Vert(CL):	NA				D*	130	/ -	/ -	/81	/21	/60		
TCDL:	10.00	Speed: 130 mph		Snow Duration: NA		HORZ(LL): -0.003 B		-	-	-				C	101	/ -	/ -	/68	/76	/ -
BCLL:	0.00	Enclosure: Closed		EXP: C		Kzt: NA		HORZ(TL): 0.004 C		-	-	Wind reactions based on MWFRS			D Brg Wid = 41.4 Min Req = -					
BCDL:	10.00	Risk Category: II		Building Code:		Creep Factor: 2.0		C		C Brg Wid = 1.5			Bearing A is a rigid surface.							
Des Ld:	40.00	Mean Height: 20.91 ft		FBC 2017 RES		Max TC CSI: 0.246		Max BC CSI: 0.096		Max Web CSI: 0.083		Members not listed have forces less than 375#								
NCBLL:	10.00	TCDL: 5.0 psf		TPI Std: 2014		Rep Fac: Yes		FT/RT:20(0)/10(0)		Plate Type(s):										
Soffit:	2.00	BCDL: 5.0 psf		WAVE		VIEW Ver: 20.02.01A.1209.11														
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2																		
Spacing: 24.0 "		C&C Dist a: 3.00 ft		Loc. from endwall: not in 4.50 ft		GCpi: 0.18														

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 3X4(D1) except as noted.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 6-1-8.

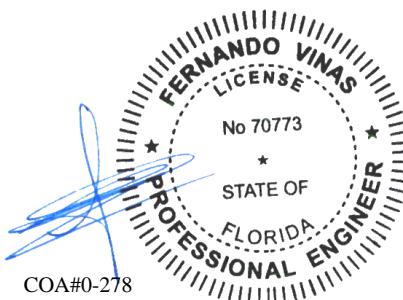

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing, and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

Drawing for any structure is the responsibility of the Building Designer per ASCE 7-16 C2.2.

For more information see these web sites: Alpine: alpinetw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org



SEQN: 353626 / FROM: CDM	VAL Ply: 1 Qty: 2	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: V05	Cust: R 215 JRef:1XcL2150006 T11 / DrwNo: 028.22.1004.53014 AK / FV 01/28/2022
-----------------------------	-------------------------	--	--

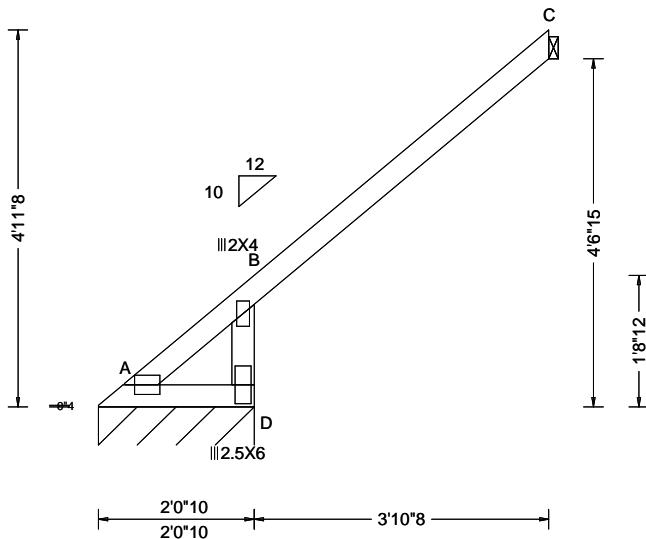

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): NA	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): NA	D*	159	/-	/-	/92	/22	/82
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.002 C	C	104	/-	/-	/69	/79	/-
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.003 C							
Mean Height: 21.49 ft				Creep Factor: 2.0							
NCBLL: 10.00		TCDL: 5.0 psf	Building Code:	Max TC CSI: 0.220							
Soffit: 2.00		BCDL: 5.0 psf	FBC 2017 RES	Max BC CSI: 0.057							
Load Duration: 1.25		MWFRS Parallel Dist: 0 to h/2	TPI Std: 2014	Max Web CSI: 0.084							
Spacing: 24.0 "		C&C Dist a: 3.00 ft	Rep Fac: Yes								
Loc. from endwall: not in 9.00 ft		Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)								
GCpi: 0.18		GCpi: 0.18	Plate Type(s):								
Wind Duration: 1.60		Wind Duration: 1.60	WAVE								
VIEW Ver: 20.02.01A.1209.11											

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 3X4(D1) except as noted.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 4-11-8.

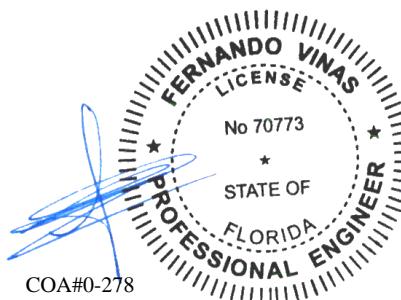

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcacomponents.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344166 / FROM: CDM	VAL Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: V07	Cust: R 215 JRef:1XcL2150006 T44 / DrwNo: 028.22.1004.51047 KD / WHK 01/28/2022
-----------------------------	-------------------------	--	---

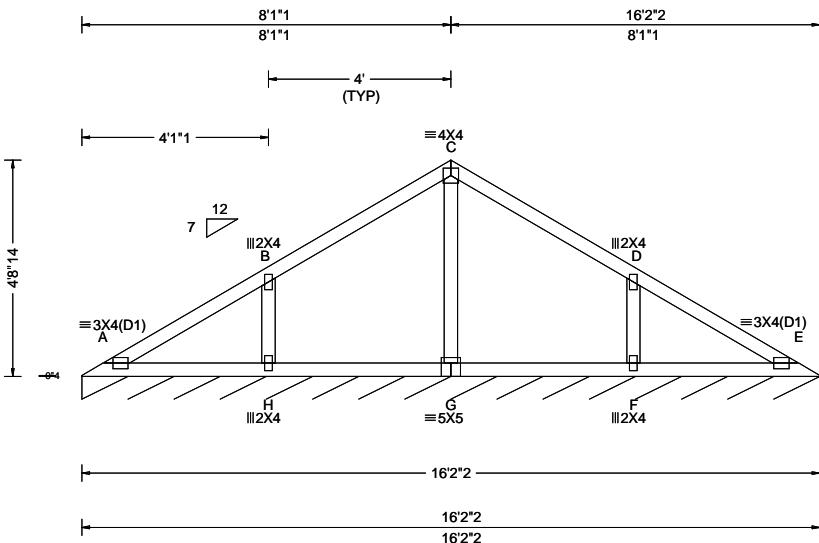

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity					
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.005 H 999 240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.011 H 999 180	E*	82	/ -	/ -	/ 42	/ -	/ 7
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): 0.002 H - -	Wind reactions based on MWFRS						
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.004 H - -	E	Brg Width = 194	Min Req = -				
NCBLL:	10.00	Mean Height: 15.00 ft		Creep Factor: 2.0	Bearing A is a rigid surface.						
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.301	Members not listed have forces less than 375#						
Load Duration: 1.25	BCDL: 5.0 psf	MWFRS Parallel Dist: > 2h		Max BC CSI: 0.148							
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: Yes		Max Web CSI: 0.102							
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)									
	GCpi: 0.18	Plate Type(s):									
	Wind Duration: 1.60	WAVE									
VIEW Ver: 20.02.01A.1209.11											

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 4-8-14.

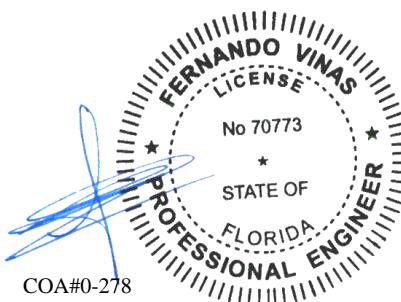

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344167 / FROM: CDM	VAL Ply: 1 Qty: 1	Job Number: 22-6857 Sellers Residence (LIVE DORMER) Truss Label: V08	Cust: R 215 JRef:1XcL2150006 T45 / DrwNo: 028.22.1004.51733 KD / WHK 01/28/2022
-----------------------------	-------------------------	--	---

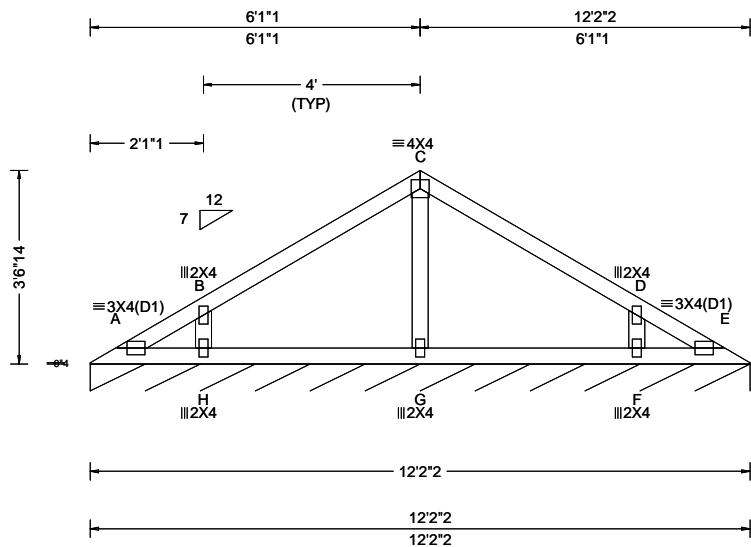

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF				
TCLL:	20.00	Wind Std: ASCE 7-10	Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity	Non-Gravity			
TCDL:	10.00	Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.001 C 999 240	Loc	R+	/ R-	/ Rh	/ Rw / U / RL
BCLL:	0.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.001 C 999 180	E* 82 /- /- /42 /- /7				Wind reactions based on MWFRS
BCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL): -0.000 B - -	E Brg Width = 146 Min Req = -				Bearing A is a rigid surface.
Des Ld:	40.00	EXP: C Kzt: NA		HORZ(TL): 0.001 H - -	Members not listed have forces less than 375#				
NCBCLL:	10.00	Mean Height: 15.30 ft		Creep Factor: 2.0					
Soffit:	2.00	TCDL: 5.0 psf		Max TC CSI: 0.204					
Load Duration: 1.25	BCDL: 5.0 psf	MWFRS Parallel Dist: > 2h		Max BC CSI: 0.117					
Spacing: 24.0 "	C&C Dist a: 3.00 ft	Rep Fac: Yes		Max Web CSI: 0.048					
	Loc. from endwall: not in 9.00 ft	FT/RT:20(0)/10(0)							
	GCpi: 0.18	Plate Type(s):							
	Wind Duration: 1.60	WAVE							
VIEW Ver: 20.02.01A.1209.11									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 3'-6-14".

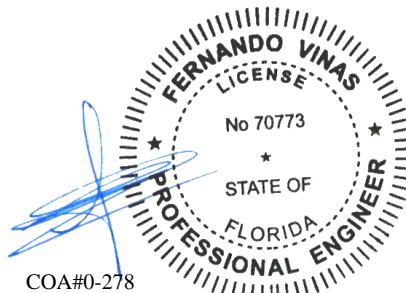

01/28/2022

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!


IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org

SEQN: 344168 / VAL Ply: 1 Job Number: 22-6857 Cust: R 215 JRef:1XcL2150006 T46 /
FROM: CDM Qty: 1 Sellers Residence (LIVE DORMER) DrwNo: 028.22.1004.51422
Truss Label: V09 KD / WHK 01/28/2022

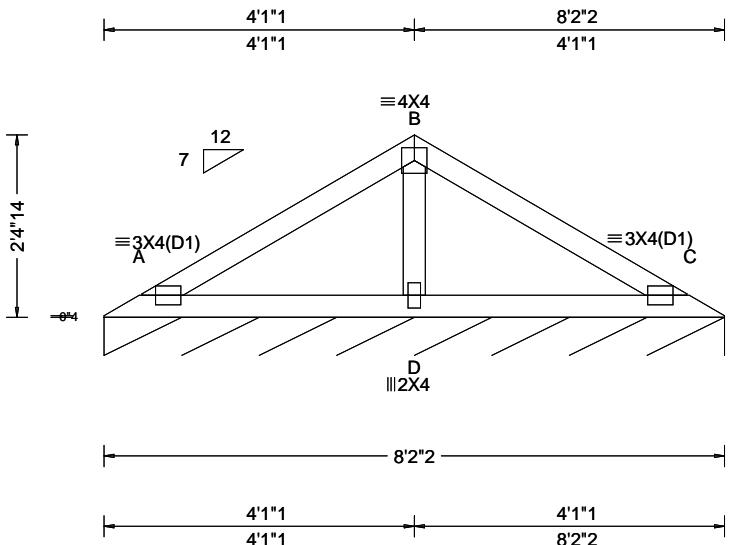

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF						
			Pg: NA Ct: NA CAT: NA	PP Deflection in loc L/defl L/#	Gravity		Non-Gravity				
		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL): 0.007 D 999 240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
TCLL: 20.00		Enclosure: Closed	Lu: NA Cs: NA	VERT(CL): 0.015 D 999 180	C* 81 /- /- /41 /- /6		Wind reactions based on MWFRS				
TCDL: 10.00		Risk Category: II	Snow Duration: NA	HORZ(LL): -0.003 D - -	C Brg Width = 98.1 Min Req = -		Bearing A is a rigid surface.				
BCLL: 0.00		EXP: C Kzt: NA		HORZ(TL): 0.007 D - -	Creep Factor: 2.0		Members not listed have forces less than 375#				
BCDL: 10.00		Mean Height: 15.88 ft			Building Code:		Maximum Web Forces Per Ply (lbs)				
Des Ld: 40.00		TCDL: 5.0 psf			FBC 2017 RES		Webs Tens.Comp.				
NCBLL: 10.00		BCDL: 5.0 psf			TPI Std: 2014		B - D 161 - 384				
Soffit: 2.00		MWFRS Parallel Dist: > 2h			Rep Fac: Yes						
Load Duration: 1.25		C&C Dist a: 3.00 ft			FT/RT:20/0/10(0)						
Spacing: 24.0 "		Loc. from endwall: not in 9.00 ft			Plate Type(s):						
		GCpi: 0.18			WAVE		VIEW Ver: 20.02.01A.1209.11				
		Wind Duration: 1.60									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 2-4-14

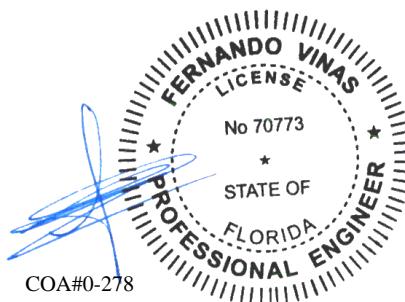

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org.

SEQN: 344169 / VAL Ply: 1 Job Number: 22-6857 Cust: R 215 JRef:1XcL2150006 T47 i
FROM: CDM Qty: 1 Sellers Residence (LIVE DORMER) DrwNo: 028.22.1004.52046
Truss Label: V10 KD / WHK 01/28/2022

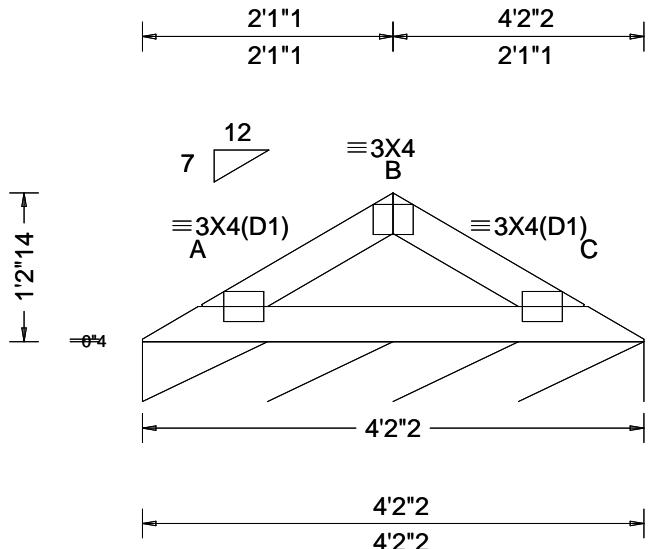

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria			▲ Maximum Reactions (lbs), or *=PLF							
			Pg: NA Ct: NA CAT: NA	PP Deflection in	loc	L/defl	L/#	Gravity			Non-Gravity			
		Speed: 130 mph	Pf: NA Ce: NA	VERT(LL):	0.004	999	240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
TCLL:	20.00	Enclosure: Closed	Lu: NA Cs: NA	VERT(CL):	0.007	999	180							
TCDL:	10.00	Risk Category: II	Snow Duration: NA	HORZ(LL):	-0.002	-	-							
BCLL:	0.00	EXP: C Kzt: NA		HORZ(TL):	0.003	-	-							
BCDL:	10.00	Mean Height: 16.46 ft		Creep Factor: 2.0										
Des Ld:	40.00	TCDL: 5.0 psf												
NCBCLL:	10.00	BCDL: 5.0 psf												
Soffit:	2.00	MWFRS Parallel Dist: h to 2h												
Load Duration:	1.25	C&C Dist a: 3.00 ft												
Spacing:	24.0 "	Loc. from endwall: not in 9.00 ft												
		GCpi: 0.18												
		Wind Duration: 1.60												
				Plate Type(s):										
				WAVE										
					VIEW Ver: 20.02.01A.1209.11									

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

See DWG VAL160101014 for valley details.

The overall height of this truss excluding overhang is 1-2-14.

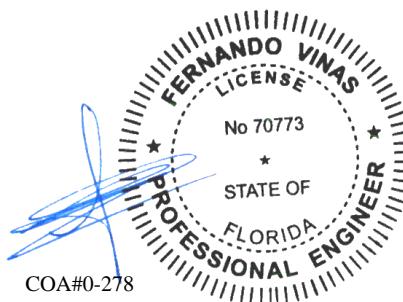

01/28/2022

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing, and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.



For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCA: sbcindustry.com; ICC: iccsafe.org; AWC: awc.org.

Gable Stud Reinforcement Detail

ASCE 7-10: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00
 Or: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00
 Or: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Gable Vertical Length	2x4 Gable Vertical Spacing	Brace Species	Grade	No Braces	(1) 1x4 "L" Brace *		(1) 2x4 "L" Brace *		(2) 2x4 "L" Brace **		(1) 2x6 "L" Brace *		(2) 2x6 "L" Brace **	
					Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B
24" O.C.	SPF HF	#1 / #2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
		#3	4' 1"	6' 7"	7' 1"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	14' 0"
		Stud	4' 1"	6' 7"	7' 0"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	14' 0"
		Standard	4' 1"	5' 8"	6' 0"	7' 7"	8' 1"	10' 1"	10' 6"	11' 10"	12' 8"	14' 0"	14' 0"	14' 0"
	SP DFL	#1	4' 6"	7' 4"	7' 8"	8' 8"	9' 0"	10' 4"	10' 9"	13' 8"	14' 0"	14' 0"	14' 0"	14' 0"
		#2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
		#3	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"	14' 0"
		Stud	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"	14' 0"
	SP DFL	Standard	4' 0"	5' 3"	5' 7"	7' 0"	7' 6"	9' 6"	10' 2"	11' 0"	11' 10"	14' 0"	14' 0"	14' 0"
		#1 / #2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#3	4' 8"	8' 1"	8' 8"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		Stud	4' 8"	8' 1"	8' 6"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
16" O.C.	SPF HF	Standard	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#1	5' 1"	8' 5"	8' 9"	9' 11"	10' 4"	11' 10"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#3	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SP DFL	Stud	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	4' 8"	6' 5"	6' 10"	8' 7"	9' 2"	11' 7"	12' 1"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
		#1 / #2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#3	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SP DFL	Stud	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#1	5' 8"	9' 3"	9' 8"	10' 11"	11' 4"	13' 0"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	12' 11"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		#3	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		Stud	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"

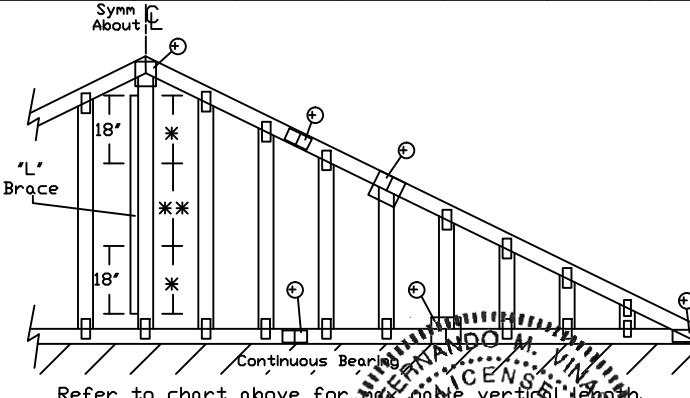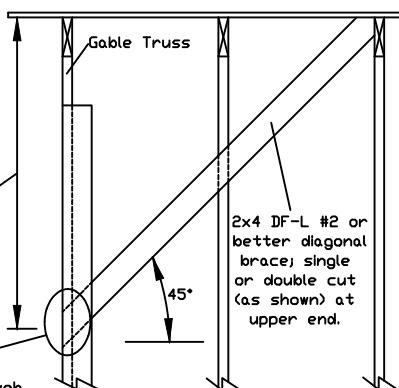

WARNING! READ AND FOLLOW ALL NOTES ON THIS DRAWING!

IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached right ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpineitw.com; TPI: www.tpihst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

Bracing Group Species and Grades:

Group A:

Spruce-Pine-Fir		Hem-Fir
#1 / #2	Standard	#2 Stud
#3	Stud	#3 Standard

Douglas Fir-Larch

#3	Stud
Standard	Standard

Group B:

Hem-Fir

#1 & Btr
#1

Douglas Fir-Larch

#1	Stud
#2	Stud

1x4 Braces shall be SRB (Stress-Rated Board).

***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:
 Wind Load deflection criterion is L/240.
 Provide uplift connections for 55 psf over continuous bearing (5 psf TC Dead Load).
 Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach "L" braces with 10d (0.128" x 3.0" min) nails.

* For (1) "L" brace: space nails at 2' o.c.

in 18" end zones and 4' o.c. between zones.

** For (2) "L" braces: space nails at 3' o.c.

in 18" end zones and 6' o.c. between zones.

"L" bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes

Vertical Length	No Splice
Less than 4' 0"	1x4 or 2x3
Greater than 4' 0"	3x4

+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

COA#0-278

Gable Stud Reinforcement Detail



ASCE 7-10: 140 mph Wind Speed, 30' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 30' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 30' Mean Height, Enclosed, Exposure D, Kzt = 1.00

Or: 100 mph wind speed, 30' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Max Gable Vertical Length	Gable Vertical Spacing	2x4 Gable Vertical Species	Brace Grade	No Braces	(1) 1x4 "L" Brace *		(1) 2x4 "L" Brace *		(2) 2x4 "L" Brace **		(1) 2x6 "L" Brace *		(2) 2x6 "L" Brace **	
					Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B
24" O.C.	SPF HF	#1 / #2	4' 1"	6' 11"	7' 2"	8' 2"	8' 6"	9' 9"	10' 2"	12' 10"	13' 4"	14' 0"	14' 0"	
		#3	3' 10"	6' 2"	6' 7"	8' 1"	8' 5"	9' 8"	10' 0"	12' 8"	13' 2"	14' 0"	14' 0"	
		Stud	3' 10"	6' 2"	6' 6"	8' 1"	8' 5"	9' 8"	10' 0"	12' 8"	13' 2"	14' 0"	14' 0"	
		Standard	3' 10"	5' 3"	5' 7"	7' 0"	7' 6"	9' 6"	10' 0"	11' 0"	11' 10"	14' 0"	14' 0"	
	SP DFL	#1	4' 2"	7' 0"	7' 3"	8' 3"	8' 7"	9' 10"	10' 3"	13' 0"	13' 6"	14' 0"	14' 0"	
		#2	4' 1"	6' 11"	7' 2"	8' 2"	8' 6"	9' 9"	10' 2"	12' 10"	13' 4"	14' 0"	14' 0"	
		#3	4' 0"	5' 7"	5' 11"	7' 5"	7' 11"	9' 8"	10' 1"	11' 7"	12' 5"	14' 0"	14' 0"	
		Stud	4' 0"	5' 7"	5' 11"	7' 5"	7' 11"	9' 8"	10' 1"	11' 7"	12' 5"	14' 0"	14' 0"	
	SPF HF	Standard	3' 9"	4' 11"	5' 13"	6' 6"	7' 0"	8' 10"	9' 6"	10' 3"	11' 0"	13' 11"	14' 0"	
		#1 / #2	4' 8"	7' 11"	8' 3"	9' 4"	9' 9"	11' 2"	11' 7"	14' 0"	14' 0"	14' 0"	14' 0"	
		#3	4' 5"	7' 6"	8' 3"	9' 3"	9' 7"	11' 0"	11' 6"	14' 0"	14' 0"	14' 0"	14' 0"	
		Stud	4' 5"	7' 6"	8' 0"	9' 3"	9' 7"	11' 0"	11' 6"	14' 0"	14' 0"	14' 0"	14' 0"	
16" O.C.	SP DFL	Standard	4' 5"	6' 5"	6' 10"	8' 7"	9' 2"	11' 0"	11' 6"	13' 6"	14' 0"	14' 0"	14' 0"	
		#1	4' 10"	8' 0"	8' 4"	9' 6"	9' 10"	11' 3"	11' 9"	14' 0"	14' 0"	14' 0"	14' 0"	
		#2	4' 8"	7' 11"	8' 3"	9' 4"	9' 9"	11' 2"	11' 7"	14' 0"	14' 0"	14' 0"	14' 0"	
		#3	4' 7"	6' 10"	7' 3"	9' 1"	9' 8"	11' 1"	11' 6"	14' 0"	14' 0"	14' 0"	14' 0"	
	SPF HF	Stud	4' 7"	6' 10"	7' 3"	9' 1"	9' 8"	11' 1"	11' 6"	14' 0"	14' 0"	14' 0"	14' 0"	
		Standard	4' 5"	6' 0"	6' 5"	8' 0"	8' 7"	10' 10"	11' 6"	12' 7"	13' 15"	14' 0"	14' 0"	
		#1 / #2	5' 2"	8' 9"	9' 1"	10' 4"	10' 9"	11' 2"	12' 9"	14' 0"	14' 0"	14' 0"	14' 0"	
		#3	4' 10"	8' 7"	8' 11"	10' 2"	10' 7"	12' 2"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"	
	SP DFL	Stud	4' 10"	8' 7"	8' 11"	10' 2"	10' 7"	12' 2"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"	
		Standard	4' 10"	7' 5"	7' 11"	9' 11"	10' 7"	12' 2"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"	
		#1	5' 4"	8' 10"	9' 2"	10' 5"	10' 10"	12' 5"	12' 11"	14' 0"	14' 0"	14' 0"	14' 0"	
		#2	5' 2"	8' 9"	9' 1"	10' 4"	10' 9"	12' 3"	12' 9"	14' 0"	14' 0"	14' 0"	14' 0"	
		#3	5' 0"	7' 10"	8' 4"	10' 3"	10' 8"	12' 2"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"	
		Stud	5' 0"	7' 10"	8' 4"	10' 3"	10' 8"	12' 2"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"	
		Standard	4' 10"	6' 11"	7' 4"	9' 3"	9' 10"	12' 2"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"	

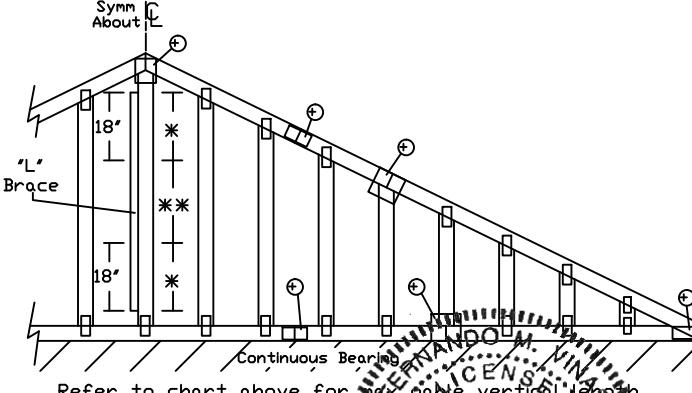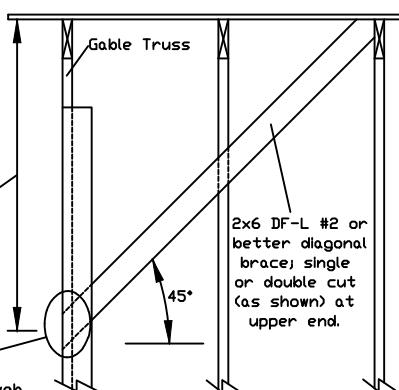

WARNING! READ AND FOLLOW ALL NOTES ON THIS DRAWING

IMPORTANT! FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com TPI: www.tpiinc.org SBCA: www.sbcacomponents.com ICC: www.iccsafe.org

Bracing Group Species and Grades:

Group A:

Spruce-Pine-Fir		Hem-Fir
#1 / #2	Standard	#2 Stud
#3	Stud	#3 Standard

Group B:

Douglas Fir-Larch		Southern Pine***
#3	Stud	#3 Standard

Group B:

Douglas Fir-Larch		Southern Pine***
#1		#1
#2		#2

1x4 Braces shall be SRB (Stress-Rated Board).
***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:
Wind Load deflection criterion is L/240.

Provide uplift connections for 100 psf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach "L" braces with 10d (0.128" x 3.0" min) nails.

* For (1) "L" brace: space nails at 2' o.c. in 18' end zones and 4' o.c. between zones.

** For (2) "L" braces: space nails at 3' o.c. in 18' end zones and 6' o.c. between zones.

"L" bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes

Vertical Length	No Splice
Less than 4' 0"	2X4
Greater than 4' 0", but less than 11' 6"	3X4
Greater than 11' 6"	4X4

+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

REF ASCE7-10-GAB14030

DATE 10/01/14

DRWG A14030ENC101014

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

No 70773
STATE OF FLORIDA
PROFESSIONAL ENGINEER
COA#0-278
01/28/2022

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.

Web Member Size	Specified CLR Restraint	Alternative Reinforcement T- or L- Reinf.	Scab Reinf.
2x3 or 2x4	1 row	2x4	1-2x4
2x3 or 2x4	2 rows	2x6	2-2x4
2x6	1 row	2x4	1-2x6
2x6	2 rows	2x6	2-2x4(*)
2x8	1 row	2x6	1-2x8
2x8	2 rows	2x6	2-2x6(*)

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.


(*) Center scab on wide face of web. Apply (1) scab to each face of web.

T-Reinforcement

or

L-Reinforcement:


Apply to either side of web narrow face. Attach with 10d (0.128" x 3.0", min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

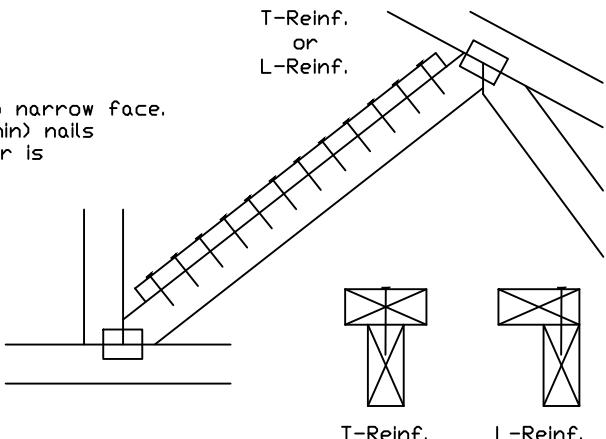

T-Reinf. L-Reinf.

Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128" x 3.0", min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

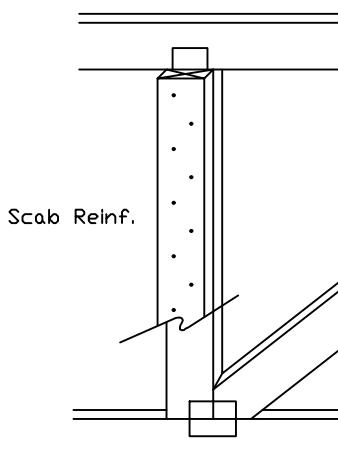

Scab Reinf.



WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpiinst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org



No 70773

★ STATE OF FLORIDA ★

★ PROFESSIONAL ENGINEER ★

01/28/2022

COA#0-278

FC LL

FC DL

BC DL

BC LL

TOT. LD.

DUR. FAC.

SPACING

PSF

PSF

PSF

PSF

PSF

PSF

PSF





REF CLR Subst.

DATE 01/02/19

DRWG BRCLBSUB0119

Gable Detail

For Let-in Verticals

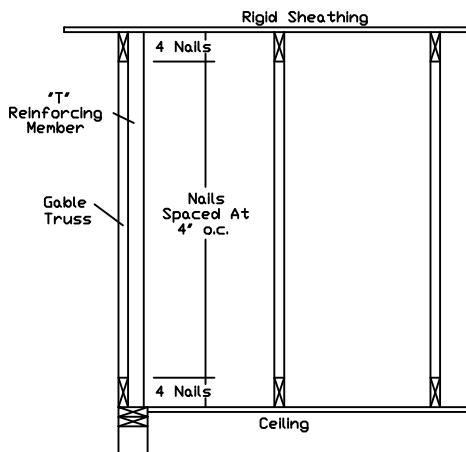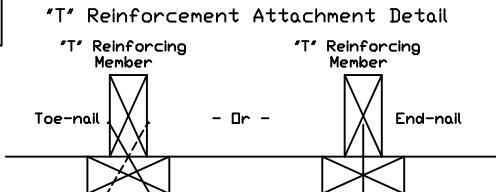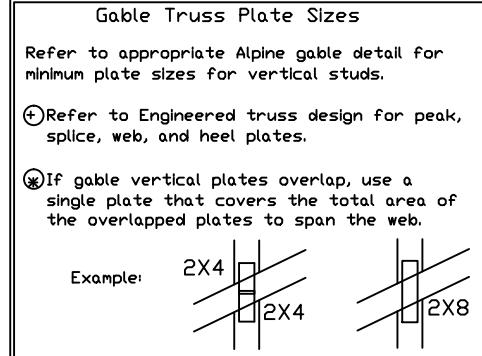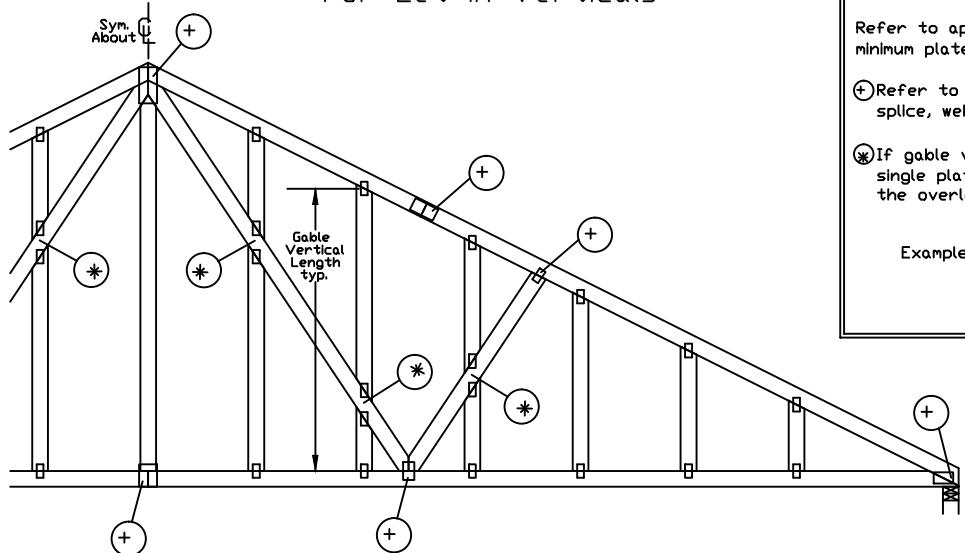

Provide connections for uplift specified on the engineered truss design.

Attach each 'T' reinforcing member with

End Driven Nails:

10d Common (0.148" x 3", min) Nails at 4" o.c. plus
(4) nails in the top and bottom chords.

Toenailed Nails:

10d Common (0.148" x 3", min) Toenails at 4" o.c. plus
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE wind load.

ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014, A13030051014, A12030051014, A11030051014, A10030051014, A14030051014

ASCE 7-10 & ASCE 7-16 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A16015ENC100118, A18015ENC100118, A20015ENC100118, A20015END100118, A20015PED100118, A11530ENC100118, A12030ENC100118, A14030ENC100118, A16030ENC100118, A18030ENC100118, A20030ENC100118, A20030END100118, A20030PED100118, S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118, S18015ENC100118, S20015ENC100118, S20015END100118, S20015PED100118, S11530ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118, S18030ENC100118, S20030ENC100118, S20030END100118, S20030PED100118

See appropriate Alpine gable detail for maximum unreinforced gable vertical length.

To convert from 'L' to 'T' reinforcing members, multiply 'T' increase by length (based on appropriate Alpine gable detail).

Maximum allowable 'T' reinforced gable vertical length is 14' from top to bottom chord.

'T' reinforcing member material must match size, specie, and grade of the 'L' reinforcing member.

Web Length Increase w/ 'T' Brace

'T' Relnf. Mbr. Size	'T' Increase
2x4	30 %
2x6	20 %

Example:

ASCE 7-10 Wind Speed = 120 mph
Mean Roof Height = 30 ft, Kzt = 1.00

Gable Vertical = 24"o.c. SP #3

'T' Reinforcing Member Size = 2x4

'T' Brace Increase (From Above) = 30% = 1.30

(1) 2x4 'L' Brace Length = 8' 7"

Maximum 'T' Reinforced Gable Vertical Length
1.30 x 8' 7" = 11' 2"



514 Earth City Expressway
Suite 242
Earth City, MO 63045


WARNING!! READ AND FOLLOW ALL NOTES ON THIS DRAWING!!
IMPORTANT!! FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpinetw.com; TPI: www.tpiinst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

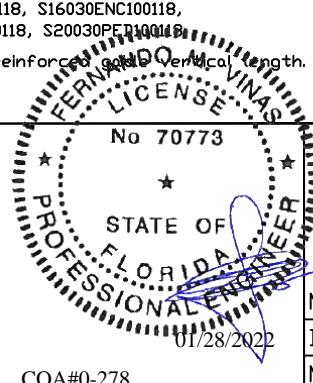

REF	LET-IN VERT
DATE	01/02/2018
DRWG	GBLLETIN0118

MAX. TOT. LD. 60 PSF
DUR. FAC. ANY
MAX. SPACING 24.0"

Piggyback Detail - ASCE 7-10: 160 mph, 30' Mean Height, Enclosed, Exposure C, Kzt=1.00


160 mph Wind, 30.00 ft Mean Hgt, ASCE 7-10, Enclosed Bldg. located anywhere in roof, Exp C, Wind DL= 5.0 psf (min), Kzt=1.0.
Or 140 mph Wind, 30.00 ft Mean Hgt, ASCE 7-10, Enclosed Bldg. located anywhere in roof, Exp D, Wind DL= 5.0 psf (min), Kzt=1.0.

Note: Top chords of trusses supporting piggyback cap trusses must be adequately braced by sheathing or purlins. The building Engineer of Record shall provide diagonal bracing or any other suitable anchorage to permanently restrain purlins, and lateral bracing for out of plane loads over gable ends.

Maximum truss spacing is 24" o.c. detail is not applicable if cap supports additional loads such as cupola, steeple, chimney or drag strut loads.

** Refer to Engineer's sealed truss design drawing for piggyback and base truss specifications.

Detail A : Purlin Spacing = 24" o.c. or less

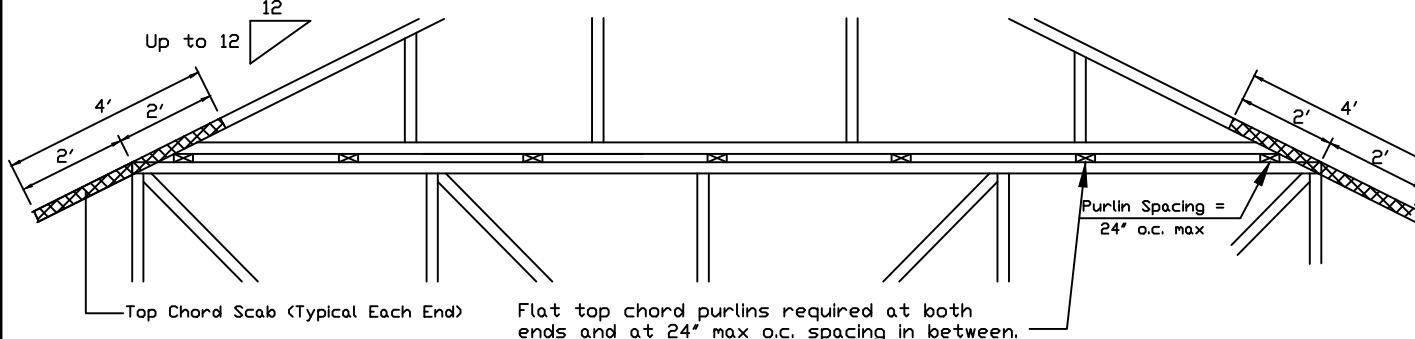


Piggyback cap truss slant nailed to all top chord purlin bracing with (2) 16d box nails (0.135"x3.5") and secure top chord with 2x4 #3 grade scab (1 side only at each end) attached with 2 rows of 10d box nails (0.128"x3") at 4" o.c.

Attach purlin bracing to the flat top chord using (2) 16d box nails (0.135"x3.5").

The top chord #3 grade 2x4 scab may be replaced with either of the following: (1) 3X8 Trulox plate attached with (8) 0.120"x1.375" nails, (4) into cap TC & (4) into base truss TC or (1) 28PB wave piggyback plate plated to the piggyback truss TC and attached to the base truss TC with (4) 0.120"x1.375" nails. Note: Nailing thru holes of wave plate is acceptable.

Detail B : Purlin Spacing > 24" o.c.

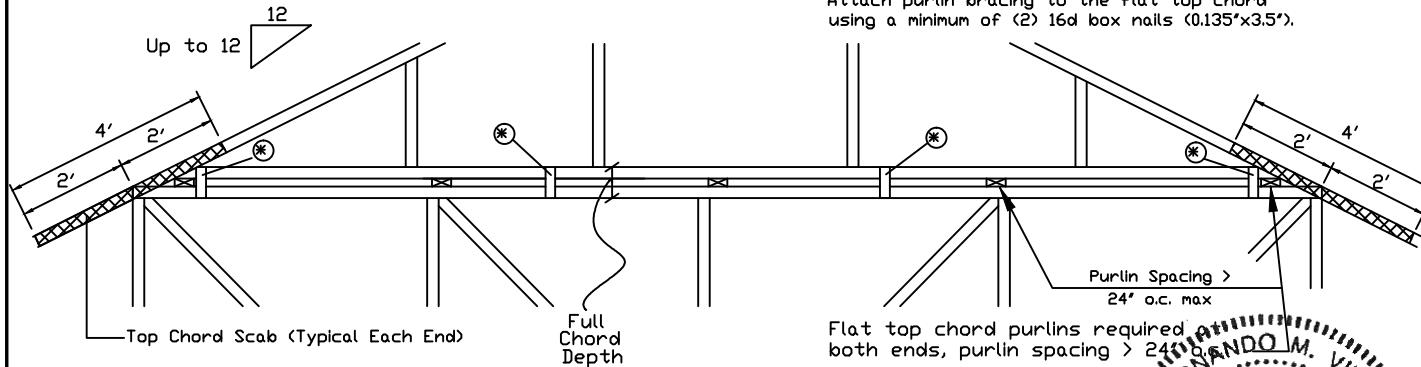

Note: If purlins or sheathing are not specified on the flat top of the base truss, purlins must be installed at 24" o.c. max. and use Detail A.

* In addition, provide connection with one of the following methods:

Trulox

Use 3X8 Trulox plates for 2x4 chord member, and 3X10 Trulox plates for 2x6 and larger chord members. Attach to each face @ 8' o.c. with (4) 0.120"x1.375" nails into cap bottom chord and (4) in base truss top chord. Trulox plates may be staggered 4' o.c. front to back faces.

APA Rated Gusset

8"x8"x7/16" (min) APA rated sheathing gussets (each face). Attach @ 8' o.c. with (8) 6d common (0.113"x2") nails per gusset, (4) in cap bottom chord and (4) in base truss top chord. Gussets may be staggered 4' o.c. front to back faces.

2x4 Vertical Scabs

2x4 SPF #2, full chord depth scabs (each face). Attach @ 8' o.c. with (6) 10d box nails (0.128"x3") per scab, (3) in cap bottom chord and (3) in base truss top chord. Scabs may be staggered 4' o.c. front to back faces.

28PB Wave Piggyback Plate

One 28PB wave piggyback plate to each face @ 8' o.c. Attach teeth to piggyback at time of fabrication. Attach to supporting truss with (4) 0.120"x1.375" nails per face per ply. Piggyback plates may be staggered 4' o.c. front to back faces.



514 Earth City Expressway
Suite 242
Earth City, MO 63045


WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING!
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpiinc.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

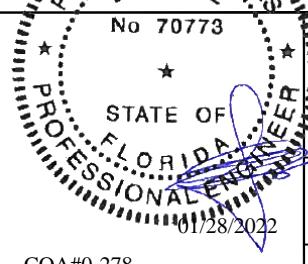

REF PIGGYBACK

DATE 10/01/14

DRWG PB160101014

SPACING 24.0"

Valley Detail - ASCE 7-10: 160 mph, 30' Mean Height, Enclosed, Exp. C, Kzt=1.00

Top Chord 2x4 SP #2N, SPF #1/#2, DF-L #2 or better.
 Bot Chord 2x4 SP #2N or SPF #1/#2 or better.
 Webs 2x4 SP #3, SPF #1/#2, DF-L #2 or better.

** Attach each valley to every supporting truss with:

(2) 16d box (0.135" x 3.5") nails toe-nailed for ASCE 7-10 160 mph. 30' Mean Height, Enclosed Building, Exp. C, Wind TC DL=5 psf, Kzt = 1.00

Or

ASCE 7-10 140 mph. 30' Mean Height, Enclosed Building, Exp. D, Wind TC DL=5 psf, Kzt = 1.00

Bottom chord may be square or pitched cut as shown.

Valleys short enough to be cut as solid triangular members from a single 2x6, or larger as required, shall be permitted in lieu of fabricating from separate 2x4 members.

All plates shown are ITW BCG Wave Plates.

Unless specified otherwise on engineer's sealed design, for vertical valley webs taller than 7-9" apply 2x4 "T" reinforcement, 80% length of web, same species and grade or better, attached with 10d box (0.128" x 3.0") nails at 6" o.c. In lieu of "T" reinforcement, 2x4 Continuous Lateral Restraint applied at mid-length of web is permitted with diagonal bracing as shown in DRWG BRCLBANC1014.

Top chord of truss beneath valley set must be braced with: properly attached, rated sheathing applied prior to valley truss installation.

Or



Purlins at 24" o.c. or as otherwise specified on engineer's sealed design

Or

By valley trusses used in lieu of purlin spacing as specified on Engineer's sealed design.

*** Note that the purlin spacing for bracing the top chord of the truss beneath the valley is measured along the slope of the top chord.

++ Larger spans may be built as long as the vertical height does not exceed 14'-0".

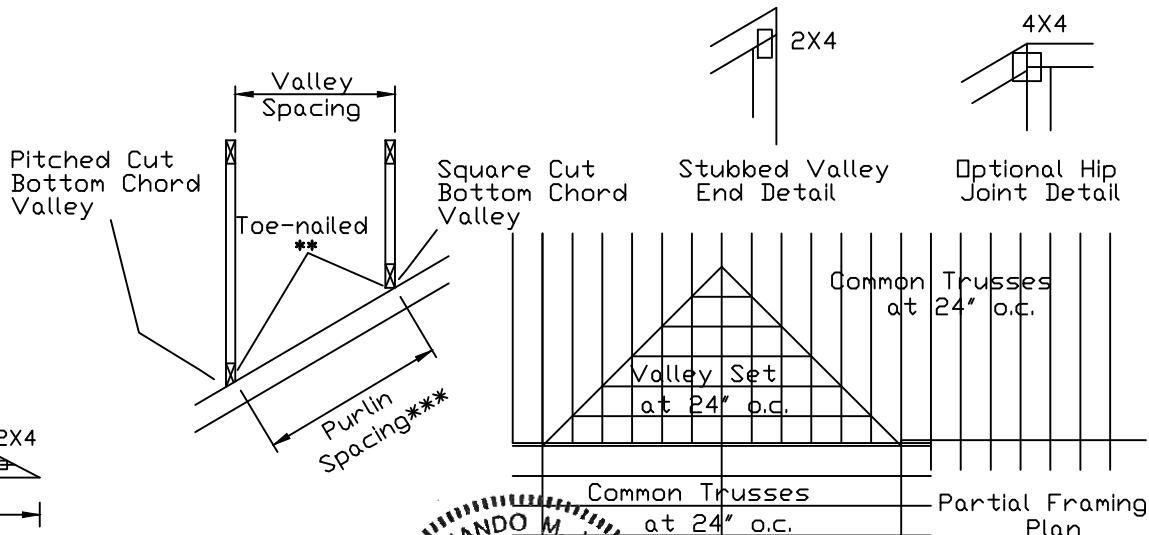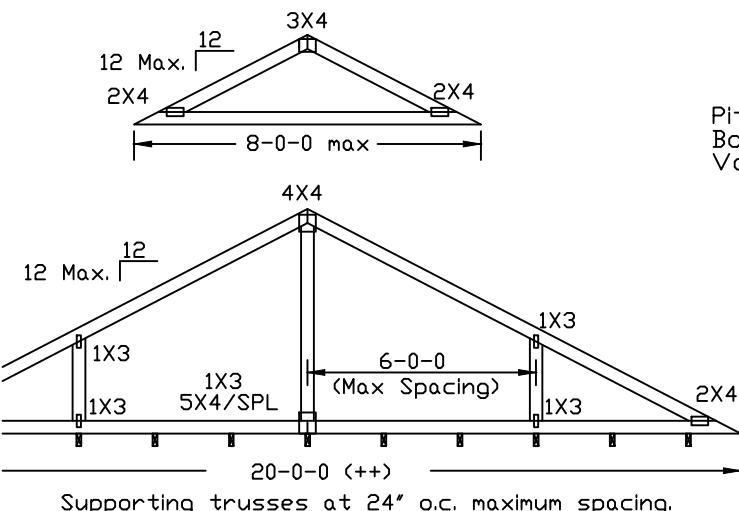

514 Earth City Expressway
 Suite 242
 Earth City, MO 63045

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpinetw.com; TPI: www.tpihost.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

FERNANDO M. VINAS
 LICENSE #70773
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 COA#0-278

DATE 10/01/2014
 DRWG VAL160101014
 10/28/2022
 DUR.FAC.1.25/1.33 1.15 1.15
 SPACING 24.0"

REF	VALLEY DETAIL
TC LL	30 30 40PSF
TC DL	20 15 7PSF
BC DL	10 10 10 PSF
BC LL	0 0 0 PSF
TOT. LD.	60 55 57PSF
DUR.FAC.1.25/1.33	1.15 1.15
SPACING	24.0"