

Florida Department of Business and Professional Regulation - Residential Performance Method

- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with R403.3.2.1.
- Compliance requires an Air Barrier and Insulation Inspection Checklist in accordance with R402.4.1.1 and this project requires an envelope leakage test report with envelope leakage no greater than 5.00 ACH50 (R402.4.1.2).

## INPUT SUMMARY CHECKLIST REPORT

## PROJECT

Title:	Lot 9 Crosswinds	Bedrooms:	3	Address Type:	Lot Information
Building Type:	User	Conditioned Area:	1676	Lot #	9
Owner Name:		Total Stories:	1	Block/Subdivision:	Crosswinds
# of Units:	1	Worst Case:	No	PlatBook:	
Builder Name:	Rhett Smithy	Rotate Angle:	0	Street:	
Permit Office:	Columbia County	Cross Ventilation:	Yes	County:	Columbia
Jurisdiction:		Whole House Fan:	No	City, State, Zip:	Lake City , FL , 32024
Family Type:	Detached				
New/Existing:	New (From Plans)				
Comment:					

## CLIMATE

✓	Design Location	TMY Site	Design Temp 97.5 %	2.5 %	Int Design Temp Winter	Summer	Heating Degree Days	Design Moisture	Daily Temp Range
_____	FL, Gainesville	FL_GAINESVILLE_REGI	32	92	70	75	1305.5	51	Medium

## BLOCKS

Number	Name	Area	Volume
1	Block1	1676	15084

## SPACES

Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Infil ID	Finished	Cooled	Heated
1	Main	1676	15084	Yes	6	3	1	Yes	Yes	Yes

## FLOORS

✓	#	Floor Type	Space	Perimeter	R-Value	Area		Tile	Wood	Carpet
_____	1	Slab-On-Grade Edge Insulation	Main	176.4 ft	0	1676 ft²	----	0	0	1

## ROOF

✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt Tested	Emitt Tested	Deck Insul.	Pitch (deg)
_____	1	Hip	Composition shingles	2015 ft²	0 ft²	Medium	Y	0.96	No	0.9	No	0	33.7

## ATTIC

✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
_____	1	Full attic	Vented	300	1676 ft²	Y	N

## CEILING

✓	#	Ceiling Type	Space	R-Value	Ins Type	Area	Framing Frac	Truss Type
_____	1	Under Attic (Vented)	Main	38	Double Batt	1759 ft²	0.11	Wood

## INPUT SUMMARY CHECKLIST REPORT

## WALLS

✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area	Sheathing R-Value	Framing Fraction	Solar Absor.	Below Grade%
1	S	Exterior	Frame - Wood	Main	13	22	8	9		204.0 ft²		0.23	0.75	0
2	E	Exterior	Frame - Wood	Main	13	28	6	9		256.5 ft²		0.23	0.75	0
3	N	Exterior	Frame - Wood	Main	13	10		9		90.0 ft²		0.23	0.75	0
4	E	Exterior	Frame - Wood	Main	13	16		9		144.0 ft²		0.23	0.75	0
5	N	Exterior	Frame - Wood	Main	13	33	8	9		303.0 ft²		0.23	0.75	0
6	W	Exterior	Frame - Wood	Main	13	39		9		351.0 ft²		0.23	0.75	0
7	S	Garage	Frame - Wood	Main	13	21		9		189.0 ft²		0.23	0.75	0
8	W	Exterior	Frame - Wood	Main	13	5	6	9		49.5 ft²		0.23	0.75	0

## DOORS

✓ #	Ornt	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area
1	S	Insulated	Main	None	.46	3		6	8	20 ft²
2	S	Insulated	Main	None	.46	3		6	8	20 ft²

## WINDOWS

Orientation shown is the entered, Proposed orientation.

✓ #	Ornt	Wall ID	Frame	Panes	NFRC	U-Factor	SHGC	Imp	Area	Overhang Depth	Separation	Int Shade	Screening
1	S	1	Vinyl	Low-E Double	Yes	0.36	0.25	N	30.0 ft²	7 ft 6 in	1 ft 0 in	None	None
2	E	2	Vinyl	Low-E Double	Yes	0.36	0.25	N	30.0 ft²	1 ft 6 in	1 ft 0 in	None	None
3	N	3	TIM	Low-E Double	Yes	0.36	0.25	N	40.0 ft²	6 ft 6 in	1 ft 0 in	None	None
4	N	5	Vinyl	Low-E Double	Yes	0.36	0.25	N	30.0 ft²	1 ft 6 in	1 ft 0 in	None	None
5	N	5	Vinyl	Low-E Double	Yes	0.36	0.25	N	4.0 ft²	1 ft 6 in	1 ft 0 in	None	None
6	W	6	Vinyl	Low-E Double	Yes	0.36	0.25	N	6.0 ft²	1 ft 6 in	1 ft 0 in	None	None
7	W	6	Vinyl	Low-E Double	Yes	0.36	0.25	N	30.0 ft²	1 ft 6 in	1 ft 0 in	None	None

## GARAGE

✓ #	Floor Area	Ceiling Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
1	504 ft²	504 ft²	65.5 ft	9 ft	1

## INFILTRATION

#	Scope	Method	SLA	CFM 50	ELA	EqLA	ACH	ACH 50
1	Wholehouse	Proposed ACH(50)	.000286	1257	68.96	129.47	.1027	5

## HEATING SYSTEM

✓ #	System Type	Subtype	Speed	Efficiency	Capacity	Block	Ducts
1	Electric Heat Pump/	None	Single	HSPF:8.2	25.16 kBtu/hr	1	sys#1

## INPUT SUMMARY CHECKLIST REPORT

## COOLING SYSTEM

✓	#	System Type	Subtype	Subtype	Efficiency	Capacity	Air Flow	SHR	Block	Ducts
✓	1	Central Unit/	None	Single	SEER: 14	19.42 kBtu/hr	570 cfm	0.7	1	sys#1

## HOT WATER SYSTEM

✓	#	System Type	SubType	Location	EF	Cap	Use	SetPnt	Conservation
✓	1	Electric	None	Garage	0.92	50 gal	40 gal	120 deg	None

## SOLAR HOT WATER SYSTEM

✓	FSEC Cert #	Company Name	System Model #	Collector Model #	Collector Area	Storage Volume	FEF
✓	None	None				ft²	

## DUCTS

✓	#	Location	Supply R-Value	Area	Location	Return Area	Leakage Type	Air Handler	CFM 25 TOT	CFM25 OUT	QN	RLF	HVAC # Heat Cool
✓	1	Attic	6	419 ft²	Attic	83.8 ft²	Default Leakage	Garage	(Default) c	(Default) c			1 1

## TEMPERATURES

Programmable Thermostat: Y

Ceiling Fans:

Cooling	[X] Jan	[X] Feb	[X] Mar	[X] Apr	[X] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[X] Oct	[X] Nov	[X] Dec
Heating	[X] Jan	[X] Feb	[X] Mar	[X] Apr	[X] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[X] Oct	[X] Nov	[X] Dec
Venting	[X] Jan	[X] Feb	[X] Mar	[X] Apr	[X] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[X] Oct	[X] Nov	[X] Dec

Thermostat Schedule: HERS 2006 Reference

Schedule Type		1	2	3	4	5	6	7	8	9	10	11	12
Cooling (WD)	AM	78	78	78	78	78	78	78	78	80	80	80	80
	PM	80	80	78	78	78	78	78	78	78	78	78	78
Cooling (WEH)	AM	78	78	78	78	78	78	78	78	78	78	78	78
	PM	78	78	78	78	78	78	78	78	78	78	78	78
Heating (WD)	AM	66	66	66	66	66	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	66	66
Heating (WEH)	AM	66	66	66	66	66	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	66	66

## MASS

Mass Type	Area	Thickness	Furniture Fraction	Space
Default(8 lbs/sq.ft.)	0 ft²	0 ft	0.3	Main

# ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX\* = 100

The lower the EnergyPerformance Index, the more efficient the home.

, Lake City, FL, 32024

1. New construction or existing	New (From Plans)	10. Wall Type and Insulation	Insulation	Area
2. Single family or multiple family	Detached	a. Frame - Wood, Exterior	R=13.0	1398.00 ft <sup>2</sup>
3. Number of units, if multiple family	1	b. Frame - Wood, Adjacent	R=13.0	189.00 ft <sup>2</sup>
4. Number of Bedrooms	3	c. N/A	R=	ft <sup>2</sup>
5. Is this a worst case?	No	d. N/A	R=	ft <sup>2</sup>
6. Conditioned floor area (ft <sup>2</sup> )	1676	11. Ceiling Type and insulation level	Insulation	Area
7. Windows**	Description	a. Under Attic (Vented)	R=38.0	1759.00 ft <sup>2</sup>
a. U-Factor:	DbI, U=0.36	b. N/A	R=	ft <sup>2</sup>
SHGC:	SHGC=0.25	c. N/A	R=	ft <sup>2</sup>
b. U-Factor:	N/A	12. Ducts, location & insulation level	R	ft <sup>2</sup>
SHGC:		a. Sup: Attic, Ret: Attic, AH: Garage	6	419
c. U-Factor:	N/A			
SHGC:		13. Cooling systems	kBtu/hr	Efficiency
d. U-Factor:	N/A	a. Central Unit	19.4	SEER:14.00
SHGC:				
Area Weighted Average Overhang Depth:	3.735 ft.	14. Heating systems	kBtu/hr	Efficiency
Area Weighted Average SHGC:	0.250	a. Electric Heat Pump	25.2	HSPF:8.20
8. Skylights	Description			
a. U-Factor(AVG):	N/A	15. Hot water systems		Cap: 50 gallons
SHGC(AVG):	N/A	a. Electric		EF: 0.92
9. Floor Types	Insulation	b. Conservation features		
a. Slab-On-Grade Edge Insulation	R=0.0	None		
b. N/A	R=	Credits (Performance method)		CV, Pstat
c. N/A	R=			

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Address of New Home: \_\_\_\_\_ City/FL Zip: \_\_\_\_\_



\*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida Energy Rating. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

\*\*Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.



# Envelope Leakage Test Report (Blower Door Test)

## Residential Prescriptive, Performance or ERI Method Compliance

### 2020 Florida Building Code, Energy Conservation, 7th Edition

Jurisdiction:	Permit #:
<b>Job Information</b>	
Builder: Rhett Smithey	Community: Lot: 9
Address:	
City: Lake City	State: FL Zip: 32024
<b>Air Leakage Test Results</b> <i>Passing results must meet either the Performance, Prescriptive, or ERI Method</i>	
<input type="radio"/> <b>PRESCRIPTIVE METHOD</b> -The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.	
<input type="radio"/> <b>PERFORMANCE or ERI METHOD</b> -The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2020 (Performance) or R406-2020 (ERI), section labeled as infiltration, sub-section ACH50. ACH(50) specified on Form R405-2020-Energy Calc (Performance) or R406-2020 (ERI): <span style="border: 1px solid black; padding: 2px 20px;">5.000</span>	
<div style="display: flex; justify-content: space-between; align-items: flex-start;"> <div style="width: 60%;"> <math display="block">\frac{\text{CFM}(50)}{\text{Building Volume}} \times 60 \div \frac{15084}{\text{ACH}(50)} =</math> <div style="display: flex; align-items: center; margin-top: 10px;"> <input type="checkbox"/> <b>PASS</b> </div> <div style="margin-top: 10px;"> <input type="checkbox"/> When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.         </div> </div> <div style="width: 35%;"> <p><u>Method for calculating building volume:</u></p> <input type="radio"/> Retrieved from architectural plans  <input checked="" type="radio"/> Code software calculated  <input type="radio"/> Field measured and calculated         </div> </div>	
<p><b>R402.4.1.2 Testing.</b> Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7) <i>Florida Statutes</i> or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.</p> <p>During testing:</p> <ol style="list-style-type: none"> <li>1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.</li> <li>2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.</li> <li>3. Interior doors, if installed at the time of the test, shall be open.</li> <li>4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.</li> <li>5. Heating and cooling systems, if installed at the time of the test, shall be turned off.</li> <li>6. Supply and return registers, if installed at the time of the test, shall be fully open.</li> </ol>	
<b>Testing Company</b>	
Company Name: _____ Phone: _____ I hereby verify that the above Air Leakage results are in accordance with the 2020 7th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.	
Signature of Tester: _____ Date of Test: _____ Printed Name of Tester: _____ License/Certification #: _____ Issuing Authority: _____	

# Residential System Sizing Calculation

## Summary

Project Title:  
Lot 9 Crosswinds

Lake City, FL 32024


4/30/2021

Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M)					
Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(51gr.)					
Winter design temperature(TMY3 99%) 30 F			Summer design temperature(TMY3 99%) 94 F		
Winter setpoint 70 F			Summer setpoint 75 F		
Winter temperature difference 40 F			Summer temperature difference 19 F		
<b>Total heating load calculation 25156 Btuh</b>			<b>Total cooling load calculation 19434 Btuh</b>		
Submitted heating capacity % of calc Btuh			Submitted cooling capacity % of calc Btuh		
Total (Electric Heat Pump) 100.0 25156			Sensible (SHR = 0.70) 85.7 13593		
Heat Pump + Auxiliary(0.0kW) 100.0 25156			Latent 163.5 5826		
			Total (Electric Heat Pump) 99.9 19419		

## WINTER CALCULATIONS

Winter Heating Load (for 1676 sqft)


Load component		Load	
Window total	170 sqft	2448	Btuh
Wall total	1377 sqft	4889	Btuh
Door total	40 sqft	736	Btuh
Ceiling total	1759 sqft	1786	Btuh
Floor total	1676 sqft	8326	Btuh
Infiltration	41 cfm	1809	Btuh
Duct loss		5163	Btuh
<b>Subtotal</b>		<b>25156</b>	<b>Btuh</b>
Ventilation	0 cfm	0	Btuh
<b>TOTAL HEAT LOSS</b>		<b>25156</b>	<b>Btuh</b>

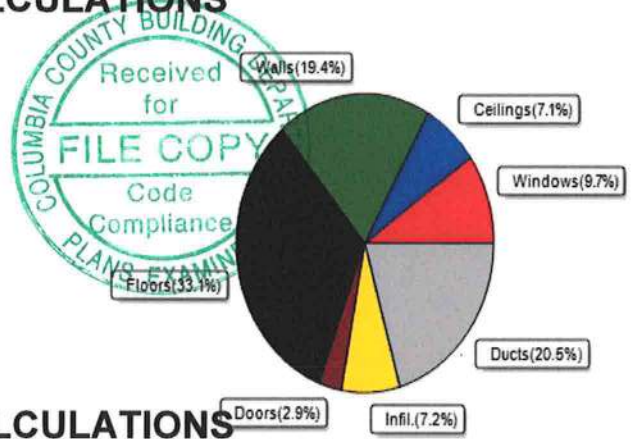

## SUMMER CALCULATIONS

Summer Cooling Load (for 1676 sqft)

Load component		Load	
Window total	170 sqft	3252	Btuh
Wall total	1377 sqft	3019	Btuh
Door total	40 sqft	552	Btuh
Ceiling total	1759 sqft	1518	Btuh
Floor total		0	Btuh
Infiltration	31 cfm	644	Btuh
Internal gain		2580	Btuh
Duct gain		4305	Btuh
Sens. Ventilation	0 cfm	0	Btuh
Blower Load		0	Btuh
<b>Total sensible gain</b>		<b>15870</b>	<b>Btuh</b>
Latent gain(ducts)		1295	Btuh
Latent gain(infiltration)		1069	Btuh
Latent gain(ventilation)		0	Btuh
Latent gain(internal/occupants/other)		1200	Btuh
<b>Total latent gain</b>		<b>3564</b>	<b>Btuh</b>
<b>TOTAL HEAT GAIN</b>		<b>19434</b>	<b>Btuh</b>

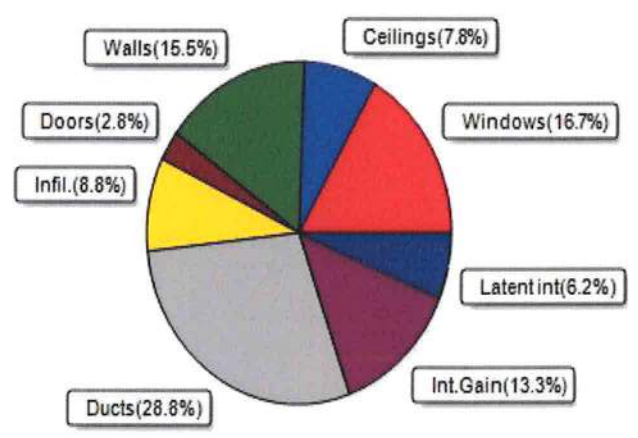

8th Edition

EnergyGauge® System Sizing  
PREPARED BY: [Signature]  
DATE: 4/30/2021

# System Sizing Calculations - Winter

## Residential Load - Whole House Component Details

Lake City, FL 32024

Project Title:  
Lot 9 Crosswinds  
Building Type: User

4/30/2021

Reference City: Gainesville, FL (Defaults) Winter Temperature Difference: 40.0 F (TMY3 99%)

Component Loads for Whole House								
Window	Panes/Type	Frame	U	Orientation	Area(sqft)	X	HTM=	Load
1	2, NFRC 0.25	Vinyl	0.36	S	30.0		14.4	432 Btuh
2	2, NFRC 0.25	Vinyl	0.36	E	30.0		14.4	432 Btuh
3	2, NFRC 0.25	TIM	0.36	N	40.0		14.4	576 Btuh
4	2, NFRC 0.25	Vinyl	0.36	N	30.0		14.4	432 Btuh
5	2, NFRC 0.25	Vinyl	0.36	N	4.0		14.4	58 Btuh
6	2, NFRC 0.25	Vinyl	0.36	W	6.0		14.4	86 Btuh
7	2, NFRC 0.25	Vinyl	0.36	W	30.0		14.4	432 Btuh
	Window Total				170.0(sqft)			2448 Btuh
Walls	Type	Ornt.	Ueff.	R-Value (Cav/Sh)	Area	X	HTM=	Load
1	Frame - Wood	- Ext	(0.089)	13.0/0.0	154		3.55	547 Btuh
2	Frame - Wood	- Ext	(0.089)	13.0/0.0	227		3.55	804 Btuh
3	Frame - Wood	- Ext	(0.089)	13.0/0.0	50		3.55	178 Btuh
4	Frame - Wood	- Ext	(0.089)	13.0/0.0	144		3.55	511 Btuh
5	Frame - Wood	- Ext	(0.089)	13.0/0.0	269		3.55	955 Btuh
6	Frame - Wood	- Ext	(0.089)	13.0/0.0	315		3.55	1118 Btuh
7	Frame - Wood	- Adj	(0.089)	13.0/0.0	169		3.55	600 Btuh
8	Frame - Wood	- Ext	(0.089)	13.0/0.0	50		3.55	176 Btuh
	Wall Total				1377(sqft)			4889 Btuh
Doors	Type	Storm	Ueff.		Area	X	HTM=	Load
1	Insulated - Exterior, n		(0.460)		20		18.4	368 Btuh
2	Insulated - Garage, n		(0.460)		20		18.4	368 Btuh
	Door Total				40(sqft)			736Btuh
Ceilings	Type/Color/Surface		Ueff.	R-Value	Area	X	HTM=	Load
1	Vented Attic/L/Shing		(0.025)	38.0/0.0	1759		1.0	1786 Btuh
	Ceiling Total				1759(sqft)			1786Btuh
Floors	Type		Ueff.	R-Value	Size	X	HTM=	Load
1	Slab On Grade		(1.180)	0.0	176.4 ft(perim.)		47.2	8326 Btuh
	Floor Total				1676 sqft			8326 Btuh
	Envelope Subtotal:							18185 Btuh
Infiltration	Type	Wholehouse	ACH	Volume(cuft)	Wall Ratio	CFM=		
	Natural		0.16	15084	1.00	41.3		1809 Btuh
Duct load	Average sealed, R6.0, Supply(Att), Return(Att)					(DLM of 0.258)		5163 Btuh
All Zones	Sensible Subtotal All Zones							25156 Btuh



# Manual J Winter Calculations

## Residential Load - Component Details (continued)

Lake City, FL 32024

Project Title:  
Lot 9 Crosswinds  
Building Type: User

4/30/2021

### WHOLE HOUSE TOTALS

<b>Totals for Heating</b>	Subtotal Sensible Heat Loss Ventilation Sensible Heat Loss Total Heat Loss	25156 Btuh 0 Btuh 25156 Btuh
---------------------------	--	------------------------------------

### EQUIPMENT

1. Electric Heat Pump	#	25156 Btuh
-----------------------	---	------------

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)  
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)  
U - (Window U-Factor)  
HTM - (ManualJ Heat Transfer Multiplier)



Version 8

# System Sizing Calculations - Summer

## Residential Load - Whole House Component Details

Project Title:  
Lot 9 Crosswinds

Lake City, FL 32024

4/30/2021

Reference City: Gainesville, FL

Temperature Difference: 19.0F(TMY3 99%) Humidity difference: 51gr.

### Component Loads for Whole House

Window	Type*						Overhang		Window Area(sqft)			HTM		Load	
	Panes	SHGC	U	InSh	IS	Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded		
1	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	1.0ft.	30.0	30.0	0.0	12	14	363	Btuh
2	2 NFRC	0.25, 0.36	No	No	E		1.5ft.	1.0ft.	30.0	1.5	28.5	12	31	901	Btuh
3	2 NFRC	0.25, 0.36	No	No	N		6.5ft.	1.0ft.	40.0	0.0	40.0	12	12	484	Btuh
4	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	30.0	0.0	30.0	12	12	363	Btuh
5	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	4.0	0.0	4.0	12	12	48	Btuh
6	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	6.0	0.5	5.5	12	31	176	Btuh
7	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	30.0	1.5	28.5	12	31	901	Btuh
	Excursion													16	Btuh
	Window Total								170 (sqft)					3252 Btuh	
Walls	Type					U-Value	R-Value	Area(sqft)			HTM		Load		
							Cav/Sheath								
1	Frame - Wood - Ext					0.09	13.0/0.0	154.0			2.3		349 Btuh		
2	Frame - Wood - Ext					0.09	13.0/0.0	226.5			2.3		513 Btuh		
3	Frame - Wood - Ext					0.09	13.0/0.0	50.0			2.3		113 Btuh		
4	Frame - Wood - Ext					0.09	13.0/0.0	144.0			2.3		326 Btuh		
5	Frame - Wood - Ext					0.09	13.0/0.0	269.0			2.3		609 Btuh		
6	Frame - Wood - Ext					0.09	13.0/0.0	315.0			2.3		713 Btuh		
7	Frame - Wood - Adj					0.09	13.0/0.0	169.0			1.7		285 Btuh		
8	Frame - Wood - Ext					0.09	13.0/0.0	49.5			2.3		112 Btuh		
	Wall Total								1377 (sqft)					3019 Btuh	
Doors	Type							Area (sqft)			HTM		Load		
1	Insulated - Exterior							20.0			13.8		276 Btuh		
2	Insulated - Garage							20.0			13.8		276 Btuh		
	Door Total								40 (sqft)					552 Btuh	
Ceilings	Type/Color/Surface					U-Value	R-Value	Area(sqft)			HTM		Load		
1	Vented AtticLight/Shingle/RB					0.025	38.0/0.0	1759.0			0.86		1518 Btuh		
	Ceiling Total								1759 (sqft)					1518 Btuh	
Floors	Type						R-Value	Size			HTM		Load		
1	Slab On Grade						0.0	1676 (ft-perimeter)			0.0		0 Btuh		
	Floor Total								1676.0 (sqft)					0 Btuh	
	Envelope Subtotal:													8341 Btuh	
Infiltration	Type					Average ACH		Volume(cuft)		Wall Ratio		CFM=		Load	
	Natural					0.12		15084		1		31.0		644 Btuh	
Internal gain						Occupants		Btuh/occupant		Appliance		Load			
						6	X	230		+		1200		2580 Btuh	
	Sensible Envelope Load:													11565 Btuh	
Duct load	Average sealed,Supply(R6.0-Attic), Return(R6.0-Attic)										(DGM of 0.372)			4305 Btuh	
	Sensible Load All Zones													15870 Btuh	

# Manual J Summer Calculations

## Residential Load - Component Details (continued)

Project Title: Climate:FL\_GAINESVILLE\_REGIONAL\_A  
Lot 9 Crosswinds

Lake City, FL 32024

4/30/2021

### WHOLE HOUSE TOTALS

<b>Whole House Totals for Cooling</b>	<b>Sensible Envelope Load All Zones</b>	<b>11565 Btuh</b>
	Sensible Duct Load	4305 Btuh
	<b>Total Sensible Zone Loads</b>	<b>15870 Btuh</b>
	Sensible ventilation	0 Btuh
	Blower	0 Btuh
	<b>Total sensible gain</b>	<b>15870 Btuh</b>
	Latent infiltration gain (for 51 gr. humidity difference)	1069 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	1295 Btuh
	Latent occupant gain (6.0 people @ 200 Btuh per person)	1200 Btuh
	Latent other gain	0 Btuh
	<b>Latent total gain</b>	<b>3564 Btuh</b>
	<b>TOTAL GAIN</b>	<b>19434 Btuh</b>

### EQUIPMENT

1. Central Unit	#	19419 Btuh
-----------------	---	------------

\*Key: Window types (Panels - Number and type of panes of glass)  
(SHGC - Shading coefficient of glass as SHGC numerical value)  
(U - Window U-Factor)  
(InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))  
- For Blinds: Assume medium color, half closed  
For Draperies: Assume medium weave, half closed  
For Roller shades: Assume translucent, half closed  
(IS - Insect screen: none(N), Full(F) or Half(½))  
(Ornt - compass orientation)



Version 8