


OFFICE COPY


Duckworth Residence

SWS = Indicates a shearwall segment location referring to the labeled section of wall lying between the adjacent window / door openings in either direction. The shearwall areas have a height/width aspect ratio of 3-1/2 : 1 or wider.


| AREA SUMMARY | |
|--------------|---------|
| CONDITIONED | 1777 SF |
| GARAGE | 484 SF |
| PORCH | 54 SF |
| ROOF | 2315 SF |

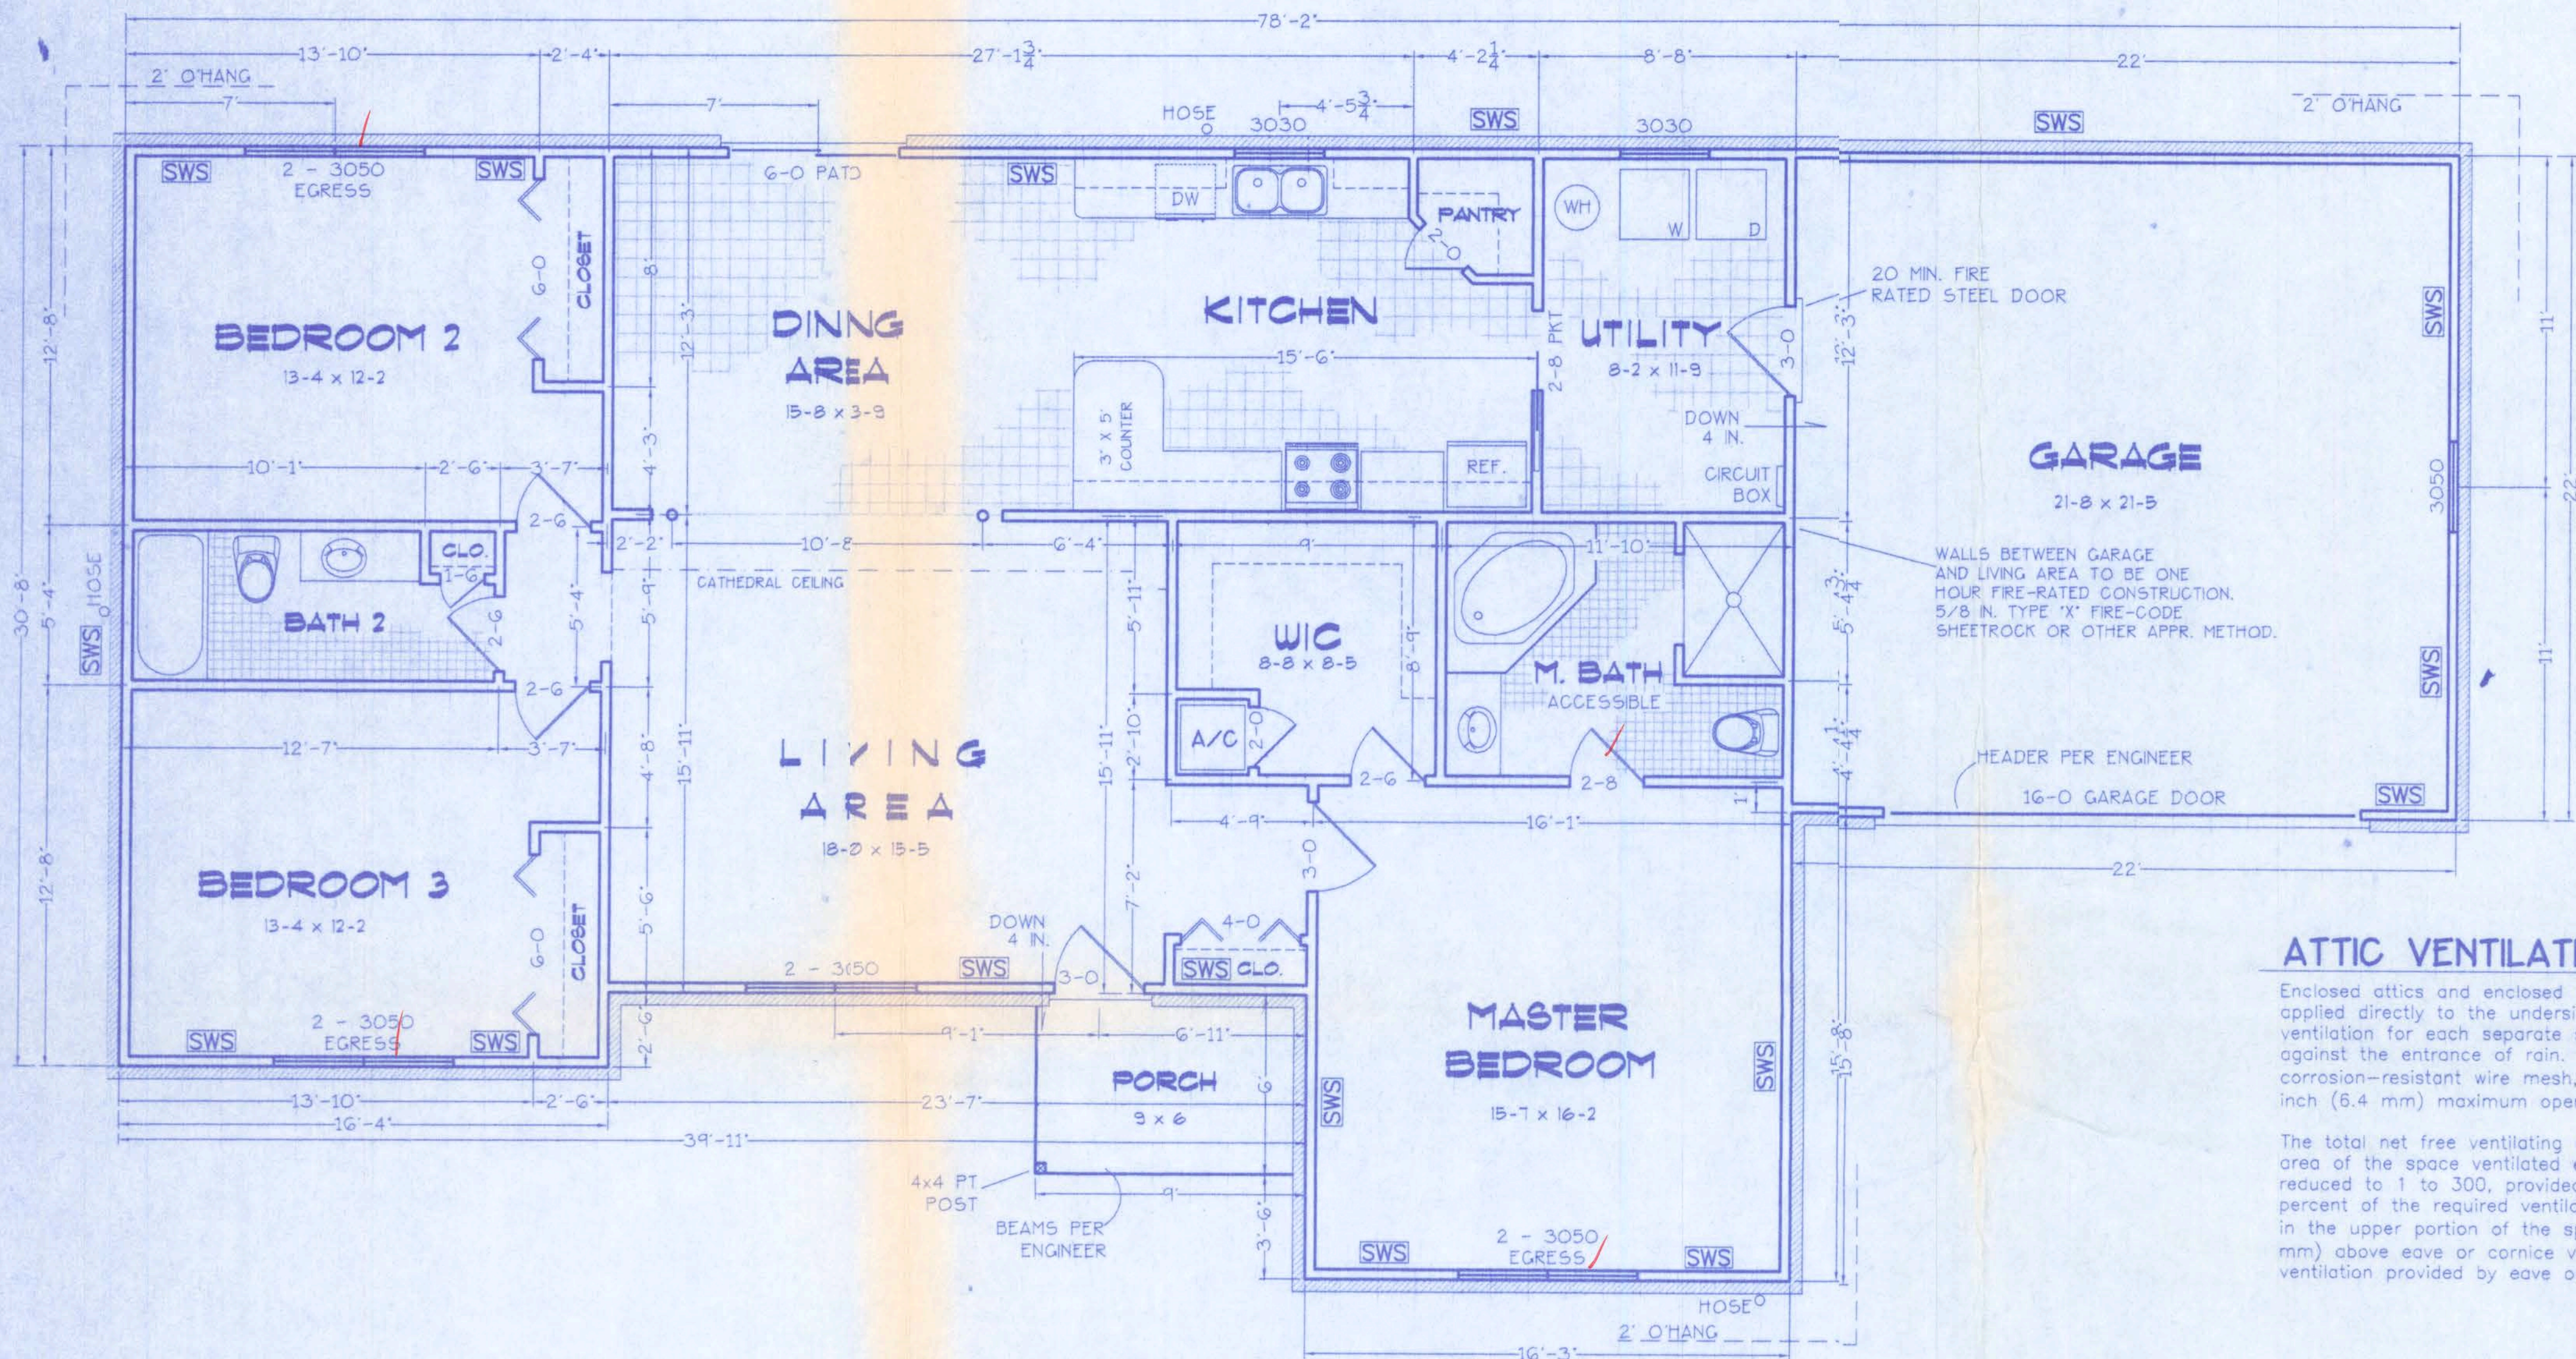

FLOOR PLAN
SCALE: 1/4 IN. = 1 FT.

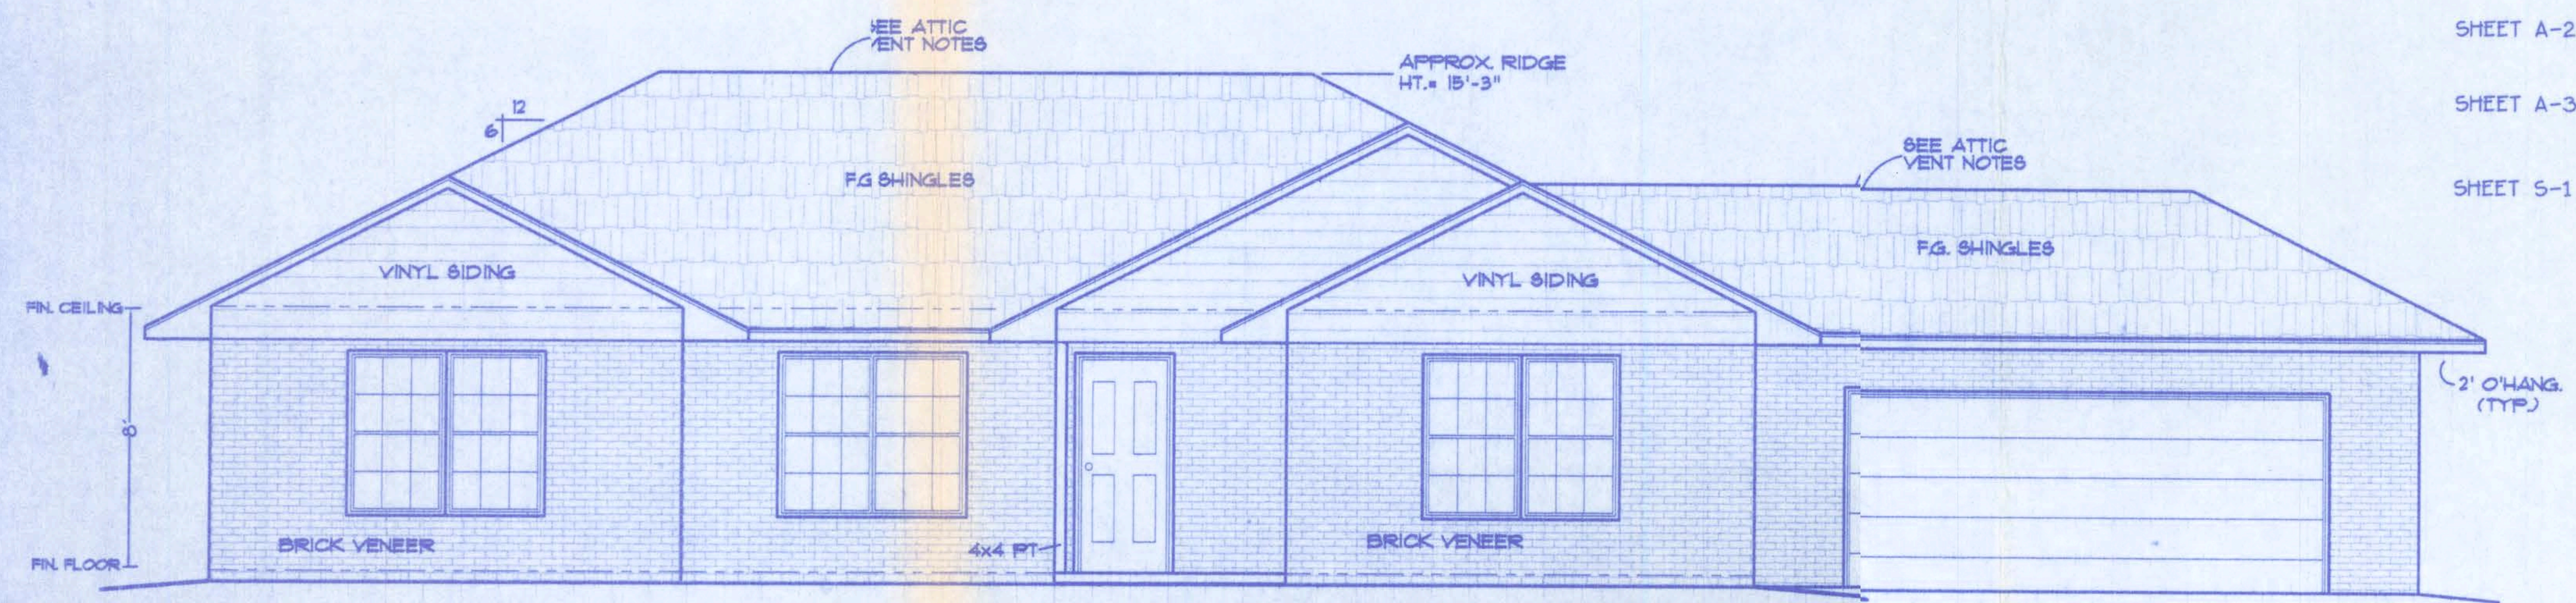

FRONT ELEVATION
SCALE: 1/4 IN. = 1 FT.

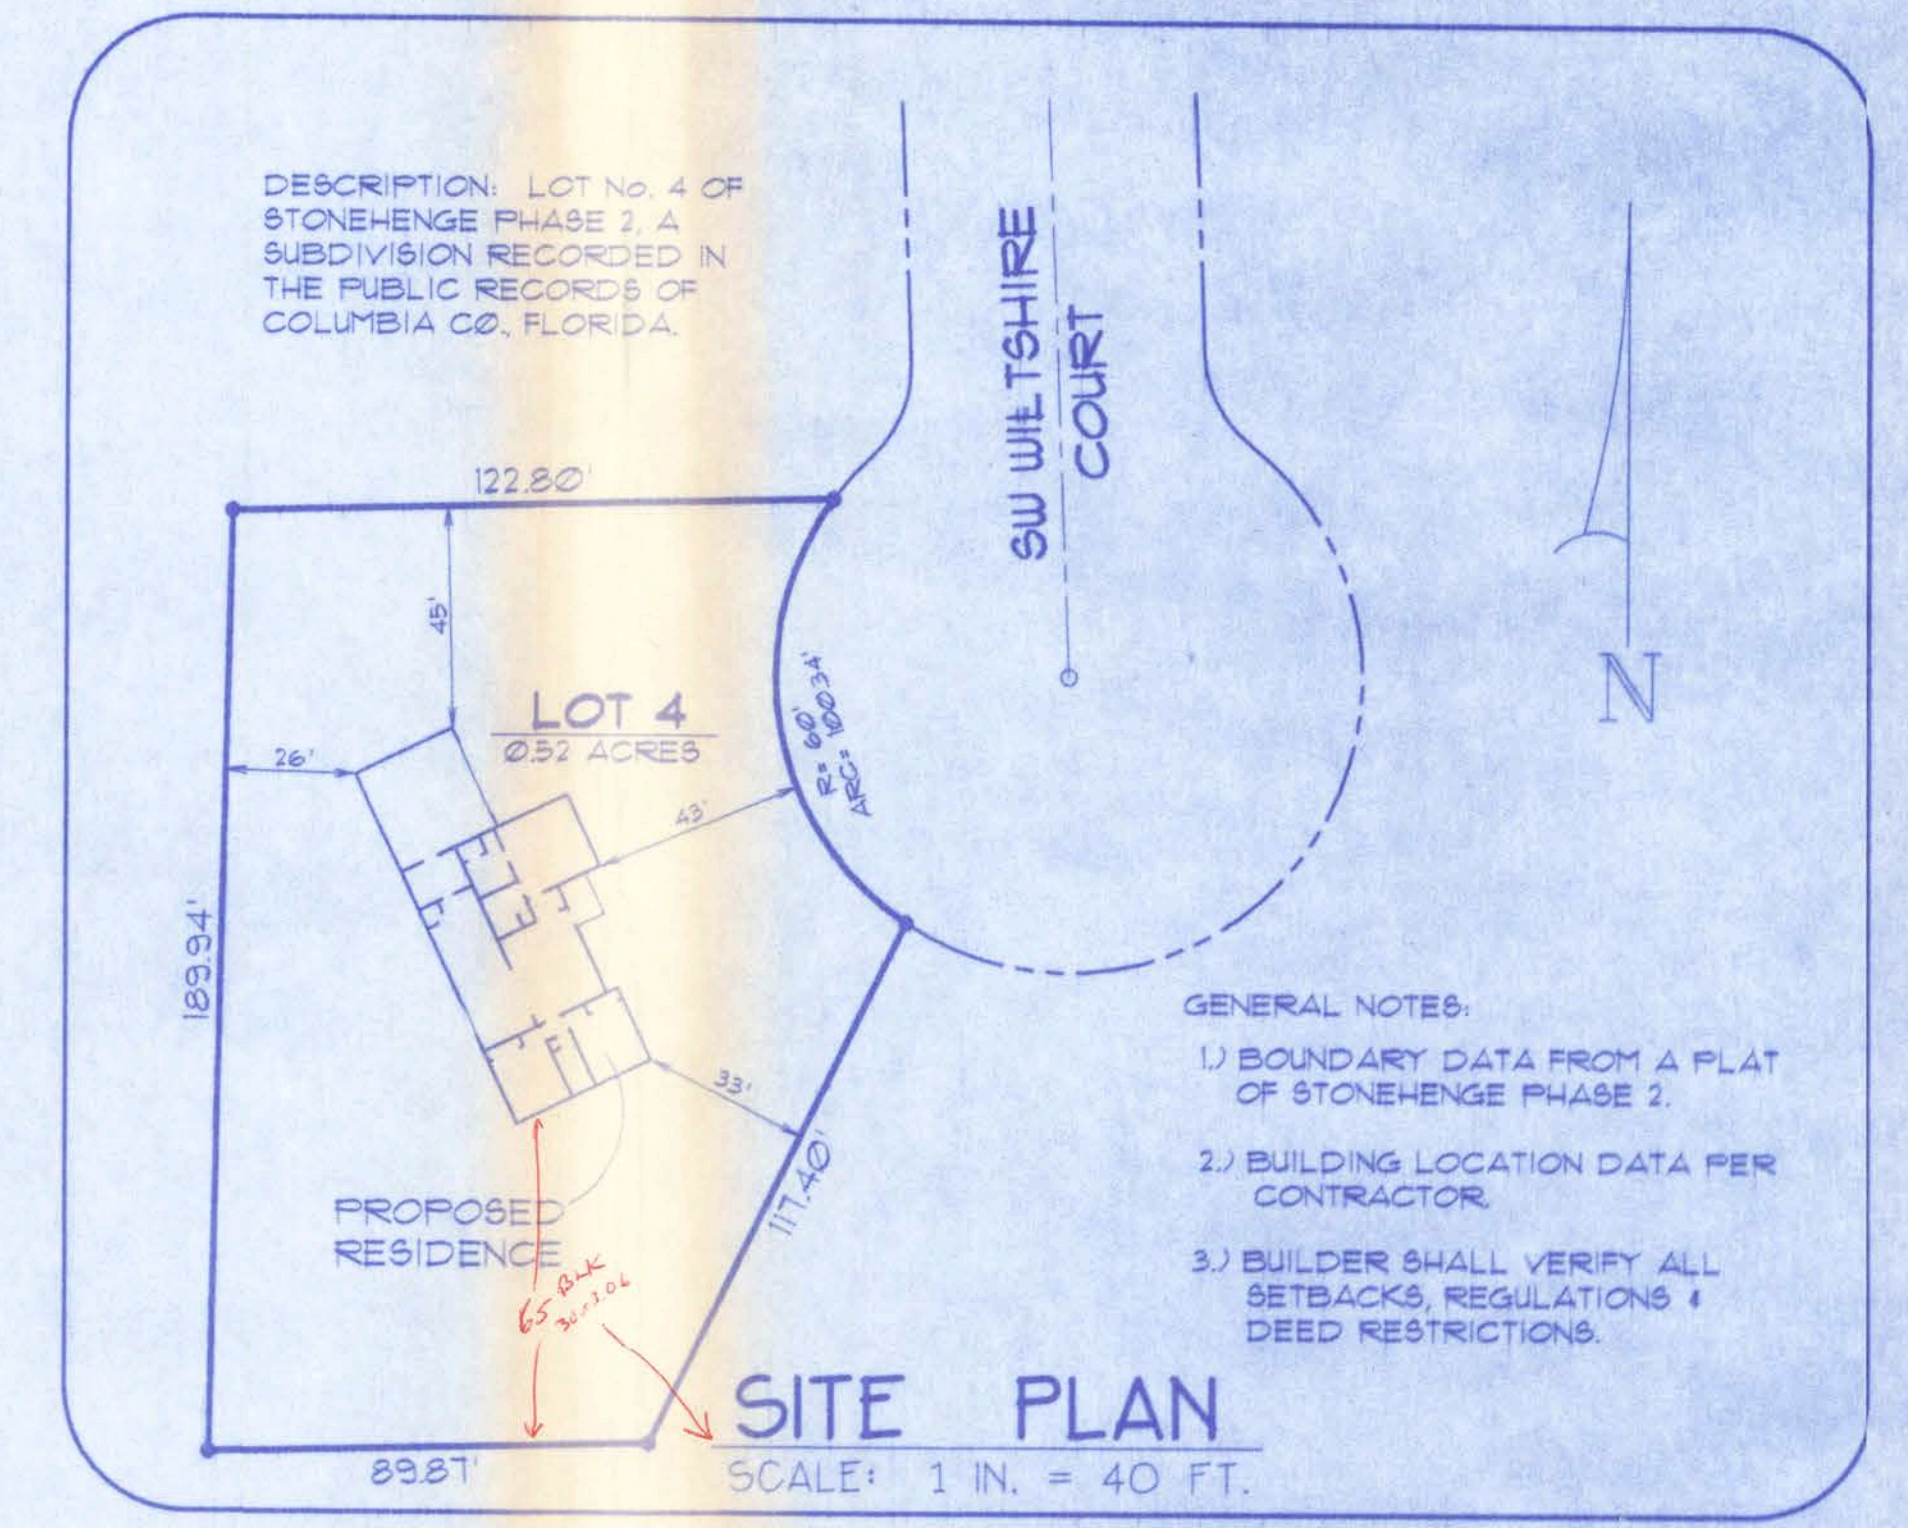

- GENERAL NOTES:**
- 1.) BOUNDARY DATA FROM A PLAT OF STONEHENGE PHASE 2.
 - 2.) BUILDING LOCATION DATA PER CONTRACTOR.
 - 3.) BUILDER SHALL VERIFY ALL SETBACKS, REGULATIONS & DEED RESTRICTIONS.

GENERAL NOTES

- 1.) See "Wind Load Detail Sheet S-1" and Wind Engineer's Notes for data pertaining to Wind Design and compliance w/ Florida Building Code.
- 2.) All concrete used to be 2500 PSI strength or greater.
- 3.) HVAC duct and unit size/design is by engineered shop drawings from the AC contractor.
- 4.) Windows to be alum. framed and double glazed. Sizes shown are nominal and may vary with manufacturer.
- 5.) Roof Truss design is the responsibility of the supplier.
- 6.) The Truss Manufacturer shall prepare Shop Drawings indicating Truss placement, Girder locations, Truss-to-Truss Connections and any point loads. The Contractor shall notify the Designer of any point loads in excess of 2.0k for Fnd. Modification.
- 7.) Site analysis or preparation information is not a part of this plan and is the responsibility of the owner.
- 8.) Cabinet and millwork detail is not a part of this plan. The plan is a general design and details shall be the responsibility of the owner and/or contractor.

WINDLOAD ENGINEER: Mark Disoway, PE No.53915, POB 868, Lake City, FL 32056, 386-754-5419

CERTIFICATION: These plans and "Windload Engineering", Sheet S-1, attached, comply with Florida Building Code Residential 2004, Section R301.2.1 to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location, permitted within 90 days of signature date. In case of conflict, structural requirements, scope of work, and builder responsibilities on sheet S-1 control.


Location: LOT 4 - STONEHENGE PH 2 Job No.:

Index to Sheets

| | |
|-----------|---|
| SHEET A-1 | FLOOR PLAN + ELEVATION + GEN. NOTES |
| SHEET A-2 | ELEVATIONS + FOUNDATION |
| SHEET A-3 | WALL SECTION + ELECTRICAL |
| SHEET S-1 | WIND ENGINEERING |


A-1

| | | |
|---------------|--|-----------------|
| FILE: 06-004 | THE Lisa MODEL | SHEET: 1 OF 3 |
| DATE: 2-11-06 | | CAD FILE: 06004 |
| DRAWN: T A D | PREPARED BY: TIM DELBENE Residential Drafting + Design Rt. 4, Box 330, Lake City, FL 32056 Phone (904) 755-5891 | REV: 0/30/03 |
| CHECK: T A D | | REV: |

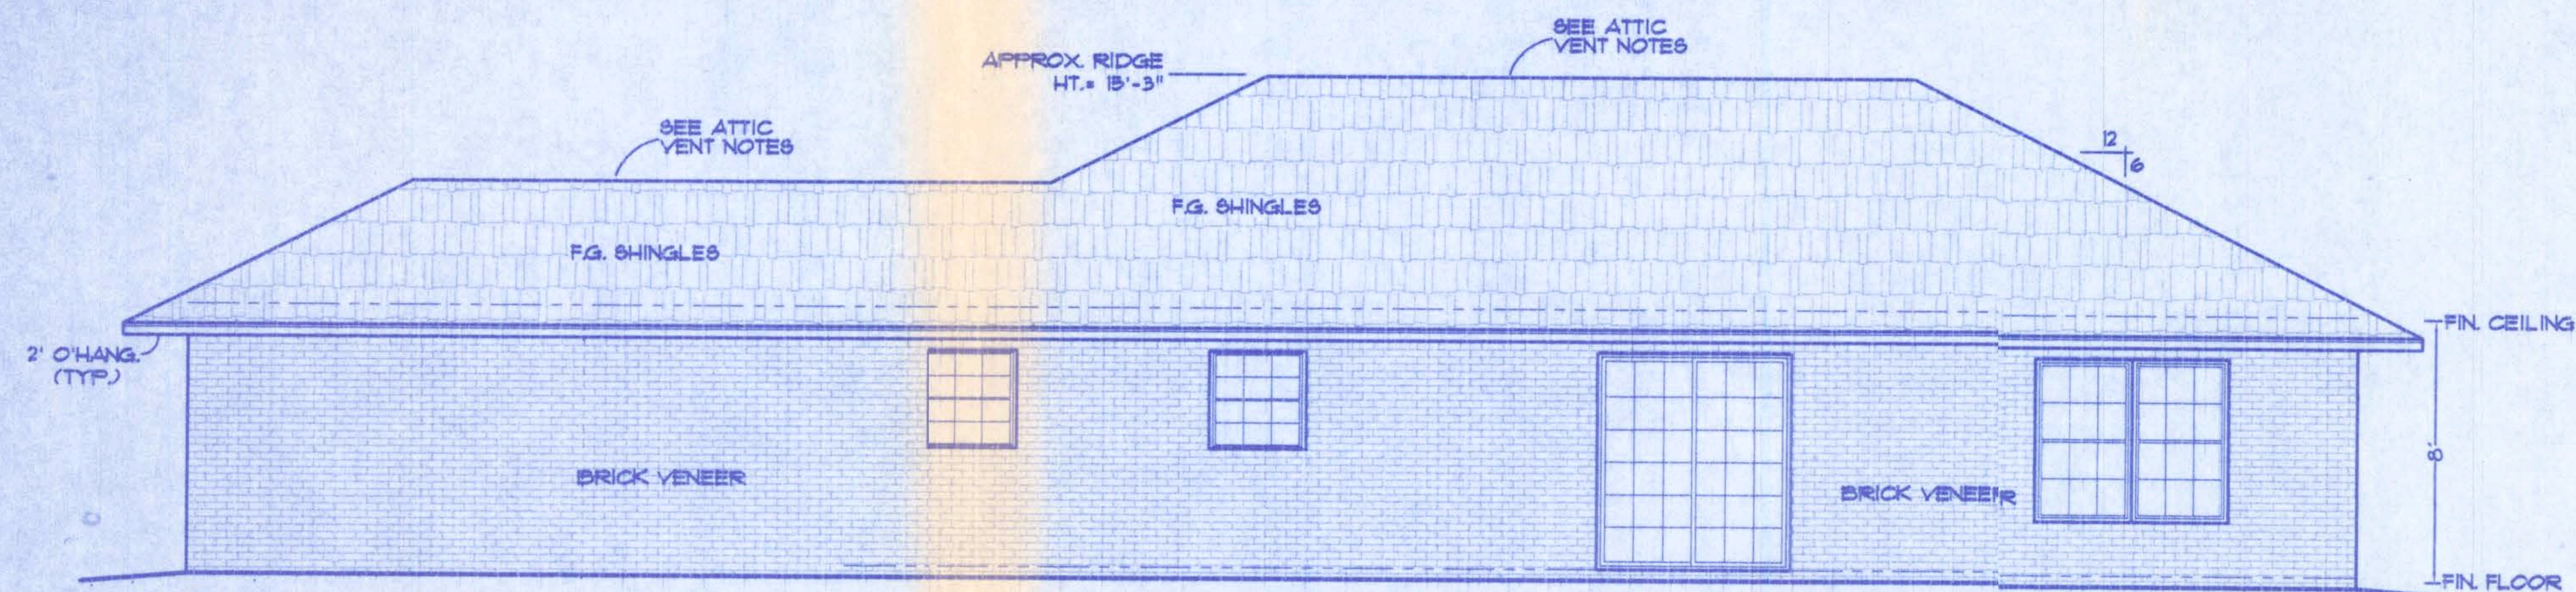


REAR ELEVATION

SCALE: 1/4 IN. = 1 FT.

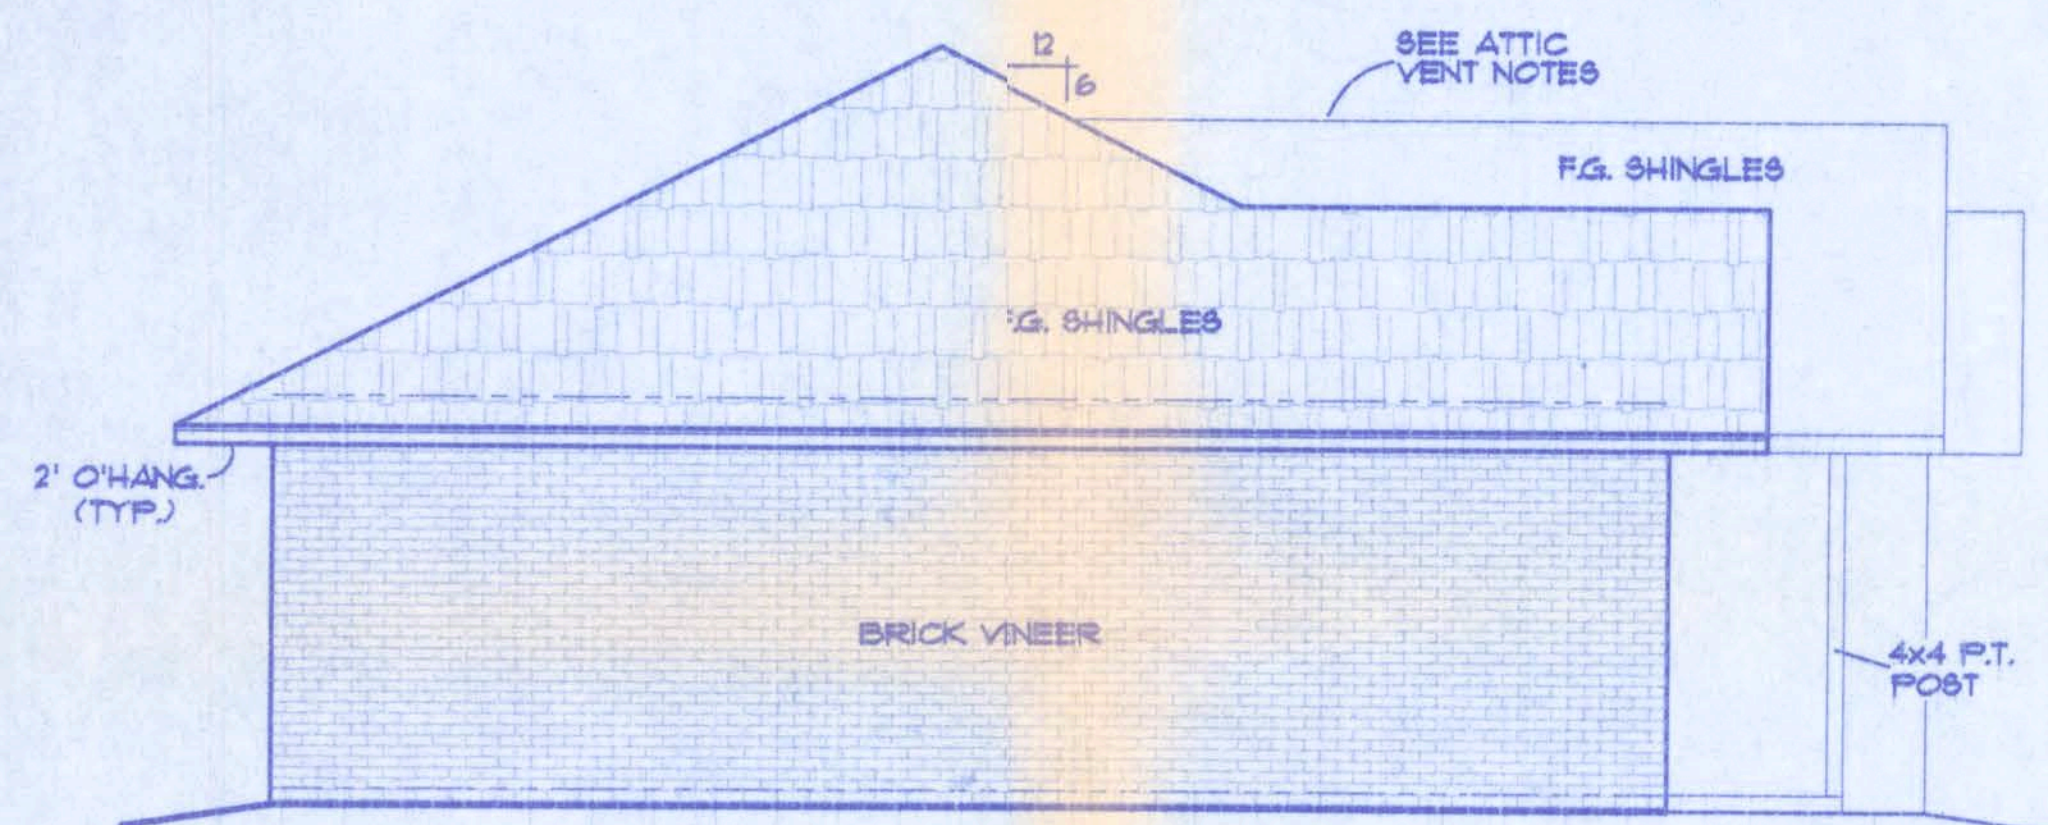

LEFT ELEVATION

SCALE: 1/4 IN. = 1 FT.

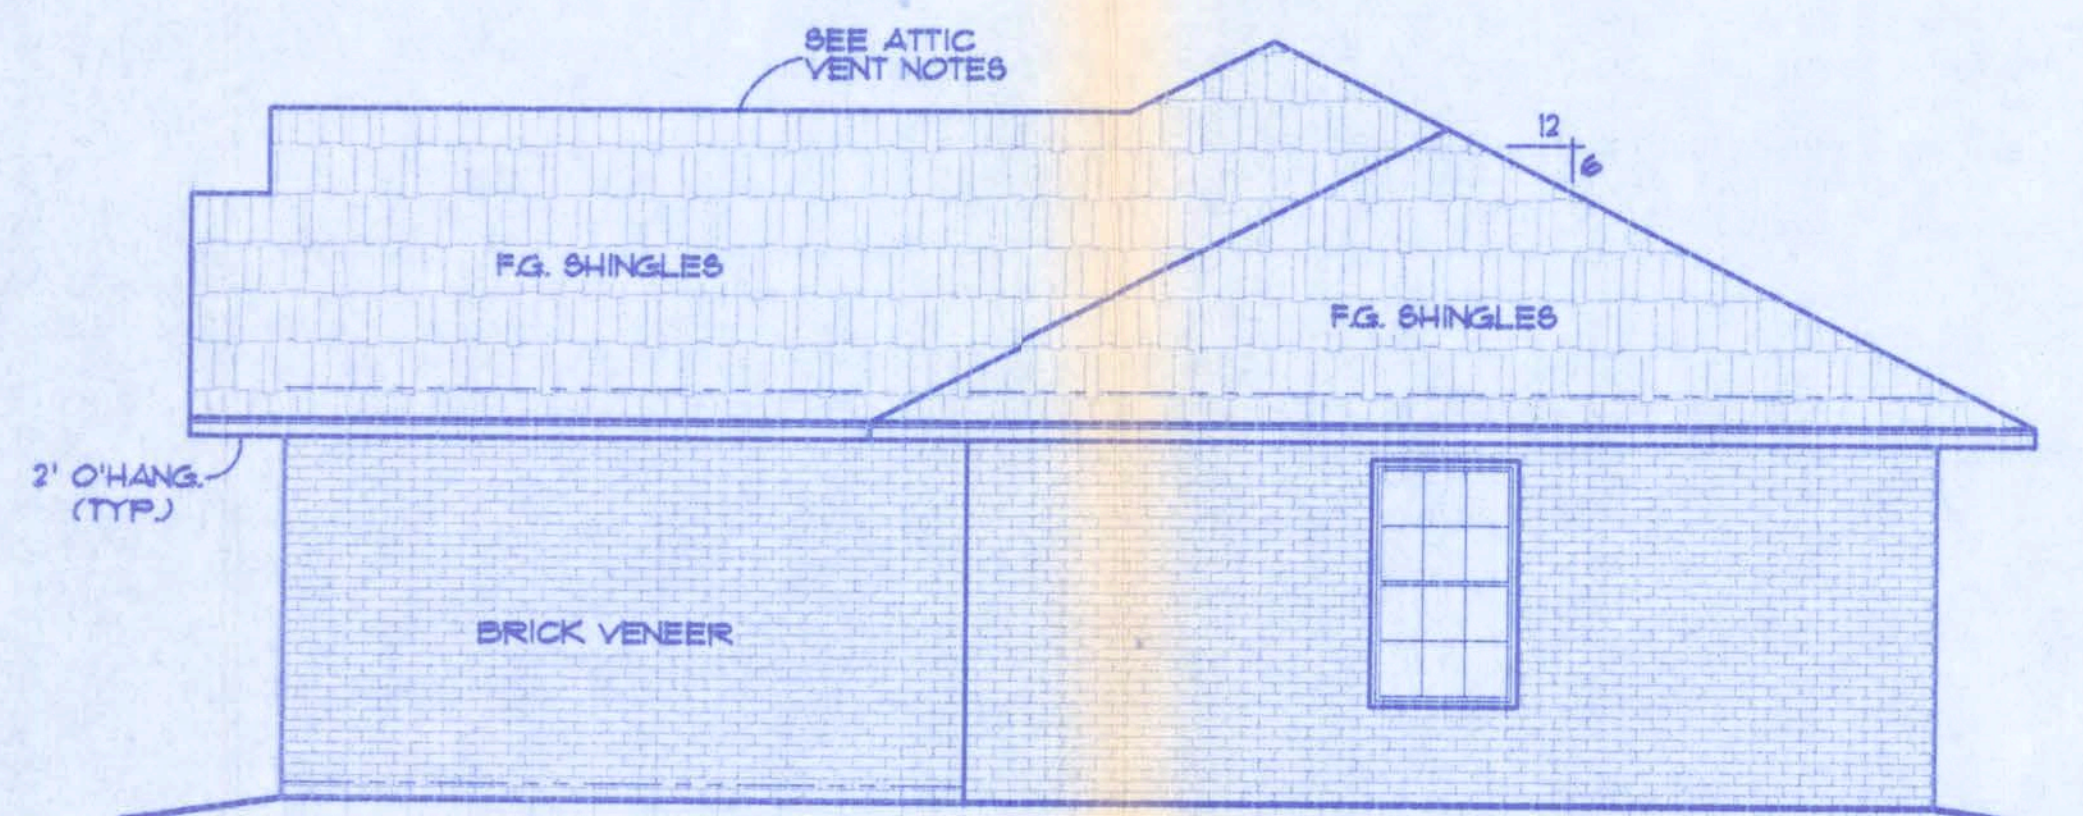


RIGHT ELEVATION

SCALE: 1/4 IN. = 1 FT.

ATTIC VENTILATION


Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of roof rafters shall have cross ventilation for each separate space by ventilating openings protected against the entrance of rain. Ventilating openings shall be provided with corrosion-resistant wire mesh, with $1/8$ inch (3.2 mm) minimum to $1/4$ inch (6.4 mm) maximum openings.

The total net free ventilating area shall not be less than 1 to 150 of the area of the space ventilated except that the total area is permitted to be reduced to 1 to 300, provided at least 50 percent and not more than 80 percent of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated at least 3 feet (914 mm) above eave or cornice vents with the balance of the required ventilation provided by eave or cornice vents.

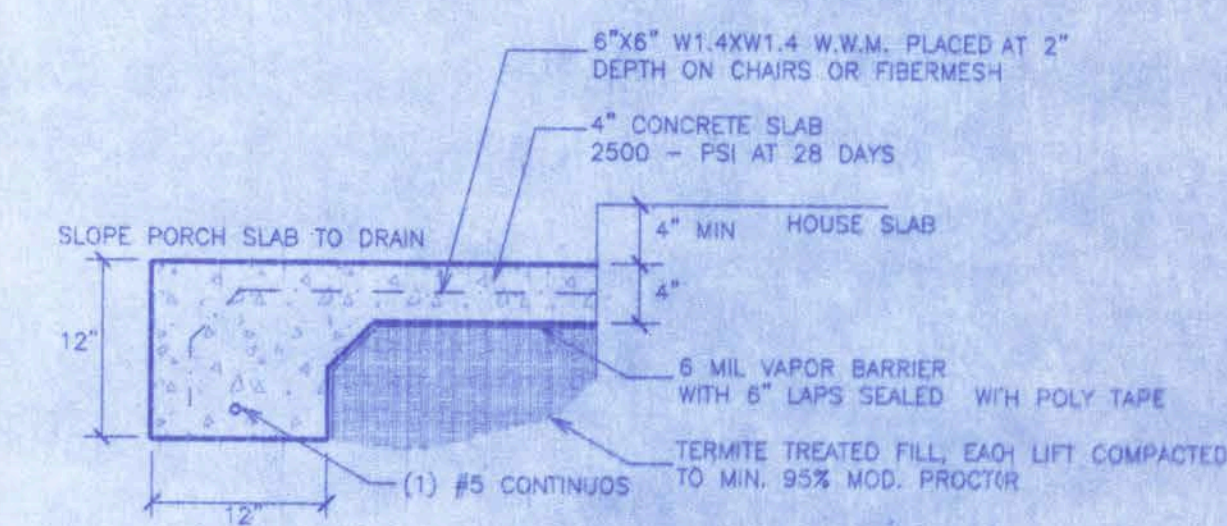

F2 - PORCH SLAB

SCALE: 1" = 1'-0"

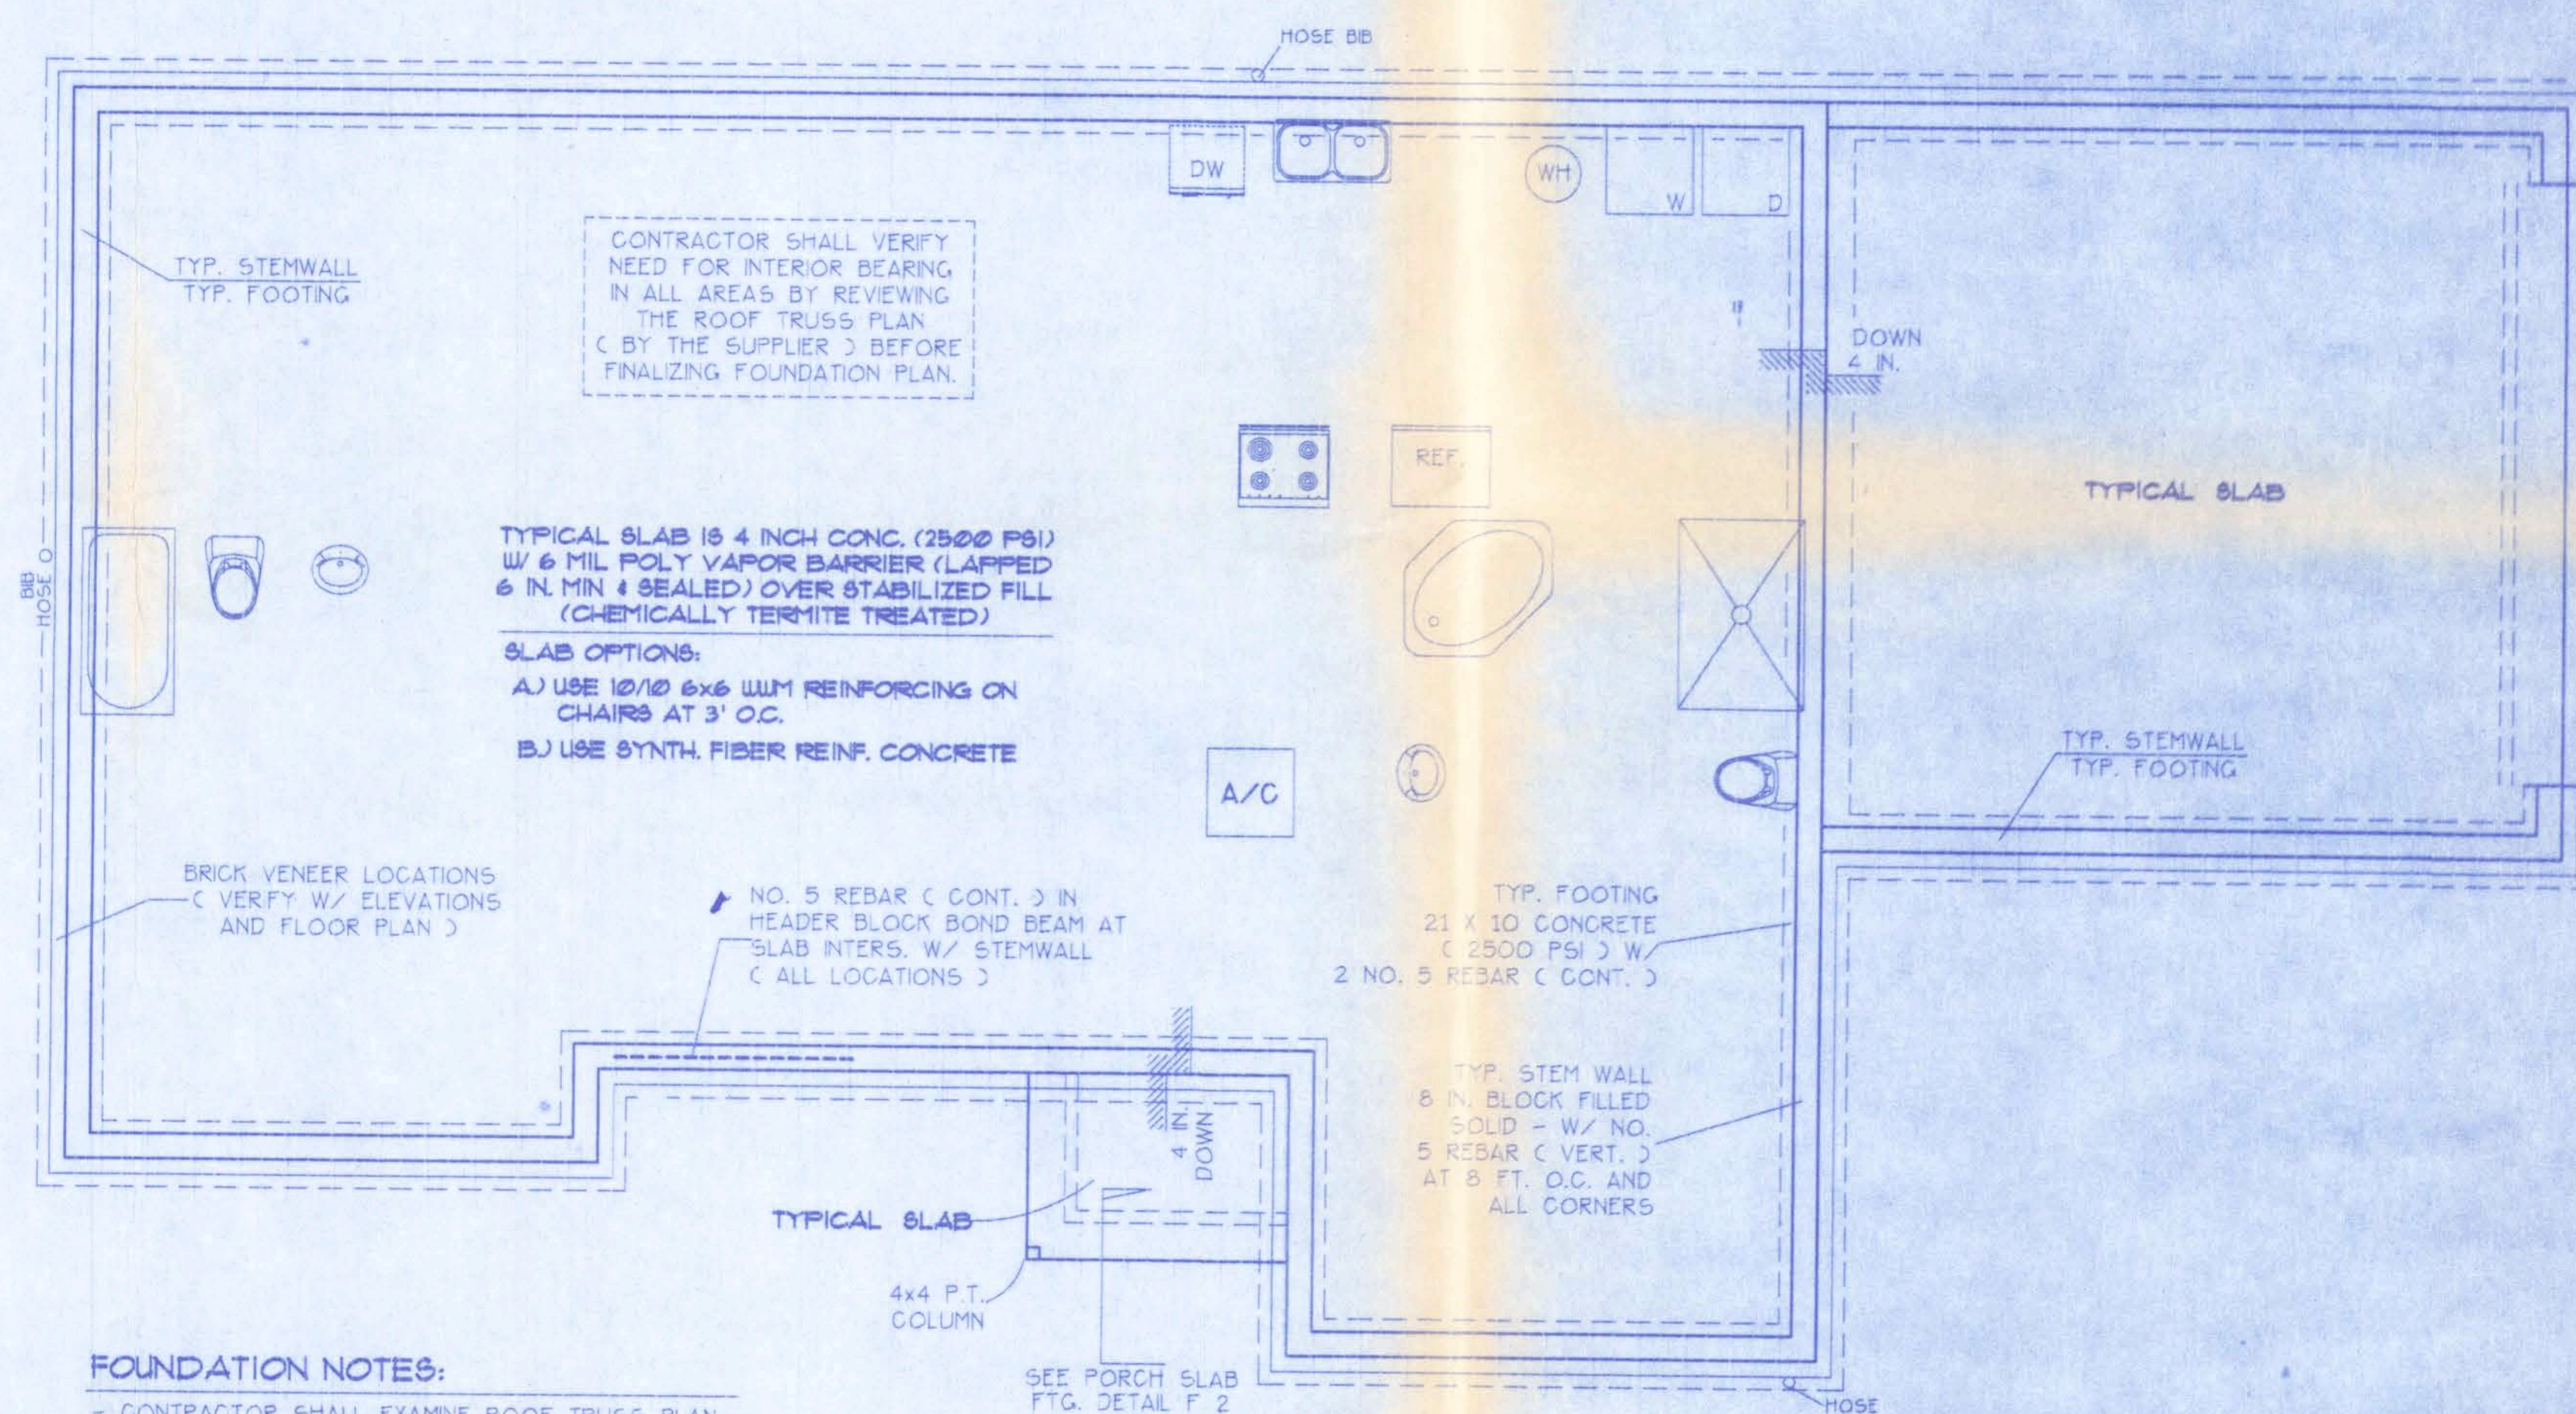

FOUNDATION NOTES:

- CONTRACTOR SHALL EXAMINE ROOF TRUSS PLAN (BY SUPPLIER) TO DETERMINE ANY ADDITIONAL BEARING REQUIREMENTS BEFORE FINALIZING THE FOUNDATION PLAN.
- ALL CONCRETE IS 2500 PSI STRENGTH (MIN.)
- SEE FLOOR PLAN FOR DIMENSIONS.
- SITE ANALYSIS AND PREPARATION DATA IS NOT A PART OF THIS PLAN AND IS THE RESPONSIBILITY OF THE CONTRACTOR / OWNER.

FOUNDATION PLAN

SCALE: 1/4 IN. = 1 FT.

WINDLOAD ENGINEER: Mark Disosway, PE No.53915, POB 868, Lake City, FL 32056, 386-754-5419

CERTIFICATION: These plans and "Windload Engineering", Sheet S-1, attached, comply with Florida Building Code Residential 2004, Section R301.2.1 to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location, permitted within 90 days of signature date. In case of conflict, structural requirements, scope of work, and builder responsibilities on sheet S-1 control.

Location: LOT 4 - STONEHENGE PH 2 Job No.:

A-2

| | | |
|------------------|--|--------------------|
| FILE: OG-004 | THE <i>Lisa</i> MODEL | SHEET: 2 OF 3 |
| DATE: 2-11-06 | | CAD FILE: OG004 |
| DRAWN: T A D | PREPARED BY: TIM DELBENE Residential Drafting + Design | REV: 12/30/03 |
| CHECK: T A D | Rt. 4, Box 330, Lake City, FL 32055 Phone (904) 755-5891 | REV: |

Mark Disosway
OWNER

| ELECTRICAL SYMBOL LEGEND | |
|--------------------------|---------------------------------------|
| | = FLOURESCENT LIGHTING FIXTURE |
| | = CEILING LIGHT FIXTURE |
| | = EXTERIOR LIGHTING FIXTURE |
| | = LIGHT SWITCH |
| | = THREE-WAY SWITCH |
| | = 110 V. DUPLEX OUTLET |
| | = SPECIAL HEIGHT 110 V. DUPLEX OUTLET |
| | = GROUND FAULT CIRC. OUTLET |
| | = AFCI OUTLET |
| | = 110 V. SINGLE RECEPTACLE OUTLET |
| | = 220 VOLT OUTLET (4 WIRE) |
| | = FAN LOCATION (CEILING) |
| | = FAN LOCATION (EXHAUST) 35 CFM |
| | = SMOKE DETECTOR |

ELECTRICAL PLAN NOTES

-WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

-CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.


-ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.

-ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLINKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.


-TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, + IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.

-ELECTRICAL CONTR. SHALL BE RESPONSIBLE FOR THE DESIGN + SIZING OF ELECTRICAL SERVICE AND CIRCUITS.

-ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY + OWNER.

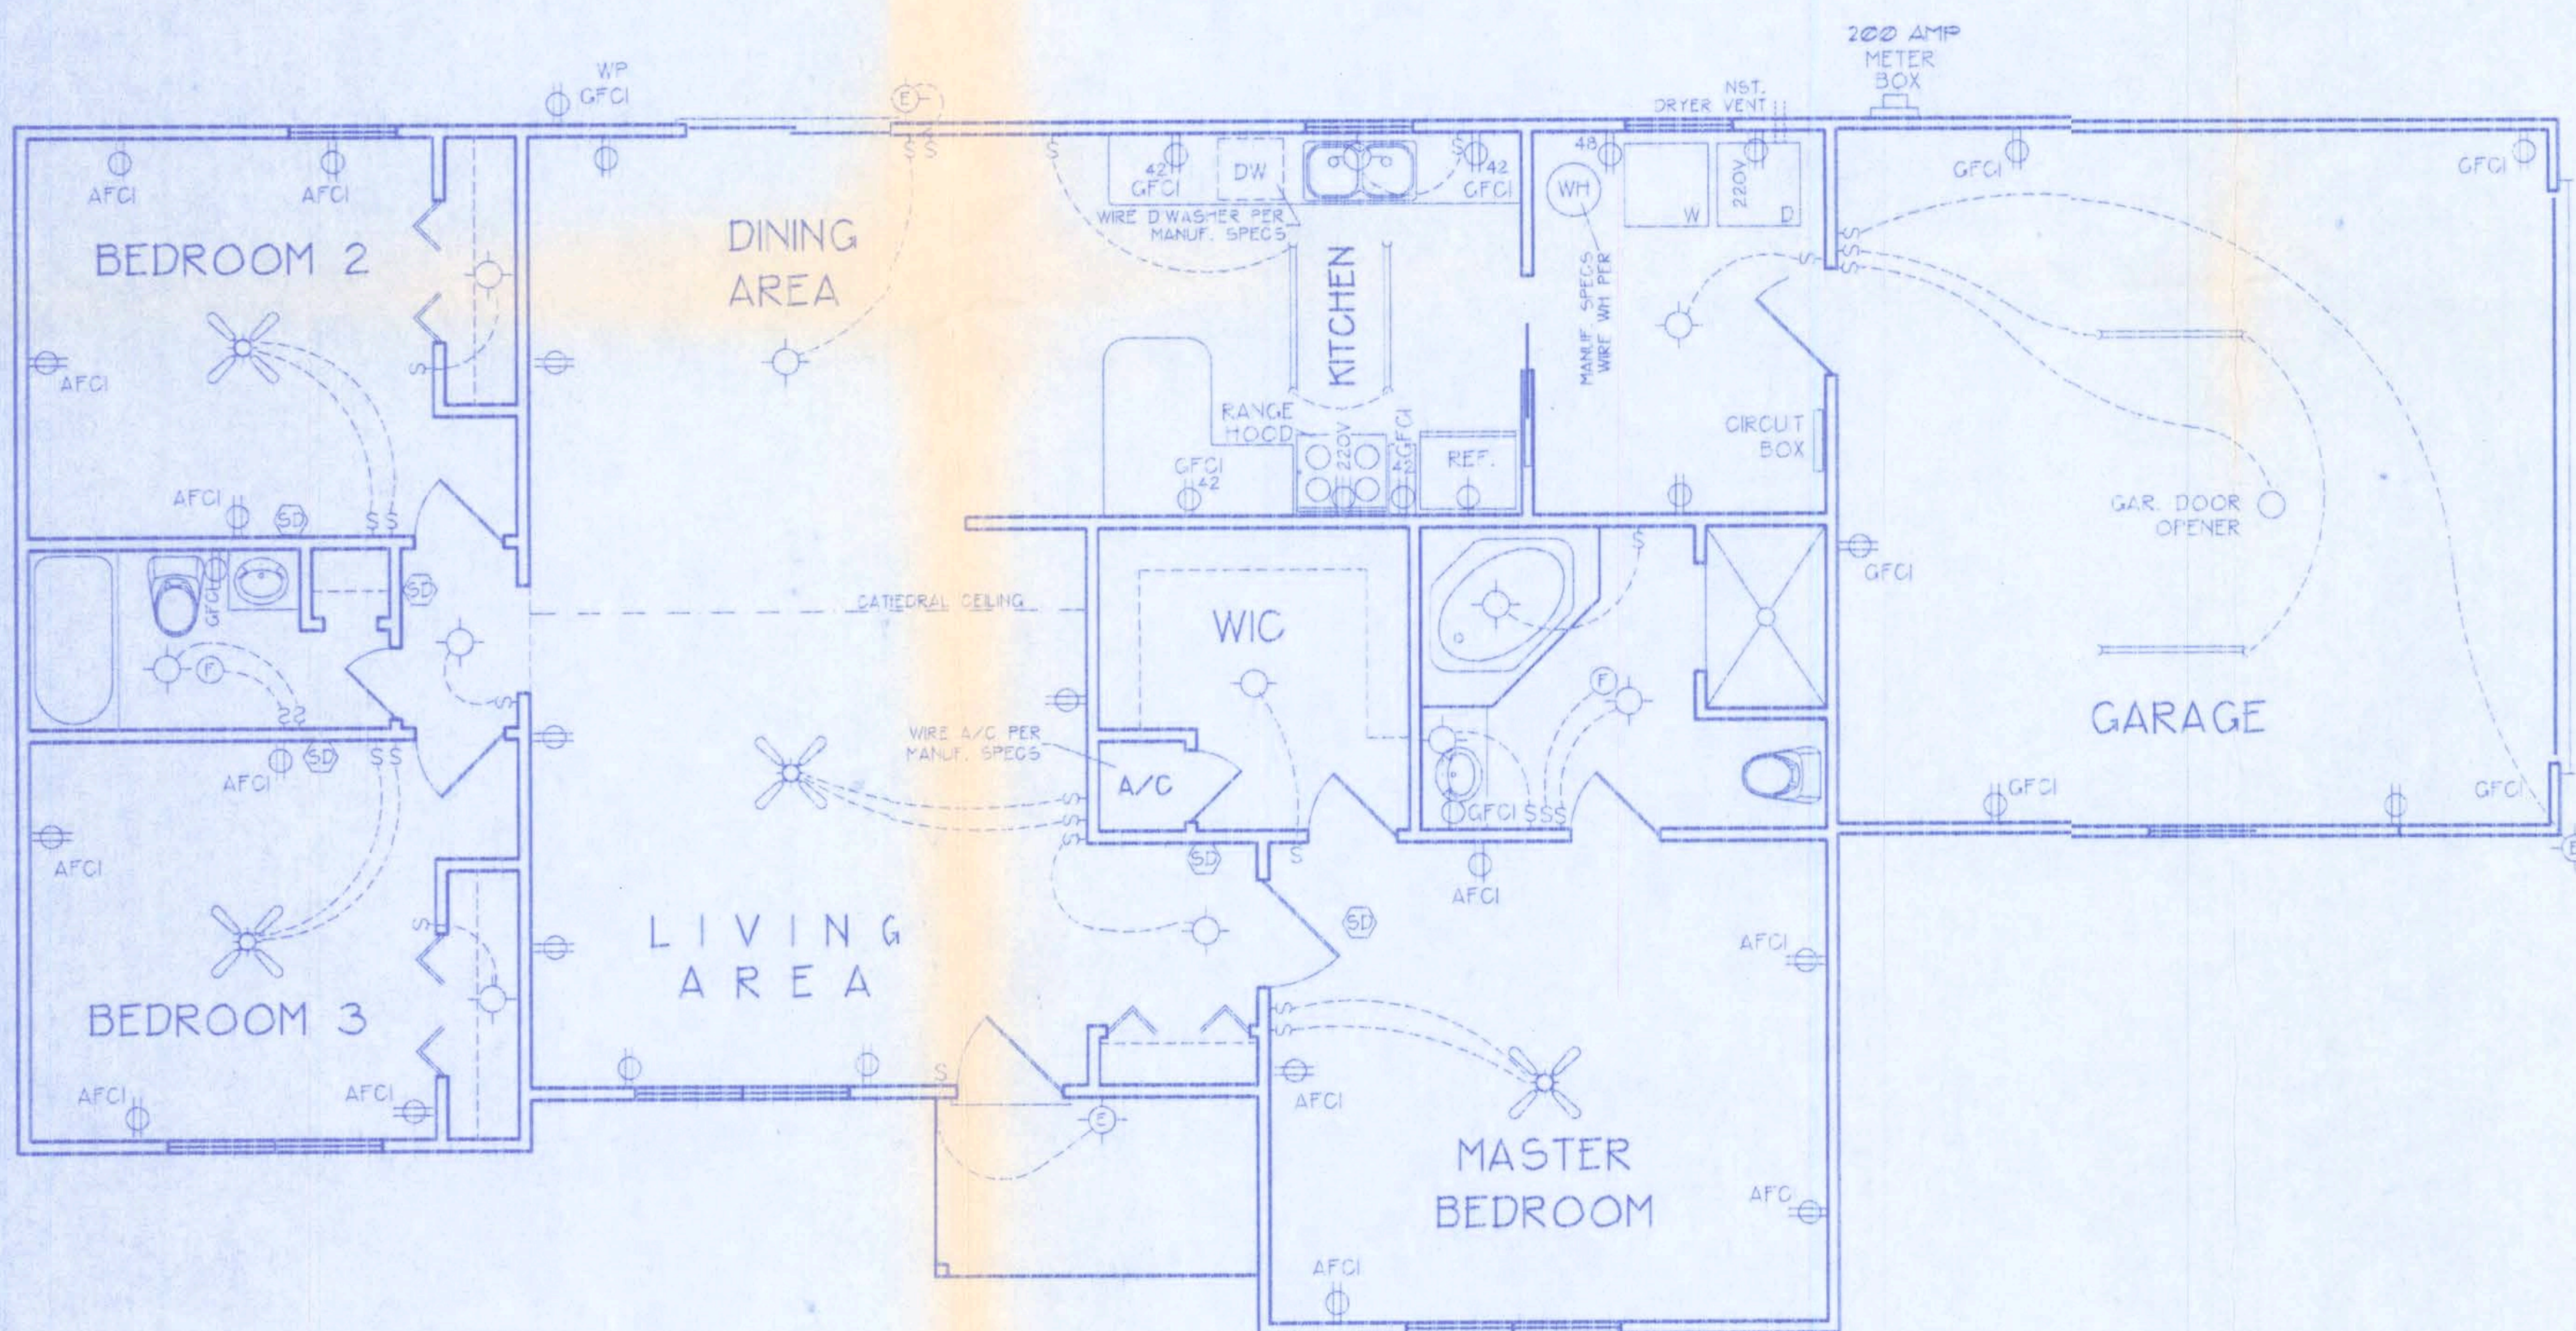

ELECTRICAL PLAN
NOT TO SCALE

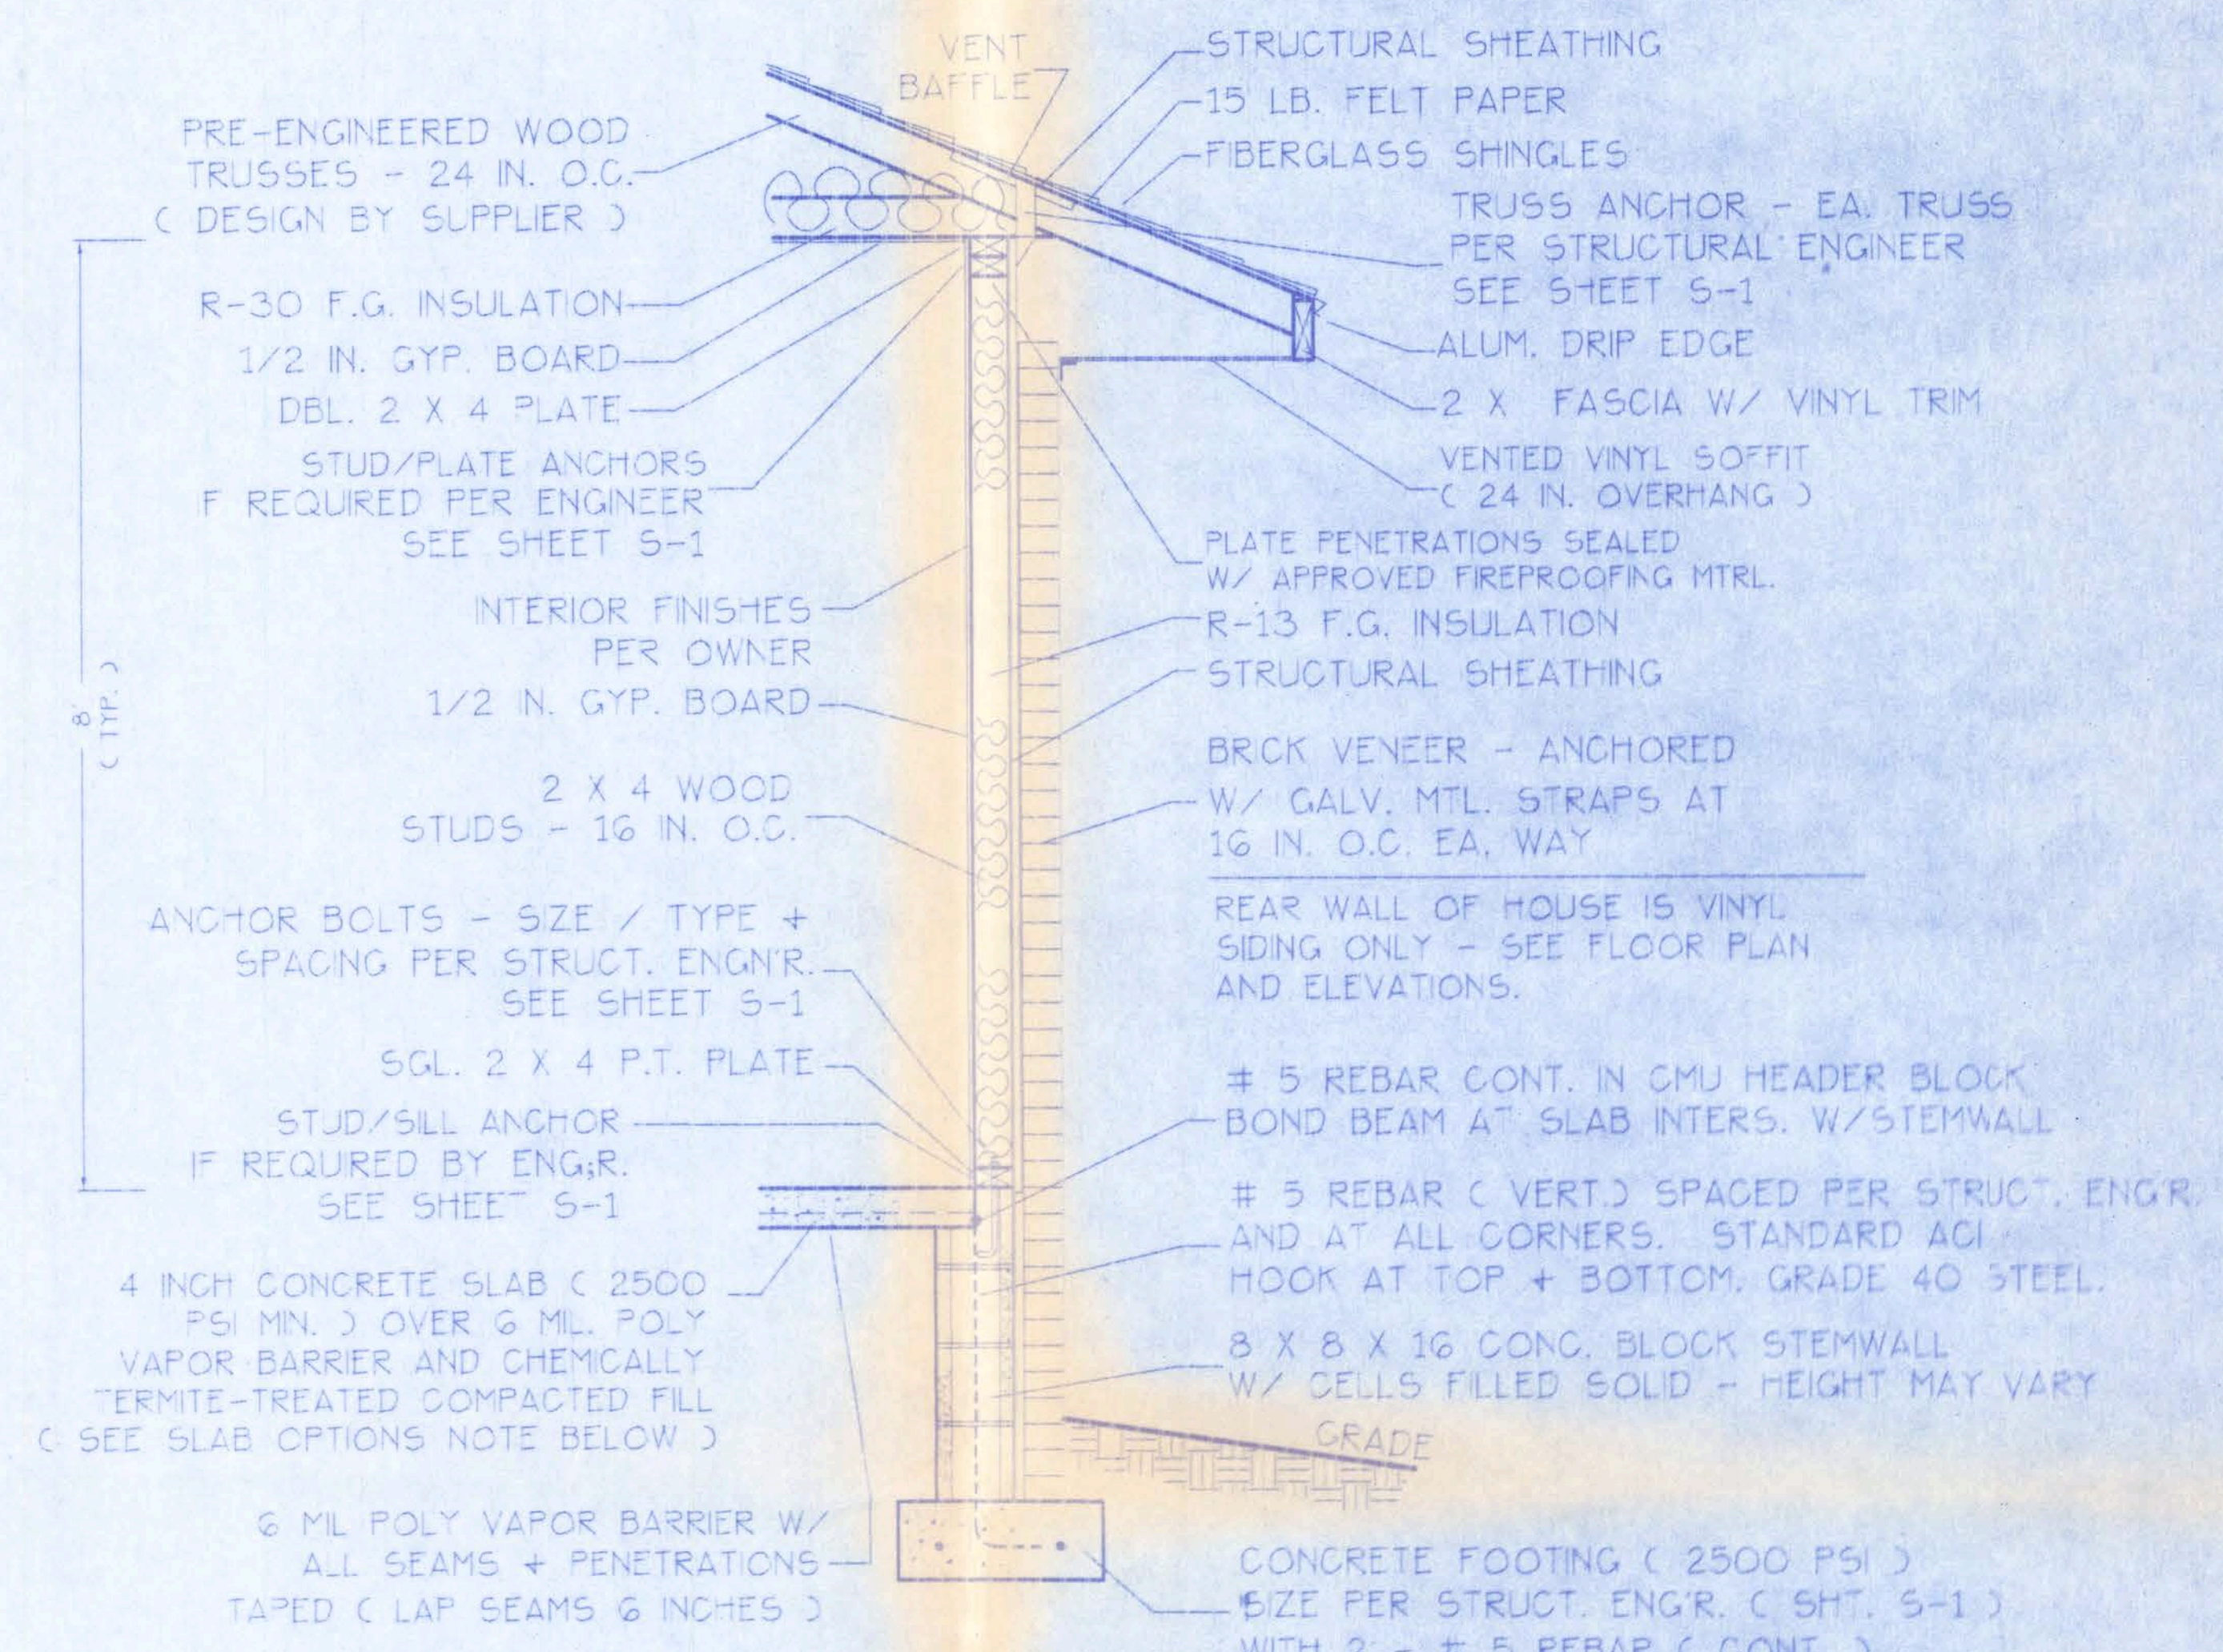

SLAB OPTIONS:

- OPTION 1 - Use 6x6 10/10 WWM reinforcing on chair supports at 3' O.C.
- OPTION 2 - Use Synthetic Fiber reinforced concrete.

WALL SECTION NOTES:

- This Typical Wall Section is for Estimating purposes only.
- All data shown in this Wall Section shall be subject to review and final input by the Structural Engineer.

DESIGN WALL SECTION

NON-STRUCTURAL DATA

SCALE: 3/4 IN. = 1 FT.

WINDLOAD ENGINEER: Mark Diasoway, PE No.53915, POB 868, Lake City, FL 32056, 386-754-5419

CERTIFICATION: These plans and "Windload Engineering", Sheet S-1, attached, comply with Florida Building Code Residential 2004, Section R301.2.1 to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location, permitted within 90 days of signature date. In case of conflict, structural requirements, scope of work, and builder responsibilities on sheet S-1 control.

Location: _____ Job No.: _____

A-3

| | | |
|------------------|--|--------------------|
| FILE: OG-004 | THE <i>Lisa</i> MODEL | SHEET: 3 OF 3 |
| DATE: 2-11-06 | | CAD FILE: OG004 |
| DRAWN: T A D | PREPARED BY: TIM DELBENE Residential Drafting + Design Rt. 4, Box 330, Lake City, FL 32055 Phone: (904) 755-5831 | REV: 10/1 |
| CHECK: T A D | | REV: |

Mark Diasoway
01/10/06

| REVISIONS | |
|-----------|--|
| | |
| | |
| | |



GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR 2004. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTION LOADS. BUILDER SHALL PROVIDE STRAP 2X4 RAFTERS WITH MIN UPLIFT CONNECTION 415# EACH END, 2X8 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN. FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1000 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, $f_c = 3000$ PSI.

WELDED WIRE REINFORCED SLAB: 6" x 8" W1.4 x W1.4, FB = 85KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.M.) CONFORMING TO ASTM A185, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH 1/2 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1118. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIO OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12 FT. DO NOT CUT W.M. OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A 615, GRADE 60, DEFORMED BARS, $F_y = 60$ KSI. ALL LAP SPLICES 40" DB (25" FOR #5 BARS); UNO. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 315-96, U.N.O.

GLULAM BEAMS: GLULAM BEAM, GLB, 24F-V3SP, $F_b = 2.4$ ksi, $E = 1800$ ksi; UNO. SUPPLIER MAY SUPPLY AN ALTERNATE BEAM WITH EQUAL PROPERTIES OR MAY SUBMIT THEIR OWN SIZING CALC. ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS; 7/16" OSB SHEATHING, UNBLOKED. APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES MEMBERS, GABLE ENDS AND DIAPHRAGM BOUNDARY, 4" OC, UNO.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CHL.

WASHERS: WASHERS USED WITH 1/2" BOLTS TO BE 2" x 2" x 9/64"; WITH 5/8" BOLTS TO BE 3" x 3" x 9/64"; WITH 3/4" BOLTS TO BE 3" x 3" x 9/64"; WITH 7/8" BOLTS TO BE 3" x 3" x 9/16"; UNO.

NAILS: ALL NAILS ARE COMMON NAILS UNLESS OTHERWISE SPECIFIED OR ACCEPTED BY FBC TEST REPORTS AS HAVING EQUAL STRUCTURAL VALUES.

BUILDER'S RESPONSIBILITY

THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.

CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.

PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR 2004 REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.

PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMTS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.

VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

ROOF SYSTEM DESIGN

THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR 2004, SECTION R301.2.1 IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, SEALED, AND STAMPED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBC 2001 REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DELEGATES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

DESIGN DATA

WIND LOADS PER FLORIDA BUILDING CODE 2004 RESIDENTIAL, SECTION R301.2.1

(ENCLOSED SIMPLE DIAPHRAGM BUILDINGS WITH FLAT, HIPPED, OR GABLE ROOFS; MEAN ROOF HEIGHT NOT EXCEEDING LEAST HORIZONTAL DIMENSION OR 60 FT; NOT ON UPPER HALF OF HILL OR ESCARPMENT 60 FT IN EXP. B, 30 FT IN EXP. C AND >10% SLOPE AND UNOBSTRUCTED UPWIND FOR 50x HEIGHT OR 1 MILE WHICHEVER IS LESS.)

BUILDING IS NOT IN THE HIGH VELOCITY HURRICANE ZONE

BUILDING IS NOT IN THE WIND-BORNE DEBRIS REGION

1.) BASIC WIND SPEED = 110 MPH

2.) WIND EXPOSURE = B

3.) WIND IMPORTANCE FACTOR = 1.0

4.) BUILDING CATEGORY = II

5.) ROOF ANGLE = 10-45 DEGREES

6.) MEAN ROOF HEIGHT = <30 FT

7.) INTERNAL PRESSURE COEFFICIENT = N/A (ENCLOSED BUILDING)

8.) COMPONENTS AND CLADDING DESIGN WIND PRESSURES (TABLE R301.2(2))

| Zone | Effective Wind Area (ft ²) | 10 | 15 | 20 |
|--|--|-------|-------|----|
| 1 | 19.9 - 21.8 | 18.1 | -18.1 | - |
| 2 | 19.9 - 25.5 | 18.1 | -21.8 | - |
| 2 Othg | - | -40.6 | -40.6 | - |
| 3 | 19.9 - 25.5 | 18.1 | -21.8 | - |
| 3 Othg | - | -68.3 | -42.4 | - |
| 4 | 21.8 - 23.6 | 18.5 | -20.4 | - |
| 5 | 21.8 - 29.1 | 18.5 | -22.6 | - |
| Doors & Windows Worst Case (Zone 5, 10 ft ²) | 21.8 | -29.1 | - | - |
| 8x7 Garage Door | 19.5 | -22.9 | - | - |
| 16x7 Garage Door | 18.5 | -21.0 | - | - |

DESIGN LOADS

| | |
|--------|--|
| FLOOR | 40 PSF (ALL OTHER DWELLING ROOMS) |
| | 30 PSF (SLEEPING ROOMS) |
| | 30 PSF (ATTICS WITH STORAGE) |
| | 10 PSF (ATTICS WITHOUT STORAGE, <3:12) |
| ROOF | 20 PSF (FLAT OR <4:12) |
| | 16 PSF (4:12 TO <12:12) |
| | 12 PSF (12:12 AND GREATER) |
| STAIRS | 40 PSF (ONE & TWO FAMILY DWELLINGS) |
| | SOIL BEARING CAPACITY 1000PSF |
| | NOT IN FLOOD ZONE (BUILDER TO VERIFY) |

WIND LOAD ENGINEER: Mark Disoway, P.E. No. 5385, P.O. Box 899, Lake City, FL 32056, 386/754-5419

DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first this express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined the plan, and that the applicable portions of the plan, relating to wind engineering comply with Section R301.2.1, Florida Building Code Residential 2004, to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY
P.E. 5385
15 MAY 2006
SEAL

Donny Williams
Spec House
Lot 4
Stonelenge S/D Phase II

ADDRESS:
Lot 4 Stonelenge S/D Phase II
Columbia County, Florida

Mak Disoway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
March 15, 2006

DRAWN BY: STRUCTURAL BY:
David Disoway

FINALS DATE:
15 / Mar / 06

JOB NUMBER:
603016
DRAWING NUMBER

S-1
OF 3 SHEETS

ANCHOR TABLE

OBTAIN UPLIFT REQUIREMENTS FROM TRUSS MANUFACTURER'S ENGINEERING

| UPLIFT LBS. SYP | UPLIFT LBS. SPF | TRUSS CONNECTOR* | TO PLATES | TO RAFTER/TRUSS | TO STUDS |
|-----------------|-----------------|------------------|----------------|-----------------|----------|
| < 420 | < 245 | H5A | 3-6d | 3-6d | |
| < 455 | < 265 | H5 | 4-6d | 4-6d | |
| < 380 | < 235 | H4 | 4-6d | 4-6d | |
| < 455 | < 320 | H3 | 4-6d | 4-6d | |
| < 415 | < 365 | H2.5 | 5-6d | 5-6d | |
| < 600 | < 535 | H2.5A | 5-6d | 5-6d | |
| < 950 | < 820 | H6 | 8-6d | 8-6d | |
| < 745 | < 565 | H8 | 5-10d, 1 1/2" | 5-10d, 1 1/2" | |
| < 1465 | < 1050 | H14-1 | 13-6d | 12-8d, 1 1/2" | |
| < 1465 | < 1050 | H14-2 | 15-6d | 12-8d, 1 1/2" | |
| < 990 | < 850 | H10-1 | 8-6d, 1 1/2" | 8-6d, 1 1/2" | |
| < 760 | < 655 | H10-2 | 6-10d | 6-10d | |
| < 1470 | < 1265 | H16-1 | 10-10d, 1 1/2" | 2-10d, 1 1/2" | |
| < 1470 | < 1265 | H16-2 | 10-10d, 1 1/2" | 2-10d, 1 1/2" | |
| < 1000 | < 860 | MTS24C | 7-10d 1 1/2" | 7-10d 1 1/2" | |
| < 1450 | < 1245 | HTS24 | 12-10d 1 1/2" | 12-10d 1 1/2" | |
| < 2900 | < 2490 | 2 - HTS24 | | | |
| < 2050 | < 1785 | LG72 | 14 - 16d | 14 - 16d | |


| HEAVY GIRDER TIEDOWNS* | | TO FOUNDATION | |
|------------------------|--------|---------------|----------|
| < 3965 | < 3330 | MGT | 22 - 10d |
| < 10980 | < 6485 | HGT-2 | 16 - 10d |
| < 10530 | < 9035 | HGT-3 | 16 - 10d |
| < 9250 | < 9250 | HGT-4 | 16 - 10d |

| STUD STRAP CONNECTOR* | | TO STUDS | |
|-----------------------|--------|-----------------------|------------------|
| < 435 | < 435 | SSP DOUBLE TOP PLATE | 3 - 10d |
| < 455 | < 420 | SSP SINGLE SILL PLATE | 1 - 10d |
| < 825 | < 825 | DSP DOUBLE TOP PLATE | 6 - 10d |
| < 825 | < 600 | DSP SINGLE SILL PLATE | 2 - 10d |
| < 885 | < 760 | SP4 | 6 - 10d, 1 1/2" |
| < 1240 | < 1065 | SPH4 | 10 - 10d, 1 1/2" |
| < 885 | < 760 | SP6 | 6 - 10d, 1 1/2" |
| < 1240 | < 1065 | SPH6 | 10 - 10d, 1 1/2" |
| < 1235 | < 1165 | LSTA18 | 14 - 10d |
| < 1235 | < 1235 | LSTA21 | 16 - 10d |
| < 1030 | < 1030 | CS20 | 18 - 8d |
| < 1705 | < 1705 | CS16 | 28 - 8d |


| STUD ANCHORS* | | TO STUDS | |
|---------------|--------|----------|------------------|
| < 1350 | < 1305 | LTT19 | 8 - 16d |
| < 2310 | < 2310 | LTT31 | 18 - 10d, 1 1/2" |
| < 2775 | < 2570 | HD2A | 2 - 5/8" BOLTS |
| < 4175 | < 3695 | HTT16 | 18 - 16d |
| < 1400 | < 1400 | PAH242 | 16 - 16d |
| < 3335 | < 3335 | HPAH222 | 16 - 16d |
| < 2200 | < 2200 | ABU44 | 12 - 16d |
| < 2300 | < 2300 | ABU66 | 12 - 16d |
| < 2320 | < 2320 | ABU88 | 18 - 16d |

*SEE STRUCTURAL PLAN FOR DETAILS


TYPICAL GABLE END (X-BRACING)

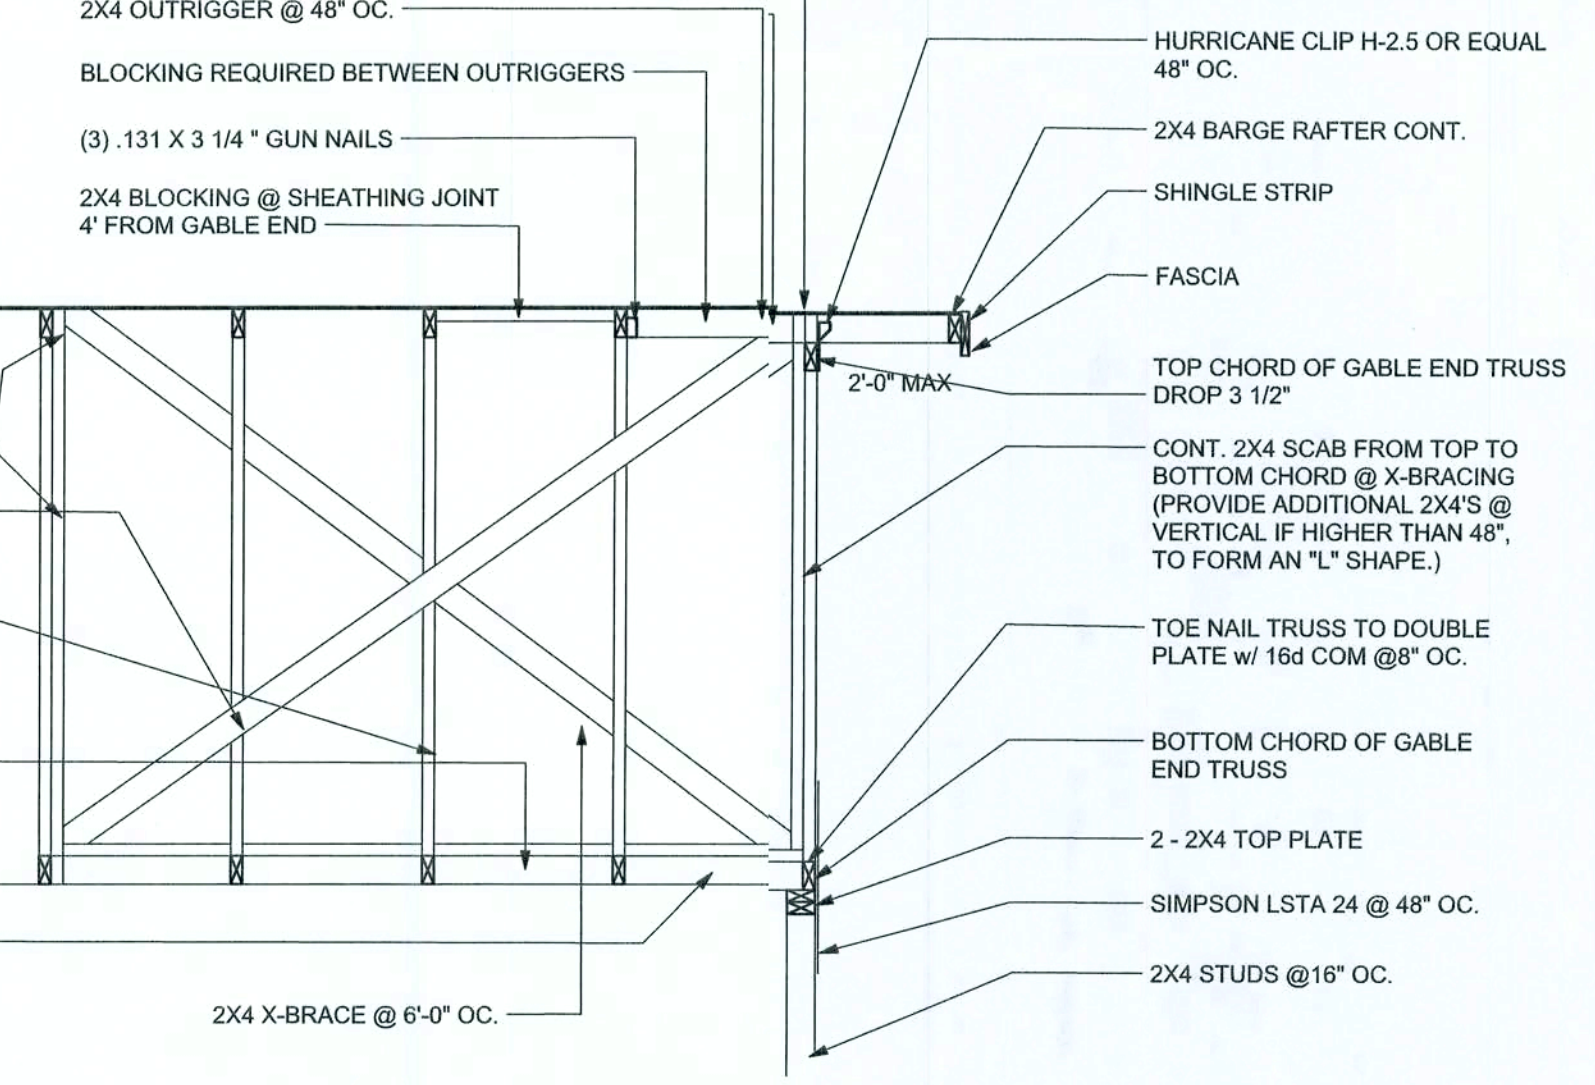


REVISIONS

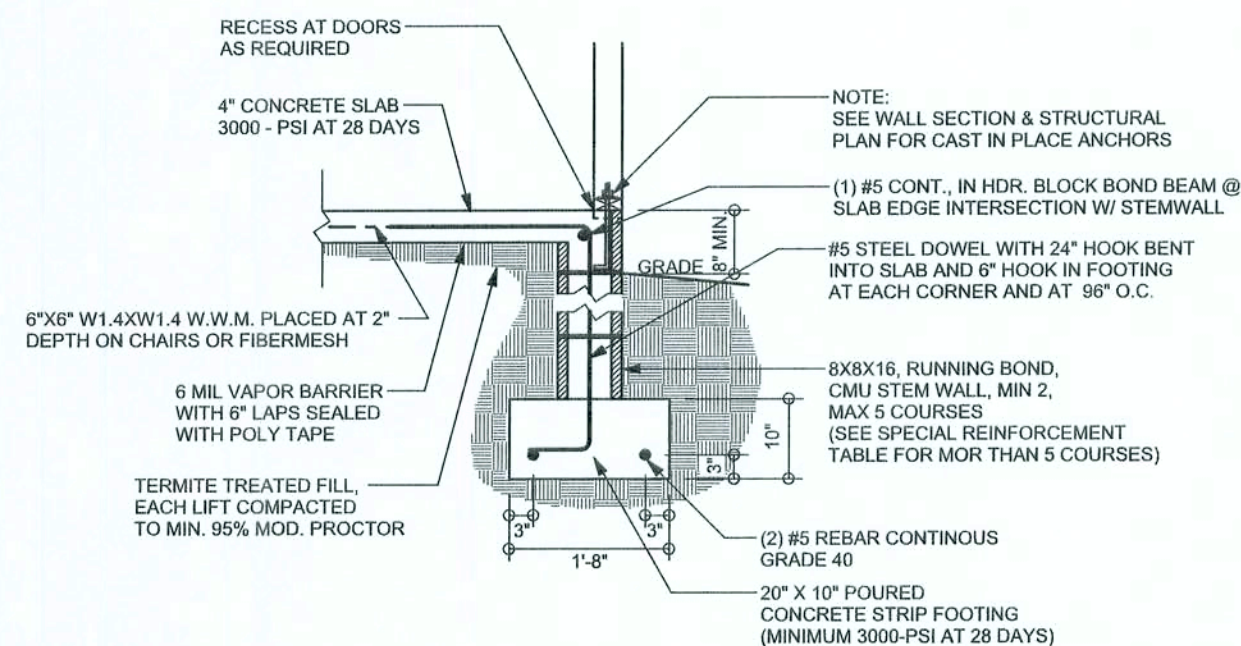SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE


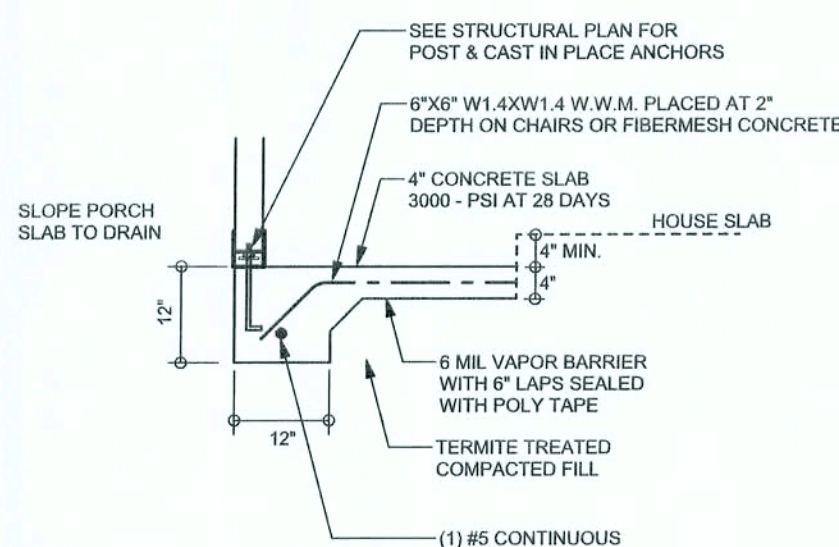
F9 S-2 STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

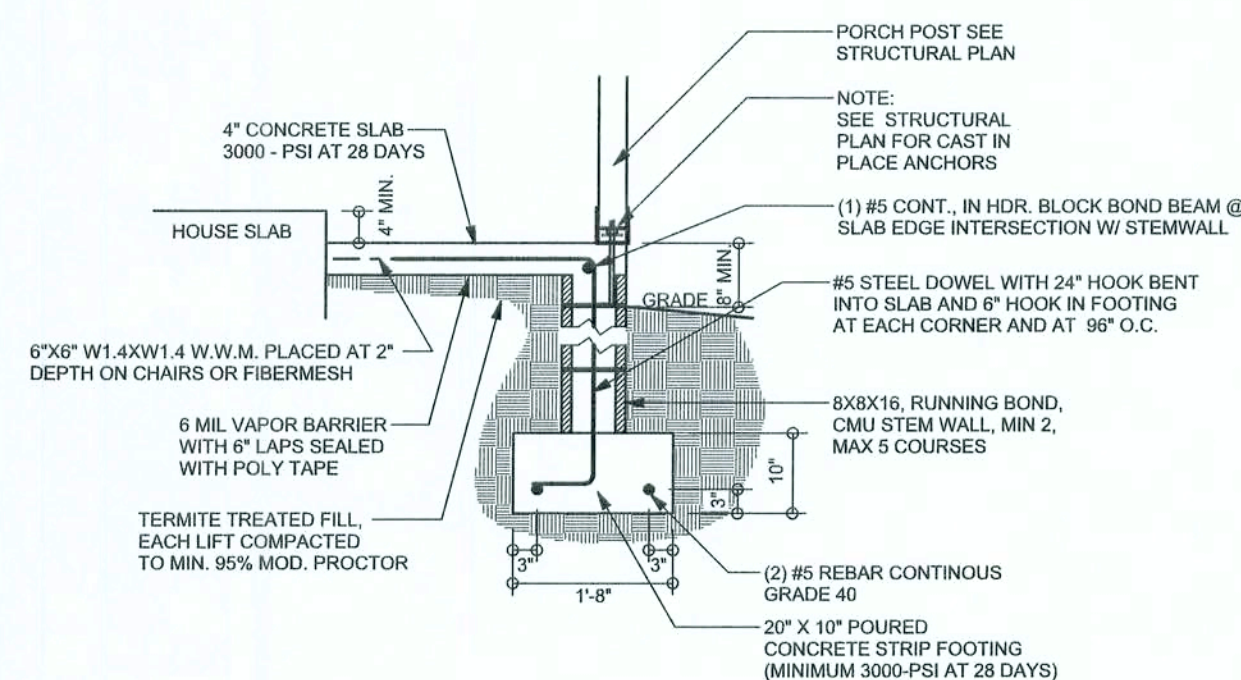


F12 S-2 ALT. STEM WALL PORCH FOOTING
SCALE: 1/2" = 1'-0"

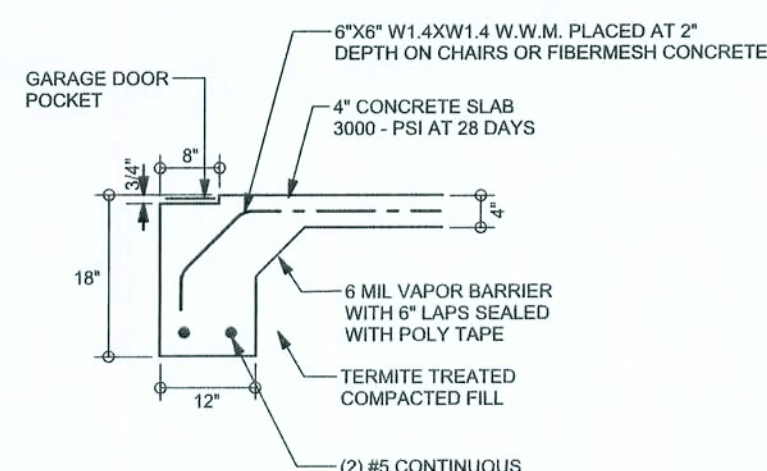

F13 S-2 ALT. STEM WALL GARAGE DOOR FOOTING
SCALE: 1/2" = 1'-0"



F5 S-2 PORCH FOOTING
SCALE: 1/2" = 1'-0"

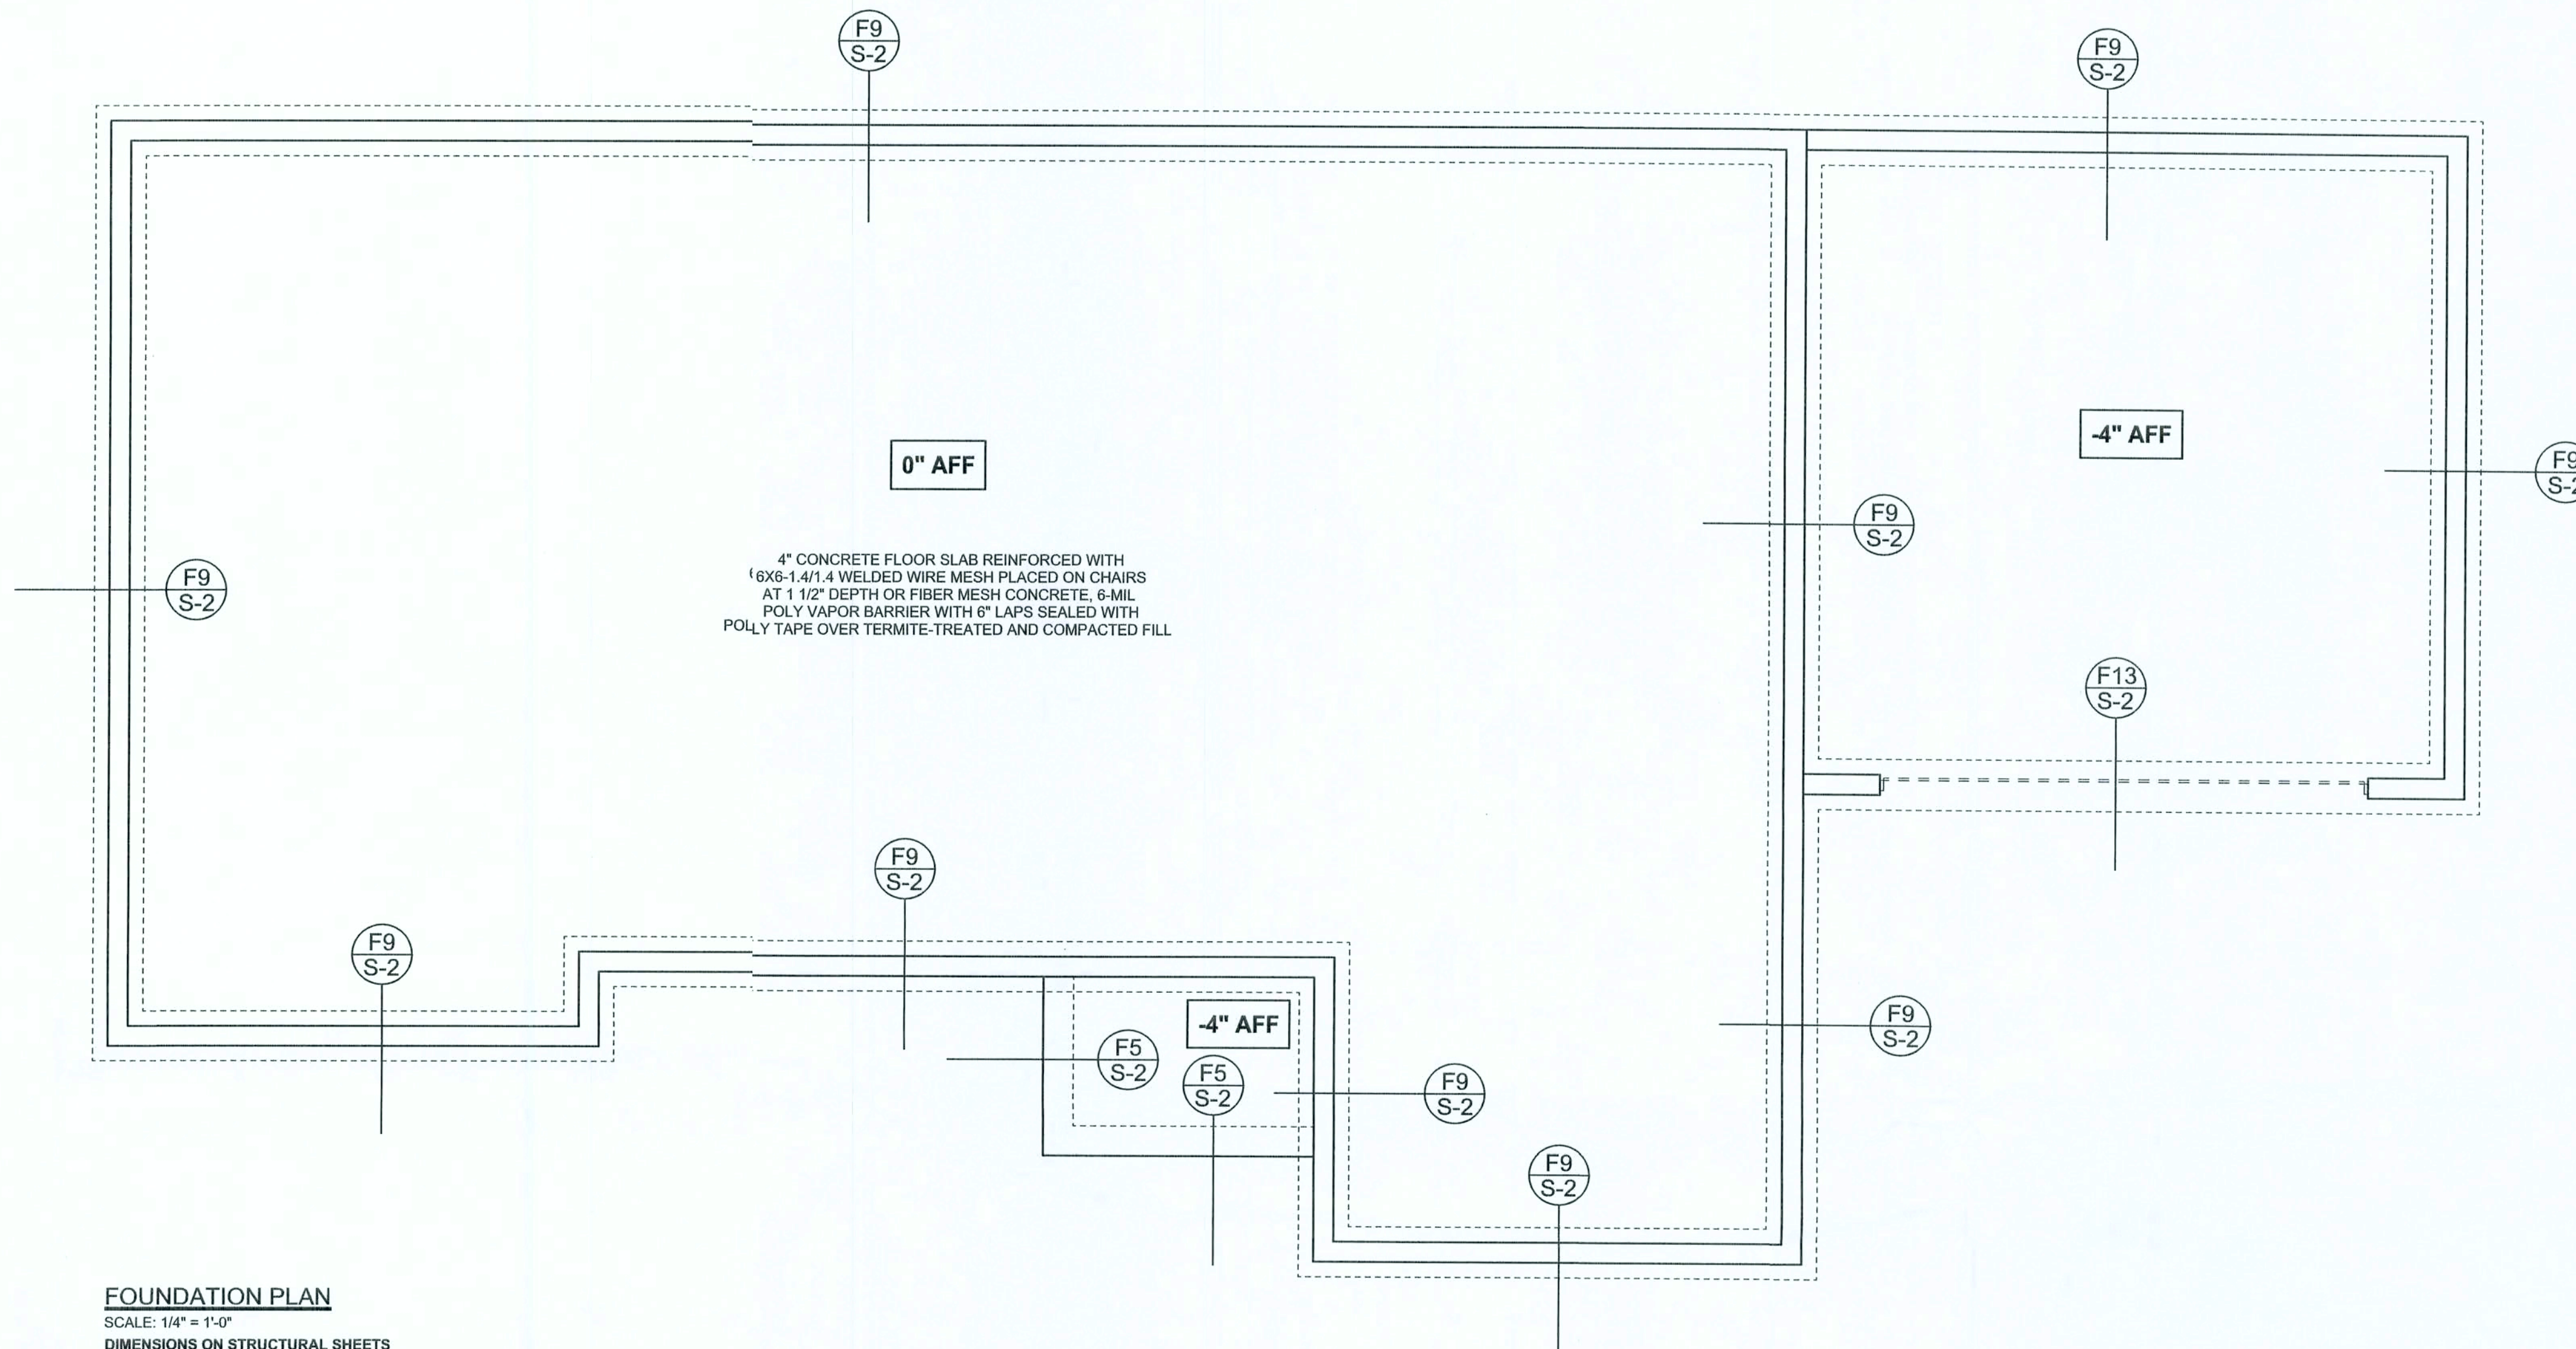

FOUNDATION PLAN
SCALE: 1/4" = 1'-0"
DIMENSIONS ON STRUCTURAL SHEETS
ARE NOT EXACT. REFER TO ARCHITECTURAL
FLOOR PLAN FOR ACTUAL DIMENSIONS

WINDLOAD ENGINEER: Mark Discosway,
PE No.53915, 808 868, Lake City, FL
32056, 386-75-5419

DIMENSIONS:
Stated dimensions supercede scaled
dimensions. Refer all questions to
Mark Discosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Discosway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Discosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable
portions of the plan, relating to wind engineering
comply with section R301.2.1, Florida building
code residential 2004, to the best of my
knowledge.

LIMITATION: This design is valid for one
building, at specified location.

MARK DISCOSWAY
P.E. 53915

Mark Discosway
SEAL

Dorny Williams

Spec House
Lot 4
Stonehenge S/D Phase II

ADDRESS:
Lot 4 Stonehenge S/D Phase II
Columbia County, Florida

Mark Discosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
March 15, 2006

DRAWN BY: STRUCTURAL BY:
David Discosway

FINALS DATE:
15 / Mar / 06



JOB NUMBER:
603016

DRAWING NUMBER
S-2

OF 3 SHEETS

REVISIONS

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

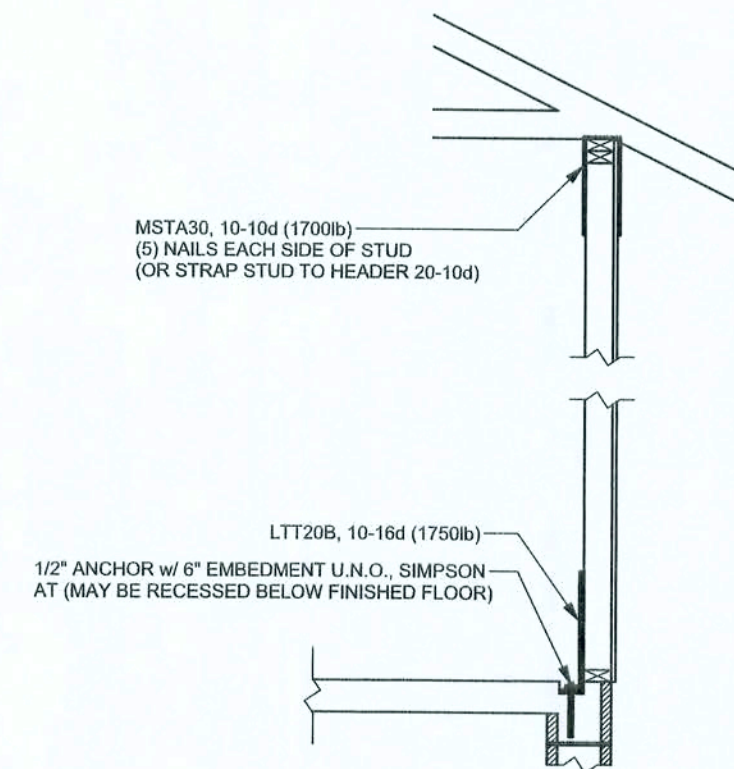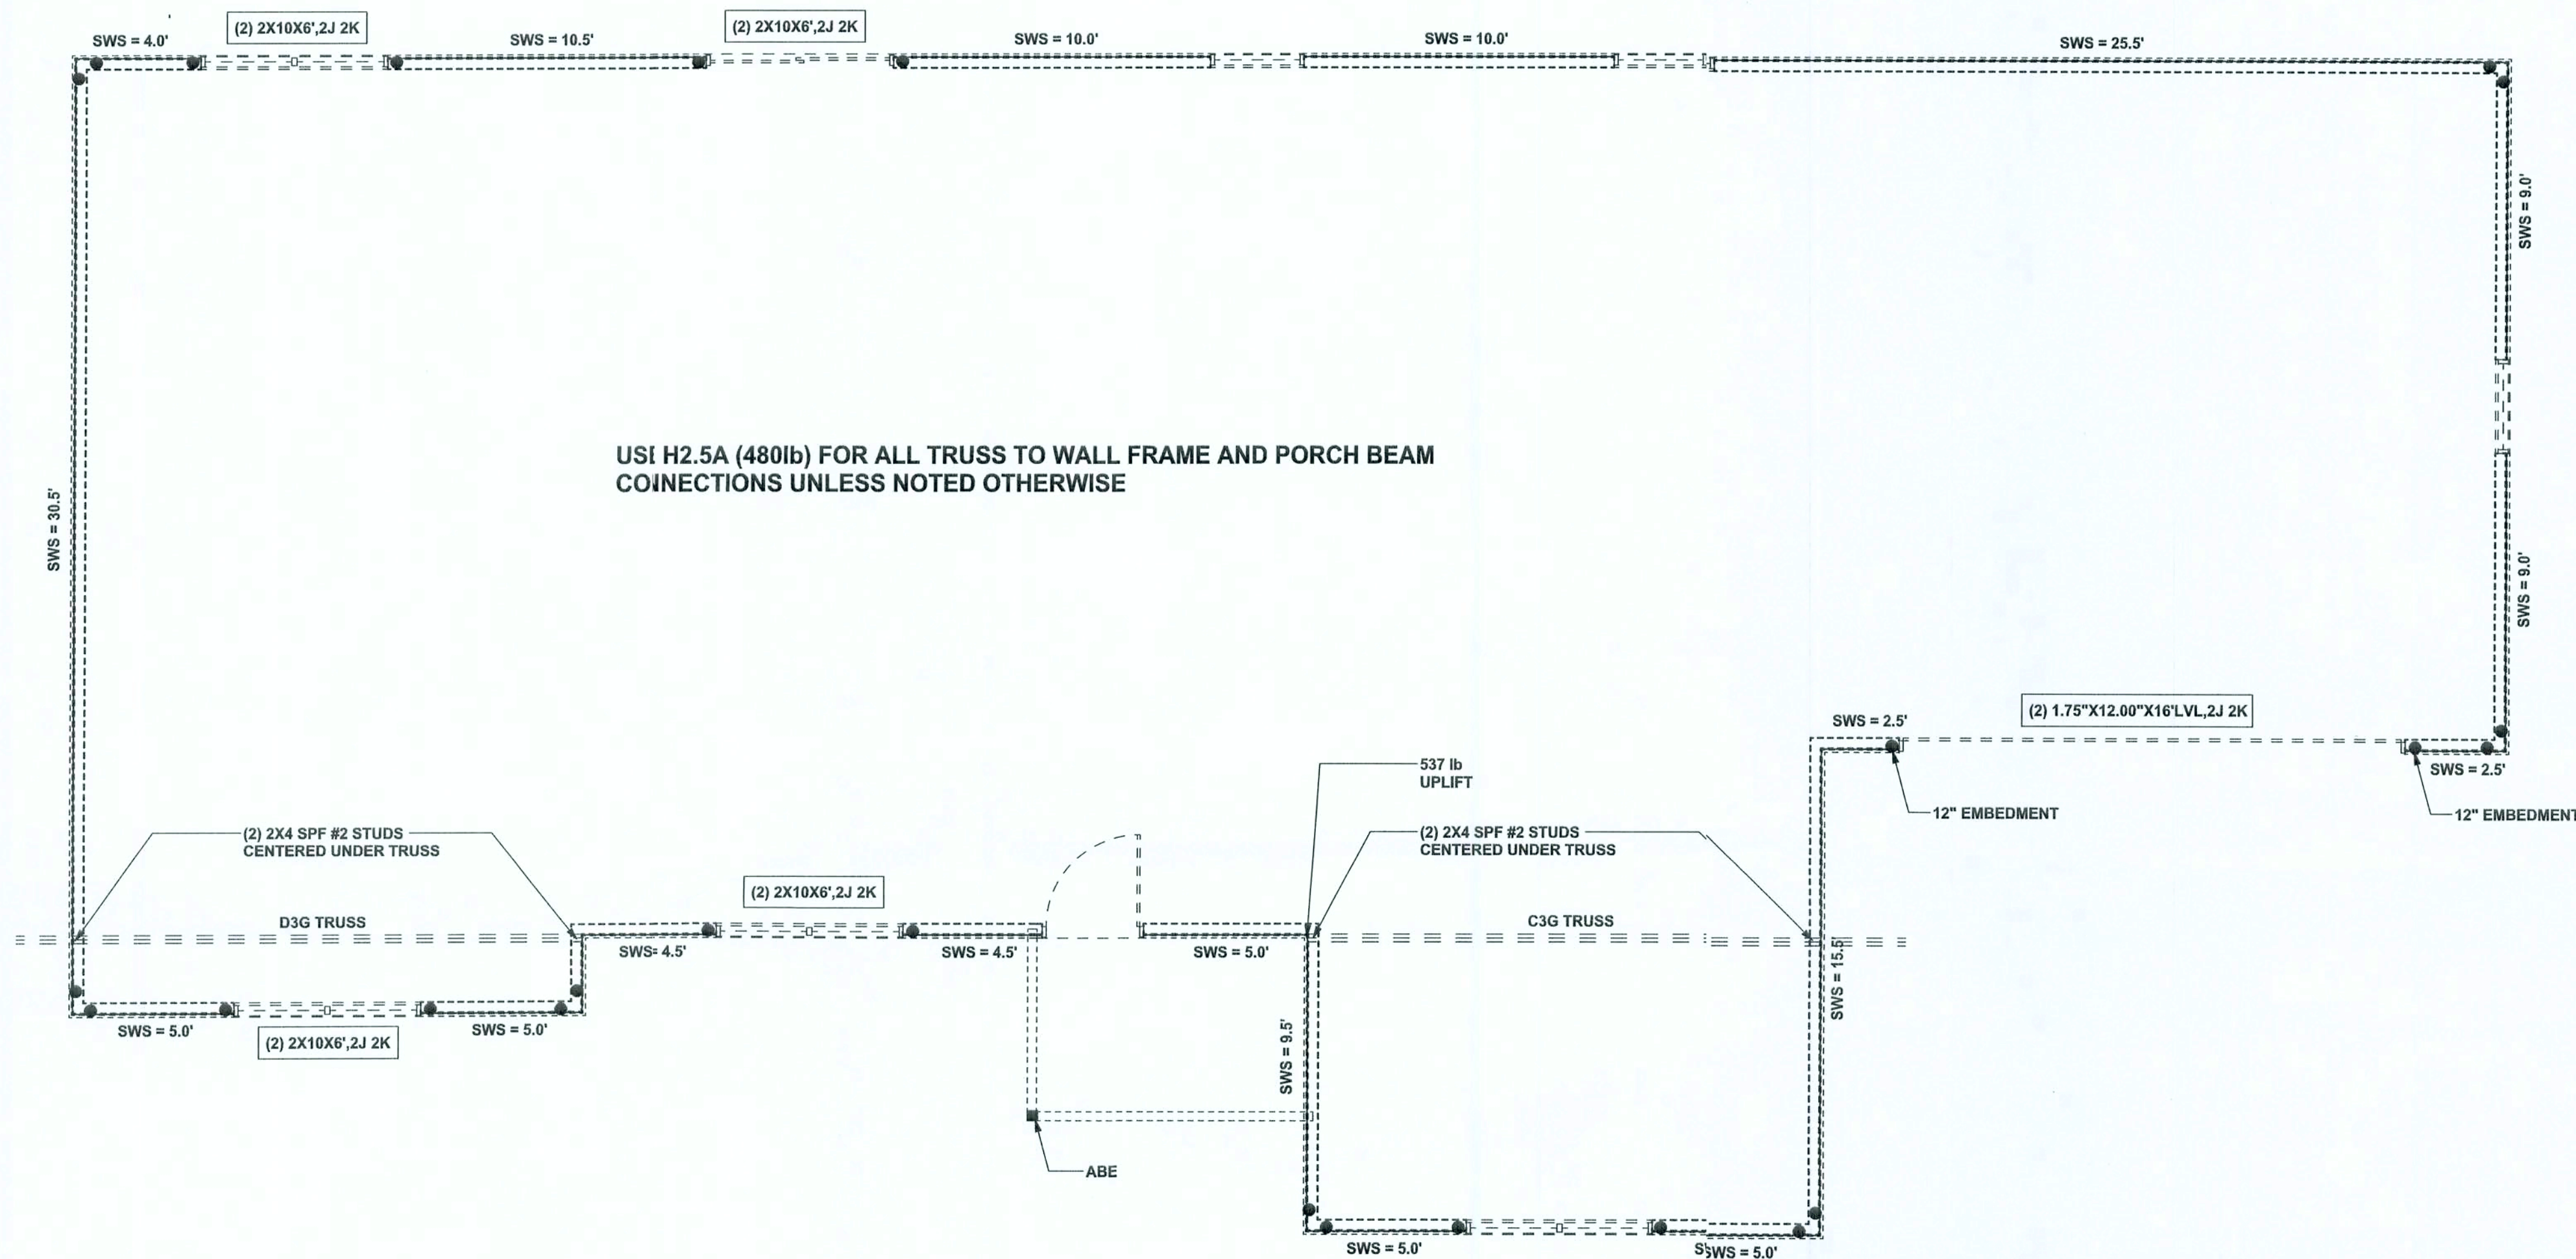

ALTERNATE WALL TIE CONNECTION WHERE
THREADED ROD CANNOT BE PLACED IN WALL.
SCALE: 1/2" = 1'-0"

STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

TOTAL SHEAR WALL SEGMENTS

SWS = 0.0' INDICATES SHEAR WALL SEGMENTS

| | REQUIRED | ACTUAL |
|--------------|----------|--------|
| TRANSVERSE | 35.2' | 73.5' |
| LONGITUDINAL | 28.5' | 99.0' |

STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X10 SYP#2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-4 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI-03, BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

WALL LEGEND

| | |
|------------|--|
| SWS = 0.0' | 1ST FLOOR EXTERIOR WALL |
| SWS = 0.0' | 2ND FLOOR EXTERIOR |
| IBW | 1ST FLOOR INTERIOR BEARING WALLS SEE DETAILS ON SHEET S-1 |
| IBW | 2ND FLOOR INTERIOR BEARING WALLS SEE DETAILS ON SHEET S-1 |

THREADED ROD LEGEND

- INDICATES LOCATION OF:
1ST FLOOR 1/2" A307 ALL THREADED ROD
- INDICATES LOCATION OF:
2ND FLOOR 1/2" A307 ALL THREADED ROD

HEADER LEGEND

- (2) 2X10X0' 1J 1K
- HEADER/BEAM CALL-OUT (U.N.O.)
- NUMBER OF KING STUDS (FULL LENGTH)
- NUMBER OF JACK STUDS (UNDER HEADER)
- SPAN OF HEADER
- SIZE OF HEADER MATERIAL
- NUMBER OF PLIES IN HEADER

CONNECTIONS, WALL, & HEADER DESIGN IS BASED
ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING
FURNISHED BY BUILDER, ANDERSON TRUSS CO.
(JOB #6-082)

WINDLOAD ENGINEER: Mark Disosway,
P.E. No. 53115, P.O. Box 868, Lake City, FL
32056, 386-754-5419

DIMENSIONS:
Stated dimensions supersede scaled
dimensions. Refer all questions to
Mark Disosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves
its common law copyright and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable
portions of the plan, relating to wind engineering
comply with section F301.2.1, Florida building
code, residential 2004, to the best of my
knowledge.

LIMITATION: This design is valid for one
building, a specified location.

MARK DISOSWAY
P.E. 53115

Tonny Williams
Spec House
Lot 4
Stonehenge S/D Phase II

ADDRESS:
Lot - Stonehenge S/D Phase II
Columbia County, Florida

Mark Disosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
March 15, 2006

DRAWN BY: STRUCTURAL BY:
David Disosway

FINAL DATE:
15 / Mar / 06

JOB NUMBER:
603016

DRAWING NUMBER
S-3

OF 3 SHEETS