

REVISIONS



GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBC 2001. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS TO TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED AND SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN UPLIFT CONNECTION 415LB EACH END, 2X6 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN.

FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1000 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, $F_c = 3000$ PSI.

WELDED WIRE REINFORCED SLAB: 6" x 6" W1.4 x W1.4, FB = 85KSI, WELDED WIRE REINFORCEMENT FABRIC 10 M.M. CONFORMING TO ASTM A185, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH 1/2 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD. PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN WITHIN RATIOS OF SLAB AREAS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 10FT. DO NOT CUT W/M OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE).

REBAR: ASTM A 615, GRADE 60, DEFORMED BARS, $F_y = 60$ KSI, ALL LAP SPLICES 48" DB (30" FOR #5 BARS); UNO. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 315-96, U.N.O.

GLULAM BEAMS: GLULAM BEAM, GLB, 24F-V3SP, $F_b = 2.4$ ksi, $E = 1800$ ksi; UNO. SUPPLIER MAY SUPPLY AN ALTERNATE BEAM WITH EQUAL PROPERTIES OR MAY SUBMIT THEIR OWN SIZING CALC.

ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS; 7/16" OSB SHEATHING, UNLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED, FASTENED WITH 8d COMMON NAILS (131), 6" OC PANEL EDGES, 12" OC INTERMEDIATE MEMBERS, GABLE ENDS AND DIAPHRAGM BOUNDARY, 4" OC, UNO.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.

WASHERS: WASHERS USED WITH 1/2" BOLTS TO BE 2" x 2" x 9/64"; WITH 5/8" BOLTS TO BE 3" x 3" x 9/64"; WITH 3/4" BOLTS TO BE 3" x 3" x 9/64"; WITH 7/8" BOLTS TO BE 3" x 3" x 5/16"; UNO.

NAILS: ALL NAILS ARE COMMON NAILS UNLESS OTHERWISE SPECIFIED OR ACCEPTED BY FBC TEST REPORTS AS HAVING EQUAL STRUCTURAL VALUES.

BUILDER'S RESPONSIBILITY

THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.

CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.

PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBC 2001 REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.

PROVIDE A CONTINUOUS LAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMMITS A CONTINUOUS LAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.

VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

ROOF SYSTEM DESIGN

THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBC 2001, SECTION 1606.2 IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBC 2001 REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

DESIGN DATA

WIND LOADS PER FLORIDA BUILDING CODE 2001, SECTION 1606.2

(ENCLOSED SIMPLE DIAPHRAGM BUILDINGS WITH FLAT, HIPPED, OR GABLE ROOFS; MEAN ROOF HEIGHT NOT EXCEEDING LEAST HORIZONTAL DIMENSION OR 60 FT; NOT ON UPPER HALF OF HILL OR ESCARPMENT 80FT IN EXP. B, SOFT IN EXP. C AND >10% SLOPE AND UNOBSTRUCTED UPWIND FOR 50x HEIGHT OR 1 MILE WHICHEVER IS LESS.)

BUILDING IS NOT IN THE HIGH VELOCITY HURRICANE ZONE

BUILDING IS NOT IN THE WIND-BORNE DEBRIS REGION

1.) BASIC WIND SPEED = 110 MPH

2.) WIND EXPOSURE = B

3.) WIND IMPORTANCE FACTOR = 1.0

4.) BUILDING CATEGORY = II

5.) ROOF ANGLE = 10-45 DEGREES

6.) MEAN ROOF HEIGHT = <30 FT

7.) INTERNAL PRESSURE COEFFICIENT = N/A (ENCLOSED BUILDING, 1606.2)

8.) COMPONENTS AND CLADDING DESIGN WIND PRESSURES (FBC TABLE 1606.2 B&C)

Zone	Effective Wind Area (ft ²)	10	100
1	19.9 -21.8	18.1	-18.1
2	19.9 -25.5	18.1	-21.8
2 On	-	-40.6	-40.6
3	19.9 -25.5	18.1	-21.8
3 On	-	-42.4	-42.4
4	21.8 -23.6	18.5	-20.4
5	21.8 -29.1	18.5	-22.6
Doors & Windows (Zone 5, 10 R2)		21.8	-29.1
8x7 Garage Door	19.5	-22.9	
16x7 Garage Door	18.5	-21.0	

DESIGN LOADS

FLOOR 40 PSF (ALL OTHER DWELLING ROOMS)

30 PSF (SLEEPING ROOMS)

30 PSF (ATTICS WITH STORAGE)

10 PSF (ATTICS WITHOUT STORAGE, <3:12)

ROOF 20 PSF (FLAT OR <4:12)

16 PSF (4:12 TO <12:12)

12 PSF (12:12 AND GREATER)

STAIRS 40 PSF (ONE & TWO FAMILY DWELLINGS)

SOIL BEARING CAPACITY 1000PSF

NOT IN FLOOD ZONE (BUILDER TO VERIFY)


ANCHOR TABLE

OBTAIN UPLIFT REQUIREMENTS FROM TRUSS MANUFACTURER'S ENGINEERING


UPLIFT LBS. SYP	UPLIFT LBS. SPF	TRUSS CONNECTOR*	TO PLATES	TO RAFTER/TRUSS	TO STUDS
< 420	< 245	H5A	3-8d	3-8d	
< 455	< 265	H5	4-8d	4-8d	
< 380	< 235	H4	4-8d	4-8d	
< 455	< 320	H3	4-8d	4-8d	
< 415	< 365	H2.5	5-8d	5-8d	
< 600	< 535	H2.5A	5-8d	5-8d	
< 950	< 820	H6	8-8d	8-8d	
< 745	< 565	H8	5-10d, 1 1/2"	5-10d, 1 1/2"	
< 1465	< 1050	H14-1	13-8d	12-8d, 1 1/2"	
< 1465	< 1050	H14-2	15-8d	12-8d, 1 1/2"	
< 990	< 850	H10-1	8-8d, 1 1/2"	8-8d, 1 1/2"	
< 760	< 655	H10-2	6-10d	6-10d	
< 1470	< 1265	H16-1	10-10d, 1 1/2"	2-10d, 1 1/2"	
< 1470	< 1265	H16-2	10-10d, 1 1/2"	2-10d, 1 1/2"	
< 1000	< 860	MTS24C	7-10d 1 1/2"	7-10d 1 1/2"	
< 1450	< 1245	HTS24	12-10d 1 1/2"	12-10d 1 1/2"	
< 2900	< 2490	2 - HTS24			
< 2050	< 1785	LG2	14 -16d	14 -16d	
HEAVY GIRDER TIEDOWNS*					
< 3965	< 3330	MG1		22 -10d	1-5/8" THREADED ROD 12" EMBEDMENT
< 10980	< 6485	HGT-2		16 -10d	2-5/8" THREADED ROD 12" EMBEDMENT
< 10530	< 8035	HGT-3		16 -10d	2-5/8" THREADED ROD 12" EMBEDMENT
< 9250	< 8250	HGT-4		16 -10d	2-5/8" THREADED ROD 12" EMBEDMENT
STUD STRAP CONNECTOR*					
< 435	< 435	SSP DOUBLE TOP PLATE	3 -10d		4 -10d
< 455	< 420	SSP SINGLE SILL PLATE	1 -10d		4 -10d
< 825	< 825	DSP DOUBLE TOP PLATE	6 -10d		8 -10d
< 825	< 600	DSP SINGLE SILL PLATE	2 -10d		8 -10d
< 885	< 760	SP4		6 -10d, 1 1/2"	
< 1240	< 1065	SPH4		10 -10d, 1 1/2"	
< 885	< 760	SP6		6 -10d, 1 1/2"	
< 1240	< 1065	SPH6		10 -10d, 1 1/2"	
< 1235	< 1165	LSTA18	14 -10d		
< 1235	< 1235	LSTA21	16 -10d		
< 1030	< 1030	CS30	18 -8d		
< 1705	< 1705	CS16	28 -8d		
STUD ANCHORS*					
< 1350	< 1305	LTT19	8 -16d		1/2" AB
< 2310	< 2310	LTT31	18 -10d, 1 1/2"		1/2" AB
< 2775	< 2570	HD2A	2-5/8" BOLTS		5/8" AB
< 4175	< 3695	HTT16	18 - 16d		5/8" AB
< 1400	< 1400	PAHD42	16 -16d		
< 3335	< 3335	HPAHD22	16 -16d		
< 2200	< 2200	ABU44	12 -16d		1/2" AB
< 2300	< 2300	ABU66	12 -16d		1/2" AB
< 2320	< 2320	ABU88	18 - 16d		2-5/8" AB

TYPICAL GABLE END (X-BRACING)


ALL MEMBERS SHALL BE SYP

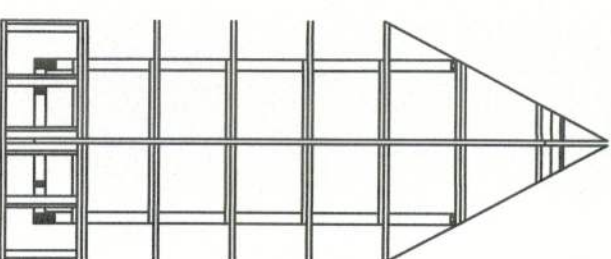

FRAMING PLAN

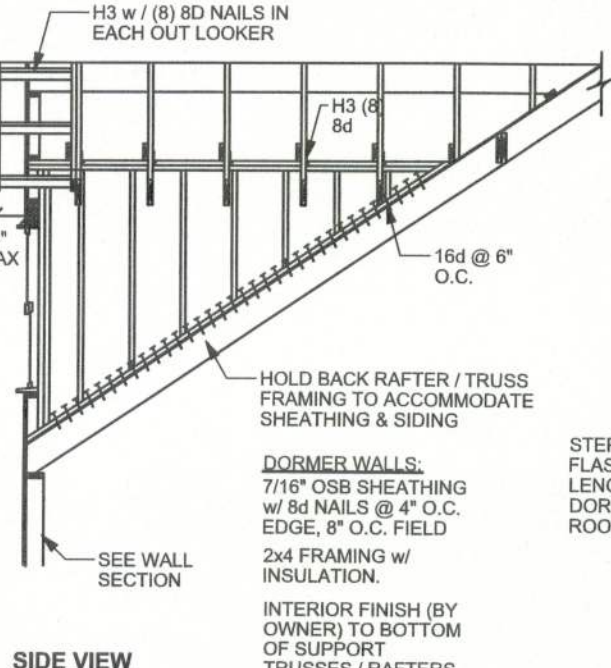

SIDE VIEW

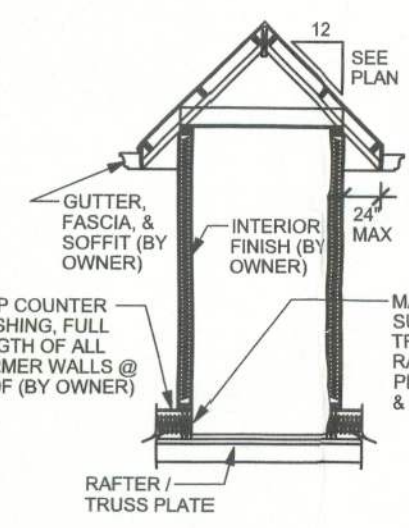

FRONT VIEW

DORMER ANCHORING DETAIL

SCALE: N.T.S.

FOR LESS THAN 1500 lb UPLIFT USE
2 X 2 X 1/8" WASHER w/ 1/2" HEX NUT
FOR LESS THAN 3750 lb UPLIFT USE
3 X 3 X 1/8" WASHER

NAIL SHEATHING TO HEADER AND TOP PLATE WITH 8d AT 3" O.C. FOR UPLIFT

(7) .131 x 3 1/4" GUN NAILS
TOE NAILED THRU SILL
INTO KING STUD

(5) .131 x 3 1/4" GUN NAILS
TOE NAILED THRU SILL
INTO JACK STUD U.N.O.

NOTE:
TYPICAL STRAPPING (U.N.O.)
(SEE STRUCTURAL PLAN)

(1) 2X8 SPF #2 SILL UP TO 7'-6" U.N.O.
(2) 2X4 SPF #2 SILL UP TO 7'-8" U.N.O.
(1) 2X4 SPF #2 SILL UP TO 5'-1" U.N.O.
(FOR: 120 MPH, 10'-0" WALL HEIGHT U.N.O.)

TYPICAL 1 STORY HEADER STRAPPING DETAIL

SCALE: 1/2" = 1'-0"

CONTINUOUS FRAME TO CEILING DIAPHRAGM DETAIL

SCALE: N.T.S.



DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS

ALL STUDS TO BE 2X4 SPF NAILED TO TOP AND BOTTOM PLATES WITH 2-16d NAILS

DOUBLE 2X4 SPF TOP PLATE NAILED TOGETHER W/2-16d NAILS AT 16" O.C.
4" MIN. LAP W/ (12) - 16d OR 4" LAP W/ CS20 w/ (4) - 16d AT (14) - 10d

INTERIOR CEILING AS SPECIFIED ON FLOOR PLAN

CONTINUOUS FRAME TO TOP PLATE AT BOTTOM CHORD OF TRUSS

PRE ENGINEERED ROOF TRUSS