


These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

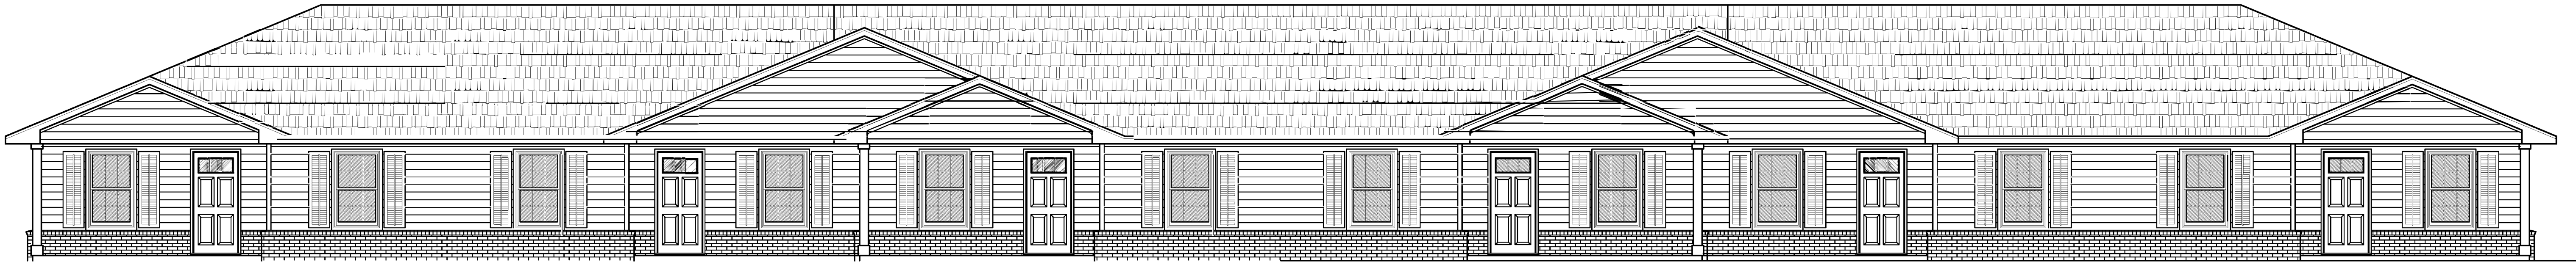

6 Unit Apartment Building for: Blake Lundy Construction

Lake City, Florida

| Drawing Index | | | |
|---------------|----------------------------|----|--|
| C6.1 | COVER SHEET, DRAWING INDEX | A3 | ENLARGED FLOOR PLAN, ELECTRICAL DATA, DIMENSIONS |
| | | A4 | WALL SECTION & DETAILS |
| G.1 | GENERAL CONSTRUCTION NOTES | A5 | ARCHITECTURAL DETAILS |
| G.2 | GENERAL CONSTRUCTION NOTES | A6 | GENERAL STRUCTURAL INFORMATION |
| G.3 | GENERAL CONSTRUCTION NOTES | A7 | FOUNDATION PLAN & DETAILS |
| | | A8 | ROOF PLAN & DETAILS |
| A1 | BUILDING ELEVATIONS | A9 | FRAMING DETAILS |
| A2 | COMPOSITE FLOOR PLAN | | |



REVISION:

Copyright, 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
COVER SHEET

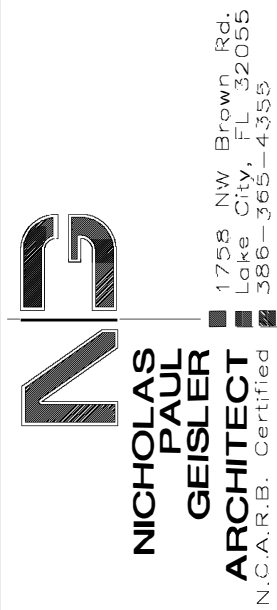

DATE:

20 AUG 2020

CONTRACT:

2K2064

SHEET:


C6.1

1 OF 1

AR0007005

This image shows a full page of blank, lined paper. The paper is white and features evenly spaced, light gray horizontal lines running across its entire width. There are no margins, text, or other markings on the page.


These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

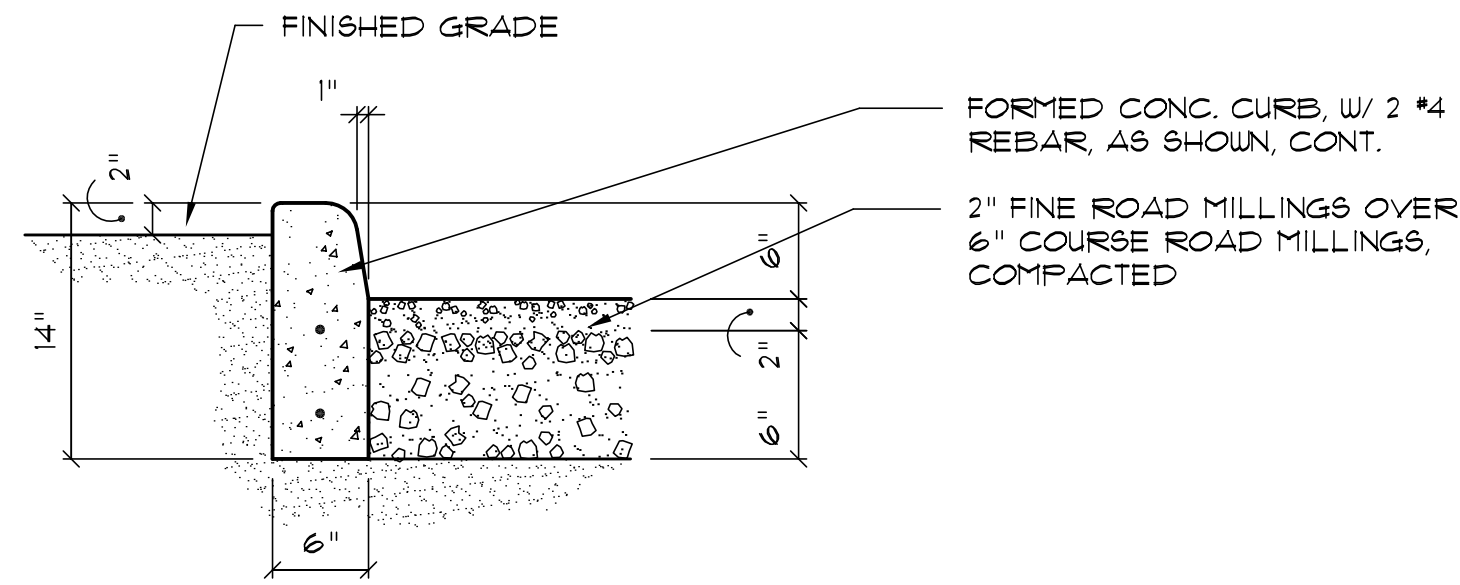

Curb DETAIL

SCALE: 1" = 1'-0"


A

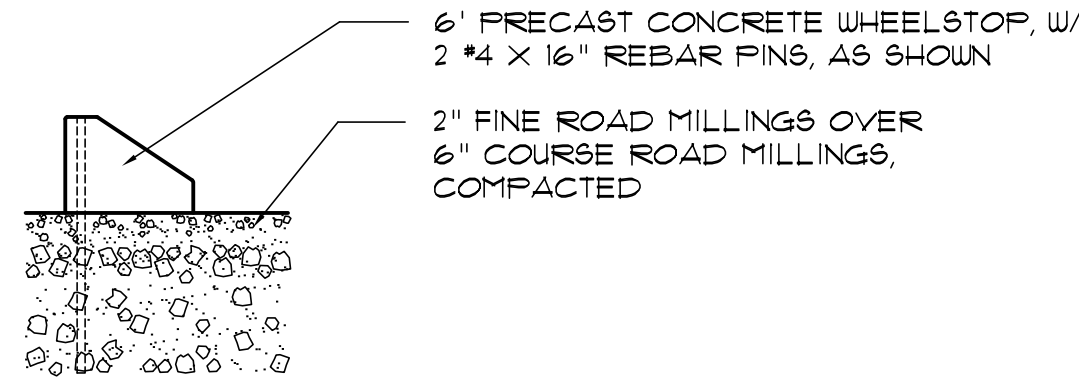

Wheelstop DETAIL

SCALE: 1" = 1'-0"

B

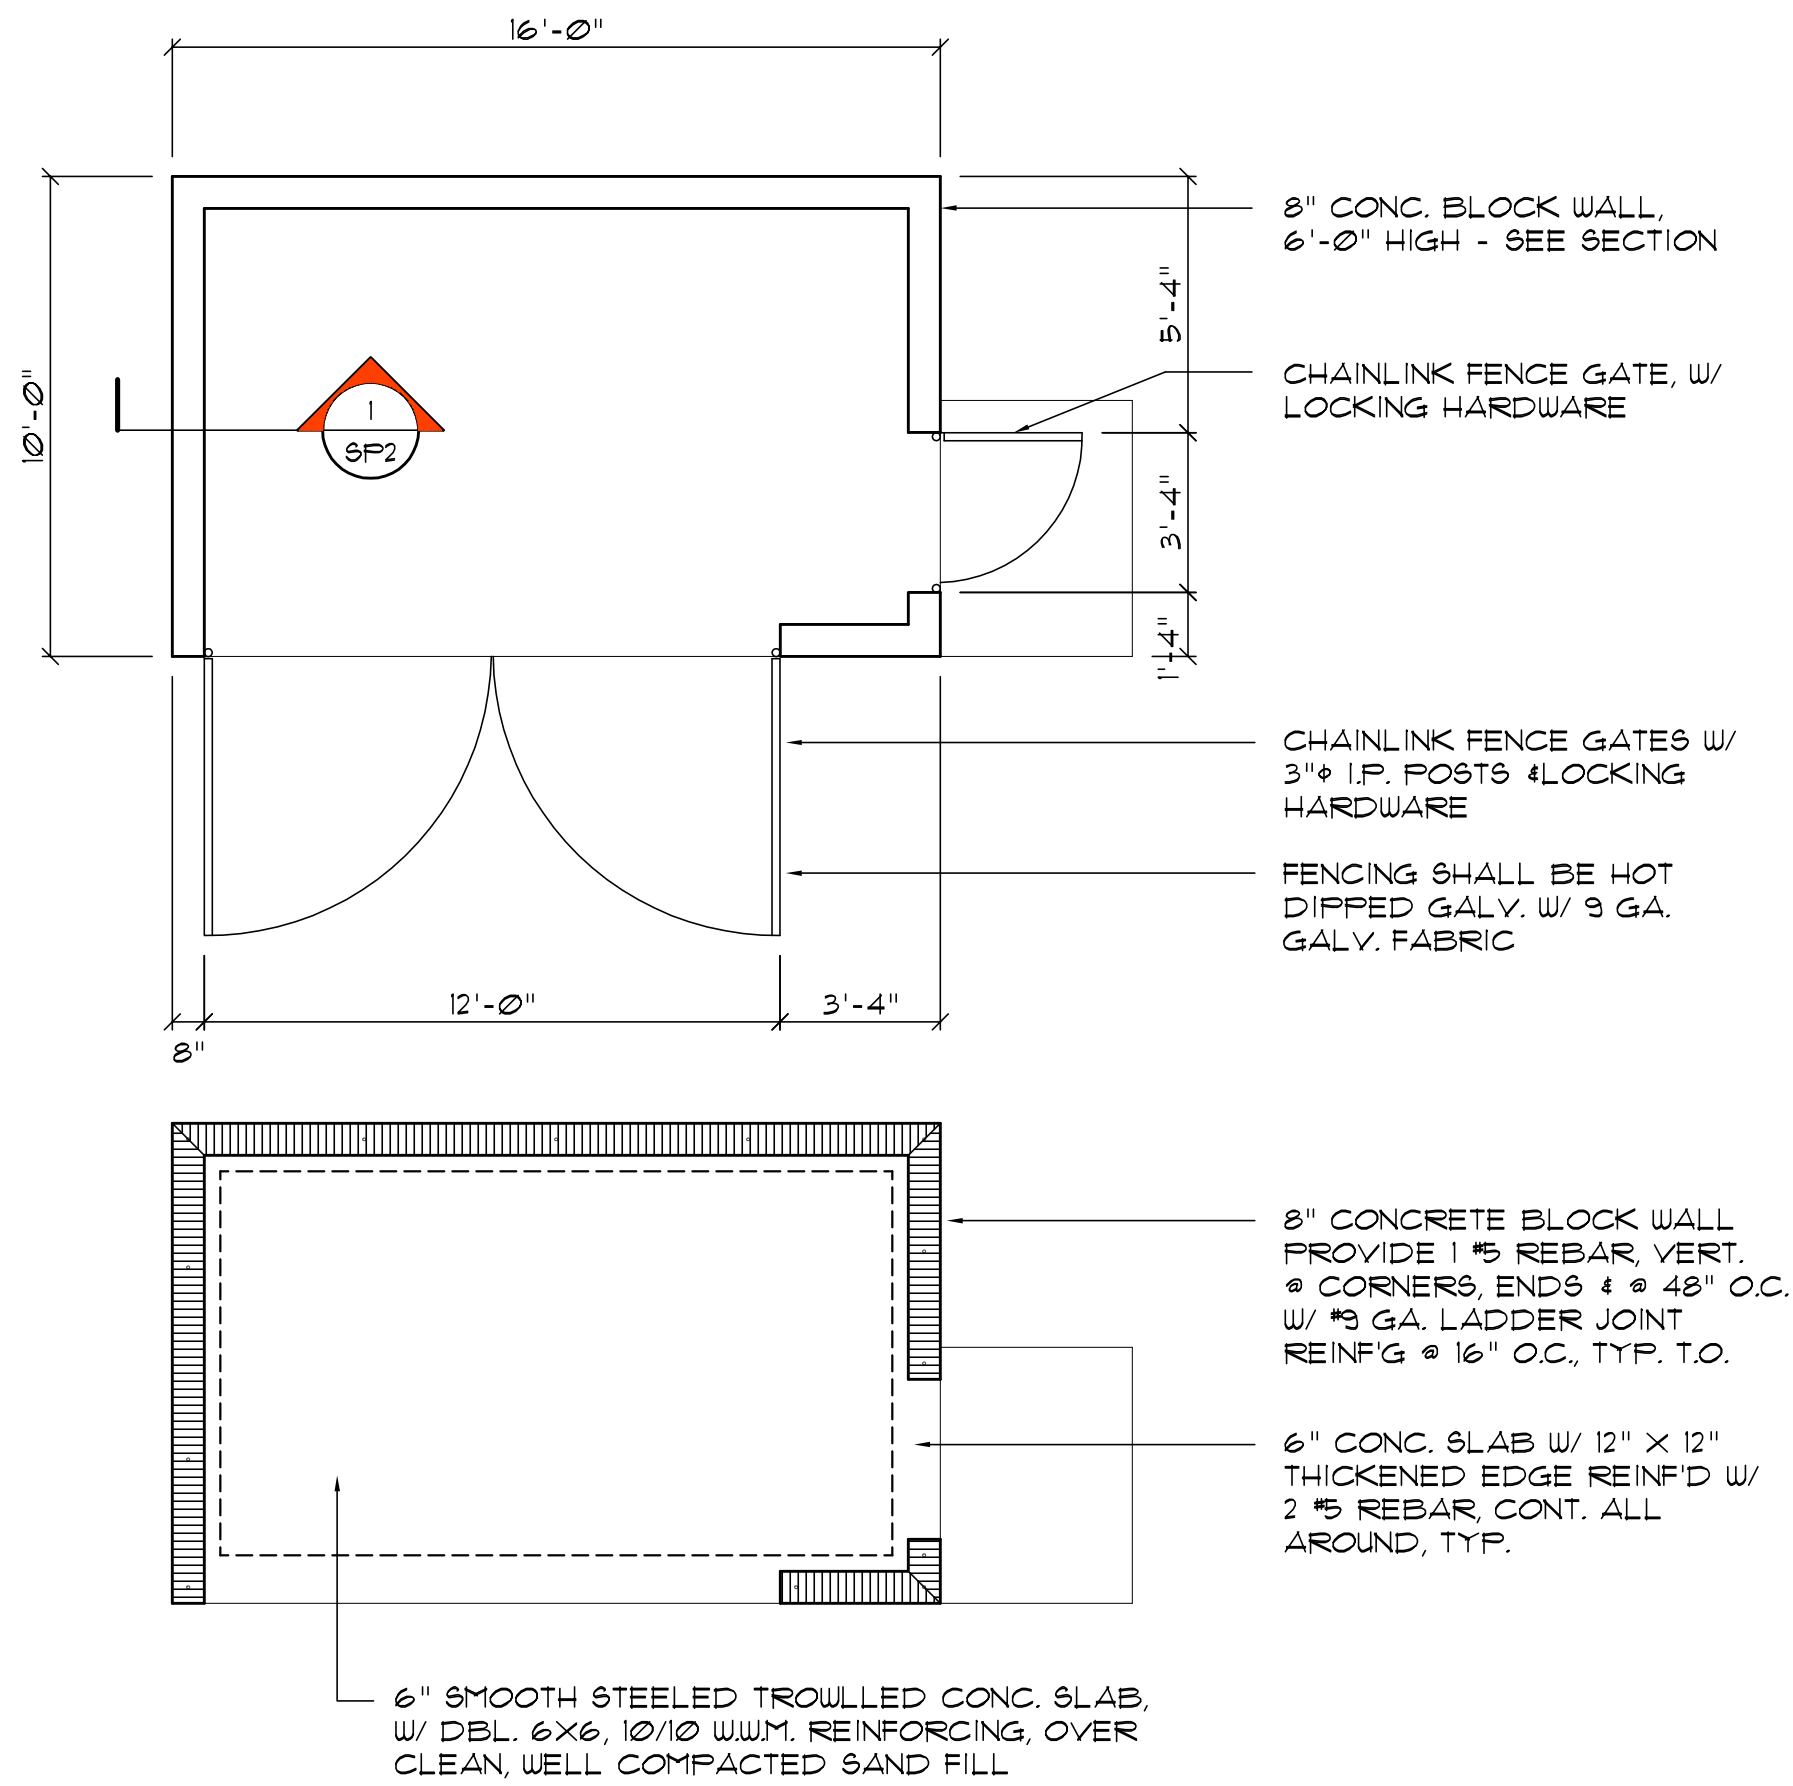


Dumpster Enclosure

SCALE: 1/4" = 1'-0"


D

NOTE!
ADDED FILL SHALL BE APPLIED IN 8" LIFTS -
EA. LIFT SHALL BE COMPACTED TO 95% DRY
COMPACTION PER THE "MODIFIED PROCTOR"
METHOD.

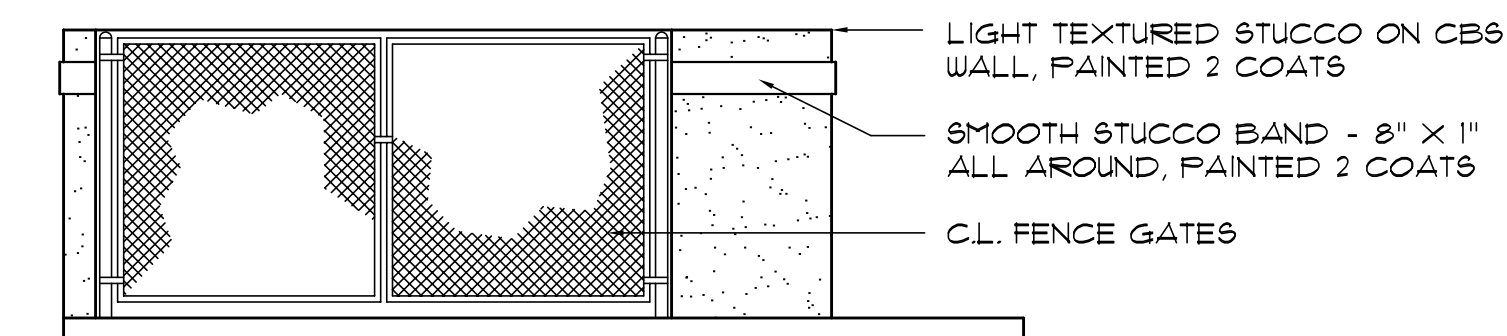

Enclosure ELEV.


SCALE: 1/4" = 1'-0"

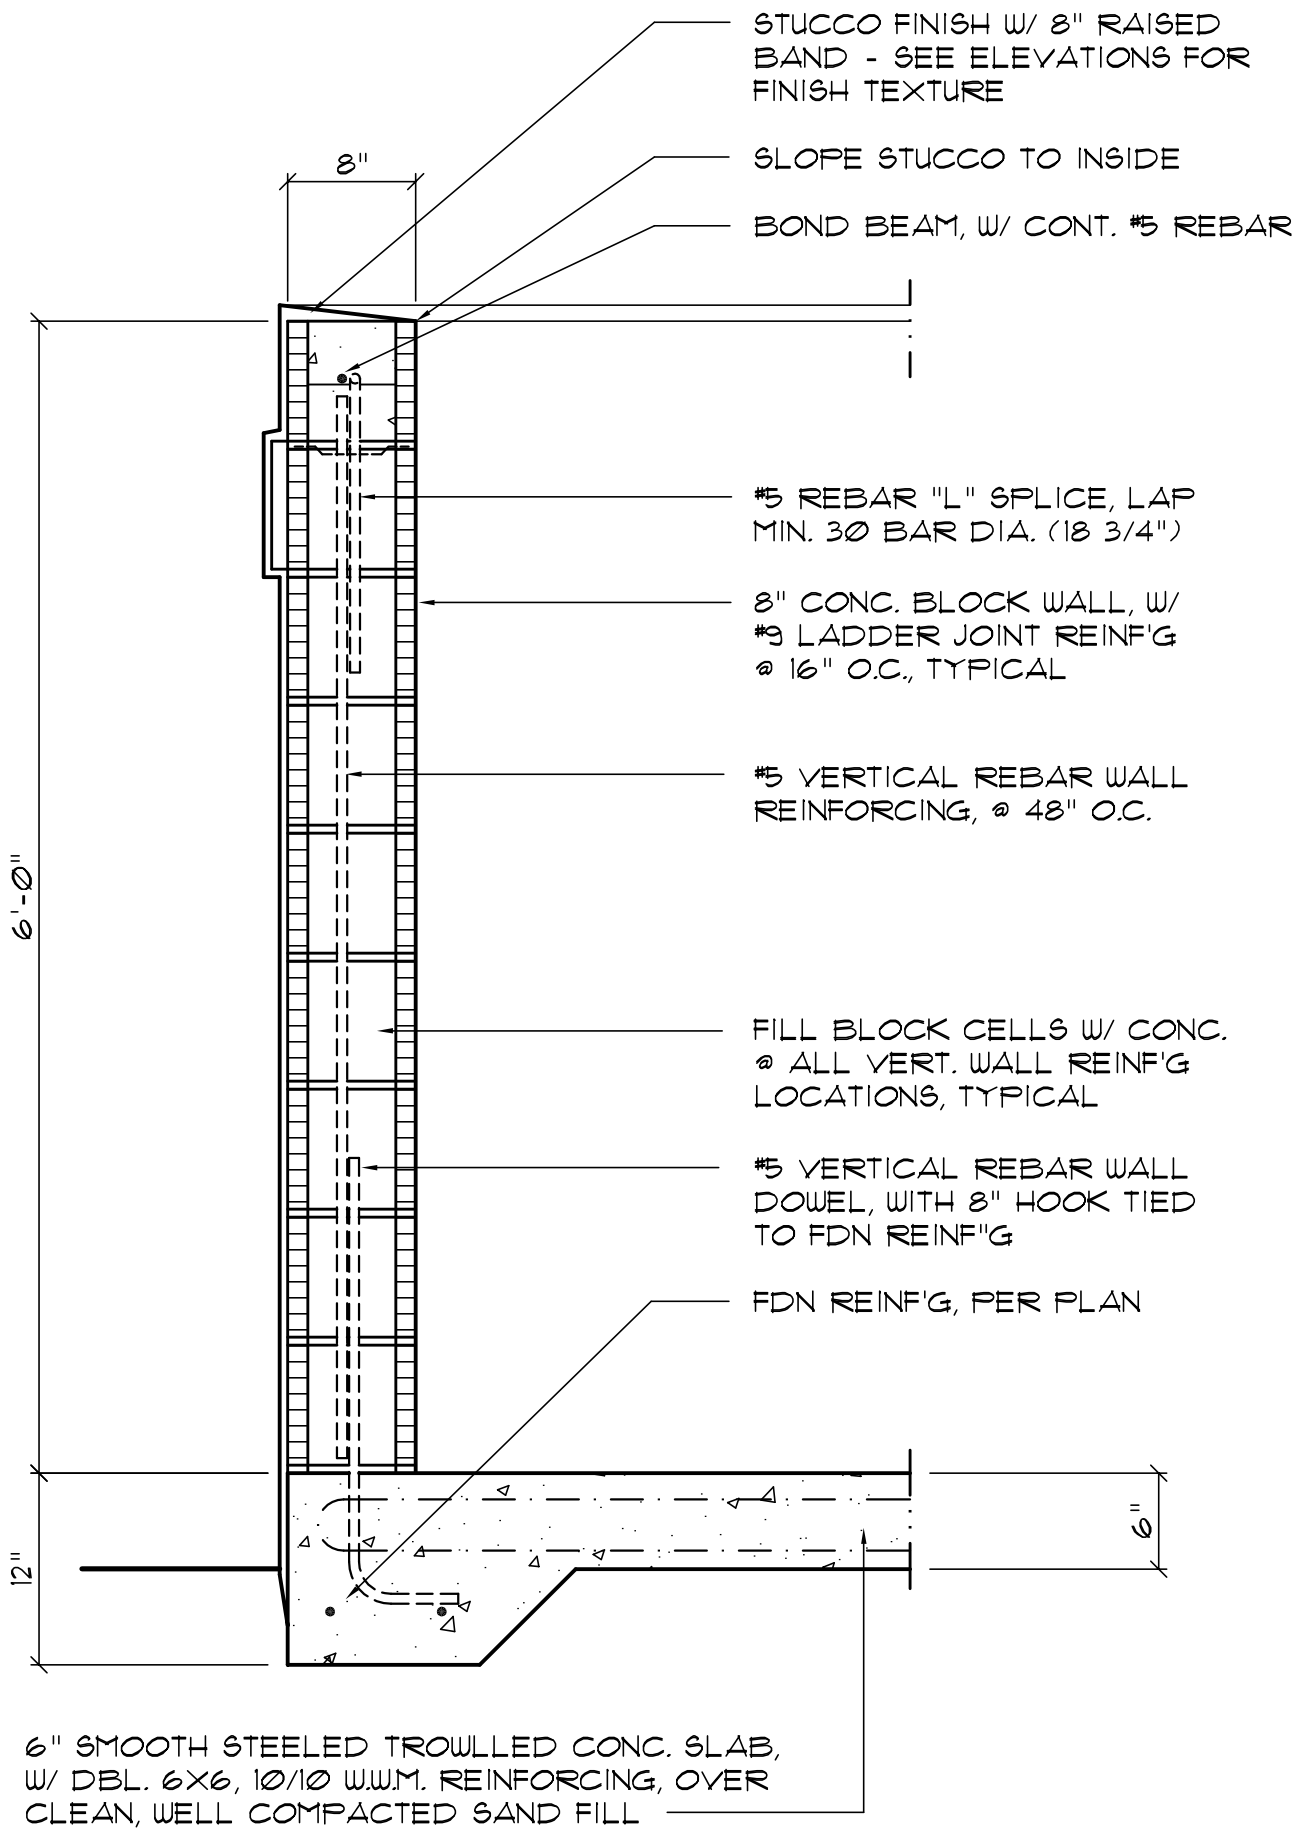

Enclosure Wall SEC.

SCALE: 1" = 1'-0"


1

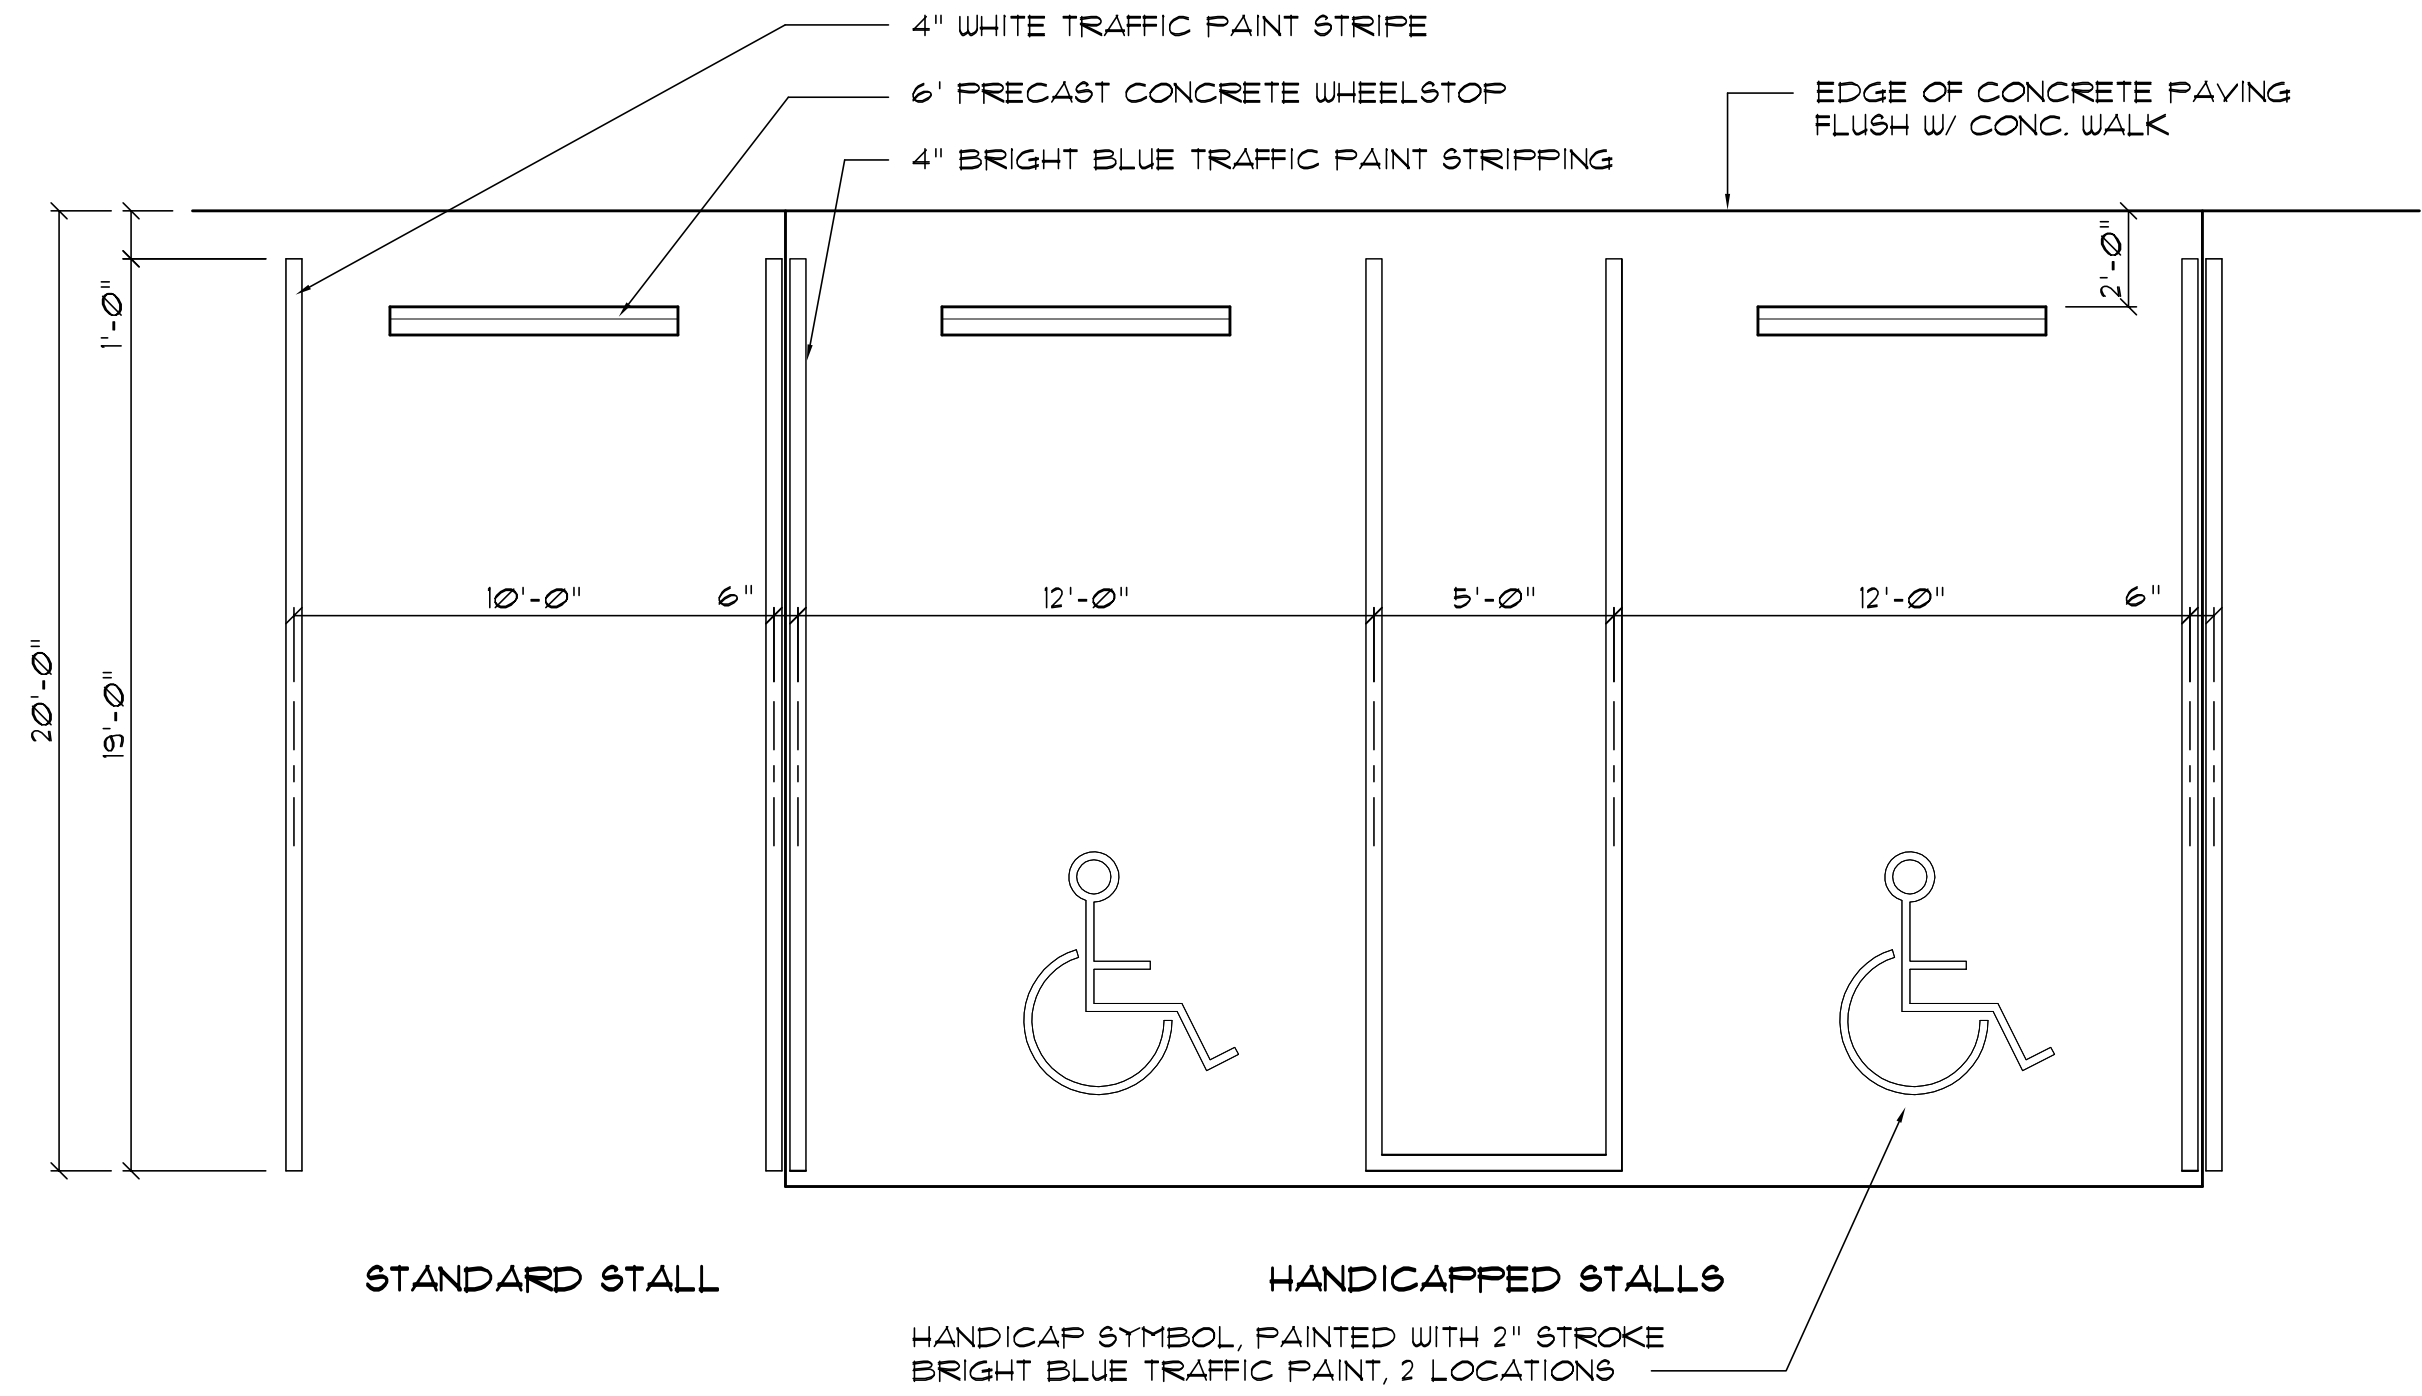

Parking DETAIL

SCALE: 1" = 1'-0"

C

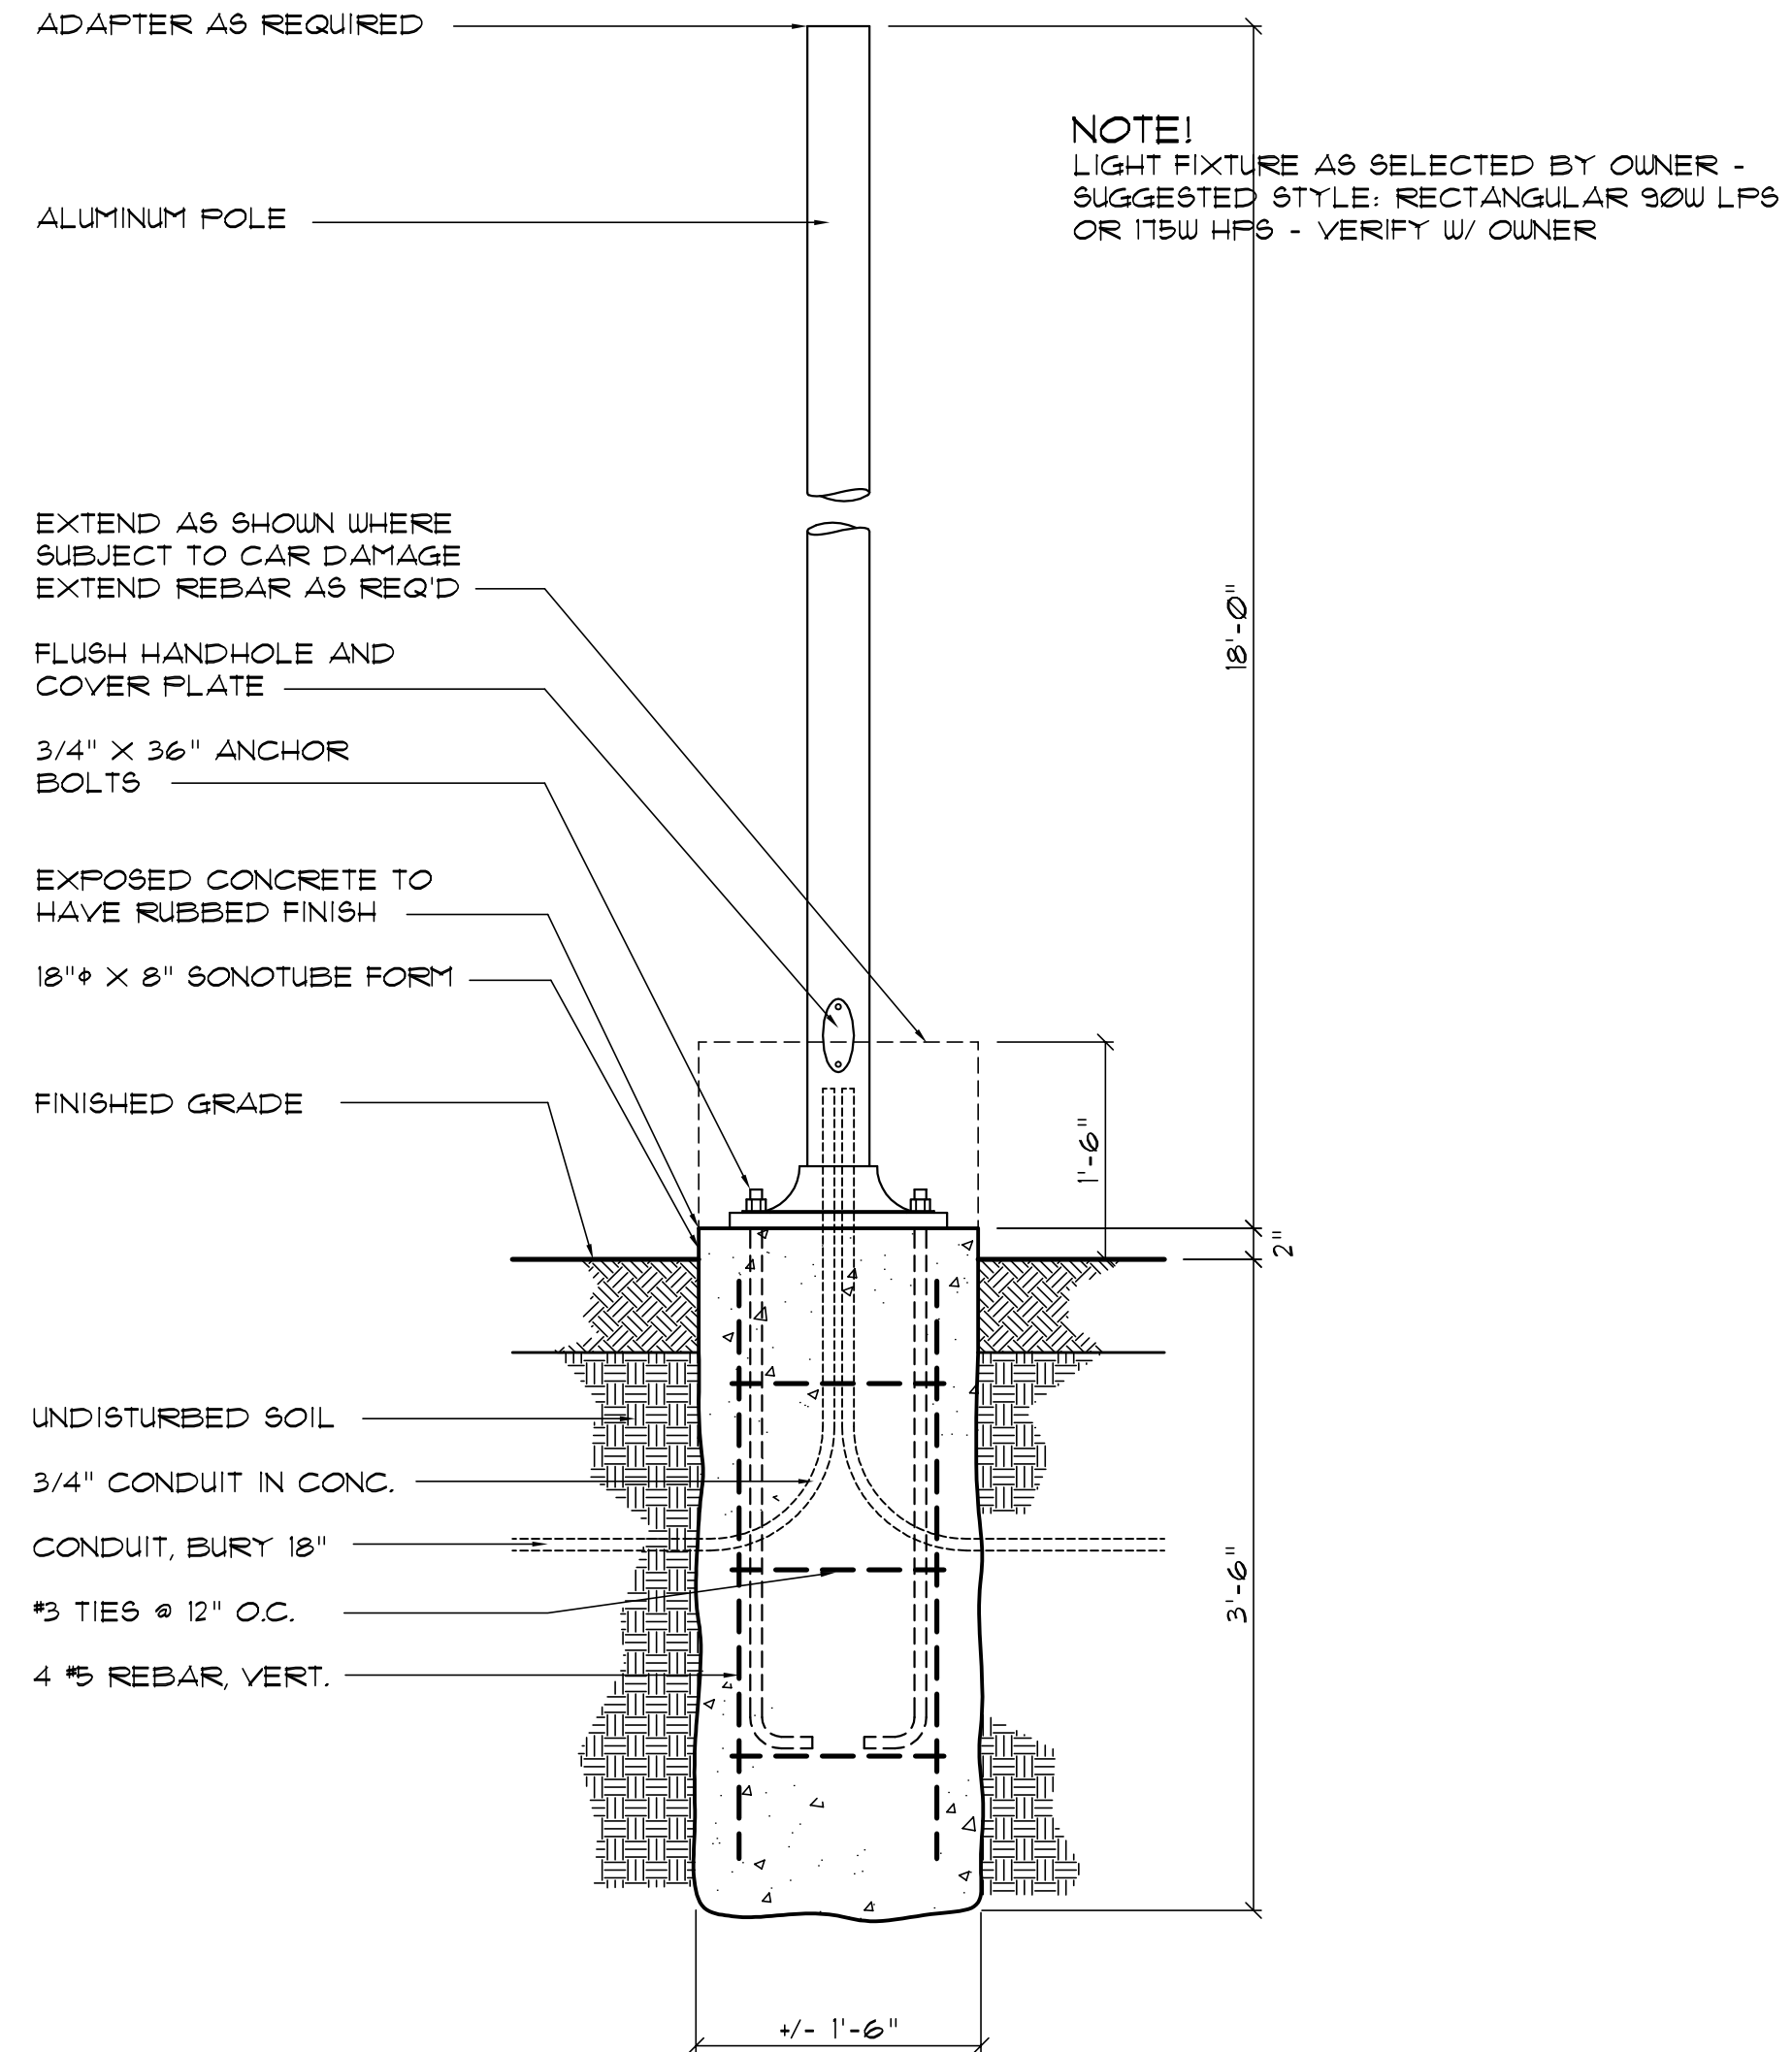

Pole & Base DET.

SCALE: 3/4" = 1'-0"

III



REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
GENERAL SITE DETAILS

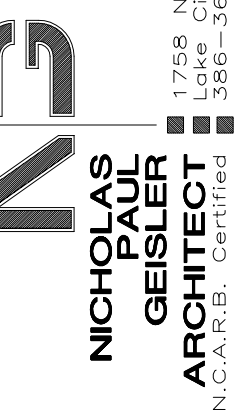

DATE:

20 AUG 2020

COMMITTEE:

2K2064

SHEET:

G.2

2 OF 3

AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

GENERAL NOTES:

- THE CONTRACTOR SHALL INDEMNIFY THE OWNER AGAINST ALL CLAIMS, WHETHER FROM PERSONAL INJURY OR PROPERTY DAMAGE, ARISING FROM EVENTS ASSOCIATED WITH THE WORK PERFORMED UNDER THE CONTRACT FOR THIS PROJECT.
- THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL WARRANT ALL WORK FOR A PERIOD OF ONE YEAR FOLLOWING THE DATE OF FINAL COMPLETION AND ACCEPTANCE BY THE OWNER. NO TIELEIN OR TIELEIN, INSTALLATION OF CABINET HINGES, CATCHES, DRAWER 4 TRAY GUIDES, ADJUSTABLE SHELF STANDARDS 4 SURFACE BOLTS.
- AT THE OWNER'S OPTION, A WARRANTY INSPECTION SHALL BE PERFORMED DURING THE ELEVENTH MONTH FOLLOWING THE COMMENCEMENT OF THE WARRANTY PERIOD, FOR THE PURPOSE OF DETERMINING ANY WARRANTY WORK THAT MAY BE REQUIRED. THE CONTRACTOR SHALL BE PRESENT DURING THIS INSPECTION IF REQUESTED BY THE OWNER.
- THE CONTRACTOR SHALL PAY FOR ALL PERMITS, LICENSES, TESTS AND THE LIKE THAT MAY BE REQUIRED BY THE VARIOUS AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT BE THEY CITY, COUNTY, STATE OR FEDERAL.
- THE OWNER SHALL FILE A "NOTICE OF COMMENCEMENT" PRIOR TO THE BEGINNING OF THE PROJECT AND THE CONTRACTOR(S) SHALL FILE "NOTICE TO OWNER" AND PROVIDE "RELEASE OF LIEN" FOR ALL PAYMENT REQUESTS PRIOR TO DISBURSEMENT OF ANY FUNDS.
6. ANY AND ALL DISPUTES ARISING FROM EVENTS ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT BETWEEN THE OWNER, CONTRACTOR(S) AND SUPPLIERS SHALL BE RESOLVED THROUGH BINDING ARBITRATION.
- ALL WORK SHALL BE IN ACCORDANCE W/ APPLICABLE CODES AND LOCAL REGULATIONS, INCLUDING APPLICABLE ENERGY CODES. ALL COMPONENTS OF THE BUILDING SHALL MEET WITH THE MINIMUM ENERGY REQUIREMENTS OF THE BUILDING CODE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IN WRITING PRIOR TO THE COMMENCEMENT OF THE WORK.
- ALL INSULATION SHALL BE LEFT EXPOSED AND ALL LABELS LEFT INTACT UNTIL THE WINDOWS AND DOORS UNTIL INSPECTED BY THE BUILDING OFFICIAL.
- ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED.
10. INTERIOR BEARING WALLS SHALL BE CONSTRUCTED IN COMPLIANCE WITH "UL Design U333". BATT INSULATION SHALL BE INCLUDED WHERE UNCONDITIONED AREA IS BEING SEPARATED FROM HEATED / COOLED AREA.
- INTERIOR STUD WALLS SEPARATING LIVING AREA FROM GARAGE AREAS SHALL BE CONSTRUCTED IN COMPLIANCE WITH "UL Design U333", INCLUDING R-II BATT INSULATION.
12. CEILINGS OVER ATTACHED GARAGES OR GARAGES W/ LIVING AREA ABOVE SHALL BE 5/8" FIRECODE "C" GIBS ON 1X3 WOOD FURRING AT 16" O.C., ATTACHED W/ 1 1/4" BUGLEHEAD SCREWS @ 6" O.C. ALONG EACH POINT OF BEARING.

AS - BUILT DRAWING REQUIREMENTS:

- A. ELECTRICAL "AS-BUILT" DRAWINGS
ELECTRICAL CONTR SHALL PREPARE "AS-BUILT" SHOP DUGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADDNS TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT N°, DESCRIPTION 4 BRKR, SERVICE ENT. 4 ALL UNDERGROUND WIRE LOCATION/ROUTING/DEPTH. RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE 4 EQUIPMENT TYPE W/ RATINGS 4 LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER 4 1 COPY TO THE PERMIT ISSUING AUTHORITY.
- B. HVAC "AS-BUILT" DRAWINGS
HVAC CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL HVAC WORK, INCLUDING ALL DUCTWORK LOC, SIZES, LINES, EQUIPMENT SCH. 4 BALANCING REPORT - CONTR SHALL PROVIDE 1 COPY OF AS-BLT DUGS TO OWNER 4 1 COPY TO THE PERMIT ISSUING AUTHORITY.
- C. PLUMBING "AS-BUILT" DRAWINGS
PLUMBING CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL PLUMBING WORK, INCLUDING ALL PLUMBING LINE LOCATIONS AND RISER DIAGRAM - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER AND 1 COPY TO THE PERMIT ISSUING AUTHORITY.

GENERAL MILLWORK NOTES:

1. MILLWORK SUB-CONTRACTOR PROVIDING CASEWORK, MILLWORK OR THE LIKE FOR THIS PROJECT SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6 OF THE GENERAL NOTES, THIS SHEET.
2. SCOPE OF WORK INCLUDES, BUT IS NOT LIMITED TO THE FOLLOWING: FABRICATION AND DELIVERY OF MILLWORK SHOWN IN THE DRAWINGS, TO THE JOB SITE, INSTALLATION OF CABINET HINGES, CATCHES, DRAWER 4 TRAY GUIDES, ADJUSTABLE SHELF STANDARDS 4 SURFACE BOLTS.
3. ALL APPLICABLE STANDARDS OF "AIA" QUALITY STANDARDS 4 GUIDE SPECIFICATIONS APPLY TO THIS PROJECT, UNLESS NOTED OTHERWISE.
4. AIA "CUSTOM" GRADE EXCEPT AS OTHERWISE NOTED OR DIRECTED BY THE OWNER, SHALL BE THE BASE STANDARD OF QUALITY REQ'D FOR THIS WORK.
5. MILLWORK SUB-CONTRACTOR SHALL SUBMIT FOR APPROVAL BY THE OWNER, THE FOLLOWING ITEMS, PRIOR TO FABRICATING ANY MATLS OR MILLWORK: COMPLETE SET OF SHOP DRAWINGS, SAMPLES OF WD, SPECIES RECEIVING TRANSPARENT FINISH, MFR'S LITERATURE FOR ALL SPECIALTY ITEMS NOT MFD. BY THE ARCHITECTURAL WOODWORK FIRM AND HARDWARE SCHEDULE, SHOWING HARDWARE USED AT EA. LOCATION 4 CONFORMANCE W/ THE DESIGN INTENT OF THE DRAWINGS OR DIRECTIVES ISSUED BY THE OWNER.
6. PRODUCTS SHALL INCLUDE THE FOLLOWING:
SOFTWOOD - SOLID STOCK PINE, C OR BETTER
HARDWOOD - SPECIES AS SELECTED BY OWNER
PLYWOOD, OPAQUE FINISH - FIR GRADE A/B
PLYWOOD, TRANSPARENT FINISH - SPECIES AS SELECTED BY OWNER
PARTICLE BOARD - HIGH DENSITY, W/ RESIN BINDER
LAM. PLASTIC - MFG, COLORS, PATTERNS 4 TEXTURES AS SELECTED BY OWNER
LAMINATING ADHESIVES - POLYVINYL ACETATE, UREA-FORMALDEHYDE, CASEIN
7. ASSEMBLE WORK AT MILL 4 DELIVER TO JOB SITE READY TO INSTALL INSOFAR AS POSSIBLE.
8. PROTECT MILLWORK FROM MOISTURE 4 DAMAGE WHILE IN TRANSIT TO THE JOB SITE. UNLOAD AND STORE IN A PLACE WHERE IT WILL BE PROTECTED FROM MOISTURE AND DAMAGE AND BE CONVENIENT FOR INSTALLATION.
9. FABRICATE WORK IN ACCORDANCE WITH MEASUREMENTS TAKEN AT THE JOB SITE.
10. INSTALL HARDWARE IN ACCORDANCE WITH MANUF'R'S DIRECTIONS. LEAVE OPERATING HARDWARE OPERATING SMOOTHLY 4 QUIETLY.
11. DAMAGED SURFACES SHALL BE REPAIRED TO MATCH UNDAMAGED ADJACENT PORTION OF THE WORK.

GENERAL H.V.A.C. NOTES:

1. SUB-CONTRACTORS PROVIDING HVAC INSTALLATION SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6, GENERAL NOTES/D.1a.
2. HVAC SUB-CONTRACTOR SHALL PROVIDE ALL LABOR, MATERIALS, TOOLS AND EQUIPMENT TO INSTALL A COMPLETE 4 OPERATING HVAC SYSTEM.
3. HVAC SYSTEM SHALL BE AS DETAILED IN THE PLANS (IF INCLUDED), OR SHALL BE AS DIRECTED BY THE OWNER IN CONSULTATION WITH THE HVAC SUB-CONTRACTOR.
4. HVAC SUB-CONTRACTOR SHALL FURNISH SHOP DUGS FOR DUCTWORK, CONDENSING UNIT 4 AIR HANDLER, EXHAUST FANS AND AIR DEVICES.
5. IT IS THE HVAC SUB-CONTRACTOR'S RESPONSIBILITY TO COMPLY WITH NFPA-90A AND ALL APPLICABLE CODES.
6. FLEXIBLE DUCT SHALL BE FULLY ANNEALED, CORRUGATED ALUMINUM W/ 1 3/4 LB. DENSITY FIBERGLASS INSULATION AND SHALL BE UL LISTED. SHEET METAL DUCT SHALL BE LINED W/ 1" MATFACED DUCT LINER 4 WRAPPED W/ 1 3/4 LB. POLIFACED FIBERGLASS INSULATION. ALL FIBERGLASS DUCT SHALL BE POLIFACED, R42/R6 @ DUCTBOARD.
7. ALL EXHAUST AND OUTSIDE AIR DUCT SHALL BE GALVANIZED SHEET METAL CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH ASHREA AND SHAGNA STANDARDS.
8. ALL AIR DEVICES SHALL BE OF ALUMINUM CONSTRUCTION FOR WALL AND CEILING APPLICATIONS AND STEEL CONSTRUCTION IN FLOOR APPLICATIONS. ACCEPTABLE MANUFACTURER'S SHALL BE TITUS, METALLAIRE, NAILORHART, HART 4 COOLIE OR AS DIRECTED BY THE OWNER.
9. IF REQUIRED BY THE OWNER, THE HVAC SUB-CONTRACTOR SHALL SUPPLY A TEST AND BALANCE REPORT IN ACCORDANCE WITH AIR BALANCE COUNCIL STANDARDS, SIGN AND SEALED BY A REGISTERED ENGINEER.
10. HVAC SUB-CONTRACTOR SHALL SUPPLY ALL CONTRACTORS, RELAYS, AND THERMOSTATS. THE ELECTRICAL SUB-CONTRACTOR SHALL PROVIDE ALL SWITCHES, DISCONNECTS 4 CONTROL WIRING. THERMOSTATS SHALL BE APPROVED BY THE EQUIPMENT MFG'R.
11. ALL DUCT SIZES INDICATED IN THE PLANS (IF INCLUDED) ARE NET INSIDE DIMENSIONS.
12. ALL EQUIPMENT SHALL BE FULLY WARRANTED FOR 1 YEAR AND THE COMPRESSOR(S) SHALL BE WARRANTED 5 YEARS FROM DATE OF FINAL ACCEPTANCE, BY THE OWNER.
13. ALL WORK IN THIS TRADE SHALL BE COORDINATED WITH ALL OTHER TRADES SO AS TO AVOID CONFLICTS OR HINDERANCE TO COMPLETION OF THE JOB.
14. CONDENSATE DRAIN PIPING SHALL BE INSULATED WITH 1/2" THICK ARMAFLEX INSULATION.
15. FILTERS SHALL BE DISPOSABLE TYPE AND HAVE INITIAL SHARE WEIGHT ARRESTANCE OF 10% AND A CLEAN PRESSURE DROP OF 2/15. PROVIDE 2 SETS, ONE DURING CONSTRUCTION AND ONE FOR USE AT FINAL ACCEPTANCE.
16. HVAC SUB-CONTRACTOR SHALL PROVIDE 4 INSTALL ALL NECESSARY OFFSETS, TRANSITIONS 4 BENDS REQUIRED TO PROVIDE A COMPLETE SYSTEM AT NO ADDITIONAL COST TO THE OWNER.
17. IT IS THE RESPONSIBILITY OF THE HVAC SUB-CONTRACTOR TO COORDINATE LOCATION OF CEILING DIFFUSERS, GRILLES AND REGISTERS IN THE FIELD WITH THE ELECTRICIAN, LIGHTS AND ARCHITECTURAL ELEMENTS.
18. COORDINATE W/ THE ELECTRICIAN, PARTICULARLY ELECTRICAL NOTE N°. 29, TO ASSURE SUITABLE SIZES OF BREAKERS, SWITCHES AND WIRING.

GENERAL PLUMBING NOTES:

1. SUB-CONTRACTORS PROVIDING PLUMBING MATERIALS AND INSTALLATION SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6.
2. ALL WORKMANSHIP AND MATERIALS SHALL BE IN STRICT ACCORDANCE WITH APPLICABLE LOCAL CODES, RULES AND ORDINANCES.
3. ALL MATERIALS SHALL BE NEW.
4. ALL WORK SHALL BE PERFORMED BY A LICENSED PLUMBING CONTRACTOR IN A FIRST CLASS WORKMANLIKE MANNER. THE COMPLETED SYSTEM SHALL BE FULLY OPERATIONAL.
5. ALL EXCAVATION 4 BACKFILL AS REQUIRED FOR THIS PHASE OF THE CONSTRUCTION SHALL BE PART OF THE PLUMBING SUB-CONTRACTOR'S RESPONSIBILITIES.
6. PLUMBING FLAT PLANS AND RISER DIAGRAMS (IF INCLUDED) ARE DIAGRAMATIC. DO NOT SCALE THE DRAWINGS FOR EXACT LOCATIONS OF THE PLUMBING FIXTURES.
7. ALL WORK SHALL BE COORDINATED WITH OTHER TRADES TO AVOID INTERFERENCE WITH THE PROGRESS OF THE CONSTRUCTION.
8. WATER PIPING SHALL BE TYPE L COPPER UP TO 1", 4 TYPE K FOR ALL LARGER SIZES. ALL UNDERGROUND PIPING SHALL BE TYPE K COPPER. AT THE OWNER'S OPTION SUPPLY PIPING MAY BE CPVC, SCHEDULE 40 OR SCHEDULE 80.
9. DO NOT USE LEAD BASED SOLDER FOR JOINING SUPPLY PIPING.
10. SOIL, WASTE, VENT 4 RAINWATER PIPING SHALL BE CAST IRON NO-HUB 3/2"-12" ABOVE GRADE WITH NEOPRENE GASKETS AND STAINLESS STEEL BANDS 4 BELL 4 SPIGOT CAST IRON BELOW GRADE W/ LEAD 4 OAKUM JOINTS OR AT THE OWNER'S OPTION, P.V.C., SCHEDULE 40, SEE NOTE 12.
11. AIR CONDITIONING CONDENSATE DRAIN PIPING SHALL BE THREADED STEEL PIPE, COPPER DRAIN, WASTE OR VENT PIPE AND FITTINGS, OR P.V.C. SEE NOTE 12. BELOW. INSULATE ALL CONDENSATE PIPING EXCEPT WHERE UNDERGROUND, AND ELECTRIC HEAT TRAP WHERE EXPOSED TO FREEZING CONDITIONS.
12. P.V.C. SCHEDULE 40 PIPE AND FITTINGS MAY BE USED FOR SOIL, WASTE, VENT, RAINWATER OR CONDENSATE PIPING AS APPROPRIATE, WHERE APPROVED BY THE BUILDING CODES 4 OFFICIALS. P.V.C. MAY NOT BE USED TO PENETRATE CHASES OR FIRE RATED WALLS / CEILINGS.
13. ALL FIXTURES MUST BE PROVIDED WITH READILY ACCESSIBLE STOPS AND WHERE PROVIDED, MARKED ACCESS PANELS.
14. FURNISH AND INSTALL APPROVED AIR CHAMBERS AT EACH PLUMBING FIXTURE AND APPROVED SHOCK ARRESTERS ON MAIN LINE OR RISERS.
15. DIELECTRIC COUPLINGS ARE REQUIRED BETWEEN ALL DISSIMILAR METALS IN PIPING AND EQUIPMENT CONNECTIONS.
16. ISOLATE COPPER PIPING FROM HANGERS OR SUPPORTS W/ HAIR FELT INSULATOR PADS.
17. PROVIDE 1/2" TRAP PRIMER LINE FOR ALL FLOOR DRAINS FROM NEAREST PLUMBING FIXTURE, DO NOT MANIFOLD.
18. PROVIDE ACCESS PANELS FOR ALL CONCEALED VALVES.
19. PROVIDE COMBINATION COVERPLATE / CLEANOUT PLUG FOR ALL WALL CLEANOUTS, FINISH AS DIRECTED BY THE OWNER.
20. FIXTURES, HARDWARE, EQUIPMENT, COLORS AND FINISHES SHALL BE AS SELECTED BY THE OWNER.

GENERAL WELL 4 SEPTIC NOTES:

1. SUB-CONTRACTORS PROVIDING WATER WELLS AND/OR SEPTIC TANKS AND DRAINFIELDS SHALL BE SUBJECT TO THE PROVISIONS OF NOTES 1 THRU 6, THIS SHEET.
2. LOCATION OF POTABLE WATER WELLS SHALL BE DETERMINED BY THE OWNER IN CONSULTATION WITH THE WELL DRILLING CONTRACTOR. WELLS SHALL NOT BE LOCATED CLOSER THAN 15'-0" TO ANY PROPOSED OR EXISTING SEPTIC TANK OR DRAINFIELD, EITHER ON SUBJECT PROPERTY OR ADJACENT/ADJOINING PROPERTY.
3. POTABLE WATER WELLS SHALL BE A MINIMUM 4"ø WITH BLACK IRON CASING TO A DEPTH OF 80'-0". PUMPS SHALL BE OF THE SUBMERSIBLE TYPE, THREE WIRE SYSTEM, MINIMUM HORSEPOWER SHALL BE 1/2 H/P OR AS DIRECTED BY THE OWNER. MOTOR STARTER SHALL BE ENCLOSED IN A WEATHERPROOF HOUSING, MOUNTED ON A P/T 4X4 POST AT THE WELL HEAD.
4. WELL HEAD SHALL PROJECT 12" ABOVE GRADE.
5. ALL REQUIRED COMPONENTS FOR A COMPLETE OPERATING SYSTEM SHALL BE PROVIDED, INCLUDING ANTI-FREEZE BLEEDER FITTING, CHECKVALVE, AIR BLEEDERS, SHUTOFF VALVE, HOSE BIBB, PRESSURE REGULATOR/CONTACTOR, UNIONS AND PRESSURE GAUGE.
6. PRESSURE TANK SHALL BE GALVANIZED 82 GALLON CAPACITY, UNLESS DIRECTED OTHERWISE BY THE OWNER.
7. SEPTIC TANK LOCATION 4 DRAINFIELD INVERT SHALL BE DETERMINED BY THE LOCAL HEALTH DEPARTMENT, IN CONSULTATION W/ THE OWNER.
8. SEPTIC TANKS SHALL BE OF A SIZE 4 CONSTRUCTION AS DETERMINED BY THE LOCAL HEALTH DEPARTMENT. TANK MAT'L SHALL BE FOURED CONCRETE OR FIBERGLASS AS ALLOWED BY THE SEPTIC TANK PERMIT.
9. SEPTIC DRAINFIELDS SHALL BE CONSTRUCTED TO THE STANDARDS OF THE LOCAL HEALTH DEPARTMENT. DRAINFIELD PIPING SHALL BE CLAY TILE OR P.V.C. OR POLY AS ALLOWED BY THE SEPTIC TANK PERMIT. DRAINFIELD BEDS SHALL BE 3/4" WASHED ROCK, INSTALLED THICKNESS SHALL BE AS PER SEPTIC TANK PERMIT.
10. SAND FILTER BEADS, MOUND SYSTEMS, DOSING TANKS, GREASE TRAPS, DISTRIBUTION BOXES, GRINDER PUMPS, SUMP PUMPS AND OTHER SUCH RELATED ITEMS (IF REQUIRED OR REQUESTED) SHALL BE AS PER THE DESIGN STANDARDS OF THE LOCAL HEALTH DEPARTMENT.

ELECTRICAL NOTES : General

1. DO NOT SCALE THE ELECTRICAL DRAWINGS. REFER TO ARCHITECTURAL PLANS AND ELEVATIONS FOR EXACT LOCATION OF ALL EQUIPMENT, CONFIRM WITH OWNER.
2. INSTALL ALL ELECTRICAL WORK IN CONFORMANCE WITH THE NEC 2014 EDITION, AND ITS AMENDMENTS AS ADOPTED BY THE PERMIT ISSUING AUTHORITY AT THE TIME OF CONSTRUCTION.
3. GROUNDING: GROUND ALL MAIN DISCONNECTS TO STANDARD GROUND ROD(S) AND TO COLD WATER SUPPLY AS PER ARTICLE 250 OF NEC-1994.
4. INSTALL ONLY COPPER WIRING ON THIS PROJECT. THW, TW, THWN, THHN OR NM CABLE, UNLESS NOTED OTHERWISE. ALL CONDUCTORS #10 4 SMALLER MAY BE SOLID. ALL CONDUCTORS #8 AND LARGER SHALL BE STRANDED TYPE.
5. PROVIDE CONTINUITY OF NEUTRAL ON MULTI-BRANCH CIRCUITS BY SPlicing AND BRINGING OUT A TAP, ASSURING NO OPENINGS OF NEUTRAL IN REPLACEMENT OF A DEVICE.
6. COLOR CODE MULTI-CIRCUIT WIRING AS FOLLOWS: NEUTRAL - WHITE, GROUND - GREEN, LINE - ALL OTHER COLORS.
7. INSTALL ONLY HIGH POWER FACTOR BALLASTS AT FLUORESCENT FIXTURES.
8. INSTALL GFI BREAKERS OF DEVICES AT ALL BATHROOM, RESTROOM, KITCHEN, GARAGE AND EXTERIOR RECEPTACLES AND AS NOTED ON THE DRAWINGS.
9. INSTALL ONLY THOSE ELECTRICAL DEVICES THAT BEAR A "UL" OR OTHER RECOGNIZED TESTING LAB LABEL. ALL MATERIALS SHALL BE NEW.
10. INSTALL NON-FUSED DISCONNECT SWITCHES AT ALL PIECES OF ELECTRICAL EQUIPMENT LOCATED WHERE SAID EQUIPMENT IS NOT VISIBLE FROM THE CIRCUIT BREAKER THAT PROTECTS IT. SIZE IN ACCORD WITH THE LOAD. ALL DISCONNECT SWITCHES SHALL BE H.P., RATED, HEAVY DUTY, QUICK-MAKE - QUICK-BREAK TYPE - ENCLOSURES SHALL BE AS REQ'D FOR EXPOSURE.
11. MOTOR STARTERS SHALL BE MANUAL OR MAGNETIC WITH OVERLOAD RELAYS IN EACH HOT LEG.
12. ISOLATE DISSIMILAR CONDUIT AND TUBING METALS FROM SOIL, WATER AND GAS PIPING AND OTHER BUILDING MATERIALS WHERE DAMAGE BY FRICTION OR ELECTROLYSIS MAY OCCUR, EXCEPT WHERE ELECTRICAL GROUND IS PROVIDED.
13. FURNISH AND INSTALL ALL ELECTRICAL DEVICES AND ITEMS REQUIRED FOR A COMPLETE, OPERATING SYSTEM, PROVIDING THE FUNCTIONS AS DETAILED IN THE PLANS (AND SPECS).
14. OUTLET BOXES SHALL BE PRESSED STEEL OR PLASTIC OR ALL DRY LOCATIONS, FOR WET LOCATIONS, CAST ALLOY WITH THREADED HUB OUTLET BOXES SHALL BE INSTALLED.
15. HOT CHECK ALL SYSTEMS WITH THE OWNER'S REPRESENTATIVE PRESENT TO VERIFY PROPER FUNCTION PRIOR TO C.O.
16. COORDINATE ALL WORK THROUGH GC TO AVOID CONFLICTS. COORDINATE WITH HVAC CONTRACTOR AND ELECTRONICS SYSTEMS CONTRACTORS SO THAT A COMPLETE, FUNCTIONING SYSTEM IS INSTALLED, IN EACH CASE, WITH NO EXTRA COST TO THE OWNER.
17. EMERGENCY LIGHTING AND EXIT SIGNS, IF INDICATED ON THE PLANS, SHALL BE WIRED PER NEC 100-12F.
18. ALL PANEL SCHEDULES SHALL BE FULLY FILLED OUT AND SHALL BE TYPEWRITTEN. EA. CIRCUIT SHALL BE CLEARLY IDENTIFIED A TO WHAT IS INCLUDED ON SAID CIRCUIT.
19. IT IS NOT THE INTENT OF THESE DRAWINGS TO SHOW EVERY MINOR DETAIL OF THE CONSTRUCTION.
20. THE ELECTRICAL INSTALLATION SHALL MEET ALL STANDARD REQUIREMENTS OF THE POWER COMPANY 4 TELEPHONE COMPANY.
21. FURNISH AND INSTALL DISCONNECT SWITCHES AND WIRING FOR HVAC SYSTEM AS PER MANUFACTURER'S RECOMMENDATIONS. CONTROLS ARE TO BE SUPPLIED BY THE HVAC CONTRACTOR, AND CONNECTED BY THE ELECTRICAL CONTRACTOR.
22. ALL RACEWAYS BELOW GROUND SHALL BE A MINIMUM OD 3/4".
23. ALL CIRCUIT BREAKERS, TWO AND THREE POLE, SHALL BE COMMON TRIP, NO TIE HANDLES OR TANDEMS SHALL BE ACCEPTABLE.
24. ALL FUSES, UNLESS NOTED OTHERWISE ON THE DRAWINGS, SHALL BE CURRENT LIMITED TYPE (CL) RATED 200,000 AIC.
25. ELECTRICAL CONTRACTOR SHALL VERIFY ALL COMPONENTS FOR ALL ELECTRICAL APPLICATIONS 4 DETERMINE THE CORRECTNESS OF SAME. ANY DISCREPANCY SHALL BE REPORTED TO THE OWNER PRIOR TO FABRICATING ANY MATERIALS, ORDERING COMPONENTS OR DOING ANY WORK.
26. CIRCUITS ON PANEL SCHEDULE (AND PLANS) ARE TO DETERMINE LOAD DATA AND SIZE. THE CONTRACTOR SHALL PROVIDE CIRCUITS AND ROUTING OF CONDUITS AND WIRING TO SUIT JOB CONDITIONS, AND BALANCE THE JOB, THROUGHOUT.
27. CHECK EQUIPMENT FOR PROPER VOLTAGE, PHASE AND AMPERAGE RATING PRIOR TO CONNECTION TO CIRCUITS.
28. PANEL BOARDS SHALL BE CIRCUIT BREAKER TYPE. VERIFY NUMBER AND SIZES OF CIRCUITS.
29. WHEN CONDUIT RUNS EXCEED 200 FEET, FULL BOXES SHALL BE INSTALLED SO THAT NO FULL EXCEEDS THIS DISTANCE.
30. ELECTRICAL EQUIPMENT AIC RATING AND FEEDER SIZE SHOWN ON THE PLANS ARE DESIGNED FOR MAX. AVAILABLE FAULT CURRENT AND MAX. ALLOWABLE VOLTAGE DROP, RESPECTIVELY.

PROJECT INFORMATION / NOTES:

DESIGN VALUES/LOADS 4 CODES
WIND DESIGN SPEED: 130 MPH, UNLESS NOTED OTHERWISE

SOIL DESIGN STATEMENT:
FOOTING DESIGN IS BASED UPON 1000 PSF SOIL BEARING PRESSURE PROVIDED BY CLEAN SAND, GRAVEL OR STONE. OTHER SOIL CONDITIONS IS: CLAY, HIGH LEVEL OF ORGANICS OR OTHER UNDESIRABLE SOILS SHALL REQUIRE FOUNDATION MODIFICATIONS.

LIVE LOADS: 1st FLOOR: 40PSF, 2nd FLOOR: 30PSF, ROOF: AS DETERMINED BY SHAPE FACTORS APPLIED TO THE WIND FORCE GENERATED BY THE DESIGN WIND SPEED.

BUILDING CODE: 2017 FLORIDA BUILDING CODE, 6th ED.

ELECTRICAL CODE: NATIONAL ELECTRICAL CODE - LATEST
LIFE SAFETY: NFPA-101 - LATEST

CONSTRUCTION DOCUMENTS
THE CUSTOMER IS RESPONSIBLE FOR DELIVERING THE REQUIRED SETS OF CONSTRUCTION DOCUMENTS TO THE PERMIT ISSUING AUTHORITIES, FOR THE ISSUANCE OF CONSTRUCTION PERMITS. THE CONTRACTOR SHALL REVIEW THE CONSTRUCTION DOCUMENTS AND VERIFY ALL DIMENSIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT PRIOR TO THE COMMENCEMENT OF ANY WORK OR FABRICATION OF ANY MATERIALS.

DO NOT SCALE OFF THESE PLANS
AMPLE DIMENSIONS ARE SHOWN ON THE PLANS TO LOCATE ALL ITEMS. SIMPLE ARITHMETIC MAY BE USED TO DETERMINE THE LOCATIONS OF THOSE ITEMS NOT DIMENSIONED.

CHANGES TO FINAL PLAN SETS

PLEASE DO NOT MAKE ANY STRUCTURAL CHANGES TO THESE PLANS WITHOUT CONSULTING WITH THE ARCHITECT. THE OWNER SHALL ASSUME ANY AND ALL LIABILITY FOR STRUCTURAL DAMAGE RESULTING FROM CHANGES MADE TO THE PLANS OR BY SUBSTITUTION OF MATERIALS DIFFERENT FROM SPECIFICATION ON THE PLANS.

INORGANIC ARSENICAL PRESSURE TREATED WOOD

SOME FRAMING MATERIALS SPECIFIED FOR THE CONSTRUCTION OF YOUR PROJECT SUCH AS SILLIS OR EXTERIOR FRAMING ARE PRESSURE TREATED. EACH PIECE IS CLEARLY MARKED FOR EASY IDENTIFICATION AND IS USUALLY GREENISH IN COLOR.

THIS WOOD HAS BEEN PRESERVED BY PRESSURE-TREATMENT WITH AN EPA-REGISTERED PRESERVATIVE. INORGANIC ARSENIC IS USED TO PROTECT IT FROM INSECT ATTACK AND DECAY. EXPOSURE TO TREATED WOOD MAY PRESENT CERTAIN HAZARDS, THEREFORE, PRECAUTIONS SHOULD BE TAKEN BOTH WHEN HANDLING THE TREATED WOOD AND IN DETERMINING WHERE TO USE OR DISPOSE OF THE TREATED WOOD.

FOR FURTHER INFORMATION ON THE USE OF AND DISPOSAL OF INORGANIC ARSENIC PRESSURE TREATED WOOD, PLEASE REFER TO THE EPA MATERIAL SAFETY SHEET DEALING WITH THIS PRODUCT.

General Roofing NOTES:

DECK REQUIREMENTS:
ASPHALT SHINGLES SHALL BE FASTENED TO SOLIDLY SHEATHED DECKS.

SLOPE:
ASPHALT SHINGLES SHALL BE USED ONLY ON ROOF SLOPES OF 2:12 OR GREATER. FOR ROOF SLOPES FROM 2:12 TO 4:12, DBL. UNDERLAYMENT IS REQUIRED.

UNDERLAYMENT:
UNLESS OTHERWISE NOTED, UNDERLAYMENT SHALL CONFORM W/ ASTM D 226, TYPE I, OR ASTM D 4863, TYPE I.

SELF-ADHERING POLYMER MODIFIED BITUMEN SHEET:
SELF ADHERING POLYMER MODIFIED BITUMEN SHALL COMPLY W/ ASTM D 1910.

ASPHALT SHINGLES:
ASPHALT SHINGLES SHALL HAVE SELF SEAL STRIPS OR BE INTERLOCKING, AND COMPLY WITH ASTM D 225 OR ASTM D 3462.

FASTENERS:
FASTENERS FOR ASPHALT SHINGLES SHALL BE GALVANIZED, STAINLESS STEEL, ALUMINUM OR COPPER ROOFING NAILS, MINIMUM 12 GAUGE SHANK WITH A MINIMUM 3/8 INCH DIAMETER HEAD, OF A LENGTH TO PENETRATE THROUGH THE ROOFING MATERIAL AND A MINIMUM 3/4" INTO THE ROOF SHEATHING. WHERE THE SHEATHING IS LESS THAN 3/4" THICK, THE NAILS SHALL PENETRATE THROUGH THE SHEATHING.

ATTACHMENT:
ASPHALT SHINGLES SHALL BE SECURED TO THE ROOF WITH NOT LESS THAN FOUR FASTENERS PER STRIP SHINGLE OR TWO FASTENERS PER INDIVIDUAL SHINGLE. WHERE ROOFS LOCATED IN BASIC WIND SPEED OF 110 MPH OR GREATER, SPECIAL METHODS OF FASTENING ARE REQUIRED. UNLESS OTHERWISE NOTED, ATTACHMENT OF ASPHALT SHINGLES SHALL CONFORM WITH ASTM D 3161 OR M-DC PA 1071-95.

UNDERLAYMENT APPLICATION:
FOR ROOF SLOPES FROM 2:12 TO 4:12, UNDERLAYMENT SHALL BE A MINIMUM OF TWO LAYERS APPLIED AS FOLLOWS:
1. STARTING AT THE EAVE, A 19 INCH STRIP OF UNDERLAYMENT SHALL BE APPLIED PARALLEL WITH THE EAVE AND FASTENED SUFFICIENTLY TO STAY IN PLACE.
2. STARTING AT THE EAVE, 36 INCH WIDE STRIPS OF UNDERLAYMENT FELT SHALL BE APPLIED OVERLAPPING SUCCESSIVE SHEETS 19 INCHES AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

FOR ROOF SLOPED 4:12 AND GREATER, UNDERLAYMENT SHALL BE A MINIMUM OF ONE LAYER OF UNDERLAYMENT FELT APPLIED AS FOLLOWS:
1. STARTING AT THE EAVE, UNDERLAYMENT SHALL BE APPLIED SHINGLE FASHION PARALLEL TO THE EAVE, LAPPED 2 INCHES, AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

BASE AND CAP FLASHINGS:
BASE AND CAP FLASHING SHALL BE INSTALLED IN ACCORDANCE W/ MFR'S INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE EITHER CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS 0.019 INCH OR MINERAL SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 11 LBS PER 100 SQUARE FEET. CAP FLASHING SHALL BE CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS OF 0.019 INCH.

VALLEYS:
VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE W/ MANUFACTURER'S INSTALLATION INSTRUCTIONS BEFORE APPLYING ASPHALT SHINGLES. VALLEY LININGS OF THE FOLLOWING TYPES SHALL BE PERMITTED:
1. OPEN VALLEYS LINED WITH METAL. THE VALLEY LINING SHALL BE AT LEAST 16" WIDE AND OF ANY OF THE CORROSION RESISTANT METALS IN FBC TABLE 1507.3.3.2.
2. OPEN VALLEYS: VALLEY LINING OF TWO PLIES OF MINERAL SURFACE ROLL ROOFING SHALL BE PERMITTED. THE BOTTOM LAYER SHALL BE 18 INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.
3. CLOSED VALLEYS: VALLEY LINING SHALL BE ONE OF THE FOLLOWING:
1. BOTH TYPES 1 AND 2 ABOVE COMBINED.
2. ONE PLY OF SMOOTH ROLL ROOFING AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 224.
3. SPECIALITY UNDERLAYMENT AT LEAST 36 INCHES WIDE 4 COMPLYING WITH ASTM D 1910.


REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
GENERAL NOTES



DATE:

20 AUG 2020

CON#:


2K2064

SHEET:

G.3
3 OF 3

AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

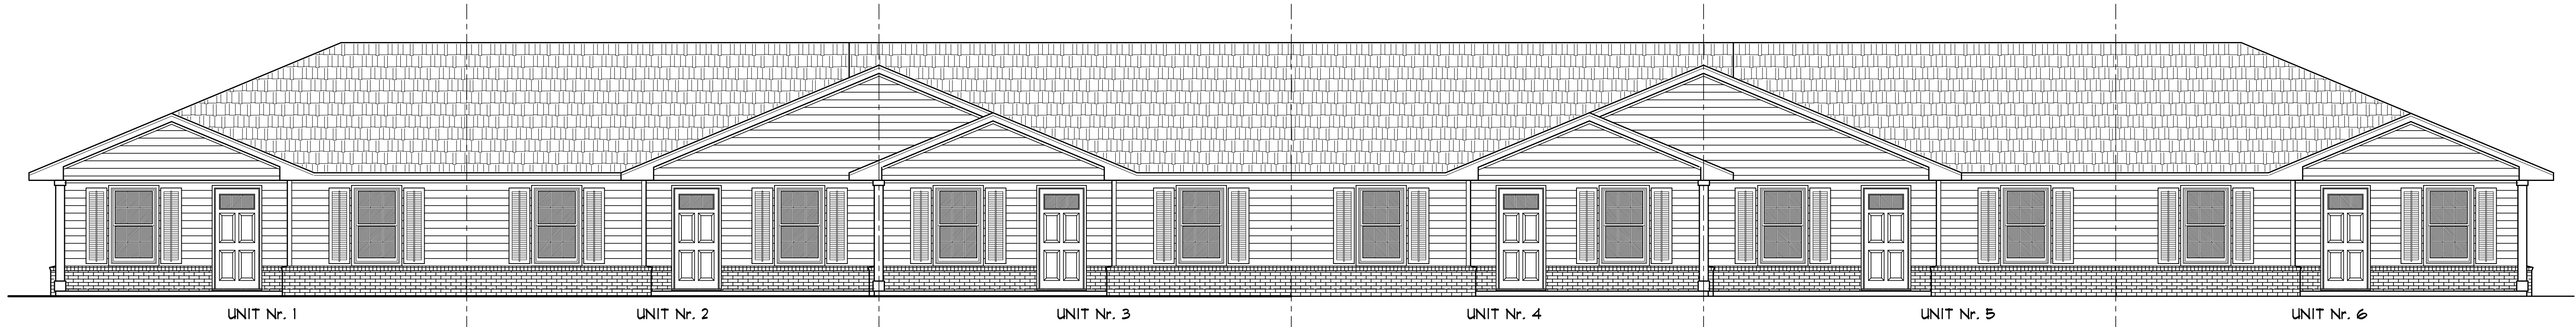


SOUTH ELEVATION

SCALE: 3/16" = 1'-0"




GRAPHIC SCALE

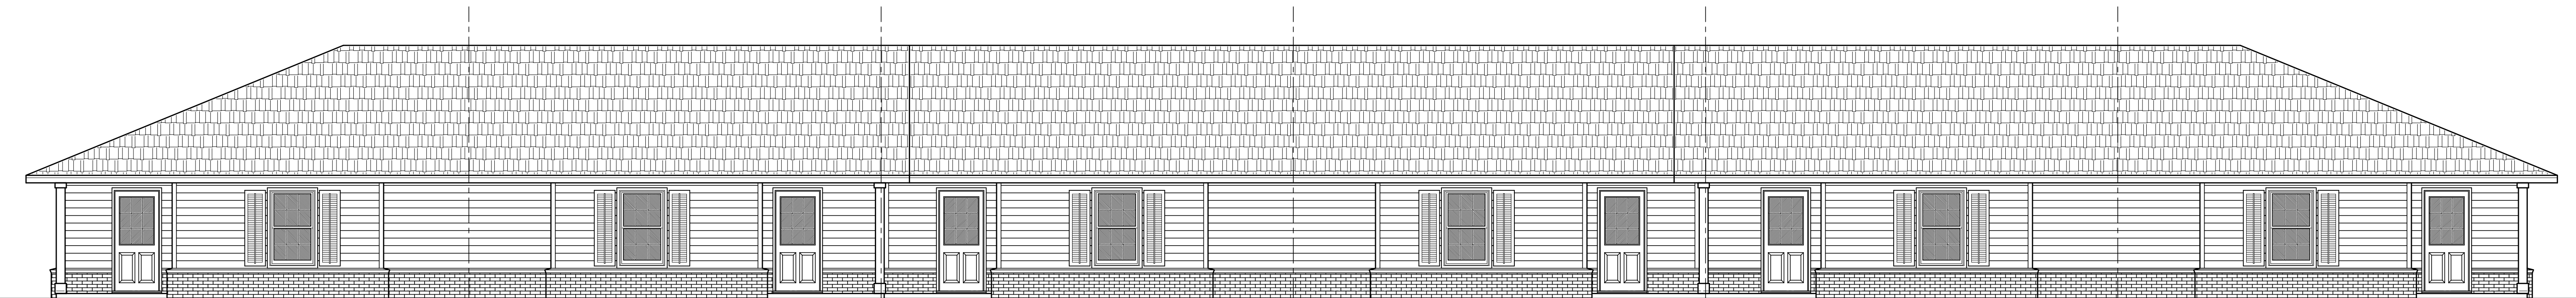

NORTH ELEVATION

SCALE: 3/16" = 1'-0"

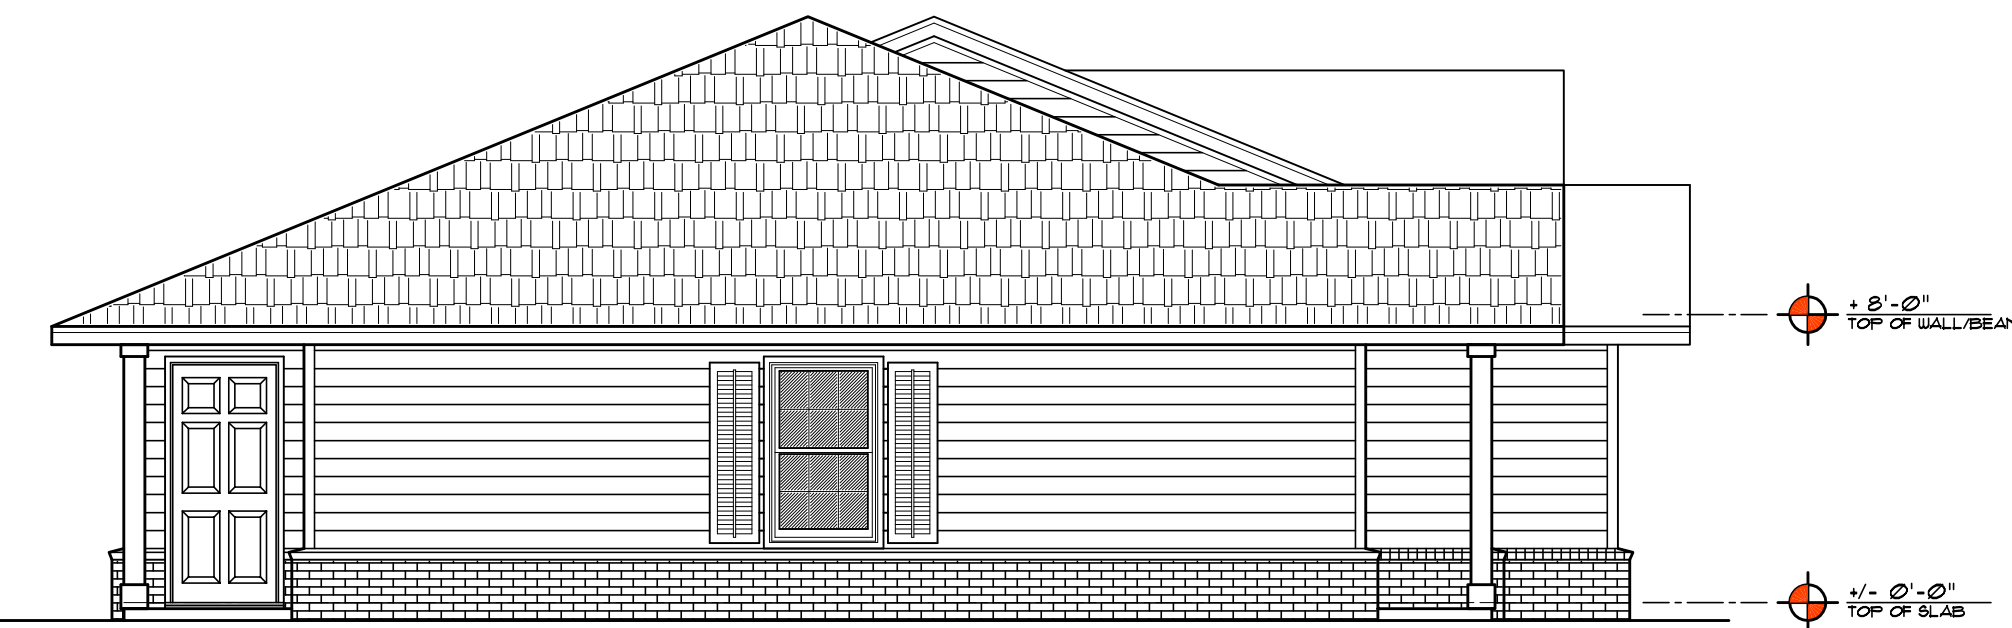

WEST ELEVATION

SCALE: 3/16" = 1'-0"

| WINDOW SCHEDULE | | | |
|-----------------|--|--|---------------|
| MARK | DESCRIPTION | INSTALLATION | MODEL |
| 3050 | SINGLE HUNG ALUM. SASH W/ INSUL. GLASS | 1" ROOFING NAILS - 3 PER FLANGE, MAX. 18" O.C. | SERIES 6050 - |

ALL WINDOWS ARE INSULATED AND WEATHERSTRIPPED AS MANUFACTURED BY "MI HOME PRODUCTS, INC."
- OTHER MANUFACTURERS/PRODUCTS SHALL BE CONSIDERED AS EQUAL IF THEIR WIND DESIGN PERFORMANCE MEETS OR EXCEEDS THESE UNITS

NOTE, VERIFY ROUGH OPENING WINDOW REQUIREMENTS PRIOR TO CONSTRUCTION.

NOTE !!!


EXTERIOR DOORS SHALL MEET OR EXCEED THE WIND RESISTANCE OF THE FOLLOWING PRODUCT:

SERIES ENTERGY 6-8 W/E INSULING OPAQUE RESIDENTIAL INSULATED STEEL DOOR W/ STEEL FRAME AS MFG'D BY "FREMDOR ENTRY SYSTEMS"

NOTE !!!

WINDOW ASSEMBLIES SHALL MEET OR EXCEED THE WIND RESISTANCE OF THE FOLLOWING PRODUCTS:

"MI HOME PRODUCTS, INC." SERIES 450/650 ALUMINUM WINDOWS, SINGLE HUNG, 1, 2 & 3 MULLED UNITS, PICTURE WINDOWS & SLIDING GLASS DOORS PER ASTM E 283, ASTM E 330 & ASTM E 541

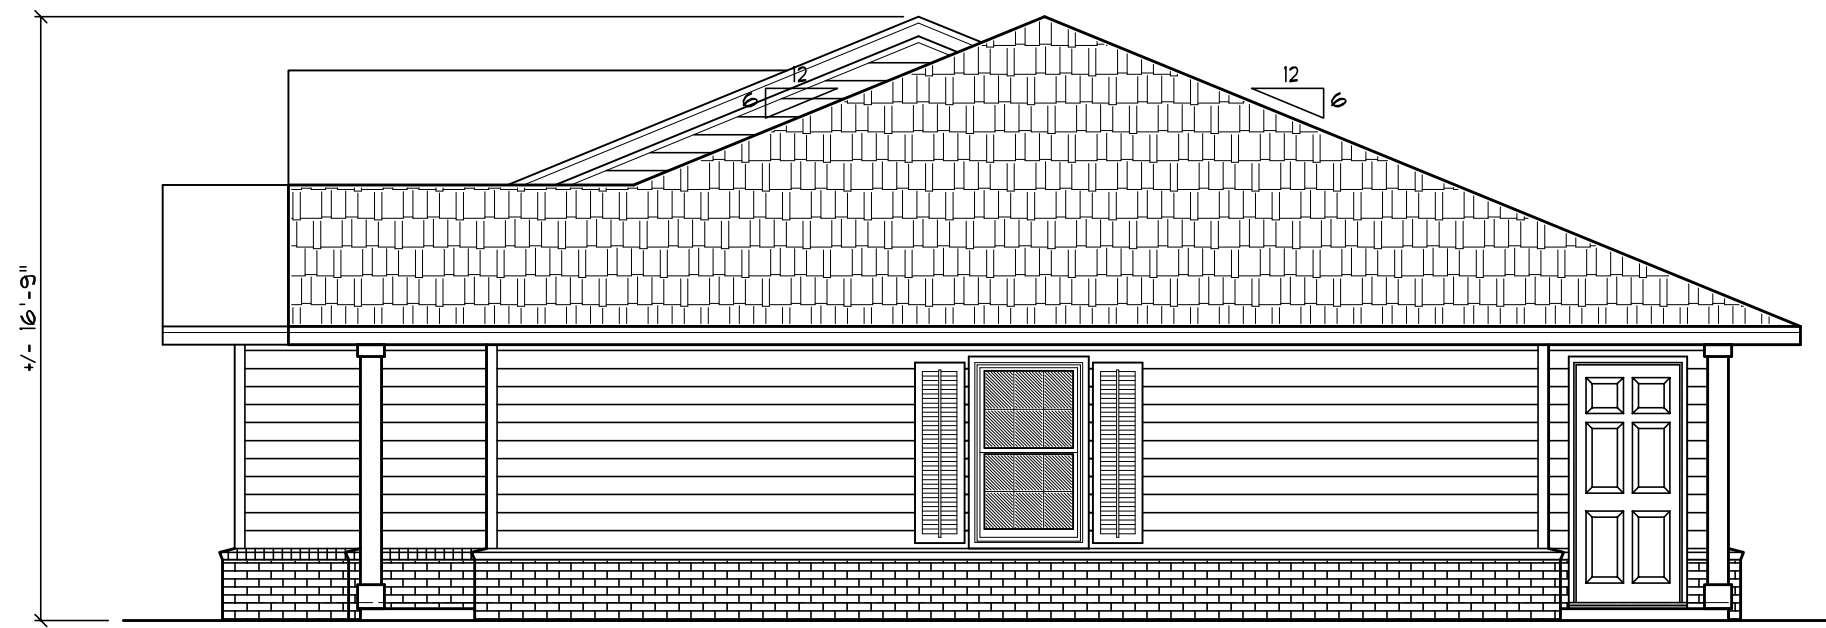

EAST ELEVATION

SCALE: 3/16" = 1'-0"

NOTE !!!



ROOF SHINGLES SHALL BE OF THE FOLLOWING MANUFACTURERS AND MODELS:

| TAKKO ROOFING PRODUCTS | GAF MATERIALS CORP. | ELK PREMIUM ROOFING |
|------------------------|--------------------------------|--------------------------------|
| GLASS-SEAL AIR | ROYAL SOVEREIGN | RAISED PROFILE # |
| ELITE GLASS-SEAL AIR | HARGIS | PRESTIGE HIGH DEFINITION # |
| HERITAGE 30 AIR | LEATHERMAX | PRESTIGE 25 # |
| HERITAGE 40 AIR | SLATELINE | PRESTIGE 35 # |
| HERITAGE 50 AIR | GRAND CANYON | PRESTIGE 35 # |
| | GRAND SEQUOIA | PRESTIGE 1" # |
| | COUNTRY HAVEN | PRESTIGE PLUS # |
| | COUNTRY ESTATES | PRESTIGE GALLERY COLLECTION # |
| | THREELINE 30 | CAPSTONE # |
| | THREELINE SELECT 40 | |
| | THREELINE ULTRA | ELK REQUIRED NAILS/SHINGLE = 4 |
| | SENTINEL | # = 5 NAILS |
| | | # = 6 NAILS |
| | GAF REQUIRED NAILS/SHINGLE = 4 | |

THESE SHINGLES MEET THE REQUIREMENTS OF ASTM D-3161 TYPE 1 MODIFIED TO 110 MPH WINDS & FBC TAS 100, USING THE SPECIFIED NAILS

EXTERIOR FINISH MATERIALS:

1. CONT. RIDGE VENT TO MATCH ROOFING
2. FINISH ROOFING AS SELECTED BY OWNER
3. MTL. FLASHING ON 1X6 CYPRESS FASCIA
4. PORCH BEAM - SEE PLANS FOR SIZE
5. STEEL ENTRY DOOR, STYLE AS SELECTED BY THE OWNER - PAINTED FINISH
6. BRICK VENEER - COLOR, STYLE & PATTERN AS SELECTED BY THE OWNER
1. CONCRETE PORCH DECK, W/ WOOD FLOAT FINISH & TOOLED EDGES
8. SINGLE HUNG ALUMINUM WINDOWS W/ DBL. GLAZING, AS SELECTED BY OWNER
9. PORCH POST - SEE PLANS FOR SIZE
10. HARDIEBOARD, STYLE & COLOR AS SELECTED BY THE OWNER
11. VINYL DECO SHUTTERS

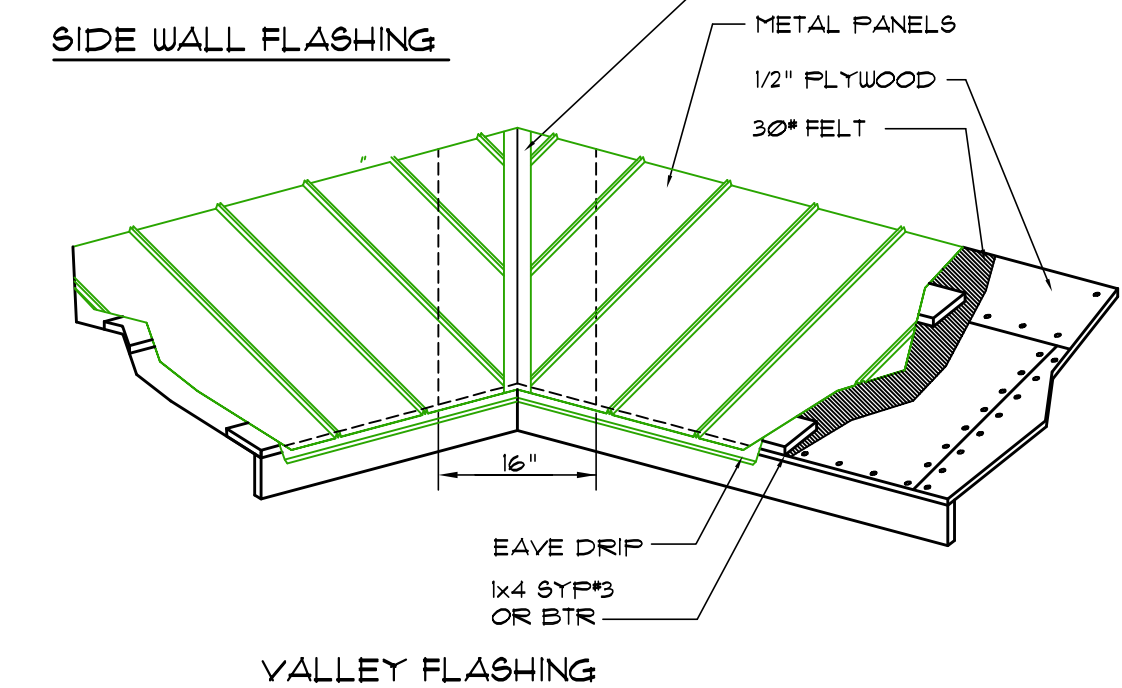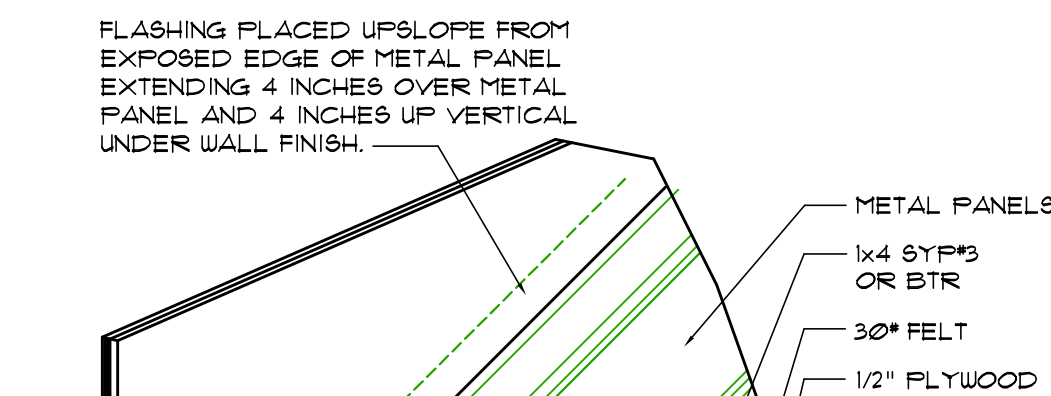

OPT'L METAL ROOFING

SCALE: NONE

Z


REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
BUILDING ELEVATIONS



**NICHOLAS
GEISLER
ARCHITECT**
N.C.A.R.B. Certified
1758 NW Browns Rd.
Lakeland, FL 33805
356-365-4355

DATE:

20 AUG 2020

COM#:

2K2064


SHEET:

C6.1


1 OF 1

AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

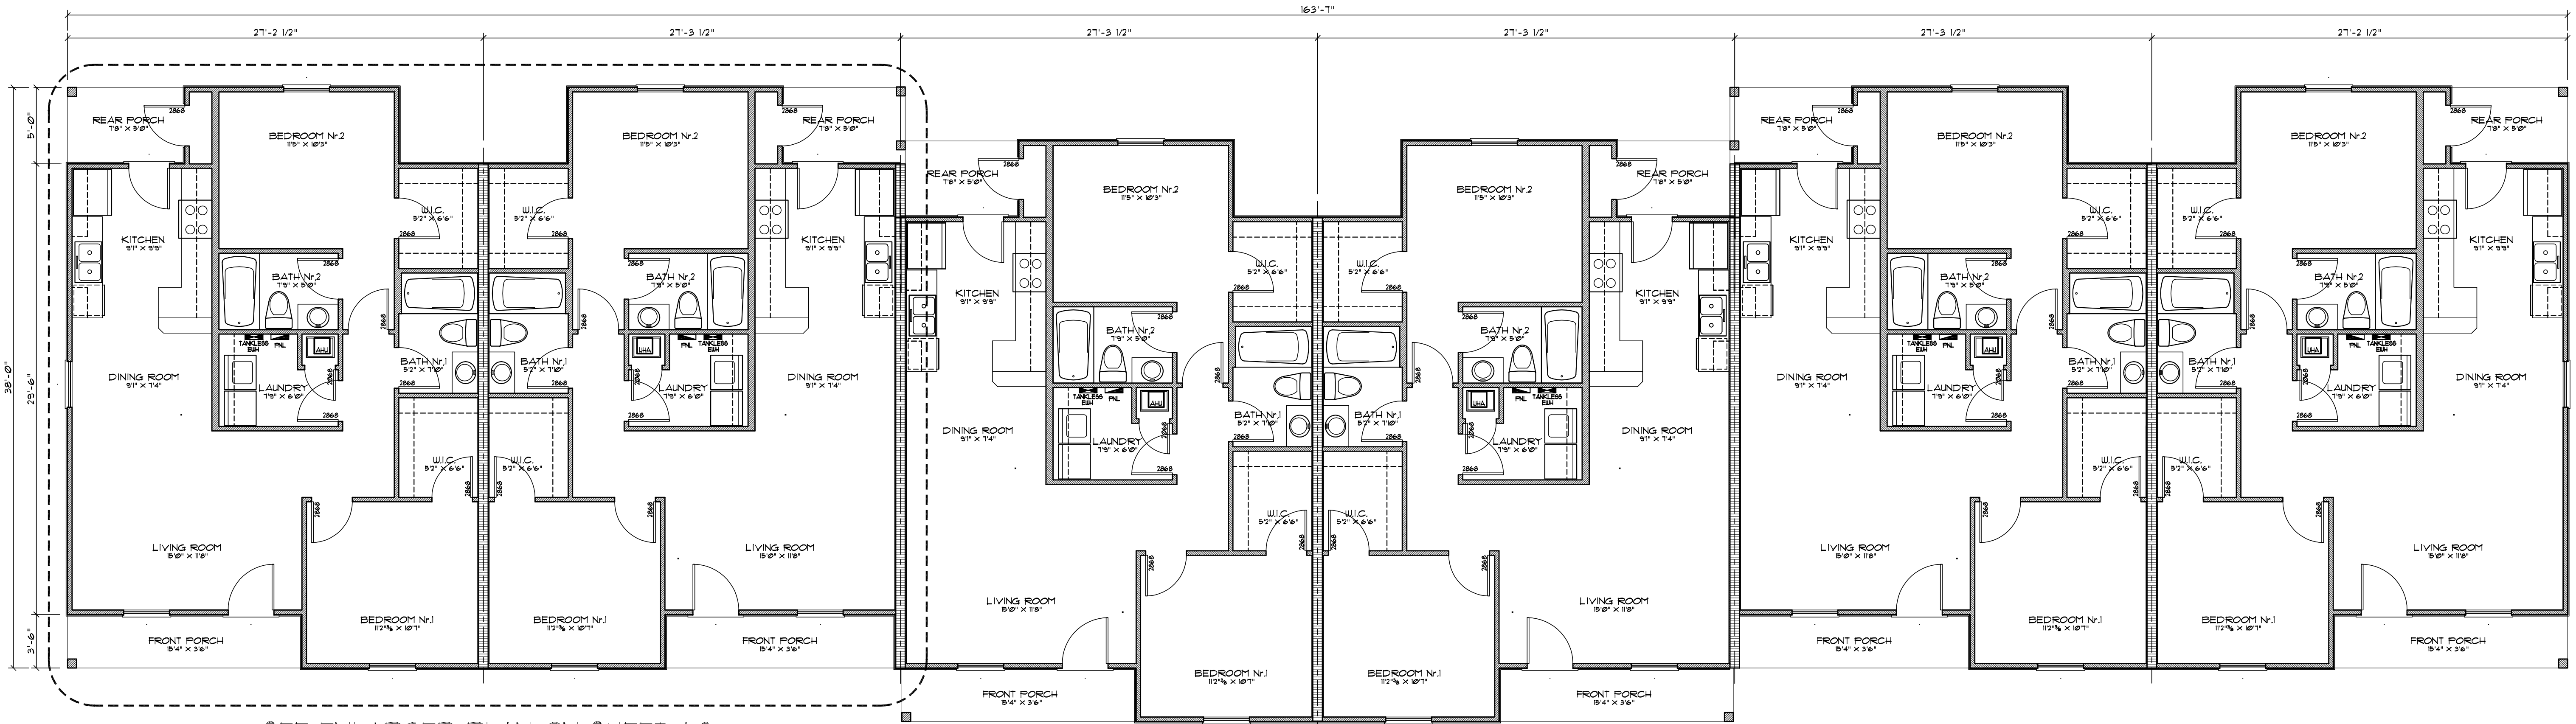

SEE ENLARGED PLAN ON SHEET A.3



COMPOSITE FLOOR PLAN

SCALE: 3/16" = 1'-0"



AREA CALCULATION

| | |
|-------------------------|-----------|
| GROSS FLOOR AREA: | 5497.0 SF |
| GROSS FRONT PORCH AREA: | 230.0 SF |
| GROSS REAR PORCH AREA: | 322.0 SF |

TOTAL AREA: 6049.0 SF




NOTE:
CABINETS, COUNTERS, SHELVES AND THE LIKE, SHOWN ON THIS PLAN SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS OF QUALITY AS OUTLINED IN THE NOTES TITLED "GENERAL MILLWORK NOTES", AND SHALL INCLUDE SUCH FEATURES, HARDWARE AND FINISHES AS DIRECTED BY THE OWNER. THE PLAN VIEWS INDICATED ARE FOR GENERAL LOCATION AND EXTENT OF THE WORK - UNLESS DETAILED CABINET PLANS ARE INCLUDED WITH THIS PLANS PACKAGE ALL OTHER PHYSICAL CHARACTERISTICS SHALL BE AS DIRECTED BY THE OWNER.

NOTE:
PROVIDE 2X6 BACKING AT ALL OVERHEAD CABINET LOCATIONS, FLUSH WITH FACE OF FRAMING - TOP OF BACKING TO BE 1'-0" AFF.

TEMPERED GLASS NOTES:

THE FOLLOWING SHALL BE CONSIDERED SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSES OF GLAZING:

- GLAZING IN SWINGING DOORS AND FIXED AND SLIDING PANELS OF SLIDING (PATIO) DOOR ASSEMBLIES.
- GLAZING IN DOORS AND WALLS OF ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS AND OTHER SUCH FACILITIES WHERE SUCH GLAZING IS LOCATED 36 INCHES (914 MM) OR LESS, MEASURED HORIZONTALLY, FROM A STANDING OR WALKING SURFACE WITHIN THE ENCLOSURE AND WHERE THE BOTTOM EDGE OF THE EXPOSED GLAZING IS LESS THAN 60 INCHES (1524 MM), MEASURED VERTICALLY, ABOVE SUCH STANDING OR WALKING SURFACES.
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24-INCH (610 MM) RADIUS OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS LESS THAN 60 INCHES (1524 MM) ABOVE THE FLOOR OR WALKING SURFACE.
- EXCEPTION: GLAZING IN WALLS PERPENDICULAR TO THE PLANE OF THE DOOR IN A CLOSED POSITION IN GROUP R3 OR WITHIN DWELLING UNITS IN GROUP R2 SHALL BE SUBJECT TO 2004 FBC 2405.2(4).
- GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL, OTHER THAN THOSE LOCATIONS DESCRIBED IN ITEMS 2 AND 3 ABOVE, THAT MEETS ALL OF THE FOLLOWING CONDITIONS:
 - EXPOSED AREA OF AN INDIVIDUAL PANE GREATER THAN 9 SQ FT (0.84 M²).
 - BOTTOM EDGE LESS THAN 18 INCHES (457 MM) ABOVE THE FLOOR.
 - TOP EDGE GREATER THAN 36 INCHES (914 MM) ABOVE THE FLOOR.
 - ONE OR MORE WALKING SURFACES WITHIN 36 INCHES (914 MM) HORIZONTALLY OF THE PLANE OF THE GLAZING.

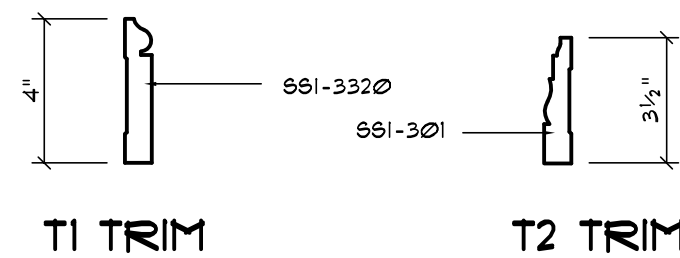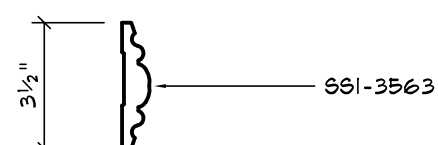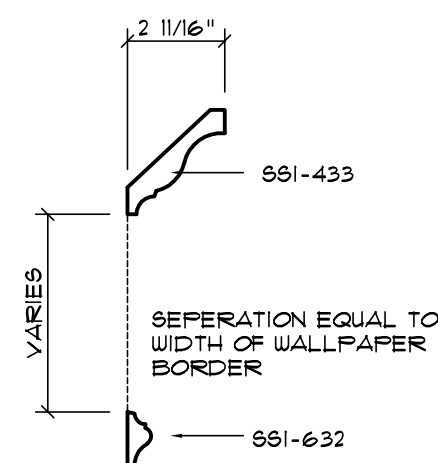

NOTE !!!
ALL PROFILES AS PER S&S CRAFTSMAN, INC., TAMPA FLORIDA
TRIM WOOD SPECIES SHALL BE "POPLAR"

Wall/Ceiling Trim DETAIL

SCALE: 3" = 1'-0"

ALTERNATE N#2:
FOR TRIM TYPE T1, 2" DENTIL MOULDING MAY BE
INSERTED BETWEEN 991-433 AND 991-3349



Int. Wall Trim DETAIL

SCALE: 1/2" = 1'-0"

REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
OVERALL FLOOR PLAN

48 Years of Service
1972 - 2020
N.P. Geisler, Architect
Architect

**NICHOLAS
PLASTER
GEISLER
ARCHITECT**
N.C.A.R.B. Certified

DATE:

20 AUG 2020

COM#:

2K2064


SHEET:

A.2

2 OF 9


AR00007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

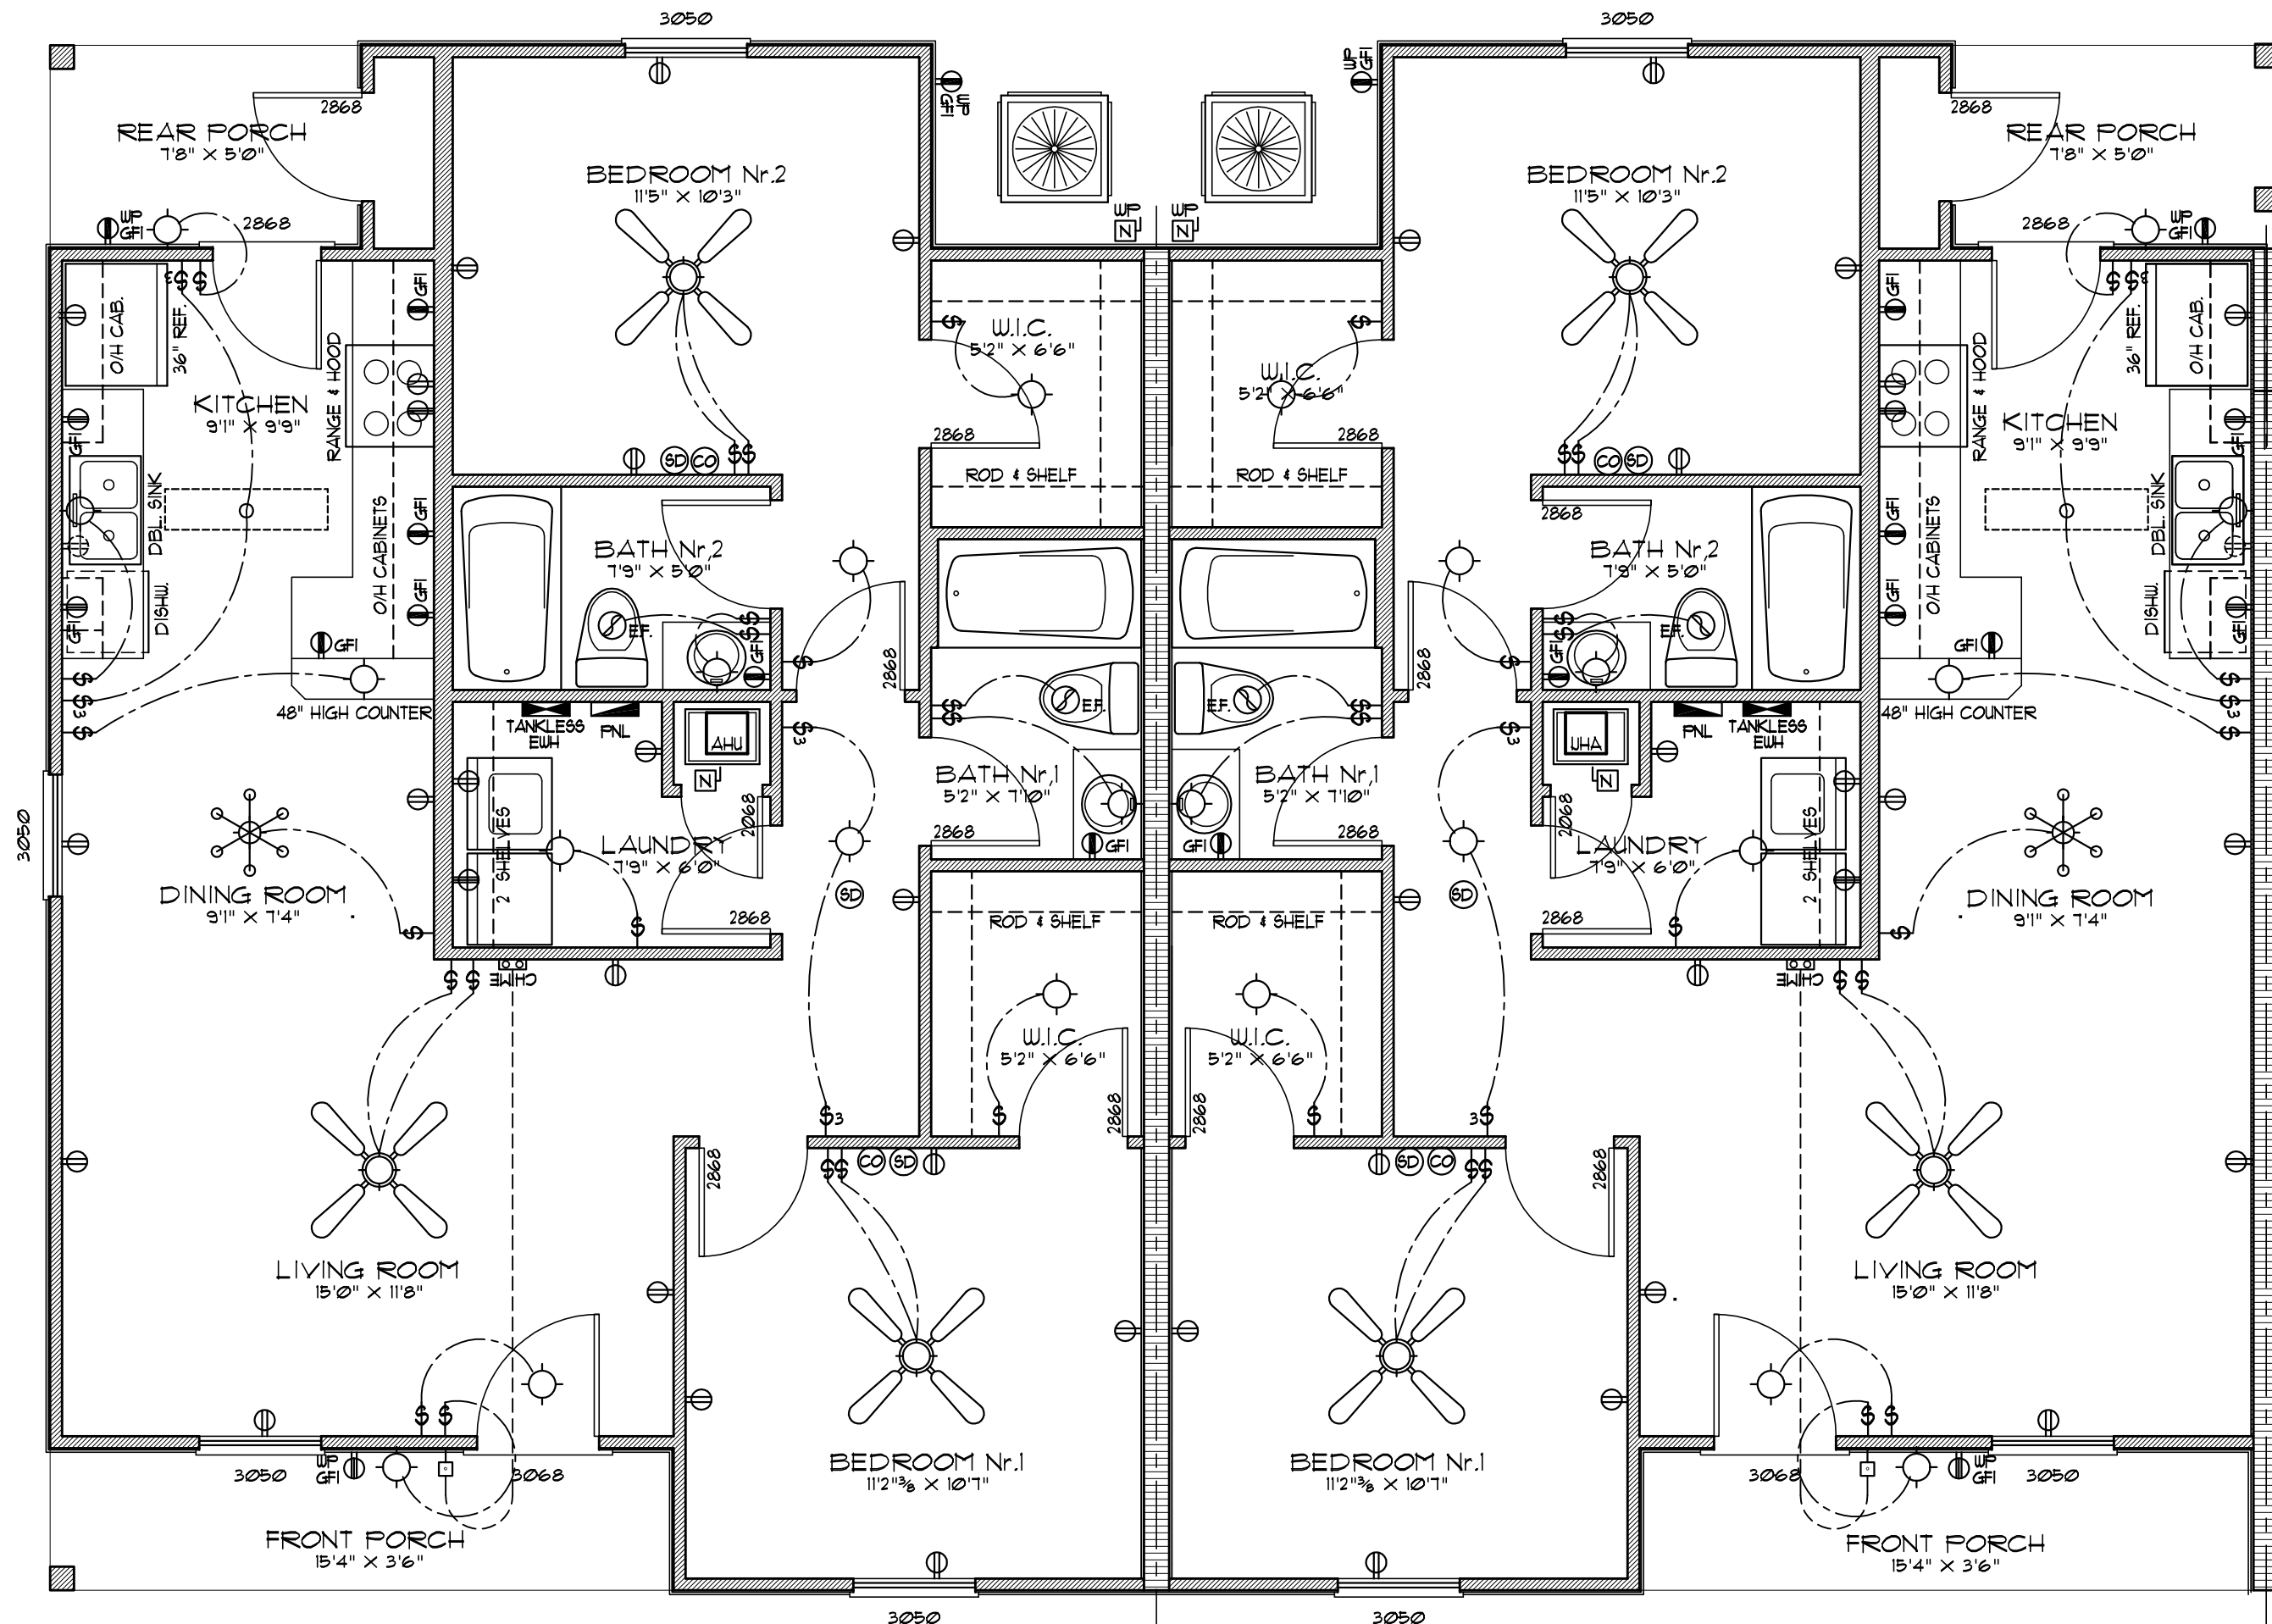

ENLARGED DBL. UNIT PLAN

SCALE: 1/4" = 1'-0"

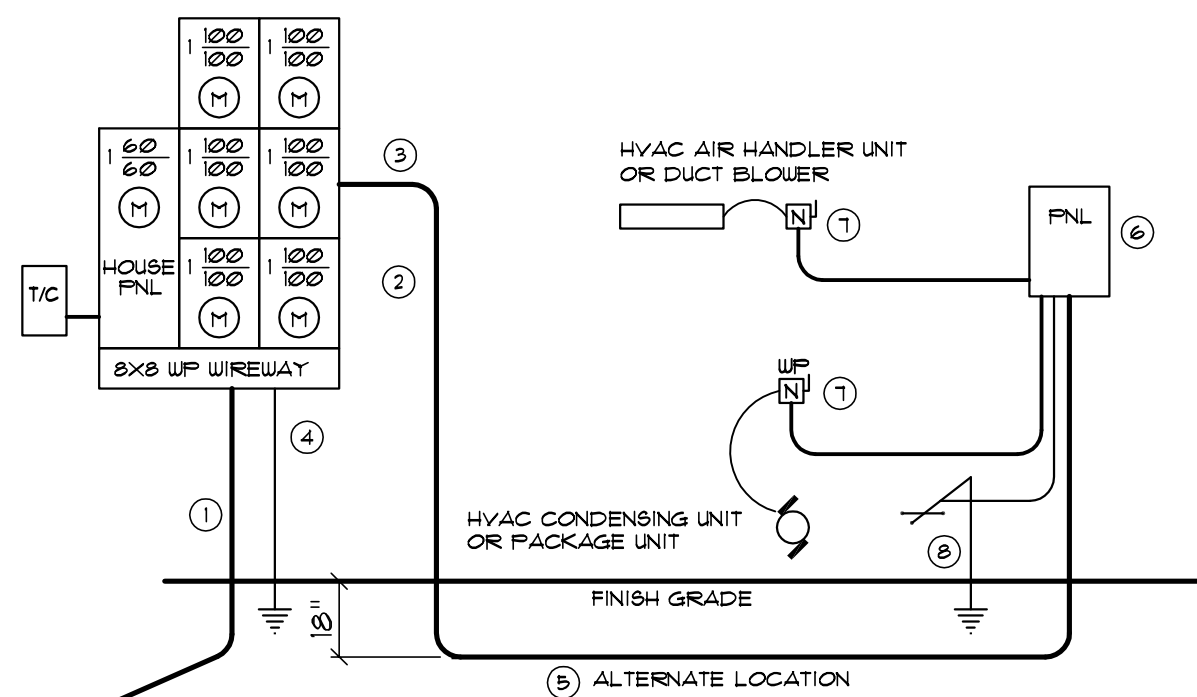

- Service/Feeder Entrance Conductors: 2 - 3/4" rigid conduit, min. 18" deep, w/ continuous Ground Bonding Conductor. Service/Entrance Conductors shall not be spliced except that bolted connections at the Meter, Disconnecting Devices and Panel shall be allowed.
- Meter Enclosure, weatherproof, UL Listed.
- Main Disconnect Switch: fused or Main BRKR, weatherproof, UL Listed.
- Service entrance Ground: 3/4" x iron/steel rod x 8'-0" long and/or concrete encased foundation steel rebar x 20'-0" long. Grounding Conductor shall be bonded to each piece of Service/Entrance Equipment, and shall be sized per Item 5, below.
- 100 AMPERE FEEDER: 3-5-USE-Cu, 1-4-Cu-GND, 1/4" Conduit.
- House Panel (FNL): UL Listed, sized per schedule.
- Equipment Disconnect Switch: non-fused, in weatherproof enclosure, size according to Panel Schedule loads.
- Provide Ground Bond Wire to metal piping, size in accordance with the Service Ground Conductor.

NOTE!
THE MINIMUM AIC RATING FOR PANEL BOARDS, BRKRS AND DISCONNECT SWITCHES SHALL BE 22,000 AIC.

SERVICE ENTRANCE SIZE:
4 X 200A X 80% = 640 AMPERS
USE: 2 - 3" CONDUITS EA. W/ 2 - 400MCM - THW - Cu
& 1 - 350MCM THW - Cu - NEUT. & 1 #3 Cu GND.

ELECTRICAL RISER DIAGRAM: 270A

SCALE: NONE

HOUSE PANEL SCHEDULE

PANEL "L": 30A - MLO - 120/240V - 1ø - 4 WIRE
4 SLOT - FLUSH MOUNT

| Cir. Nr. | Location | Trip Poles | Wir Size | Load |
|-----------------------|---------------|------------|----------|-------|
| 1-2 | GEN. LIGHTING | 20A/1P | 12NM | 1600W |
| 3 | SERV. RECPT. | - | - | 720W |
| 4-6 | SPARE | - | - | 1200W |
| TOTAL CONNECTED LOAD: | | | | 2520W |

SERVICE ENTRANCE ELECTRICAL COMPUTATIONS

| | |
|-----------------------------|----------|
| Dwelling Unit Load | |
| 24843W X 6 Units = | 149034W |
| Load @ 39% = 149034 x .39 = | 58146.7W |
| House Load @ 100% = | 25200W |
| Total Demand Load = | 60666.7W |

FEEDER SIZE: 60666.7W / 240V = 252.8 amperes
USE: 2 - 400MCM-THW-AL, 1-250MCM-AL-NEUT.
1-1/0-AL-GND, 3" Conduit

GENERAL ELEC. NOTES

- ALL DIMENSIONS ARE FROM FINISHED WALL, CEILING AND FLOOR MATERIALS. DIMENSION SHOWN AT ROUGH-IN IS TO CENTERLINE IN ALL CASES.
- ALL ELECTRICAL MATERIALS INCLUDING WIRE, CONDUIT, STARTERS, SWITCHES ETC. SHALL BE FURNISHED BY THE ELECTRICAL CONTRACTOR.
- FINAL CONNECTIONS FROM ROUGH-IN TO EQUIPMENT AND ALL INTERWIRING BETWEEN EQUIPMENT SHALL BE PERFORMED BY THE ELECTRICAL CONTRACTOR.
- ALL CONVENIENCE OUTLETS TO BE PROVIDED WITH 15 AMP CIRCUIT

TYPICAL APARTMENT UNIT ELECTRICAL COMPUTATIONS

General Lighting/Receptacles @ 3w/sf
916.2 sf x 3w = 2748.6w
Sm. Appliance Circuits (1 @ 1500w) 1500.0w
Sub-Total 4248.6w
1st 3KW @ 100% 3000.0w
Balance @ 35% 437.0w

Fixed Appliances:
Refrigerator 1200.0w
Clg. Fans (3 @ 360w) 1080.0w
EWH 7620.0w
Spares (4 @ 400w) 1600.0w
Sub-Total 11500.0w
Load @ 75% DF. 8625.0w

100% Demand Factor Loads:
Range 8000.0w
HVAC System (2.0T Heat Pump) 1900.0w

Total Demand Load: 21562.0w


FEEDER SIZE: 20810.0w / 240V = 86.71 amperes
USE: 3 #3 THW w/ 1 #4 Cu GND / 1 1/4" C.

TYPICAL APARTMENT UNIT PANEL SCHEDULE

PANEL "L": 100A - MLO - 120/240V - 1ø - 4 WIRE
16 SLOT - FLUSH MOUNT

| Cir. Nr. | Location | Trip Poles | Wire Size | Load |
|----------|---------------------|------------|-----------|-------|
| 1-4 | Lighting/Recept. | 15A/1P | 14NM | 2743W |
| 5 | Ceiling Fans | - | - | 1080W |
| 6 | Sm. Kit. Appliances | 20A/1P | 12NM | 1500W |
| 7 | Refrigerator | 15A/1P | 14NM | 1200W |
| 8/10 | EWH | 40A/2P | 8NM | 7620W |
| 9/11 | Range | 50A/2P | 6NM | 8000W |
| 12/14 | HVAC CU | 20A/2P | 12NM | 1400W |
| 15 | HVAC AHU | 15A/1P | 14NM | 500W |
| 16-17 | Spares | - | - | 800W |
| 18-20 | Space | - | - | 0W |

TOTAL CONNECTED LOAD: 24843W

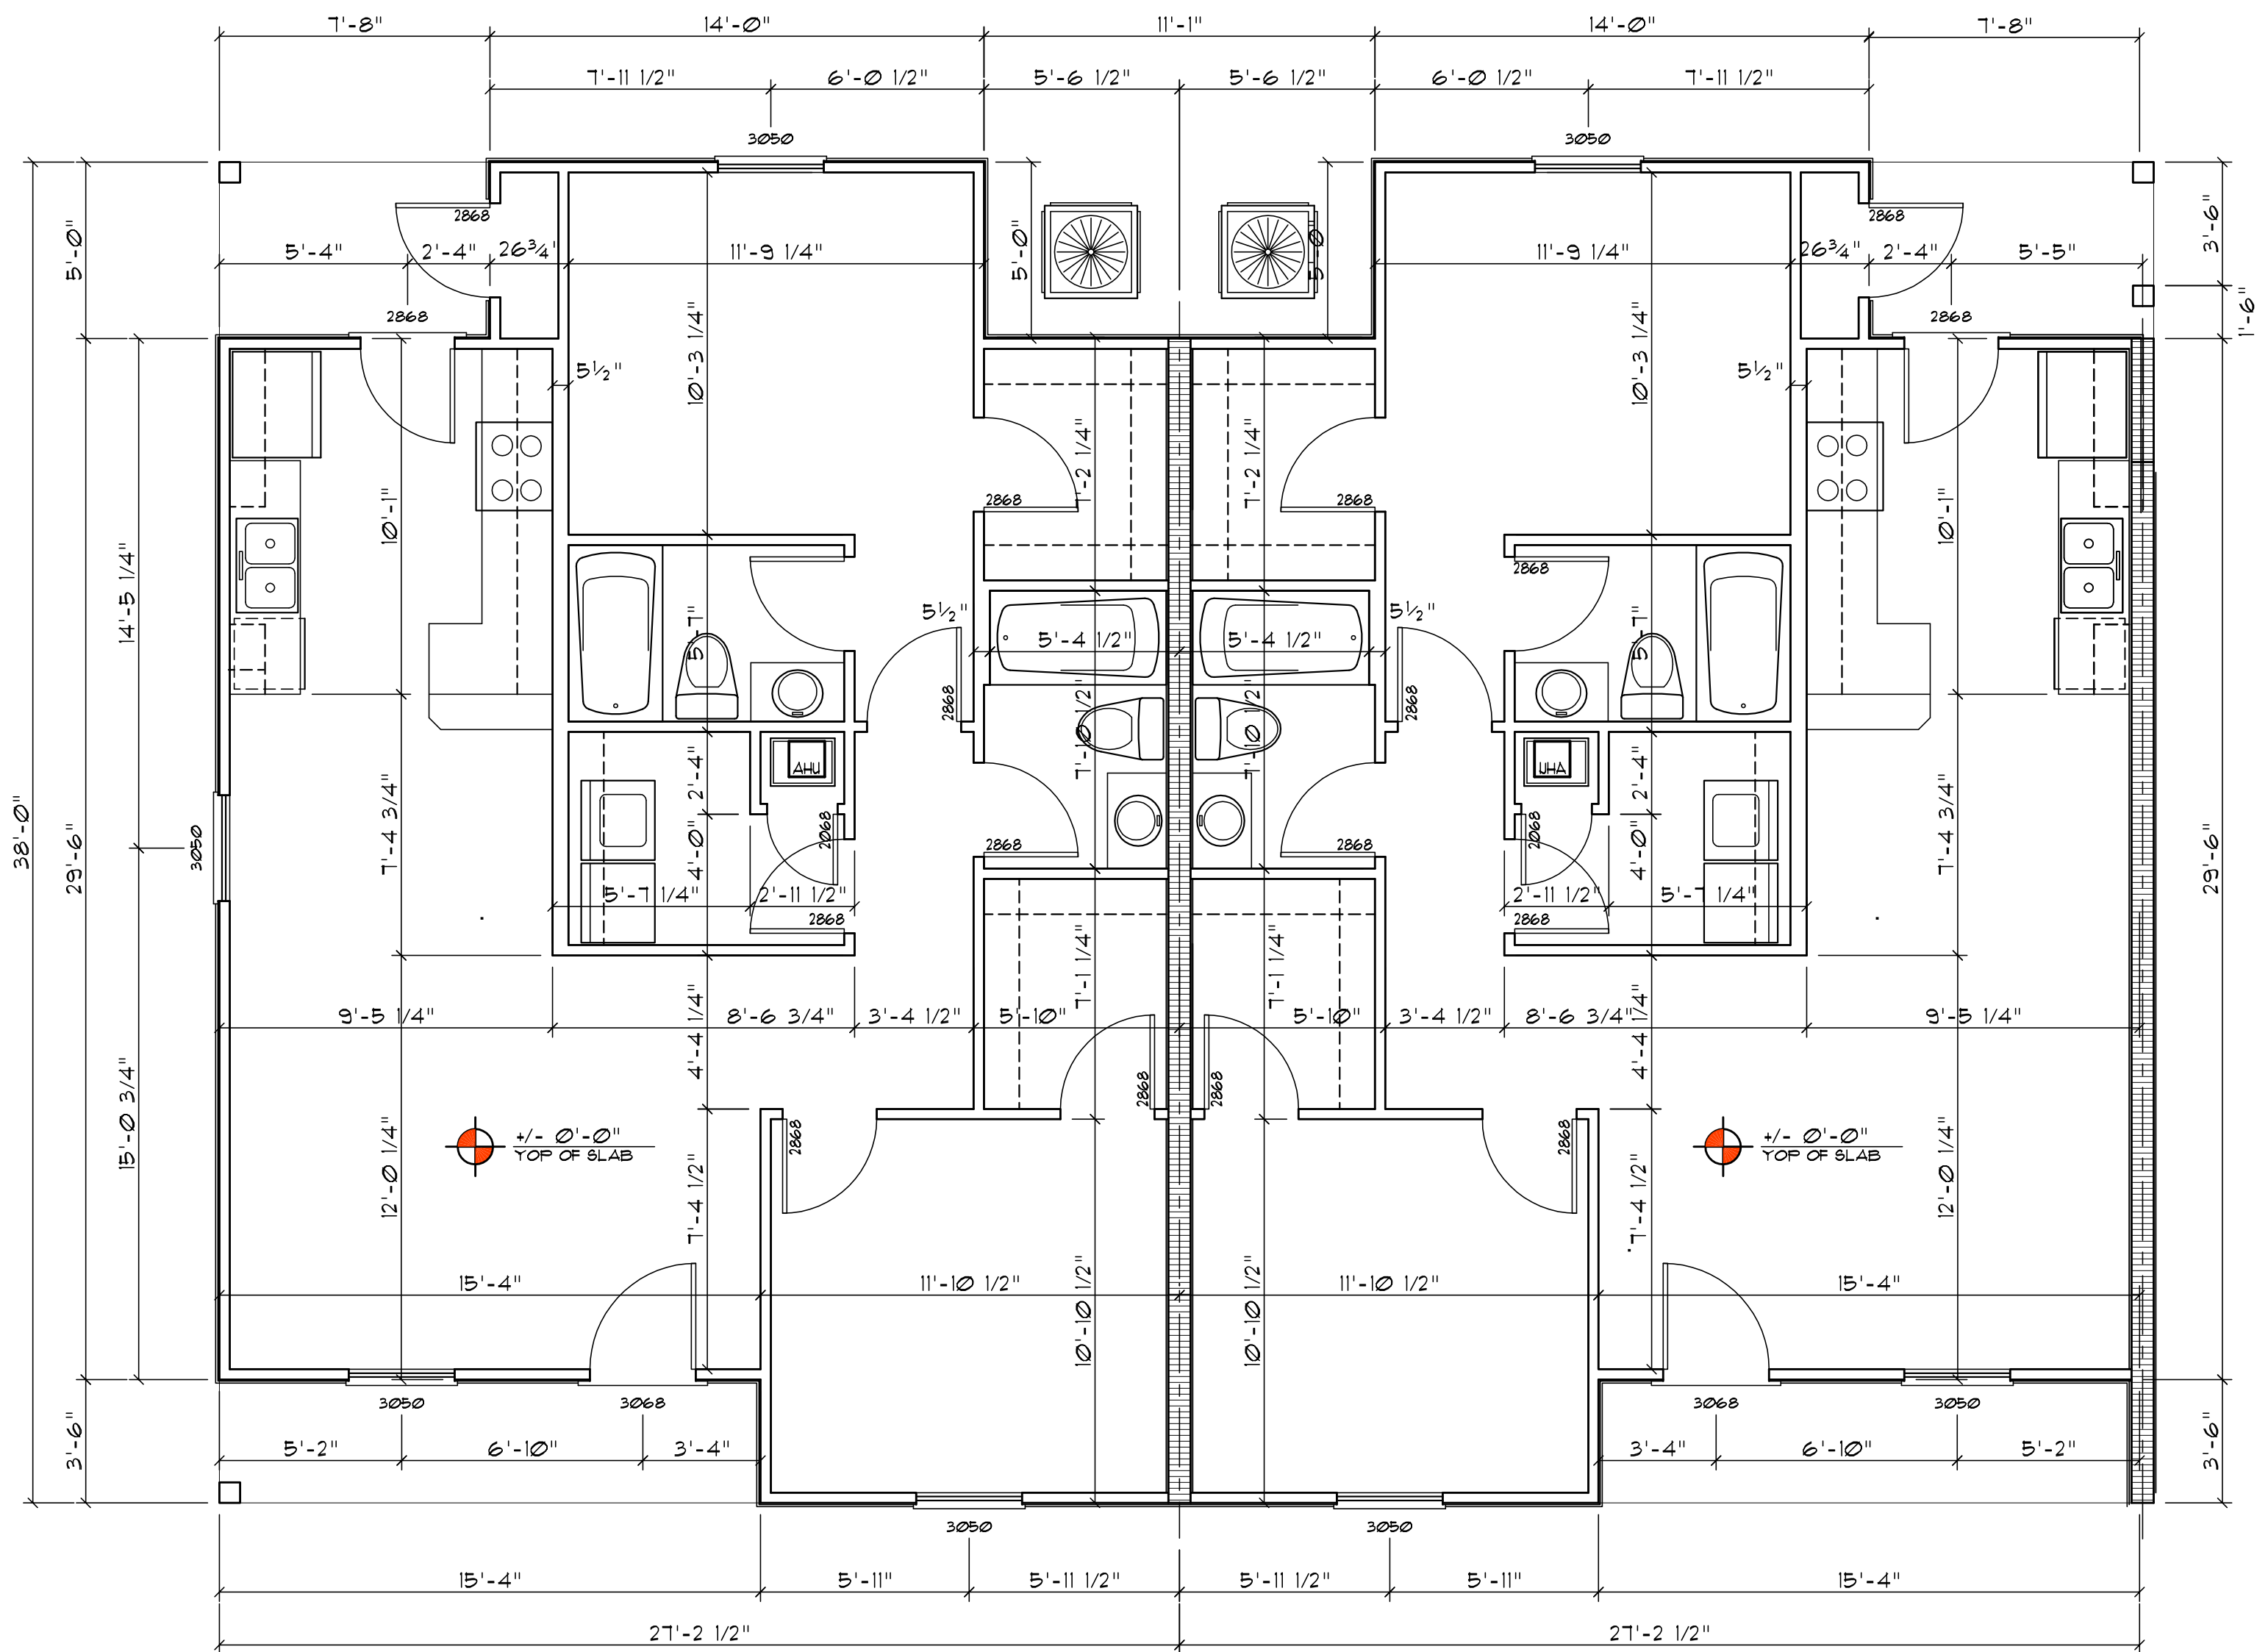

Electrical SYMBOLS

- SPST WALL SWITCH
- DPDT WALL SWITCH (3-WAY)
- DUPLEX WALL RECEPTACLE
- DUPLEX WALL RECPT., BELOW COUNTER
- 240V OUTLET
- GND FAULT INTERRUPTER DUPLEX RECEPT.
- WEATHER PROOF GFI DUPLEX RECEPT.
- MOTOR
- ELECTRICAL PANEL
- EXHAUST FAN
- CEILING FAN, W/ INC. LIGHT FIXTURE
- INC. LIGHT FIXTURE
- SMOKE DETECTOR, 120V
- CARBONMONOXIDE DETECTOR, 12" ABV. FLOOR, 120V
- 4 TUBE FLU. FRIGMATIC WRAP SURFACE FIXTURE
- CHIME
- MOMENTARY PUSHBUTTON SWITCH, LIGHTED
- SWITCH/FIXTURE WIRING
- CONTROL WIRE - LOW VOLTAGE
- NON-FUSED DISC. SWITCH
- WEATHER PROOF NON-FUSED DISC. SWITCH

DIMENSION PLAN

SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN NOTES

INSTALLATION SHALL BE PER 2008 NAT'L. ELECTRIC CODE.

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.

ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.

PROVIDE 4 INSTALL CARBON MONOXIDE DETECTORS IN ALL BEDROOMS, @ 12" ABV. FIN. FL. INTERLOCKED TOGETHER.

TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.

ALL RECEPTICALS, NOT OTHERWISE DESIGNATED, SHALL BE ARC FAULT INTERRUPTER TYPE, EXCEPT DEDICATED OUTLETS.

ALL RECEPTICALS IN KITCHEN AND BATHS SHALL BE GROUND FAULT INTERRUPTER TYPE (GFI).

ALL EXTERIOR RECEPTICALS SHALL BE WEATHERPROOF GROUND FAULT INTERRUPTER TYPE (WPGFI).

ELECTRICAL CONTR SHALL PREPARE "AS-BUILT" SHOP DUGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADDS TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT NR., DESCRIPTION & BRKR, SERVICE ENT. & ALL UNDERGROUND WIRE LOCATION/ROUTING/DEPTH. RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT TYPE W/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:
198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
ENLARGED PLAN W/ DIMENSIONS & ELECTRICAL

48 Years of Service
1972 - 2020
N.P. Geisler, Architect
N.C.A.R.B. Certified

NICHOLAS GEISLER ARCHITECT
TYPE: NW, Brown, 255
LO: CH, 2055
358-368-4355

DATE:

20 AUG 2020

CONTRACT:

2K2064


SHEET:

A.3
3 OF 9

AR0007005


GENERAL INTERIOR FINISH SCHEDULE:

| | |
|-------------------|---|
| FLOOR AREA: | CARPET AND PAD, PATTERN & COLOR AS PER THE OWNER OR LAMINATE STRIP WOOD - SEE OWNER FOR CHANGES |
| RESTROOM FLOOR: | THINSET CERAMIC TILE OR NATURAL STONE, PAT. & COLOR AS SELECTED BY THE OWNER |
| BASE: | TRIM AS PER DETAIL ON A2, COLOR AS SELECTED BY THE OWNER OR CERAMIC TILE OR STONE - MATCH WITH FLOORING |
| TRIM: | COVES, CROWNS, CASINGS CHAIRRAILS AND THE LIKE AS PER DETAIL ON A2, STAIN & VARNISH OR PAINT COLOR AS SELECTED BY THE OWNER |
| WALLS: | 1/2" GWB, PRIMED AND PAINTED 2 COATS LATEX WALL PAINT, COLOR & GLOSS AS SELECTED BY THE OWNER |
| MAIN CEILING: | 5/8" GWB, DIRECT HUNG, TAPED & FINISHED, W/ 2 COATS OF LATEX CEILING PAINT, COLOR & GLOSS AS SELECTED BY THE OWNER |
| APPLIED FINISHES: | APPLIED FINISHED TO GWB, I.e. SPRAY, KNOCK-DOWN, SKIP-TROWEL AND SIMILAR TREATMENTS AS DIRECTED BY THE OWNER |
| CABNETS: | AS SELECTED BY THE OWNER. MINIMUM API GRADE: "CUSTOM" - ALL COUNTERTOPS SHALL BE AS SELECTED BY THE OWNER |

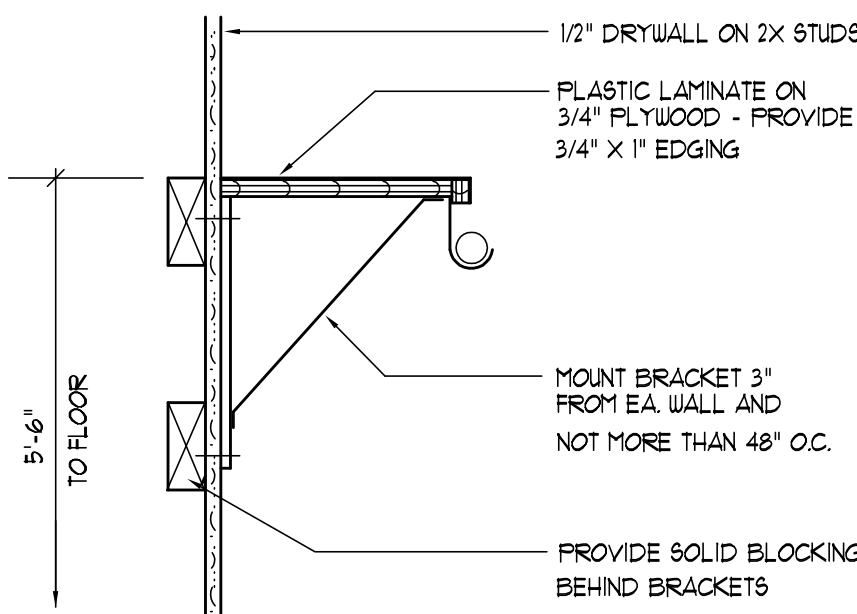


Closet Rod & Shelf Detail

SCALE: NONE

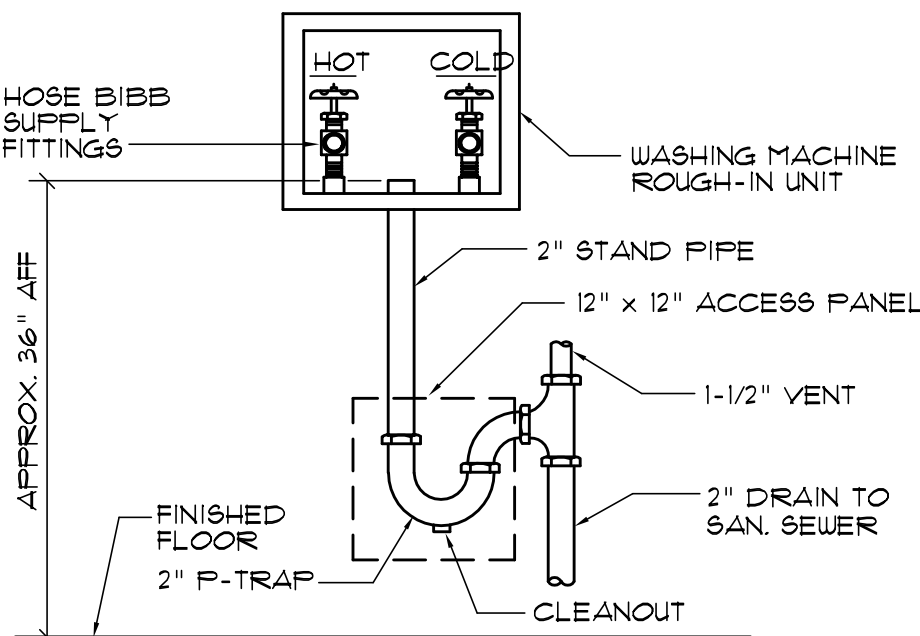


Washing Machine DET.

N.T.S.

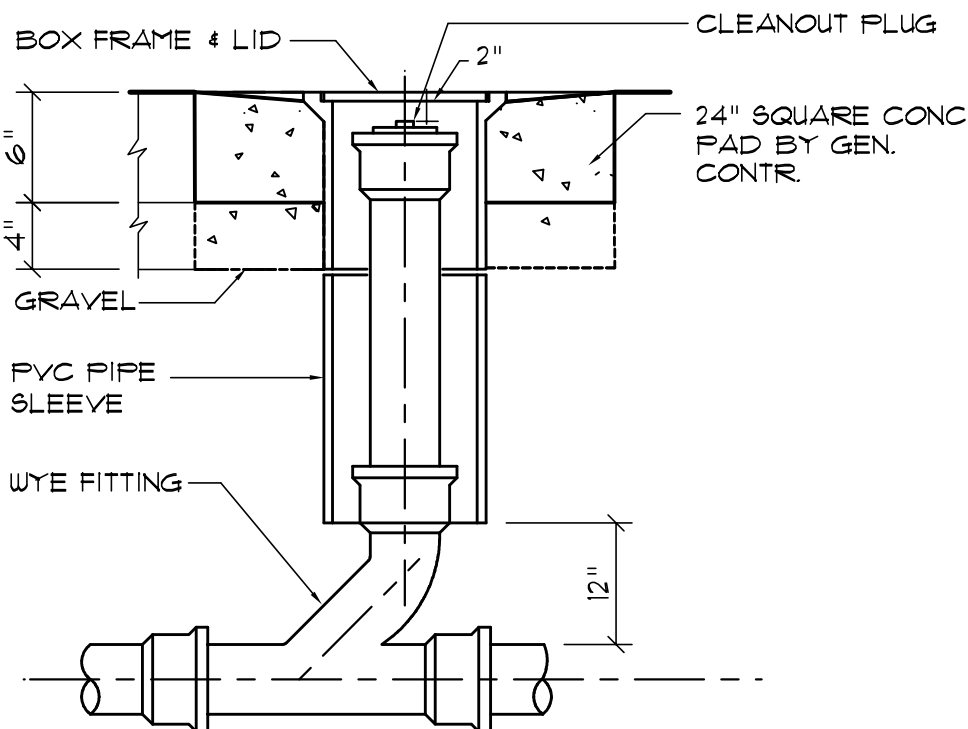

Outdoor Cleanout DETAIL


N.T.S.

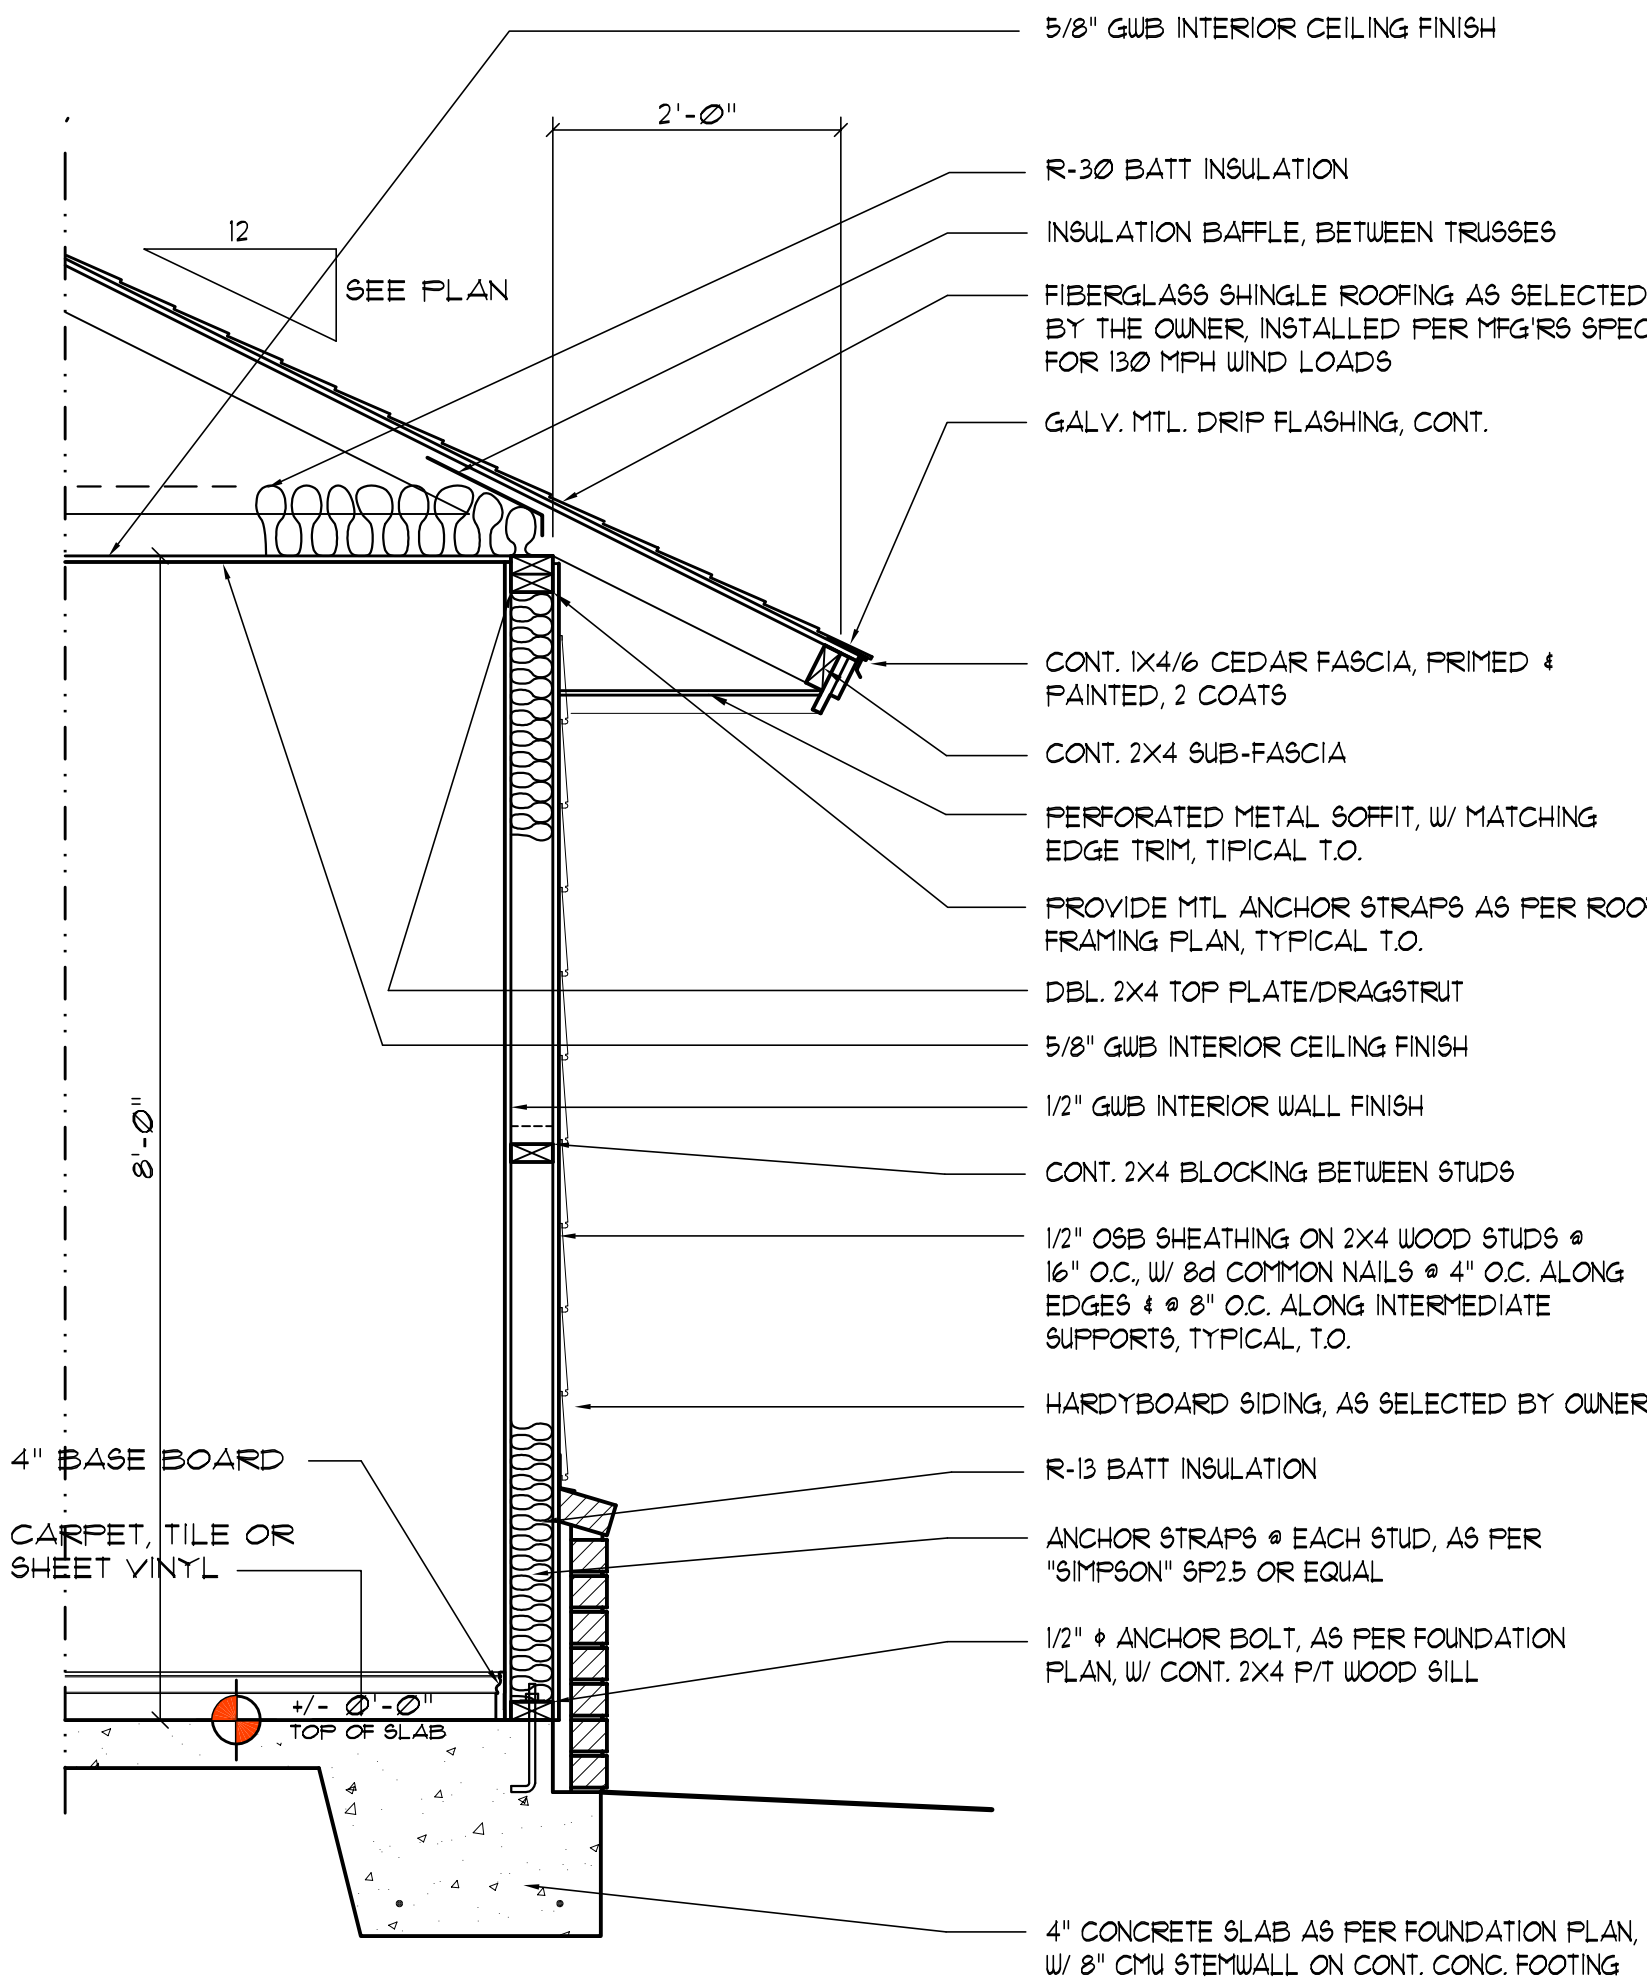

Typical 8'-1" Wall SECTION


SCALE: 3/4" = 1'-0"

| AREA OF ATTIC | REQ'D LF. OF VENT | NET FREE AREA OF INTAKE |
|---------------|-------------------|-------------------------|
| 1600 SF | 20 LF | 410 SQ.IN. |
| 1800 SF | 24 LF | 490 SQ.IN. |
| 2200 SF | 28 LF | 510 SQ.IN. |
| 2500 SF | 32 LF | 650 SQ.IN. |
| 2800 SF | 36 LF | 130 SQ.IN. |
| 3100 SF | 40 LF | 820 SQ.IN. |
| 3600 SF | 44 LF | 920 SQ.IN. |

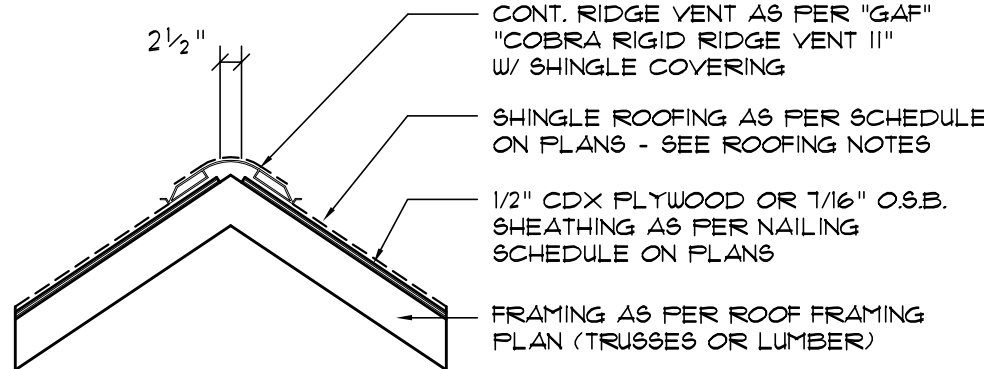


Ridge Vent DETAIL

SCALE: 3/4" = 1'-0"

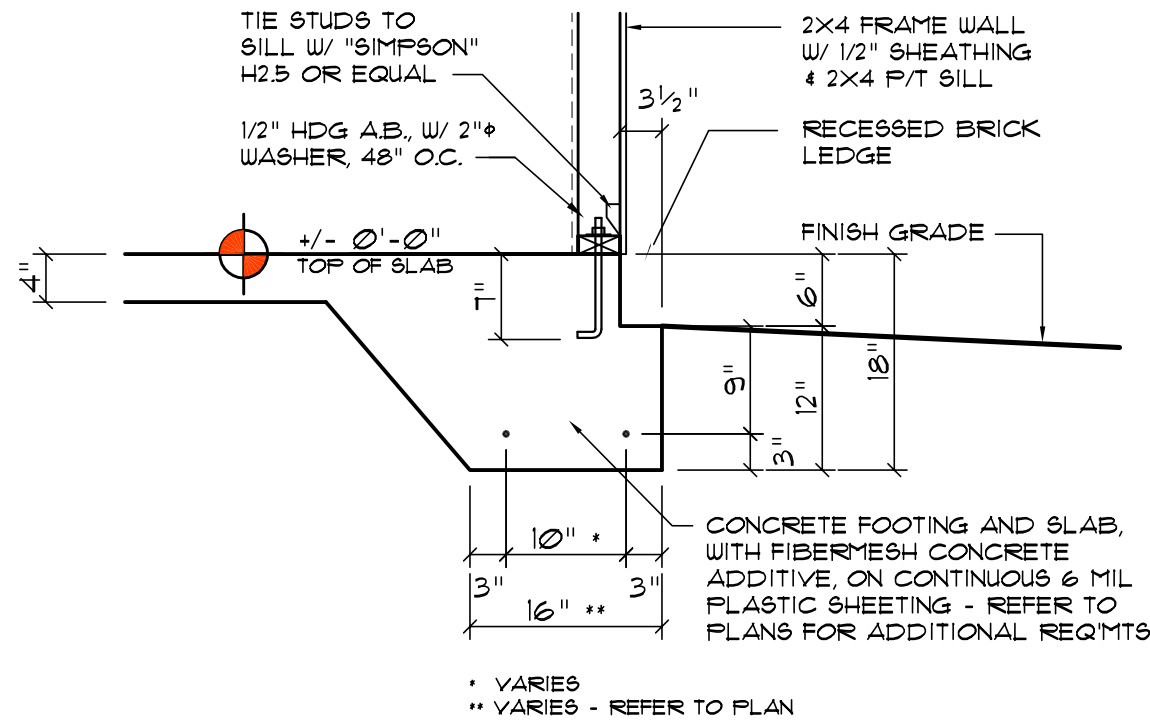

Typ. Mono. Ftg. DET.

SCALE: 3/4" = 1'-0"

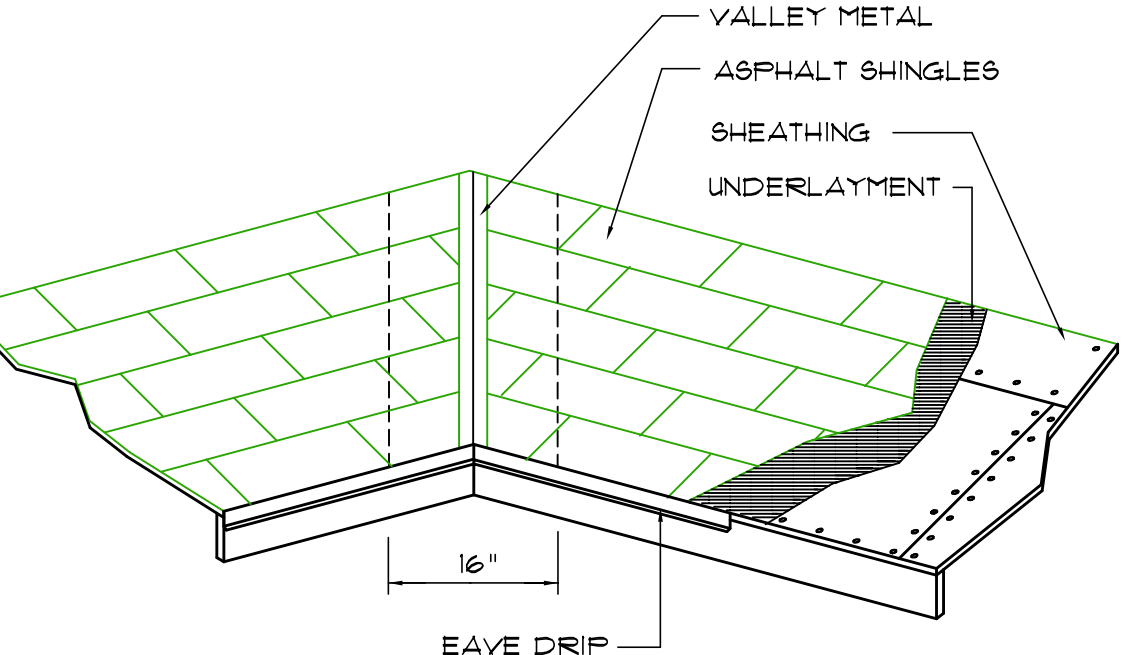

| ROOFING METALS for FLASHING/ROOFING MINIMUM THICKNESS REQUIREMENTS | | | |
|--|------------------------|----------------------|--------------|
| MATERIAL | MINIMUM THICKNESS (in) | GAGE | WEIGHT (oz.) |
| COPPER | | | 16 |
| ALUMINUM | 0.024 | | |
| GALVANIZED STEEL | 0.0175 | 26 (ZINC COATED G90) | |

Roofing/Flashing DETS.

SCALE: NONE

REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
WALL SECTION & DETAILS

48 Years of Service
1972 - 2020
N.P. Geisler, Architect
Architect

**NICHOLAS
GEISLER
ARCHITECT**
N.C.A.R.B. Certified
7758 NW Browns Rd.
Lakeland, FL 33805
356-366-4355

DATE:

20 AUG 2020

COM#:


2K2064

SHEET:

A.4
4 OF 9

AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

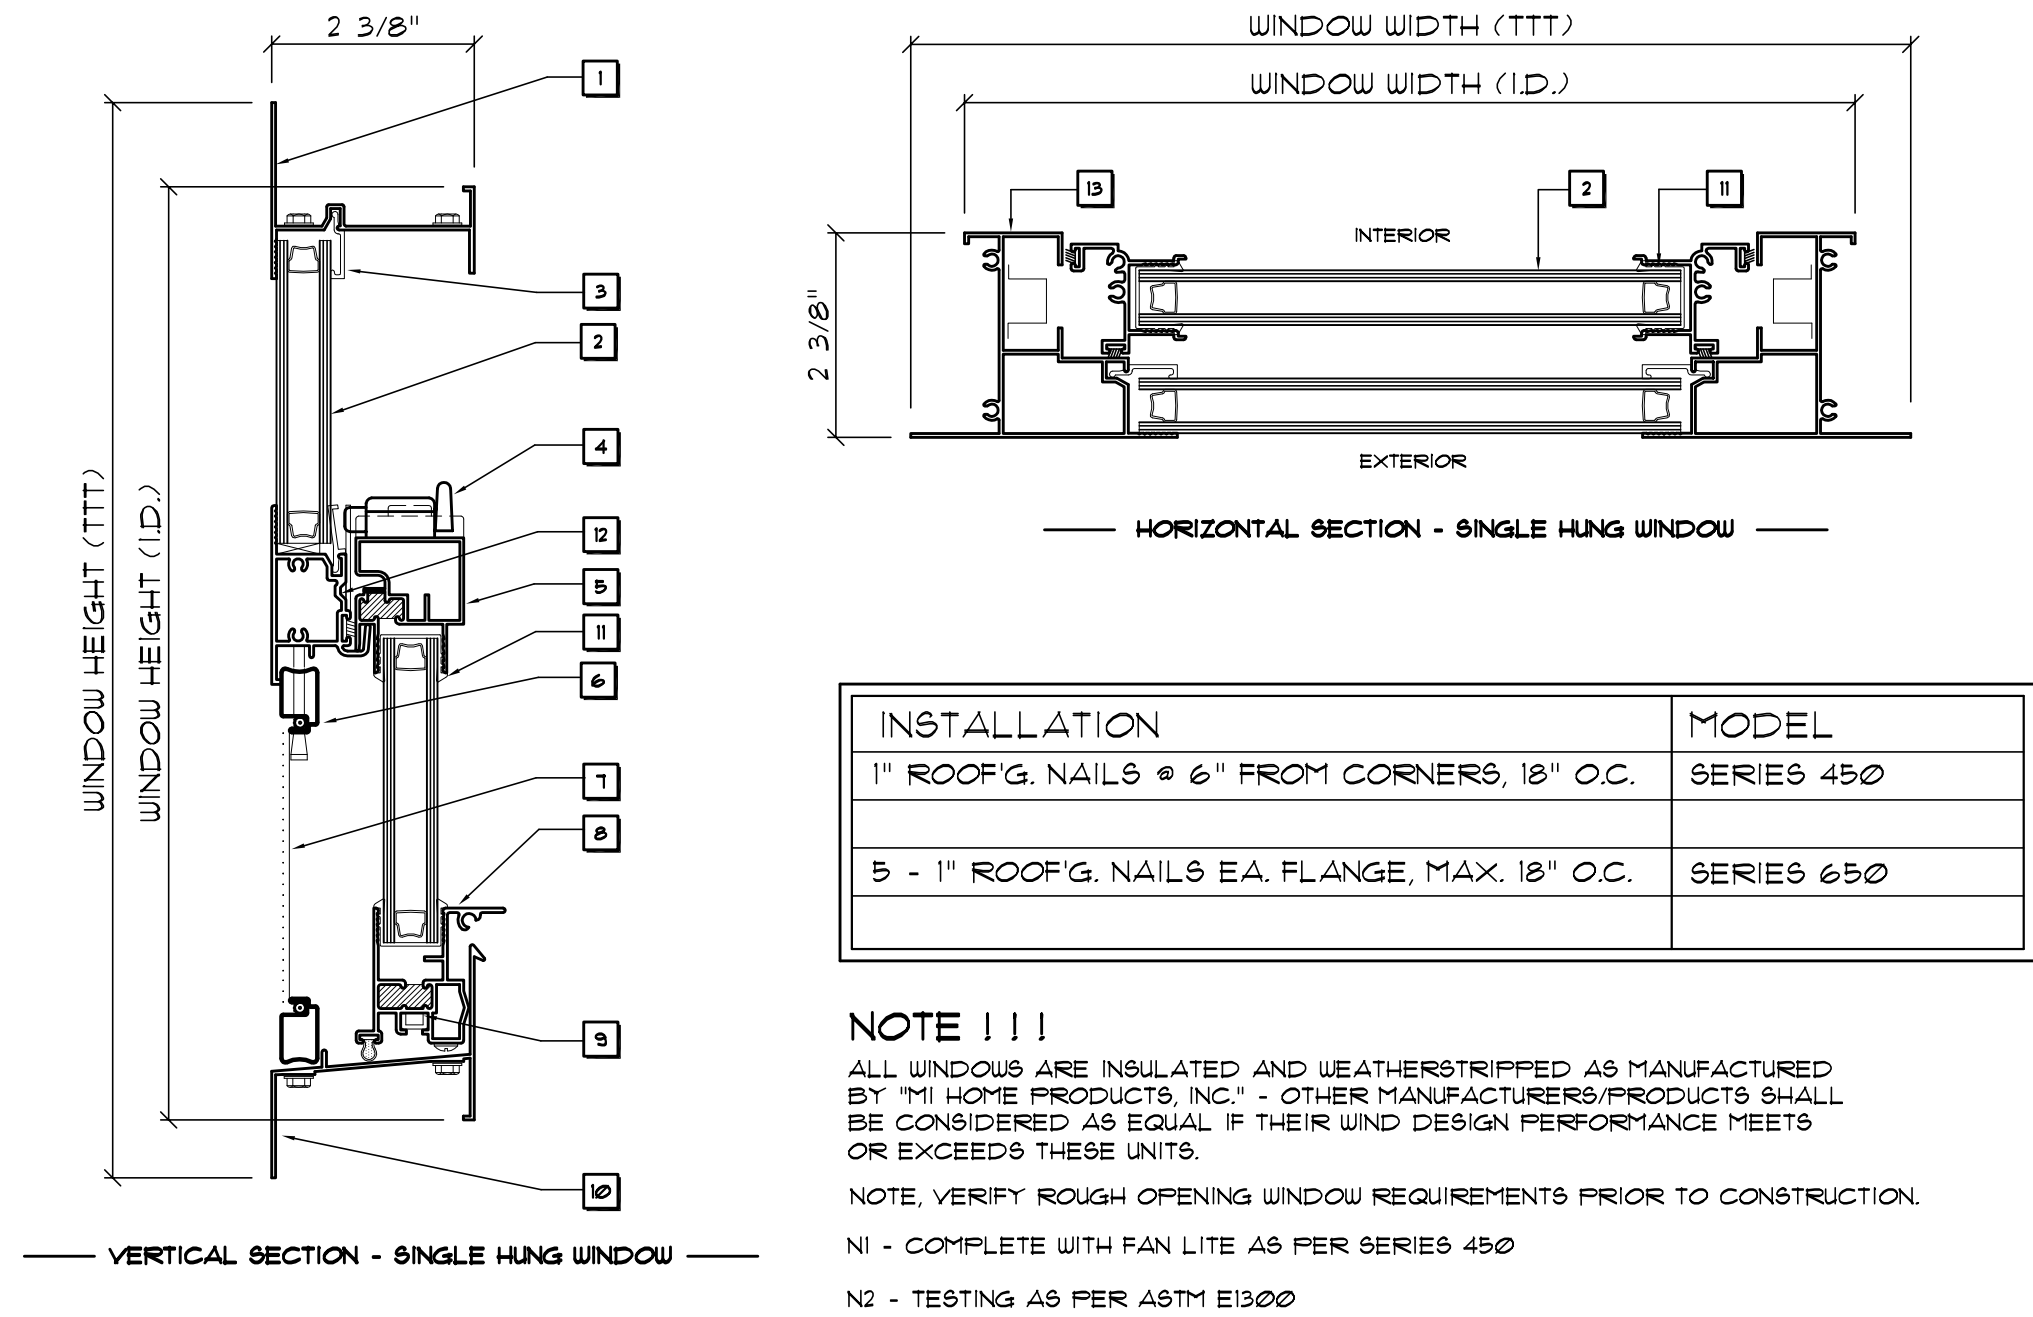

Typ. Window Sash DETAILS

SCALE : NONE

TEMPERED GLASS NOTES:


THE FOLLOWING SHALL BE CONSIDERED SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSES OF GLAZING:

1. GLAZING IN SWINGING DOORS AND FIXED AND SLIDING PANELS OF SLIDING (PATIO) DOOR ASSEMBLIES.
2. GLAZING IN DOORS AND WALLS OF ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS AND OTHER SUCH FACILITIES WHERE SUCH GLAZING IS LOCATED 36 INCHES (914 MM) OR LESS, MEASURED HORIZONTALLY, FROM A STANDING OR WALKING SURFACE WITHIN THE ENCLOSURE AND WHERE THE BOTTOM EDGE OF THE EXPOSED GLAZING IS LESS THAN 60 INCHES (1524 MM) MEASURED VERTICALLY, ABOVE SUCH STANDING OR WALKING SURFACES.
3. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24-INCH (610 MM) RADIUS OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS LESS THAN 60 INCHES (1524 MM) ABOVE THE FLOOR OR WALKING SURFACE.

EXCEPTION: GLAZING IN WALLS PERPENDICULAR TO THE PLANE OF THE DOOR IN A CLOSED POSITION IN GROUP R3 OR WITHIN DUELLING UNITS IN GROUP R2 SHALL BE SUBJECT TO 2004 FBC 2405.2(1.4).

4. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL, OTHER THAN THOSE LOCATIONS DESCRIBED IN ITEMS 2 AND 3 ABOVE, THAT MEETS ALL OF THE FOLLOWING CONDITIONS:


- 4.1 EXPOSED AREA OF AN INDIVIDUAL PANE GREATER THAN 9 SQ FT (0.84 M²).
- 4.2 BOTTOM EDGE LESS THAN 18 INCHES (457 MM) ABOVE THE FLOOR.
- 4.3 TOP EDGE GREATER THAN 36 INCHES (914 MM) ABOVE THE FLOOR.
- 4.4 ONE OR MORE WALKING SURFACES WITHIN 36 INCHES (914 MM) HORIZONTALLY OF THE PLANE OF THE GLAZING.

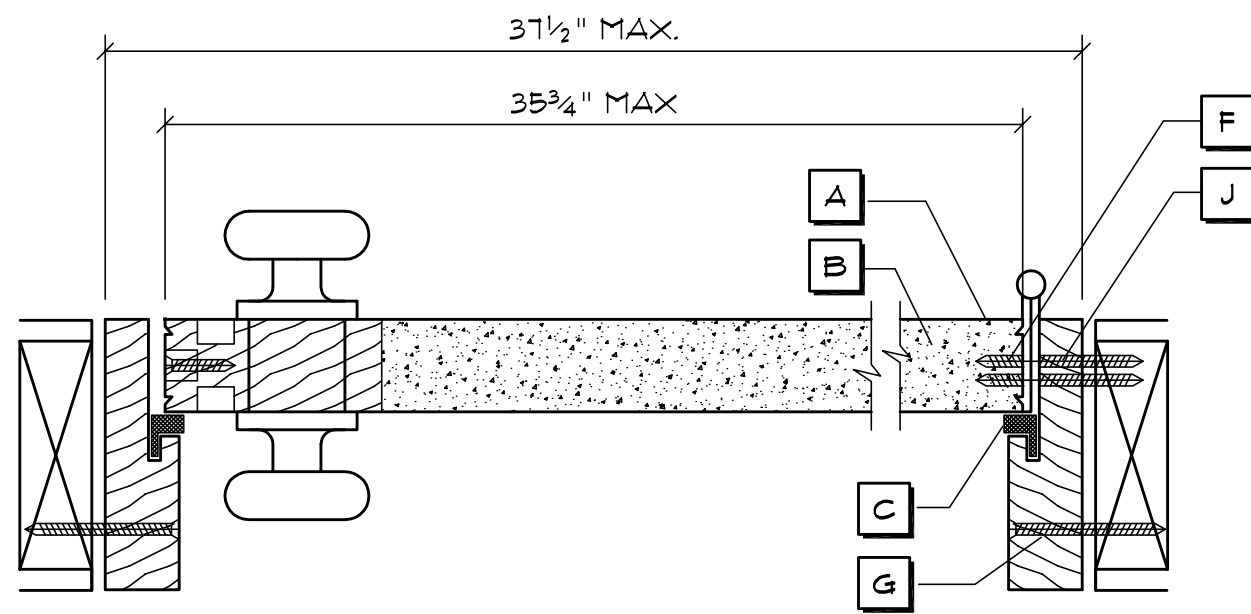

NOTE: VERIFY ROUGH OPENING DOOR REQUIREMENTS PRIOR TO CONSTRUCTION.

Door Notes

- | | |
|---|--|
| A | STEEL SKIN - 26 GA. |
| B | POLYURETHANE FOAM CORE |
| C | COMPRESSION WEATHER STRIP |
| D | WOOD HEAD JAMB |
| E | ALUMINUM BUMPER THRESHOLD |
| F | #10-24 X 1/2" F.H.W.S. (4) SCREWS PER HINGE INTO DOOR |
| G | #10 X 3" F.H.W.S. (5) SCREWS THROUGH HINGE JAMB, 8" DOWN FROM TOP, MAX. 18" O.C. THEREAFTER. |
| H | NOT USED |
| J | #10 X 2" F.H.W.S (4) SCREWS THROUGH EACH HINGE INTO DOOR JAMB. |
| K | #10 X 2" F.H.W.S (2) SCREWS THROUGH HEAD INTO HEADER. |

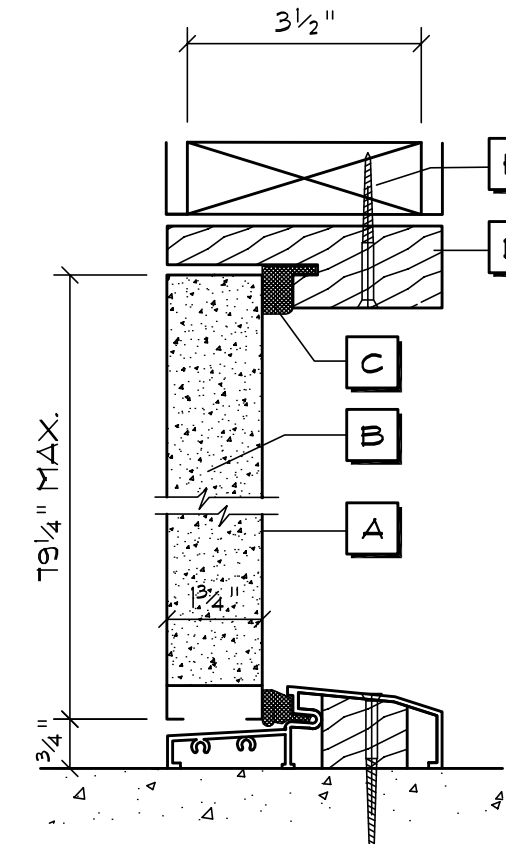


| DESIGN PRESSURE RATINGS * | |
|---------------------------|-----------|
| POSITIVE | +16.0 PSF |
| NEGATIVE | -16.0 PSF |


* WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED

NOTE !!!
EXTERIOR DOORS SHALL MEET OR EXCEED THE WIND RESISTANCE OF THE FOLLOWING PRODUCT:

SERIES ENTERGY 6-B W/E INSULW OPAQUE RESIDENTIAL INSULATED STEEL DOOR W/ STEEL FRAME AS MFG'D BY "PREMDOR ENTRY SYSTEMS"

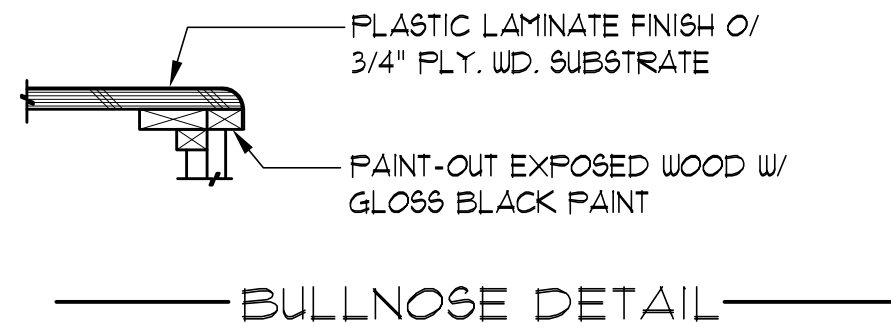

NOTE!
CABINETS, COUNTERS, SHELVES AND THE LIKE, SHOWN ON THIS PLAN SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STANDARDS OF QUALITY AS OUTLINED IN THE NOTES TITLED "GENERAL MILLWORK NOTES", AND SHALL INCLUDE SUCH FEATURES, HARDWARE AND FINISHES AS DIRECTED BY THE OWNER. THE PLAN VIEWS INDICATED ARE FOR GENERAL LOCATION AND EXTENT OF THE WORK - UNLESS DETAILED CABINET PLANS ARE INCLUDED WITH THIS PLANS PACKAGE ALL OTHER PHYSICAL CHARACTERISTICS SHALL BE AS DIRECTED BY THE OWNER.

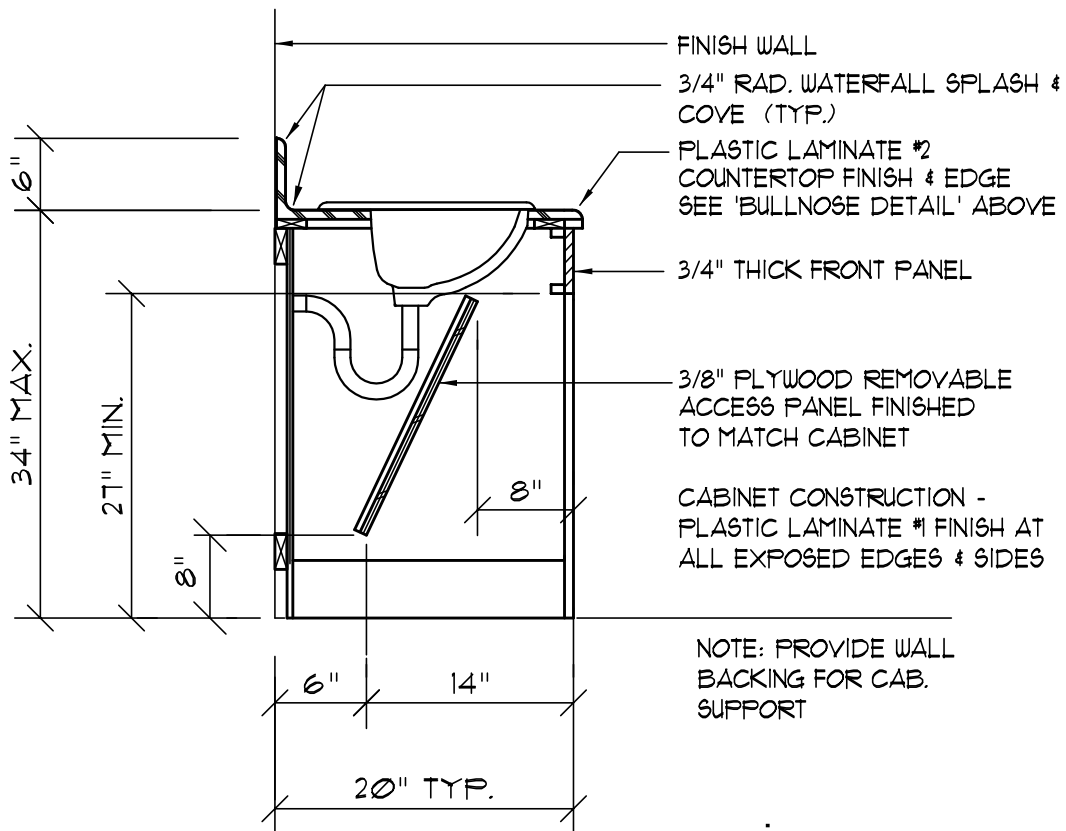

R/R Vanity Cab.


SCALE 3/4" = 1'-0"

NOTE!
THESE COUNTER DETAILS ARE GENERAL IN NATURE AND PROVIDE A BASIS FOR ACTUAL CABINET CONSTRUCTION.

Typical Cabinet DETAILS

SCALE 3/4" = 1'-0"

NOTE!
PROVIDE 2X6 BACKING AT ALL OVERHEAD CABINET LOCATIONS, FLUSH WITH FACE OF FRAMING - TOP OF BACKING TO BE 1'-0" AFF.

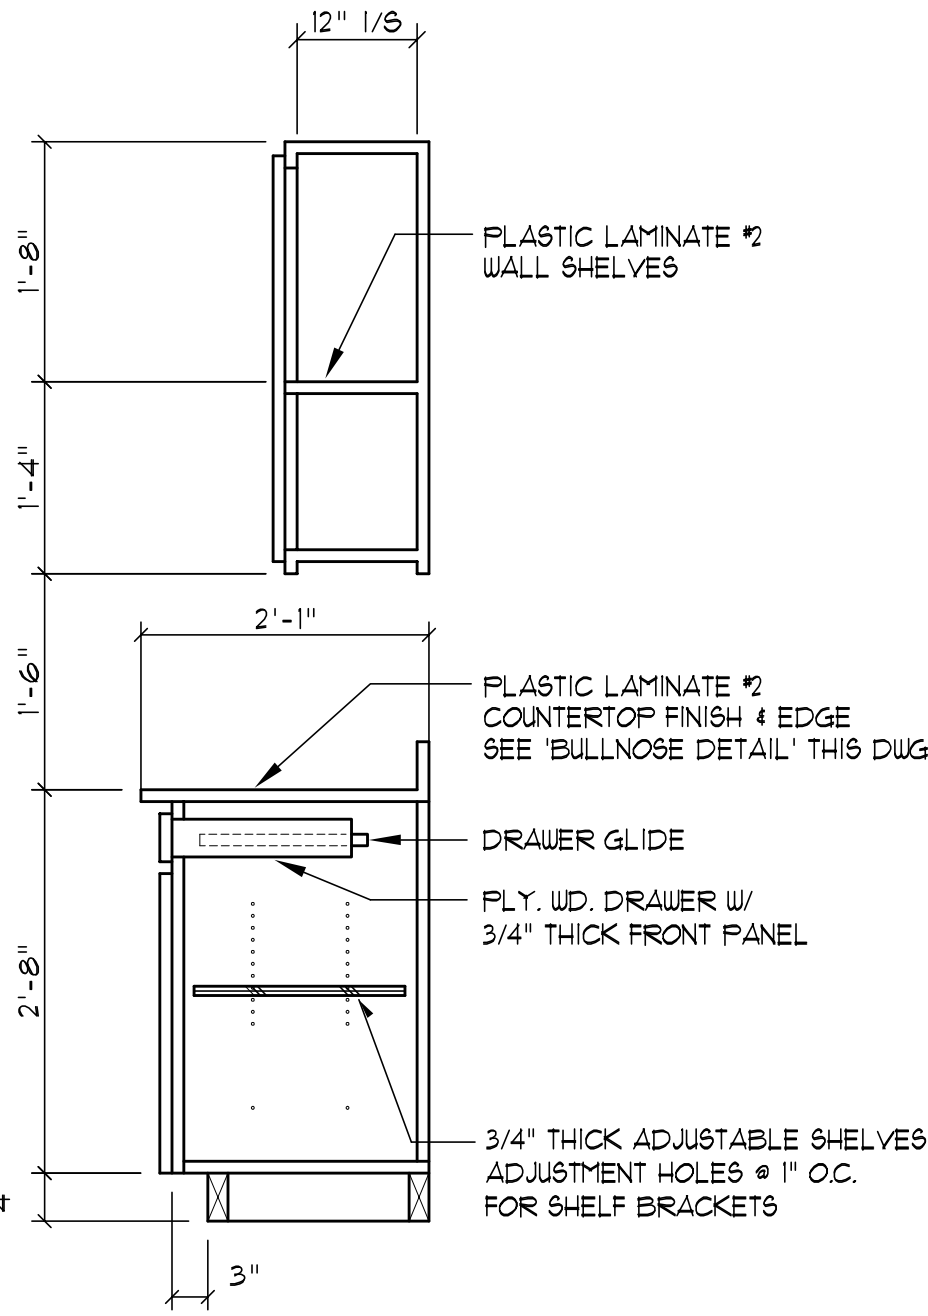

Base & O/H Cab.

SCALE 3/4" = 1'-0"

| BATH ROOM ACCESSORIES | | | | |
|-----------------------|----------------------|--------------|---|----------------------|
| MANUF'R | ITEM | MODEL No. | COMMENTS | LOCATION |
| BOBRICK | FACIAL TISSUE DISP. | B-8391 | SURFACE MOUNTED, 48" AFF. | ADJ. TO LAV. |
| BOBRICK | PAPER TOWEL DISP. | T1100TBK | SURFACE MOUNTED, 40" AFF. TO OPERATOR | ADJ. TO LAV. |
| BOBRICK | HANDICAP RAILING | B-5806.99-36 | PEENED GRIP SURFACES | PER DET & PLAN |
| BOBRICK | TOILET TISSUE DISP'R | B-685 | 30" AFF. TO TOP | ADJ. TO TOILET |
| BOBRICK | TOWEL BAR | B-676X24 | 48" AFF. TO TOP | ADJ. TO SHOWER |
| BOBRICK | MIRROR | B-1830 | WALL ABV. SUITE VANITY TO RECEIVE FULL MIRROR | ABV. LAVATORY'S |
| BOBRICK | COAT HOOK | B-211 | HOOK W/ EXPOSED MOUNTING | 1/8 TOILET ROOM DOOR |
| AM. STD. | LAVATORY | 9140.013 | W/ MONTERREY 6500.270 WIDESPREAD FAUCET | WALL MTD. |
| AM. STD. | WATER CLOSET | - | W/CHURCH 130EC000 FLAS. SEAT | - |
| AM. STD. | WATER CLOSET | 3264.016.020 | W/CHURCH 130EC000 FLAS. SEAT | - |
| AM. STD. | TUB | - | - | - |
| FREEDOM | SHOWER | AFF06233BFT5 | W/ ALL AVAILABLE ACCESSORIES | - |

BOBRICK WASHROOM ACCESSORIES
200 COMMERCE DRIVE
CLIFFTON PARK, NY 12065-1350
518-871-1444
www.bobrick.com

FREEDOM SHOWERS
741-1623 MILITARY ROAD
NIAGARA FALLS, NY 14304-1145
811-941-7169
www.freedomshowers.com

AMERICAN STANDARD
CUSTOMER CARE AT AMERICAN STANDARD
1 CENTENNIAL AVENUE
PISCATAWAY, NJ 08855-6820
800-442-1902
www.americanstandard-us.com

NOTE !!!
MANUFACTURERS LISTED ARE FOR BASIS OF COMPARISON FOR "AS EQUAL" PRODUCTS. OTHER MANUFACTURER'S PRODUCTS MAY BE SUBSTITUTED WITH ARCHITECT'S APPROVAL FOR PRODUCTS MEETING OR EXCEEDING THE SPECIFICATIONS FOR THOSE LISTED IN THE SCHEDULE, ABOVE.

Exterior Door DETAILS

SCALE : NONE


REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
ARCHITECTURAL DETAILS



**NICHOLAS
GEISLER
ARCHITECT**
N.C.A.R.B. Certified
7756 NW Browns Rd.
Lake City, FL 33605
352-568-4355

DATE:

20 AUG 2020

COM#:


2K2064

SHEET:

A5
5 OF 9


AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

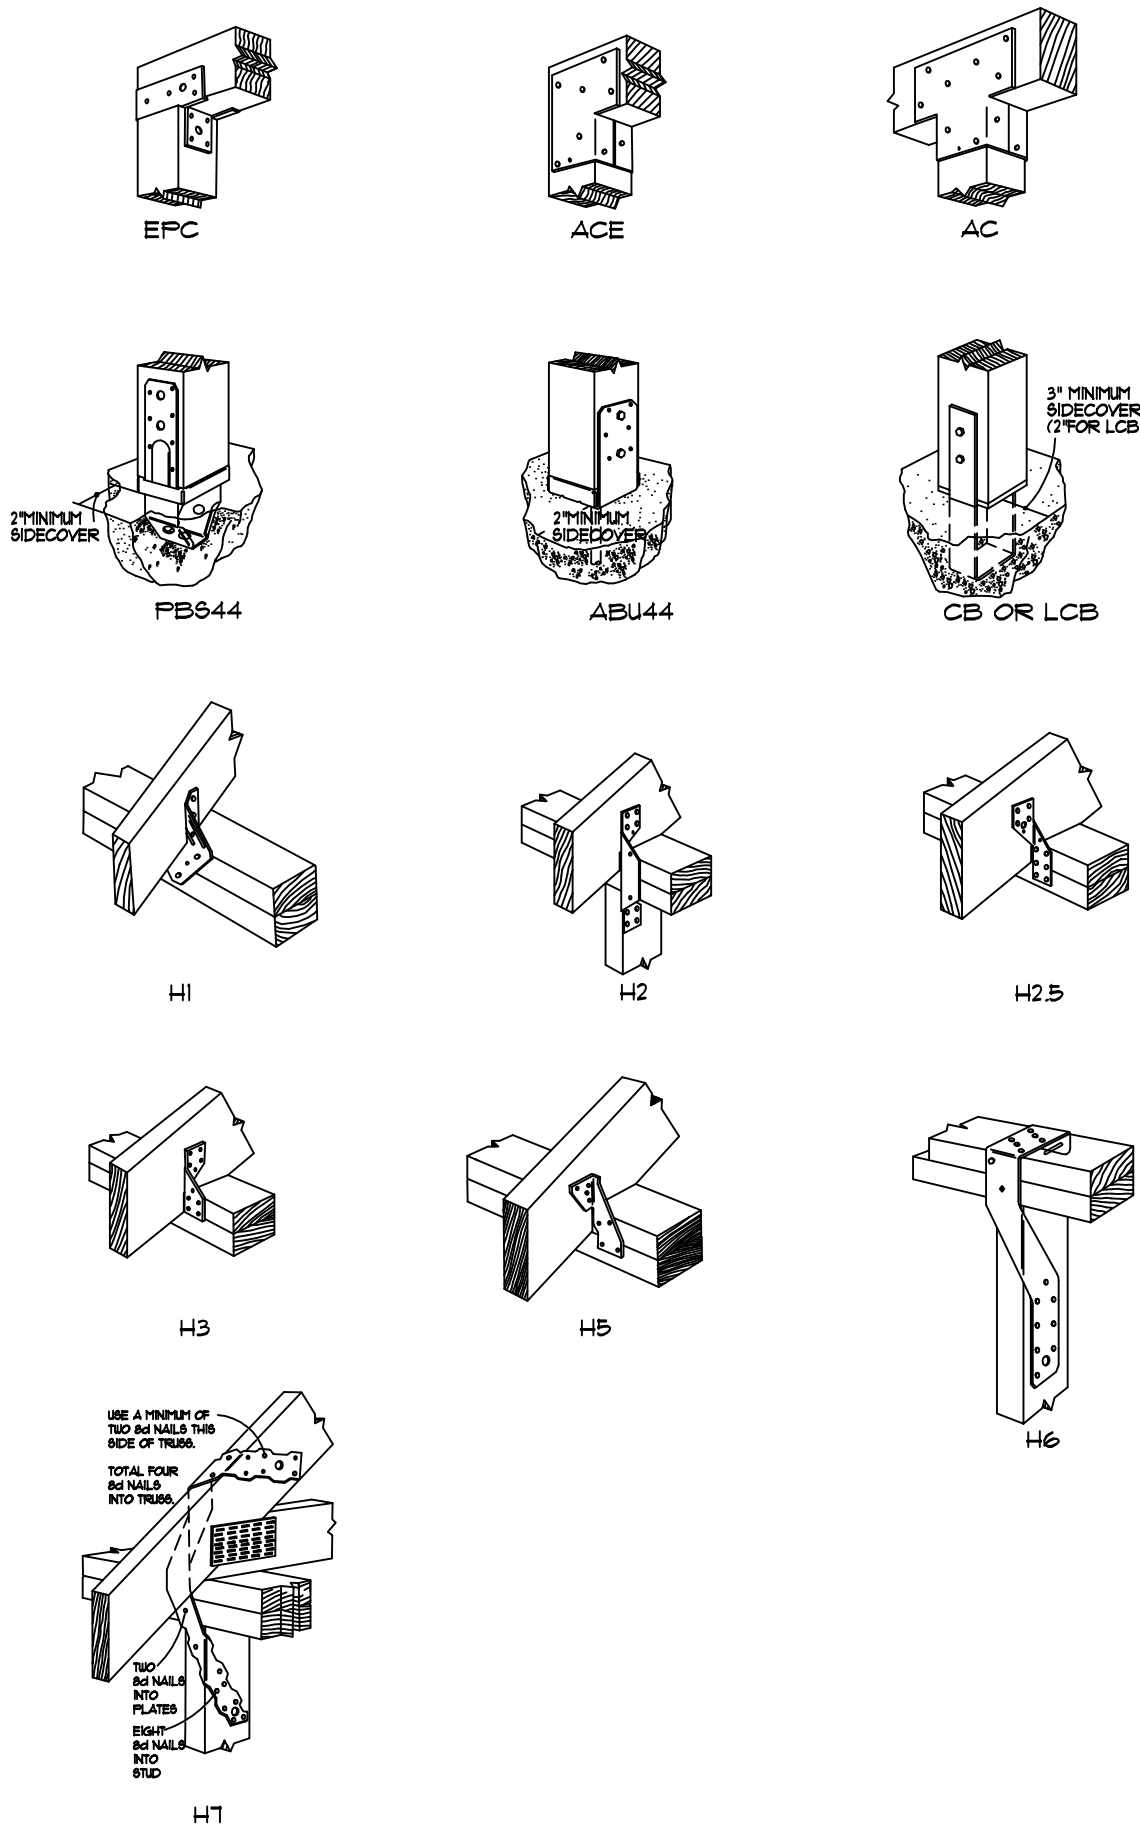

Typical "Simpson" CONNECTORS

SCALE: NONE

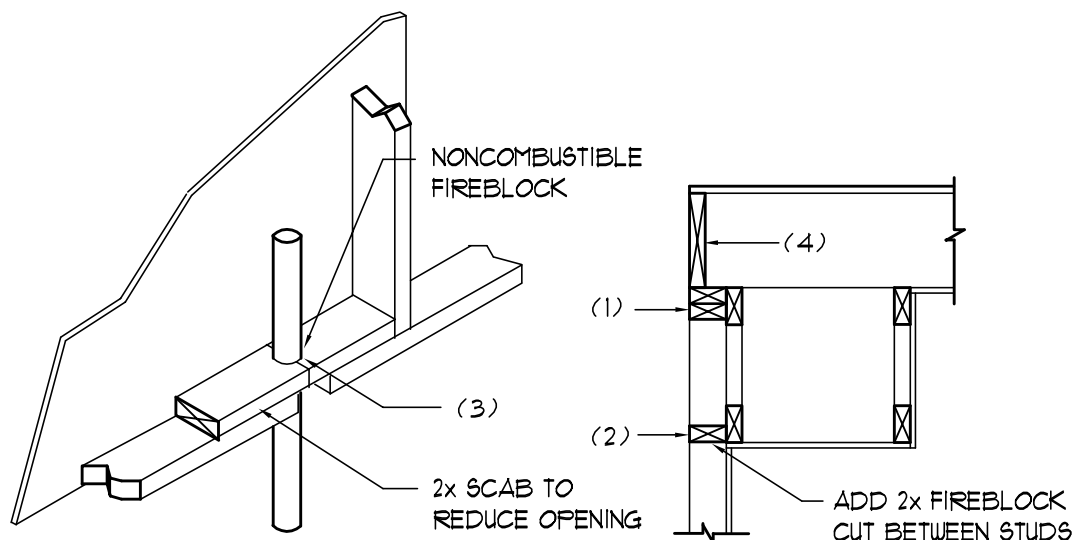

PENETRATIONS

SOFFIT/DROPPED CLG.

FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH "PYROFANEL MULTIFLEX SEALANT"
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

Fire Stopping DETAILS

SCALE: NONE



GENERAL NOTES:

- THE CONTRACTOR SHALL INDEMNIFY THE OWNER AGAINST ALL CLAIMS, WHETHER FROM PERSONAL INJURY OR PROPERTY DAMAGE, ARISING FROM EVENTS ASSOCIATED WITH THE WORK PERFORMED UNDER THE CONTRACT FOR THIS PROJECT.
- THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL WARRANT ALL WORK FOR A PERIOD OF ONE YEAR FOLLOWING THE DATE OF FINAL COMPLETION AND ACCEPTANCE BY THE OWNER. DEFECTS IN MATERIALS, EQUIPMENT, COMPONENTS AND WORKMANSHIP SHALL BE CORRECTED AT NO FURTHER COST TO THE OWNER DURING THE ONE YEAR WARRANTY PERIOD.
- AT THE OWNER'S OPTION, A WARRANTY INSPECTION SHALL BE PERFORMED DURING THE ELEVENTH MONTH FOLLOWING THE COMMENCEMENT OF THE WARRANTY PERIOD, FOR THE PURPOSE OF DETERMINING ANY WARRANTY WORK THAT MAY BE REQUIRED. THE CONTRACTOR SHALL BE PRESENT DURING THIS INSPECTION IF REQUESTED BY THE OWNER.
- THE CONTRACTOR SHALL PAY FOR ALL PERMITS, LICENSES, TESTS AND THE LIKE THAT MAY BE REQUIRED BY THE VARIOUS AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT BE THEY CITY, COUNTY, STATE OR FEDERAL.
- THE OWNER SHALL FILE A "NOTICE OF COMMENCEMENT" PRIOR TO THE BEGINNING THE PROJECT AND THE CONTRACTOR(S) SHALL FILE "NOTICE TO OWNER" AND PROVIDE "RELEASE OF LIEN" FOR ALL PAYMENT REQUESTS PRIOR TO DISBURSEMENT OF ANY FUNDS.
- ANY AND ALL DISPUTES ARISING FROM EVENTS ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT BETWEEN THE OWNER, CONTRACTOR(S) AND SUPPLIERS SHALL BE RESOLVED THROUGH BINDING ARBITRATION.
- ALL WORK SHALL BE IN ACCORDANCE W/ APPLICABLE CODES AND LOCAL REGULATIONS, INCLUDING APPLICABLE ENERGY CODES. ALL COMPONENTS OF THE BUILDING SHALL MEET WITH THE MINIMUM ENERGY REQUIREMENTS OF THE BUILDING CODE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IN WRITING PRIOR TO THE COMMENCEMENT OF THE WORK.
- ALL INSULATION SHALL BE LEFT EXPOSED AND ALL LABELS LEFT INTACT ON THE WINDOWS AND DOORS UNTIL INSPECTED BY THE BUILDING OFFICIAL.
- ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED.
- INTERIOR BEARING WALLS SHALL BE CONSTRUCTED IN COMPLIANCE WITH "UL Design U333". BATT INSULATION SHALL BE INCLUDED WHERE UNCONDITIONED AREA IS BEING SEPARATED FROM HEATED / COOLED AREA.
- INTERIOR STUD WALLS SEPARATING LIVING AREA FROM GARAGE AREAS SHALL BE CONSTRUCTED IN COMPLIANCE WITH "UL Design U333", INCLUDING R-11 BATT INSULATION.
- CEILINGS OVER ATTACHED GARAGES OR GARAGES W/ LIVING AREA ABOVE SHALL BE 5/8" FIRECODE "C" GIB ON 1X3 WOOD FURRING AT 16" O.C., ATTACHED W/ 1/4" BUGLEHEAD SCREWS @ 6" O.C. ALONG EACH POINT OF BEARING.

STANDARD ABBREVIATIONS

| | | | |
|------------|--------------------|------------|----------------------------|
| @ | AT | GALV. | GALVANIZED |
| # | NUMBER OF POUND(S) | HORZ. | HORIZONTAL |
| = | EQUALS | INS. | INSULATION |
| Ø | DIAMETER | INT. | INTERIOR |
| W | WITH | LAV. | LAVATORY |
| WO | WITHOUT | LVL. | LAMINATED VENEER LUMBER |
| ¢ | CENTERLINE | MAX. | MAXIMUM |
| ¢ | AND | MIN. | MINIMUM |
| +/- or ± | PLUS OR MINUS | MISC. | MISCELLANEOUS |
| 1' | ONE FOOT | M.O. | MASONRY OPENING |
| 1" | ONE INCH | No. or Nr. | NUMBER |
| 1/4" or ¼" | ONE QUARTER INCH | O.C. | ON CENTER |
| Ød | Ø PENNY | O/H | OVERHEAD |
| BM | BEAM | OHD | OVERHEAD DOOR |
| BY | BY OTHERS | PLYUD. | PLYWOOD |
| BOT. | BOTTOM | P/T | PRESSURE TREATED |
| CLG. | CEILING | REINF. | REINFORCING (ED) |
| CO | CLEANOUT | REQ'D | REQUIRED |
| CONC. | CONCRETE | RM. | ROOM |
| COTG. | CLEANOUT TO GRADE | RO. | ROUGH OPENING |
| DBL. | DOUBLE | SF | SQUARE FEET |
| DM. | DIMENSION | SGLD | SLIDING GLASS DOOR |
| DN. | DOWN | SHT. | SHEET |
| ELEV. | ELEVATION | SRHL | SULLIVANEE RIVER LOG HOMES |
| EXT. | EXTERIOR | TYP. | TYPICAL |
| F | FRENCH (DOORS) | VERT. | VERTICAL |
| FDN. | FOUNDATION | WC | WATERCLOSET (TOILET) |

PROJECT INFORMATION / NOTES:

DESIGN VALUES/LOADS & CODES

WIND DESIGN SPEED: 130 MPH, UNLESS NOTED OTHERWISE

SOIL DESIGN STATEMENT:

FOOTING DESIGN IS BASED UPON 1000PSF SOIL BEARING PRESSURE PROVIDED BY CLEAN SAND, GRAVEL OR STONE. OTHER SOIL CONDITIONS (ie: CLAY, HIGH LEVEL OF ORGANICS OR OTHER UNDESIRABLE SOILS) SHALL REQUIRE FOUNDATION MODIFICATIONS.

LIVE LOADS: 1st FLOOR: 40PSF, 2nd FLOOR: 40PSF, ROOF: AS DETERMINED BY SHAPE FACTORS APPLIED TO THE WIND FORCE GENERATED BY THE DESIGN WIND SPEED.

BUILDING CODE: 2014 FLORIDA BUILDING CODE

ELECTRICAL CODE: NATIONAL ELECTRICAL CODE - LATEST
LIFE SAFETY: NFPA-101 - LATEST

CONSTRUCTION DOCUMENTS

THE CUSTOMER IS RESPONSIBLE FOR DELIVERING THE REQUIRED SETS OF CONSTRUCTION DOCUMENTS TO THE PERMIT ISSUING AUTHORITIES FOR THE ISSUANCE OF CONSTRUCTION PERMITS. THE CONTRACTOR SHALL REVIEW THE CONSTRUCTION DOCUMENTS AND VERIFY ALL DIMENSIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT PRIOR TO THE COMMENCEMENT OF ANY WORK OR FABRICATION OF ANY MATERIALS.

DO NOT SCALE OFF THESE PLANS

AMPLE DIMENSIONS ARE SHOWN ON THE PLANS TO LOCATE ALL ITEMS. SIMPLE ARITHMETIC MAY BE USED TO DETERMINE THE LOCATIONS OF THOSE ITEMS NOT DIMENSIONED.

CHANGES TO FINAL PLAN SETS

PLEASE DO NOT MAKE ANY STRUCTURAL CHANGES TO THESE PLANS WITHOUT CONSULTING WITH THE ARCHITECT. THE OWNER SHALL ASSUME ANY AND ALL LIABILITY FOR STRUCTURAL DAMAGE RESULTING FROM CHANGES MADE TO THE PLANS OR BY SUBSTITUTION OF MATERIALS DIFFERENT FROM SPECIFICATION ON THE PLANS.

FLORIDA BUILDING CODE

Compliance Summary

TYPE OF CONSTRUCTION

Roof: Gable Construction, Wood Trusses @ 24" O.C.
Walls: 2x4 Wood Studs @ 16" O.C.
Floor: 4" Thk. Concrete Slab w/ Fiberglass Concrete Additive
Foundation: Continuous Smallwall Footer

ROOF DECKING

Material: 1/2" CD Plywood or 1/6" OSB.
Sheet Size: 48"x96" Sheets Perpendicular to Roof Framing
Fasteners: 8d Ring Shank Nails per schedule on sheet A.1

SHEARWALLS

Material: 1/6" OSB. "WindSTORM": 48" X 91", 109", 121" OR 145"
Sheet Size: 48"x91" (109", 121" OR 145") Sheets Placed Vertical
Fasteners: 8d Ring Shank Nails @ 4" O.C. Edges @ 8" O.C. Interior
Diaphragm: Double Top Plate (S.T.P.) w/ 2 - 16d Nails @ 12" O.C.
Wall Studs: 2x4 SFF Studs @ 16" O.C.

HURRICANE UPLIFT CONNECTORS

Truss Anchors: Simpson H2.5a @ Ea. Truss End (Typ. U.O.N.)
Wall Tension: Wall Sheathing Nailing Is Adequate - 8d @ 4" O.C. Top @ Bot.
Anchor Bolts: 1/2" A307 @ 48" O.C. - 1st Bolt Ø" from corner
Corner Hold-down Device: Simpson HD2a, ea. corner

FOOTINGS AND FOUNDATIONS

Footings: 20"x12" Cont. W/2-#5 Cont. @ wire chairs @ 48" O.C.



| WIND ZONE | AREA | Vult 10 MPH | Vult 12 MPH | Vult 13 MPH | Vult 14 MPH |
|----------------|------|--------------|--------------|--------------|--------------|
| ROOF 1' TO 21' | 1 10 | 12.0 / -19.9 | 14.9 / -23.1 | 17.5 / -27.8 | 20.3 / -32.3 |
| | 1 20 | 11.4 / -19.4 | 13.6 / -23.0 | 16.0 / -27.0 | 18.5 / -31.4 |
| | 1 50 | 10.0 / -18.6 | 11.9 / -22.2 | 13.9 / -26.0 | 16.1 / -30.2 |
| | 2 10 | 12.5 / -34.1 | 14.9 / -41.3 | 17.5 / -48.4 | 20.3 / -56.2 |
| | 2 20 | 11.4 / -31.9 | 13.6 / -38.0 | 16.0 / -44.6 | 18.5 / -51.1 |
| | 2 50 | 10.0 / -28.2 | 11.9 / -33.6 | 13.9 / -39.4 | 16.1 / -45.1 |
| | 3 10 | 12.5 / -51.3 | 14.9 / -61.0 | 17.5 / -71.6 | 20.3 / -83.1 |
| | 3 20 | 11.4 / -47.9 | 13.6 / -57.1 | 16.0 / -67.0 | 18.5 / -77.1 |
| | 3 50 | 10.0 / -43.5 | 11.9 / -51.8 | 13.9 / -60.8 | 16.1 / -70.5 |
| | 4 10 | 21.8 / -23.6 | 25.9 / -34.1 | 30.4 / -33.0 | 35.3 / -38.2 |
| | 4 20 | 20.8 / -22.6 | 24.1 / -26.9 | 29.0 / -31.6 | 33.1 / -36.7 |
| | 4 50 | 19.5 / -21.3 | 23.2 / -25.4 | 27.2 / -29.8 | 31.6 / -34.6 |
| WALL | 5 10 | 21.8 / -29.1 | 25.9 / -34.1 | 30.4 / -40.7 | 35.3 / -47.2 |
| | 5 20 | 20.8 / -27.2 | 24.1 / -32.4 | 29.0 / -38.0 | 33.1 / -44.0 |
| | 5 50 | 19.5 / -24.6 | 23.2 / -29.3 | 27.2 / -34.3 | 31.6 / -39.8 |

| BLDG HEIGHT | EXPOSURE "B" | EXPOSURE "C" | EXPOSURE "D" |
|-------------|--------------|--------------|--------------|
| 15 | 100 | 121 | 141 |
| 20 | 100 | 129 | 155 |
| 25 | 100 | 135 | 161 |
| 30 | 100 | 140 | 166 |

STRUCTURAL DESIGN CRITERIA:

- THE DESIGN COMPLIES WITH THE REQUIREMENTS OF THE 2014 FLORIDA BUILDING CODE - SECTION 1609 AND OTHER REFERENCED CODES AND SPECIFICATIONS. ALL CODES AND SPECIFICATIONS SHALL BE LATEST EDITION AT TIME OF PERMIT.
- WIND LOAD CRITERIA: RISK CATEGORY: 2

BASED ON ANSI/ASCE 7-10. 2014 FBC 1609-A WIND VELOCITY: $V_{ULT} = 130$ MPH
 $V_{ASD} = 108$ MPH

- ROOF DESIGN LOADS:
SUPERIMPOSED DEAD LOADS: 20 PSF
SUPERIMPOSED LIVE LOADS: 20 PSF

- FLOOR DESIGN LOADS:
SUPERIMPOSED DEAD LOADS: 25 PSF
SUPERIMPOSED LIVE LOADS:

RESIDENTIAL 40 PSF
BALCONIES 60 PSF

- WIND NET UPLIFT: ARE AS INDICATED ON TRUSS SHOP DRAWINGS

SYMBOLS

THESE SYMBOLS ARE MOST OFTEN ENCOUNTERED IN THE FOLLOWING DRAWINGS: ELEVATIONS, DIMENSION PLANS, SECTIONS & STRUCTURAL PLANS

| | | |
|--|---------------------|--|
| | ELEV 1/8" | TYPE OF ELEVATION MARK USED TO INDICATE A PREFERRED TARGET ELEVATION - TRUE MEASUREMENT. |
| | ELEV 1/8" | TYPE OF ELEVATION MARK USED TO INDICATE THE TOP OF A LOG WALL STACK - NOMINAL ONLY. |
| | SECTION LOCATION | TYPE OF DETAIL MARK USED TO INDICATE A SECTION OR DETAIL ASSOCIATED WITH A PLAN VIEW |
| | SECTION LOCATION | TYPE OF DETAIL MARK USED TO INDICATE A SECTION (ie: SECTION "A" ON SHEET "A5") TAIL INDICATES DIRECTION OF VIEW |
| | SECTION LOCATION | TYPE OF SECTION MARK USED TO INDICATE A VIEW TAKEN IN THE DIRECTION OF THE ARROW (ie: SECTION "A" FOUND ON "D&S" OF THE PROJECT MANUAL |

FRAMING ANCHOR SCHEDULE

| APPLICATION | MANUFACTURER/MODEL | CAP. |
|------------------------------|--------------------------------|-----------|
| TRUSS TO WALL: | SIMPSON H2.5a | 535* |
| GIRDER TRUSS TO POST/HEADER: | SIMPSON LGT. w/ 28 - 16d NAILS | 1785* |
| HEADER TO KING STUD(S): | SIMPSON ST72 | 1310* |
| PLATE TO FOUNDATION: | 5/8" thru-BOLT | 3340* |
| FORCH BEAM TO POST: | SIMPSON FC44/EPC44 | 1700* |
| FORCH JOIST TO FND.: | SIMPSON ABU44 | 2200* |
| MISC. POINTS | SIMPSON A34 | 315*/240* |

NOTE:
ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.

NOTE:
REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/ JOINT REINFORCEMENT AND FASTENERS.

NOTE:
ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL TO.

NOTE:
"SEMCO" PRODUCT APPROVAL:
MIAMI/DADE COUNTY REPORT #35-0818/5

NOTE:
"SIMPSON" PRODUCT APPROVAL:
MIAMI/DADE COUNTY REPORT #31-0107.05, #36-1126.11, #39-0623.04
SBCCI NER-443, NER-333

GENERAL NAILING SCHEDULE:

| NUMBER OF NAILS FOR CONNECTING WOOD MEMBERS: | CONNECTION | COMMON NAILS | Nr. / SPACING |
|---|------------|--------------|---------------------------|
| BRIDGING TO JOIST, TOE NAIL | 16d | | 2 EA. END |
| 2" SUBFLOOR TO JOIST, BLIND & FACE NAILING | 16d | | 2 |
| SOLE PLATE TO JOIST OR BLOCKING | 16d | | 16" O.C. |
| FACE NAILED | 16d | | |
| TOP OR SOLE PLATE TO STUD | 16d | | 2 |
| END NAILED | 8d | | 3 OR 2 16d |
| STUD TO SOLE PLATE, TOE NAILED | 16d | | 24" O.C. |
| DOUBLE STUDS, FACE NAILED | 16d | | 16" O.C. |
| DOUBLE TOP PLATES, FACE NAILED | 16d | | |
| TOP PLATES - LAPPS & INTERSECTIONS | 16d | | 2 |
| FACE NAILED | 16d | | |
| 1 X 6 SHEATHING TO EACH POINT OF BEARING, FACE NAILED | 8d | | 2 |
| BUILT-UP CORNER STUDS, FACE NAILED | 16d | | |
| NAILED | 20d | | 30" O.C. |
| BUILT-UP GIRDERS & BEAMS | 16d | | 32" O.C. @ TOP & BOTTOM |
| | | | 4 STAGGERED - 2 @ EA. END |
| | | | 4 @ SPLICES |
| 3/4" PLYWOOD SUBFLOORING | 8d | | 10" O.C. @ INTERMEDIATE |
| OSB SHEATHING, 1/6" THICK | 8d | | 6" O.C. @ EDGES |
| 1/8" FIBERBOARD SHEATHING | 6d | | 10" O.C. @ INTERMEDIATE |
| | | | 6" O.C. @ INTERMEDIATE |

- NAILS, BOLTS AND OTHER METAL CONNECTORS WHICH ARE USED IN LOCATIONS EXPOSED TO THE WEATHER SHALL BE GALVANIZED OR OTHERWISE CORROSION RESISTANT.
- IN GENERAL, NAILS SHALL PENETRATE THE SECOND MEMBER A DISTANCE EQUAL TO THE THICKNESS OF THE MEMBER BEING NAILED THERETO, OR GREATER.
- THERE SHALL BE NOT LESS THAN 2 NAILS PER CONNECTION.
- GLUING SHALL NOT BE CONSIDERED AN ACCEPTABLE CONNECTOR IN LIEU OF THOSE SPECIFIED HEREIN.
- FORMED METAL CONNECTORS, AS PER THE SCHEDULE HEREIN, SHALL HAVE THE NUMBER OF NAILS INSTALLED AS REQUIRED BY THE MANUFACTURER, OR AS DIRECTED BY THE PLANS.
- NAILS PROJECTING BEYOND THE LAST WOOD MEMBER SHALL BE CLINCHED, WHEREVER POSSIBLE.
- NOTES IN THE "PLANS" PACKAGE OF THE CONSTRUCTION DOCUMENTS SUPERSEDES SIZES & SPACINGS OF NAILS CONTAINED HEREIN.

REVISION:

Copyright 2020
N.P. Gessler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
STRUCTURAL INFORMATION

48 Years of Service
1972 - 2020
N.P. Gessler, Architect
358-368-4355

NICHOLAS GEISLER
ARCHITECT
N.C.A.R.B. Certified

DATE:

20 AUG 2020

CONTRACT:



2K2064

SHEET:

A.6
6 OF 9

AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

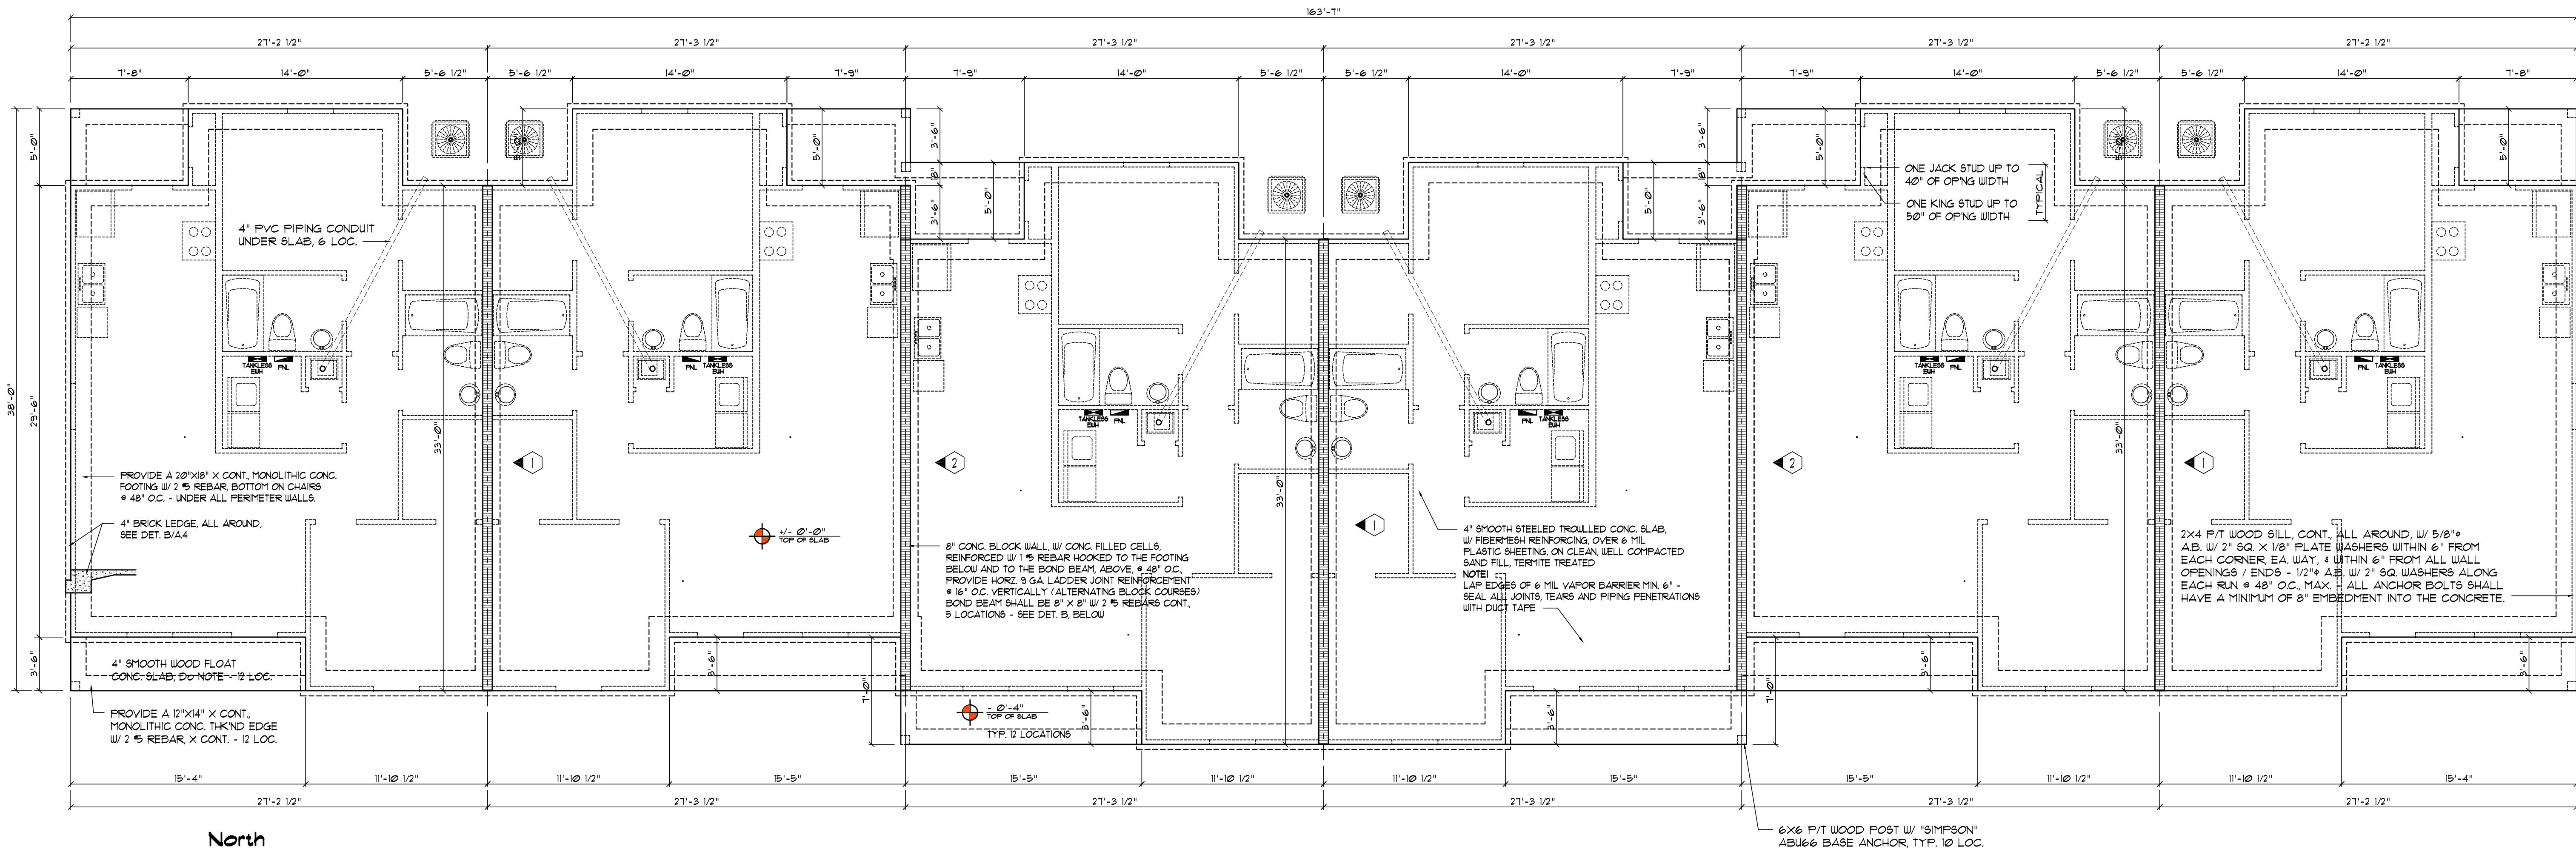

FOUNDATION PLAN



SCALE: 3/16" = 1'-0"

NOTE!
THE DESIGN WIND SPEED FOR THIS PROJECT IS 130 MPH PER 2011 FBC 1609, AND LOCAL JURISDICTION REQUIREMENTS

NOTE!
ADDED FILL SHALL BE APPLIED IN 8" LIFTS - EA. LIFT SHALL BE COMPACTED TO 98% DRY COMPACTION PER THE "MODIFIED PROCTOR" METHOD.

NOTE!
PLUMBING CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL PLUMBING WORK, INCLUDING ALL PLUMBING LINE LOCATIONS AND RISER DIAGRAM - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER AND 1 COPY TO THE PERMIT ISSUING AUTHORITY.

NOTE!
HVAC CONTRACTOR SHALL PREPARE "AS-BUILT" SHOP DRAWINGS INDICATING ALL HVAC WORK, INCLUDING ALL DUCTWORK LOC. SIZES, LINES, EQUIPMENT SGN. 4 BALANCING REPORT - CONTR SHALL PROVIDE 1 COPY OF AS-BUILT DUGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

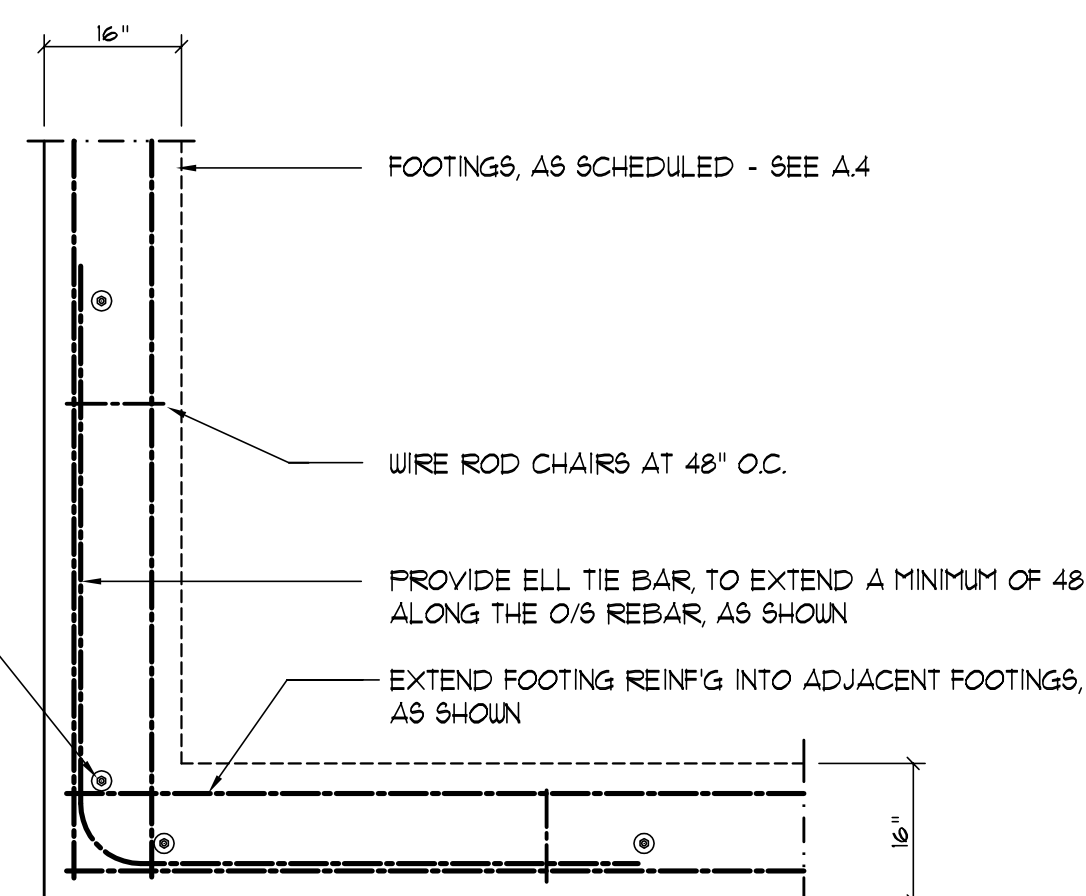
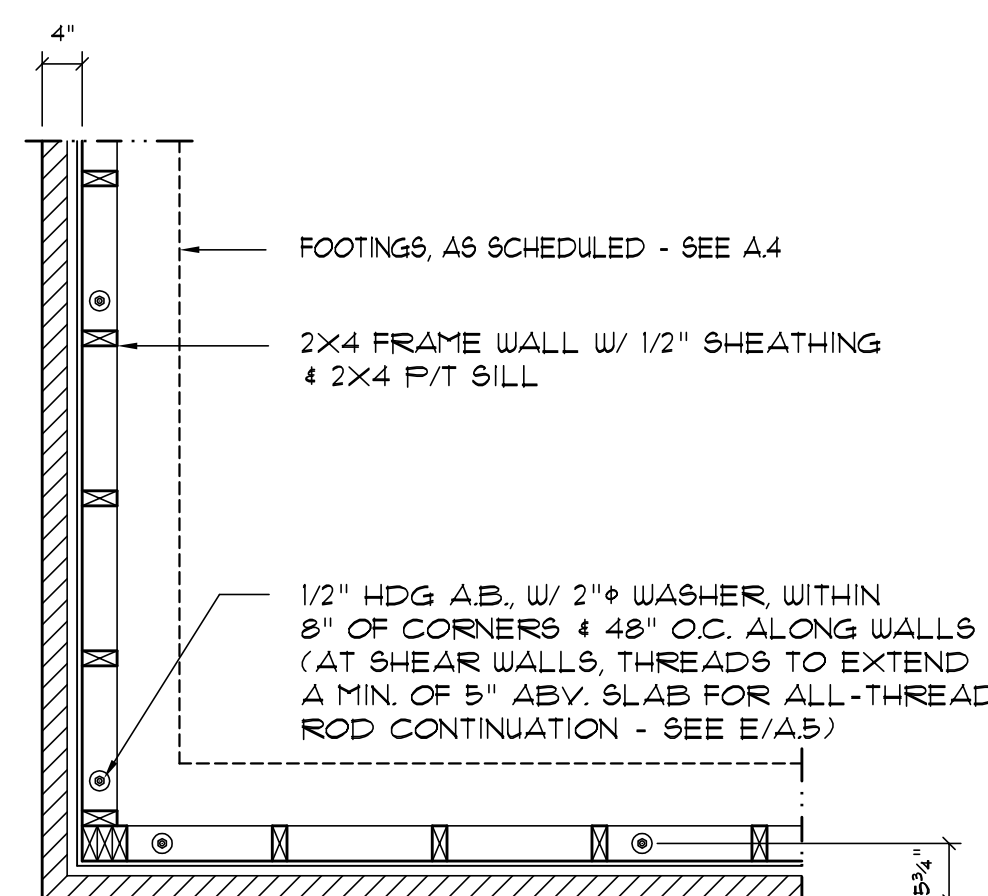


NOTE!
PRIOR TO THE CONSTRUCTION OF THE FOUNDATION, THE CONTRACTOR SHALL COORDINATE ANY INTERIOR BEARING LOCATION CONDITIONS PER THE TRUSS ENGINEERED SHOP DRAWINGS WITH THE FOUNDATION PLAN. ANY INTERIOR BEARING LOCATIONS OR ANY POINT LOADS OF 40 K OR GREATER SHALL BE SUPPORTED VIA A MODIFIED FOUNDATION PLAN. TAKING THESE LOADS INTO CONSIDERATION, THE CONTRACTOR SHALL MAKE THE ENGINEERED TRUSS SHOP DRAWINGS AVAILABLE TO THE ARCHITECT FOR THE PURPOSE OF RENDERING SUCH MODIFICATIONS PRIOR TO POURING ANY CONCRETE.

Wall/Foundation Reinf'g DETAIL

SCALE: NONE

A

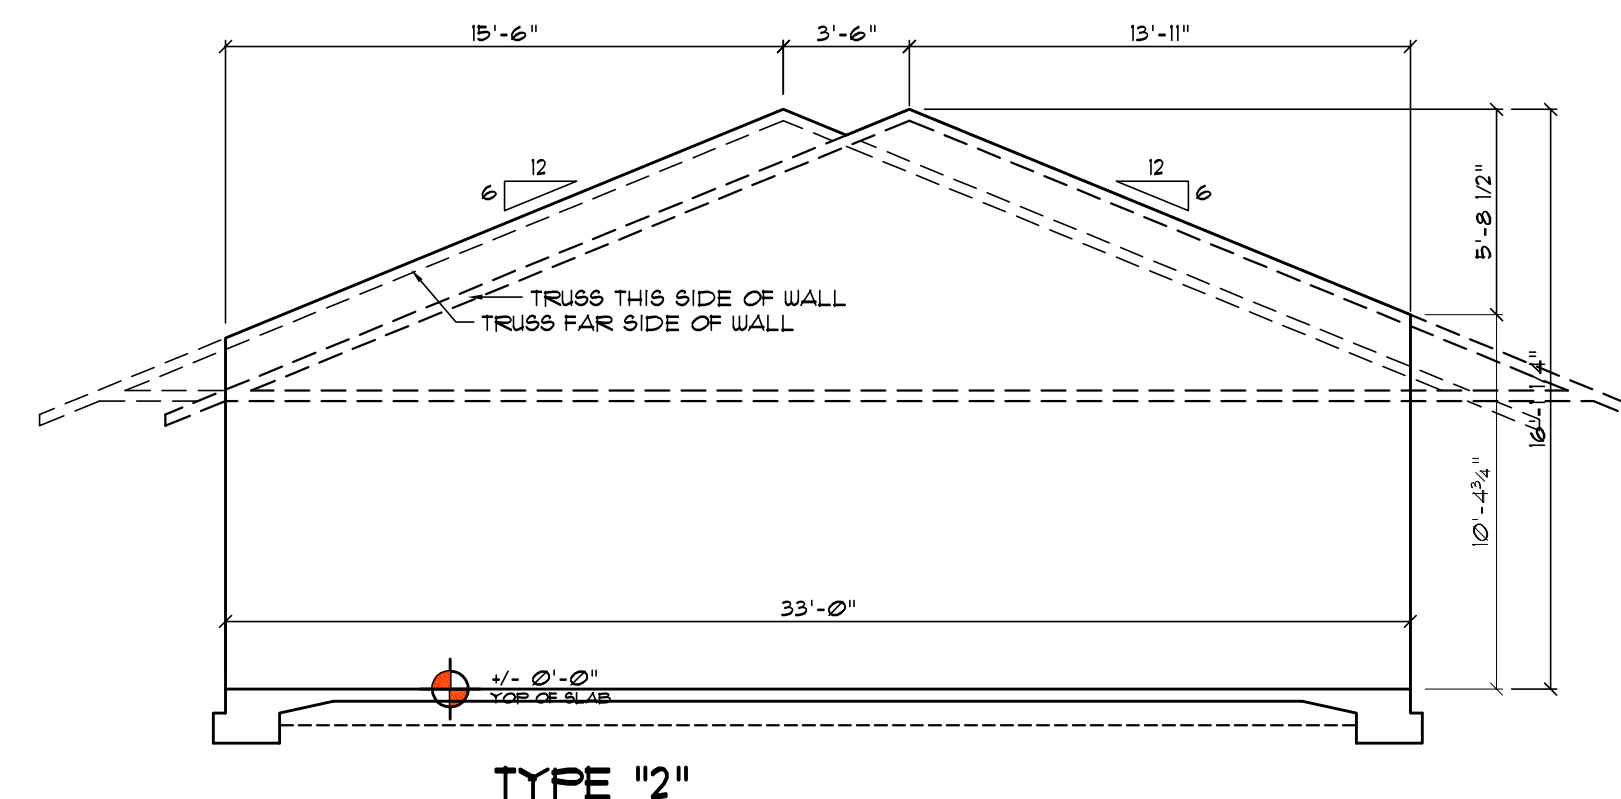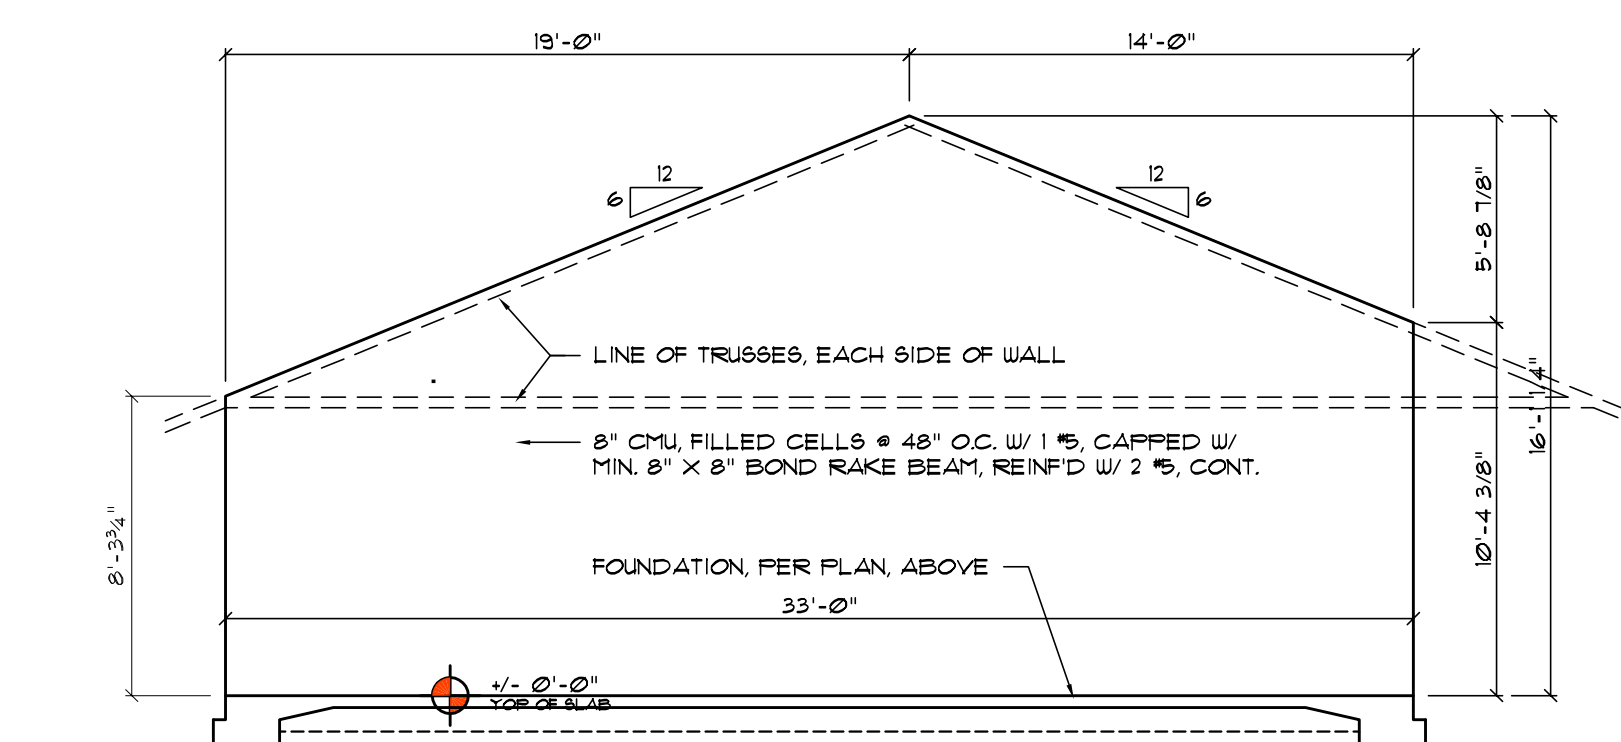

2 HOUR DEMISING PARTITION WALL

SCALE: NONE

B

CONCRETE GENERAL NOTES:

- DESIGN SOIL BEARING PRESSURE: 1000 PSF.
- EXPANSIVE SOILS: WHERE DIRECTED BY THE SOILS ENGINEER, SOIL AUGMENTATION PER THE SOILS ENGINEER'S SPECIFICATIONS SHALL BE IMPLEMENTED PRIOR TO PLACING ANY FOUNDATIONS - TESTS AS SPECIFIED SHALL BE PREPARED TO DETERMINE THE SUITABILITY OF THE SUB-GRADE TO SUPPORT THE DESIGN LOADS.
- CLEAN SAND FILL OVER STRIPPED AND COMPACTED EXISTING GD. SHALL BE PLACED IN 12" LIFTS, BOTH SUB-SOIL AND FILL COMPACTION SHALL BE NOT LESS THAN 98% AS MEASURED BY A MODIFIED PROCTOR TEST AT THE RATE OF ONE TEST FOR EACH 1500 SF OF BUILDING PAD AREA, OR FRACTION THEREOF, FOR EACH 12" LIFT.
- REINFORCING STEEL SHALL BE GRADE 60 AND MEET THE REQUIREMENTS OF ASTM A615, ALL BENDS SHALL BE MADE COLD.
- WELDED WIRE MESH SLAB REINFORCING SHALL MEET THE REQUIREMENTS OF ASTM A185 - MIN. YIELD STRESS = 25 KSI.
- CONCRETE SHALL BE STANDARD MIX F_c = 3000 PSI FOR ALL FTGS. SLABS, COLUMNS AND BEAMS OR SHALL BE STANDARD PUMP MIX F_c = 3000 PSI. STRENGTH SHALL BE ATTAINED WITHIN 28 DAYS OF PLACEMENT, MIXING, PLACING AND FINISHING SHALL BE AS PER ACI STANDARDS.

CONSTRUCTION NOTES

- FIELD VERIFY ALL DIMENSIONS AND MATERIALS. ALL OUTSIDE DIMENSIONS ARE TO FACE OF FOUNDATION.
- ALL NAILING CONSTRUCTION MATERIALS SHALL BE AS PER 2011 FBC - SEE A6
- PROVIDE EXTERIOR COMBUSTION AIR TO GAS FIRED HVAC, EQUIPMENT, WOOD BURNING STOVES, AND FIREPLACES.
- VENT CLOTHES DRYER, BATH, AND COOKING FANS TO EXTERIOR AS REQUIRED
- CONTRACTOR SHALL CALL ATTENTION TO THE DESIGNER, ANY DISCREPANCIES IN DRAWINGS AND/OR SPECIFICATIONS AND SHALL RECEIVE INSTRUCTIONS OR CLEARIFICATIONS BEFORE PROCEEDING WITH THE PORTION OF THE WORK IN QUESTION.
- ROOF & FLOOR TRUSS FRAMING PLANS ARE FOR GENERAL INFORMATION ONLY. THE TRUSS MANUFACTURER SHALL PROVIDE A DETAILED LAYOUT FOR TRUSS AND FRAMING MEMBERS.
- SHOULD CONDITIONS AT THE SITE BE FOUND MATERIALLY DIFFERENT FROM THOSE INDICATED BY THE DRAWINGS AND/OR SPECIFICATIONS, AND THE CONDITIONS USUALLY INHERENT IN THE WORK OF THE CHARACTER SHOWN AND SPECIFIED BE DIFFERENT FROM THE DESIGNERS RECOMMENDED BUILDING PROCEDURES, CALL IMMEDIATE ATTENTION TO SUCH CONDITIONS BEFORE PROCEEDING.
- LP GAS-BURNING APPLIANCES ARE NOT PERMITTED IN BASEMENTS OR CRAWLSPACES.
- DO NOT SCALE DRAWINGS. USE PRINTED DIMENSIONS ONLY.

REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
FOUNDATION PLAN

48 Years of Service
1972 - 2020
N.P. Geisler, Architect
AB00000000

NICHOLAS GEISLER
ARCHITECT
N.C.A.R.B. Certified

DATE:

20 AUG 2020

COM#:

2K2064



SHEET:

A.7

1 OF 9

AR0007005

These drawings, as instruments of service, are the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

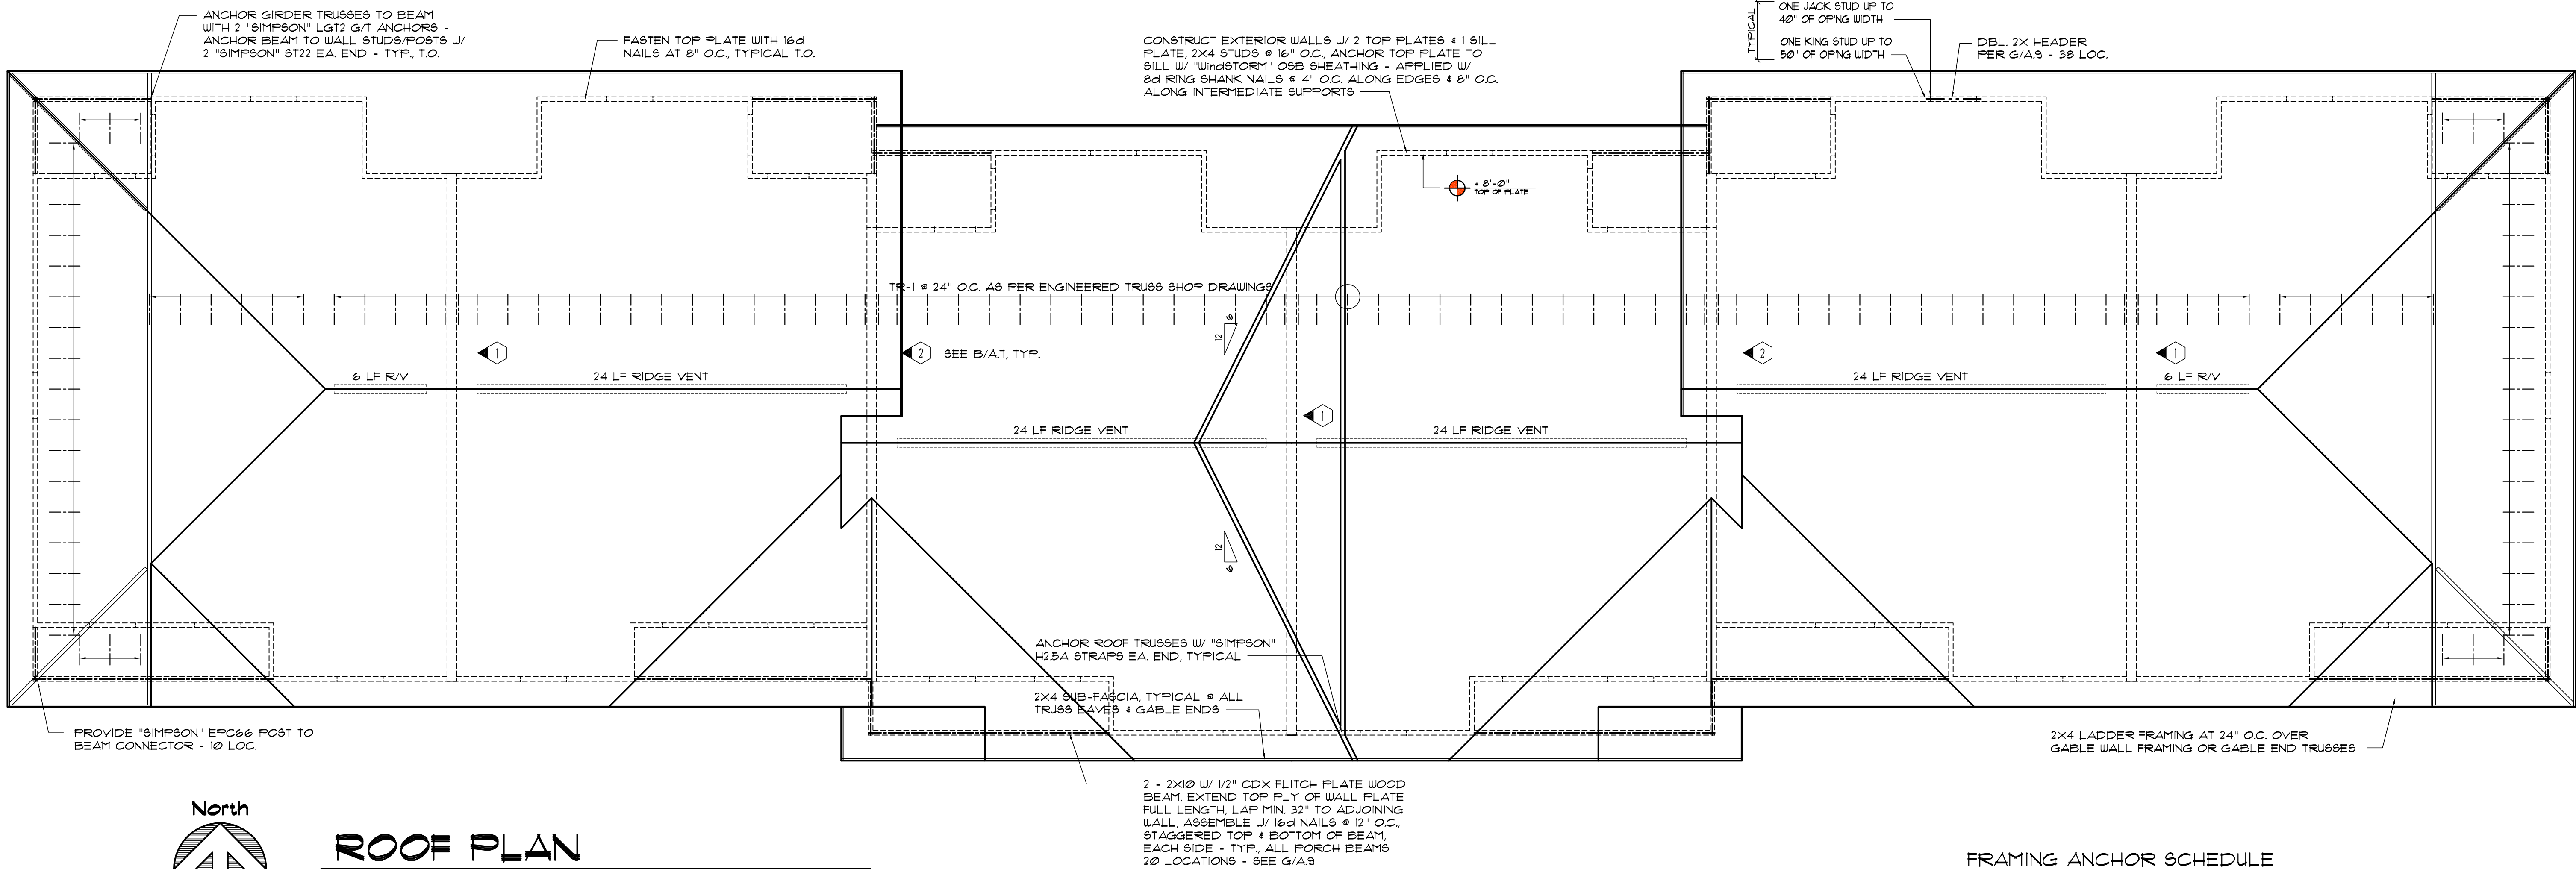

ROOF PLAN

SCALE: 3/16" = 1'-0"

NOTE!

ALL PENETRATIONS OF THE TOP PLATE OF ALL LOAD BEARING WALLS SHALL BE SEALED WITH FIRE RETARDANT CAULKING, INCLUDING WIRING, PLUMBING OR OTHER SUCH PENETRATIONS. WALLS OVER 8'-0" TALL SHALL HAVE CONTINUOUS BLOCKING TO LIMIT CAVITY HEIGHT TO 8'-0". PENETRATIONS THROUGH SUCH BLOCKING SHALL BE TREATED IN THE SAME MANNER AS TOP PLATES, NOTED ABOVE.

NOTE!

SHEATH ROOF W/ 1/2" CDX PLYWOOD PLACED W/ LONG DIMENSION PERPENDICULAR TO THE ROOF TRUSSES, SECURE TO FRAMING W/ 8d RING SHANK NAILS - AS PER DET. B/A.4

NOTE!

THE DESIGN WIND SPEED FOR THIS PROJECT IS 130 MPH PER 2017 FBC 1603 AND LOCAL JURISDICTION REQUIREMENTS.

NOTE!

REFER TO THE WINDOW/DOOR HEADER SCHEDULE ON SHEET A.5 FOR ALL MINIMUM SIZE HEADERS AND ALTERNATES. MINIMUM SIZE ALLOWABLE IS 2-2X10.

ROOF PLAN NOTES

- R-1 ALL ROOF PITCH 5/12
R-2 ALL OVERHANG 24" UNLESS OTHERWISE NOTED
R-3 PROVIDE ATTIC VENTILATION IN ACCORDANCE WITH SCHEDULE ON A.4
R-4 MOVE ALL VENTS AND OTHER ROOF PENETRATIONS TO REAR

NOTE!

ALL UPLIFT CONNECTORS SHALL BE FIELD ADJUSTED TO MATCH OR EXCEED THE DEVELOPED LOADS PER ENGINEERED TRUSS SHOP DRAWINGS.

SHOP DUG COORDINATION: THE TRUSS ANCHOR STRAPS AS INDICATED IN THE CONSTRUCTION DOCUMENTS ARE SUGGESTED STRAPS AND THAT THE TRUSS ENGINEERED SHOP DRAWINGS LOADS TAKE PRECEDENCE OVER THAT INDICATED IN THE CONSTRUCTION DOCUMENTS. THE UPLIFT LOADS INDICATED FOR EACH TRUSS IN THE ENGINEERED TRUSS SHOP DRAWINGS MAY BE MATCHED TO STANDARD PRODUCT UPLIFT RATINGS FOR COMPARABLE UPLIFT CONNECTORS, AND THAT THE PRODUCTS THAT PROVIDE EQUAL OR GREATER UPLIFT RESISTANCE FOR THE LISTED LOADS MAY BE USED IN LIEU OF THOSE INDICATED IN THE CONSTRUCTION DOCUMENTS OR AS APPROVED BY THE BUILDING OFFICIAL.

THE CONTRACTOR SHALL COORDINATE THE TRUSS TO TRUSS ANCHOR REQUIREMENTS WITH THE TRUSS ENGINEERING SHOP DRAWINGS. SOME OF THE TRUSS TO TRUSS CONNECTIONS WILL REQUIRE ANCHOR STRAPS IN ADDITION TO TYPICAL NAILING. ANCHOR DEVICES SHALL BE REQUIRED FOR ALL JOINTS WITH AN UPLIFT OR GRAVITY LOAD OF 100 LBS OR GREATER.

TRUSSES BEARING ON INTERIOR PARTITIONS WHERE UPLIFT LOADS ARE PRESENT SHALL REQUIRE ANCHORS OF EQUAL OR GREATER LOAD CAPACITY THAN THAT INDICATED BY THE TRUSS SHOP DRAWINGS. THE UPLIFT ANCHOR SYSTEM SHALL BE CONTINUOUS TO THE FOUNDATION.

GENERAL TRUSS NOTES:

- TRUSSES SHALL BE DESIGNED BY A LICENSED ENGINEER, AND IN ACCORDANCE WITH THE REQUIREMENTS OF THE "NATIONAL FOREST PRODUCTS ASSOCIATION" MANUAL FOR "STRESS RATED LUMBER AND ITS CONNECTIONS", LATEST Ed., ALONG W/ THE "TRUSS PLATE INSTITUTE" SUGGESTED GUIDELINES FOR TEMPORARY AND PERMANENT BRACING, AND HANDLING OF TRUSSES. TRUSS SHOP DRAWINGS SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, DETAILS, & TRUSS TO TRUSS CONNECTIONS.
- TRUSS SHOP DRAWINGS SHALL BE SIGNED & SEALED BY THE DESIGNING ENGINEER.
- FOLLOWING DEVELOPMENT OF TRUSS SHOP DRAWINGS, ADJUSTMENTS TO THE ANCHOR REQUIREMENTS MAY BE REQUIRED DEPENDING ON THE ENGINEERED GRAVITY AND WIND UPLIFT REQUIREMENTS OF TRUSSES OR GIRDERS. THE CONTRACTOR SHALL MAKE AVAILABLE A COMPLETE SET OF TRUSS SHOP DRAWINGS TO THE ARCHITECT FOR THE PURPOSE OF REVIEW OF LOADS IMPOSED ON THE BALANCE OF THE STRUCTURE. ANY SUCH REQUIRED CHANGE SHALL BE INCORPORATED INTO THE CONSTRUCTION OF THIS STRUCTURE.

NOTE!

VAULTED OR TRAY CEILINGS AS PER OWNER'S DIRECTIONS & ENGINEERED TRUSS SHOP DUGS.

ROOF SHEATHING:

SHEATH ROOF W/ 5/32" CDX PLYWOOD OR 1/16" OSB PLACED W/ LONG DIMENSION PERPENDICULAR TO THE ROOF TRUSSES, SECURE TO FRAMING W/ 8d RING SHANK NAILS, PER FASTENER SCHEDULE.

FRAMING ANCHOR SCHEDULE

| APPLICATION | MANUF./MODEL | CAP. |
|------------------------------|--------------------------------|-----------|
| TRUSS TO WALL: | SEMCO HDPT2, W/ 6 - 10d NAILS | 960* |
| GIRDER TRUSS TO POST/HEADER: | SIMPSON LGT, W/ 28 - 16d NAILS | 1785* |
| HEADER TO KING STUD(S): | SIMPSON ST22 | 1310* |
| PLATE TO STUD: | SIMPSON SP2 | 1065* |
| STUD TO SILL: | SIMPSON SP1 | 585* |
| PORCH BEAM TO POST: | SIMPSON PC66/EPC66 | 1700* |
| PORCH POST TO FND.: | SIMPSON ABJ66 | 2300* |
| MISC. JOINTS | SIMPSON A34 | 315*/240* |

NOTE:

ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.

NOTE:

REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/ JOINT REINFORCEMENT AND FASTENERS.

NOTE:

ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL T.O.

NOTE:

"SEMCO" PRODUCT APPROVAL:
MIAMI/DADE COUNTY REPORT #35-0818.15

NOTE:

"SIMPSON" PRODUCT APPROVALS:
MIAMI/DADE COUNTY REPORT #31-0107.05, #36-1126.11, #39-0623.04
SBCCI NER-443, NER-393

WOOD STRUCTURAL NOTES

- TEMPORARY BRACING OF THE STRUCTURE DURING ERECTION, REQUIRED FOR SAFE AND STABLE CONSTRUCTION, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR SO ENGAGED. TEMPORARY & PERMANENT BRACING OF ROOF TRUSSES SHALL BE AS PER THE STANDARD GUIDELINES OF THE "TRUSS PLATE INSTITUTE".
- ALL TRUSSES SHALL BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER & SHALL BE SIGNED AND SEALED BY SAME. TRUSS DESIGN SHALL INCLUDE PLACEMENT PLANS, TRUSS DETAILS, TRUSS TO TRUSS CONNECTIONS & THE STANDARD SPECIFICATIONS & RECOMMENDATIONS OF INSTALLATION OF THE "TRUSS PLATE INSTITUTE".
- WOOD STUDS IN EXTERIOR WALLS & INTERIOR BEARING WALLS SHALL BE NOT LESS THAN No.2 HEM-FIR OR BETTER.
- CONNECTORS FOR WOOD FRAMING SHALL BE GALVANIZED METAL OR BLACK METAL AS MANUFACTURED OR AS CALLED FOR IN THE PLANS AND BE OF A DESIGN SUITABLE FOR THE LOADS AND USE INTENDED. REFER TO THE JOINT REINFORCEMENT SCHEDULE FOR PRINCIPLE CONNECTIONS.


REVISION:

Copyright 2020
N.P. Geisler, Architect

DRAWN:

198

6 UNIT APARTMENT BUILDING for:
BLAKE LUNDY CONSTRUCTION
LAKE CITY, FLORIDA
ROOF PLAN



DATE:

20 AUG 2020

COMM:

2K2064


SHEET:

A.8

8 OF 9


AR0007005

These drawings, as instruments of service, and the sole property of the architect, and may not be used, copied or reproduced in whole or in part for use on or incorporated within any other job without specific and individual authorization by the architect.

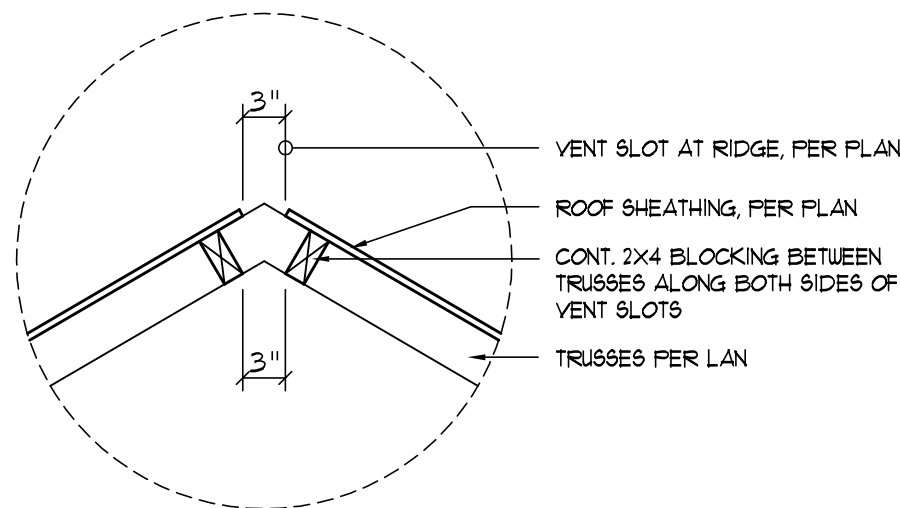


Vent DETAIL
SCALE: NONE

C1

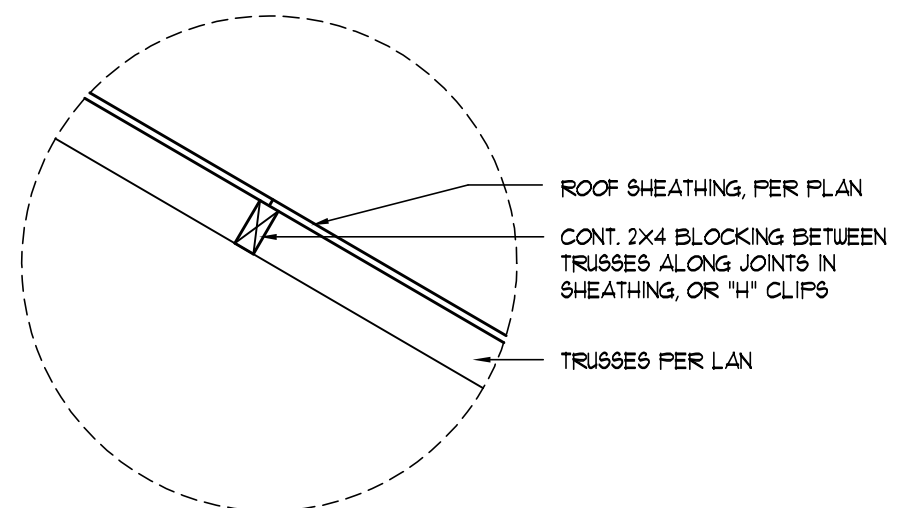


Joint DETAIL
SCALE: NONE

C2

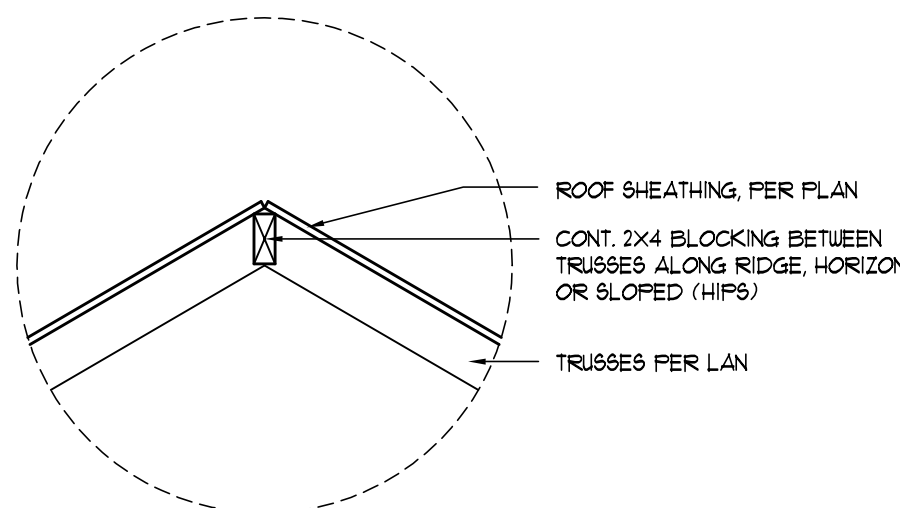


Ridge DETAIL
SCALE: NONE

C3

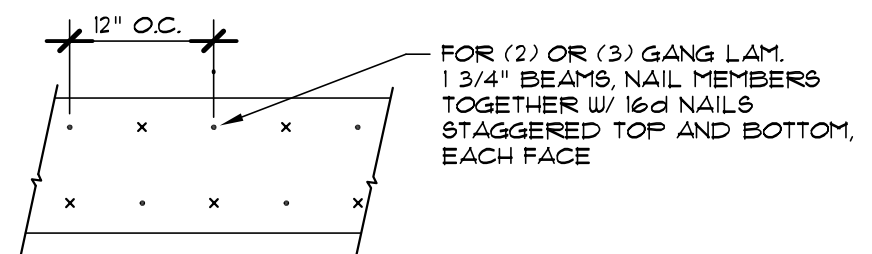

MULTIPLE GANG LAM. DETAIL
NOT TO SCALE

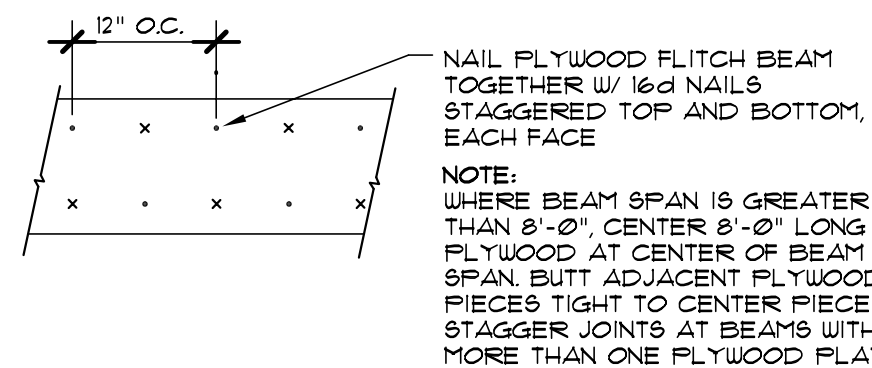


PLYWOOD FLITCH BEAM DETAIL
NOT TO SCALE

Beam DETAILS
SCALE: NONE

G

| ROOF SHEATHING FASTENINGS | | | |
|---------------------------|-----------------------------|---|---|
| NAILING ZONE | SHEATHING TYPE | FASTENER | SPACING |
| 1 | | | 6 in. o.c. EDGE 12 in. o.c. FIELD |
| 2 | 1/16" OSB, OR 15/32" CDX | 8d COMMON OR 8d HOT DIPPEED GALVANIZED BOX NAILS | 6 in. o.c. EDGE 6 in. o.c. FIELD |
| 3 | | | 4 in. o.c. GABLE ENDWALL OR GABLE TRUSSES 6 in. o.c. EDGE 6 in. o.c. FIELD |

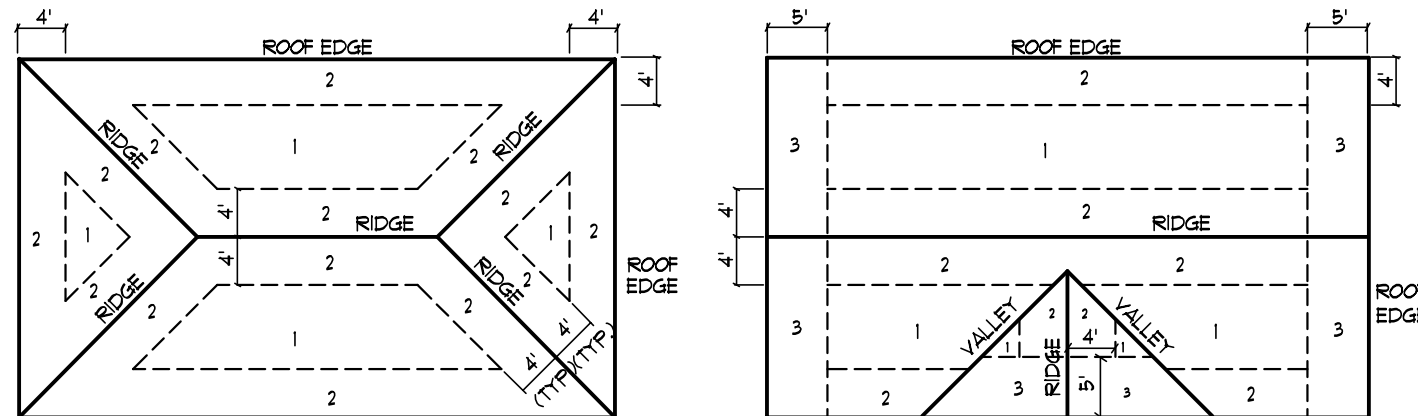


ROOF SHEATHING NAILING ZONES
(HIP ROOF) (GABLE ROOF)


Roof Nail Pattern DET.
SCALE: NONE

B

| HEADER SPANS FOR EXTERIOR BEARING WALLS | | | | | |
|---|-------------|---------------------|---------------|-------------|-----------|
| HEADERS SUPPORTING: | HEADER SIZE | BUILDING WIDTH (FT) | | | |
| | | 20' | 28' | 36' | |
| ROOF, CEILING | 2-2x4 | SPAN 3'-6" | * JACKS 3'-2" | SPAN 2'-10" | * JACKS 1 |
| | 2-2x6 | 5'-5" | 1 | 4'-8" | 1 |
| | 2-2x8 | 6'-10" | 1 | 5'-11" | 2 |
| | 2-2x10 | 8'-5" | 2 | 7'-3" | 2 |
| | 2-2x12 | 9'-9" | 2 | 8'-5" | 2 |
| | 3-2x8 | 8'-4" | 1 | 7'-5" | 1 |
| | 3-2x10 | 10'-6" | 1 | 9'-1" | 2 |
| | 3-2x12 | 12'-2" | 2 | 10'-7" | 2 |
| | 4-2x8 | 9'-2" | 1 | 8'-4" | 1 |
| | 4-2x10 | 11'-8" | 1 | 10'-6" | 1 |
| | 4-2x12 | 14'-1" | 1 | 12'-2" | 2 |
| | | | | 10'-11" | 1 |

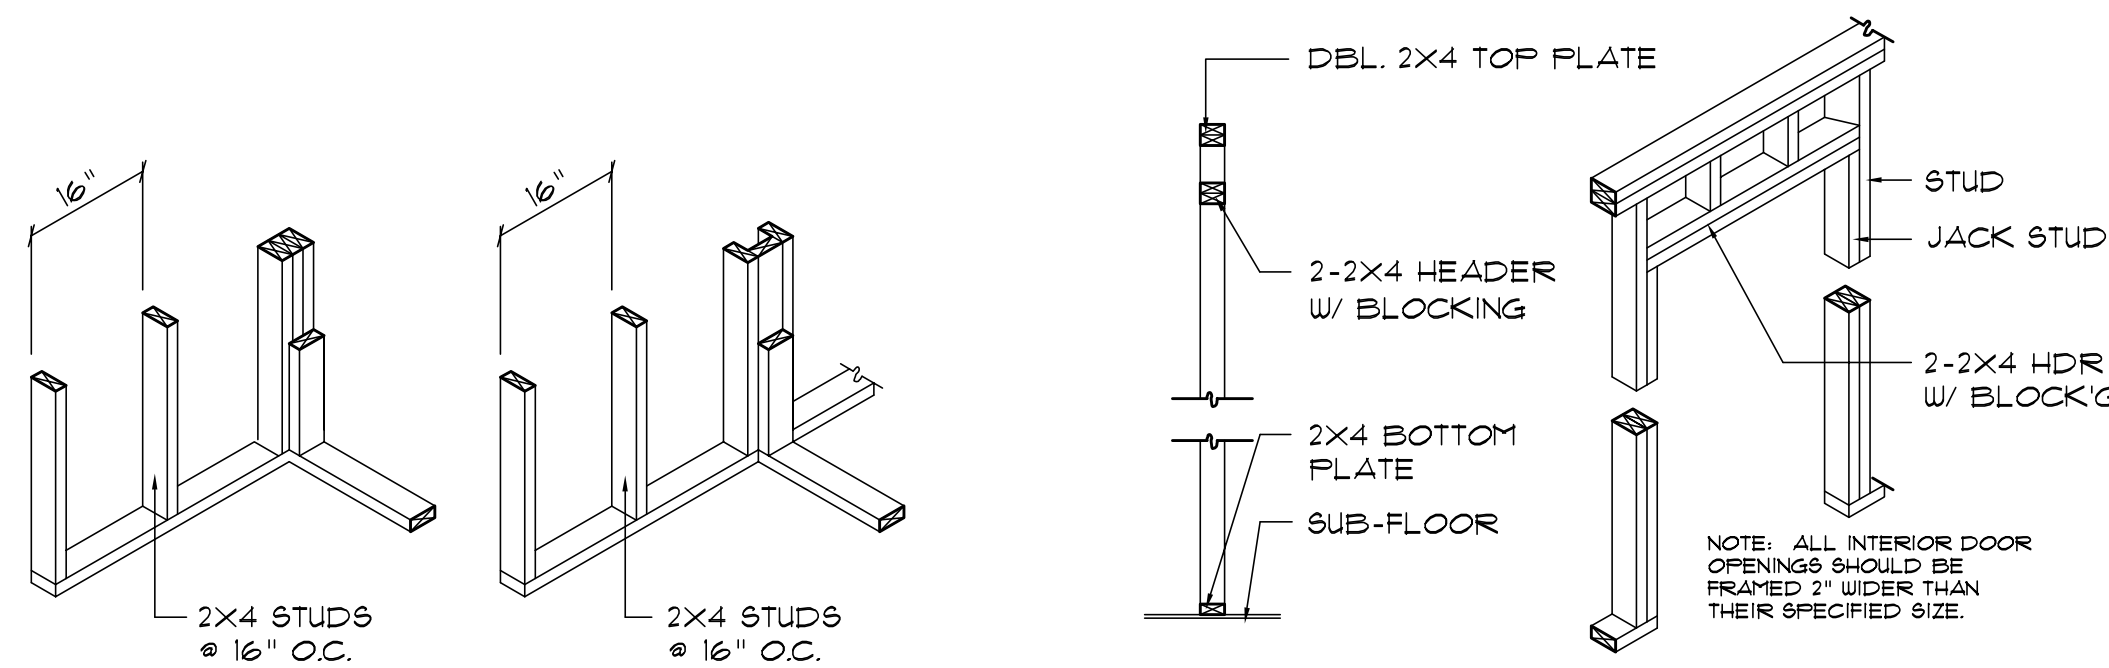


WALL CORNER WALL INTERSECTION NON-BEARING WALL HEADER

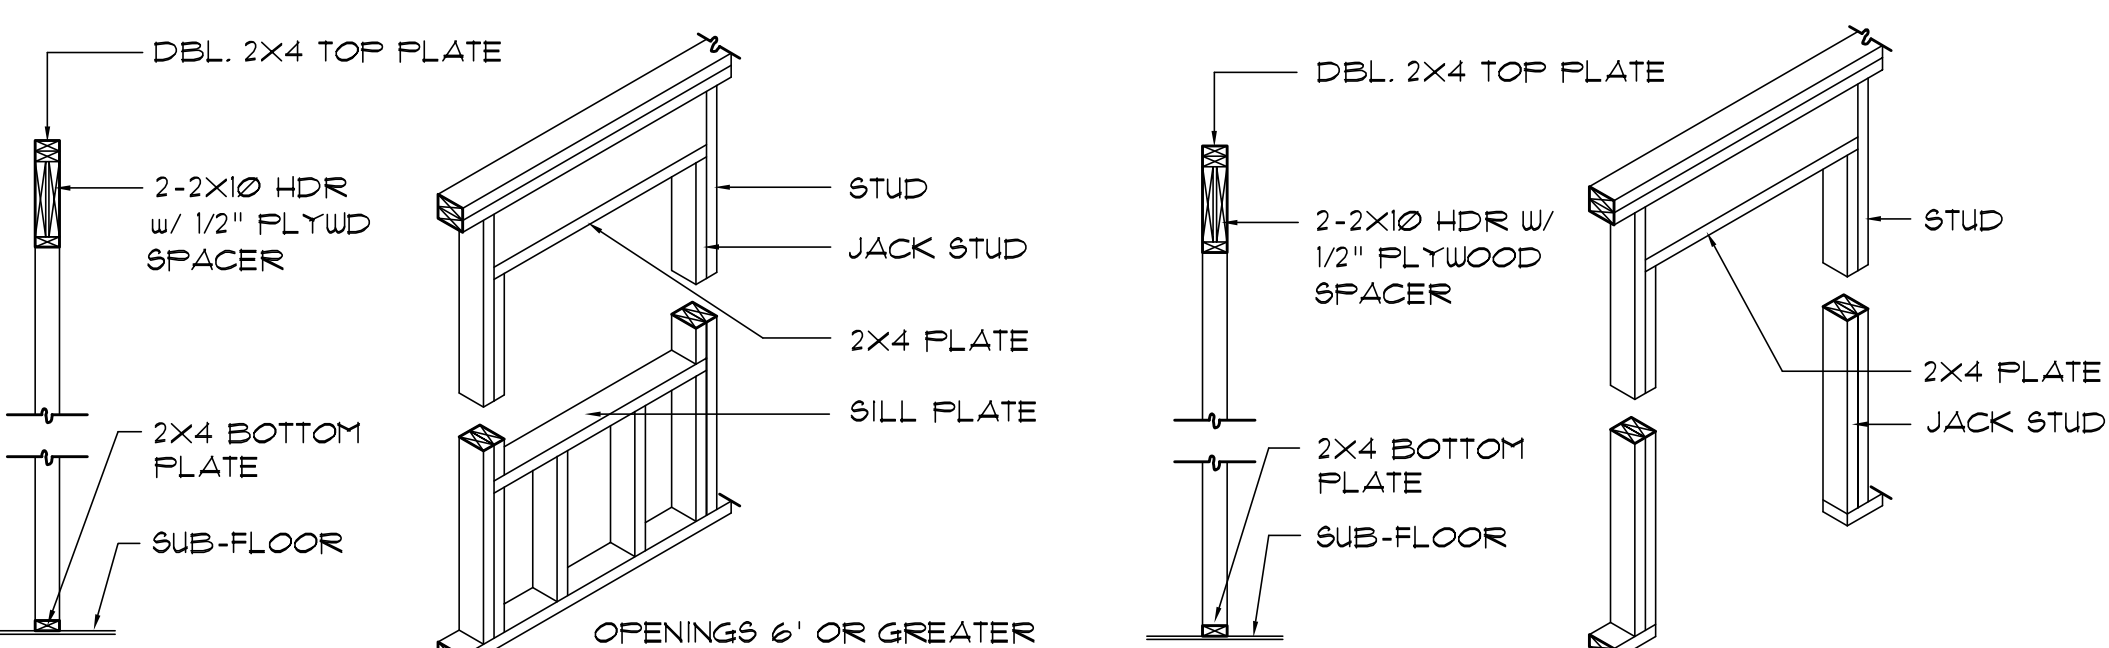

TYPICAL WINDOW HEADER BEARING WALL HEADER


Wall Framing/Header DETAILS
SCALE: NONE

F

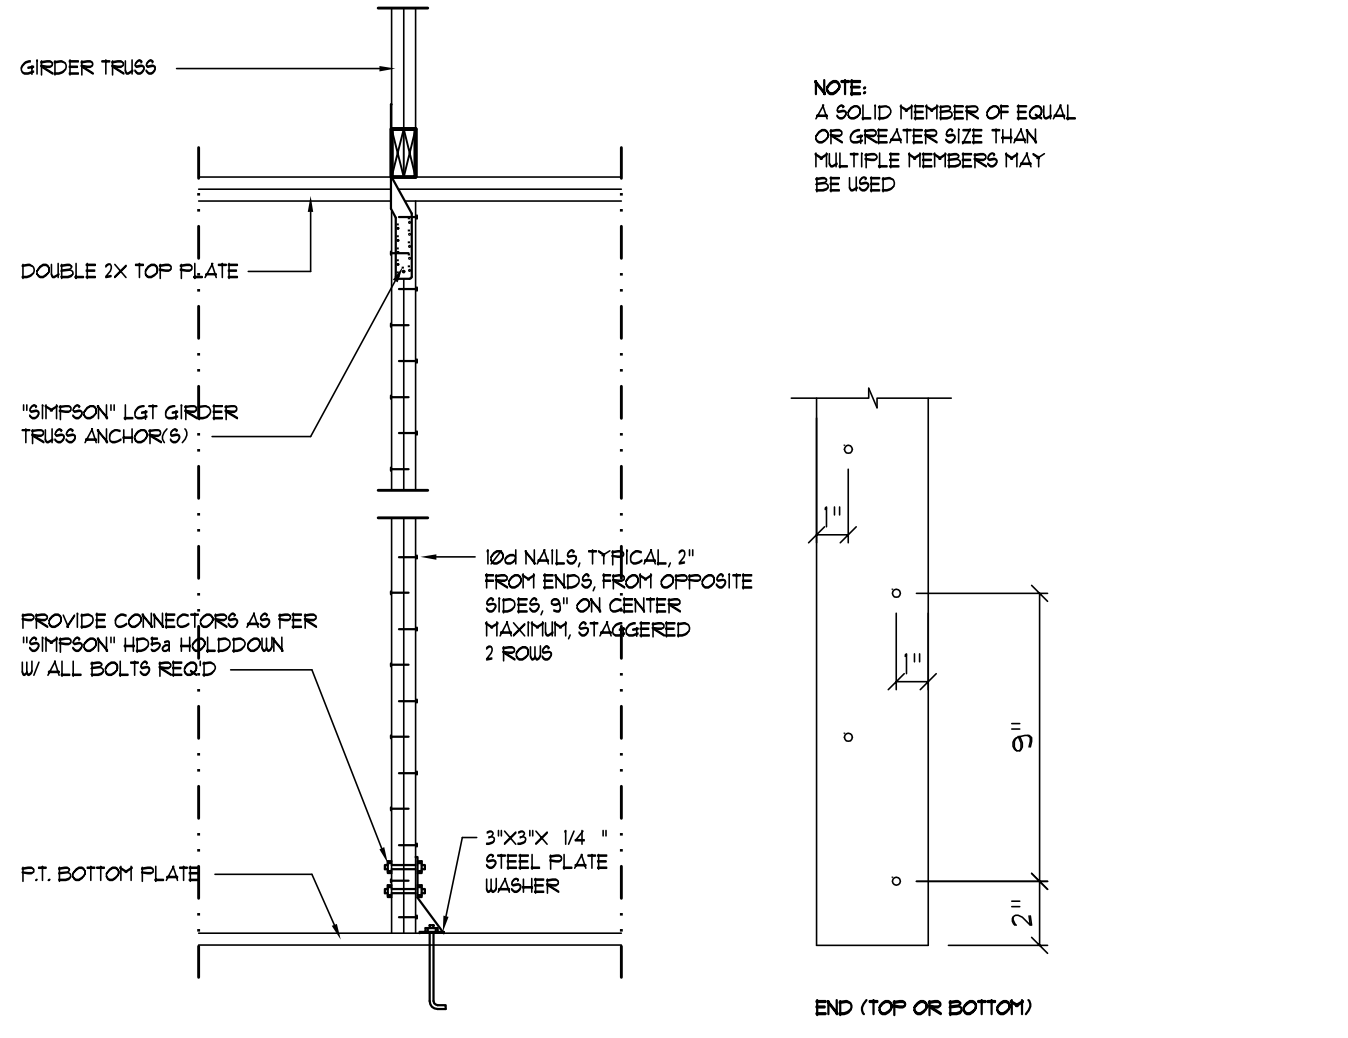

Girdler Truss Column DET.
SCALE: 1/2" = 1'-0"


C

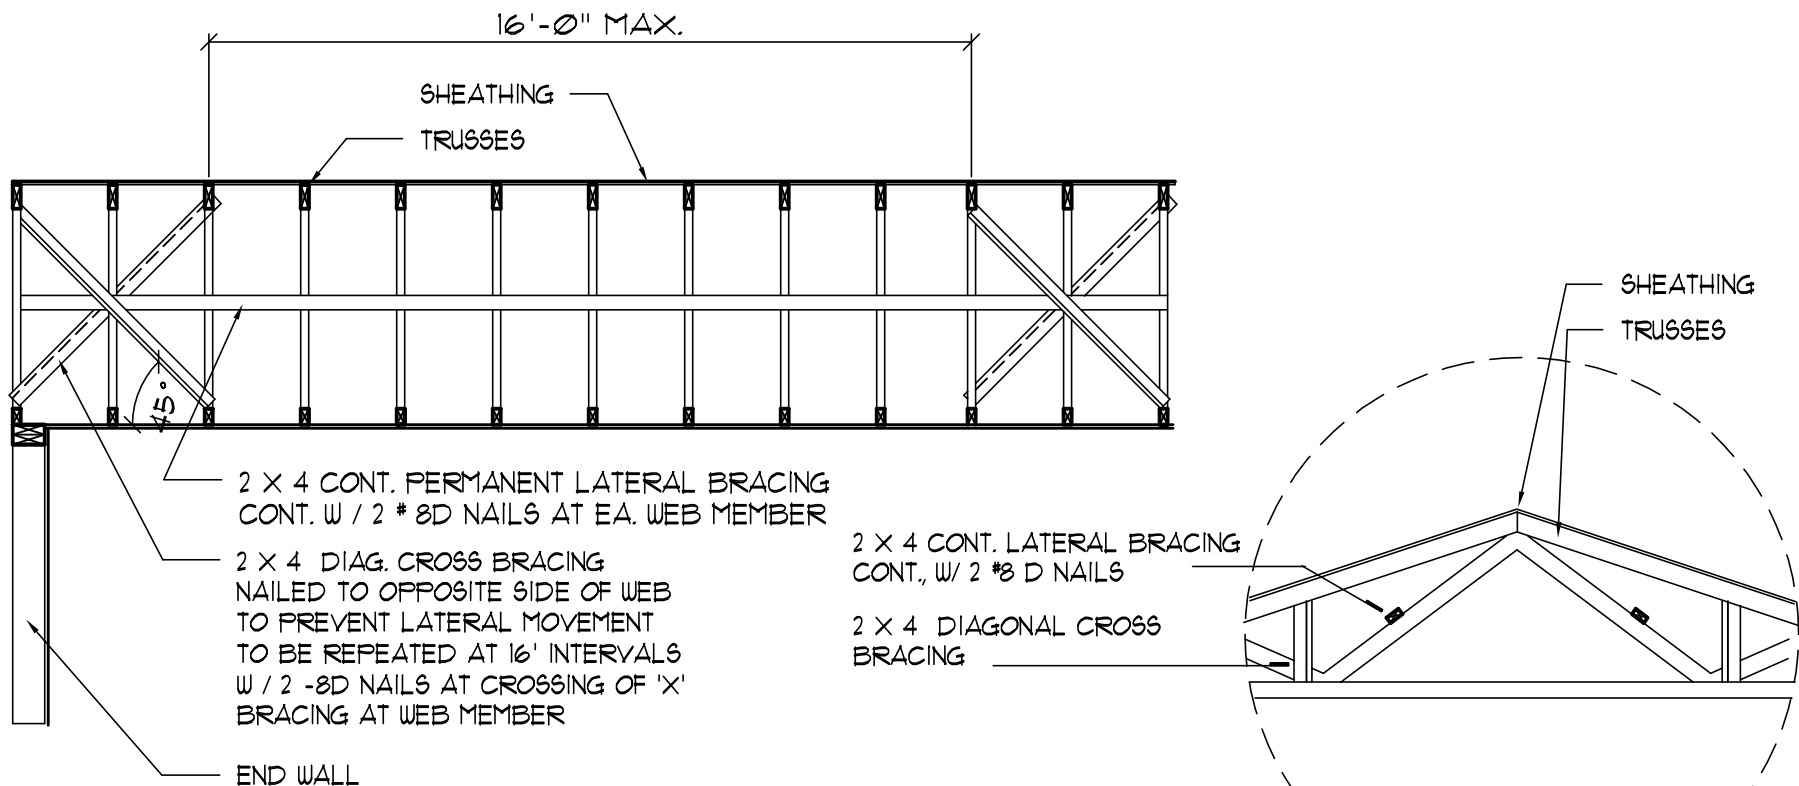

TYP. PERMANENT TRUSS BRACING DIA.
NTS
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

Truss Bracing DETAILS
SCALE: AS NOTED

D

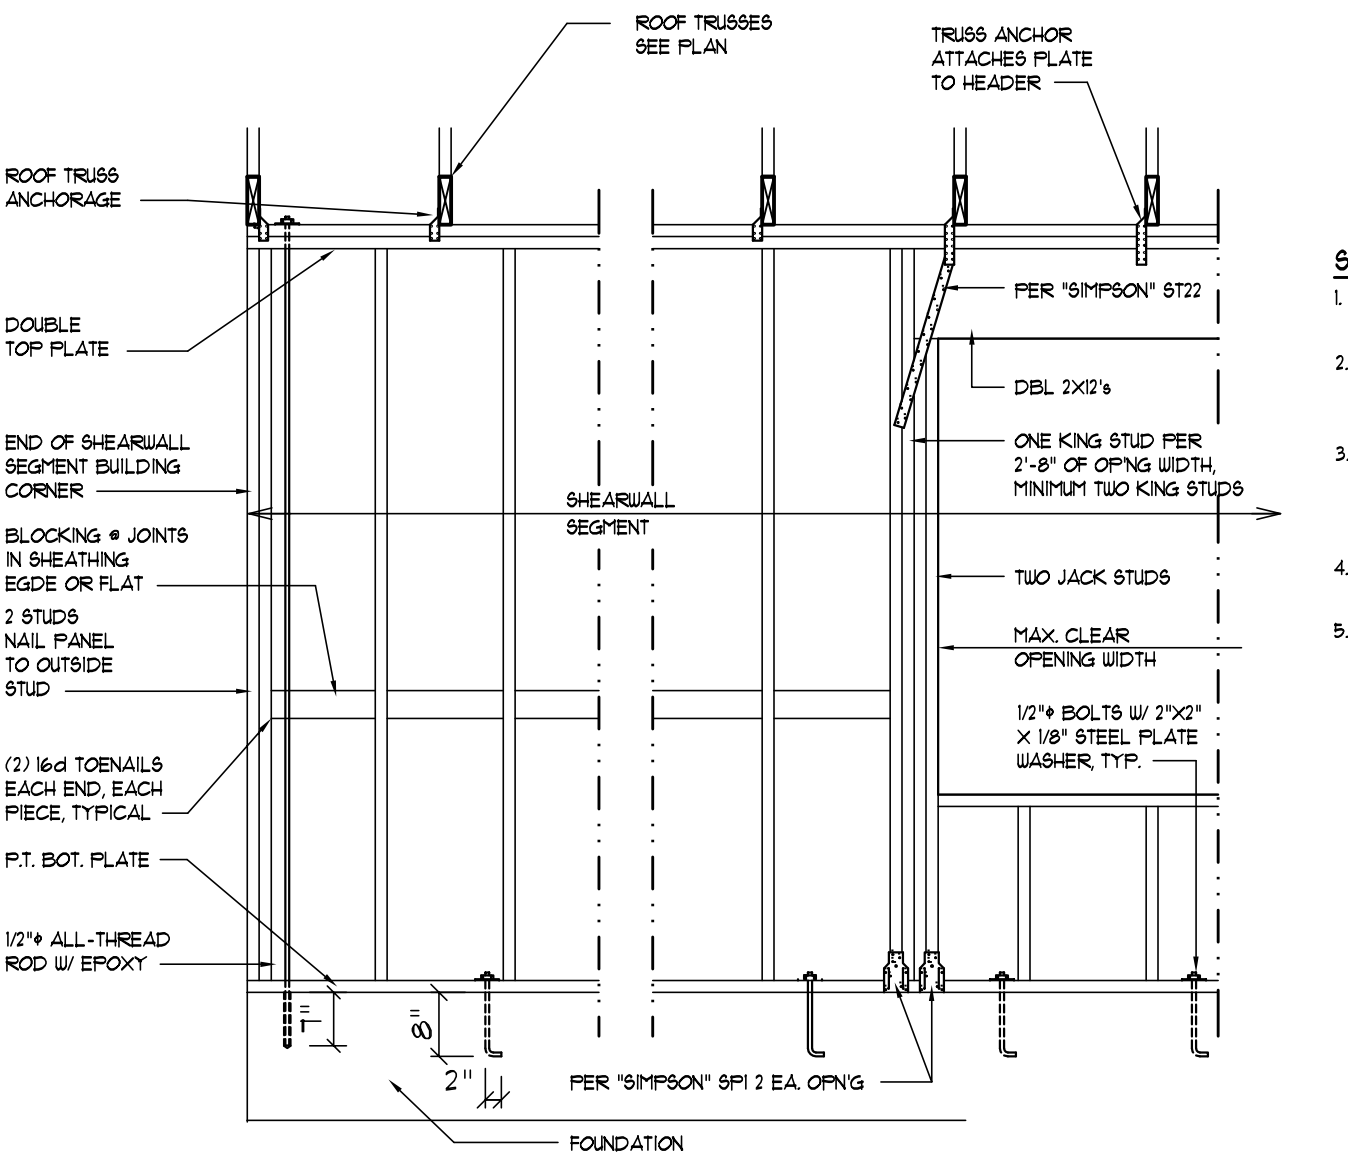

SHEARWALL NOTES:

- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DERIVED BY STD 10-91 S550C1 305.43.
- THE WALL SHALL BE ENTIRELY SHEATHED WITH 1/16" OSB, INCLUDING AREAS ABOVE AND BELOW OPENINGS.
- ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
- NAIL SPACING SHALL BE 4" O.C. EDGES AND 8" O.C. IN THE FIELD.
- TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3 FOR 8'-0" WALLS (7'-3").

| OPENING WIDTH | SILL PLATES | 16d TOE NAILS EACH END |
|---------------|--------------------|------------------------|
| UP TO 6'-0" | (1) 2x4 OR (1) 2x6 | 1 |
| 6' TO 8'-0" | (3) 2x4 OR (1) 2x6 | 2 |
| 8' TO 12'-0" | (5) 2x4 OR (2) 2x6 | 3 |

Shear Wall DETAILS
SCALE: NONE

E