

A. THE 2023 FLORIDA BUILDING CODE, 8TH EDITION

- B. ASCE/SEI 7-22: MINIMUM DESIGN LOADS ON BUILDINGS AND OTHER STRUCTURES
C. ACI 318-19: BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE
D. AISC STEEL CONSTRUCTION MANUAL (15TH EDITION)
E. AWS D1.1: STRUCTURAL WELDING

1. THESE PLANS BELONG EXCLUSIVELY TO THE STRUCTURE, INCLUDING MAIN WIND FORCE RESISTING SYSTEM (MWFRS), COMPONENTS AND CLADDING (C&C), AND BASE RAIL ANCHORAGE. OTHER DESIGN ISSUES, INCLUDING BUT NOT LIMITED TO PROPERTY SET-BACKS, ELECTRICAL, PLUMBING, INGRESS/EGRESS, FINISH FLOOR SLOPES AND ELEVATIONS, OR OTHER LOCAL ZONING REQUIREMENTS ARE THE LIABILITY OF OTHERS.

2. THESE STRUCTURES ARE ENGINEERED AS CAPABLE OF SUPPORTING DEAD LOAD OF THE STRUCTURE AND LIVE AND WIND LOADS. UPGRADES NOT SPECIFICALLY ADDRESSED HEREIN, SUCH AS WINDOWS, DOORS, OR ANOTHER COMPONENT NOT LISTED IN THE FLORIDA BUILDING CODE APPROVED PRODUCT LIST, AND NOT PROVIDED AND INSTALLED BY TUBULAR BUILDING SYSTEMS, WHICH CAUSE ADDITIONAL LOADS ON THE STRUCTURE SHALL BE AT THE OWNER'S RISK. FLORIDA ENGINEERING LLC, SHALL NOT BE RESPONSIBLE FOR FAILURE OR STRUCTURAL DAMAGE DUE TO THE EXTRA LOAD.

3. LOW ULTIMATE WIND SPEED 105 TO 140 MPH (NOMINAL WIND SPEED 81 TO 108 MPH): MAXIMUM RAFTER/POST AND END POST SPACING = 5.0 FEET.

4. HIGH ULTIMATE WIND SPEED 141 TO 170 MPH (NOMINAL WIND SPEED 109 TO 132 MPH): MAXIMUM RAFTER/POST AND END POST SPACING = 4.0 FEET.

5. ALL STEEL TUBING SHALL BE 50 KSI GALVANIZED STEEL. ALL FASTENERS SHALL BE ZINC COATED HARDWARE.

6. SPECIFICATIONS APPLICABLE TO 29 GAUGE METAL PANELS FASTENED DIRECTLY TO 2 1/2" x 2 1/2" - 14 GAUGE TUBE STEEL (TS) FRAMING MEMBERS FOR VERTICAL PANELS, 29 GAUGE METAL PANELS SHALL BE FASTENED TO 18 GAUGE HAT CHANNELS (UNLESS OTHERWISE NOTED).

7. FASTENERS CONSIST OF #12-14 x 3/4" SELF DRILLING FASTENER (SDF), USE CONTROL SEAL WASHER WITH EXTERIOR FASTENERS SPECIFICATIONS APPLICABLE ONLY FOR MEAN ROOF HEIGHT OF 20 FEET OR LESS, AND ROOF SLOPES OF 14° (3:12 PITCH) OR LESS SPACING REQUIREMENTS FOR OTHER ROOF HEIGHTS AND/OR SLOPES MAY VARY.

8. AVERAGE FASTENER SPACING ON-CENTERS ALONG RAFTERS OR PURLINS, AND POSTS, INTERIOR = 9" OR END = 6", (MAX.).

9. WIND FORCES GOVERN OVER SEISMIC FORCES. SEISMIC PARAMETERS ANALYZED ARE:
SOIL SITE CLASS = D
RISK CATEGORY I/II/III
R = 3.25 Ie = 1.0
Sds = 0.087 g V = CsW
Sdi = 0.084 g

10. GROUND ANCHORS SHALL BE INSTALLED THROUGH BASE RAIL WITHIN 6" OF EACH RAFTER COLUMN ALONG SIDES.

11. GROUND ANCHOR (SOIL NAILS) CONSIST OF #5 REBAR W/ WELDED NUT X 30" LONG IN SUITABLE SOIL CONDITIONS MAY BE USED FOR LOW (≤ 108 MPH NOMINAL) WIND SPEEDS ONLY. OPTIONAL ANCHORAGE MAY BE USED IN SUITABLE SOILS AND MUST BE USE IN UNSUITABLE SOILS AS NOTED.

12. MIN. LAP REQUIREMENT FOR REBAR IN FOOTER IS 25".

13. SOIL TO BE COMPACTED TO 95% OF ITS MAXIMUM DRY DENSITY, AT OPTIMUM MOISTURE CONTENT, IN ACCORDANCE WITH ASTM D1557-93

14. PRIOR TO PLACING CONCRETE, TREAT THE ENTIRE SUBSURFACE AREA FOR TERMITES IN COMPLIANCE WITH THE FBC. FOR RISK CATEGORY II, III, & IV STRUCTURES ONLY.

15. ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE.


16. A LANDING OF MIN. 36" WIDTH IN THE DIRECTION OF TRAVEL SHALL BE PROVIDED AT THE EXTERIOR DOORS. SLOPE OF LANDING NOT TO EXCEED 1/4"-1'. LANDING LEVEL NOT TO BE LOWER THAN 1-1/2" (FOR EGRESS DOORS) & 7-3/4" (FOR OTHER EXTERIOR DOORS) BELOW THE TOP OF THRESHOLD.

SHEET NO.	DRAWING INDEX
S/01	GENERAL NOTES
S/02	PLAN/ ELEVATIONS
S/03	FOUNDATION PLAN
S/04	DETAILS


PROPOSED METAL BUILDING FOUNDATION & SHELL STRUCTURAL DESIGN ONLY. ALL OTHER REQUIRED PERMITS TO BUILD OUT TO A HABITABLE LIVING SPACE ARE TO BE BY OTHERS/ PER SEPERATE CERTIFICATE. INCLUDING BUT NOT LIMITED TO, ELECTRICAL, PLUMBING, ENERGY CALCS., ETC. FOR MORE INFORMATION VISIT:
<https://flengineeringllc.com/order/> OR SCAN QR CODE.




THE ENGINEERING ON THESE PLANS IS SITE SPECIFIC FOR (1) STRUCTURE ONLY AT THE PROVIDED ADDRESS(ES).

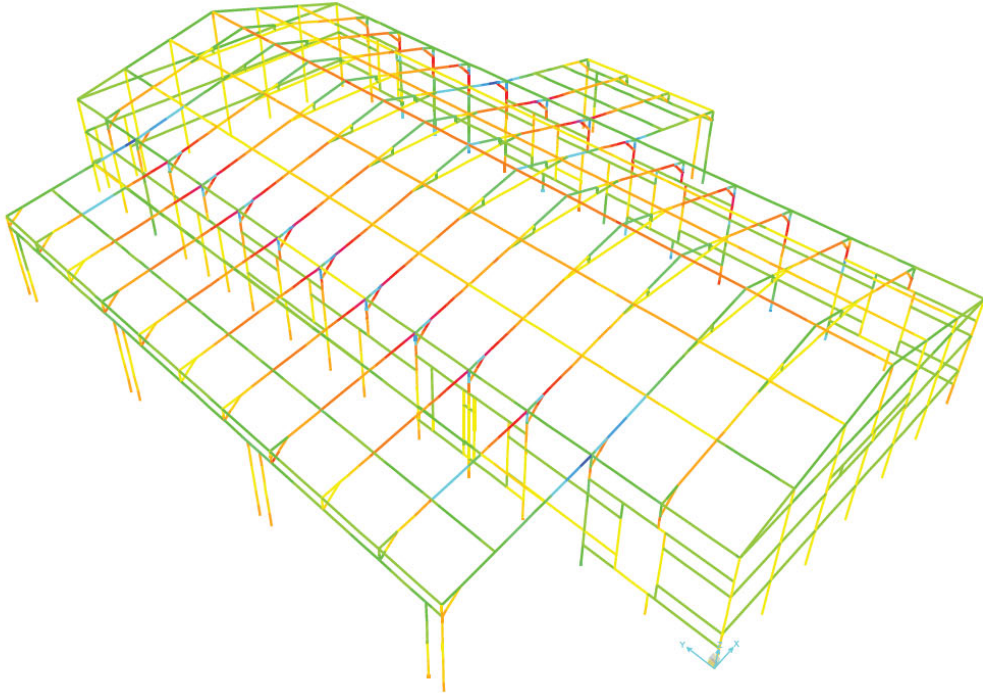


3-D FINITE ELEMENT ANALYSIS PERFORMED
STRUCTURE COMPLIES w/ FBC 2023 8th EDITION

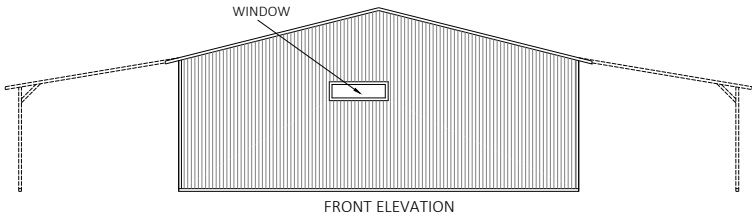


FRONT ELEVATION

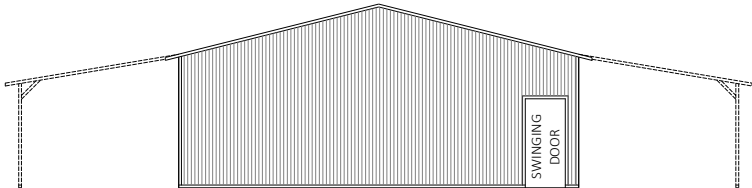

REAR ELEVATION

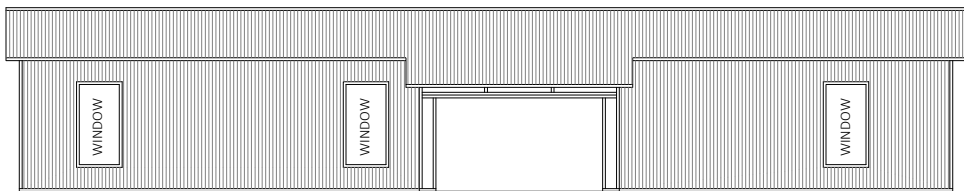

RIGHT SIDE ELEVATION

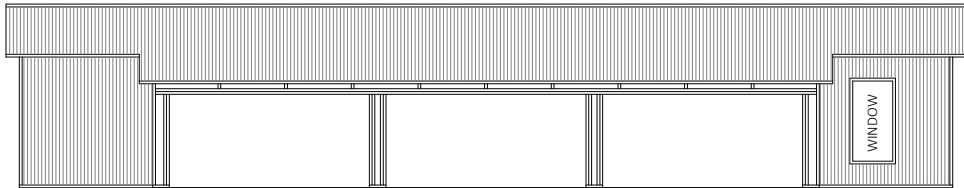

LEFT SIDE ELEVATION


PRODUCT CATEGORY	SUB CATEGORY	MANUFACTURER	APPROVAL No. & DATE
STRUCTURAL COMPONENTS	ROOF DECK	CAPITAL METAL SUPPLY, INC. 29 GA. CAPITAL RIB ROOF PANEL	FL20147.2-R3 12/13/23
STRUCTURAL COMPONENTS	STRUCTURAL WALL	CAPITAL METAL SUPPLY, INC. 29 GA. CAPITAL RIB WALL PANEL	FL20148.2-R3 12/13/23
EXTERIOR DOORS	SWINGING	MASONITE INTERNATIONAL WOOD-EDGE STEEL SIDE-HINGED DOOR UNIT	FL5465.1-R11 12/14/23
EXTERIOR DOORS	SWINGING	PLASTPRO INC. / NANYA PLASTICS CORP. A. SMOOTH/WOOD GRAIN/ RUSTIC/MAHOGANY SERIES N FIBERGLASS DOOR	FL15220.1-R5 10/17/23
WINDOWS	SINGLE HUNG	MI WINDOWS AND DOORS 3500 HP	FL17894.1-R6 08/19/23

CTP = CONTRACTOR TO PROVIDE APPROVED PRODUCTS THAT MEET OR EXCEED WIND DESIGN PRESSURES.

DESIGN DATA			
DESIGN CRITERIA :		ASCE/SEI 7	
RISK CATEGORY :		II	
OCCUPANCY CLASSIFICATION :		R3	
CONSTRUCTION TYPE :		II-B	
DEFLECTION LIMIT =		L/240	
ULTIMATE DESIGN WIND SPEED (MPH) V _{ULT} =		120	
NOMINAL DESIGN WIND SPEED (MPH) V _{ASD} =		93	
EXPOSURE CATEGORY :		C	
MEAN BUILDING HEIGHT (FT) =		11.88	
MINIMUM BUILDING PLAN DIMENSION (FT) =		30.00	
END ZONE DIMENSION (FT) a =		3.00	
ROOF STYLE :		GABLE	
ROOF PITCH :		3.00 IN 12	
OCCUPANCY CLASSIFICATION :		PARTIALLY ENCLOSED	
DEAD LOAD (DUE TO SELF-WEIGHT) =		3.5 PSF	
ROOF LIVE LOAD =		12 PSF	
GROUND SNOW LOAD =		0 PSF	
ADJUSTED C & C WIND PRESSURES (ASD) (PSF)			
ROOF		EWA (FT ²)	
		75.00	
Zone 1'	NA	NA	
Zone 1	15.2	-26.6	
Zone 2'	NA	NA	
Zone 2	15.2	-33.8	
Zone 3'	NA	NA	
Zone 3	15.2	-41.2	
ROOF O/H		EWA (FT ²)	
		75.00	
Zone 1'	NA	NA	
Zone 1	NA	-40.1	
Zone 2'	NA	NA	
Zone 2	NA	-47.2	
Zone 3'	NA	NA	
Zone 3	NA	-54.8	
WALL		EWA (FT ²)	
		50.00	
Zone 4	22.9	-24.5	
Zone 5	22.9	-27.3	
SWING DOOR		EWA (FT ²)	
		20.00	
Zone 4	24.0	-25.6	
Zone 5	24.0	-29.5	
ROLL-UP DOOR		EWA (FT ²)	
		87.50	
Zone 4	22.2	-23.8	
Zone 5	22.2	-25.9	
WINDOW		EWA (FT ²)	
		4.00	
Zone 4	24.8	-26.5	
Zone 5	24.8	-31.3	


CONTRACTOR TO PROVIDE BUILDING CODE APPROVED PRODUCTS TO MEET OR EXCEED THE DESIGN PRESSURES AS TABULATED.

This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by Richard E Walker
Date: 2024.02.28 14:23:44-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2403108

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

PROJECT ADDRESS:

SNIDER
403 SE TEVIS AVE
LAKE CITY, FL 32025

DESIGN DATE: 02/23/2024

REVISION 1: 02/23/2024

REVISION 2: 02/23/2024

DRAWN BY: TCP

SCALE: NTS

SHEET:









01

FRAMING NOTES:

1. ALL FRAME MEMBERS ARE 2.5"X2.5"X14 GA TS U.N.O.
2. MAX. RAFTER SPACING = 5'-0"
3. U-BRACE = 2.5"X2"X18 GA CHANNEL
4. PURLIN = 1.5" X 18GA HAT CHANNEL
5. KNEE BRACE = 2.5"X2"X18GA CHANNEL

A circular professional engineer seal for Richard Edward Walker. The seal features a blue and white striped background. The text "RICHARD EDWARD WALKER" is arched across the top, "LICENSE" is in the center, "No. 61240" is below the license word, "STATE OF FLORIDA" is below the number, and "PROFESSIONAL ENGINEER" is arched across the bottom. Two stars are positioned on the left and right sides of the seal.

Digitally signed by Richard E Walker
Date: 2024.02.28 14:23:41-05'00'

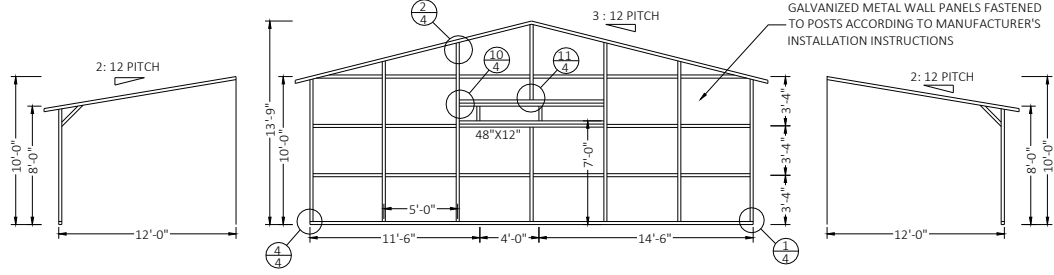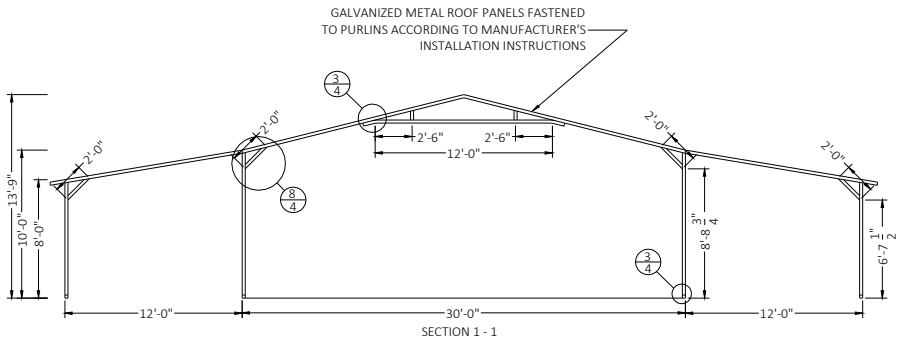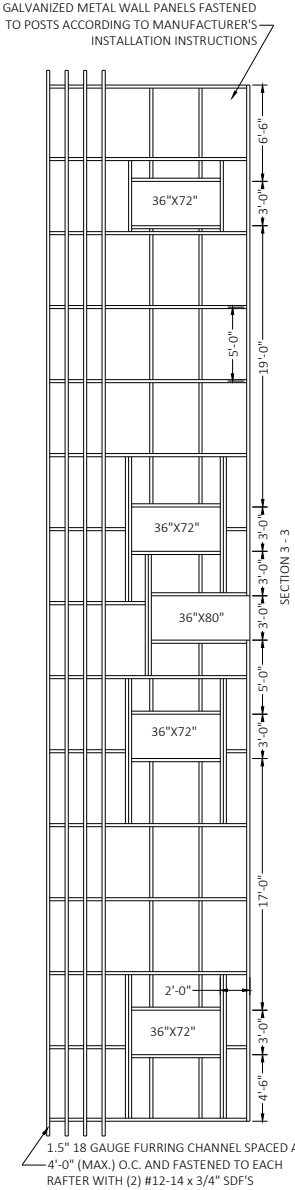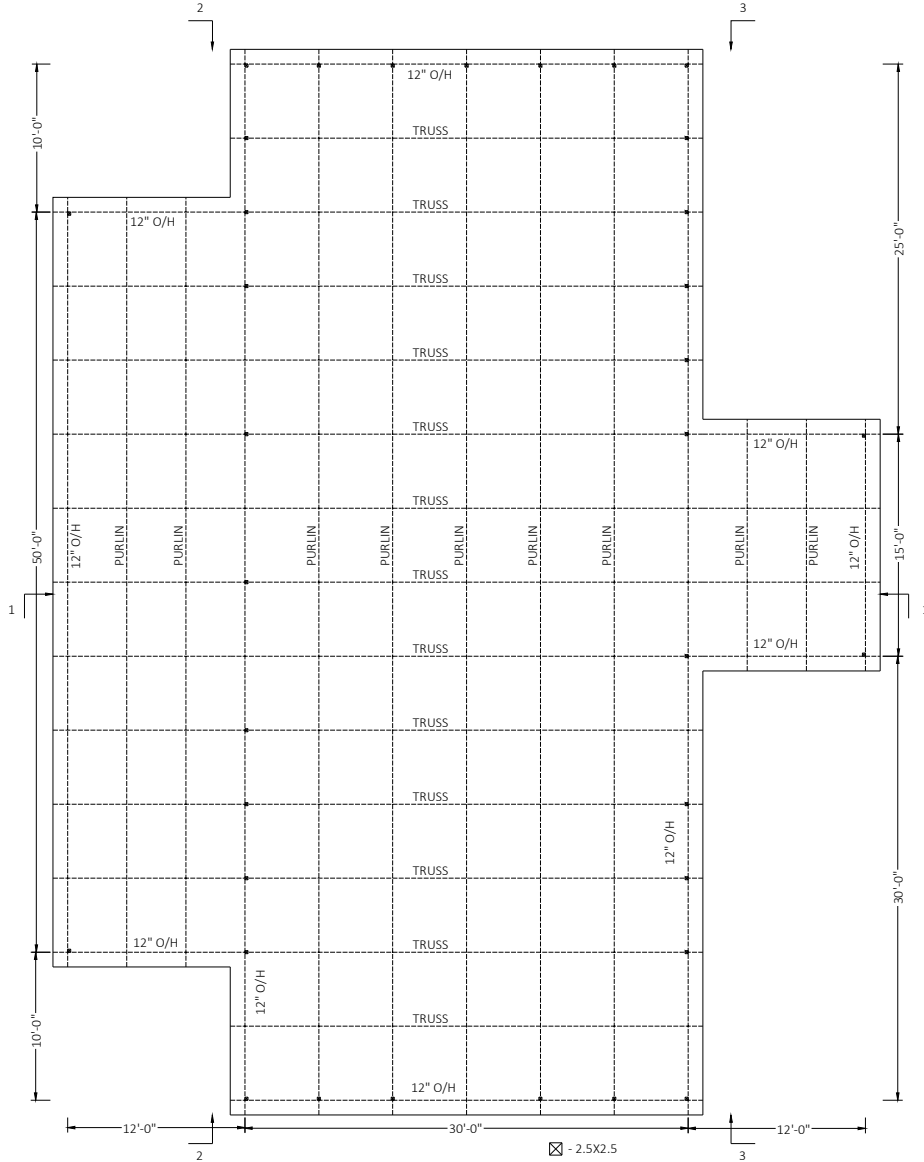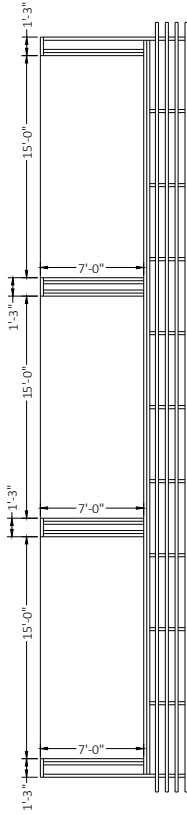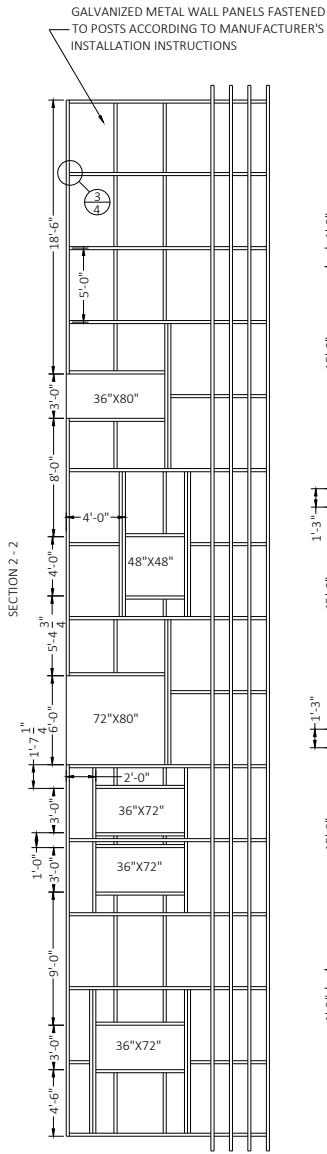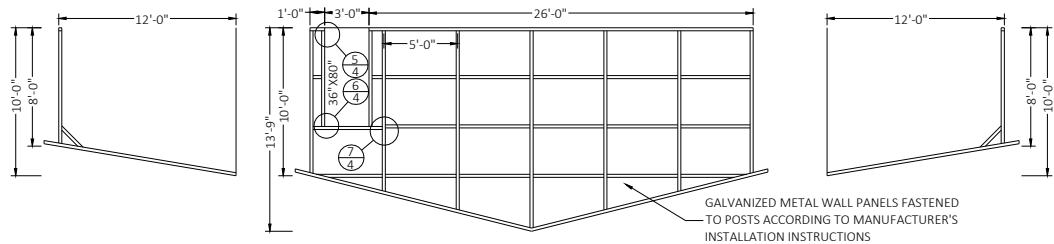

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com

PROJECT NO. 2403108

CA CERT. #30782

TRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

LECT ADDRESS:
SNIDER
403 SE TEVIS AVE
LAKE CITY, FL 32025

DESIGN DATE:	02/23/2024
REVISION 1:	02/23/2024
REVISION 2:	02/23/2024
DRAWN BY:	TCP
SCALE:	NTS

02

GENERAL NOTES

CONCRETE:
CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS.


COVERAGE OF THE REINFORCED STEEL:
FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE PER ACI-318: 3 INCHES WHERE THE CONCRETE IS POURED AGAINST AND TEMPORARY IN CONTACT WITH THE EARTH OR UNPROTECTED FROM THE EARTH OR WEATHER, OTHERWISE 1-1/2 INCHES.

CONCRETE NOTE:
ALL OPEN AREAS OF CONCRETE OUTSIDE OF THE PROPOSED STRUCTURE SHALL BE DESIGNED TO SLOPE AWAY FROM THE STRUCTURE


REINFORCING STEEL:
THE TURNDOWN REINFORCING STEEL SHALL BE ASTM A615 GRADE 60. THE SLAB REINFORCEMENT SHALL BE WELDED WIRE FABRIC MEETING ASTM A185 OR FIBERGLASS FIBER REINFORCEMENT.

REINFORCEMENT MAY BE BENT IN THE FIELD OR SHOP AS LONG AS:
1. IT IS BENT COLD;
2. REINFRCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT;
3. THE DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS NOT LESS THAN SIX-BAR DIAMETERS.

FROST PROTECTION:
FOUNDATION SHALL BE PROTECTED AGAINST FROST USING RIGID FOAM INSULATION (EPS OR EQUIVALENT). FOR NO FROST PROTECTION OPTION, COORDINATE WITH LOCAL BUILDING CODE AND/OR BUILDING OFFICIAL REGARDING REQUIRED FOOTING DEPTH BASED ON FROST LINE DEPTH.

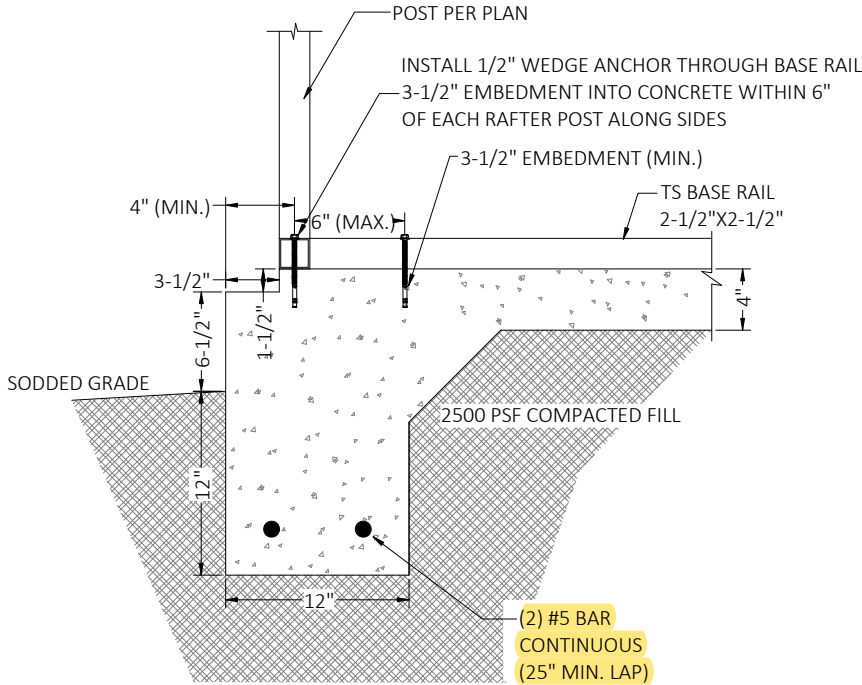


1 12"X20" MONO. FOOTER BASE RAIL ANCHORAGE
SCALE: NTS

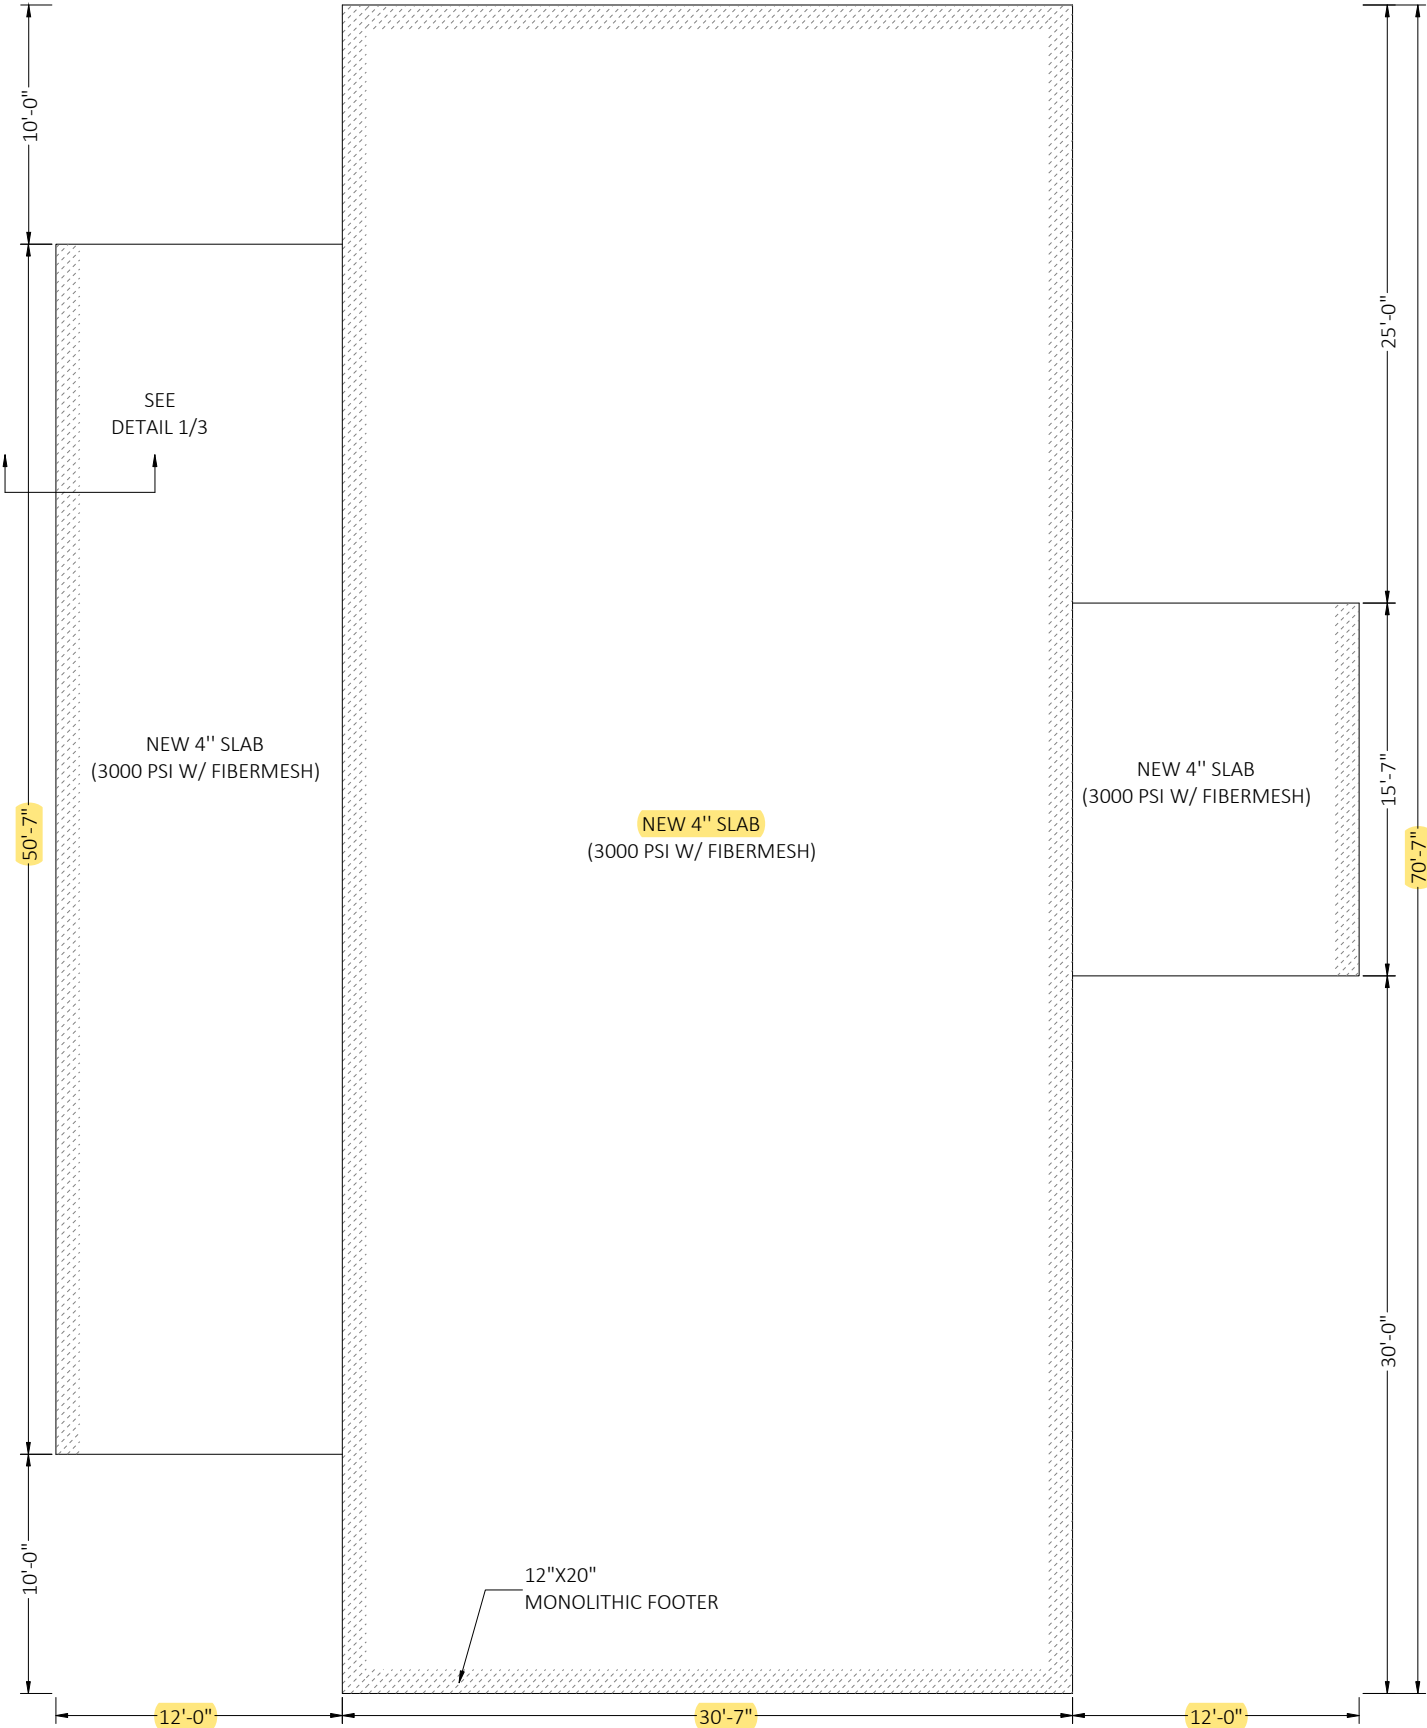


FOUNDATION PLAN SCALE :
NTS

This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by Richard E Walker
Date: 2024.02.28 14:23:42-05'00'

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2403108

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

PROJECT ADDRESS:

SNIDER
403 SE TEVIS AVE
LAKE CITY, FL 32025

DESIGN DATE: 02/23/2024

REVISION 1: DATE

REVISION 2: 02/23/2024


DRAWN BY: TCP

SCALE: NTS


SHEET:

03


This item has been digitally signed and sealed by Richard E. Walker, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.




Digitally signed by Richard E Walker
Date: 2024.02.28 14:23:43-05'00'

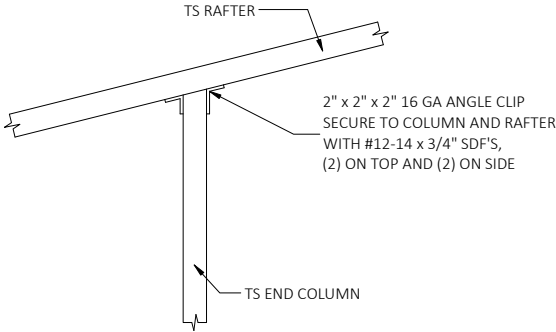


2 END POST/RAFTER CONNECTION DETAIL
SCALE: NTS

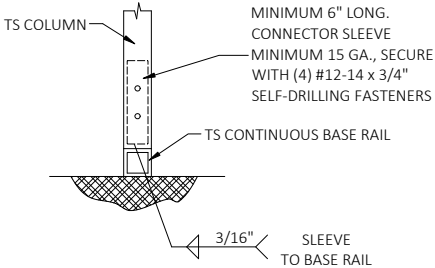


3 RAFTER POST/BASE RAIL CONNECTION DETAIL
SCALE: NTS

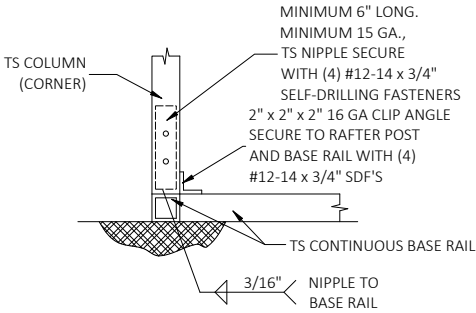


4 END POST/BASE RAIL CONNECTION DETAIL
SCALE: NTS

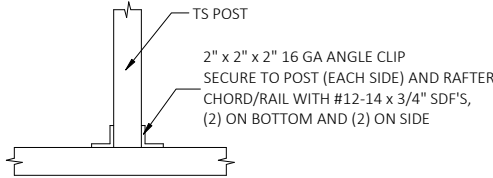


5 POST TO NON-STRUCTURAL HEADER, BASE, RAIL OR WINDOW RAIL CONNECTION DETAIL
SCALE: NTS

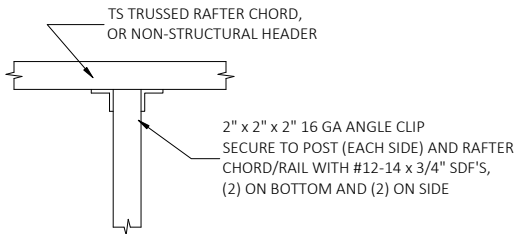


6 POST TO NON-STRUCTURAL HEADER, BASE, RAIL OR WINDOW RAIL CONNECTION DETAIL
SCALE: NTS

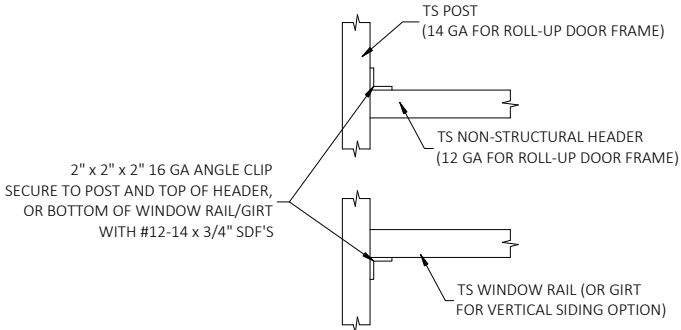


7 NON-STRUCTURAL HEADER OR WINDOW RAIL TO POST CONNECTION DETAIL
SCALE: NTS

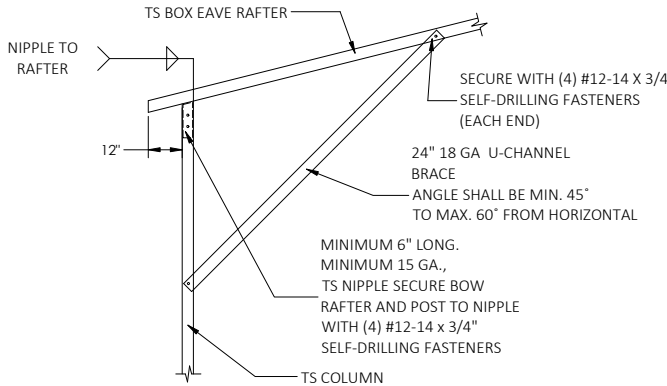


8 BOX EAVE RAFTER/CORNER POST CONNECTION DETAIL
SCALE: NTS




9 COLLAR-TIE CONNECTION
SCALE: NTS

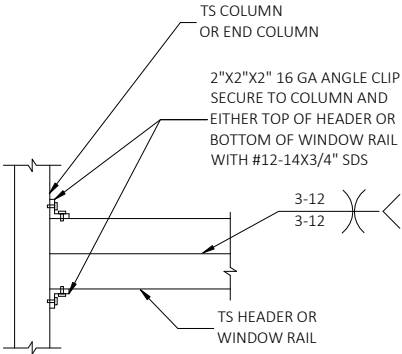


10 DOUBLE HEADER TO COLUMN CONNECTION DETAIL
SCALE: NTS

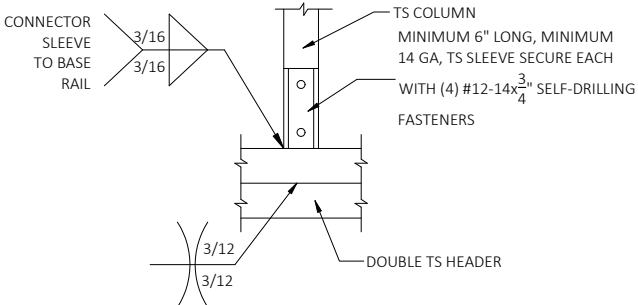

11 COLUMN/DOUBLE HEADER CONNECTION DETAIL
SCALE: NTS

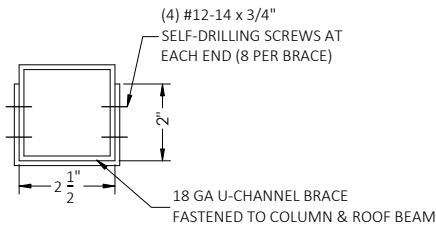


12 BRACE SECTION
SCALE: NTS

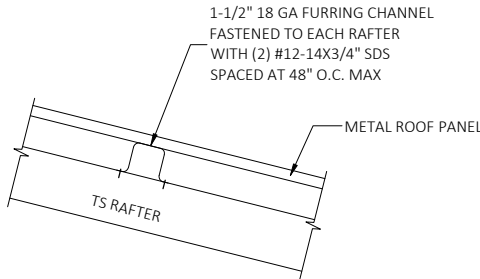

12 PANEL ATTACHMENT (ALTERNATE FOR VERTICAL ROOF PANELS)
SCALE: NTS

FLORIDA ENGINEERING LLC
4161 TAMiami TRAIL, UNIT 101
PORT CHARLOTTE, FLORIDA 33952
(941) 391-5980
FLEng.com
Orders@FLEng.com



CA CERT. #30782

PROJECT NO. 2403108

CONTRACTOR:
TUBULAR BUILDING SYSTEMS
P.O. BOX. 2254
LAKE CITY, FL 32056

PROJECT ADDRESS:

SNIDER
403 SE TEVIS AVE
LAKE CITY, FL 32025

DESIGN DATE: 02/23/2024

REVISION 1: 02/23/2024

REVISION 2: 02/23/2024

DRAWN BY: TCP

SCALE: NTS

SHEET:

04