




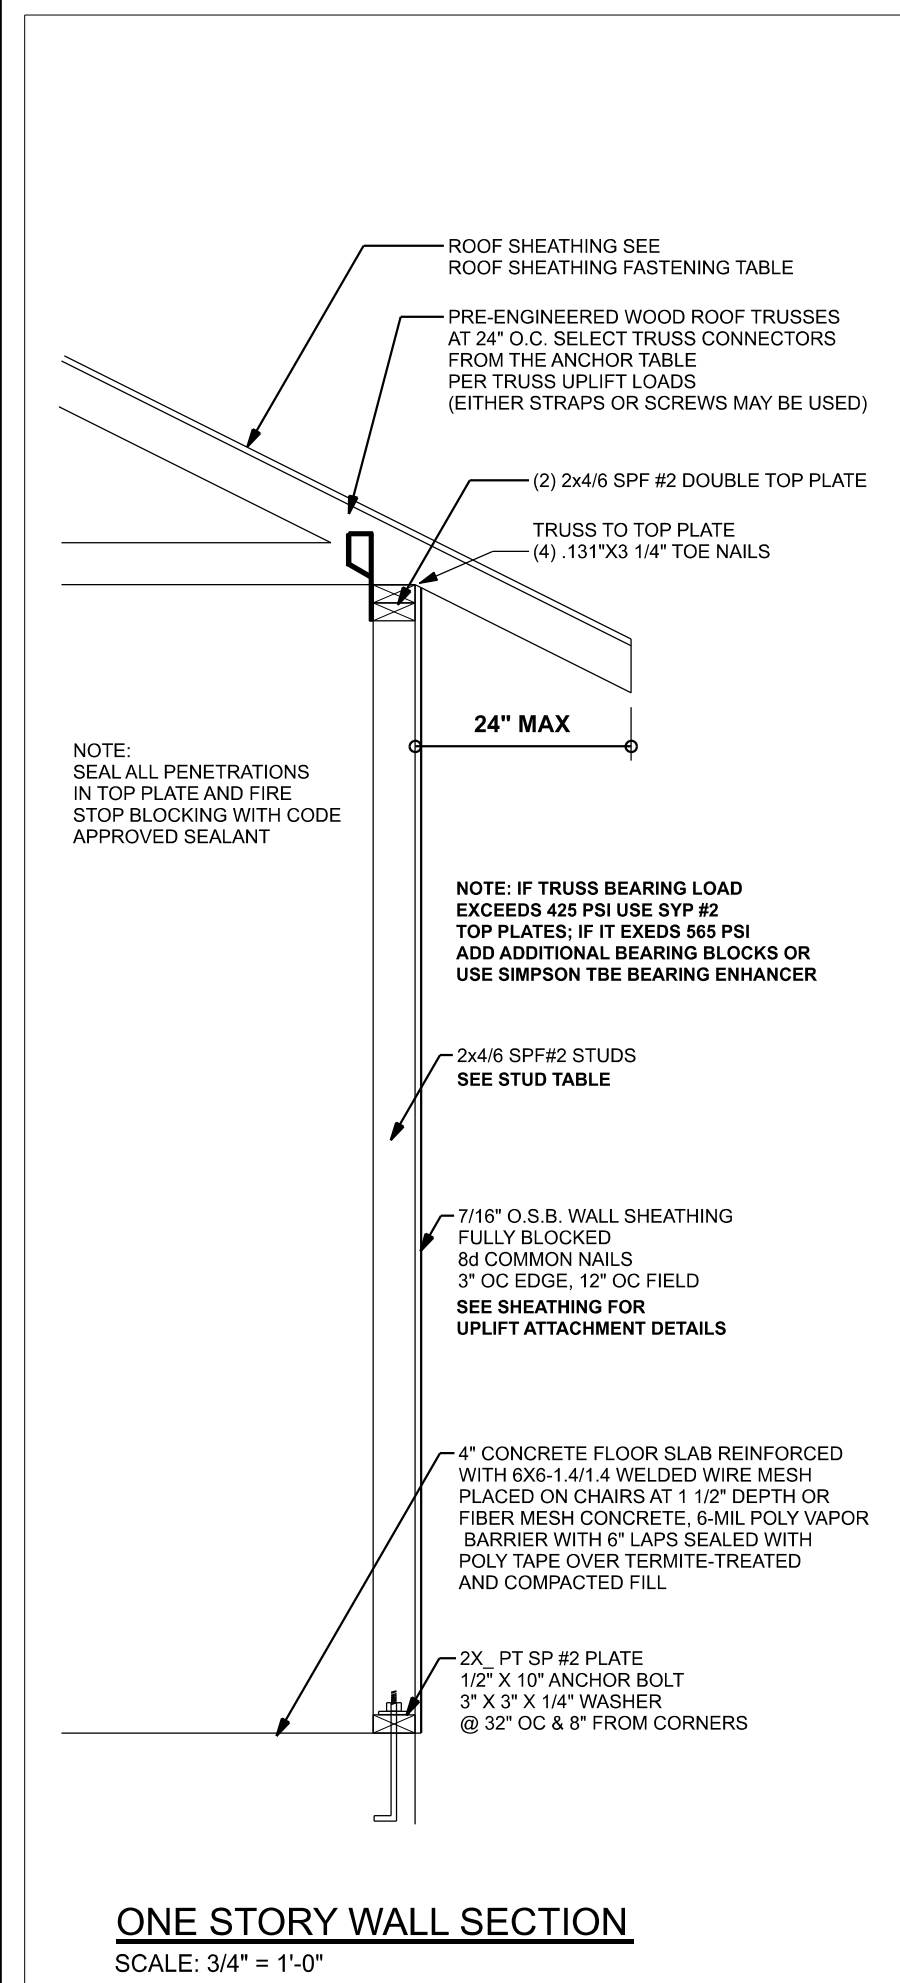


ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

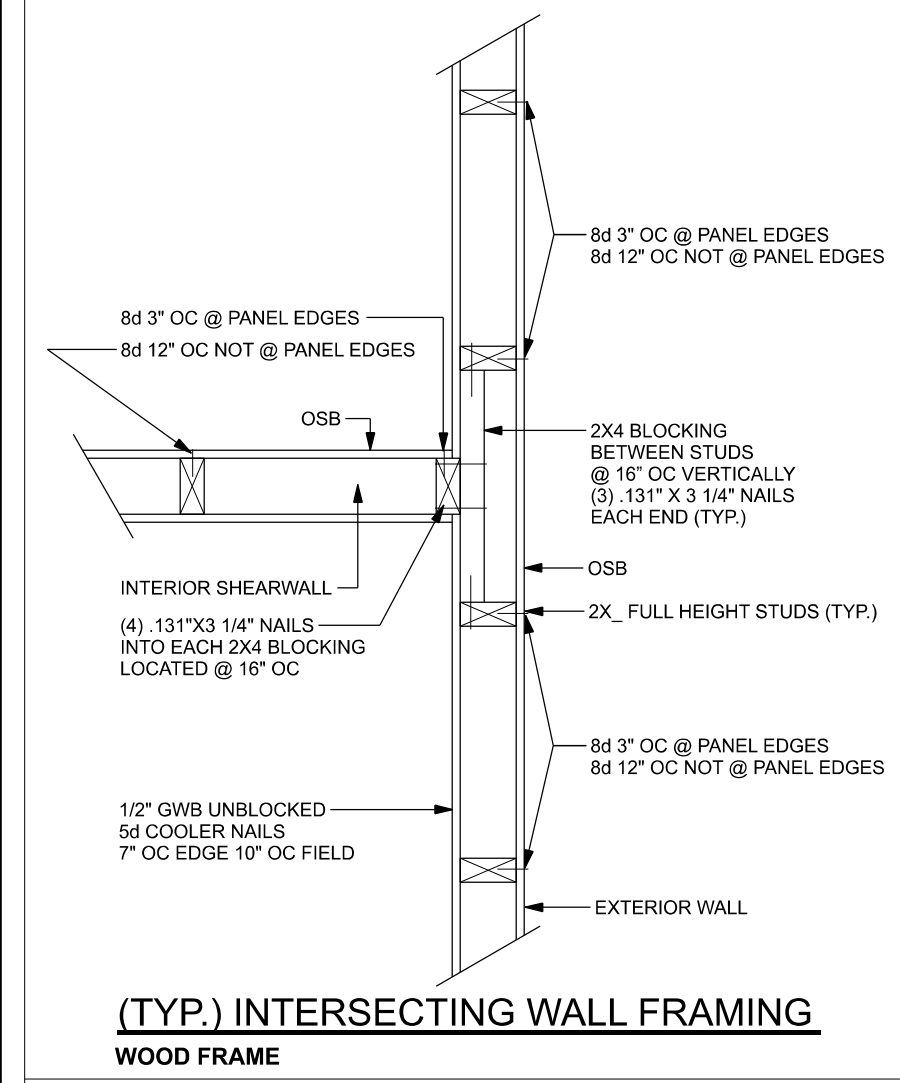


(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

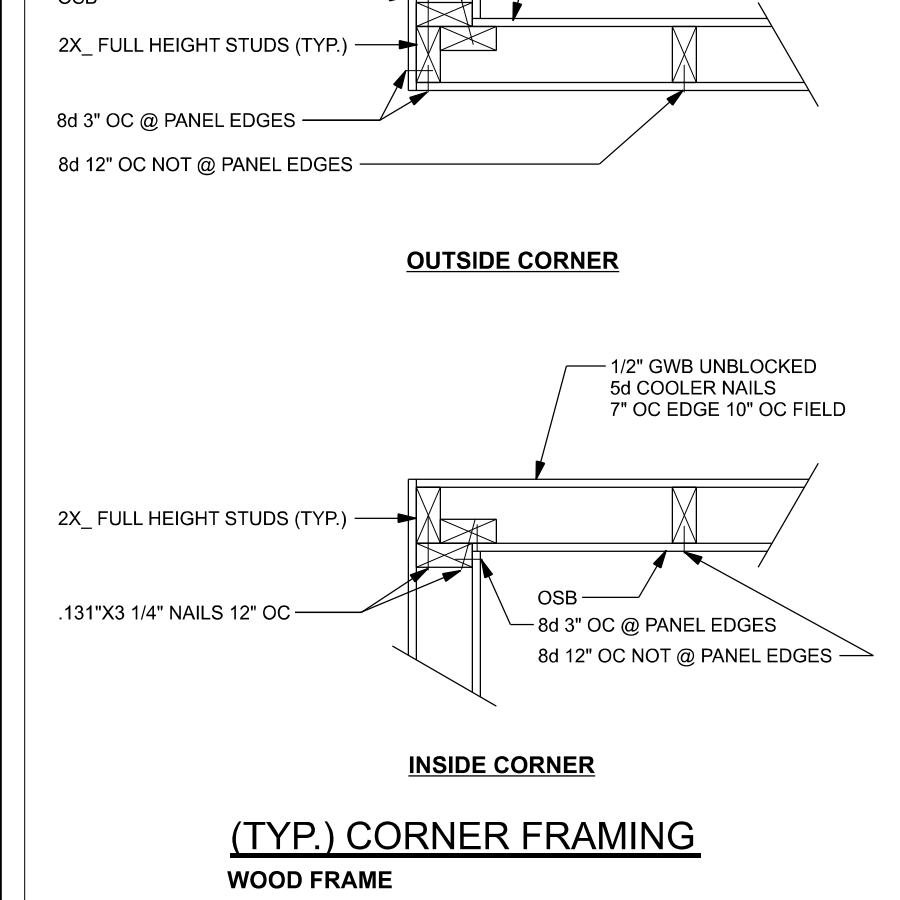


(TYP.) CORNER FRAMING
WOOD FRAME

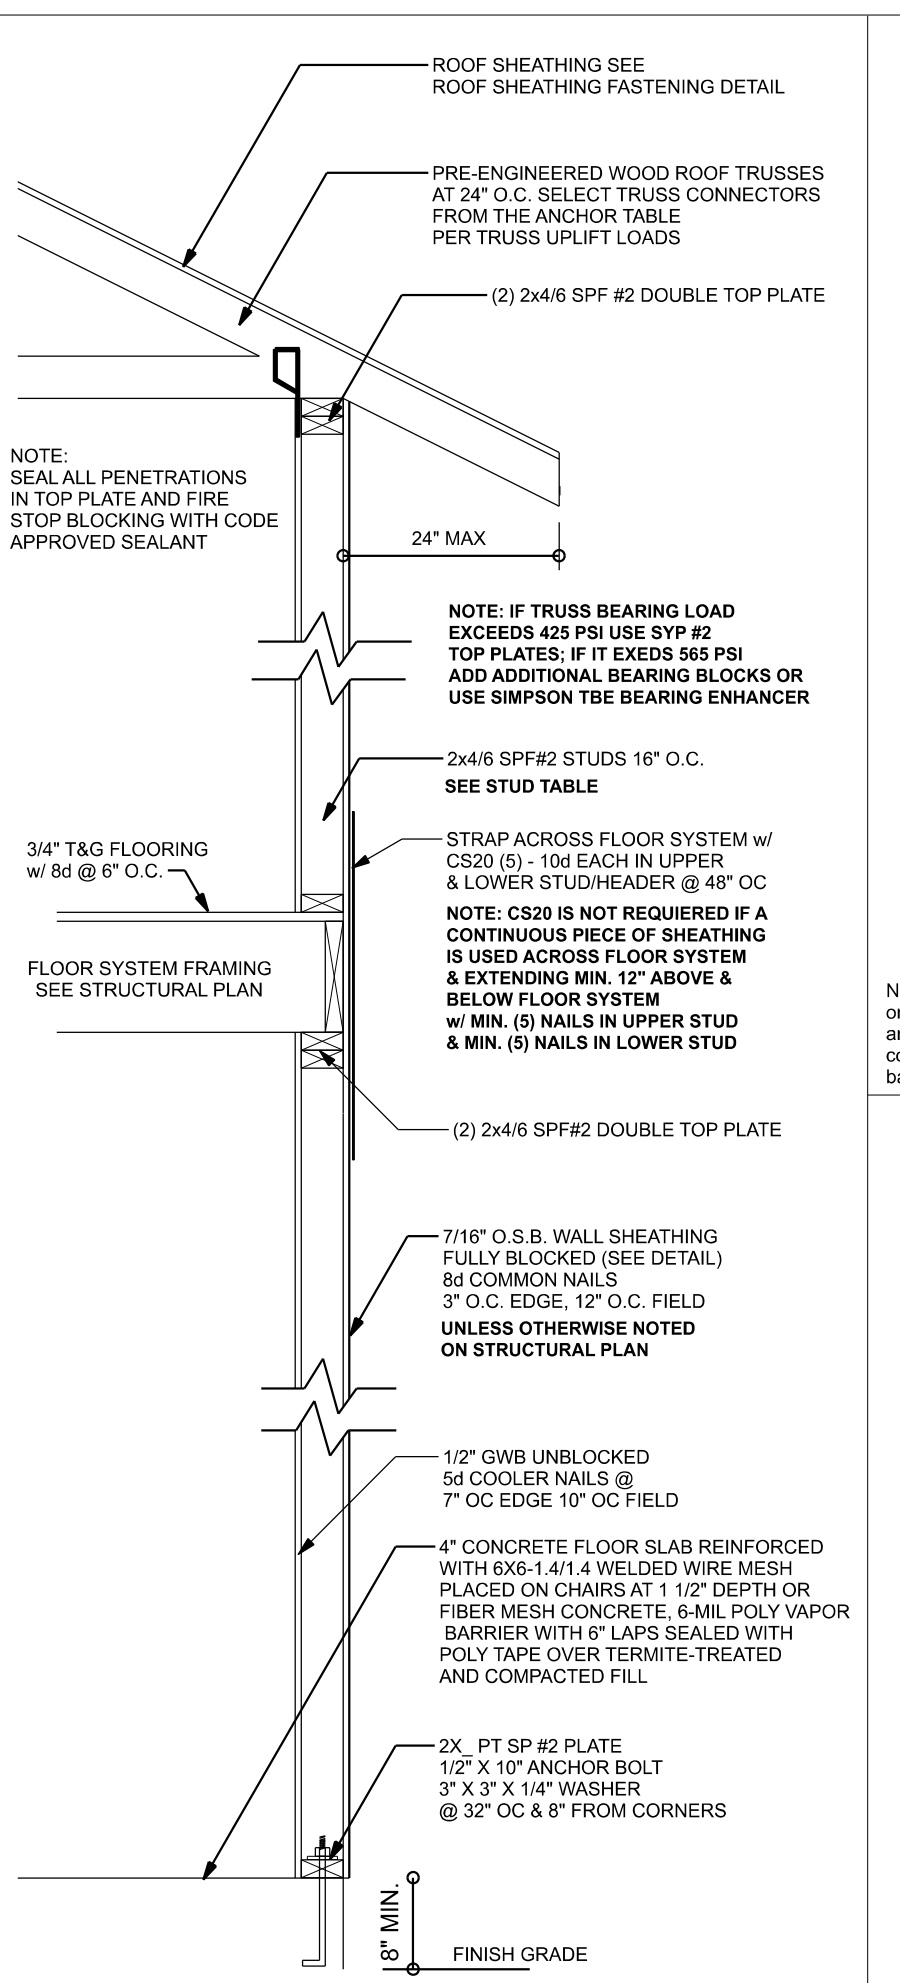

TWO STORY WALL SECTION
SCALE: 3/4" = 1'-0"

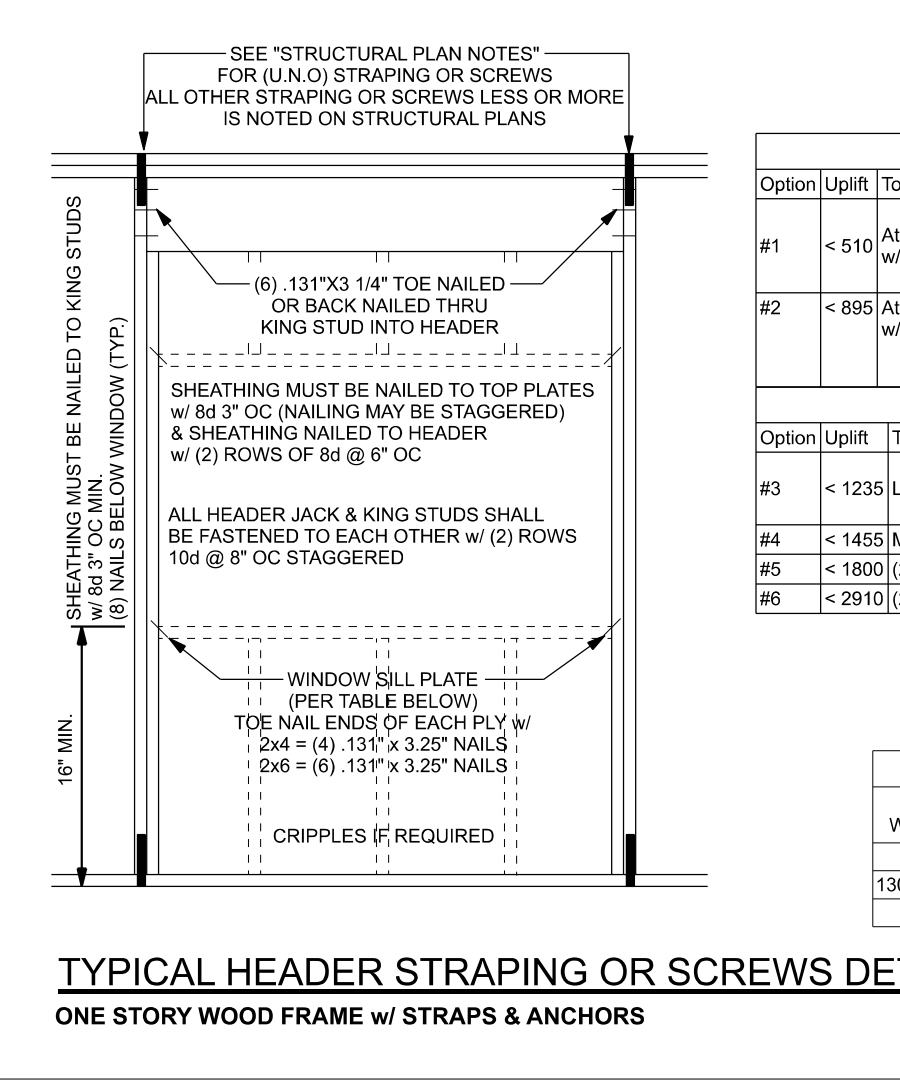


TYPICAL HEADER STRAPING OR SCREWS DETAIL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

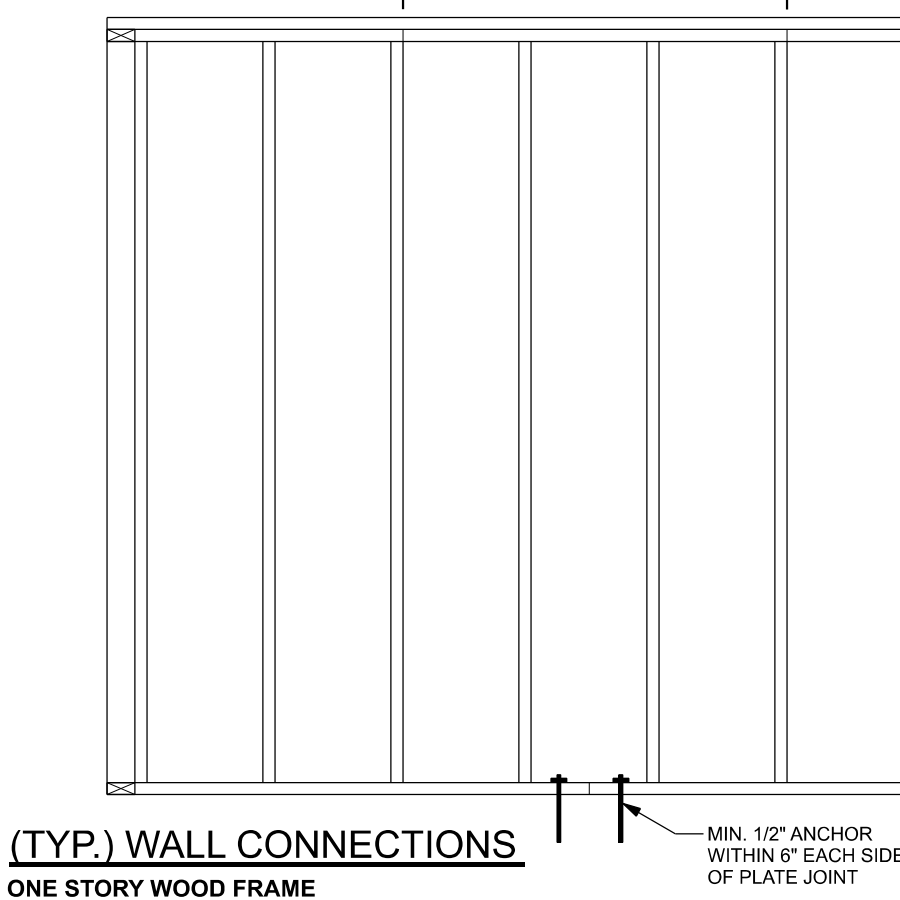

(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

Wind Speed	Sheathing Thickness Plywood OR OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. C	15/32"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	4" oc	4" oc


Note: For sheathing located a minimum of 1 foot from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

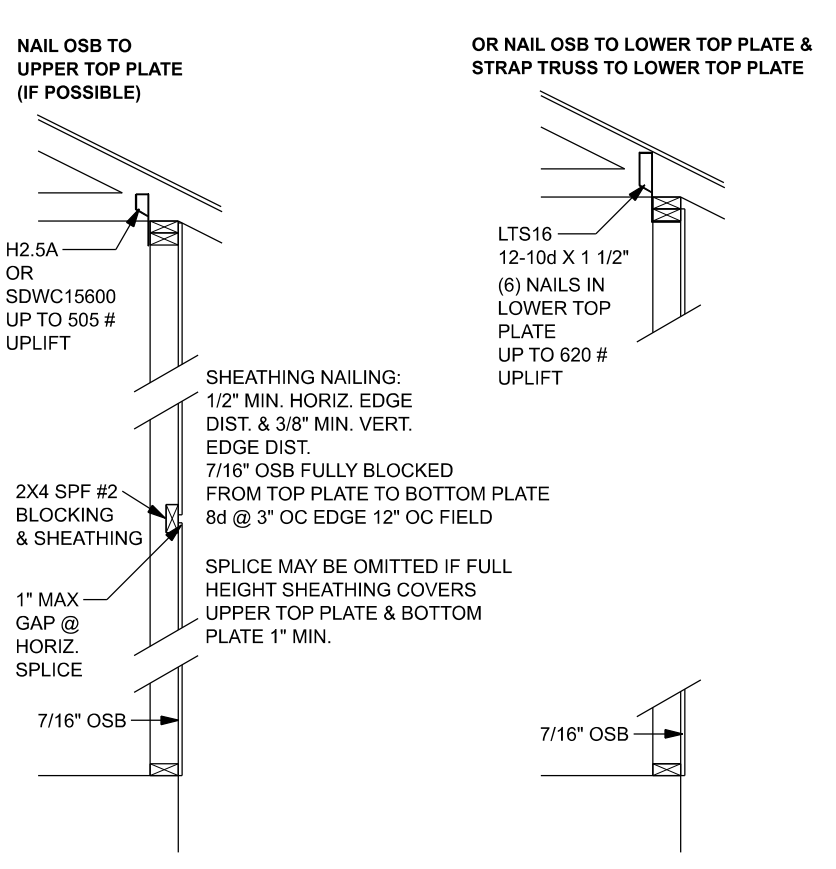

SHEATHING FOR UPLIFT ATTACHMENT DETAILS
ONE STORY WOOD FRAME

Option	Uplift	Top Connection	Bottom Connection
#1	< 510	Attach king stud to top plate w/ (1) Simpson SDWC15600	Attach king stud to bottom plate w/ (2) Simpson SDWC15450 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer must be located within 6" of king stud @ all door locations
#2	< 895	Attach king stud to top plate w/ (2) Simpson SDWC15600	Attach king stud to bottom plate w/ (3) Simpson SDWC15450 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer must be located within 6" of king stud @ all door locations
Option	Uplift	Top Connection	Bottom Connection
#3	< 1235	LSTA24, 14-10d wrap over plate	LSTA24, 14-10d wrap over plate
#4	< 1455	MSTA24, 18-10d header to jacks	DTT22
#5	< 1800	(2) MST24, 18-10d header to jacks	DTT22
#6	< 2910	(2) MST24, 18-10d header to jacks	HTT4


SILL PLATE SPANS FOR 10'-0" WALL HEIGHT

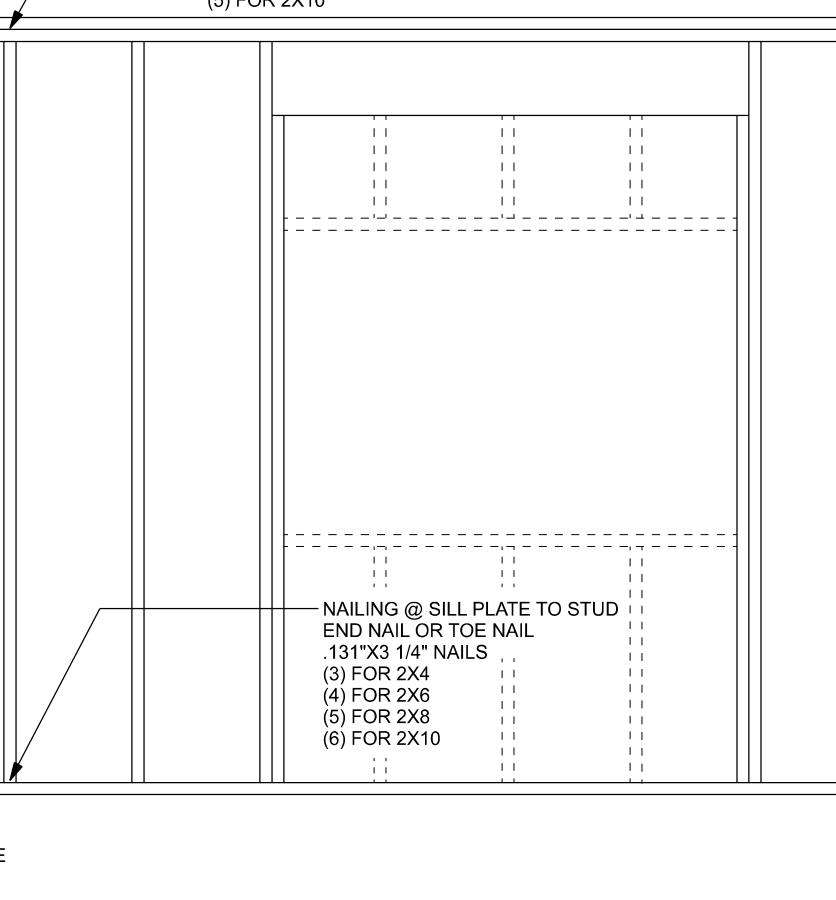

(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

Wind Speed	Sheathing Thickness Plywood OR OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. C	15/32"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	4" oc	4" oc


Note: For sheathing located a minimum of 1 foot from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

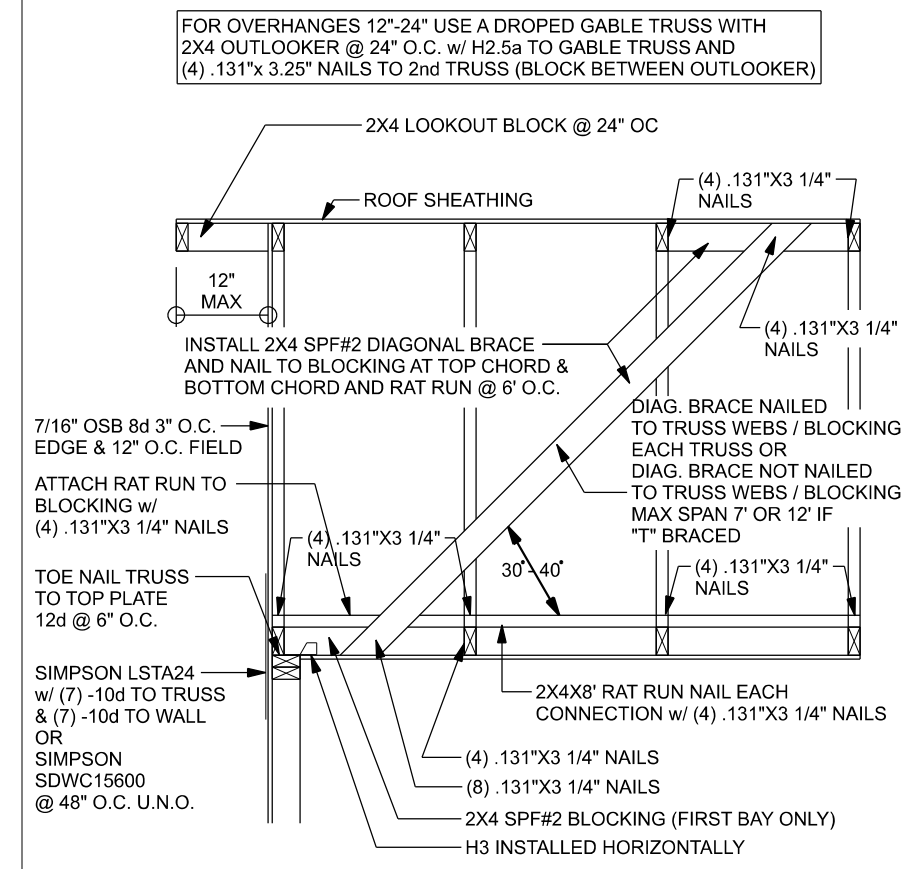

(TYP.) GABLE BRACING DETAIL
WOOD FRAME

Option	Uplift	Top Connection	Bottom Connection
#1	< 510	Attach king stud to top plate w/ (1) Simpson SDWC15600	Attach king stud to bottom plate w/ (2) Simpson SDWC15450 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer must be located within 6" of king stud @ all door locations
#2	< 895	Attach king stud to top plate w/ (2) Simpson SDWC15600	Attach king stud to bottom plate w/ (3) Simpson SDWC15450 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer must be located within 6" of king stud @ all door locations
Option	Uplift	Top Connection	Bottom Connection
#3	< 1235	LSTA24, 14-10d wrap over plate	LSTA24, 14-10d wrap over plate
#4	< 1455	MSTA24, 18-10d header to jacks	DTT22
#5	< 1800	(2) MST24, 18-10d header to jacks	DTT22
#6	< 2910	(2) MST24, 18-10d header to jacks	HTT4


SILL PLATE SPANS FOR 10'-0" WALL HEIGHT

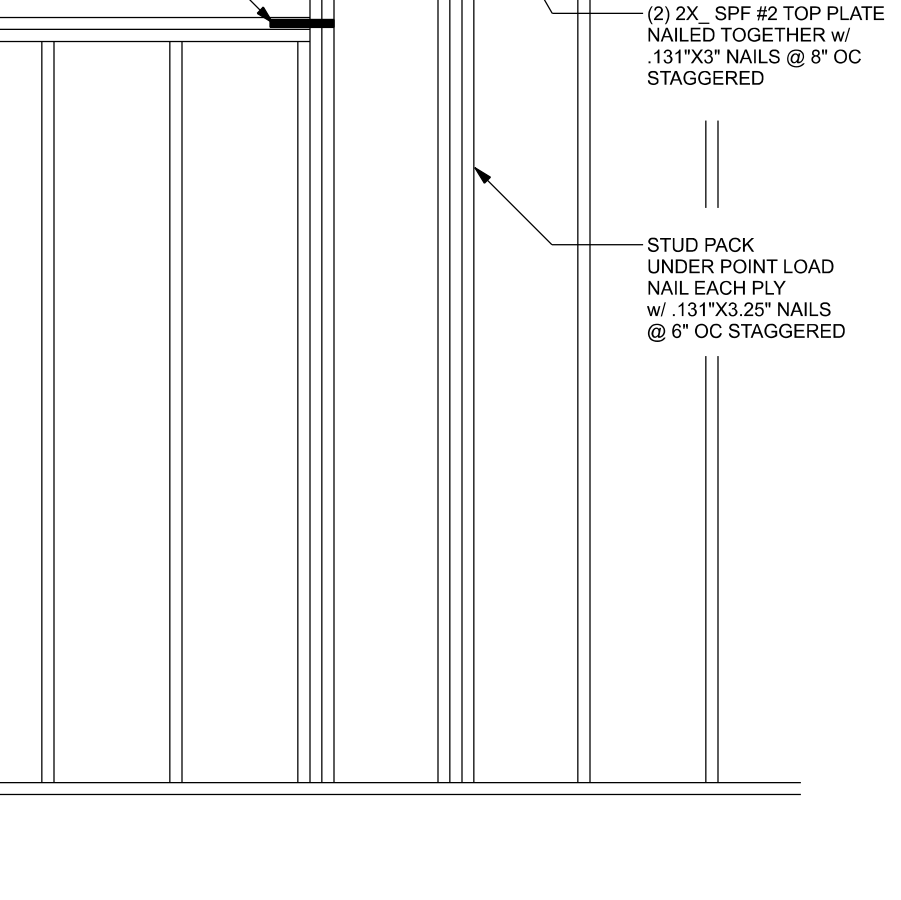

(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

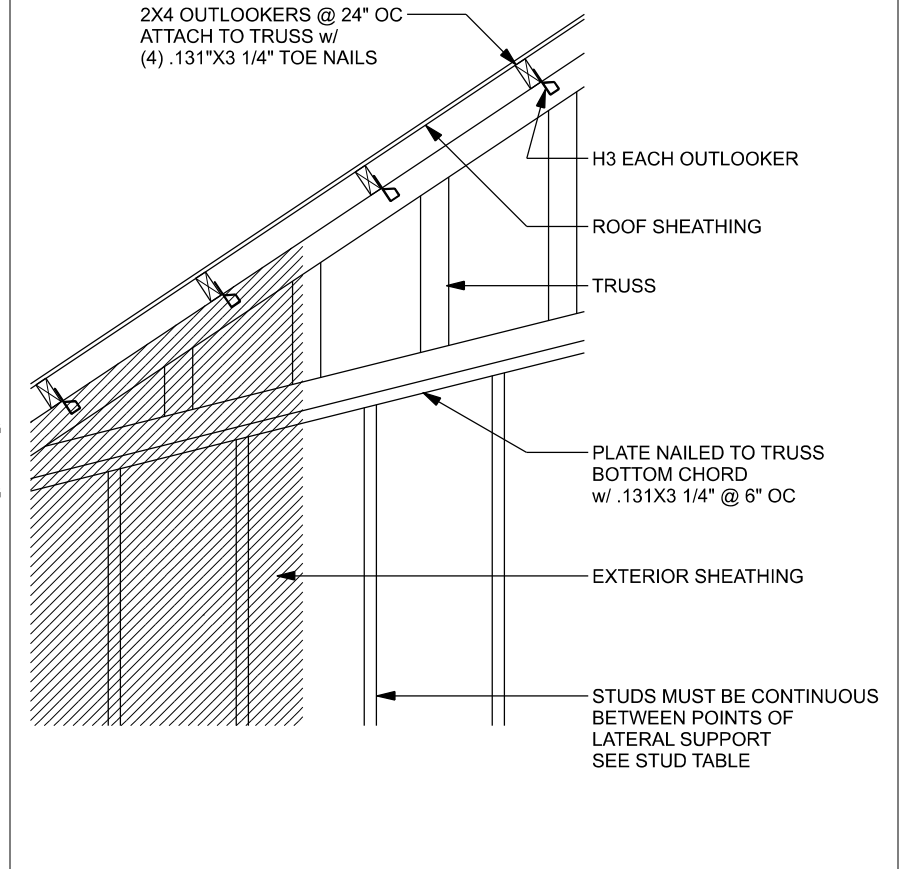

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

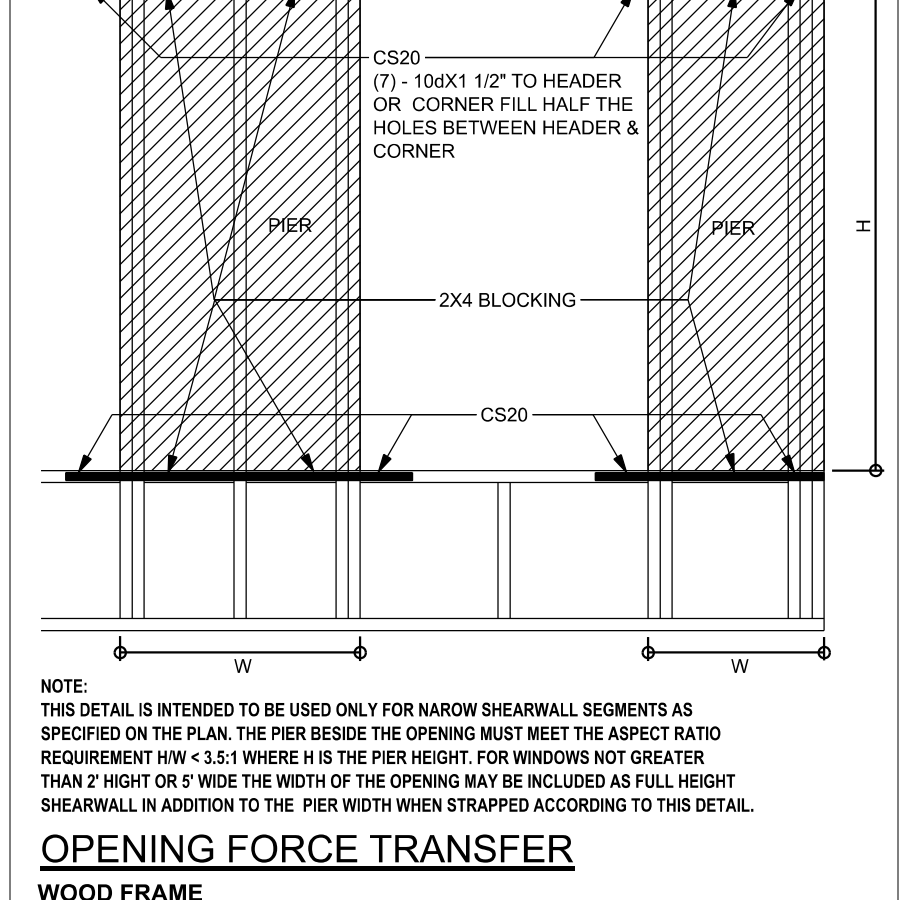

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

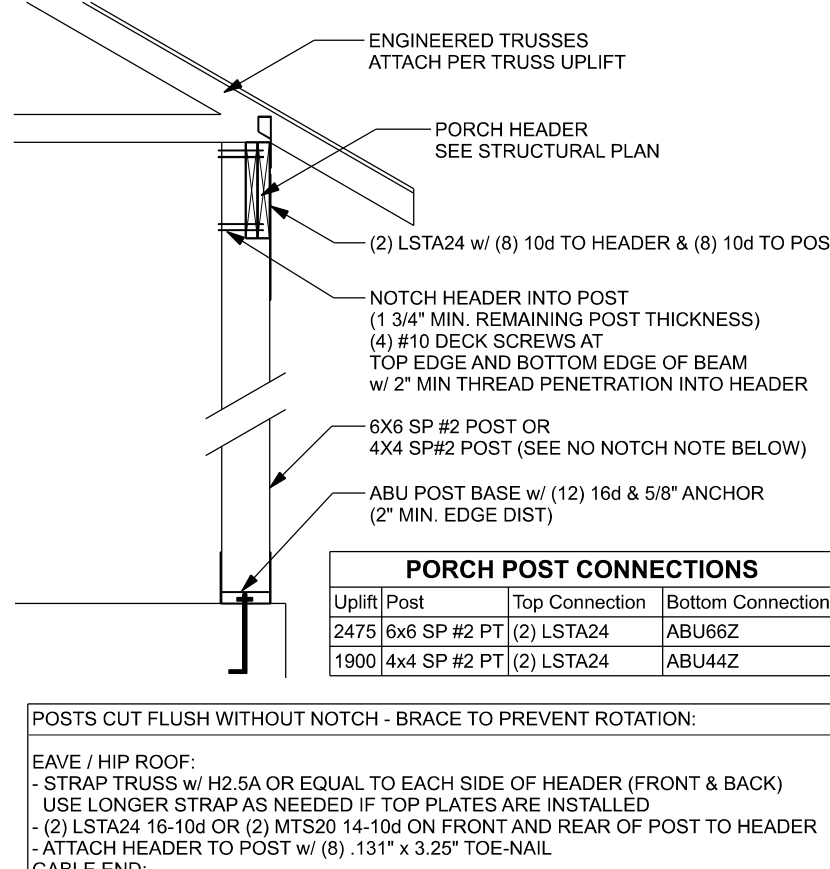

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

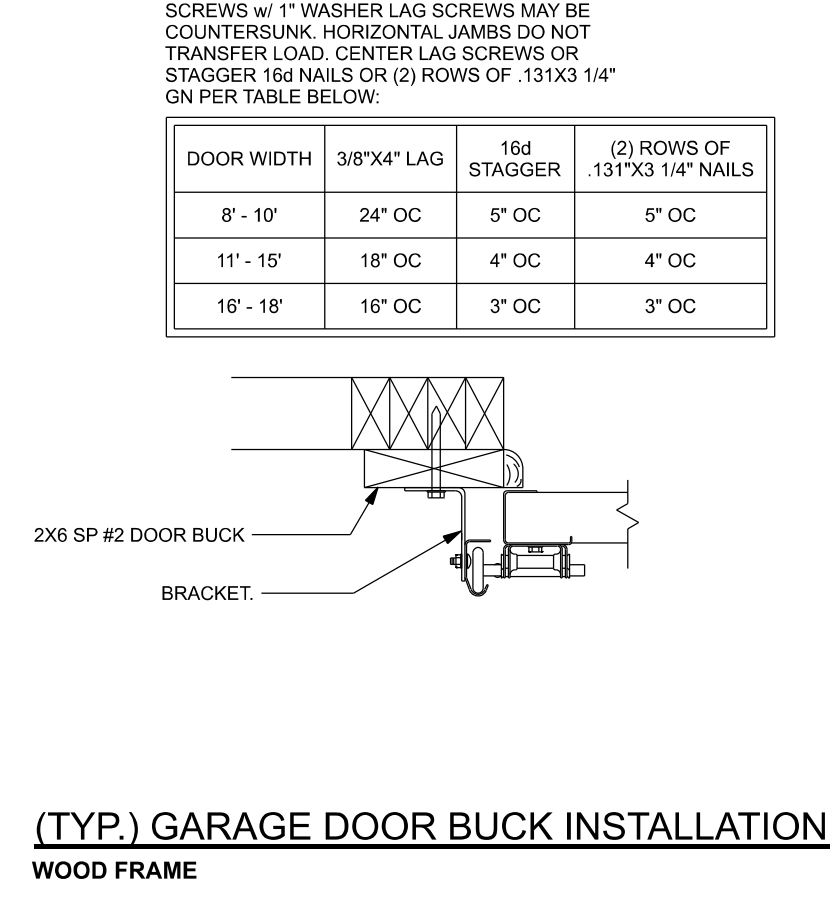

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

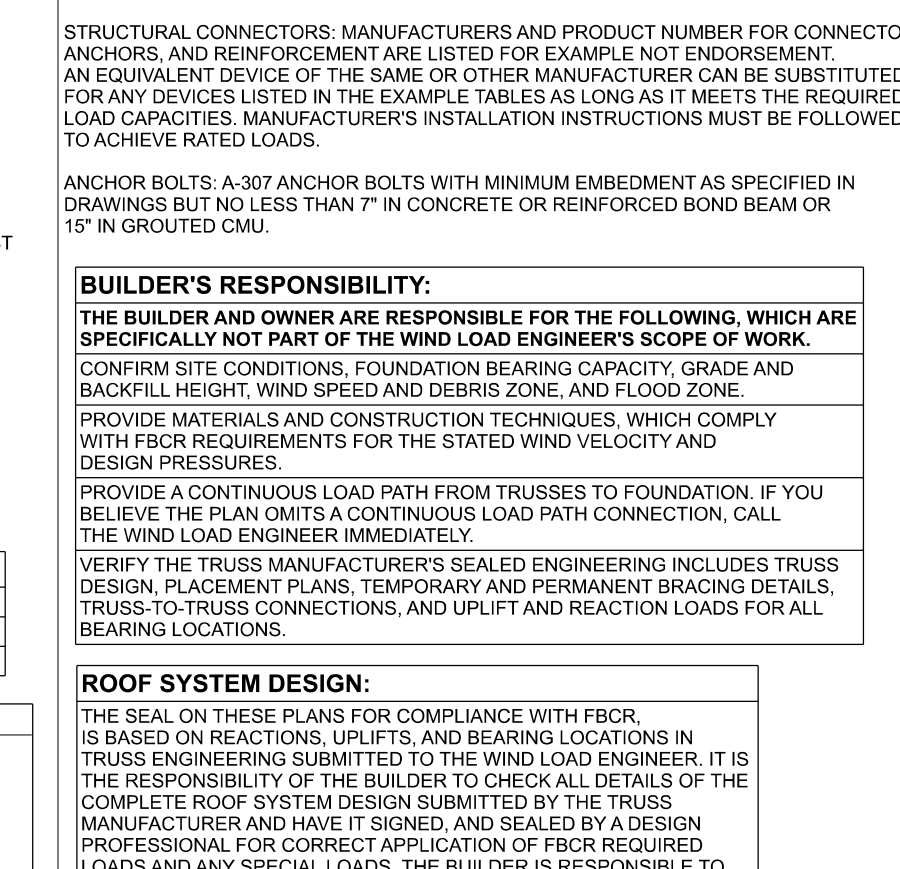

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

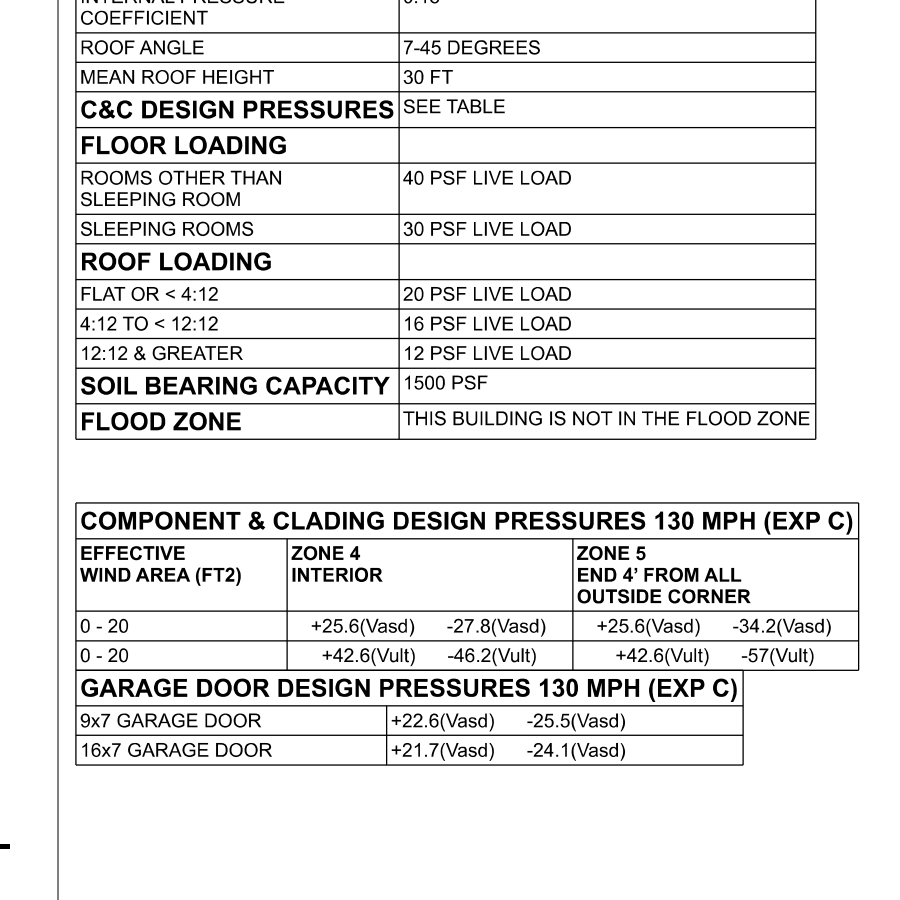

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

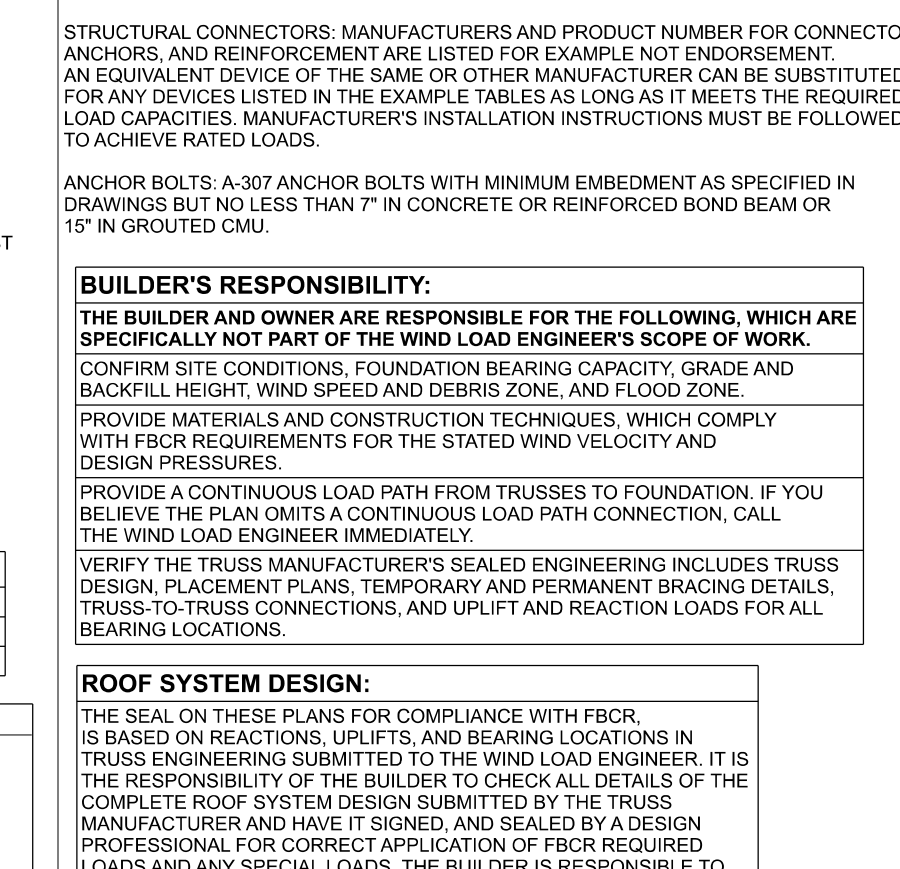

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

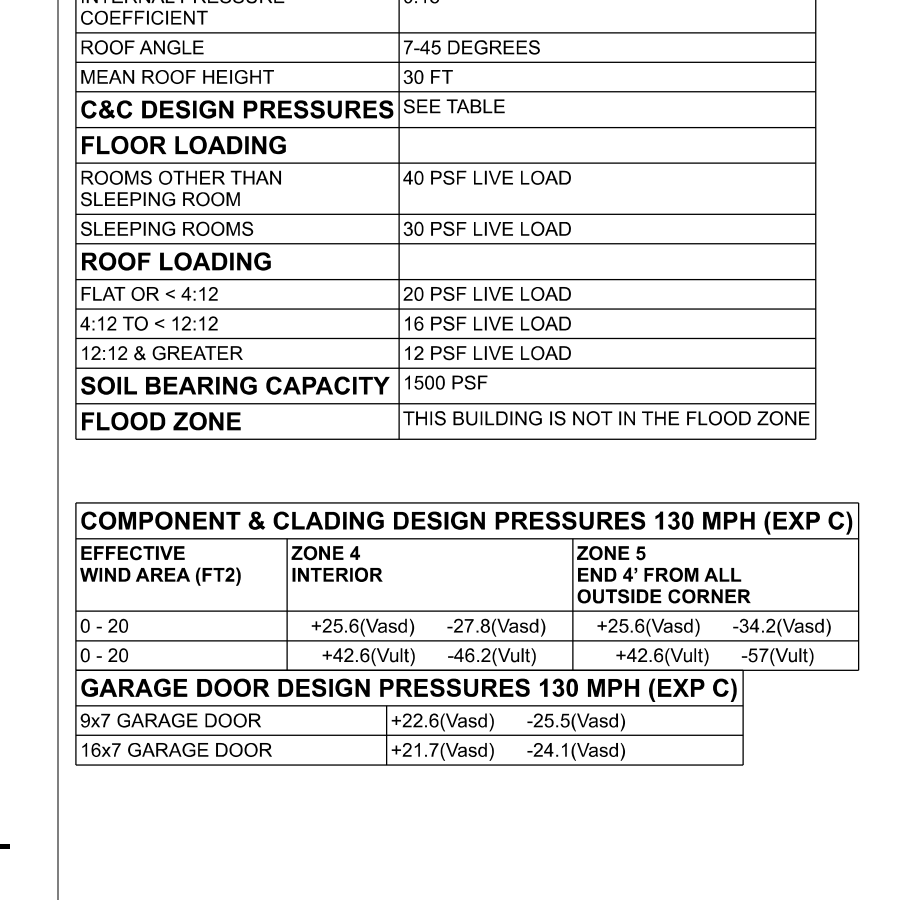

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

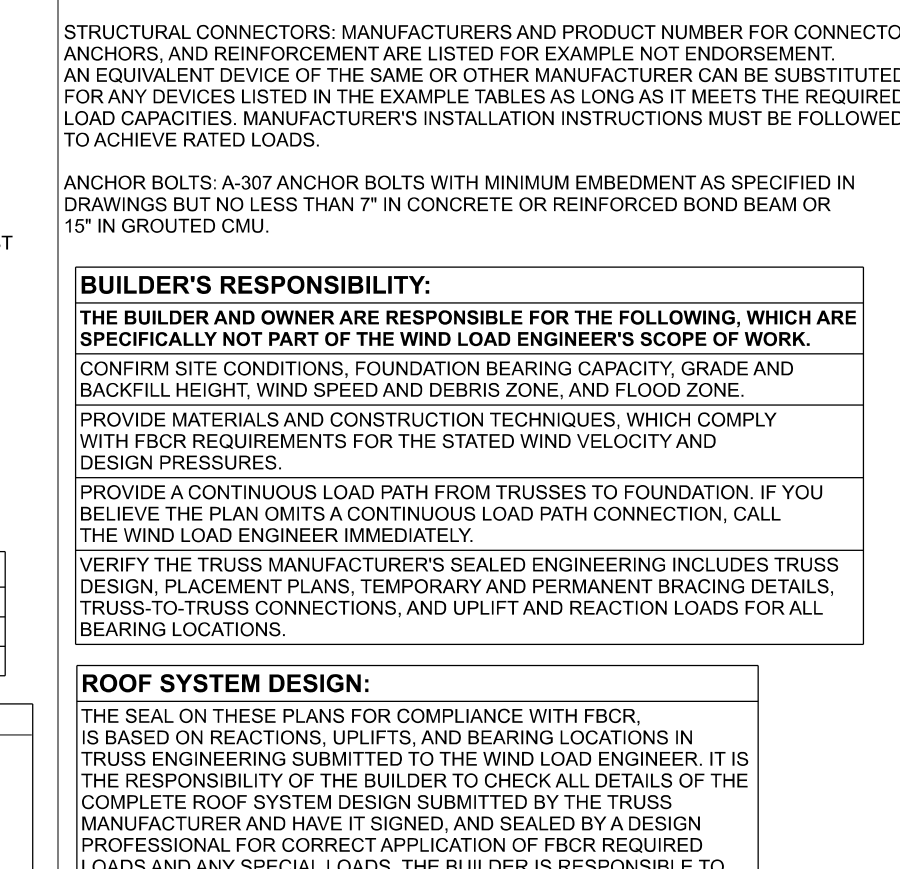

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

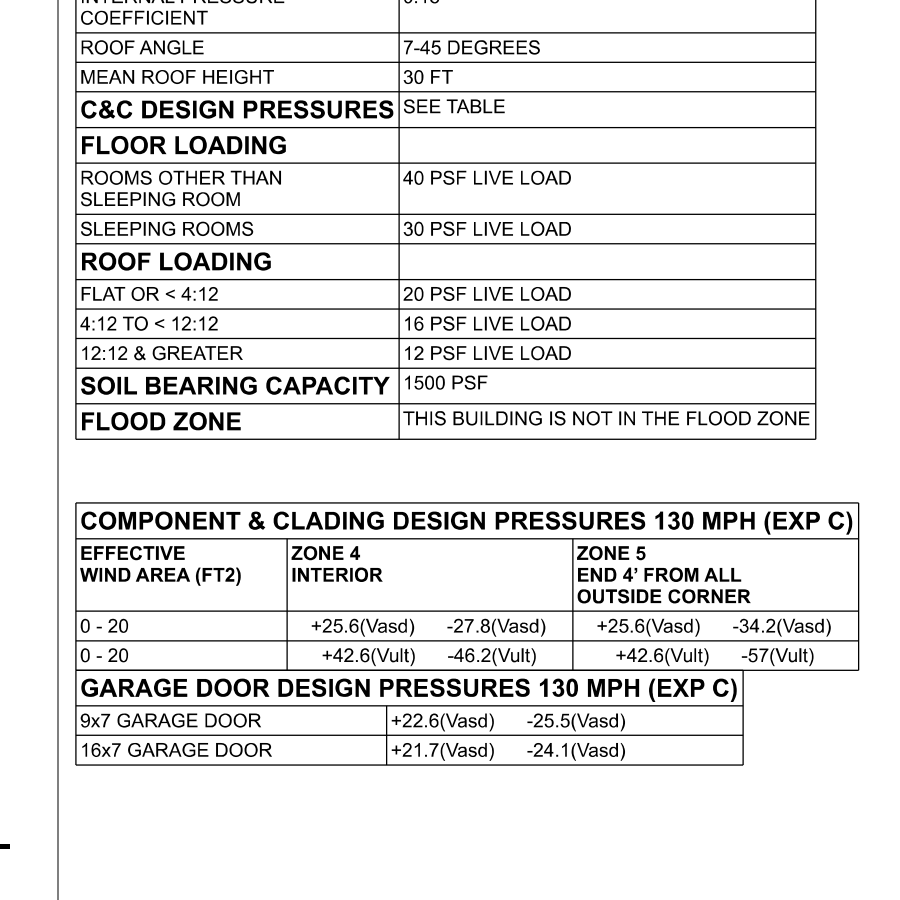

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

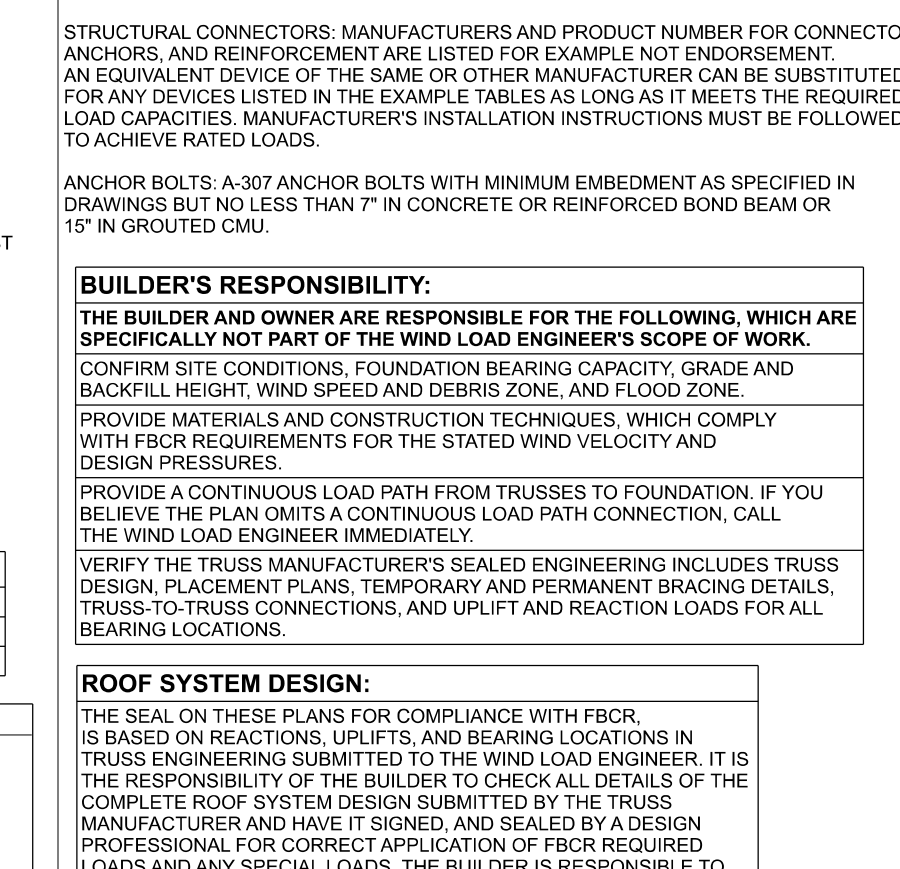

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

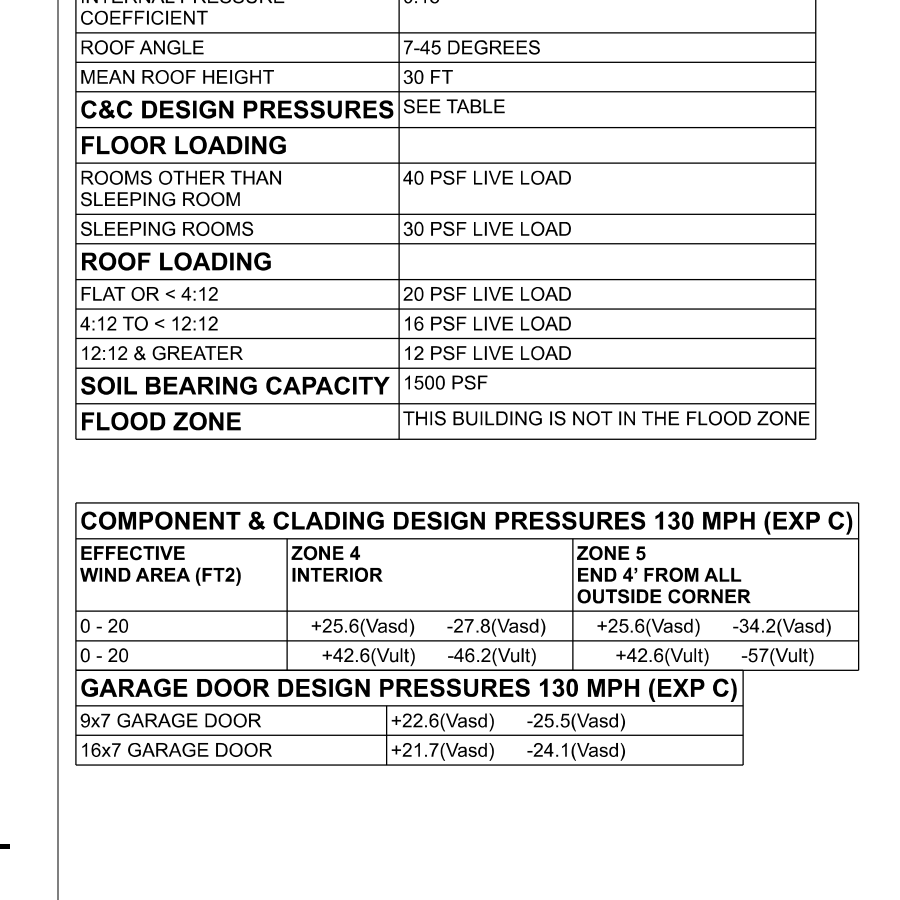

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

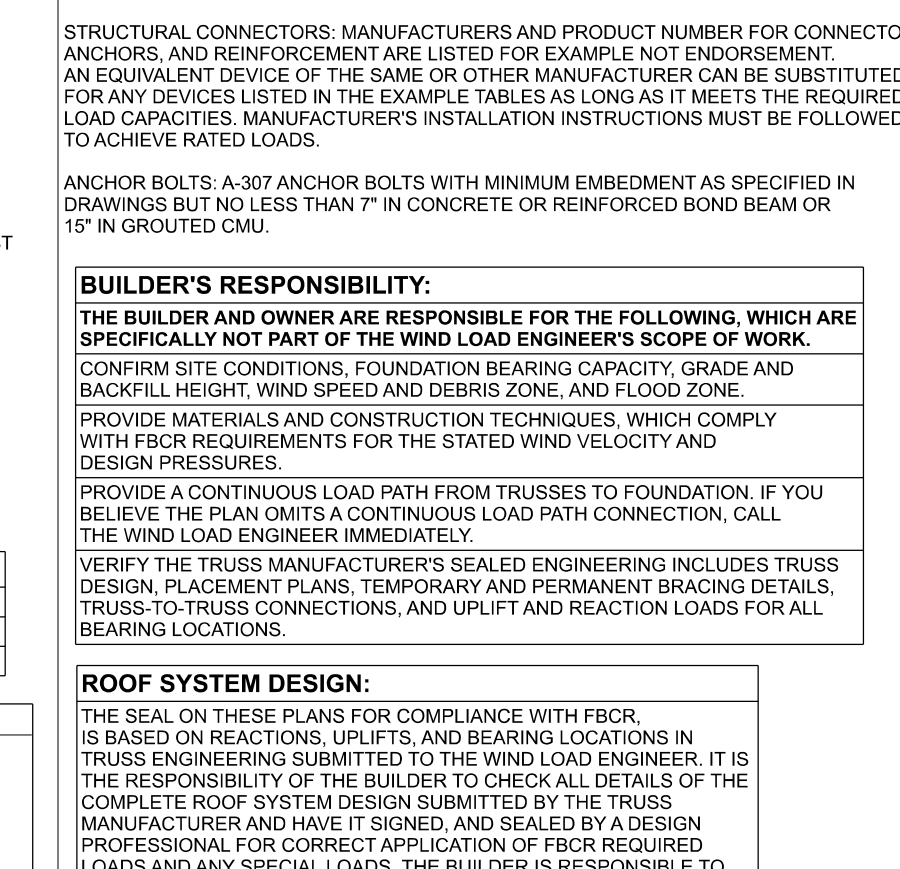

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

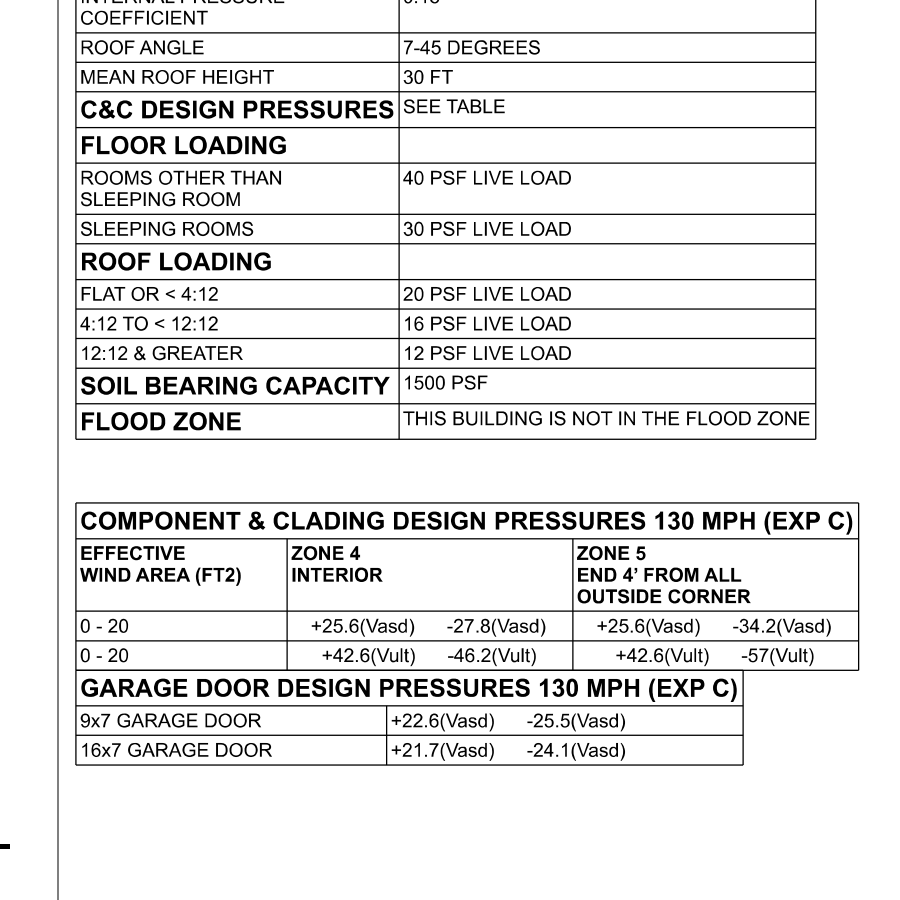

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

Uplift	Top Connection	Bottom Connection
up to 850 lb	(2) SDWC15600	(3) SDWC15450 w/ anchor bolt within 6"
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4


1 PLY GIRDER TRUSS HOLD DOWN TABLE

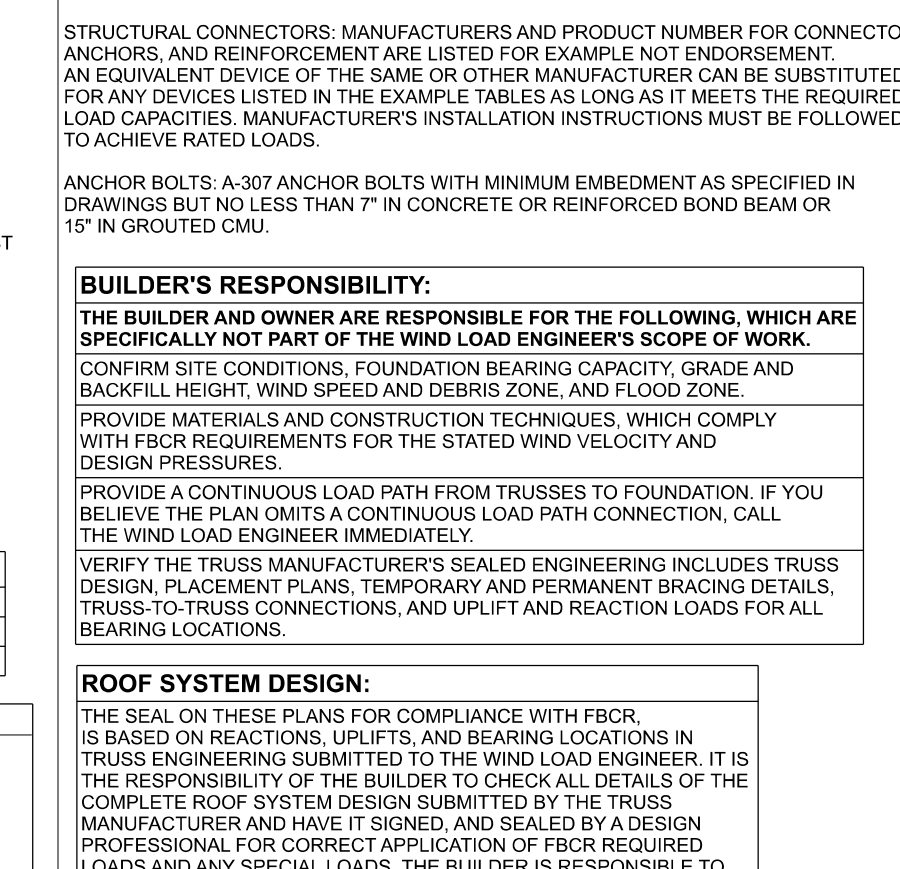

MULTI PLY GIRDER TRUSS HOLD DOWN TABLE

Uplift	Top Connection	Bottom Connection
up to 1125 lb	HTS16	LSTA24, 14-10d Wrap under plate w/ anchor bolt within 6"
up to 1700 lb	(4) SDWC15600 (2) Each Ply	HTT4
up to 2250 lb	(2) HTS16	HTT4
up to 3375 lb	(3) HTS16	HTT4

(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

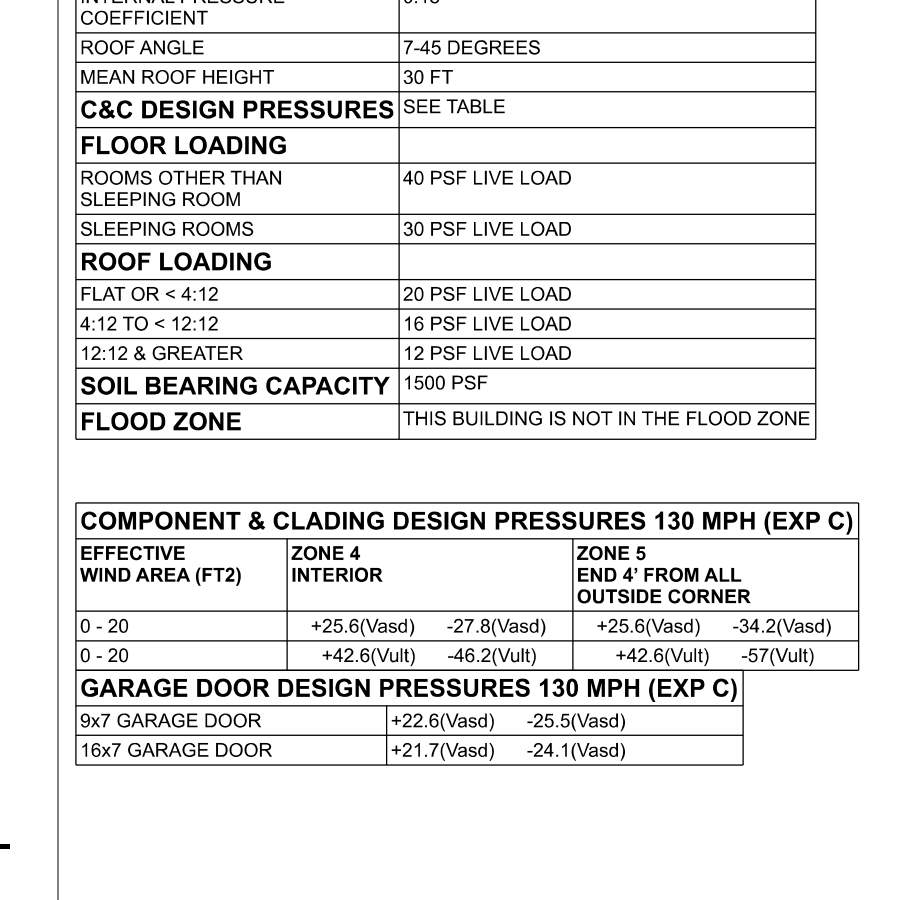


(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME


MASONRY NOTE:
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 8/ITMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

	ACI 530.1-02 Section	Specific Requirements
1.4A	Compressive strength	8" block bearing walls F'm = 1500 psi
2.1	Mortar	ASTM C 270, Type N, UNO
2.2	Grout	ASTM C 476; admixtures require approval
2.3	CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3	Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, S, S&2, 75/111.5"
2.4	Reinforcing bars, #3 - #11	ASTM A615, Grade 40, Fy = 40 ksi, Lap splices min 40 bar dia. (25" for #5)
2.4F	Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class G60, 0.60 oz/lb or 304SS
2.4F	Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/lb or 304SS
3.3.E.2	Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7	Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.


BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

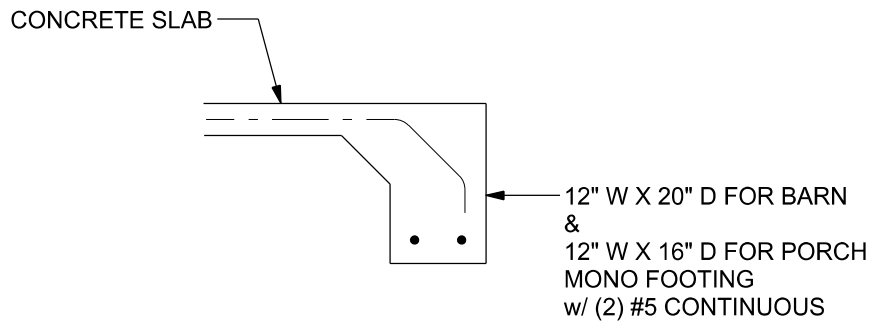

F1
S-2
MONOLITHIC FOOTING
SCALE: 1/2" = 1'-0"

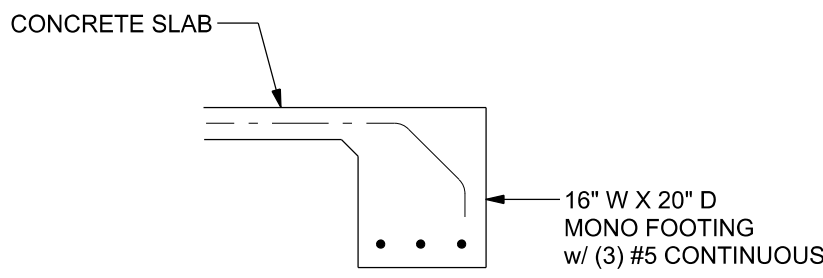

F2
S-2
MONOLITHIC FOOTING
SCALE: 1/2" = 1'-0"

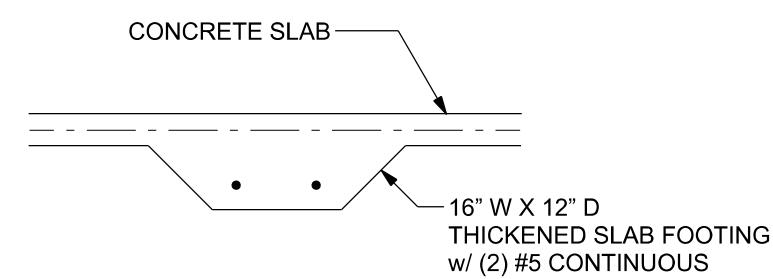


F3
S-2
INTERIOR BEARING FOOTING
SCALE: 1/2" = 1'-0"

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES

- FN - 1 DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
- CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING
- FN - 2 IN ALL AREAS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN
- FN - 3 THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ 6X8-1 AT 14" WELDED WIRE MESH PLACED ON CHAIRS @ 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL. POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITES TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED TERMITES TREATMENT METHOD CAN BE USED INSTAD)

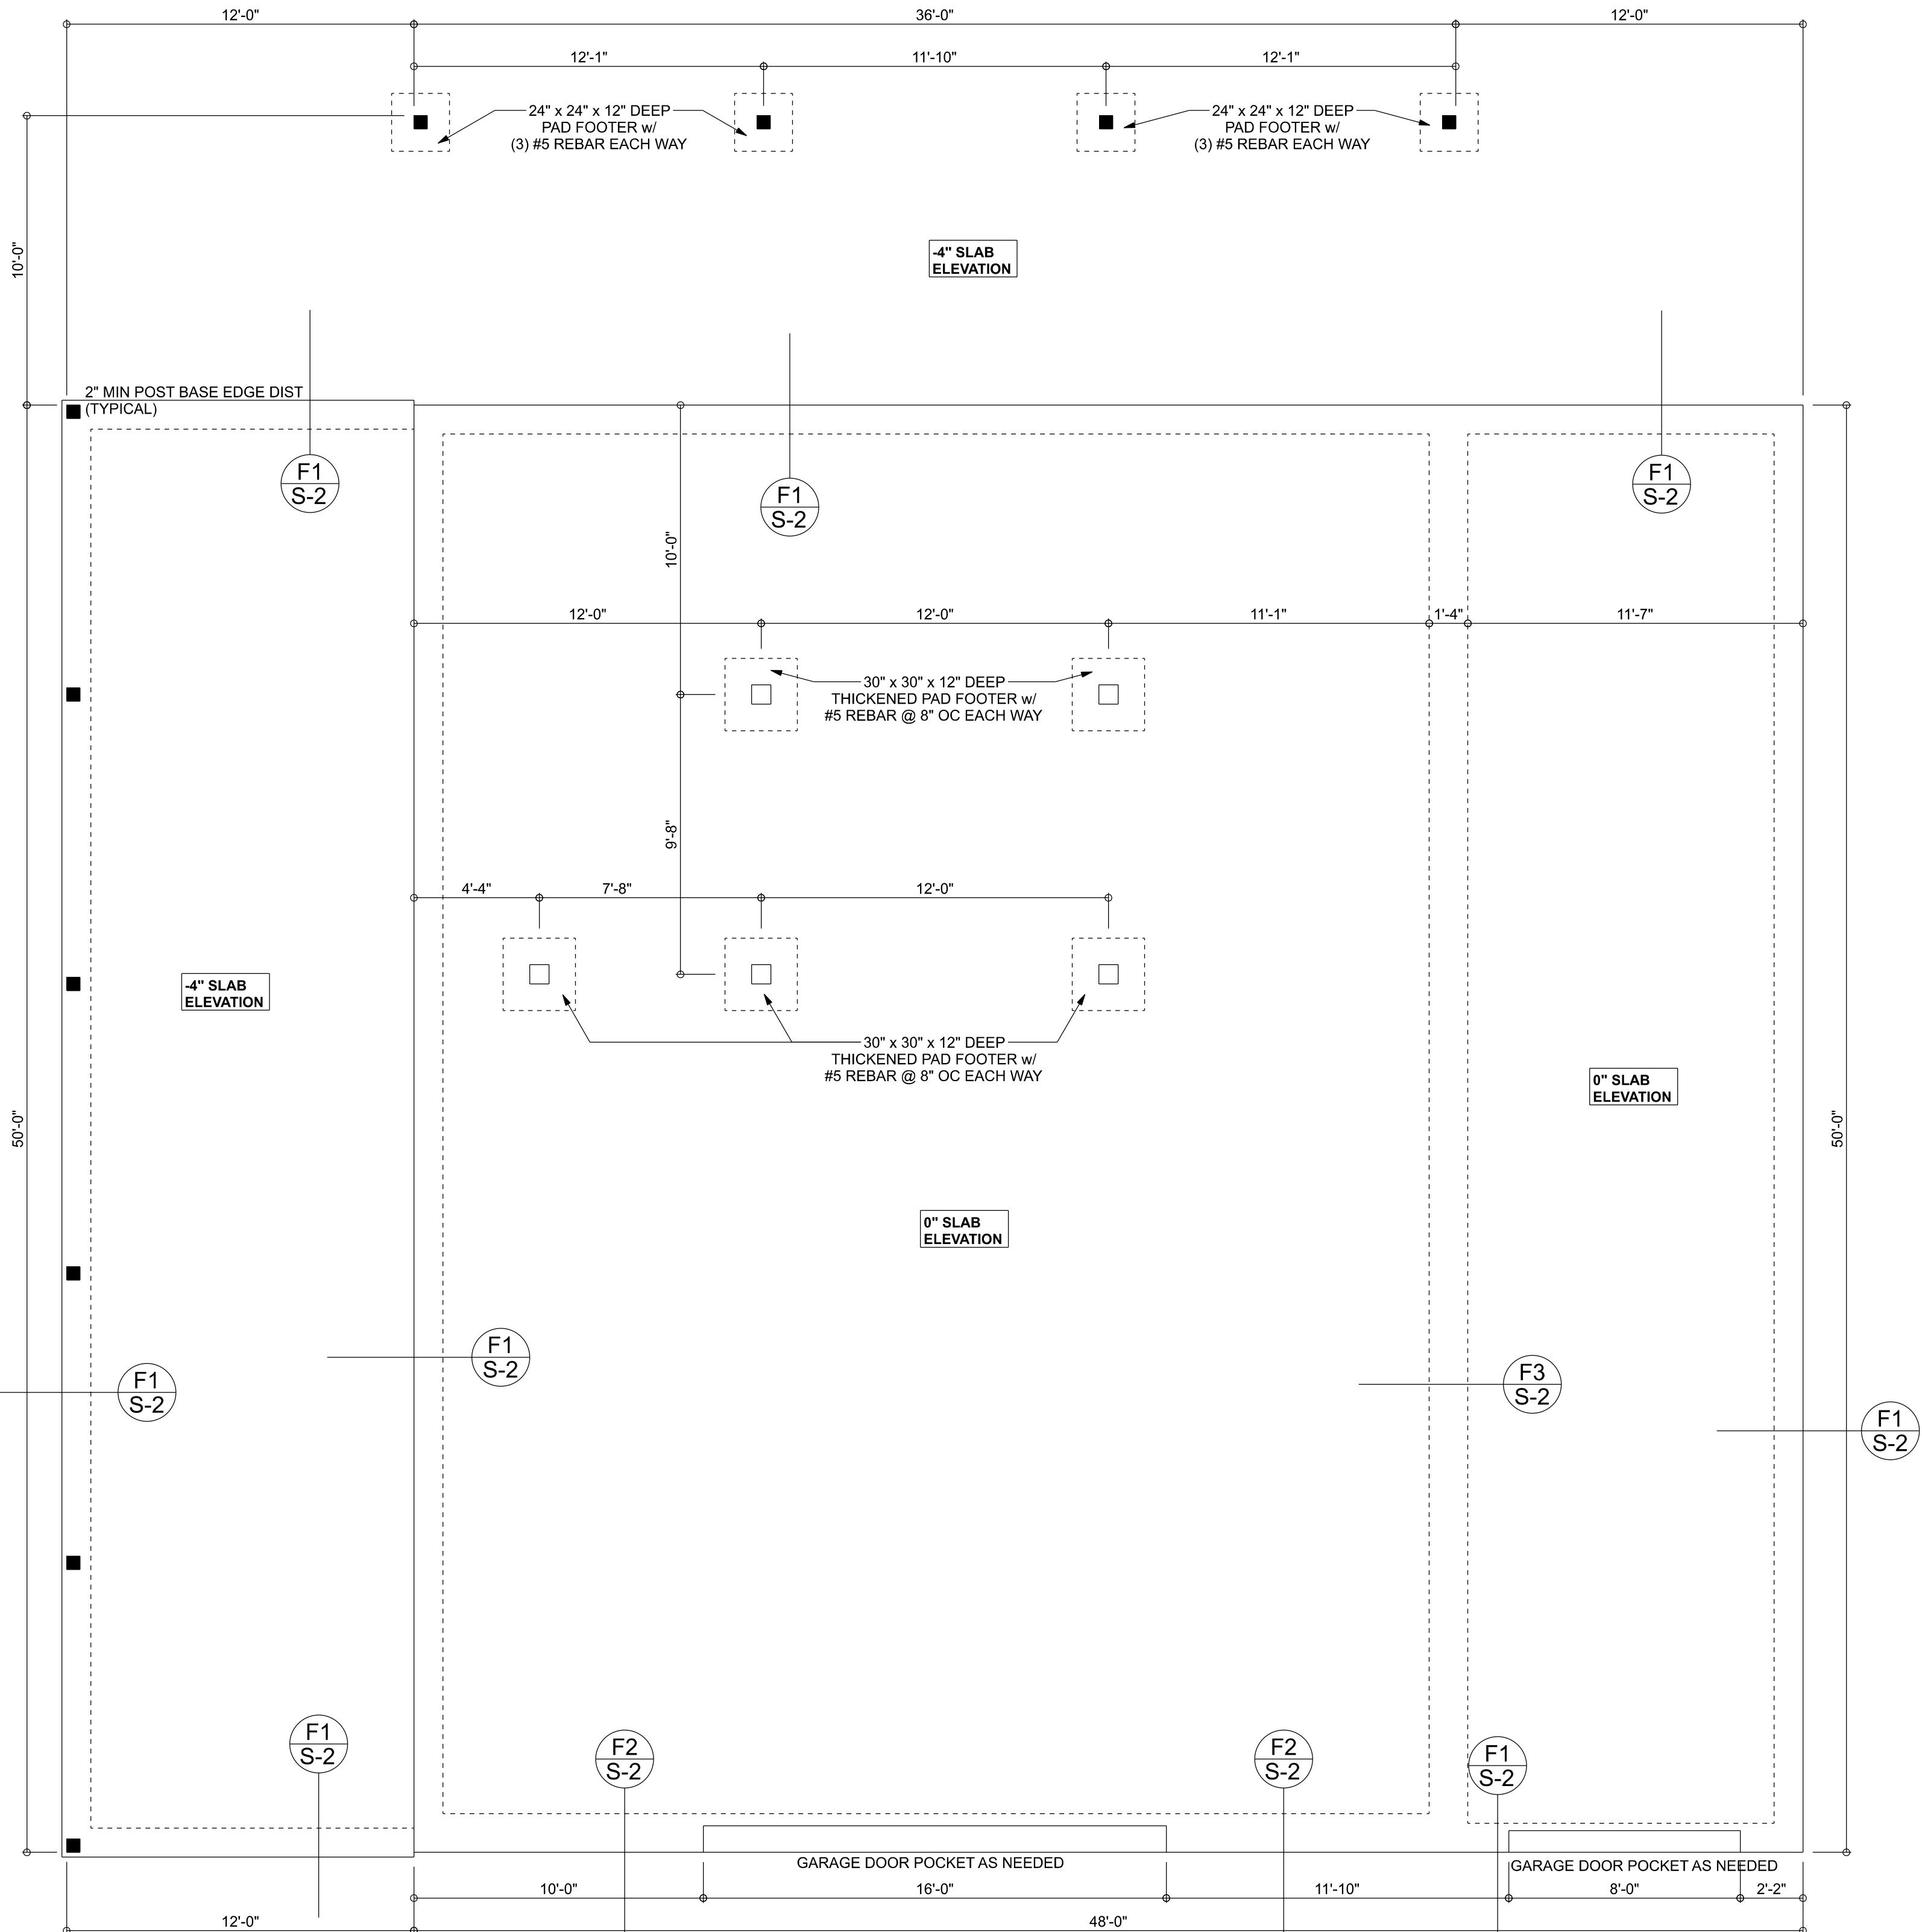

Bryan Zecher Construction

Kyle & Jessica Dicks
Barn

PROJECT ADDRESS:
483 SW CR 240
Lake City, Florida 32025

FL PE 53915

This item has been digitally signed and sealed by Mark Disosway PE on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US, O=Florida, dnQualifier=A01410C0000017E97DE07CA000746F0, CN=Mark d Disosway
2023-11-15 17:41:15

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.



LIMITATION: This design is valid for one building, at specified location.

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
231379

S-2

OF 3 SHEETS

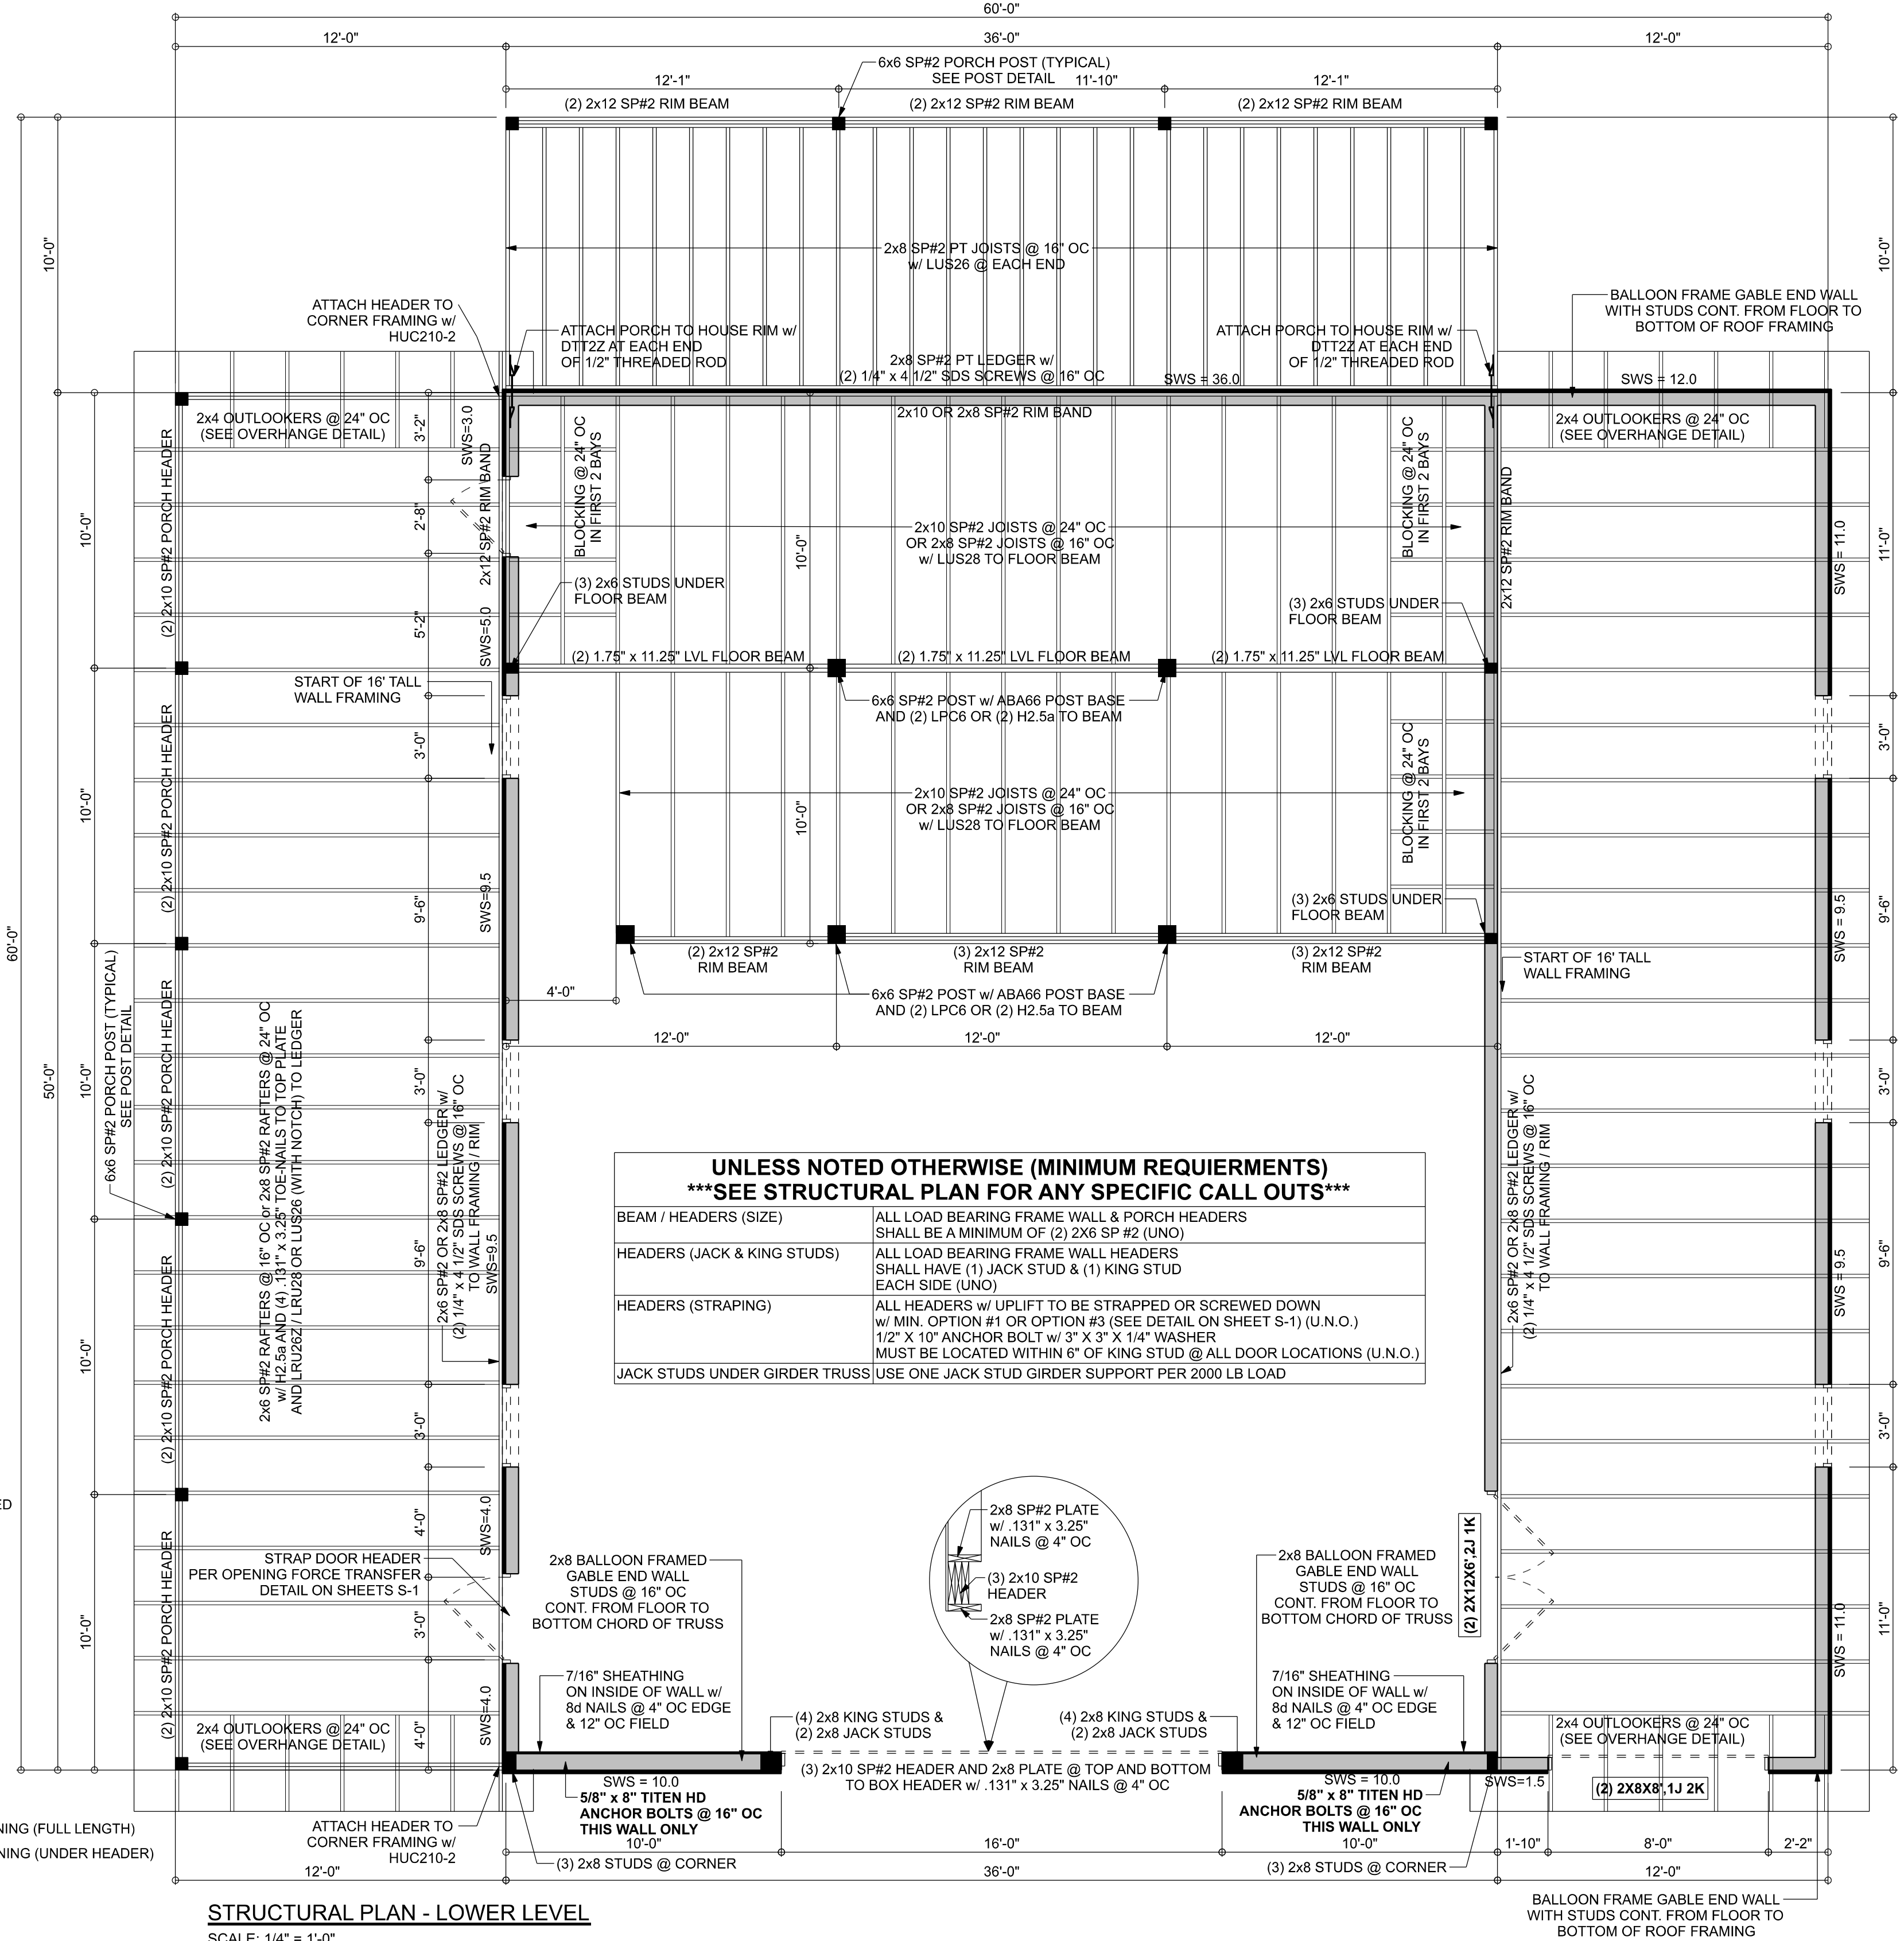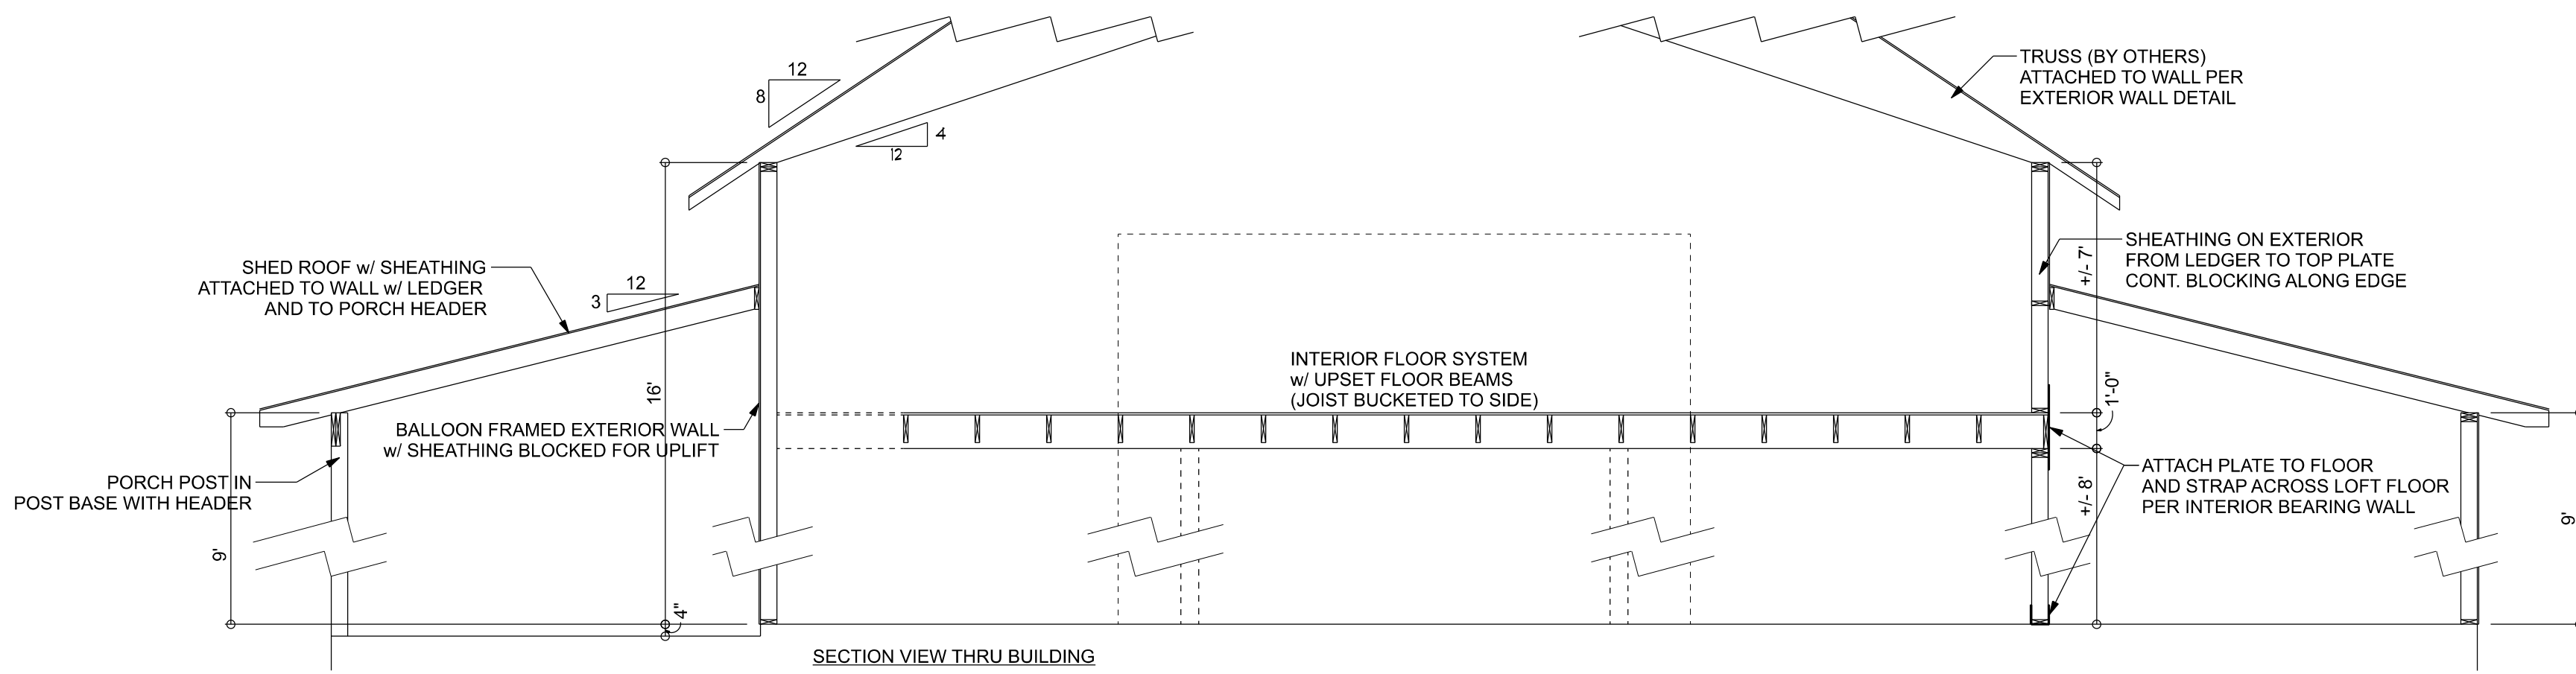

UNLESS NOTED OTHERWISE (MINIMUM REQUIERMENTS)	
SEE STRUCTURAL PLAN FOR ANY SPECIFIC CALL OUTS	
BEAM / HEADERS (SIZE)	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF: (2) 2X8 SP#2 (UNO)
HEADERS (JACK & KING STUDS)	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (UNO)
HEADERS (STRAPING)	ALL HEADERS w/ UPLIFT TO BE STRAPPED OR SCREWED DOWN w/ MIN. OPTION #1 OR OPTION #3 (SEE DETAIL ON SHEET S-1) (U.N.O.) 1/2\" x 10\" ANCHOR BOLT w/ 3\" x 3\" x 1/4\" WASHER MUST BE LOCATED WITHIN 6\" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
JACK STUDS UNDER GIRDER TRUSS	USE ONE JACK STUD GIRDER SUPPORT PER 2000 LB LOAD

CONNECTIONS, WALL & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. BUILDERS FIRST SOURCE JOB #22-7732D

STRUCTURAL PLAN NOTES



- SN-1 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-2 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI1-03, BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

ACTUAL vs REQUIRED SHEARWALL		
	TRANSVERSE	LONGITUDUNAL
ACTUAL	30096 LBF	38608 LBF
REQUIRED	25733 LBF	32358 LBF

HEADER LEGEND

- (2) 2X6X0' 1J 1K ——— HEADER/BEAM CALL-OUT (U.N.O.)
- NUMBER OF KING STUDS EACH SIDE OF OPENING (FULL LENGTH)
- NUMBER OF JACK STUDS EACH SIDE OF OPENING (UNDER HEADER)
- SPAN OF HEADER
- SIZE OF HEADER MATERIAL
- NUMBER OF PLIES IN HEADER

STRUCTURAL PLAN - LOWER LEVEL
SCALE: 1/4" = 1'-0"

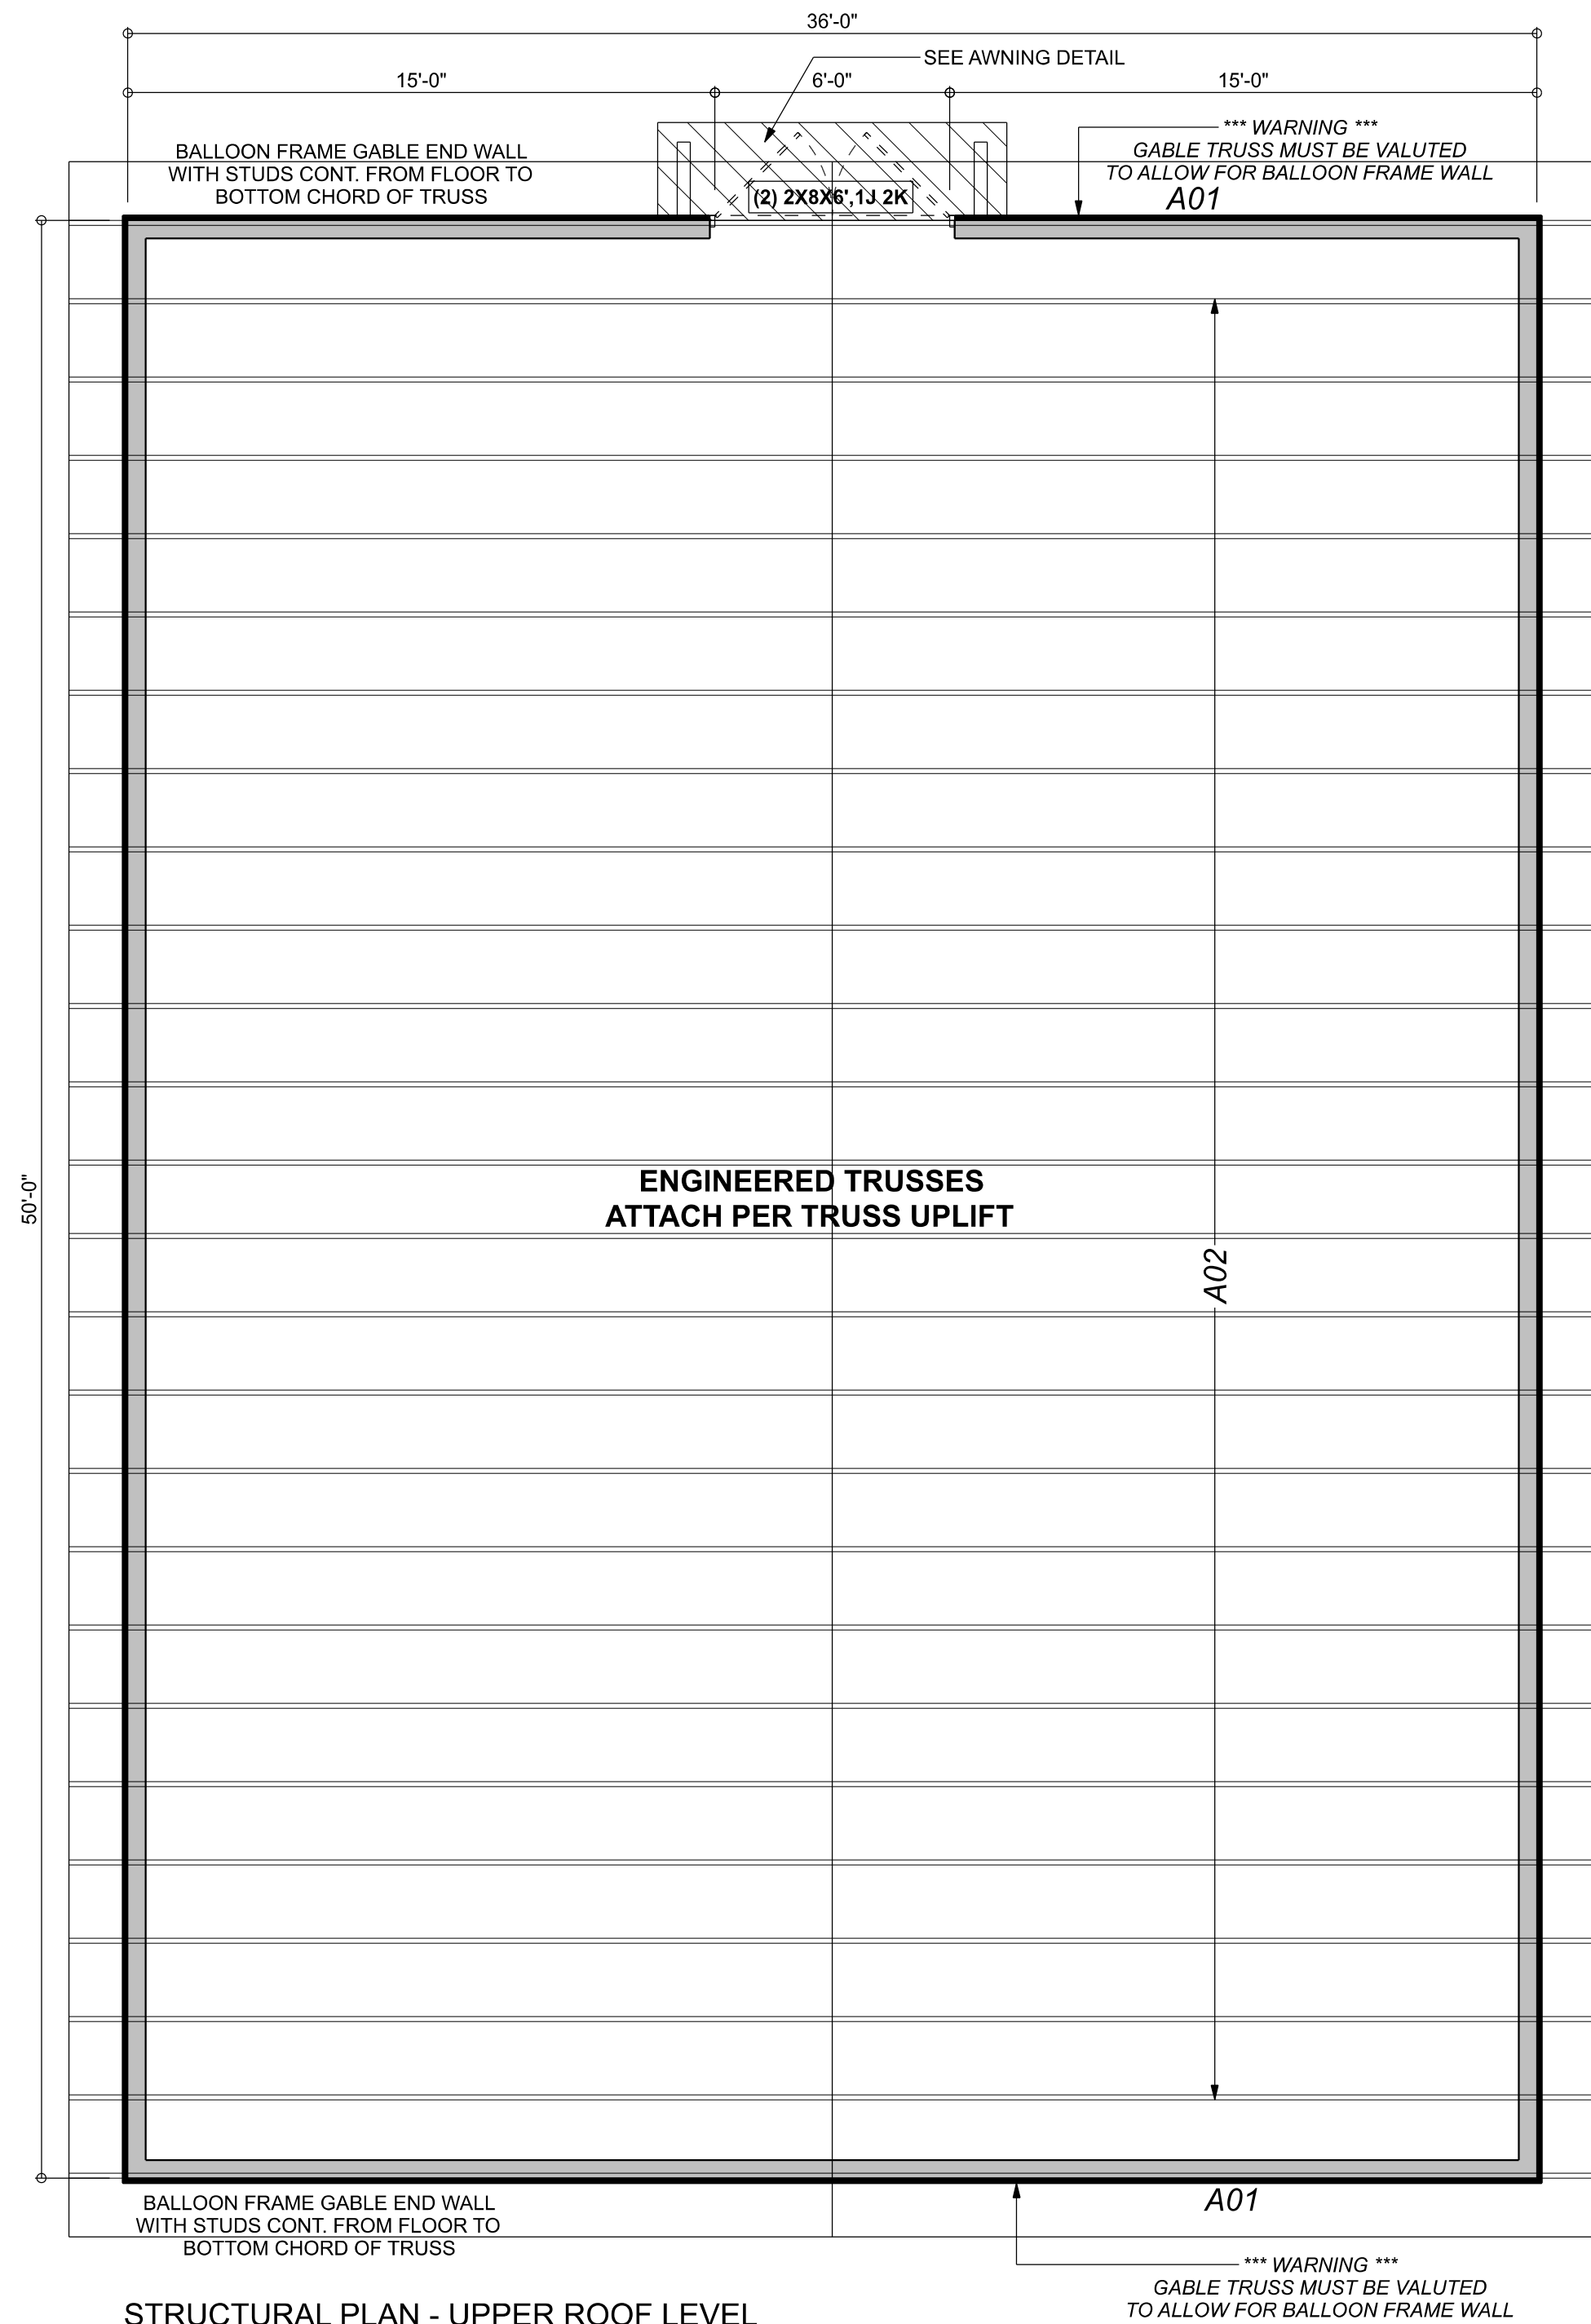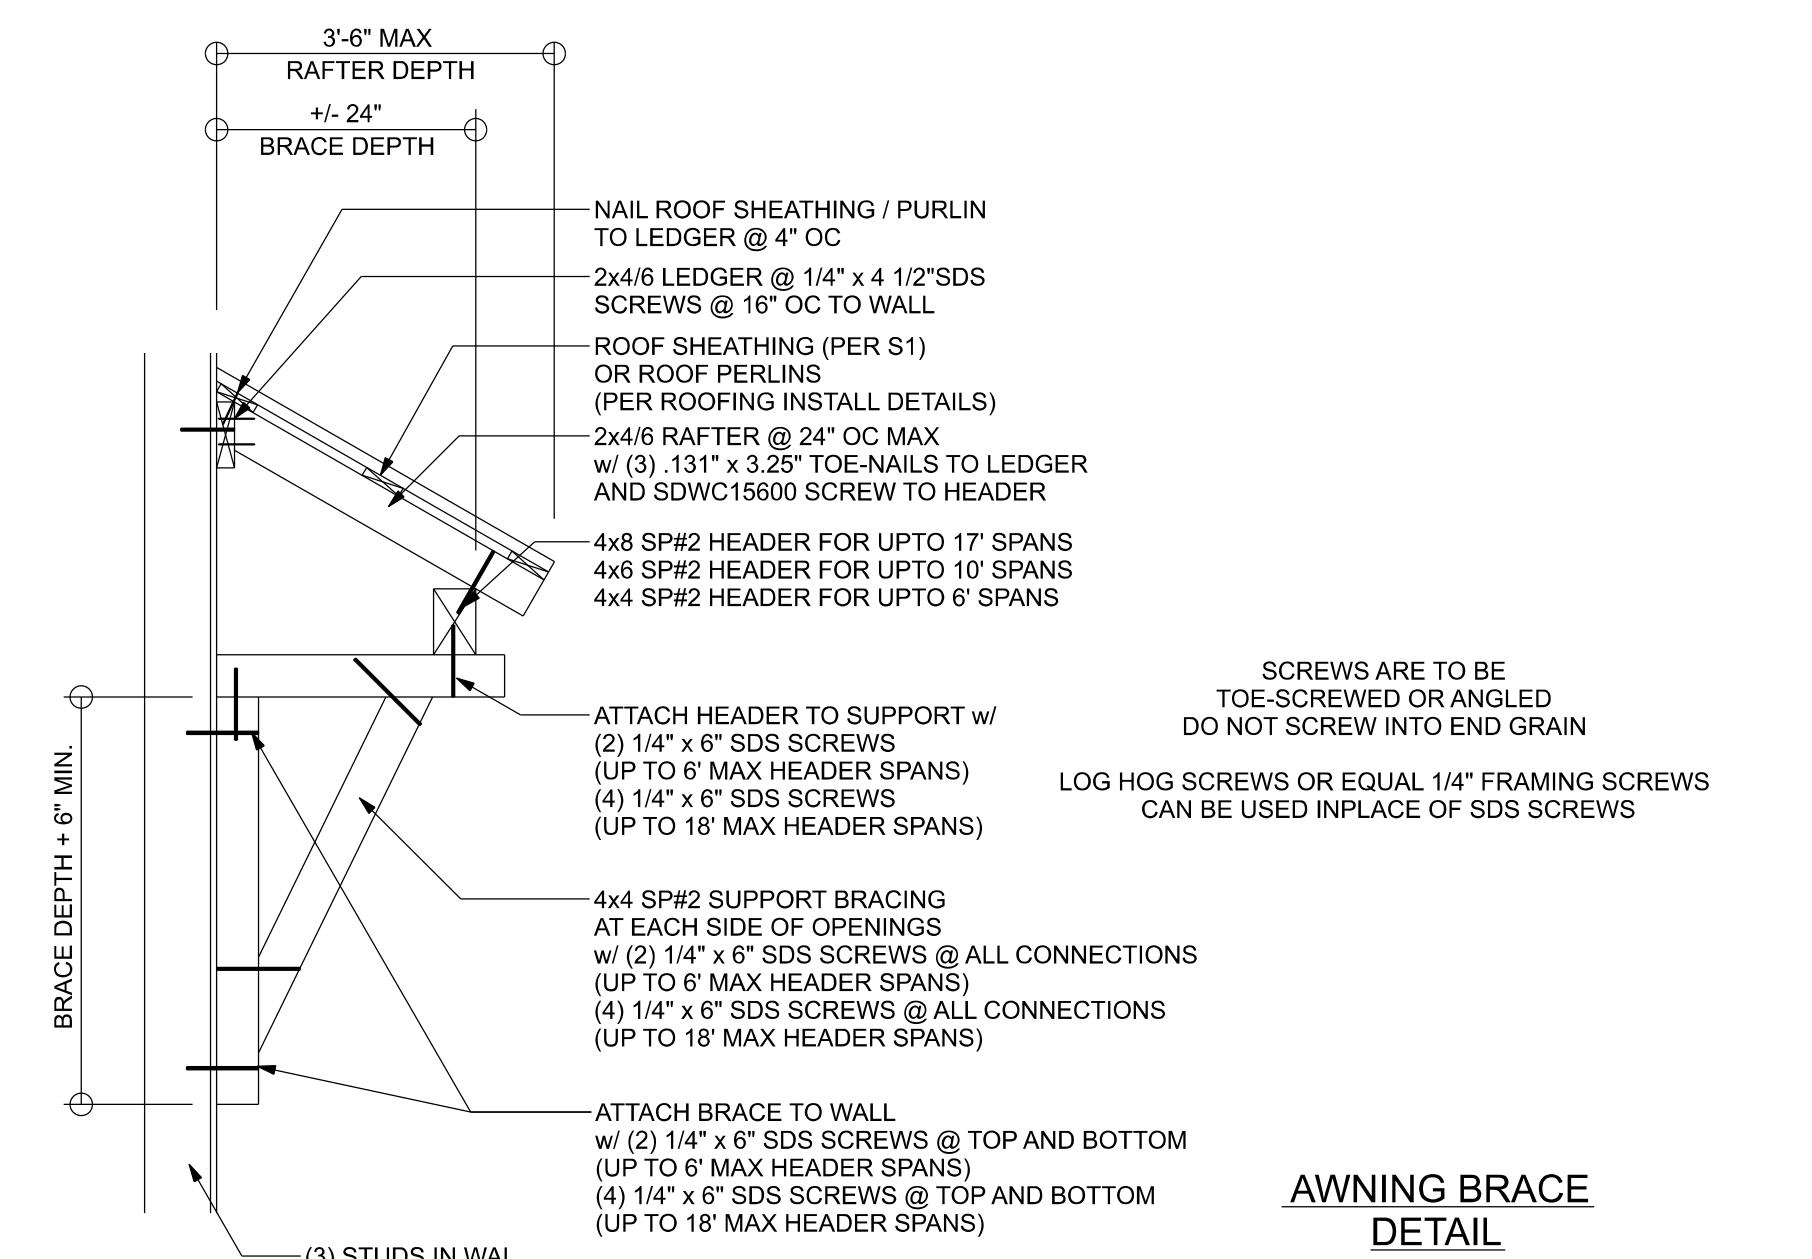

STRUCTURAL PLAN - UPPER ROOF LEVEL
SCALE: 1/4" = 1'-0"

Bryan Zecher Construction

Kyle & Jessica Dicks
Barn

PROJECT ADDRESS:
483 SW CR 240
Lake City, Florida 32025

FL PE 53915
This item has been digitally signed and sealed by Mark Disoway P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C-US, O=Florida, dnQualifier=A01410C0000017E97DE07CA000746F0, CN=Mark d Disoway 2023-11-15 17:55:50

DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and properly right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
231379

S-3
OF 3 SHEETS