


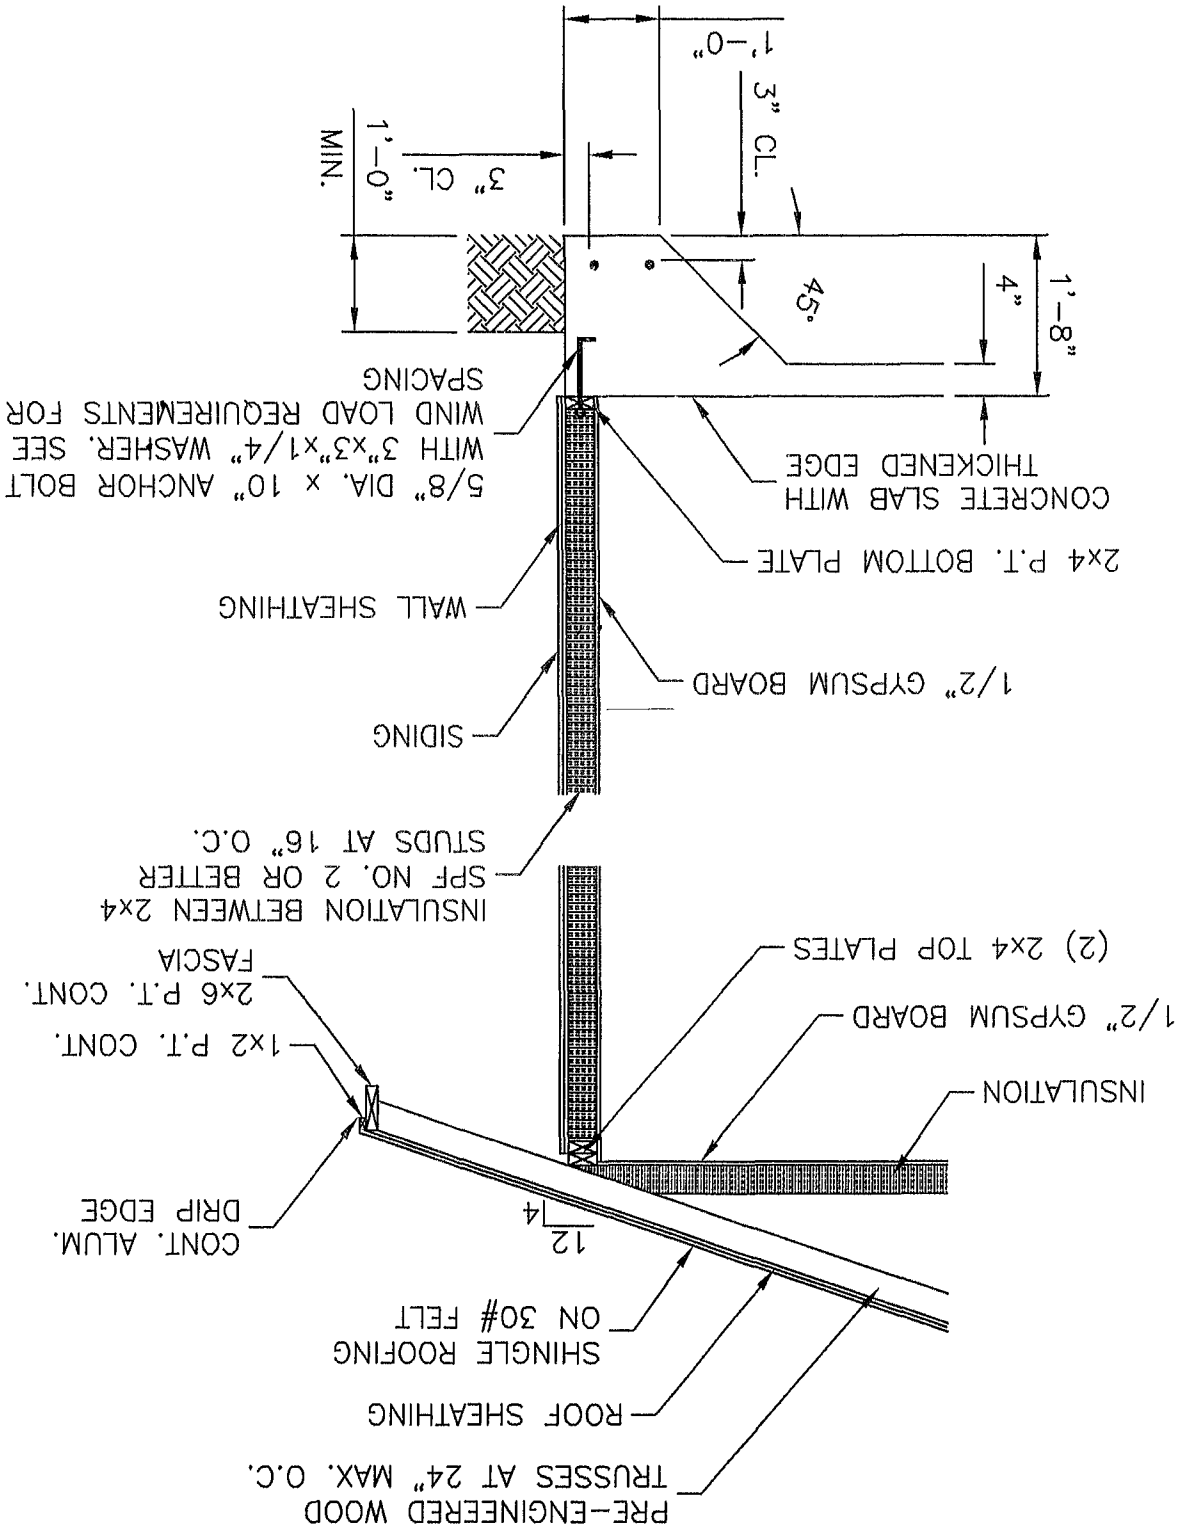

3
TYPICAL WALL SECTION
1/2" = 1'-0"

1. CODE COMPLIANCE: FLORIDA BUILDING CODE, 2010 EDITION;
ASCE/SEI 7-10.
2. MATERIALS:
a. CONCRETE: $f'_c = 3000$ PSI MIN AT 28 DAYS.
b. REINFORCING STEEL: ASTM A 615, GRADE 40 OR 60.
c. LUMBER: SYP NO. 2, UNLESS SPECIFIED OTHERWISE.
3. ASSUMED ALLOWABLE SOIL CONTACT PRESSURE: 1500 PSF MINIMUM.
4. LOADS:
a. ROOF LIVE LOAD: 20 PSF.
b. ULTIMATE DESIGN WIND SPEED: 120 MPH. SEE WIND LOAD REQUIREMENTS FOR ADDITIONAL INFORMATION.
5. FIELD VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS.
6. CEILING ELEVATION TO MATCH EXISTING HOUSE AT THE PASSAGEWAY.

GENERAL NOTES

PROJECT NO.	5090117	DATE	18 JUL 2013	SHEET NO.	S2
FAMILY ROOM RECONSTRUCTION LOTT RESIDENCE 142 SW ARVID GLEN, LAKE CITY, FLORIDA					

