

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Business and Professional Regulation - Residential Performance Method

Project Name: Norman_Almonte Street: SW Kicklighter Terr City, State, Zip: Lake City, FL, Owner: Norman_Almonte Design Location: FL, Gainesville	Builder Name: ChrisMill Homes Florida Permit Office: Columbia County Permit Number: Jurisdiction: County: Columbia(Florida Climate Zone 2)
--	--

1. New construction or existing New (From Plans) 2. Single family or multiple family Detached 3. Number of units, if multiple family 1 4. Number of Bedrooms 1 5. Is this a worst case? No 6. Conditioned floor area above grade (ft²) 2137 Conditioned floor area below grade (ft²) 0 7. Windows(220.9 sqft.) Description Area a. U-Factor: Dbl, U=0.36 220.89 ft² SHGC: SHGC=0.25 b. U-Factor: N/A ft² SHGC: c. U-Factor: N/A ft² SHGC: Area Weighted Average Overhang Depth: 3.593 ft Area Weighted Average SHGC: 0.250 8. Skylights Description Area U-Factor:(AVG) N/A N/A ft² SHGC(AVG): N/A 9. Floor Types Insulation Area a. Slab-On-Grade Edge Insulation R= 0.0 2137.00 ft² b. N/A R= ft² c. N/A R= ft²	10. Wall Types(2049.0 sqft.) Insulation Area a. Frame - Wood, Exterior R=13.0 1737.00 ft² b. Frame - Wood, Adjacent R=13.0 312.00 ft² c. N/A d. N/A 11. Ceiling Types(2350.7 sqft.) Insulation Area a. Flat ceiling under att (Vented) R=38.0 2350.70 ft² b. N/A c. N/A 12. Roof(Comp. Shingles, Vented) Deck R=0.0 2568 ft² 13. Ducts, location & insulation level R ft² a. Sup: Attic, Ret: Attic, AH: Attic 6 534 b. c. 14. Cooling Systems kBtu/hr Efficiency a. Central Unit 39.5 SEER2:16.00 15. Heating Systems kBtu/hr Efficiency a. Electric Heat Pump 39.6 HSPF2:8.80 16. Hot Water Systems a. Electric Cap: 50 gallons EF: 0.920 b. Conservation features None 17. Credits CV, Pstat
--	---

Glass/Floor Area:0.103	Total Proposed Modified Loads: 46.69	PASS
	Total Baseline Loads: 49.13	

NOTE: Proposed residence must have annual total normalized Modified Loads that are less than or equal to 95 percent of the annual total loads of the standard reference design in order to comply.

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code. PREPARED BY: <u>Wm C. [Signature]</u> DATE: <u>4 / 8 / 2025</u> I hereby certify that this building, as designed, is in compliance with the Florida Energy Code. OWNER/AGENT: _____ DATE: _____	Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.  BUILDING OFFICIAL: _____ DATE: _____
---	--

- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with R403.3.2.1.
- Default duct leakage does not require a Duct Leakage Test Report.
- Compliance requires an Air Barrier and Insulation Inspection Checklist in accordance with R402.4.1.1 and this project requires a PERFORMANCE envelope leakage test report with envelope leakage no greater than 7.00 ACH50 (R402.4.1.2).

INPUT SUMMARY CHECKLIST REPORT

PROJECT

Title:	Norman_Almonte	Bedrooms:	1	Address type:	Street Address
Building Type:	User	Conditioned Area:	2137	Lot #:	---
Owner:	Norman_Almonte	Total Stories:	1	Block/SubDivision:	---
Builder Home ID:		Worst Case:	No	PlatBook:	---
Builder Name:	ChrisMill Homes Florida	Rotate Angle:	0	Street:	SW Kicklighter Terr
Permit Office:	Columbia County	Cross Ventilation:	Yes	County:	Columbia
Jurisdiction:		Whole House Fan:	No	City, State, Zip:	Lake City, FL,
Family Type:	Detached	Terrain:	Suburban		
New/Existing:	New (From Plans)	Shielding:	Suburban		
Year Construct:	2025				
Comment:					

CLIMATE

✓ Design Location	Tmy Site	Design Temp 97.5%	2.5%	Int Design Temp Winter	Summer	Heating Degree Days	Design Moisture	Daily temp Range
___ FL, Gainesville	FL_GAINESVILLE_REGIONA	32	92	70	75	1305.5	51	Medium

BLOCKS

✓ Number	Name	Area	Volume
___ 1	Block1	2137	19233 cu ft

SPACES

✓ Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Finished	Cooled	Heated
___ 1	1st Floor	2137	19233	Yes	1	1	Yes	Yes	Yes

FLOORS

(Total Exposed Area = 2137 sq.ft.)

✓ #	Floor Type	Space	Exposed Perim(ft)	Area	R-Value Perim.	U-Factor Joist	Slab Insul. Vert/Horiz	Tile	Wood	Carpets
___ 1	Slab-On-Grade Edge Ins	1st Floor	208	2137 sqft	0.0	---	0.304	2 (ft)/0 (ft)	0.00	0.00 1.00

ROOF

✓ #	Type	Materials	Roof Area	Gable Area	Framing. Fract.	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
___ 1	Hip	Composition shingles	2568 ft²	0 ft²	0.11	Medium	Y	0.96	No	0.9	No	0	33.69

ATTIC

✓ #	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
___ 1	Full attic	Vented	300	2137 ft²	Y	N

CEILING

(Total Exposed Area = 2351 sq.ft.)

✓ #	Ceiling Type	Space	R-Value	Ins. Type	Area	U-Factor	Framing Frac.	Truss Type
___ 1	Flat ceiling under attic(Vented)	1st Floor	38.0	Double Batt	2350.7ft²	0.024	0.11	Wood

INPUT SUMMARY CHECKLIST REPORT

WALLS															(Total Exposed Area = 2049 sq.ft.)			
✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area sq.ft.	U-Factor	Sheath R-Value	Frm. Frac.	Solar Absor.	Below Grade			
___ 1	W	Exterior	Frame - Wood	1st Floor	13.0	8.0	4	9.0	0	75.0	0.084		0.23	0.75	0 %			
___ 2	N	Exterior	Frame - Wood	1st Floor	13.0	2.0	0	9.0	0	18.0	0.084		0.23	0.75	0 %			
___ 3	W	Exterior	Frame - Wood	1st Floor	13.0	11.0	8	9.0	0	105.0	0.084		0.23	0.75	0 %			
___ 4	S	Exterior	Frame - Wood	1st Floor	13.0	2.0	0	9.0	0	18.0	0.084		0.23	0.75	0 %			
___ 5	W	Exterior	Frame - Wood	1st Floor	13.0	6.0	4	9.0	0	57.0	0.084		0.23	0.75	0 %			
___ 6	N	Exterior	Frame - Wood	1st Floor	13.0	2.0	0	9.0	0	18.0	0.084		0.23	0.75	0 %			
___ 7	W	Exterior	Frame - Wood	1st Floor	13.0	12.0	0	9.0	0	108.0	0.084		0.23	0.75	0 %			
___ 8	N	Exterior	Frame - Wood	1st Floor	13.0	6.0	0	9.0	0	54.0	0.084		0.23	0.75	0 %			
___ 9	W	Exterior	Frame - Wood	1st Floor	13.0	13.0	4	9.0	0	120.0	0.084		0.23	0.75	0 %			
___ 10	S	Exterior	Frame - Wood	1st Floor	13.0	39.0	2	9.0	0	352.5	0.084		0.23	0.75	0 %			
___ 11	E	Exterior	Frame - Wood	1st Floor	13.0	13.0	4	9.0	0	120.0	0.084		0.23	0.75	0 %			
___ 12	E	Exterior	Frame - Wood	1st Floor	13.0	28.0	6	9.0	0	256.5	0.084		0.23	0.75	0 %			
___ 13	E	Exterior	Frame - Wood	1st Floor	13.0	31.0	6	9.0	0	283.5	0.084		0.23	0.75	0 %			
___ 14	N	Exterior	Frame - Wood	1st Floor	13.0	16.0	10	9.0	0	151.5	0.084		0.23	0.75	0 %			
___ 15	W	Garage	Frame - Wood	1st Floor	13.0	21.0	8	9.0	0	195.0	0.084		0.23	0.75	0 %			
___ 16	N	Garage	Frame - Wood	1st Floor	13.0	13.0	0	9.0	0	117.0	0.084		0.23	0.75	0 %			

DOORS												(Total Exposed Area = 38 sq.ft.)	
✓ #	Ornt	Adjacent To	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area		
___ 1	S	Exterior	Insulated	1st Floor	None	0.46	3.00	0	6.00	8	20.0ft²		
___ 2	W	Garage	Insulated	1st Floor	None	0.46	2.00	8	6.00	8	17.8ft²		

WINDOWS																	(Total Exposed Area = 221 sq.ft.)	
✓ #	Ornt	Wall ID	Frame	Panes	NFRC U-Factor	SHGC	Imp	Storm	Total Area (ft²)	Same Units	Width (ft)	Height (ft)	--Overhang-- Depth (ft) Sep. (ft)		Interior Shade	Screen		
___ 1	W	1	Vinyl	Low-E Double	Y	0.36	0.25	N	N	7.0	1	2.33	3.00	1.5	1.0	None	None	
___ 2	W	3	Vinyl	Low-E Double	Y	0.36	0.25	N	N	27.6	2	2.67	5.17	1.5	1.0	None	None	
___ 3	W	7	Vinyl	Low-E Double	Y	0.36	0.25	N	N	27.6	2	2.67	5.17	1.5	1.0	None	None	
___ 4	W	9	Vinyl	Low-E Double	Y	0.36	0.25	N	N	15.5	1	3.00	5.17	1.5	1.0	None	None	
___ 5	S	10	Vinyl	Low-E Double	Y	0.36	0.25	N	N	31.0	2	3.00	5.17	1.5	1.0	None	None	
___ 6	S	10	Vinyl	Low-E Double	Y	0.36	0.25	N	N	4.0	1	4.00	1.00	1.5	1.0	None	None	
___ 7	E	11	Vinyl	Low-E Double	Y	0.36	0.25	N	N	15.5	1	3.00	5.17	1.5	1.0	None	None	
___ 8	E	12	Vinyl	Low-E Double	Y	0.36	0.25	N	N	31.0	2	3.00	5.17	9.5	1.0	None	None	
___ 9	E	12	Vinyl	Low-E Double	Y	0.36	0.25	N	N	9.0	1	3.00	3.00	9.5	1.0	None	None	
___ 10	E	12	TIM	Low-E Double	Y	0.36	0.25	N	N	17.8	1	2.67	6.67	9.5	1.0	None	None	
___ 11	E	13	Vinyl	Low-E Double	Y	0.36	0.25	N	N	31.0	2	3.00	5.17	1.5	1.0	None	None	
___ 12	N	14	Vinyl	Low-E Double	Y	0.36	0.25	N	N	4.0	1	4.00	1.00	1.5	1.0	None	None	

INFILTRATION											
✓ #	Scope	Method	SLA	CFM50	ELA	EqLA	ACH	ACH50	Space(s)	Infiltration Test Volume	
___ 1	Wholehouse	Proposed ACH(50)	0.00040	2244	123.10	231.11	0.1438	7.0	All	19233 cu ft	

GARAGE								
✓ #	Floor Area	Length	Width	Roof Area	Exposed Perimeter	Area Under Uncond.	Avg. Wall Height	Exposed Wall Insulation
___ 1	520 ft²	21.7 ft²	24.0 ft²	520 ft²	57 ft	520 ft	9 ft	1

INPUT SUMMARY CHECKLIST REPORT

MASS

#	Mass Type	Area	Thickness	Furniture Fraction	Space
1	Default(8 lbs/sq.ft.)	0 ft ²	0 ft	0.30	1st Floor

HEATING SYSTEM

#	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	Geothermal Entry	HeatPump Power	Ducts Volt	Block Current
1	Electric Heat Pump	None/Single		HSPF2: 8.80	39.6		0.00	0.00	0.00

COOLING SYSTEM

#	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	Air Flow cfm	SHR	Duct	Block
1	Central Unit	None/Single		SEER2:16.0	39.5	1185	0.75	sys#1	1

HOT WATER SYSTEM

#	System Type	Subtype	Location	EF(UEF)	Cap	Use	SetPnt	Fixt. Flow	Trap	Pipe Ins.	Pipe length
1	Electric	None	1st Floor	0.92 (0.92)	50.0 gal	40 gal	120 deg	Standard	Yes	None	12
	Recirculation System	Recirc Control Type	Loop length	Branch length	Pump power	DWHR	Facilities Connected	Equal Flow	DWHR Eff	Other Credits	
1	No		NA	NA	NA	No	NA	NA	NA	None	

DUCTS

Duct #	Location	Supply R-Value	Area	Return R-Value	Area	Leakage Type	AHU Location	CFM 25 TOT OUT	QN OUT	AHU SEALED	RLF	HVAC # Heat Cool
1	Attic	6.0	534 ft ²	6.0	107 ft ²	Default Leakage	Attic	(Default) (Default)				1 1

TEMPERATURES

Programable Thermostat: Y				Ceiling Fans: N									
Cooling	[] Jan	[] Feb	[] Mar	[] Apr	[] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[] Oct	[] Nov	[] Dec	
Heating	[X] Jan	[X] Feb	[X] Mar	[] Apr	[] May	[] Jun	[] Jul	[] Aug	[] Sep	[] Oct	[X] Nov	[X] Dec	
Venting	[] Jan	[] Feb	[X] Mar	[X] Apr	[] May	[] Jun	[] Jul	[] Aug	[] Sep	[X] Oct	[X] Nov	[] Dec	
Thermostat Schedule: HERS 2006 Reference													
Schedule Type	1	2	3	4	5	6	Hours	7	8	9	10	11	12
Cooling (WD)	AM PM	78 80	78 80	78 78	78 78	78 78	78 78	78 78	78 78	80 78	80 78	80 78	80 78
Cooling (WEH)	AM PM	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78
Heating (WD)	AM PM	66 68	66 68	66 68	66 68	66 68	68 68	68 68	68 68	68 68	68 68	68 66	68 66
Heating (WEH)	AM PM	66 68	66 68	66 68	66 68	66 68	68 68	68 68	68 68	68 68	68 68	68 66	68 66

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 95

The lower the EnergyPerformance Index, the more efficient the home.

SW Kicklighter Terr,Lake City,FL,

1. New construction or existing	New (From Plans)	10. Wall Types(2049.0 sqft.)	Insulation	Area
2. Single family or multiple family	Detached	a. Frame - Wood, Exterior	R=13.0	1737.00 ft ²
3. Number of units, if multiple family	1	b. Frame - Wood, Adjacent	R=13.0	312.00 ft ²
4. Number of Bedrooms	1	c. N/A		
5. Is this a worst case?	No	d. N/A		
6. Conditioned floor area above grade (ft ²)	2137	11. Ceiling Types(2350.7 sqft.)	Insulation	Area
Conditioned floor area below grade (ft ²)	0	a. Flat ceiling under att (Vented)	R=38.0	2350.70 ft ²
7. Windows**	Description	b. N/A		
a. U-Factor:	Dbl, U=0.36	c. N/A		
SHGC:	SHGC=0.25	12. Roof(Comp. Shingles, Vented) Deck	R=0.0	2568 ft ²
b. U-Factor:	N/A	13. Ducts, location & insulation level	R	ft ²
SHGC:		a. Sup: Attic, Ret: Attic, AH: Attic	6	534
c. U-Factor:	N/A	b.		
SHGC:		c.		
Area Weighted Average Overhang Depth:	3.593 ft	14. Cooling Systems	kBtu/hr	Efficiency
Area Weighted Average SHGC:	0.250	a. Central Unit	39.5	SEER2:16.00
8. Skylights	Description	15. Heating Systems	kBtu/hr	Efficiency
U-Factor:(AVG)	N/A	a. Electric Heat Pump	39.6	HSPF2:8.80
SHGC(AVG):	N/A			
9. Floor Types	Insulation	16. Hot Water Systems		
a. Slab-On-Grade Edge Insulation	R= 0.0	a. Electric	Cap: 50 gallons	
b. N/A	R=		EF: 0.920	
c. N/A	R=	b. Conservation features		
		17. Credits	None	
			CV, Pstat	

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: SW Kicklighter Terr City/FL Zip: Lake City,FL,



*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida Energy Rating. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

**Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.

Envelope Leakage Test Report (Blower Door Test)
Residential Prescriptive, Performance or ERI Method Compliance
2023 Florida Building Code, Energy Conservation, 8th Edition

Jurisdiction:	Permit #:
---------------	-----------

Job Information

Builder: ChrisMill Homes Florida	Community:	Lot: NA
Address: SW Kicklighter Terr		
City: Lake City	State: FL	Zip:

Air Leakage Test Results *Passing results must meet either the Performance, Prescriptive, or ERI Method*

- ☐ **PRESCRIPTIVE METHOD**-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.
- ☒ **PERFORMANCE or ERI METHOD**-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2023 (Performance) or R406-2023 (ERI), section labeled as infiltration, sub-section ACH50.
ACH(50) specified on Form R405-2023-Energy Calc (Performance) or R406-2023 (ERI): 7.000

$$\frac{\text{CFM}(50)}{\text{Building Volume}} \times 60 \div \frac{19233}{\text{ACH}(50)} =$$

☒ **PASS**

☐ When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.

Method for calculating building volume:

- ☐ Retrieved from architectural plans
- ☒ Code software calculated
- ☐ Field measured and calculated

R402.4.1.2 Testing. The building or dwelling unit shall be tested and verified as having an air leakage rate not exceeding seven air changes per hour in Climate Zones 1 and 2, and three air changes per hour in Climate Zones 3 through 8. Dwelling units with an air leakage rate less than three air changes per hour shall be provided with whole-house mechanical ventilation in accordance with Section R403.6.1 of this code and Section M1507.3 if the *Florida Building Code, Residential*. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), *Florida Statutes*, or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the *code official*. Testing shall be performed at any time after creation of all penetrations of the *building thermal envelope*.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
3. Interior doors, if installed at the time of the test, shall be open.
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
6. Supply and return registers, if installed at the time of the test, shall be fully open.
7. If an attic is both sealed and insulated at the roof deck, interior access doors and hatches between the conditioned space volume and the attic shall be opened during the test and the volume of the attic shall be added to the conditioned space volume for purposes of reporting the infiltration volume and calculating the air leakage of the home.

Testing Company

Company Name: _____ Phone: _____
I hereby verify that the above Air Leakage results are in accordance with the 2023 8th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.

Signature of Tester: _____ Date of Test: _____

Printed Name of Tester: _____

License/Certification #: _____ Issuing Authority: _____

Residential System Sizing Calculation

Summary

Norman_Almonte
SW Kicklighter Terr
Lake City, FL

Project Title:
Norman_Almonte


4/8/2025

Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M)			
Humidity data: Interior RH (50%) Outdoor wet bulb (79F) Humidity difference(54gr.)			
Winter design temperature(MJ8 99%/Cu)	33 F	Summer design temperature(MJ8 99%/Cu)	99 F
Winter setpoint	70 F	Summer setpoint	75 F
Winter temperature difference	37 F	Summer temperature difference	24 F
Total heating load calculation	29665 Btuh	Total cooling load calculation	27408 Btuh
Submitted heating capacity	% of calc Btuh	Submitted cooling capacity	% of calc Btuh
Total (Electric Heat Pump)	133.4 39580	Sensible (SHR = 0.75)	126.0 29625
Heat Pump + Auxiliary(0.0kW)	133.4 39580	Latent	253.9 9875
		Total (Electric Heat Pump)	144.1 39500

WINTER CALCULATIONS

Winter Heating Load (for 2137 sqft)


Load component		Load	
Window total	221 sqft	2942 Btuh	
Wall total	1790 sqft	5880 Btuh	
Door total	38 sqft	643 Btuh	
Ceiling total	2351 sqft	2208 Btuh	
Floor total	2137 sqft	9081 Btuh	
Infiltration	74 cfm	2987 Btuh	
Duct loss		5924 Btuh	
Subtotal		29665 Btuh	
Ventilation	Ex:0 cfm; Sup:0 cfm	0 Btuh	
TOTAL HEAT LOSS		29665 Btuh	

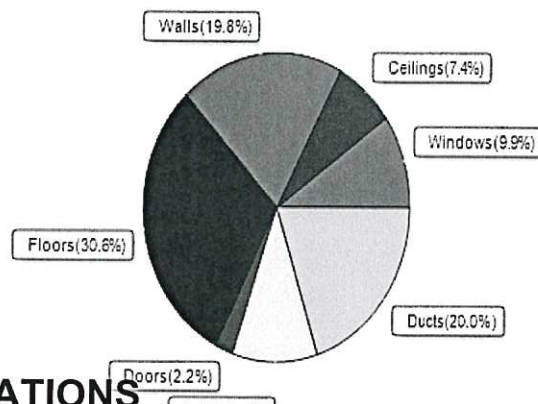

SUMMER CALCULATIONS

Summer Cooling Load (for 2137 sqft)

Load component		Load	
Window total	221 sqft	5456 Btuh	
Wall total	1790 sqft	4677 Btuh	
Door total	38 sqft	608 Btuh	
Ceiling total	2351 sqft	2923 Btuh	
Floor total		0 Btuh	
Infiltration	55 cfm	1453 Btuh	
Internal gain		1430 Btuh	
Duct gain		6971 Btuh	
Sens. Ventilation	Ex:0 cfm; Sup:0 cfm	0 Btuh	
Blower Load		0 Btuh	
Total sensible gain		23518 Btuh	
Latent gain(ducts)		1668 Btuh	
Latent gain(infiltration)		2021 Btuh	
Latent gain(ventilation)		0 Btuh	
Latent gain(internal/occupants/other)		200 Btuh	
Total latent gain		3890 Btuh	
TOTAL HEAT GAIN		27408 Btuh	

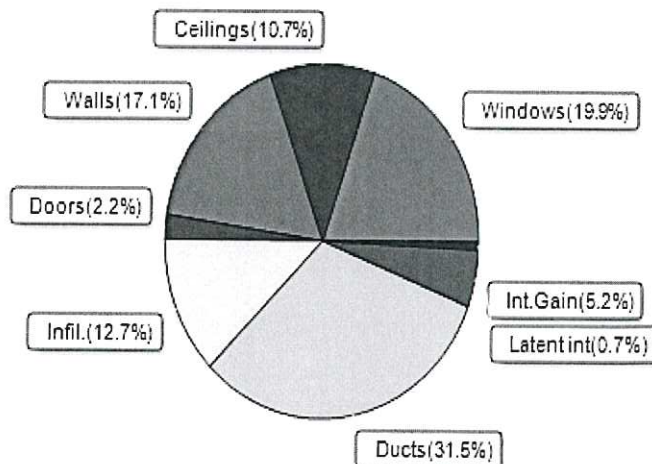

8th Edition

EnergyGauge® System Sizing

PREPARED BY:

DATE:

4 / 8 / 2025

System Sizing Calculations - Winter

Residential Load - Whole House Component Details

Norman_Almonte
SW Kicklighter Terr
Lake City, FL

Project Title:
Norman_Almonte
Building Type: User

4/8/2025

Reference City: Gainesville, FL (Defaults) Winter Temperature Difference: 37.0 °F (MJ8 99%/Cu)
Winter Setpoint: 70 °F (Required Manual J default)

Component Loads for Whole House

Window	Panes/Type	Frame	U	Orientation	Area(sqft)	X	HTM=	Load
1	2, NFRC 0.25	Vinyl	0.36	W	7.0		13.3	93 Btuh
2	2, NFRC 0.25	Vinyl	0.36	W	27.6		13.3	367 Btuh
3	2, NFRC 0.25	Vinyl	0.36	W	27.6		13.3	367 Btuh
4	2, NFRC 0.25	Vinyl	0.36	W	15.5		13.3	206 Btuh
5	2, NFRC 0.25	Vinyl	0.36	S	31.0		13.3	413 Btuh
6	2, NFRC 0.25	Vinyl	0.36	S	4.0		13.3	53 Btuh
7	2, NFRC 0.25	Vinyl	0.36	E	15.5		13.3	206 Btuh
8	2, NFRC 0.25	Vinyl	0.36	E	31.0		13.3	413 Btuh
9	2, NFRC 0.25	Vinyl	0.36	E	9.0		13.3	120 Btuh
10	2, NFRC 0.25	TIM	0.36	E	17.8		13.3	237 Btuh
11	2, NFRC 0.25	Vinyl	0.36	E	31.0		13.3	413 Btuh
12	2, NFRC 0.25	Vinyl	0.36	N	4.0		13.3	53 Btuh
Window Total					220.9(sqft)			2942 Btuh
Walls	Type	Ornt.	Ueff.	R-Value (Cav/Sh)	Area	X	HTM=	Load
1	Frame - Wood	- Ext	(0.089)	13.0/0.0	68		3.28	223 Btuh
2	Frame - Wood	- Ext	(0.089)	13.0/0.0	18		3.28	59 Btuh
3	Frame - Wood	- Ext	(0.089)	13.0/0.0	77		3.28	254 Btuh
4	Frame - Wood	- Ext	(0.089)	13.0/0.0	18		3.28	59 Btuh
5	Frame - Wood	- Ext	(0.089)	13.0/0.0	37		3.28	122 Btuh
6	Frame - Wood	- Ext	(0.089)	13.0/0.0	18		3.28	59 Btuh
7	Frame - Wood	- Ext	(0.089)	13.0/0.0	80		3.28	264 Btuh
8	Frame - Wood	- Ext	(0.089)	13.0/0.0	54		3.28	177 Btuh
9	Frame - Wood	- Ext	(0.089)	13.0/0.0	105		3.28	343 Btuh
10	Frame - Wood	- Ext	(0.089)	13.0/0.0	318		3.28	1043 Btuh
11	Frame - Wood	- Ext	(0.089)	13.0/0.0	105		3.28	343 Btuh
12	Frame - Wood	- Ext	(0.089)	13.0/0.0	199		3.28	653 Btuh
13	Frame - Wood	- Ext	(0.089)	13.0/0.0	253		3.28	829 Btuh
14	Frame - Wood	- Ext	(0.089)	13.0/0.0	148		3.28	484 Btuh
15	Frame - Wood	- Adj	(0.089)	13.0/0.0	195		3.28	640 Btuh
16	Frame - Wood	- Adj	(0.089)	13.0/0.0	99		3.28	326 Btuh
Wall Total					1790(sqft)			5880 Btuh
Doors	Type	Storm	Ueff.		Area	X	HTM=	Load
1	Insulated - Exterior, n		(0.460)		20		17.0	340 Btuh
2	Insulated - Garage, n		(0.460)		18		17.0	303 Btuh
Door Total					38(sqft)			643Btuh
Ceilings	Type/Color/Surface		Ueff.	R-Value	Area	X	HTM=	Load
1	Flat ceil/D/Shing		(0.025)	38.0/0.0	2351		0.94	2208 Btuh
Ceiling Total					2351(sqft)			2208Btuh
Floors	Type		Ueff.	R-Value	Size	X	HTM=	Load
1	Slab On Grade		(1.180)	0.0	208.0 ft(perim.)		43.7	9081 Btuh
Floor Total					2137 sqft			9081 Btuh

Manual J Winter Calculations

Residential Load - Component Details (continued)

Norman, Almonte
SW Kicklighter Terr
Lake City, FL

Project Title:
Norman, Almonte
Building Type: User

4/8/2025

	Envelope Subtotal:						20754 Btuh
Infiltration	Type	Wholehouse	ACH	Volume(cuft)	Wall Ratio	CFM=	
	Natural		0.23	19233	1.00	73.7	2987 Btuh
Duct load	Average sealed, R6.0, Supply(Att), Return(Att)					(DLM of 0.250)	5924 Btuh
All Zones	Sensible Subtotal All Zones						29665 Btuh

WHOLE HOUSE TOTALS

Totals for Heating	Subtotal Sensible Heat Loss						29665 Btuh
	Ventilation Sens. Heat Loss (Ex:0 cfm; Sup:0 cfm)						0 Btuh
	Total Heat Loss						29665 Btuh

EQUIPMENT

1. Electric Heat Pump	#	39580 Btuh
-----------------------	---	------------

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)
U - (Window U-Factor)
HTM - (ManualJ Heat Transfer Multiplier)



Version 8

System Sizing Calculations - Summer

Residential Load - Whole House Component Details

Norman_Almonite
SW Kicklighter Terr
Lake City, FL

Project Title:
Norman_Almonite

4/8/2025

Reference City: Gainesville, FL (Defaults)
Humidity difference: 54gr.

Temperature Difference: 24.0F(MJ8 99%/Cu)
Summer Setpoint: 75 °F (Required Manual J default)

Component Loads for Whole House

Window	Type*						Overhang		Window Area(sqft)			HTM		Load
	Panes	SHGC	U	InSh	IS	Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded	
1	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	7.0	0.6	6.4	14	33	218 Btuh
2	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	27.6	1.3	26.2	14	33	878 Btuh
3	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	27.6	1.3	26.2	14	33	878 Btuh
4	2 NFRC	0.25, 0.36	No	No	W		1.5ft.	1.0ft.	15.5	0.7	14.8	14	33	494 Btuh
5	2 NFRC	0.25, 0.36	No	No	S		1.5ft.	1.0ft.	31.0	31.0	0.0	14	16	431 Btuh
6	2 NFRC	0.25, 0.36	No	No	S		1.5ft.	1.0ft.	4.0	4.0	0.0	14	16	56 Btuh
7	2 NFRC	0.25, 0.36	No	No	E		1.5ft.	1.0ft.	15.5	0.7	14.8	14	33	494 Btuh
8	2 NFRC	0.25, 0.36	No	No	E		9.5ft.	1.0ft.	31.0	31.0	0.0	14	33	431 Btuh
9	2 NFRC	0.25, 0.36	No	No	E		9.5ft.	1.0ft.	9.0	9.0	0.0	14	33	125 Btuh
10	2 NFRC	0.25, 0.36	No	No	E		9.5ft.	1.0ft.	17.8	17.8	0.0	14	33	247 Btuh
11	2 NFRC	0.25, 0.36	No	No	E		1.5ft.	1.0ft.	31.0	1.5	29.5	14	33	987 Btuh
12	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	1.0ft.	4.0	0.0	4.0	14	14	56 Btuh
	Excursion AE													
	Window Total								221 (sqft)					5456 Btuh
Walls	Type	U-Value		R-Value		Area(sqft)		HTM		Load				
1	Frame - Wood - Ext		0.09		13.0/0.0		68.0		2.7		184 Btuh			
2	Frame - Wood - Ext		0.09		13.0/0.0		18.0		2.7		49 Btuh			
3	Frame - Wood - Ext		0.09		13.0/0.0		77.4		2.7		210 Btuh			
4	Frame - Wood - Ext		0.09		13.0/0.0		18.0		2.7		49 Btuh			
5	Frame - Wood - Ext		0.09		13.0/0.0		37.0		2.7		100 Btuh			
6	Frame - Wood - Ext		0.09		13.0/0.0		18.0		2.7		49 Btuh			
7	Frame - Wood - Ext		0.09		13.0/0.0		80.4		2.7		218 Btuh			
8	Frame - Wood - Ext		0.09		13.0/0.0		54.0		2.7		146 Btuh			
9	Frame - Wood - Ext		0.09		13.0/0.0		104.5		2.7		283 Btuh			
10	Frame - Wood - Ext		0.09		13.0/0.0		317.5		2.7		860 Btuh			
11	Frame - Wood - Ext		0.09		13.0/0.0		104.5		2.7		283 Btuh			
12	Frame - Wood - Ext		0.09		13.0/0.0		198.7		2.7		538 Btuh			
13	Frame - Wood - Ext		0.09		13.0/0.0		252.5		2.7		684 Btuh			
14	Frame - Wood - Ext		0.09		13.0/0.0		147.5		2.7		399 Btuh			
15	Frame - Wood - Adj		0.09		13.0/0.0		195.0		2.1		415 Btuh			
16	Frame - Wood - Adj		0.09		13.0/0.0		99.2		2.1		211 Btuh			
	Wall Total								1790 (sqft)			4677 Btuh		
Doors	Type	Area (sqft)		HTM		Load								
1	Insulated - Exterior		20.0		16.1		322 Btuh							
2	Insulated - Garage		17.8		16.1		286 Btuh							
	Door Total		38 (sqft)		608 Btuh									
Ceilings	Type/Color/Surface	U-Value	R-Value	Area(sqft)	HTM	Load								
1	Vented Attic/DarkShingle/RB	0.025	38.0/0.0	2350.7	1.24	2923 Btuh								
	Ceiling Total				2351 (sqft)		2923 Btuh							
Floors	Type	R-Value		Size	HTM	Load								
1	Slab On Grade	0.0		2137 (ft-perimeter)	0.0	0 Btuh								
	Floor Total				2137.0 (sqft)		0 Btuh							
	Envelope Subtotal:					13664 Btuh								

Manual J Summer Calculations

Residential Load - Component Details (continued)

Norman_Almonte
SW Kicklighter Terr
Lake City, FL

Project Title: Climate:FL_GAINESVILLE_REGIONAL_A
Norman_Almonte

4/8/2025

Infiltration	Type Natural	Average ACH 0.17	Volume(cuft) 19233	Wall Ratio 1	CFM= 55.3	Load 1453 Btuh
Internal gain		Occupants 1	Btuh/occupant X 230	Appliance +	1200	Load 1430 Btuh
					Sensible Envelope Load:	16547 Btuh
Duct load	Average sealed,Supply(R6.0-Attic), Return(R6.0-Attic)				(DGM of 0.421)	6971 Btuh
					Sensible Load All Zones	23518 Btuh

Manual J Summer Calculations

Residential Load - Component Details (continued)

Norman_Almonte
SW Kicklighter Terr
Lake City, FL

Project Title:
Norman_Almonte

Climate:FL_GAINESVILLE_REGIONAL_A

4/8/2025

WHOLE HOUSE TOTALS

Whole House Totals for Cooling	Sensible Envelope Load All Zones	16547 Btuh
	Sensible Duct Load	6971 Btuh
	Total Sensible Zone Loads	23518 Btuh
	Sensible ventilation (Ex:0 cfm; Sup:0 cfm)	0 Btuh
	Blower	0 Btuh
	Total sensible gain	23518 Btuh
	Latent infiltration gain (for 54 gr. humidity difference)	2021 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	1668 Btuh
	Latent occupant gain (1.0 people @ 200 Btuh per person)	200 Btuh
	Latent other gain	0 Btuh
	Latent total gain	3890 Btuh
	TOTAL GAIN	27408 Btuh

EQUIPMENT

1. Central Unit	#	39500 Btuh
-----------------	---	------------

*Key: Window types (Panels - Number and type of panes of glass)

(SHGC - Shading coefficient of glass as SHGC numerical value)

(U - Window U-Factor)

(InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))

- For Blinds: Assume medium color, half closed

For Draperies: Assume medium weave, half closed

For Roller shades: Assume translucent, half closed

(IS - Insect screen: none(N), Full(F) or Half(½))


(Ornt - compass orientation)



Version 8

WM Design & Associates, Inc.
426 SW Commerce Drive, Suite 135
LAKE CITY, FL 32025
(386)758-8406
will@willmyers.net

Invoice



BILL TO
ChrisMill Homes of Florida

INVOICE #	DATE	TOTAL DUE	DUE DATE	TERMS	ENCLOSED
2802	04/08/2025	\$350.00	04/08/2025	Due on receipt	

DESCRIPTION	QTY	RATE	AMOUNT
Norman_Almonte - Florida Energy Code & Manual J System Sizing Calculations	1	350.00	350.00

Thank you for your business!

BALANCE DUE

\$350.00