


STATE OF FLORIDA
DEPARTMENT OF HEALTH
APPLICATION FOR CONSTRUCTION PERMIT

Permit Application Number

1120 Pump
13-0137

----- PART II - SITEPLAN -----

Scale: Each block represents 10 feet and 1 inch = 40 feet.

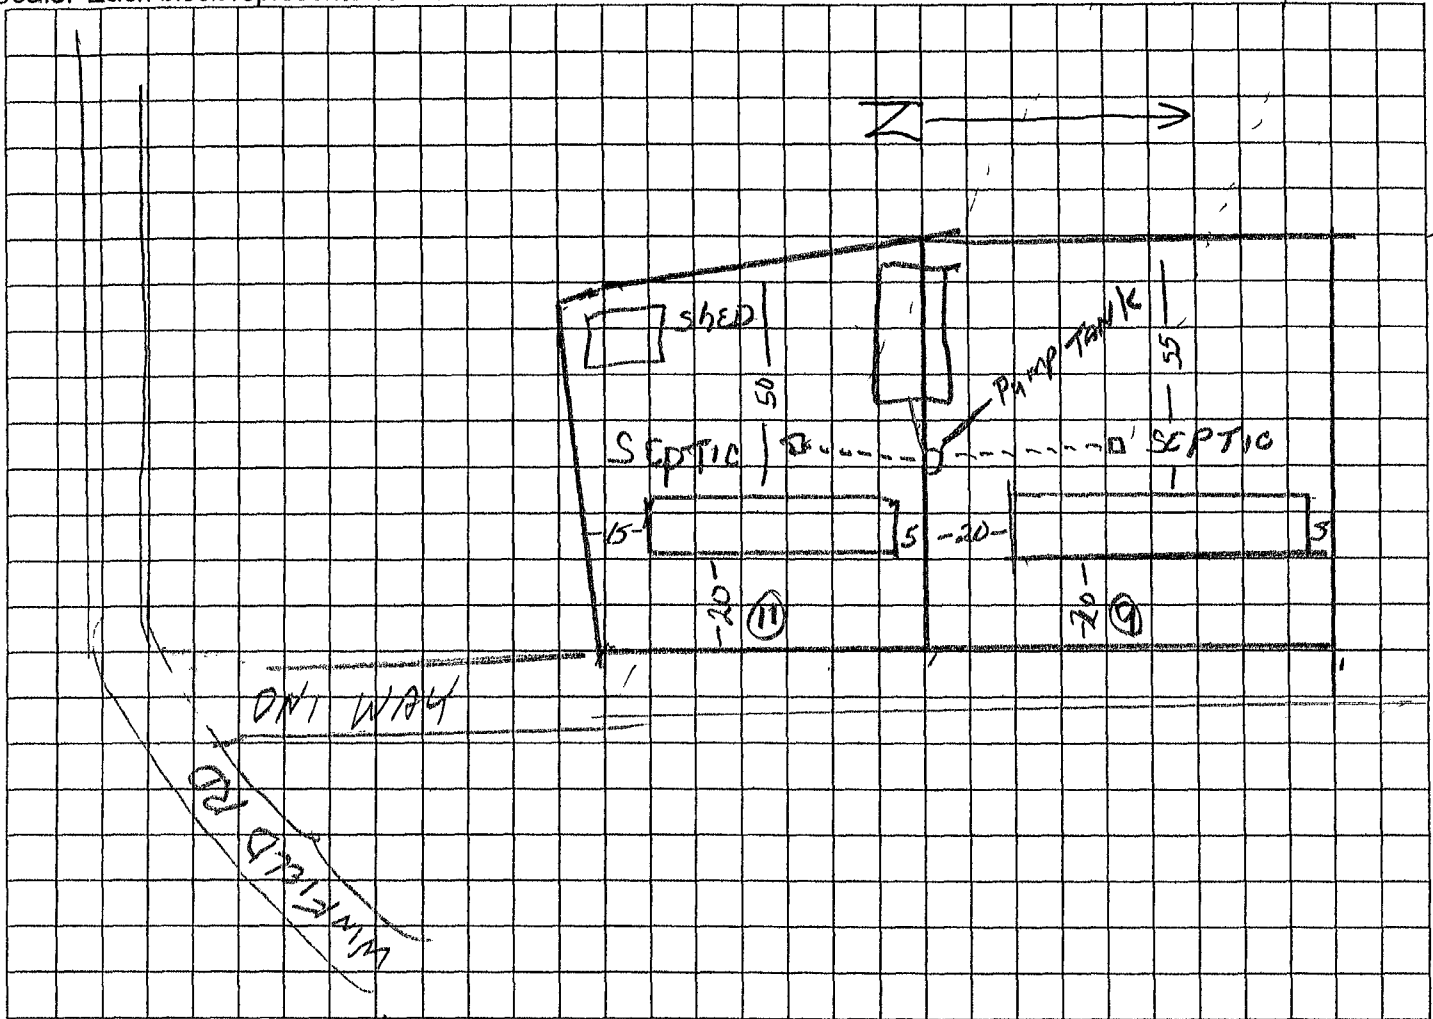

Notes: See attached

Site Plan submitted by: 313 Allen

OWNER

Plan Approved X

Not Approved

Date 5.14.13

By [Signature] Colson

County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION PERMIT

PERMIT #: 12-SC-1461192
APPLICATION #: AP1100895
DATE PAID: _____
FEE PAID: _____
RECEIPT #: _____
DOCUMENT #: PR902980

CONSTRUCTION PERMIT FOR: OSTDS New
APPLICANT: WILLIE*13-0137 ALLEN
PROPERTY ADDRESS: WINFIELD Lake City, FL 32055
LOT: _____ BLOCK: _____ SUBDIVISION: _____
PROPERTY ID #: 01877-000 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [1,200] GALLONS / GPD _____ Septic _____ CAPACITY
A [] GALLONS / GPD _____ CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K [375] GALLONS DOSING TANK CAPACITY [] GALLONS @ [6] DOSES PER 24 HRS #Pumps [1]
D [625] SQUARE FEET _____ Drainfield _____ SYSTEM
R [] SQUARE FEET _____ SYSTEM
A TYPE SYSTEM: [] STANDARD [] FILLED [x] MOUND [] _____
I CONFIGURATION: [x] TRENCH [] BED [] _____
N
F LOCATION OF BENCHMARK: Nail in oak tree west of system site
I ELEVATION OF PROPOSED SYSTEM SITE [25 00] [INCHES / FT] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT
E BOTTOM OF DRAINFIELD TO BE [15 00] [INCHES / FT] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT
L
D FILL REQUIRED: [28 00] INCHES EXCAVATION REQUIRED: [00 0] INCHES

O
T
H
E
R
Permit for lots 9 and 11 of Winfield Mobile Home Park for two SW mobile homes
1) Performing lift dosing Pumps must be certified as suitable for distributing sewage effluent
2) Maintain at least 100' from limited use well that serves the property
3) Per 64E-8 001(9), no more than fourteen (14) connections are permitted for a single limited use water system
4) While not required, the property owner requests that separate septic tanks are to be installed for each residence with a shared lift station For this scenario, each residence must have at least a 900 gallon tank The size of the pump tank will not change

SPECIFICATIONS BY: Jeremy X Gifford TITLE: Environmental Specialist I
APPROVED BY: Jeremy X Gifford TITLE: Environmental Specialist I Columbia CHD
DATE ISSUED: 05/10/2013 EXPIRATION DATE: 10/11/2014
DH 4016, 08/09 (Obsoletes all previous editions which may not be used)
Incorporated: 64E-6.003, FAC



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 13-0137
DATE PAID: 3/14/13
FEE PAID: 12500
RECEIPT #: 1100825

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Willie B Allen

AGENT: OWNER TELEPHONE: (386) 397-0917

MAILING ADDRESS: 377 NW Senior Ct. - Lake City, Fla. 32055

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: 9411 BLOCK: S SUBDIVISION: Winfield M/H Park PLATTED:

PROPERTY ID #: R 35-20^S-16-01877-000 ZONING: I/M OR EQUIVALENT: ☐ Y ☐ N

PROPERTY SIZE: 10 ACRES WATER SUPPLY: ☐ PRIVATE PUBLIC ☒ $\leq 2000\text{GPD}$ ☐ $> 2000\text{GPD}$

IS SEWER AVAILABLE AS PER 381.0065, FS? ☐ Y ☐ N DISTANCE TO SEWER: FT

PROPERTY ADDRESS:

DIRECTIONS TO PROPERTY: 41 North to winfield rd. turn left - 400 yds turn right on One way go 100 yds Lots on left

BUILDING INFORMATION

☐ RESIDENTIAL

☐ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	1 SW MH	3	980	2 SW MH 1 connection
2	1 SW MH	3	980	2(750) = 500 GPD
3				
4				Held for pumpout

☐ Floor/Equipment Drains ☐ Other (Specify)

SIGNATURE: W B Allen DATE: 3-14-13