

# Residential System Sizing Calculation

## Summary

TBD  
Anyplace  
Lake City, FL 32055

Project Title:  
Trent Geibeig Lot 57 Crosswinds Sub




Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(164 ft.) Temp Range(M)					
Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(51gr.)					
Winter design temperature(TMY3 99%)	30	F	Summer design temperature(TMY3 99%)	94	F
Winter setpoint	70	F	Summer setpoint	75	F
Winter temperature difference	40	F	Summer temperature difference	19	F
<b>Total heating load calculation</b>	<b>18033</b>	<b>Btuh</b>	<b>Total cooling load calculation</b>	<b>14799</b>	<b>Btuh</b>
Submitted heating capacity	% of calc	Btuh	Submitted cooling capacity	% of calc	Btuh
Total (Electric Heat Pump)	100.0	18033	Sensible (SHR = 0.75)	90.3	11099
Heat Pump + Auxiliary(0.0kW)	100.0	18033	Latent	147.8	3700
			Total (Electric Heat Pump)	100.0	14799

## WINTER CALCULATIONS

Winter Heating Load (for 1660 sqft)


Load component		Load	
Window total	142 sqft	2272	Btuh
Wall total	1411 sqft	4560	Btuh
Door total	78 sqft	1335	Btuh
Ceiling total	1660 sqft	2115	Btuh
Floor total	1660 sqft	2424	Btuh
Infiltration	57 cfm	2507	Btuh
Duct loss		2820	Btuh
<b>Subtotal</b>		<b>18033</b>	<b>Btuh</b>
Ventilation	Ex:0 cfm; Sup:0 cfm	0	Btuh
<b>TOTAL HEAT LOSS</b>		<b>18033</b>	<b>Btuh</b>

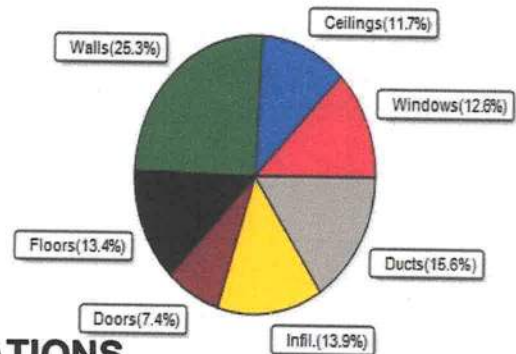

## SUMMER CALCULATIONS

Summer Cooling Load (for 1660 sqft)

Load component		Load	
Window total	142 sqft	1755	Btuh
Wall total	1411 sqft	1877	Btuh
Door total	78 sqft	1001	Btuh
Ceiling total	1660 sqft	2326	Btuh
Floor total		0	Btuh
Infiltration	43 cfm	893	Btuh
Internal gain		1890	Btuh
Duct gain		2553	Btuh
Sens.Ventilation	Ex:0 cfm; Sup:0 cfm	0	Btuh
Blower Load		0	Btuh
<b>Total sensible gain</b>		<b>12296</b>	<b>Btuh</b>
Latent gain(ducts)		421	Btuh
Latent gain(infiltration)		1482	Btuh
Latent gain(ventilation)		0	Btuh
Latent gain(internal/occupants/other)		600	Btuh
<b>Total latent gain</b>		<b>2503</b>	<b>Btuh</b>
<b>TOTAL HEAT GAIN</b>		<b>14799</b>	<b>Btuh</b>

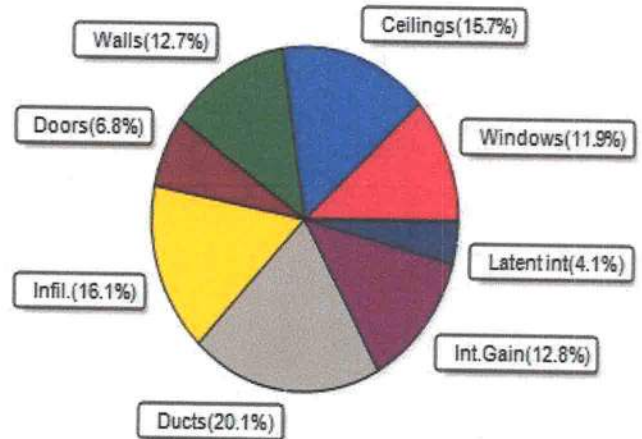

8th Edition

EnergyGauge® System Sizing

PREPARED BY: *William H. Freeman*

DATE: 1/28/24

## **RESIDENTIAL ENERGY CONSERVATION CODE DOCUMENTATION CHECKLIST**

### **Florida Department of Business and Professional Regulation Simulated Performance Alternative (Performance) Method**

**Applications for compliance with the 2023 Florida Building Code, Energy Conservation via the Residential Simulated Performance Alternative shall include:**

- ☒ This checklist
- ☒ Form R405-2023 report
- ☒ Input summary checklist that can be used for field verification (usually four pages/may be greater)
- ☒ Energy Performance Level (EPL) Display Card (one page)
- ☒ HVAC system sizing and selection based on ACCA Manual S or per exceptions provided in Section R403.7
- ☒ Mandatory Requirements (five pages)

**Required prior to CO:**

- ☒ Air Barrier and Insulation Inspection Component Criteria checklist (Table R402.4.1.1 - one page)
- ☒ A completed 2023 Envelope Leakage Test Report (usually one page); exception in R402.4 allows dwelling units of R-2 Occupancies and multiple attached single family dwellings to comply with Section C402.5
- ☒ If Form R405 duct leakage type indicates anything other than "default leakage", then a completed 2023 Duct Leakage Test Report - Performance Method (usually one page)



# FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Business and Professional Regulation - Residential Performance Method

<p>Project Name: Trent Geibeig Lot 57 Crosswinds Sub          Street: Anyplace          City, State, Zip: Lake City, FL, 32055          Owner: TBD          Design Location: FL, Gainesville</p>	<p>Builder Name: Trent Giegeig          Permit Office: Columbia County          Permit Number:          Jurisdiction: Columbia County          County: Columbia(Florida Climate Zone 2)</p>
--	---

<p>1. New construction or existing      New (From Plans)          2. Single family or multiple family      Attached          3. Number of units, if multiple family      1          4. Number of Bedrooms      3          5. Is this a worst case?      No          6. Conditioned floor area above grade (ft<sup>2</sup>)      1660             Conditioned floor area below grade (ft<sup>2</sup>)      0          7. Windows(142.0 sqft.)      Description      Area             a. U-Factor:      Dbl, U=0.40      142.00 ft<sup>2</sup>                  SHGC:      SHGC=0.25             b. U-Factor:      N/A      ft<sup>2</sup>                  SHGC:             c. U-Factor:      N/A      ft<sup>2</sup>                  SHGC:             Area Weighted Average Overhang Depth:      1.289 ft             Area Weighted Average SHGC:      0.250          8. Skylights      Description      Area             U-Factor:(AVG)      N/A      N/A ft<sup>2</sup>             SHGC(AVG):      N/A          9. Floor Types      Insulation      Area             a. Slab-On-Grade Edge Insulation      R= 13.0      1660.00 ft<sup>2</sup>             b. N/A      R=      ft<sup>2</sup>             c. N/A      R=      ft<sup>2</sup></p>	<p>10. Wall Types(1630.9 sqft.)      Insulation      Area             a. Face Brick - Wood, Exterior      R=13.0      1408.90 ft<sup>2</sup>             b. Frame - Wood, Adjacent      R=13.0      180.00 ft<sup>2</sup>             c. Face Brick - Wood, Adjacent      R=13.0      42.00 ft<sup>2</sup>             d. N/A          11. Ceiling Types(1660.0 sqft.)      Insulation      Area             a. Flat ceiling under att (Vented)      R=30.0      1660.00 ft<sup>2</sup>             b. N/A             c. N/A          12. Roof(Comp. Shingles, Vented)      Deck R=0.0      1856 ft<sup>2</sup>          13. Ducts, location &amp; insulation level      R      ft<sup>2</sup>             a. Sup: Attic, Ret: Main, AH: Main      8      400             b.             c.          14. Cooling Systems      kBtu/hr      Efficiency             a. Central Unit      14.8      SEER2:15.00           15. Heating Systems      kBtu/hr      Efficiency             a. Electric Heat Pump      18.0      HSPF2:7.70           16. Hot Water Systems             a. Electric      Cap: 50 gallons             EF: 0.920             b. Conservation features           17. Credits      None             CF</p>
--	---

Glass/Floor Area: 0.086

Total Proposed Modified Loads: 41.35

Total Baseline Loads: 46.19

**PASS**

NOTE: Proposed residence must have annual total normalized Modified Loads that are less than or equal to 95 percent of the annual total loads of the standard reference design in order to comply.

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.

PREPARED BY: William H. Freeman

DATE: 1/28/24

I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.

OWNER/AGENT: \_\_\_\_\_

DATE: \_\_\_\_\_

Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.



BUILDING OFFICIAL: \_\_\_\_\_

DATE: \_\_\_\_\_

- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with R403.3.2.1.
- Compliance with a proposed duct leakage Qn requires a PERFORMANCE Duct Leakage Test Report confirming duct leakage to outdoors, tested in accordance with ANSI/RESNET/ICC 380, is not greater than 0.040 Qn for whole house.
- Compliance requires a roof absorptance test and a roof emittance test in accordance with R405.7.2
- Compliance requires an Air Barrier and Insulation Inspection Checklist in accordance with R402.4.1.1 and this project requires a PERFORMANCE envelope leakage test report with envelope leakage no greater than 7.00 ACH50 (R402.4.1.2).

## INPUT SUMMARY CHECKLIST REPORT

## PROJECT

Title:	Trent Geibeig Lot 57 Crosswinds Sub	Bedrooms:	3	Address type:	Lot
Building Type:	User	Conditioned Area:	1660	Lot #:	57
Owner:	TBD	Total Stories:	1	Block/SubDivision:	Crosswinds
Builder Home ID:		Worst Case:	No	PlatBook:	
Builder Name:	Trent Giegeig	Rotate Angle:	0	Street:	Anyplace
Permit Office:	Columbia County	Cross Ventilation:	No	County:	Columbia
Jurisdiction:	Columbia County	Whole House Fan:	No	City, State, Zip:	Lake City, FL, 32055
Family Type:	Attached	Terrain:	Suburban		
New/Existing:	New (From Plans)	Shielding:	Suburban		
Year Construct:	2023				
Comment:					

## CLIMATE

✓ Design Location	Tmy Site	Design Temp	97.5%	2.5%	Int Design Temp	Winter	Summer	Heating Degree Days	Design Moisture	Daily temp Range
___ FL, Gainesville	FL_GAINESVILLE_REGIONA	32	92	70	75	1305.5	51	Medium		

## BLOCKS

✓ Number	Name	Area	Volume
___ 1	Block1	1660	14940 cu ft

## SPACES

✓ Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Finished	Cooled	Heated
___ 1	Main	1660	14940	Yes	3	3	Yes	Yes	Yes

## FLOORS

(Total Exposed Area = 1660 sq.ft.)

✓ #	Floor Type	Space	Exposed Perim(ft)	Area	R-Value Perim.	U-Factor Joist	Slab Insul. Vert/Horiz	Tile	Wood	Carpet
___ 1	Slab-On-Grade Edge Ins	Main	190	1660 sqft	13	---	0.068	2 (ft)/0 (ft)	0.25	0.50 0.25

## ROOF

✓ #	Type	Materials	Roof Area	Gable Area	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
___ 1	Hip	Composition shingles	1856 ft²	0 ft²	Medium	N	0.75	Yes	0.9	Yes	0	26.57

## ATTIC

✓ #	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
___ 1	Full attic	Vented	300	1660 ft²	N	N

## CEILING

(Total Exposed Area = 1660 sq.ft.)

✓ #	Ceiling Type	Space	R-Value	Ins. Type	Area	U-Factor	Framing Frac.	Truss Type
___ 1	Flat ceiling under attic(Vented)	Main	30.0	Blown	1660.0ft²	0.030	0.11	Wood



# INPUT SUMMARY CHECKLIST REPORT

WALLS															(Total Exposed Area = 1631 sq.ft.)			
✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area sq.ft.	U-Factor	Sheath R-Value	Frm. Frac.	Solar Absor.	Below Grade			
___ 1	N	Exterior	Face Brick - Wood	Main	13.0	24.0	8	9.0	0	222.0	0.086		0.23	0.75	0 %			
___ 2	N	Exterior	Face Brick - Wood	Main	13.0	14.0	0	9.0	0	126.0	0.086		0.23	0.75	0 %			
___ 3	N	Exterior	Face Brick - Wood	Main	13.0	13.0	6	9.0	0	121.5	0.086		0.23	0.75	0 %			
___ 4	E	Exterior	Face Brick - Wood	Main	13.0	30.0	1	9.0	0	270.8	0.086		0.23	0.75	0 %			
___ 5	S	Exterior	Face Brick - Wood	Main	13.0	13.0	1	9.0	0	117.8	0.086		0.23	0.75	0 %			
___ 6	W	Exterior	Face Brick - Wood	Main	13.0	8.0	4	9.0	0	75.0	0.086		0.23	0.75	0 %			
___ 7	S	Exterior	Face Brick - Wood	Main	13.0	8.0	0	9.0	4	74.7	0.086		0.23	0.75	0 %			
___ 8	E	Garage	Face Brick - Wood	Main	13.0	4.0	8	9.0	0	42.0	0.086		0.23	0.75	0 %			
___ 9	S	Exterior	Face Brick - Wood	Main	13.0	14.0	6	9.0	0	130.5	0.086		0.23	0.75	0 %			
___ 10	S	Garage	Frame - Wood	Main	13.0	20.0	0	9.0	0	180.0	0.084		0.23	0.75	0 %			
___ 11	W	Exterior	Face Brick - Wood	Main	13.0	30.0	1	9.0	0	270.8	0.086		0.23	0.75	0 %			

DOORS											(Total Exposed Area = 78 sq.ft.)		
✓ #	Ornt	Adjacent To	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area		
___ 1	N		Insulated	Main	None	0.40	6.00	0	6.00	8	40.0ft²		
___ 2	S		Wood	Main	None	0.46	3.00	0	6.00	8	20.0ft²		
___ 3	S		Wood	Main	None	0.46	2.00	8	6.00	8	17.8ft²		

WINDOWS															(Total Exposed Area = 142 sq.ft.)			
✓ #	Ornt	Wall ID	Frame	Panes	NFRC U-Factor	SHGC	Imp	Storm	Total Area (ft²)	Same Units	Width (ft)	Height (ft)	—Overhang— Depth (ft)	Sep. (ft)	Interior Shade	Screen		
___ 1	N	1	Vinyl	Low-E Double	Y	0.40	0.25	N	N	30.0	1	6.00	5.00	1.0	1.0	IECC 2012	None	
___ 2	N	1	Vinyl	Low-E Double	Y	0.40	0.25	N	N	15.0	1	3.00	5.00	0.5	1.0	Drapes/blinds	None	
___ 3	N	3	Vinyl	Low-E Double	Y	0.40	0.25	N	N	15.0	1	3.00	5.00	1.5	1.0	Drapes/blinds	None	
___ 4	S	5	Vinyl	Low-E Double	Y	0.40	0.25	N	N	18.0	1	3.00	6.00	1.5	1.0	Drapes/blinds	None	
___ 5	S	9	Vinyl	Low-E Double	Y	0.40	0.25	N	N	36.0	1	6.00	6.00	1.5	1.0	Drapes/blinds	None	
___ 6	W	11	Vinyl	Low-E Double	Y	0.40	0.25	N	N	8.0	1	2.00	4.00	1.5	1.0	Drapes/blinds	None	
___ 7	W	11	Vinyl	Low-E Double	Y	0.40	0.25	N	N	20.0	2	2.00	5.00	1.5	1.0	Drapes/blinds	None	

INFILTRATION											
✓ #	Scope	Method	SLA	CFM50	ELA	EqLA	ACH	ACH50	Space(s)	Infiltration Test Volume	
___ 1	Wholehouse	Proposed ACH(50)	0.00040	1743	95.63	179.53	0.1438	7.0	All	14940 cu ft	

GARAGE					
✓ #	Floor Area	Roof Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
___ 1	400 ft²	400 ft²	60 ft	9 ft	13

MASS					
✓ #	Mass Type	Area	Thickness	Furniture Fraction	Space
___ 1	Default(8lbs/sq.ft.)	0 ft²	0 ft	0.30	Main

# INPUT SUMMARY CHECKLIST REPORT

## HEATING SYSTEM

✓ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	—Geothermal HeatPump— Entry Power Volt Current				Ducts	Block
1	Electric Heat Pump	None/Single		HSPF2: 7.70	18.0	0.00	0.00	0.00	sys#1	1	

## COOLING SYSTEM

✓ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	Air Flow cfm	SHR	Duct	Block
1	Central Unit	Split/Single		SEER2:15.0	14.8	450	0.75	sys#1	1

## HOT WATER SYSTEM

✓ #	System Type	Subtype	Location	EF(UEF)	Cap	Use	SetPnt	Fixture Flow	Pipe Ins.	Pipe length
1	Electric	None	Garage	0.92 (0.92)	50.00 gal	60 gal	120 deg	Standard	=>R-3	99
	Recirculation System	Recirc Control Type	Loop length	Branch length	Pump power	DWHR	Facilities Connected	Equal Flow	DWHR Eff	Other Credits
1	No		NA	NA	NA	No	NA	NA	NA	None

## DUCTS

✓ Duct #	Location	Supply R-Value	Area	Return R-Value	Area	Leakage Type	Air Handler	CFM 25 TOT	CFM 25 OUT	QN	RLF	HVAC # Heat Cool
1	Attic	8.0	400 ft²	Main	6.0	100 ft²	Proposed Qn	Main	—	—	0.040 0.50	1 1

## TEMPERATURES

Programable Thermostat: N				Ceiling Fans: N									
Cooling	[X] Jan	[X] Feb	[X] Mar	[X] Apr	[X] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[X] Oct	[X] Nov	[X] Dec	
Heating	[X] Jan	[X] Feb	[X] Mar	[X] Apr	[X] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[X] Oct	[X] Nov	[X] Dec	
Venting	[X] Jan	[X] Feb	[X] Mar	[X] Apr	[X] May	[X] Jun	[X] Jul	[X] Aug	[X] Sep	[X] Oct	[X] Nov	[X] Dec	

✓ Thermostat Schedule: FloridaCode 2014	Schedule Type	1	2	3	4	5	6	Hours	7	8	9	10	11	12
Cooling (WD)	AM PM	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75
Cooling (WEH)	AM PM	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75	75 75
Heating (WD)	AM PM	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72
Heating (WEH)	AM PM	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72	72 72

# ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

## ESTIMATED ENERGY PERFORMANCE INDEX\* = 90

The lower the EnergyPerformance Index, the more efficient the home.

Anyplace, Lake City, FL, 32055

<p>1. New construction or existing</p> <p>2. Single family or multiple family</p> <p>3. Number of units, if multiple family</p> <p>4. Number of Bedrooms</p> <p>5. Is this a worst case?</p> <p>6. Conditioned floor area above grade (ft<sup>2</sup>)</p> <p>Conditioned floor area below grade (ft<sup>2</sup>)</p> <p>7. Windows**</p> <p style="margin-left: 20px;">a. U-Factor: Dbl, U=0.40</p> <p style="margin-left: 20px;">SHGC: SHGC=0.25</p> <p style="margin-left: 20px;">b. U-Factor: N/A</p> <p style="margin-left: 20px;">SHGC:</p> <p style="margin-left: 20px;">c. U-Factor: N/A</p> <p style="margin-left: 20px;">SHGC:</p> <p>Area Weighted Average Overhang Depth:</p> <p>Area Weighted Average SHGC:</p> <p>8. Skylights</p> <p style="margin-left: 20px;">U-Factor:(AVG)</p> <p style="margin-left: 20px;">SHGC(AVG):</p> <p>9. Floor Types</p> <p style="margin-left: 20px;">a. Slab-On-Grade Edge Insulation</p> <p style="margin-left: 20px;">b. N/A</p> <p style="margin-left: 20px;">c. N/A</p>	<p>New (From Plans)</p> <p>Attached</p> <p>1</p> <p>3</p> <p>No</p> <p>1660</p> <p>0</p> <p>Area</p> <p>142.00 ft<sup>2</sup></p> <p>ft<sup>2</sup></p> <p>ft<sup>2</sup></p> <p>1.289 ft</p> <p>0.250</p> <p>Description</p> <p>N/A</p> <p>N/A</p> <p>Insulation</p> <p>R= 13.0</p> <p>R=</p> <p>R=</p> <p>Area</p> <p>1660.00 ft<sup>2</sup></p> <p>ft<sup>2</sup></p> <p>ft<sup>2</sup></p>	<p>10. Wall Types(1630.9 sqft.)</p> <p style="margin-left: 20px;">a. Face Brick - Wood, Exterior</p> <p style="margin-left: 20px;">b. Frame - Wood, Adjacent</p> <p style="margin-left: 20px;">c. Face Brick - Wood, Adjacent</p> <p style="margin-left: 20px;">d. N/A</p> <p>11. Ceiling Types(1660.0 sqft.)</p> <p style="margin-left: 20px;">a. Flat ceiling under att (Vented)</p> <p style="margin-left: 20px;">b. N/A</p> <p style="margin-left: 20px;">c. N/A</p> <p>12. Roof(Comp. Shingles, Vented)</p> <p>13. Ducts, location &amp; insulation level</p> <p style="margin-left: 20px;">a. Sup: Attic, Ret: Main, AH: Main</p> <p style="margin-left: 20px;">b.</p> <p style="margin-left: 20px;">c.</p> <p>14. Cooling Systems</p> <p style="margin-left: 20px;">a. Central Unit</p> <p>15. Heating Systems</p> <p style="margin-left: 20px;">a. Electric Heat Pump</p> <p>16. Hot Water Systems</p> <p style="margin-left: 20px;">a. Electric</p> <p style="margin-left: 20px;">b. Conservation features</p> <p>17. Credits</p>	<p>Insulation</p> <p>R=13.0</p> <p>R=13.0</p> <p>R=13.0</p> <p>Insulation</p> <p>R=30.0</p> <p>Deck R=0.0</p> <p>R</p> <p>8</p> <p>kBtu/hr</p> <p>14.8</p> <p>kBtu/hr</p> <p>18.0</p> <p>Cap: 50 gallons</p> <p>EF: 0.920</p> <p>None</p> <p>CF</p> <p>Area</p> <p>1408.90 ft<sup>2</sup></p> <p>180.00 ft<sup>2</sup></p> <p>42.00 ft<sup>2</sup></p> <p>Area</p> <p>1660.00 ft<sup>2</sup></p> <p>1856 ft<sup>2</sup></p> <p>400</p> <p>Efficiency</p> <p>SEER2:15.00</p> <p>Efficiency</p> <p>HSPF2:7.70</p>
---	--	--	---

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Address of New Home: Anyplace City/FL Zip: Lake City, FL, 32055



\*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida Energy Rating. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

\*\*Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.



# Florida Building Code, Energy Conservation, 8th Edition (2023)

## Mandatory Requirements for Residential Performance, Prescriptive and ERI Methods

ADDRESS: Anyplace  
Lake City, FL 32055

Permit Number:

### MANDATORY REQUIREMENTS - See individual code sections for full details.

#### SECTION R401 GENERAL

- ☐ **R401.3 Energy Performance Level (EPL) display card - (Mandatory).** The building official shall require that an energy performance level (EPL) display card be completed and certified by the builder to be accurate and correct before final approval of the building for occupancy. Florida law (Section 553.9085, Florida Statutes) requires the EPL display card to be included as an addendum to each sales contract for both presold and nonpresold residential buildings. The EPL display card contains information indicating the energy performance level and efficiencies of components installed in a dwelling unit. The building official shall verify that the EPL display card completed and signed by the builder accurately reflects the plans and specifications submitted to demonstrate code compliance for the building. A copy of the EPL display card can be found in Appendix RD.

#### SECTION R402 BUILDING THERMAL ENVELOPE

- ☐ **R402.2.10.1 Slab-on-grade floor insulation installation (Mandatory).** Where installed, the insulation shall extend downward from the top of the slab on the outside or inside of the foundation wall. Insulation located below grade shall be extended the distance provided in Table R402.1.2, or the distance of the proposed design as applicable, by any combination of vertical insulation, insulation extending under the slab or insulation extending out from the building. Insulation extending away from the building shall be protected by pavement or by not less than 10 inches (254 mm) of soil. The top edge of the insulation installed between the exterior wall and the edge of the interior slab shall be permitted to be cut at a 45-degree (0.79 rad) angle away from the exterior wall.
  - ☐ **R402.2.11.1 Crawl space walls insulation installation (Mandatory).** Where crawl space wall insulation is installed, it shall be permanently fastened to the wall and extend downward from the floor to the finished grade level and then vertically and/or horizontally for at least an additional 24 inches (610 mm). Exposed earth in unvented crawl space foundations shall be covered with a continuous Class I vapor retarder in accordance with the Florida Building Code, Building, or Florida Building Code, Residential, as applicable. All joints of the vapor retarder shall overlap by 6 inches (153 mm) and be sealed or taped. The edges of the vapor retarder shall extend not less than 6 inches (153 mm) up the stem wall and shall be attached to the stem wall.
  - ☐ **R402.4 Air leakage (Mandatory).** The building thermal envelope shall be constructed to limit air leakage in accordance with the requirements of Sections R402.4.1 through R402.4.5.
    - Exception:** Dwelling units of R-2 Occupancies and multiple attached single family dwellings shall be permitted to comply with Section C402.5.
  - ☐ **R402.4.1 Building thermal envelope.** The building thermal envelope shall comply with Sections R402.4.1.1 and R402.4.1.2. The sealing methods between dissimilar materials shall allow for differential expansion and contraction.
  - ☐ **R402.4.1.1 Installation.** The components of the building thermal envelope as listed in Table R402.4.1.1 shall be installed in accordance with the manufacturer's instructions and the criteria listed in Table R402.4.1.1, as applicable to the method of construction. Where required by the code official, an approved third party shall inspect all components and verify compliance.
  - ☐ **R402.4.1.2 Testing.** The building or dwelling unit shall be tested and verified as having an air leakage rate not exceeding seven air changes per hour in Climate Zones 1 and 2, and three air changes per hour in Climate Zones 3 through 8. Dwelling units with an air leakage rate less than three air changes per hour shall be provided with whole-house mechanical ventilation in accordance with Section R403.6.1 of this code and Section M1507.3 of the Florida Building Code, Residential. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.
    - Exception:** Testing is not required for additions, alterations, renovations, or repairs, of the building thermal envelope of existing buildings in which the new construction is less than 85 percent of the building thermal envelope.
- During testing:
1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
  2. Dampers including exhaust, intake, makeup air, backdraft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
  3. Interior doors, if installed at the time of the test, shall be open.
  4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
  5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
  6. Supply and return registers, if installed at the time of the test, shall be fully open.
  7. If an attic is both air sealed and insulated at the roof deck, interior access doors and hatches between the conditioned space volume and the attic shall be opened during the test and the volume of the attic shall be added to the conditioned space volume for purposes of reporting an infiltration volume and calculating the air leakage of the home.



## Florida Building Code, Energy Conservation, Mandatory Requirements (2023 Continued)

- ☐ **R402.4.2 Fireplaces.** New wood-burning fireplaces shall have tight-fitting flue dampers or doors, and outdoor combustion air. Where using tight-fitting doors on factory-built fireplaces listed and labeled in accordance with UL 127, the doors shall be tested and listed for the fireplace. Where using tight-fitting doors on masonry fireplaces, the doors shall be listed and labeled in accordance with UL 907.
- ☐ **R402.4.3 Fenestration air leakage.** Windows, skylights and sliding glass doors shall have an air infiltration rate of no more than 0.3 cfm per square foot (1.5 L/s/m<sup>2</sup>), and swinging doors no more than 0.5 cfm per square foot (2.6 L/s/m<sup>2</sup>), when tested according to NFRC 400 or AAMA/WDMA/CSA 101/I.S.2/A440 by an accredited, independent laboratory and listed and labeled by the manufacturer.
- Exception:** Site-built windows, skylights and doors.
- ☐ **R402.4.4 Rooms containing fuel - burning appliances.** In Climate Zones 3 through 8, where open combustion air ducts provide combustion air to open combustion fuel burning appliances, the appliances and combustion air opening shall be located outside the building thermal envelope or enclosed in a room, isolated from inside the thermal envelope. Such rooms shall be sealed and insulated in accordance with the envelope requirements of Table R402.1.2, where the walls, floors and ceilings shall meet not less than the basement wall R-value requirement. The door into the room shall be fully gasketed and any water lines and ducts in the room insulated in accordance with Section R403. The combustion air duct shall be insulated where it passes through conditioned space to a minimum of R-8.
- Exceptions:**
1. Direct vent appliances with both intake and exhaust pipes installed continuous to the outside.
  2. Fireplaces and stoves complying with Section R402.4.2 and Section R1006 of the Florida Building Code, Residential.
- ☐ **R402.4.5 Recessed lighting.** Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed luminaires shall be IC-rated and labeled as having an air leakage rate not more than 2.0 cfm (0.944 L/s) when tested in accordance with ASTM E283 at a 1.57 psf (75 Pa) pressure differential. All recessed luminaires shall be sealed with a gasket or caulk between the housing and the interior wall or ceiling covering.
- ☐ **R402.4.6 Air-sealed electrical and communication boxes.** Air-sealed electrical and communication boxes that penetrate the air barrier of the building thermal envelope shall be caulked, taped, gasketed, or otherwise sealed to the air barrier element being penetrated. Air-sealed boxes shall be buried in or surrounded by insulation. Air-sealed boxes shall be marked in accordance with NEMA OS 4. Air-sealed boxes shall be installed in accordance with the manufacturer's instructions.

## SECTION R403 SYSTEMS

### R403.1 Controls

- ☐ **R403.1.1 Thermostat provision (Mandatory).** At least one thermostat shall be provided for each separate heating and cooling system
- ☐ **R403.1.3 Heat pump supplementary heat (Mandatory).** Heat pumps with supplementary electric-resistance heaters shall have controls that limit supplemental heat operation to only those times when one of the following applies:
1. The vapor compression cycle cannot provide the necessary heating energy to satisfy the thermostat setting.
  2. The heat pump is operating in defrost mode.
  3. The vapor compression cycle malfunctions.
  4. The thermostat malfunctions
- ☐ **R403.3.2 Sealing (Mandatory).** All ducts, air handlers, filter boxes and building cavities that form the primary air containment passageways for air distribution systems shall be considered ducts or plenum chambers, shall be constructed and sealed in accordance with Section C403.2.9.2 of the Commercial Provisions of this code and shall be shown to meet duct tightness criteria below.
- Duct tightness shall be verified by testing in accordance with ANSI/RESNET/ICC 380 by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i), Florida Statutes, to be "substantially leak free" in accordance with Section R403.3.3.
- ☐ **R403.3.2.1 Sealed air handler.** Air handlers shall have a manufacturer's designation for an air leakage of no more than 2 percent of the design airflow rate when tested in accordance with ASHRAE 193.
- ☐ **R403.3.3 Duct testing (Mandatory).** Ducts shall be pressure tested to determine air leakage by one of the following methods:
1. Rough-in test: Total leakage shall be measured with a pressure differential of 0.1 inch w.g. (25 Pa) across the system, including the manufacturer's air handler enclosure if installed at the time of the test. All registers shall be taped or otherwise sealed during the test.
  2. Postconstruction test: Total leakage shall be measured with a pressure differential of 0.1 inch w.g. (25 Pa) across the entire system, including the manufacturer's air handler enclosure. Registers shall be taped or otherwise sealed during the test.
- Exceptions;**
1. A duct air leakage test shall not be required where the ducts and air handlers are located entirely within the building thermal envelope.
  2. Duct testing is not mandatory for buildings complying by Section 405 of this code. Duct leakage testing is required for Section R405 compliance where credit is taken for leakage, and a duct air leakage  $Q_n$  to the outside of less than 0.080 (where  $Q_n$  = duct leakage to the outside in cfm per 100 square feet of conditioned floor area tested at 25 Pascals) is indicated in the compliance report for the proposed design.
- A written report of the results of the test shall be signed by the party conducting the test and provided to the code official

## Florida Building Code, Energy Conservation, Mandatory Requirements (2023 Continued)

- ☐ **R403.3.5 Building cavities (Mandatory).** Building framing cavities shall not be used as ducts or plenums
- ☐ **R403.4 Mechanical system piping insulation (Mandatory).** Mechanical system piping capable of carrying fluids above 105°F (41°C) or below 55°F (13°C) shall be insulated to a minimum of R-3.
- ☐ **R403.4.1 Protection of piping insulation.** Piping insulation exposed to weather shall be protected from damage, including that caused by sunlight, moisture, equipment maintenance and wind, and shall provide shielding from solar radiation that can cause degradation of the material. Adhesive tape shall not be permitted.
- ☐ **R403.5.1 Heated water circulation and temperature maintenance systems (Mandatory).** If heated water circulation systems are installed, they shall be in accordance with Section R403.5.1.1. Heat trace temperature maintenance systems shall be in accordance with Section R403.5.1.2. Automatic controls, temperature sensors and pumps shall be accessible. Manual controls shall be readily accessible.
- ☐ **R403.5.1.1 Circulation systems.** Heated water circulation systems shall be provided with a circulation pump. The system return pipe shall be a dedicated return pipe or a cold water supply pipe. Gravity and thermosiphon circulation systems shall be prohibited. Controls for circulating hot water system pumps shall start the pump based on the identification of a demand for hot water within the occupancy. The controls shall automatically turn off the pump when the water in the circulation loop is at the desired temperature and when there is no demand for hot water.
- ☐ **R403.5.1.2 Heat trace systems.** Electric heat trace systems shall comply with IEEE 515.1 or UL 515. Controls for such systems shall automatically adjust the energy input to the heat tracing to maintain the desired water temperature in the piping in accordance with the times when heated water is used in the occupancy.
- ☐ **R403.5.2 Demand recirculation water systems (Mandatory).** Where installed, demand recirculation water systems shall have controls that comply with both of the following:
  - 1. The control shall start the pump upon receiving a signal from the action of a user of a fixture or appliance, sensing the presence of a user of a fixture or sensing the flow of hot or tempered water to a fixture fitting or appliance.
  - 2. The control shall limit the temperature of the water entering the cold water piping to 104°F (40°C).
- ☐ **R403.5.5 Heat traps (Mandatory).** Storage water heaters not equipped with integral heat traps and having vertical pipe risers shall have heat traps installed on both the inlets and outlets. External heat traps shall consist of either a commercially available heat trap or a downward and upward bend of at least 3 ½ inches (89 mm) in the hot water distribution line and cold water line located as close as possible to the storage tank.
- ☐ **R403.5.6 Water heater efficiencies (Mandatory).**
  - ☐ **R403.5.6.1.1 Automatic controls.** Service water-heating systems shall be equipped with automatic temperature controls capable of adjustment from the lowest to the highest acceptable temperature settings for the intended use. The minimum temperature setting range shall be from 100°F to 140°F (38°C to 60°C).
  - ☐ **R403.5.6.1.2 Shut down.** A separate switch or a clearly marked circuit breaker shall be provided to permit the power supplied to electric service systems to be turned off. A separate valve shall be provided to permit the energy supplied to the main burner(s) of combustion types of service water-heating systems to be turned off.
  - ☐ **R403.5.6.2 Water-heating equipment.** Water-heating equipment installed in residential units shall meet the minimum efficiencies of Table C404.2 in Chapter 4 of the Florida Building Code, Energy Conservation, Commercial Provisions, for the type of equipment installed. Equipment used to provide heating functions as part of a combination system shall satisfy all stated requirements for the appropriate water-heating category. Solar water heaters shall meet the criteria of Section R403.5.6.2.1.
  - ☐ **R403.5.6.2.1 Solar water-heating systems.** Solar systems for domestic hot water production are rated by the annual solar energy factor of the system. The solar energy factor of a system shall be determined from the Florida Solar Energy Center Directory of Certified Solar Systems. Solar collectors shall be tested in accordance with ISO Standard 9806, Test Methods for Solar Collectors, and SRCC Standard TM-1, Solar Domestic Hot Water System and Component Test Protocol. Collectors in installed solar water-heating systems should meet the following criteria:
    - 1. Be installed with a tilt angle between 10 degrees and 40 degrees of the horizontal; and
    - 2. Be installed at an orientation within 45 degrees of true south.
- ☐ **R403.6 Mechanical ventilation (Mandatory).** The building shall be provided with ventilation that meets the requirements of the Florida Building Code, Residential, or Florida Building Code, Mechanical, as applicable, or with other approved means of ventilation including: Natural, Infiltration or Mechanical means. Outdoor air intakes and exhausts shall have automatic or gravity dampers that close when the ventilation system is not operating.

# Florida Building Code, Energy Conservation, Mandatory Requirements (2023 Continued)



**R403.6.1 Whole-house mechanical ventilation system fan efficacy.** When installed to function as a whole-house mechanical ventilation system, fans shall meet the efficacy requirements of Table R403.6.1.

**Exception:** Where an air handler that is integral to tested and listed HVAC equipment is used to provide whole-house mechanical ventilation, the air handler shall be powered by an electronically commutated motor.

**TABLE R403.6.1  
WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM FAN EFFICACY**

FAN LOCATION	AIRFLOW RATE MINIMUM (CFM)	MINIMUM EFFICACY <sup>a</sup> (CFM/WATT)	AIRFLOW RATE MAXIMUM (CFM)
HRV or ERV	Any	1.2 cfm/watt	Any
Range hoods	Any	2.8 cfm/watt	Any
In-line fan	Any	3.8 cfm/watt	Any
Bathroom, utility room	10	2.8 cfm/watt	<90
Bathroom, utility room	90	3.5 cfm/watt	Any

For SI: 1 cfm = 28.3 L/min.

a. When tested in accordance with HVI Standard 916



**R403.6.2 Ventilation Air.** Residential buildings designed to be operated at a positive indoor pressure or for mechanical ventilation shall meet the following criteria:

1. The design air change per hour minimums for residential buildings in ASHRAE 62.2, Ventilation for Acceptable Indoor Air Quality, shall be the maximum rates allowed for residential applications.
2. No ventilation or air-conditioning system make-up air shall be provided to conditioned space from attics, crawlspaces, attached enclosed garages or outdoor spaces adjacent to swimming pools or spas.
3. If ventilation air is drawn from enclosed space(s), then the walls of the space(s) from which air is drawn shall be insulated to a minimum of R-11 and the ceiling shall be insulated to a minimum of R-19, space permitting, or R-10 otherwise.

## R403.7 Heating and cooling equipment.



**R403.7.1 Equipment sizing (Mandatory).** Heating and cooling equipment shall be sized in accordance with ACCA Manual S based on the equipment loads calculated in accordance with ACCA Manual J or other approved heating and cooling calculation methodologies, based on building loads for the directional orientation of the building. The manufacturer and model number of the outdoor and indoor units (if split system) shall be submitted along with the sensible and total cooling capacities at the design conditions described in Section R302.1. This Code does not allow designer safety factors, provisions for future expansion or other factors that affect equipment sizing. System sizing calculations shall not include loads created by local intermittent mechanical ventilation such as standard kitchen and bathroom exhaust systems. New or replacement heating and cooling equipment shall have an efficiency rating equal to or greater than the minimum required by federal law for the geographic location where the equipment is installed.



## Florida Building Code, Energy Conservation, Mandatory Requirements (2023 Continued)

- ☐ **R403.7.1.1 Cooling equipment capacity.** Cooling only equipment shall be selected so that its total capacity is not less than the calculated total load but not more than 1.15 times greater than the total load calculated according to the procedure selected in Section R403.7, or the closest available size provided by the manufacturer's product lines. The corresponding latent capacity of the equipment shall not be less than the calculated latent load.
- The published value for AHRI total capacity is a nominal, rating-test value and shall not be used for equipment sizing. Manufacturer's expanded performance data shall be used to select cooling-only equipment. This selection shall be based on the outdoor design dry-bulb temperature for the load calculation (or entering water temperature for water-source equipment), the blower CFM provided by the expanded performance data, the design value for entering wet-bulb temperature and the design value for entering dry-bulb temperature.

Design values for entering wet-bulb and dry-bulb temperatures shall be for the indoor dry bulb and relative humidity used for the load calculation and shall be adjusted for return side gains if the return duct(s) is installed in an unconditioned space.

### Exceptions:

1. Attached single- and multiple-family residential equipment sizing may be selected so that its cooling capacity is less than the calculated total sensible load but not less than 80 percent of that load.
2. When signed and sealed by a Florida-registered engineer, in attached single- and multiple-family units, the capacity of equipment may be sized in accordance with good design practice.

### R403.7.1.2 Heating equipment capacity.

- ☐ **R403.7.1.2.1 Heat pumps.** Heat pump sizing shall be based on the cooling requirements as calculated according to Section R403.7.1.1, and the heat pump total cooling capacity shall not be more than 1.15 times greater than the design cooling load even if the design heating load is 1.15 times greater than the design cooling load.
- ☐ **R403.7.1.2.2 Electric resistance furnaces.** Electric resistance furnaces shall be sized within 4 kW of the design requirements calculated according to the procedure selected in Section R403.7.1.
- ☐ **R403.7.1.2.3 Fossil fuel heating equipment.** The capacity of fossil fuel heating equipment with natural draft atmospheric burners shall not be less than the design load calculated in accordance with Section R403.7.1.
- ☐ **R403.7.1.3 Extra capacity required for special occasions.** Residences requiring excess cooling or heating equipment capacity on an intermittent basis, such as anticipated additional loads caused by major entertainment events, shall have equipment sized or controlled to prevent continuous space cooling or heating within that space by one or more of the following options:
1. A separate cooling or heating system is utilized to provide cooling or heating to the major entertainment areas.
  2. A variable capacity system sized for optimum performance during base load periods is utilized.
- ☐ **R403.8 Systems serving multiple dwelling units (Mandatory).** Systems serving multiple dwelling units shall comply with Sections C403 and C404 of the Florida Building Code, Energy Conservation—Commercial Provisions in lieu of Section R403.
- ☐ **R403.9 Snow melt and ice system controls (Mandatory).** Snow- and ice-melting systems, supplied through energy service to the building, shall include automatic controls capable of shutting off the system when the pavement temperature is above 50°F (10°C), and no precipitation is falling and an automatic or manual control that will allow shutoff when the outdoor temperature is above 40°F (4.8°C).
- ☐ **403.10 Pools and permanent spa energy consumption (Mandatory).** The energy consumption of pools and permanent spas shall be in accordance with Sections R403.10.1 through R403.10.5.
- ☐ **R403.10.1 Heaters.** The electric power to heaters shall be controlled by a readily accessible on-off switch that is an integral part of the heater mounted on the exterior of the heater, or external to and within 3 feet (914 mm) of the heater. Operation of such switch shall not change the setting of the heater thermostat. Such switches shall be in addition to a circuit breaker for the power to the heater.
- Gas-fired heaters shall not be equipped with continuously burning ignition pilots.
- ☐ **R403.10.2 Time switches.** Time switches or other control methods that can automatically turn off and on according to a preset schedule shall be installed for heaters and pump motors. Heaters and pump motors that have built-in time switches shall be in compliance with this section.

### Exceptions:

1. Where public health standards require 24-hour pump operation.
2. Pumps that operate solar- and waste-heat-recovery pool heating systems
3. Where pumps are powered exclusively from on-site renewable generation.

## Florida Building Code, Energy Conservation, Mandatory Requirements (2023 Continued)

- ☐ **R403.10.3 Covers.** Outdoor heated swimming pools and outdoor permanent spas shall be equipped with a vapor-retardant cover on or at the water surface or a liquid cover or other means proven to reduce heat loss.
- Exception:** Where more than 70 percent of the energy for heating, computed over an operation season, is from site-recovered energy, such as from a heat pump or solar energy source, covers or other vapor-retardant means shall not be required.
- ☐ **R403.10.4 Gas- and oil-fired pool and spa heaters.** All gas- and oil-fired pool and spa heaters shall have a minimum thermal efficiency of 82 percent for heaters manufactured on or after April 16, 2013, when tested in accordance with ANSI Z 21.56. Pool heaters fired by natural or LP gas shall not have continuously burning pilot lights.
- ☐ **R403.10.5 Heat pump pool heaters.** Heat pump pool heaters shall have a minimum COP of 4.0 when tested in accordance with AHRI 1160, Table 2, Standard Rating Conditions-Low Air Temperature. A test report from an independent laboratory is required to verify procedure compliance. Geothermal swimming pool heat pumps are not required to meet this standard.
- ☐ **R403.11 Portable spas (Mandatory).** The energy consumption of electric-powered portable spas shall be controlled by the requirements of APSP-14.
- ☐ **R403.13 Dehumidifiers (Mandatory).** If installed, a dehumidifier shall conform to the following requirements:
1. The minimum rated efficiency of the dehumidifier shall be greater than 1.7 liters/ kWh if the total dehumidifier capacity for the house is less than 75 pints/day and greater than 2.38 liters/kWh if the total dehumidifier capacity for the house is greater than or equal to 75 pints/day.
  2. The dehumidifier shall be controlled by a sensor that is installed in a location where it is exposed to mixed house air.
  3. Any dehumidifier unit located in unconditioned space that treats air from conditioned space shall be insulated to a minimum of R-2.
  4. Condensate disposal shall be in accordance with Section M1411.3.1 of the Florida Building Code, Residential.
- ☐ **R403.13.1 Ducted dehumidifiers.** Ducted dehumidifiers shall, in addition to conforming to the requirements of Section R403.13, conform to the following requirements:
1. If a ducted dehumidifier is configured with return and supply ducts both connected into the supply side of the cooling system, a backdraft damper shall be installed in the supply air duct between the dehumidifier inlet and outlet duct.
  2. If a ducted dehumidifier is configured with only its supply duct connected into the supply side of the central heating and cooling system, a backdraft damper shall be installed in the dehumidifier supply duct between the dehumidifier and central supply duct.
  3. A ducted dehumidifier shall not be ducted to or from a central ducted cooling system on the return duct side upstream from the central cooling evaporator coil.
  4. Ductwork associated with a dehumidifier located in unconditioned space shall be insulated to a minimum of R-6.

## SECTION R404 ELECTRICAL POWER AND LIGHTING SYSTEMS

- ☐ **R404.1 Lighting equipment (Mandatory).** All permanently installed luminaires, excluding those in kitchen appliances, shall have an efficacy of at least 45 lumens-per-watt or shall utilize lamps with an efficacy of not less than 65 lumens-per-watt.
- R404.1.1 Lighting equipment (Mandatory).** Fuel gas lighting systems shall not have continuously burning pilot lights.

**SECTION R405  
SIMULATED PERFORMANCE ALTERNATIVE  
(PERFORMANCE)**

- ☐ **R405.2 Mandatory requirements.** Compliance with this section requires that the mandatory provisions identified in Section R401.2 be met. All supply and return ducts not completely inside the building thermal envelope shall be insulated to a minimum of R-6, except site-wrapped supply ducts not completely inside the building thermal envelope shall be insulated to a minimum of R-8.
  
- ☐ **R405.2.1 Ceiling insulation.** Ceilings shall have an insulation level of at least R-19, space permitting. For the purposes of this code, types of ceiling construction that are considered to have inadequate space to install R-19 include single assembly ceilings of the exposed deck and beam type and concrete deck roofs. Such ceiling assemblies shall be insulated to at least a level of R-10.
  
- ☐ **R405.2.2 Building air leakage testing.** Building or dwelling air leakage testing shall be in accordance with Sections R402.4 through R402.4.1.2. If an air leakage rate below seven air changes per hour at a pressure of 0.2 inch w.g. (50 pascals) is specified for the proposed design, testing shall verify the air leakage rate does not exceed the air leakage rate of the proposed design instead of seven air changes per hour.
  
- ☐ **R405.2.3 Duct air leakage testing.** In cases where duct air leakage lower than the default  $Q_n$  to outside of 0.080 (where  $Q_n$  = duct leakage to the outside in cfm per 100 square feet of conditioned floor area tested at 25 Pascals) is specified for the proposed design, testing in accordance with Section R403.3.2 shall verify a duct air leakage rate not exceeding the leakage rate of the proposed design. Otherwise, in accordance with Section R403.3.3, duct testing is not mandatory for buildings complying by Section R405.

**SECTION R406  
ENERGY RATING INDEX  
COMPLIANCE ALTERNATIVE**

- ☐ **R406.2 Mandatory requirements.** Compliance with this section requires that the provisions identified in Sections R401 through R404 labeled as "mandatory" and Section R403.5.3 of the 2015 International Energy Conservation Code be met. For buildings that do not utilize on-site renewable power production for compliance with this section, the building thermal envelope shall be greater than or equal to levels of efficiency and Solar Heat Gain Coefficient in Table 402.1.1 or 402.1.3 of the 2009 International Energy Conservation Code. For buildings that utilize on-site renewable power production for compliance with this section, the building thermal envelope shall be greater than or equal to levels of efficiency and Solar Heat Gain Coefficient in Table R402.1.2 or Table R402.1.4 of the 2015 International Energy Conservation Code.

**Exception:** Supply and return ducts not completely inside the building thermal envelope shall be insulated to a minimum of R-6.

- ☐ **R406.2.1 Site-wrapped supply ducts.** Site-wrapped supply ducts not completely inside the building thermal envelope shall be insulated to a minimum of R-8.



# 2023 - AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA-TABLE 402.4.1.1<sup>a</sup>

Project Name: Trent Geibeig Lot 57 Crosswinds Sub		Builder Name: Trent Giegeig	
Street: Anyplace		Permit Office: Columbia County	
City, State, Zip: Lake City, FL, 32055		Permit Number:	
Owner: TBD		Jurisdiction: Columbia County	
Design Location: FL, Gainesville		County: Columbia(Florida Climate Zone 2)	
COMPONENT	AIR BARRIER CRITERIA	INSULATION INSTALLATION CRITERIA	CHECK
General requirements	A continuous air barrier shall be installed in the building envelope. The exterior thermal envelope contains a continuous air barrier. Breaks or joints in the air barrier shall be sealed.	Air-permeable insulation shall not be used as a sealing material.	✓
Ceiling/attic	The air barrier in any dropped ceiling/soffit shall be aligned with the insulation and any gaps in the air barrier shall be sealed. Access openings, drop down stairs or knee wall doors to unconditioned attic spaces shall be sealed.	The insulation in any dropped ceiling/soffit shall be aligned with the air barrier.	
Walls	The junction of the foundation and sill plate shall be sealed. The junction of the top plate and the top of exterior walls shall be sealed. Knee walls shall be sealed.	Cavities within corners and headers of frame walls shall be insulated by completely filling the cavity with a material having a thermal resistance of R-3 per inch minimum. Exterior thermal envelope insulation for framed walls shall be installed in substantial contact and continuous alignment with the air barrier.	
Windows, skylights and doors	The space between window/door jambs and framing, and skylights and framing shall be sealed.		
Rim joists	Rim joists shall include the air barrier.	Rim joists shall be insulated.	
Floors (including above-garage and cantilevered floors)	The air barrier shall be installed at any exposed edge of insulation.	Floor framing cavity insulation shall be installed to maintain permanent contact with the underside of subfloor decking, or floor framing cavity insulation shall be permitted to be in contact with the top side of sheathing, or continuous insulation installed on the underside of floor framing and extends from the bottom to the top of all perimeter floor framing members.	
Crawl space walls	Exposed earth in unvented crawl spaces shall be covered with a Class I vapor retarder with overlapping joints taped.	Where provided instead of floor insulation, insulation shall be permanently attached to the crawlspace walls.	
Shafts, penetrations	Duct shafts, utility penetrations, and flue shafts opening to exterior or unconditioned space shall be sealed.		
Narrow cavities		Batts in narrow cavities shall be cut to fit, or narrow cavities shall be filled by insulation that on installation readily conforms to the available cavity spaces.	
Garage separation	Air sealing shall be provided between the garage and conditioned spaces.		
Recessed lighting	Recessed light fixtures installed in the building thermal envelope shall be sealed to the finished surface.	Recessed light fixtures installed in the building thermal envelope shall be air tight and IC rated.	
Plumbing and wiring		Batt insulation shall be cut neatly to fit around wiring and plumbing in exterior walls, or insulation that on installation readily conforms to available space shall extend behind piping and wiring.	
Shower/tub on exterior wall	The air barrier installed at exterior walls adjacent to showers and tubs shall separate them from the showers and tubs.	Exterior walls adjacent to showers and tubs shall be insulated.	
Electrical, communication, and other equipment boxes, housings, and enclosures	Boxes, housings, and enclosures that penetrate the air barrier shall be caulked, taped, gasketed, or otherwise sealed to the air barrier element being penetrated. All concealed openings into the box, housing, or enclosure shall be sealed. The continuity of the air barrier shall be maintained around boxes, housings, and enclosures that penetrate the air barrier. Alternatively, air-sealed boxes shall be installed in accordance with R402.4.6	Boxes, housings, and enclosures shall be buried in or surrounded by tightly fitted insulation.	
HVAC register boots	HVAC supply and return register boots that penetrate building thermal envelope shall be sealed to the sub-floor, wall covering or ceiling penetrated by the boot.		
Concealed sprinklers	When required to be sealed, concealed fire sprinklers shall only be sealed in a manner that is recommended by the manufacturer. Caulking or other adhesive sealants shall not be used to fill voids between fire sprinkler cover plates and walls or ceilings.		

a. In addition, inspection of log walls shall be in accordance with the provisions of ICC-400.

1/28/2024 6:10:03 PM

EnergyGauge® USA 8.0.00 - FlaRes2023 FBC 8th Edition (2023) Compliant Software

Page 1



**Envelope Leakage Test Report (Blower Door Test)**  
**Residential Prescriptive, Performance or ERI Method Compliance**  
**2023 Florida Building Code, Energy Conservation, 8th Edition**

<b>Jurisdiction:</b> Columbia County	<b>Permit #:</b>
<b>Job Information</b>	
<b>Builder:</b> Trent Giegeig	<b>Community:</b> Lot: 57
<b>Address:</b> Anyplace	
<b>City:</b> Lake City	<b>State:</b> FL <b>Zip:</b> 32055
<b>Air Leakage Test Results</b> <i>Passing results must meet either the Performance, Prescriptive, or ERI Method</i>	
<input type="radio"/> <b>PRESCRIPTIVE METHOD</b> -The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.	
<input checked="" type="radio"/> <b>PERFORMANCE or ERI METHOD</b> -The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2023 (Performance) or R406-2023 (ERI), section labeled as infiltration, sub-section ACH50. ACH(50) specified on Form R405-2023-Energy Calc (Performance) or R406-2023 (ERI): <span style="border: 1px solid black; padding: 2px 20px;">7.000</span>	
<div style="display: flex; justify-content: space-between; align-items: flex-start;"><div style="width: 60%;"><math display="block">\frac{\text{CFM}(50) \times 60}{\text{Building Volume}} = \text{ACH}(50)</math><div style="border: 1px solid black; width: 40px; height: 40px; margin: 10px auto; display: flex; align-items: center; justify-content: center; font-weight: bold; font-size: 1.2em;">PASS</div><div style="margin-top: 10px;"><input type="checkbox"/> When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.</div></div><div style="width: 35%;"><b>Method for calculating building volume:</b> <input type="radio"/> Retrieved from architectural plans <input checked="" type="radio"/> Code software calculated <input type="radio"/> Field measured and calculated</div></div>	
<p><b>R402.4.1.2 Testing.</b> The building or dwelling unit shall be tested and verified as having an air leakage rate not exceeding seven air changes per hour in Climate Zones 1 and 2, and three air changes per hour in Climate Zones 3 through 8. Dwelling units with an air leakage rate less than three air changes per hour shall be provided with whole-house mechanical ventilation in accordance with Section R403.6.1 of this code and Section M1507.3 if the <i>Florida Building Code, Residential</i>. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), <i>Florida Statutes</i>, or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the <i>building thermal envelope</i>.</p> <p><b>During testing:</b></p> <ol style="list-style-type: none"><li>1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.</li><li>2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.</li><li>3. Interior doors, if installed at the time of the test, shall be open.</li><li>4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.</li><li>5. Heating and cooling systems, if installed at the time of the test, shall be turned off.</li><li>6. Supply and return registers, if installed at the time of the test, shall be fully open.</li><li>7. If an attic is both sealed and insulated at the roof deck, interior access doors and hatches between the conditioned space volume and the attic shall be opened during the test and the volume of the attic shall be added to the conditioned space volume for purposes of reporting the infiltration volume and calculating the air leakage of the home.</li></ol>	
<b>Testing Company</b>	
Company Name: _____ Phone: _____	
I hereby verify that the above Air Leakage results are in accordance with the 2023 8th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.	
Signature of Tester: _____	Date of Test: _____
Printed Name of Tester: _____	
License/Certification #: _____	Issuing Authority: _____



**Duct Leakage Test Report**  
**Residential Prescriptive, Performance or ERI Method Compliance**  
**2023 Florida Building Code, Energy Conservation, 8th Edition**

Jurisdiction: Columbia County	Permit #:
-------------------------------	-----------

**Job Information**

Builder: Trent Giegeig	Community:	Lot: 57
Address: Anyplace		
City: Lake City	State: FL	Zip: 32055

**Duct Leakage Test Results**

System 1	_____ cfm25
System 2	_____ cfm25
System 3	_____ cfm25
Sum of others	_____ cfm25
Total of all	_____ cfm25

☐ **Prescriptive Method** cfm25 (Total)

To qualify as "substantially leak free" Qn Total must be less than or equal to 0.04 if air handler unit is installed. If air handler unit is not installed, Qn Total must be less than or equal to 0.03. This testing method meets the requirements in accordance with Section R403.3.3.

Is the air handler unit installed during testing? ☐ YES ( = .04 Qn ) ☐ NO ( = .03 Qn )

☒ **Performance/ERI Method** cfm25 (Out or Total)

To qualify using this method, Qn must not be greater than the proposed duct leakage Qn specified on Form R405-2023 or R406-2023.

Leakage Type selected on Form R405-2023 (EnergyCalc) or R406-2023      Qn specified on Form R405-2023 (EnergyCalc) or R406-2023

Proposed Qn

0.040

$$\frac{\text{Total of all systems}}{\text{Total Conditioned Square Footage}} = \frac{1660}{\text{Total Conditioned Square Footage}} = \text{_____ Qn}$$

<input type="checkbox"/> <b>PASS</b>	<input type="checkbox"/> <b>FAIL</b>
--------------------------------------	--------------------------------------

Duct tightness shall be verified by testing in accordance with ANSI/RESNET/ICC380 by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i), Florida Statutes.

**Testing Company**

Company Name: _____	Phone: _____
I hereby verify that the above duct leakage testing results are in accordance with the Florida Building Code requirements with the selected compliance path as stated above, either the Prescriptive Method or Performance Method.	
Signature of Tester: _____	Date of Test: _____
Printed Name of Tester: _____	
License/Certification #: _____	Issuing Authority: _____





Lumber design values are in accordance with ANSI/TPI 1 section 6.3  
These truss designs rely on lumber values established by others.

RE: 3842048 - GIEGEIG CONST. - LOT 57 CW

**MiTek, Inc.**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
514.434.1200

**Site Information:**

Customer Info: GIEBEIG CONST. Project Name: Spec Hse Model: St. Johns Modified  
Lot/Block: 57 Subdivision: Crosswinds  
Address: TBD SW Chesterfield, TBD  
City: Columbia Cty State: FL

**Name Address and License # of Structural Engineer of Record, If there is one, for the building.**

Name: License #:  
Address:  
City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.7  
Wind Code: ASCE 7-22 Wind Speed: 130 mph  
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 25 individual, Truss Design Drawings and 0 Additional Drawings.  
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T32708452	CJ01	1/24/24	15	T32708466	T09	1/24/24
2	T32708453	CJ03	1/24/24	16	T32708467	T10	1/24/24
3	T32708454	CJ05	1/24/24	17	T32708468	T11	1/24/24
4	T32708455	EJ01	1/24/24	18	T32708469	T12	1/24/24
5	T32708456	HJ10	1/24/24	19	T32708470	T13	1/24/24
6	T32708457	T01	1/24/24	20	T32708471	T14	1/24/24
7	T32708458	T01G	1/24/24	21	T32708472	T15	1/24/24
8	T32708459	T02	1/24/24	22	T32708473	T16	1/24/24
9	T32708460	T03	1/24/24	23	T32708474	T17	1/24/24
10	T32708461	T04	1/24/24	24	T32708475	T17G	1/24/24
11	T32708462	T05	1/24/24	25	T32708476	T18	1/24/24
12	T32708463	T06	1/24/24				
13	T32708464	T07	1/24/24				
14	T32708465	T08	1/24/24				



This item has been digitally signed and sealed by O'Regan, Philip, PE on the date adjacent to the seal.  
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by  
MiTek USA, Inc. under my direct supervision based on the parameters  
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: O'Regan, Philip  
My license renewal date for the state of Florida is February 28, 2025.

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Philip J. O'Regan PE No. 58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024

O'Regan, Philip

1 of 1









Job 3842048	Truss HJ10	Truss Type Diagonal Hip Girder	Qty 5	Ply 1	GIEGEIG CONST. - LOT 57 CW	T32708456
----------------	---------------	-----------------------------------	----------	----------	----------------------------	-----------

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:49:58 2024 Page 1  
ID:RijugoliQj9qlqT\_5CiYdzq7NP-A7UnakxOI6I1nbVMJclXylS83SuS?m7ZO7Aq4zsk3N



Scale = 1:22.8

LOADING (psf)	SPACING-	CS.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.58	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.62	Vert(LL) 0.07 6-7 >999 240		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.44	Vert(CT) -0.12 6-7 >992 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.01 5 n/a n/a		
	Code FBC2023/TPI2014			Weight: 43 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 8-5-13 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-4-9, 5=Mechanical  
Max Horz 2=167(LC 4)  
Max Uplift 4=90(LC 4), 2=343(LC 4), 5=171(LC 4)  
Max Grav 4=149(LC 1), 2=527(LC 1), 5=299(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=799/401  
BOT CHORD 2-7=463/729, 6-7=463/729  
WEBS 3-7=76/281, 3-6=768/487

#### NOTES-

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 4, 343 lb uplift at joint 2 and 171 lb uplift at joint 5.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 67 lb down and 74 lb up at 1-6-1, 67 lb down and 74 lb up at 1-6-1, 23 lb down and 46 lb up at 4-4-0, 23 lb down and 46 lb up at 4-4-0, and 45 lb down and 87 lb up at 7-1-15, and 45 lb down and 87 lb up at 7-1-15 on top chord, and 46 lb down and 43 lb up at 1-6-1, 46 lb down and 43 lb up at 1-6-1, 19 lb down and 27 lb up at 4-4-0, 19 lb down and 27 lb up at 4-4-0, and 67 lb down and 16 lb up at 7-1-15, and 67 lb down and 16 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-54, 5-8=-20  
Concentrated Loads (lb)  
Vert: 7=6(F=-3, B=-3) 12=-73(F=-36, B=-36) 15=-59(F=-29, B=-29)

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingle Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinet.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingle Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Scale = 1:38.1





Job	Truss	Truss Type	Qty	Ply	GIEGEIG CONST. - LOT 57 CW	T32708459
3842048	T02	Half Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:04 2024 Page 2  
ID:fRijugoliQj9qlqT\_5CiYdzq7NP-?Hs2ro09uy2AVW\_VftO0nD?PWTabscW0xKaU2kzsk3H

#### LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-9=-54, 2-10=20

Concentrated Loads (lb)

Vert: 4=-110(F) 7=-110(F) 9=-139(F) 15=-335(F) 14=-64(F) 5=-110(F) 18=-110(F) 19=-110(F) 20=-110(F) 21=-110(F) 22=-110(F) 23=-110(F) 24=-110(F)  
25=-110(F) 26=-113(F) 27=-64(F) 28=-64(F) 29=-64(F) 30=-64(F) 31=-64(F) 32=-64(F) 33=-64(F) 34=-64(F) 35=-64(F) 36=-66(F)

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITP11 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

# MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job 3842048	Truss T04	Truss Type Hip	Qty 1	Ply 1	GIEGEIG CONST. - LOT 57 CW	T32708461
----------------	--------------	-------------------	----------	----------	----------------------------	-----------

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:07 2024 Page 1  
ID: fRijugoliQj9qlqT\_5CiYdzq7NP-PsXATp22BtQIM\_i4L?yPrd3ChU\_36ESdlo8e3zsk3E



Scale = 1:53.9

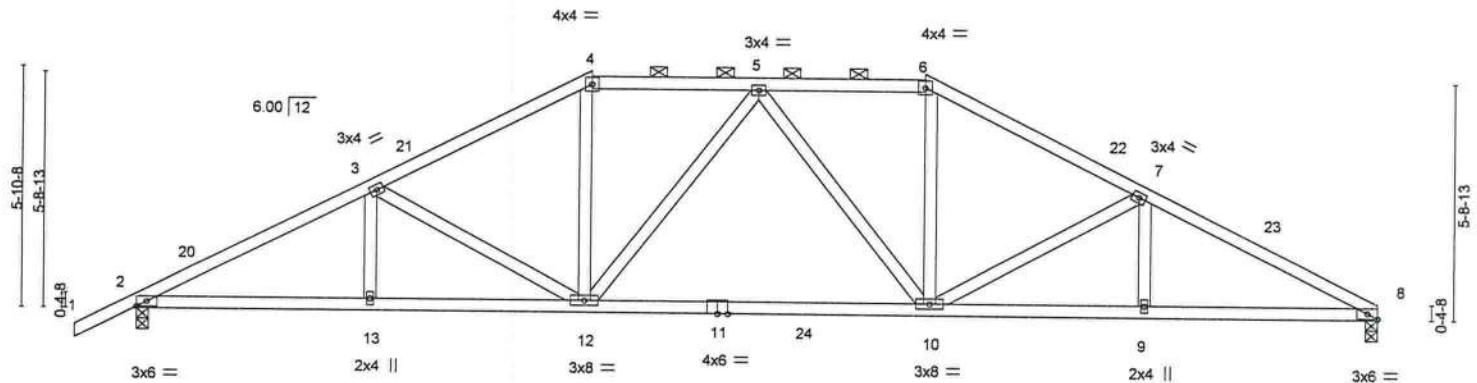


Plate Offsets (X,Y) - [8:0-2:15 Edge]		5-7-15		11-0-0		19-1-0		24-5-1		30-1-0	
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	2-0-0	Plate Grip DOL	1.25	TC	0.31	in (loc)	l/defl	L/d	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.81	Vert(LL)	-0.23 10-12	>999	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.30	Vert(CT)	-0.41 10-12	>877	180		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS		Horz(CT)	0.09 8	n/a	n/a		
										Weight: 156 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-7 oc purlins, except 2-0-0 oc purlins (4-7-8 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied or 8-3-15 oc bracing.

#### REACTIONS.

(size) 8=0-3-8, 2=0-3-8  
Max Horz 2=114(LC 12)  
Max Uplift 8=-293(LC 13), 2=-331(LC 12)  
Max Grav 8=1202(LC 2), 2=1271(LC 2)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-2228/530, 3-4=-1821/434, 4-5=-1572/424, 5-6=-1575/427, 6-7=-1825/438, 7-8=-2233/543  
BOT CHORD 2-13=-500/1953, 12-13=-500/1953, 10-12=-300/1657, 9-10=-423/1969, 8-9=-423/1969  
WEBS 3-12=-430/221, 4-12=-103/599, 5-12=-273/133, 5-10=-271/131, 6-10=-102/602, 7-10=-443/232

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 11-0-0, Zone2 11-0-0 to 15-0-8, Zone1 15-0-8 to 19-1-0, Zone2 19-1-0 to 23-3-15, Zone1 23-3-15 to 30-1-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=293, 2=331.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58125  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024



**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job 3842048	Truss T06	Truss Type Common	Qty 3	Ply 1	GIEGEIG CONST. - LOT 57 CW	T32708463
----------------	--------------	----------------------	----------	----------	----------------------------	-----------

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:10 2024 Page 1  
ID: fRijugoliQj9qlqT\_5CiYdzq7NP-qQDJ5r5wUooKDRRf07VQ0UFU8uW8GTuuJG1oFQzsk3B

Job Reference (optional)




Plate Offsets (X,Y)~		[3:0-4-0,0-3-0], [5:0-4-0,0-3-0], [6:0-2-15,Edge], [8:0-4-0,0-3-0]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL		TC	0.64	Vert(LL)	0.13	MT20		244/190	
TCDL	7.0	Lumber DOL		BC	0.72	Vert(CT)	-0.26	Weight: 143 lb FT = 20%			
BCLL	0.0 *	Rep Stress Incr		WB	0.30	Horz(CT)	0.08				
BCDL	10.0	Code FBC2023/TP12014		Matrix-MS							

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=150(LC 16)  
Max Uplift 2=324(LC 12), 6=285(LC 13)  
Max Grav 2=1196(LC 1), 6=1111(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1984/481, 3-4=-1352/368, 4-5=-1353/367, 5-6=-1994/489  
BOT CHORD 2-9=-468/1704, 8-9=-469/1701, 7-8=-351/1712, 6-7=-351/1715  
WEBS 4-8=-173/792, 5-8=-692/331, 5-7=0/320, 3-8=-679/323, 3-9=0/318

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 15-0-8, Zone2 15-0-8 to 19-3-7, Zone1 19-3-7 to 30-1-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60 to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=324, 6=285.

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-5 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 8-4-3 oc bracing.  
WEBS 1 Row at midpt 5-8, 3-8

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com







Job	Truss	Truss Type	Qty	Ply	GIEGEG CONST. - LOT 57 CW	T32708467
3842048	T10	Common	1	1		

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:17 2024 Page 1  
ID:RijugoliQ9qlqT\_5C/Ydzq7NP-6n8yZEAJqyhKZWT?w573py2gNjwcPc\_wwrDg?Uzsk34



4x6 =

Scale = 1:47.3

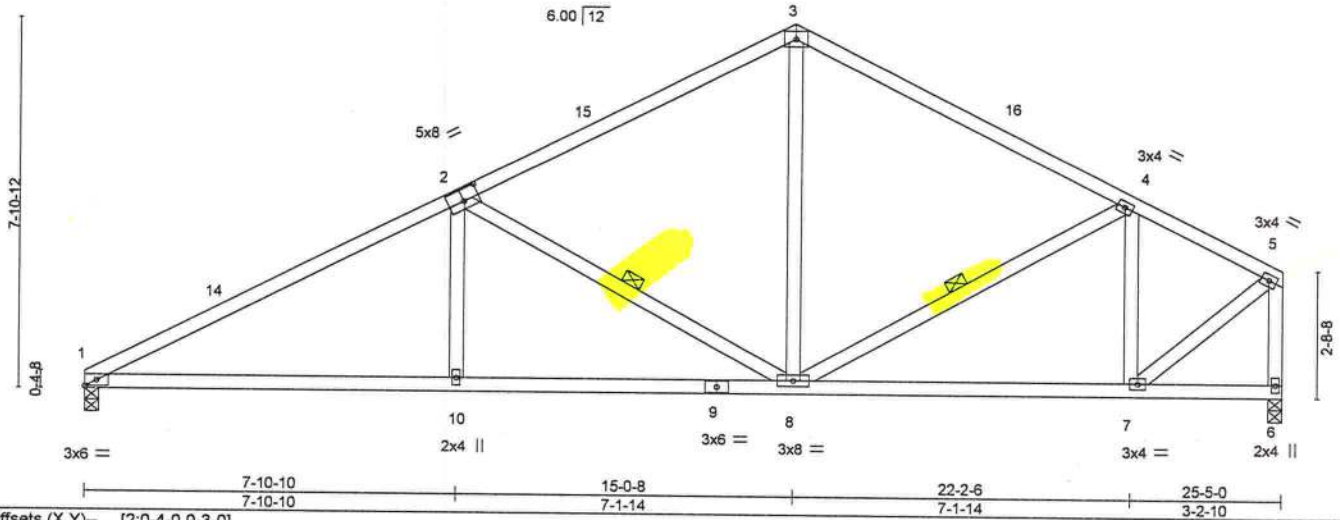


Plate Offsets (X,Y) [2-0-4-0-0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.64	Vert(LL)	0.12	10-13	>999	240	MT20
TCCL 7.0	Lumber DOL	1.25	BC 0.66	Vert(CT)	-0.23	10-13	>999	180	244/190
BCCL 0.0 *	Rep Stress Incr	YES	WB 0.34	Horz(CT)	0.04	6	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS						
								Weight: 134 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### REACTIONS.

(size) 1=0-3-8, 6=0-3-8  
Max Horz 1=178(LC 12)  
Max Uplift 1=250(LC 12), 6=217(LC 13)  
Max Grav 1=935(LC 1), 6=935(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-1608/412, 2-3=-966/268, 3-4=-961/288, 4-5=-781/199, 5-6=-924/235  
BOT CHORD 1-10=-460/1370, 8-10=-460/1367, 7-8=-163/698  
WEBS 2-10=0/318, 2-8=-693/331, 3-8=-98/487, 4-7=-444/171, 5-7=-214/900

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 15-0-8, Zone2 15-0-8 to 19-3-7, Zone1 19-3-7 to 25-3-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=250, 6=217.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingle Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinet.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingle Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	GIEGEIG CONST. - LOT 57 CW	T32708468
3842048	T11	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:19 2024 Page 2  
ID: fRijugoliQj9qlqT\_5Ciydzq7NP-39Gj\_wCZMz2oqdO2WAXuN7?EWiDiRIDO9in4Nzsk32

#### LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-9=-54, 9-12=-54, 2-11=-20

Concentrated Loads (lb)

Vert: 4=-110(B) 7=-110(B) 9=-182(B) 17=-335(B) 16=-64(B) 6=-110(B) 14=-64(B) 13=-335(B) 22=-110(B) 23=-110(B) 24=-110(B) 25=-110(B) 26=-110(B)  
27=-64(B) 28=-64(B) 29=-64(B) 30=-64(B) 31=-64(B)

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job 3842048	Truss T13	Truss Type Hip	Qty 1	Ply 1	GIEGIG CONST. - LOT 57 CW	T32708470
----------------	--------------	-------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

Job Reference (optional)  
8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:22 2024 Page 1  
ID:fRijugolQj9qlqT\_5CiYdzq7NP-TkxrdyESfUjdfHMzjfiEW0idekcW4u6f47xRghzsk3?



Scale = 1:54.8

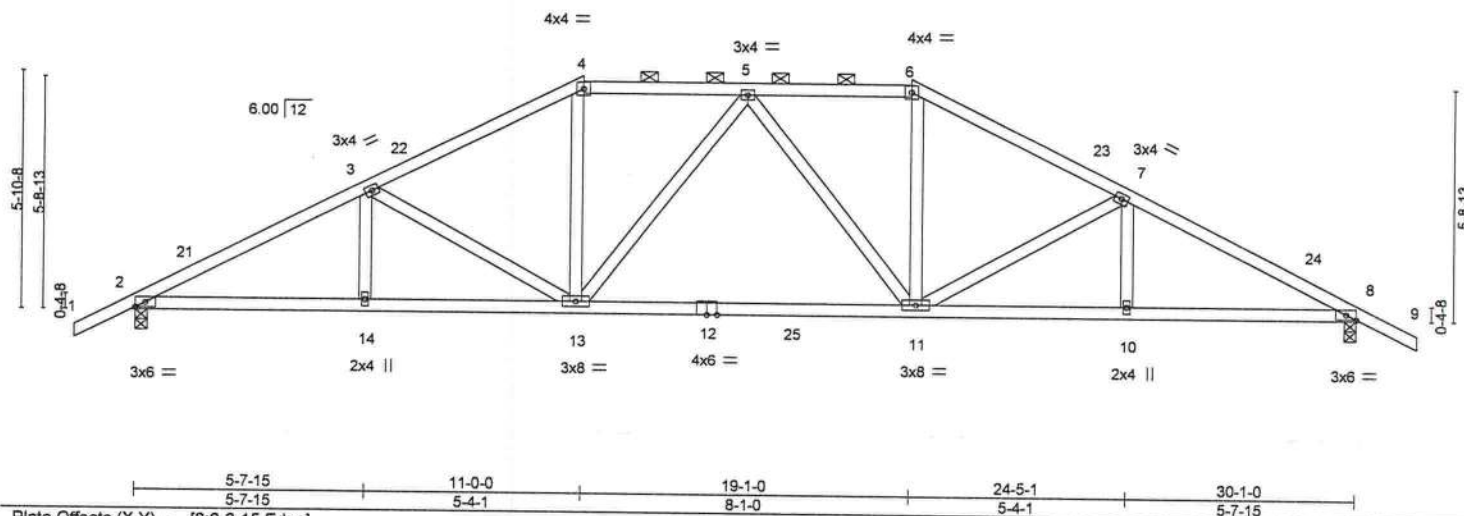

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.29	Vert(LL)	-0.23 11-13 >999	MT20	244/190		
TCDL	7.0	Lumber DOL	1.25	BC	0.81	Vert(CT)	-0.41 11-13 >880				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.29	Horz(CT)	0.09 8 n/a n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							
								Weight: 158 lb		FT = 20%	

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-9-8 oc purlins, except
BOT CHORD	2x4 SP No.2	BOT CHORD	2-0-0 oc purlins (4-7-11 max.): 4-6.
WEBS	2x4 SP No.3		Rigid ceiling directly applied or 8-5-3 oc bracing.

<b>REACTIONS.</b>		<b>FORCES.</b>	
(size)	2=0-3-8, 8=0-3-8	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
Max Horz	2=102(LC 16)	TOP CHORD	2-3=-2225/529, 3-4=-1818/433, 4-5=-1569/423, 5-6=-1569/423, 6-7=-1818/433, 7-8=-2225/530
Max Uplift	2=-331(LC 12), 8=-331(LC 13)	BOT CHORD	2-14=-486/1950, 13-14=-486/1950, 11-13=-287/1653, 10-11=-385/1950, 8-10=-385/1950
Max Grav	2=1270(LC 2), 8=1270(LC 2)	WEBS	3-13=-430/221, 4-13=-102/598, 5-13=-271/132, 5-11=-271/132, 6-11=-101/598, 7-11=-430/222

<b>NOTES-</b>	
1) Unbalanced roof live loads have been considered for this design.	
2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 11-0-0, Zone2 11-0-0 to 15-0-8, Zone1 15-0-8 to 19-1-0, Zone2 19-1-0 to 23-3-15, Zone1 23-3-15 to 31-7-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60	
3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.	
4) Provide adequate drainage to prevent water ponding.	
5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	
6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.	
7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=331, 8=331.	
8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.	

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA, Inc. 16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24,2024



**WARNING -** Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job 3842048	Truss T15	Truss Type QUEENPOST	Qty 1	Ply 1	GIEGIG CONST. - LOT 57 CW T32708472
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,


8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:25 2024 Page 1

ID: fRijugoliQj9qlqT\_5CiYdzq7NP-tJd\_FzGKyPhBWI4YOnHx7eNAMxkUHEw6m595G0zsk2y

Job Reference (optional)



Scale = 1:27.3

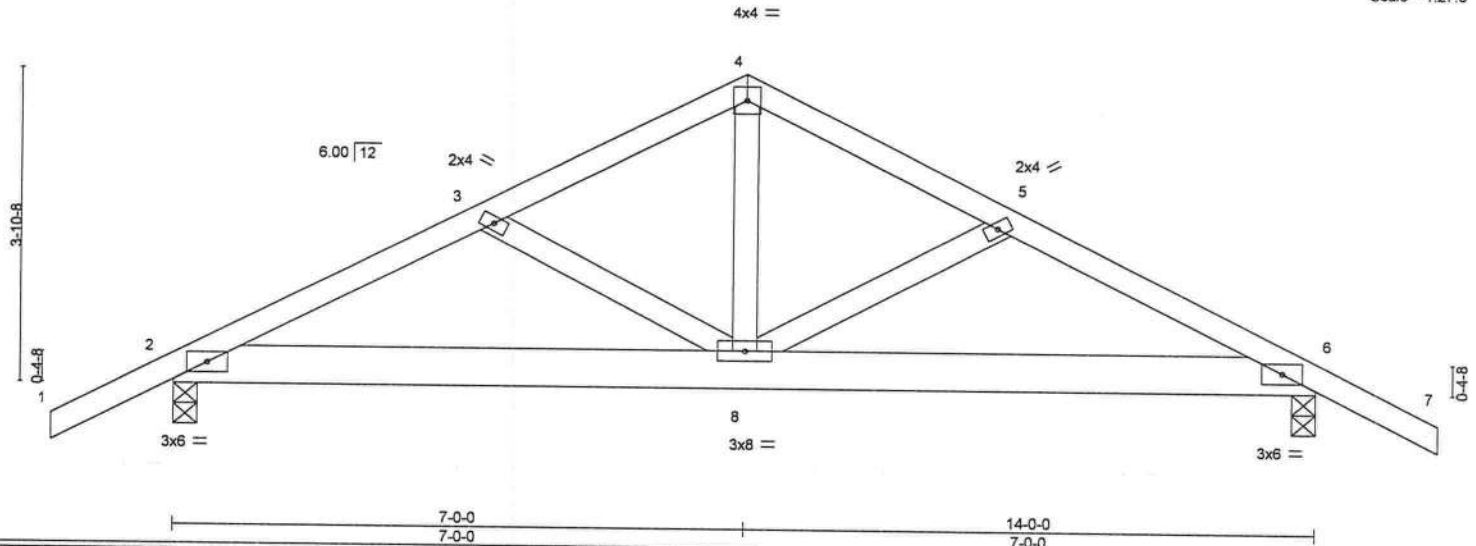

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	0.05	8-10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.34	Vert(CT)	-0.07	8-10	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.35	Horz(CT)	0.02	6	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS							
									Weight: 76 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-11 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 9-5-1 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=-71(LC 34)  
Max Uplift 2=-386(LC 8), 6=-386(LC 9)  
Max Grav 2=906(LC 1), 6=906(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1499/685, 3-4=-1326/651, 4-5=-1326/651, 5-6=-1499/685  
BOT CHORD 2-8=-611/1321, 6-8=-563/1321  
WEBS 4-8=-466/906

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=386, 6=386.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 101 lb down and 100 lb up at 7-0-0 on top chord, and 541 lb down and 409 lb up at 7-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 2-6=-20, 1-4=-54, 4-7=-54  
Concentrated Loads (lb)  
Vert: 4=-73(B) 8=-541(B)

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No. 58126  
MiTek Inc. DBA MiTek USA, Inc. Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024



**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	GIEGEIG CONST. - LOT 57 CW	T32708474
3842048	T17	Common	1	1		

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:28 2024 Page 1  
ID:RijugolIQj9qlqT\_5CiYdzq7NP-lul7t?JDEK4mNCp73vqelH7hn8pkUf?YS3OitLzsk2v



Scale = 1:20.9

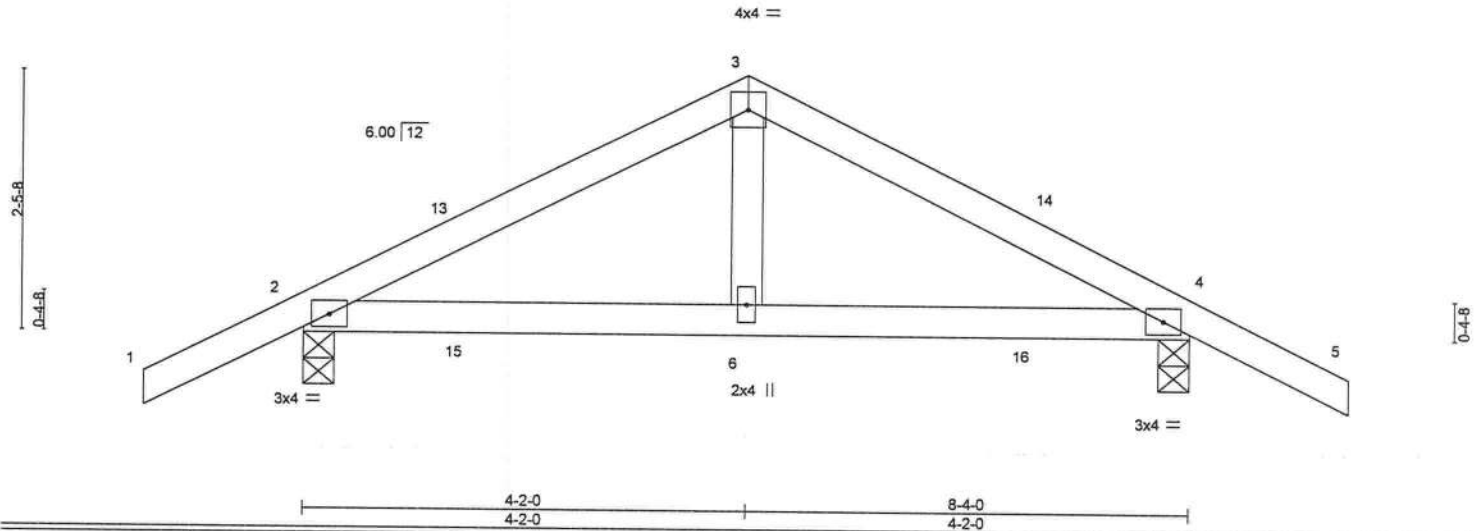

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.19	Vert(LL)	0.02	6-12	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.18	Vert(CT)	-0.02	6-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS							
									Weight: 34 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 4=0-3-8  
Max Horz 2=47(LC 12)  
Max Uplift 2=119(LC 12), 4=119(LC 13)  
Max Grav 2=389(LC 1), 4=389(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=390/320, 3-4=390/321  
BOT CHORD 2-6=167/310, 4-6=167/310

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-2-0, Zone2 4-2-0 to 8-4-0, Zone1 8-4-0 to 9-10-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=119, 4=119.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024



**WARNING -** Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




Job #	Truss	Truss Type	Qty	Ply	GIEGIG CONST. - LOT 57 CW	T32708476
3842048	T18	Common	3	1		

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Mon Jan 22 17:50:31 2024 Page 1  
ID: fRijugoliQj9qlqT\_5CiYdzq7NP-T\_FWOL5XFSLEgYil2NLNvdBMMpDh?i\_81cQUgzsk2s



Scale = 1:17.6

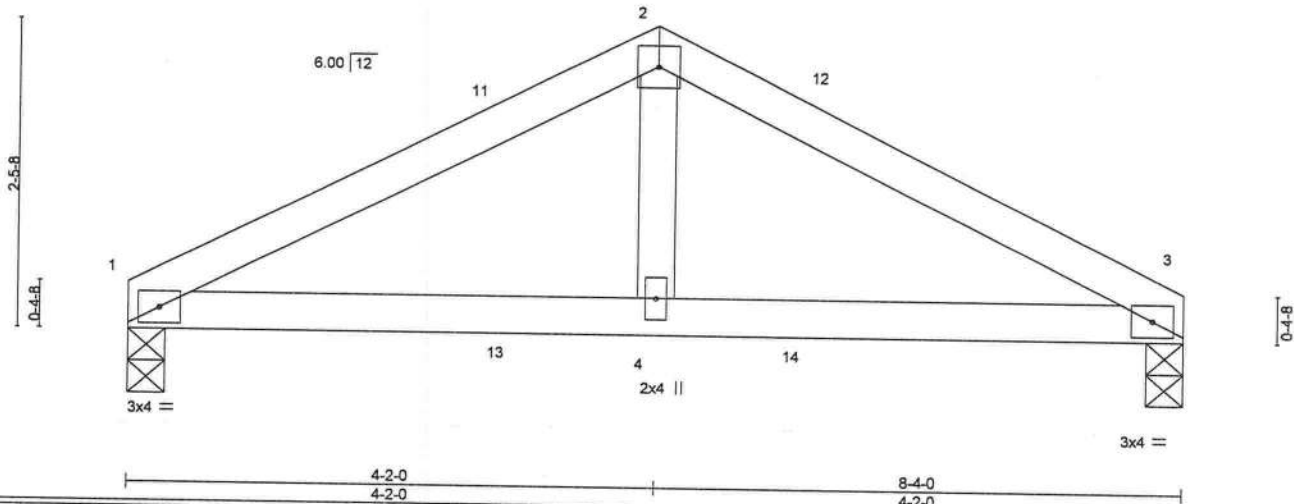

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.23	Vert(LL)	0.02	4-10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.19	Vert(CT)	-0.02	4-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS							
									Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=0-3-8, 3=0-3-8  
Max Horz 1=35(LC 13)  
Max Uplift 1=99(LC 9), 3=99(LC 8)  
Max Grav 1=308(LC 1), 3=308(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=430/433, 2-3=430/417  
BOT CHORD 1-4=289/349, 3-4=289/349

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 4-2-0, Zone3 4-2-0 to 8-4-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 24, 2024



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI Quality Criteria and OSB-22 available from Truss Plate Institute (www.tpinet.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



## 56-04-00



- Per AISI/PSI-1:2002 all "Truss to Wall" connections shall be designed to transfer all loads from the responsibility of the Building Designer, not the Truss Manufacturer.
- Use Manufacturer's specifications for all hanger connections unless noted otherwise.
- Trusses are to be 24' o.c. U.N.O.
- All hangers are to be Simpson or equivalent U.N.O.
- Use 100 x 1 1/2" Nails in hanger connections to single ply girders trusses.
- Trusses are not designed to support brick U.N.O.
- Dimensions are Feet-Inches-Sixteenths

No back charges will be accepted by Builders FirstSource unless approved in writing first.  
850-835-4541

850-835-4541

ACQ lumber is corrosive to truss plates. Any ACQ lumber that comes in contact with truss plates (i.e. scabbled on tails) must have an approved barrier applied first.

Refer to BCSI-B1 Summary Sheet-Guide for handling, Installing and Bracing of Metal Plate Connected Wood Truss prior to and during truss installation.

It is the responsibility of the Contractor to ensure of the proper orientation of the Truss placement plans as to the construction documents and field conditions of the structure orientation. If a reversed or flipped layout is required, it will be supplied at no extra cost by Builders FirstSource.


It is the responsibility of the Contractor to make sure the placement of trusses are adjusted for plumbing drops, can lights, ect.... so the trusses do not interfere with these type of items.

All common framed roof or floor systems must be designed as to NOT impose any loads on the floor trusses below. The floor trusses have not been designed to carry any additional loads from above.

This truss placement playwas not created by an engineer, but rather by the Builders FirstSource staff and is solely to be used as an installation guide and does not require a seal. Complete truss engineering and analysis can be found on the truss design drawings which may be sealed by the truss design engineer.

Cable end trusses require continuous bottom chord bearing. Refer to local codes for wall framing requirements.

Although all attempts have been made to do so, trusses may not be designed symmetrically. Please refer to the individual truss drawings and truss placement plans for proper orientation and placement.



**Jacksonville**  
PHONE: 904-772-6100  
FAX: 904-772-1973

**Tallahassee**  
PHONE: 850-576-5177

Builder:  
**GEIBIG CONST.**

### Lot 57 Crosswinds

Model: St. Johns w/Step Ceiling

MITTEK PLATE APPROVAL #'S 2197.2-2197.4, BOISE EWP PRODUCT #'S LVL FL1644-R2, BCI JOISTS FL1392-R2

Date:	1-22-24	Drawn By:	KLH	Original Ref #:	3842048
Floor 1 Job#	N/A	Floor 2 Job#:	N/A	Roof Job #:	3842048