



FOOTING SCHEDULE				
MARK	SIZE (D x W x L)	TYPE	REINFORCEMENT	REMARKS
F1	16" x 24"	SPREAD	1 - #5 STL. REBAR TOP CONT. 2 - #5 STL. REBAR BOTTOM CONT.	
F2	12" x 24"	SPREAD	1 - #5 STL. REBAR TOP CONT. 2 - #5 STL. REBAR BOTTOM CONT.	
F3	12" x 36"	SPREAD	1 - #5 STL. REBAR TOP CONT. 2 - #5 STL. REBAR BOTTOM CONT.	

COLUMN SCHEDULE					
MARK	TYPE	SIZE (LxWxT)	REINFORCEMENT	#3 TIES	REMARKS
C1	GROUT-FILLED CELL	(1x) 8" x 8"	(1x) - #5 REBAR VERT.	-	(1) FILLED CELL
C2	GROUT-FILLED CELL	(2x) 8" x 8"	(2x) - #5 REBAR VERT.	-	(2) FILLED CELL
C3	GROUT-FILLED CELL	(3x) 8" x 8"	(3x) - #5 REBAR VERT.	-	(3) FILLED CELL
C4	GROUT-FILLED CELL	(4x) 8" x 8"	(4x) - #5 REBAR VERT.	-	(4) FILLED CELL
C5	GROUT-FILLED CELL	(5x) 8" x 8"	(5x) - #5 REBAR VERT.	-	(5) FILLED CELL
C6	HSS4x4x3/16"	4" x 4" x 3/16"			

- FOUNDATION NOTES:**
- ROUGH OPENINGS:**  
CONTRACTOR SHALL SELECT WINDOW & DOOR SIZES AS NEAR AS POSSIBLE TO THOSE SPECIFIED AND SHALL ADJUST ROUGH OPENINGS AS NECESSARY TO ACCOMMODATE WINDOWS & DOORS SELECTED. DIFFERENCES IN WINDOW/DOOR DIMENSIONS GREATER THAN 8" IN ANY DIRECTION SHALL BE REPORTED TO ENGINEER PRIOR TO ORDERING.
  - TERMITE PROTECTION**  
ALL SOIL AND FILL UNDER NEW FLOORS AND/OR UNDER BUILDINGS SHALL HAVE PRE-CONSTRUCTION SOIL TREATMENT FOR PROTECTION AGAINST SUBTERRANEAN TERMITES, AS PER "FLORIDA BUILDING CODE 2023 8TH EDITION". A "CERTIFICATE OF COMPLIANCE" SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT:  
"The building has received a complete treatment for the prevention of subterranean termites. Treatment is in accordance with the rules and laws established by the Florida Department of Agriculture and Consumer Services".
  - CONTRACTOR TO VERIFY THAT THE SOIL CONDITION IS ADEQUATE TO SUPPORT A DESIGN LOAD OF 2,500 P.S.F. - IF ANY OTHER CONDITION IS FOUND AT SITE, NOTIFY ENGINEER PRIOR TO PROCEEDING WITH WORK.
  - CONTRACTOR TO COORDINATE WITH SURVEYOR AND MAINTAIN MIN. 18" ABOVE CROWN OF ROAD FOR NEW SLAB AND EQUIPMENT ELEVATION.
  - ALL CORNER BARS ARE REQUIRED A MINIMUM OF 36 BAR DIAMETERS EACH WAY.
  - ALL LAPS IN STEEL REBAR TO BE A MINIMUM OF 36 BAR DIAMETERS.
  - REINFORCE SLAB-ON-GRADE WITH ONE LAYER OF 6"x 6" W1.4 x W1.4 WELDED WIRE MESH.
  - PROVIDE 30" WIDE DOUBLE LAYER OF 6"x 6" W1.4 x W1.4 WELDED WIRE MESH - TYPICAL ALL AROUND ENTIRE PERIMETER OF CONCRETE SLAB.
  - PROVIDE #4 x 3'-0" LONG CRACK CONTROL REINFORCEMENT @ MID OF SLAB (TYP.) (ALL FLOOR CORNERS)

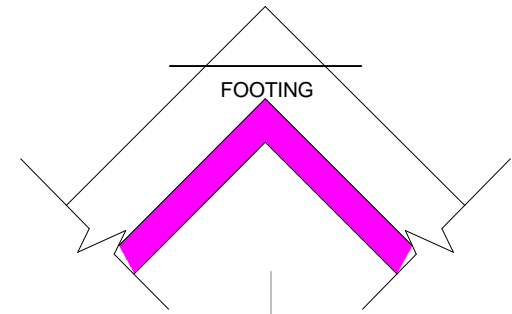

1 Foundation Plan  
3/16" = 1'-0"

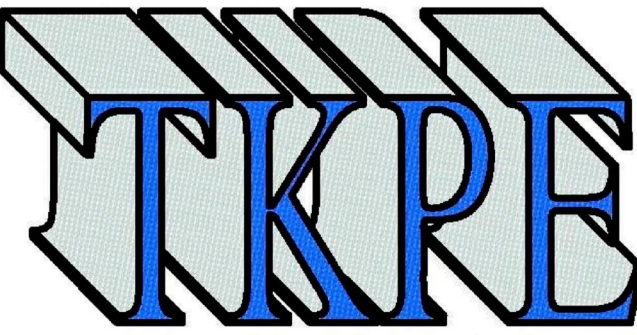

Thomas M. Kelaher, P.E.  
Structural Consultants  
Florida Rg. No 40159  
1108 S.E. 14th Terrace  
Deerfield Beach, FL 33441  
Phone (954) 360.9628  
Fax (954) 360.0173  
tkelaherengr@comcast.net

Dana & Carol (Wendy) Anderson  
Residence

SW Meadowlands Drive  
Lake City, Florida

No.	Description	Date

Proposed Residence

Foundation Plan

Project number	24-045
Date	12/25/2024
Drawn by	A.O.
Checked by	T.K.

S102.2

Scale As indicated