


BEARING WOOD INTERIOR WALL SCHEDULE					
MARK	STUD SPACING	CONNECTION & FASTENERS		LUMBER SPECIES	UPLIFT CAP (PIF)
		TOP	BOTTOM		
BW1	16"	(2) 16d TOENAILS	(2) 16d TOENAILS	SPF	0
BW2	16"	SP2 W/ (6)10d NAILS	SP1 W/ (6)10d NAILS	SPF	402
BW3	16"	SP4 W/ (6) 10d x 1 1/2" NAILS	SP4 W/ (6) 10d x 1 1/2" NAILS	SPF	571
BW4	16"	(2) 16d TOENAILS	(2) 16d TOENAILS	SYP	0
BW5	16"	SP2 W/ (6)10d NAILS	SP1 W/ (6)10d NAILS	SYP	439
BW6	16"	SP4 W/ (6) 10d x 1 1/2" NAILS	SP4 W/ (6) 10d x 1 1/2" NAILS	SYP	665
BW7	12"	(2) 16d TOENAILS	(2) 16d TOENAILS	SPF	0
BW8	12"	SP2 W/ (6)10d NAILS	SP1 W/ (6) 10d NAILS	SPF	535
BW9	12"	SP4 W/ (6) 10d x 1 1/2" NAILS	SP4 W/ (6) 10d x 1 1/2" NAILS	SPF	760
BW10	12"	(2) 16d TOENAILS	(2) 16d TOENAILS	SYP	0
BW11	12"	SP2 W/ (6)10d NAILS	SP1 W/ (6) 10d NAILS	SYP	585
BW12	12"	SP4 W/ (6) 10d x 1 1/2" NAILS	SP4 W/ (6) 10d x 1 1/2" NAILS	SYP	885

NOTE: 2 x 4 WALLS ARE ASSUMED U.N.O. ON FLOOR PLANS
* ALL LUMBER TO BE GRADE #2
** CONNECTIONS TO BE INSTALLED TO EACH STUD AS INDICATED
*** SPFS & SPFS CAN BE SUB. TOP SPFS W/ RESPECT TO STUD SIZE

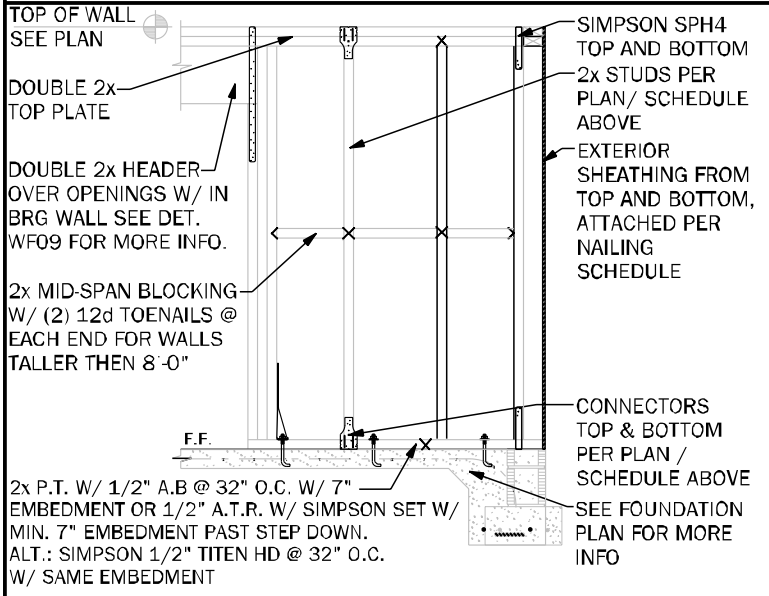

BEARING INTERIOR WALL DETAIL

DOUBLE 2x HEADER OVER OPENINGS W/ IN BRG WALL. SEE DET. W/09 FOR MORE INFO.

2x MID-SPAN BLOCKING W/ (2) 12d TOENAILS @ EACH END FOR WALLS TALLER THAN 8'-0".

2x P.T. W/ 1/2" A.B. @ 32" O.C. W/ 7" EMBEDMENT OR 1/2" A.T.R. W/ SIMPSON SET W/ MIN. 7" EMBEDMENT FAST STEP DOWN. (N.T. SIMPSON 1/2" X 12" HSS @ 32" O.C. W/ SAME EMBEDMENT)

GENERAL NOTES

- SEE FLOOR PLAN FOR WALL SIZE. ASSUME 2x4 STUDS USED U.N.O.
- ALL STRUCTURAL LUMBER TO BE SYP #1 OR SPF #2 UNO ON PLAN.
- CONNECTIONS TO BE INSTALLED TO EACH STUD AS INDICATED.
- CONTACT E.O.R. IF SP4 S OR SP5 S OR SPFS CONNECTORS ARE SUBSTITUTED, TO VERIFY THEY MEET THE STRUCTURAL REQUIREMENTS.
- IF "BW" IS INDICATED ON SECOND FLOOR BASE CONNECTION TO IGNORE. SEE WORKS/SS OR INDICATED DETAIL FOR PROPER CONNECTIONS FOR 2nd FLOOR TO FIRST FLOOR CONNECTION. (NOTE: THIS IS FOR 2 STORY PROJECTS ONLY).
- IF "SW" IS INDICATED THE WALL IS CONSIDERED A SHEARWALL AND REQUIRES WIND. (IF OSB PLYWOOD W/ 8d NAILS AT 4" O.C. IN FIELD AND EDGE TO 11" SIDE OF WALL).
- ALL 2x EXTERIOR WALLS W/ EXTERIOR SHEATHING ATTACHED PER NAILING SCHEDULE ACT AS SHEARWALLS. SEE PLAN AND WALL SECTIONS FOR STUD SPACING AND GRADE.
- IF THE BEARING WALL IS INDICATED WITH THE BW1, BW4, BW7, BW10 THESE WALLS ARE ONLY SUPPORTING THE FLOOR LOAD AND DO NOT HAVE UPLIFT. THE STUDS ARE TOE NAIL TO THE PLATE AND THE 2x PLATE CAN BE ATTACHED WITH HARD CASED NAILS (GUN NAILS) AND WILL NOT REQUIRE THE ANCHOR BOLT ATTACHMENT INDICATED IN THE BEARING WALL SCHEDULE.

COLUMN SCHEDULE				
MARK	COLUMN SIZE	(BASE) CONN. & FASTENER	UPLIFT(LBS)	
C1	(3) 2 x 4 #2 SPF	(4) 16d TOENAILS	0	
C2	(3) 2 x 4 #2 SPF	DT122 W/ 1/2" WEDGE ANCHOR* & (8) 1/4" X 1 1/2" SDS SCREWS	2145	
C3	(3) 2 x 4 SYP #1 GR.	(4) 16d TOENAILS	0	
C4	(4) 2 x 4 SPF #2	DT122 W/ 1/2" WEDGE ANCHOR* & (8) 1/4" X 1 1/2" SDS SCREWS	2145	
C5	4 x 4 P.T.#2 SYP POST	ABU44 W/ 5/8" ATR** & (12) 16d NAILS	G = 6665 U = 2200	
C6	6 x 6 P.T.#2 SYP POST	ABU66 W/ 5/8" ATR** & (12) 16d NAILS	G = 12000 U = 2200	
C7	8 x 8 P.T.#2 SYP POST	ABU88 W/ (2) 5/8" ATR** & (18) 16d NAILS	G = 24335 U = 2330	
C8	3.5 x 3.5 P.L. 1.8E Rb-2400 PSI (WOLMANIZED IF EXT.)	HDUS-SDS2.5 W/ (14) 1/4" x 2 1/2" SDS WS & 5/8" EPOXY ANCHOR, OR ATR**	5645	
C9	3.5 x 3.5 P.L. 1.8E Rb-2400 PSI (WOLMANIZED IF EXT.)	HDUS-SDS2.5 W/ (14) 1/4" x 2 1/2" SDS WS & 5/8" EPOXY ANCHOR, OR ATR**	5645	
C10	3.5 x 7 P.L. 1.8E Rb-2400 PSI (WOLMANIZED IF EXT.)	HDUS-SDS2.5 W/ (20) 1/4" x 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	6970	
C11	5.25 x 5.25 P.L. 1.8E Rb-2400 PSI (WOLMANIZED IF EXT.)	HDUS-SDS2.5 W/ (20) 1/4" x 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	7870	
C12	7 x 7 P.L. 1.8E Rb-2400 PSI (WOLMANIZED IF EXT.)	HDUS-SDS2.5 W/ (20) 1/4" x 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	7870	
C13	5.25" x 7" P.L. 1.8E Rb-2400 PSI (WOLMANIZED IF EXT.)	HDUS-SDS2.5 W/ 7/8" ATR AND (20) 1/4" x 1/2" SDS WOOD SCREWS	7870	

GENERAL COLUMN NOTES

- SEE FLOOR PLAN FOR WALL WIDTH. STUD PACKS TO MATCH WALL WIDTH UNO.
- ALL STRUCTURAL LUMBER TO BE SYP #1 OR SPF #2 UNO ON PLAN.
- NAIL BUILD UP STUDS PER DETAIL WFS7
- MINIMUM BOLT EMBEDMENT:
 - 5" EMBEDMENT FOR 1/2" ATR
 - 6" EMBEDMENT FOR 5/8" ATR
 - 8" EMBEDMENT FOR 7/8" ATR
- IF (C) COLUMN IS INDICATED ON SECOND FLOOR, THE BASE CONNECTION IS NOT REQUIRED. (SEE INDICATED CALL OUT ON PLAN FOR ATTACHMENT)
- SEE WOOD CONSTRUCTION NOTE #4 ON COVER SHEET FOR CORROSION INFORMATION
- SAME NOMINAL SIZE PARALLEL COLUMNS (LBS) MAY BE SUBSTITUTED FOR ANY P.T. SYP POST NOTED IN THE PLANS

COMMON NAIL vs. PNEUMATIC GUN NAILS:				
COMMON NAIL	DIA. / LENGTH	PNEUMATIC GUN NAIL	COMMON vs. GUN NAIL DIA. LENGTH	APPLICATION
8d	0.131" X 2 1/2"	0.131" X 2 1/2"	SEE PLAN RING SHANK ON ROOF	SHEATHING ROOF & WALLS
10d OR 12d	0.148" X 3"	0.131" X 3"	SEE PLAN	BLOCKING & TOE NAILS & TOP PLATE
12d	0.148" X 3 1/4"	0.131" X 3 1/4"	8" O.C. (COMMON)	STUD WALL CORNERS
10d	0.148" X 3"	0.131" X 3"	6" O.C. (COMMON)	STUD PACK COLUMNS
16d	0.162" X 3 1/2"	0.131" X 3 1/2"	(2) 16d (COMMON)	SEE PLAN

HEADER SCHEDULE		
MARK	HEADER SIZE	REMARKS
H1	(2) - 2X6 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H2	(2) - 2X8 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H3	(2) - 2X10 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H4	(2) - 2X12 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H5	(2) - 1 3/4" X 11 1/4" LVL 2.0E Fb-2600 PSI	ATTACH TOGETHER W/ (2) ROWS 14" X 3 1/2" SDS WD SCREWS @ 16" O.C. TYP. EACH SIDE
H6	(2) - 1 3/4" X 9 1/4" LVL 2.0E Fb-2600 PSI	ATTACH TOGETHER W/ (3) ROWS 14" X 3 1/2" SDS WD SCREWS @ 16" O.C. TYP. EACH SIDE

HEADER SUPPORT NO. OF JACKS & STUDS REQ. AT OPENINGS				
OPENING SIZE	2x4 WALL		2x6 OR 2x8 WALL	
	JACKS EA. END	KINGS EA. END	JACKS EA. END	KINGS EA. END
1'-0" - 3'-11"	(1)	(2)	(1)	(2)
4'-0" - 9'-11"	(2)	(3)	(2)	(3)
10'-0" - 16'-0"	(3)	(4)	(3)	(4)


GENERAL HEADER NOTES

- VERIFY W/ PLAN CORRECT LENGTH OF HEADER REQUIRED
- IF HEADER IS ON THE 1st FLOOR SEE PLAN FOR BEARING WALL TYPE AND FOLLOW INSTRUCTIONS WITHIN BEARING WALL SCHEDULE FOR REQUIRED CORRECTIONS UNO ON PLAN
- IF HEADER IS ON THE 2nd FLOOR SEE PLAN FOR INDICATED HEADER CONNECTION FOR REQUIRED CONNECTIONS
- ALL HEADER JACK AND KING STUDS SHALL BE FASTENED TO EACH PER DETAIL WFS7
- FASTEN ALL MULTI-PLY HEADERS TOGETHER W/ (2) ROWS 12d COMMON NAILS AT 12" o.c. ALONG EACH EDGE OR (3) ROWS IF 2X10 OR LARGER
- FASTEN ALL HEADERS TO KING STUDS WITH (3) 12d TOENAILS PER SIDE
- IF HEADER IS NOT SPECIFIED CONTACT E.O.R.

BEAM SCHEDULE		
MARK	BEAM SIZE	CONNECTIONS
BM1	(2) 2 x 8 #2 SYP W/ 7/16" OSB FLITCH PLATE, NAIL BEAM TOGETHER USING (2) ROWS OF 12d NAILS @ 12" O.C. TYP. EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HTS16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM2	(2) 2 x 10 #2 SYP W/ 7/16" OSB FLITCH PLATE, NAIL BEAM TOGETHER USING (2) ROWS OF 12d NAILS @ 12" O.C. TYP. EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HTS16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM3	(2) 2 x 12 #2 SYP W/ 7/16" OSB FLITCH PLATE, NAIL BEAM TOGETHER USING (2) ROWS OF 12d NAILS @ 12" O.C. TYP. EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HTS16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM4	(2) - 1 3/4" x 11 1/4" LVL 2.0E Fb-2600 PSI. NAIL BEAM TOGETHER USING (2) ROWS 1/4" x 3 1/2" SDS WOOD SCREWS @ 16" O.C. TYP. EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HTS16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM5	(2) - 1 3/4" x 11 7/8" LVL 2.0E Fb-2600 PSI. NAIL BEAM TOGETHER USING (2) ROWS 1/4" x 3 1/2" SDS WOOD SCREWS @ 16" O.C. TYP. EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HTS16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM6	(2) - 1 3/4" x 16" LVL 2.0E Fb-2600 PSI. NAIL BEAM TOGETHER USING (2) ROWS 1/4" x 3 1/2" SDS WOOD SCREWS @ 16" O.C. TYP. EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HTS16 TO CMU COL. U.N.O. ON ROOF PLAN.

GENERAL BEAM NOTES


- VERIFY WITH PLAN CORRECT LENGTH OF BEAMS REQUIRED (MIN. 4" BEARING EACH END)
- SEE PLAN FOR TOP OR BOTTOM OF BEAM INDICATIONS
- BEAMS ARE NOT TO BE DRILLED OR NOTCHED IN ANY WAY WITHOUT WRITTEN APPROVAL FROM THE E.O.R.

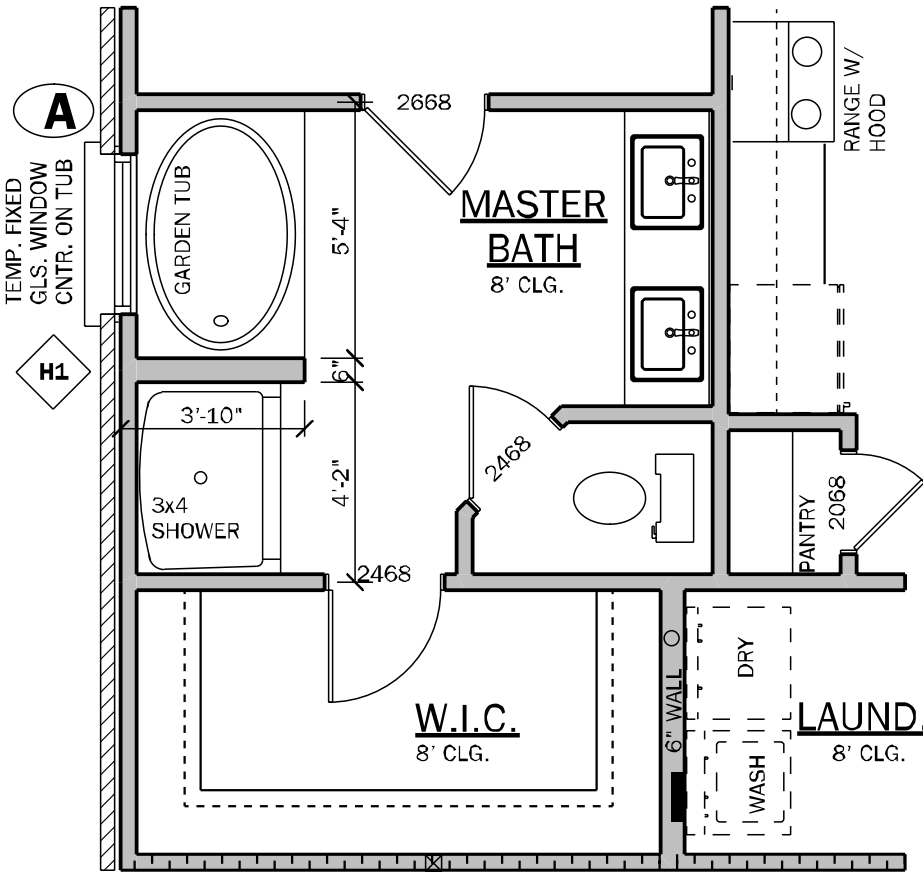

MASTER BA. OPTIONS	
Y	2030 (1) P.C. FIBERGLASS SHOWER IN LIEU OF LINEN CLOSET W/ (1) L.E.D. DISC. L.T.
N	3'-4" X 4'-0" TEMP. FIXED GLS. WINDOW CNTR. ON TUB

OPTIONAL MASTER BATH

NOTE: NO DIMENSIONAL CHANGES

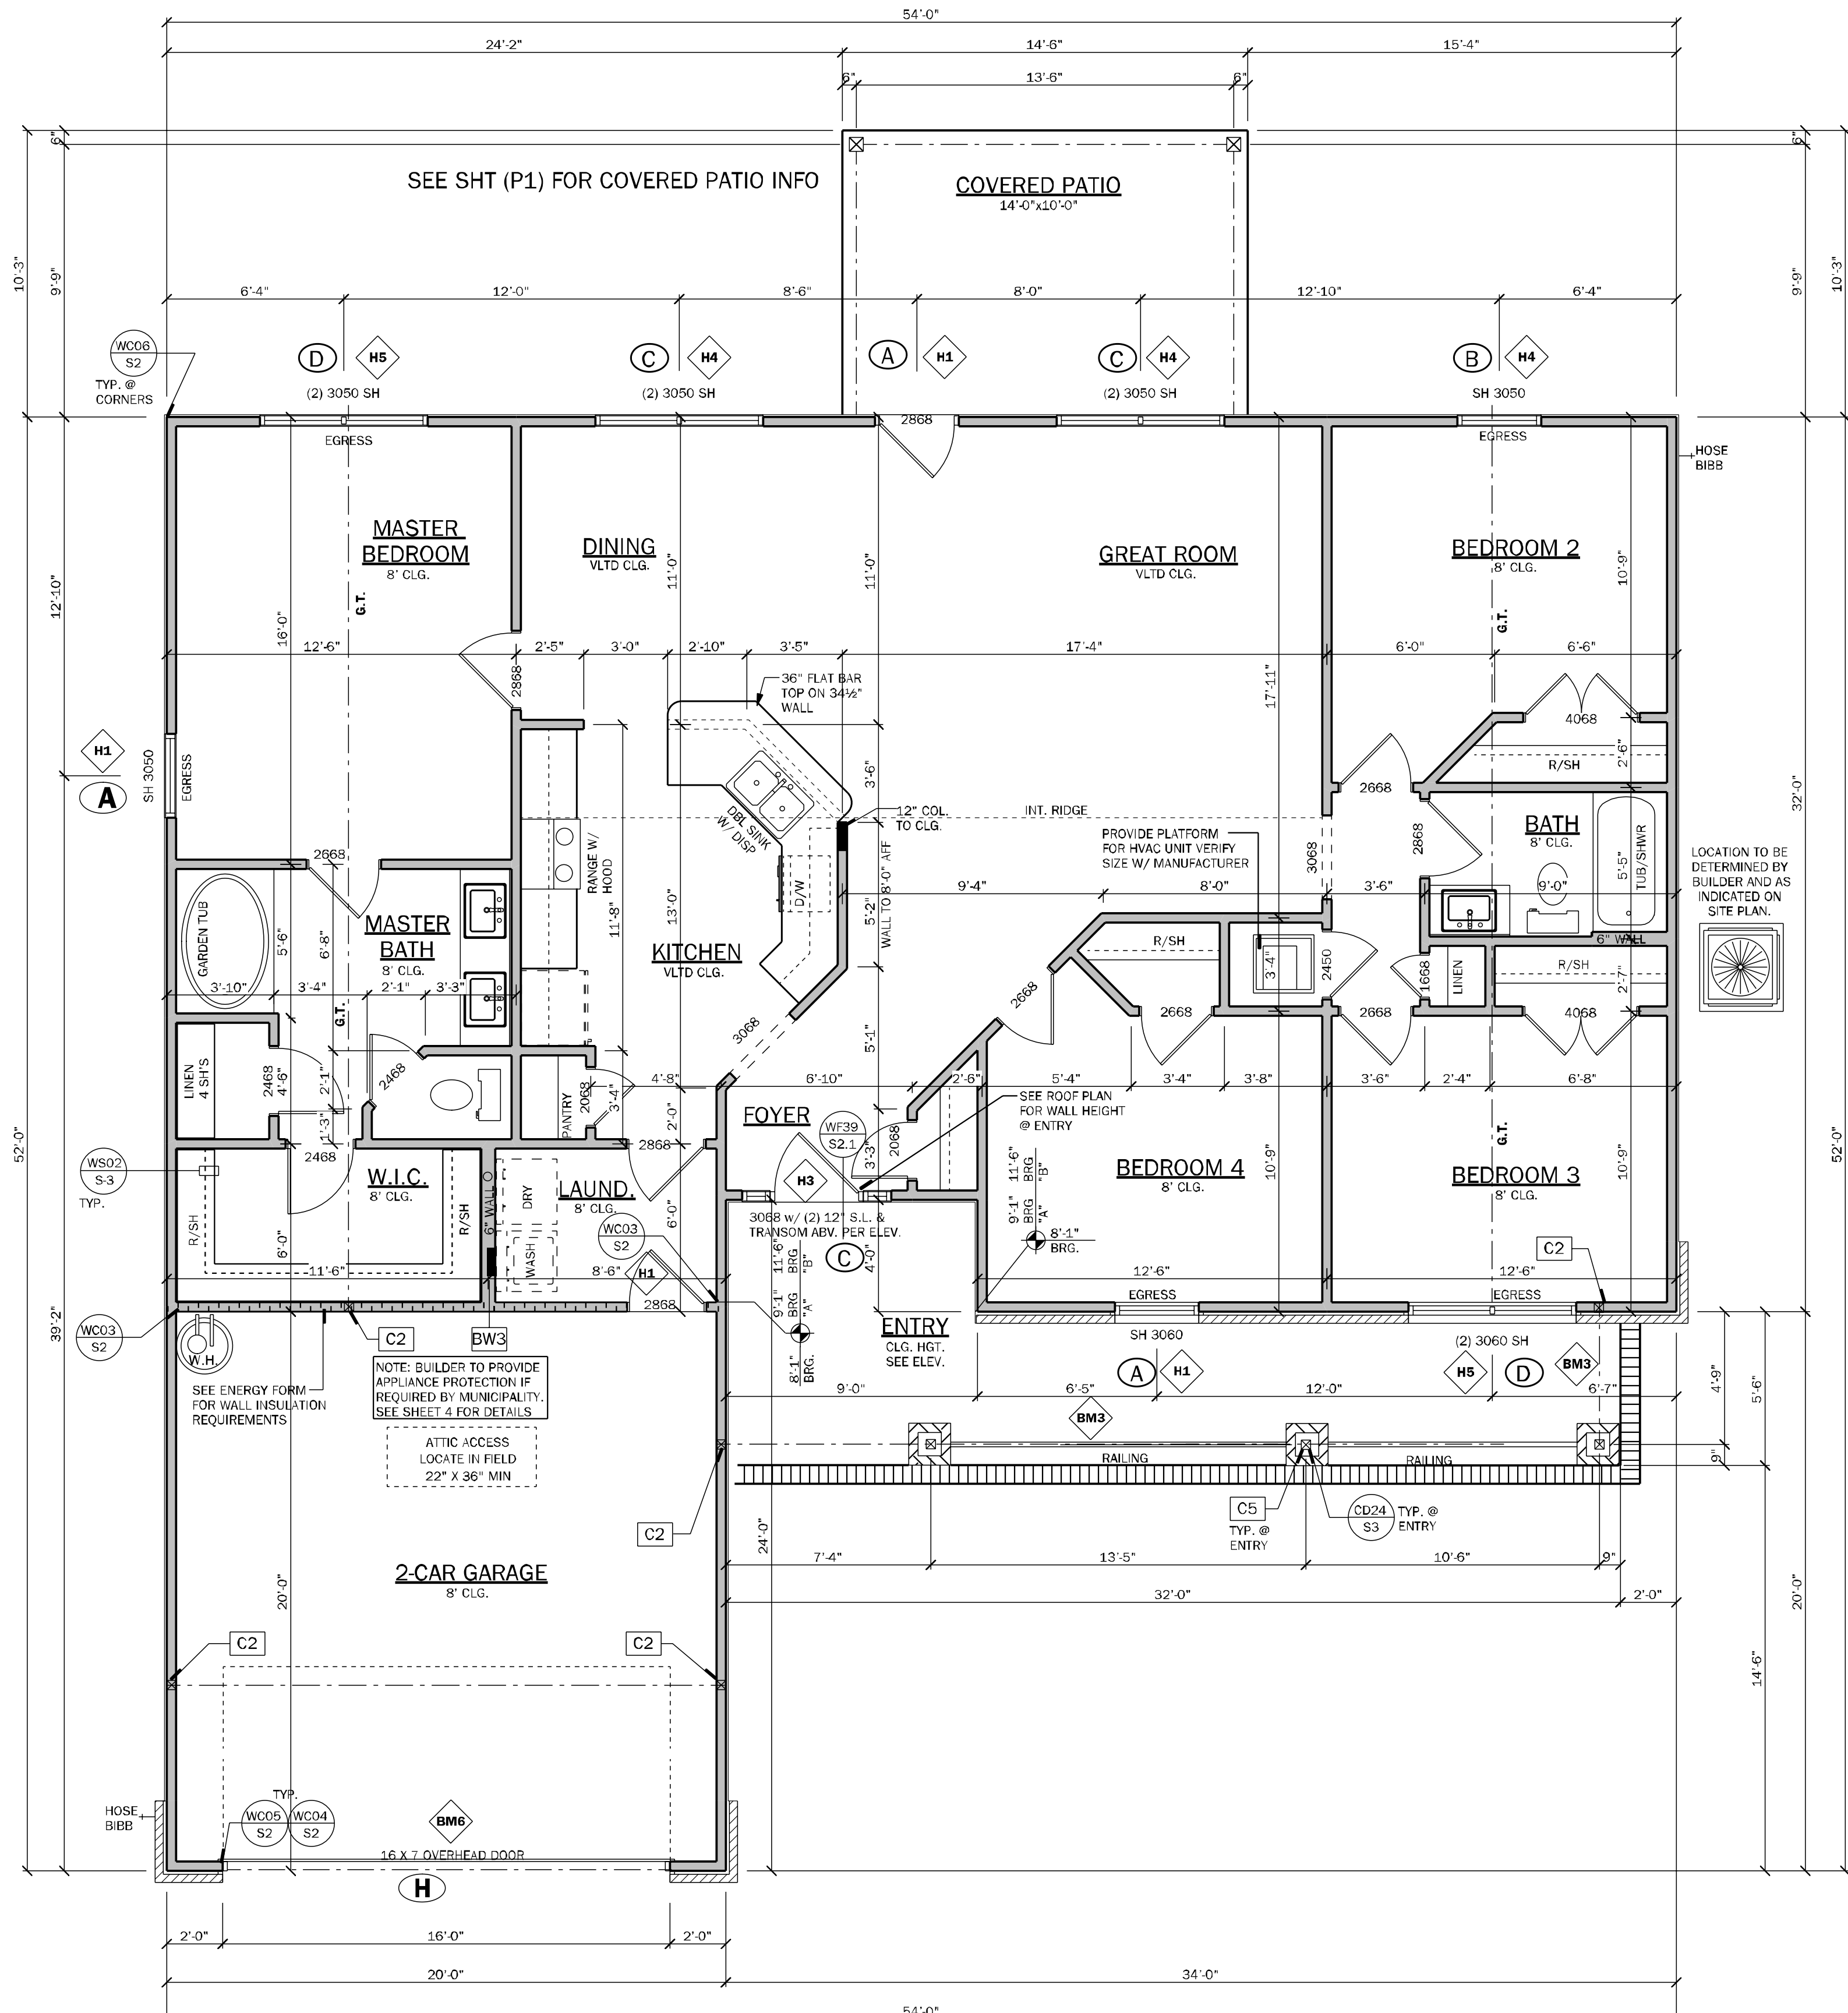

FLOOR PLAN

SCALE: 1/4" = 1'-0"

ELEVATION "D"

NOTE:

○ INDICATES OPENINGS WIND PRESSURES. SEE WIND LOADING CRITERIA ON COVER SHEET FOR INFORMATION.

WALL LEGEND	
FRAMED WALL	
BEARING FRAME WALL	
FRAMED WALL W/ BRICK VENEER	
FRAMED WALL W/ SIDING OR STUCCO	

GENERAL NOTES

- R302.6 (table 302.6) If water based ceiling texture material is used, Provide 1/2" gypsum board for 16" O.C. Framing, or 5/8" gypsum board for 24" O.C. Framing. Note 1/2" sag-resistant gypsum board may be used L.O. 5/8" gypsum board. 5/8" type "X" gypsum board must be installed on garage ceiling beneath habitable room(s).
- R302.5.2 Duct Penetration. Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel, 1 inch minimum rigid nonmetallic class 0 or class 1 duct board, or other approved material and shall not have openings into the garage.
- R302.5.1 Door from garage into house must be a minimum 1 3/8" solid wood door, solid or honeycombcore steel door, or 20 Minute fire rated door.
- R302.7 Enclosed space under stairs that is accessed by a door or access panel shall have walls, under-stair surfaces and any soffits protected on the enclosed side with 1/2" gypsum board.
- Outdoor swimming pools shall be provided with a barrier complying with R4501.17.1.1 through R4501.17.1.14.
- Bathroom exhaust fans must vent to the exterior of the building, exhaust to attic space and soffits is not acceptable. Ventilation shall be permitted to exit through the soffit if solid soffit is installed 5'-0" on each side of the venting.
- R302.6 The garage shall be separated from the residence and its attic as required by Table R302.6. From the residence and attics by not less than 1/2-inch (12.7mm) gypsum board applied to the garage side. Garage beneath rooms shall be separated from all habitable rooms above by not less than 5/8 inch (15.9mm) type X gypsum board or equivalent. Where the separation is a floor-ceiling assembly, the structure supporting the separation shall also be protected by not less than 1/2 inch (12.7mm) gypsum board or equivalent.
- R312.1 Window sills. In dwelling units, where the bottom of the clear opening of an operable window opening is located less than 24 inches (610 mm) above the finished grade and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:
 - Operable windows with openings that will not allow a 4-inch diameter (102 mm) sphere to pass through the opening where the opening is in its largest opened position.
 - Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
 - Operable windows that are provided with window opening control devices that comply with Section R312.2.2.
- R308.4.2 All windows within 2'-0" of doors and in shower or tub areas will be safety tempered glass.
- EC: R402.2.4 Vertical or horizontal access doors from conditioned spaces to unconditioned spaces such as attics and crawl spaces shall be weatherstripped and insulated to a level equivalent to the insulation on the surrounding surfaces.
- M1502.4.5 Duct length. The maximum allowable exhaust duct length shall be determined by one of the methods specified in sections M1502.4.5.1 through M1502.4.5.3
 - M1502.4.5.1 Duct termination. Exhaust ducts shall terminate on the outside of the building. Exhaust duct terminations shall be in accordance with the dryer manufacturer's installation instructions. If the manufacturer's instructions do not specify a termination location, the exhaust duct shall terminate not less than 3 feet (914 mm) in any direction from openings into buildings, including openings in ventilated soffits. Exhaust duct terminations shall be equipped with a backdraft damper. Screens shall not be installed at the duct termination.
 - Porch Ceilings: (See plan for the following options)
 - Option 1: Gypsum: 1/2" exterior gypsum soffit board shall be attached to all framing members with 2x blocking provided at perimeter and panel edges. The gypsum board shall be attached w/ Type "W" 1x4" drywall screws at 8" O.C. in field and edges.
 - Option 2: Plywood Soffit: 7/16" OSB on underside of roof trusses shall be attached to all framing members with 2x blocking provided at perimeter and panel edges. The OSB shall be attached w/ 8d nails at 6" O.C. field and 4" O.C. at edges or 7d screw shank 3" O.C. field and 4" edges.
- Energy Code Compliance Path is Performance Based Path. Code cycle is FBC 2023 8th Edition.

AREA CALCULATIONS

1st FLOOR	1760 S.F.
TOTAL LIVING (AG)	1760 S.F.
GARAGE	425 S.F.
COVERED ENTRY	193 S.F.
COVERED PATIO/LANAI	140 S.F.
TOTAL AREA UNDER ROOF	2518 S.F.

* ALL INTERIOR AND EXTERIOR WALL FRAMING, INCLUDING FURRING STRIPS ON CMU WALLS, TO BE SPACED AND 16" O.C. (U.N.O.)

Keese Associates
ARCHITECTURE | DESIGN | PLANNING
255 S. Main Ave., Marietta, GA 30060
404.870.2433
mykeese.com

FDS ENGINEERS ASSOCIATES
www.fdseng.com
To the best of the Engineer's knowledge, information, and belief, the design and construction of the project complies with all applicable codes and standards, and the Engineer is not providing any warranty or guarantee for the project.


DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502

DIVISION LOCATION:
GAINESVILLE


Job Information:
Model Name / Number:
1755
Plan Issue Date:
Wednesday, December 11, 2024
KA PROJECT NUMBER:
24-13141
Sheet:
2
OR:
FLOOR PLAN

INVENTORY
LOT: 94
BLK:
SEC:
SUB:
PRESERVE AT LAUREL LAKE
747 SW ROSEMARY DR.
LAKE CITY, FL


WEDNESDAY, DECEMBER 11, 2024

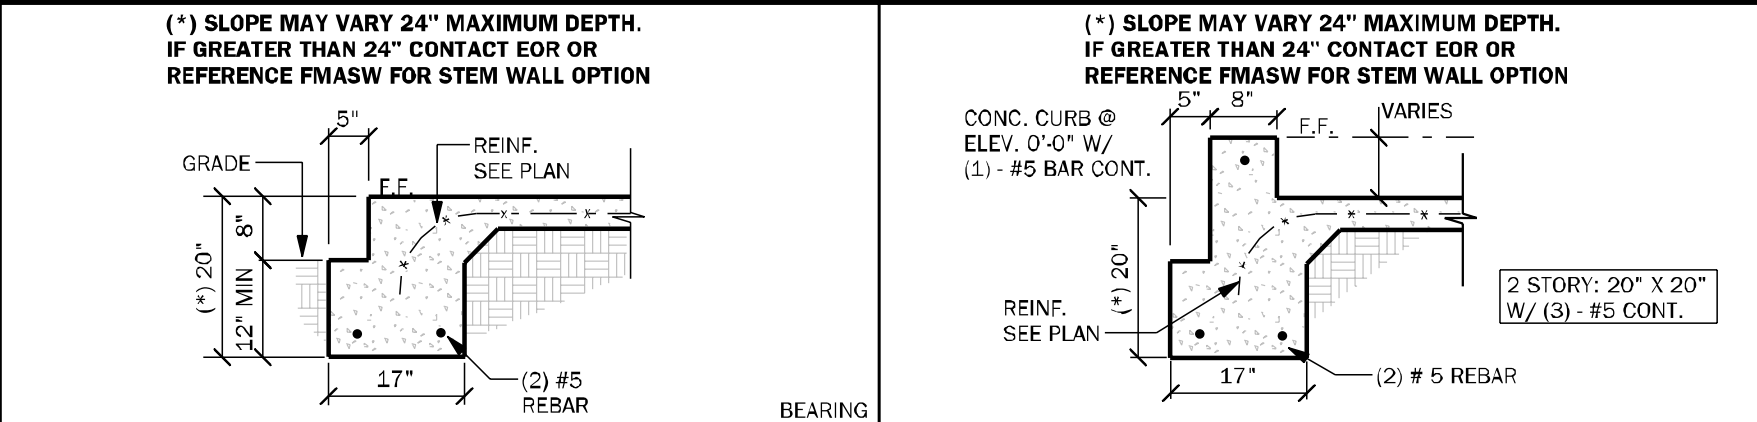


FM01 SINGLE STORY FTG 1/2" = 1'-0"

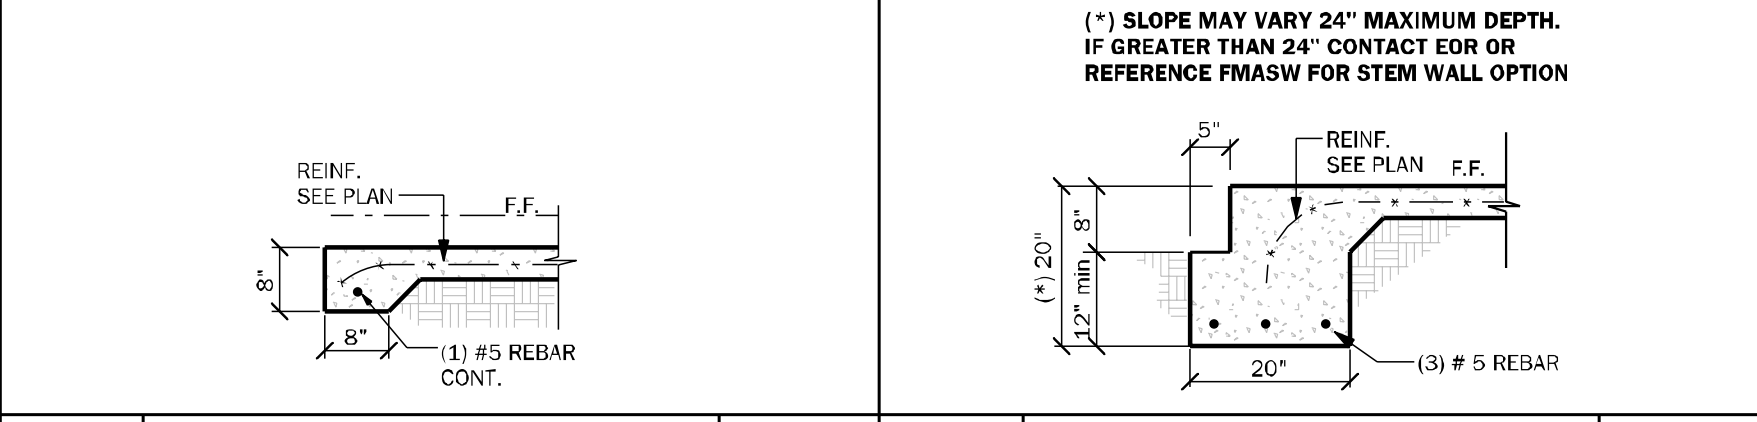


FM02 SECTION @ GARAGE 1/2" = 1'-0"

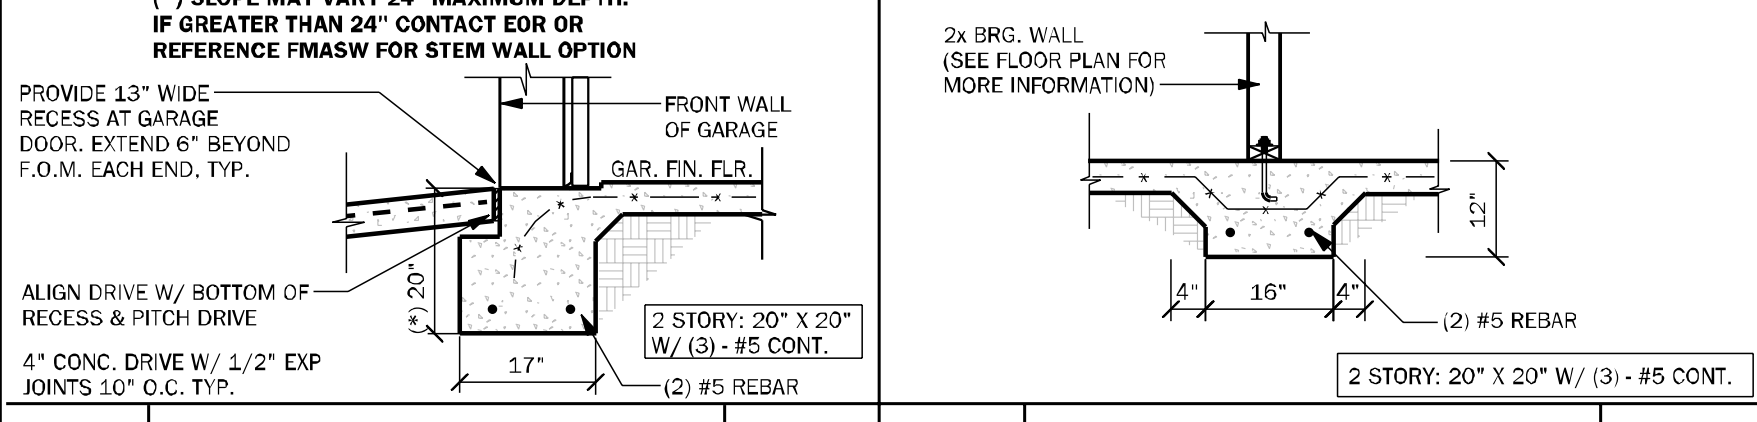


FM03 THICKENED EDGE 1/2" = 1'-0"

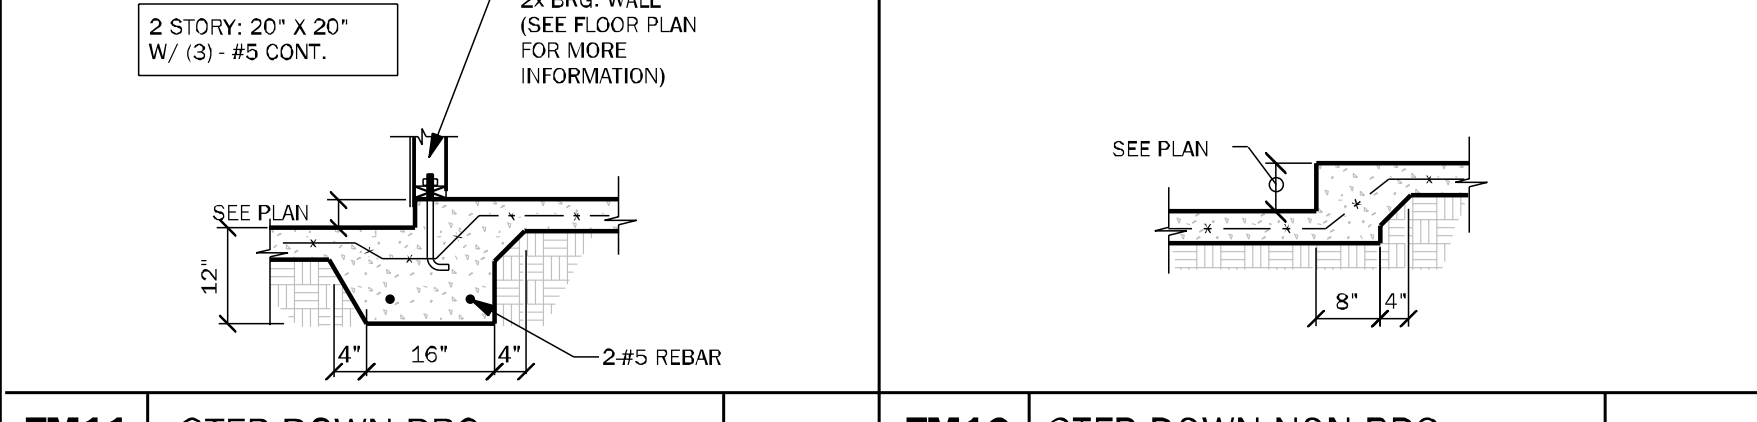


FM09 SECTION @ GAR. DOOR 1/2" = 1'-0"

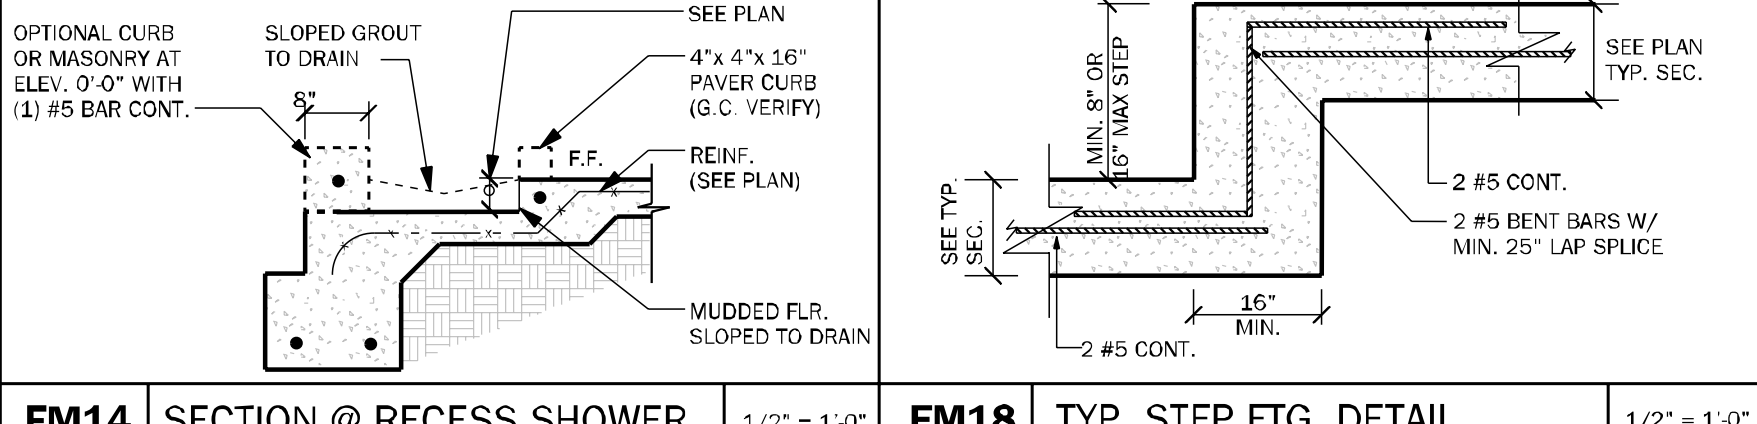


FM11 STEP DOWN BRG. 1/2" = 1'-0"

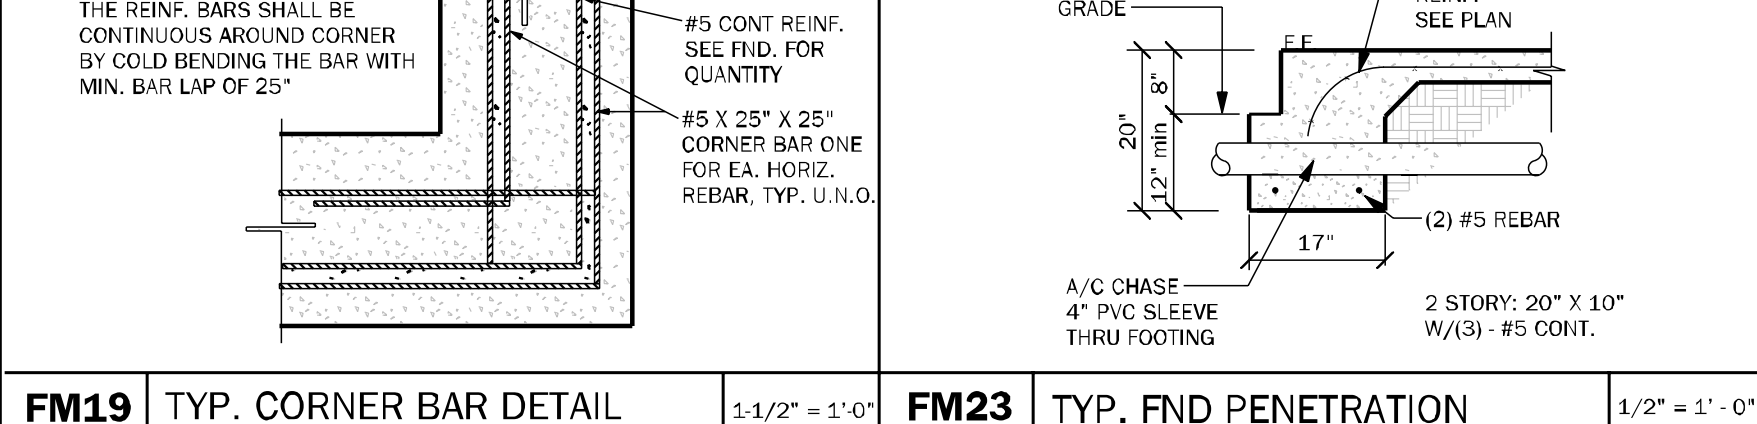

FM14 SECTION @ RECESS SHOWER 1/2" = 1'-0"

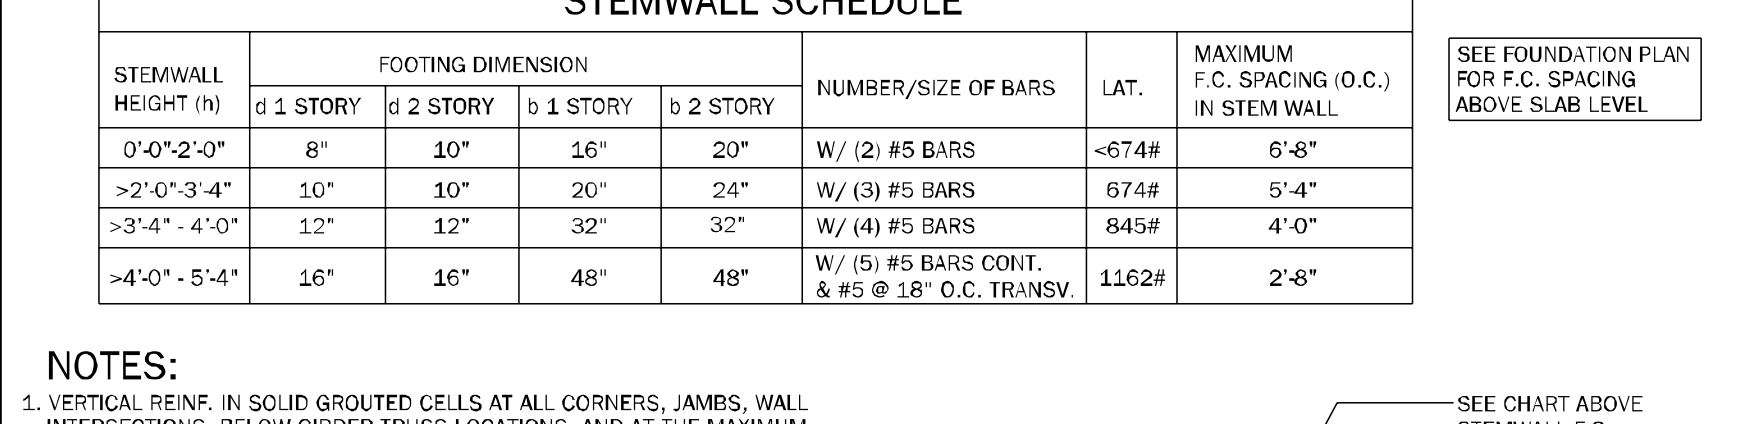


FM19 TYP. CORNER BAR DETAIL 1'-1/2" = 1'-0"

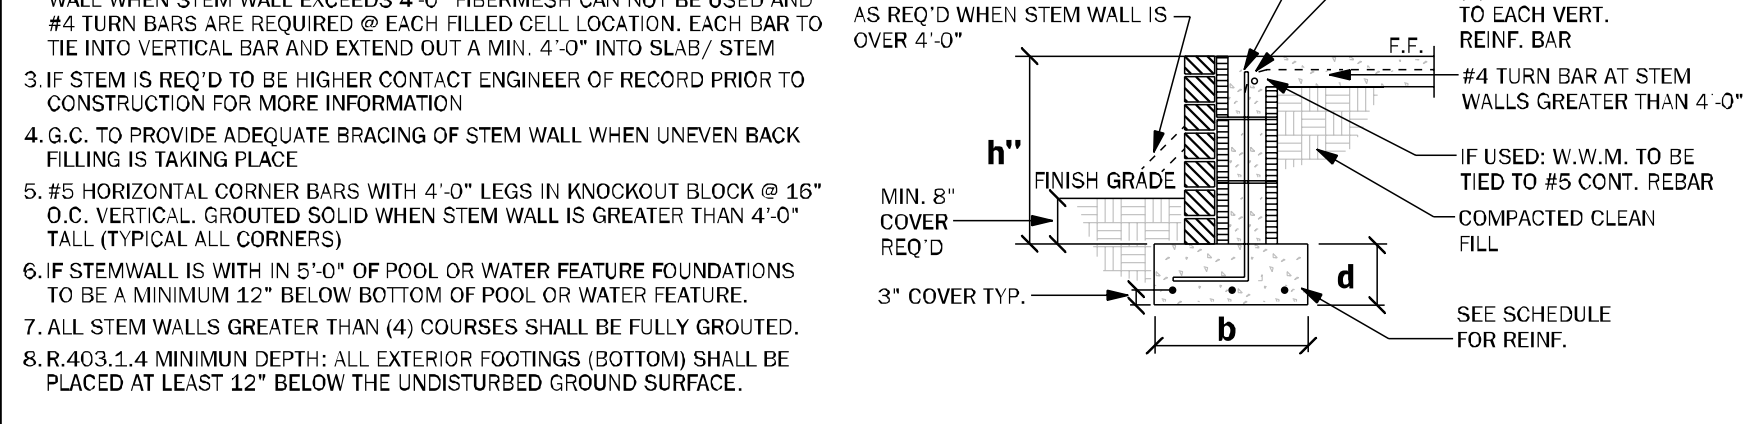


FM23 TYP. FND PENETRATION 1/2" = 1'-0"

FMASW ALTERNATE STEM WALL FOOTING SCHEDULE 1/2" = 1'-0"

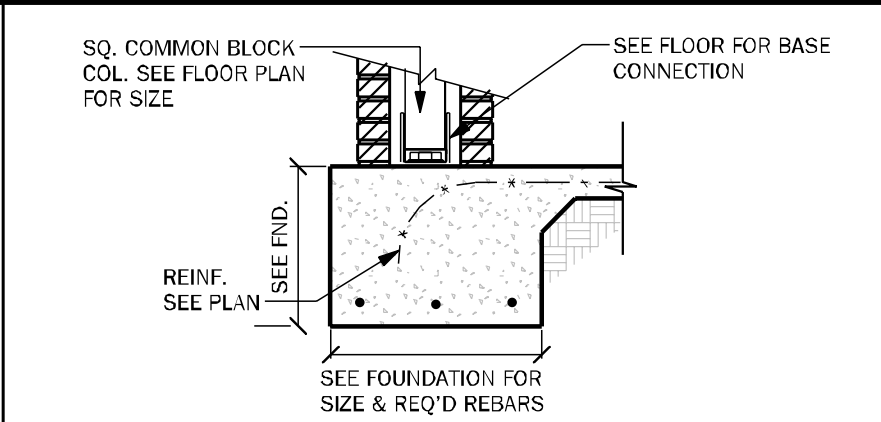


FM25 PORCH COLUMN W/ BRICK 1/2" = 1'-0"

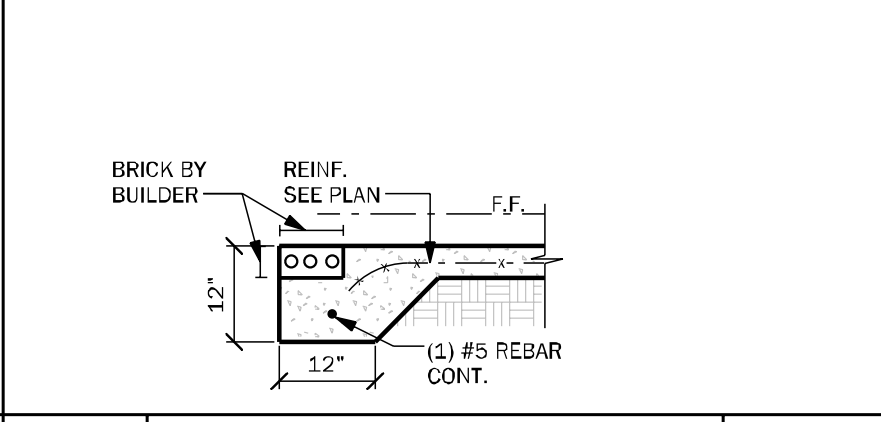


FM26 THICKENED EDGE W/ BRICK 1/2" = 1'-0"




FM08 2-STORY FTG. 1/2" = 1'-0"

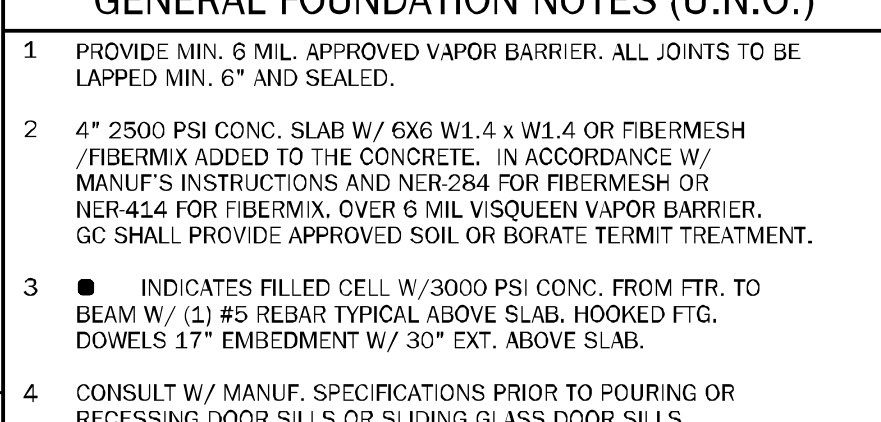

FM10 INTERIOR BRG WALL 1/2" = 1'-0"

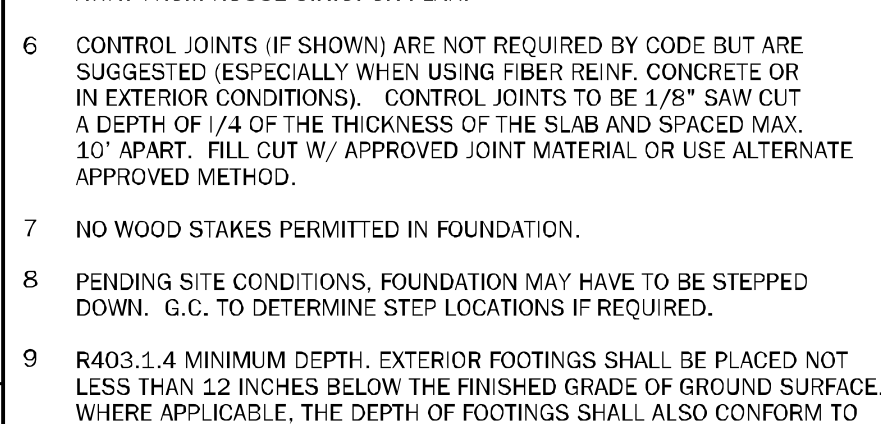


FM12 STEP DOWN NON BRG. 1/2" = 1'-0"

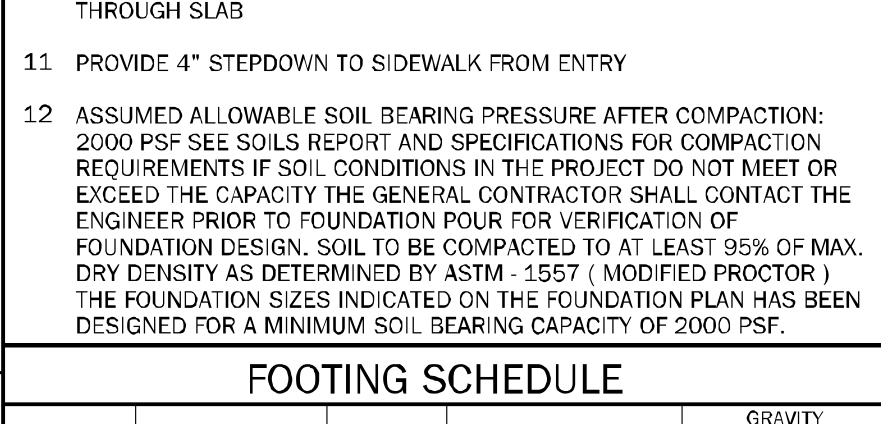

FM18 TYP. STEP FTG. DETAIL 1/2" = 1'-0"



FM23 TYP. FND PENETRATION 1/2" = 1'-0"

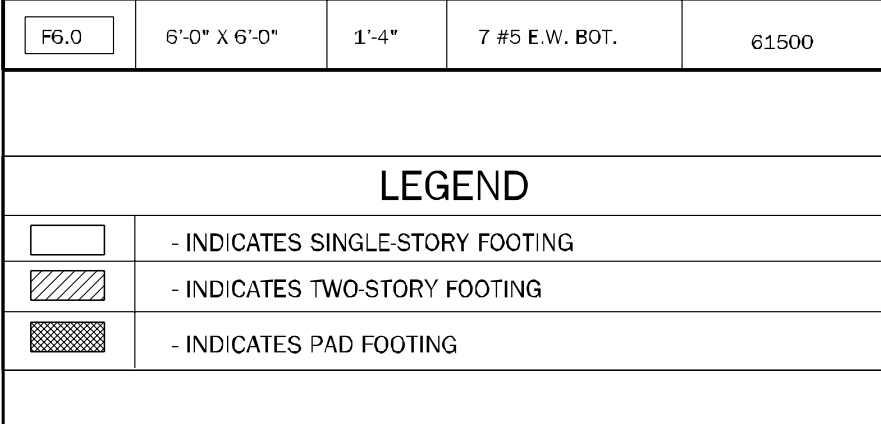

FM23 TYP. FND PENETRATION 1/2" = 1'-0"

FM23 TYP. FND PENETRATION 1/2" = 1'-0"

GENERAL FOUNDATION NOTES (U.N.O.)


1. PROVIDE MIN. 6 MIL. APPROVED VAPOR BARRIER. ALL JOINTS TO BE LAPPED MIN. 6" AND SEALED.
2. 4" 2500 PSI CONC. SLAB W/ 6X6 W1.4 X W1.4 OR FIBERMESH /FIBERMESH ADDED TO THE CONCRETE. IN ACCORDANCE W/ MANUF'S INSTRUCTIONS AND NER-284 FOR FIBERMESH OR NER-414 FOR FIBERMESH. OVER 6 MIL V/SQUEEN VAPOR BARRIER. GC SHALL PROVIDE APPROVED SOIL OR BORATE TREATMENT.
3. INDICATES FILLED CELL W/ 3000 PSI CONC. FROM FTR. TO BEAM W/ (1) #5 REBAR TYPICAL ABOVE SLAB. HOOKED FTG. DOWELS 17" EMBEDMENT W/ 30" EXT. ABOVE SLAB.
4. CONSULT W/ MANUF. SPECIFICATIONS PRIOR TO POURING OR RECESSING DOOR SILLS OR SLIDING GLASS DOOR SILLS.
5. EXTERIOR SLABS SHALL SLOPE MIN. 2% OR 1/4" PER FOOT AWAY FROM HOUSE U.N.O. ON PLAN.
6. CONTROL JOINTS (IF SHOWN) ARE NOT REQUIRED BY CODE BUT ARE SUGGESTED (ESPECIALLY WHEN USING FIBER REINF. CONCRETE OR IN EXTERIOR CONDITIONS). CONTROL JOINTS TO BE 1/8" SAW CUT A DEPTH OF 1/4 OF THE THICKNESS OF THE SLAB AND SPACED MAX. 10' APART. FILL CUT W/ APPROVED JOINT MATERIAL OR USE ALTERNATE APPROVED METHOD.
7. NO WOOD STAKES PERMITTED IN FOUNDATION.
8. PENDING SITE CONDITIONS, FOUNDATION MAY HAVE TO BE STEPPED DOWN. G.C. TO DETERMINE STEP LOCATIONS IF REQUIRED.
9. R403.1.4 MINIMUM DEPTH: EXTERIOR FOOTINGS SHALL BE PLACED NOT LESS THAN 12 INCHES BELOW THE FINISHED GRADE OF GROUND SURFACE WHERE APPLICABLE. THE DEPTH OF FOOTINGS SHALL ALSO CONFORM TO SECTION R403.1.4.1.
10. MASON TO COORDINATE WITH BUILDER ANY ELECTRICAL REQUIREMENT THROUGH SLAB.
11. PROVIDE 4" STEPDOWN TO SIDEWALK FROM ENTRY.
12. ASSUMED ALLOWABLE SOIL BEARING PRESSURE AFTER COMPACTION: 2000 PSF SEE SOILS REPORT AND SPECIFICATIONS FOR COMPACTION REQUIREMENTS IF SOIL CONDITIONS IN THE PROJECT DO NOT MEET OR EXCEED THE CAPACITY THE GENERAL CONTRACTOR SHALL CONTACT THE ENGINEER PRIOR TO FOUNDATION POUR FOR VERIFICATION OF FOUNDATION DESIGN. SOIL TO BE COMPACTED TO AT LEAST 95% OF MAX. DRY DENSITY AS DETERMINED BY ASTM 1557 (MODIFIED PROCTOR) THE FOUNDATION SIZES INDICATED ON THE FOUNDATION PLAN HAS BEEN DESIGNED FOR A MINIMUM SOIL BEARING CAPACITY OF 2000 PSF.

FOOTING SCHEDULE

MARK	SIZE	DEPTH	REINFORCING	GRAVITY CAP. (lbs)
F1.0	1'-0" X CONT.	1'-0"	2 #5 E.W. BOT.	2000
F2.0	2'-0" X 2'-0"	1'-0"	3 #5 E.W. BOT.	7200
F2.5	2'-6" X 2'-6"	1'-0"	3 #5 E.W. BOT.	11000
F3.0	3'-0" X 3'-0"	1'-0"	4 #5 E.W. BOT.	15600
F3.5	3'-6" X 3'-6"	1'-0"	4 #5 E.W. BOT.	21500
F4.0	4'-0" X 4'-0"	1'-0"	5 #5 E.W. BOT.	28000
F4.5	4'-6" X 4'-6"	1'-4"	5 #5 E.W. BOT.	34500
F5.0	5'-0" X 5'-0"	1'-4"	6 #5 E.W. BOT.	42500
F5.0	5'-0" X 6'-0"	1'-4"	7 #5 E.W. BOT.	61500

LEGEND

	- INDICATES SINGLE-STORY FOOTING
	- INDICATES TWO-STORY FOOTING
	- INDICATES PAD FOOTING

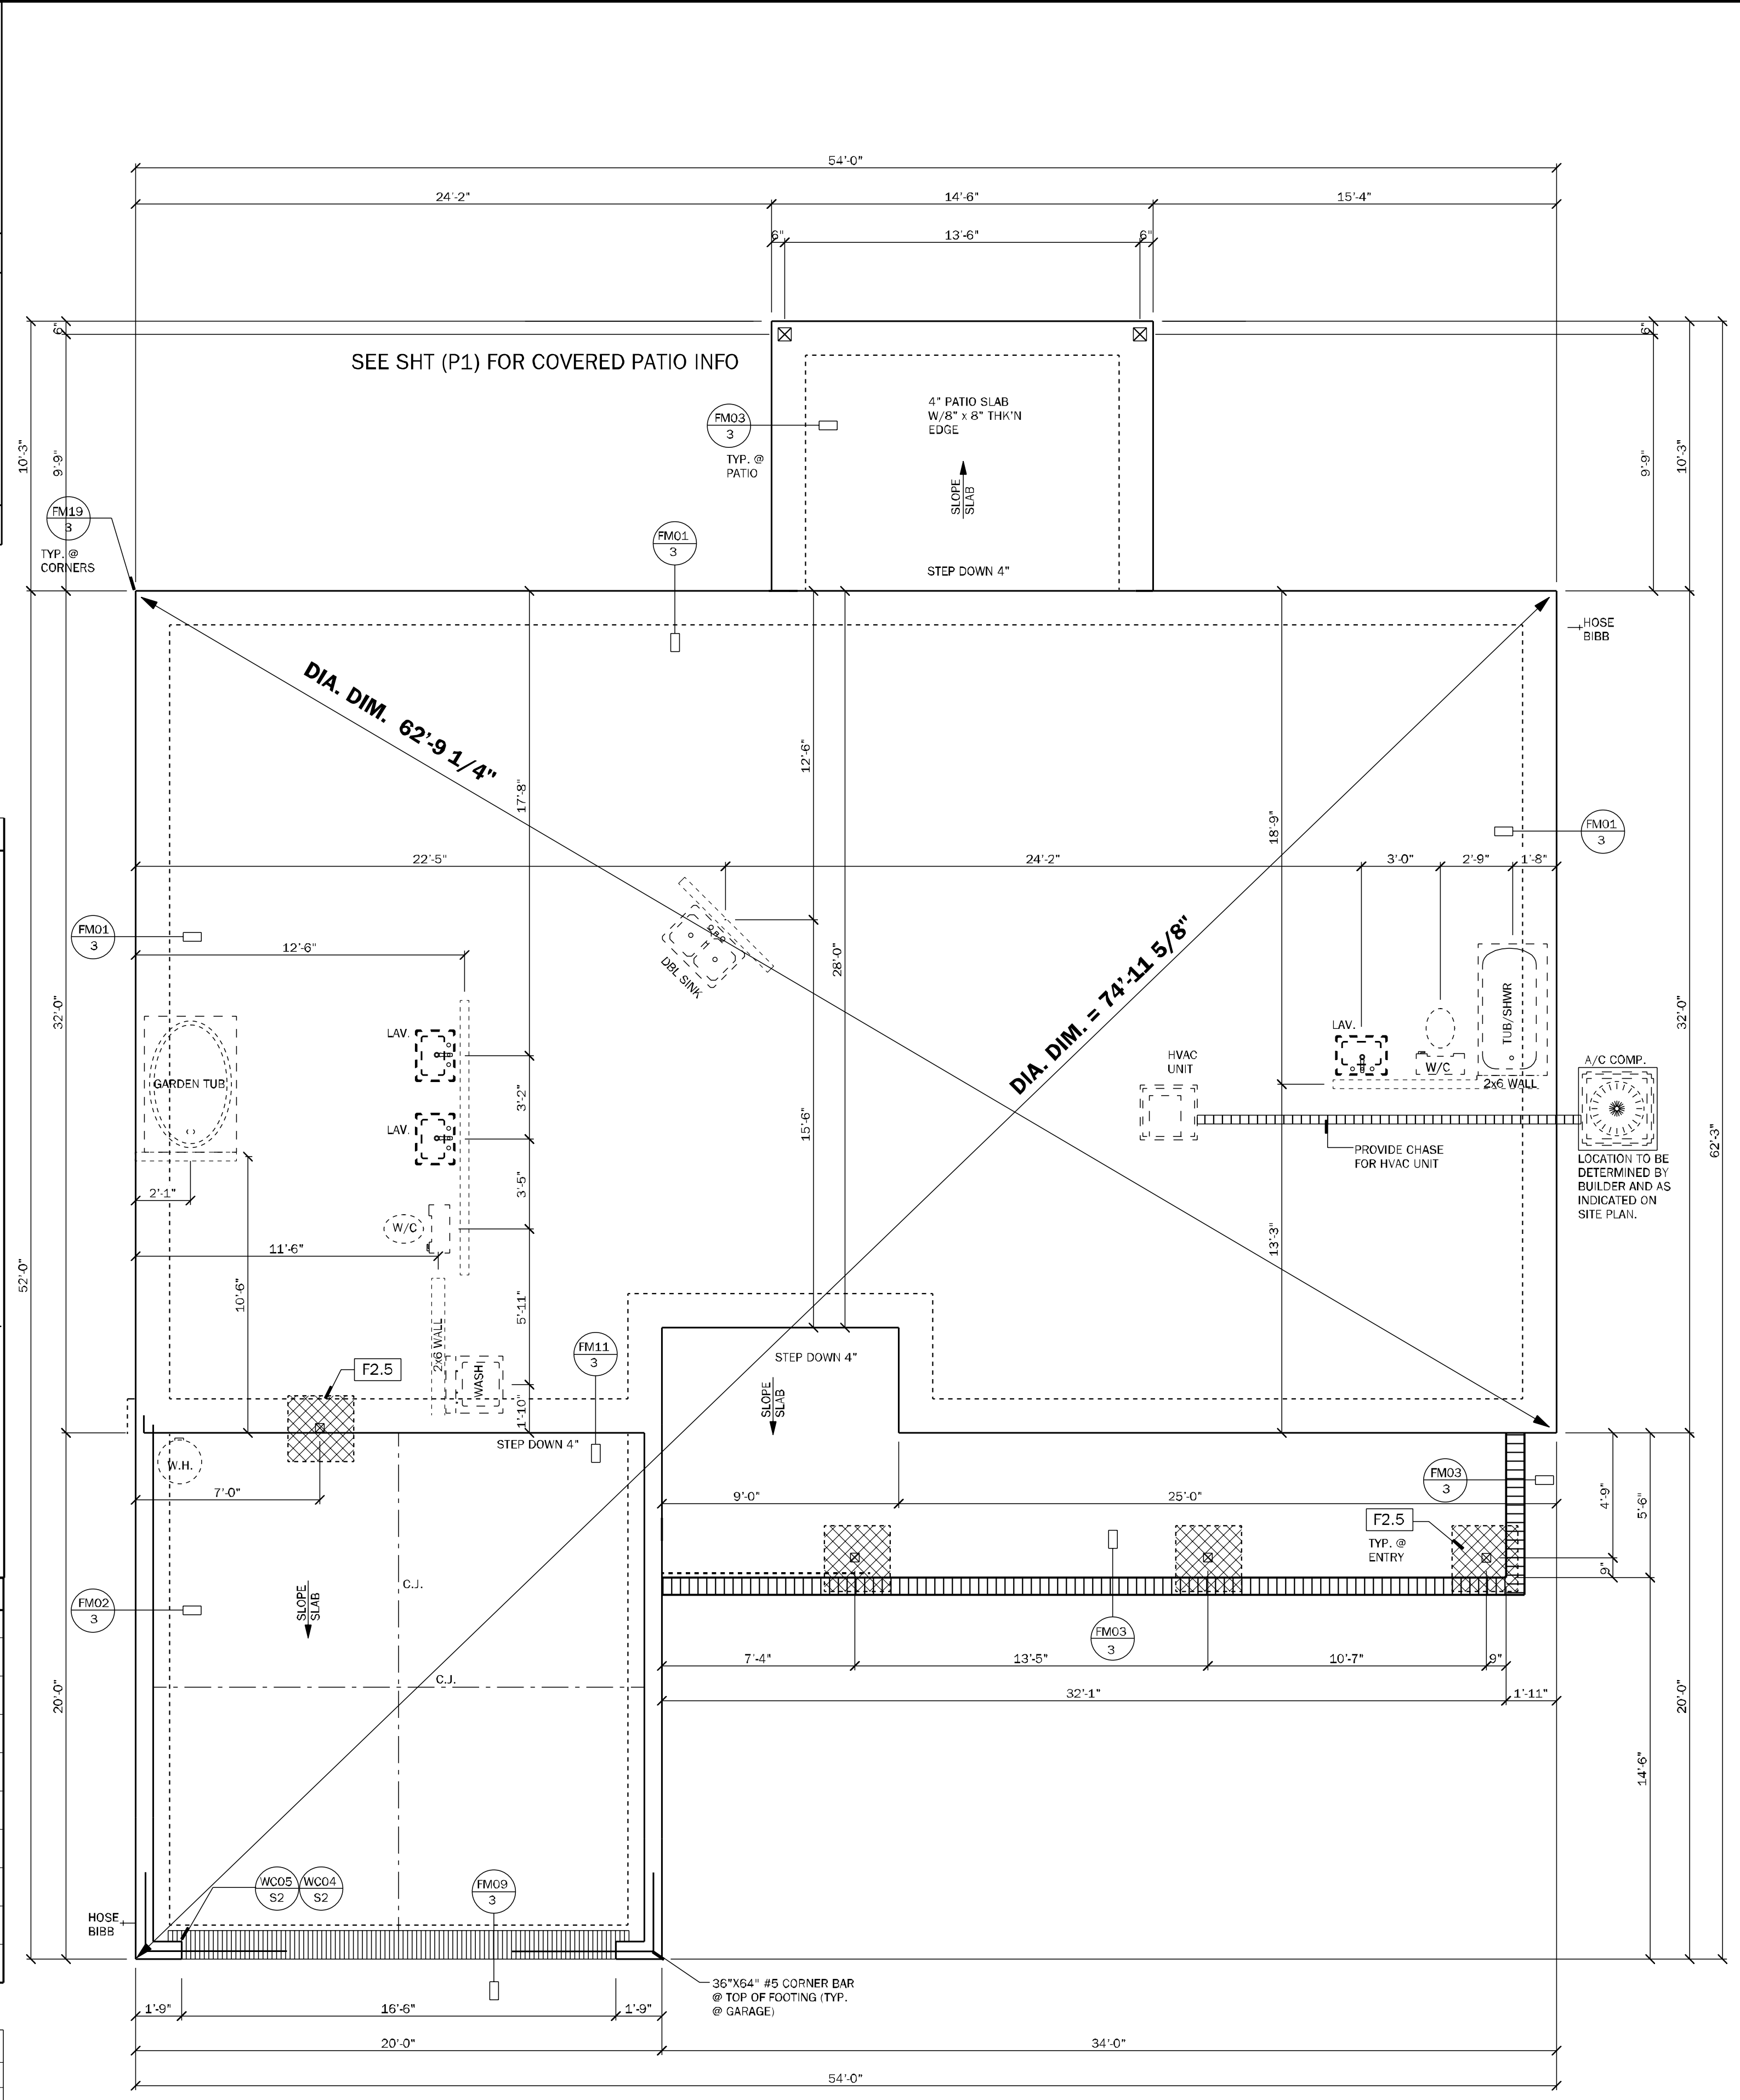

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"
ELEVATION "D"

COUNTY SEAL

ENGINEER'S ASSOCIATES
ARCHITECTURE | DESIGN | PLANNING
285 S. GULF BLVD., SUITE 200
PENSACOLA, FL 32501
www.fdseng.com

keesee
associates
ARCHITECTURE | DESIGN | PLANNING
285 S. GULF BLVD., SUITE 200
PENSACOLA, FL 32501
www.keesee.com

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502

DIVISION LOCATION:
GAINESVILLE

Job Information:

Model Name / Number:
1755

Plan Issue Date:
Wednesday, December 11, 2024

KA PROJECT NUMBER:
24-13141


Sheet:
3

Of:
3

FOUNDATION PLAN


LOT: 94
BLK:
SEC:
SUB:
PRESERVE AT LAUREL LAKE
747 SW ROSEMARY DR.
LAKE CITY, FL

Wednesday, December 11, 2024

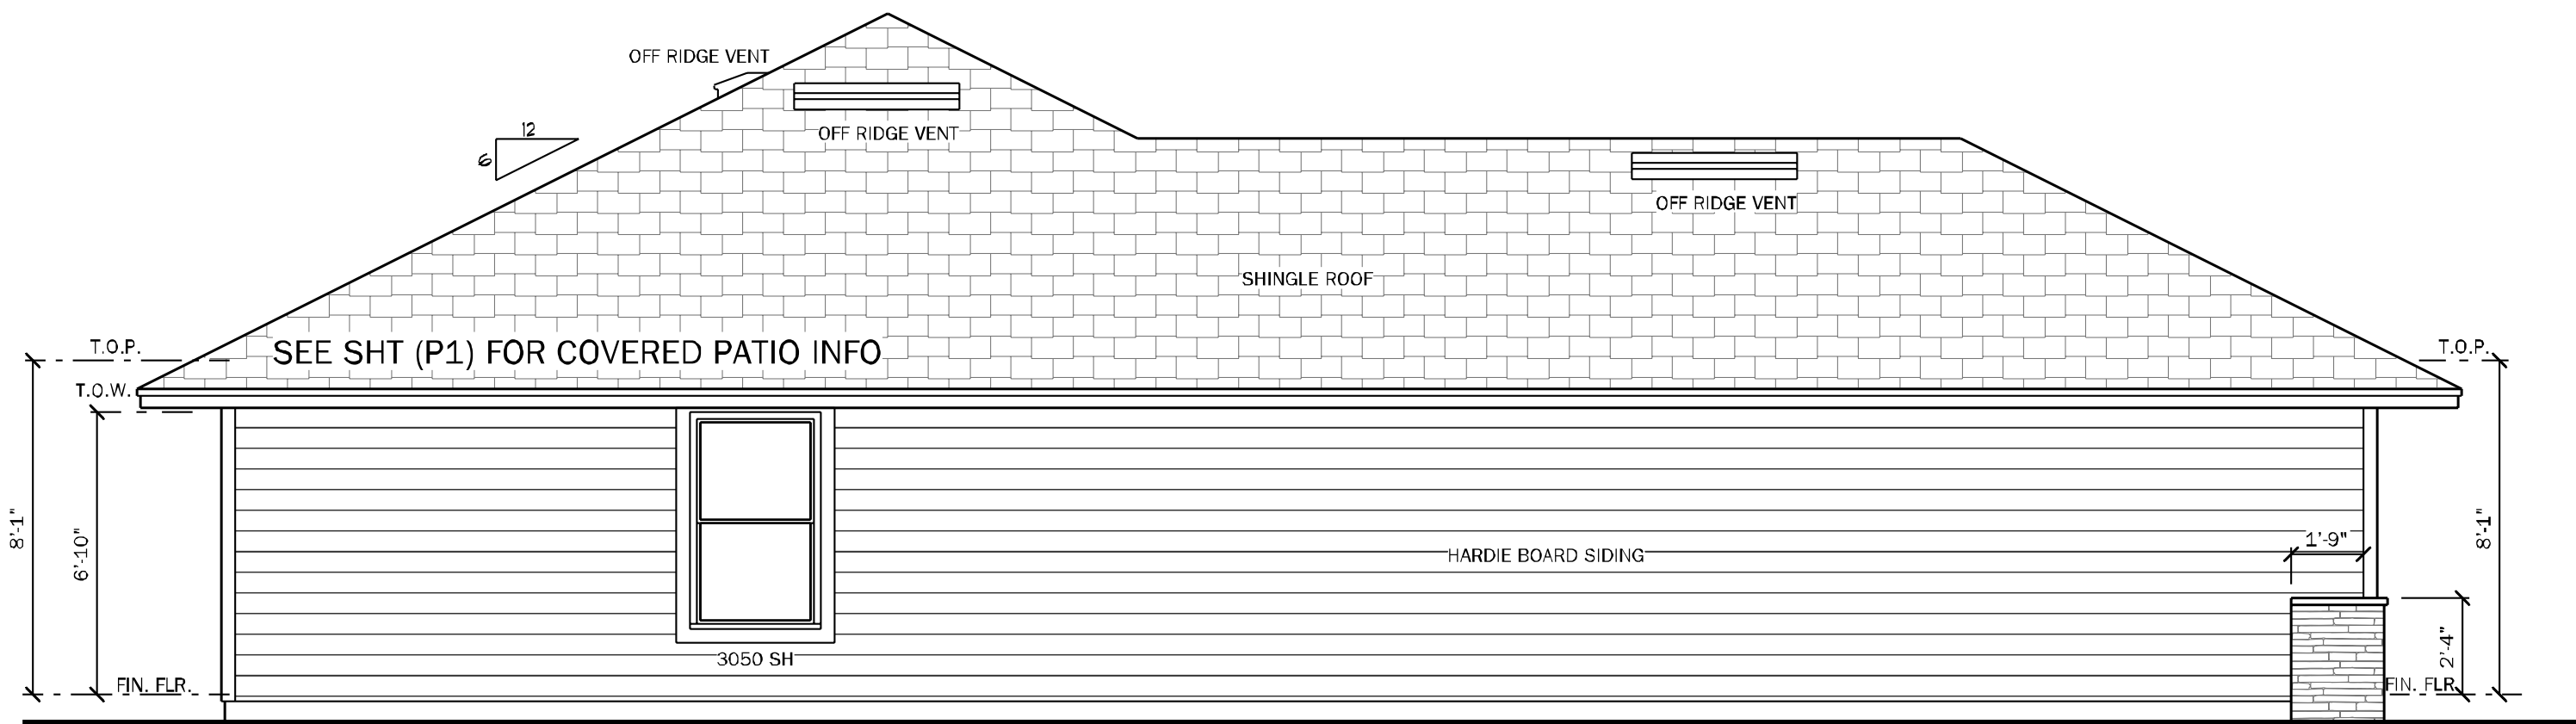


LEFT ELEVATION "D"

SCALE: 1/4" = 1'-0"

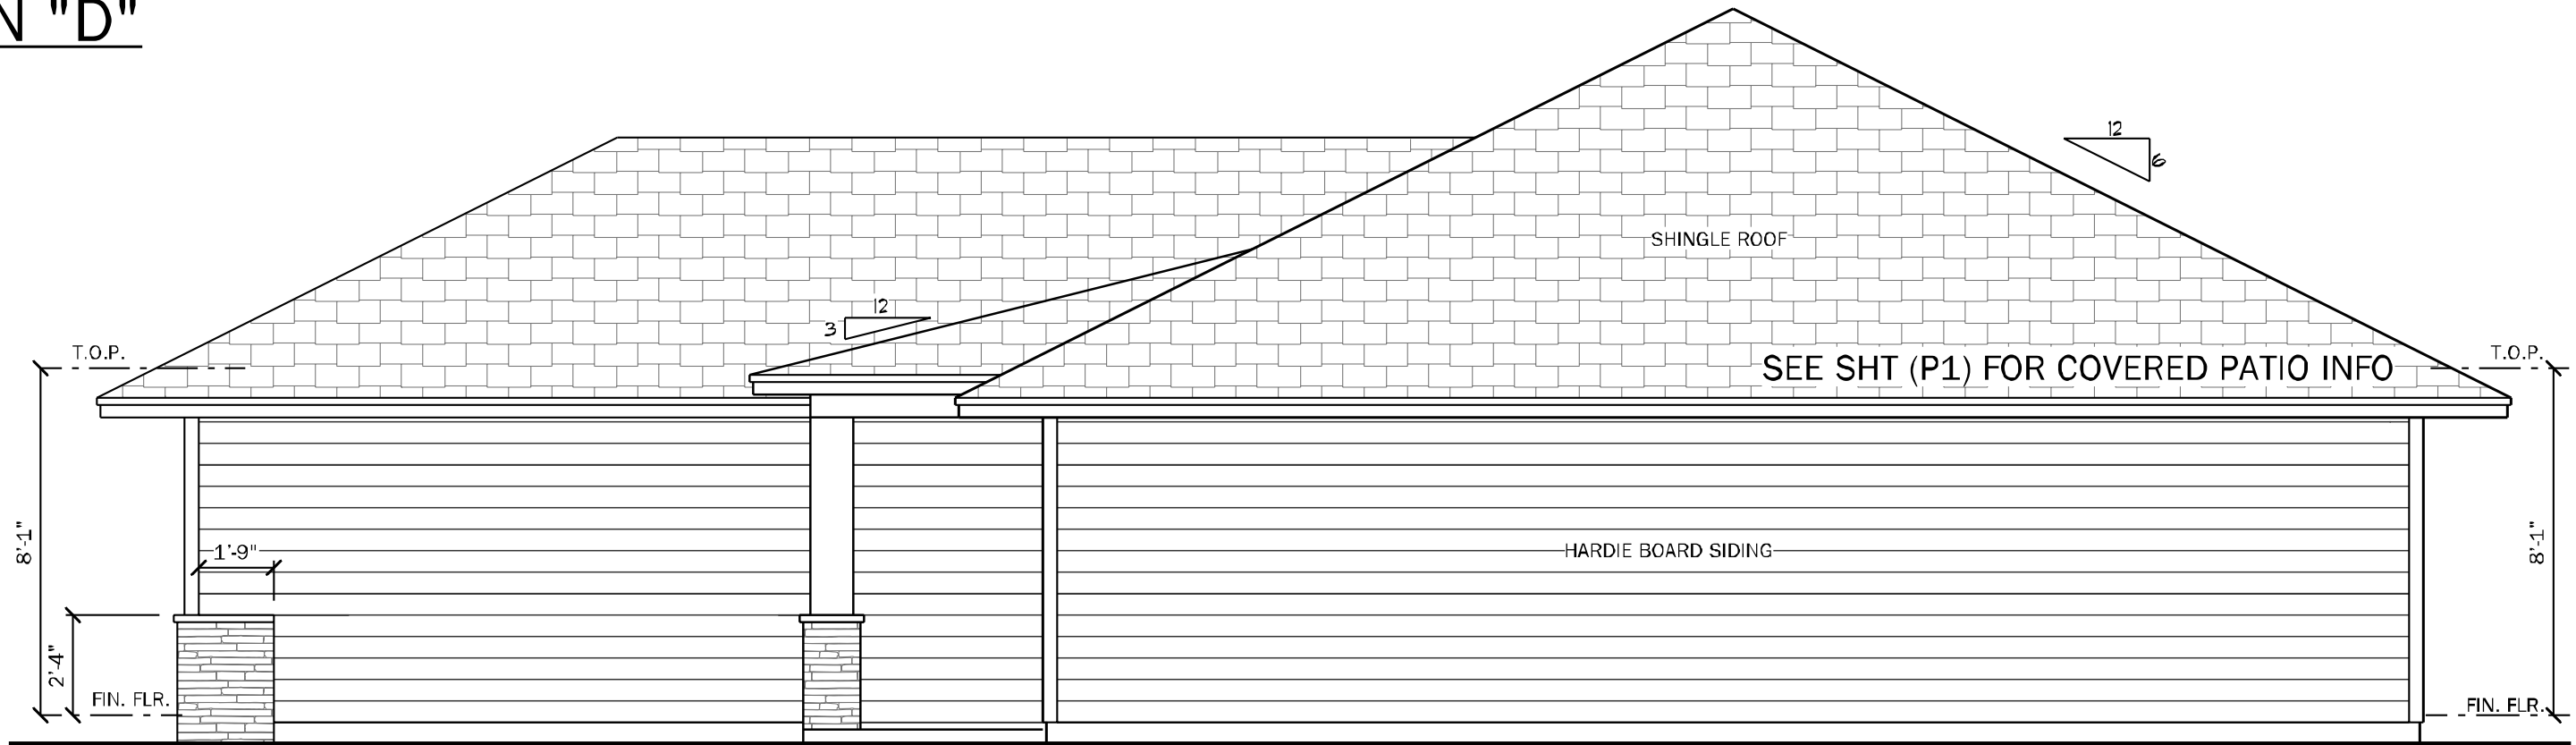

RIGHT ELEVATION "D"

SCALE: 1/4" = 1'-0"

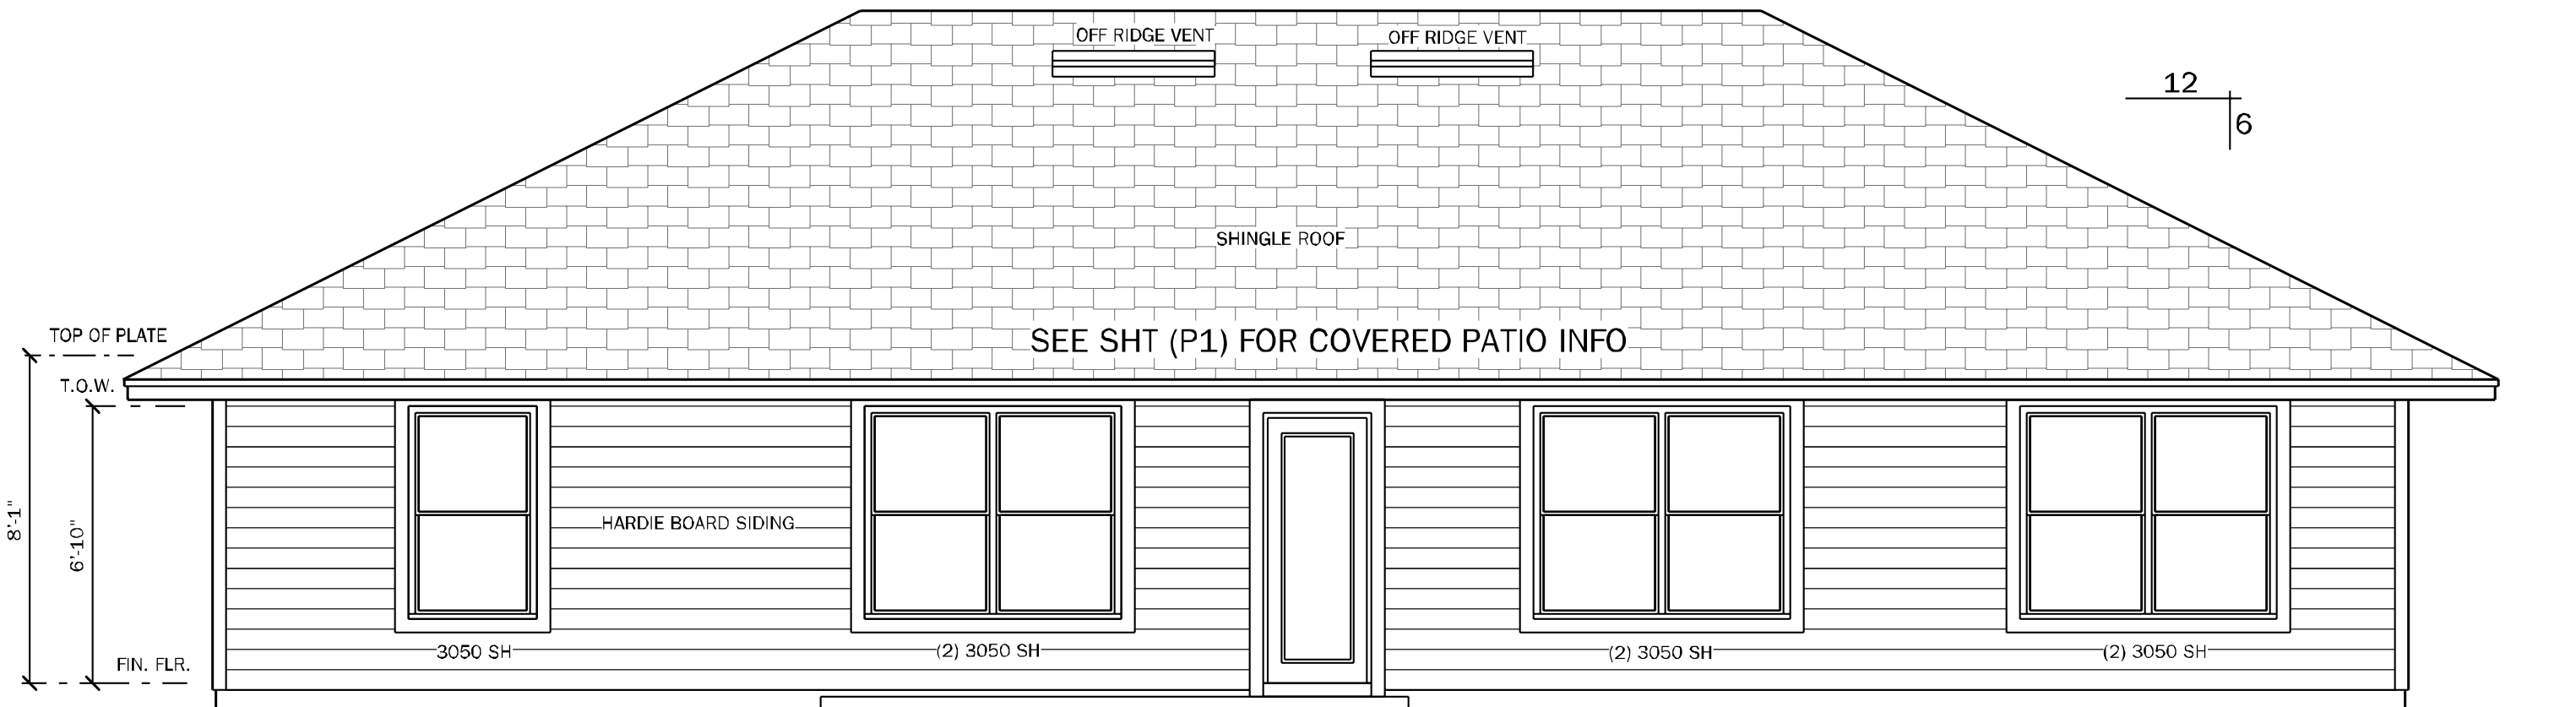

REAR ELEVATION

SCALE: 1/4" = 1'-0"



FRONT ELEVATION "D"

SCALE: 1/4" = 1'-0"

VENTILATION CALCULATION		
Formula = SF / 300 / 2 * 144 = net sq inches of venting needed equally for intake and exhaust		
Soffit product provides	4.12	net sq in / sf
Ridge vent provides	18.00	net sq in / lf
Off ridge vent provides	138.00	net sq in / sf
Overhang distance	2.00	ft
S.F. of Area to be vented (SF)	2518	s.f.
Total needed for exhaust for upper 1/3	604	net sq inches
Total needed for intake (soffit area, lower)	604	net sq inches
Number of Off Ridge Vents for upper 1/3 needed	4	
L.F. of Ridge Vent needed (can be used in combo with ORV)	34	
Lineal Feet of Soffit needed to meet required	73	
Lineal Feet of Soffit provided by plan	212	

COUNTY
SEAL

Wednesday, December 11, 2024

To the best of the Engineer's knowledge, information, and belief, the design and construction of the project complies with the current Florida Building Code. Engineer's signature is not valid until the project is approved by the local authority having jurisdiction.

FDS
ENGINEERING ASSOCIATES
0 (25A) Railroad Avenue, Suite 200
288 Southfield Lane, Suite 200
Pensacola, Florida 32504
Certificate of Authorization No. 9481

☐ CARL A. BROWN, P.E. FL # 55126
☐ SCOTT A. LEWOWSKI, PE FL # 78750
☐ THIEN BAO DUONG, PE FL # 94452

www.fdseng.com

keese
associates
ARCHITECTURE | DESIGN | PLANNING
239 Southfield Lane, Suite 200
Pensacola, Florida 32504
334.407.8800
myhighcorrie.com

AA26003115
AAS2003115

☐

AD
ARCHITECTURAL DESIGN

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502

DIVISION LOCATION:
GAINESVILLE

Job Information:

INVENTORY

LOT: 94
BLK:
SEC:
SUB: PRESERVE AT LAUREL LAKE
747 SW ROSEMARY DR.
LAKE CITY, FL

Model Name / Number:

1755

Plan Issue Date:


Wednesday, December 11, 2024

KA PROJECT NUMBER:

24-13141

Sheet: 5 of 5

ELEVATIONS

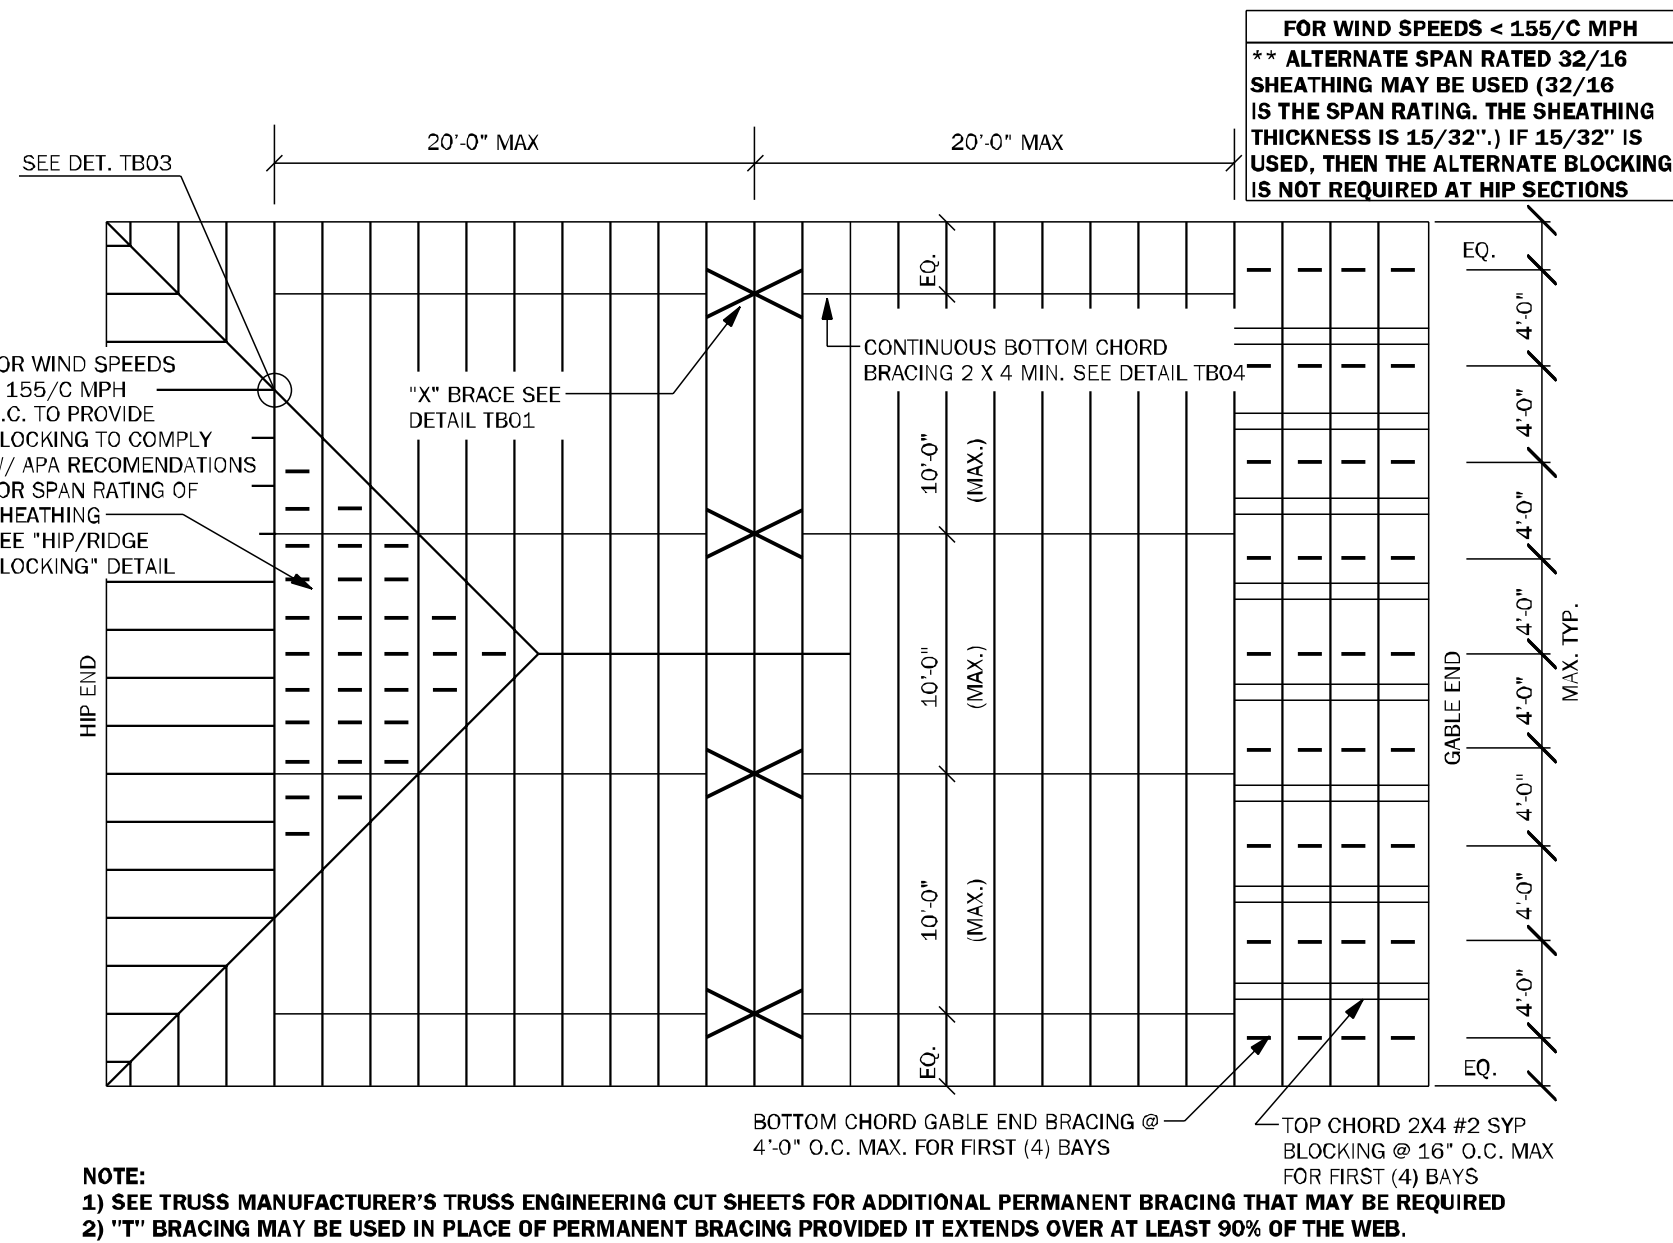


TB05	REQUIRED MINIMUM PERMANENT TRUSS BRACING PLAN	NTS
------	---	-----

RSRSH ENGINEERED ROOF PER ASCE 7-22 ROOF DESIGN ALLOWABLE COMPONENTS AND CLADDING WIND PRESSURES AND SUCTIONS FOR MEAN ROOF HEIGHT ≤ 25 ft	
WIND SPEED (ULTIMATE)	130 MPH
WIND SPEED (ALLOWABLE)	101 MPH
EXPOSURE CATEGORY	B
EFFECTIVE WIND AREA (SQ FEET)	WIND PRESSURE AND SUCTION (PSF) (-) VALUE DENOTES SUCTION
AREA	ROOF 1 2 3 GABLE 1 2 3
10	HIP -22.94 -31.68 -31.68 GABLE -24.44 -38.92 -46.25
ROOF NAILING SCHEDULE/ NAILING ZONES (SHINGLE AND TILE): ZONE 1: ASTM F1667 RSR-01 (8d) NAILS @ 6" O.C. ON EDGE & 6" O.C. IN FIELD ZONE 2: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE & 4" O.C. IN FIELD ZONE 3: ASTM F1667 RSR-01 (8d) NAILS @ 4" O.C. ON EDGE & 4" O.C. IN FIELD	
ROOF SHEATHING: SHINGLE: 7/16" EXP. 1 (2 ³ / ₁₆) or 15/32" EXP. 1 (2 ³ / ₁₆) TILE: 15/32" EXP. 1 (2 ³ / ₁₆)	
NOTE: 1. PER CODE ASTM F1667 RSR-01 REFERENCE TO 8d (2 ³ / ₁₆ " x 0.113") NAILS 2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 15/32", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RSR-03 10d (2 ¹ / ₂ " x 0.131") NAILS OR ASTM F1667 RSR-04 (3" x 120") NAILS 3. GABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END. ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE.	

WALL SHEATHING MAY BE INSTALLED VERTICALLY OR HORIZONTALLY. ATTACH PER NAILING SCHEDULE. PANEL EDGES WILL NEED TO BE ATTACHED TO STUD AND OR BLOCKING AT ALL EDGES. A MINIMUM 1/2" SPACE IS RECOMMENDED BETWEEN PANELS AT EDGES AND END JOINTS TO ALLOW FOR EXPANSION. FASTENERS SHALL NOT PENETRATE SURFACE MORE THAN 1/4".


- NAIL AT BASE 2 ROWS @ 4" O.C. w/ 8d COMMON NAIL
- NAIL AT TOP PLATE TWO ROWS @ 4" O.C. w/ 8d COMMON NAIL
- NAIL OPENING PERIMETER w/ (2) ROWS @ 4" O.C. w/ 8d COMMON NAIL
- NAIL INTERIOR AT 6" O.C. w/ 8d COMMON NAIL
- STAGGER ALL VERTICAL JOINTS & NAIL @ 4" O.C. w/ 8d COMMON NAIL
- PLYWOOD SPLICES @ HEADER - NAIL SHEATHING TO HEADER w/ 8d COMMON NAILS @ 6" O.C. (2) ROWS @ 10" & 8" B.O.T.T.
- (2) 8d NAILS @ 3" O.C. TO EACH TRUSS END OR @ VERTICAL MEMBER IF GABLE END
- FLOOR SHEATHING w/ PLYWOOD DECKING GLUED AN NAILED w/ 8d COMMON NAILS AT 6" O.C. AT EDGES OVERDRIVE NAILS. FASTENERS SHALL NOT PENETRATE SURFACE MORE THAN 1/8".

NOTE: 8d NAILS FOR WALL SHEATHING MUST BE MIN. 13" x 2 1/2". DO NOT OVERDRIVE NAILS. FASTENERS SHALL NOT PENETRATE SURFACE MORE THAN 1/4".

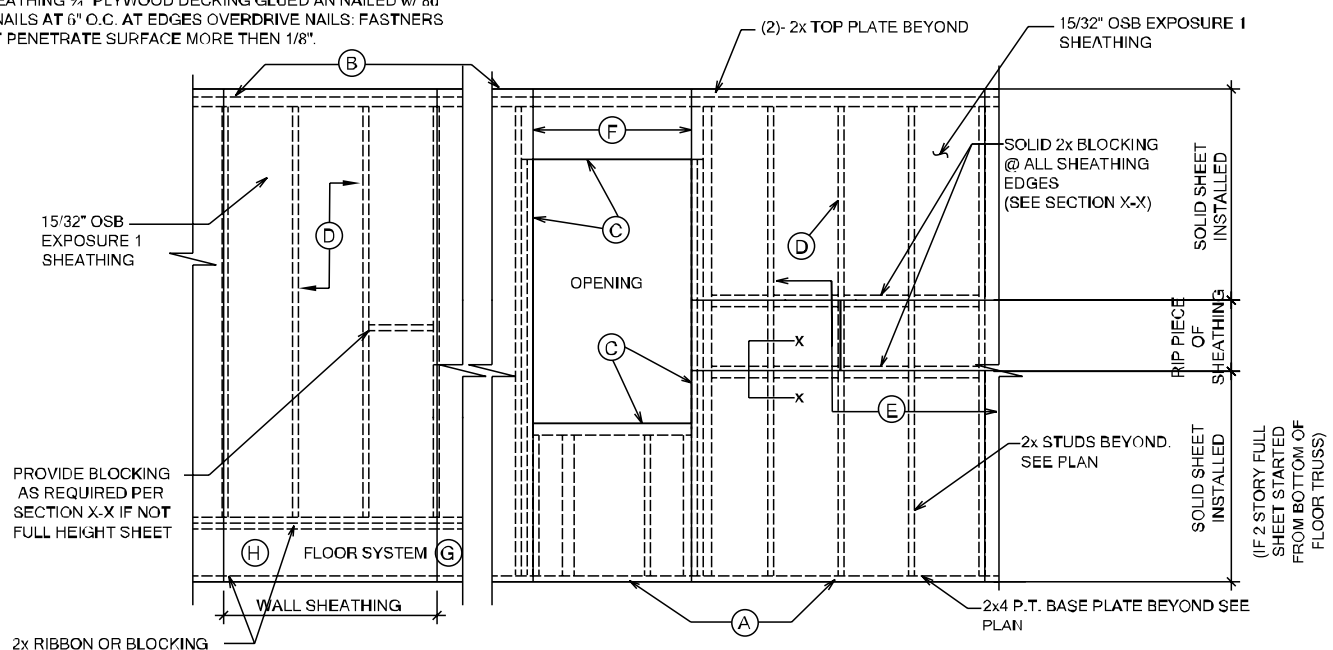


SINGLE NAIL EDGE SPACING

DOUBLE NAIL EDGE SPACING

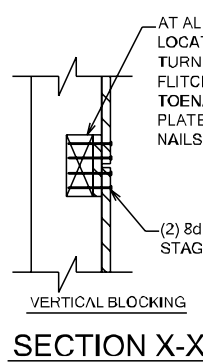

TB13	WALL SHEATHING INSTALLATION AND NAILING SCHEDULES	N.T.S.
------	---	--------

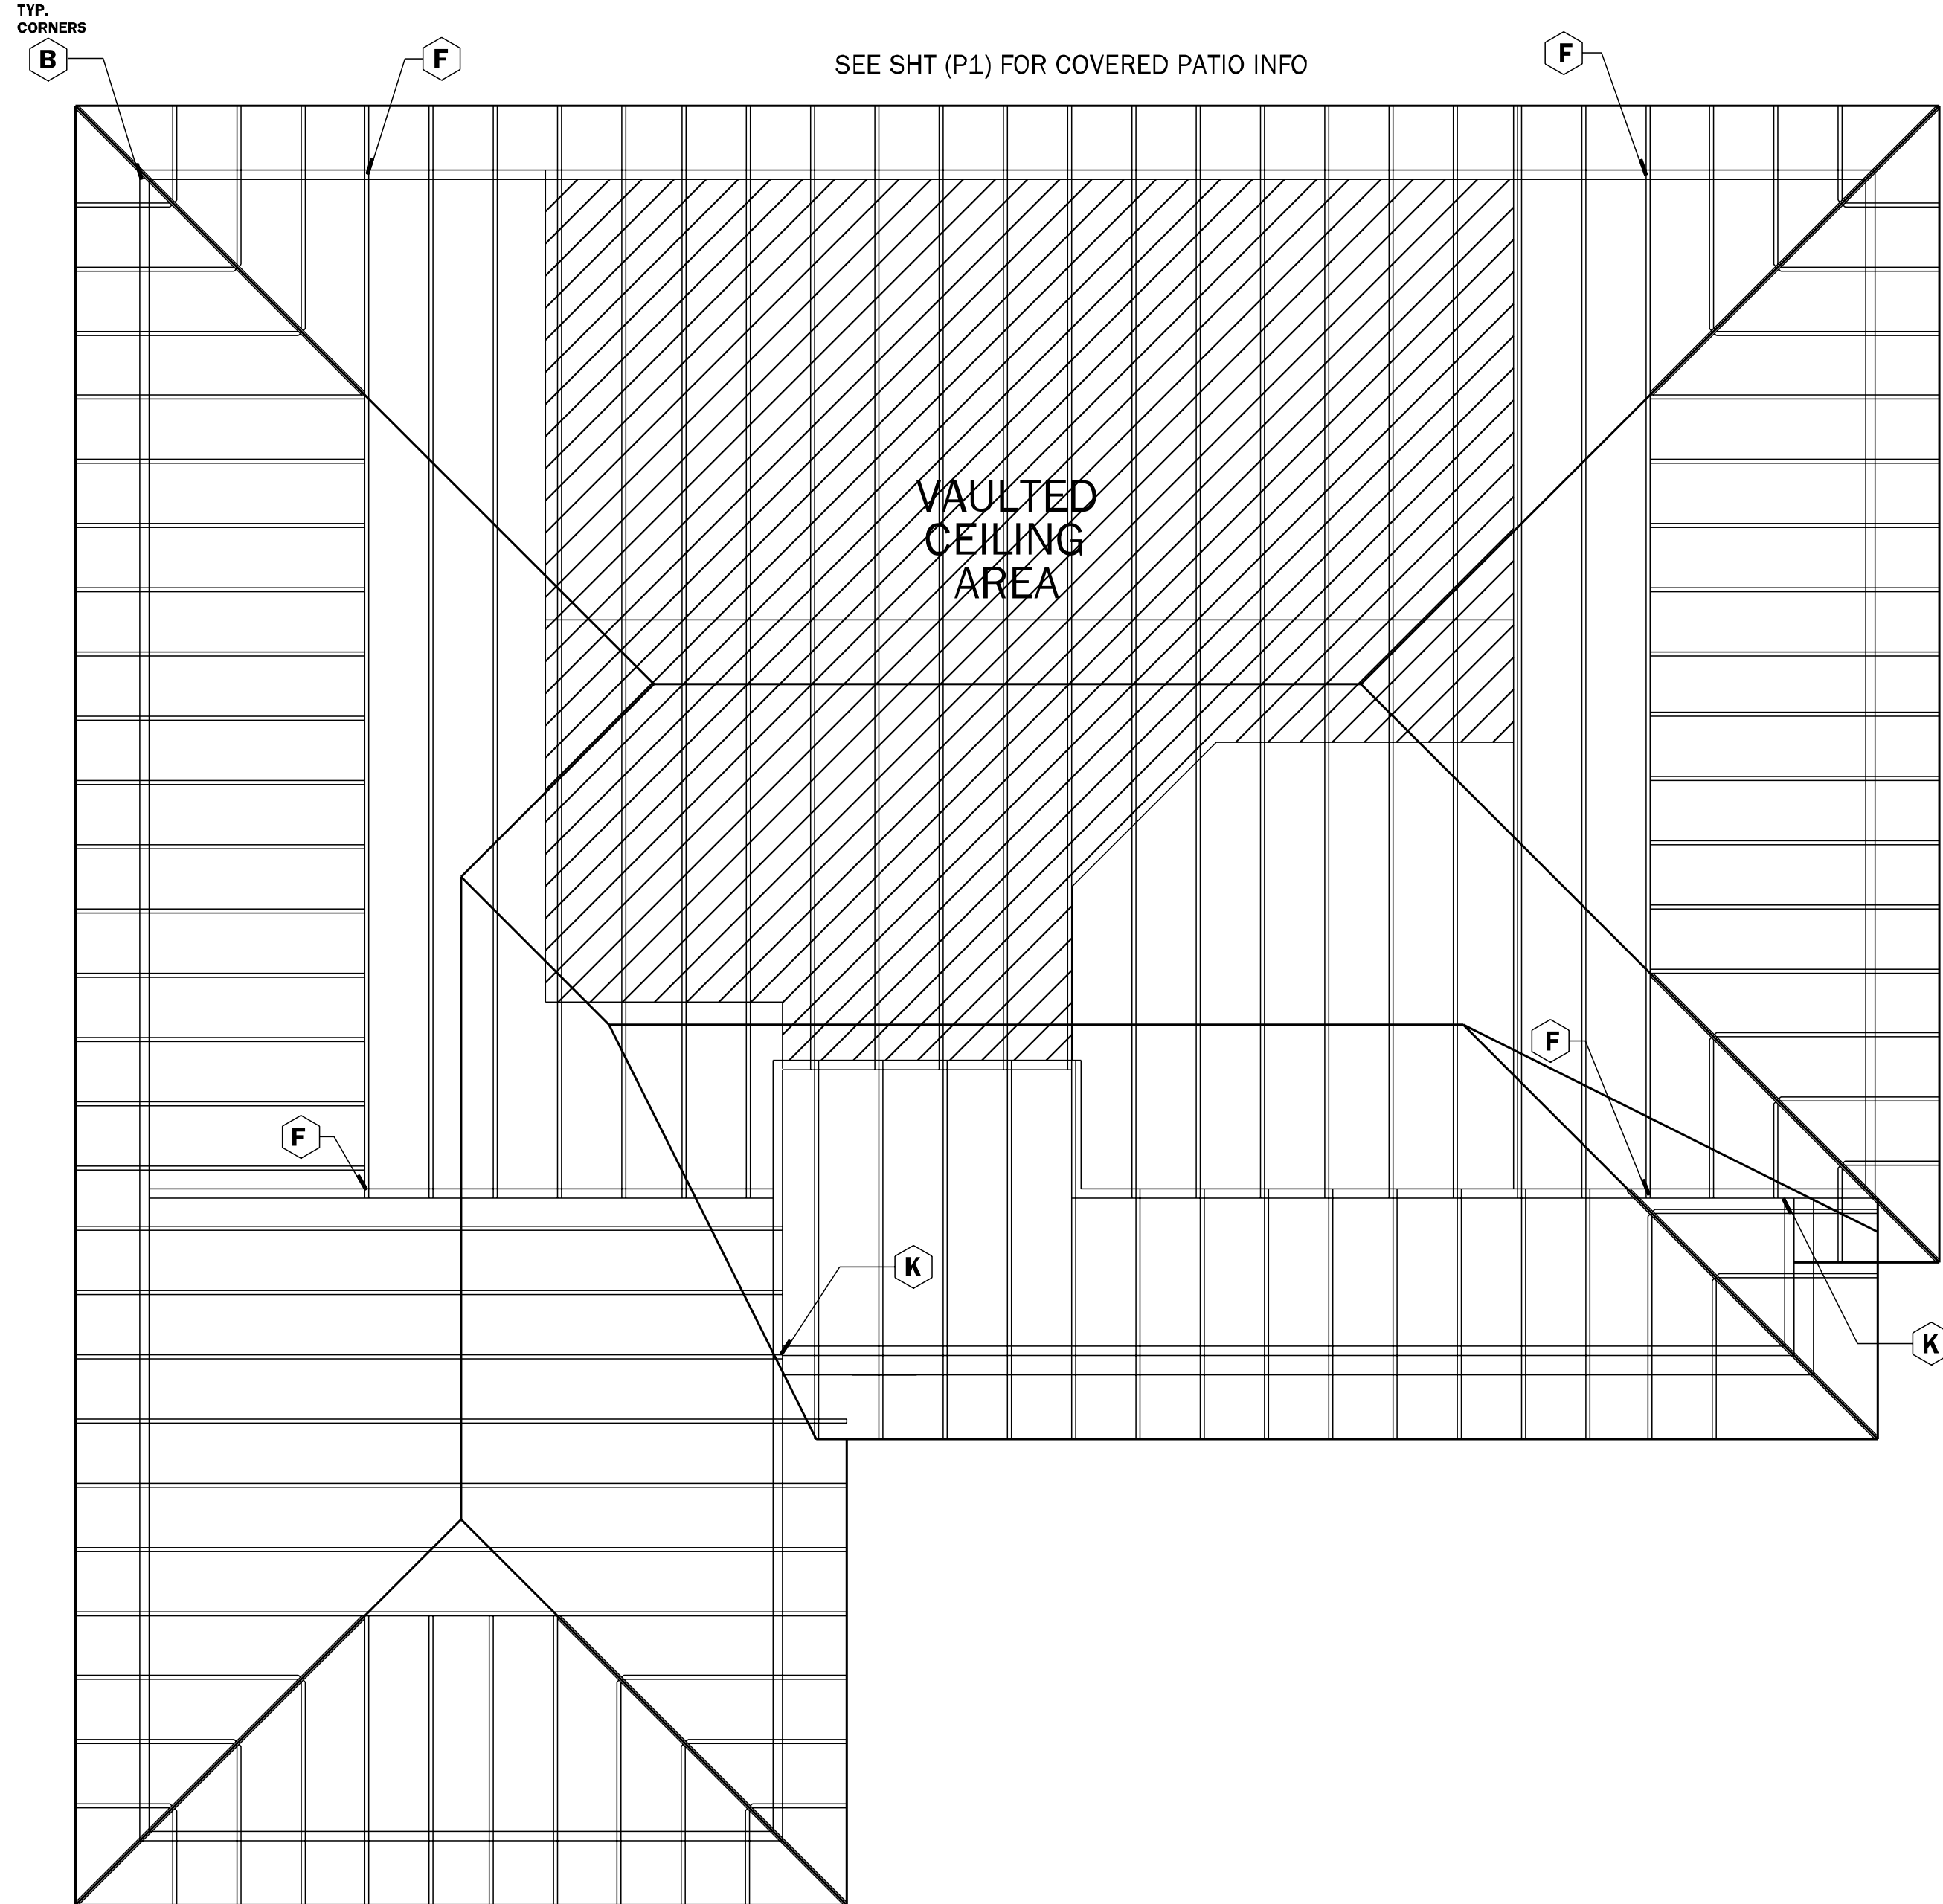

ROOF CRITERIA

24" OVERHANG @ EAVES U.N.O.
 12" OVERHANG @ GABLES U.N.O.
 SQUARE CUT FASCIA
 ROOF PITCH PER ELEVATION
 SHINGLE LOADING

SIMPSON - CONNECTOR SCHEDULE				USP - CONNECTOR SCHEDULE			
MARK	TYPE	CONNECTOR & FASTENERS	SPF	SYP	CONNECTOR & FASTENERS	SPF	SYP
(A)	FRAME TO MASONRY	HETA w/ (10)10x1 x 1 1/2" OR HETA w/ (10)10x1 x 1 1/2"	1810		HTA16 w/ (10)10x1 x 1 1/2" OR HTA16 w/ (10)10x1 x 1 1/2"	1585	1670
(B)	FRAME TO FRAME	H25A w/ (10)8d NAILS	615	700	RTA w/ (10)8d NAILS	515	585
(C)	FRAME TO FRAME	HTA2 w/ (10)10x1 x 1 1/2" AT 2 PLY TRUSSES	1015	1040	RT16A w/ (10)10x1 x 1 1/2" AT 2 PLY TRUSSES	855	1020
(D)	FRAME TO FRAME	HT12 w/ (10)10x1 x 1 1/2" AT EXTERIOR LOCATION INCLUDE (3) 12d TOENAILS	860	860	RT16 w/ (10)10x1 x 1 1/2" AT EXTERIOR LOCATION INCLUDE (3) 12d TOENAILS	1005	1115
(E)	FRAME TO MASONRY	MGT w/ (2)10d NAILS AND 58" A.T.R. w/ 12" EMBEDMENT w/ SIMPSON 'SET' EPOXY	3330	3965	MUGT15 w/ (2)10d NAILS AND 58" A.T.R. w/ 12" EMBEDMENT w/ SIMPSON 'SET' EPOXY	3330	4495
(F)	FRAME TO FRAME	HTS20 w/ (2)10x1 x 1 1/2" AT EXTERIOR LOCATION INCLUDE (3) 12d TOENAILS	1215	1415	HTV20 w/ (2)10x1 x 1 1/2" AT EXTERIOR LOCATION INCLUDE (3) 12d TOENAILS	1285	1530
(G)	FRAME TO MASONRY	HGT12 w/ (10)10d NAILS AND (2) 58" A.T.R. w/ 12" EMBEDMENT w/ SIMPSON 'SET' EPOXY (HGT12 FOR 3-PLY)	10950		HUGT12 w/ (10)10d NAILS AND (2) 58" A.T.R. w/ 12" EMBEDMENT w/ SIMPSON 'SET' EPOXY (HUGT12 FOR 3-PLY)	2570	3650
(H)	FRAME TO MASONRY	POTW w/ (10)10x1 x 1 1/2" SDS WOOD SCREWS AND (2) 1/2" x 5" TITEN HD ANCHOR BOLTS	3400	4725	RPUS w/ (10)10x1 x 1 1/2" SDS WOOD SCREWS AND (4) 3/4" x 5" WEDGE-BOLT		7400
(I)	FRAME TO MASONRY	(1) LGT2 w/ (10) 16d SINKERS & (1) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) (SEE NOTE #6 BELOW)	1755	2040	(2) LGT2 w/ (20) 16d SINKERS & (10) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) OR (20) 16d SINKERS FOR FRAME (EA)	3100-M	3100-M 4500-F
(J)	FRAME TO MASONRY	(2) LGT2 w/ (20) 16d SINKERS & (10) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) OR (20) 16d SINKERS FOR FRAME (EA)	3500-M 3510-F	4080-F	(2) LGT2 w/ (20) 16d SINKERS & (10) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) OR (20) 16d SINKERS FOR FRAME (EA)	6480-M 6480-F	7110-F
(K)	FRAME TO MASONRY	(2) LGT2 w/ (20) 16d SINKERS & (10) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) OR (20) 16d SINKERS FOR FRAME (EA)	4730-M 5010-F	5600-F	(2) LGT2 w/ (20) 16d SINKERS & (10) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) OR (20) 16d SINKERS FOR FRAME (EA)	6480-M 6480-F	7110-F
(L)	BEAM TO BEAM	HU410 OPT HU410 w/ (10) TITEN HP 2x3" & (10) 10d NAILS	G4210N	G4210N	HD411 OPT HD411 w/ (20) 1 1/4" x 3" WEDGE-BOLT & (10) 10d NAILS	G4210N	G4210N
(M)	FRAME TO MASONRY	HU45 OPT HU45 w/ (6) 10d NAILS & (12) 1/4" x 3" TITEN TO NAILS OR (12) 16d & (6) 10d (FOR FRAME)	G4210N	G4210N	HD45 OPT HU45 w/ (6) 10d NAILS & (12) 1/4" x 3" TITEN TO NAILS OR (12) 16d & (6) 10d (FOR FRAME)	G4210N	G4210N
(N)	FRAME TO MASONRY	(2) HETA16 OPT (2) HETA20 1-PLY w/ (10) 10d x 1 1/2" OR 2-PLY w/ (12) 16d	1920 2355	1920 2355	(2) HETA16 OPT (2) HETA20 1-PLY w/ (10) 10d x 1 1/2" OR 2-PLY w/ (12) 16d	1870 2450	1870 2450
(O)	FRAME TO MASONRY	HTSM16 w/ (8) 10d NAILS AND (4) 1/4" x 3" TAPCONS	955	1110	HTVM16 w/ (8) 10d NAILS AND (4) 1/4" x 3" TAPCONS	1145	1225
(P)	FRAME TO MASONRY	H20S w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" TITEN	785	910	HTVM20 w/ (10) 10d NAILS AND (4) 1/4" x 3" TAPCONS	1145	1225
(Q)	FRAME TO MASONRY	DTT22 w/ (8) 1 1/4" x 1 1/2" SDS WOOD SCREWS AND (1) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) (SEE NOTE #4)	1835	2145	DTB22 w/ (8) 1 1/4" x 1 1/2" SDS WOOD SCREWS AND (1) 1/4" x 3" WEDGE-BOLT (2 PLY TRUSSES) (SEE NOTE #4)	1510	1835
(R)	FRAME TO MASONRY	HTT15 w/ (20) 16d x 12" NAILS AND (1) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' (SEE NOTE #1 & #5 BELOW)	4375	5860	HTT15 w/ (20) 16d x 12" NAILS AND (1) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' (SEE NOTE #1 & #5 BELOW)		5165
(S)	FRAME TO MASONRY	HTT14 w/ (20) 16d x 12" NAILS AND (1) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' (SEE NOTE #1 & #5 BELOW)	3940	4235	HTT14 w/ (20) 16d x 12" NAILS AND (1) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' (SEE NOTE #1 & #5 BELOW)		4160
(T)	FRAME TO FRAME	HTB w/ (20) 16d x 12" NAILS	765	910	LUCT w/ (20) 16d x 12" NAILS	675	1045
(U)	FRAME TO MASONRY	H20K1 w/ (8) 1 1/4" x 1 1/2" SDS WOOD SCREWS & (5) 1/4" x 3" TAPCONS	760	760	HTB14 w/ (20) 16d x 12" NAILS & (1) 1/4" x 3" TAPCONS	1395	1395
(V)	FRAME TO MASONRY	VGT w/ (16) 1 1/4" x 3" SDS WOOD SCREWS & (1) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' w/ 12" MIN. EMBEDMENT	3555	4910			
(W)	FRAME TO MASONRY	(2) VGT w/ (32) 1 1/4" x 3" SDS WOOD SCREWS & (2) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' w/ 12" MIN. EMBEDMENT	5170	7185			
(X)	FRAME TO FRAME	VGT w/ (16) 1 1/4" x 3" SDS WOOD SCREWS & (1) 58" A.T.R. EPOXYED w/ SIMPSON 'SET' w/ 12" MIN. EMBEDMENT	3555	4940	MUGT15 w/ (22) 10d NAILS & HTTA w/ (18) 10d NAILS & (1) 58" A.T.R.		4100
(Y)	NOT USED						

GENERAL CONNECTOR NOTES:
 1. CONNECT ALL FLOOR TRUSSES TO INTERIOR BEARING WOOD WALLS / BEAMS w/ (2) 12d TOENAILS.
 2. ALL TRUSS TO TRUSS CONNECTIONS ARE PROVIDED BY TRUSS MANUFACTURER. UNLESS OTHERWISE NOTED.
 3. G.C. MAY USE EITHER SIMPSON OR USP CONNECTIONS. SEE FRAMING PLAN FOR CONNECTOR CALL OUT.
 4. FOR SINGLE PLY FULL HEIGHT SYP ON FULL HEIGHT SYP AT 24" TO TRUSS VERTICAL VIEW w/ (2) 10d NAILS @ 3" O.C. STAGGERED.
 5. 12" MIN. A.T.R. EPOXYED @ CMU BOND BEAM U.N.O.
 6. SCOT TRUSS CHORD w/ 10" & 24" BAY MATCH CHORD LUMBER SIZE) w/ (2) HOWS 10d @ 4" FROM END & 4" O.C. STAGGERED, CENTER AT CONNECTOR LOCATION AS MUCH AS POSSIBLE.

- MINIMAL CONNECTOR UNO ON FRAMING PLAN
 - CONNECTION FOR ALL ROOF / FLOOR TRUSSES TO MASONRY WALLS / INTERIORS WALLS UNO ON PLAN
 - CONNECTION AT 24" OR 32" O.C. PENDING VERTICALS FOR ALL FLOOR TRUSSES PARALLEL TO MASONRY WALLS
 - CONNECTION FOR ALL HIP JACK (CORNER JACK) TO MASONRY WALLS / INTERIORS WALLS
 - CONNECTION FOR ALL CONTINUOUS RM BOARD TO TOP OF MASONRY AT 32" O.C. MAX w/ (2) AT EACH CORNER G.C. TO VERIFY LOCATION DOES NOT CONFLICT w/ A.T.R. IF APPLICABLE LAYOUT
 - CONNECT ALL FLOOR TRUSSES TO INTERIOR BEARING WOOD WALLS / BEAMS w/ (2) 12d TOENAILS
- MINIMAL CONNECTOR UNO ON FRAMING PLAN
 - CONNECTION FOR JACK TRUSS TO WOOD WALL OR BEAM
 - MINIMAL CONNECTOR UNO ON FRAMING PLAN
 - CONNECTION FOR ALL TRUSSES TO INTERIOR/EXTERIOR BEARING WOOD WALLS AND/OR BEAMS

ROOF FRAMING NOTES

- SHINGLE OR METAL ROOFING SYSTEM (SEE ARCH.) SHEATHING - SEE [RSRSH] SCHEDULE THIS SHT. FOR SHT G & FASTENERS ON PRE-ENGINEERED WOOD TRUSSES AT 2'-0" O.C. MAX. OR CONVENTIONAL FRAME ROOF. SEE PLAN FOR SIZE AND SPACING. SEE ARCHITECTURAL PLAN FOR TYPICAL ROOF SLOPE AND OTHER INFORMATION.
- THE EXTERIOR CEILING FOR THE ENTRIES AND PORCHES SHALL HAVE EITHER 7/16" OSB EXPOSURE 1 SHEATHING OR 1/2" DENSOLASS TO THE UNDERSIDE OF THE ROOF TRUSSES. ALL PANEL EDGES ARE TO BE BLOCKED SOLID WITH 2x4 #2 SYP WITH (3) 10d TOENAILS EACH END. THE SHEATHING IS TO BE NAILED WITH 8d NAILS AT 4" ON CENTER AT ALL EDGES AND THEN 8" ON CENTER IN FIELD.
- FOR UNDERLAYMENT REQUIREMENTS SEE R905.1.1.1

--- NOTE TO FRAMER ---

IF ROOF TRUSS LAYOUT SHOWS TRUSS ID S, THIS LAYOUT HAS BEEN PROVIDED BY THE CLIENT/ DESIGNER OR ARCHITECT TO USE FOR THE DESIGN OF THIS PROJECT. OTHERWISE A GENERIC LAYOUT HAS BEEN DETERMINED. BUT PRIOR TO CONSTRUCTION OR TRUSS FABRICATION, FINAL TRUSS LAYOUT AND TRUSS SHOP DRAWINGS ARE TO BE SUBMITTED TO ENGINEER OF RECORD (E.O.R.) FOR REVIEW AND APPROVAL. AT THIS TIME THE E.O.R. RESERVES THE RIGHT TO REVISE THE PLAN AS REQUIRED PER THE REVIEW OF THE FINAL TRUSS LAYOUT AND TRUSS SHOP DRAWINGS. ADDITIONAL FEE'S MAY APPLY, STARTING CONSTRUCTION OR TRUSS FABRICATION PRIOR TO THIS REVIEW IS NOT ADVISED. AND THE E.O.R. IS NOT RESPONSIBLE FOR ADDITIONAL COSTS DUE TO REVISIONS OF THE PLAN. IF CONVENTIONAL FRAMING IS SHOWN, NO TRUSS APPROVAL IS REQUIRED, UNLESS LAYOUT IS REVISED W/OUT WRITTEN APPROVAL FROM FDS.

SEE PLAN SET FOR TRUSS BRACING AND ADDITIONAL ROOF INFORMATION

COUNTY SEAL

FDS ENGINEERS & ARCHITECTS
 2025 S. Main Street, Suite 200
 Tallahassee, Florida 32301
 Phone: (904) 880-2133
 Fax: (904) 880-2133
 www.fdseng.com

Professional Engineer License No. 23750
 Professional Architect License No. 23750
 Certificate of Authorization No. 23750

☐ CARL A. BROWN, P.E.
☐ SCOTT A. LEWIS, P.E.
☐ THEN-BAO DUONG, P.E.

FL # 96126
 FL # 78750
 FL # 94152

keesee ASSOCIATES
 ARCHITECTURE | DESIGN | PLANNING
 2025 S. Main Street, Suite 200
 Tallahassee, Florida 32301
 Phone: (904) 880-2133
 Fax: (904) 880-2133
 www.keesee.com

Professional Engineer License No. 23750
 Professional Architect License No. 23750
 Certificate of Authorization No. 23750

☐ CARL A. BROWN, P.E.
☐ SCOTT A. LEWIS, P.E.
☐ THEN-BAO DUONG, P.E.

FL # 96126
 FL # 78750
 FL # 94152

DAMS HOMES
 FLORIDA CONTRACTORS LICENSE NO. CRC1330146
 100 WEST GARDEN STREET
 PENSACOLA FL 32502

DIVISION LOCATION:
 GAINESVILLE

Job Information:

INVENTORY

LOT: 94
 BLK:
 SEC:
 SUB: PRESERVE AT LAUREL LAKE
 747 SW ROSEMARY DR.
 LAKE CITY, FL

Model Name / Number:
1755


Plan Issue Date:
 Wednesday, December 11, 2024

KA PROJECT NUMBER:
24-13141


Sheet: **S-1** Of:

ROOF PLAN


Wednesday, December 11, 2024

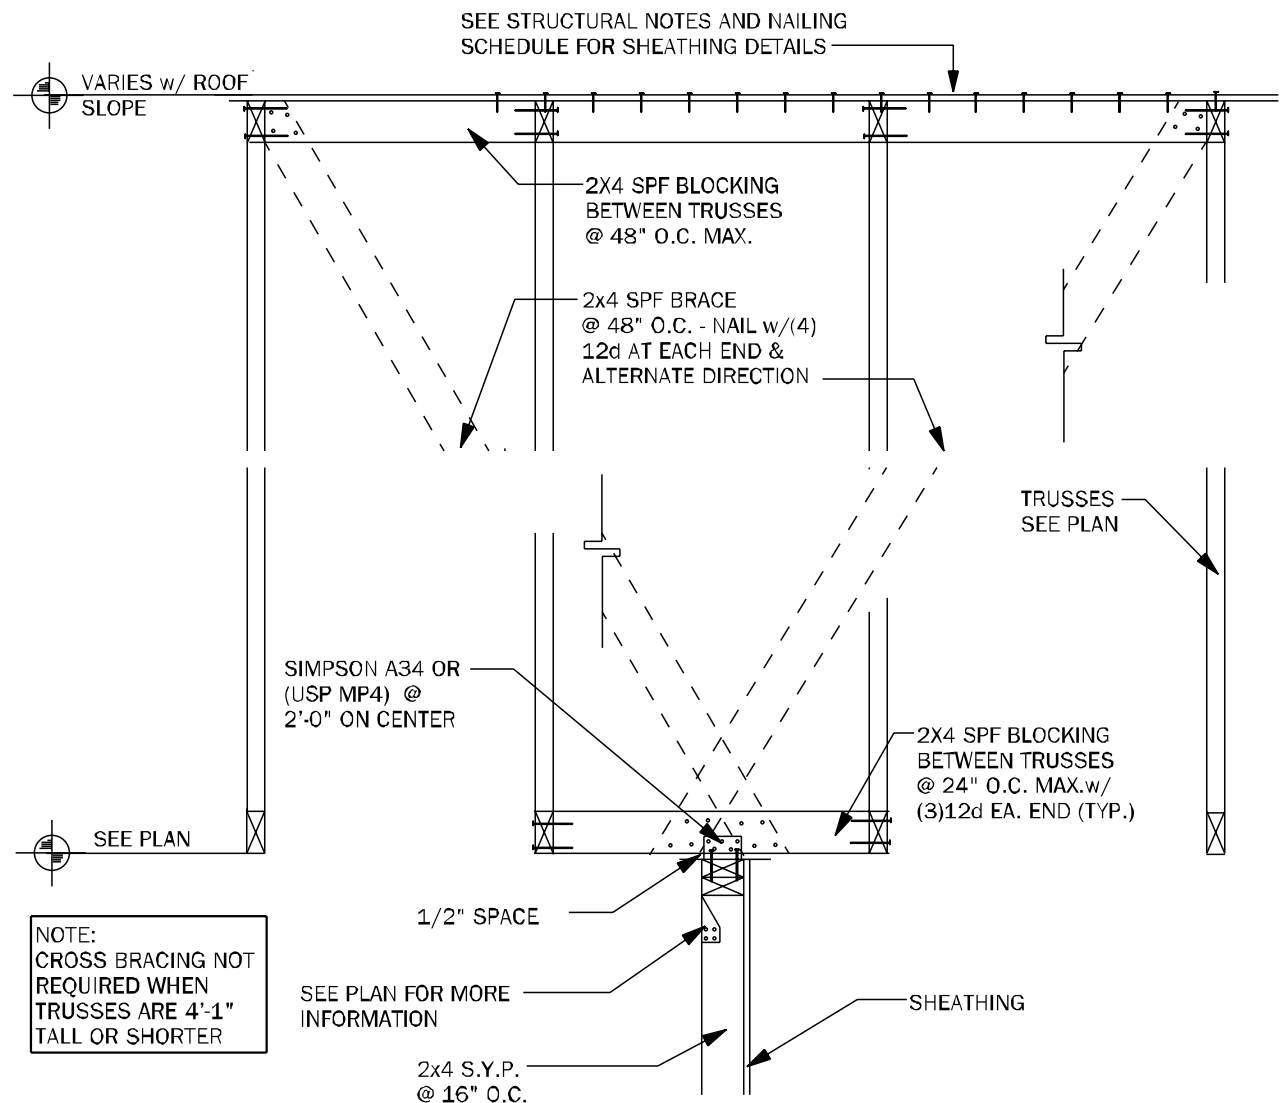


TB15 EXTERIOR NON-BEARING WALL DETAIL N.T.S.

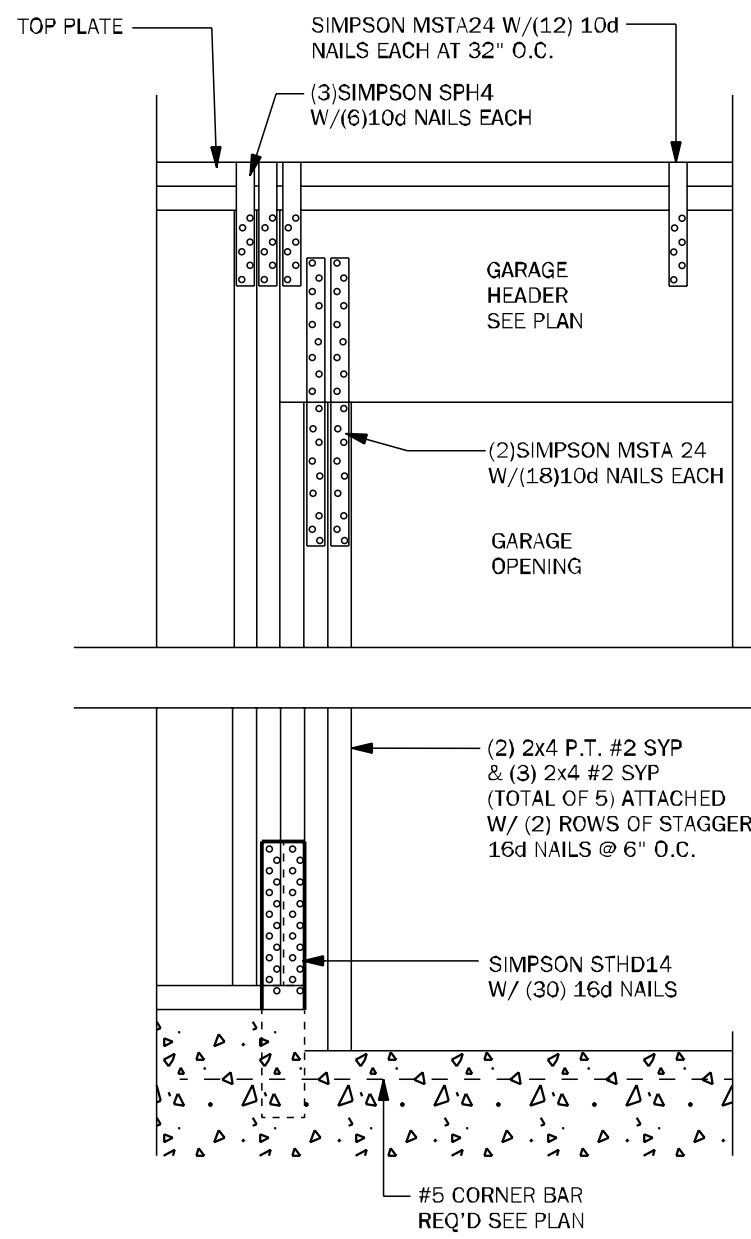


WC04 GARAGE HEADER ANCHOR 3/4" = 1'-0"

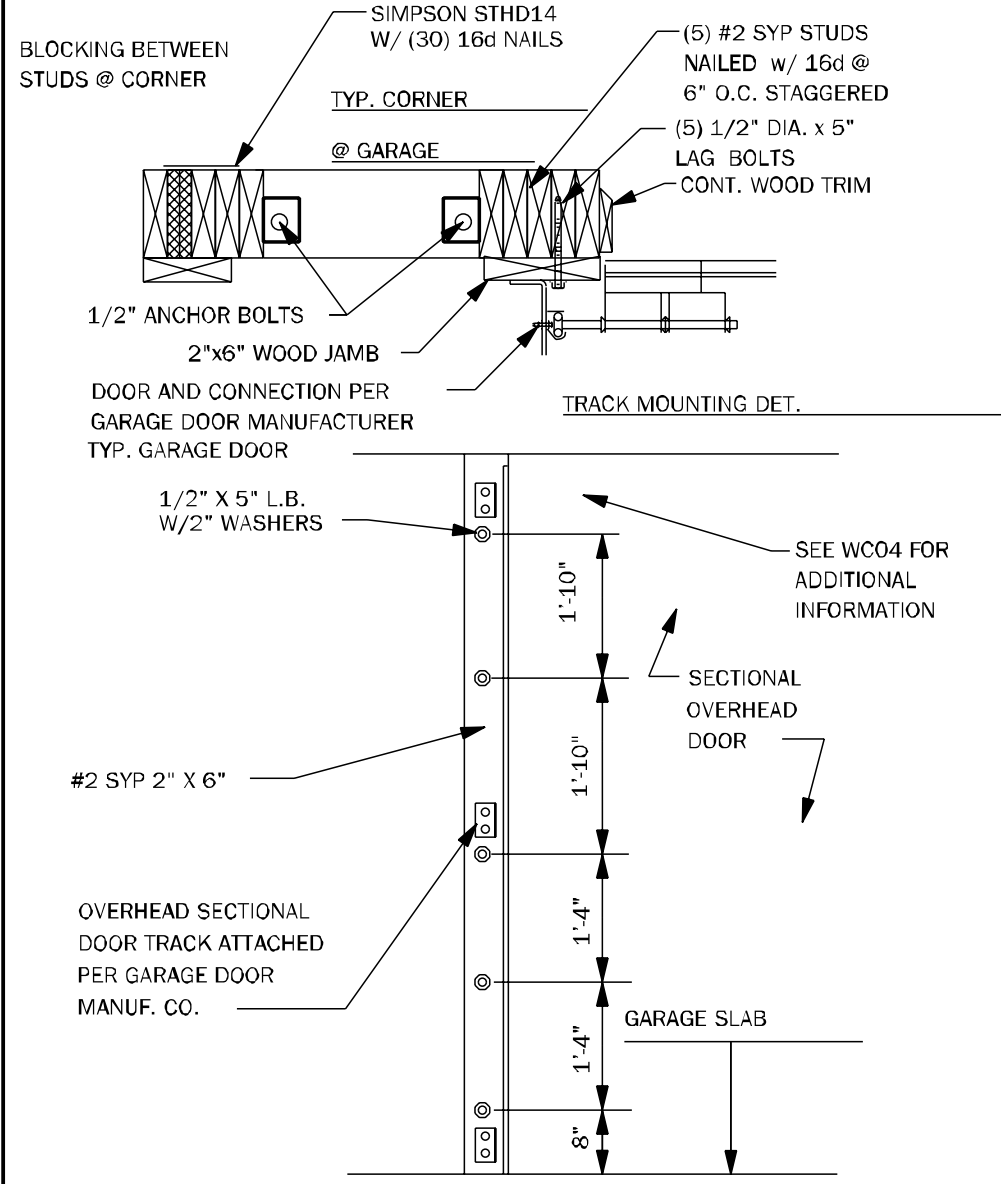


WC05 SECT. OVERHEAD GAR. DOOR INSTALL N.T.S.

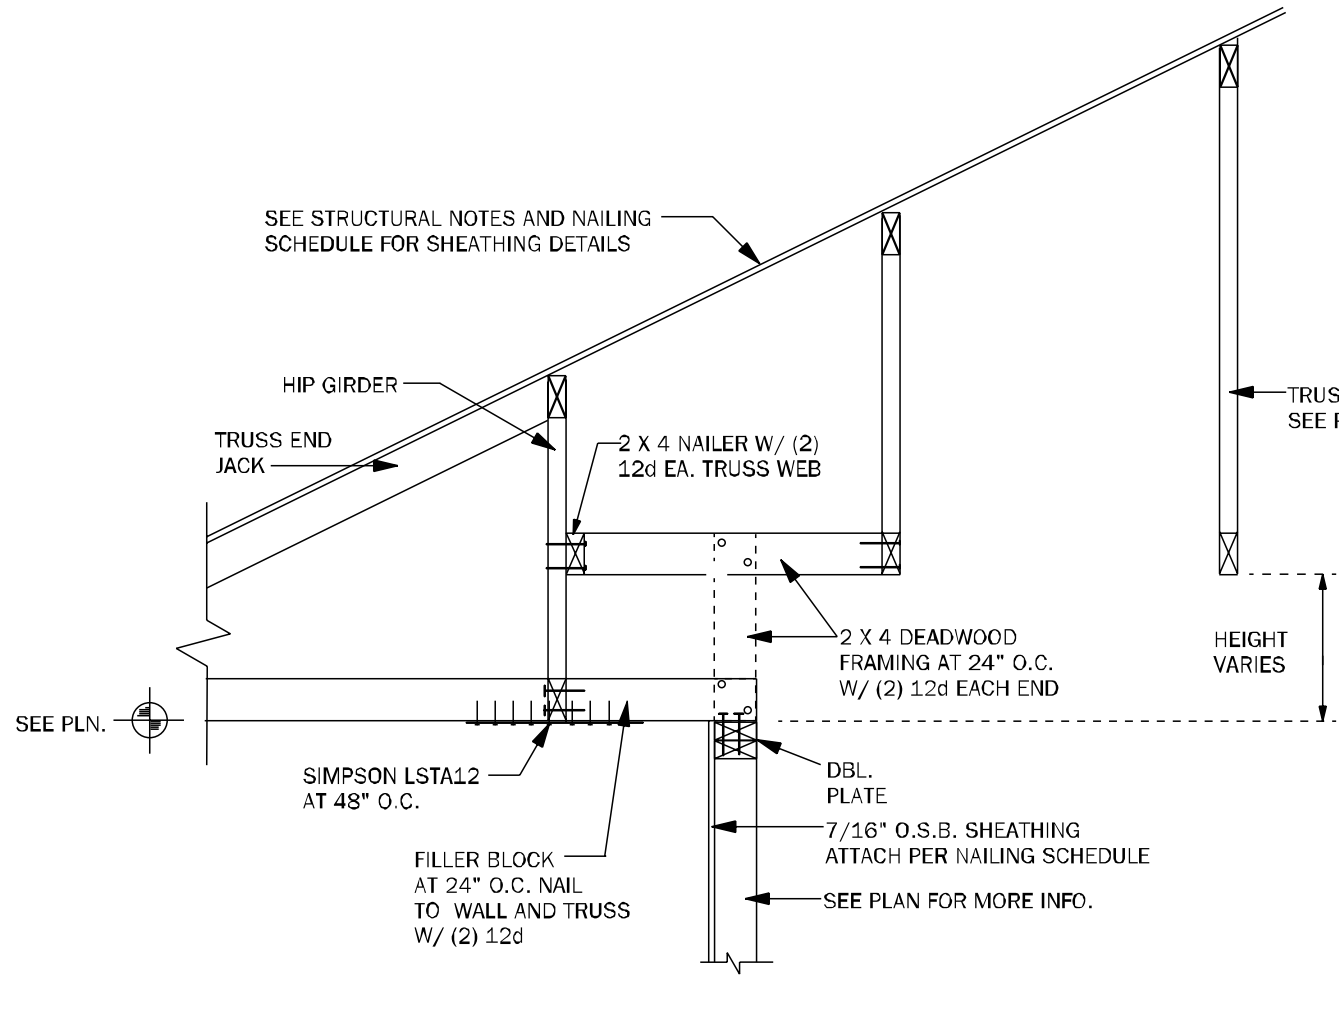


WF64 EXTERIOR NON BRG. WALL DETAIL N.T.S.

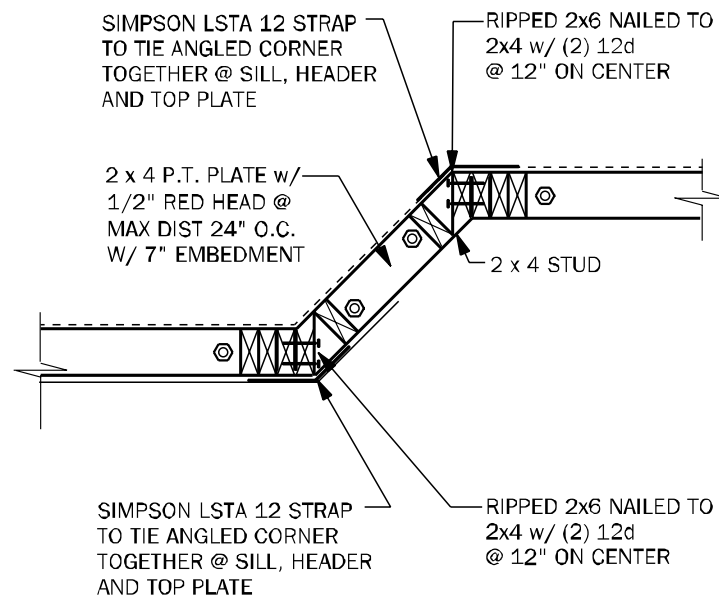

WF43 EXTERIOR ANGLED WALL DETAIL N.T.S.

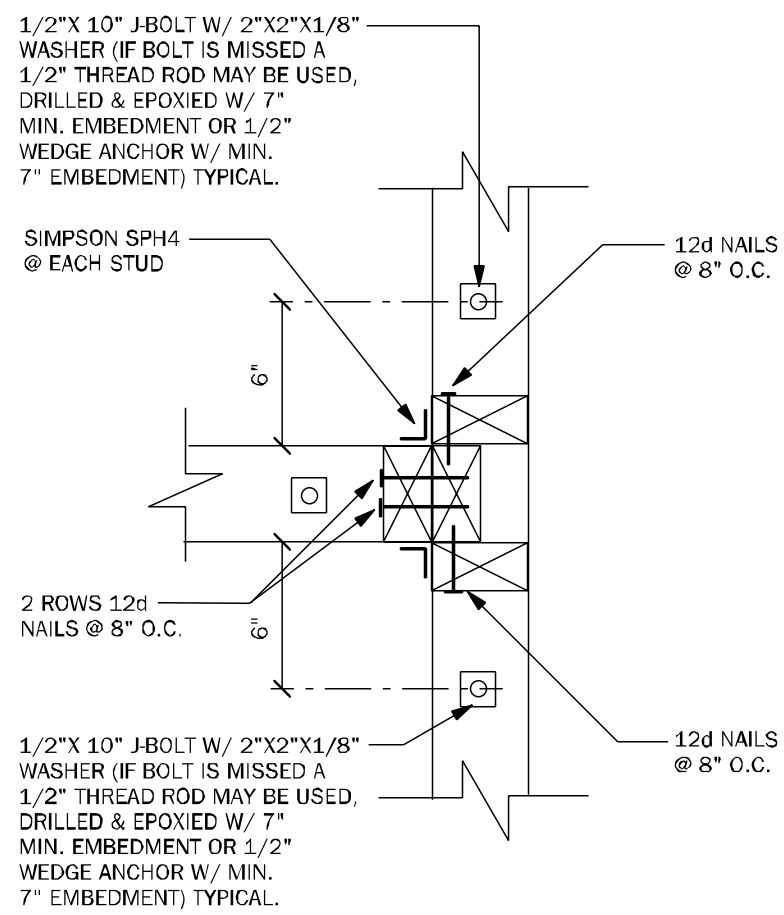


WC03 WALL TO WALL CONN. @ END OF SHEARWALL 1 1/2" = 1'-0"

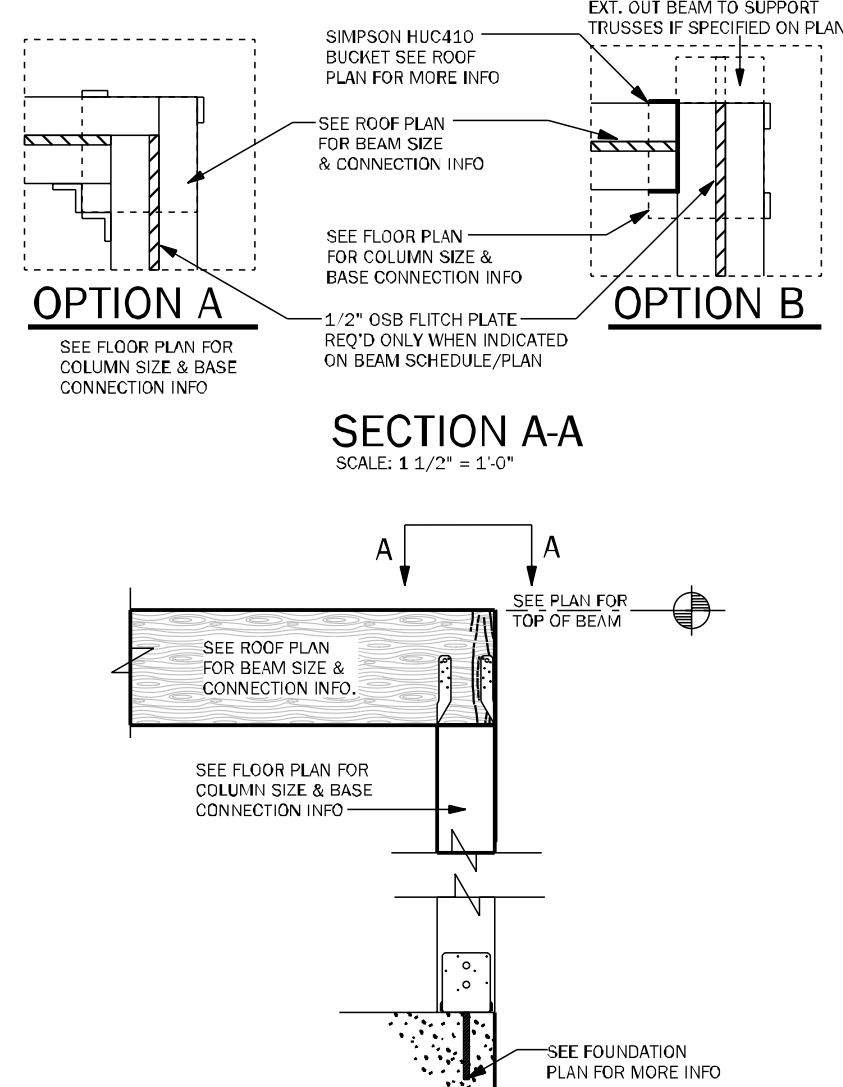


CD11 COMMON BEAM ATTACHMENT N.T.S.

NOTE: @ ALL EXT. CONDITIONS ATTACH 2x STUDS TO TOP PLATE W/ (4) 16d TONAILS (2) ON EA. SIDE TYP. TOE NAILS MAY BE SUBSTITUTED W/ (1) SIMPSON H2.5A CONNECTOR @ EA. STUD TO TOP PLATE W/ 8d 2 1/2" x 0.131 NAILS

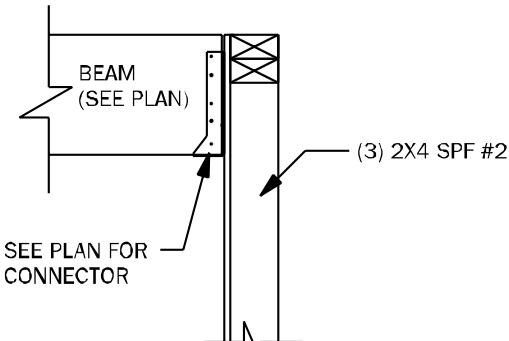


CD25 BEAM TO WALL CONNECTION N.T.S.

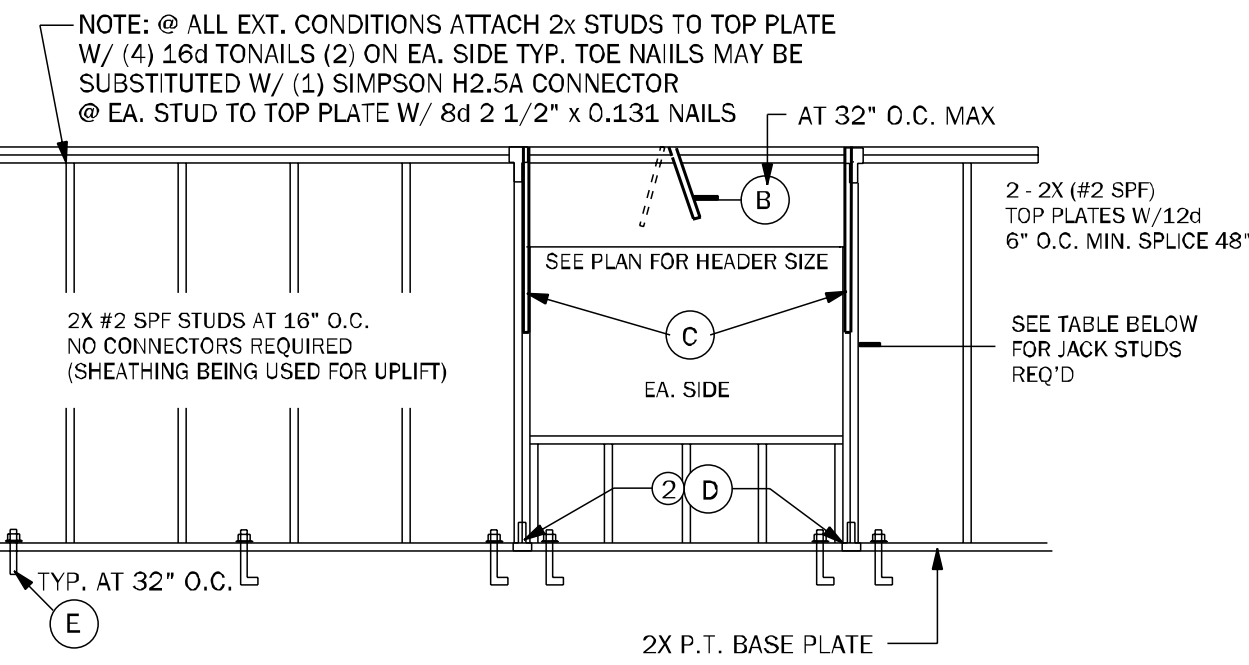


CONNECTOR LEGEND		WINDOW & DOOR JACK TABLE	
(A)	SIMPSON SPH4 W/ 12-10d x 1/2	PROVIDE JACKS @ EACH END AS FOLLOWS	
(B)	SIMPSON MSTA24 W/ (18) 10d NAILS	(2) WHEN OPN'GS ARE GREATER THEN 4'-0"	
(C)	SIMPSON MSTA24 W/ (18) 10d NAILS	(3) WHEN OPN'GS ARE GREATER THEN 10'-0" BUT LESS THAN 16'-0"	
(D)	SIMPSON SPH4 W/ 12-10d x 1 1/2"	NOTE: FOR EXTERIOR OR SHEAR WALL SEE SHEET S1 FOR WALL & ROOF SHEATHING INSTALLATION & NAILING SCHEDULES	
(E)	1/2" X 10" J-BOLT W/ 2" X 2" X 1/8" WASHER @ 32" O.C. PLUS (2) WITHIN 6" EACH SIDE OF JACK STUDS @ HEADER		


WF66 TYPICAL BEARING WALL N.T.S.

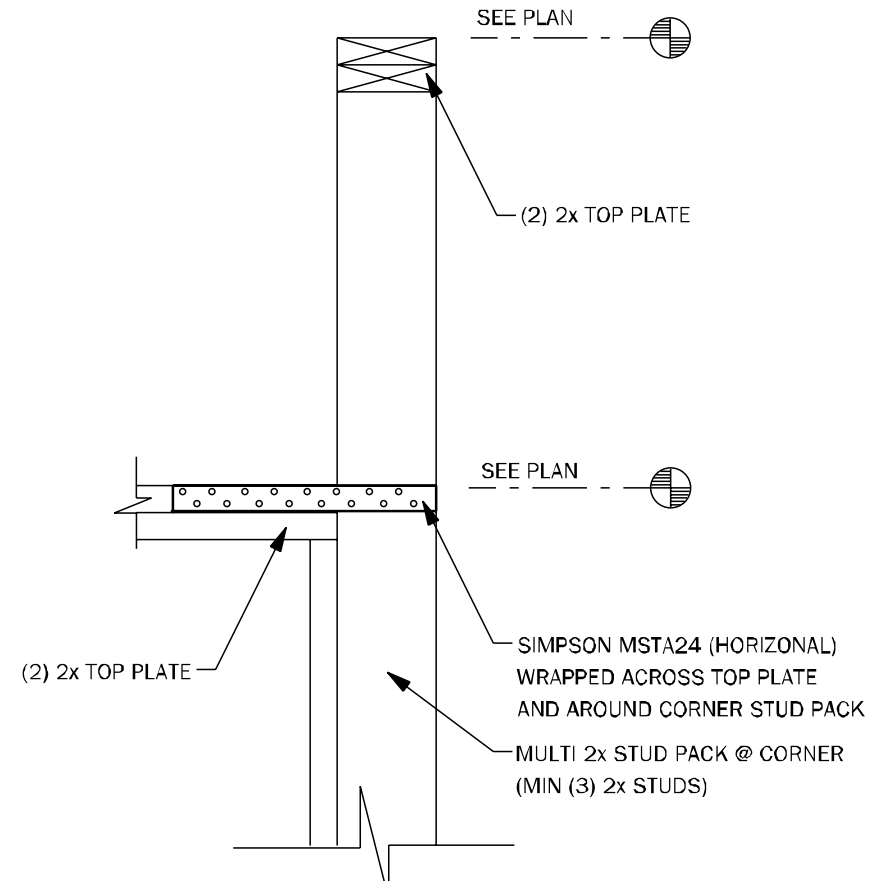


WC09 WALL STEP @ CORNER N.T.S.

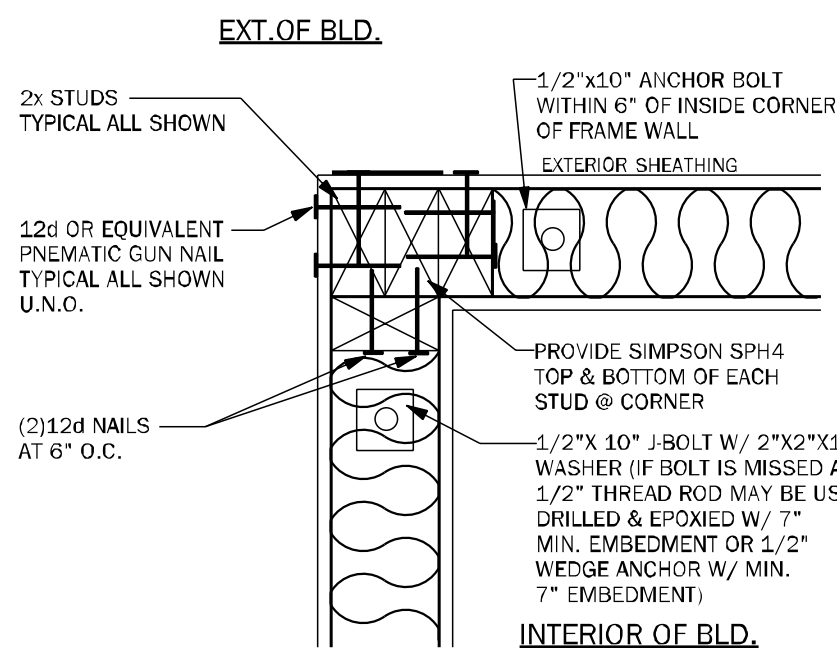


WC06 EXTERIOR FRAME CORNER 3/4" = 1'-0"

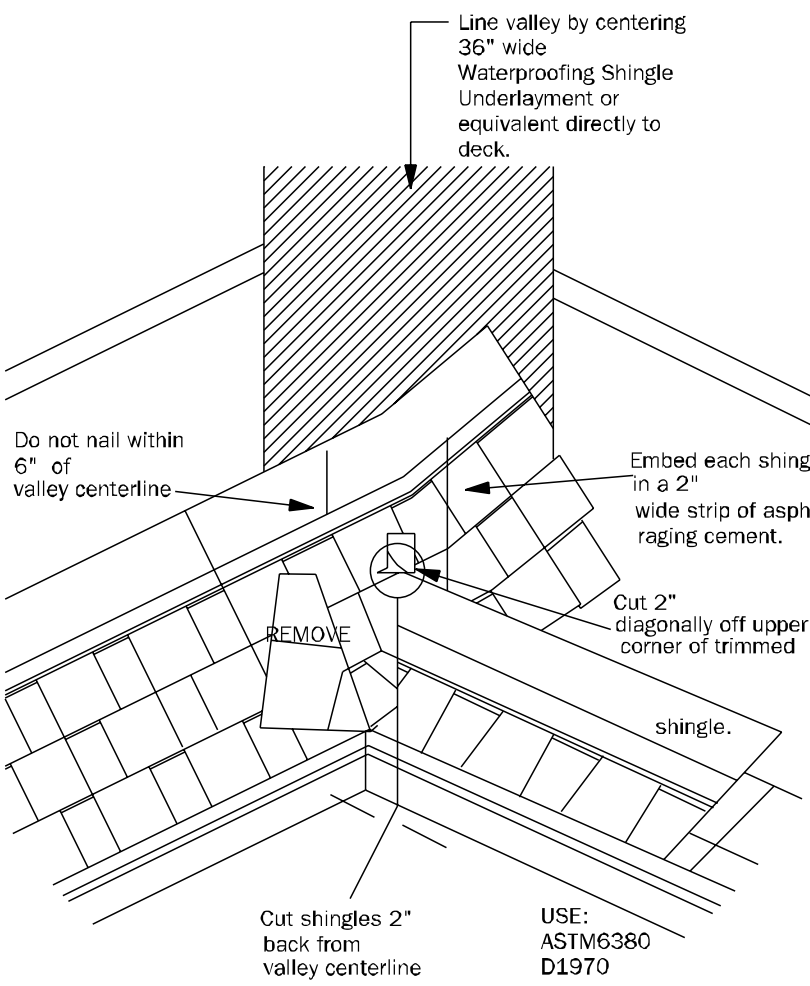

RD01 VALLEY FLASHING DETAIL N.T.S.

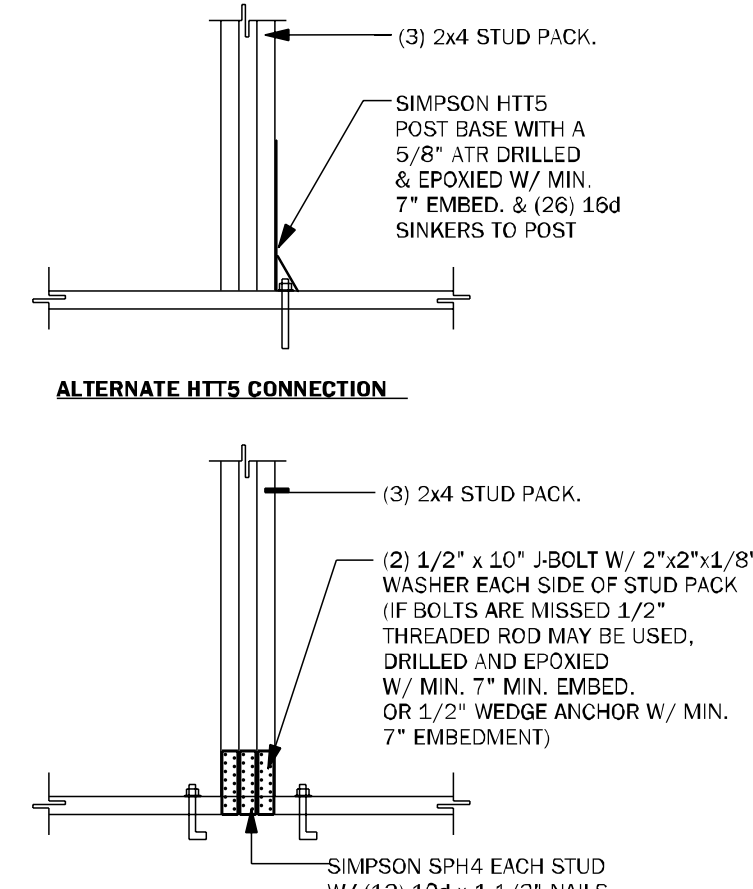

CD26 GIRDER BASE CONNECTION 1/2" = 1'-0"

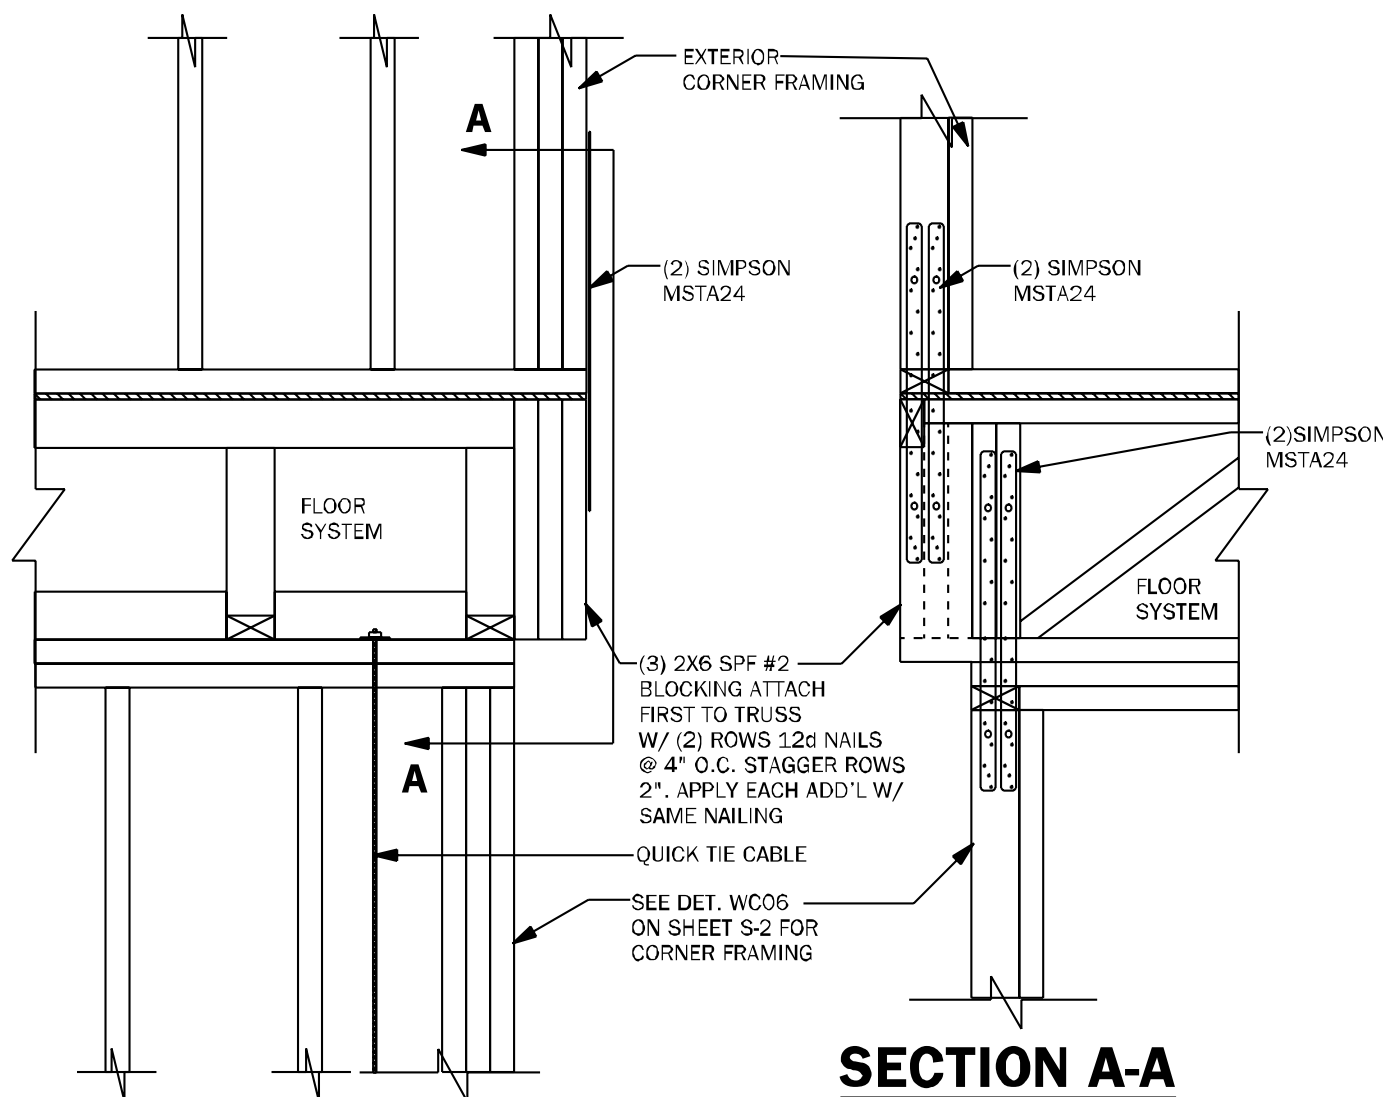

WF68 CORNER CONNECTION N.T.S.

COUNTY SEAL

FDS ENGINEERING ASSOCIATES

255 Seaboard Lane, Suite 200
Maitland, Florida 32751
Tel: 407.321.8800
Fax: 407.321.8801
www.fdseng.com

Keese Associates

ARCHITECTURE | DESIGN | PLANNING

255 Seaboard Lane, Maitland, FL 32751, Suite 200
Tel: 407.321.8800
Fax: 407.321.8801
mydesign.com

FL # 66126
FL # 78750
FL # 94452

CARL A. BROWN, P.E.
SCOTT A. LEWIS, P.E.
THIEN DAO DUONG, P.E.

DAMS HOMES

FLORIDA CONTRACTORS LICENSE NO. CRC1330146

**100 WEST GARDEN STREET
PENSACOLA FL 32502**

**DIVISION LOCATION:
GAINESVILLE**

Job Information:

Model Name / Number: **1755**

Plan Issue Date: Wednesday, December 11, 2024

KA PROJECT NUMBER: **24-13141**











Sheet: **S-2** of:


TYPICAL FRAMING DETAILS

INVENTORY


LOT: 94
BLK:
SEC:
SUB: PRESERVE AT LAUREL LAKE
747 SW ROSEMARY DR.
LAKE CITY, FL

Wednesday, December 11, 2024

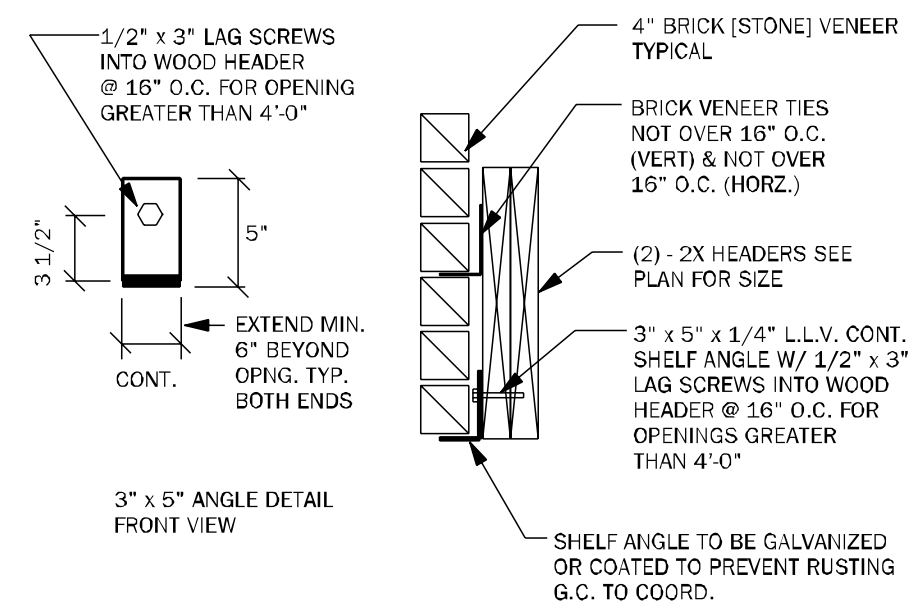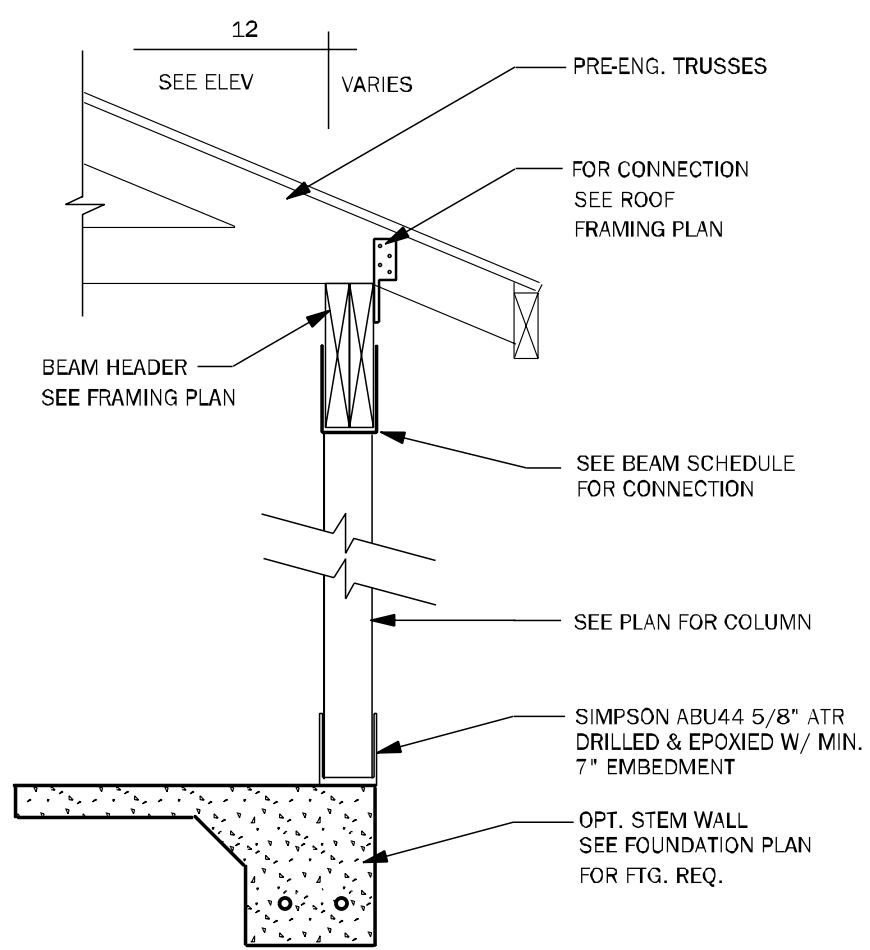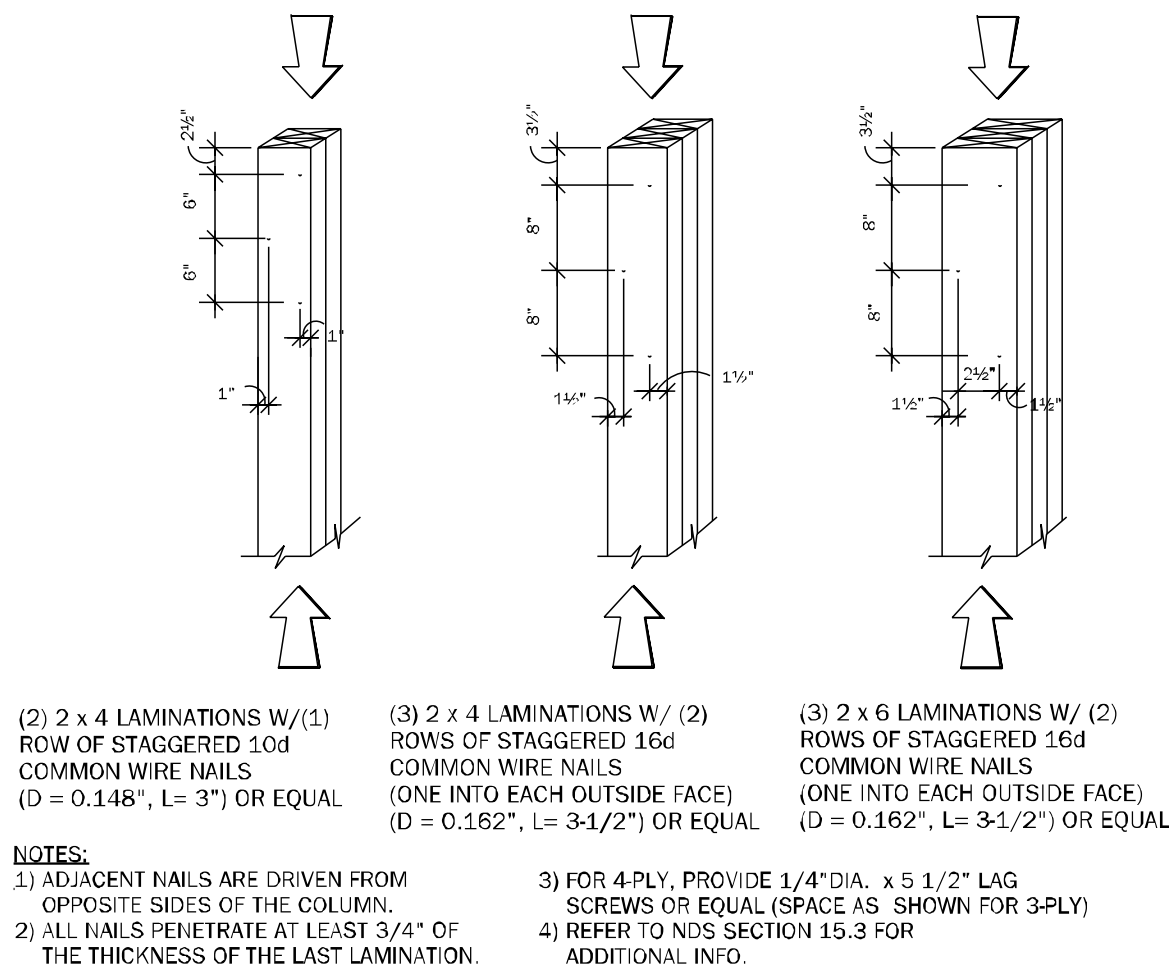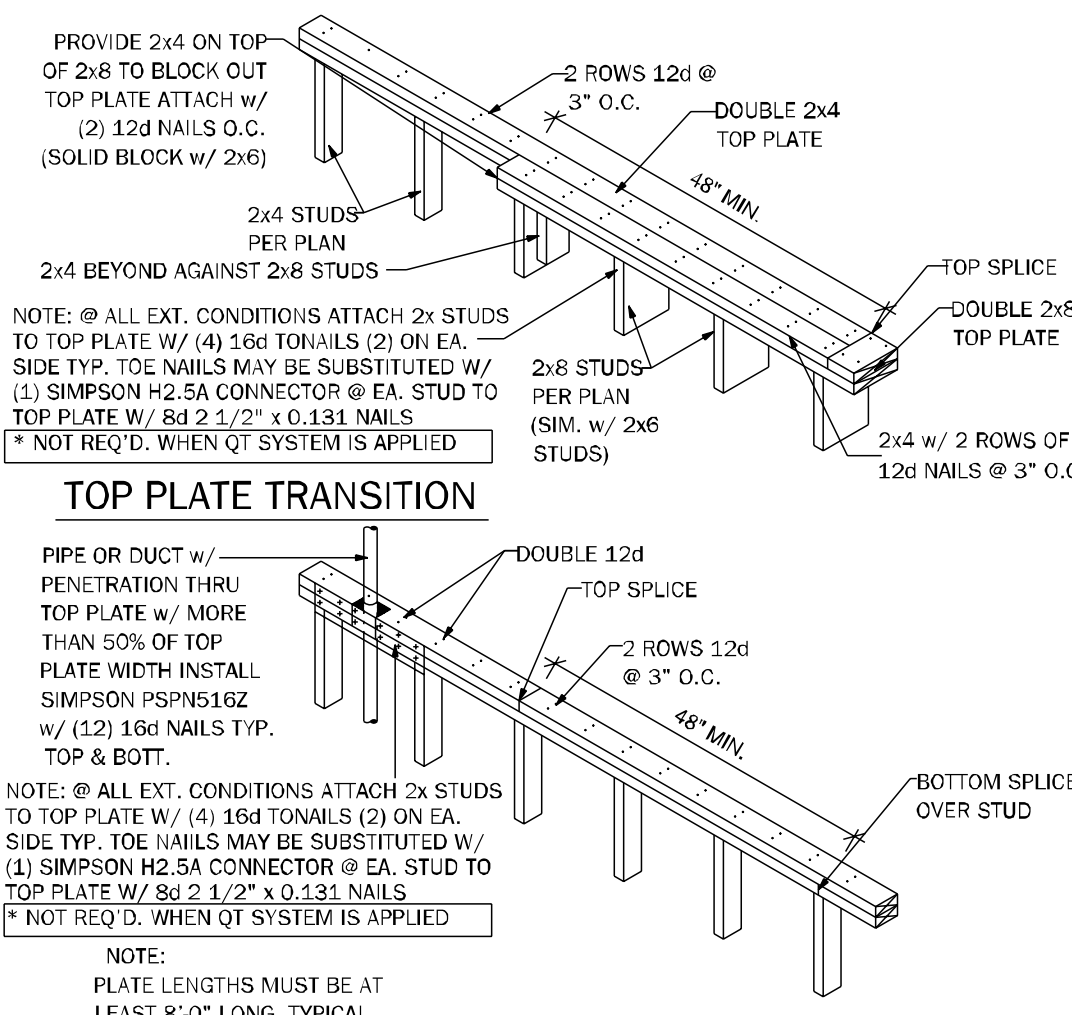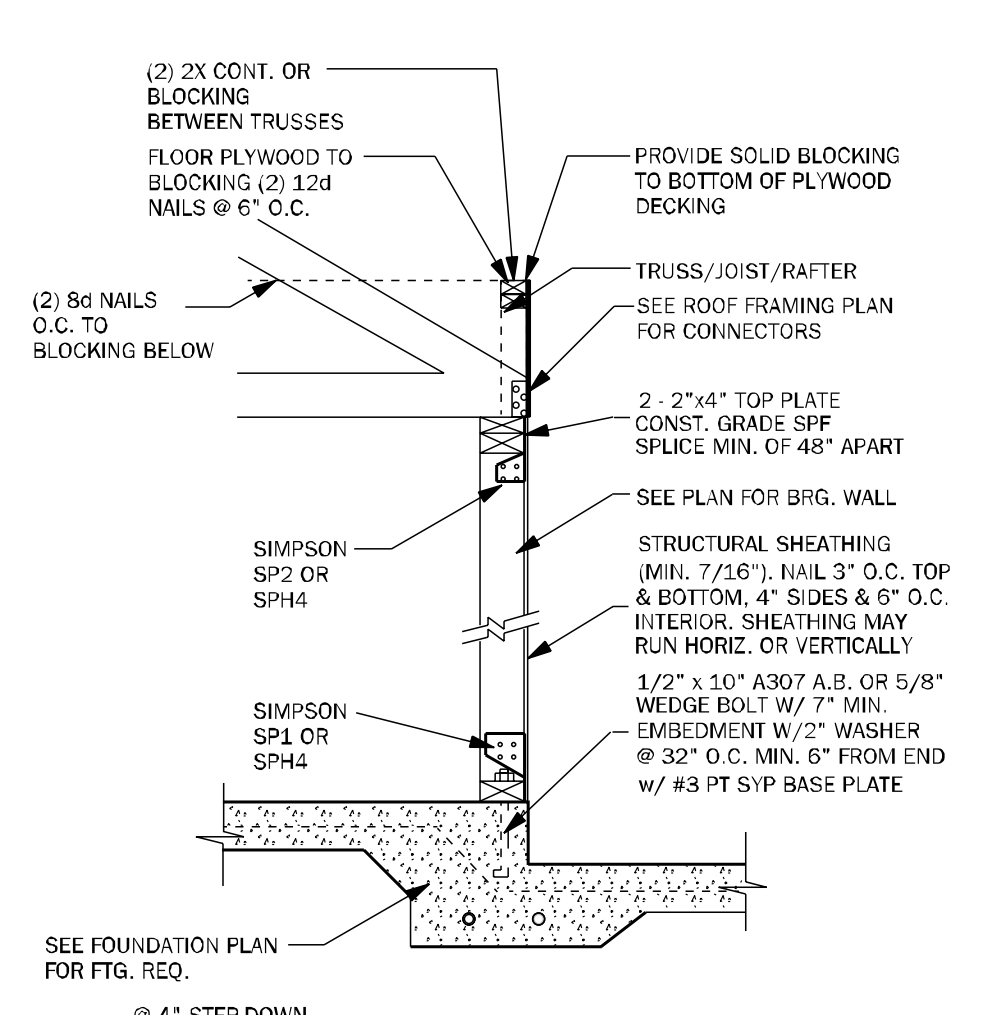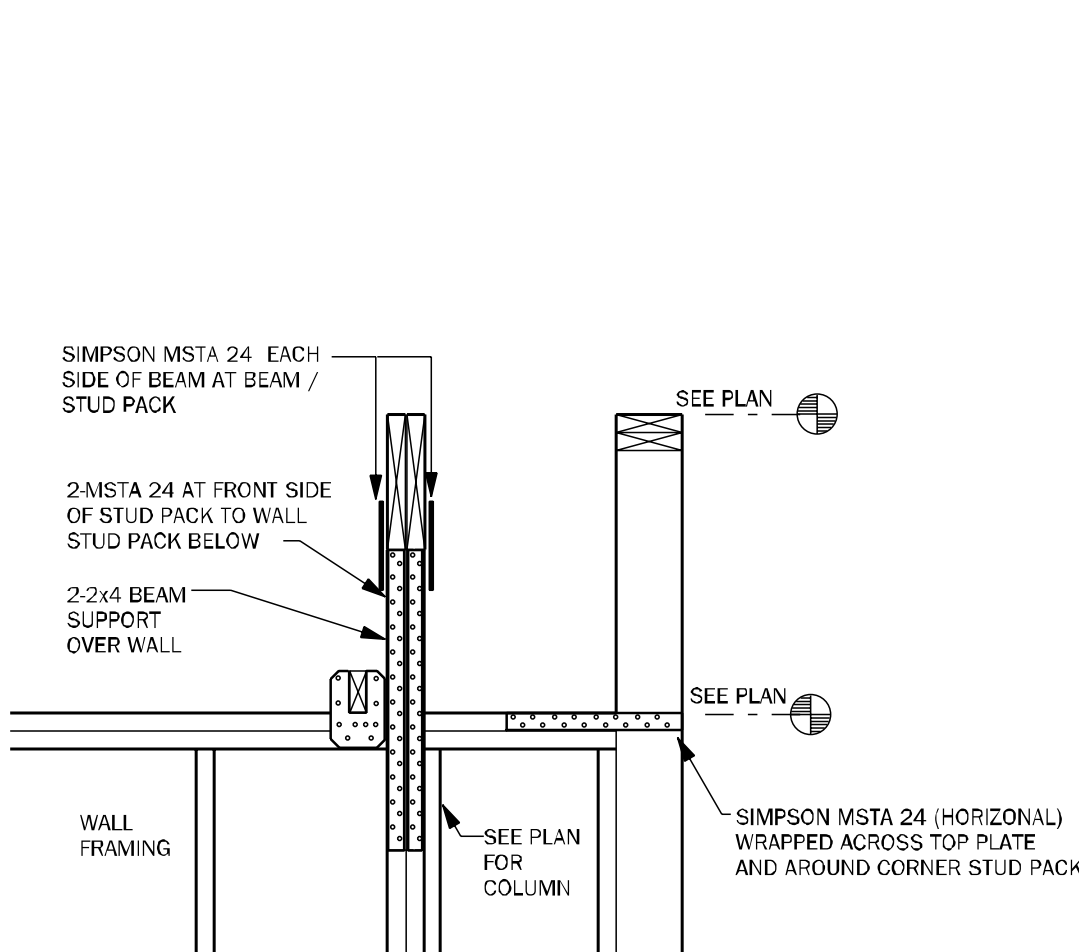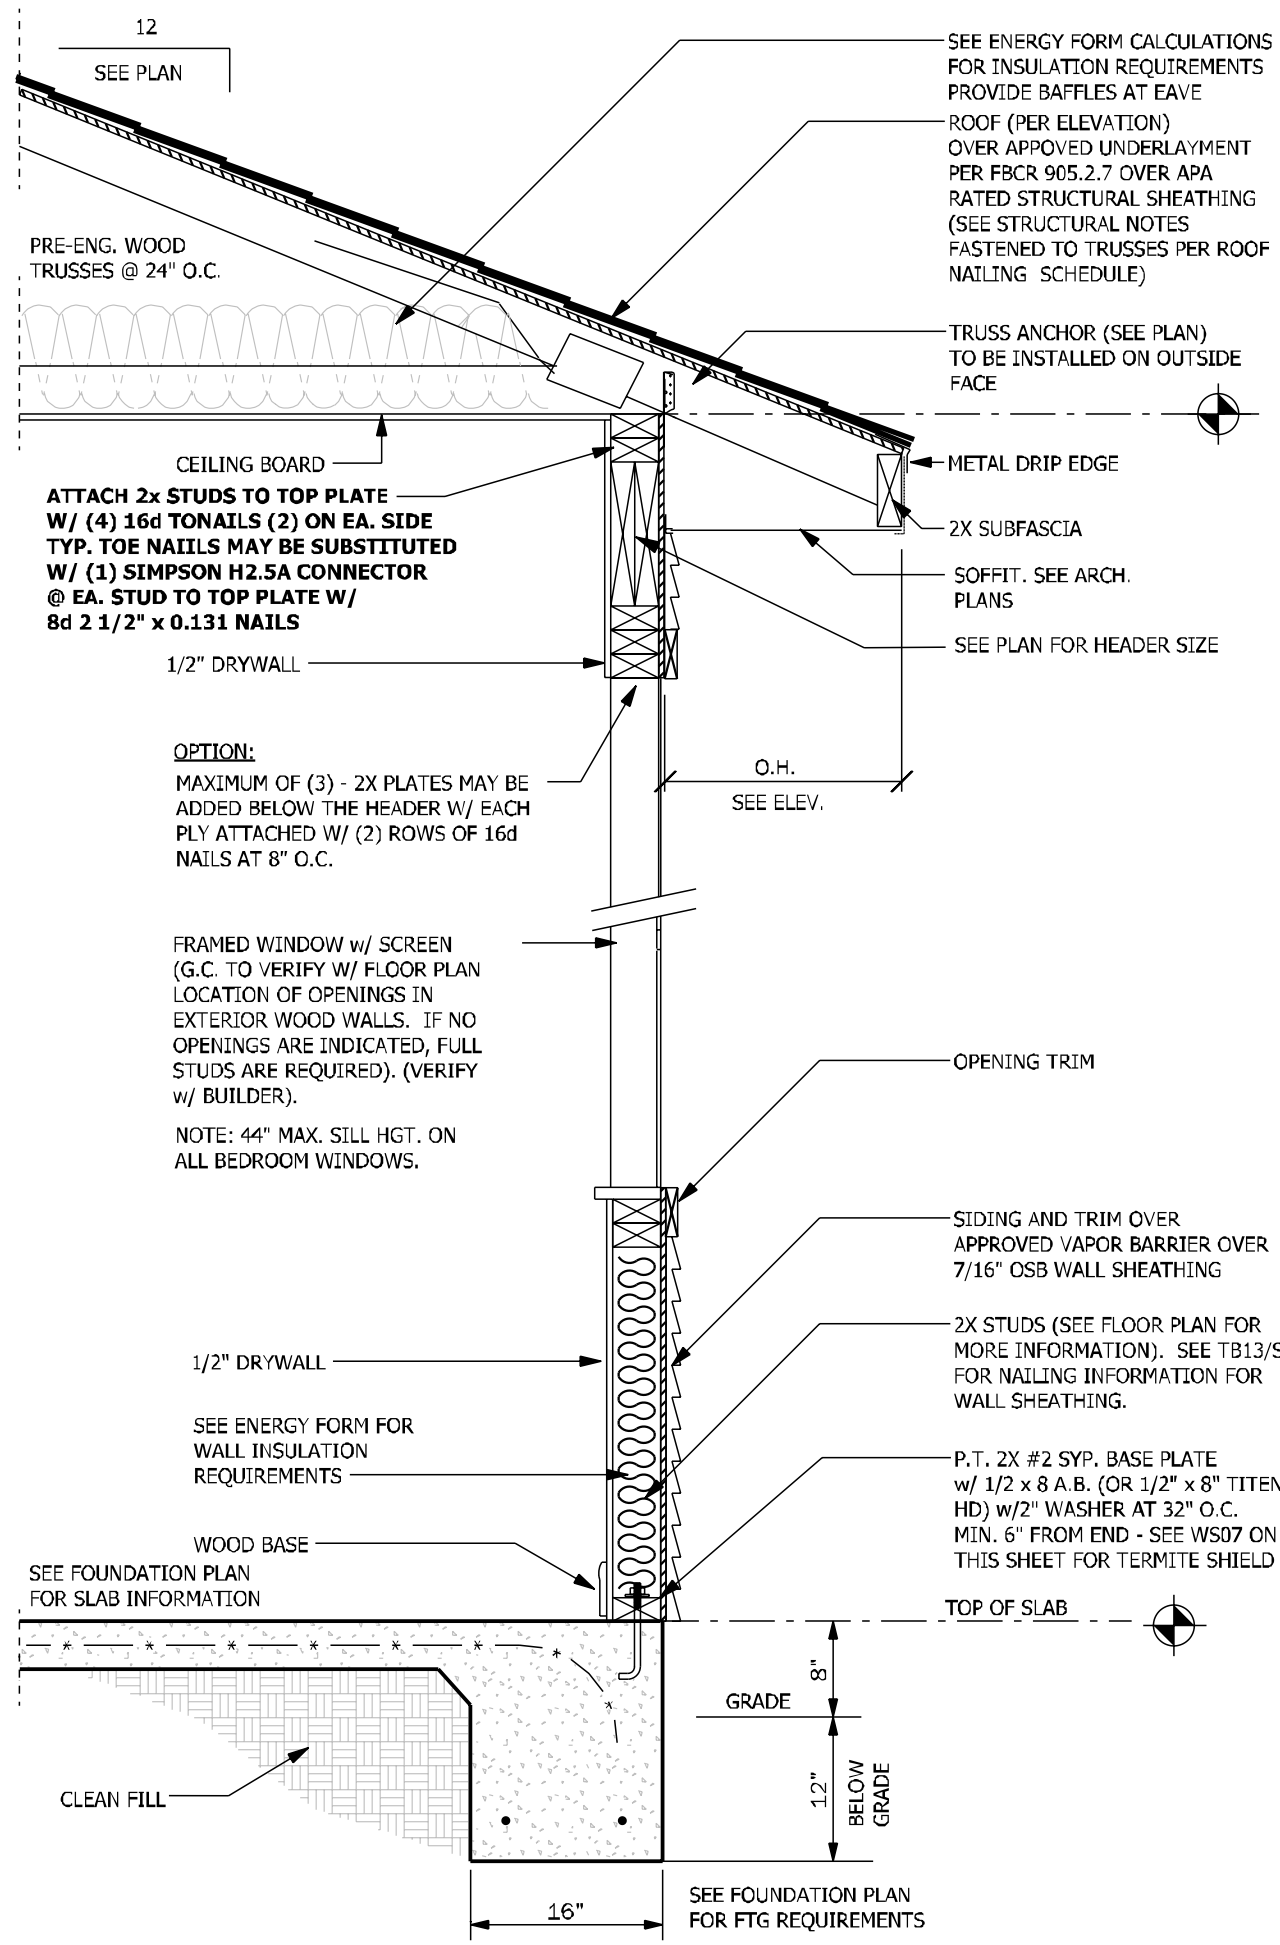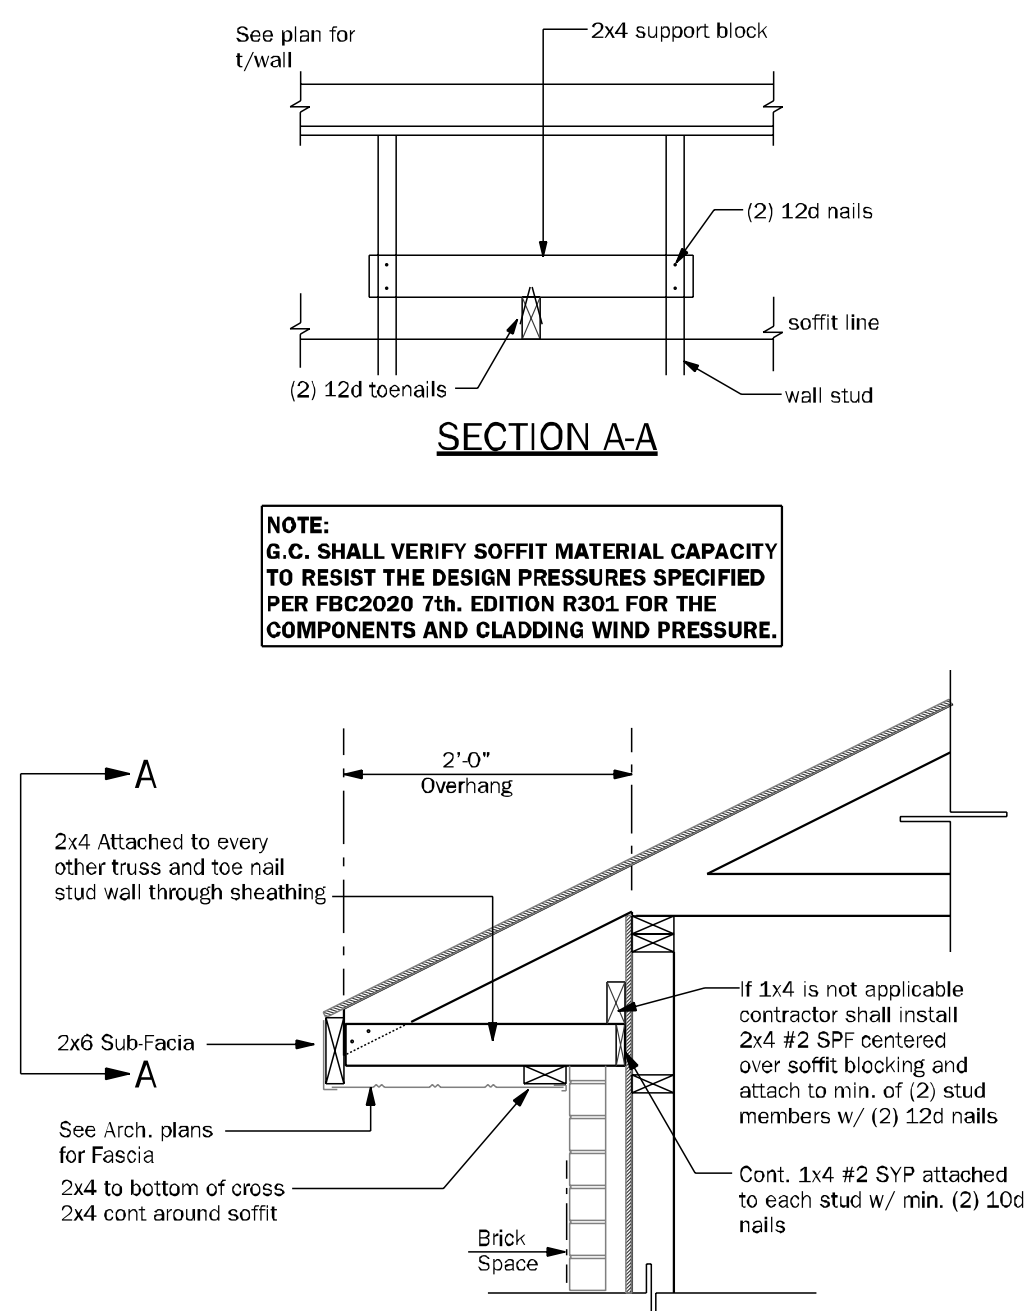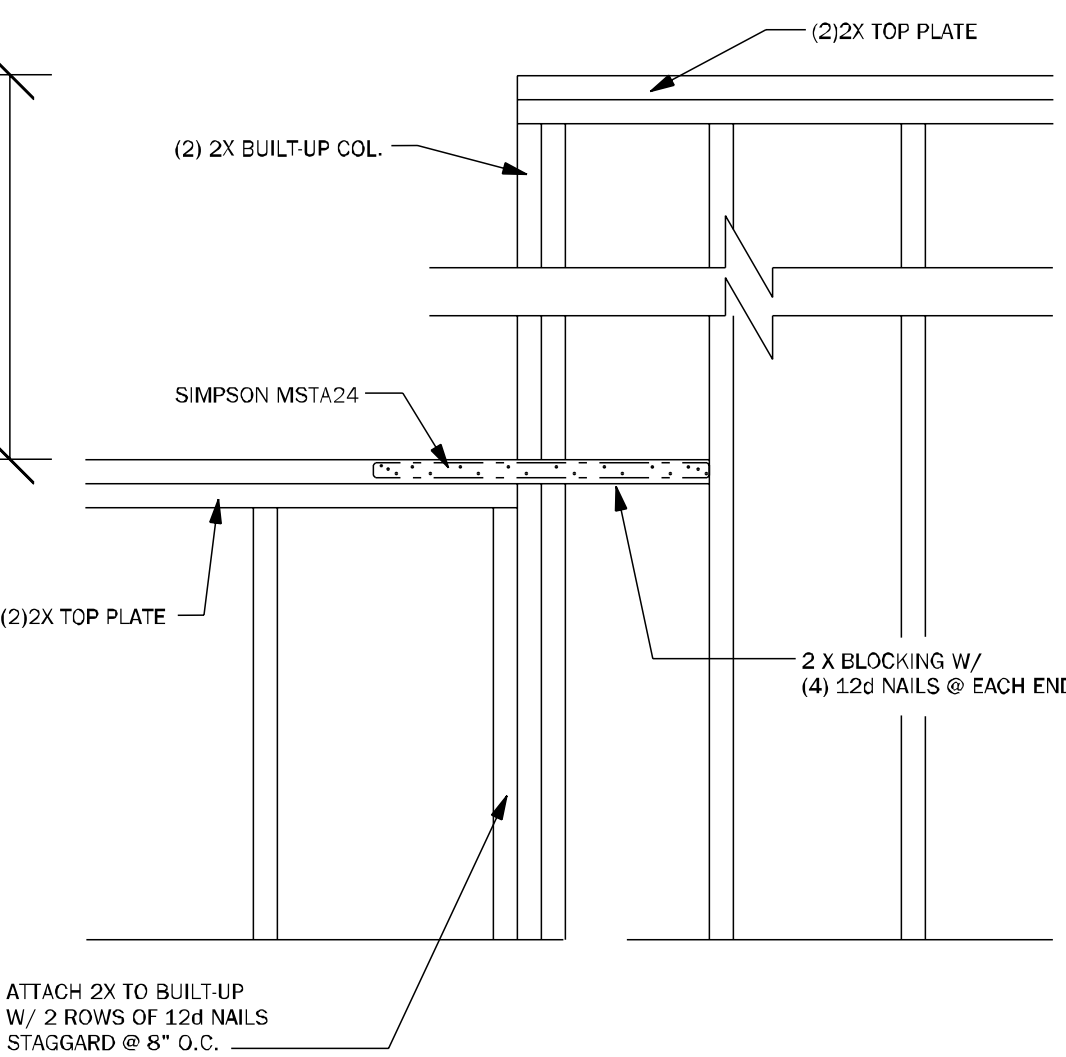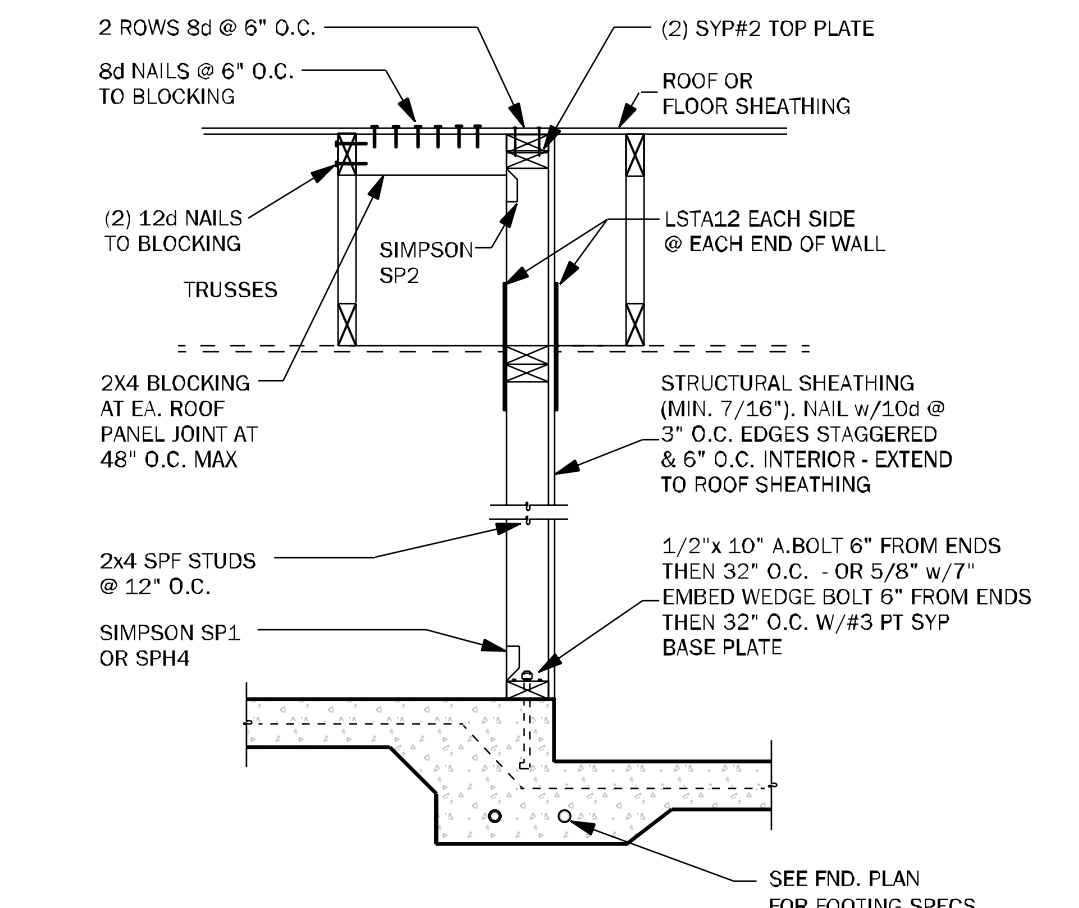**VERIFY BRICK
DIMENSION W/ BLDG.****BD07** BRICK SHELF DETAIL N.T.S.**CD24** POST & BEAM DETAIL 1/2" = 1'-0"**WF37** TYPICAL COLUMNS DETAILS N.T.S.**WF17** TOP PLATE SPLICE DETAIL 3/4" = 1'-0"**SW01** INTERIOR BEARING SHEARWALL w/UPLIFT N.T.S.**WC08** STEP UP @ CORNER & RAISED BEAM N.T.S.**WS02** TYPICAL WALL SECTION EXTERIOR FRAME 3/4" = 1'-0"**SE** TYPICAL SOFFIT AND EAVE DETAIL 3/4" = 1'-0"**WC07** STEP UP @ CORNER & RAISED BEAM 1/2" = 1'-0"**SW04** INTERIOR SHEARWALL @ TRUSSES 3/4" = 1'-0"

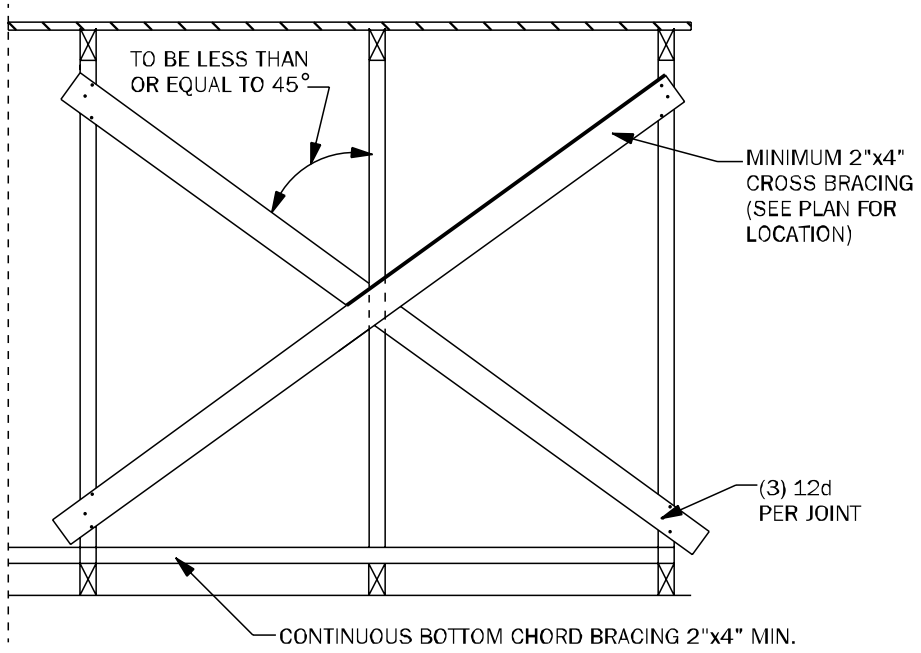


TB01 TYPICAL CROSS BRACING DETAIL N.T.S.

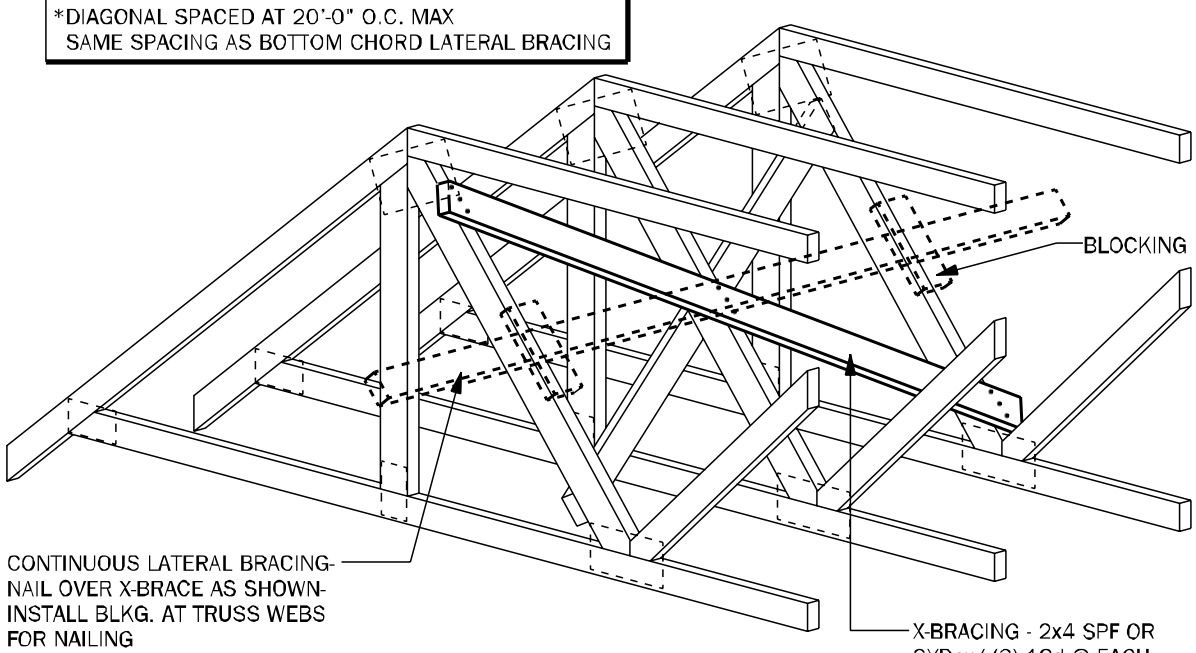


TB02 TYPICAL CROSS BRACING DETAIL N.T.S.

THE HEIGHT OF THE CHIMNEY SHOULD EXTEND 2' ABOVE THE POINT WHERE THE CHIMNEY IS 10' FROM THE NEAREST BUILDING SURFACE.

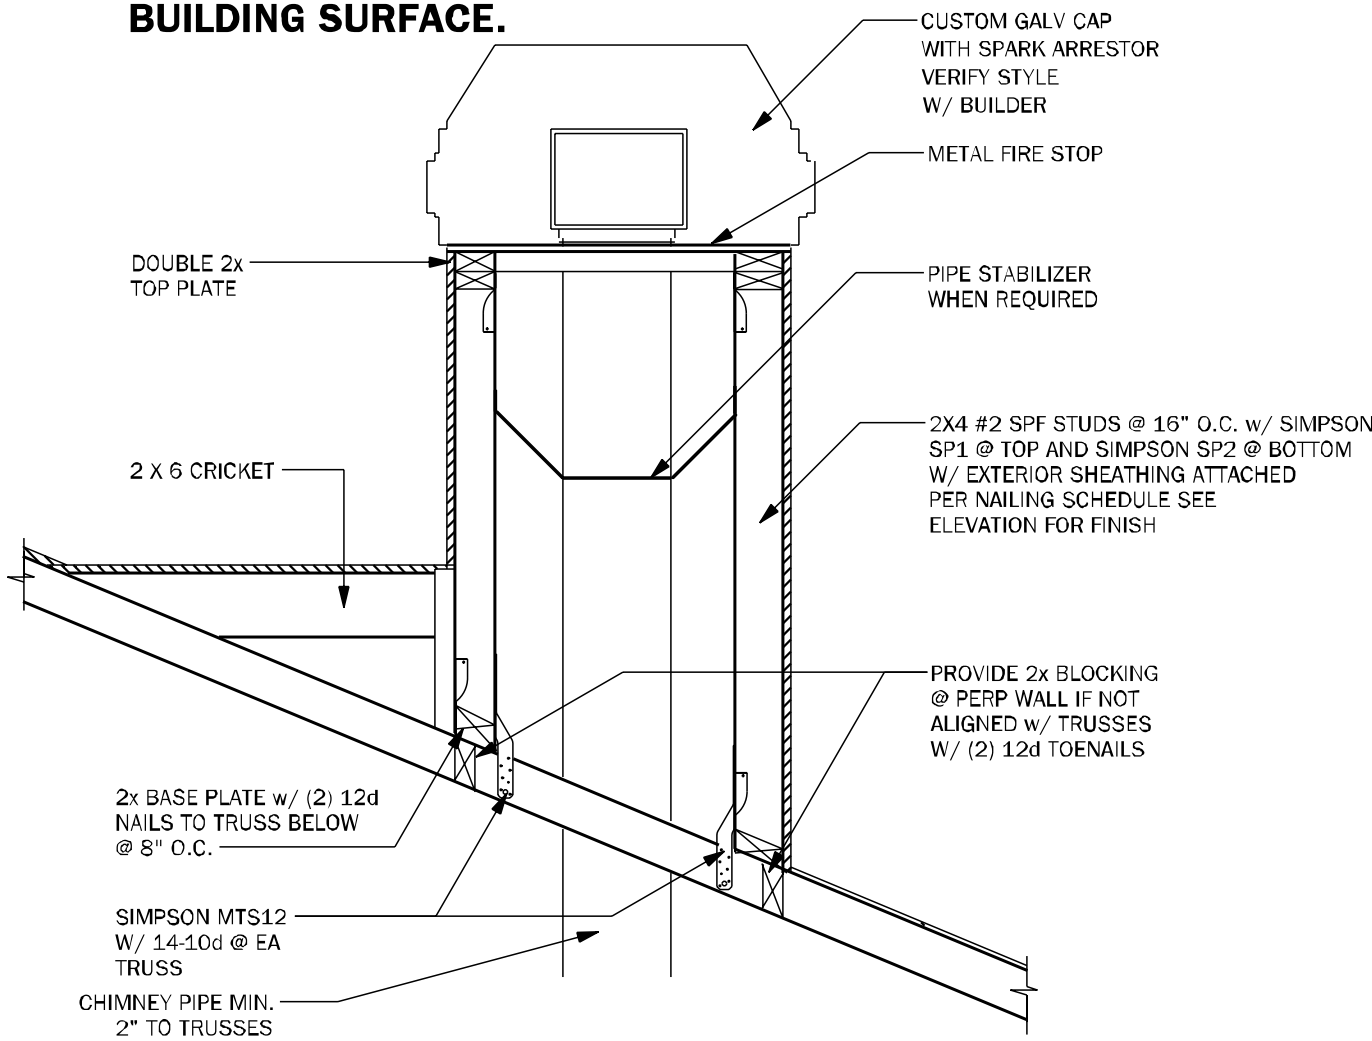


CH01 TYPICAL CHIMNEY FRAME DETAIL 3/4" = 1'-0"


RAFTER SIZE	
0'-8" SPAN -	2"x6" W/4-12d EACH END
8'-12" SPAN -	2"x8" W/4-12d EACH END
12'-15" SPAN -	2"x10" W/ SIMPSON A 34 @ EA. END
15'-18" SPAN -	2"x12" W/ SIMPSON A 34 @ EA. END

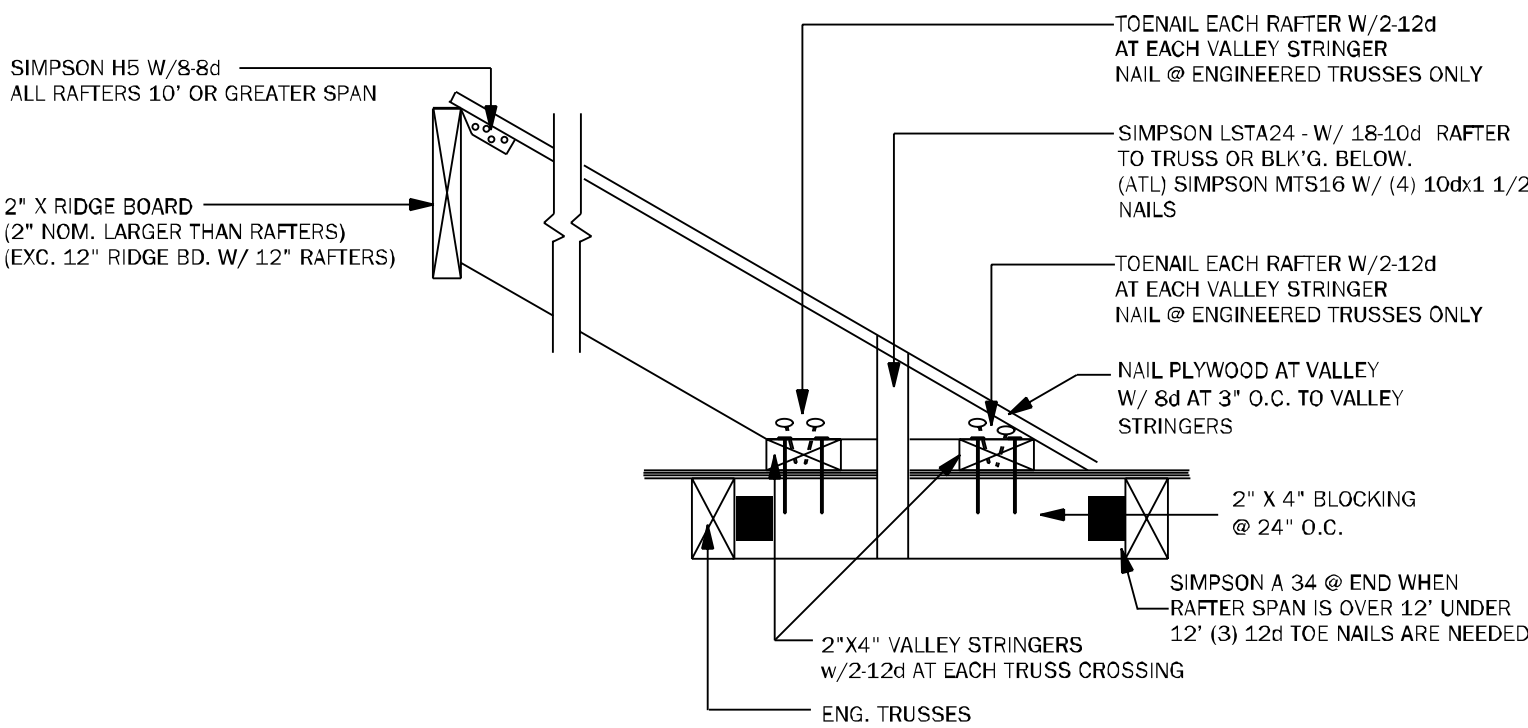


TB17 CONV. FRAMING & VALLEY FRAMING N.T.S.

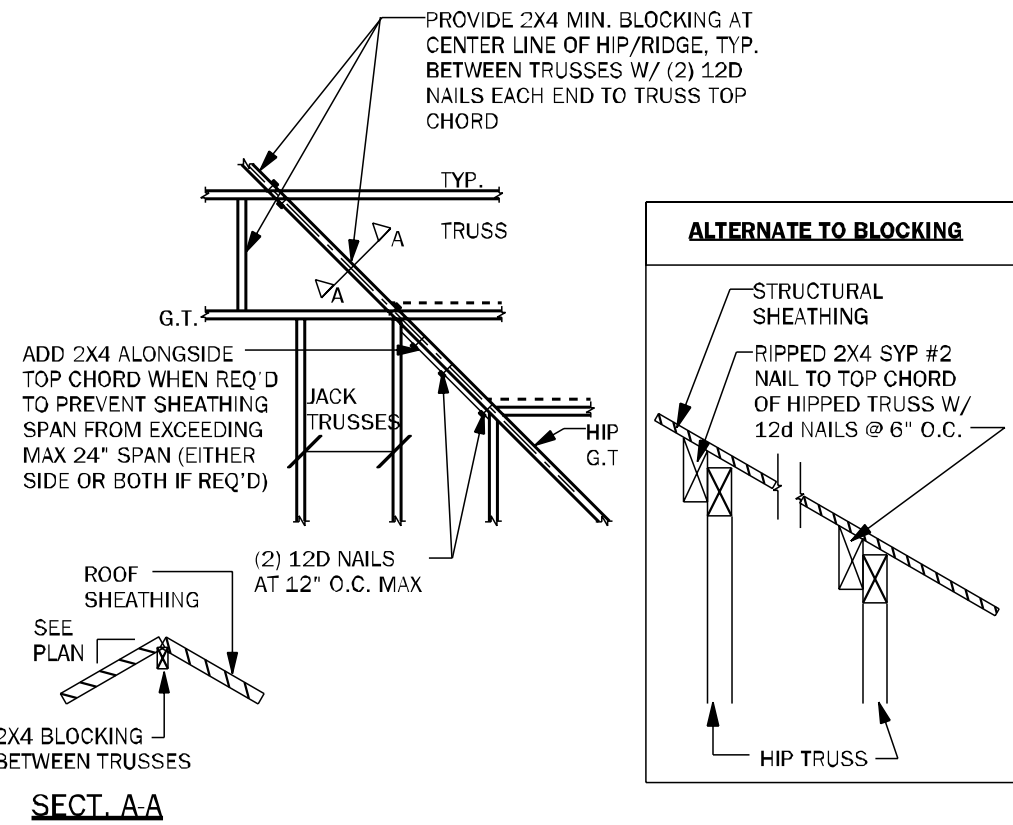


TB03 HIP / RIDGE BLOCKING DETAIL N.T.S.

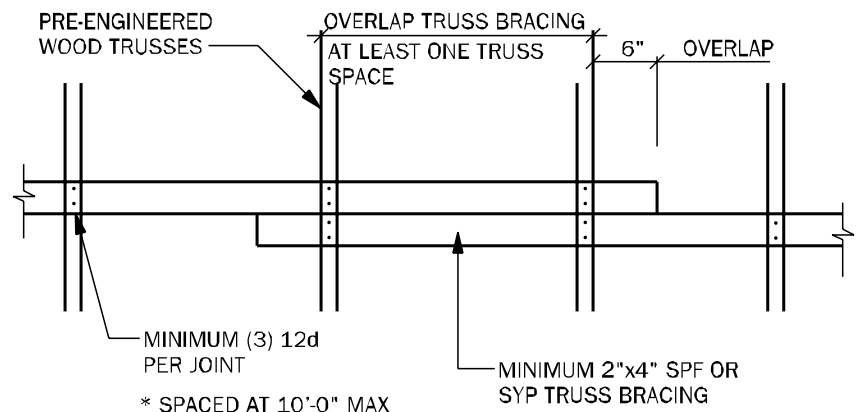

TB04 TRUSS BRACING OVERLAP DETAIL (TYP) N.T.S.

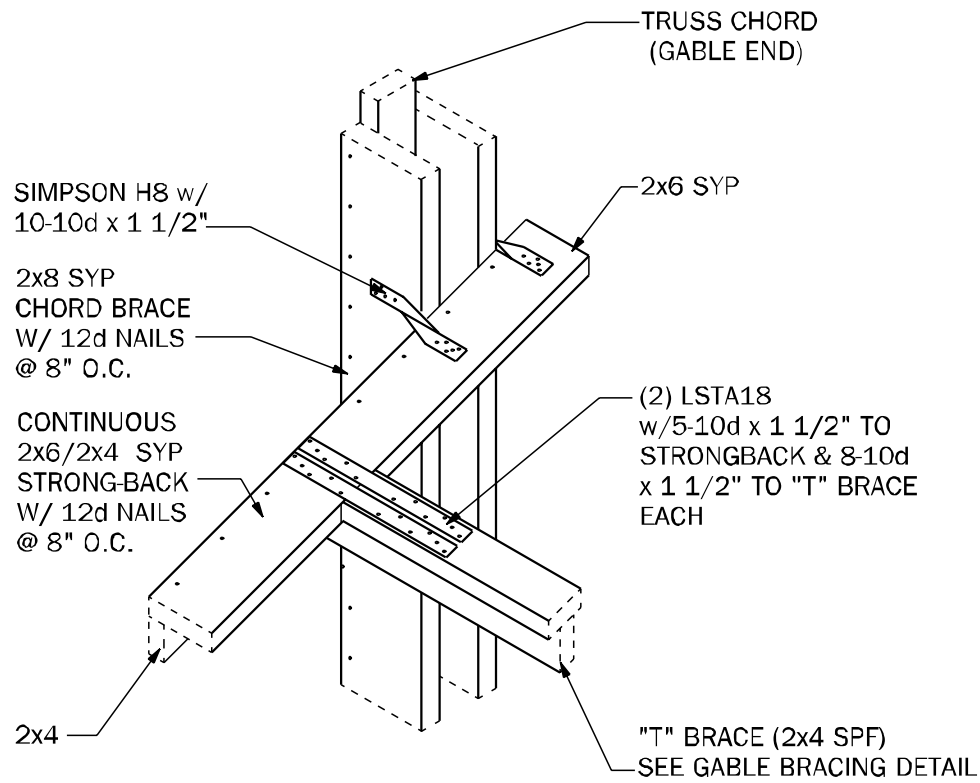




GE04 "T" BRACE CONNECTION @ GABLE END W/ VOLUME CEILING 3/4" = 1'-0"

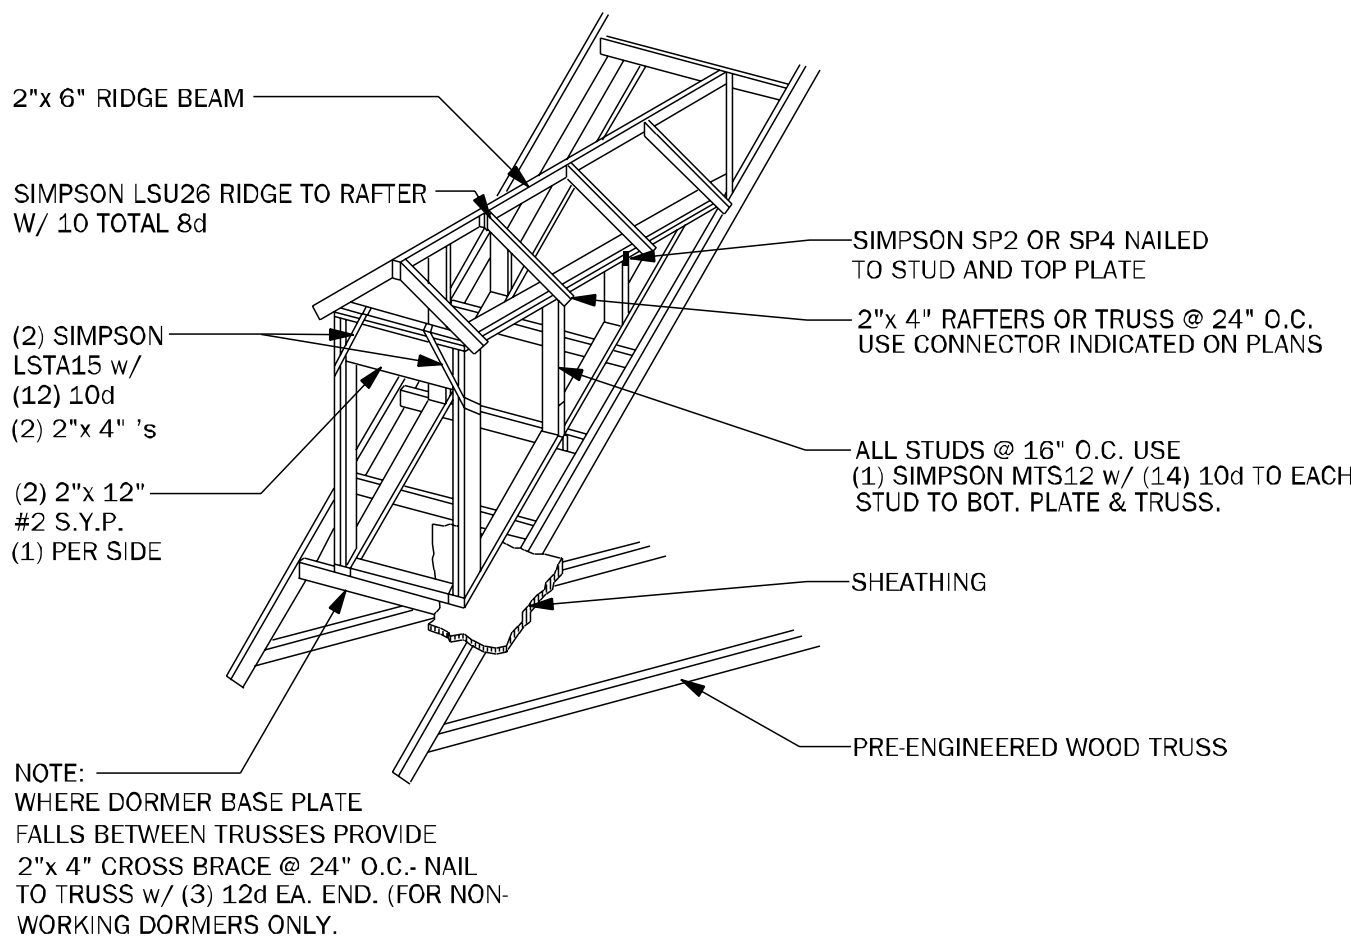

WF05 DORMER FRAMING DETAIL N.T.S.

TRUSS NOTES:

- WOOD TRUSS ERECTOR SHALL PROVIDE BRACING ACCORDING TO ANSI/TPI-2014 (TRUSS PLATE INSTITUTE) NOTE THAT THE COMBINED WIND AREA IS GREATER BEFORE THE ROOF SHEATHING IS APPLIED, AND BRACING SHALL THEREFORE BE INSTALLED AS THE TRUSSES ARE ERECTED. INADEQUATE BRACING IS THE MOST COMMON CAUSE OF ACCIDENT IN WOOD TRUSS CONSTRUCTION. FULL BUNDLES OF SHEATHING SHALL NOT BE PLACED ON TRUSSES. THIS CONSTRUCTION LOAD SHOULD BE LIMITED TO 8 SHEETS OF SHEATHING ON ANY PAIR OF TRUSSES & SHALL BE LOCATED ADJACENT TO THE SUPPORTS. NO EXCESS CONCENTRATION OF ANY CONSTRUCTION MATERIAL (SUCH AS GRAVEL OR SHINGLES) SHALL BE PLACED ON THE TRUSSES IN ANY ONE AREA THEY SHALL BE SPREAD OUT EVENLY OVER A LARGE AREA SO AS TO AVOID OVERLOADING ANY ONE TRUSS.
- ALL BRACING (DB, CB, SB) SHOWN ABOVE SHALL BE IN ADDITION TO CONTINUOUS LATERAL BRACING SPECIFIED BY THE TRUSS MANUFACTURER. ALL LATERAL BRACING SPECIFIED BY TRUSS MANUF. SHALL HAVE ADDITIONAL DIAGONAL BRACES AT 20'-0" O.C. MAXIMUM.
- ALL BRACES SHALL BE 2x4 NOMINAL DIMENSION LUMBER & SHALL BE ATTACHED W/ (3) 12d NAILS AT EACH TRUSS INTERSECTION.
- ADDITIONAL BOTTOM CHORD BRACING SHALL BE INSTALLED BY TRUSS DESIGN WHEREVER ADEQUATE STRUCTURAL CEILING ARE NOT ATTACHED DIRECTLY TO THE BOTTOM CHORD OF THE TRUSS.
- PROVIDE TRUSS BLOCKING AT ALL TRUSS BEARING SUPPORTS WHERE TRUSS DEPTH EXCEEDS STANDARD HEEL HEIGHT. SEE TYP. TRUSS BLOCKING DETAILS.

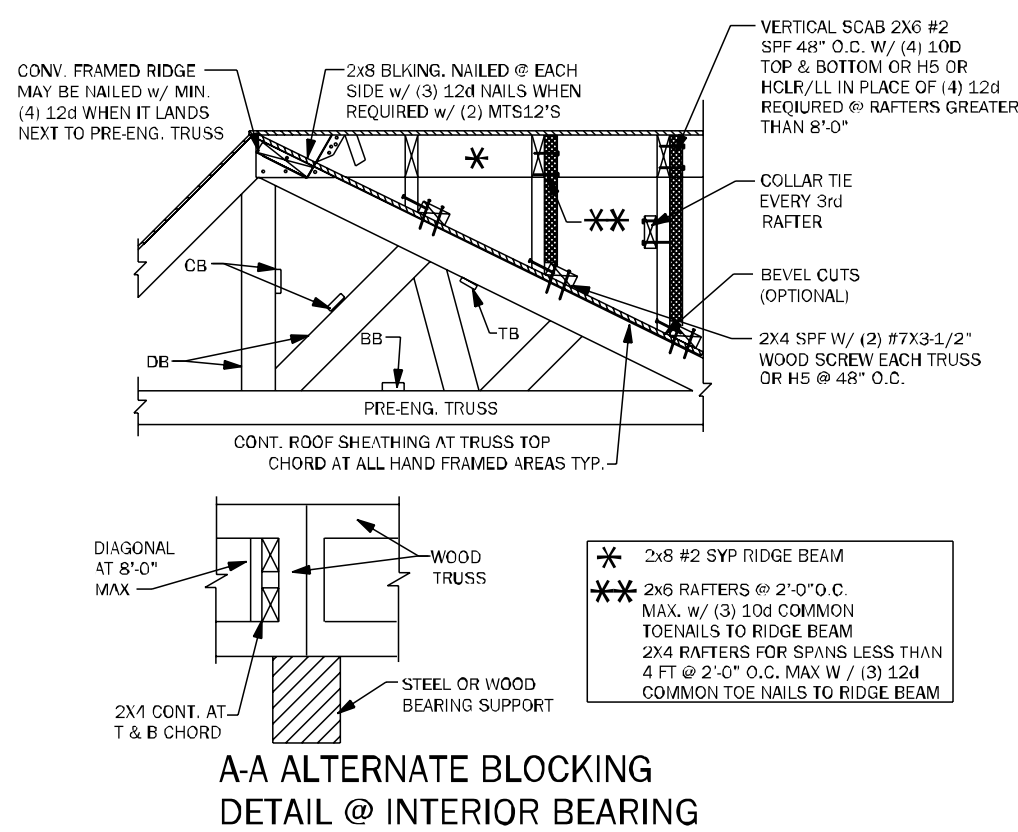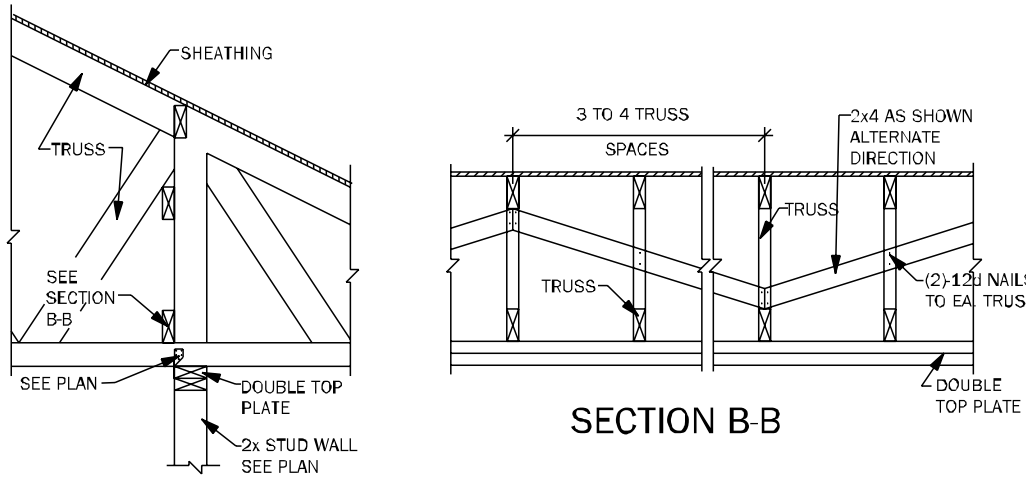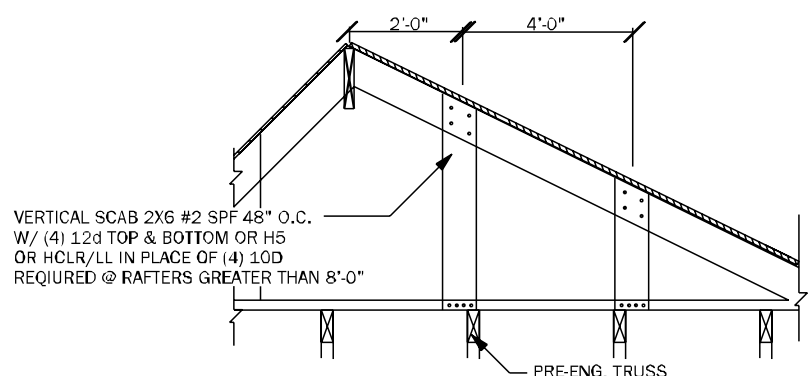

A-A ALTERNATE BLOCKING DETAIL @ INTERIOR BEARING

TB06 BLOCKING AND CONVENTIONAL FRAME DETAILS 3/4" = 1'-0"

COUNTY SEAL

Wednesday, December 11, 2024

To the best of the Engineer's knowledge, information, and belief, the structure shown herein complies with the applicable provisions of the building code and the minimum engineering practice requirements and is not intended to be used for any other purpose.

FDS
ENGINEERING ASSOCIATES
2850 Gulf Breeze Parkway, Suite 200
Gulf Breeze, FL 32561
P: 904.331.1234
F: 904.331.1235
E: info@fdseng.com
C: 904.331.1234
Certificate of Authorization No. 9304

☐ CARL A. BROWN, P.E. FL # 56126
☐ SCOTT A. LEWOWSKI, PE FL # 78750
☐ THEN BAO DUONG, PE FL # 91452

keesee
associates
ARCHITECTURE | DESIGN | PLANNING
2500 Gulf Breeze Parkway, Suite 200
Gulf Breeze, FL 32561
P: 904.331.1234
F: 904.331.1235
E: info@kdseng.com

A20003115
ABD

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330146
**100 WEST GARDEN STREET
PENSACOLA FL 32502**
DIVISION LOCATION:
GAINESVILLE

INVENTORY

LOT: 94
BLK:
SEC:
SUB: PRESERVE AT LAUREL LAKE
747 SW ROSEMARY DR.
LAKE CITY, FL


Model Name / Number:
1755

Plan Issue Date:
Wednesday, December 11, 2024


KA PROJECT NUMBER:
24-13141

Sheet: **S-4** Of:


**ROOF FRAMING
AND BRACING DETAILS**

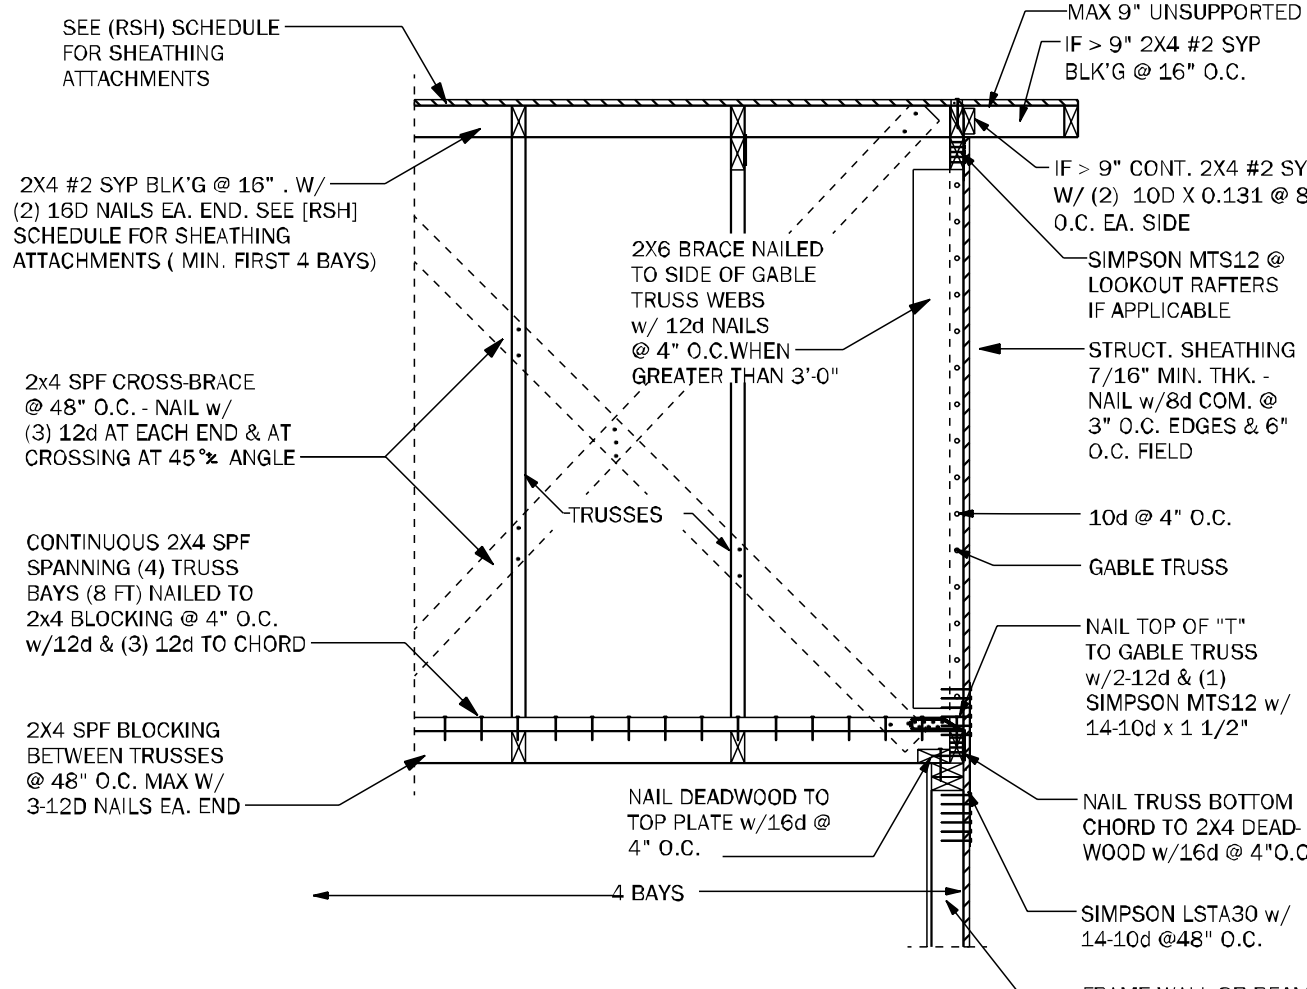


GE05 GABLE END BRACING - FRAME WALL N.T.S.

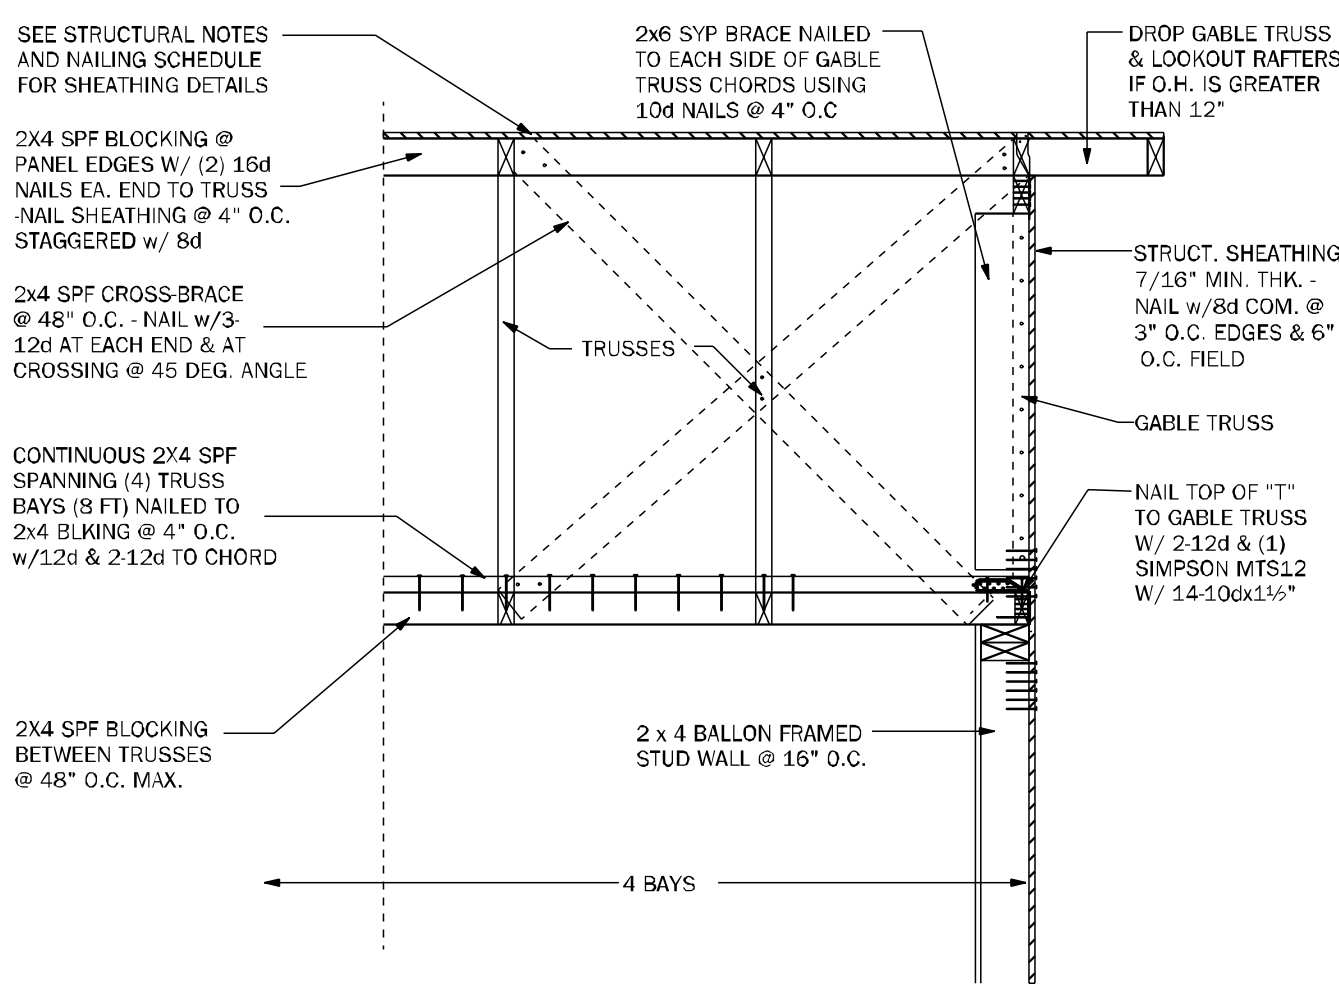


GE22 GABLE END BRACING w/ VOL CEILING 1/2"=1'-0"

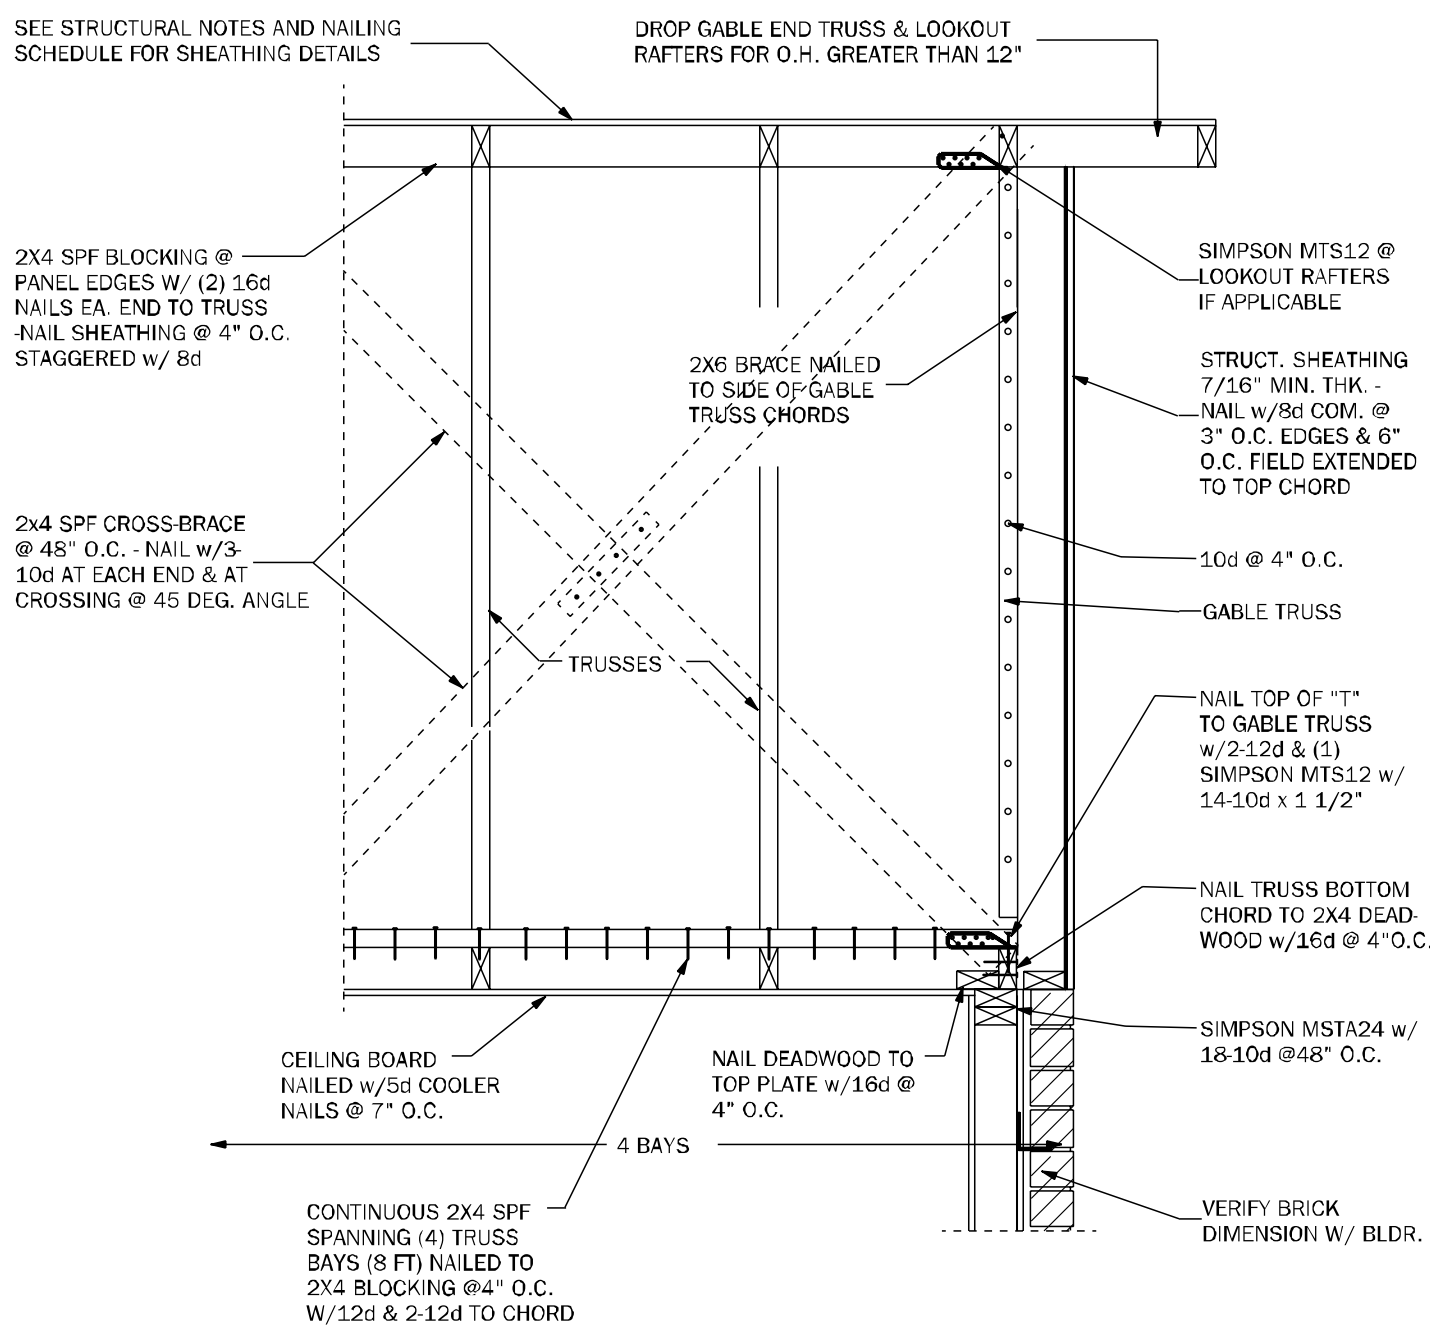


GE23 GABLE END BRACING w/o VOLUME CEILING 1/2"=1'-0"

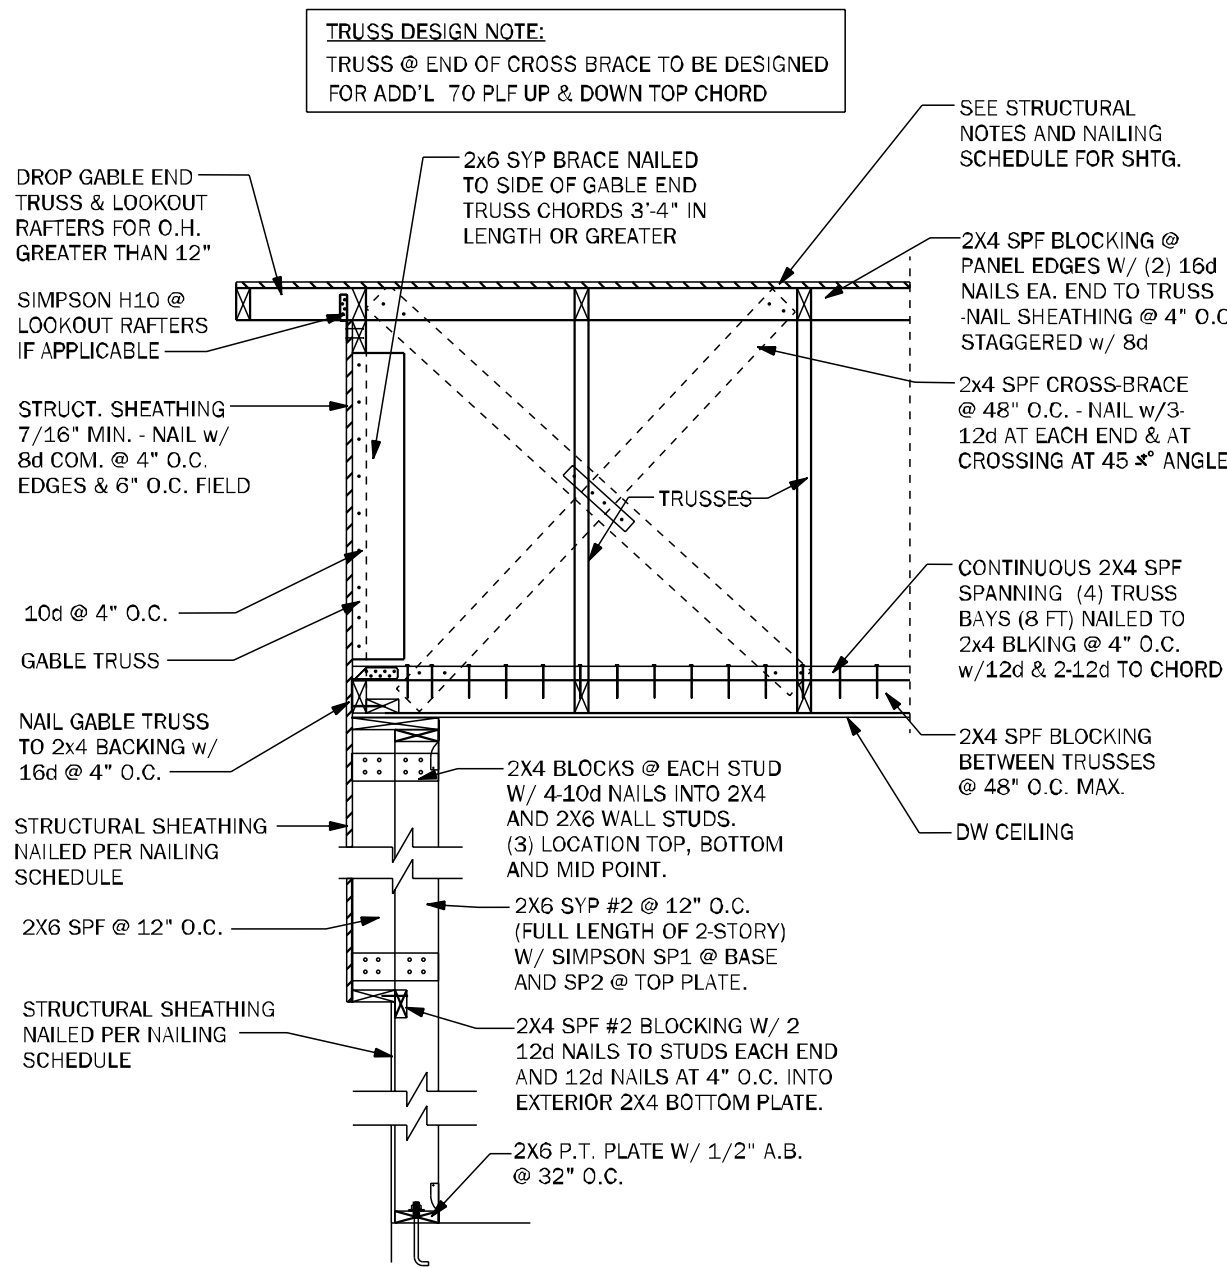


GE24 GABLE @ VAULT N.T.S.

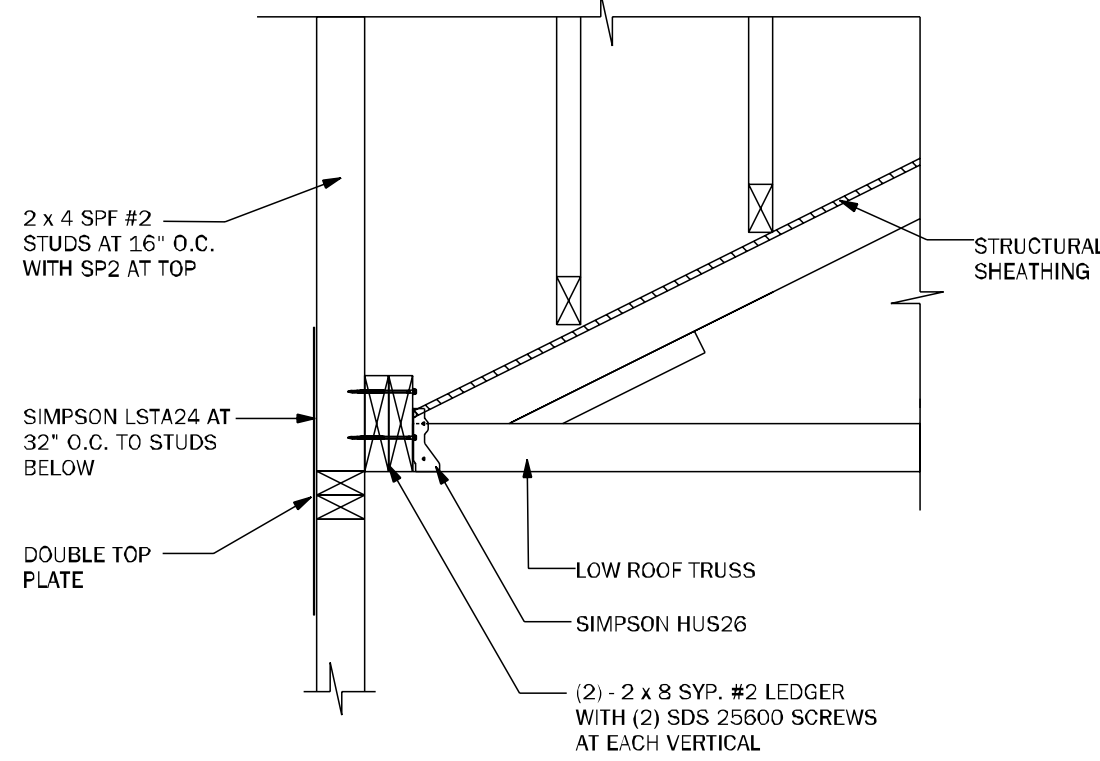


WF72 LEDGER N.T.S.

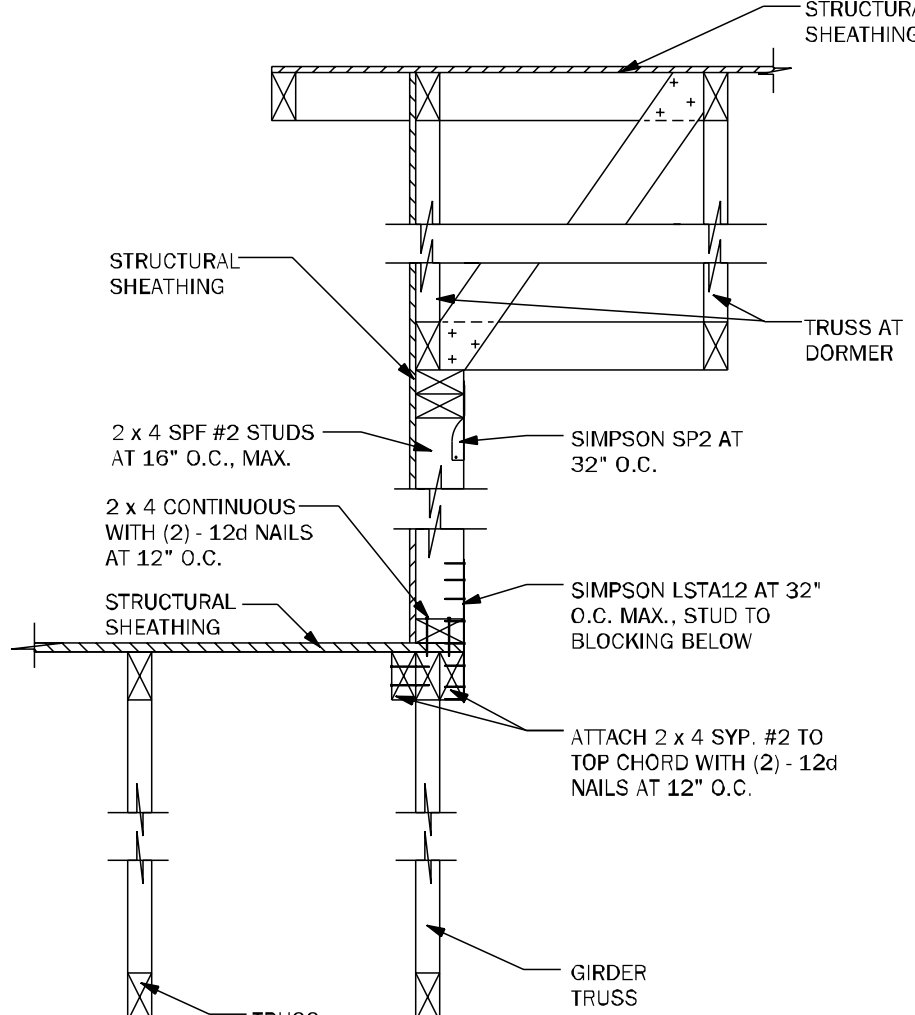


WF73 KNEEWALL @ DORMER N.T.S.

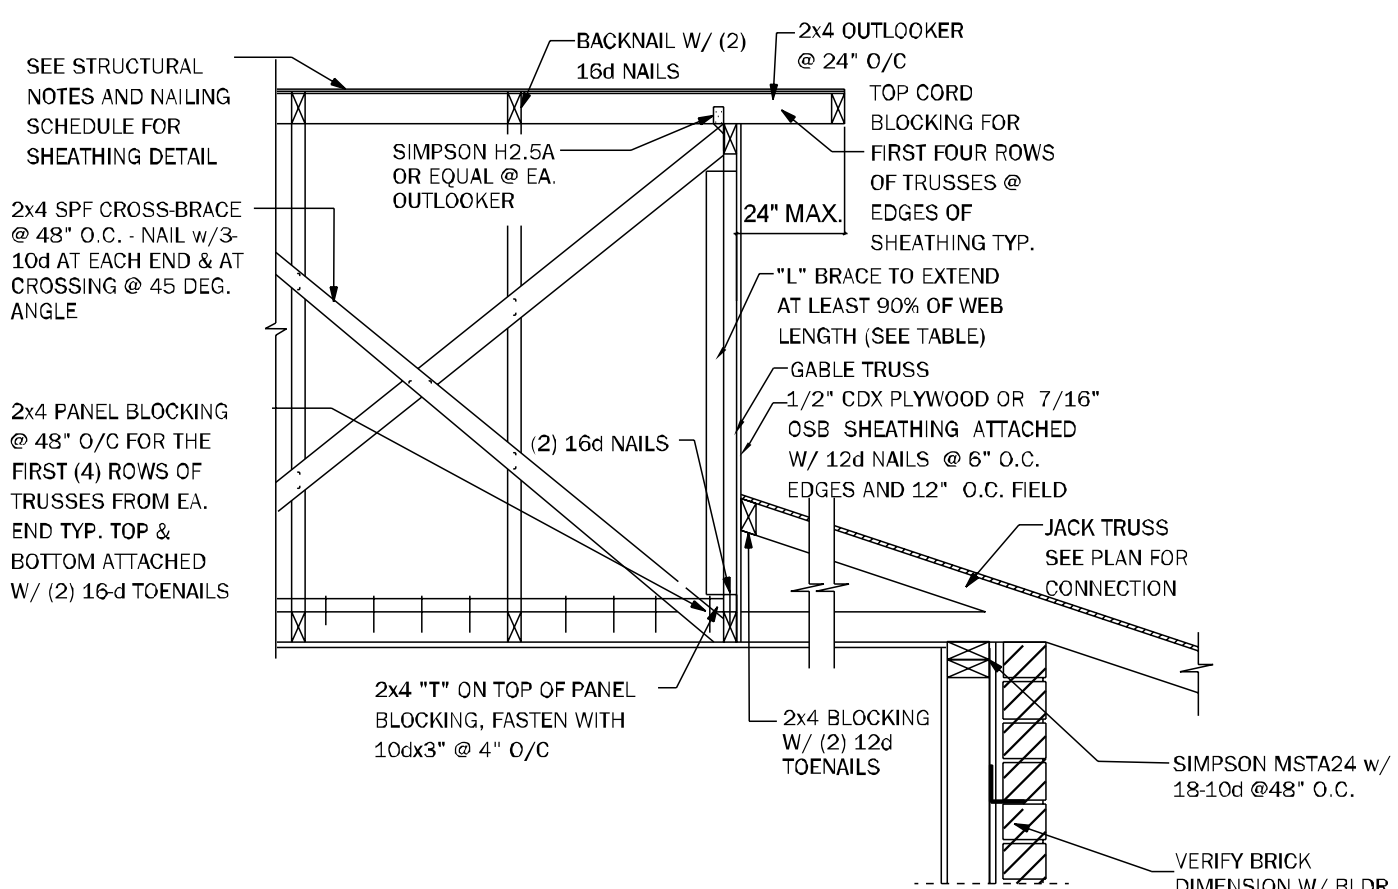



GE21 SECTION @ DUTCH GABLE 3/4"=1'-0"

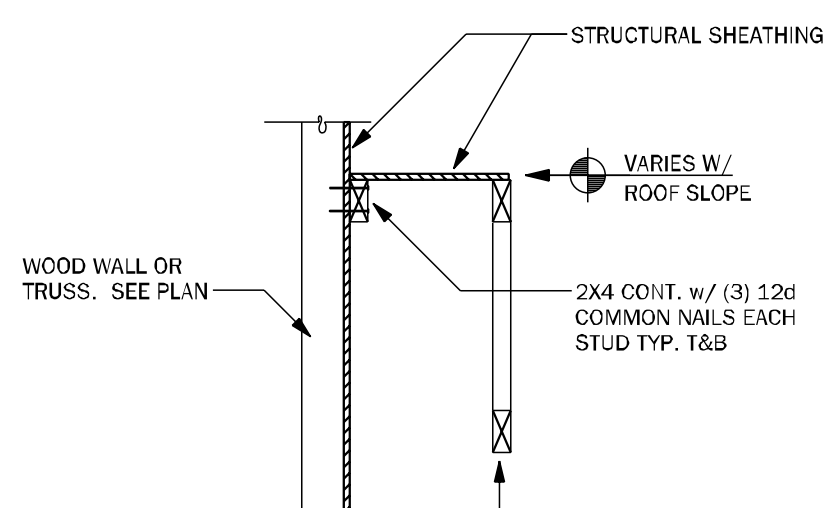

LD02 SHEAR TRANSFER EXTERIOR WALL N.T.S.

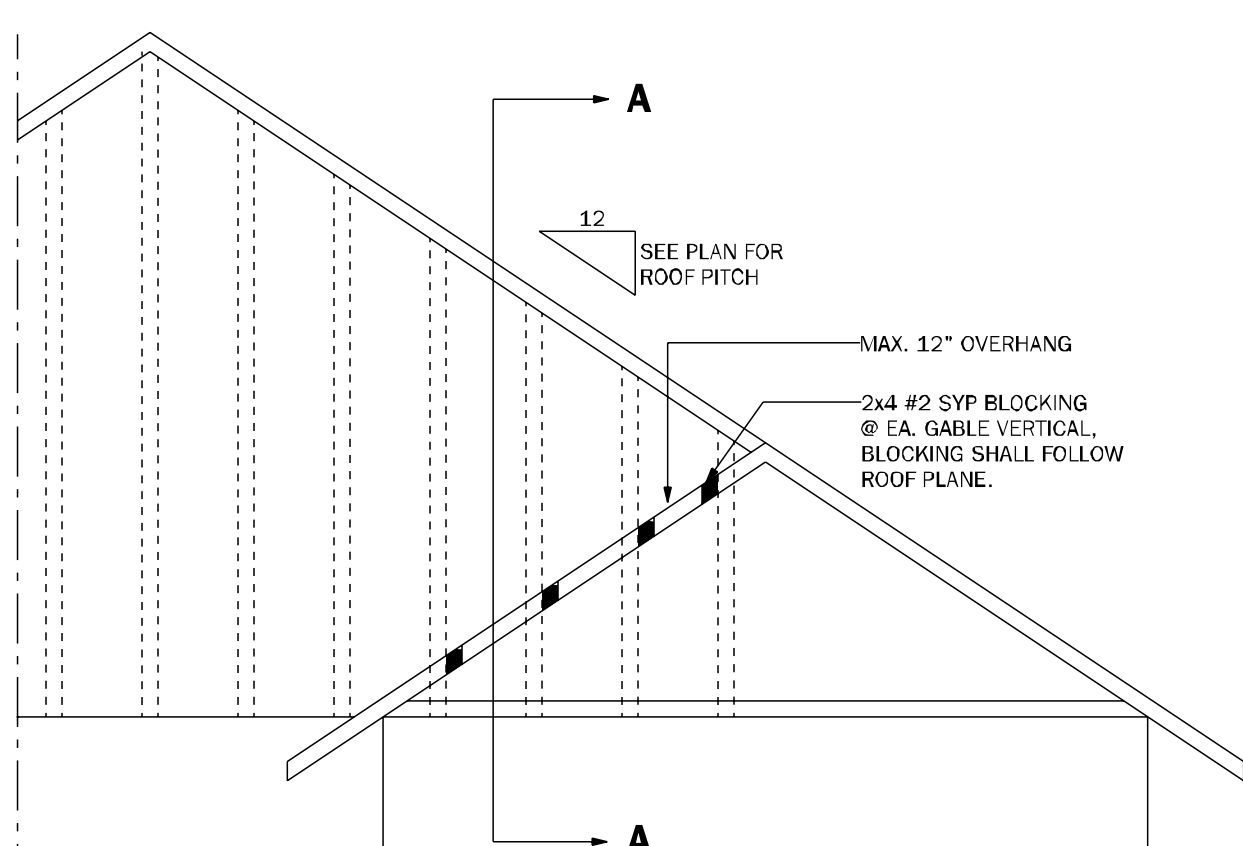

GE23.1 GABLE END OVERHANG 1/2"=1'-0"

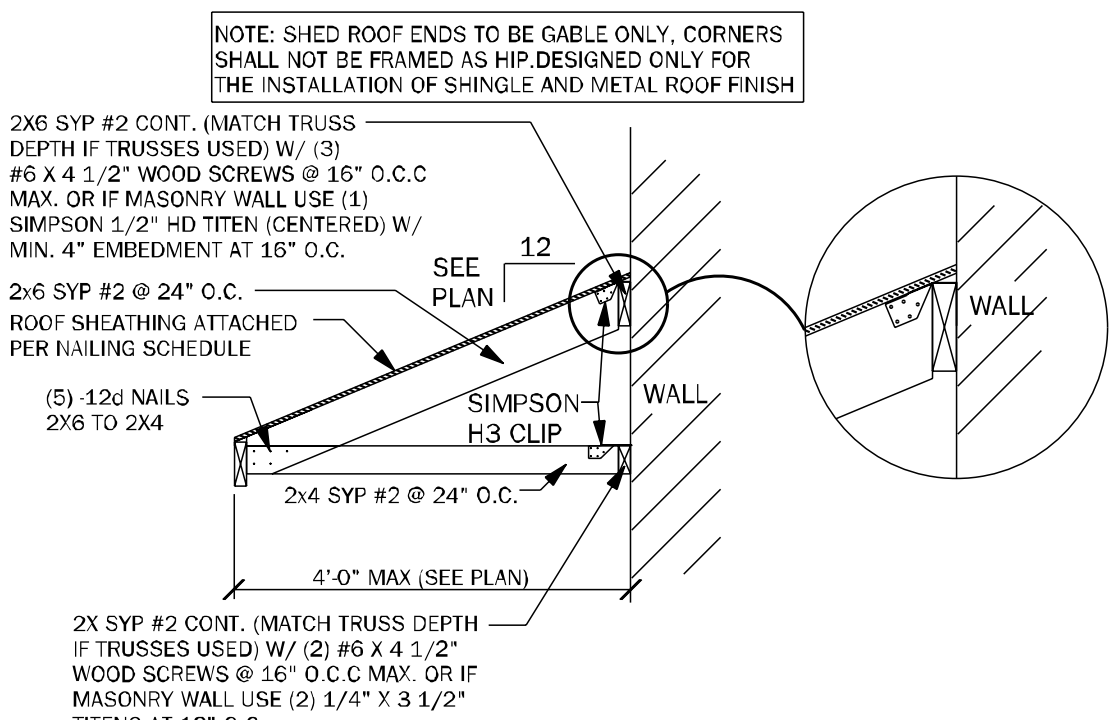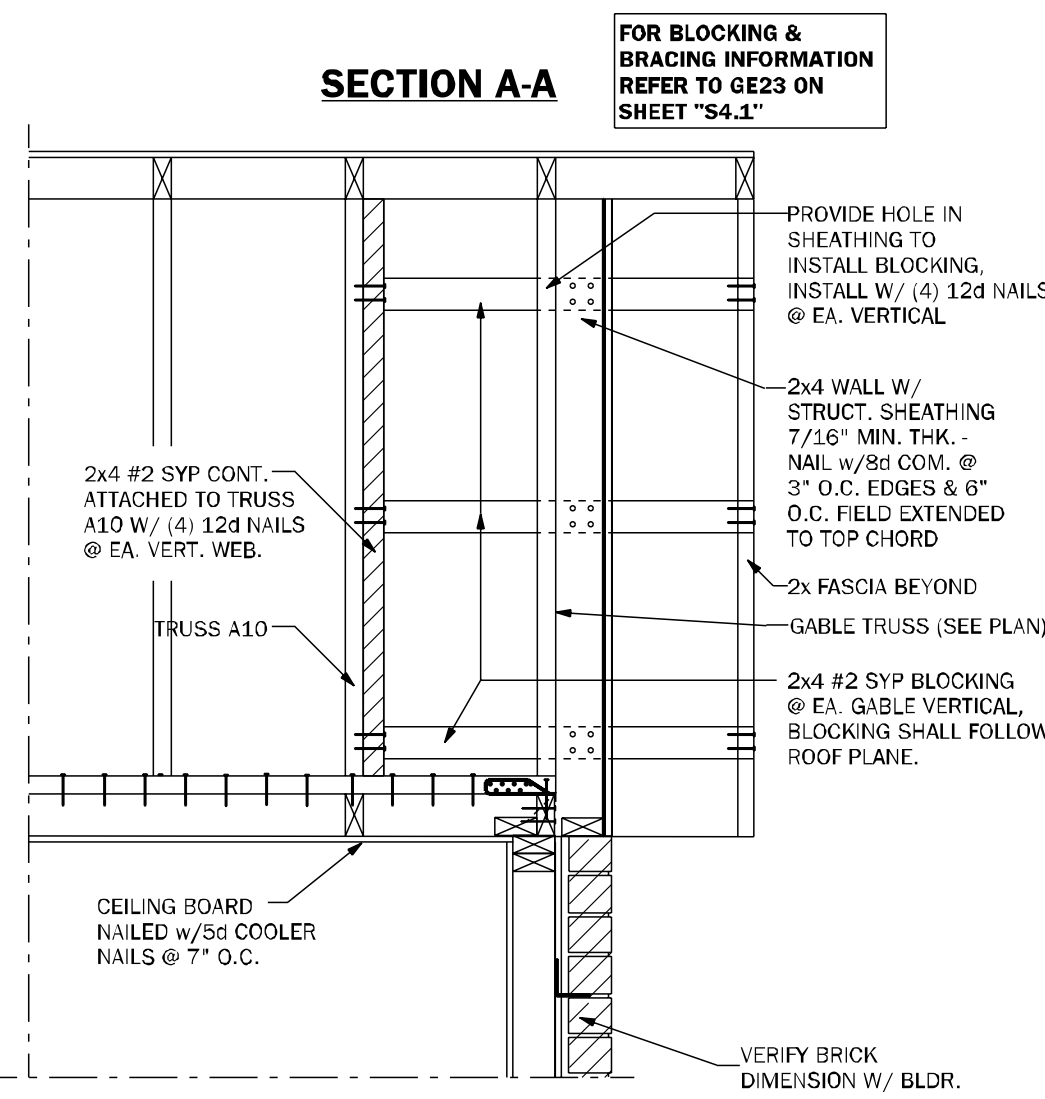

SR01 SECTION AT SHED ROOF 3/4"=1'-0"

COUNTY
SEAL

Wednesday, December 11, 2024

To the best of the Engineer's knowledge, information, and belief, the design complies with all applicable codes, regulations, and standards, and the Engineer is not providing any warranty or guarantee of performance or results. The Engineer's responsibility is limited to the design and construction of the project as shown on the drawings and as approved by the local authority having jurisdiction.

FDS ENGINEERING ASSOCIATES
285 South Lake Avenue, Suite 200
Ocala, Florida 32765
Tel: 352.237.1233
Fax: 352.237.1234
www.fdseng.com

keesee associates
ARCHITECTURE | DESIGN | PLANNING
285 South Lake Avenue, Suite 200
Ocala, Florida 32765
Tel: 352.237.1233
Fax: 352.237.1234
mydesign.com

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330148
100 WEST GARDEN STREET
PENSACOLA FL 32502

DIVISION LOCATION:
GAINESVILLE

Job Information:

Model Name / Number:
1755


Plan Issue Date:
Wednesday, December 11, 2024

KA PROJECT NUMBER:
24-13141

Sheet:
S-4.1


Of:
1

ROOF FRAMING AND BRACING DETAILS

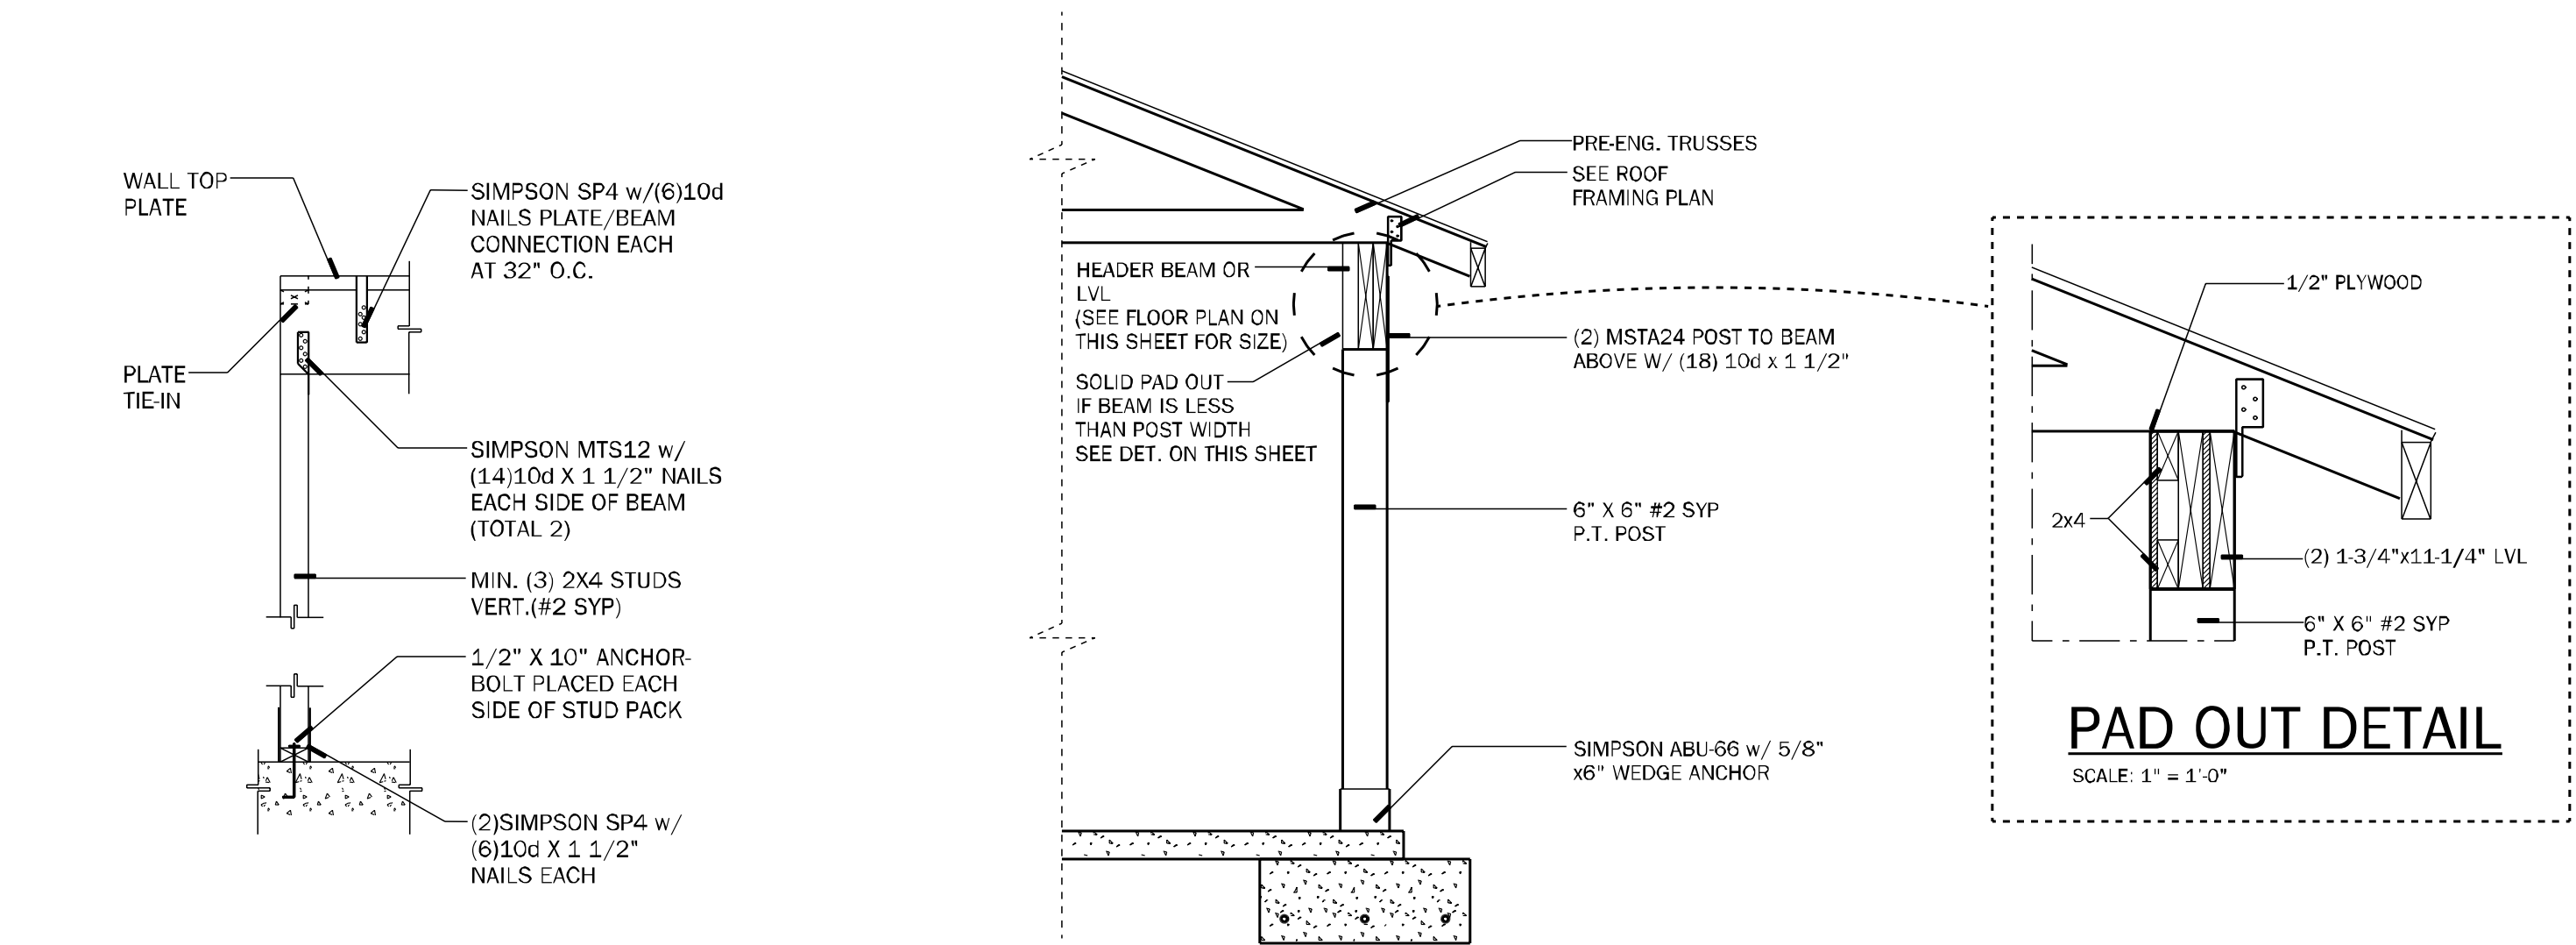


7 BEAM/WALL CONNECTION
SCALE: N.T.S.


POST SECTION
SCALE: 1/2" = 1'-0"

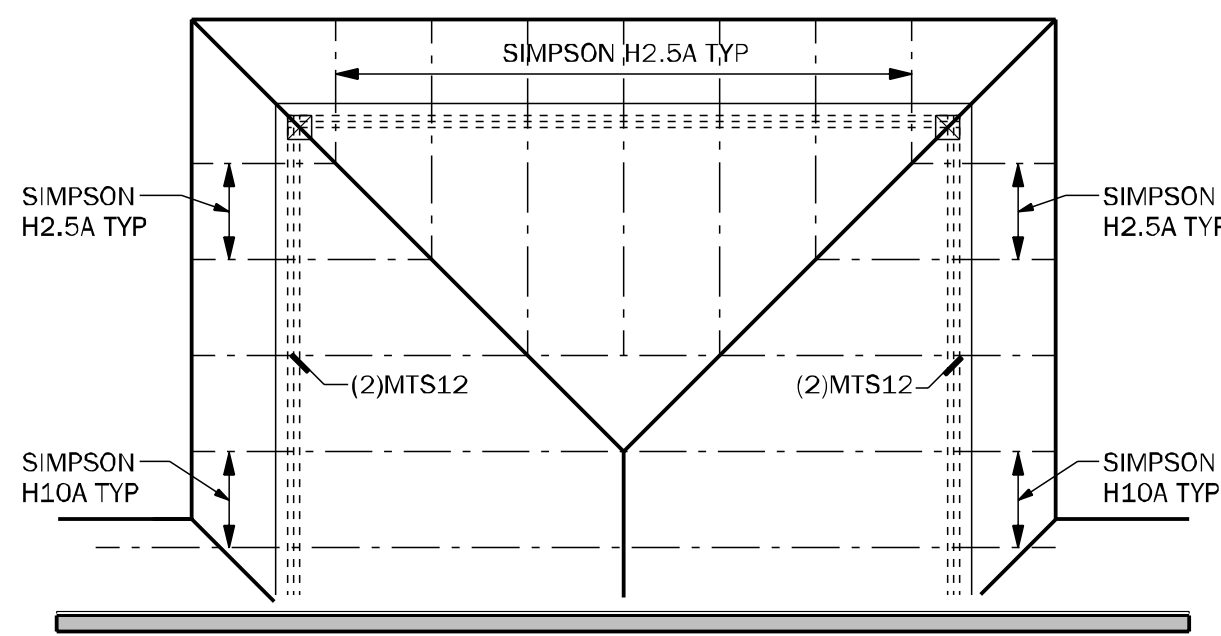

ROOF PLAN
SCALE: 1/4" = 1'-0"

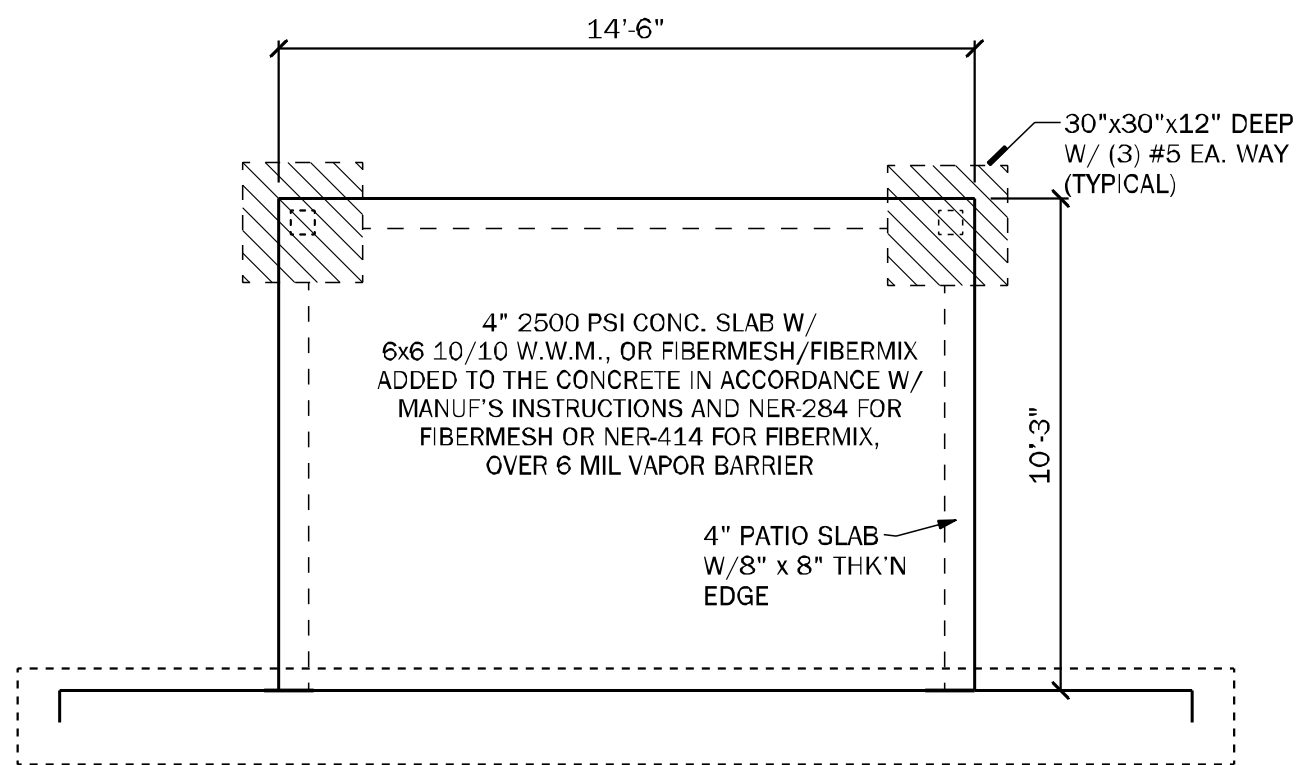


FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

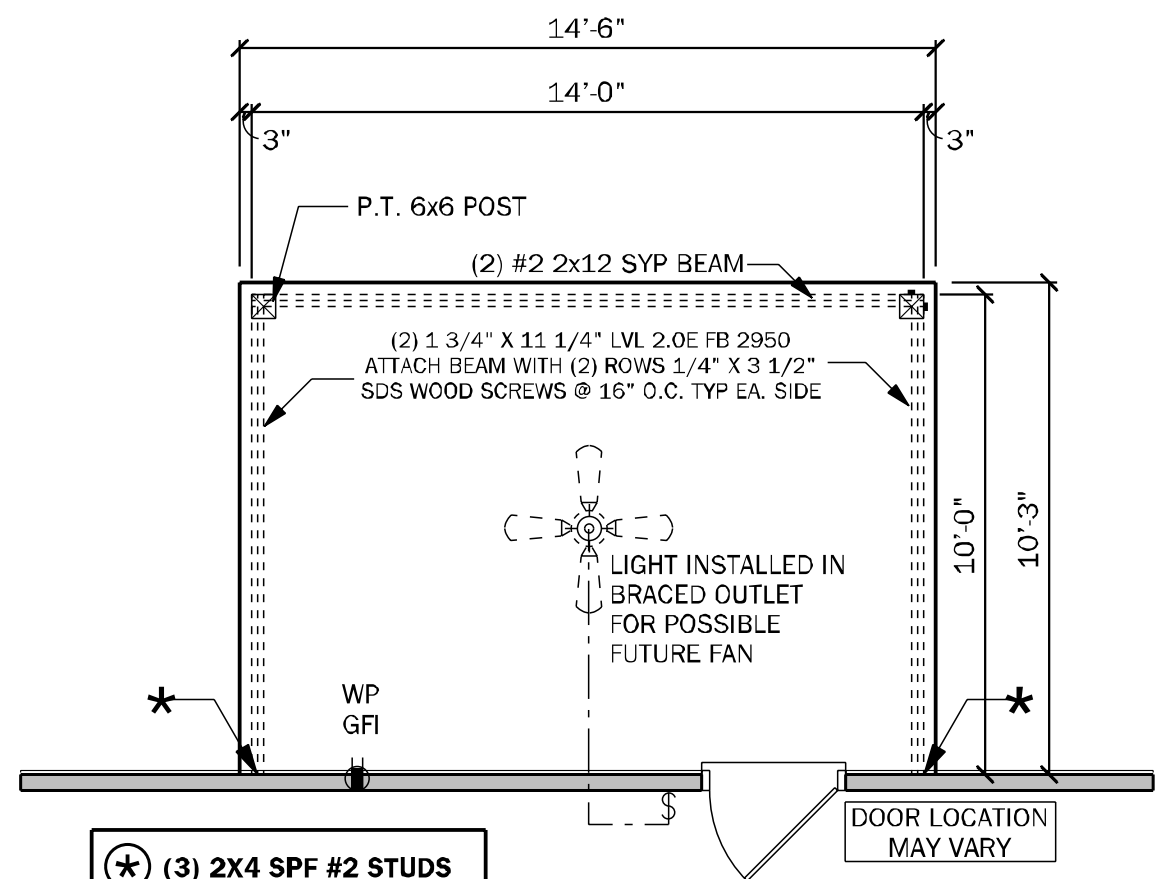

(*) (3) 2X4 SPF #2 STUDS IN WALLS. PROVIDE 7/P-1 FOR CONNECTIONS

FLOOR PLAN
SCALE: 1/4" = 1'-0"

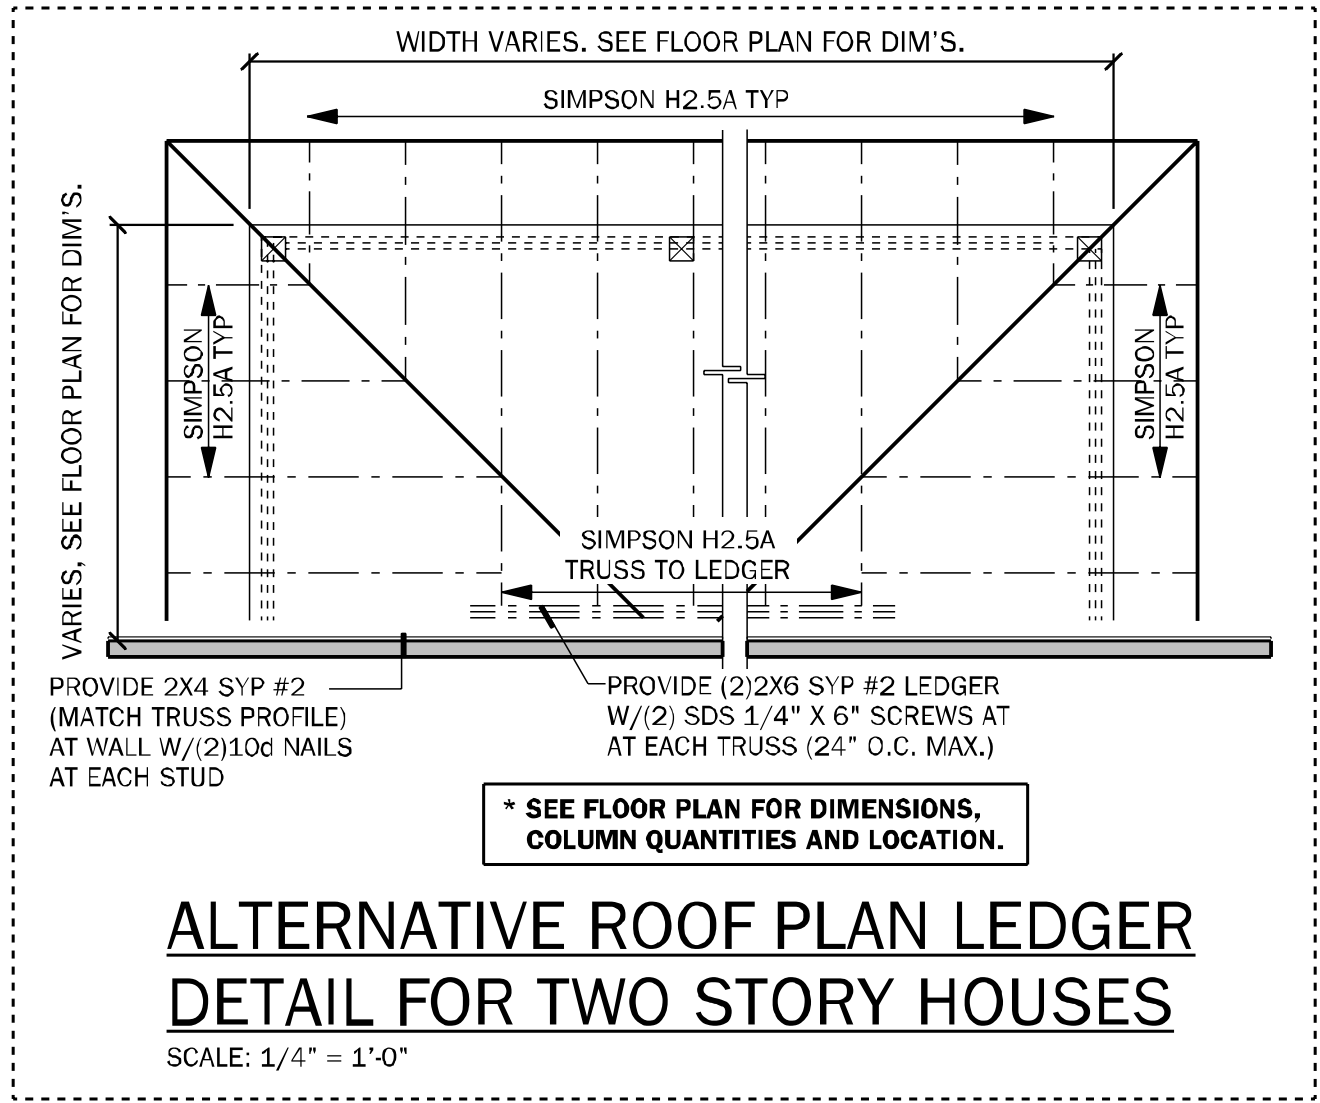

ALTERNATIVE ROOF PLAN LEDGER
DETAIL FOR TWO STORY HOUSES
SCALE: 1/4" = 1'-0"

keese
associates | DESIGN | PLANNING
ARCHITECTURE
295 South 4th Ave., Tallahassee, FL 32301
2027 880 2133
mydesignhome.com

AA2003115
F
B
I
D

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502

DIVISION LOCATION:
GAINESVILLE

Job Information:

INVENTORY
LOT: 94
BLK:
SEC:
SUB: PRESERVE AT LAUREL LAKE
747 SW ROSEMARY DR.
LAKE CITY, FL

Model Name / Number:
1755

Plan Issue Date:
Wednesday, December 11, 2024

KA PROJECT NUMBER:
24-13141

Sheet: P1 Of:

14x10 PORCH

FDS
ENGINEERS ASSOCIATES
255 South 1st Lane, Suite 200
Tallahassee, Florida 32301
904 295 2904
Certificate of Authorization No. 3431
CARL A. BROWN, P.E. FL # 56126
SCOTT A. LEWIKOWSKI, PE FL # 78750
THEN BAO DUONG, PE FL # 94452

Wednesday, December 11, 2024