

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and approval numbers on the building components listed below if they will be utilized on the construction project for which you are applying for a building permit. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. Statewide approved products are listed online @ www.floridabuilding.org

Category/Subcategory	Manufacturer	Product Description	Approval Number(s)
1. EXTERIOR DOORS			
A. SWINGING	JELD WEN	steel door, wood edge glazed	14111.1
B. SLIDING			
C. SECTIONAL/ROLL UP			
D. OTHER			
2. WINDOWS			
A. SINGLE/DOUBLE HUNG			
B. HORIZONTAL SLIDER			
C. CASEMENT			
D. FIXED			
E. MULLION			
F. SKYLIGHTS			
G. OTHER			
3. PANEL WALL			
A. SIDING			
B. SOFFITS			
C. STOREFRONTS			
D. GLASS BLOCK			
E. OTHER			
4. ROOFING PRODUCTS			
A. ASPHALT SHINGLES			
B. NON-STRUCT METAL			
C. ROOFING TILES			
D. SINGLE PLY ROOF			
E. OTHER			
5. STRUCT COMPONENTS			
A. WOOD CONNECTORS			
B. WOOD ANCHORS			
C. TRUSS PLATES			
D. INSULATION FORMS			
E. LINTELS			
F. OTHERS			
6. NEW EXTERIOR ENVELOPE PRODUCTS			

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufacturers installation requirements.
 Further, I understand these products may have to be removed if approval cannot be demonstrated during inspection.




NOTES: _____



1. THE PRODUCT SHOWN HEREIN IS DESIGNED TO COMPLY WITH THE CURRENT IRC AND FLORIDA BUILDING CODE (FBC) BASED ON THE SIGNED AND SEALED DATE AND HAS BEEN EVALUATED IN ACCORDANCE WITH ASTM E331-00 AND ASTM E330-02.
2. 2X AND 1X WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE I, PAGE 1.
5. FLORIDA APPROVED IMPACT RESISTANCE SHUTTERS ARE REQUIRED FOR DOORS AND SIDELITES.
6. SCALE BASED ON 11x17 SHEET SIZE.
7. ALL 1X & 2X TO BE 0.55 SPECIFIC GRAVITY OR GREATER.
8. CONCRETE TO SHALL HAVE A MINIMUM $f_c=3000\text{psi}$ AND MASONRY SHALL CONFORM TO ASTM C-90.

FRAME CONSTRUCTION: THE JAMBS & HEAD ARE CONSTRUCTED OF WOOD. THE SILL IS COMPRISED OF COMPOSITE MATERIAL WITH ALUMINUM CLADDING AND A SNAP FIT PLASTIC ADJUSTABLE HEIGHT THRESHOLD AND VINYL SIDELITE SILL SEAT. ALL CORNERS ARE COPED, BUTTED, & SEALED USING SILICONE OR PAINTABLE POLYURETHANE. THE HEAD & SIDE JAMBS ARE FASTENED USING FOUR 16 GA. 7/16" X 2" STAPLES PER CORNER. THE SILL & SIDE JAMBS ARE FASTENED USING THREE 16 GA. 7/16" X 2" STAPLES AND 2- #8 X 2 1/2 FH PH WOOD SCREWS PER CORNER . THE VERTICAL SOLID MULLION IS FASTENED THROUGH THE HEAD & SILL USING THREE #8X2-1/2" PH HEAD SCREWS PER END. AT THE SILL, FOR INSWING PRODUCTS, A 5/8" HOLE IS DRILLED IN THE PVC RISER AND FILLED WITH DOW 1199 SILICONE. A RETAINING PLUG IS INSTALLED TO RECEIVE THE ASTRAGAL BOLT. ON OUTSWING PRODUCTS, A 3/8" HOLE IS DRILLED AT THE CENTER OF THE FRAME SILL AND A METAL STRIKE PLATE IS FASTENED USING TWO #8 X 3" SCREWS TO RECEIVE THE BOTTOM ASTRAGAL BOLT. AT THE HEAD ON BOTH INSWING AND OUTSWING PRODUCTS, A 7/16" X 3/8" SLOT IS BORED AT THE CENTER OF THE FRAME HEAD AND A METAL STRIKE PLATE IS FASTENED USING TWO #8 X 3" SCREWS TO RECEIVE THE TOP ASTRAGAL BOLT. ALL MULLION JOINERY AND THE FIXED PANELS / FRAME JOINERY ARE SEALED AT THE EXTERIOR USING DOW 1199 SILICONE OR PAINTABLE POLYURETHANE.

1. ALL LATCH/LOCK AND HINGE HARDWARE TO BE OF CORROSION RESISTANT MATERIAL OR CORROSION RESISTANT COATED.
2. ANCHORING COMPONENTS MUST MEET THE CORROSION RESISTANT STANDARDS AS IDENTIFIED IN THE FBC.

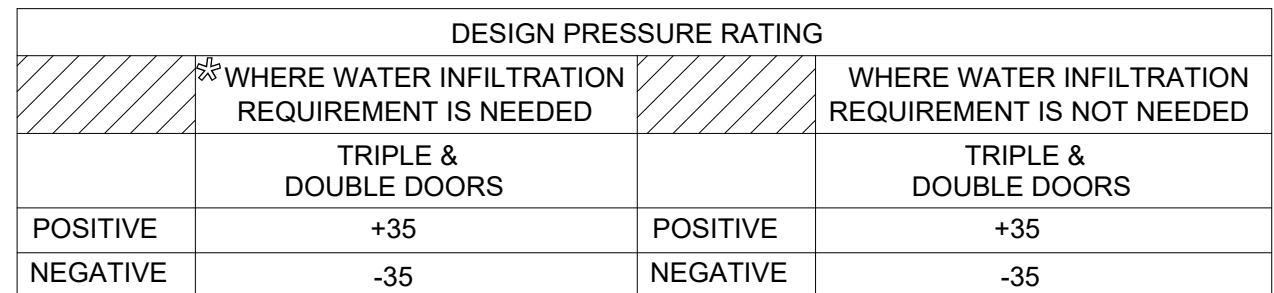


SHT #	DESCRIPTION
1	TYP. ELEVATIONS & GENERAL NOTES
2	TYPICAL ELEVATIONS
3	VERTICAL CROSS SECTIONS & B.O.M.
4	VERTICAL CROSS SECTIONS
5	HORIZONTAL CROSS SECTIONS
6	HORIZONTAL CROSS SECTIONS
7	ANCHORING LOCATIONS
8	ANCHORING LOCATIONS & DETAILS
9	UNIT COMPONENTS


HERMES F. NORERO, P.E.
Florida No. 73778
396 East Dania Beach Blvd., Suite 398
Dania Beach, FL 33004
FBPE Cert. of Auth., No. 29578

E	3.24.20	ADA THRESHOLD ADDED	TB		
D	8.29.17	CHG'D CORE DEFINITION	JH		
C	11.19.14	PRODUCT NAME UPDATE	SM		
B	3/11/13	ADD OPT. AFCD SILL	GL		
A	12.01.11	2010 CODE CHANGE	JLA		
NO.	DATE	REVISIONS	BY		


DATE: 4/14/2010
SCALE: AS NOTED
DWG. BY G.LUBBECKE
CHK. BY: S. FREY
DRAWING NO.: JW062010
SHEET 1 OF 9

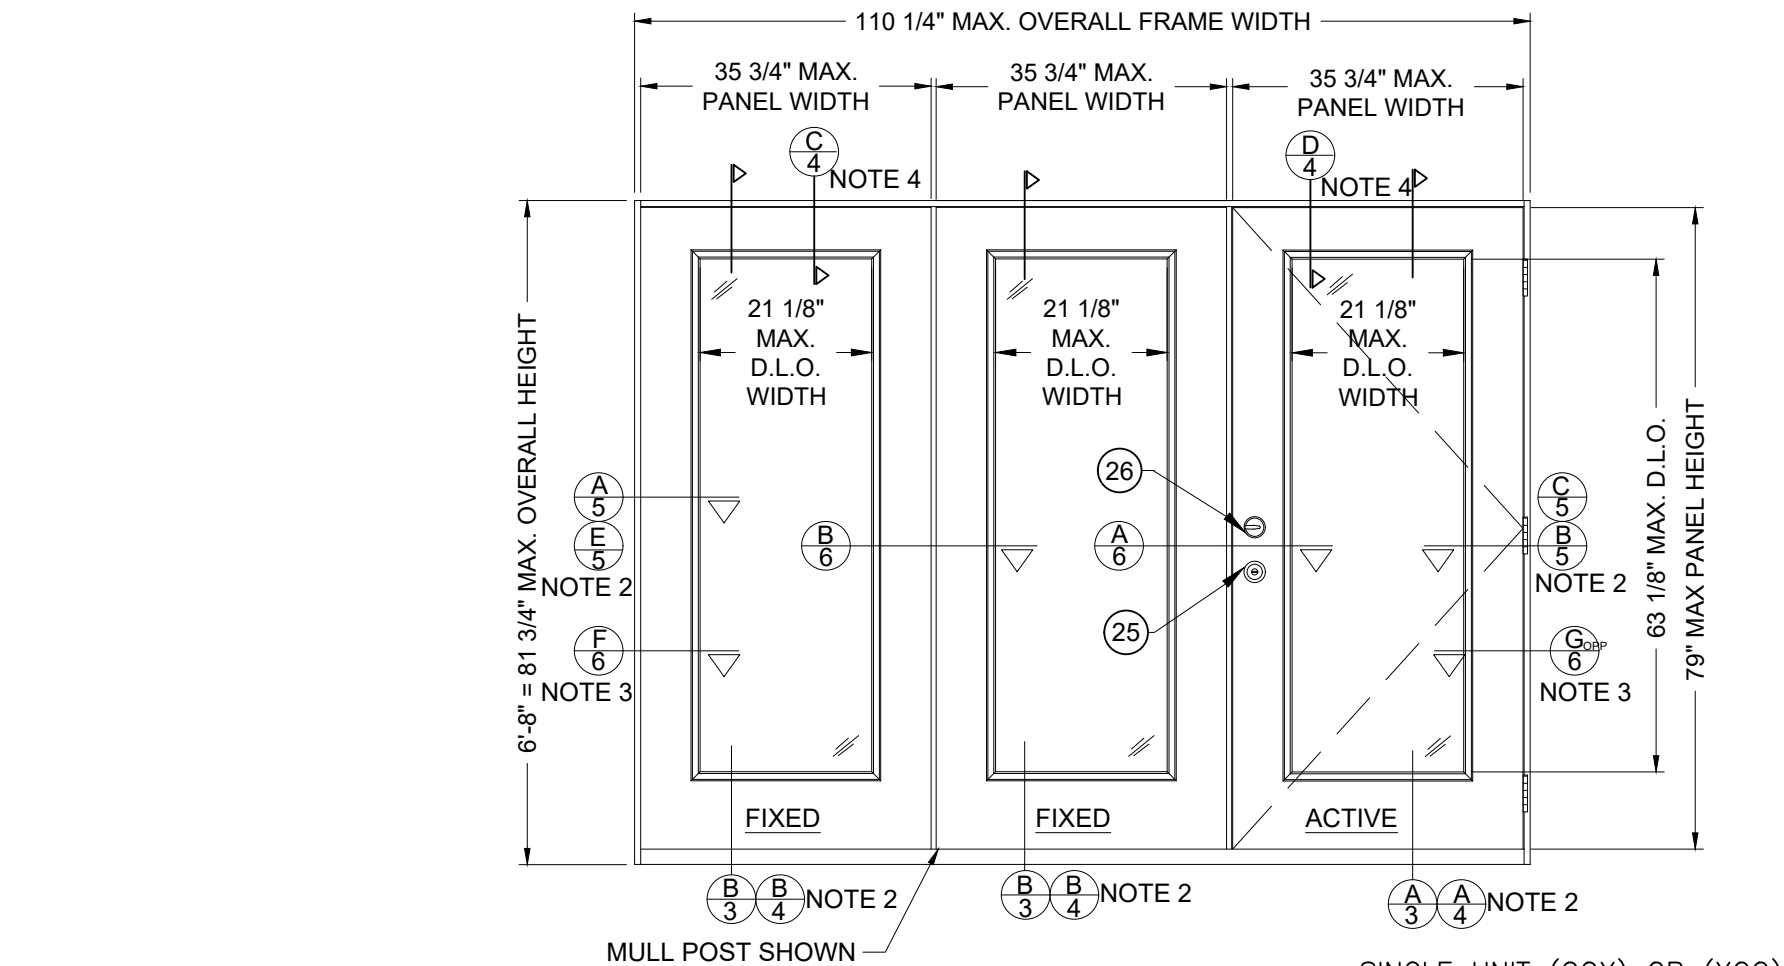


SINGLE UNIT (OOX) OR (XOO)
SCALE: 1/2" = 1'-0"

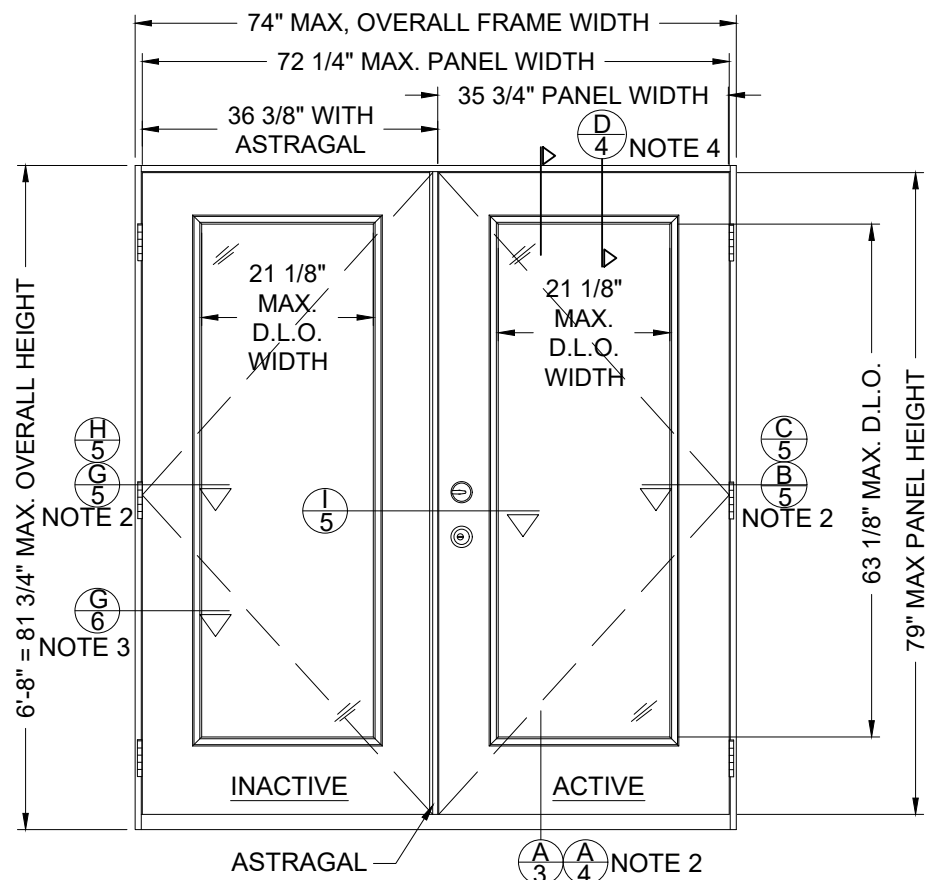

DUAL UNIT (XX)
SCALE: 1/2" = 1'-0"

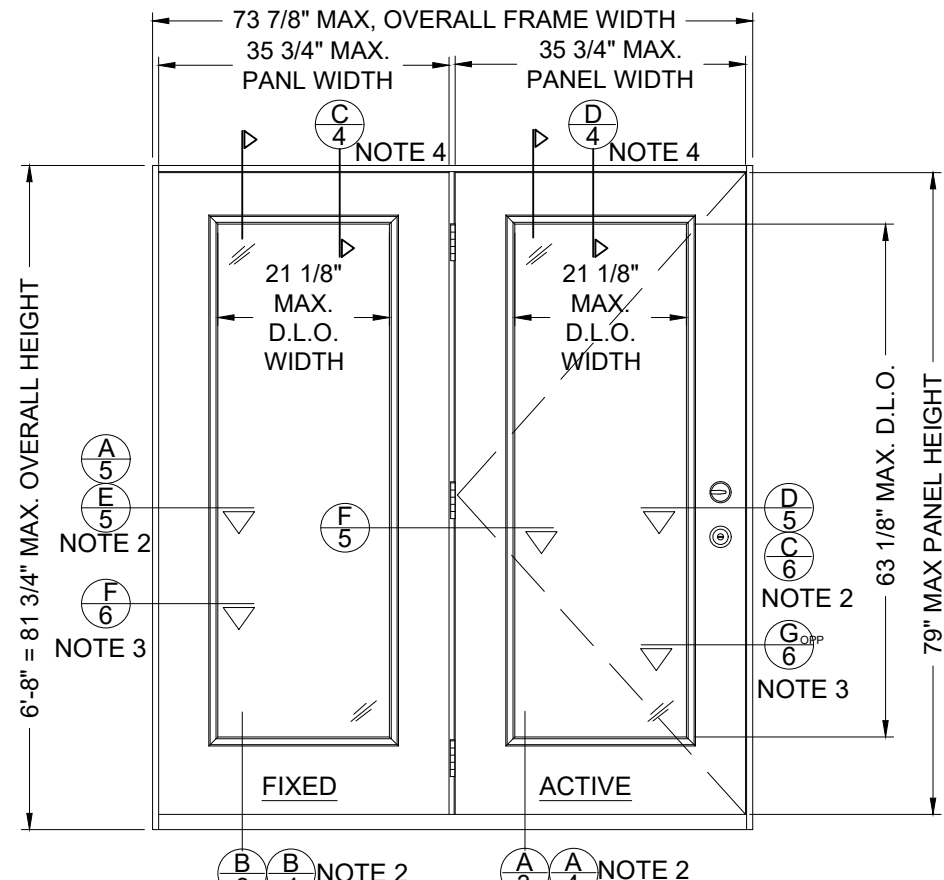


DUAL UNIT (OX) OR (XO)
SCALE: 1/2" = 1'-0"

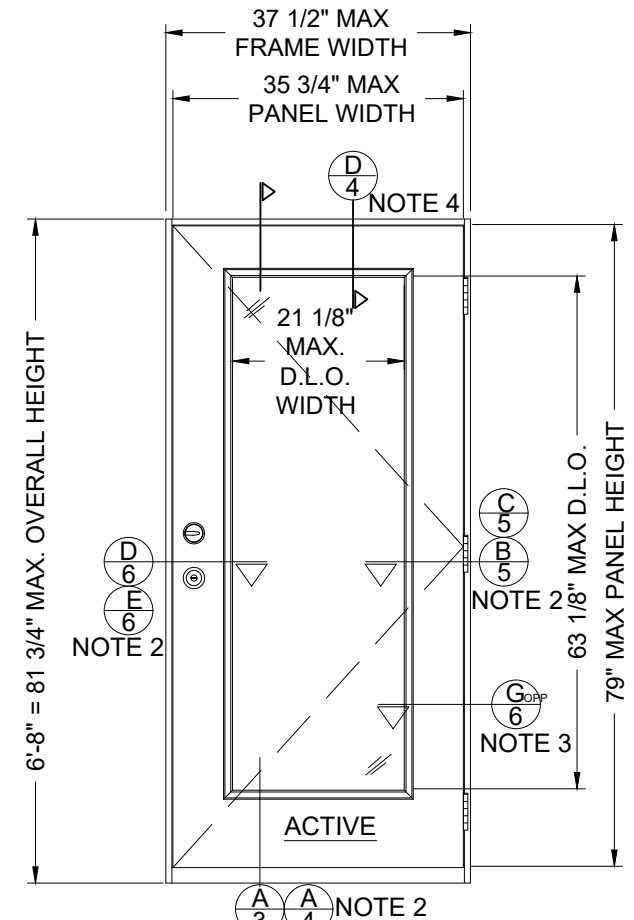

SINGLE UNIT (X)
SCALE: 1/2" = 1'-0"

NOTES:

- 1 - ALL VIEWS FROM INTERIOR.
- 2 - MASONRY AND CONCRETE INSTALLATION DETAILS.
- 3 - FOR HORIZONTAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 6 FOR DETAILS.
- 4 - FOR VERTICAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE, SEE SHEET 4 FOR DETAILS.

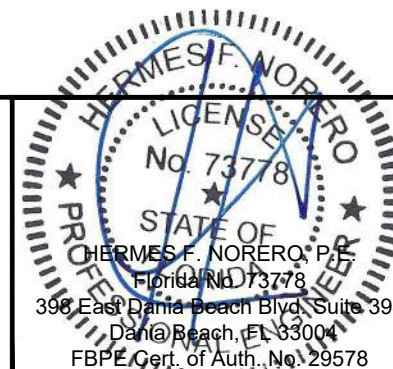


JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT: FINISHIELD/GLADIATOR
STEEL DOOR, WOOD EDGE
9-0x6-8 INSWING GLAZED DOOR SYSTEM
PART OR ASSEMBLY:
TYPICAL ELEVATIONS


NO.	DATE	REVISIONS	BY
E	3.24.20	ADA THRESHOLD ADDED	TB
D	8.29.17	CHG'D CORE DEFINITION	JH
C	11.19.14	PRODUCT NAME UPDATE	SM
B	3/11/13	ADD OPT. AFDO SILL	GL
A	12.01.11	2010 CODE CHANGE	JLA

DATE: 4/14/2010
SCALE: AS NOTED
DWG. BY: G.LUBBECKE
CHK. BY: S. FREY
DRAWING NO.: JW062010
SHEET 2 OF 9

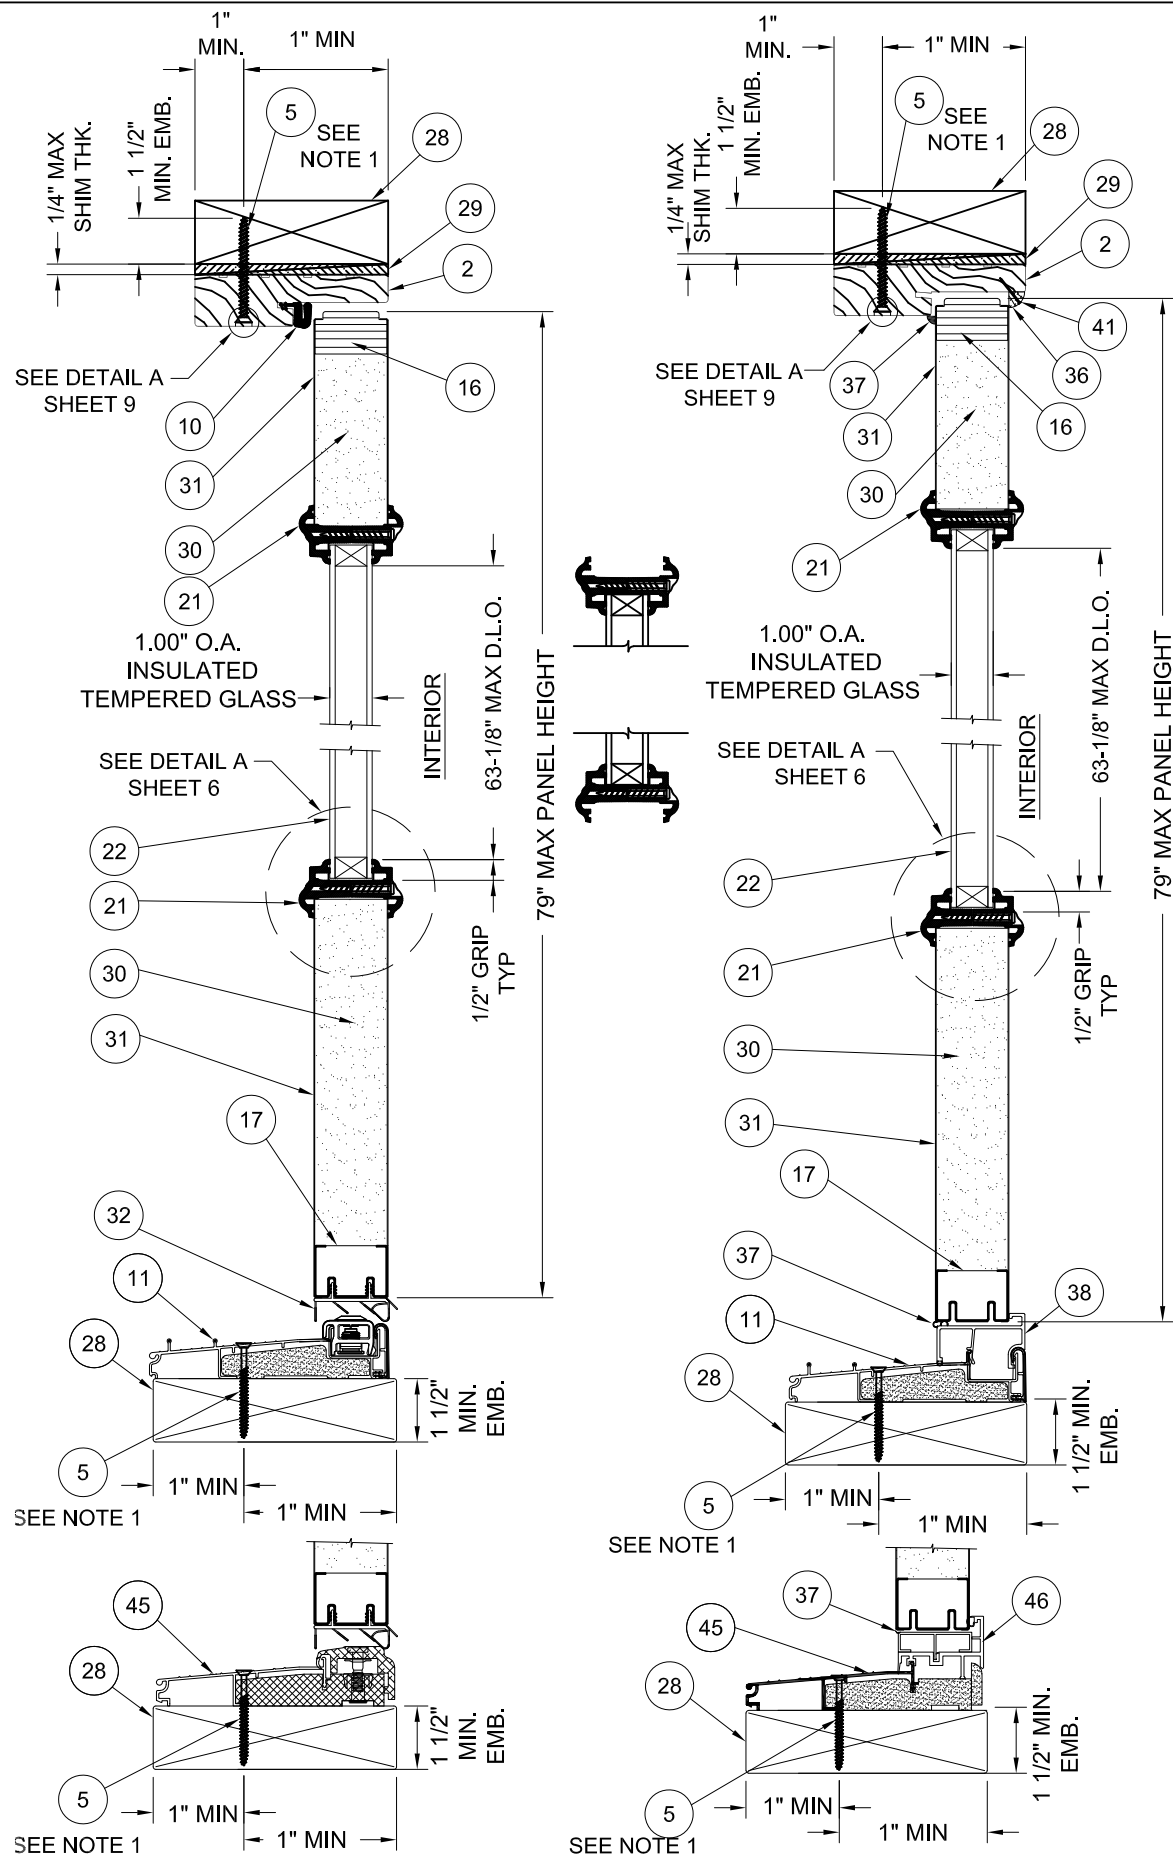

VERTICAL CROSS SECTION,
ACTIVE DOOR TYP.
WOOD FRAME INSTALLATION
SCALE: 3" = 1'-0"

VERTICAL CROSS SECTION,
SIDE LITE TYP.
WOOD FRAME INSTALLATION
SCALE: 3" = 1'-0"

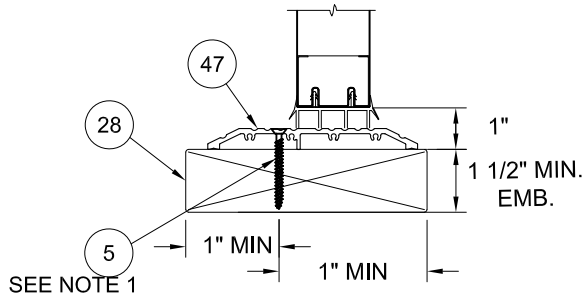

VERTICAL CROSS SECTION,
ACTIVE DOOR TYP. ADA SILL
WOOD FRAME INSTALLATION
SCALE: 3" = 1'-0"

Item	DESCRIPTION	Material
1	HINGE JAMB (1 1/4"x4-5/8" FINGERJOINTED PINE)	PINE
2	HEAD JAMB (1 1/4"x4-5/8" FINGERJOINTED PINE)	PINE
3	LATCH JAMB (1-1/4"x4-5/8" FINGERJOINTED PINE)	PINE
4	SIDELITE JAMB (1-1/4"x4-5/8" FINGERJOINTED PINE)	PINE
5	#10 PHILLIPS FLATHEAD WOOD SCREW WITH 1 1/2" MIN. EMBEDMENT	STEEL
6	4" x 4" BUTT HINGE 12GA. (.098" MIN)	STEEL
7	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
8	#10 x 1 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
9	3/16" ITW BUILDEX TAPCON WITH 1 1/4" MIN. EMBEDMENT	STEEL
10	COMPRESSION WEATHERSTRIP (Q-LON QEBD-650)	VINYL
11	INSWING THRESHOLD 6063-T6	AL/COMP. PVC
12	ASTRAGAL HAND SET STRIKE PLATE	STEEL
13	EXTRUDED ASTRAGAL 6063-T6	ALUMINUM
14	#8 X 1" PHILLIPS PAN HEAD SHEET METAL SCREW	STEEL
15	TOP ASTRAGAL STRIKE PLATE	STEEL
16	TOP RAIL (LAMINATED VENEER LUMBER)	LVL
17	BOTTOM RAIL 25GA (0.018") GALVANIZED STEEL	STEEL
18	HINGE SIDE STILE (LAMINATED VENEER LUMBER)	LVL
19	LATCH SIDE STILE (LAMINATED VENEER LUMBER)	LVL
20	LOCK BLOCK 1.688" x 3 1/8" x 12" LG PINE	PINE
21	ODL LIP-LITE FRAME #686-BKWD	PLASTIC
22	1.00" O.A. INSULATED TEMPERED GLASS	GLASS
23	16 Ga. 7/16" CROWN x 2" LONG STAPLES	STEEL
24	ASTRAGAL LOCK SET STRIKE PLATE	STEEL
25	KWIKSET LOCK SERIES 400	STEEL
26	KWIKSET DEADBOLT SERIES 980	STEEL
27	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
28	2x WOOD BUCK GRD 2 SOUTHERN YELLOW PINE	WOOD
29	NON-COMPRESSION SHIM 1/4" MAX. THICKNESS	WOOD
30	DOOR CORE BY JELD-WEN	FOAM
31	STEEL DOOR PANEL SKIN MATERIAL (25 GA GALVANIZED) A-525 COMMERCIAL QUALITY 0.018" MIN. THICK.)	STEEL GALVANIZED
32	VINYL DOOR BOTTOM SWEEP	VINYL
33	CORNER PADS 2", LOCATED AT THE BOTTOM OF EACH JAMB LEG SETTING ON TOP OF THE SILL, BEHIND THE WEATHERSTRIP	PLASTIC
34	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
35	SOLID MULL POST (LAMINATED VENEER LUMBER)	LVL
36	3/8" QUARTER ROUND MOULDING	WOOD
37	SILICONE BEAD DOW 1199 OR POLYURETHANE	SILICONE
38	SIDELITE SEAT	PVC
39	ASTRAGAL THROW BOLT, STEEL ROD, 5/16" DIA. x 18"	STEEL
40	1X WOOD BUCK GRADE 2 SOUTHERN YELLOW PINE	WOOD
41	1 1/4" BRAD NAIL 18 GA.	STEEL
42	BOTTOM ASTRAGAL INSERT PLUG - INSWING ONLY	PLASTIC
43	#8 x 3" PHILLIPS FLATHEAD WOOD SCREW	STEEL
44	SIDELITE SPACING STRIP	PVC
45	INSWING THRESHOLD 6063-T6	AL/COMP. PVC
46	SIDELITE SEAT AFCO DD-230	PVC
47	ADA THRESHOLD	ALUMINUM

- NOTES:
- FOR ANCHOR SPACING (ITEMS #5 OR #9), SEE SHEET 7.
 - 1X MAY BE UTILIZED AS AN OPTION. FOR VERTICAL SECTIONS, SEE DETAILS C/D SHEET 4.
HORIZONTAL SECTIONS: SEE DETAILS F/G SHEET 6.
 - TAPCON MASONRY ANCHOR SPACING SAME AS WOOD ANCHOR SCREW CONFIGURATION.
 - OPTIONALLY, ANCHORS CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451


PRODUCT:
FINISHIELD/GLADIATOR
STEEL DOOR, WOOD EDGE
9-0x6-8 INSWING GLAZED DOOR SYSTEM

PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS
& BILL OF MATERIALS


NO.	DATE	REVISIONS	BY
E	3.24.20	ADA THRESHOLD ADDED	ITB
D	8.29.17	CHGD CORE DEFINITION	JH
C	11.19.14	PRODUCT NAME UPDATE	SM
B	3/11/13	ADD OPT. AFCO SILL	GL
A	12.01.11	2010 CODE CHANGE	JLA

DATE: 4/14/2010
SCALE: AS NOTED
DWG. BY: G.LUBBECKE
CHK. BY: S. FREY
DRAWING NO.: JW062010
SHEET 3 OF 9




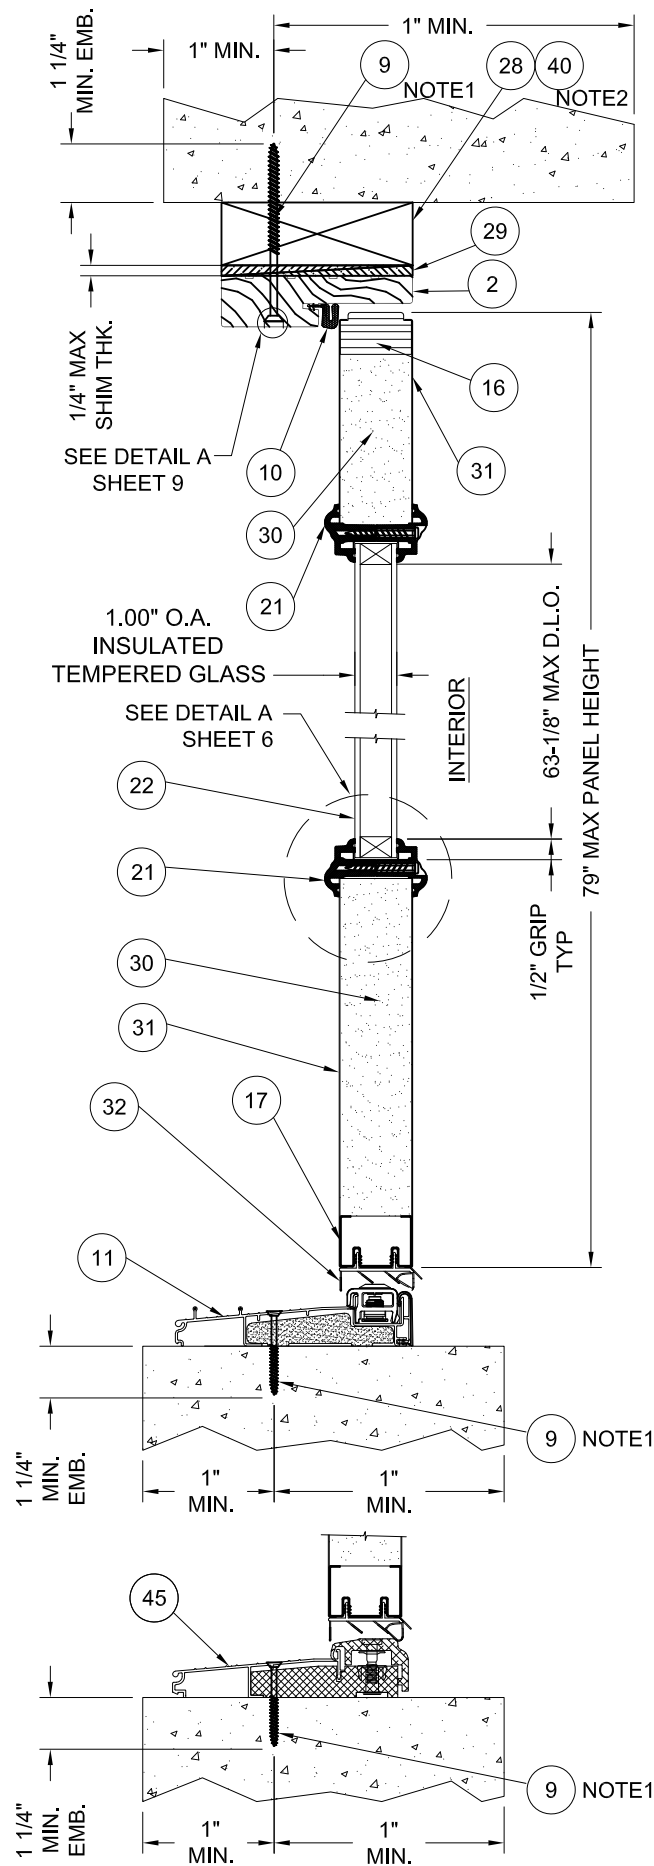


A
4 VERTICAL CROSS SECTION, ACTIVE DOOR TYP.
MASONRY AND CONCRETE INSTALLATION
SCALE: 3" = 1'-0"

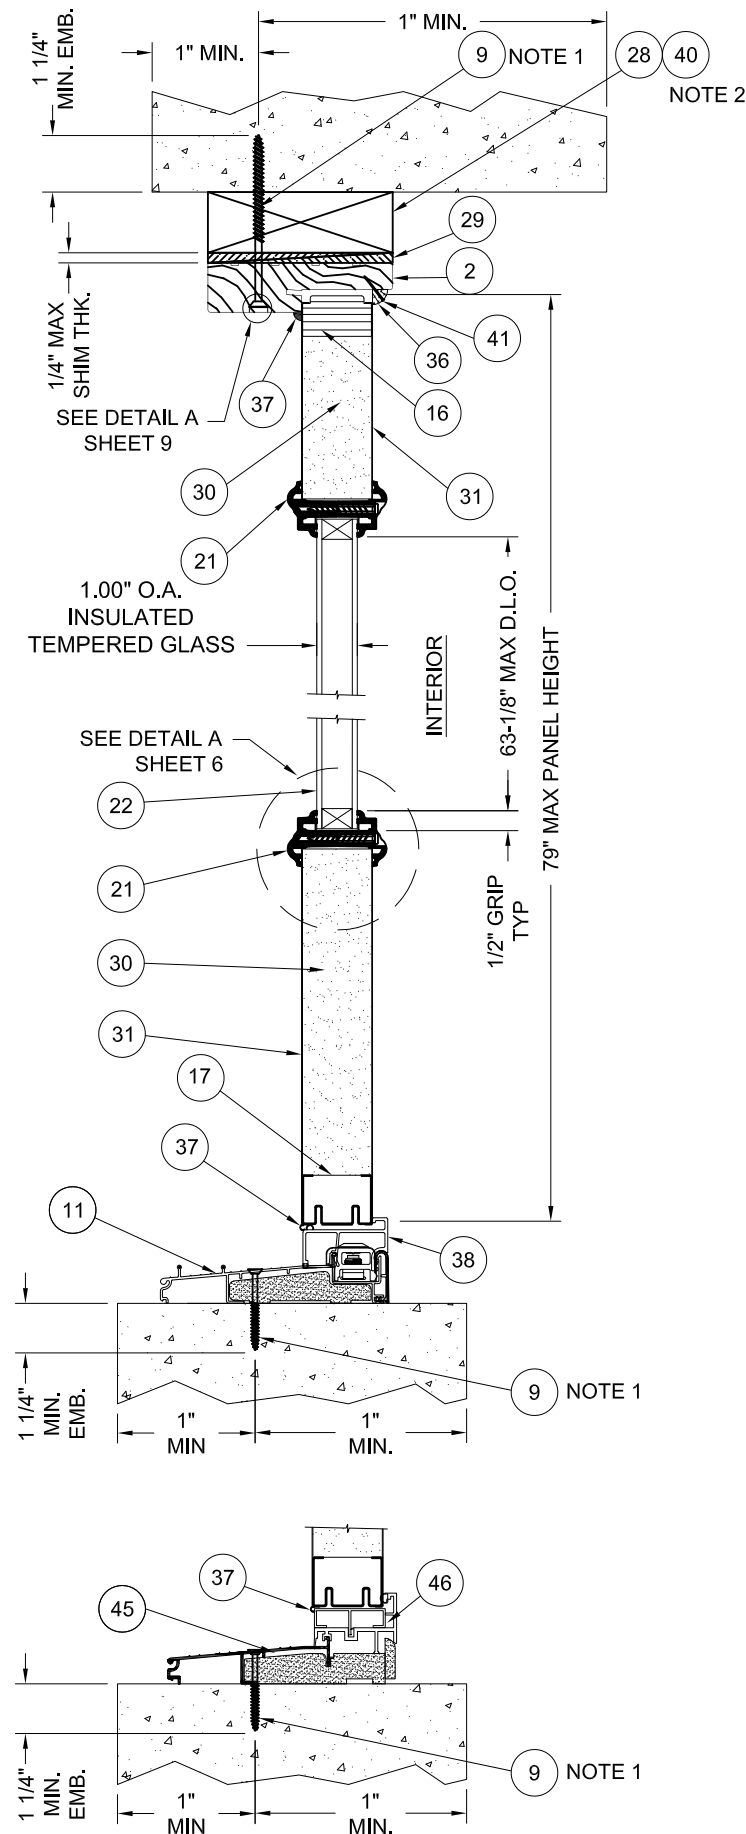

B
4 VERTICAL CROSS SECTION, SIDE LITE TYP.
MASONRY AND CONCRETE INSTALLATION
SCALE: 3" = 1'-0"

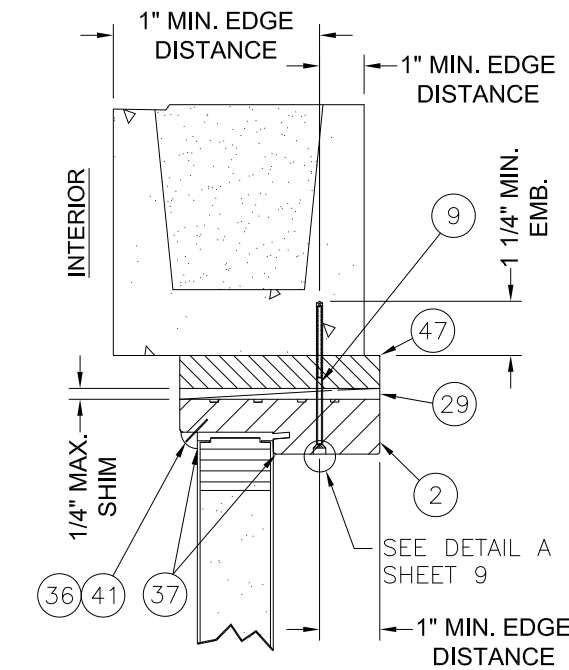


C
4 VERTICAL CROSS SECTION
FIXED UNIT 1X BUCK OPTION IN
MASONRY & CONCRETE INSTALL

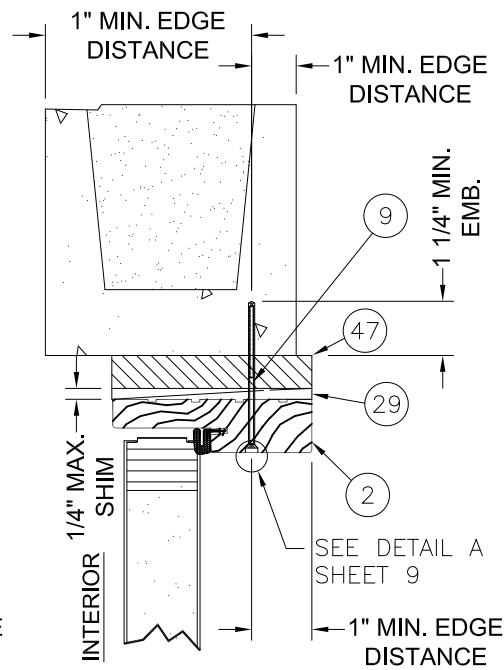


D
4 VERTICAL CROSS SECTION
OPERATING UNIT 1X BUCK OPTION IN
MASONRY & CONCRETE INSTALL

NOTES:

- FOR ANCHOR SPACING (ITEMS #5 OR #9), SEE SHEET 7.
- 1X MAY BE UTILIZED AS AN OPTION. FOR VERTICAL SECTIONS, SEE DETAILS **C**
4 **D**
4 SHEET 4. HORIZONTAL SECTIONS: SEE DETAILS **F**
6 **G**
6 SHEET 6.
- TAPCON MASONRY ANCHOR SPACING SAME AS WOOD ANCHOR SCREW CONFIGURATION.
- OPTIONALLY, ANCHORS CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.

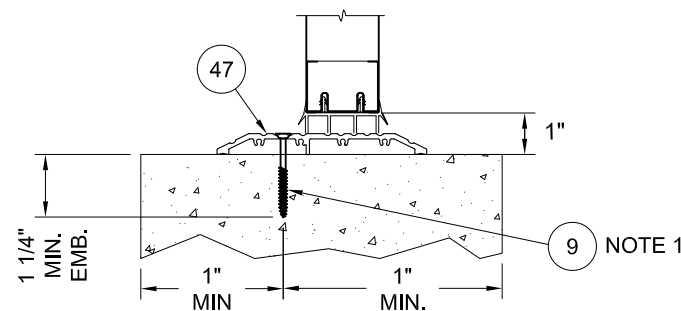










C
4 VERTICAL CROSS SECTION, ACTIVE DOOR TYP. ADA SILL
MASONRY AND CONCRETE INSTALLATION
SCALE: 3" = 1'-0"

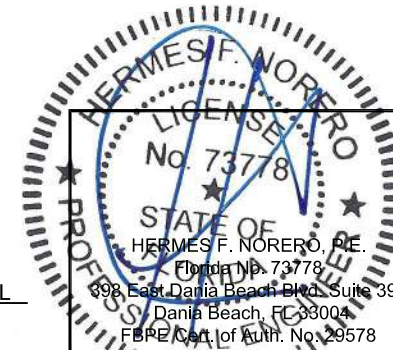

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT:		FINISHIELD/GLADIATOR	
		STEEL DOOR, WOOD EDGE	
		9-0x6-8 INSWING GLAZED DOOR SYSTEM	
		PART OR ASSEMBLY:	
		VERTICAL	
		CROSS SECTIONS	
NO.	DATE	REVISIONS	BY
E	3.24.20	ADA THRESHOLD ADDED	TB
D	8.29.17	CHGD CORE DEFINITION	JH
C	11.19.14	PRODUCT NAME UPDATE	SM
B	3/11/13	ADD OPT. AFDO SILL	GL
A	12.01.11	2010 CODE CHANGE	JLA

DATE:	4/14/2010
SCALE:	AS NOTED
DWG. BY:	G. LUBBECKE
CHK. BY:	S. FREY
DRAWING NO.:	JW062010
SHEET	4 OF 9

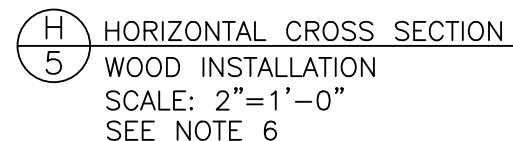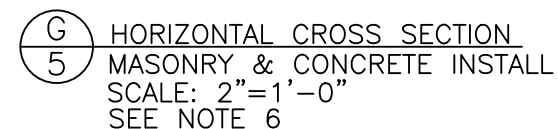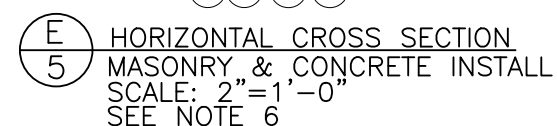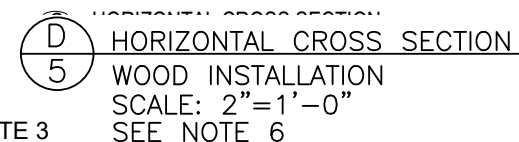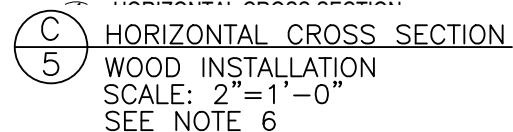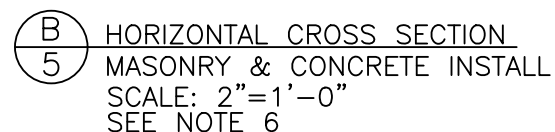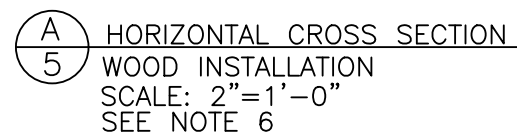


5. OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.

JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451


PRODUCT: FINISHIELD/GLADIATOR
STEEL DOOR, WOOD EDGE
9-0x6-8 INSWING GLAZED DOOR SYSTEM
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

DATE:	4/14/2010
SCALE:	AS NOTED
DWG. BY:	Y. LUBBECK
CHK. BY:	S. FREY
DRAWING NO.:	JW062010
SHEET 5 OF 9	




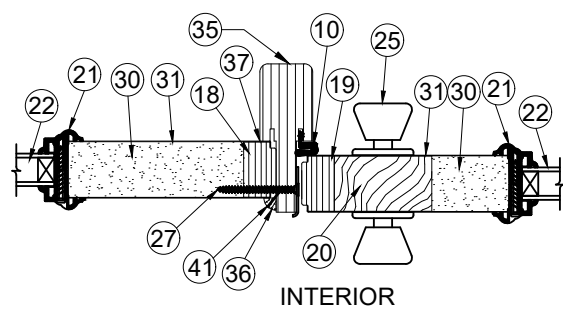


A
6 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

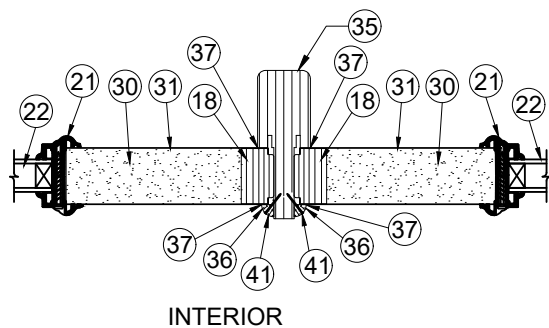


B
6 HORIZONTAL CROSS SECTION
SCALE: 2"=1'-0"

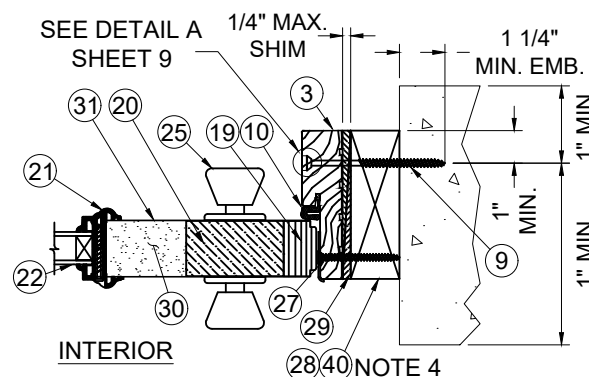


C
6 HORIZONTAL CROSS SECTION
MASONRY & CONCRETE INSTALL
SCALE: 2"=1'-0"

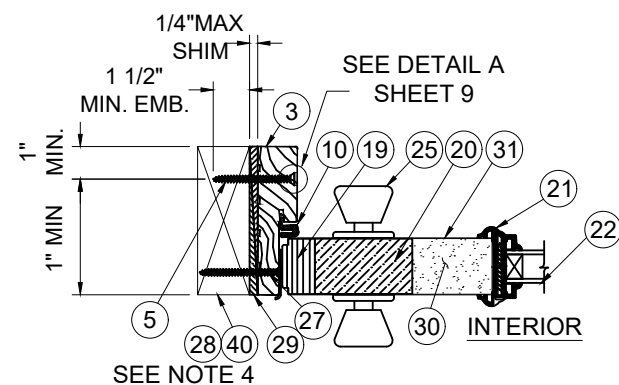


D
6 HORIZONTAL CROSS SECTION
WOOD INSTALLATION
SCALE: 2"=1'-0"

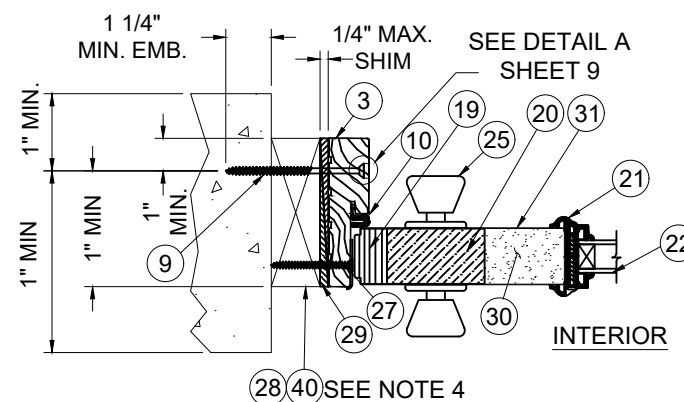


E
6 HORIZONTAL CROSS SECTION
MASONRY & CONCRETE INSTALL
SCALE: 2"=1'-0"

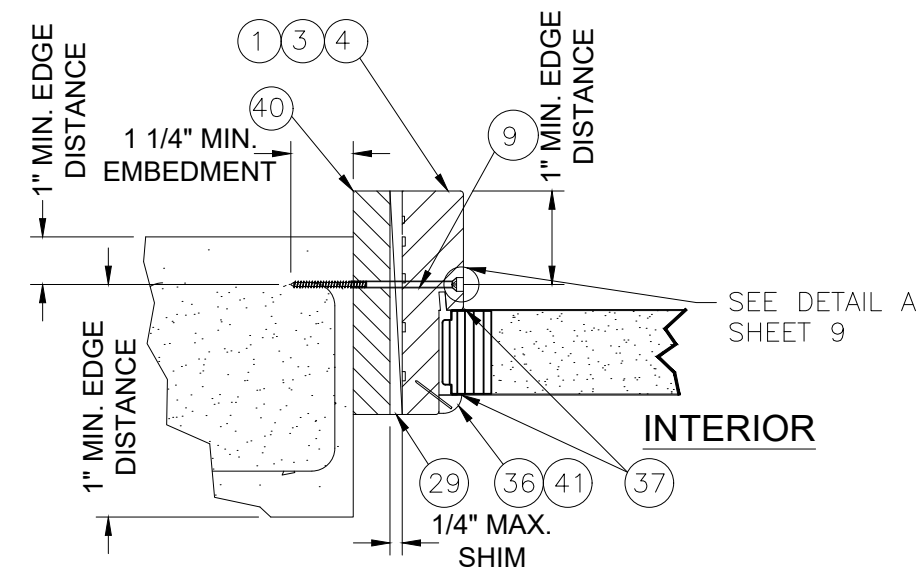

F
6 HORIZONTAL CROSS SECTION
FIXED UNIT 1X BUCK OPTION IN
MASONRY & CONCRETE INSTALL
(LEFT-HAND ANCHOR SHOWN, RIGHT-HAND ANCHOR SIMILAR)

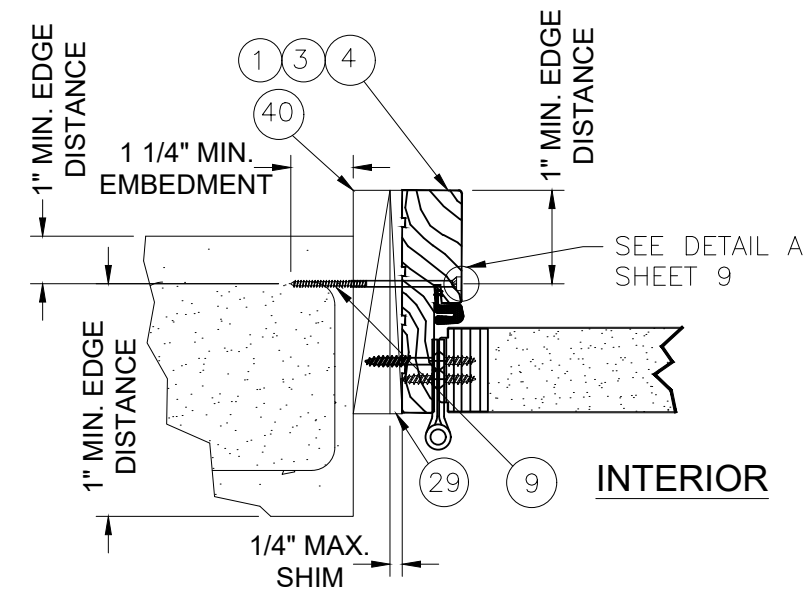

G
6 HORIZONTAL CROSS SECTION
OPERATING UNIT 1X BUCK OPTION IN
MASONRY & CONCRETE INSTALL
(LEFT-HAND ANCHOR SHOWN, RIGHT-HAND ANCHOR SIMILAR)

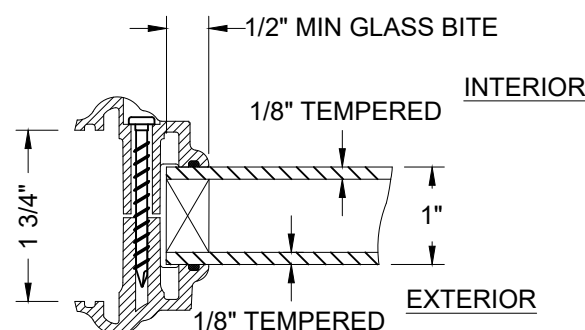

GLAZING DETAIL A
SCALE: 6"=1'-0"

NOTES:

- FOR ANCHOR SPACING (ITEMS #5 OR #9), (SEE SHEET 7).
- ASTRAGAL SCREW PATTERN SPACING FOR SCREW #14:
FROM TOP OF PANEL: 2 1/4", 9 1/4", 23 13/16", 41 1/4", 57 3/4", 69 3/4" & 76".
- 1X MAY BE UTILIZED AS AN OPTION. FOR VERTICAL SECTIONS, SEE DETAILS **C** **D** SHEET 4. HORIZONTAL SECTIONS: DETAILS **F** **G** SHEET 6.
- TAPCON MASONRY ANCHOR SPACING SAME AS WOOD ANCHOR SCREW CONFIGURATION.
- OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION OF HEAD OR JAMB AS LONG AS MINIMUM EMBEDMENT IS ACHIEVED.



JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

PRODUCT: FINISHIELD/GLADIATOR
STEEL DOOR, WOOD EDGE
9-0x6-8 INSWING GLAZED DOOR SYSTEM
PART OR ASSEMBLY:
HORIZONTAL CROSS SECTIONS

NO.	DATE	REVISIONS	BY
E	3.24.20	ADA THRESHOLD ADDED	TB
D	8.29.17	CHG'D CORE DEFINITION	JH
C	11.19.14	PRODUCT NAME UPDATE	SM
B	3/11/13	ADD OPT. AFCC SILL	GL
A	12.01.11	2010 CODE CHANGE	JLA

DATE: 4/14/2010
SCALE: AS NOTED
DWG. BY: G.LUBBECKE
CHK. BY: S. FREY
DRAWING NO.: JW062010
SHEET 6 OF 9



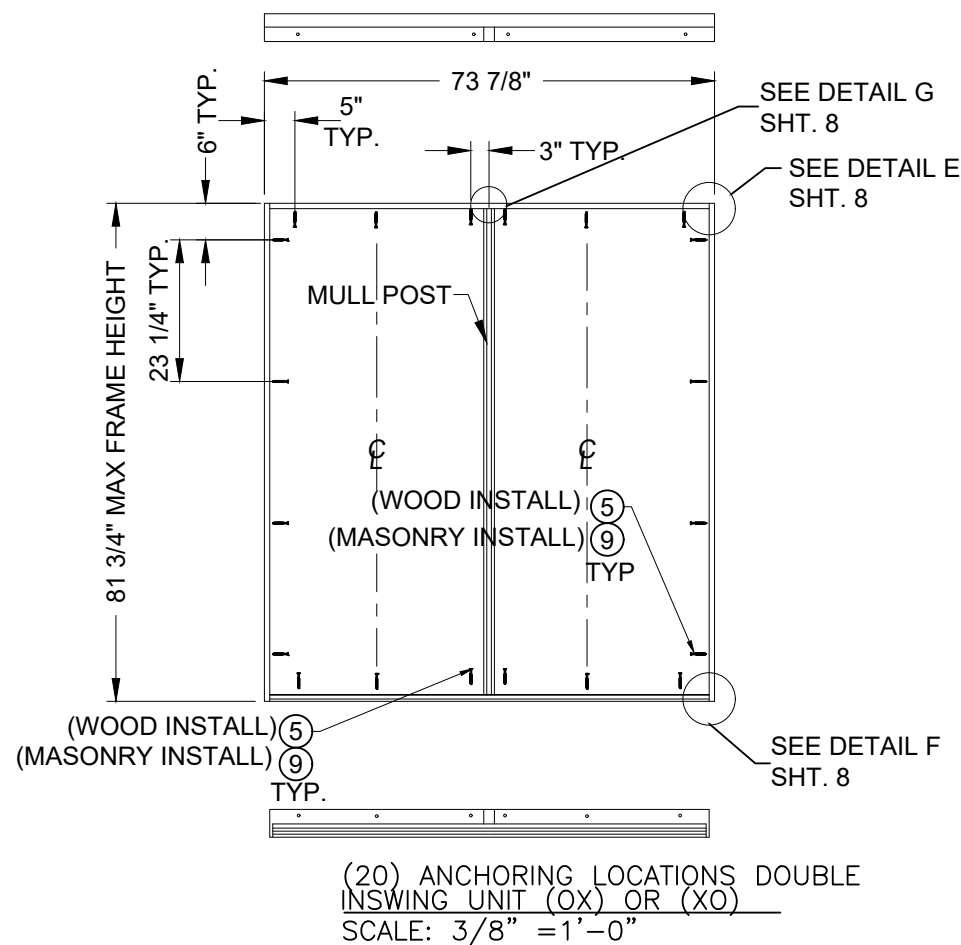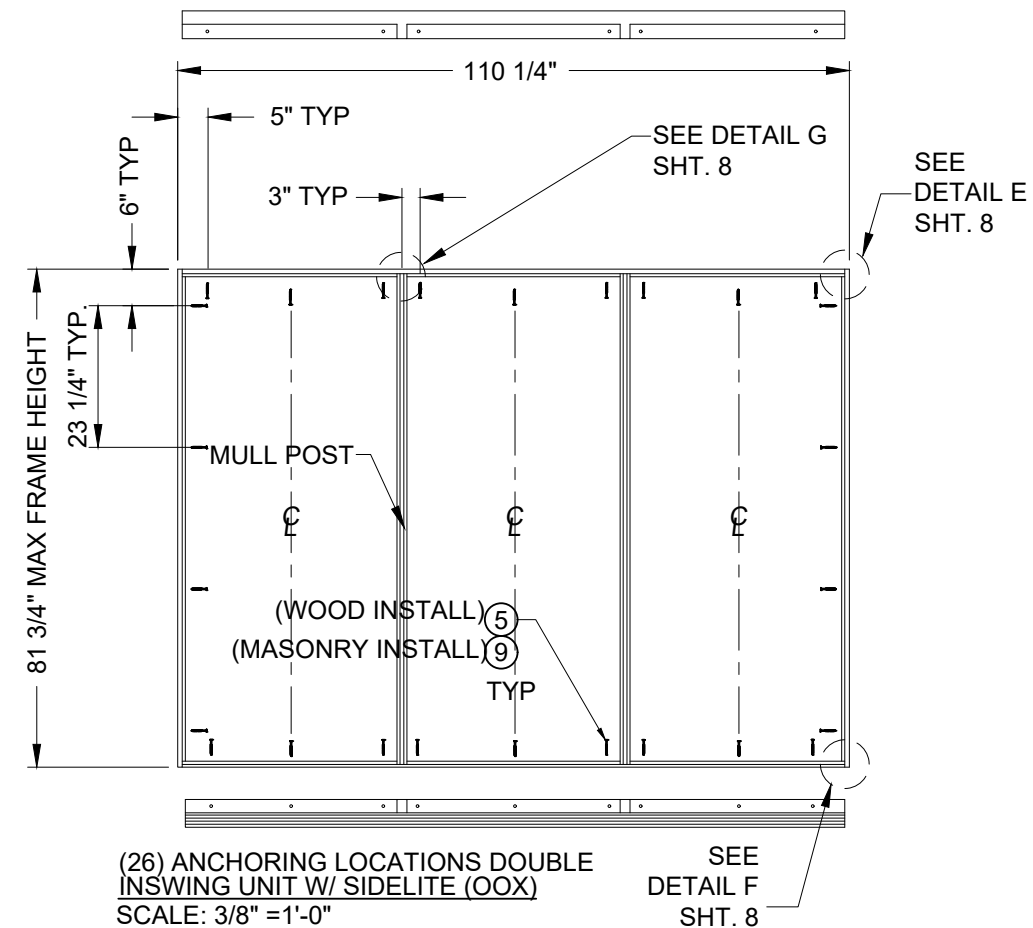

- NOTES:
1. SEE SHT 8 FOR LATCH AND HINGE LOCATIONS.
 2. SEE SHT 8 FOR SIDELITE FASTENER LOCATIONS.
 3. SEE SHT 8 FOR SIDELITE BRAD NAIL LOCATIONS FOR QUARTER ROUND MOLDING ATTACHMENT.
 4. OPTIONALLY, ANCHORS (ITEMS #5 OR #9) CAN BE PLACED IN NARROW SECTION OF JAMB OR HEAD AS LONG AS MINIMUM EMBEDMENT IS MET.
 5. ALL VIEWS FROM INTERIOR.


JELD-WEN, INC.
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR, 97601
PH. 541-882-3451

FINISHIELD/GLADIATOR
STEEL DOOR, WOOD EDGE
9-0x6-8 INSWING GLAZED DOOR SYSTEM
PART OR ASSEMBLY: _____


[illegible]

DATE: 4/14/2010
SCALE: AS NOTED
WG. BY: G.LUBBECKE
CHK. BY: S. FREY
DRAWING NO.: JW062010
SHEET 7 OF 9




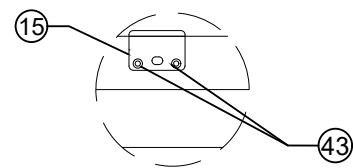


DETAIL A
UPPER ASTRAGAL
BOLT STRIKE
SCALE: 1/2" = 1'-0"

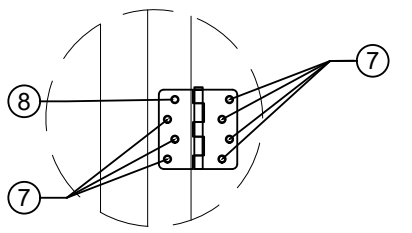


DETAIL B
HINGE DETAIL
SCALE: 1/2" = 1'-0"



DETAIL C
LOWER ASTRAGAL INSERT PLUG
SCALE: 1/2" = 1'-0"

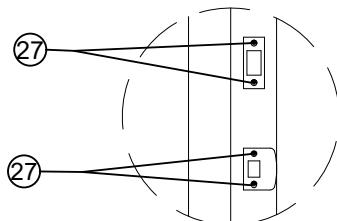


DETAIL D
LATCH & DEADBOLT
STRIKE PLATES
SCALE: 1/2" = 1'-0"

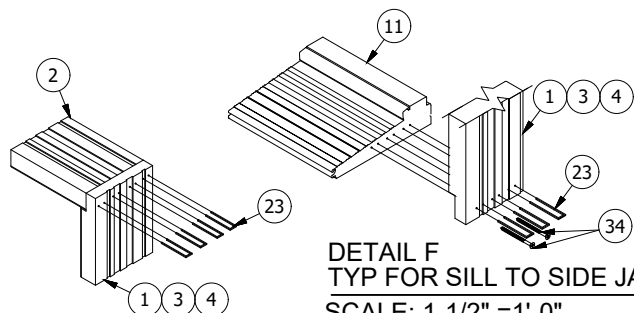


DETAIL E
TYP FOR HEAD TO SIDE JAMBS
SCALE: 1-1/2" = 1'-0"


DETAIL F
TYP FOR SILL TO SIDE JAMBS
SCALE: 1-1/2" = 1'-0"

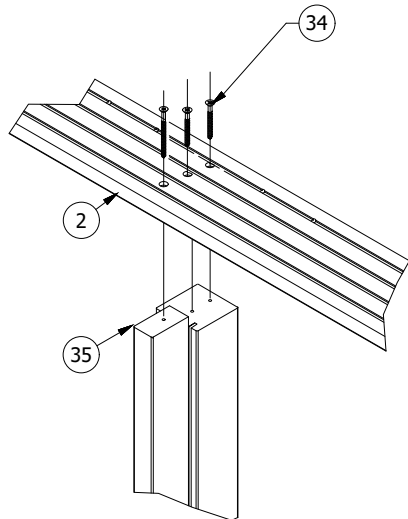

DETAIL G
TYP FOR HEAD TO MULL POST
(SILL TO MULL POST SIMILAR)
SCALE: 1-1/2" = 1'-0"

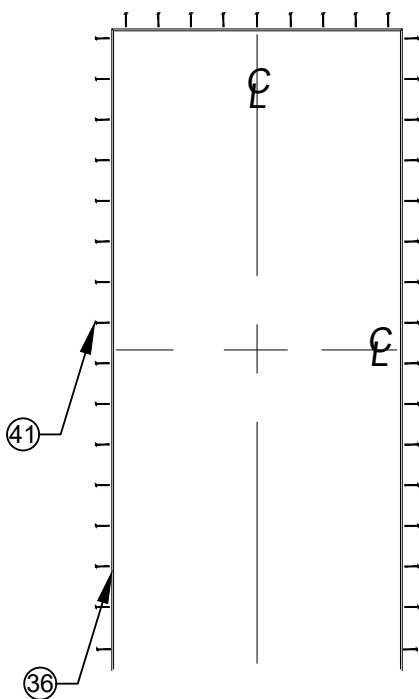

BRAD LOCATIONS
TYPICAL FOR ALL SIDELITES
SCALE: 3/8" = 1'-0"

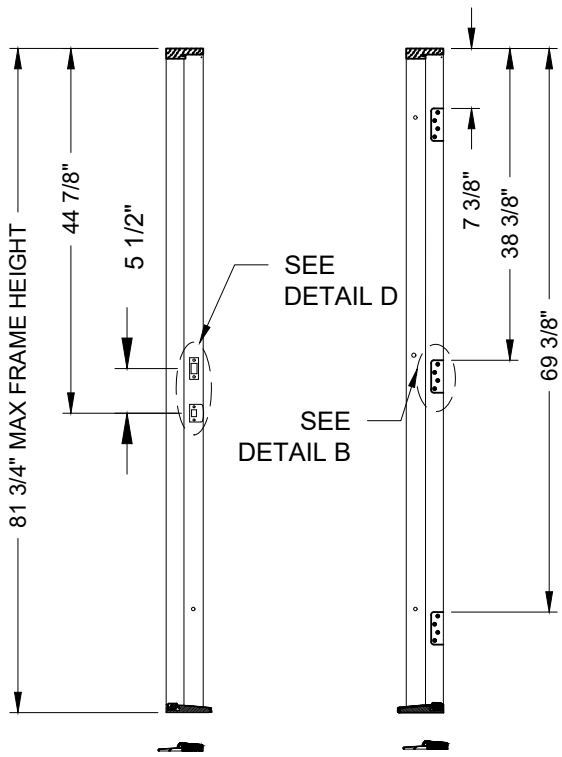

LATCH AND HINGE MULLIONS
TYP FOR ALL FRAMES
SCALE: 1/2" = 1'-0"

NOTES:
1. ALL VIEWS FROM INTERIOR.



JELD-WEN, INC. 3737 LAKEPORT BLVD. KLAMATH FALLS, OR, 97601 PH. 541-882-3451	
PRODUCT: FINISHIELD/GLADIATOR STEEL DOOR, WOOD EDGE 9-0x6-8 INSWING GLAZED DOOR SYSTEM	PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS
E 3.24.20 ADA THRESHOLD ADDED TB	NO. DATE REVISIONS BY
D 8.29.17 CHG'D CORE DEFINITION JH	
C 11.19.14 PRODUCT NAME UPDATE SM	
B 3/11/13 ADD OPT. AFCD SILL GL	
A 12.01.11 2010 CODE CHANGE JLA	
DATE: 4/14/2010	
SCALE: AS NOTED	
DWG. BY: G.LUBBECKE	
CHK. BY: S. FREY	
DRAWING NO.: JW062010	
SHEET 8 OF 9	

