

This document has been electronically signed and sealed using a Digital Signature. Printed copies without an original signature must be verified using the original electronic version.



FL REG# 278, Yoonhwak Kim, FL PE #86367

Alpine, an ITW Company
6750 Forum Drive, Suite 305
Orlando, FL 32821
Phone: (800)755-6001
www.alpineitw.com



Site Information:	Page 1:
Customer: W. B. Howland Company, Inc.	Job Number: 20-4111
Job Description: /Jerri & Paula Payne /ZECHER CONSTRUCTION	
Address:	

Job Engineering Criteria:
Design Code: FBC 2017 RES IntelliVIEW Version: 18.02.01B JRef #: 1WUT2150007 Wind Standard: ASCE 7-10 Wind Speed (mph): 130 Building Type: Closed Roof Load (psf): 20.00-10.00- 0.00-10.00 Floor Load (psf): None

This package contains general notes pages, 34 truss drawing(s) and 3 detail(s).

Item	Drawing Number	Truss
1	119.20.1032.28603	A01
3	119.20.1032.32390	A03
5	119.20.1032.35797	A05
7	119.20.1032.39607	A07
9	119.20.1032.45173	A09
11	119.20.1032.50927	A11
13	119.20.1032.55910	A13
15	119.20.1033.01623	A15
17	119.20.1033.06660	A17
19	119.20.1033.12457	A19
21	119.20.1033.37443	B01
23	119.20.1033.44620	B03
25	119.20.1033.49983	C02
27	119.20.1033.57160	D01
29	119.20.1034.19070	J02
31	119.20.1034.28100	J04
33	119.20.1034.33163	J06HJ
35	BRCLBSUB0119	
37	GBLLETIN0118	

Item	Drawing Number	Truss
2	119.20.1032.30627	A02
4	119.20.1032.34243	A04
6	119.20.1032.37830	A06
8	119.20.1032.41493	A08
10	119.20.1032.47747	A10
12	119.20.1032.53487	A12
14	119.20.1032.58037	A14
16	119.20.1033.03920	A16
18	119.20.1033.08933	A18
20	119.20.1033.29507	A20
22	119.20.1033.41480	B02
24	119.20.1033.48247	C01
26	119.20.1033.54220	C03
28	119.20.1034.12493	J01
30	119.20.1034.26450	J03
32	119.20.1034.29753	J05
34	119.20.1034.45157	J07
36	A14015ENC101014	

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

General Notes (continued)

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.

BCLL = Bottom Chord standard design Live Load in pounds per square foot.

CL = Certified lumber.

Des Ld = total of TCLL, TCDL, BCLL and BCDL Design Load in pounds per square foot.

FRT = Fire Retardant Treated lumber.

FRT-DB = D-Blaze Fire Retardant Treated lumber.

FRT-DC = Dricon Fire Retardant Treated lumber.

FRT-FP = FirePRO Fire Retardant Treated lumber.

FRT-FL = FlamePRO Fire Retardant Treated lumber.

FRT-FT = FlameTech Fire Retardant Treated lumber.

FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.

g = green lumber.

HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.

HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.

HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.

Ic = Incised lumber.

FJ = Finger Jointed lumber.

L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.

L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.

Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.

Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.

Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.

Max Web CSI = Maximum bending and axial Combined Stress Index for Webs for of all load cases.

NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.

PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.

PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds

PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.

PP = Panel Point.

R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).

Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).

RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).

TCDL = Top Chord standard design Dead Load in pounds per square foot.

TCLL = Top Chord standard design Live Load in pounds per square foot.

U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).

VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.

VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.

VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.

VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.

W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoctin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 13723 Riverport Drive, Suite 200, Maryland Heights, MO 63043; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpinst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcindustry.com.

SEQN: 314429 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A01	Cust: R 215 JRef: 1WUT2150007 T40 DrwNo: 119.20.1032.28603 / YK 04/28/2020
---------------------------	--------------------------	---	--

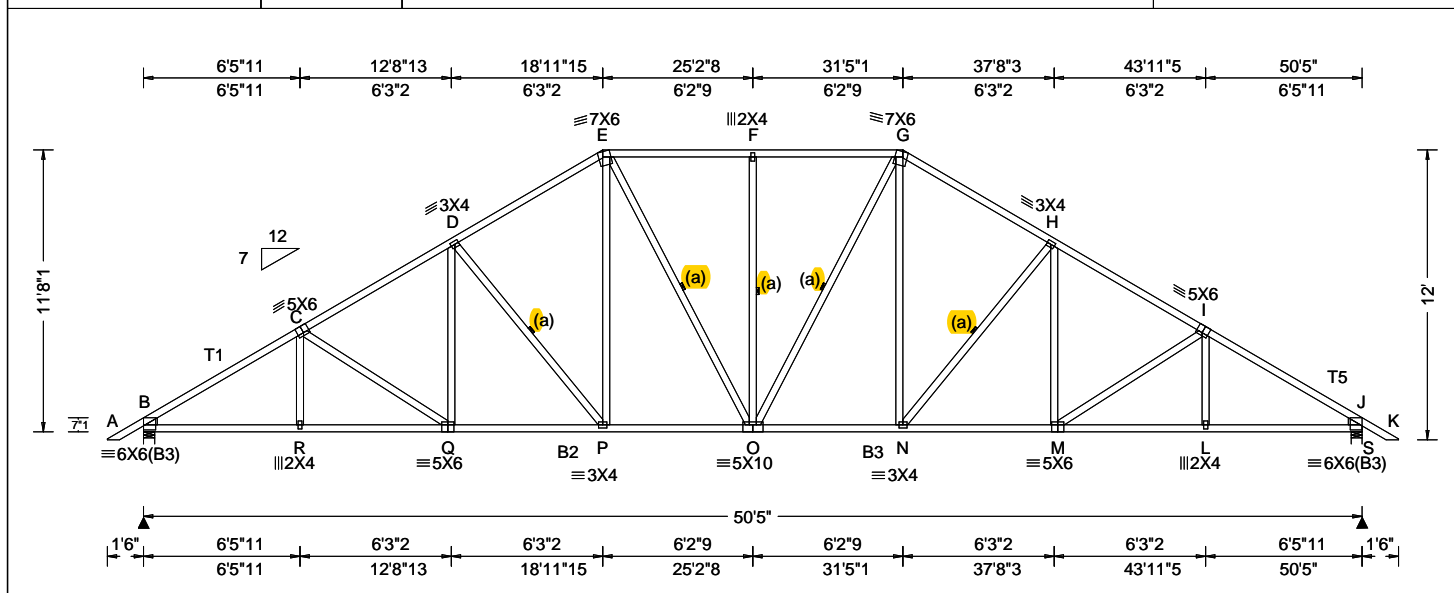

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.232 F 999 240 VERT(CL): 0.478 F 999 180 HORZ(LL): 0.113 L - - HORZ(TL): 0.232 L - - Creep Factor: 2.0 Max TC CSI: 0.591 Max BC CSI: 0.756 Max Web CSI: 0.397 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2183 -/- /- /1317 /44 /354 S 2183 -/- /- /1317 /44 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 S Brg Width = 5.5 Min Req = 1.8 Bearings B & S are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 783 -3487 F - G 734 -2334 C - D 783 -3118 G - H 758 -2643 D - E 757 -2643 H - I 784 -3118 E - F 734 -2334 I - J 784 -3487


Lumber
Top chord: 2x4 SP #2; T1,T5 2x4 SP M-31;
Bot chord: 2x4 SP M-31; B2,B3 2x4 SP #2;
Webs: 2x4 SP #3;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Bracing
(a) Continuous lateral restraint equally spaced on member.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.

Additional Notes
Refer to General Notes for additional information
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
The overall height of this truss excluding overhang is 11'-8-1/2".

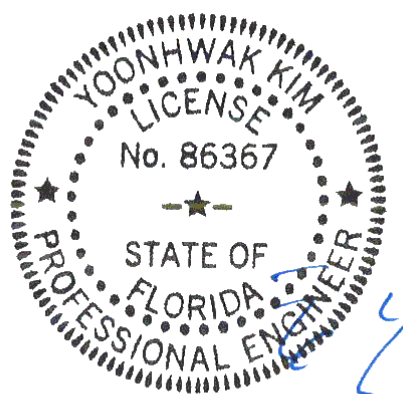


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314430 FROM: CDM	COMM Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A02	Cust: R 215 JRef: 1WUT2150007 T2 DrwNo: 119.20.1032.30627 / YK 04/28/2020
---------------------------	--------------------------	---	---

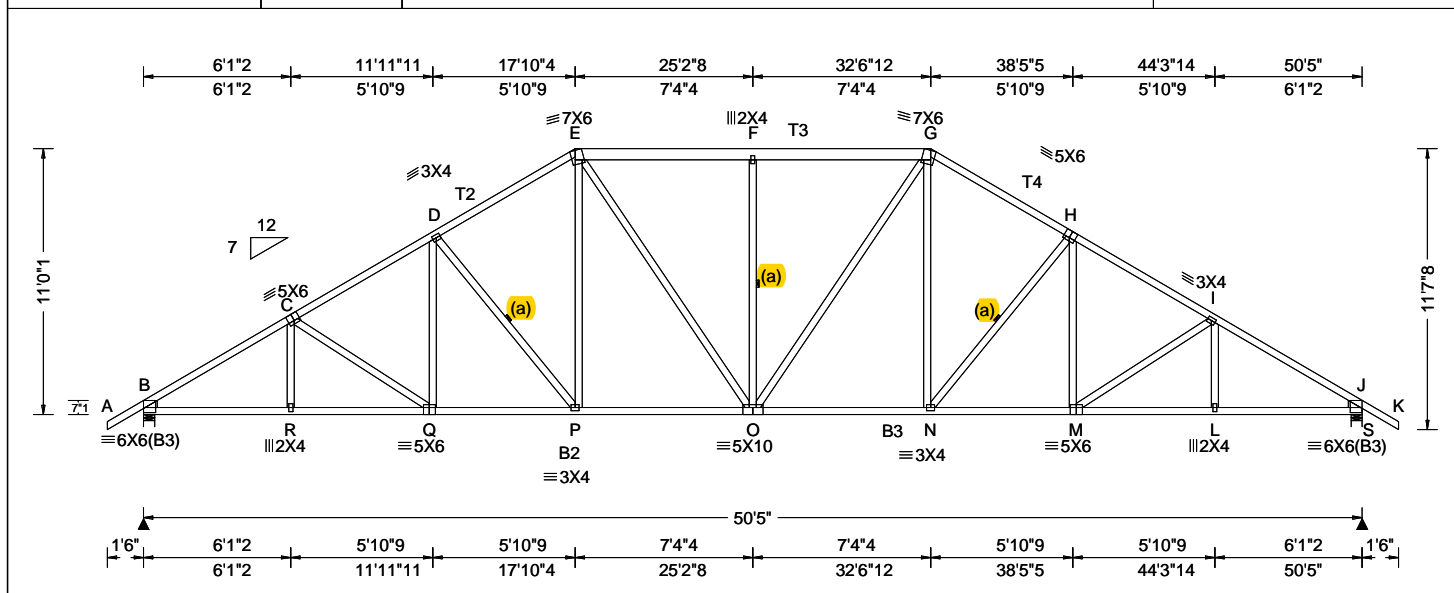

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.218 F 999 240 VERT(CL): 0.448 F 999 180 HORZ(LL): 0.114 L - - HORZ(TL): 0.235 L - - Creep Factor: 2.0 Max TC CSI: 0.548 Max BC CSI: 0.845 Max Web CSI: 0.366 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2198 - / - /1323 /50 /340 S 2198 - / - /1323 /50 - /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 S Brg Width = 5.5 Min Req = 1.8 Bearings B & S are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 786 -3479 F - G 772 -2510 C - D 794 -3157 G - H 773 -2722 D - E 773 -2723 H - I 795 -3155 E - F 772 -2510 I - J 788 -3477


Lumber Top chord: 2x4 SP M-31; T2,T4 2x4 SP #2; T3 2x4 SP 2400f-2.0E; Bot chord: 2x4 SP M-31; B2,B3 2x4 SP #2; Webs: 2x4 SP #3; Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;	Bracing (a) Continuous lateral restraint equally spaced on member.	Purlins In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	Wind Wind loads based on MWFRS with additional C&C member design.	Additional Notes Refer to General Notes for additional information WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below. The overall height of this truss excluding overhang is 11'-0-1.	Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - R 2890 -559 O - N 2276 -355 R - Q 2890 -560 N - M 2645 -485 Q - P 2646 -464 M - L 2887 -575 P - O 2276 -345 L - J 2887 -574	Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. D - P 209 -594 O - G 410 -117 E - P 616 -140 G - N 615 -140 E - O 410 -117 N - H 208 -592 F - O 203 -521
--	--	---	---	--	---	--



FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2. For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org	 6750 Forum Drive Suite 305 Orlando FL, 32821
---	--

SEQN: 314431 FROM: CDM	HIPS Qty: 1	Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A03	Cust: R 215 JRef: 1WUT2150007 T14 DrwNo: 119.20.1032.32390 / YK 04/28/2020
---------------------------	----------------	------------------	---	--

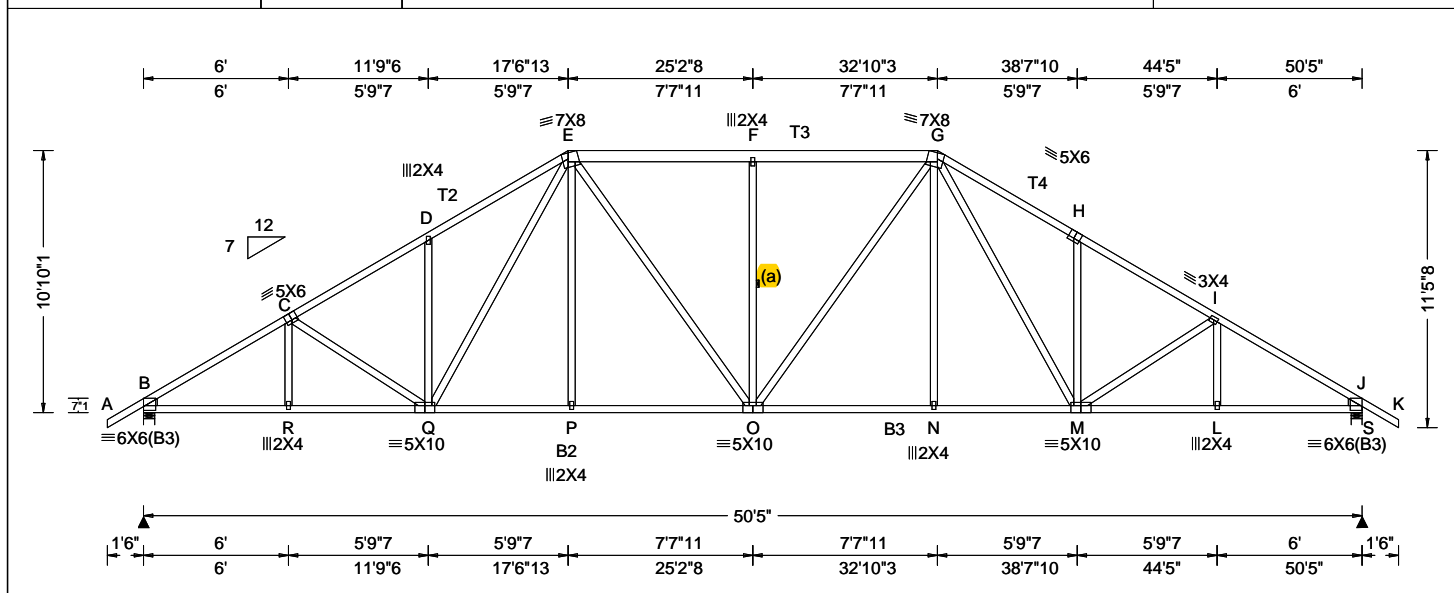

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)							
TCLL: 20.00		Wind Std: ASCE 7-10		Pg: NA Ct: NA CAT: NA		PP Deflection in loc L/defl L/#		Gravity			Non-Gravity				
TCDL: 10.00		Speed: 130 mph		Pf: NA Ce: NA		VERT(LL): 0.220 F 999 240		Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL	
BCLL: 0.00		Enclosure: Closed		Lu: NA Cs: NA		VERT(CL): 0.452 F 999 180		B	2198	/-	/-	/1322	/51	/336	
BCDL: 10.00		Risk Category: II		Snow Duration: NA		HORZ(LL): 0.111 L - -		S	2198	/-	/-	/1322	/51	/-	
Des Ld: 40.00		EXP: C Kzt: NA		Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE		HORZ(TL): 0.228 L - -		Wind reactions based on MWFRS							
NCBCLL: 10.00		Mean Height: 15.00 ft				Creep Factor: 2.0		B Brg Width = 5.5		Min Req = 1.8					
Soffit: 2.00		TCDL: 5.0 psf				Max TC CSI: 0.508		S Brg Width = 5.5		Min Req = 1.8					
Load Duration: 1.25		BCDL: 5.0 psf				Max BC CSI: 0.865		Bearings B & S are a rigid surface.							
Spacing: 24.0 "		MWFRS Parallel Dist: h to 2h				Max Web CSI: 0.723		Members not listed have forces less than 375#							
		C&C Dist a: 5.04 ft						Maximum Top Chord Forces Per Ply (lbs)							
		Loc. from endwall: not in 13.00 ft						Chords		Tens.Comp.		Chords		Tens. Comp.	
		GCpi: 0.18													
		Wind Duration: 1.60						VIEW Ver: 18.02.01B.0321.08		B - C		788 -3479		F - G 781 -2552	


Lumber
 Top chord: 2x4 SP M-31; T2,T4 2x4 SP #2;
 T3 2x6 SP 2400f-2.0E;
 Bot chord: 2x4 SP M-31; B2,B3 2x4 SP #2;
 Webs: 2x4 SP #3;
 Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Bracing
 (a) Continuous lateral restraint equally spaced on member.

Purlins
 In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
 Wind loads based on MWFRS with additional C&C member design.

Additional Notes
 Refer to General Notes for additional information
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 The overall height of this truss excluding overhang is 10'-10-1.

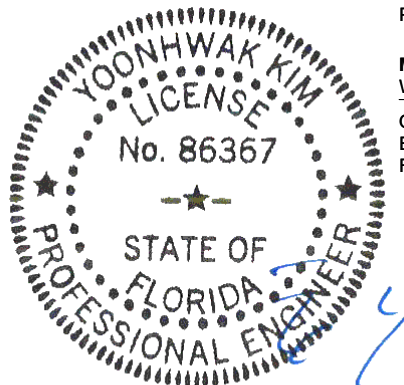


FL REG# 278, Yoonhwak Kim, FL PE #86367
 04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
 AN ITW COMPANY
 6750 Forum Drive
 Suite 305
 Orlando FL, 32821

SEQN: 314432 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A04	Cust: R 215 JRRef: 1WUT2150007 T20 DrwNo: 119.20.1032.34243 / YK 04/28/2020
---------------------------	--------------------------	---	---

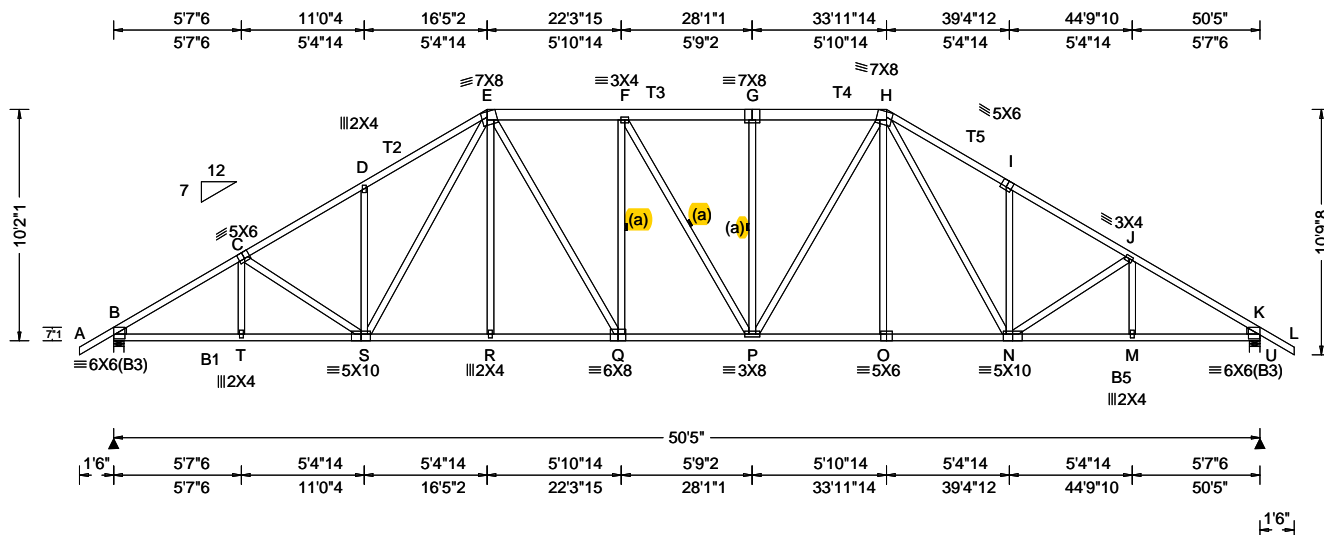

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)		Defl/CSI Criteria		▲ Maximum Reactions (lbs)										
TCLL:	20.00	Wind Std: ASCE 7-10		Pg: NA	Ct: NA	CAT: NA	PP Deflection in	loc	L/defl	L/#	Gravity			Non-Gravity				
TCDL:	10.00	Speed: 130 mph		Pf: NA		Ce: NA	VERT(LL):	0.222	F	999	240	Loc	R+	/ R-	/ Rh	/ Rw	/ U	/ RL
BCLL:	0.00	Enclosure: Closed		Lu: NA	Cs: NA		VERT(CL):	0.457	F	999	180	B	2198	-/-	-/-	/1316	/56	/317
BCDL:	10.00	Risk Category: II		Snow Duration: NA			HORZ(LL):	0.113	M	-	-	U	2198	-/-	-/-	/1316	/56	-/-
Des Ld:	40.00	EXP: C	Kzt: NA				HORZ(TL):	0.233	M	-	-	Wind reactions based on MWFRS						
NCBCLL:	10.00	Mean Height: 15.00 ft					Creep Factor:	2.0				B	Brg Width = 5.5			Min Req = 1.8		
Soffit:	2.00	TCDL: 5.0 psf					Max TC CSI:	0.467				U	Brg Width = 5.5			Min Req = 1.8		
Load Duration:	1.25	BCDL: 5.0 psf					Max BC CSI:	0.714				Bearings B & U are a rigid surface.						
Spacing:	24.0 "	MWFRS Parallel Dist: h to 2h					Max Web CSI:	0.589				Members not listed have forces less than 375#						
		C&C Dist a: 5.04 ft										Maximum Top Chord Forces Per Ply (lbs)						
		Loc. from endwall: not in 13.00 ft										Chords	Tens.Comp.		Chords	Tens. Comp.		
		GCpi: 0.18																
		Wind Duration: 1.60																

Lumber

Top chord: 2x4 SP M-31; T2,T5 2x4 SP #2; T3, T4 2x6 SP 2400f-2.0E;
 Bot chord: 2x4 SP #2; B1,B5 2x4 SP M-31;
 Webs: 2x4 SP #3;
 Lt Wedge: 2x4 SP #3; Rt Wedge: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Purlins


In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
 WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
 The overall height of this truss excluding overhang is 10'-2".

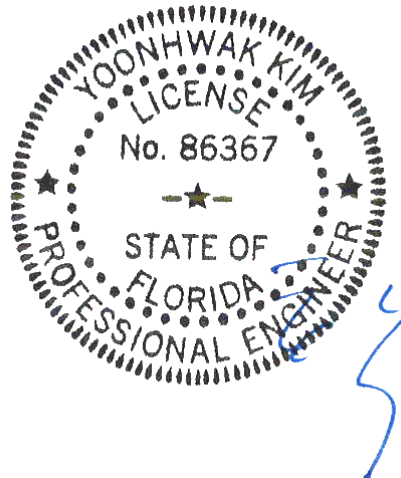


FL REG# 278, Yoonhwak Kim, FL PE #86367
 04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
 AN ITW COMPANY
 6750 Forum Drive
 Suite 305
 Orlando FL, 32821

SEQN: 314433 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A05	Cust: R 215 JRRef: 1WUT2150007 T16 DrwNo: 119.20.1032.35797 / YK 04/28/2020
---------------------------	--------------------------	---	---

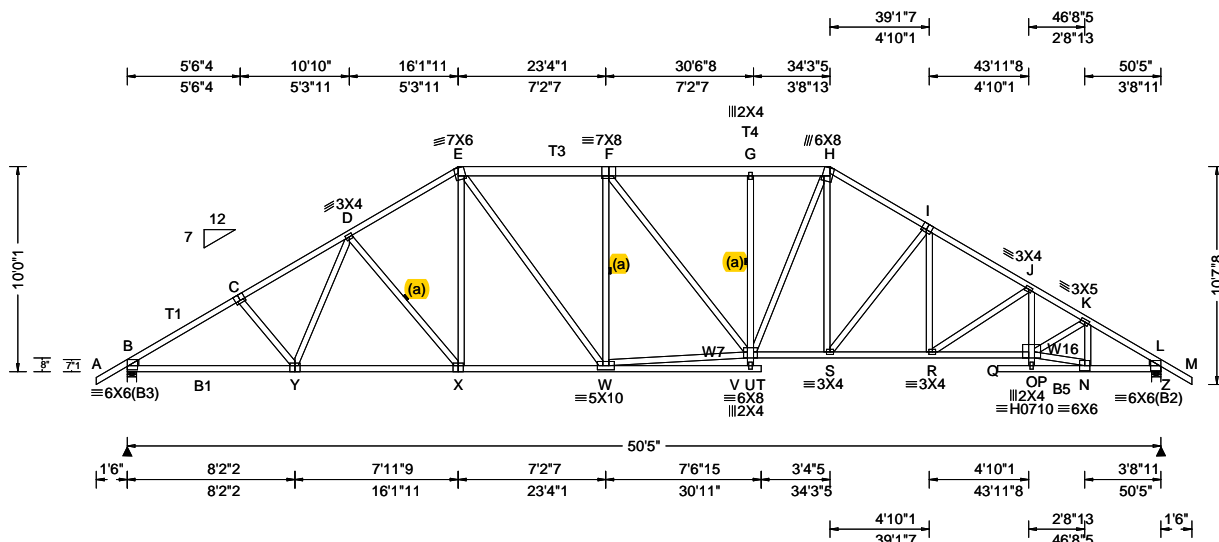

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.261 G 999 240 VERT(CL): 0.537 G 999 180 HORZ(LL): 0.140 N - - HORZ(TL): 0.288 N - - Creep Factor: 2.0 Max TC CSI: 0.972 Max BC CSI: 0.912 Max Web CSI: 0.792 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL B 2198 - / - / - /1314 /58 /313 Z 2198 - / - / - /1315 /58 - /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 Z Brg Width = 5.5 Min Req = 1.8 Bearings B & Z are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 818 -3504 G - H 835 -2866 C - D 833 -3305 H - I 835 -3029 D - E 799 -2850 I - J 877 -3518 E - F 824 -2749 J - K 983 -4223 F - G 834 -2859 K - L 761 -3336

Lumber

Top chord: 2x4 SP #2; T1 2x4 SP M-31; T3, T4 2x6 SP 2400f-2.0E;
Bot chord: 2x4 SP #2; B1, B5 2x4 SP M-31;
Webs: 2x4 SP #3; W7, W16 2x4 SP #2;
Lt Wedge: 2x4 SP #3; Rt Wedge: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 5X6 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 10'-0".

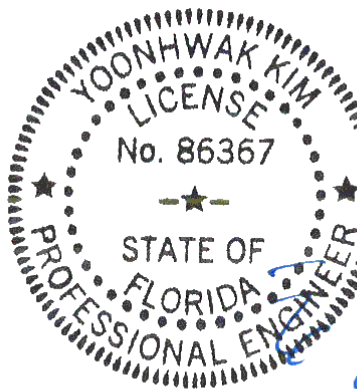


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314434 FROM: CDM	COMM Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A06	Cust: R 215 JRef: 1WUT2150007 T22 DrwNo: 119.20.1032.37830 / YK 04/28/2020
---------------------------	--------------------------	---	--

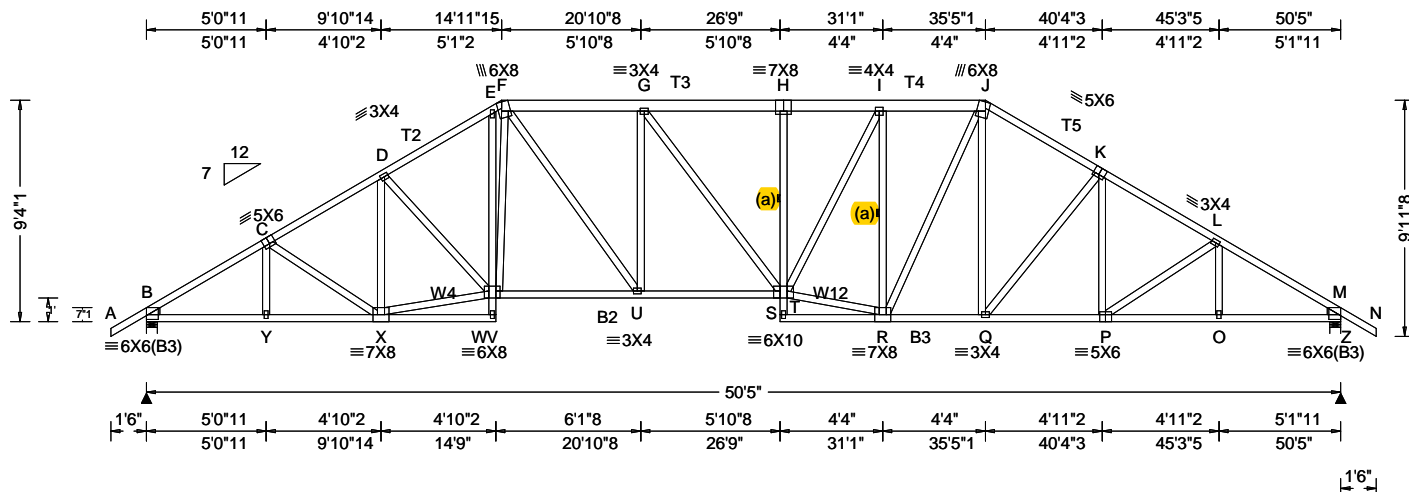

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.266 H 999 240 VERT(CL): 0.547 H 999 180 HORZ(LL): 0.139 O - - HORZ(TL): 0.286 O - - Creep Factor: 2.0 Max TC CSI: 0.528 Max BC CSI: 0.965 Max Web CSI: 0.689 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2198 - / - /1306 /113 /293 Z 2198 - / - /1306 /113 - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 Z Brg Width = 5.5 Min Req = 1.8 Bearings B & Z are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 802 -3457 H - I 940 -3351 C - D 826 -3263 I - J 824 -2779 D - E 890 -3358 J - K 815 -2913 E - F 901 -3133 K - L 827 -3255 F - G 910 -3221 L - M 804 -3456 G - H 940 -3356

Lumber

Top chord: 2x4 SP M-31; T2,T5 2x4 SP #2; T3, T4 2x6 SP 2400f-2.0E;
Bot chord: 2x4 SP M-31; B2,B3 2x4 SP #2;
Webs: 2x4 SP #3; W4,W12 2x4 SP #2;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 9'-4".

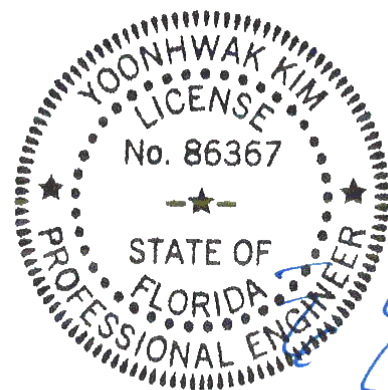

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314435 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A07	Cust: R 215 JRef: 1WUT2150007 T17 DrwNo: 119.20.1032.39607 / YK 04/28/2020
---------------------------	--------------------------	---	--

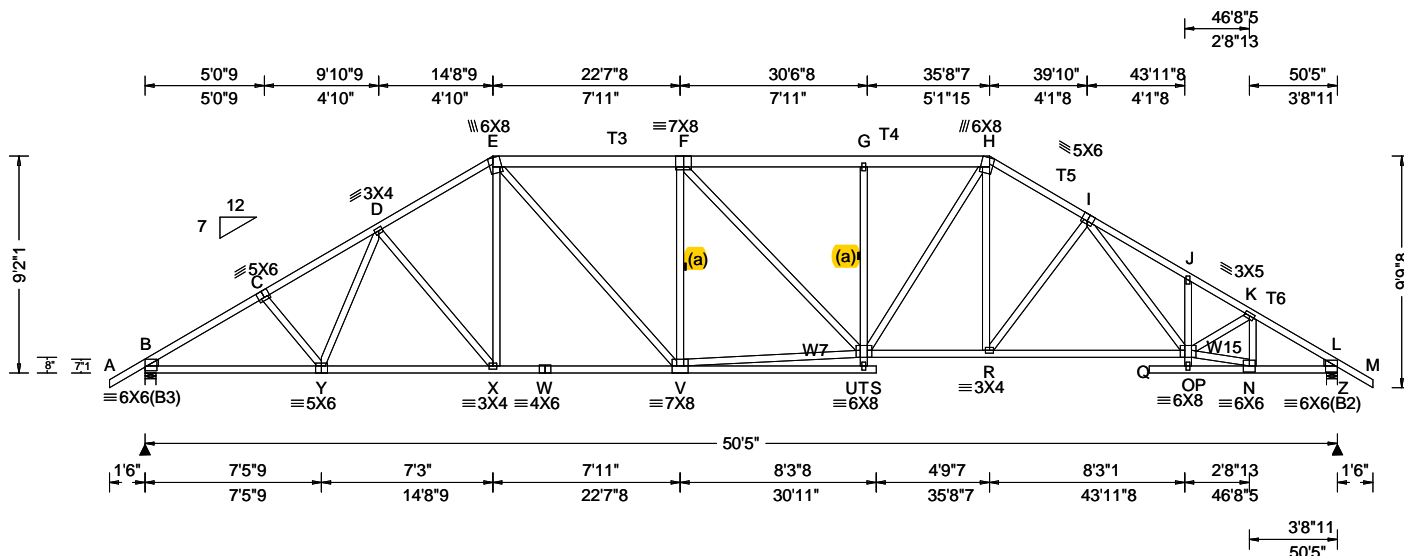

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.251 G 999 240 VERT(CL): 0.517 G 999 180 HORZ(LL): 0.125 N - - HORZ(TL): 0.256 N - - Creep Factor: 2.0 Max TC CSI: 0.971 Max BC CSI: 0.669 Max Web CSI: 0.652 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2198 - / - / - /1305 /116 /289 Z 2198 - / - / - /1306 /117 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 Z Brg Width = 5.5 Min Req = 1.8 Bearings B & Z are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 826 -3491 G - H 907 -3172 C - D 841 -3316 H - I 863 -3165 D - E 820 -2949 I - J 1080 -4302 E - F 880 -3003 J - K 999 -4227 F - G 905 -3164 K - L 774 -3338

Lumber
Top chord: 2x4 SP M-31; T3,T4 2x6 SP 2400F-2.0E;
T5,T6 2x4 SP #2;
Bot chord: 2x4 SP M-31;
Webs: 2x4 SP #3; W7,W15 2x4 SP #2;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;


Bracing
(a) Continuous lateral restraint equally spaced on member.

Plating Notes
All plates are 2X4 except as noted.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.

Additional Notes
Refer to General Notes for additional information
WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.
The overall height of this truss excluding overhang is 9'-2-1/2".

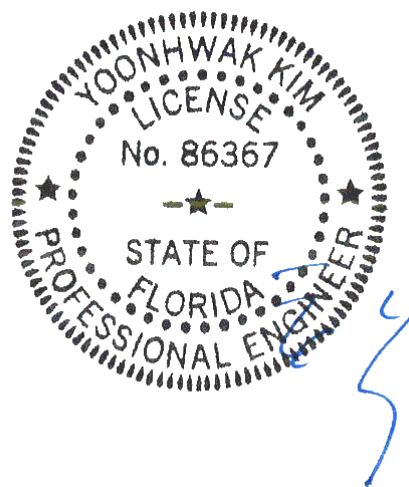


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCEA: www.sbceaindust.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314436 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A08	Cust: R 215 JRef: 1WUT2150007 T12 DrwNo: 119.20.1032.41493 / YK 04/28/2020
---------------------------	--------------------------	---	--

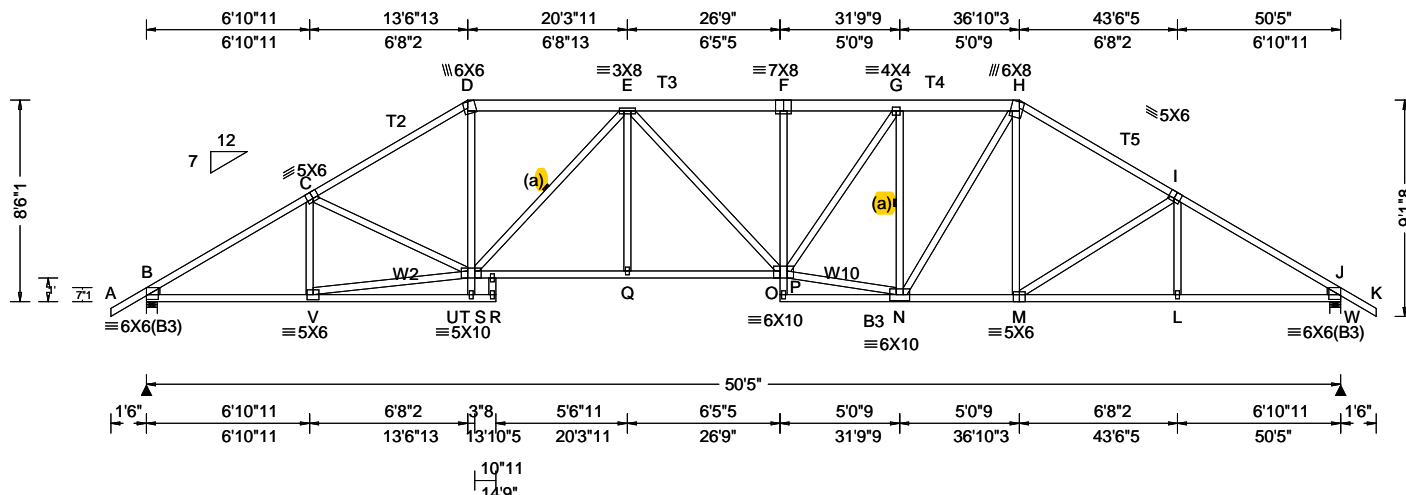

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.290 F 999 240 VERT(CL): 0.596 F 999 180 HORZ(LL): 0.146 L - - HORZ(TL): 0.301 L - - Creep Factor: 2.0 Max TC CSI: 0.714 Max BC CSI: 0.731 Max Web CSI: 0.723 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 2198 - / - / - /1296 /123 /270 W 2198 - / - / - /1296 /123 - / - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 W Brg Width = 5.5 Min Req = 1.8 Bearings B & W are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 835 -3491 F - G 1035 -3758 C - D 906 -3494 G - H 878 -3020 D - E 840 -2971 H - I 829 -3064 E - F 1036 -3765 I - J 831 -3482

Lumber

Top chord: 2x4 SP M-31; T2,T5 2x4 SP #2; T3, T4 2x6 SP 2400f-2.0E;
Bot chord: 2x4 SP M-31; B3 2x4 SP #2;
Webs: 2x4 SP #3; W2,W10 2x4 SP #2;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 8-6-1.

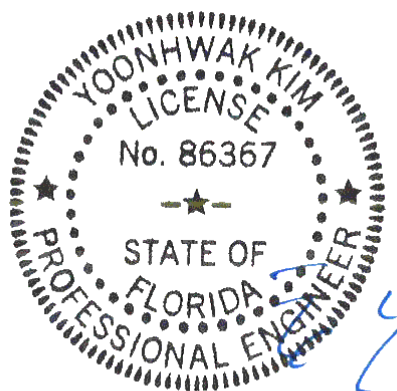

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314437 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A09	Cust: R 215 JRRef: 1WUT2150007 T36 DrwNo: 119.20.1032.45173 / YK 04/28/2020
---------------------------	--------------------------	---	---

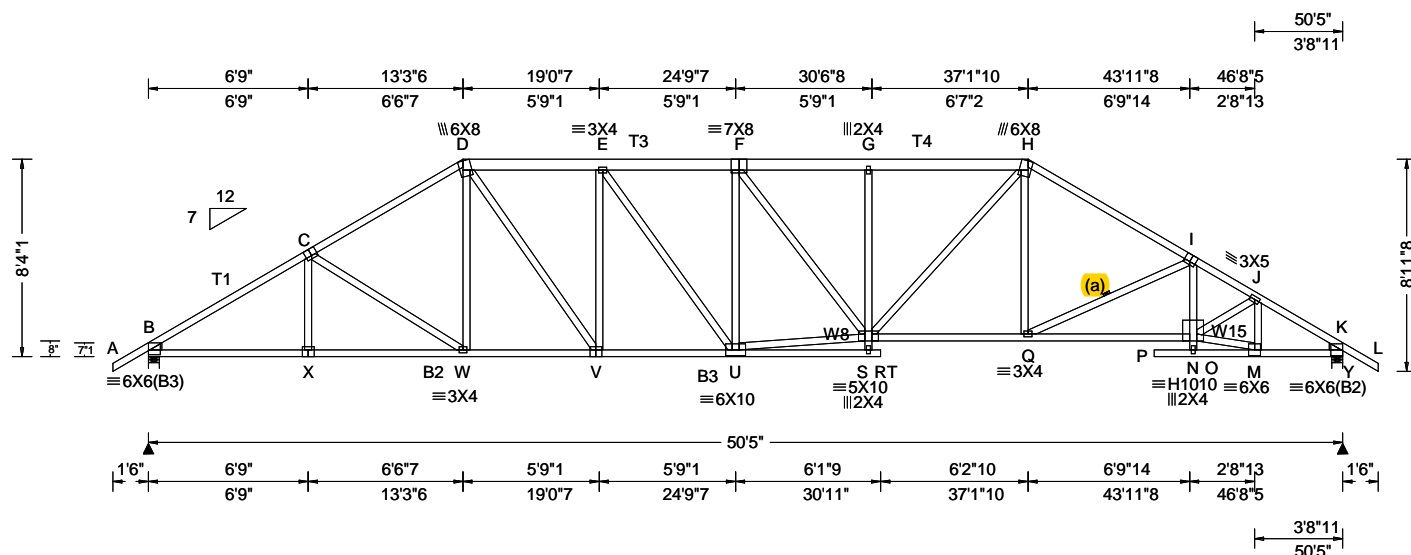

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.275 F 999 240 VERT(CL): 0.567 F 999 180 HORZ(LL): 0.139 M - - HORZ(TL): 0.287 M - - Creep Factor: 2.0 Max TC CSI: 0.974 Max BC CSI: 0.830 Max Web CSI: 0.768 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2198 -/- /- /1294 /125 /266 Y 2198 -/- /- /1296 /126 -/- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 Y Brg Width = 5.5 Min Req = 1.8 Bearings B & Y are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 837 -3486 G - H 990 -3537 C - D 833 -3083 H - I 878 -3371 D - E 900 -3107 I - J 1028 -4235 E - F 949 -3319 J - K 784 -3331 F - G 988 -3529

Lumber

Top chord: 2x4 SP #2; T1 2x4 SP M-31; T3, T4 2x6 SP 2400f-2.0E;
Bot chord: 2x4 SP M-31; B2,B3 2x4 SP #2;
Webs: 2x4 SP #3; W8,W15 2x4 SP #2;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 5X6 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 8-4-1.

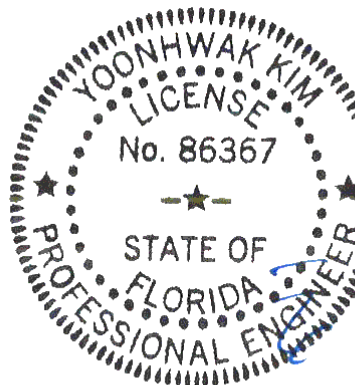


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314438 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A10	Cust: R 215 JRRef: 1WUT2150007 T5 DrwNo: 119.20.1032.47747 / YK 04/28/2020
---------------------------	--------------------------	---	--

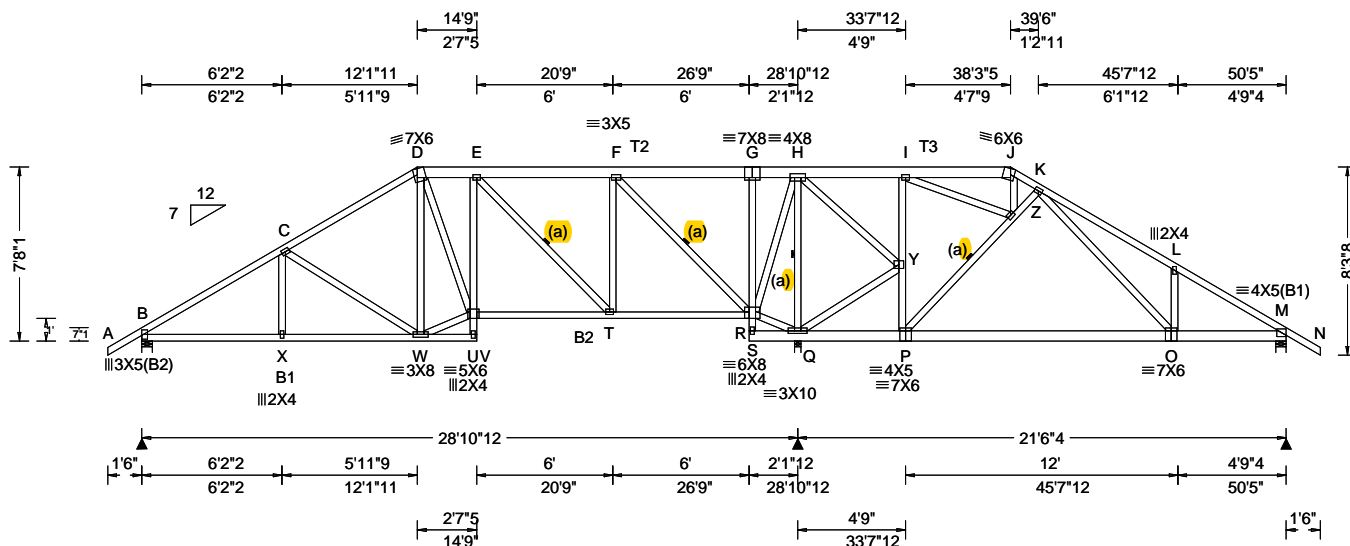

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.051 U 999 240 VERT(CL): 0.109 U 999 180 HORZ(LL): 0.021 O - - HORZ(TL): 0.048 R - - Creep Factor: 2.0 Max TC CSI: 0.502 Max BC CSI: 0.578 Max Web CSI: 0.642 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1019 -/- /- /644 /50 /246 Q 2850 -/- /- /1499 /190 /- M 725 -/- /- /485 /102 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 Q Brg Width = 3.5 Min Req = 2.0 M Brg Width = 5.5 Min Req = 1.5 Bearings B, Q, & M are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2; T2,T3 2x6 SP 2400f-2.0E;
Bot chord: 2x6 SP 2400f-2.0E; B1,B2 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 3X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 7-8-1.

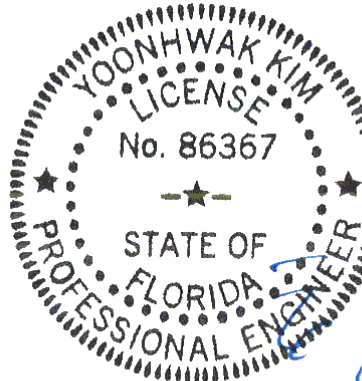

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - X	1073 -172	Q - P	232 -629
X - W	1071 -173	O - M	699 -81
U - T	731 -115		

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
C - W	168 -459	H - Y	976 -210
W - U	771 -126	Q - Y	193 -893
E - T	178 -796	Y - I	147 -395
T - F	712 -107	Y - P	745 -123
F - R	375 -1585	P - Z	224 -767
R - H	779 -117	Z - K	240 -535
R - Q	446 -1436	K - O	666 -169
H - Q	325 -1519		

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314439	HIPS	Ply: 1	Job Number: 20-4111	Cust: R 215 JRef: 1WUT2150007 T8
FROM: CDM		Qty: 1	/Jerri & Paula Payne /ZECHER CONSTRUCTION	DrwNo: 119.20.1032.50927
			Truss Label: A11	/ YK 04/28/2020

Lumber

Bracing

Plating Notes


Purlins

Wind

Additional Notes

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 7-6-1.

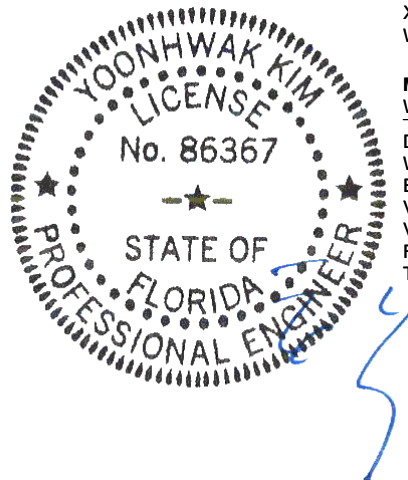

▲ Maximum Reactions (lbs)					
Loc	Gravity		Non-Gravity		
	R+	/ R-	/ Rh	/ Rw	/ U / RL
B	2198	/-	/-	/1282	/134 /242
Z	2198	/-	/-	/1283	/135 /-
Wind reactions based on MWFRS					
B	Brg Width = 5.5		Min Req = 1.8		
Z	Brg Width = 5.5		Min Req = 1.8		
Bearings B & Z are a rigid surface.					
Members not listed have forces less than 375#					
Maximum Top Chord Forces Per Ply (lbs)					
Chords	Tens.Comp.		Chords	Tens. Comp.	
B - C	845	-3475	G - H	1094	-3997
C - D	854	-3166	H - I	840	-2969
D - E	967	-3400	I - J	908	-3475
E - F	1039	-3710	J - K	1041	-4224
F - G	1092	-3985	K - L	797	-3335

Maximum Web Forces Per Ply (lbs)					
Webs	Tens.Comp.		Webs	Tens. Comp.	
D - W	1120	-294	H - R	311	-1086
W - E	246	-738	R - I	1371	-324
E - V	433	-106	R - J	254	-841
V - F	201	-676	J - O	522	-89
V - T	3627	-762	O - N	2736	-597
F - T	382	-72	O - K	1069	-229
T - H	858	-201	N - K	246	-1014

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. **A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown.** The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org




SEQN: 314440 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A12	Cust: R 215 JRRef: 1WUT2150007 T24 DrwNo: 119.20.1032.53487 / YK 04/28/2020
---------------------------	--------------------------	---	---

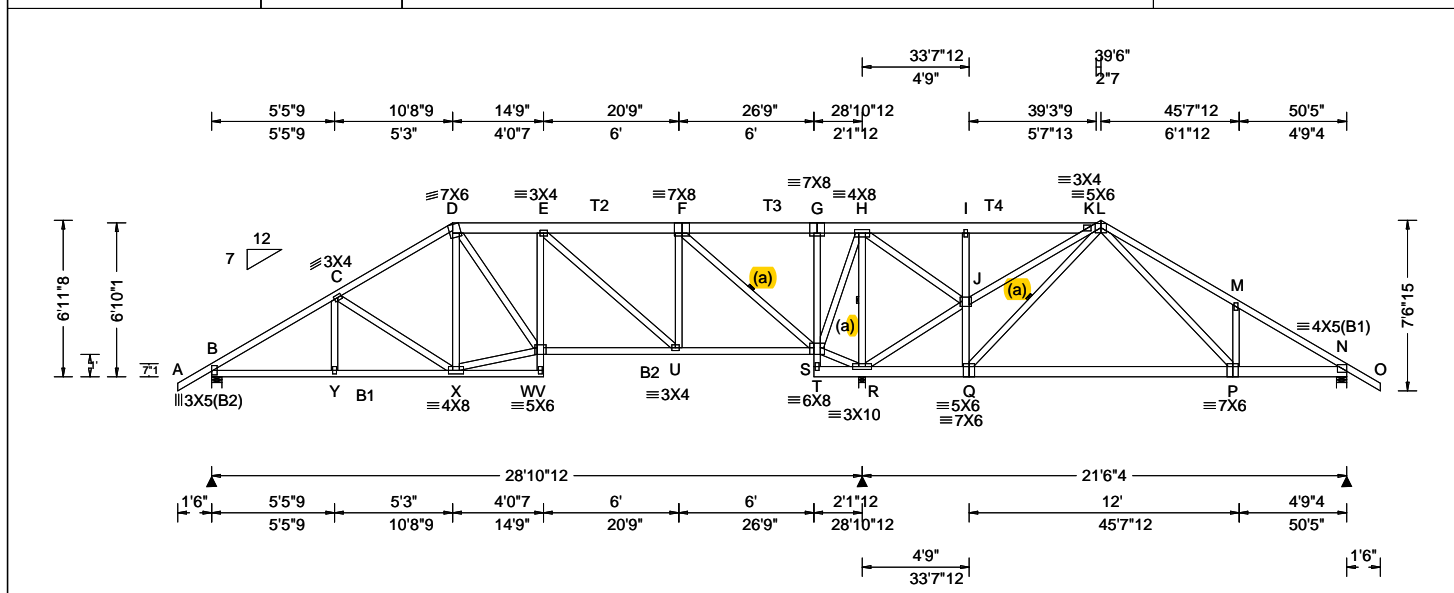

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.056 V 999 240 VERT(CL): 0.121 V 999 180 HORZ(LL): 0.026 P - - HORZ(TL): 0.055 S - - Creep Factor: 2.0 Max TC CSI: 0.510 Max BC CSI: 0.656 Max Web CSI: 0.998 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1067 -/- /- /661 /93 /226 R 2735 -/- /- /1428 /376 -/ N 756 -/- /- /508 /81 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 R Brg Width = 3.5 Min Req = 1.9 N Brg Width = 5.5 Min Req = 1.5 Bearings B, R, & N are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber	Maximum Bot Chord Forces Per Ply (lbs)
Top chord: 2x4 SP #2; T2,T3, T4 2x6 SP 2400f-2.0E; Bot chord: 2x6 SP 2400f-2.0E; B1,B2 2x4 SP #2; Webs: 2x4 SP #3;	Chords Tens.Comp. Chords Tens. Comp. B - C 350 -1444 H - I 628 -74 C - D 336 -1075 I - K 631 -78 D - E 341 -977 K - L 400 -77 E - F 201 -430 L - M 279 -941 F - G 961 -105 M - N 163 -939 G - H 963 -105


Bracing	Maximum Web Forces Per Ply (lbs)
(a) Continuous lateral restraint equally spaced on member.	Chords Tens.Comp. Chords Tens. Comp. B - Y 1160 -190 U - S 399 -64 Y - X 1159 -190 R - Q 181 -479 V - U 975 -126 P - N 751 -66
Plating Notes	
All plates are 2X4 except as noted.	
Purlins	
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	
Wind	
Wind loads based on MWFRS with additional C&C member design.	
Additional Notes	
Refer to General Notes for additional information WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below. The overall height of this truss excluding overhang is 6-11-8.	

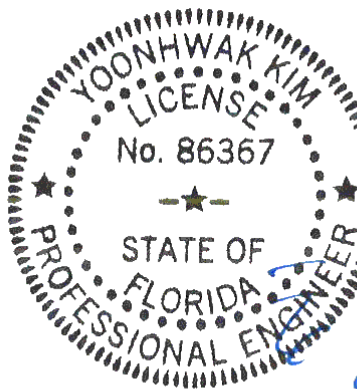

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2. For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org
ALPINE AN ITW COMPANY 6750 Forum Drive Suite 305 Orlando FL, 32821

SEQN: 314441 FROM: CDM	HIPS Qty: 1	Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: A13	Cust: R 215 JRRef: 1WUT2150007 T1 DrwNo: 119.20.1032.55910 / YK 04/28/2020
---------------------------	----------------	------------------	--	--

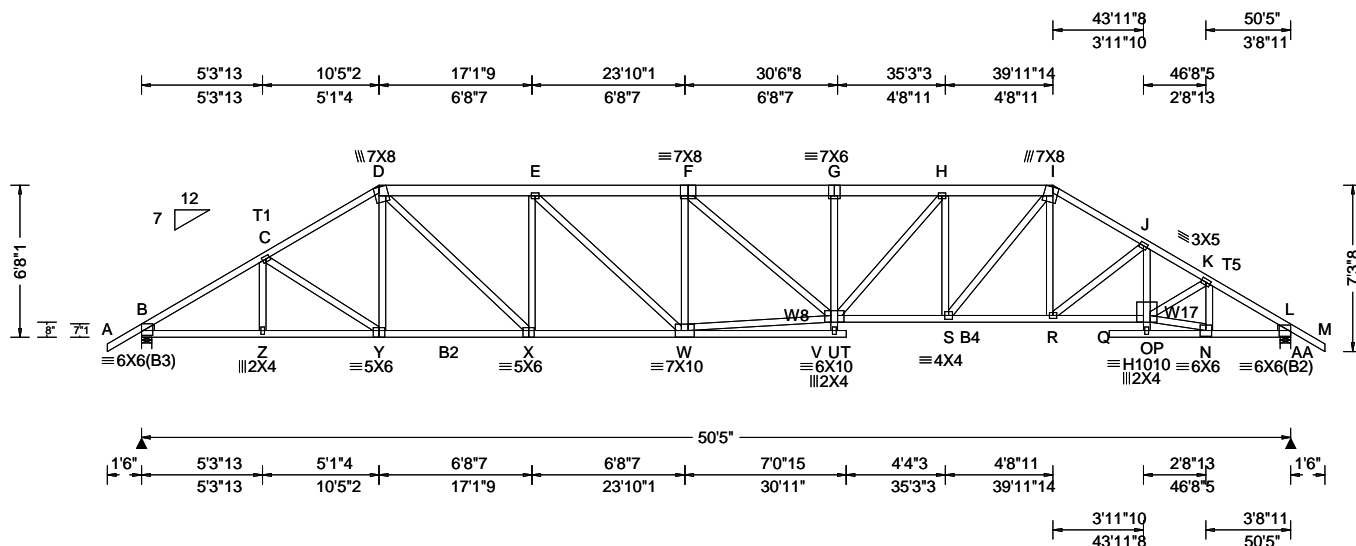

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.338 G 999 240 VERT(CL): 0.696 G 868 180 HORZ(LL): 0.154 N - - HORZ(TL): 0.316 N - - Creep Factor: 2.0 Max TC CSI: 0.971 Max BC CSI: 0.946 Max Web CSI: 0.917 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 2198 -/- /- /1268 /141 /219 AA 2198 -/- /- /1270 /142 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 AA Brg Width = 5.5 Min Req = 1.8 Bearings B & AA are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 853 -3458 G - H 1239 -4604 C - D 872 -3246 H - I 1069 -3908 D - E 1050 -3760 I - J 949 -3588 E - F 1152 -4198 J - K 1055 -4218 F - G 1235 -4585 K - L 812 -3338

Lumber

Top chord: 2x6 SP 2400F-2.0E; T1 2x4 SP M-31;
T5 2x4 SP #2;
Bot chord: 2x4 SP M-31; B2,B4 2x4 SP #2;
Webs: 2x4 SP #3; W8,W17 2x4 SP #2;
Lt Wedge: 2x4 SP #3;Rt Wedge: 2x4 SP #3;

Plating Notes

All plates are 3X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C
member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the
installation contractor. Special care must be taken
during handling, shipping and installation of trusses.
See "WARNING" note below.

The overall height of this truss excluding overhang is
6-8-1.

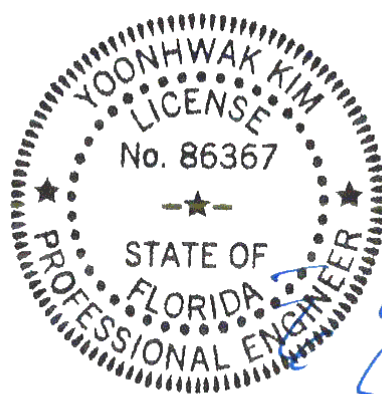


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314442 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A14	Cust: R 215 JRRef: 1WUT2150007 T10 DrwNo: 119.20.1032.58037 / YK 04/28/2020
---------------------------	--------------------------	---	---

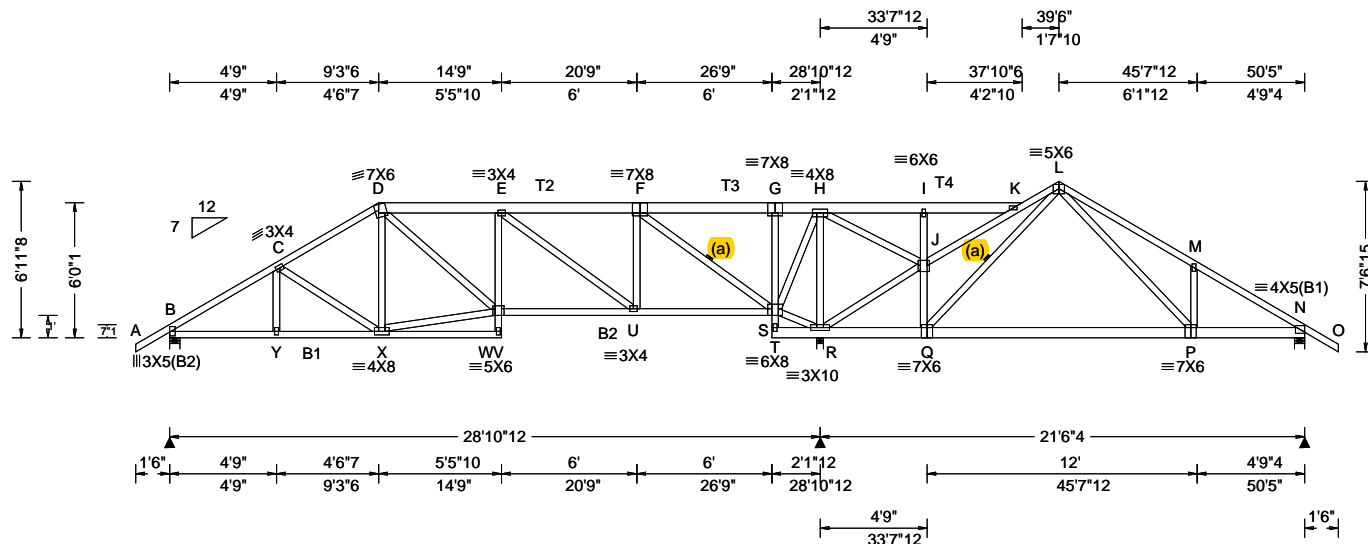

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.066 V 999 240 VERT(CL): 0.146 V 999 180 HORZ(LL): 0.032 L - - HORZ(TL): 0.072 L - - Creep Factor: 2.0 Max TC CSI: 0.525 Max BC CSI: 0.735 Max Web CSI: 0.902 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1129 -/- /- /683 /194 /226 R 2617 -/- /- /1341 /465 -/ N 780 -/- /- /526 /117 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 R Brg Width = 3.5 Min Req = 1.8 N Brg Width = 5.5 Min Req = 1.5 Bearings B, R, & N are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2; T2,T3,
T4 2x6 SP 2400f-2.0E;
Bot chord: 2x6 SP 2400f-2.0E; B1,B2 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 2X4 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 6-11-8.

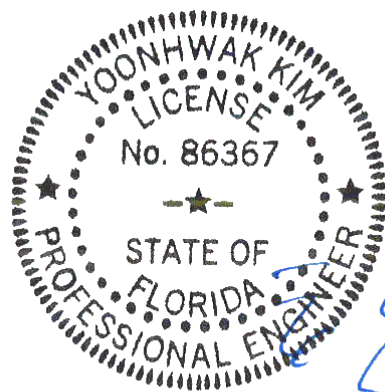

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - Y	1260 -211	U - S	748 -94
Y - X	1260 -212	R - Q	185 -504
V - U	1369 -196	P - N	787 -71

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
D - V	400 -96	H - R	276 -1363
X - V	1056 -132	H - J	970 -183
E - U	224 -821	R - J	296 -1053
U - F	631 -110	J - Q	752 -79
F - S	429 -1693	Q - L	157 -726
S - H	858 -131	L - P	662 -189
S - R	493 -1286		


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBICA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBICA: www.sbicaindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314443 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: A15	Cust: R 215 JRRef: 1WUT2150007 T3 DrwNo: 119.20.1033.01623 / YK 04/28/2020
---------------------------	--------------------------	--	--

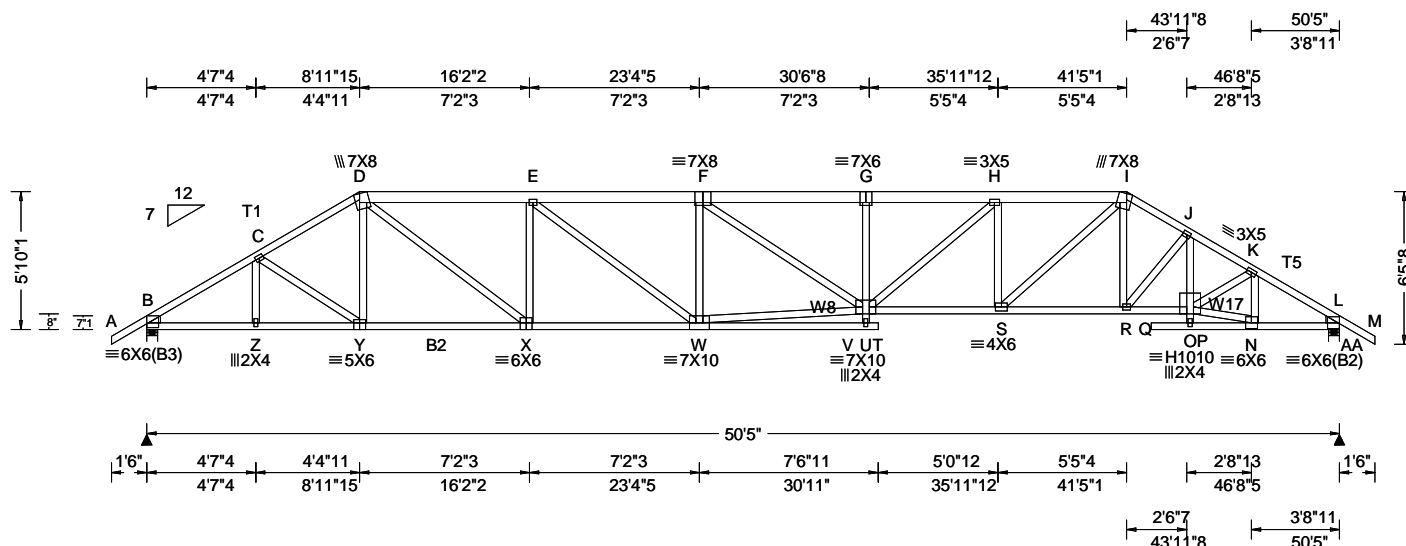

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.04 ft Loc. from endwall: not in 13.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.373 G 999 240 VERT(CL): 0.768 G 786 180 HORZ(LL): 0.145 N - - HORZ(TL): 0.299 N - - Creep Factor: 2.0 Max TC CSI: 0.970 Max BC CSI: 0.855 Max Web CSI: 0.663 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 2198 -/- /- /1253 /398 /195 AA 2198 -/- /- /1255 /399 -/- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 AA Brg Width = 5.5 Min Req = 1.8 Bearings B & AA are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 856 -3427 G - H 1436 -5430 C - D 889 -3320 H - I 1202 -4468 D - E 1157 -4213 I - J 988 -3720 E - F 1302 -4835 J - K 1067 -4212 F - G 1431 -5407 K - L 827 -3339


Lumber
Top chord: 2x6 SP 2400F-2.0E; T1 2x4 SP M-31;
T5 2x4 SP #2;
Bot chord: 2x4 SP M-31; B2 2x4 SP #2;
Webs: 2x4 SP #3; W8 2x4 SP M-31; W17 2x4 SP #2;
Lt Wedge: 2x4 SP #3; Rt Wedge: 2x4 SP #3;

Plating Notes
All plates are 3X4 except as noted.

Purlins
In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C
member design.

Additional Notes
Refer to General Notes for additional information
WARNING: Furnish a copy of this DWG to the
installation contractor. Special care must be taken
during handling, shipping and installation of trusses.
See "WARNING" note below.
The overall height of this truss excluding overhang is
5-10-1.

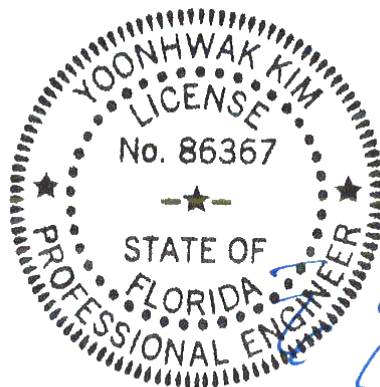


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314444 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHE CONSTRUCTION Truss Label: A16	Cust: R 215 JRRef: 1WUT2150007 T26 DrwNo: 119.20.1033.03920 / YK 04/28/2020
---------------------------	--------------------------	---	---

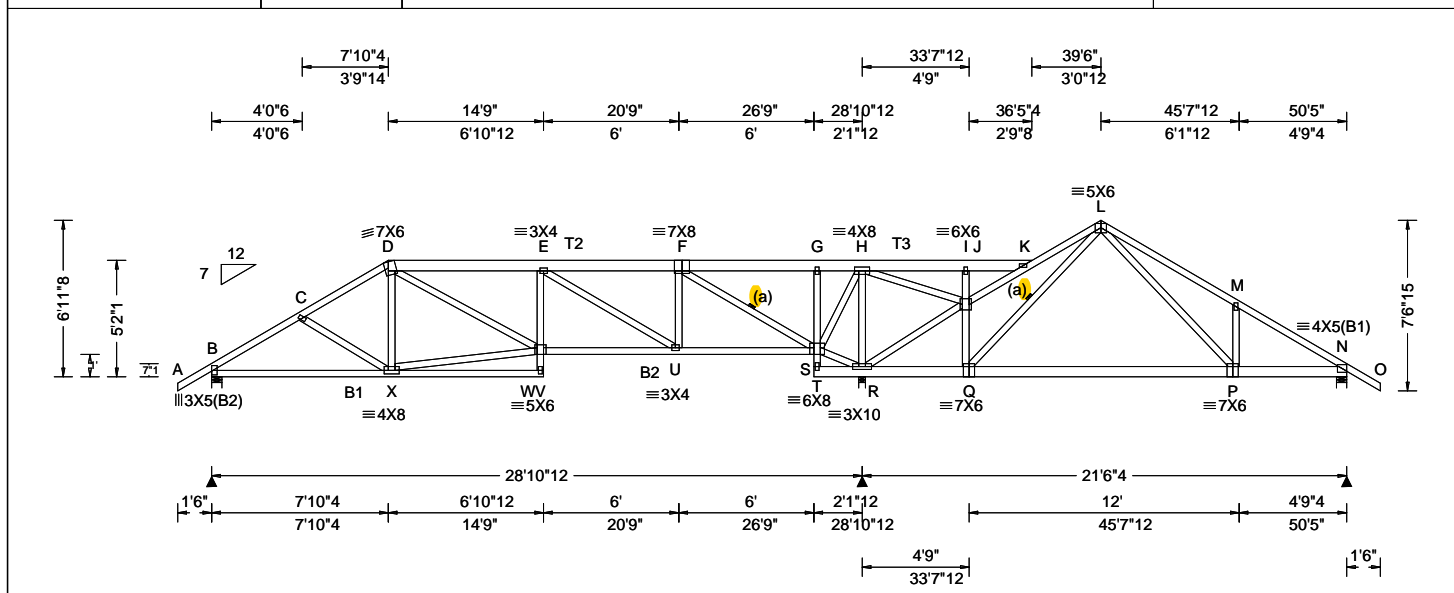

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.04 ft Loc. from endwall: not in 6.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.079 V 999 240 VERT(CL): 0.177 V 999 180 HORZ(LL): 0.035 L - - HORZ(TL): 0.079 L - - Creep Factor: 2.0 Max TC CSI: 0.648 Max BC CSI: 0.729 Max Web CSI: 0.938 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL B 1128 - / - / /671 /195 /226 R 2605 - / - / /1334 /465 - N 793 - / - / /524 /116 - Non-Gravity Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 R Brg Width = 3.5 Min Req = 1.8 N Brg Width = 5.5 Min Req = 1.5 Bearings B, R, & N are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber	Maximum Bot Chord Forces Per Ply (lbs)
Top chord: 2x4 SP #2; T2,T3 2x6 SP 2400f-2.0E; Bot chord: 2x6 SP 2400f-2.0E; B1,B2 2x4 SP #2; Webs: 2x4 SP #3;	Chords Tens.Comp. Chords Tens. Comp.
	B - C 383 -1559 G - H 979 -224 C - D 363 -1374 J - K 427 -360 D - E 442 -1684 K - L 684 -149 E - F 213 -942 L - M 284 -1003 F - G 978 -225 M - N 169 -1002


Bracing	Maximum Bot Chord Forces Per Ply (lbs)
(a) Continuous lateral restraint equally spaced on member.	Chords Tens.Comp. Chords Tens. Comp.
	B - X 1263 -242 R - Q 199 -601 V - U 1693 -280 P - N 805 -70 U - S 900 -141

Plating Notes	Maximum Web Forces Per Ply (lbs)
All plates are 2X4 except as noted.	Chords Tens.Comp. Chords Tens. Comp.
	D - V 603 -148 H - R 241 -1194 X - V 1119 -165 H - J 1067 -199 E - U 276 -966 R - J 318 -1196 U - F 627 -118 J - Q 805 -101 F - S 492 -1912 Q - L 185 -817 S - H 822 -137 L - P 653 -188 S - R 525 -1471

Purlins	Maximum Web Forces Per Ply (lbs)
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	Chords Tens.Comp. Chords Tens. Comp.
	D - V 603 -148 H - R 241 -1194 X - V 1119 -165 H - J 1067 -199 E - U 276 -966 R - J 318 -1196 U - F 627 -118 J - Q 805 -101 F - S 492 -1912 Q - L 185 -817 S - H 822 -137 L - P 653 -188 S - R 525 -1471

Wind	Maximum Web Forces Per Ply (lbs)
Wind loads based on MWFRS with additional C&C member design.	Chords Tens.Comp. Chords Tens. Comp.
	D - V 603 -148 H - R 241 -1194 X - V 1119 -165 H - J 1067 -199 E - U 276 -966 R - J 318 -1196 U - F 627 -118 J - Q 805 -101 F - S 492 -1912 Q - L 185 -817 S - H 822 -137 L - P 653 -188 S - R 525 -1471


Additional Notes	Maximum Web Forces Per Ply (lbs)
Refer to General Notes for additional information WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below. The overall height of this truss excluding overhang is 6-11-8.	Chords Tens.Comp. Chords Tens. Comp.
	D - V 603 -148 H - R 241 -1194 X - V 1119 -165 H - J 1067 -199 E - U 276 -966 R - J 318 -1196 U - F 627 -118 J - Q 805 -101 F - S 492 -1912 Q - L 185 -817 S - H 822 -137 L - P 653 -188 S - R 525 -1471

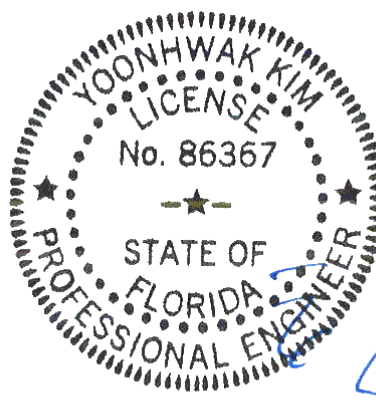

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!	ALPINE
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2. For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org	6750 Forum Drive Suite 305 Orlando FL, 32821

SEQN: 314445 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A17	Cust: R 215 JRRef: 1WUT2150007 T25 DrwNo: 119.20.1033.06660 / YK 04/28/2020
---------------------------	--------------------------	---	---

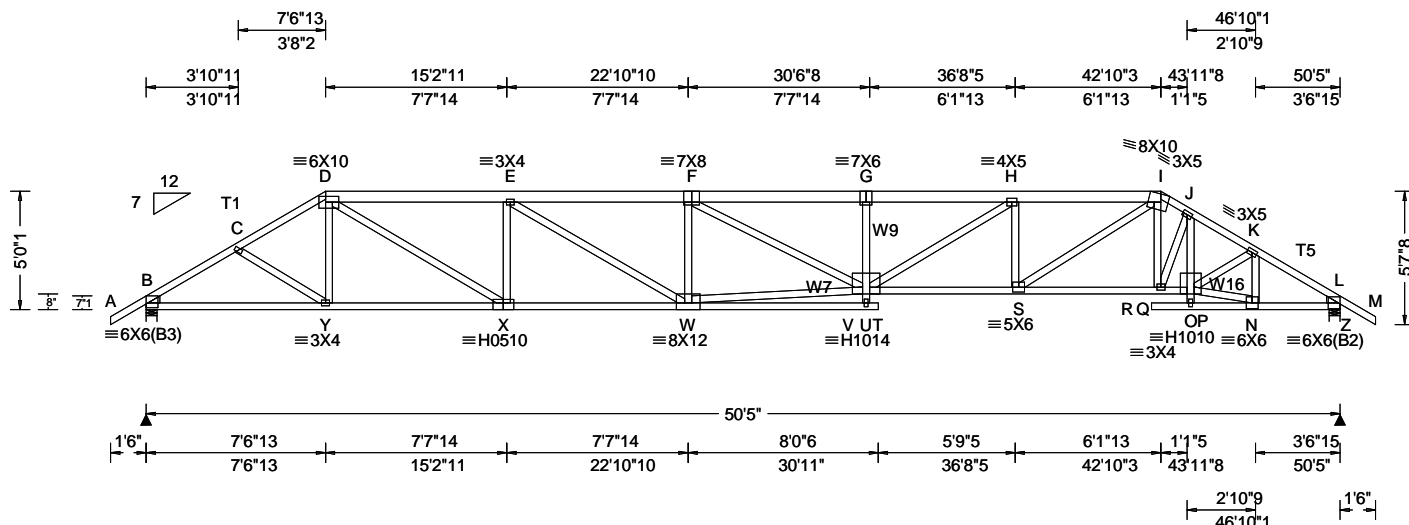

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.04 ft Loc. from endwall: not in 6.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.479 G 999 240 VERT(CL): 0.985 G 613 180 HORZ(LL): 0.157 N - - HORZ(TL): 0.323 N - - Creep Factor: 2.0 Max TC CSI: 0.970 Max BC CSI: 0.671 Max Web CSI: 0.857 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL B 2198 -/- /- /1238 /401 /172 Z 2198 -/- /- /1238 /401 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.8 Z Brg Width = 5.5 Min Req = 1.8 Bearings B & Z are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 888 -3460 G - H 1723 -6616 C - D 892 -3364 H - I 1389 -5245 D - E 1302 -4816 I - J 1025 -3856 E - F 1506 -5693 J - K 1075 -4210 F - G 1713 -6571 K - L 840 -3339

Lumber

Top chord: 2x6 SP 2400F-2.0E; T1 2x4 SP M-31;
T5 2x4 SP #2;
Bot chord: 2x4 SP M-31;
Webs: 2x4 SP #3; W7 2x4 SP M-31; W9,
W16 2x4 SP #2;
Lt Wedge: 2x4 SP #3; Rt Wedge: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

Purlins


In lieu of structural panels use purlins to brace all flat
TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C
member design.

Additional Notes

Refer to General Notes for additional information
WARNING: Furnish a copy of this DWG to the
installation contractor. Special care must be taken
during handling, shipping and installation of trusses.
See "WARNING" note below.
The overall height of this truss excluding overhang is
5'-0-1.

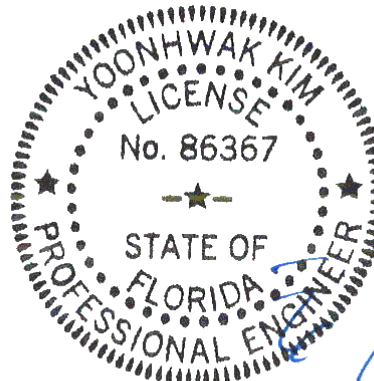


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314446 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: A18	Cust: R 215 JRRef: 1WUT2150007 T30 DrwNo: 119.20.1033.08933 / YK 04/28/2020
---------------------------	--------------------------	---	---

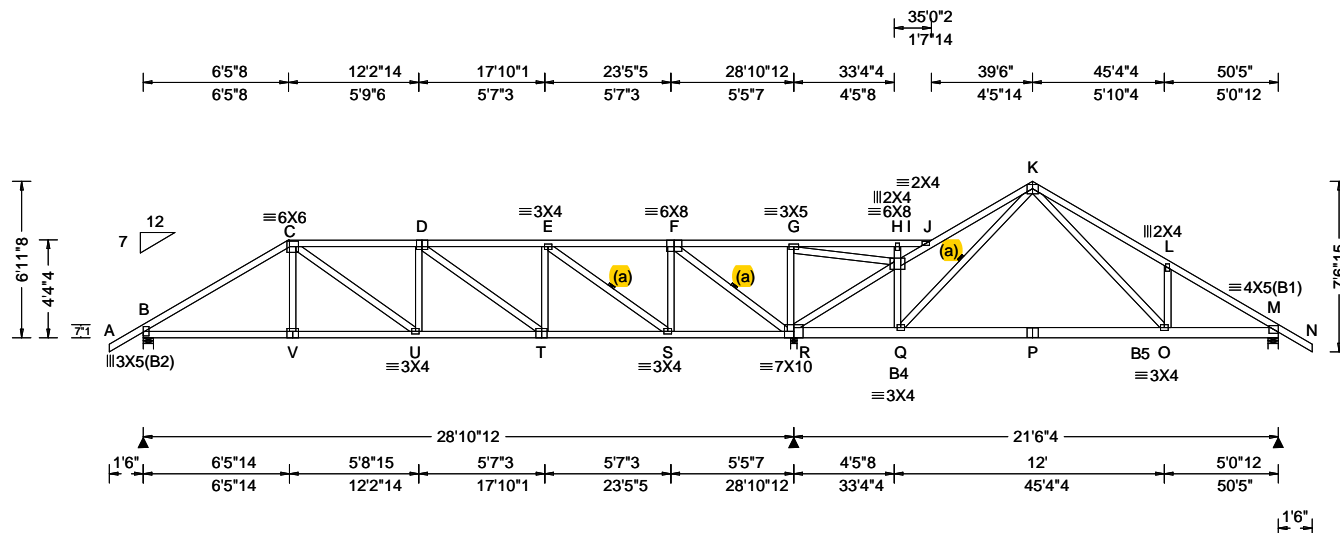

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.04 ft Loc. from endwall: not in 6.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.082 D 999 240 VERT(CL): 0.182 D 999 180 HORZ(LL): 0.030 O - - HORZ(TL): 0.063 K - - Creep Factor: 2.0 Max TC CSI: 0.710 Max BC CSI: 0.662 Max Web CSI: 0.832 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1144 -/- /- /568 /68 /226 R 2551 -/- /- /983 /41 -/ M 815 -/- /- /539 /147 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 R Brg Width = 3.5 Min Req = 2.5 M Brg Width = 5.5 Min Req = 1.5 Bearings B, R, & M are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2; B4,B5 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 5X6 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 6-11-8.

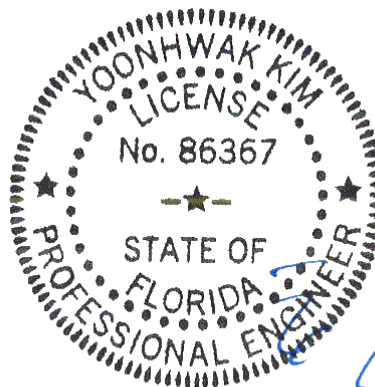

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.	Chords	Tens. Comp.
B - V	1250 -139	R - Q	155 -520
V - U	1253 -139	Q - P	396 -7
U - T	1637 -94	P - O	396 -7
T - S	1331 -87	O - M	838 -136
S - R	384 -144		


Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.	Webs	Tens. Comp.
C - U	460 -55	G - R	0 -525
D - T	43 -416	G - I	1066 0
T - E	410 -9	R - I	241 -1384
E - S	24 -1185	I - Q	754 0
S - F	828 0	Q - K	0 -740
F - R	0 -1935	K - O	640 -175

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314447 FROM: CDM	HIPS Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: A19	Cust: R 215 JRef: 1WUT2150007 T18 DrwNo: 119.20.1033.12457 / YK 04/28/2020
---------------------------	--------------------------	--	--

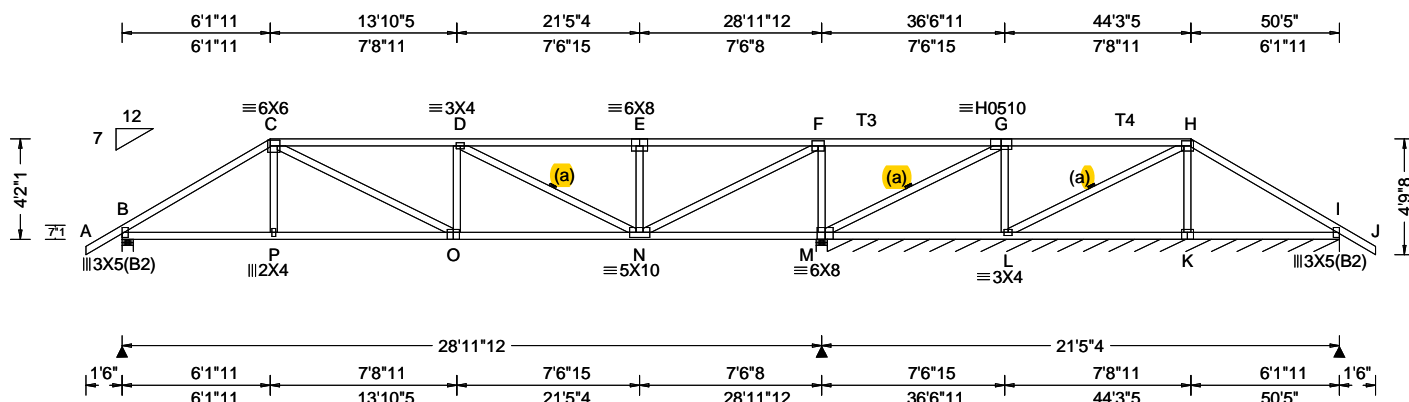

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 5.04 ft Loc. from endwall: not in 6.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE, HS	PP Deflection in loc L/defl L/# VERT(LL): 0.109 D 999 240 VERT(CL): 0.225 D 999 180 HORZ(LL): 0.030 C - - HORZ(TL): 0.061 C - - Creep Factor: 2.0 Max TC CSI: 0.758 Max BC CSI: 0.769 Max Web CSI: 0.858 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 1151 -/- /- /693 /213 /148 M 2123 -/- /- /1061 /398 -/ I* 63 -/- /- /33 /9 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 M Brg Width = 5.5 Min Req = 2.5 I Brg Width = 254 Min Req = - Bearings B, M, & M are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2; T3,T4 2x4 SP M-31;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Bracing

(a) Continuous lateral restraint equally spaced on member.

Plating Notes

All plates are 5X6 except as noted.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below.

The overall height of this truss excluding overhang is 4-2-1.

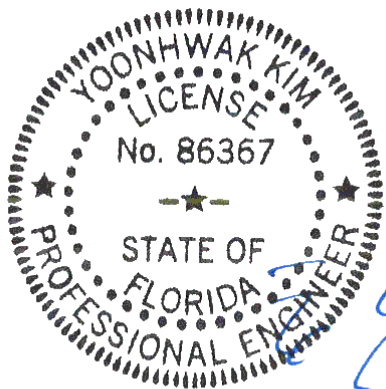


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

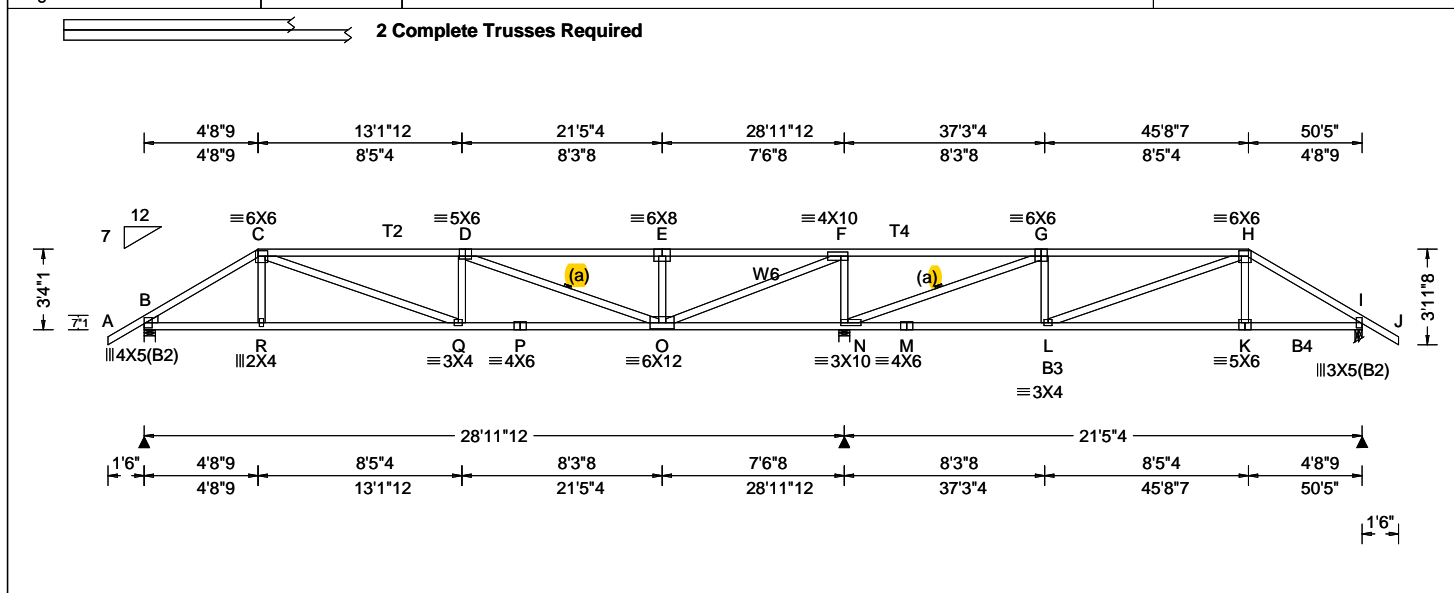

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 5.04 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: No FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.171 D 999 240 VERT(CL): 0.347 D 999 180 HORZ(LL): 0.044 K - - HORZ(TL): 0.089 K - - Creep Factor: 2.0 Max TC CSI: 0.989 Max BC CSI: 0.816 Max Web CSI: 1.000 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 2490 -/- /- /- /499 -/ N 6425 -/- /- /- /1281 -/ I 1521 -/- /- /- /299 -/ Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 N Brg Width = 5.5 Min Req = 2.3 I Brg Width = 3.5 Min Req = 1.5 Bearings B, N, & I are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber	
Top chord: 2x4 SP #2; T2,T4 2x4 SP M-31; Bot chord: 2x4 SP M-31; B3,B4 2x4 SP #2; Webs: 2x4 SP #3; W6 2x4 SP #2; Lt Wedge: 2x4 SP #3;	


Bracing		Maximum Bot Chord Forces Per Ply (lbs)
(a) Continuous lateral restraint equally spaced on member.		Chords Tens.Comp. Chords Tens. Comp.
		B - R 1724 -332 N - M 570 -96 R - Q 1736 -330 M - L 570 -96 Q - P 2679 -529 L - K 1013 -182 P - O 2679 -529 K - I 1000 -184 O - N 409 -2064

Nailnote		Maximum Web Forces Per Ply (lbs)
Nail Schedule: 0.131"x3", min. nails Top Chord: 1 Row @12.00" o.c. Bot Chord: 1 Row @12.00" o.c. Webs : 1 Row @ 4" o.c. Use equal spacing between rows and stagger nails in each row to avoid splitting.		Webs Tens.Comp. Webs Tens. Comp.
		C - Q 1003 -202 F - N 453 -1859 D - O 320 -1583 N - G 587 -2898 E - O 177 -484 G - L 487 -6 O - F 3489 -691 L - H 91 -511

Purlins	
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	

Wind	
Wind loads and reactions based on MWFRS.	

Additional Notes	
Refer to General Notes for additional information WARNING: Furnish a copy of this DWG to the installation contractor. Special care must be taken during handling, shipping and installation of trusses. See "WARNING" note below. The overall height of this truss excluding overhang is 3-4-1.	

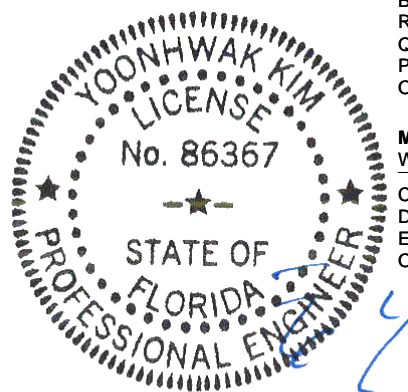


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

SEQN: 314448	HIPS	Ply: 2	Job Number: 20-4111	Cust: R 215 JRef: 1WUT2150007 T37
FROM: CDM		Qty: 1	/Jerri & Paula Payne /ZECHER CONSTRUCTION	DrwNo: 119.20.1033.29507
Page 2 of 2			Truss Label: A20	/ YK 04/28/2020

Special Loads

----- (Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)

TC: From 63 plf at -1.50 to 63 plf at 4.71
TC: From 32 plf at 4.71 to 32 plf at 45.71
TC: From 63 plf at 45.71 to 63 plf at 51.92
BC: From 5 plf at -1.50 to 5 plf at 0.00
BC: From 20 plf at 0.00 to 20 plf at 4.60
BC: From 10 plf at 4.60 to 10 plf at 45.81
BC: From 20 plf at 45.81 to 20 plf at 50.42
BC: From 5 plf at 50.42 to 5 plf at 51.92
TC: 361 lb Conc. Load at 4.60,45.81
TC: 187 lb Conc. Load at 6.63, 8.63,10.63,12.63
14.63,16.63,18.63,20.63,22.63,24.63,25.78,27.78
29.78,31.78,33.78,35.78,37.78,39.78,41.78,43.78
BC: 330 lb Conc. Load at 4.60,45.81
BC: 129 lb Conc. Load at 6.63, 8.63,10.63,12.63
14.63,16.63,18.63,20.63,22.63,24.63,25.78,27.78
29.78,31.78,33.78,35.78,37.78,39.78,41.78,43.78

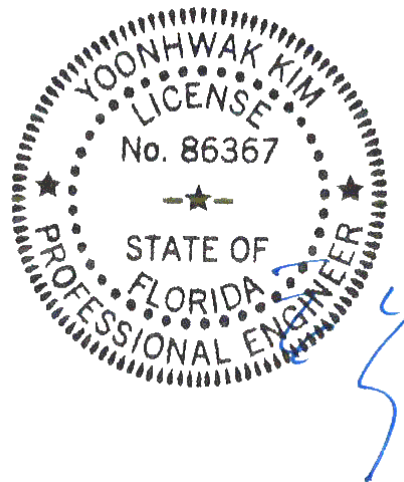

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. **A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.**

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314466 FROM: CDM	SPEC Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: B01	Cust: R 215 JRef: 1WUT2150007 T15 DrwNo: 119.20.1033.37443 / YK 04/28/2020
---------------------------	--------------------------	--	--

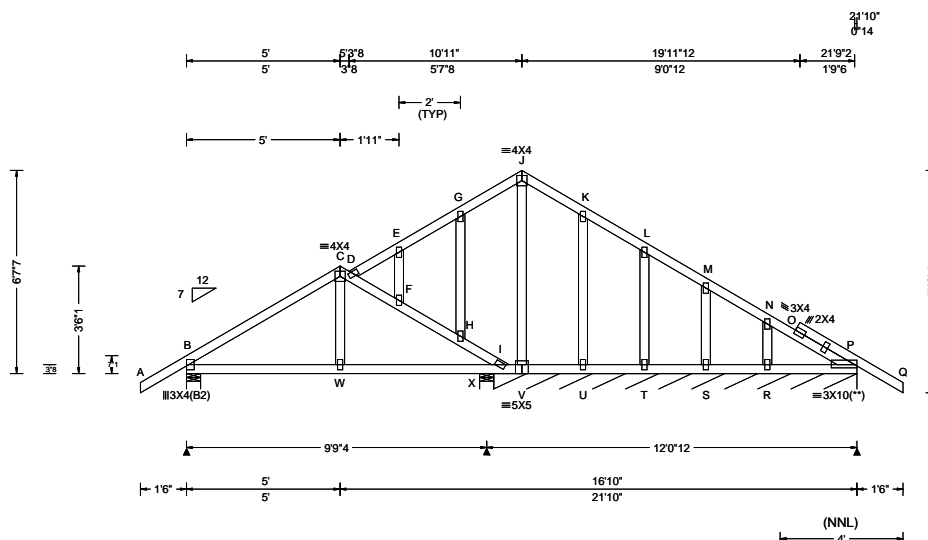

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.024 G 999 240 VERT(CL): 0.057 G 999 180 HORZ(LL): -0.015 H - - HORZ(TL): 0.035 H - - Creep Factor: 2.0 Max TC CSI: 0.301 Max BC CSI: 0.263 Max Web CSI: 0.237 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL B 469 -/- /- /294 /87 /209 X 196 -/- /- /137 /- /- P* 123 -/- /- /62 /23 /- Non-Gravity Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 X Brg Width = 5.5 Min Req = 1.5 P Brg Width = 142 Min Req = - Bearings B, X, & I are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Plating Notes

All plates are 2X4 except as noted.

(**) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 6'-7".

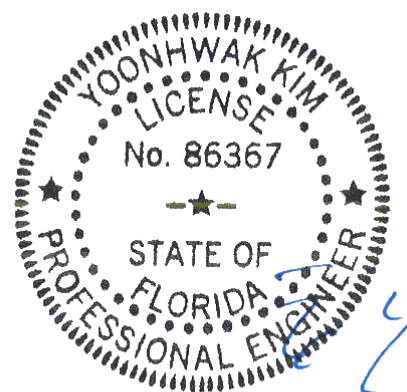

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020


****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314450 FROM: CDM	COMM Ply: 1 Qty: 2	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: B02	Cust: R 215 JRef: 1WUT2150007 T7 DrwNo: 119.20.1033.41480 / YK 04/28/2020
---------------------------	--------------------------	--	---

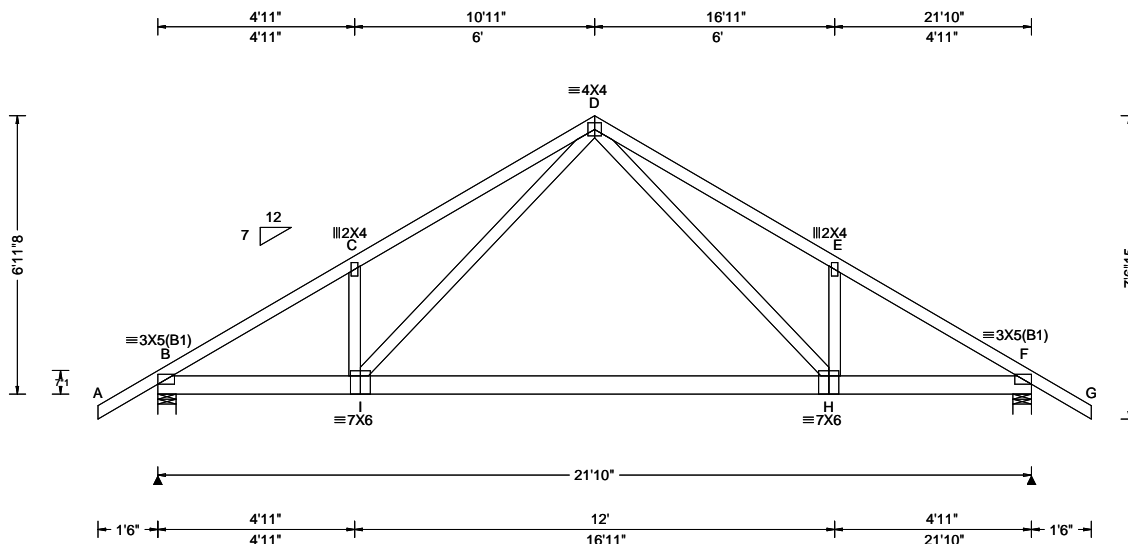

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.052 H 999 240 VERT(CL): 0.098 H 999 180 HORZ(LL): 0.020 C - - HORZ(TL): 0.037 C - - Creep Factor: 2.0 Max TC CSI: 0.422 Max BC CSI: 0.264 Max Web CSI: 0.314 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1102 - / - /608 /174 /207 F 1103 - / - /608 /174 - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 F Brg Width = 5.5 Min Req = 1.5 Bearings B & F are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 363 - 1627 D - E 485 - 1614 C - D 486 - 1611 E - F 361 - 1629

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;

Loading


Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
The overall height of this truss excluding overhang is 6-11-8.

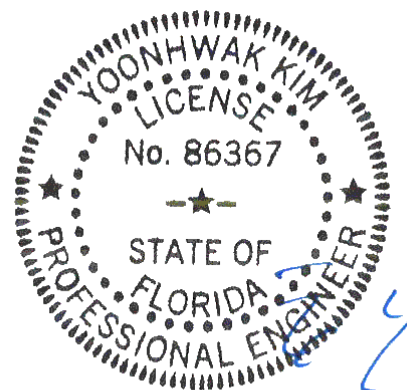


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314451 FROM: CDM	COMM Ply: 1 Qty: 3	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: B03	Cust: R 215 JRef: 1WUT2150007 T6 DrwNo: 119.20.1033.44620 / YK 04/28/2020
---------------------------	--------------------------	--	---

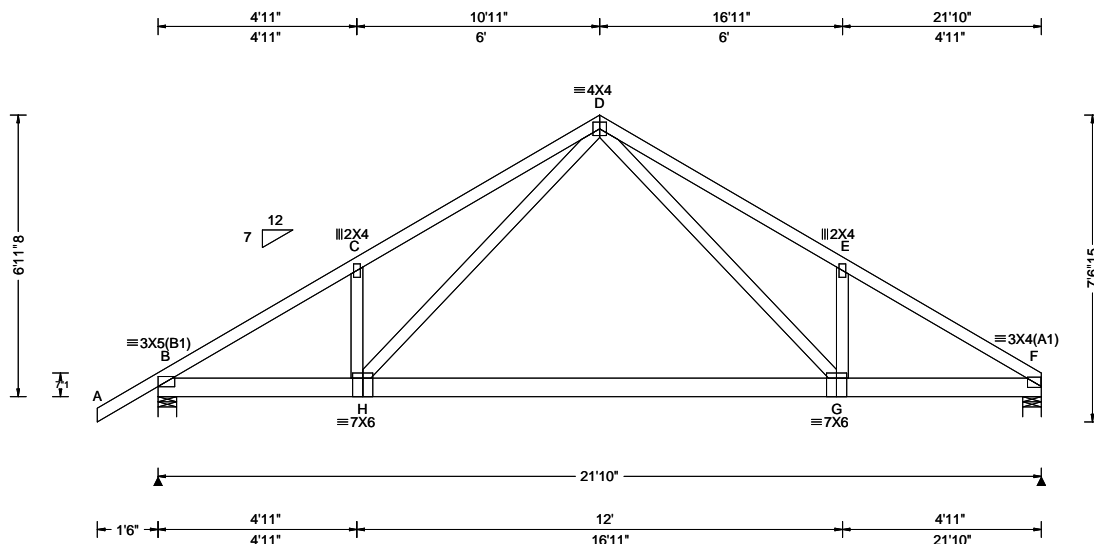

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.052 H 999 240 VERT(CL): 0.098 H 999 180 HORZ(LL): 0.020 C - - HORZ(TL): 0.037 C - - Creep Factor: 2.0 Max TC CSI: 0.420 Max BC CSI: 0.264 Max Web CSI: 0.299 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity B 1106 - / - /608 /175 /191 F 997 - / - /521 /146 - Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 F Brg Width = 5.5 Min Req = 1.5 Bearings B & F are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 270 - 1633 D - E 396 - 1646 C - D 375 - 1618 E - F 290 - 1657

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x6 SP 2400f-2.0E;
Webs: 2x4 SP #3;

Loading


Truss passed check for 20 psf additional bottom chord live load in areas with 42"-high x 24"-wide clearance.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
The overall height of this truss excluding overhang is 6-11-8.

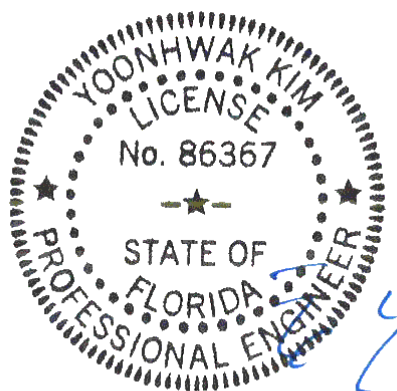


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314452 FROM: CDM	GABL Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: C01	Cust: R 215 JRef: 1WUT2150007 T27 DrwNo: 119.20.1033.48247 / YK 04/28/2020
---------------------------	--------------------------	--	--

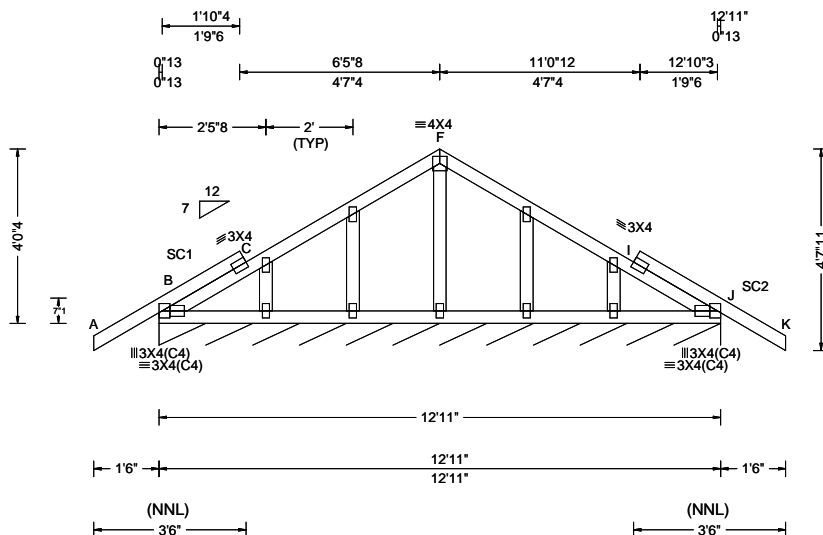

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 L 999 240 VERT(CL): 0.003 L 999 180 HORZ(LL): -0.001 P - - HORZ(TL): 0.001 P - - Creep Factor: 2.0 Max TC CSI: 0.198 Max BC CSI: 0.068 Max Web CSI: 0.038 VIEW Ver: 18.02.01B.0321.08	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL J* 99 - / - /51 /17 /11 Wind reactions based on MWFRS J Brg Width = 154 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;
Stack Chord: SC2 2x4 SP #2;

Plating Notes

All plates are 2X4 except as noted.

Wind


Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
See DWGS A14015ENC101014 & GBLETIN0118 for gable wind bracing and other requirements.

Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.

The overall height of this truss excluding overhang is 4'-0".

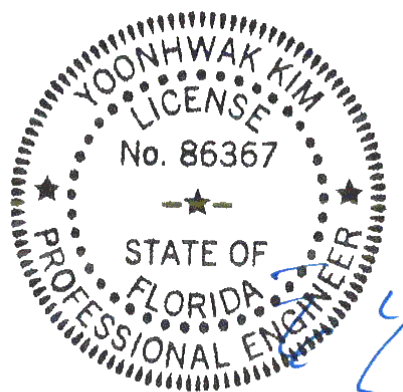

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314453 FROM: CDM	COMN Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: C02	Cust: R 215 JRef: 1WUT2150007 T28 DrwNo: 119.20.1033.49983 / YK 04/28/2020
---------------------------	--------------------------	--	--

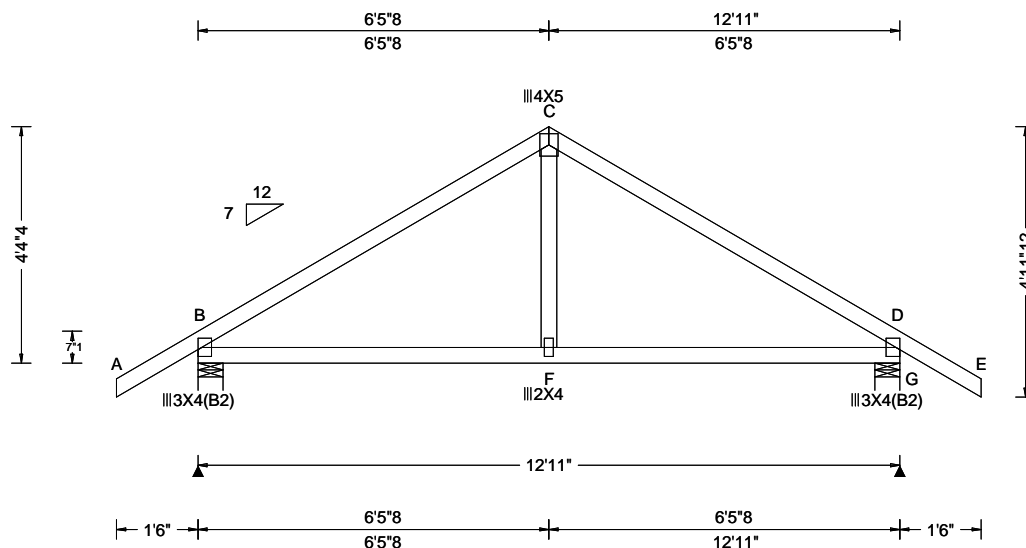

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.009 F 999 240 VERT(CL): 0.019 F 999 180 HORZ(LL): 0.005 F - - HORZ(TL): 0.010 F - - Creep Factor: 2.0 Max TC CSI: 0.407 Max BC CSI: 0.422 Max Web CSI: 0.108 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL B 639 - / - /396 /113 /141 G 639 - / - /396 /113 - Non-Gravity Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 G Brg Width = 5.5 Min Req = 1.5 Bearings B & G are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 192 -649 C - D 193 -649 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - F 474 -42 F - D 474 -42

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
The overall height of this truss excluding overhang is 4-4-4.

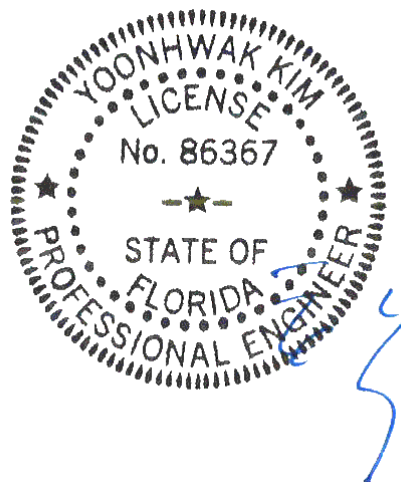

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!** ****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314454 FROM: CDM	COMN Ply: 1 Qty: 3	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: C03	Cust: R 215 JRef: 1WUT2150007 T9 DrwNo: 119.20.1033.54220 / YK 04/28/2020
---------------------------	--------------------------	--	---

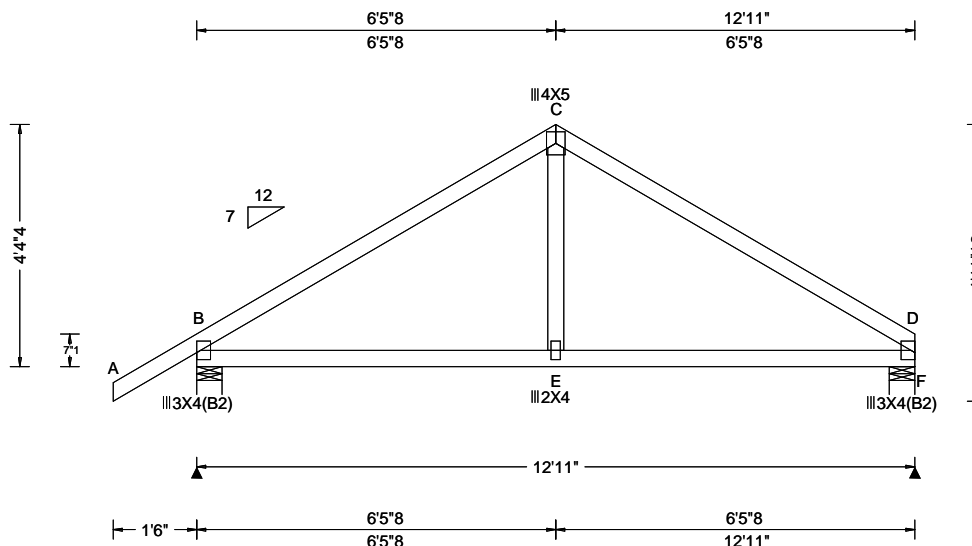

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.008 E 999 240 VERT(CL): 0.016 E 999 180 HORZ(LL): 0.005 E - - HORZ(TL): 0.011 E - - Creep Factor: 2.0 Max TC CSI: 0.442 Max BC CSI: 0.431 Max Web CSI: 0.109 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL B 645 -/- /- /396 /115 /124 F 531 -/- /- /307 /85 -/ Non-Gravity Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 F Brg Width = 5.5 Min Req = 1.5 Bearings B & F are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. B - C 170 -664 C - D 177 -660

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
The overall height of this truss excluding overhang is 4-4-4.

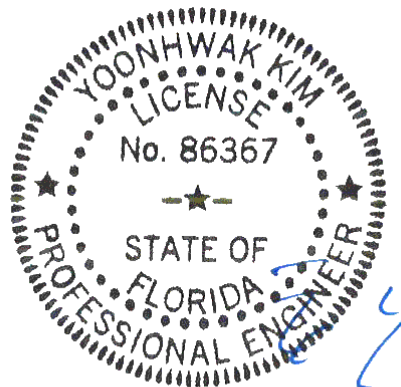


FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314455 FROM: CDM	GABL Ply: 1 Qty: 1	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: D01	Cust: R 215 JRef: 1WUT2150007 T21 DrwNo: 119.20.1033.57160 / YK 04/28/2020
---------------------------	--------------------------	--	--

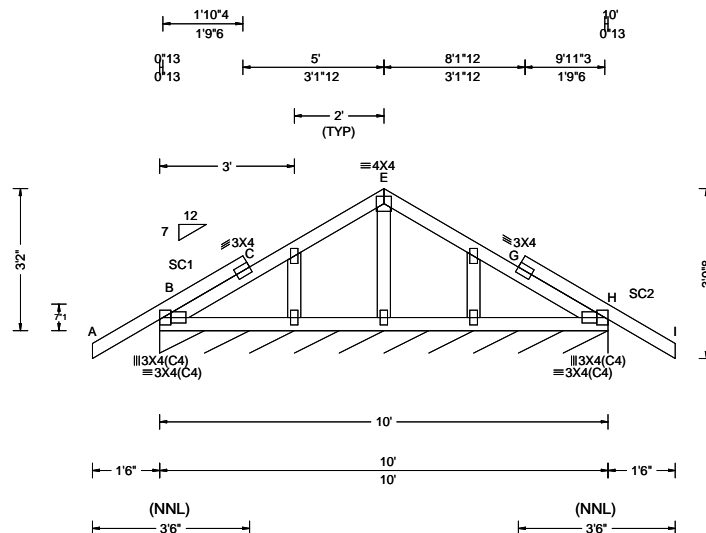

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs), or *=PLF
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.001 L 999 240 VERT(CL): 0.002 L 999 180 HORZ(LL): -0.001 C - - HORZ(TL): 0.001 G - - Creep Factor: 2.0 Max TC CSI: 0.198 Max BC CSI: 0.067 Max Web CSI: 0.031 VIEW Ver: 18.02.01B.0321.08	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL H* 103 /- /- /53 /18 /12 Wind reactions based on MWFRS H Brg Width = 120 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;
Stack Chord: SC2 2x4 SP #2;

Plating Notes


All plates are 2X4 except as noted.

Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information
See DWGS A14015ENC101014 & GBLETIN0118 for gable wind bracing and other requirements.
Stacked top chord must NOT be notched or cut in area (NNL). Dropped top chord braced at 24" oc intervals. Attach stacked top chord (SC) to dropped top chord in notchable area using 3x4 tie-plates 24" oc. Center plate on stacked/dropped chord interface, plate length perpendicular to chord length. Splice top chord in notchable area using 3x6.
The overall height of this truss excluding overhang is 3-2-0.

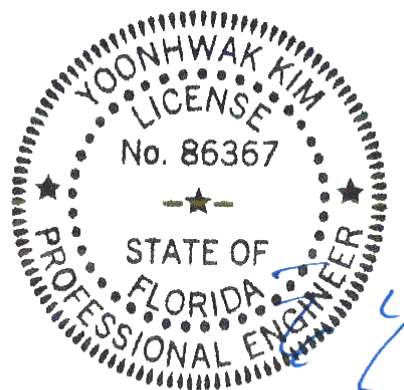

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314456 FROM: CDM	EJAC Ply: 1 Qty: 22	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: J01	Cust: R 215 JRef: 1WUT2150007 T35 DrwNo: 119.20.1034.12493 / YK 04/28/2020
---------------------------	---------------------------	--	--

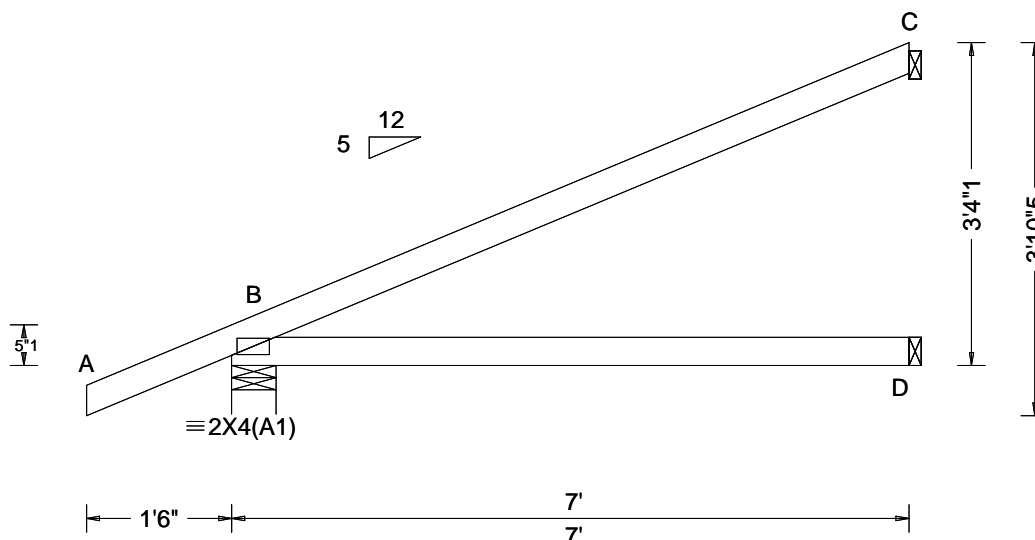

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.012 D - - HORZ(TL): 0.024 D - - Creep Factor: 2.0 Max TC CSI: 0.714 Max BC CSI: 0.511 Max Web CSI: 0.000 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh / Rw / U / RL Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 404 /- /- /268 /62 /101 D 129 /- /- /87 /- /- C 187 /- /- /82 /66 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 3-4-1.

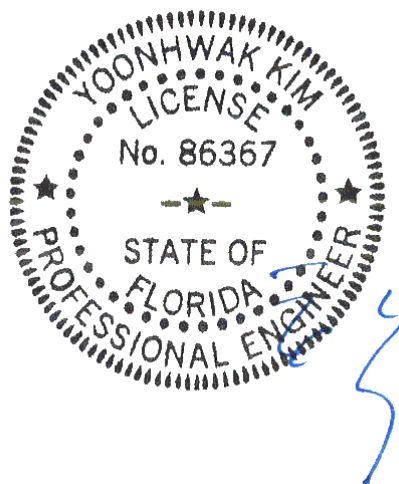

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314457 FROM: CDM	JACK Ply: 1 Qty: 2	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: J02	Cust: R 215 JRef: 1WUT2150007 T33 DrwNo: 119.20.1034.19070 / YK 04/28/2020
---------------------------	--------------------------	---	--

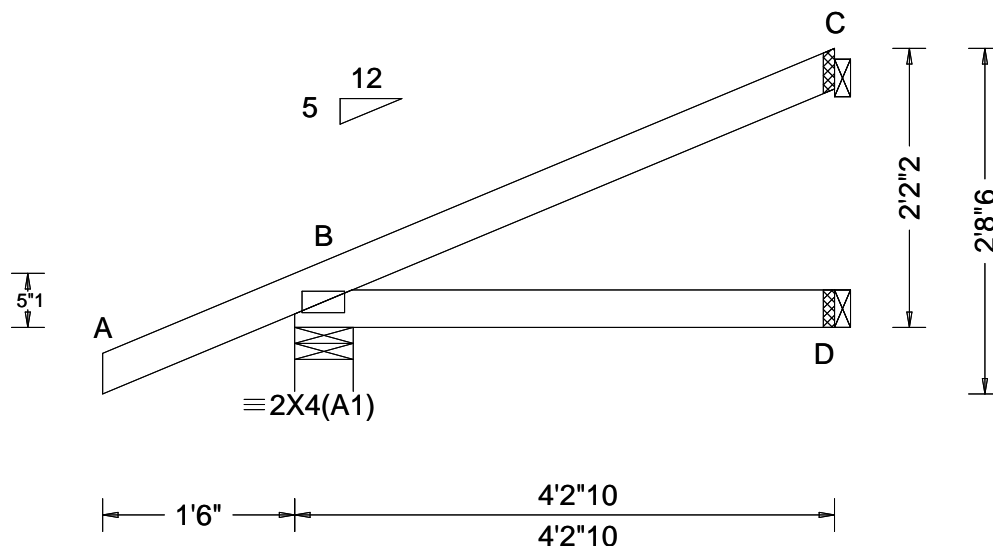

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.002 D - - HORZ(TL): 0.003 D - - Creep Factor: 2.0 Max TC CSI: 0.312 Max BC CSI: 0.170 Max Web CSI: 0.000 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh Non-Gravity / Rw / U / RL B 299 /- /- /204 /51 /68 D 74 /- /- /53 /- /- C 103 /- /- /42 /37 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 2-2-2.

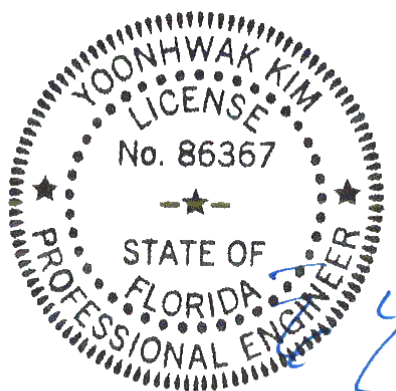

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314458 FROM: CDM	JACK Ply: 1 Qty: 2	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: J03	Cust: R 215 JRef: 1WUT2150007 T34 DrwNo: 119.20.1034.26450 / YK 04/28/2020
---------------------------	--------------------------	--	--

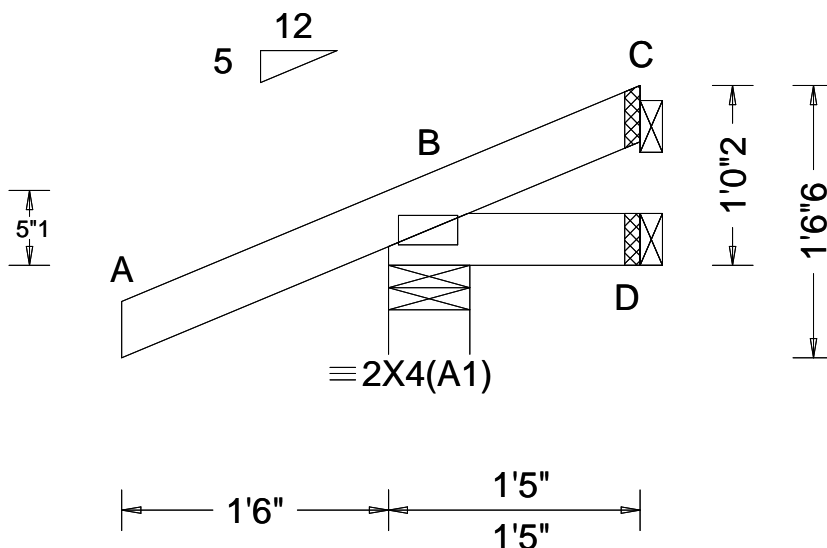

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.000 D - - HORZ(TL): 0.001 D - - Creep Factor: 2.0 Max TC CSI: 0.279 Max BC CSI: 0.047 Max Web CSI: 0.000 VIEW Ver: 18.02.01B.0321.08	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 233 /- /- /171 /63 /34 D 16 /-4 /- /21 /10 /- C - /-14 /- /21 /24 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 1'-0"-2."

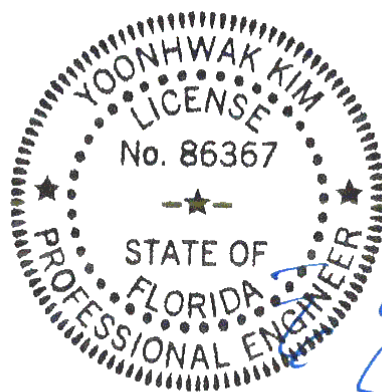

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!** ****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314459 FROM: CDM	JACK Ply: 1 Qty: 2	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: J04	Cust: R 215 JRRef: 1WUT2150007 T11 DrwNo: 119.20.1034.28100 / YK 04/28/2020
---------------------------	--------------------------	---	---

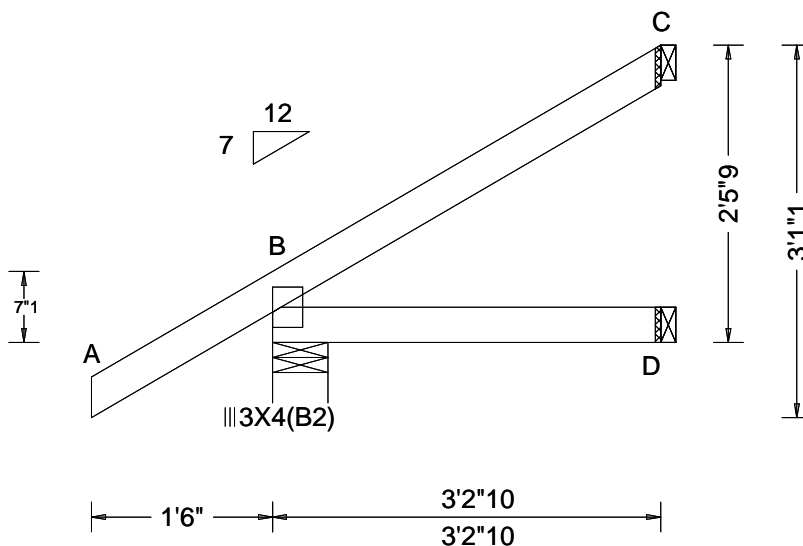

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.001 D - - HORZ(TL): 0.001 D - - Creep Factor: 2.0 Max TC CSI: 0.182 Max BC CSI: 0.111 Max Web CSI: 0.000 VIEW Ver: 18.02.01B.0321.08	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 262 /- /- /194 /37 /79 D 60 /- /- /43 /- /- C 78 /- /- /34 /36 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 2-5-9.

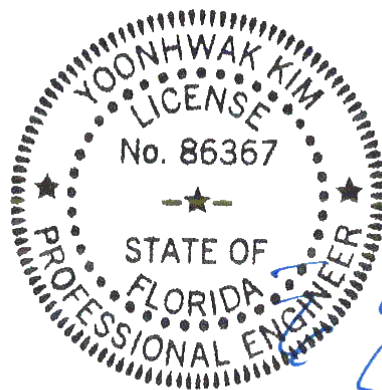

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314460 FROM: CDM	JACK Ply: 1 Qty: 2	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: J05	Cust: R 215 JRRef: 1WUT2150007 T29 DrwNo: 119.20.1034.29753 / YK 04/28/2020
---------------------------	--------------------------	---	---

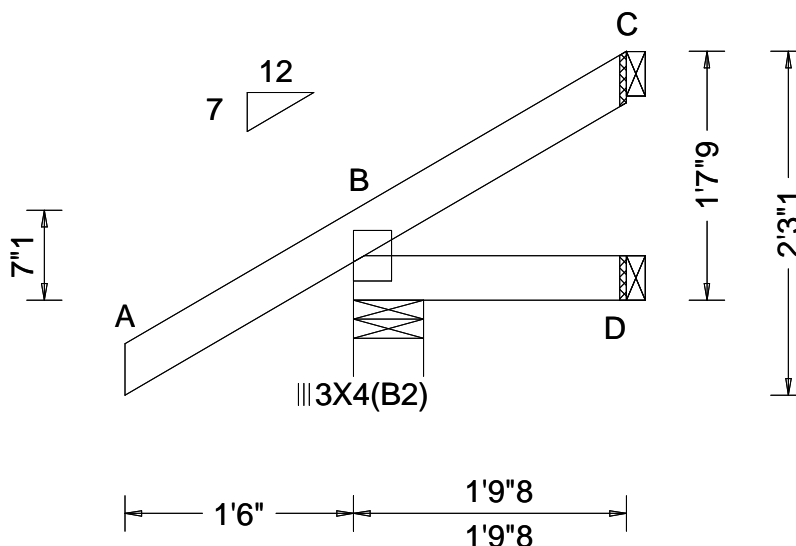

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): -0.001 C - - HORZ(TL): 0.002 C - - Creep Factor: 2.0 Max TC CSI: 0.182 Max BC CSI: 0.033 Max Web CSI: 0.000 VIEW Ver: 18.02.01B.0321.08	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 223 /- /- /173 /40 /55 D 31 /- /- /24 /3 /- C 18 /- /- /19 /14 /- Wind reactions based on MWFRS B Brg Width = 5.5 Min Req = 1.5 D Brg Width = 1.5 Min Req = - C Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;


Wind

Wind loads based on MWFRS with additional C&C member design.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 1'-7-9.

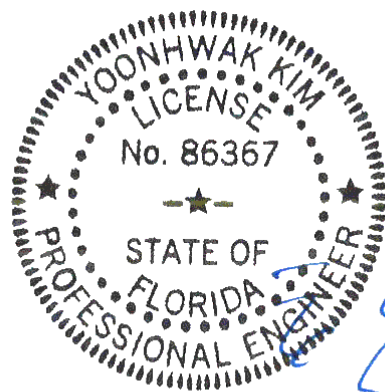

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314461 FROM: CDM	HIP_	Ply: 1 Qty: 2	Job Number: 20-4111 /Jerri & Paula Payne /ZECHEER CONSTRUCTION Truss Label: J06HJ	Cust: R 215 JRef: 1WUT2150007 T4 DrwNo: 119.20.1034.33163 / YK 04/28/2020
---------------------------	------	------------------	---	---

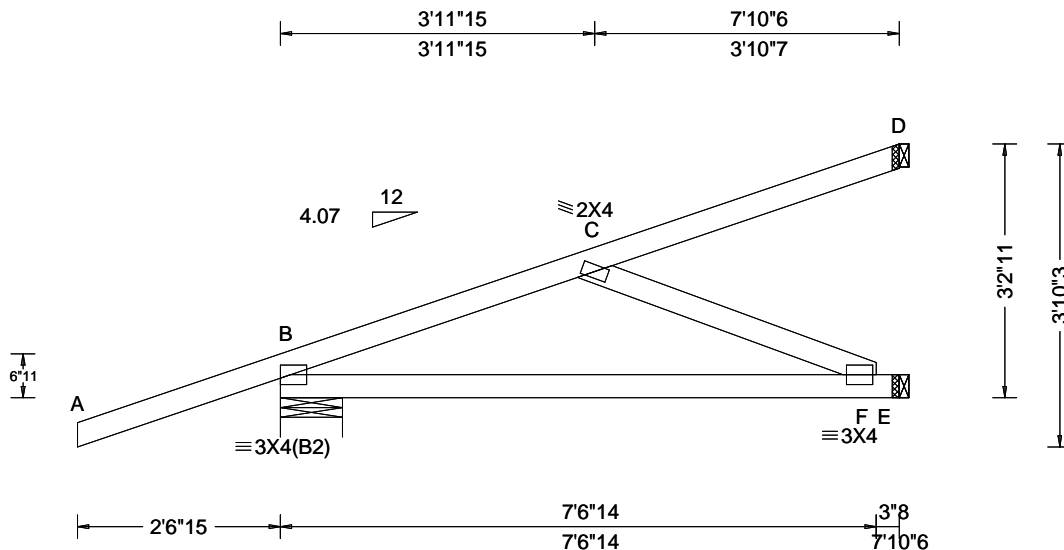

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: NA GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: No FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): 0.014 C 999 240 VERT(CL): 0.028 C 999 180 HORZ(LL): -0.004 D - - HORZ(TL): 0.008 D - - Creep Factor: 2.0 Max TC CSI: 0.527 Max BC CSI: 0.394 Max Web CSI: 0.114 VIEW Ver: 18.02.01B.0321.08	Gravity Loc R+ / R- / Rh Non-Gravity / Rw / U / RL B 352 /- /- /- /80 /- E 201 /- /- /6 /- /- D 175 /- /- /- /69 /- Wind reactions based on MWFRS B Brg Width = 9.5 Min Req = 1.5 E Brg Width = 1.5 Min Req = - D Brg Width = 1.5 Min Req = - Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber

Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Loading

Hipjack supports 5-6-12 setback jacks with no webs.


Wind

Wind loads and reactions based on MWFRS.

Additional Notes

Refer to General Notes for additional information

The overall height of this truss excluding overhang is 3-2-11.

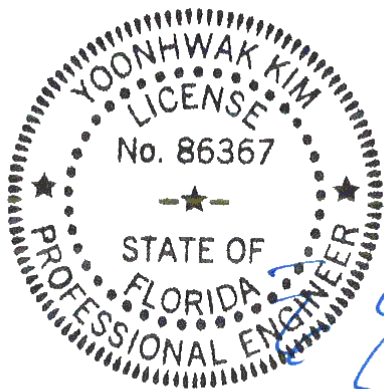

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

SEQN: 314462 FROM: CDM	MONO Ply: 1 Qty: 8	Job Number: 20-4111 /Jerri & Paula Payne /ZECHER CONSTRUCTION Truss Label: J07	Cust: R 215 JRef: 1WUT2150007 T13 DrwNo: 119.20.1034.45157 / YK 04/28/2020
---------------------------	--------------------------	--	--

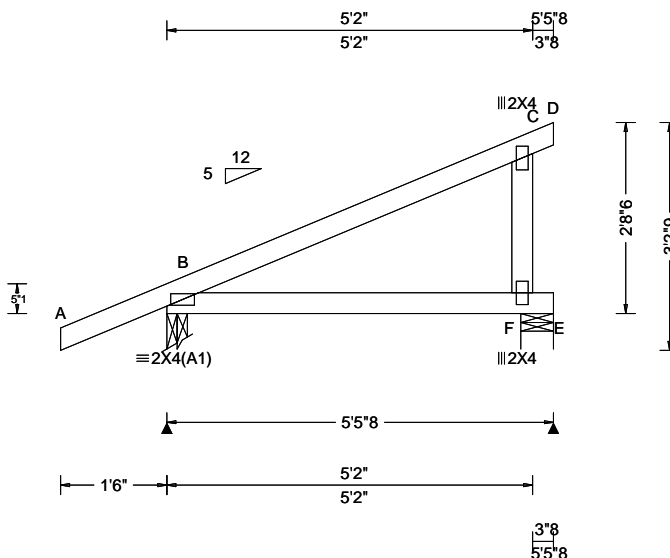

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Defl/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-10 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpi: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Code / Misc Criteria Bldg Code: FBC 2017 RES TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/defl L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.004 F - - HORZ(TL): 0.007 F - - Creep Factor: 2.0 Max TC CSI: 0.307 Max BC CSI: 0.246 Max Web CSI: 0.099 VIEW Ver: 18.02.01B.0321.08	Gravity Non-Gravity Loc R+ / R- / Rh / Rw / U / RL B 333 /- /- /224 /31 /55 E 212 /- /- /133 /22 /- Wind reactions based on MWFRS B Brg Width = 3.5 Min Req = 1.5 E Brg Width = 5.5 Min Req = 1.5 Bearings B & F are a rigid surface. Members not listed have forces less than 375#

Lumber


Top chord: 2x4 SP #2;
Bot chord: 2x4 SP #2;
Webs: 2x4 SP #3;

Wind

Wind loads based on MWFRS with additional C&C member design.
Right end vertical not exposed to wind pressure.

Additional Notes

Refer to General Notes for additional information
The overall height of this truss excluding overhang is 2-8-6.

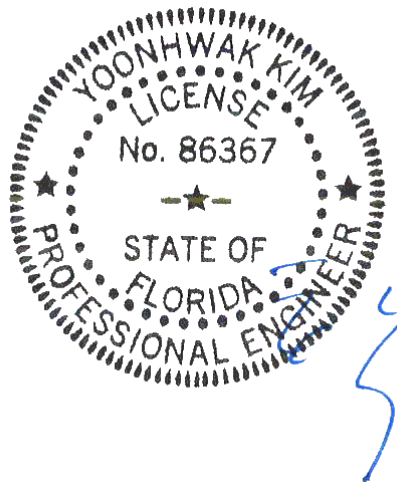

FL REG# 278, Yoonhwak Kim, FL PE #86367
04/28/2020

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING! **IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites: ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcindustry.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY
6750 Forum Drive
Suite 305
Orlando FL, 32821

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.


Web Member Size	Specified CLR Restraint	Alternative Reinforcement T- or L- Reinf.	Scab Reinf.
2x3 or 2x4	1 row	2x4	1-2x4
2x3 or 2x4	2 rows	2x6	2-2x4
2x6	1 row	2x4	1-2x6
2x6	2 rows	2x6	2-2x4(*)
2x8	1 row	2x6	1-2x8
2x8	2 rows	2x6	2-2x6(*)

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.

(*) Center scab on wide face of web. Apply (1) scab to each face of web.



T-Reinforcement or L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

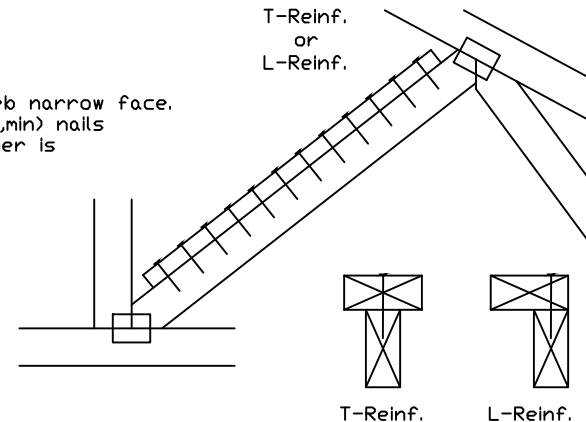

Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

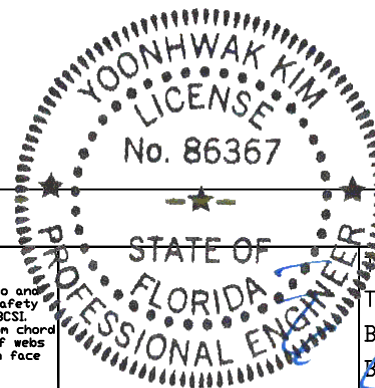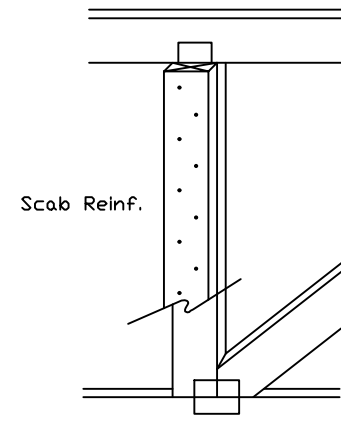

13723 Riverport Drive
Suite 200
Maryland Heights, MO 63043

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.
A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcindustry.org ICC: www.iccsafe.org

BC LL	PSF	REF	CLR Subst.
TC DL	PSF	DATE	01/02/19
BC DL	PSF	DRWG	BRCLBSUB0119
BC LL	PSF		
TDT, LD.	PSF		
DUR. FAC.			
SPACING			

Gable Stud Reinforcement Detail



ASCE 7-10: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00

Or: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Max Gable Vertical Length	2x4 Gable Vertical		Brace	No Braces	(1) 1x4 'L' Brace *		(1) 2x4 'L' Brace *		(2) 2x4 'L' Brace **		(1) 2x6 'L' Brace *		(2) 2x6 'L' Brace **	
	Spacing	Species			Group A		Group B		Group A		Group B		Group A	
			Grade											
24" o.c.	SPF	HF	#1 / #2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"
			#3	4' 1"	6' 7"	7' 1"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"
			Stud	4' 1"	6' 7"	7' 0"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"
		DFL	Standard	4' 1"	5' 8"	6' 0"	7' 7"	8' 1"	10' 6"	11' 10"	12' 8"	14' 0"	14' 0"	14' 0"
			#1	4' 6"	7' 4"	7' 8"	8' 8"	9' 0"	10' 4"	10' 9"	13' 8"	14' 0"	14' 0"	14' 0"
			#2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"
	SP	DFL	#3	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"
			Stud	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"
			Standard	4' 0"	5' 3"	5' 7"	7' 0"	7' 6"	9' 6"	10' 2"	11' 0"	11' 10"	14' 0"	14' 0"
		SPF	#1 / #2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	4' 8"	8' 1"	8' 8"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	4' 8"	8' 1"	8' 6"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
16" o.c.	SPF	HF	Standard	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			#1	5' 1"	8' 5"	8' 9"	9' 11"	10' 4"	11' 10"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"
		DFL	#3	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Standard	4' 8"	6' 5"	6' 10"	8' 7"	9' 2"	11' 7"	12' 1"	13' 6"	14' 0"	14' 0"	14' 0"
	SP	SPF	#1 / #2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
		HF	Standard	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#1	5' 8"	9' 3"	9' 8"	10' 11"	11' 4"	13' 0"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	12' 11"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
12" o.c.	SPF	HF	#3	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			Standard	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	DFL	#1	5' 8"	9' 3"	9' 8"	10' 11"	11' 4"	13' 0"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	12' 11"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"

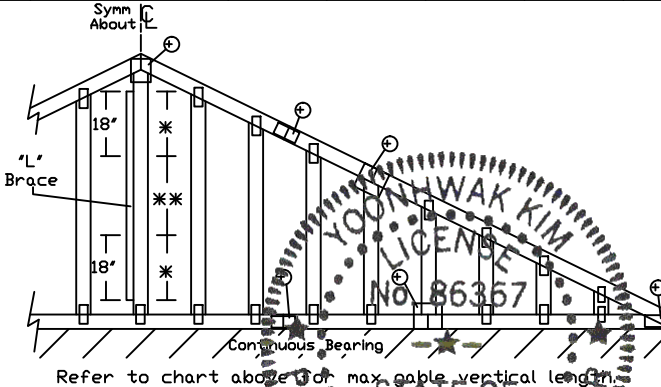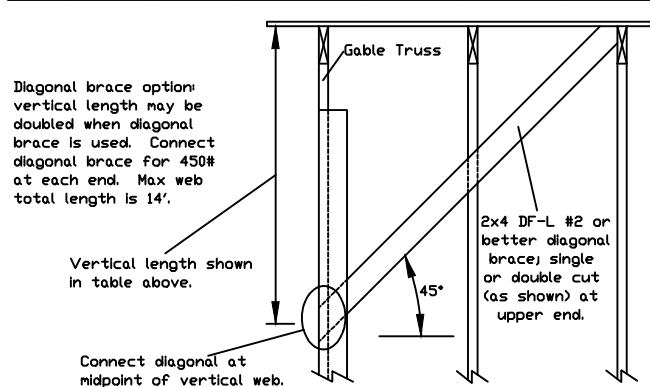

Bracing Group Species and Grades:			
Group A:			
Spruce-Pine-Fir		Hem-Fir	
#1 / #2	Standard	#2	Stud
#3	Stud	#3	Standard
Douglas Fir-Larch		Southern Pine****	
#3		#3	
Stud		Stud	
Standard		Standard	
Group B:			
Hem-Fir			
#1 & Btr			
#1			
Douglas Fir-Larch		Southern Pine****	
#1		#1	
#2		#2	

1x4 Braces shall be SRB (Stress-Rated Board).

****For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:
Wind Load deflection criterion is L/240.

Provide uplift connections for 55 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach 'L' braces with 10d (0.128"x3.0" min) nails.
* For (1) 'L' brace: space nails at 2' o.c. in 18' end zones and 4' o.c. between zones.
**For (2) 'L' braces: space nails at 3' o.c. in 18' end zones and 6' o.c. between zones.
'L' bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes	
Vertical Length	No Splice
Less than 4' 0"	1X4 or 2X3
Greater than 4' 0"	3X4

+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

ALPINE
AN ITW COMPANY

13723 Riverport Drive
Suite 200
Maryland Heights, MO 63043


WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcindustry.org ICC: www.iccsafe.org

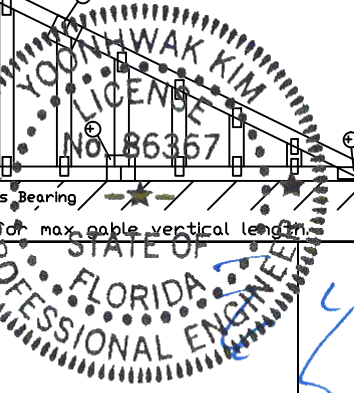


MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCE7-10-GAB14015
DATE 10/01/14
DRWG A14015ENC101014

Gable Detail For Let-in Verticals

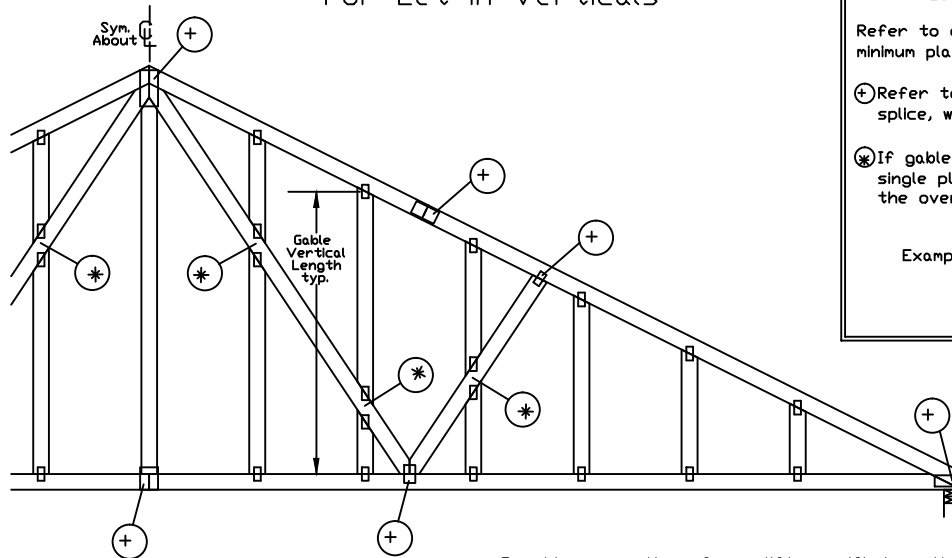


Gable Truss Plate Sizes


Refer to appropriate Alpine gable detail for minimum plate sizes for vertical studs.

(+) Refer to Engineered truss design for peak, splice, web, and heel plates.

(X) If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.



"T" Reinforcement Attachment Detail

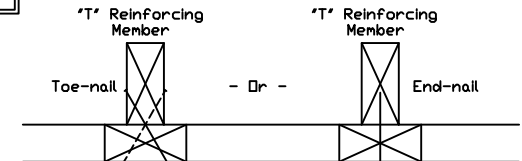

To convert from "L" to "T" reinforcing members, multiply "T" increase by length (based on appropriate Alpine gable detail).

Maximum allowable "T" reinforced gable vertical length is 14' from top to bottom chord.

"T" reinforcing member material must match size, specie, and grade of the "L" reinforcing member.

Web Length Increase w/ "T" Brace

"T" Reinf. Mbr. Size	"T" Increase
2x4	30 %
2x6	20 %

Example:

ASCE 7-10 Wind Speed = 120 mph

Mean Roof Height = 30 ft, Kzt = 1.00

Gable Vertical = 24' o.c. SP #3

"T" Reinforcing Member Size = 2x4

"T" Brace Increase (From Above) = 30% = 1.30

(1) 2x4 "L" Brace Length = 8' 7"

Maximum "T" Reinforced Gable Vertical Length
1.30 x 8' 7" = 11' 2"

Provide connections for uplift specified on the engineered truss design.

Attach each "T" reinforcing member with

End Driven Nails:

10d Common (0.148"x 3", min) Nails at 4' o.c. plus
(4) nails in the top and bottom chords.

Toenailed Nails:

10d Common (0.148"x 3", min) Toenails at 4' o.c. plus
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE wind load.


ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014,
A13030051014, A12030051014, A11030051014, A10030051014, A14030051014

ASCE 7-10 & ASCE 7-16 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A10015ENC100118,
A18015ENC100118, A20015ENC100118, A20015END100118, A20015P100118,
A11530ENC100118, A12030ENC100118, A14030ENC100118, A10030ENC100118,
A18030ENC100118, A20030ENC100118, A20030END100118, A20030P100118,
S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118,
S18015ENC100118, S20015ENC100118, S20015END100118, S20015P100118,
S11530ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118,
S18030ENC100118, S20030ENC100118, S20030END100118, S20030P100118

See appropriate Alpine gable detail for maximum unreinforced gable vertical length.

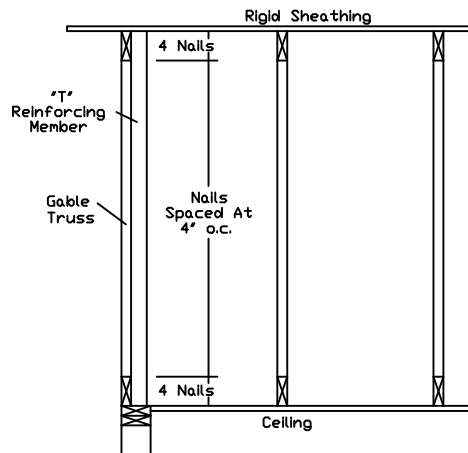

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.


Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this Job's general notes page and these web sites: 04/28/2020
ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcindustry.org; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY

13723 Riverport Drive
Suite 200
Maryland Heights, MO 63043

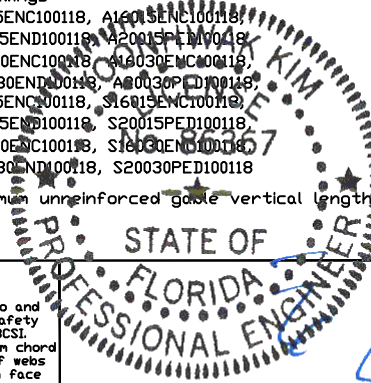

Yoonhwak Kim, FL PE #86367

REF LET-IN VERT

DATE 01/02/2018

DRWG GBLLETIN0118

MAX. TOT. LD. 60 PSF

DUR. FAC. ANY

MAX. SPACING 24.0"