

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and approval numbers on the building components listed below if they will be utilized on the construction project for which you are applying for a building permit. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. Statewide approved products are listed online @ www.floridabuilding.org

Category/Subcategory	Manufacturer	Product Description	Approval Number(s)
1. EXTERIOR DOORS			
A. SWINGING	JELD WEN	6-8 Outswing Woodedge steel	14569.1
B. SLIDING			
C. SECTIONAL/ROLL UP			
D. OTHER			
2. WINDOWS			
A. SINGLE/DOUBLE HUNG			
B. HORIZONTAL SLIDER			
C. CASEMENT			
D. FIXED			
E. MULLION			
F. SKYLIGHTS			
G. OTHER			
3. PANEL WALL			
A. SIDING			
B. SOFFITS			
C. STOREFRONTS			
D. GLASS BLOCK			
E. OTHER			
4. ROOFING PRODUCTS			
A. ASPHALT SHINGLES			
B. NON-STRUCT METAL			
C. ROOFING TILES			
D. SINGLE PLY ROOF			
E. OTHER			
5. STRUCT COMPONENTS			
A. WOOD CONNECTORS			
B. WOOD ANCHORS			
C. TRUSS PLATES			
D. INSULATION FORMS			
E. LINTELS			
F. OTHERS			
6. NEW EXTERIOR ENVELOPE PRODUCTS			

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufacturers installation requirements.

Further, I understand these products may have to be removed if approval cannot be demonstrated during inspection.

NOTES: _____

JELD-WEN® Steel

WOOD EDGE IMPACT GLAZED STEEL DOOR
6-8 OUTSWING SINGLE OR DOUBLE DOOR UNIT
UTILIZING COMPONENTS FROM ODL® INC. AND
ENDURA PRODUCTS INC.

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC) BASED ON THE SIGNED AND SEALED DATE, INCLUDING HVHZ AND HAS BEEN EVALUATED IN ACCORDANCE WITH THE FOLLOWING:
TAS 201-94 ASTM E330-02 ASTM E1886-05
TAS 202-94 ASTM E331-00 ASTM E1996-05
TAS 203-94 ASTM E283-91
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE I, PAGE 1.
5. THIS PRODUCT MEETS THE WATER REQUIREMENTS FOR HIGH VELOCITY HURRICANE ZONE (HVHZ)
6. PRODUCT DOES NOT REQUIRE SHUTTERS

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

DOOR LEAF CONSTRUCTION:


Face sheets: 24 GA (0.021" min) thickness. Galvanized steel A-525 commercial quality AKDQ per ASTM 620 with average minimum yield strength $F_y(ave) = 30627$ psi.

Core Design: Door core by JELD-WEN.

Panel Construction: The active and inactive panels are constructed from 24 GA (0.021" min) galvanized steel. The face sheets at top and bottom are bent 90° over the top and bottom rails. The top rail measures 1.0" high x 1.688" wide. The steel bottom rail measures 1.21" high x 1.688" wide. The sides of the face sheets are roll formed into the latch and hinge stiles which measure 1.00" high x 1.688" wide. The interior cavity is filled with door core. The face sheets are glued to the door core. The panels are cut out for the two-piece ODL Aluminum ALLEN frame. Units are glazed with tempered and laminated impact 1" IG. On double door applications the inactive door is fitted with an extruded aluminum astragal of 6063-T5 alloy.

Frame Construction: The frames are constructed of fingerjointed pine jambs measuring 4-9/16" x 1-1/4". The head jambs are mortised and butt joined to the side jambs, and attached with three (3) 16GA 7/16" crown x 2" long staples on each side. The threshold is attached to the side jambs with three (3) 16GA 7/16" crown x 2" long staples on each side.

Glazing: ODL insulated lite is 1" overall thickness, consisting of one (1) pane of 0.125" tempered glass; 0.5" air space; two (2) panes of 0.125" annealed with .090" PVB interlayer by Solutia. All lites are sandwiched glazed into the panels.

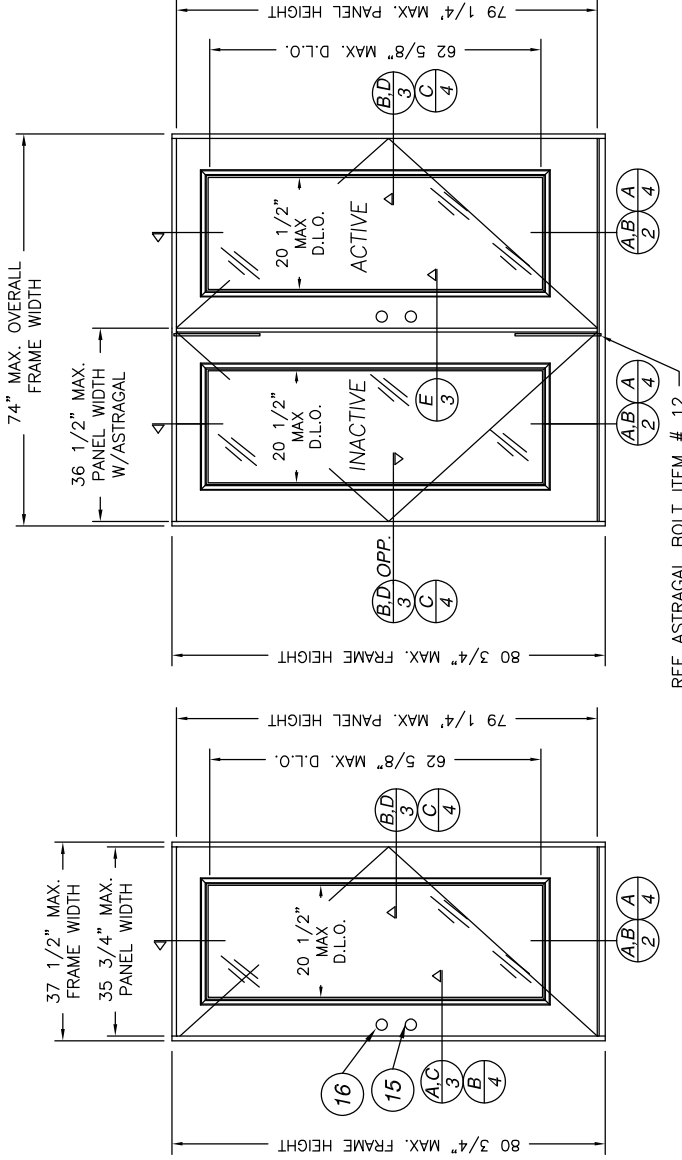

SINGLE OUTSWING UNIT (X)
SCALE: 1/2" = 1'-0"

DOUBLE OUTSWING UNIT (XX)
SCALE: 1/2" = 1'-0"

ALL DOOR MODELS ARE VIEWED
FROM THE EXTERIOR SIDE

TABLE I	DESIGN PRESSURE RATING	APPROVED FOR USE WHERE PROTECTION FOR WATER INFILTRATION IS REQUIRED
POSITIVE		+60.0 PSF
NEGATIVE		-60.0 PSF

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTION & BILL OF MATERIAL
3	HORIZONTAL CROSS SECTIONS
4	OPTIONAL 1X BUCK IN MASONRY/CONCRETE CROSS SECTIONS
5	ANCHORING LOCATIONS
6	COMPONENT DETAILS
7	UNIT COMPONENTS

- NOTES:
- 1 - ALL VIEWS FROM EXTERIOR.
 - 2 - FOR HORIZONTAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE. SEE SHEET 4 FOR DETAILS.
 - 3 - FOR VERTICAL ANCHOR IN 1X BUCK OPTION IN MASONRY/CONCRETE. SEE SHEET 5 FOR DETAILS.




Digitally signed by Hermes F. Norero
Reason: I am approving this document
Date: 2020.09.26 08:07:55 -0200


PRODUCT: WOOD EDGE IMPACT GLAZED
STEEL DOOR 6-8 OUTSWING
SINGLE OR DOUBLE
PART OR ASSEMBLY:
TYPICAL ELEVATIONS &
GENERAL NOTES

REVISONS	
NO.	DATE
1	12/17/04
2	4/8/06
3	2/5/08
4	ADD CONC. DWG. EAG
5	ADD CONC. DWG. EAG
6	CHG CORE DEFIN. JH
7	ADD ADA THRESHOLD


JELD-WEN
3737 Lakport Blvd.
Klamath Falls, Oregon 97601
Ph. (541) 882-3451
Fax (541) 850-2609

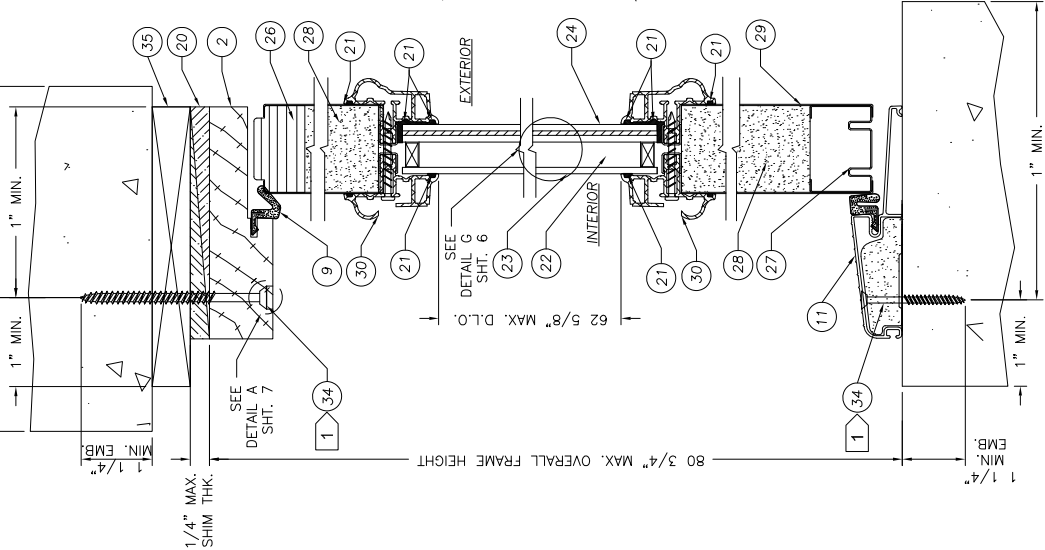


2 4 VERTICAL CROSS SECTION TYP.
OPERATING UNIT 1X BUCK
OPTION IN MASONRY/CONCRETE
(SCALE: 6" = 1'-0")

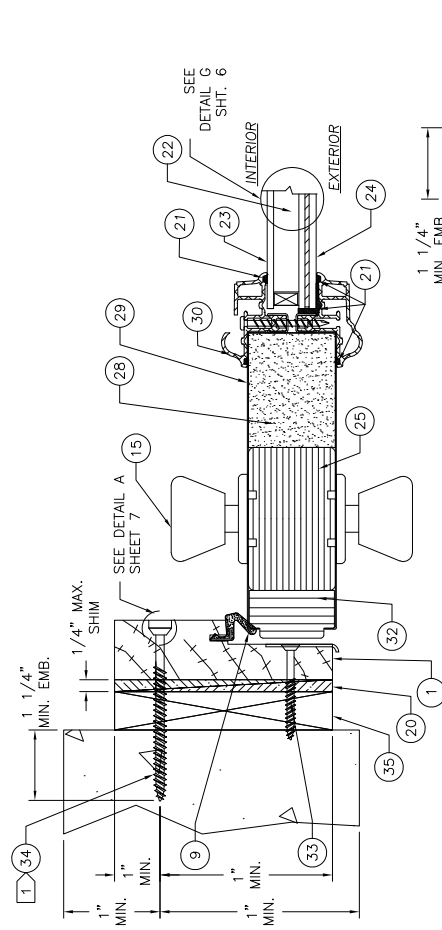


2 4 HORIZONTAL CROSS SECTION TYP.
OPERATING UNIT 1X BUCK
OPTION IN MASONRY/CONCRETE
(SCALE: 6" = 1'-0")

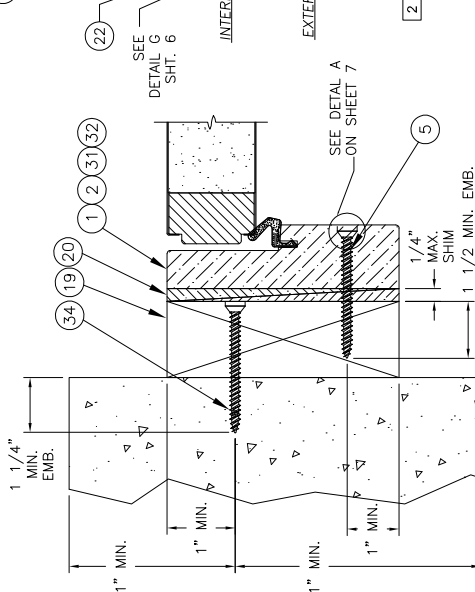

2 4 CROSS SECTION OF HEAD OR JAMB
OPERATING UNIT 2X BUCK
OPTION IN MASONRY/CONCRETE
(SCALE: 6" = 1'-0")

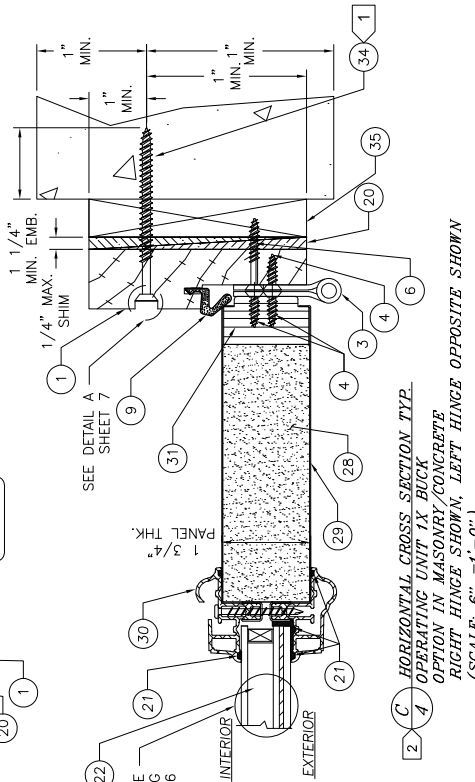

2 4 HORIZONTAL CROSS SECTION TYP.
OPERATING UNIT 1X BUCK
OPTION IN MASONRY/CONCRETE
RIGHT HINGE SHOWN, LEFT HINGE OPPOSITE SHOWN
(SCALE: 6" = 1'-0")

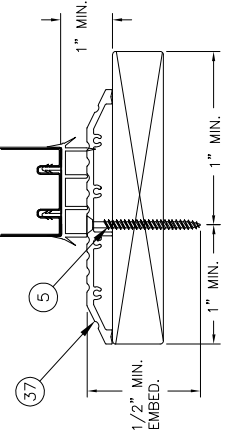

2 4 VERTICAL CROSS SECTION (SILL)
OPERATING UNIT 1X BUCK
OPTIONAL ADA SILL
(SCALE: 6" = 1'-0")


- NOTES:
- 1 FOR TAPCON MASONRY AND WOOD SCREW ANCHOR SPACING (ITEMS #5 & #34), SEE SHEET 5.
 - 2 OPTIONALLY, ANCHOR CAN BE PLACED IN NARROW SECTION AS MINIMUM EMBEDMENT IS ACHIEVED.



REVISIONS	
NO.	DATE
A	12/17/04
B	4/8/06
C	2/5/08
D	11/17/10
E	8/28/17
F	01/21/20

PRODUCT:	WOOD EDGE IMPACT GLAZED STEEL DOOR 6-8 OUTSWING SINGLE OR DOUBLE
PART OR ASSEMBLY:	1X BUCK & OPTIONAL INSTALL IN CONCRETE/MASONRY CROSS SECTIONS


JELB WEN
WINDOWS & DOORS
3737 Lakeport Blvd.
Klamath Falls, Oregon 97601
Ph. (541) 882-3451
Fax (541) 850-2609

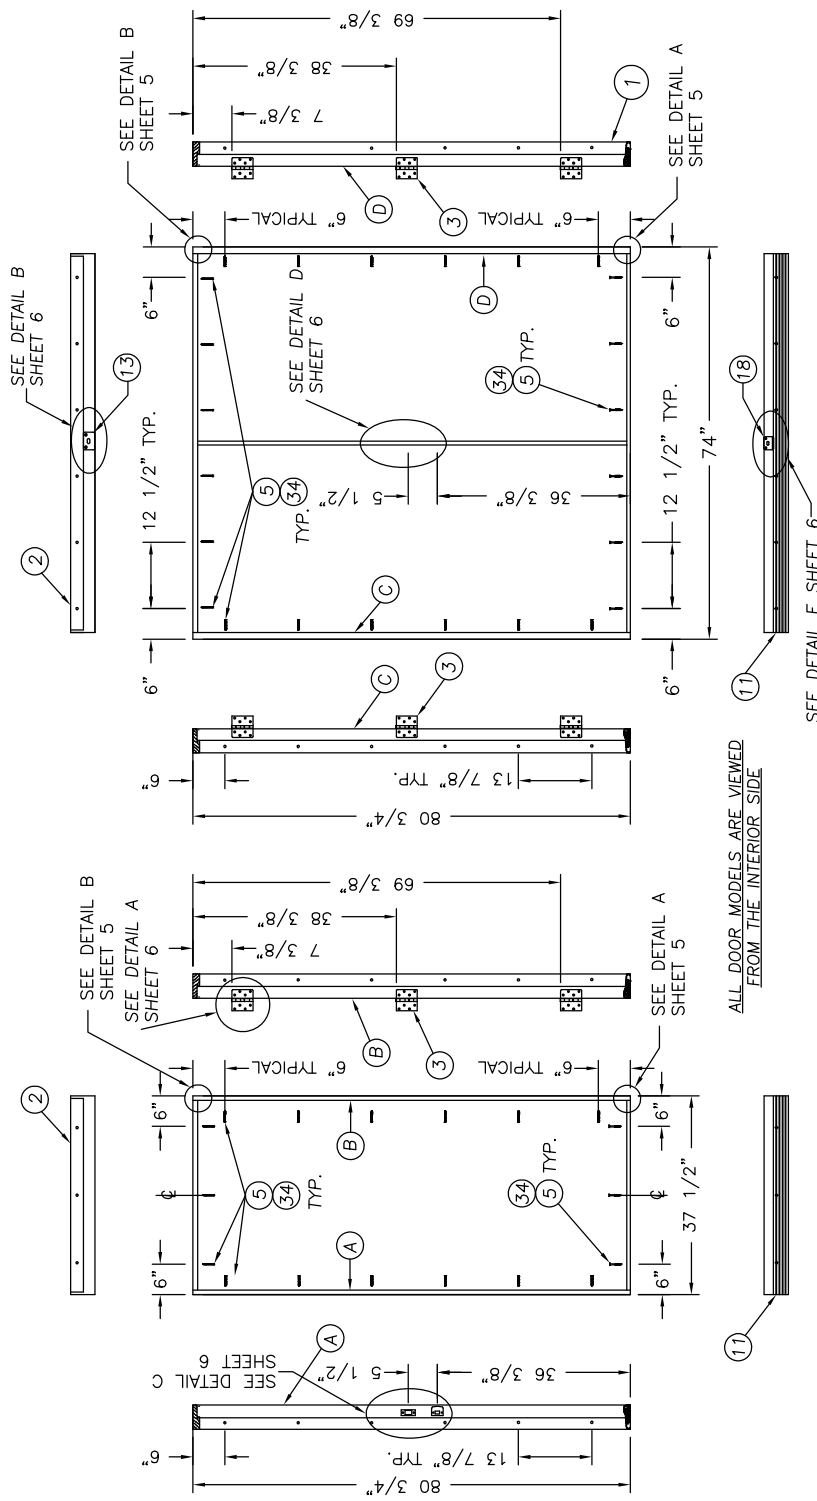

ALL DOOR MODELS ARE VIEWED
FROM THE INTERIOR SIDE

ANCHORING LOCATIONS
OUTSWING SINGLE UNIT (X)
SCALE: 1/2" = 1'-0"

ANCHORING LOCATIONS DOUBLE
OUTSWING UNIT (XX)
SCALE: 1/2" = 1'-0"

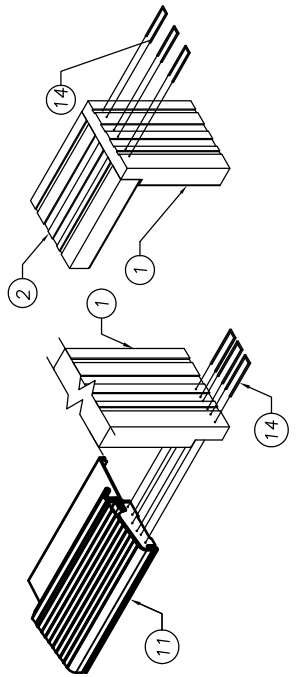

DETAIL A
SCALE: 3" = 1'-0"

DETAIL B
SCALE: 3" = 1'-0"



DATE: 6/18/13
SCALE: AS NOTED
DWG. BY: EAG
CHK. BY: S. SAFFELL
DRAWING NO.: JWC0509-03
SHEET 5 OF 7

NO.	DATE	REVISIONS
A	12/17/04	GENERAL REVISION
B	4/8/06	GENERAL REVISION
C	2/5/08	ADD CONC. DWG. EAG
D	11/17/10	GENERAL REVISION
E	8/28/17	CHG CORE DEFIN. JH
F	01/21/20	ADD ADA THRESHOLD

PRODUCT: WOOD EDGE IMPACT GLAZED STEEL DOOR 6-8 OUTSWING SINGLE OR DOUBLE
PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS

3737 Lakewood Blvd.
Klamath Falls, Oregon 97601
Ph. (541) 882-3451
Fax (541) 850-2609

