


SCALE NOTE:
PLAN VIEW: 1/8" = 1'-0"

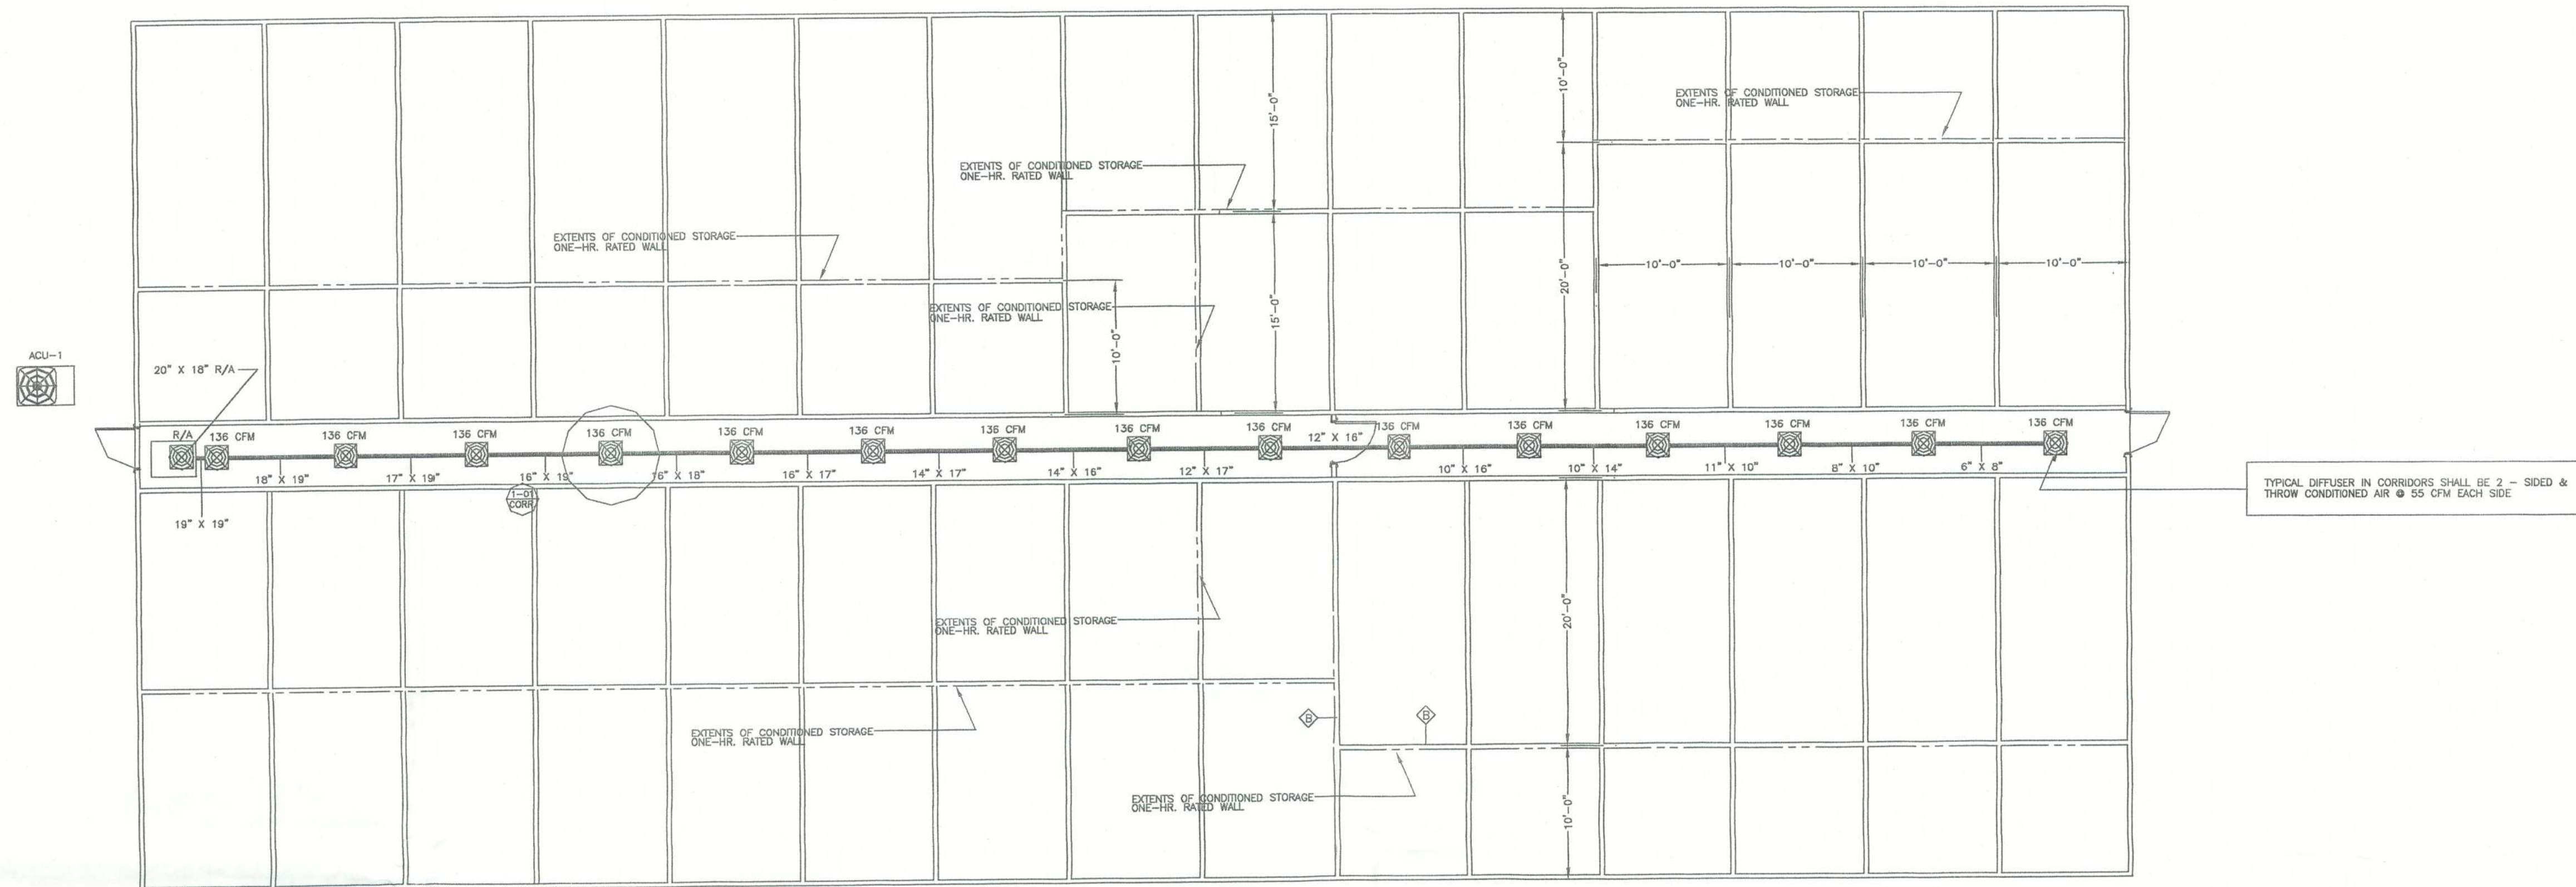

AHU-1	5.0 TON	2050 CFM	SEER 10.5	COP 3.00	TRANE TWE060 OR EQUAL
AHU-1	5.0 TON	2050 CFM	SEER 10.5	COP 3.00	TRANE 2TWR1060A OR EQUAL

- ① BASED UPON 96" AIR ENTERING CONDENSER
② PROVIDE FLEXIBLE CONNECTIONS @ ALL AIR HANDLING UNITS

CONTRACTOR TO PROVIDE FOR ADEQUATE CONDENSATION DRAINAGE TO PREVENT FREE WATER FLOW FROM HEAT PUMP UNITS AND TO THOROUGHLY SEAL/GASKET HEAT PUMP UNIT PENETRATION AGAINST MOISTURE AND AIR INFILTRATION.

Curtis Keen
11/10/03