



STATE OF FLORIDA  
DEPARTMENT OF HEALTH  
ONSITE SEWAGE TREATMENT AND DISPOSAL  
SYSTEM

PERMIT #: **12-SC-2888415**  
APPLICATION #: **AP2062547**  
DATE PAID: **4/8/24**  
FEE PAID: **310.00**  
RECEIPT #:  
DOCUMENT #: **PR2076674**

CONSTRUCTION PERMIT FOR: OSTDS New  
APPLICANT: ANGELA\*\*24-0293 REUTER  
PROPERTY ADDRESS: 1108 SW CENTRAL Fort White, FL 32038  
LOT: 17 BLOCK: SUBDIVISION: 3 Rivers Est U-17  
PROPERTY ID #: 00943-001 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]  
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [ 400 ] GALLONS / GPD Aerobic Treatment Unit CAPACITY  
A [ ] GALLONS / GPD N/A CAPACITY  
N [ ] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]  
K [ ] GALLONS DOSING TANK CAPACITY [ ] GALLONS @ [ ] DOSES PER 24 HRS #Pumps [ ]  
D [ 282 ] SQUARE FEET Drainfield SYSTEM  
R [ ] SQUARE FEET N/A SYSTEM  
A TYPE SYSTEM: [x] STANDARD [ ] FILLED [ ] MOUND [ ]  
I CONFIGURATION: [x] TRENCH [ ] BED [ ]  
N  
F LOCATION OF BENCHMARK: Nail in oak N of site

I ELEVATION OF PROPOSED SYSTEM SITE [ 12.00 ] [ INCHES / FT ] [ ABOVE / BELOW ] BENCHMARK/REFERENCE POINT  
E BOTTOM OF DRAINFIELD TO BE [ 42.00 ] [ INCHES / FT ] [ ABOVE / BELOW ] BENCHMARK/REFERENCE POINT

L  
D FILL REQUIRED: [ 0.00 ] INCHES EXCAVATION REQUIRED: [ ] INCHES

O The system is sized for 3 bedrooms with a maximum occupancy of 6 persons (2 per bedroom), for a total estimated flow of 300 gpd.

T  
H System will be 50% nitrogen reducing ATU as required by BMAP restriction in code, using a 24" water table separation.  
E Nitrogen reducing NSF-245 certified aerobic treatment unit required." Maintenance contract and operating permitting also required. Maintenance contract with fee also required before final system approval.

R  
SPECIFICATIONS BY: William D Bishop II TITLE: Master Septic Contractor

APPROVED BY: [Signature] TITLE: Environmental Specialist I Columbia CHD  
Sean P Havens

DATE ISSUED: 04/11/2024 EXPIRATION DATE: 10/11/2025

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)  
Incorporated 62-6.004, FAC



STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
ONSITE SEWAGE TREATMENT AND DISPOSAL  
SYSTEM (OSTDS)

FW

PERMIT NO. 24-0298  
DATE PAID: 4/8/24  
FEE PAID: 310.50  
RECEIPT #: 2022547

APPLICATION FOR CONSTRUCTION PERMIT

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative  
☐ Repair ☐ Abandonment ☐ Temporary

APPLICANT: Angela Reuter EMAIL: rockyford@windstream.net  
AGENT: A&B Construction TELEPHONE: 386-497-2311  
MAILING ADDRESS: 2416 SW Dorch St, Ft. White, FL 32038

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: 17 BLOCK: NA SUBDIVISION: Three Rivers Estates OSTDS REMEDIATION PLAN? ☐ Y ☐ N

PROPERTY ID #: 00-00-00-00943-001 ZONING: \_\_\_\_\_ I/M OR EQUIVALENT: ☐ Y ☐ N

PROPERTY SIZE: 0.918 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐  $\leq 2000$  GPD ☐  $> 2000$  GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y ☐ N DISTANCE TO SEWER: NA FT

PROPERTY ADDRESS: 1108 SW Central Ter, Ft. White, FL 32038

DIRECTIONS TO PROPERTY: TL onto FL-247S, TL onto Sand Hill Rd, TL onto US 27S, TR onto SW Riverside Ave, TL onto Utah Pkwy, TR onto Central Blvd.

BUILDING INFORMATION

☒ RESIDENTIAL ☐ COMMERCIAL

Unit No. Type of Establishment No. of Bedrooms Building Area Sqft Commercial/Institutional System Design Table I, Chapter 62-6, FAC

1 SF Residential 3 1704

2

3

4

☐ Floor/Equipment Drains ☐ Other (Specify) \_\_\_\_\_

SIGNATURE: William A. Bishop II DATE: 4-2-24



STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
APPLICATION FOR CONSTRUCTION PERMIT

Permit Application Number 24-0293

Reuter

PART II - SITEPLAN

Scale: Each block represents 10 feet and 1 inch = 40 feet.

See  
Attached

Notes

Site Plan submitted by: William L. Bishop II

Master Contractor

Plan Approved ☒

Not Approved ☐

Date 4/11/24

By [Signature]

ESZ Columbia

County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)

Incorporated 02-0.004 F.A.C


Page 2 of 4

↑ N

24-0293

Reuter  
4-2-24  
lin = 60 ft.

ATU System

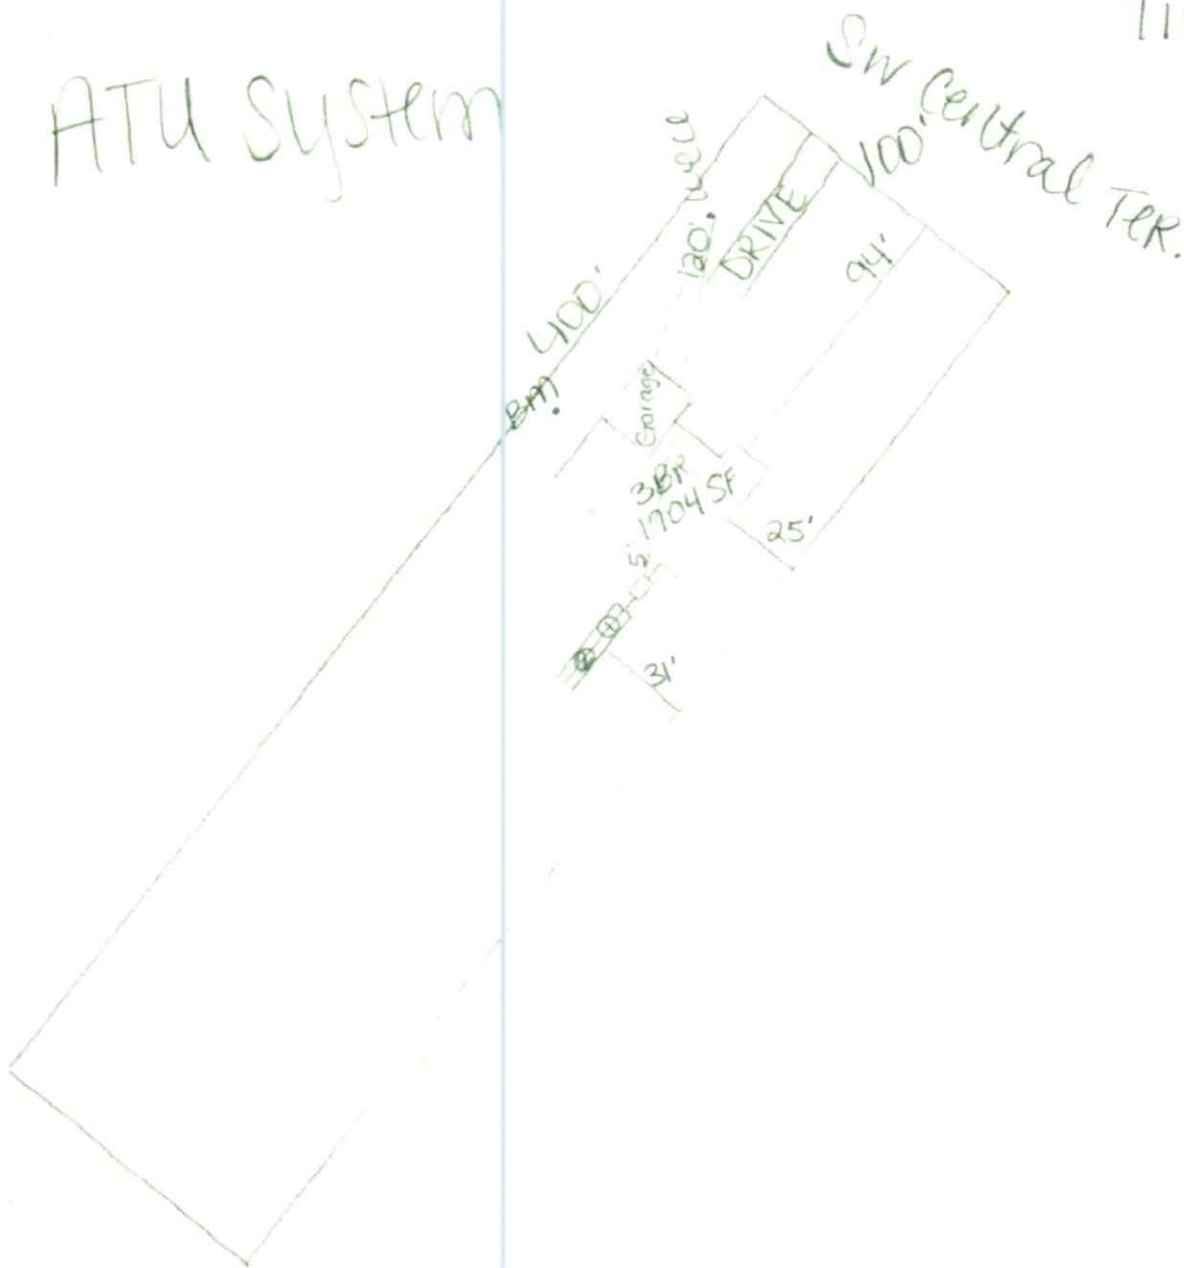

William R. Bishop II