



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 2524511 - IC CONST. - HANDY RES.

MiTek USA, Inc.

6904 Parke East Blvd.
Tampa, FL 33610-4115

Site Information:

Customer Info: IC CONST. Project Name: Handy Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: 292 SW Bradshaw Glen, N/A
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2017/TPI2014 Design Program: MiTek 20/20 8.2
Wind Code: ASCE 7-10 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 42 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.


No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T21941161	CJ01	11/19/20	23	T21941183	T08	11/19/20
2	T21941162	CJ02	11/19/20	24	T21941184	T09	11/19/20
3	T21941163	CJ03	11/19/20	25	T21941185	T09G	11/19/20
4	T21941164	CJ04	11/19/20	26	T21941186	T10	11/19/20
5	T21941165	EJ01	11/19/20	27	T21941187	T11	11/19/20
6	T21941166	EJ02	11/19/20	28	T21941188	T12	11/19/20
7	T21941167	EJ03	11/19/20	29	T21941189	T12G	11/19/20
8	T21941168	EJ04	11/19/20	30	T21941190	T13	11/19/20
9	T21941169	HJ08	11/19/20	31	T21941191	T14	11/19/20
10	T21941170	HJ09	11/19/20	32	T21941192	T14G	11/19/20
11	T21941171	PB01	11/19/20	33	T21941193	T15	11/19/20
12	T21941172	PB01G	11/19/20	34	T21941194	T16	11/19/20
13	T21941173	T01	11/19/20	35	T21941195	T17	11/19/20
14	T21941174	T01G	11/19/20	36	T21941196	T18	11/19/20
15	T21941175	T02	11/19/20	37	T21941197	T19	11/19/20
16	T21941176	T03	11/19/20	38	T21941198	T20	11/19/20
17	T21941177	T03G	11/19/20	39	T21941199	T21	11/19/20
18	T21941178	T04	11/19/20	40	T21941200	T22	11/19/20
19	T21941179	T05	11/19/20	41	T21941201	T23	11/19/20
20	T21941180	T05G	11/19/20	42	T21941202	T24	11/19/20
21	T21941181	T06	11/19/20				
22	T21941182	T07	11/19/20				

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource-Jacksonville.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2021.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

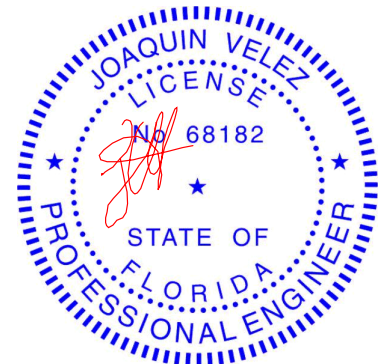


Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

Job 2524511	Truss CJ01	Truss Type Jack-Open	Qty 4	Ply 1	IC CONST. - HANDY RES. T21941161
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:41 2020 Page 1					
Job Reference (optional)					

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-TFIPnRbMrmEmteKwBuyLMDQj6X55qIOCewHupgyHh_W

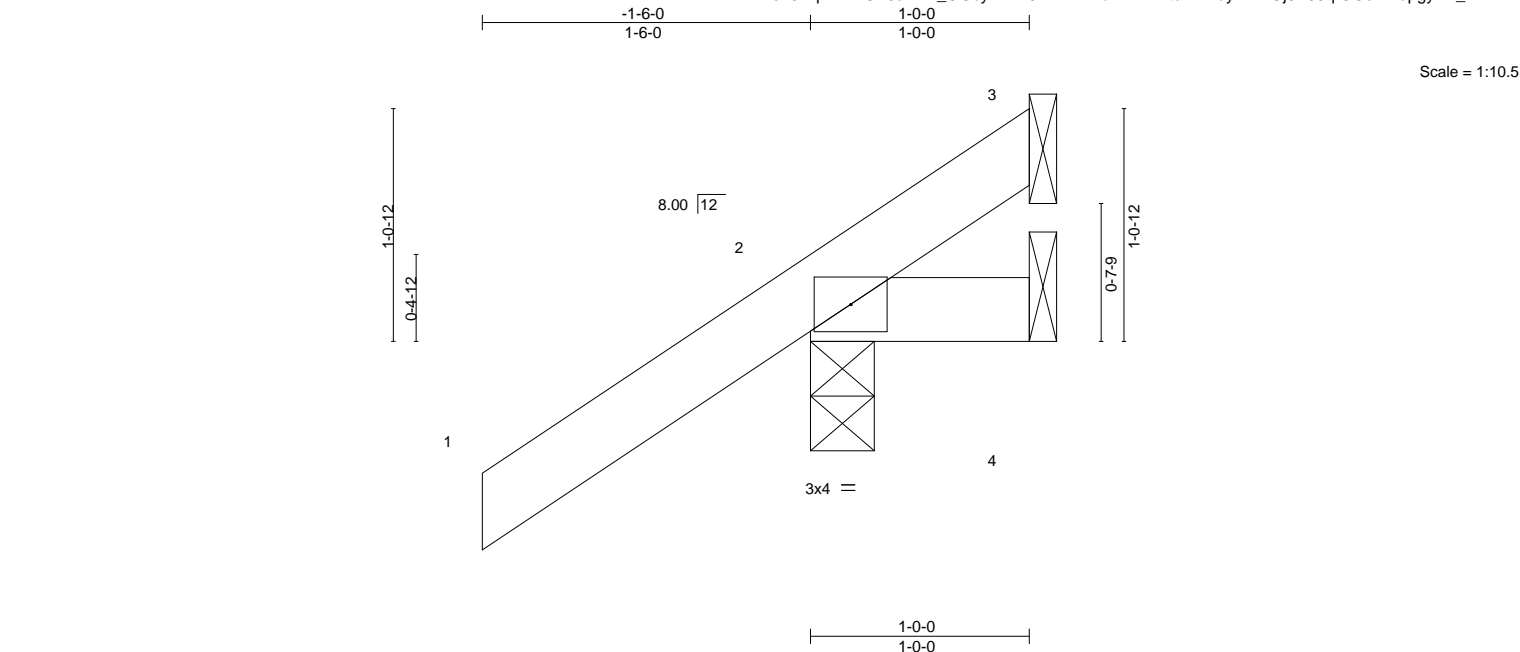


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	-0.00	7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	0.00	7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP						
Weight: 6 lb									FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=74(LC 12)
Max Uplift 3=5(LC 1), 2=109(LC 12), 4=20(LC 1)
Max Grav 3=10(LC 8), 2=179(LC 1), 4=30(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
4) Refer to girder(s) for truss to truss connections.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 3, 109 lb uplift at joint 2 and 20 lb uplift at joint 4.

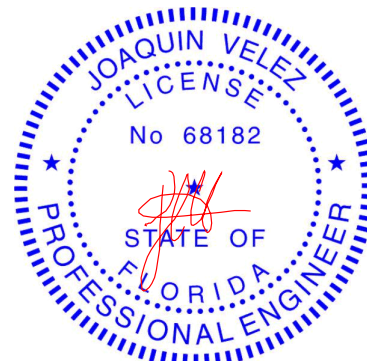

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2524511	Truss CJ02	Truss Type Jack-Open	Qty 2	Ply 1	IC CONST. - HANDY RES. T21941162
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:42 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-xSso?nc_c3MdUou6lcTauRxuZxRkZleMsa1SM6yHh_V

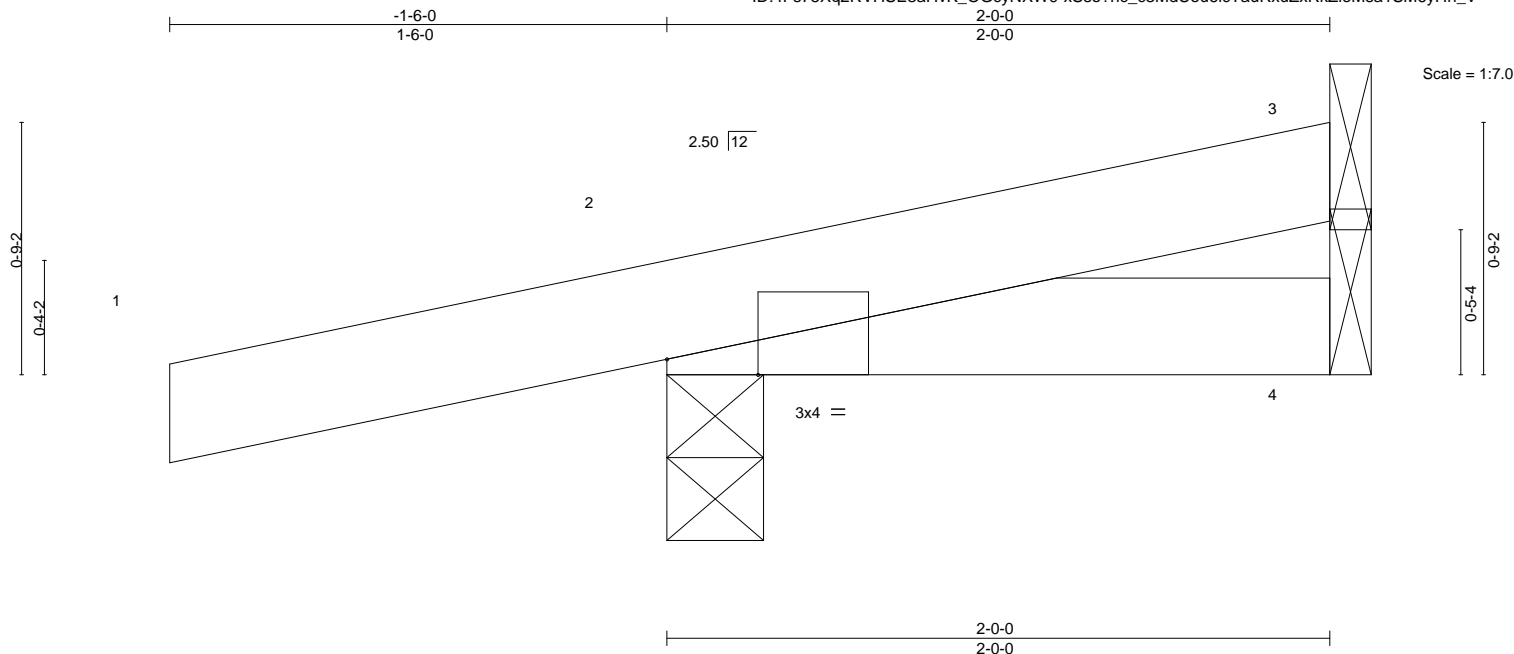


Plate Offsets (X,Y)--		[2:0-3-5,Edge]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.14
TCDL 7.0	Lumber DOL	1.25	BC 0.03
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code	FBC2017/TPI2014	Matrix-MP
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.00 7 >999 240
			Vert(CT) -0.00 7 >999 180
			Horz(CT) 0.00 2 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 8 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=40(LC 8)
Max Uplift 3=18(LC 8), 2=172(LC 8), 4=15(LC 9)
Max Grav 3=28(LC 1), 2=185(LC 1), 4=26(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 3, 172 lb uplift at joint 2 and 15 lb uplift at joint 4.

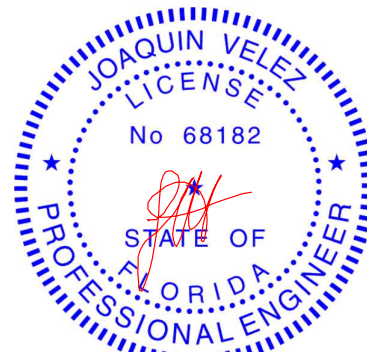

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2524511	Truss CJ03	Truss Type Jack-Open	Qty 4	Ply 1	IC CONST. - HANDY RES. T21941163
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:43 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-PePAC7ccNNUU6yTJlJ?pReT3cLmRICuV5Em?uYyHh_U

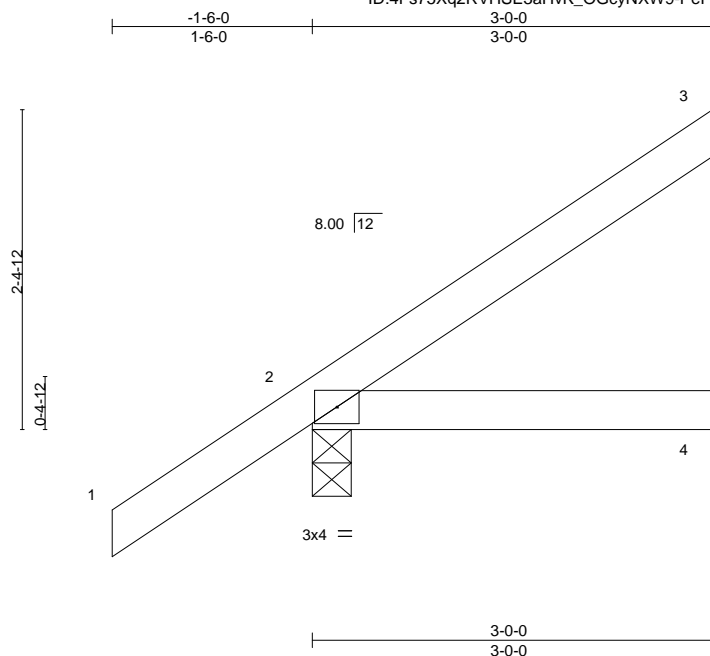

Scale = 1:17.3

LOADING (psf)	SPACING-	2'-0'-0'	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	-0.01	4-7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.12	Vert(CT)	-0.01	4-7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP						
									Weight: 13 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 3'-0'-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0'-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=137(LC 12)
Max Uplift 3=66(LC 12), 2=-85(LC 12)
Max Grav 3=71(LC 19), 2=210(LC 1), 4=51(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6'-0 tall by 2'-0'-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 66 lb uplift at joint 3 and 85 lb uplift at joint 2.

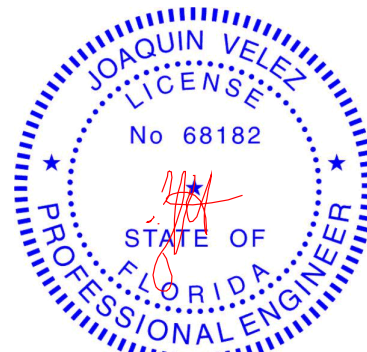

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941164
2524511	CJ04	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:44 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-tqzYQTdE8hclK52Vs1W2zs0ELk4c1f8eKuWYQ_yHh_T



Scale = 1:10.8

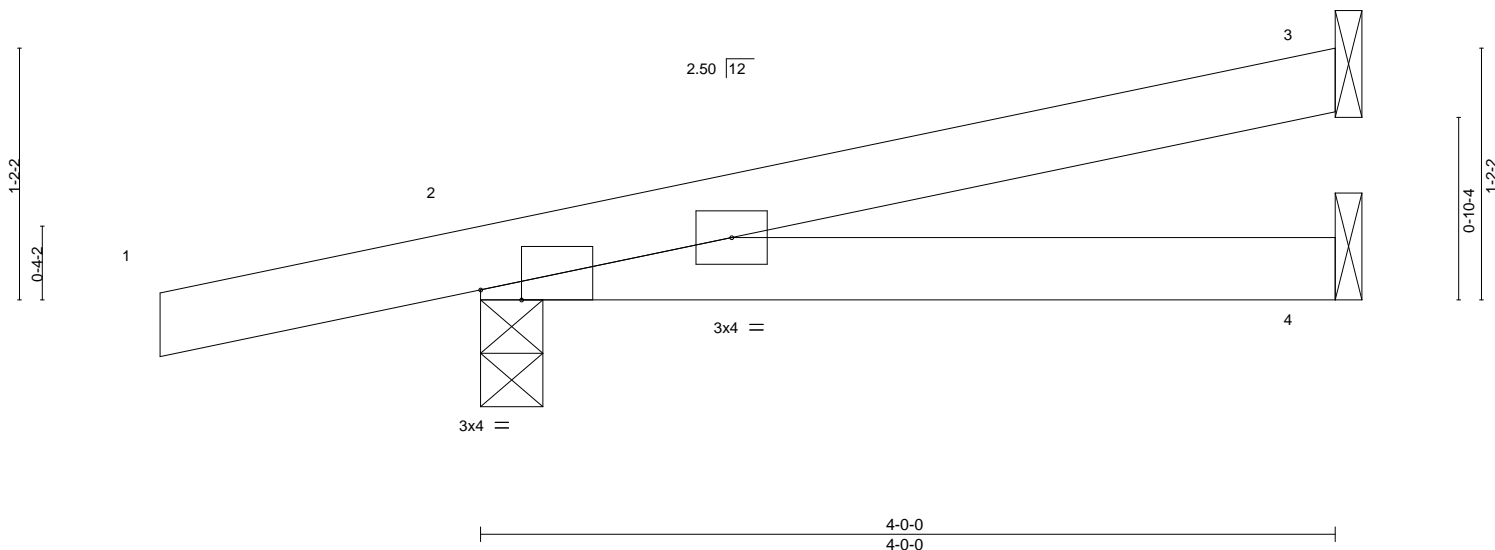


Plate Offsets (X,Y)--		[2:0-2-5,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	l/defl	L/d	PLATES
TCLL	20.0	Plate Grip DOL	1.25	TC	0.19	Vert(LL)	0.03	4-7	>999	240	MT20
TCDL	7.0	Lumber DOL	1.25	BC	0.19	Vert(CT)	-0.02	4-7	>999	180	GRIP
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	2	n/a	n/a	244/190
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MP							Weight: 14 lb
											FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=60(LC 8)
Max Uplift 3=64(LC 8), 2=210(LC 8), 4=37(LC 8)
Max Grav 3=83(LC 1), 2=242(LC 1), 4=65(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 3, 210 lb uplift at joint 2 and 37 lb uplift at joint 4.

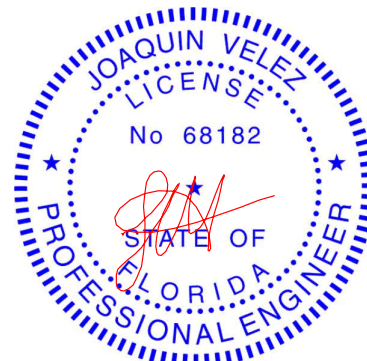

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job 2524511	Truss EJ01	Truss Type Jack-Partial	Qty 4	Ply 1	IC CONST. - HANDY RES. Job Reference (optional)	T21941165
----------------	---------------	----------------------------	----------	----------	----------------------------------------------------	-----------

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:46 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-qD5lq9fVgt3zPCu_SYW2H5X8YkUVZexnC?VtyHh_R

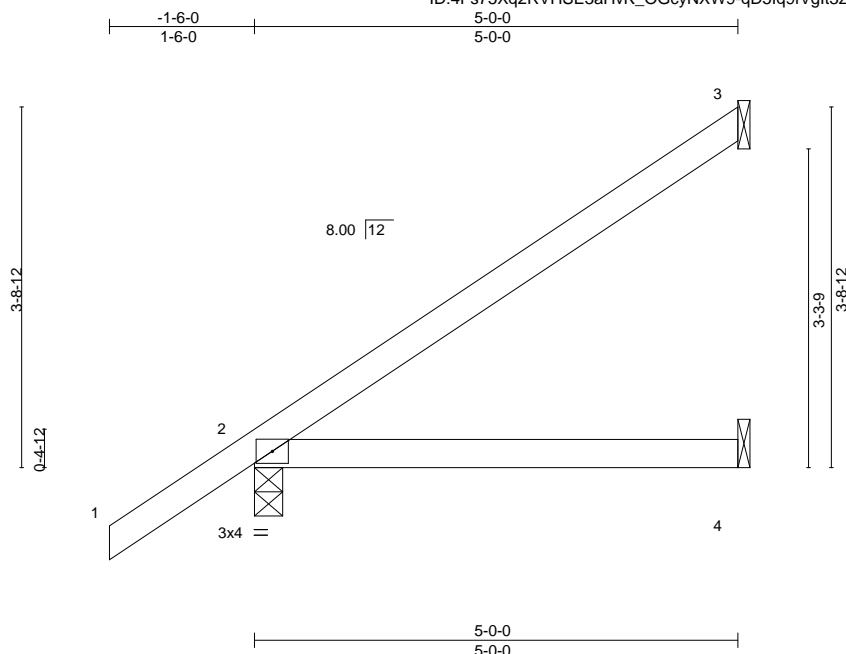

Scale: 1/2"=1'

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.36	Vert(LL)	0.04	4-7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.29	Vert(CT)	-0.07	4-7	>860	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP						
								Weight: 19 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=202(LC 12)
Max Uplift 3=122(LC 12), 2=90(LC 12), 4=7(LC 12)
Max Grav 3=131(LC 19), 2=276(LC 1), 4=89(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 122 lb uplift at joint 3, 90 lb uplift at joint 2 and 7 lb uplift at joint 4.

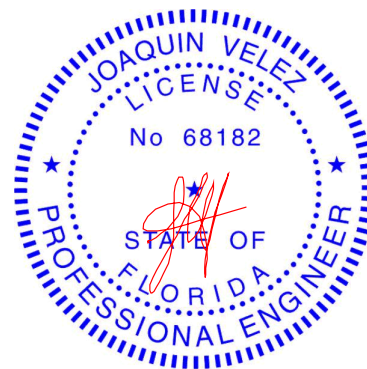

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941166
2524511	EJ02	Jack-Open	10	1		

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:47 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-IPfh2Vg7Rc?wbZn4X93lbUeiPy45E0C50skD1JyHh_Q

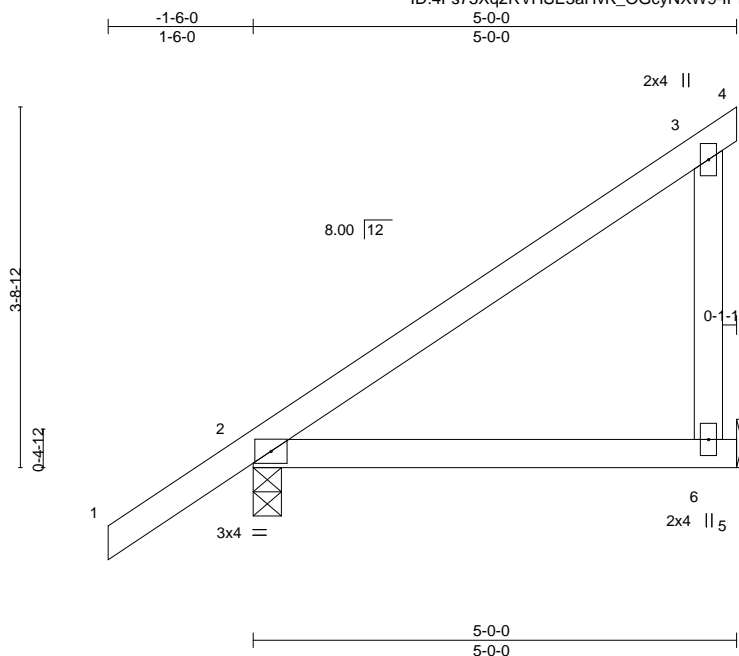

Scale: 1/2"=1'

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.03 6-9	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	-0.06 6-9	>986	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00 2	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP					Weight: 24 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 6=Mechanical

Max Horz 2=202(LC 12)


Max Uplift 2=-83(LC 12), 6=-136(LC 12)

Max Grav 2=268(LC 1), 6=197(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 83 lb uplift at joint 2 and 136 lb uplift at joint 6.

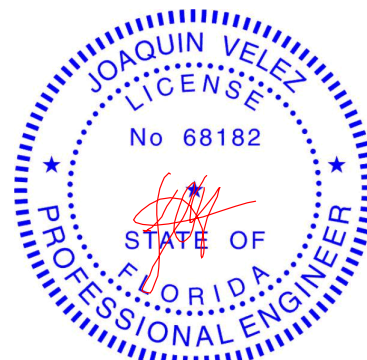

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610


Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941167
2524511	EJ03	Jack-Open Girder	1	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:48 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-mcD3FrglBv7mCjMG5ta_8iBtFMPjzTWEFWUmZmyHh_P

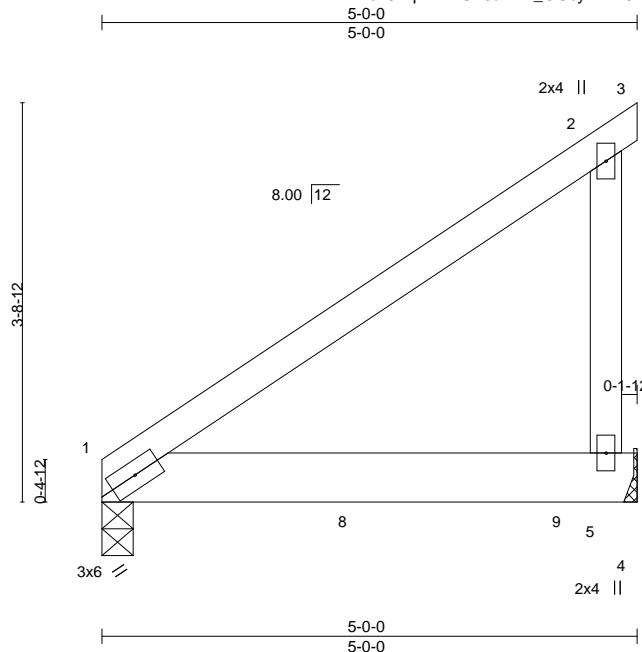

Scale = 1:21.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.38	Vert(LL)	-0.05	5-7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.37	Vert(CT)	-0.08	5-7	>673	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.00	5	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MP						
									Weight: 25 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x6 SP M 26

WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=Mechanical

Max Horz 1=161(LC 8)

Max Uplift 1=321(LC 8), 5=471(LC 8)

Max Grav 1=951(LC 1), 5=1041(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 321 lb uplift at joint 1 and 471 lb uplift at joint 5.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 547 lb down and 218 lb up at 0-4-12, and 541 lb down and 222 lb up at 2-4-12, and 545 lb down and 218 lb up at 4-4-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard


1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-2=-54, 2-3=-14, 1-4=-20

Concentrated Loads (lb)

Vert: 7=-547(B) 8=-541(B) 9=-545(B)

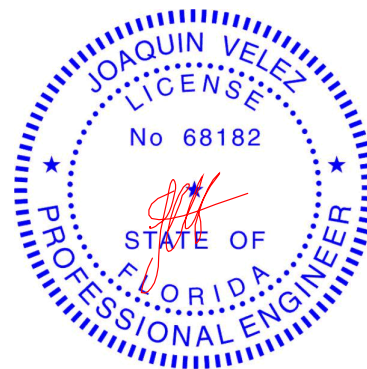

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941168
2524511	EJ04	Jack-Open	6	1		
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,						Job Reference (optional)

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:49 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-EonRTBhNyDFdqtXf5a5DgviJ0AljiwNOTADJ5CyHh_O



Scale = 1:14.5

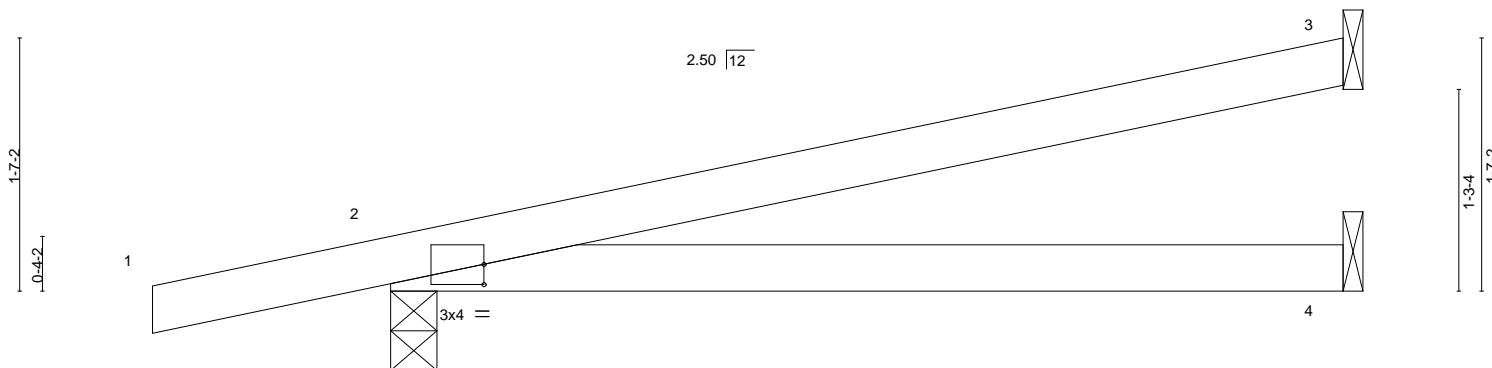

										6-0-0																			
Plate Offsets (X,Y)--										[2:0-0-0,0-1-8]										6-0-0									
LOADING (psf)		SPACING-		2-0-0		CSI.				DEFL.		in (loc)		l/defl		L/d		PLATES		GRIP									
TCLL	20.0	Plate Grip DOL	1.25	TC	0.50	Vert(LL)	0.17	4-7	>428	240	MT20	244/190																	
TCDL	7.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	0.14	4-7	>498	180																			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	2	n/a	n/a																			
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MP											Weight: 20 lb		FT = 20%												

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=80(LC 8)
Max Uplift 3=106(LC 8), 2=259(LC 8), 4=61(LC 8)
Max Grav 3=135(LC 1), 2=311(LC 1), 4=103(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 106 lb uplift at joint 3, 259 lb uplift at joint 2 and 61 lb uplift at joint 4.

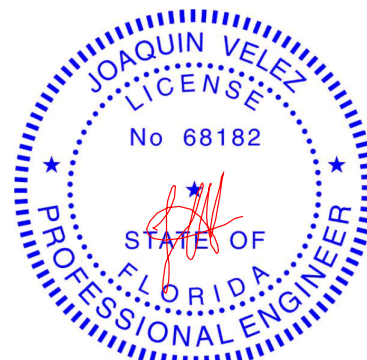

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941169
2524511	HJ08	Diagonal Hip Girder	2	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:50 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-i_KpgWi?jXNUS0WfDHdSD6G8u918RNdXipzteeYHh_N

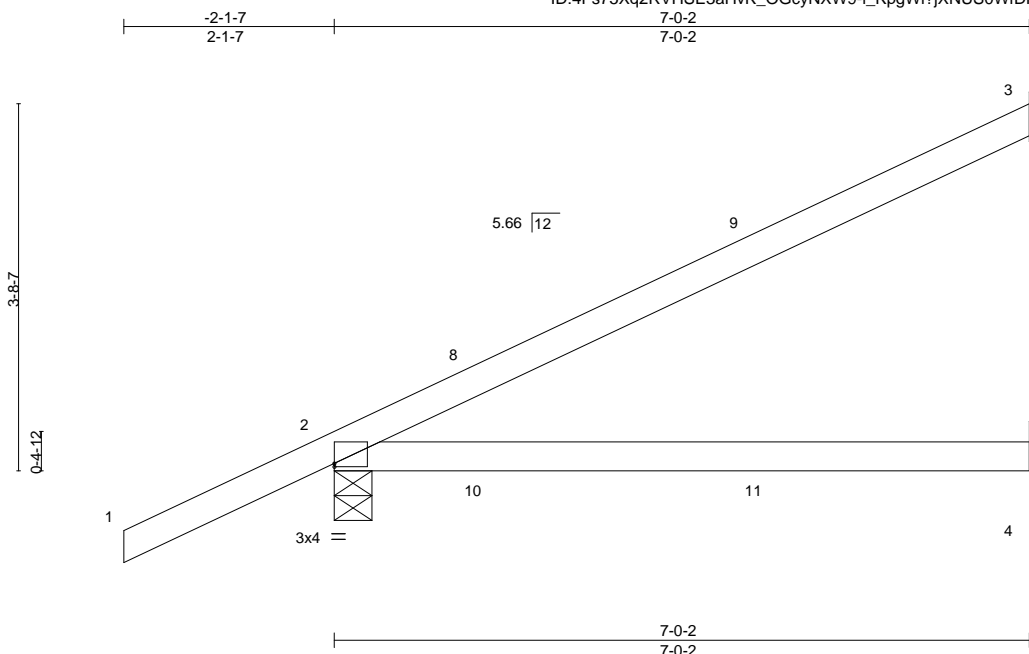

Scale = 1:23.2

Plate Offsets (X,Y)--		[2:Edge,0-0-6]									
LOADING	(psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC 0.69	Vert(LL)	0.13	4-7	>624	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC 0.57	Vert(CT)	-0.25	4-7	>338	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS						Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical
Max Horz 2=201(LC 8)
Max Uplift 3=155(LC 8), 2=213(LC 8), 4=12(LC 8)
Max Grav 3=160(LC 1), 2=391(LC 1), 4=126(LC 3)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 155 lb uplift at joint 3, 213 lb uplift at joint 2 and 12 lb uplift at joint 4.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 87 lb down and 76 lb up at 1-6-1, 87 lb down and 76 lb up at 1-6-1, and 110 lb down and 65 lb up at 4-4-0, and 110 lb down and 65 lb up at 4-4-0 on top chord, and 29 lb down and 46 lb up at 1-6-1, 29 lb down and 46 lb up at 1-6-1, and 28 lb down at 4-4-0, and 28 lb down at 4-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-5=-20
Concentrated Loads (lb)
Vert: 11=-4(F=-2, B=-2)

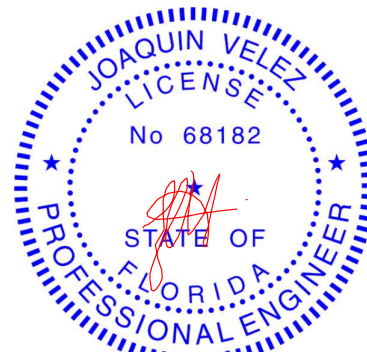

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:51 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-AAuBusjdUqVL3A4rm?8hIkPvZPuAmGgxTlQA4yHh_M
-2-1-7 4-8-0 8-5-1
2-1-7 4-8-0 3-9-1
Scale = 1:19.4

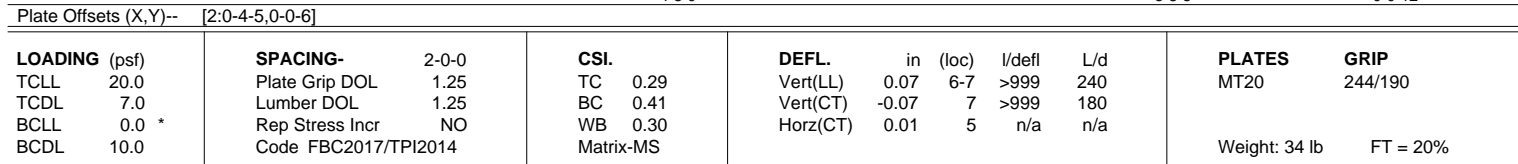

REACTIONS. (size) 4=Mechanical, 2=0-4-9, 5=Mechanical
 Max Horz 2=80(LC 4)
 Max Uplift 4=-74(LC 4), 2=-390(LC 4), 5=-193(LC 4)
 Max Grav 4=94(LC 1), 2=458(LC 1), 5=240(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-994/746
BOT CHORD	2-7=-776/977, 6-7=-776/977
WEBS	3-6=-999/793

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 74 lb uplift at joint 4, 390 lb uplift at joint 2 and 193 lb uplift at joint 5.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 15 lb down and 19 lb up at 2-11-0, 15 lb down and 19 lb up at 2-11-0, and 37 lb down and 71 lb up at 5-8-15, and 37 lb down and 71 lb up at 5-8-15 on top chord, and 8 lb down and 20 lb up at 2-11-0, 8 lb down and 20 lb up at 2-11-0, and 30 lb down and 52 lb up at 5-8-15, and 30 lb down and 52 lb up at 5-8-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 5-8=-20
Concentrated Loads (lb)
Vert: 12=-17(F=-8, B=-8) 13=-3(F=-2, B=-2) 14=-38(F=-19, B=-19)

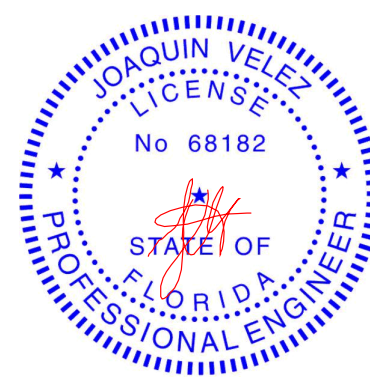

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


November 19, 2020

Job 2524511	Truss PB01	Truss Type Piggyback	Qty 15	Ply 1	IC CONST. - HANDY RES. T21941171
----------------	---------------	-------------------------	-----------	----------	-------------------------------------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:52 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-eNSa5CjGF8dChKf1KifwiXLB7zpmvHSqA7S_iXyHh_L



Scale = 1:21.7

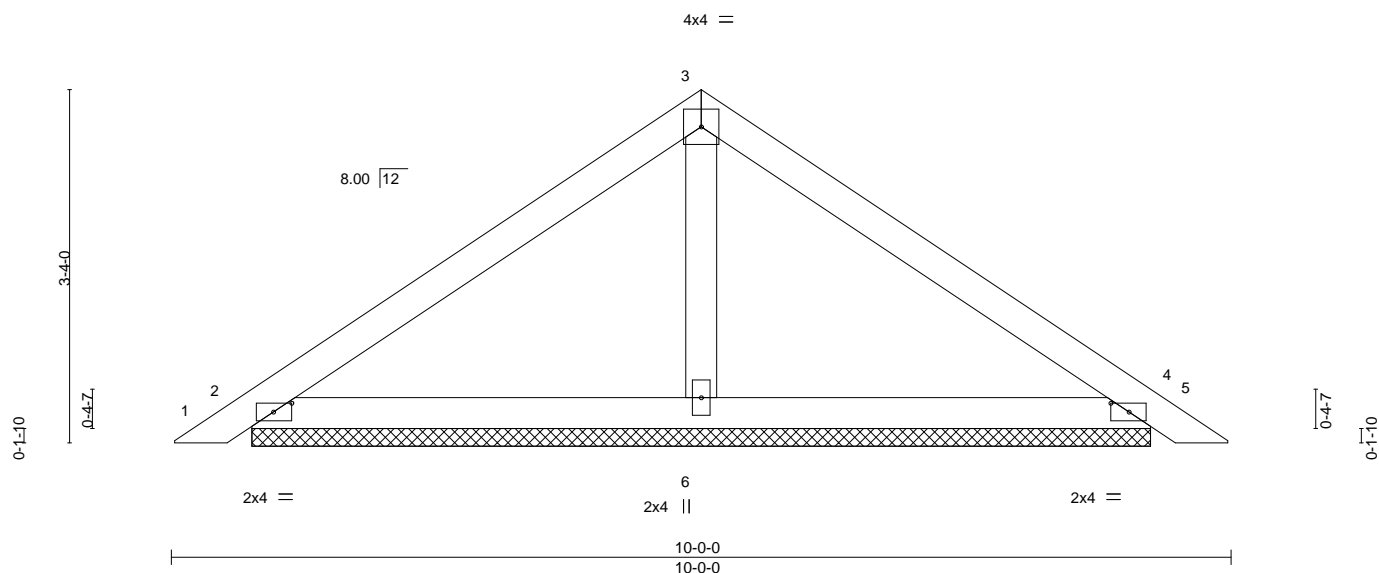


Plate Offsets (X,Y)--		[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.20		Vert(LL)	0.01 5 n/r 120	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.17		Vert(CT)	0.01 5 n/r 120		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.04		Horz(CT)	0.00 4 n/a n/a		
BCDL 10.0		Code	FBC2017/TPI2014	Matrix-S				Weight: 34 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 2=8-5-12, 4=8-5-12, 6=8-5-12
Max Horz 2=-98(LC 10)
Max Uplift 2=-86(LC 12), 4=-99(LC 13), 6=-87(LC 12)
Max Grav 2=181(LC 1), 4=181(LC 20), 6=318(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 2, 99 lb uplift at joint 4 and 87 lb uplift at joint 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

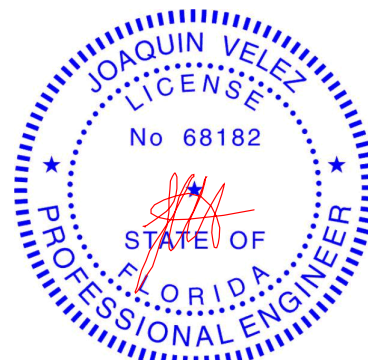

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941172
2524511	PB01G	GABLE	2	1		

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:53 2020 Page 1


ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-7Z0yJYku0SI3JUEEuQA9rlupHNBHekzOnBXEzyHh_K

Job Reference (optional)

8-11-6

4-5-11

Scale = 1:19.6

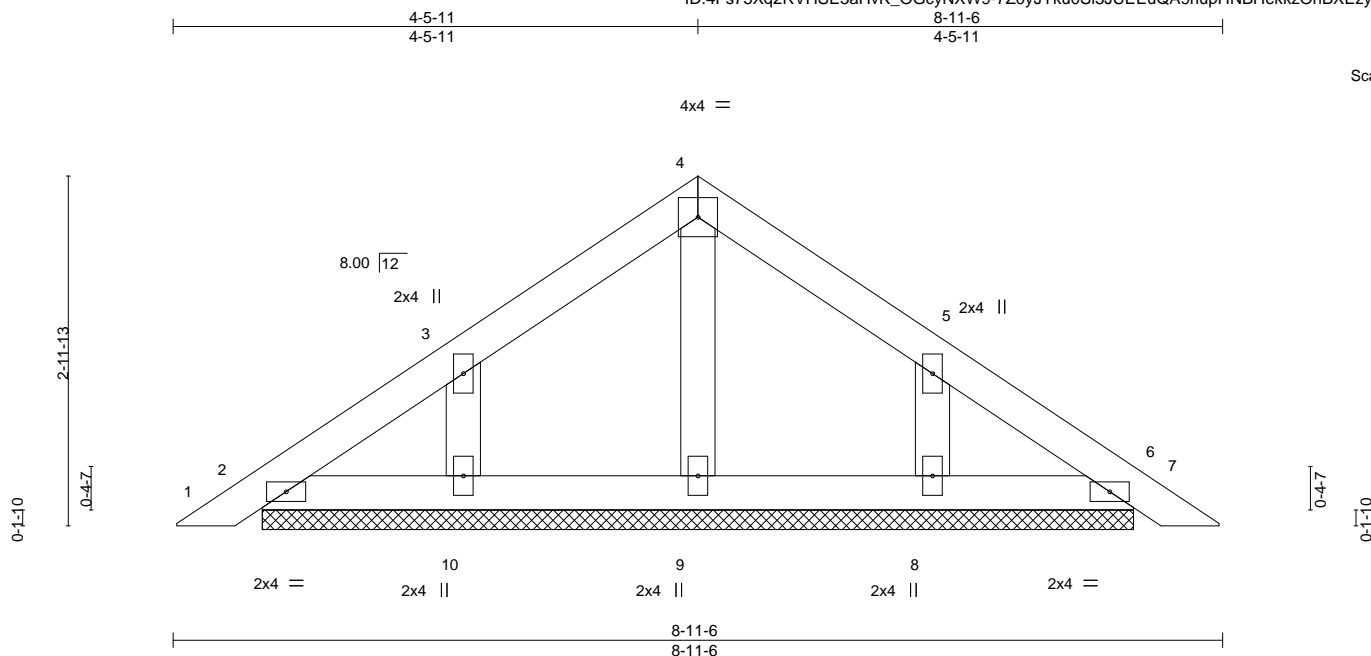

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.04	Vert(LL)	0.00	6	n/r	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.03	Vert(CT)	0.00	6	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S					Weight: 33 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

OTHERS 2x4 SP No.3

BRACING-

TOP CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 7-5-2.

(lb) - Max Horz 2=-87(LC 10)

Max Uplift All uplift 100 lb or less at joint(s) 2, 6 except 10=-121(LC 12), 8=-121(LC 13)


Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9, 10, 8

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 10=121, 8=121.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

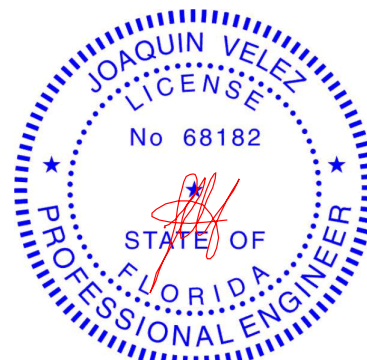

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941173
2524511	T01	ATTIC STRUCTURAL GAB	1	2	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:55 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-3y8ijEm8Y3?nYoOc?rCdwAz?hAmA6UeGs5geJsyHh_I

2-0-4	4-11-3	5-8-0	9-4-0	13-0-0	13-8-13	16-7-12	21-11-8	23-6-0
2-0-4	2-10-15	0-8-13	3-8-0	3-8-0	0-8-13	2-10-15	5-3-12	1-6-8

5x6 ==

Scale = 1:76.1

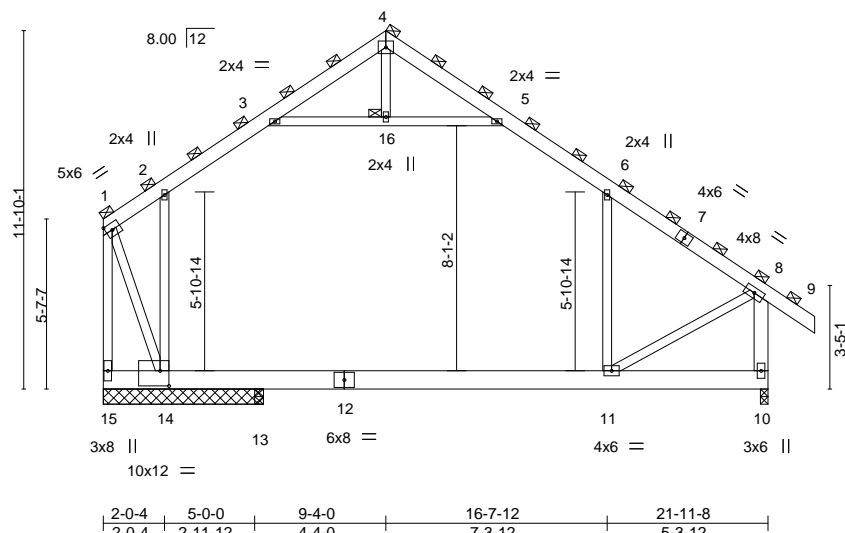


Plate Offsets (X,Y)-- [14:0-3-8,0-6-0]

LOADING (psf)	SPACING-	3-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.63	Vert(LL)	-0.17 11-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.45	Vert(CT)	-0.29 11-13	>698	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.59	Horz(CT)	0.00 10	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS	Attic	-0.12 11-14	1492	360	Weight: 392 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
BOT CHORD 2x8 SP 2400F 2.0E	(Switched from sheeted: Spacing > 2-8-0).
WEBS 2x4 SP No.3 *Except*	Rigid ceiling directly applied or 10-0-0 oc bracing.
8-10: 2x6 SP No.2	1 Brace at Jt(s): 4, 16, 1, 8

REACTIONS. All bearings 5-3-8 except (jt=length) 10=0-3-0, 13=0-3-8.
 (lb) - Max Horz 15=527(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) except 15=1195(LC 13), 14=5283(LC 21), 10=363(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) except 15=5246(LC 21), 14=1056(LC 13), 10=2029(LC 21), 13=2724(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1772/459, 2-3=-1421/511, 3-4=-428/192, 4-5=-409/220, 5-6=-1299/509,
 6-8=-1553/294, 1-15=-4778/1192, 8-10=-1824/440
 BOT CHORD 14-15=-497/523, 13-14=-50/1189, 11-13=-50/1189
 WEBS 2-14=-494/455, 6-11=-284/409, 3-16=-1198/444, 5-16=-1198/444, 1-14=-934/3816,
 8-11=0/1237

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 2-3, 5-6, 3-16, 5-16; Wall dead load (5.0psf) on member(s). 2-14, 6-11
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-14, 11-13
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1195 lb uplift at joint 15, 5283 lb uplift at joint 14 and 363 lb uplift at joint 10.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- This truss has large uplift reaction(s) from gravity load case(s). Proper connection is required to secure truss against upward movement at the bearings. Building designer must provide for uplift reactions indicated.
- Attic room checked for L/360 deflection.

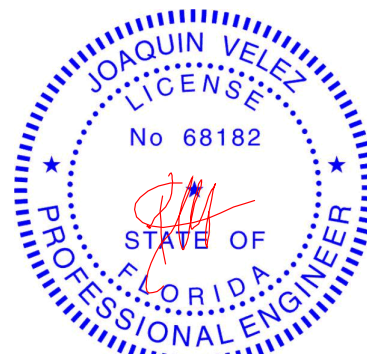

Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941174
2524511	T01G	GABLE	1	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:56 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-X8i4xanmJN7eAxzpZYksSNWG_aA1r0RP4iQBrlYHh_H

Job Reference (optional)

1-6-8	5-3-12	8-2-11	9-5-13	12-7-8	15-9-3	17-0-5	19-11-4	25-3-0	26-9-8
1-6-8	5-3-12	2-10-15	1-3-2	3-1-11	3-1-11	1-3-2	2-10-15	5-3-12	1-6-8

Scale = 1:67.9

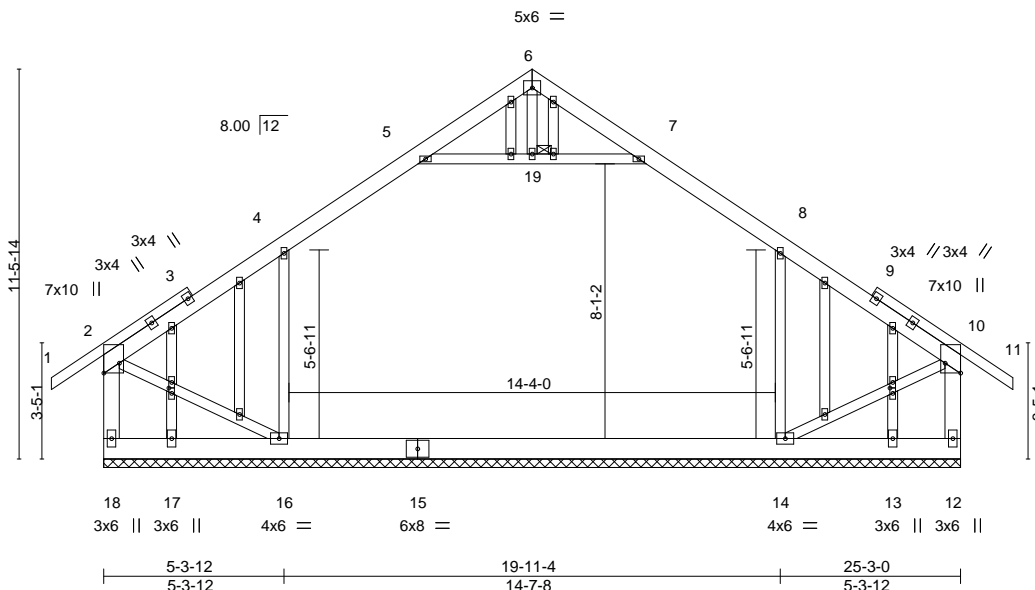


Plate Offsets (X,Y)-- [2:Edge,0-5-8], [10:Edge,0-5-8], [21:0-1-14,0-1-0], [26:0-1-14,0-1-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.21	Vert(LL)	-0.01 11	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.22	Vert(CT)	-0.01 10-11	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.30	Horz(CT)	0.00 12	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						
								Weight: 247 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2 *Except*
1-3,9-11: 2x4 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
2-18,10-12: 2x6 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 19

REACTIONS.


All bearings 25-3-0.
(lb) - Max Horz 18=412(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) except 18=157(LC 13), 12=155(LC 12), 14=231(LC 13), 16=232(LC 12), 13=506(LC 18), 17=506(LC 18)
Max Grav All reactions 250 lb or less at joint(s) except 18=896(LC 21), 12=891(LC 20), 14=1043(LC 21), 16=1046(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-18=-755/269, 2-4=-612/170, 4-5=-642/304, 5-6=-271/108, 6-7=-271/108, 7-8=-642/304, 8-10=-608/169, 10-12=-755/267
BOT CHORD 17-18=-372/362, 16-17=-372/362, 14-16=-99/525
WEBS 5-19=-360/264, 7-19=-360/264, 8-14=-468/263, 10-14=-77/553, 4-16=-471/264, 2-16=-78/553

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 5-19, 7-19; Wall dead load (5.0psf) on member(s).8-14, 4-16
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 157 lb uplift at joint 18, 155 lb uplift at joint 12, 231 lb uplift at joint 14, 232 lb uplift at joint 16, 506 lb uplift at joint 13 and 506 lb uplift at joint 17.
- Attic room checked for L/360 deflection.

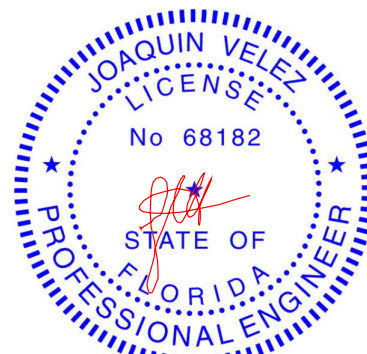

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941175
2524511	T02	Attic	3	1		

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:55:58 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-TXprMFo1r_NMPF7BhzmKYobTrOm2Jq2iY3vIwByHh_F

2-0-4 4-11-3 5-8-0 9-4-0 13-0-0 13-8-13 16-7-12 21-11-8 23-6-0
2-0-4 2-10-15 0-8-13 3-8-0 3-8-0 0-8-13 2-10-15 5-3-12 1-6-8

5x6 =

Scale = 1:74.1

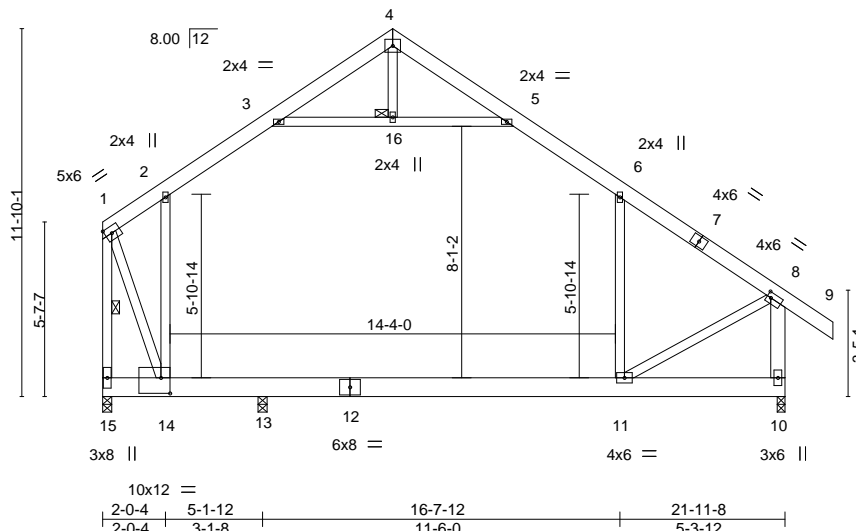


Plate Offsets (X,Y)-- [8:0-1-8,0-2-0], [14:0-3-8,0-6-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.82	Vert(LL)	-0.33 11-13	>598	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.57	Vert(CT)	-0.57 11-13	>349	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.68	Horz(CT)	0.01 10	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS	Attic	-0.24 11-14	737	360	Weight: 196 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
8-10: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-4-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-2-13 oc bracing.
WEBS 1 Row at midpt 1-15
JOINTS 1 Brace at Jt(s): 16

REACTIONS.


(size) 15=0-3-8, 10=0-3-0, 13=0-3-8
Max Horz 15=-351(LC 8)
Max Uplift 15=-319(LC 13), 10=-231(LC 13), 13=-16(LC 9)
Max Grav 15=1108(LC 21), 10=1296(LC 21), 13=1006(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-858/242, 2-3=-844/332, 3-4=-318/132, 4-5=-270/144, 5-6=-728/326, 6-8=-910/182,
1-15=-2469/652, 8-10=-1054/283
BOT CHORD 14-15=-338/351, 13-14=-24/711, 11-13=-24/711
WEBS 2-14=-451/223, 6-11=-203/253, 3-16=-609/278, 5-16=-609/278, 1-14=-548/2170,
8-11=-24/712

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 2-3, 5-6, 3-16, 5-16; Wall dead load (5.0psf) on member(s).2-14, 6-11
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-14, 11-13
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 319 lb uplift at joint 15, 231 lb uplift at joint 10 and 16 lb uplift at joint 13.
- Attic room checked for L/360 deflection.

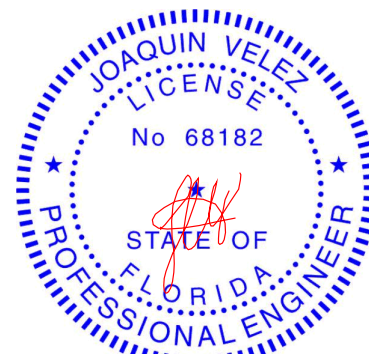

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941176
2524511	T03	ATTIC	6	1		

Builders FirstSource (Jacksonville, FL),
Jacksonville, FL - 32244,

8.240 s Mar 9 2020
MiTek Industries, Inc.
Thu Nov 19 07:55:59 2020
Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-xjNDZbpclVD1PiOEgHZ408f5n612L7snjerSdyHh_E

1-6-8
1-6-8

5-3-12
5-3-12

9-8-11
4-4-15

10-5-8 12-7-8
0-8-13 2-2-0

14-9-8 15-6-5
2-2-0 0-8-13

19-11-4
4-4-15


23-10-5
3-11-1

28-7-0
4-8-11

30-1-8
1-6-8

5x8 =

Scale = 1:67.3

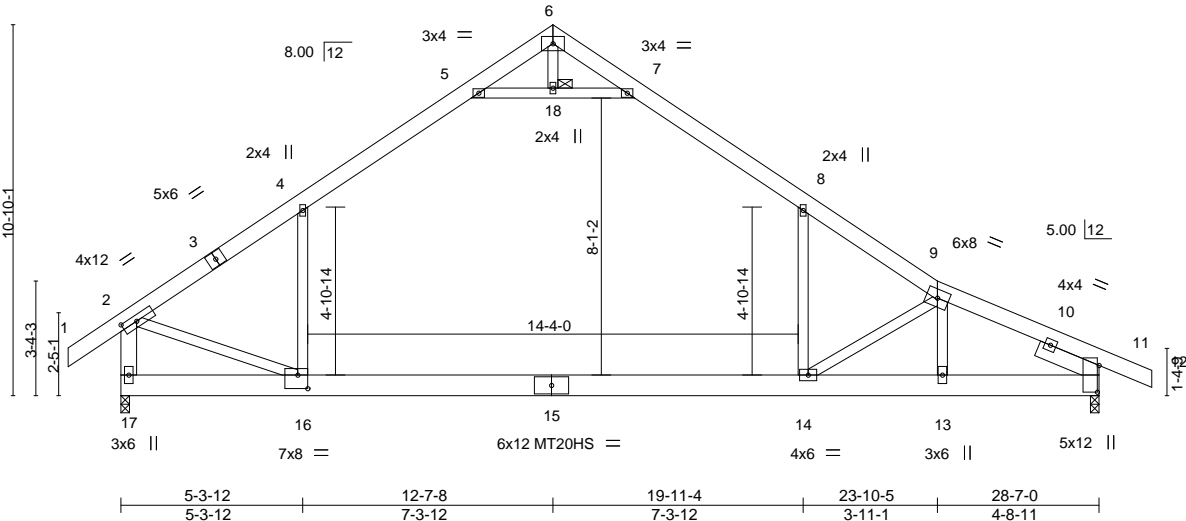


Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941177
2524511	T03G	GABLE	1	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:00 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-QvxbnqxHNbd3eZGaoOoodDhoLBTgni3??NOP_3yHh_D



Scale = 1:77.1

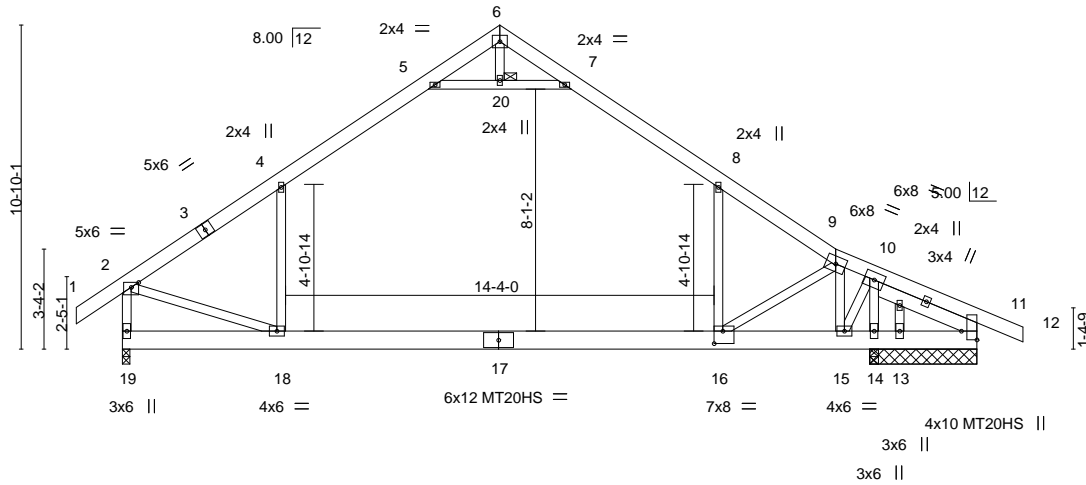


Plate Offsets (X,Y)--	[11:Edge,0-6-4], [16:0-3-8,0-5-0]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	1-4-0	TC 0.89	in (loc) l/deff L/d	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.49	Vert(LL) -0.39 16-18 >766 240	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.25	WB 0.77	Vert(CT) -0.63 16-18 >478 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.01 11 n/a n/a		
	Code FBC2017/TPI2014		Attic -0.27 16-18 645 360	Weight: 236 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2 *Except*
3-6: 2x6 SP M 26
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3
SLIDER Right 2x6 SP No.2 3-8-1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 20

REACTIONS.

All bearings 3-7-0 except (jt=length) 19=0-3-0.
(lb) - Max Horz 19=251(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) except 19=148(LC 12), 11=698(LC 21), 13=920(LC 21), 14=355(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 11, 13 except 19=1005(LC 20), 14=2926(LC 21), 14=1859(LC 1)


FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-918/94, 4-5=-682/211, 5-6=-33/330, 6-7=0/298, 7-8=-754/212, 8-9=-995/148, 9-10=-115/946, 10-11=-31/394, 2-19=-962/171
BOT CHORD 18-19=-142/288, 16-18=-44/764, 15-16=-788/175, 14-15=-1029/180, 13-14=-1052/185, 11-13=-1052/185
WEBS 4-18=-4/406, 8-16=-129/285, 9-16=0/1657, 9-15=-1822/53, 5-20=-1060/247, 7-20=-1060/247, 2-18=0/647, 10-14=-759/178, 10-15=-46/373

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are MT20 plates unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 8-9, 5-20, 7-20; Wall dead load (5.0psf) on member(s). 4-18, 8-16
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 16-18
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 148 lb uplift at joint 19, 698 lb uplift at joint 11, 920 lb uplift at joint 13 and 355 lb uplift at joint 14.
- NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS.

Continued on Page 2

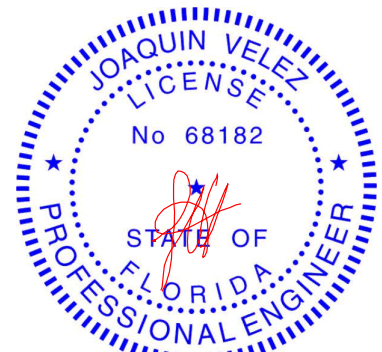

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941177
2524511	T03G	GABLE	1	1	Job Reference (optional)	

NOTES-
12) Attic room checked for L/360 deflection.




Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941178
2524511	T04	ATTIC	4	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:02 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-MI3LBdrXuDunusQywpqGiemAJ78jFisIThtV3yyHh_B



Scale = 1:66.3

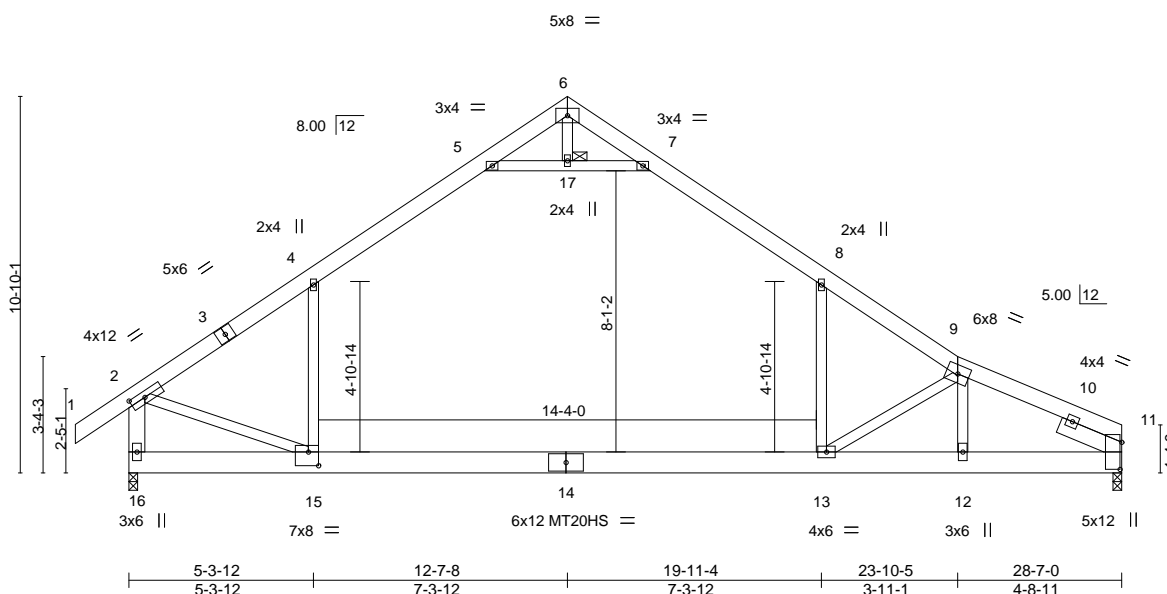


Plate Offsets (X,Y)--	[2:0-5-4-0-2-0], [11:0-9-6-0-0-10], [15:0-3-8-0-4-12]						
LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP		
TCLL 20.0	Plate Grip DOL 1.4-0	TC 0.73	in (loc) l/deff L/d	MT20	244/190		
TCDL 7.0	Lumber DOL 1.25	BC 0.52	Vert(LL) -0.56 13-15 >610 240	MT20HS	187/143		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.43	Vert(CT) -0.98 13-15 >346 180				
BCDL 10.0	Code FBC2017/TPI2014	Matrix-MS	Horz(CT) -0.05 11 n/a n/a				
			Attic -0.31 13-15 572 360	Weight: 222 lb	FT = 20%		

LUMBER-

TOP CHORD 2x6 SP M 26 *Except*
9-11,1-3: 2x6 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
2-16: 2x6 SP No.2
SLIDER Right 2x6 SP No.2 1-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-2-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 17

REACTIONS.


(size) 11=0-3-0, 16=0-3-0
Max Horz 16=-196(LC 10)
Max Uplift 11=-139(LC 13), 16=-133(LC 12)
Max Grav 11=1038(LC 2), 16=1233(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1494/145, 4-5=-1073/247, 5-6=-16/629, 6-7=-24/672, 7-8=-1026/239,
8-9=-1586/166, 9-11=-1625/292, 2-16=-1463/221
BOT CHORD 15-16=-168/292, 13-15=-30/1125, 12-13=-217/1494, 11-12=-220/1482
WEBS 4-15=0/671, 8-13=0/906, 9-13=-595/292, 9-12=-377/34, 5-17=-1822/323,
7-17=-1822/323, 2-15=-53/1103

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 7-8, 8-9, 5-17, 7-17; Wall dead load (5.0psf) on member(s).4-15, 8-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 139 lb uplift at joint 11 and 133 lb uplift at joint 16.
- NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
- Attic room checked for L/360 deflection.

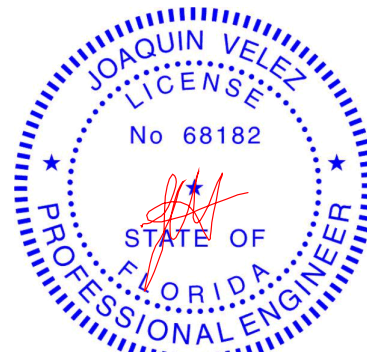

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941179
2524511	T05	ROOF TRUSS	1	1		
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,						8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:03 2020 Page 1
						ID:A4xBp23bIRyZpZZzk8Brq?yNXLX-qUdkPzs9fW0eV0?9TWMVFslQkPTQ_3ORhLc3bOyHh_A
Job Reference (optional)						

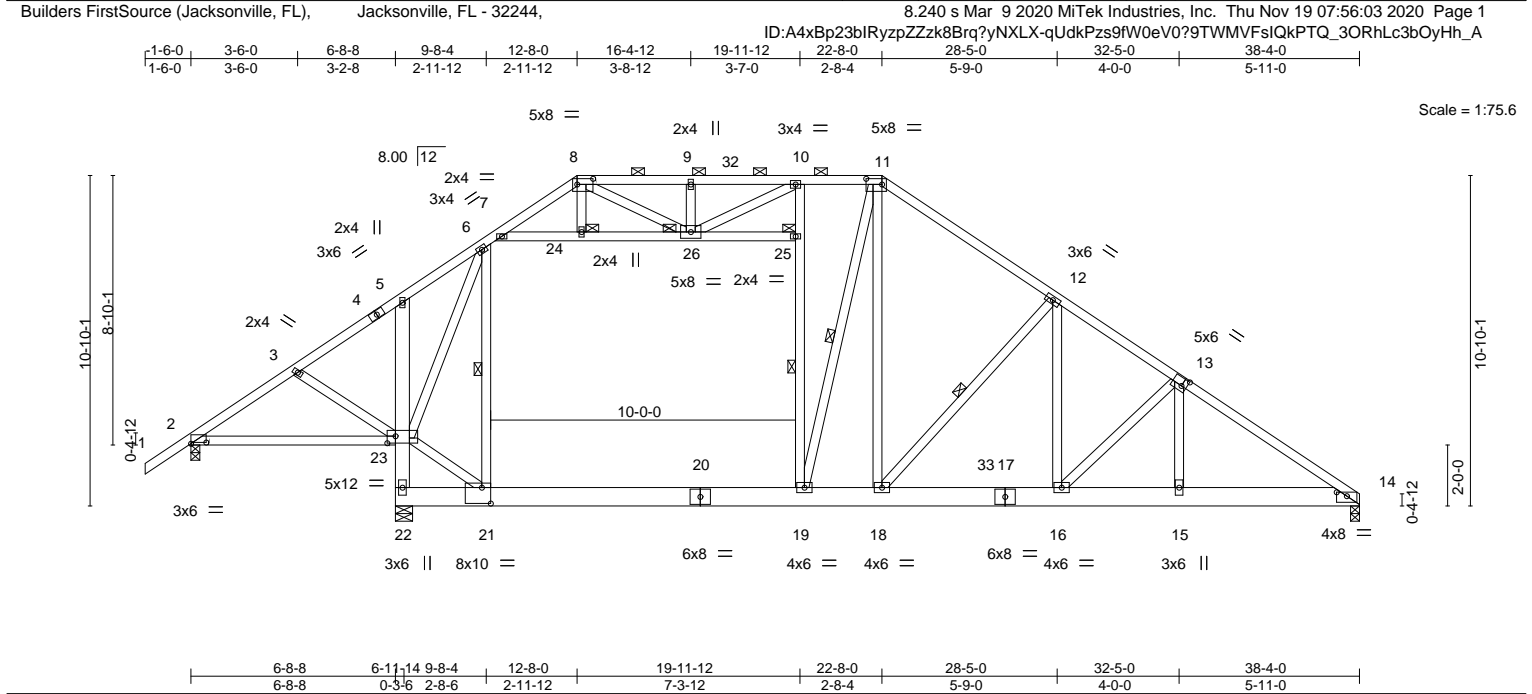


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/deff	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.43	Vert(LL)	-0.18 19-21	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.55	Vert(CT)	-0.35 19-21	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.80	Horz(CT)	0.09 14	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS	Attic	-0.10 19-21	1215	360	Weight: 332 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-4-8 oc purlins, except 2-0-0 oc purlins (4-4-7 max.): 8-11.
BOT CHORD 2x8 SP 2400F 2.0E *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
2-23: 2x4 SP No.2, 5-22: 2x6 SP No.2	6-0-0 oc bracing: 22-23,21-22.
WEBS 2x4 SP No.3	1 Row at midpt 12-18, 19-25, 6-21, 11-19
	JOINTS 1 Brace at Jt(s): 24, 25, 26

REACTIONS.	(size) 2=0-3-8, 22=0-6-12, 14=0-3-8
	Max Horz 2=320(LC 11)
	Max Uplift 2=308(LC 13), 22=321(LC 12), 14=441(LC 13)
	Max Grav 2=1463(LC 2), 22=830(LC 20), 14=1618(LC 21)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2244/497, 3-5=-2128/475, 5-6=-2087/532, 6-7=-1742/500, 7-8=-930/377, 8-9=-1457/568, 9-10=-1457/568, 10-11=-1684/513, 11-12=-2010/588, 12-13=-2374/679, 13-14=-2644/733
BOT CHORD	2-23=-285/1832, 22-23=-1369/328, 19-21=-30/1678, 18-19=-83/1615, 16-18=-324/1938, 15-16=-499/2146, 14-15=-498/2140
WEBS	11-18=-357/712, 12-18=-632/395, 12-16=-130/402, 13-16=-404/255, 7-24=-1043/246, 24-26=-1039/247, 19-25=-226/269, 10-25=-129/285, 6-21=-51/465, 21-23=-64/2006, 9-26=-254/170, 8-26=-254/849, 10-26=-442/63, 11-19=-53/463, 6-23=-277/427

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Ceiling dead load (5.0 psf) on member(s). 6-7, 7-24, 24-26, 25-26; Wall dead load (5.0psf) on member(s).19-25, 6-21
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 19-21
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 308 lb uplift at joint 2, 321 lb uplift at joint 22 and 441 lb uplift at joint 14.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Attic room checked for L/360 deflection.

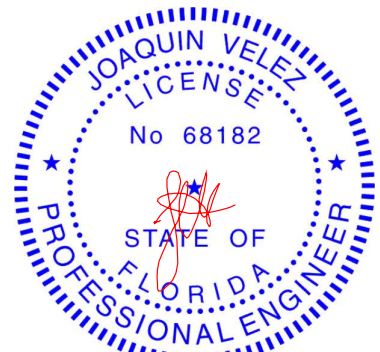

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941180
2524511	T05G	GABLE	1	1		

Builders FirstSource (Jacksonville, FL),
Jacksonville, FL - 32244,
8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:06 2020 Page 1
ID:A4xBp23bIRyzpZZzk8Brq?yNLX-E3ls1?u2yRODNuk9evCsUwy8cZuBOuuOJrjCjyHh_7

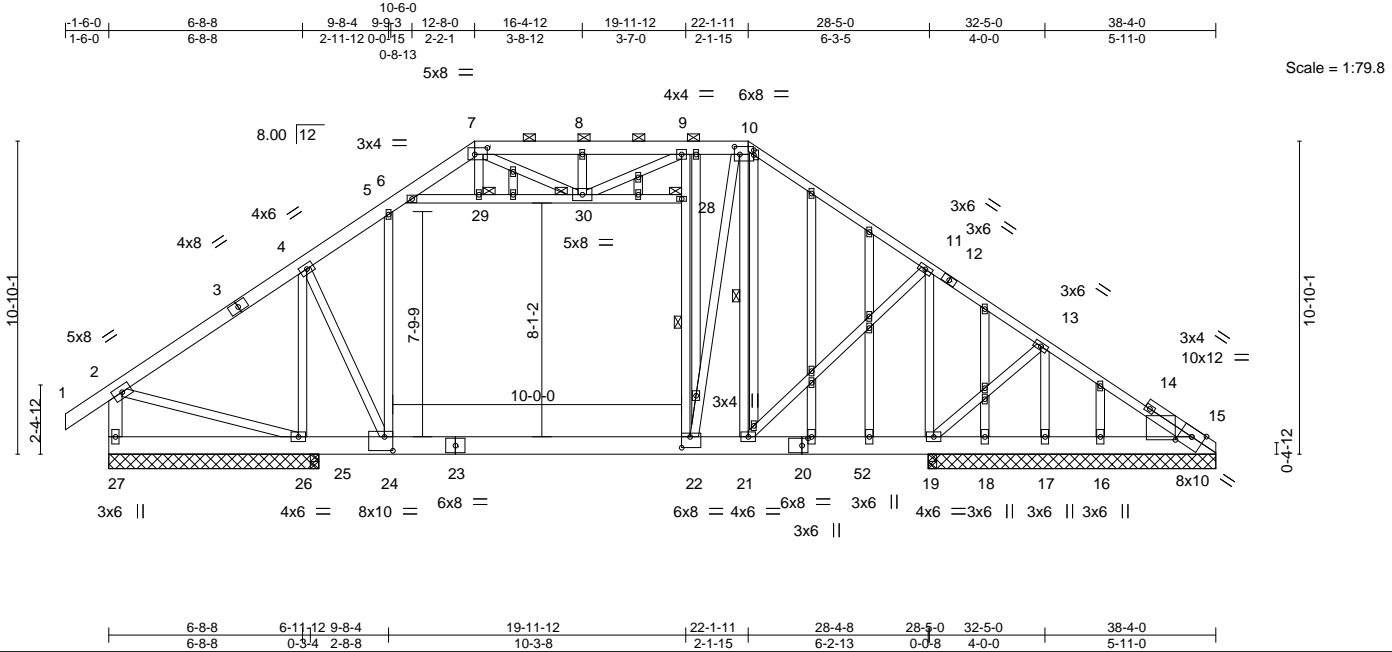


Plate Offsets (X,Y)--		[7:0-5-4,0-2-12], [10:0-2-4,0-3-4], [15:0-6-13,0-1-4], [20:0-2-8,0-3-0], [22:0-3-8,0-4-8], [24:0-3-8,0-5-12], [43:0-2-0,0-0-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc)		l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL 1.25		TC	0.36	Vert(LL)	-0.11 22-24	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL 1.25		BC	0.31	Vert(CT)	-0.18 22-24	>999	180		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.94	Horz(CT)	0.01 15	n/a	n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS		Attic	-0.09 22-24	1420	360	Weight: 424 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD	TOP CHORD
2x6 SP No.2 *Except*	Structural wood sheathing directly applied or 5-6-15 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-10.
10-12,12-15,14-15: 2x4 SP No.2	
BOT CHORD	BOT CHORD
2x8 SP 2400F 2.0E	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	WEBS
2x4 SP No.3 *Except*	1 Row at midpt 22-28, 10-21
2-27: 2x6 SP No.2	JOINTS
OTHERS	1 Brace at Jt(s): 28, 29, 30
2x4 SP No.3	

REACTIONS.	All bearings 9-11-8 except (jt=length) 27=7-3-4, 26=7-3-4, 25=0-3-8.
(lb) - Max Horz	27=365(LC 10)
Max Uplift	All uplift 100 lb or less at joint(s) 17, 18 except 27=117(LC 8), 19=273(LC 13), 16=148(LC 13), 25=497(LC 12)
Max Grav	All reactions 250 lb or less at joint(s) 15, 18, 15 except 27=740(LC 2), 19=1366(LC 27), 19=1203(LC 1), 26=1007(LC 18), 17=299(LC 20), 16=270(LC 21), 25=363(LC 20)


FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=698/202, 4-5=1105/191, 5-6=973/272, 6-7=684/308, 7-8=934/406, 8-9=934/406, 9-10=863/269, 10-11=934/246, 11-13=254/87, 2-27=677/223
BOT CHORD	26-27=337/374, 25-26=133/598, 24-25=133/598, 22-24=77/973, 21-22=70/806, 19-21=109/259
WEBS	22-28=334/239, 9-28=240/255, 10-22=1/941, 10-21=635/0, 11-21=32/824, 11-19=1219/327, 6-29=427/13, 29-30=423/15, 2-26=188/555, 7-30=128/459, 13-17=326/185, 4-26=1359/134, 4-24=0/921

- NOTES-
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
4) na
5) Provide adequate drainage to prevent water ponding.
6) All plates are 2x4 MT20 unless otherwise indicated.
7) Gable studs spaced at 2-0-0 oc.
8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
10) Ceiling dead load (5.0 psf) on member(s). 5-6, 6-29, 29-30, 28-30; Wall dead load (5.0psf) on member(s).5-24, 22-28
11) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 22-24

Continued on page 2
November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

6904 Parke East Blvd.
Tampa, FL 36610

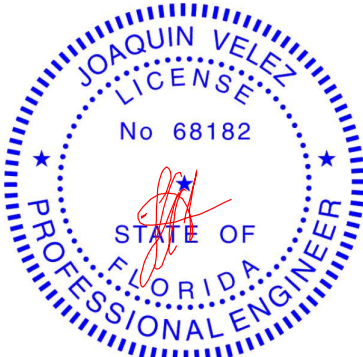

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941180
2524511	T05G	GABLE	1	1	Job Reference (optional)	

- NOTES-**
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 18 except (jt=lb) 27=117, 19=273, 16=148, 25=497.
 - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 14) Attic room checked for L/360 deflection.



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941182
2524511	T07	Piggyback Base	1	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:10 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-7qYnMxY0gufr51VOU_81K5fBDM67JsTlxpwLUyHh_3

Job Reference (optional)

1-6-0	3-6-0	6-8-8	9-4-0	12-8-0	17-8-0	22-8-0	24-0-0	28-5-0	32-5-0	36-0-0
1-6-0	3-6-0	3-2-8	2-7-8	3-4-0	5-0-0	5-0-0	1-4-0	4-5-0	4-0-0	3-7-0

Scale = 1:73.2

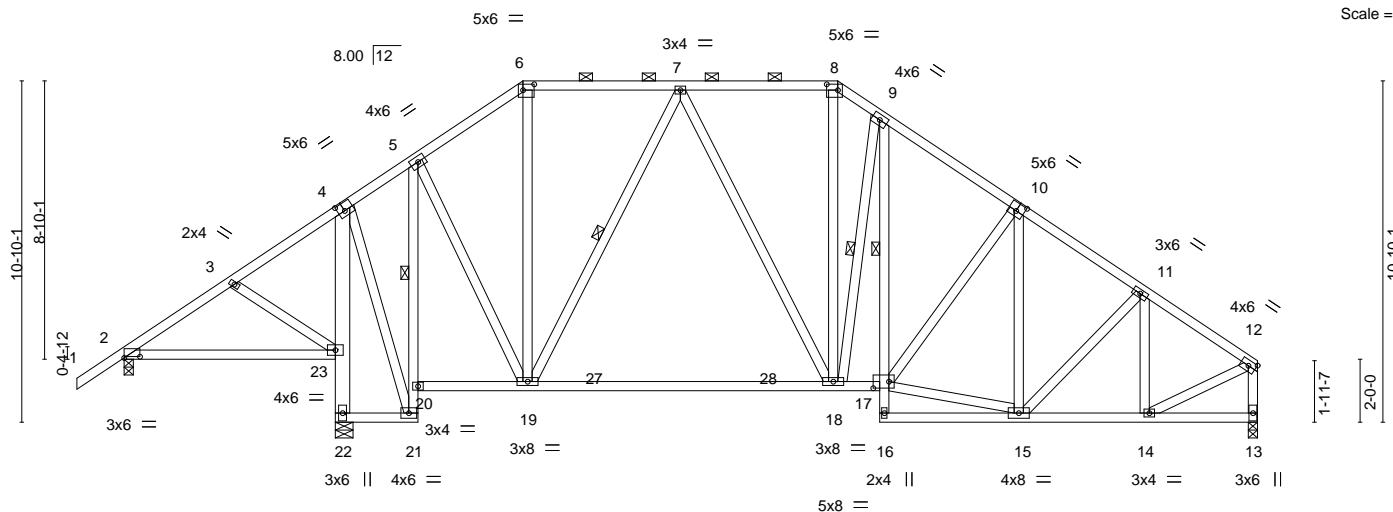


Plate Offsets (X,Y)--	[2:0-6-0,0-0-8], [4:0-2-8,0-3-0], [6:0-4-4,0-2-4], [8:0-4-4,0-2-4], [10:0-3-0,0-3-0], [17:0-6-0,0-2-8]
-----------------------	--------------------------------------------------------------------------------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/deff	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29	Vert(LL)	-0.29 18-19	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.93	Vert(CT)	-0.47 18-19	>733	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.05 13	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS					Weight: 304 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2 *Except*
 4-22: 2x6 SP No.2, 5-21,9-16: 2x4 SP No.3
 WEBS 2x4 SP No.3

REACTIONS.


(size) 2=0-3-8, 22=0-6-12, 13=0-3-8
 Max Horz 2=291(LC 11)
 Max Uplift 2=201(LC 13), 22=544(LC 12), 13=459(LC 13)
 Max Grav 2=279(LC 23), 22=1419(LC 1), 13=1050(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-259/305, 3-4=-236/305, 4-5=-441/402, 5-6=-697/501, 6-7=-614/464, 7-8=-862/585,
 8-9=-1032/690, 9-10=-1087/655, 10-11=-1112/596, 11-12=-1017/476, 12-13=-1015/480
 BOT CHORD 22-23=-1438/734, 4-23=-1265/481, 20-21=-794/253, 5-20=-829/253, 18-19=-184/723,
 17-18=-228/835, 14-15=-343/807
 WEBS 4-21=-269/906, 5-19=-138/622, 7-19=-531/264, 7-18=-66/275, 8-18=-281/495,
 9-18=-415/360, 15-17=-317/808, 12-14=-367/876, 11-14=-324/191, 3-23=-259/243

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=201, 22=544, 13=459.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

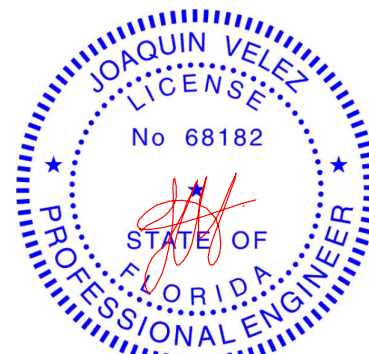

Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941183
2524511	T08	Piggyback Base	3	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:12 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-3Dg7I2zpYH8N5PBtVv0c6IAzV1STbFhmmFI1PNyHh_1


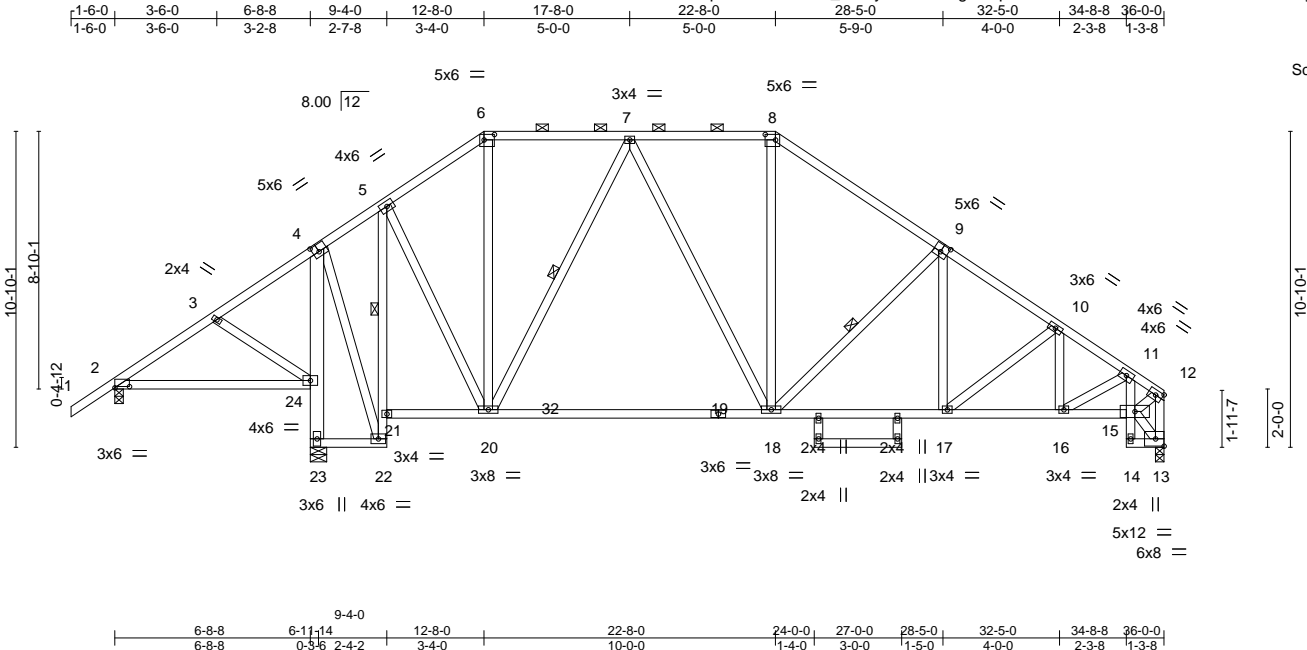


Plate Offsets (X,Y)--		[2:0-6-0,0-0-8], [4:0-2-8,0-3-0], [6:0-4-4,0-2-4], [8:0-4-4,0-2-4], [9:0-3-0,0-3-0]																	
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d		PLATES		GRIP	
TCLL 20.0		Plate Grip DOL		1.25		TC 0.36		Vert(LL)		-0.35 18-20		>995		240		MT20		244/190	
TCDL 7.0		Lumber DOL		1.25		BC 0.94		Vert(CT)		-0.55 18-20		>629		180					
BCLL 0.0 *		Rep Stress Incr		YES		WB 0.35		Horz(CT)		0.07 13		n/a		n/a					
BCDL 10.0		Code FBC2017/TPI2014				Matrix-MS										Weight: 281 lb		FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-11-1 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-8.
BOT CHORD 2x4 SP No.2 *Except* 4-23: 2x6 SP No.2, 5-22,11-14,25-26: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing. Except: 1 Row at midpt 5-21
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 7-20, 9-18
REACTIONS. (size) 2=0-3-8, 23=0-6-12, 13=0-3-8	
Max Horz 2=291(LC 11)	
Max Uplift 2=200(LC 13), 23=545(LC 12), 13=459(LC 13)	
Max Grav 2=277(LC 23), 23=1422(LC 1), 13=1050(LC 1)	

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=257/303, 3-4=234/306, 4-5=439/402, 5-6=696/501, 6-7=614/464, 7-8=862/588, 8-9=1048/621, 9-10=1295/664, 10-11=1311/618, 11-12=857/394, 12-13=1004/459	
BOT CHORD 23-24=1440/735, 4-24=1268/482, 21-22=796/254, 5-21=843/254, 18-20=185/721, 17-18=393/1041, 16-17=444/1063, 15-16=331/732, 11-15=511/251	
WEBS 4-22=270/907, 5-20=137/635, 7-20=526/262, 7-18=75/280, 8-18=142/326, 9-18=458/322, 11-16=130/382, 12-15=385/854, 3-24=259/243	

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=200, 23=545, 13=459.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

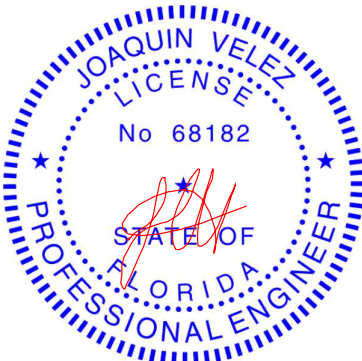


Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:13 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK OGcyNXW9-XPDWVO RjbGDiZm43dXrfzj2fRs0Ke3w?u1bypyHh 0



FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1079/590, 3-4=-840/561, 4-5=-1094/697, 5-6=-1382/747, 6-7=-1719/851,
7-8=-2038/861

BOT CHORD 14-15=-276/635, 12-14=-272/1016, 10-12=-403/1382, 9-10=-586/1613, 8-9=-586/1613

WEBS 2-14=-199/573, 3-14=-146/371, 4-14=-546/333, 4-12=-172/368, 5-12=-204/503,
6-12=-638/417, 7-10=-505/319, 7-9=-12/265, 2-15=-1320/633, 6-10=-208/455

November 19, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941185
2524511	T09G	GABLE	1	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:16 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-y_ve7P0JbWeoZ0VfkI4YGbLVWexgXwnMhsGFX8yHgzz

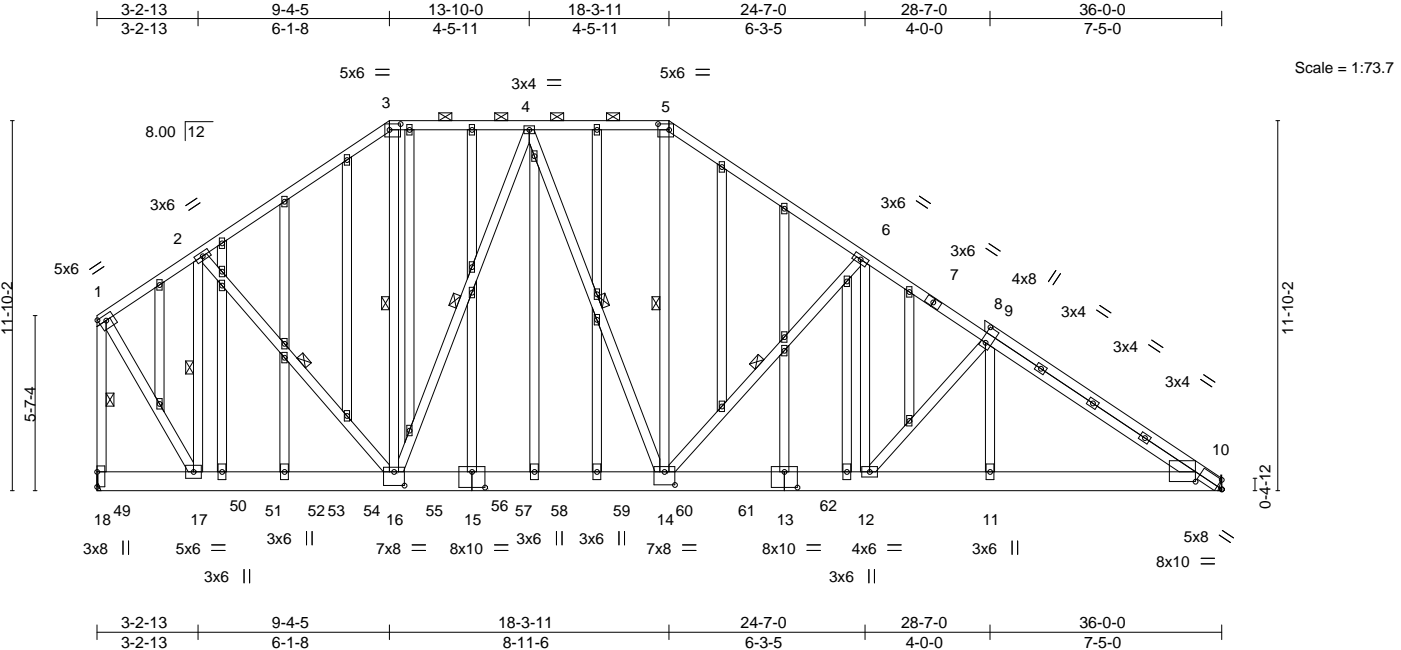


Plate Offsets (X,Y)--	[1:0-2-12,0-2-0], [3:0-4-4,0-2-4], [5:0-4-4,0-2-4], [9:0-6-0,0-1-12], [10:0-2-1,0-3-0], [10:0-10-2,0-2-15], [13:0-5-0,0-6-0], [14:0-4-0,0-5-0], [15:0-5-0,0-6-0], [16:0-4-0,0-5-4]
-----------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 1.00	Vert(LL)	0.21 12-14	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.41	Vert(CT)	-0.29 12-14	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.85	Horz(CT)	0.05 10	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS					Weight: 475 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-7-11 max.): 3-5.
BOT CHORD 2x8 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 9-5-9 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 2-17, 2-16, 3-16, 4-16, 5-14, 6-14, 1-18
OTHERS 2x4 SP No.3	

REACTIONS. (size) 18=Mechanical, 10=Mechanical
Max Horz 18=-386(LC 9)
Max Uplift 18=-1691(LC 8), 10=-1167(LC 9)
Max Grav 18=2868(LC 1), 10=2320(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1389/823, 2-3=-2245/1363, 3-4=-1795/1215, 4-5=-2432/1553, 5-6=-3012/1760, 6-9=-3705/2009, 9-10=-3916/2006, 1-18=-2708/1576
BOT CHORD 17-18=-287/389, 16-17=-756/1298, 14-16=-1106/2158, 12-14=-1402/3080, 11-12=-1561/3276, 10-11=-1561/3276
WEBS 2-17=-1491/825, 2-16=-609/1008, 3-16=-649/999, 4-16=-1085/583, 4-14=-461/853, 5-14=-805/1345, 6-14=-1019/624, 6-12=-344/805, 9-12=-469/340, 9-11=-145/262, 1-17=-1278/2217

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=1691, 10=1167.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 170 lb down and 152 lb up at 0-9-4, 166 lb down and 156 lb up at 2-9-4, 166 lb down and 156 lb up at 4-9-4, 166 lb down and 156 lb up at 6-9-4, 166 lb down and 156 lb up at 8-9-4, 166 lb down and 156 lb up at 10-9-4, 166 lb down and 156 lb up at 12-9-4, 166 lb down and 156 lb up at 14-9-4, 166 lb down and 156 lb up at 16-9-4, and 166 lb down and 156 lb up at 18-9-4, and 1020 lb down and 491 lb up at 20-9-4

Contractor's responsibility. The design/selection of such connection device(s) is the responsibility of others.

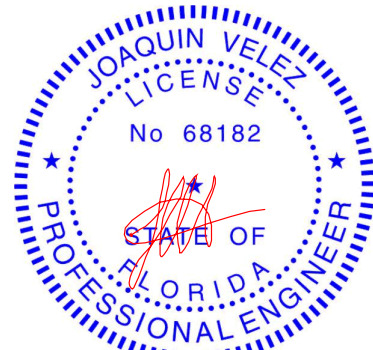

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941185
2524511	T09G	GABLE	1	1	Job Reference (optional)	

NOTES-
 13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).


- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-3=-54, 3-5=-54, 5-10=-54, 10-18=-20
 - Concentrated Loads (lb)
 - Vert: 49=-155(B) 50=-152(B) 51=-152(B) 53=-152(B) 54=-152(B) 55=-152(B) 57=-152(B) 58=-152(B) 59=-152(B) 60=-152(B) 61=-1020(B)

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941186
2524511	T10	Piggyback Base	1	1		


Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:18 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-uN1PY5Z277vWpKf1sA70M0QvRSZA?vLf8AIMc0yHgZx




Scale = 1:74.1

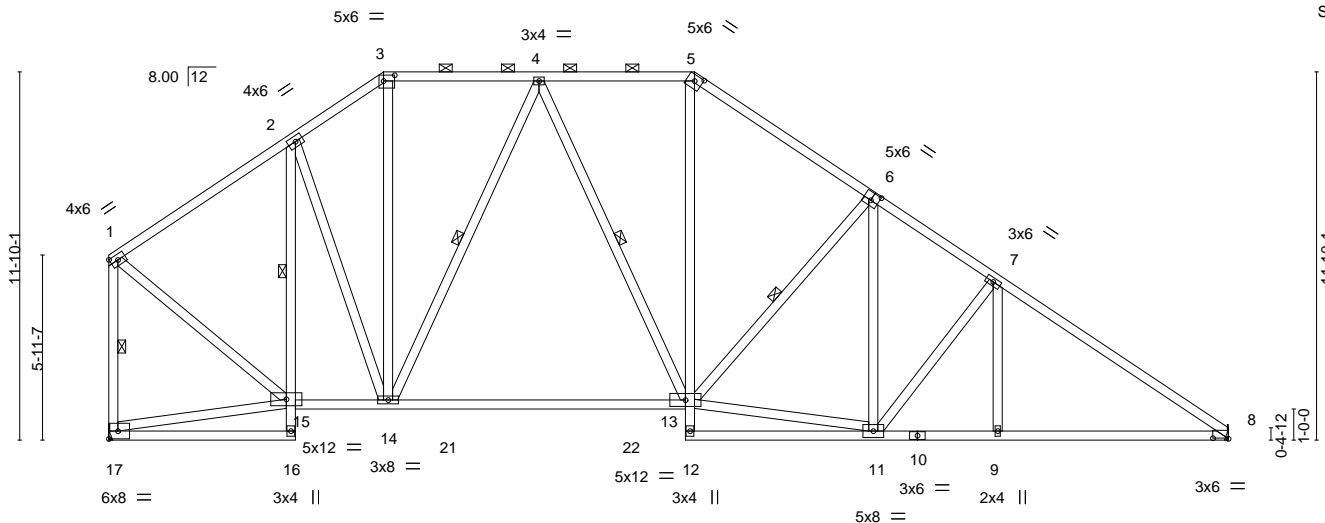

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:19 2020 Page 1

Job Reference (optional)



- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=-0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 3x6 MT20 unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=500, 10=534.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



November 19, 2020




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2524511	Truss T12	Truss Type Common	Qty 2	Ply 1	IC CONST. - HANDY RES. T21941188
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:20 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-qm89zn3qf19E2doQzb9URRWMDFG5TvDycUESgvyHgzv

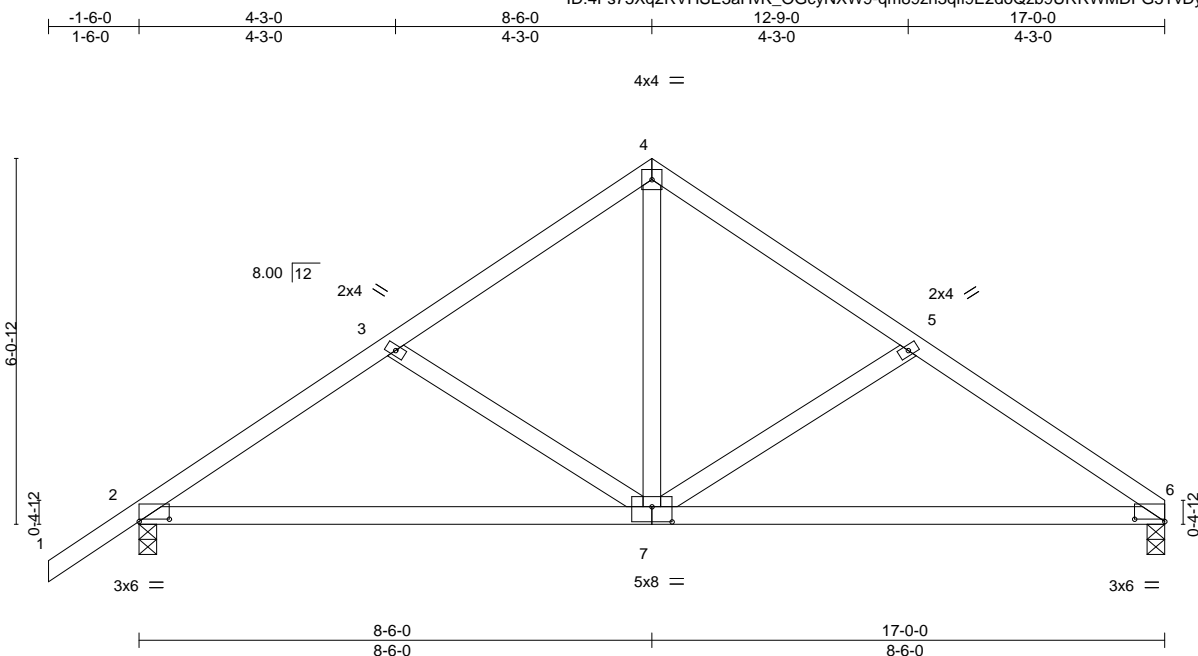

Scale = 1:38.2

Plate Offsets (X,Y)--		[2:0-6-0,0-0-7], [6:0-6-0,0-0-7], [7:0-4-0,0-3-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32
TCDL 7.0	Lumber DOL	1.25	BC 0.64
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.18
BCDL 10.0	Code	FBC2017/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.08 7-10 >999 240
			Vert(CT) -0.18 7-10 >999 180
			Horz(CT) 0.02 6 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 82 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 6=0-3-8, 2=0-3-8
Max Horz 2=197(LC 9)
Max Uplift 6=225(LC 13), 2=279(LC 12)
Max Grav 6=625(LC 1), 2=714(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-858/400, 3-4=-684/330, 4-5=-684/332, 5-6=-864/406
BOT CHORD 2-7=-307/735, 6-7=-269/700
WEBS 4-7=-202/537, 5-7=-316/260, 3-7=-323/248

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=225, 2=279.

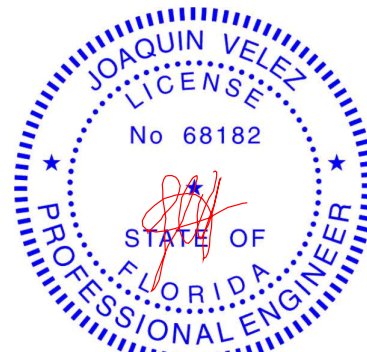

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job 2524511	Truss T12G	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	IC CONST. - HANDY RES. T21941189
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:22 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-m8GvOT54BMPyHxyo50ByWsbkC34rxqUE3ojZlNyHgzt



Scale = 1:37.9

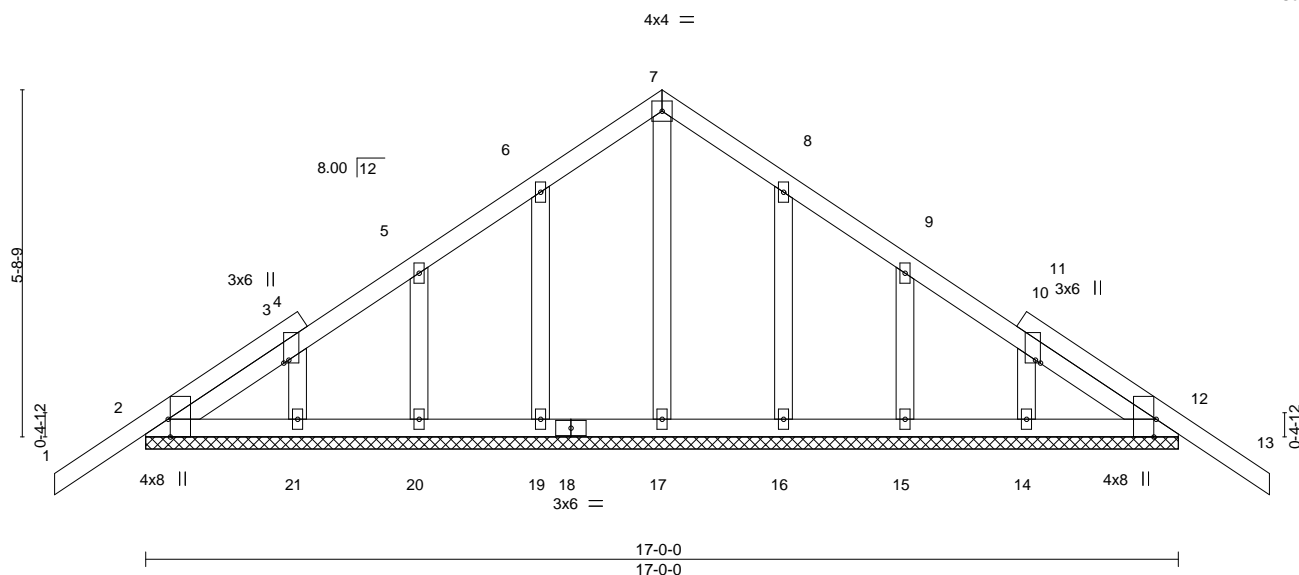


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [3:0-0-9,0-1-0], [11:0-0-9,0-1-0], [12:0-3-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	-0.01 13	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.04	Vert(CT)	-0.01 13	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00 12	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S					Weight: 99 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 17-0-0.
(lb) - Max Horz 2=197(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 12 except 19=117(LC 12), 20=107(LC 12), 21=100(LC 12),
16=115(LC 13), 15=110(LC 13), 14=102(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 17, 19, 20, 21, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12 except (jt=lb) 19=117, 20=107, 21=100, 16=115, 15=110, 14=102.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.

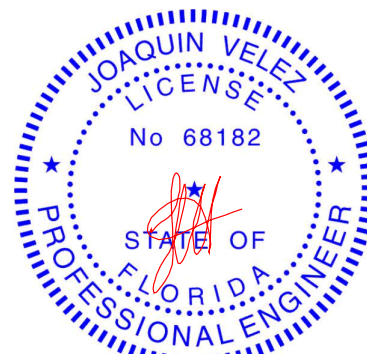

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941190
2524511	T13	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:23 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-EKqlbp5iygXpv5X?ejjB248q2TKWg7xOISS7HEyHgzs

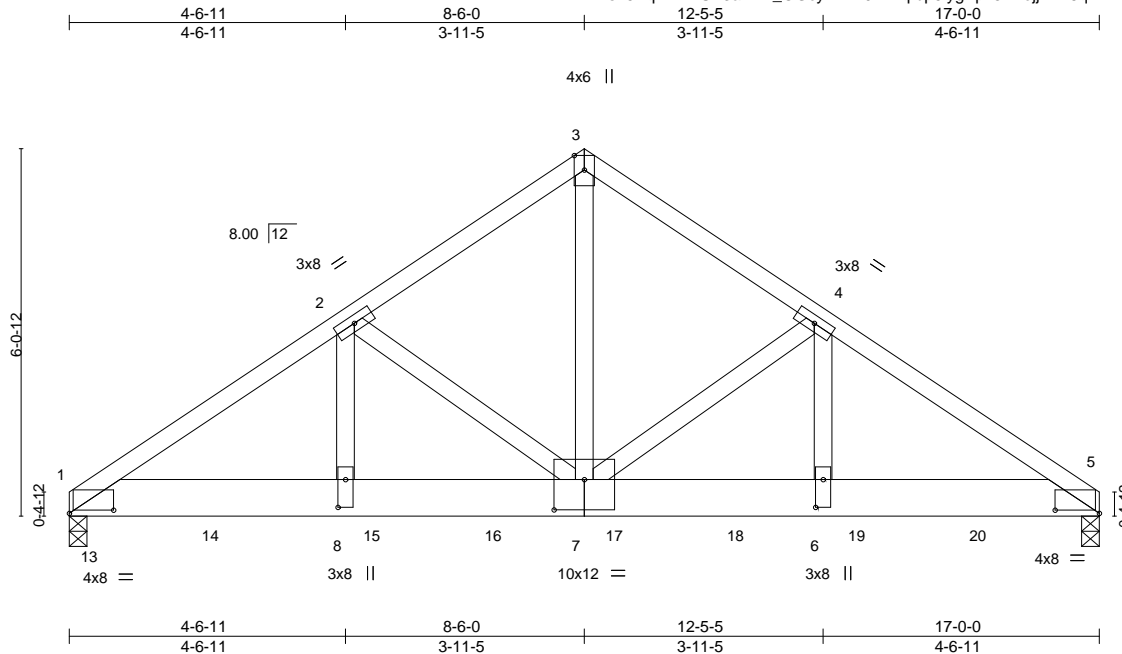

Scale = 1:38.0

Plate Offsets (X,Y)-- [1:0-8,12,0-0-10], [5:0-8,12,0-0-10], [6:0-5-8,0-1-8], [7:0-6-0,0-6-0], [8:0-5-8,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.47	Vert(LL)	0.12 7-8 >999	240	MT20 244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.40	Vert(CT)	-0.19 7-8 >999	180	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.76	Horz(CT)	0.04 5 n/a	n/a	
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS					Weight: 224 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
3-7: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=0-3-8
Max Horz 1=176(LC 6)
Max Uplift 1=2476(LC 8), 5=2294(LC 9)
Max Grav 1=5921(LC 1), 5=5799(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=9218/3913, 2-3=6319/2654, 3-4=6334/2658, 4-5=8849/3546
BOT CHORD 1-8=3285/7634, 7-8=3285/7634, 6-7=2875/7337, 5-6=2875/7337
WEBS 3-7=2802/6724, 4-7=2645/1123, 4-6=1013/2774, 2-7=3016/1498, 2-8=1449/3221

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=2476, 5=2294.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 547 lb down and 218 lb up at 0-4-12, 541 lb down and 222 lb up at 2-4-12, 541 lb down and 222 lb up at 4-4-12, 2300 lb down and 1187 lb up at 5-0-12, 1307 lb down and 527 lb up at 7-0-12, 1307 lb down and 527 lb up at 9-0-12, 1307 lb down and 527 lb up at 11-0-12, and 1307 lb down and 527 lb up at 13-0-12, and 1307 lb down and 480 lb up at 15-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)

Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

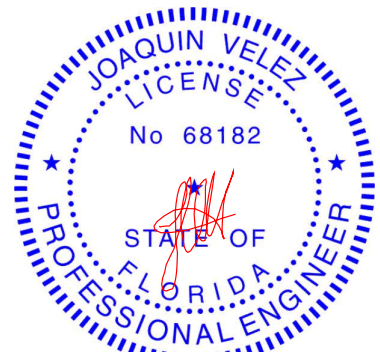

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941190
2524511	T13	Common Girder	1	2	Job Reference (optional)	

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 1-3=-54, 3-5=-54, 1-5=-20


Concentrated Loads (lb)

Vert: 8=-541(F) 13=-547(F) 14=-541(F) 15=-2300(F) 16=-1307(F) 17=-1307(F) 18=-1307(F) 19=-1307(F) 20=-1307(F)



Job 2524511	Truss T14	Truss Type Common	Qty 1	Ply 1	IC CONST. - HANDY RES. T21941191
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:24 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-jXOgp86KjzfgXF6BCQEQbHg2Ysd6PJEXW6CgqgyHgzz

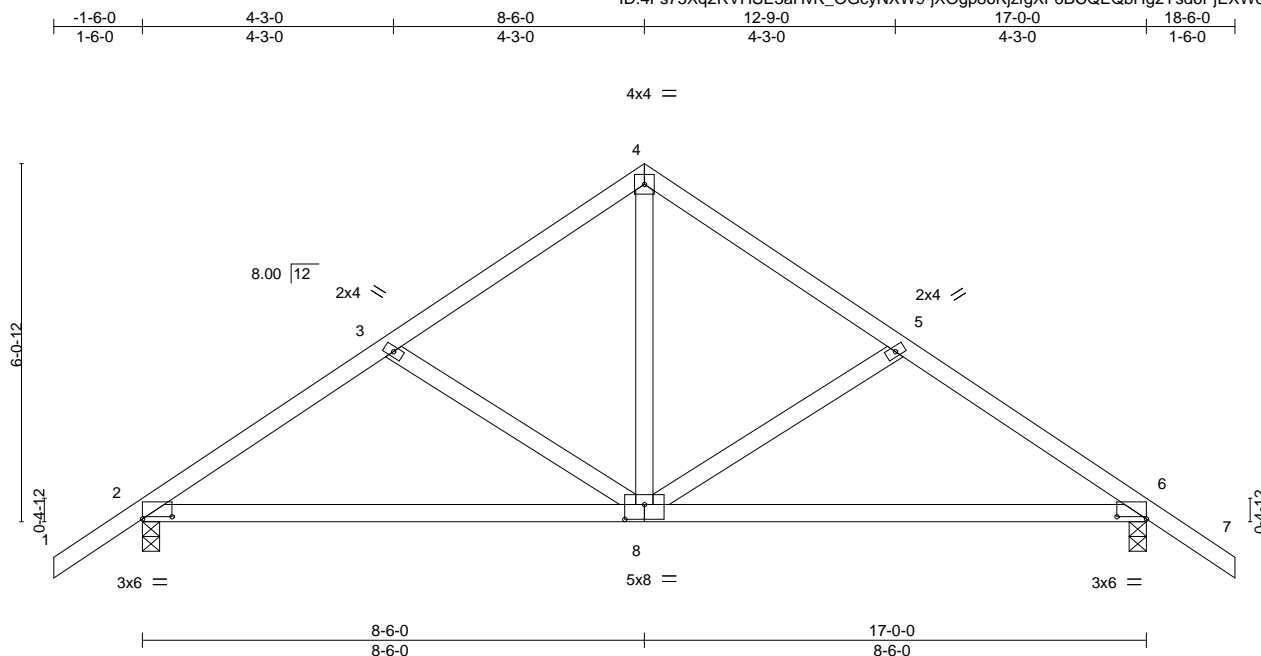

Scale = 1:39.0

Plate Offsets (X,Y)-- [2:0-6-0,0-0-8], [6:0-6-0,0-0-8], [8:0-4-0,0-3-0]																			
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d		PLATES		GRIP	
TCLL 20.0		Plate Grip DOL		1.25		TC 0.29		Vert(LL)		-0.08 8-14		>999		240		MT20		244/190	
TCDL 7.0		Lumber DOL		1.25		BC 0.63		Vert(CT)		-0.17 8-14		>999		180					
BCLL 0.0 *		Rep Stress Incr		YES		WB 0.18		Horz(CT)		0.02 6		n/a		n/a					
BCDL 10.0		Code FBC2017/TPI2014				Matrix-MS										Weight: 84 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 6=0-3-8
Max Horz 2=-208(LC 10)
Max Uplift 2=-278(LC 12), 6=-278(LC 13)
Max Grav 2=710(LC 1), 6=710(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-850/389, 3-4=-677/319, 4-5=-676/319, 5-6=-850/389
BOT CHORD 2-8=-285/748, 6-8=-211/683
WEBS 4-8=-185/525, 5-8=-323/249, 3-8=-323/248

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=278, 6=278.

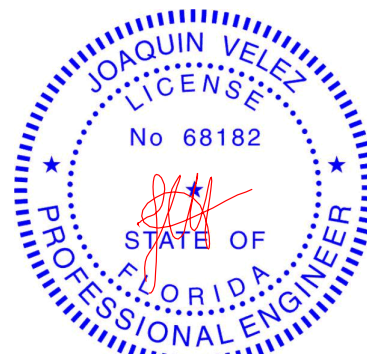

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job 2524511	Truss T14G	Truss Type Common Supported Gable	Qty 1	Ply 1	IC CONST. - HANDY RES. Job Reference (optional)	T21941192
----------------	---------------	--------------------------------------	----------	----------	----------------------------------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:26 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-fvWQE8bFbvNmYGaKrGugilQCgSnteTq_QhnuZyHgzp



Scale = 1:37.9

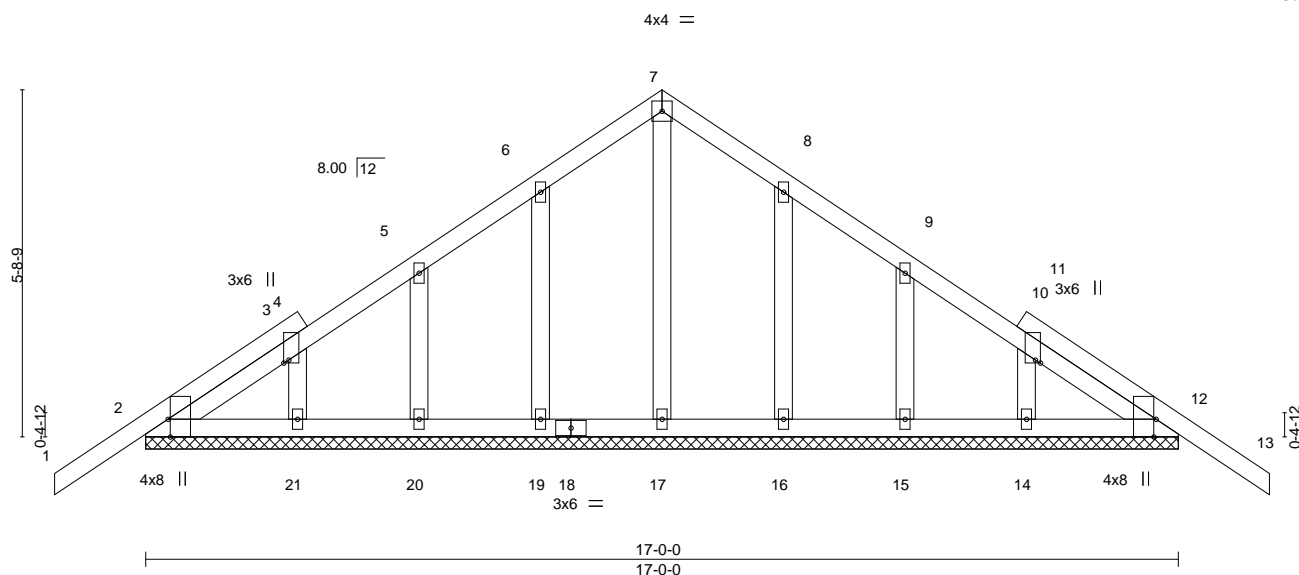


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [3:0-0-9,0-1-0], [11:0-0-9,0-1-0], [12:0-3-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	-0.01	13	n/r	120	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.04	Vert(CT)	-0.01	13	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	12	n/a	n/a	
BCDL 10.0	Code FBC2017/TPI2014		Matrix-S						
								Weight: 99 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 17-0-0.
(lb) - Max Horz 2=197(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 12 except 19=117(LC 12), 20=107(LC 12), 21=100(LC 12),
16=115(LC 13), 15=110(LC 13), 14=102(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 17, 19, 20, 21, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12 except (jt=lb) 19=117, 20=107, 21=100, 16=115, 15=110, 14=102.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 12.

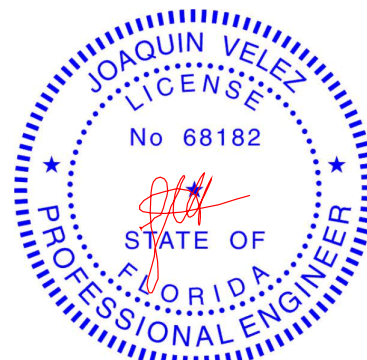

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:27 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK OGcyNXW9-764oRA9D0u1EOirmZn7DwlSx4cRc3gzD4QKQ?yHqzo





TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=275. 8=275.




November 19, 2020



WARNING - Verify design parameters and READ NOTES on THIS and INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the erection, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI 1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:30 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-XhIx4CB5lpPfFAZLZhLqrYw0QHjCploQv2f_1KyHgZl
| -1-6-0 | 4-6-11 | 8-6-0 | 12-5-5 | 17-0-0 |
| 1-6-0 | 4-6-11 | 3-11-5 | 3-11-5 | 4-6-11 |
4x6 || Scale = 1:37.6

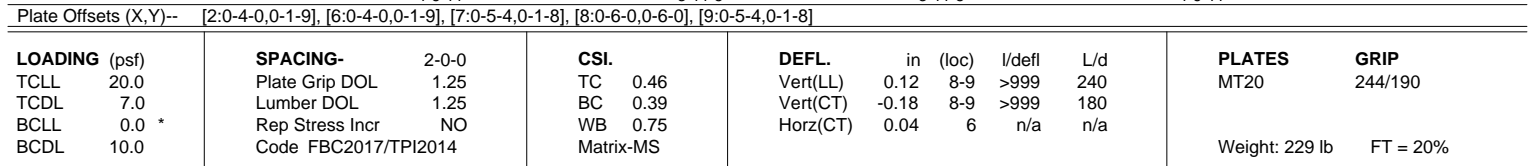


BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 3-10-12 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-8697/3922, 3-4=-6218/2619, 4-5=-6222/2620, 5-6=-8771/3378
BOT CHORD	2-9=-3289/7184, 8-9=-3289/7184, 7-8=-2731/7278, 6-7=-2731/7278
WEBS	4-8=-2760/6656, 5-8=-2663/982, 5-7=-855/2840, 3-8=-2577/1542, 3-9=-1508/2743

- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-4-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=-0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=2161, 2=2266.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2848 lb down and 1711 lb up at 5-0-12, 1386 lb down and 473 lb up at 7-0-12, 1386 lb down and 473 lb up at 9-0-12, 1386 lb down and 473 lb up at 11-0-12, and 1386 lb down and 473 lb up at 13-0-12, and 1307 lb down and 401 lb up at 15-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-6=-54, 2-6=-20

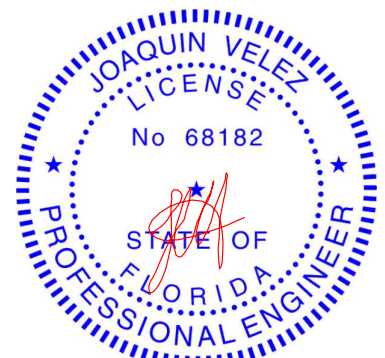

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component**


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.
2524511	T17	Common Girder	1	2	T21941195
Job Reference (optional)					

LOAD CASE(S) Standard
 Concentrated Loads (lb)
 Vert: 14=-2848(B) 15=-1307(B) 16=-1307(B) 17=-1307(B) 18=-1307(B) 19=-1307(B)

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:31 2020 Page 1
 ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-?tJJHYCj37XgsK8X6Os3NmT5Chz6YgQZ7tOYZmyHgzk

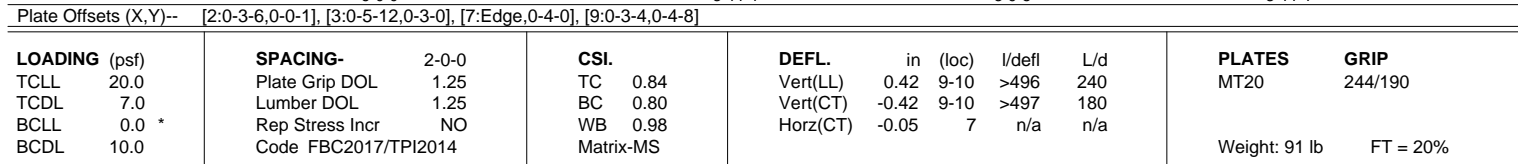 Scale: 3/8"=1'




LUMBER- TOP CHORD BOT CHORD WEBS	2x4 SP No.2 2x6 SP M 26 *Except* 7-9: 2x6 SP No.2 2x4 SP No.3	BRACING- TOP CHORD BOT CHORD	Structural wood sheathing directly applied or 2-2-4 oc purlins, except end verticals. Rigid ceiling directly applied or 4-6-3 oc bracing.
REACTIONS.	(size) 7=0-3-8, 2=0-3-8 Max Horz 2=82(LC 4) Max Uplift 7=984(LC 4), 2=-961(LC 4) Max Grav 7=1221(LC 1), 2=1174(LC 1)		
FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-3=-4135/3304, 3-4=-4253/3432, 4-5=-4230/3414		
BOT CHORD	2-10=-3251/4025, 9-10=-3296/4080, 8-9=-2454/3044, 7-8=-2454/3044		
WEBS	3-10=-381/496, 4-9=-360/285, 5-9=-1010/1249, 5-8=-154/282, 5-7=-3035/2448		

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=984, 2=961.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 81 lb down and 108 lb up at 6-0-0, 81 lb down and 108 lb up at 8-0-12, 81 lb down and 108 lb up at 10-0-12, 81 lb down and 101 lb up at 12-0-12, and 81 lb down and 108 lb up at 14-0-12, and 81 lb down and 108 lb up at 16-0-12 on top chord, and 266 lb down and 310 lb up at 6-0-0, 63 lb down and 81 lb up at 8-0-12, 63 lb down and 81 lb up at 10-0-12, 63 lb down and 81 lb up at 12-0-12, and 63 lb down and 81 lb up at 14-0-12, and 63 lb down and 81 lb up at 16-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).


LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54 3-6=-54 2-7=-20

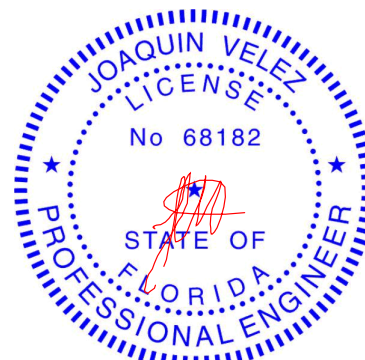

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19.2020

Continued on page 2

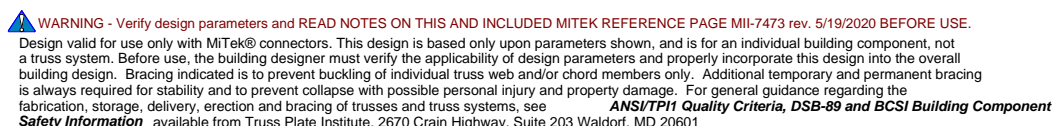

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941196
2524511	T18	Half Hip Girder	1	1	Job Reference (optional)	


LOAD CASE(S) Standard
 Concentrated Loads (lb)
 Vert: 3=-81(B) 10=-266(B) 9=-54(B) 4=-81(B) 13=-81(B) 15=-81(B) 16=-81(B) 17=-81(B) 18=-54(B) 19=-54(B) 20=-54(B) 21=-54(B)



Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941197
2524511	T19	Monopitch	1	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:32 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-U3thUuCLqRfXUTjjg6Nlwz?JO5LsHM0jMM856CyHgZj



Scale = 1:17.5

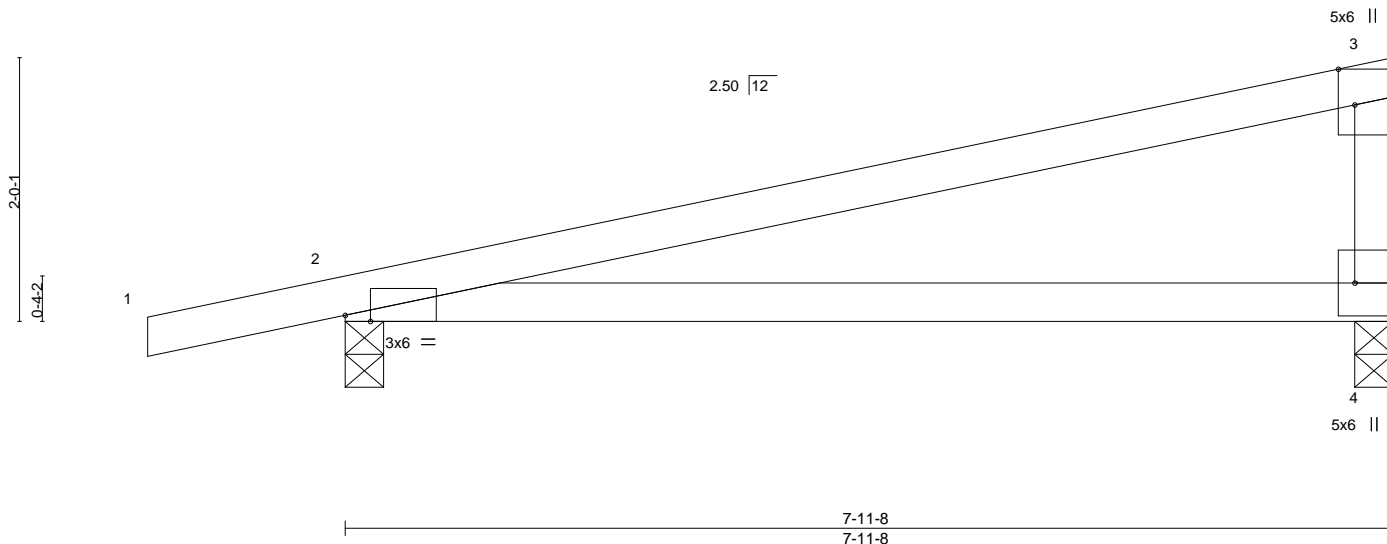


Plate Offsets (X,Y)--		[2:0-2-5,Edge], [3:0-3-4,Edge], [4:Edge,0-3-8]	
LOADING (psf)		SPACING-	2-0-0
TCLL 20.0		Plate Grip DOL	1.25
TCDL 7.0		Lumber DOL	1.25
BCLL 0.0 *		Rep Stress Incr	YES
BCDL 10.0		Code	FBC2017/TPI2014
		CSI.	
		TC	0.69
		BC	0.70
		WB	0.00
		Matrix-MS	
		DEFL.	
		Vert(LL)	0.34 4-7 >275 240
		Vert(CT)	0.29 4-7 >322 180
		Horz(CT)	-0.01 2 n/a n/a
		PLATES	MT20
		GRIP	244/190
		Weight: 28 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-2-6 oc bracing.

REACTIONS.


(size) 4=0-3-8, 2=0-3-8
Max Horz 2=99(LC 8)
Max Uplift 4=225(LC 8), 2=309(LC 8)
Max Grav 4=281(LC 1), 2=378(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 2-4=274/164

NOTES-

- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=225, 2=309.

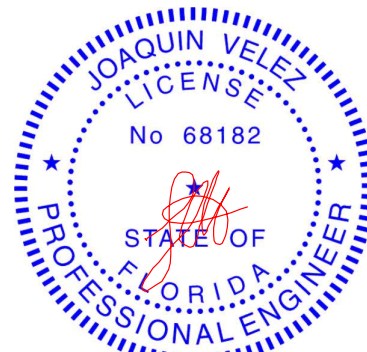

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941198
2524511	T20	Monopitch	5	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:33 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-yGR3iDD_bknO6dlwEpuXSBYTSViN0pGsb0teefyHgzi



Scale = 1:23.2

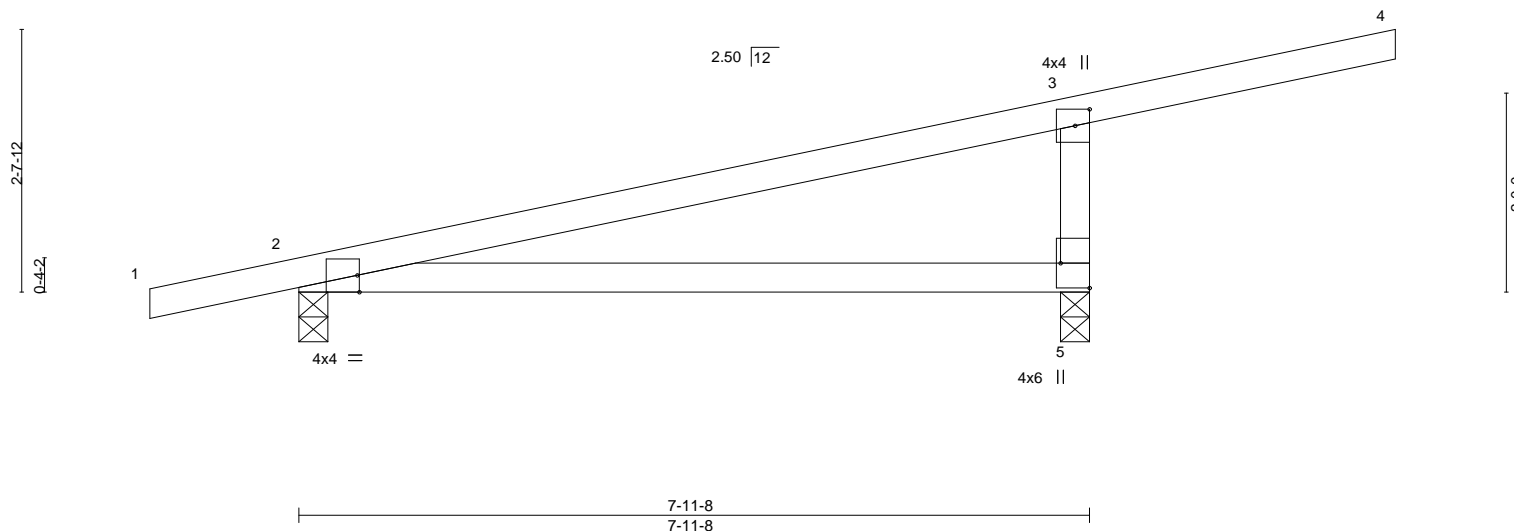


Plate Offsets (X,Y)--		[2:0-0-4,Edge], [3:0-2-0,0-1-12], [5:Edge,0-3-8]										
LOADING	(psf)	SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.73	Vert(LL)	0.30	5-8	>313	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.62	Vert(CT)	0.26	5-8	>365	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code	FBC2017/TPI2014	Matrix-MS							Weight: 33 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-8-5 oc bracing.

REACTIONS.


(size) 5=0-3-8, 2=0-3-8
Max Horz 2=127(LC 8)
Max Uplift 5=361(LC 8), 2=279(LC 8)
Max Grav 5=491(LC 1), 2=342(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-5=393/537

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 5=361, 2=279.

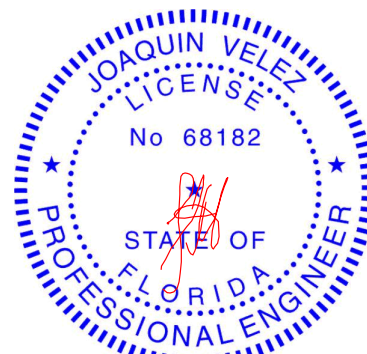

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.	T21941199
2524511	T21	Monopitch	4	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:34 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-QS?SvZEcM2wFjnt6oXPm?O5iUu6hIA7?qqdCA5yHgzh

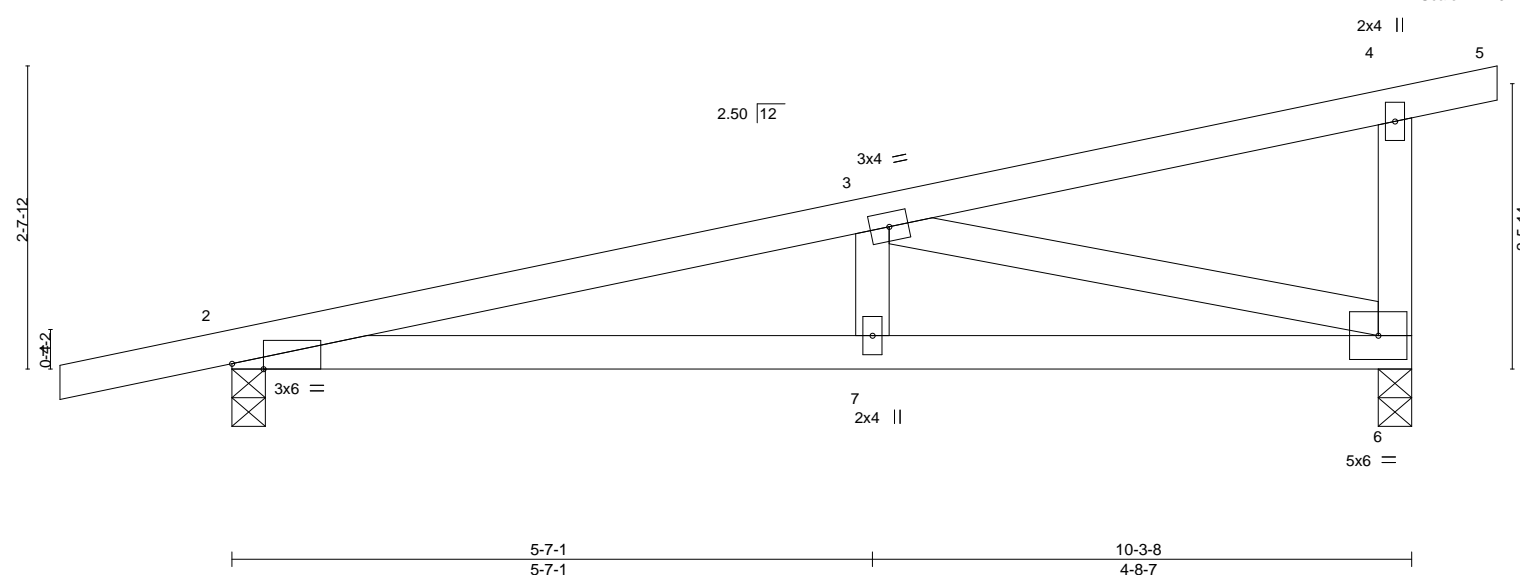



Plate Offsets (X,Y)--		[2:0-3-5,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.46		Vert(LL)	0.11 7-10	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.36		Vert(CT)	0.09 7-10	>999	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.41		Horz(CT)	-0.02 6	n/a	n/a		
BCDL 10.0		Code FBC2017/TPI2014		Matrix-MS						Weight: 45 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 4-7-12 oc bracing.

REACTIONS.


(size) 6=0-3-8, 2=0-3-8
Max Horz 2=131(LC 8)
Max Uplift 6=329(LC 8), 2=368(LC 8)
Max Grav 6=420(LC 1), 2=460(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-895/1298
BOT CHORD 2-7=-1374/862, 6-7=-1374/862
WEBS 3-7=-323/216, 3-6=-862/1375

NOTES-

- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=329, 2=368.

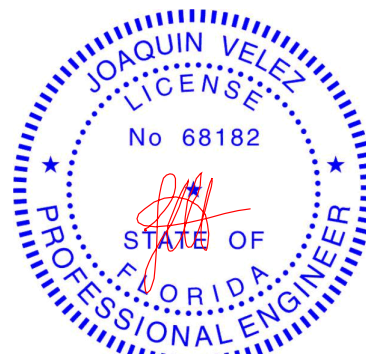

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	IC CONST. - HANDY RES.
2524511	T22	Hip Girder	1	1	T21941200

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:35 2020 Page 1

ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-ueYq7vFE7M26LxSILEw?YcdqmiSHUhR92KMiXyHgzz



Scale = 1:29.6

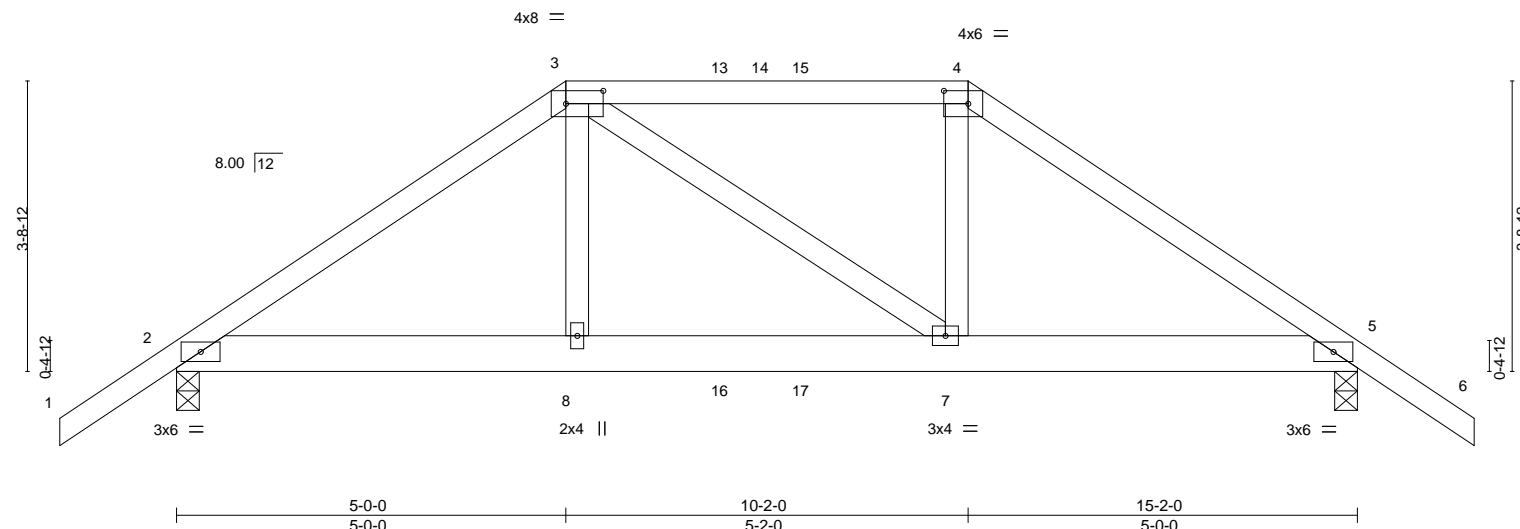


Plate Offsets (X,Y)--		[3:0-5-12,0-2-0], [4:0-3-12,0-2-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.68
TCDL 7.0	Lumber DOL	1.25	BC 0.27
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.15
BCDL 10.0	Code	FBC2017/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.04 7-8 >999 240
			Vert(CT) -0.05 7-8 >999 180
			Horz(CT) 0.02 5 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 84 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-5-7 oc purlins.
BOT CHORD Rigid ceiling directly applied or 9-5-14 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=-136(LC 25)
Max Uplift 2=-534(LC 8), 5=-557(LC 9)
Max Grav 2=916(LC 1), 5=945(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-1259/750, 3-4=-1045/718, 4-5=-1308/800
BOT CHORD 2-8=-592/1045, 7-8=-593/1058, 5-7=-591/1057
WEBS 3-8=-46/391, 4-7=-8/377

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 2=534, 5=557.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 129 lb down and 126 lb up at 5-0-0, 129 lb down and 117 lb up at 7-0-12, and 129 lb down and 117 lb up at 8-1-4, and 277 lb down and 288 lb up at 10-2-0 on top chord, and 147 lb down and 50 lb up at 5-0-0, 53 lb down and 22 lb up at 7-0-12, and 53 lb down and 22 lb up at 8-1-4, and 147 lb down and 50 lb up at 10-1-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-4=-54, 4-6=-54, 2-5=-20
Concentrated Loads (lb)
Vert: 3=-59(B) 4=-143(B) 8=-91(B) 7=-91(B) 13=-59(B) 15=-59(B) 16=-38(B) 17=-38(B)

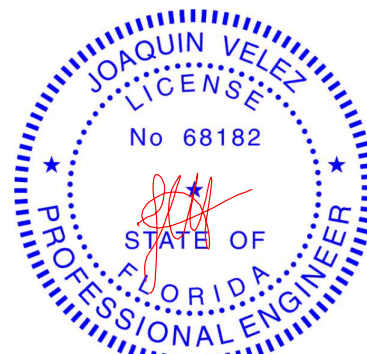

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2524511	Truss T23	Truss Type Hip	Qty 1	Ply 1	IC CONST. - HANDY RES. T21941201
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:36 2020 Page 1					
Job Reference (optional)					

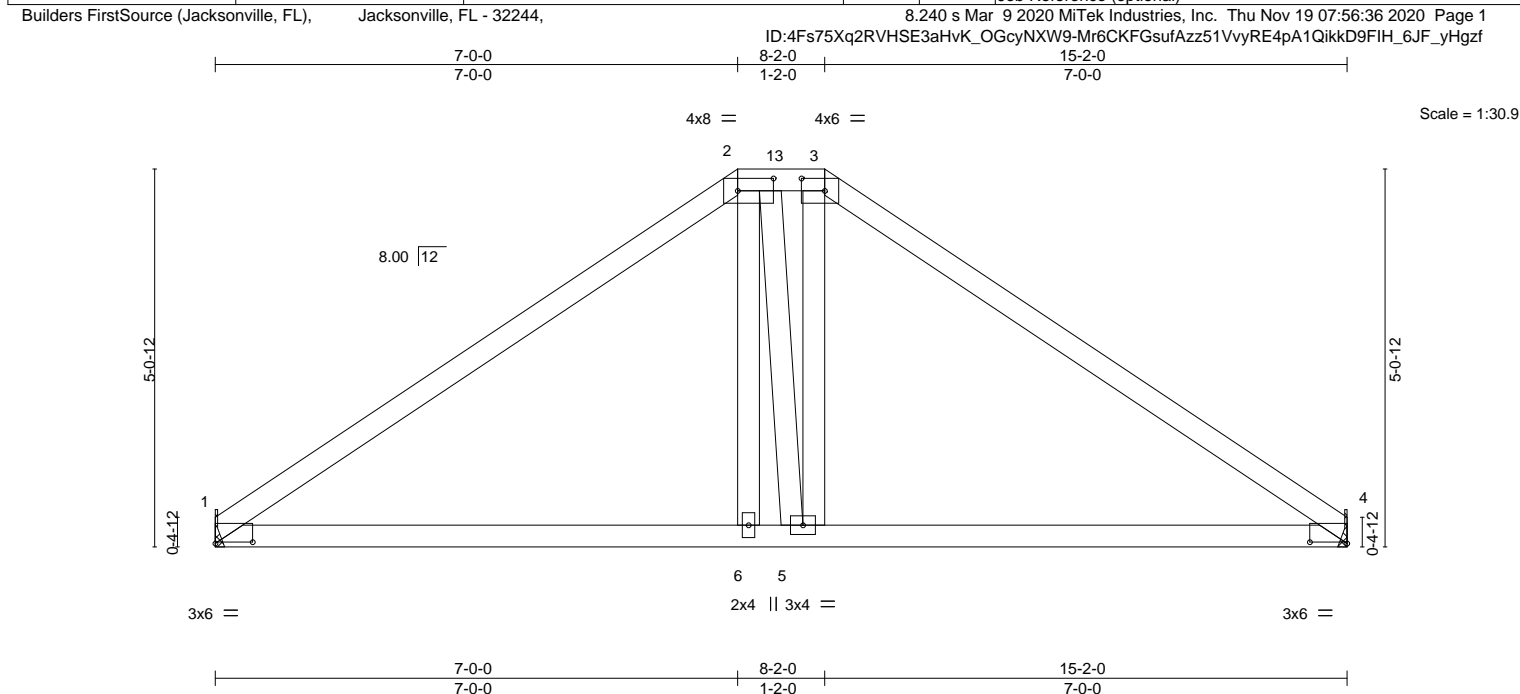


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.56	Vert(LL)	0.12 5-12	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.51	Vert(CT)	-0.15 5-12	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	-0.01 1	n/a	n/a		
BCDL 10.0	Code FBC2017/TPI2014		Matrix-MS					Weight: 70 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-4-10 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 1=Mechanical, 4=Mechanical
Max Horz 1=146(LC 9)
Max Uplift 1=204(LC 12), 4=204(LC 13)
Max Grav 1=561(LC 1), 4=561(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-699/313, 2-3=-583/349, 3-4=-694/311
BOT CHORD 1-6=-150/500, 5-6=-153/503, 4-5=-128/496
WEBS 2-5=-256/285

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=204, 4=204.

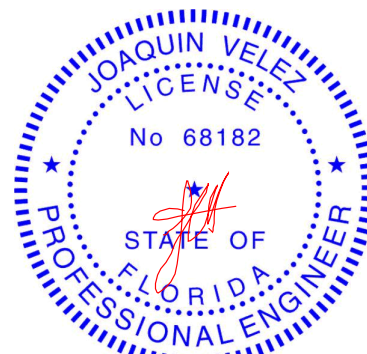

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2524511	Truss T24	Truss Type Common	Qty 2	Ply 1	IC CONST. - HANDY RES. T21941202
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					Job Reference (optional)

8.240 s Mar 9 2020 MiTek Industries, Inc. Thu Nov 19 07:56:37 2020 Page 1
ID:4Fs75Xq2RVHSE3aHvK_OGcyNXW9-q1gaYbGUfzIqbFchTfzTd1JA563ryb9SWdrsnQyHgze

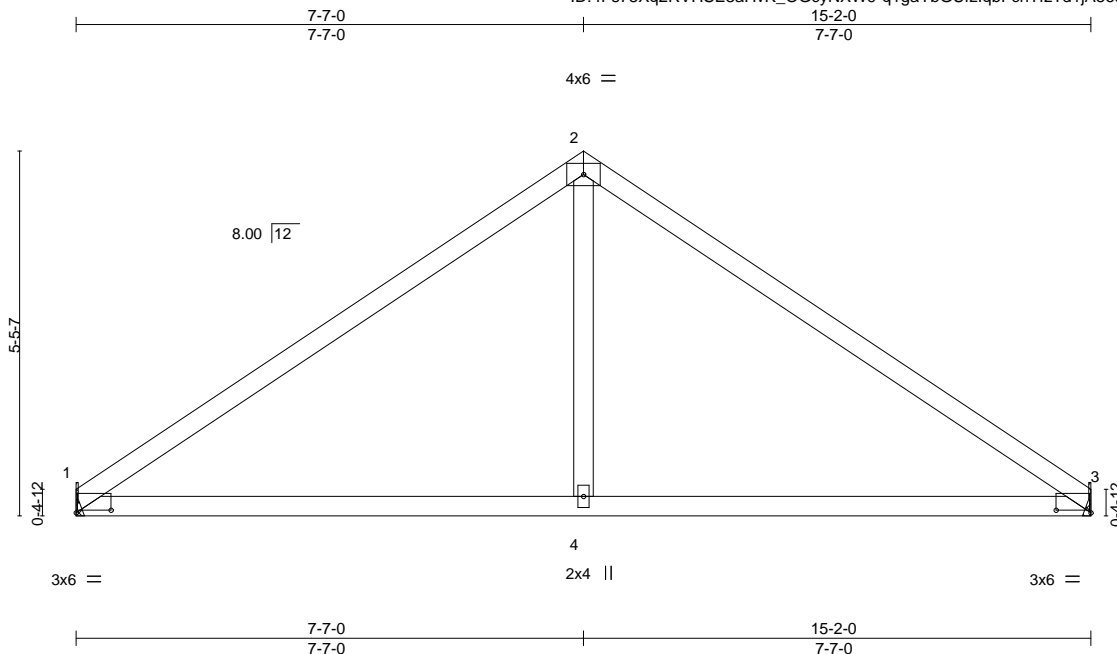


Plate Offsets (X,Y)-- [1:0-6-4,0-0-7], [3:0-6-4,0-0-7]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.69	Vert(LL)	0.16	4-7	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	-0.20	4-10	>923	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.01	1	n/a	n/a		
BCDL	10.0	Code FBC2017/TPI2014		Matrix-MS							Weight: 57 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-1 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 1=Mechanical, 3=Mechanical
Max Horz 1=157(LC 8)
Max Uplift 1=202(LC 12), 3=202(LC 13)
Max Grav 1=561(LC 1), 3=561(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-692/303, 2-3=-692/303
BOT CHORD 1-4=-129/490, 3-4=-129/490
WEBS 2-4=-40/356

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=202, 3=202.

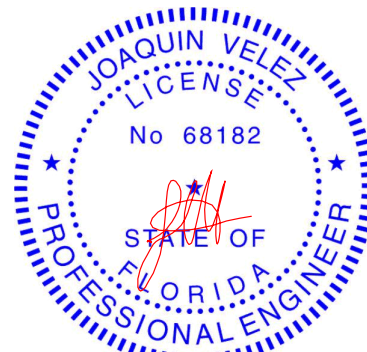

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

November 19,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Symbols

PLATE LOCATION AND ORIENTATION

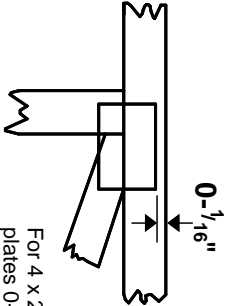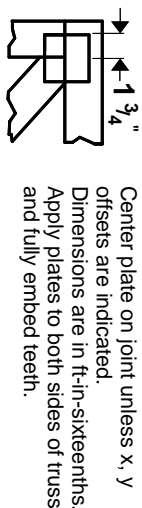

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MiTek 20/20** software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

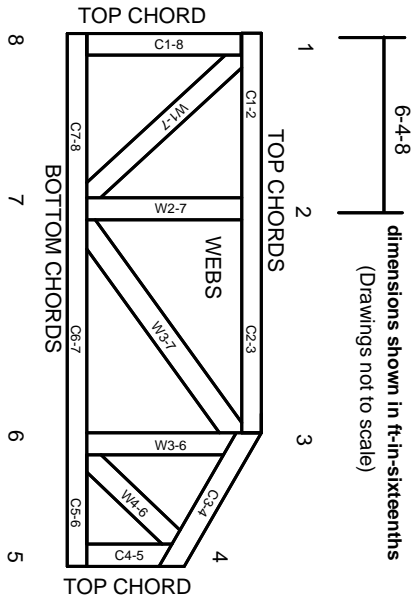

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.