


OPENING CONNECTION REQUIREMENTS				
CLEAR OPENING WIDTH	HEADER SIZE #2 GRADE OR BETTER	END BEARING	CONNECTOR AT EACH END OF OPENING	ANCHORAGE TO FOUNDATION @ EACH END OF OPENING
0' - 3'	(2) 2x8	1.5"	SIMPSON H2.5	SIMPSON SPH4
>3' - 6'	(2) 2x10	3"	(1) SIMPSON LSTA30	(2) SIMPSON SPH4
>6' - 9'	(2) 2x12	3"	(1) SIMPSON LSTA30	(2) SIMPSON SPH4
>9' - 12'	(2) 1 3/4" x 11 1/4" LVL - 2.0E	3"	(1) SIMPSON LSTA30	(2) SIMPSON SPH4
>12' - 15'	(2) 1 3/4" x 11 1/4" LVL - 2.0E	3"	(2) SIMPSON LSTA30	SIMPSON HD5A
>15' - 18'	(2) 1 3/4" x 11 1/4" LVL - 2.0E	4.5"	(2) SIMPSON LSTA30	SIMPSON HD5A

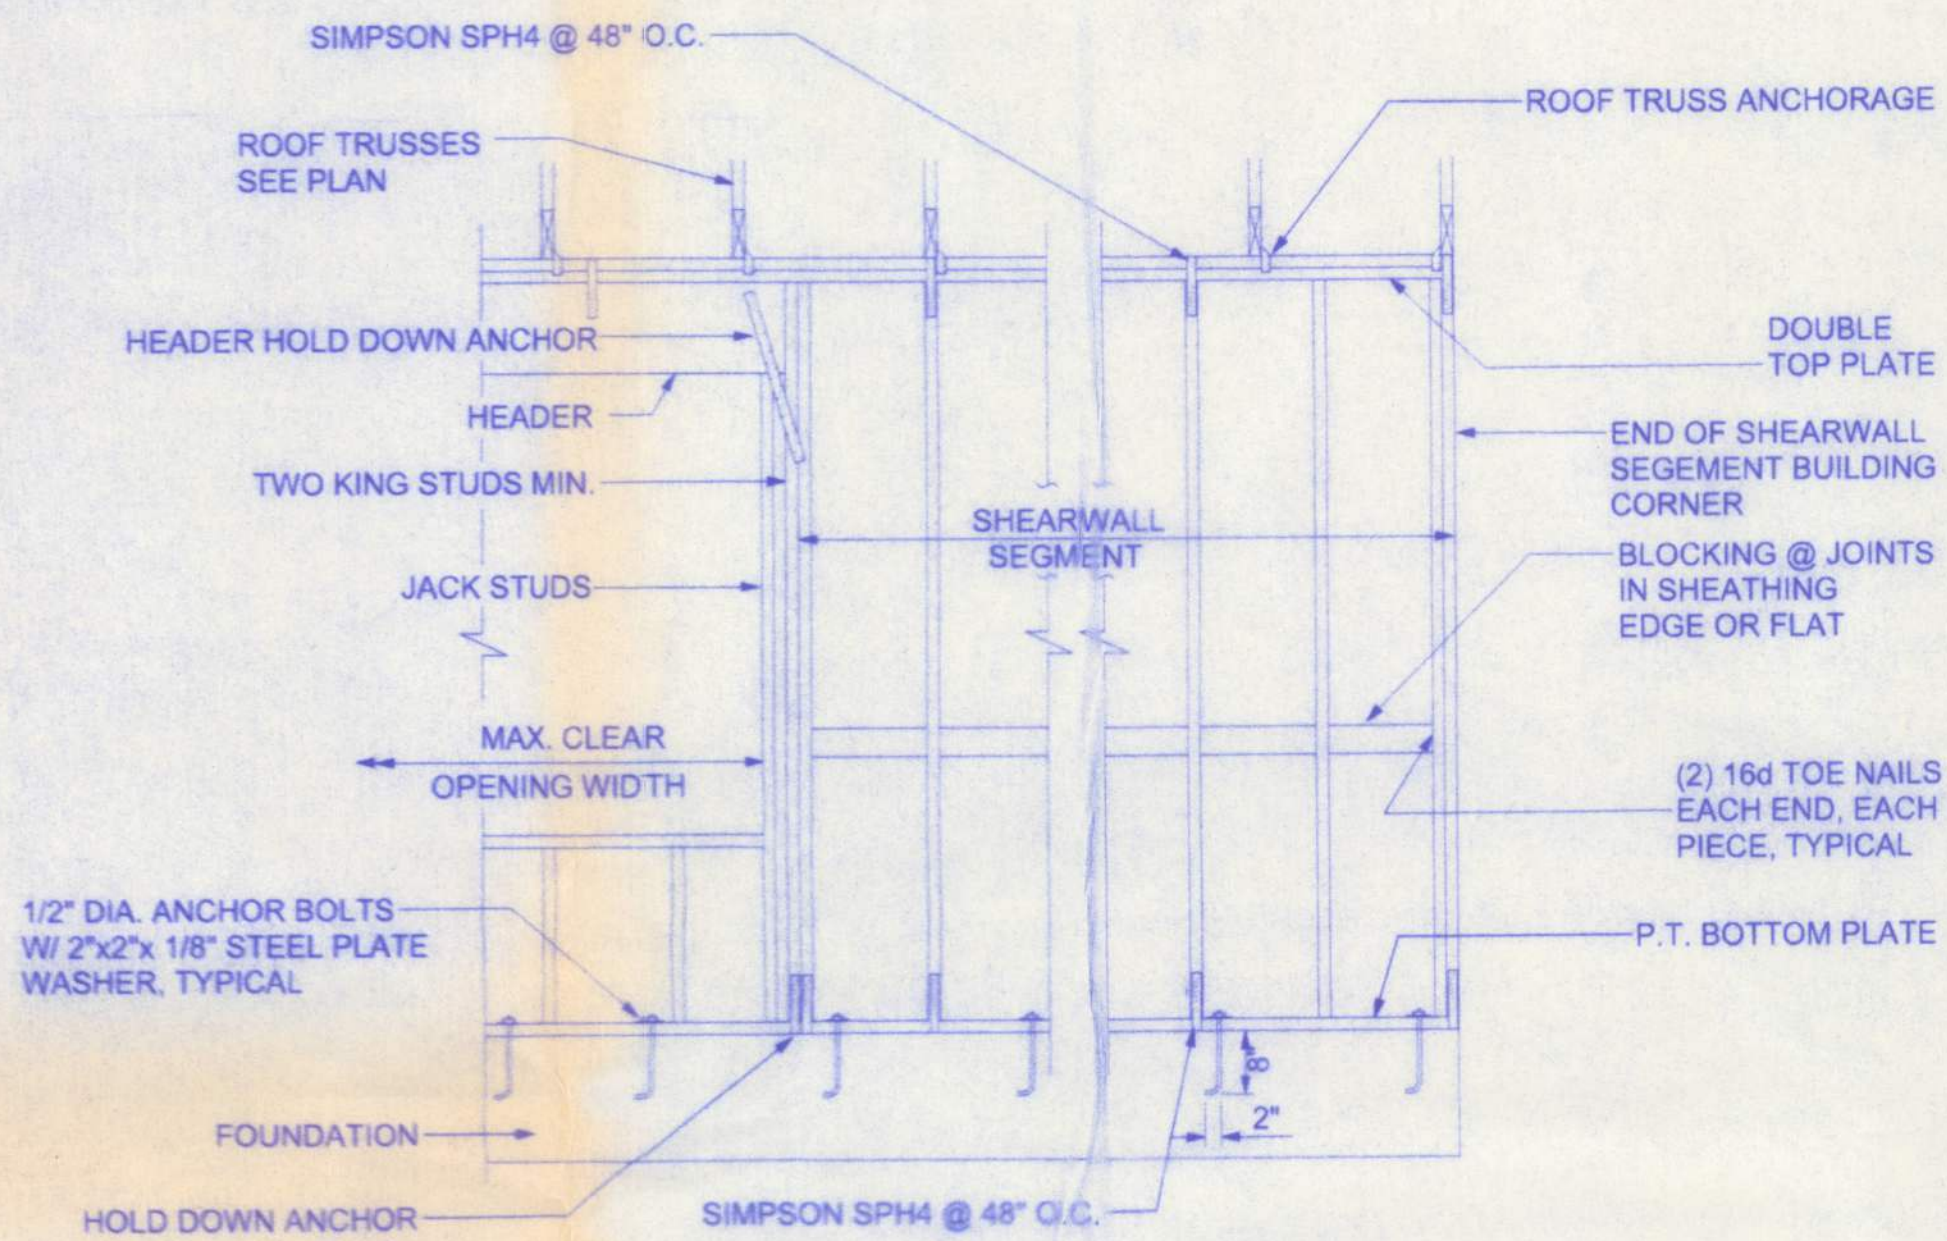


**SHEARWALL DETAILS**  
SCALE: 1/2" = 1'-0"

**SHEARWALL NOTES:**


- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-99 305.4.3.
- THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
- ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
- NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD.
- TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 ie. FOR 8'-0" WALLS - (2'-3").

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

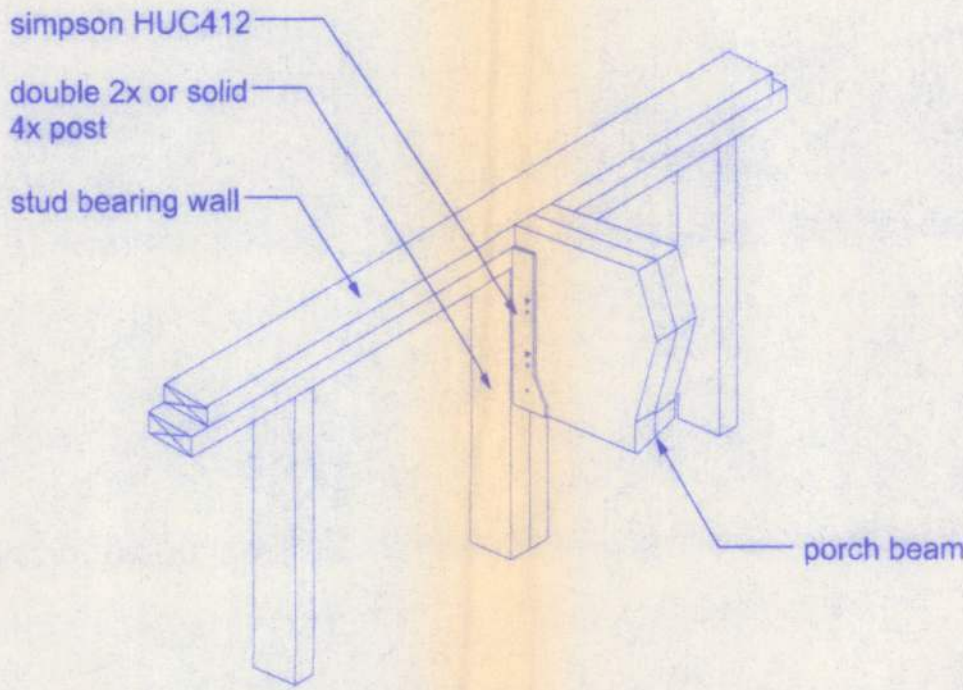

**BEAM/WALL CONNECTION**  
NTS

NOTE:  
A SOLID MEMBER OF EQUAL OR GREATER SIZE THAN MULTIPLE MEMBERS MAY BE USED.  
IF RATED SHEATHING IS APPLIED TO NARROW EDGES, NAILED TO EACH STUD AT 12" O.C. MAXIMUM, THE LAMINATION NAILING SHOWN HERE IS NOT REQUIRED.

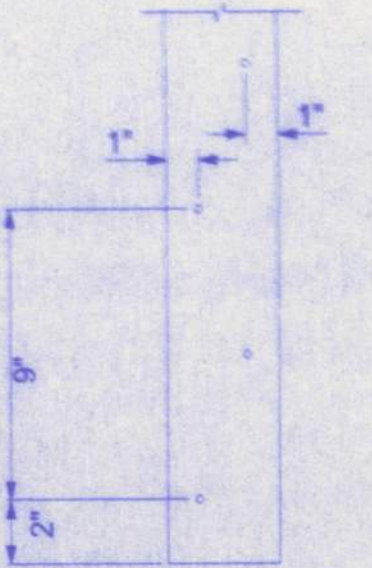

END (TOP OR BOTTOM)

10d NAILS, TYPICAL 2" FROM ENDS, FROM OPPOSITE SIDES, 9" ON CENTER MAX. STAGGERED 2 ROWS.

3"x3"x 1/4" STEEL PLATE WASHER


**GIRDER COLUMN DETAIL**  
SCALE: 1/2" = 1'-0"

**STEEL COATING RECOMMENDATIONS IN PRESSURE TREATED WOOD:**

- Thicker galvanizing generally extends service life of a product. The treated wood industry recommends use of Stainless Steel and hot-dip galvanized connectors and fasteners with treated wood.
- Due to the uncertainties, which are out of the specifiers control, in regard to the chemicals used in pressure treated wood, Simpson recommends the use of stainless steel fasteners, anchors and connectors with treated wood when possible. At a minimum, customers should use ZMAX (G185 HDG per ASTM A653), Batch/Post Hot-Dip Galvanized (per ASTM A123 for connectors and ASTM A153 for fasteners), or mechanically galvanized fasteners (per ASTM B695, Class 55 or greater), product with the newer alternative treated woods.
- G60 galvanized products should not be used with treated woods.
- G90 galvanized connectors can be used with Sodium Borate (DOT - Disodium Octaborate Tetrahydrate) treated woods. Sodium Borate Treated woods are not suitable for applications where moisture exposure is likely. They are suitable for mudsill applications when transported, stored, and installed appropriately.
- When using stainless steel or hot-dip galvanized connectors, the connectors and fasteners should be made of the same material.

Simpson Strong-Tie Product Finishes	Untreated Wood	Chromated Copper Arsenate (CCA-C)	DOT Sodium Borate (SBX)	Alkaline Copper Quat ACQ-C and ACQ-D (Carbonate)	Copper Azole (CBA-A and CA-B)	SBX (DOT) with NASiO <sub>2</sub>	Ammoniacal Copper Zinc Arsenate (ACZA)	Other Pressure Treated Woods
Standard (G90)	X	X	X					
ZMAX (G185)	X	X	X	X	X	X		
Post Hot-Dip Galvanized (HDG)	X	X	X	X	X	X	X	X
SST300 (Stainless Steel)	X	X	X	X	X	X	X	X

161 N.W. MADISON STREET  
SUITE #102  
LAKE CITY, FL 32055  
(386)758-4209



**Freeman**  
Design Group inc

DATE 9/22/05 DRAWN BY W.H.F.

REVISIONS

SHEET A-7

OF 7

PROJECT NO.

LAUREL LAKES LOT #8

With 11 feet  
10/26/05

CERTIFICATE OF AUTHORIZATION # 00008701