

ALL INTERIOR AND EXTERIOR WALL FRAMING, INCLUDING FURRING STRIPS ON CMU WALLS, TO BE SPACED AND 16" O.C. (U.N.O.) *

FLOOR PLAN
SCALE: 1/4" = 1'-0"
ELEVATION "A" & "B"

NOTE:
○ INDICATES OPENINGS WIND PRESSURES. SEE WIND LOADING CRITERIA ON COVER SHEET FOR INFORMATION.

WALL LEGEND

- FRAMED WALL
- BEARING FRAME WALL
- FRAMED WALL W/ BRICK VENEER
- FRAMED WALL W/ SIDING OR STUCCO

GENERAL NOTES

- R302.6 (Table 302.6) If water based ceiling texture material is used, provide 4" gypsum board for 16" O.C. Framing, or 5/8" gypsum board for 24" O.C. Framing. Note 1/2" sag-resistant gypsum board may be used I.L.O. 5/8" gypsum board. 5/8" type "X" gypsum board must be installed on garage ceiling beneath habitable rooms).
- R302.5.2 Duct Penetration. Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 20 gage (0.48 mm) sheet steel, 1 inch minimum rigid nonmetallic class 0 or class 1 duct board or other approved material and shall not have openings into the garage.
- R302.5.1 Door from garage into house must be a minimum 1 3/8" solid wood door, solid or honeycomb core steel door, or 20 Minute fire rated door.
- R302.7 Enclosed space under stairs that is accessed by a door or access panel shall have walls, under-stair surface and any soffits protected on the enclosed side with 1/2" gypsum board.
- Outdoor swimming pools shall be provided with a barrier complying with R4501.17.1.1 through R4501.17.1.14.
- Bathroom exhaust fans must vent to the exterior of the building, exhaust to attic space and soffits is not acceptable. Ventilation shall be permitted to exit through the soffit if solid soffit is installed 5'-0" on each side of the venting.
- R302.6 The garage shall be separated from the residence and it's attic as required by Table R302.6. From the residence and attic by not less than 1/2" inch (12.7 mm) gypsum board applied to the garage side. Garage beneath rooms shall be separated from all habitable rooms above by not less than 5/8 inch (15.9 mm) type X gypsum board or equivalent. Where the separation is a floor-ceiling assembly, the structure supporting the separation shall also be protected by not less than 1/2 inch (12.7 mm) gypsum board or equivalent.
- R312.2.1 Window sills. In dwelling units, where the bottom of the clear opening of an operable window opening is located less than 24 inches (610 mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:
 - Operable windows with openings that will not allow a 4-inch diameter (102 mm) sphere to pass through the opening where the opening is in its largest opened position.
 - Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
 - Operable windows that are provided with window opening control devices that comply with Section R312.2.2.
- R308.4.2 All windows within 2'-0" of doors and in shower or tub areas will be safety tempered glass.
- EC: R402.2.4 Vertical or horizontal access doors from conditioned spaces to unconditioned spaces such as attics and crawl spaces shall be weatherstripped and insulated to a level equivalent to the insulation on the surrounding surfaces.
- M1502.4.5 Duct length. The maximum allowable exhaust duct length shall be determined by one of the methods specified in sections M1502.4.5.1 through M1502.4.5.3. M1502.3 Duct termination. Exhaust ducts shall terminate on the outside of the building. Exhaust duct terminations shall be in accordance with the dryer manufacturer's installation instructions. If the manufacturer's instructions do not specify a termination location, the exhaust duct shall terminate not less than 3 feet (914 mm) in any direction from openings into buildings, including openings in ventilated soffits. Exhaust duct terminations shall be equipped with a backdraft damper. Screens shall not be installed at the duct termination.
- Porch Ceilings: (See plan for the following options)
 - Option 1. Gypsum: 1/2" exterior gypsum soffit board shall be attached to all framing members with 2x blocking provided at perimeter and panel edges. The gypsum board shall be attached w/ Type "WF" 1 1/2" drywall screws at 8" O.C. in field and edges.
 - Option 2. Plaster Base: 7/16" OSB on underside of roof trusses shall be attached to all framing members with 2x blocking provided at perimeter and panel edges. The OSB shall be attached w/ 8d nails at 8" O.C. field and 4" O.C. at edges or 7d screw shank 3" O.C. field and 4" edges.
- Energy Code Compliance Path is Performance Based Path. Code cycle is FBC 2023 8th Edition.

AREA CALCULATIONS

1st FLOOR	2433 S.F.
TOTAL LIVING (AC)	2433 S.F.
GARAGE	729 S.F.
COVERED ENTRY	60 S.F.
COVERED PATIO/LANAI	185 S.F.
TOTAL AREA UNDER ROOF	3304 S.F.

TSG
CA No. 9181
AC060315
Making Dreams Come True

TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL # 78750

100% Employee Owned
myTSGhome.com




MUNICIPAL STAMP AREA

SIGNATURE & SEAL
10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans are in accordance with the 2023 Florida Building Code, Residential Part, Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CR1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502
Division Location:

LOT: 33
Community: The Preserve at Laurel Lake
Plan Name: 2508
Project Address: Lake City
Client No.:

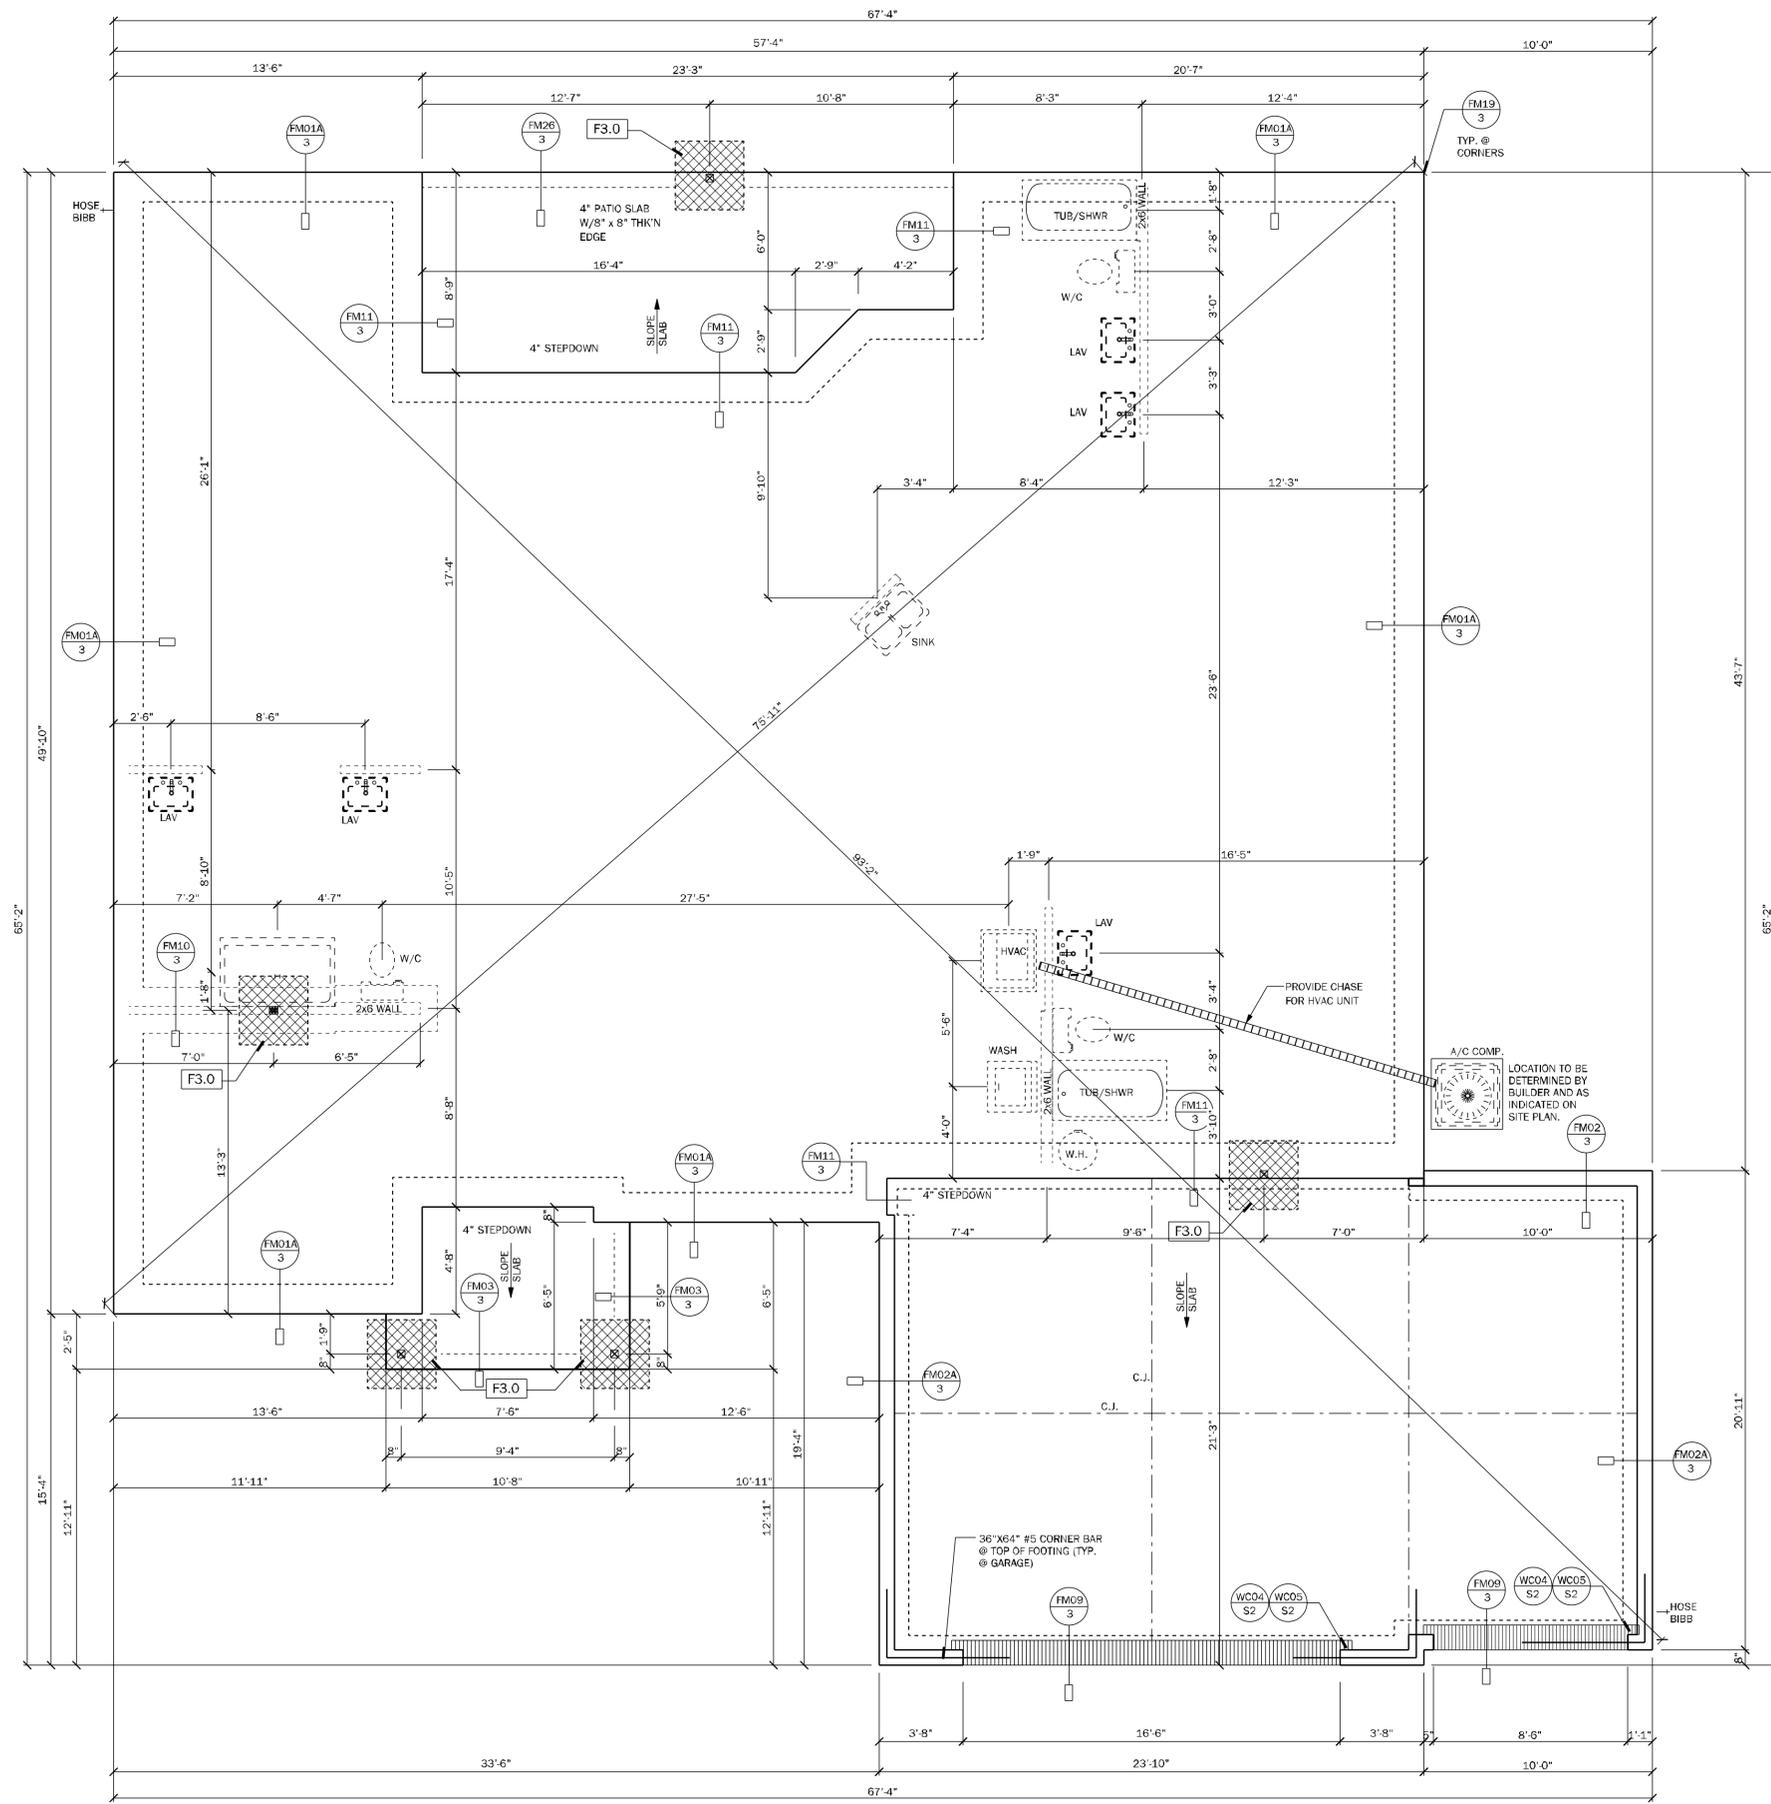

FOUNDATION PLAN
 SCALE: 1/4" = 1'-0"
 ELEVATION "A" & "B"



TOTAL SOLUTIONS GROUP
 258 Southhall Lane, Suite 200
 Maitland, Florida, 32751
 (407) 800-2333
 CARL A. BROWN, PE - FL # 56126
 SCOTT LEWKOWSKI, PE - FL #78750
100% Employee Owned
 myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
 10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 4th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.


This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright of intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and International law.

DAMS HOMES
 FLORIDA CONTRACTORS LICENSE NO. CR130146
100 WEST GARDEN STREET
PENSACOLA FL 32502
 Division Location

LOT: 33
 Community: The Preserve at Laurel Lake
 Plan Name: 2508
 Project Address: Lake City
 Client No.:

Project No:
 Sheet No:
3
 FOUNDATION PLAN

BEARING WOOD WALL SCHEDULE				
MARK	STUD SPACING	CONNECTION & FASTENERS	LUMBER SPECIES	UPLIFT CAP.(#)
BW1	16"	(2) 16# TOENAILS	SPF	NO UPLIFT
BW2	16"	SP2 W/ (6) 10# STUD, (4) 10# PLATE	SPF	402
BW3	16"	(2) SP2 W/ (6) 10# STUD, (6) 16# PLATE	SPF	803
BW4	16"	(2) 16# TOENAILS	SYP	NO UPLIFT
BW5	16"	SP2 W/ (6) 10# STUD, (4) 10# PLATE	SYP	439
BW6	16"	(2) SP2 W/ (6) 10# STUD, (6) 16# PLATE	SYP	878
BW7	12"	(2) 16# TOENAILS	SPF	NO UPLIFT
BW8	12"	SP2 W/ (6) 10# STUD, (6) 16# PLATE	SPF	535
BW9	12"	(2) SP2 W/ (6) 10# STUD, (6) 16# PLATE	SPF	1070
BW10	12"	(2) 16# TOENAILS	SYP	0
BW11	12"	SP2 W/ (6) 10# STUD, (6) 16# PLATE	SYP	585
BW12	12"	(2) SP2 W/ (6) 10# STUD, (6) 16# PLATE	SYP	1170
BW13		NOT USED		

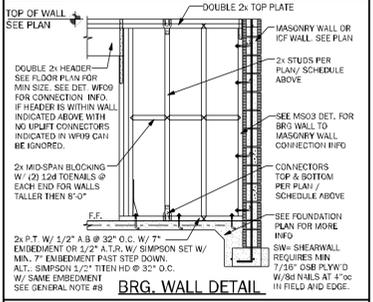


- GENERAL NOTES**
- SEE FLOOR PLAN FOR WALL SIZE. ASSUME 2x4 STUDS USED UNO.
 - ALL STRUCTURAL LUMBER TO BE SP# #1 OR SP# #2 UNO ON PLAN.
 - CONNECTIONS TO BE INSTALLED TO EACH STUD AS INDICATED.
 - SP# #1 AND SP# #2 CONNECTIONS CAN BE SUBSTITUTED IN PLACE FOR THE SP#1 AND SP#2 INDICATED IN SCHEDULE ABOVE.
 - IF "BW" IS INDICATED ON SECOND FLOOR BASE CONNECTION TO IGNORED. SEE WFO9 DET. OR INDICATED DETAIL FOR PROPER CONNECTIONS FOR 2ND FLOOR TO FIRST FLOOR CONNECTIONS. NOTE: THIS IS FOR 2 STORY PROJECTS ONLY.
 - IF "SW" IS INDICATED THE WALL IS CONSIDERED A SHEARWALL AND REQUIRES MIN. 7/8" Ø BRG PLATE W/ 8# BRG NAILS AT 4" O.C. IN FIELD AND EDGE TO 1/4 SIDE OF WALL.
 - ALL 2x EXTERIOR WALLS W/ EXTERIOR SHEATHING ATTACHED PER NAILING SCHEDULE SHALL BE SHEARWALLS. SEE PLAN AND WALL SECTIONS FOR STUD SPACING AND GRADE.
 - IF THE BEARING WALL IS INDICATED WITH THE BW1, BW4, BW7, BW10 THESE WALLS ARE ONLY SUPPORTING THE FLOOR LOAD AND DO NOT HAVE UPLIFT. THE STUDS ARE TOE NAIL TO THE PLATE AND THE 2x PLATE CAN BE ATTACHED WITH HARD CAPPED NAILS (GUN NAILS) AND WILL NOT REQUIRE THE ANCHOR BOLT ATTACHMENT INDICATED IN THE BEARING WALL SCHEDULE.
 - SP#2 APPROX ONE NAIL AT AN ANGLE THROUGH THE STUD INTO THE PLATE TO ACHIEVE THE TABLE LOAD. 10# @ 0.148" DIA. X 3" LONG.

COLUMN SCHEDULE				
MARK	COLUMN SIZE	BASE/ CORR. & FASTENER	UPLIFT(Lb)	
C1	(3) 2' x 4' #2 SPF	(4) -16# TOENAILS	0	
C2	(3) 2' x 4' #2 SPF	DT2Z W/ 1/2" WEDGE ANCHOR - 6 (8) 1/4" X 1 1/2" SDS SCREWS	2145	
C3	(3) 2' x 4' SYP #1 OR	(4) -16# TOENAILS	0	
C4	(4) 2' x 4' SPF #2	DT2Z W/ 1/2" WEDGE ANCHOR - 6 (8) 1/4" X 1 1/2" SDS SCREWS	2145	
C5	4' x 4' P.T. #2 SYP POST	ABU14 W/ 5/8" ATR** & (12) -16# NAILS	G = 6665 U = 2200	
C6	6' x 6' P.T. #2 SYP POST	ABU66 W/ 5/8" ATR** & (12) -16# NAILS	G = 12000 U = 2900	
C7	8' x 8' P.T. #2 SYP POST	ADU88 W/ (2) -5/8" ATR** & (12) -16# NAILS	G = 24335 U = 3200	
C8	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDS-SDS2.5 W/ (14) 1/4" X 2 1/2" SDS WS & 5/8" EPOXY ANCHOR, OR ATR**	5645	
C9	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDS-SDS2.5 W/ (14) 1/4" X 2 1/2" SDS WS & 5/8" EPOXY ANCHOR, OR ATR**	5645	
C10	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDS-SDS2.5 W/ (20) 1/4" X 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	6970	
C11	5.25 x 5.25 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDS-SDS2.5 W/ (20) 1/4" X 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	7870	
C12	7 x 7 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDS-SDS2.5 W/ (20) 1/4" X 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	7870	
C13	6.25 x 7 x 7 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDS-SDS2.5 W/ 7/8" ATR AND (20) 1/4" X 2 1/2" SDS WOOD SCREWS	7870	

- GENERAL COLUMN NOTES**
- SEE FLOOR PLAN FOR WALL WIDTH. STUD PACKS TO MATCH WALL WIDTH UNO.
 - ALL STRUCTURAL LUMBER TO BE SP# #1 OR SP# #2 UNO ON PLAN.
 - NAIL BUILT UP STUDS PER DETAIL WFS7
 - MINIMUM BOLT EMBEDMENT:
 - 5" EMBEDMENT FOR 1/2" ATR
 - 6" EMBEDMENT FOR 5/8" ATR
 - 6" EMBEDMENT FOR 7/8" ATR
 - IF (C) COLUMN IS INDICATED ON SECOND FLOOR, THE BASE CONNECTION IS NOT REQUIRED. (SEE INDICATED CALL OUT ON PLAN FOR ATTACHMENT)
 - SEE WOOD CONSTRUCTION NOTE #4 ON COVER SHEET FOR CORROSION INFORMATION
 - 7. SAME NOMINAL SIZE PARALLEL COLUMN (1.8E) MAY BE SUBSTITUTED FOR ANY P.L. SYP POST NOTED IN THE PLANS**

COMMON NAIL vs. PNEUMATIC GUN NAILS:				
COMMON NAIL	DIAM. / LENGTH	PNEUMATIC GUN COMMON vs. GUN NAIL DIA./LENGTH/ NAIL SPACING	APPLICATION	
8d	0.131" X 2 1/2"	0.131" X 2 1/2"	SEE PLAN RING SHEATHING ROOF	
10d OR 12d	0.148" X 3"	0.131" X 3"	SEE PLAN RING SHEATHING ROOF	
10d	0.148" X 3 1/4"	0.131" X 3 1/4"	STUD WALL CORNERS	
12d	0.148" X 3"	0.131" X 3"	R: O.C. (COMMON) 6" O.C. (GUN NAIL)	
16d	0.162" X 3 1/2"	0.131" X 3 1/4"	R: O.C. (COMMON) 6" O.C. (GUN NAIL)	

BEARING WOOD INTERIOR WALL SCHEDULE				
MARK	STUD SPACING	CONNECTION & FASTENERS	LUMBER SPECIES	UPLIFT CAP.(#)
BW1	16"	(2) 16# TOENAILS	SPF	0
BW2	16"	SP2 W/ (6) 10# STUD, (4) 10# PLATE	SPF	402
BW3	16"	SP4 W/ (6) 10# X 1 1/2" NAILS	SPF	571
BW4	16"	(2) 16# TOENAILS	SYP	0
BW5	16"	SP2 W/ (6) 10# STUD, (4) 10# PLATE	SYP	439
BW6	16"	SP4 W/ (6) 10# X 1 1/2" NAILS	SYP	665
BW7	12"	(2) 16# TOENAILS	SPF	0
BW8	12"	SP2 W/ (6) 10# STUD, (6) 16# PLATE	SPF	535
BW9	12"	SP4 W/ (6) 10# X 1 1/2" NAILS	SPF	760
BW10	12"	(2) 16# TOENAILS	SYP	0
BW11	12"	SP2 W/ (6) 10# STUD, (6) 16# PLATE	SYP	585
BW12	12"	SP4 W/ (6) 10# X 1 1/2" NAILS	SYP	865














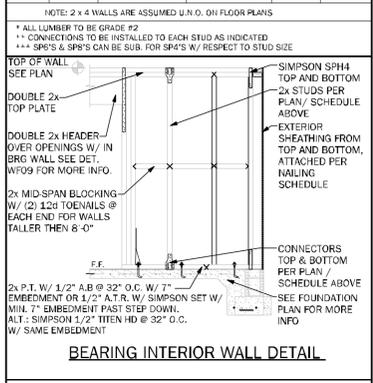


- GENERAL NOTES**
- SEE FLOOR PLAN FOR WALL SIZE. ASSUME 2x4 STUDS USED UNO.
 - ALL STRUCTURAL LUMBER TO BE SP# #1 OR SP# #2 UNO ON PLAN.
 - CONNECTIONS TO BE INSTALLED TO EACH STUD AS INDICATED. TO VERIFY THEY MEET THE STRUCTURAL REQUIREMENTS.
 - IF "BW" IS INDICATED ON SECOND FLOOR BASE CONNECTION TO IGNORED. SEE WFO9 DET. OR INDICATED DETAIL FOR PROPER CONNECTIONS FOR 2ND FLOOR TO FIRST FLOOR CONNECTIONS. NOTE: THIS IS FOR 2 STORY PROJECTS ONLY.
 - IF "SW" IS INDICATED THE WALL IS CONSIDERED A SHEARWALL AND REQUIRES MIN. 7/8" Ø BRG PLATE W/ 8# BRG NAILS AT 4" O.C. IN FIELD AND EDGE TO 1/4 SIDE OF WALL.
 - ALL 2x EXTERIOR WALLS W/ EXTERIOR SHEATHING ATTACHED PER NAILING SCHEDULE SHALL BE SHEARWALLS. SEE PLAN AND WALL SECTIONS FOR STUD SPACING AND GRADE.
 - IF THE BEARING WALL IS INDICATED WITH THE BW1, BW4, BW7, BW10 THESE WALLS ARE ONLY SUPPORTING THE FLOOR LOAD AND DO NOT HAVE UPLIFT. THE STUDS ARE TOE NAIL TO THE PLATE AND THE 2x PLATE CAN BE ATTACHED WITH HARD CAPPED NAILS (GUN NAILS) AND WILL NOT REQUIRE THE ANCHOR BOLT ATTACHMENT INDICATED IN THE BEARING WALL SCHEDULE.









HEADER SCHEDULE		
MARK	HEADER SIZE	REMARKS
H1	(2) -2X6 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H2	(2) -2X8 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H3	(2) -2X10 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H4	(2) -2X12 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H5	(2) -1 3/4" X 11 1/4 LVL 2.0E Fb=2600 PSI	ATTACH TOGETHER W/ (2) ROWS 1/4" X 1/2" SDS W/ SCREWS @ 16" O.C. TYP. EACH SIDE
H6	(2) -1 3/4" X 9 1/4 LVL 2.0E Fb=2600 PSI	ATTACH TOGETHER W/ (2) ROWS 1/4" X 1/2" SDS W/ SCREWS @ 16" O.C. TYP. EACH SIDE

HEADER SUPPORT NO. OF JACKS & STUDS REQ. AT OPENINGS				
OPENING SIZE	2x4 WALL		2x6 OR 2x8 WALL	
	JACKS EA. END	KINGS EA. END	JACKS EA. END	KINGS EA. END
1'-0" - 3'-11"	(1)	(2)	(1)	(2)
4'-0" - 9'-11"	(2)	(3)	(2)	(3)
10'-0" - 16'-0"	(3)	(4)	(3)	(4)









- GENERAL HEADER NOTES**
- VERIFY W/ PLAN CORRECT LENGTH OF HEADER REQUIRED.
 - IF HEADER IS ON THE 1st FLOOR SEE PLAN FOR BEARING WALL TYPE AND FOLLOW INSTRUCTIONS WITHIN BEARING WALL SCHEDULE FOR REQUIRED CONNECTIONS UNO ON PLAN.
 - IF HEADER IS ON THE 2ND FLOOR SEE PLAN FOR INDICATED HEADER CONNECTION FOR REQUIRED CONNECTIONS.
 - ALL HEADER JACK AND KING STUDS SHALL BE FASTENED TO EACH PER DETAIL WFS7.
 - FASTEN ALL MULTIPLE HEADERS TOGETHER W/ (2) ROWS 1/2" COMMON NAILS AT 12" O.C. ALONG EACH EDGE OR (3) ROWS IF 2x10 OR LARGER.
 - FASTEN ALL HEADERS TO KING STUDS WITH (3) 12# TOENAILS PER SIDE.
 - IF HEADER IS NOT SPECIFIED CONTACT E.O.R.

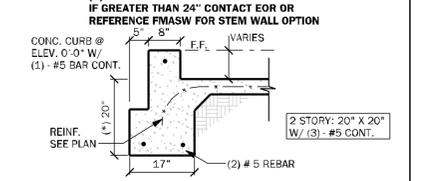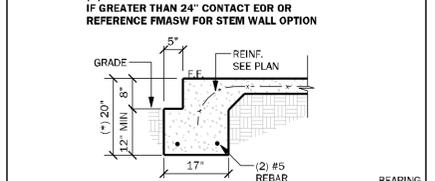

FMASW ALTERNATE STEM WALL FOOTING SCHEDULE 1/2" = 1'-0"

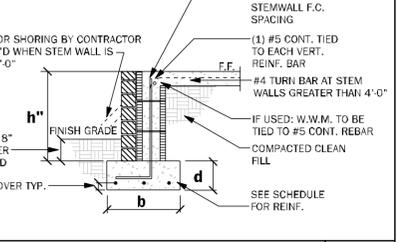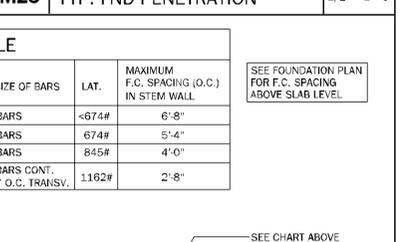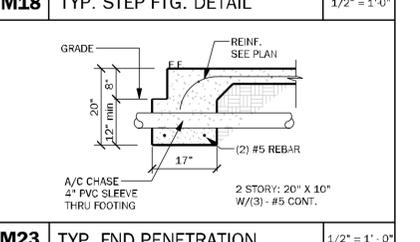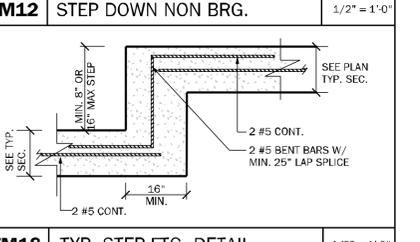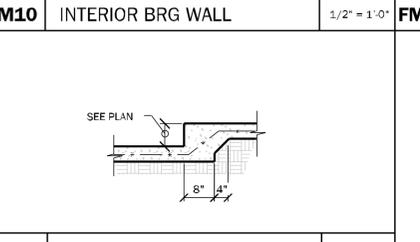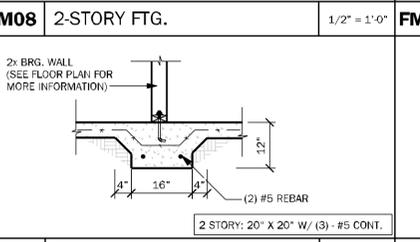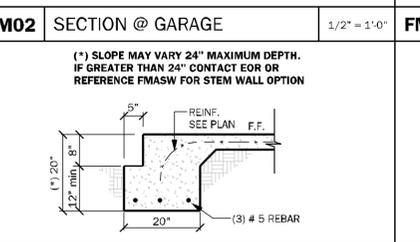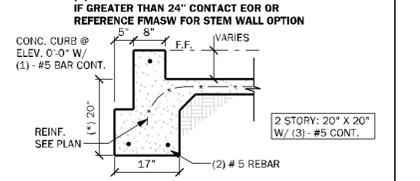

FM02A SECTION @ GARAGE 1/2" = 1'-0"

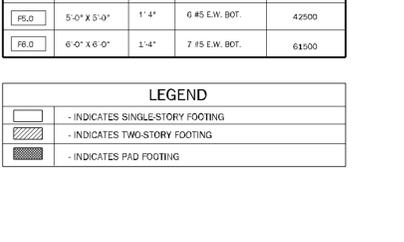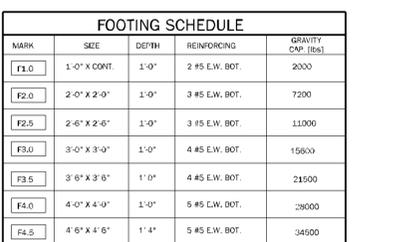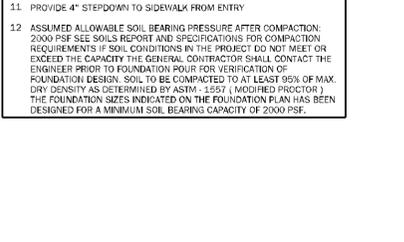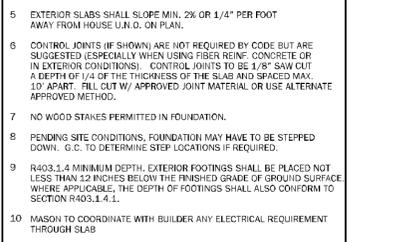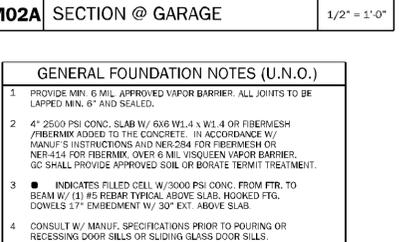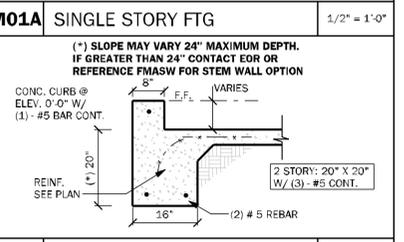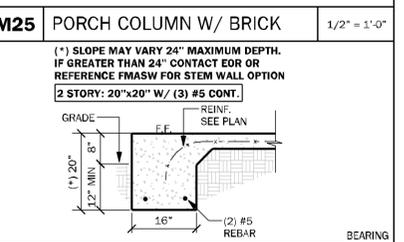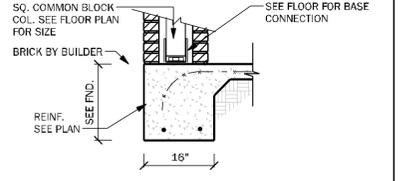

FM02A SECTION @ GARAGE 1/2" = 1'-0"

FOOTING SCHEDULE				
MARK	SIZE	DEPTH	REINFORCING	GRAVITY CAP. (Lb)
F1.0	1'-0" X CONT.	1'-0"	2 #5 E.W. BOT.	2000
F2.0	2'-0" X 2'-0"	1'-0"	3 #5 E.W. BOT.	7200
F2.5	2'-6" X 2'-6"	1'-0"	3 #5 E.W. BOT.	11000
F3.0	3'-0" X 3'-0"	1'-0"	4 #5 E.W. BOT.	15600
F3.5	3'-6" X 3'-6"	1'-0"	4 #5 E.W. BOT.	21500
F4.0	4'-0" X 4'-0"	1'-0"	5 #5 E.W. BOT.	28000
F4.5	4'-6" X 4'-6"	1'-4"	5 #5 E.W. BOT.	34500
F5.0	5'-0" X 5'-0"	1'-4"	6 #5 E.W. BOT.	42500
F6.0	6'-0" X 6'-0"	1'-4"	7 #5 E.W. BOT.	61500

- LEGEND**
- INDICATES SINGLE-STORY FOOTING
 - INDICATES TWO-STORY FOOTING
 - INDICATES PAD FOOTING

TS&S
 Making Dreams Come True
 TOTAL SOLUTIONS GROUP
 258 Southland Lane, Suite 200
 Maitland, Florida, 32751
 (407) 800-2333
 CARLA BROWN, PE - FL # 66126
 SCOTT LEHKOWSKI, PE - FL #78750
 100% Employee Owned
 myTSHome.com

ATA **hba** **GO** **BA**
 MUNICIPAL STAMP AREA
 SIGNATURE & SEAL
 10/27/2025

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 8th Edition. The Engineer's signature and seal is only for the structural engineering portions of the drawings prepared by the engineer's signature and seal.

I, the undersigned, as the design concept expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright of intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and prohibited by United States and International law.

DAMS HOMES
 FLORIDA CONTRACTORS LICENSE NO. CRC130146
 100 WEST GARDEN STREET
 PENSACOLA FL 32502
 Division Location:


Community: The Preserve at Laurel Lake
 Plan Name: 2508
 Project Address: Lake City
 Client No.:
 Project No.:
 Sheet No.: **3.1**
 FOUNDATION DETAILS
 PLAN SCHEDULES

ELECTRICAL NOTES: UNLESS OTHERWISE NOTED.

- ELECTRICAL OUTLET HEIGHTS AS MEASURED FROM FINISHED FLOOR TO CENTER LINE OF THE BOX TO BE: 16" AFF (GENERAL), IN A FLOOD ZONE, ALL ELECTRICAL EQUIPMENT TO BE AT OR ABOVE DFE.
- KITCHEN - 44" AFF
- BATHROOM - 39" AFF
- LAUNDRY ROOM - 36" AFF
- EXTERIOR WATERPROOF - 12" AFF
- GARAGE - GENERAL PURPOSE 42" AFF
- RANGE - 2" AFF
- ALL TRIM PLATES AND DEVICES TO BE GAUGED, WHERE POSSIBLE.
- ELECTRICAL SWITCHES TO BE AT 42" CENTERLINE ABOVE FINISHED FLOOR.
- ELECTRICAL PLAN IS INTENDED FOR BID PURPOSES ONLY. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC), LATEST EDITION, BY A LICENSED ELECTRICAL CONTRACTOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION & SIZING OF ALL ELECTRICAL WIRING & ACCESSORIES.
- SMOKE ALARMS SHALL COMPLY WITH NFPA 72 AND SECTION R314 AND SHALL BE LISTED IN ACCORDANCE WITH UL 217. COMBINATION SMOKE AND CARBON MONOXIDE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL 217 AND ILL 2034.
- PROVIDE AFCIS (ARC-FAULT CIRCUIT INTERRUPTERS) COMBINATION TYPE INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUITS IN ALL DWELLING UNITS PER NFPA 70 (CURRENT EDITION) AND THE NEC AND AS DEFINED IN UL 1699.
- PROVIDE TAMPER RESISTANT RECEPTACLES AS REQUIRED BY THE NFPA 70 (CURRENT EDITION).
- CARBON MONOXIDE PROTECTION: CARBON MONOXIDE ALARMS OR DETECTORS SHALL BE INSTALLED IN ALL DWELLING UNITS IN ACCORDANCE WITH IBC R315 AND NFPA 70. SUCH DEVICES SHALL BE LISTED BY THE APPROPRIATE STANDARD, EITHER ANSI/UL 2034, STANDARD FOR SINGLE AND MULTIPLE STATION CO ALARMS OR UL 2075, GAS AND VAPOR DETECTOR SENSOR, ACCORDING TO THE INSTALLATION.
- R315.1.2 COMBINATION ALARMS: COMBINATION SMOKE/CARBON MONOXIDE ALARMS SHALL BE LISTED AND LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.
- KEEP ALL SMOKE DETECTORS MINIMUM OF 36" FROM BATHROOM DOORS.
- IN NEW CONSTRUCTION, SMOKE DETECTORS SHALL BE HARDWIRED INTO AN A/C ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP.
- BATHROOM EXHAUST FANS MUST VENT TO THE EXTERIOR OF THE BUILDING, VENTILATION TO ATTIC SPACE AND SOFFITS IS NOT ACCEPTABLE.
- CHAPTER 45 PRIVATE SWIMMING POOLS - OUTDOOR SWIMMING POOLS SHALL BE PROVIDED WITH A BARRIER COMPLYING WITH R4501.17.1.1 THROUGH R4501.17.1.4.
- ADD GFCI PROTECTION TO RECEPTACLES IN LAUNDRY ROOMS AND UTILITY ROOMS OF DWELLINGS WHERE INSTALLED WITHIN 6' OF THE OUTSIDE EDGE OF A SINK. THIS WOULD INCLUDE THE RECEPTACLE INSTALLED FOR A WASHING MACHINE. RECEPTACLE OUTLETS SHALL NOT BE REQUIRED ON A WALL DIRECTLY BEHIND A RANGE OR SINK TO FULFILL THE REQUIREMENT OF AN OUTLET EVERY 24". THE WIDTH OF THE SINK OR RANGE IS NOT TO BE INCLUDED IN THE SPACING OF THE OUTLETS UNLESS THE DISTANCE FROM THE SINK OR RANGE IS GREATER THAN 12" FOR STRAIGHT COUNTER TOPS AND 18" FOR SINKS AND RANGES INSTALLED IN CORNER COUNTERS.
- WHERE MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN AN INDIVIDUAL DWELLING UNIT IN ACCORDANCE WITH SECTION R314.3, THE ALARM DEVICES SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE INDIVIDUAL DWELLING UNIT. PHYSICAL INTERCONNECTION OF SMOKE ALARMS SHALL NOT BE REQUIRED WHERE LISTED WIRELESS ALARMS ARE INSTALLED AND ALL ALARMS SOUND UPON ACTIVATION OF ONE ALARM.
- FOR ONE- AND TWO-FAMILY DWELLING UNITS, ALL SERVICE CONDUCTORS SHALL TERMINATE IN DISCONNECTING MEANS HAVING A SHORT-CIRCUIT CURRENT RATING EQUAL TO OR GREATER THAN THE AVAILABLE FAULT CURRENT, INSTALLED IN A READILY ACCESSIBLE OUTDOOR LOCATION. EACH DISCONNECT SHALL BE ONE OF THE FOLLOWING:
 - SERVICE DISCONNECTS MARKED AS FOLLOWS: EMERGENCY DISCONNECT, NOT SERVICE EQUIPMENT
 - METER DISCONNECTS INSTALLED PER 230.82(3) AND MARKED AS FOLLOWS: EMERGENCY DISCONNECT, METER DISCONNECT, NOT SERVICE EQUIPMENT
 - OTHER LISTED DISCONNECT SWITCHES OR CIRCUIT BREAKERS ON THE SUPPLY SIDE OF EACH SERVICE DISCONNECT THAT ARE SUITABLE FOR USE AS SERVICE EQUIPMENT AND MARKED AS FOLLOWS: EMERGENCY DISCONNECT, NOT SERVICE EQUIPMENT
- MARKINGS SHALL COMPLY WITH 110.21(B).
- ALL PERMANENTLY INSTALLED LUMINAIRES, EXCLUDING THOSE IN KITCHEN APPLIANCES, SHALL HAVE AN EFFICACY OF AT LEAST 45 LUMENS-PER-WATT OR SHALL UTILIZE LAMPS WITH AN EFFICACY OF NOT LESS THAN 65 LUMENS-PER-WATT.


ELECTRICAL LEGEND

- | | | | |
|------|--------------------------------|-----|--|
| \$ | SINGLE POLE SWITCH | ☉ | SMOKE DETECTOR |
| \$2 | DOUBLE POLE SWITCH | ☉M | CARBON MONOXIDE/ SMOKE DETECTOR COMBO UNIT |
| \$3 | THREE-WAY SWITCH | ☉F | FLOOD LIGHT |
| \$4 | FOUR-WAY SWITCH | ☉FL | FLUORESCENT LIGHTING |
| \$DM | DIMMER SWITCH | ☉T | TRACK LIGHTING |
| ☉ | CEILING MOUNTED FIXTURE | ☉C | CEILING FAN |
| ☉ | SCOURCE (WALL MOUNTED) FIXTURE | ☉ | DOOR BELL CHIMES |
| ☉ | 110 VOLT DUPLEX OUTLET | ☉ | DOOR BELL |
| ☉ | 110 VOLT SPLIT SWITCHED OUTLET | ☉ | DISPOSAL |
| ☉ | GROUND FAULT INTERRUPT | ☉ | DISCONNECT SWITCH |
| ☉WP | WATER PROOF W/ GROUND FAULT | ☉ | PREWIRE SPEAKER |
| ☉ | 220 VOLT OUTLET | ☉ | DISCONNECT SWITCH |
| ☉ | SPECIAL SERVICES OUTLET | ☉ | PREWIRE SPEAKER |
| ☉ | T.V. CABLE OUTLET | ☉ | DISCONNECT SWITCH |
| ☉ | TELEPHONE CABLE OUTLET | ☉ | PREWIRE SPEAKER |
| ☉ | RECESSED LIGHTING | ☉ | JUNCTION BOX |
| ☉WP | WATER PROOF RECESSED LIGHTING | ☉ | THERMOSTAT |
| ☉ | BATH FAN | ☉ | LOW VOLTAGE LIGHTING |
| ☉ | BATH FAN W/ LIGHT | ☉ | INTERCOM SYSTEM |
| ☉ | L.E.D. DISC LIGHT | ☉ | GARAGE DOOR PUSH BUTTON |

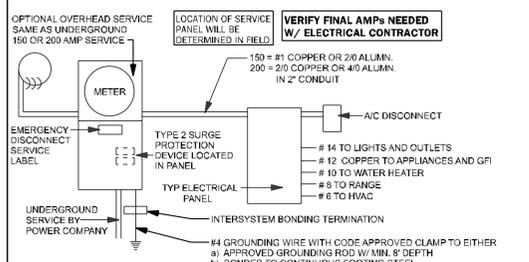


ELECTRICAL RISER

NOTE: ELECTRICAL MATERIAL AND INSTALLATIONS SHALL COMPLY WITH APPLICABLE PROVISIONS AS STATED ON STRUCTURAL NOTES SHEET LOCAL CODES AND THE LOCAL POWER CO.

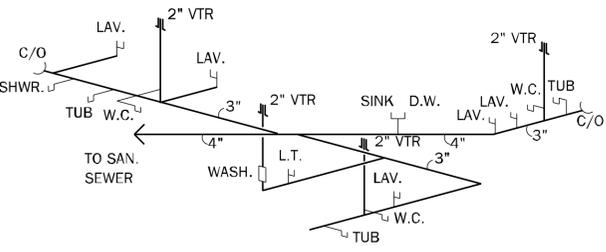

PLUMBING RISER

LOAD	EQUIPMENT	POLES	CU/CU	AMPS	AMPS	CU/CU	POLE	EQUIPMENT	LOAD		
10000	A/C HEAT UNIT NO. 1	2	6/4	60	1	2	40	8/6	2	ACCU NO. 1	0
1500	SMALL APPL. (GFI)	1	12/10	20	5	6				Spare	
1500	SMALL APPL. (GFI)	1	12/10	20	7	8				Spare	
830	REF.	1	12/10	20	9	10	20	12/10	1	DISHWASHER	1500
2000	Opt. Grinder Pump (GFCI)	2	12/10	20	11	12	20	12/10	1	DISPOSAL	900
					13	14	20	12/10	1	WASHER	1500
5000	DRYER (GFCI)	2	10/8	30	15	16	20	12/10	1	GARAGE DOOR OPEN	600
					17	18	15	14/12	1	General Lighting & Recept.	
4500	WATER HEATER	2	10/8	30	19	20	15	14/12	1	General Lighting & Recept.	
					21	22	20	12/10	1	Bath Circuit	
					23	24	20	12/10	1	Bath Circuit	
					25	26	20	12/10	1	Bath Circuit**	
					27	28	50	6/4	2	Range	8500
15330	LOAD LEFT SIDE				29	30				(Provide GFCI if within 6' of range)	
										LOAD RIGHT SIDE	13000
Totals		Enter S.F. Here		7524		28330		35854		10000	
GENERAL LIGHTING		2508 @ 3 w		7524		28330		35854		10000	
NAME PLATE RATING				7524		28330		35854		10000	
TOTAL WATTS LESS A/C				7524		28330		35854		10000	
FIRST 10000 W @ 100% REMAINDER @ 40% CONTINUOUS LOAD - A/C, POOL, CHARGER				10342		12000		1347567		10000	
TOTAL PANEL LOAD		32341.6 watts / 240 V		1347567						Breaker AIC Rating: 10,000	
MIN PANEL BOX SIZE		200		Licensed Electrician to verify all loads and modify if needed.							

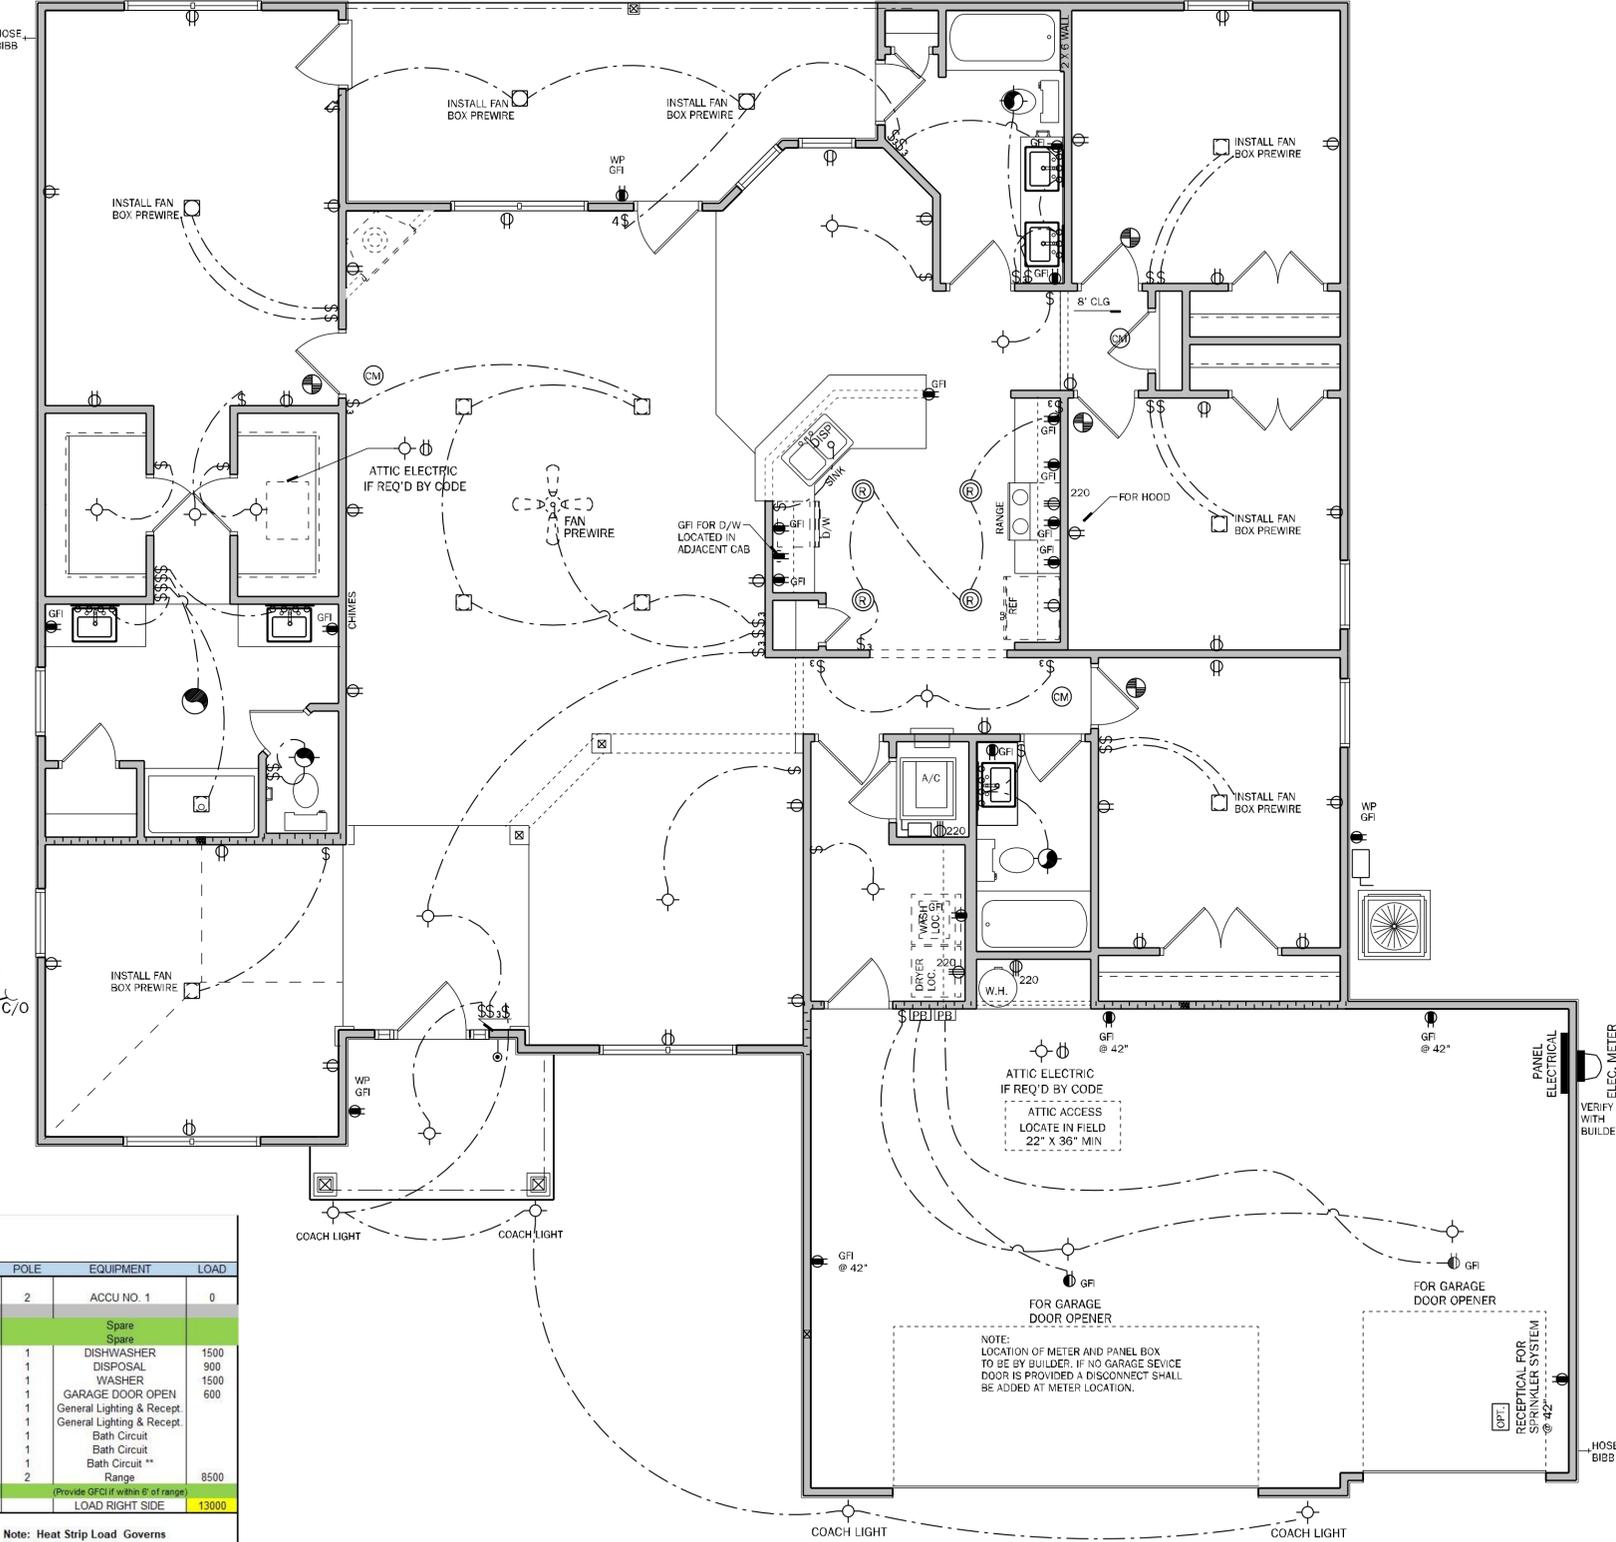

ALL INTERIOR AND EXTERIOR WALL FRAMING, INCLUDING FURRING STRIPS ON CMU WALLS, TO BE SPACED AND 16" O.C. (I.N.O.) *

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"
ELEVATION "A" & "B"

TSG
CA 102-9181
AQ060313
Making Dreams Come True

TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL #78750

100% Employee Owned
myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans are specific and contain within these drawings comply with the 2023 Florida Building Code, Residential 9th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.


This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright of intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and International Law.

DAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CR1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502
Division Location:

LOT: 33
Community: The Preserve at Laurel Lake
Plan Name: 2508
Project Address: Lake City
Client No:



LEFT ELEVATION "A"
SCALE: 3/16" = 1'-0"

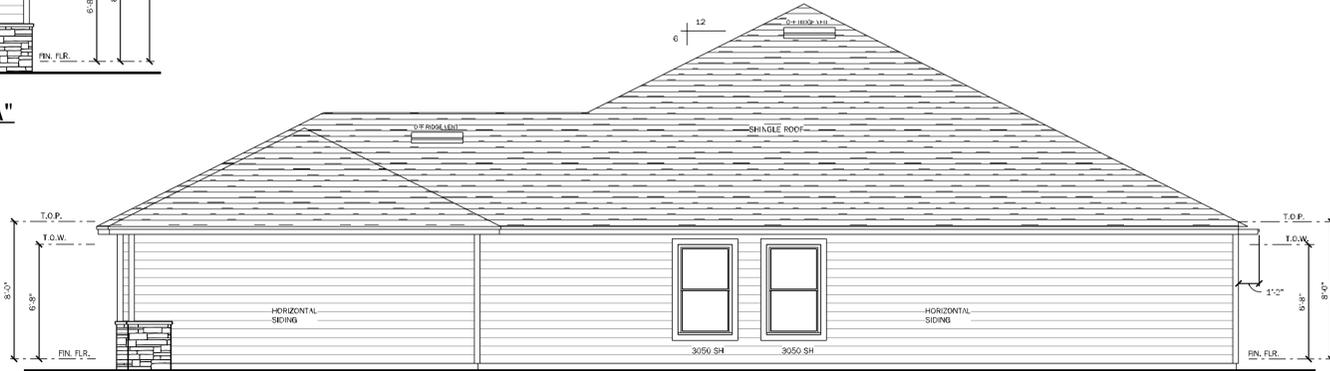

RIGHT ELEVATION "A"
SCALE: 3/16" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"



FRONT ELEVATION "A"
SCALE: 1/4" = 1'-0"

VENTILATION CALCULATION	
Calculations shown below are for both, off ridge and ridge vent systems. Only ONE system is required. See builder's specs for product used.	
Formula = SF / 300 * 144 = net sq. inches of venting needed.	
(Based on the 1/300 exception for the minimum vent area).	
S.F. of Area to be vented (SF)	3304
Total needed for exhaust for upper 1/3 Upper = 45% approx.	714 net sq inches
Total needed for intake (soffit area, lower) Lower = 55% approx.	872 net sq inches
Total needed combined to be no less than 40% and no more than 50%	1586 Upper 1/3= 45%
Soffit product provides	6.57 net sq in / sf
Overhang distance	2.00 ft
Net sq in per linear feet of soffit	13.14 sq in / lf
Linear Feet of Soffit needed to meet required	67
Linear Feet of Soffit provided by plan	236
Option one (Ridge vents)	
Ridge vent provides	18.00 net sq in / lf
L.F. of Ridge Vent needed	40
Option two (Off ridge vents)	
Off ridge vent provides	138.00 net sq in / sf
Number of Off Ridge Vents for upper 1/3	6



TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL # 478750

100% Employee Owned
myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
10/21/2025


To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contained within these drawings comply with the 2023 Florida Building Code - Residential 8th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.

This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright of intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and international law.

ADAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CR130146
100 WEST GARDEN STREET
PENSACOLA FL 32502
Builder: _____
Division Location: _____

Community: **The Preserve at Laurel Lake**
Plan Name: **2508**
Project Address: **Lake City**
Client No.: _____

Project No.: _____
Sheet No.: **5**
ELEVATIONS

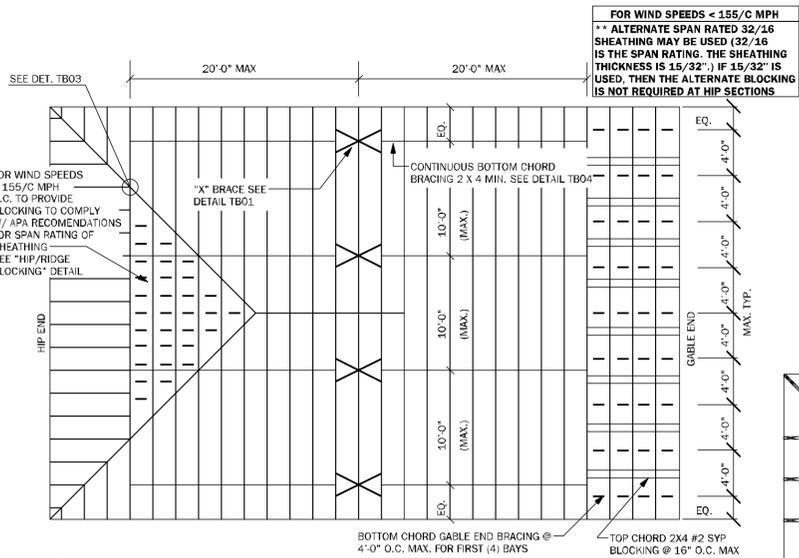

TB05 REQUIRED MINIMUM PERMANENT TRUSS BRACING PLAN

WIND SPEED (ULTIMATE)	130 MPH				
WIND SPEED (ALLOWABLE)	101 MPH				
EXPOSURE CATEGORY	B				
EFFECTIVE WIND AREA (SQ FEET)	AREA	ROOF	1	2	3
	HIP	-22.94	-31.68	-31.68	
	GABLE	-24.44	-38.92	-46.25	

ROOF NAILING SCHEDULE / NAILING ZONES (SHINGLE AND TILE):
 ZONE 1: ASTM F1667 RRSR-01 (8d) NAILS @ 6" O.C. ON EDGE & 6" O.C. IN FIELD
 ZONE 2: ASTM F1667 RRSR-01 (8d) NAILS @ 4" O.C. ON EDGE & 4" O.C. IN FIELD
 ZONE 3: ASTM F1667 RRSR-01 (8d) NAILS @ 4" O.C. ON EDGE & 4" O.C. IN FIELD



ROOF SHEATHING:
 SHINGLE: 7/16" EXP. 1 (2 3/16) or 15/32" EXP. 1 (2 3/16)
 TILE: 15/32" EXP. 1 (2 3/16)

NOTE:
 1. PER CODE ASTM F1667 RRSR-01 REFERENCE TO 8d (2 3/16" x 0.113") NAILS
 2. WHERE THE SHEATHING THICKNESS IS GREATER THAN 15/32", SHEATHING SHALL BE FASTENED WITH ASTM F1667 RRSR-03 10d (2 1/2" x 0.131") NAILS OR ASTM F1667 RRSR-04 (3" x .120") NAILS
 3. GABLES- DROP GABLE END & (1) ADDITIONAL DROPPED TRUSS 2x4 #2 SYP OUTLOOKER RAFTER W/ BLOCKING @ 16" O.C. IF NO DROPPED GABLE END, ATTACH 2x4 #2 SYP BLOCKING @ 16" O.C. FIRST 4 BAYS WITH (2) 12d NAILS EA. END, ATTACH ROOF SHEATHING TO RAFTERS W/ BLOCKING PER NAILING SCHEDULE


RRSR-01, RRSR-03, AND RRSR-04 ARE RING SHANK NAILS MEETING THE SPECIFICATIONS IN ASTM F1667

WALL SHEATHING MAY BE INSTALLED VERTICALLY OR HORIZONTALLY. ATTACH PER NAILING SCHEDULE. PANEL EDGES WILL NEED TO BE ATTACHED TO STUD AND OR BLOCKING AT ALL EDGES. A MINIMUM 1/2" SPACE IS RECOMMENDED BETWEEN PANELS AT EDGES AND END JOINTS TO ALLOW FOR EXPANSION. FASTENERS SHALL NOT PENETRATE SURFACE MORE THAN 1/2".

- (A) NAIL AT BASE 2 ROWS @ 4" O.C. w/ 8d COMMON NAIL.
- (B) NAIL AT TOP PLATE TWO ROWS @ 4" O.C. w/ 8d COMMON NAIL.
- (C) NAIL OPENING PERIMETER w/ (2) ROWS @ 4" O.C. w/ 8d COMMON NAIL.
- (D) NAIL INTERIOR AT 7" O.C. w/ 8d COMMON NAIL.
- (E) STAGGER ALL VERTICAL JOINTS & NAIL @ 4" O.C. w/ 8d COMMON NAIL.
- (F) PLYWOOD SPLICES @ HEADER - NAIL SHEATHING TO HEADER w/ 8d COMMON NAIL @ 4" O.C. (2) ROWS @ TOP & BOTTOM.
- (G) (2) 8d NAILS @ 3" O.C. TO EACH TRUSS END OR @ VERTICAL MEMBER IF GABLE END.
- (H) FLOOR SHEATHING "X" PLYWOOD DECKING CALLED AN NAILLED w/ 8d COMMON NAIL AT 4" O.C. AT EDGES OVERLAP NAILS FASTENERS SHALL NOT PENETRATE SURFACE MORE THAN 1/2".

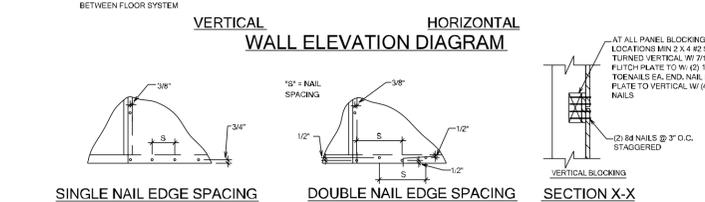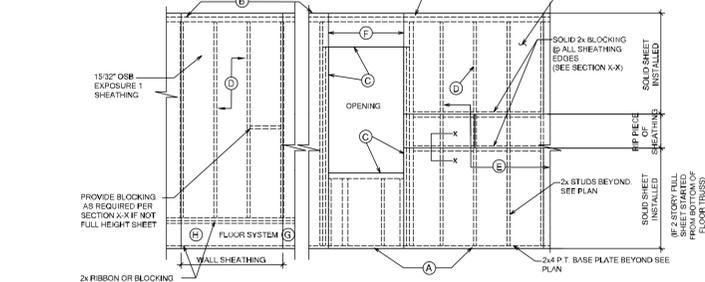

TB13 WALL SHEATHING INSTALLATION AND NAILING SCHEDULES

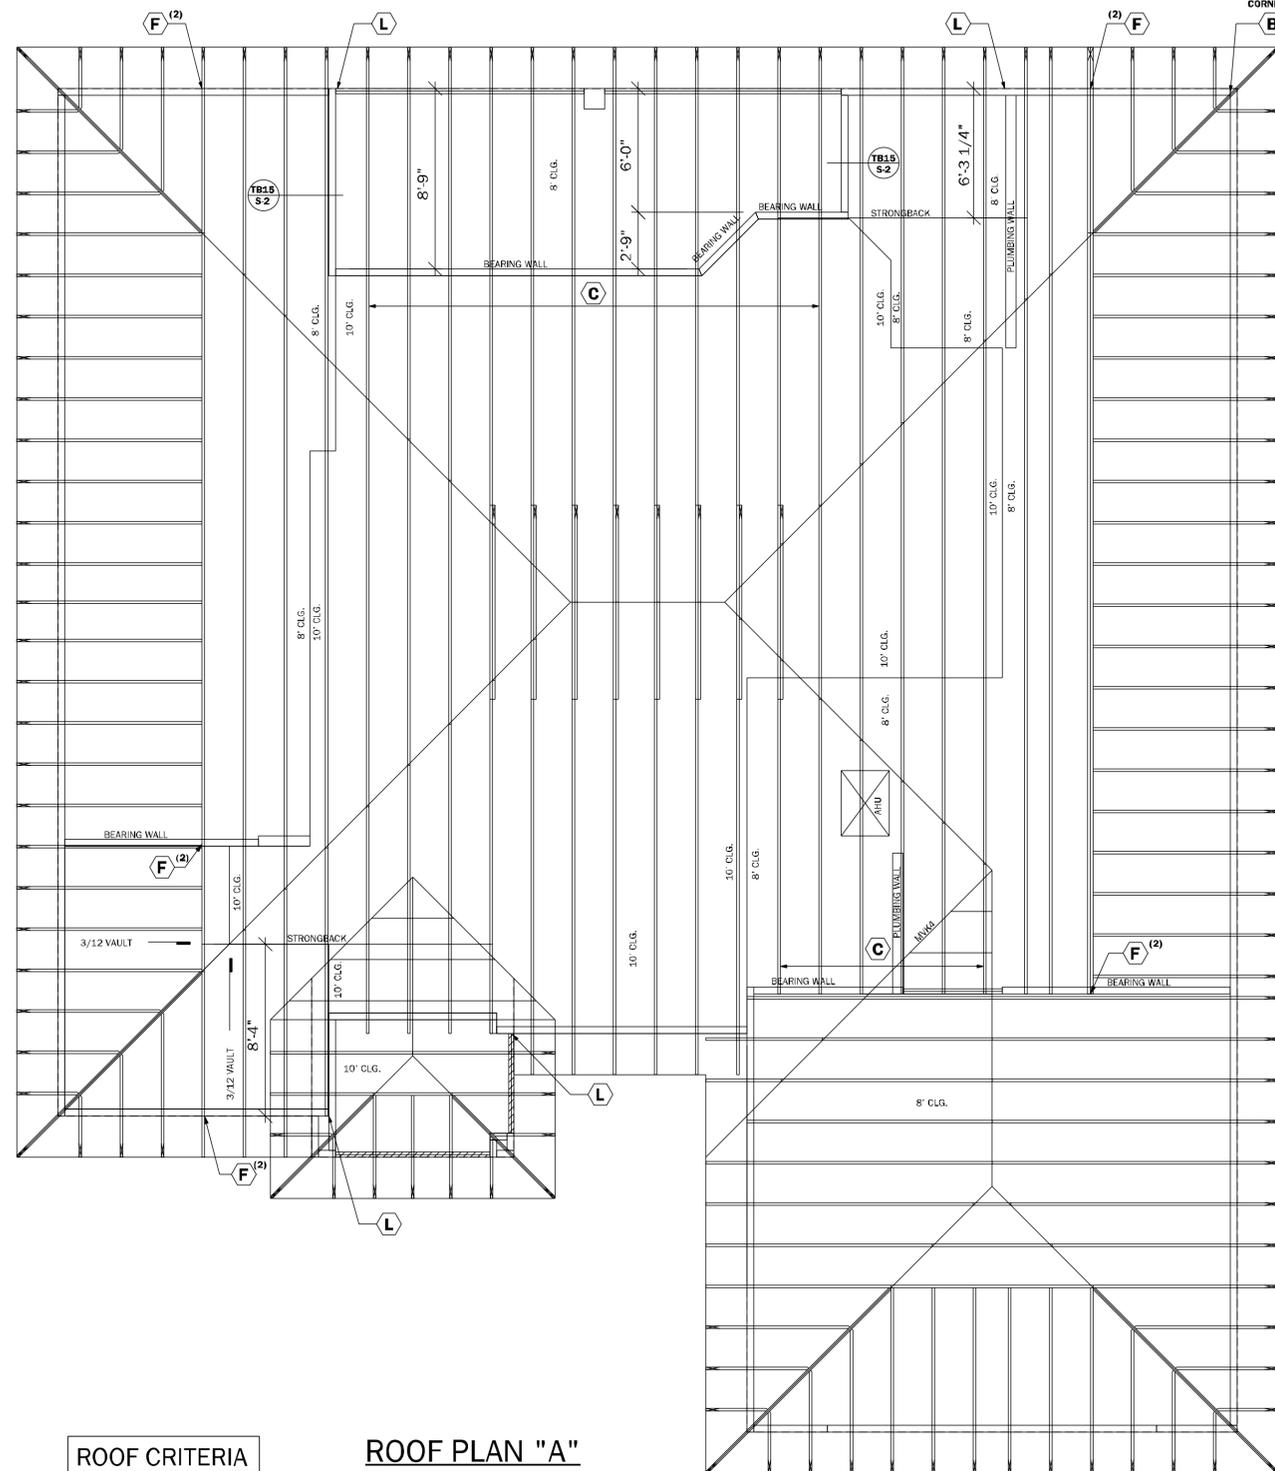

ROOF CRITERIA
 -24" OVERHANG @ EAVES U.N.O.
 -12" OVERHANG @ GABLES U.N.O.
 -SQUARE CUT FASCIA
 -ROOF PITCH PER ELEVATION
 -SHINGLE LOADING

ROOF PLAN "A"
 SCALE: 1/4" = 1'-0"

SIMPSON - CONNECTOR SCHEDULE					USP - CONNECTOR SCHEDULE		
MARK	TYPE	CONNECTOR & FASTENERS	SPF	SYP	CONNECTOR & FASTENERS	SPF	SYP
(A)	FRAME TO MASONRY	HETAR w/ (9) 10d x 1 1/2" OR HETAW w/ (10) 10d x 1 1/2"	1810	1810	HT16 w/ (10) 10d x 1 1/2" OR HT16 w/ (10) 10d x 1 1/2"	1885	1870
(B)	FRAME TO FRAME	H2 SA w/ (10) 8d NAILS	615	700	RT16 w/ (10) 8d NAILS	515	585
(C)	FRAME TO FRAME	H10A w/ (10) 10d x 1 1/2"	1015	1040	RT16A w/ (10) 10d x 1 1/2"	890	1020
(D)	FRAME TO MASONRY	H10A w/ (10) 10d x 1 1/2" AT 2 PLY TRUSSES EMBEDDED w/ SIMPSON "SET-30" EPOXY	930	1080	RT16A w/ (10) 10d x 1 1/2" AT 2 PLY TRUSSES EMBEDDED w/ SIMPSON "SET-30" EPOXY	930	1080
(E)	FRAME TO MASONRY	MGT w/ (2) 10d NAILS AND 6" A.T.R. w/ 12" MIN. EMBEDMENT w/ SIMPSON "SET-30" EPOXY	3330	3965	MUST BE w/ (2) 10d NAILS AND 6" A.T.R. w/ 12" MIN. EMBEDMENT w/ SIMPSON "SET-30" EPOXY	3330	4495
(F)	FRAME TO FRAME	H25 w/ (2) 10d x 1 1/2" AT EXTERIOR LOCATION INCLUDE (2) 12d TOENAILS	1215	1415	HT16 w/ (2) 10d x 1 1/2" AT EXTERIOR LOCATION INCLUDE (2) 12d TOENAILS	1295	1530
(G)	FRAME TO FRAME	H25 w/ (2) 10d x 1 1/2" AT EXTERIOR LOCATION INCLUDE (6) 12d TOENAILS	2430	2830	HT16 w/ (2) 10d x 1 1/2" AT EXTERIOR LOCATION INCLUDE (6) 12d TOENAILS	2570	3060
(H)	FRAME TO MASONRY	HGT w/ (10) 10d x 1 1/2" A.T.R. w/ 12" EMBEDMENT w/ SIMPSON "SET-30" EPOXY (MGT-3 FOR 3-PLY)	10990		HGT w/ (10) 10d x 1 1/2" A.T.R. w/ 12" EMBEDMENT w/ SIMPSON "SET-30" EPOXY (MGT-3 FOR 3-PLY)	7020	9790
(I)	FRAME TO MASONRY	FOR w/ (10) 10d x 1 1/2" SYP WOOD SCREWS AND (2) 1/2" x 5" TITENITE ANCHOR BOLTS	3400	4725	RFLS w/ (10) W8 WOOD SCREWS AND (4) 3/4" x 8" WEDGE BOLT		7100
(J)	FRAME TO MASONRY	(1) LGT w/ (10) 10d SINKERS & (1) 1/4" x 2 1/2" TITENITE Z (SEE NOTE #6 BELOW)	1795	2340	(2) LGT w/ (10) 10d SINKERS & (1) 1/4" x 3" WEDGE BOLT (2 PLY TRUSSES) OR (2) 10d SINKERS FOR FRAME (EA)	3100M	3100M
(K)	FRAME TO MASONRY	(2) LGT w/ (10) 10d SINKERS & (1) 1/4" x 3" WEDGE BOLT (2 PLY TRUSSES) OR (2) 10d SINKERS FOR FRAME (EA)	3500M	4090M	(2) LGT w/ (10) 10d SINKERS & (1) 1/4" x 3" WEDGE BOLT (2 PLY TRUSSES) OR (2) 10d SINKERS FOR FRAME (EA)	4480M	4480M
(L)	FRAME TO MASONRY	(2) LGT w/ (10) 10d SINKERS & (1) 1/4" x 3" WEDGE BOLT (2 PLY TRUSSES) OR (2) 10d SINKERS FOR FRAME (EA)	4780M	5704M	(2) LGT w/ (10) 10d SINKERS & (1) 1/4" x 3" WEDGE BOLT (2 PLY TRUSSES) OR (2) 10d SINKERS FOR FRAME (EA)	6480M	7194M
(M)	BEAM TO BEAM	HU10 OPT HU10A10 w/ (10) 10d x (10) 10d NAILS	G4260	U8185	HU10 OPT HU10A10 w/ (10) 10d x (10) 10d NAILS	G4260	U8185
(N)	BEAM TO MASONRY	HU10 OPT HU10A10 w/ (10) 10d NAILS	G4260	U8185	HU10 OPT HU10A10 w/ (10) 10d NAILS	G4260	U8185
(O)	BEAM TO MASONRY	HU10 OPT HU10A10 w/ (10) 10d NAILS & (1) 1/2" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	G4260	U8185	HU10 OPT HU10A10 w/ (10) 10d NAILS & (1) 1/2" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	G4260	U8185
(P)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(Q)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(R)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(S)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(T)	FRAME TO FRAME	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(U)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(V)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(W)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(X)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(Y)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430
(Z)	FRAME TO MASONRY	H10B w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1800	2365	HT16 w/ (8) 8d x 1 1/2" NAILS AND (2) 3/8" x 4" A.T.R. EMBEDDED w/ SIMPSON "SET-30" EPOXY	1870	2430

GENERAL CONNECTOR NOTES:
 1. CONNECT ALL FLOOR TRUSSES TO INTERIOR BEARING WOOD WALLS (BEAMS w/ (2) 12d TOENAILS)
 2. ALL TRUSSES TO TRUSS CONNECTIONS ARE PROVIDED BY TRUSS MANUFACTURER. USE ON PLAN.
 3. O.C. MAY USE EITHER SIMPSON OR USP CONNECTIONS. SEE FRAMING PLAN FOR CONNECTOR CALL OUT.
 4. FOR SINGLE PLY TRUSSES, SCHEMATIC HEIGHT SHIP 2" TO TRUSS VERTICAL WEB w/ (2) ROWS OF 10d NAILS @ 3" O.C. STAGGERED.
 5. 12" MIN. A.T.R. EMBEDMENT @ CMU BOND BEAM U.O.
 6. SCAB TRUSS CHORDS w/ 4" x 8" OR 4" x 6" MATCH CHORD LUMBER SIZE w/ (2) ROWS 10d @ 4" FROM END & 4" O.C. STAGGERED. CENTER AT CONNECTOR LOCATION AS MUCH AS POSSIBLE.

- (A) MINIMAL CONNECTOR UNO ON FRAMING PLAN
- 1. CONNECTION FOR ALL ROOF FLOOR TRUSSES TO MASONRY WALLS (MIN. 1/2" NAILS UNO ON PLAN)
- 2. CONNECTION AT 24" OR 32" O.C. PENDING VERTICALS FOR ALL FLOOR TRUSSES PARALLEL TO MASONRY WALLS.
- 3. CONNECTION FOR ALL HIP JACK (CORNER JACK) TO MASONRY WALLS (1/2" NAILS UNO ON PLAN)
- 4. CONNECTION FOR ALL CONTINUOUS BEAMS TO TOP OF MASONRY AT 24" O.C. MAX. w/ (2) AT EACH CORNER. C.L.C. TO VERIFY LOCATION DOES NOT CONFLICT w/ (1) IF APPLICABLE LAYOUT.
- 5. CONNECT ALL FLOOR TRUSSES TO INTERIOR BEARING WOOD WALL BEAMS w/ (2) 12d TOENAILS.
- (B) MINIMAL CONNECTOR UNO ON FRAMING PLAN
- 1. CONNECTION FOR JACK TRUSS TO WOOD WALL OR BEAM
- (C) MINIMAL CONNECTOR UNO ON FRAMING PLAN
- 1. CONNECTION FOR ALL TRUSSES TO INTERIOR/EXTERIOR BEARING WOOD WALLS AND/OR BEAMS

ROOF FRAMING NOTES
 1. SHINGLE OR METAL ROOFING SYSTEM (SEE ARCH.) SHEATHING - SEE (RSH) SCHEDULE THIS SHEET. FOR SHIT'S & FASTENERS ON PRE-ENGINEERED WOOD TRUSSES AT 2'-0" O.C. MAX. OR CONVENTIONAL FRAME ROOF (SEE PLAN FOR SIZE AND SPACING. SEE ARCHITECTURAL PLAN FOR TYPICAL ROOF SLOPE AND OTHER INFORMATION.
 TILE ROOFING SYSTEM (SEE ARCH.) SEE (RSH) SCHEDULE THIS SHEET
 2. THE EXTERIOR CEILING FOR THE ENTRIES AND PORCHES SHALL HAVE EITHER 7/16" OSB EXPOSURE 1 SHEATHING OR 1/2" DENSGLOSS TO THE UNDERSIDE OF THE ROOF TRUSSES. ALL PANEL EDGES ARE TO BE BLOKED SOLID w/ 2x4 #2 SYP WITH (2) 12d TOENAILS EACH END. THE SHEATHING IS TO BE NAILLED WITH 8d NAILS @ 4" ON CENTER AT ALL EDGES AND THEN 8" ON CENTER IN FIELD.
 3. FOR UNDERLAYMENT REQUIREMENTS SEE R905.1.1.1

--- NOTE TO FRAMER ---
 IF ROOF TRUSS LAYOUT SHOWS TRUSS ID'S, THIS LAYOUT HAS BEEN PROVIDED BY THE CLIENT / DESIGNER OR ARCHITECT TO USE FOR THE DESIGN OF THIS PROJECT. OTHERWISE A GENERIC LAYOUT HAS BEEN DETERMINED. BUT PRIOR TO CONSTRUCTION OR TRUSS FABRICATION, FINAL TRUSS LAYOUT AND TRUSS SHOP DRAWINGS ARE TO BE SUBMITTED TO ENGINEER OF RECORD (E.O.R.) FOR REVIEW AND APPROVAL. AT THIS TIME THE E.O.R. RESERVES THE RIGHT TO REVISE THE PLAN AS REQUIRED PER THE REVIEW OF THE FINAL TRUSS LAYOUT AND TRUSS SHOP DRAWINGS, ADDITIONAL FEES MAY APPLY. STARTING CONSTRUCTION OR TRUSS FABRICATION PRIOR TO THIS REVIEW IS NOT ADVISED, AND THE E.O.R. IS NOT RESPONSIBLE FOR ADDITIONAL COSTS DUE TO REVISIONS OF THE PLAN. IF CONVENTIONAL FRAMING IS SHOWN, NO TRUSS APPROVAL IS REQUIRED, UNLESS LAYOUT IS REVISED W/OUT WRITTEN APPROVAL FROM E.O.R.

SEE PLAN SET FOR TRUSS BRACING AND ADDITIONAL ROOF INFORMATION

TOTAL SOLUTIONS GROUP
 258 Southhall Lane, Suite 200
 Maitland, Florida, 32751
 (407) 800-2333
 CARLA A. BROWN, PE - FL # 56126
 SCOTT LEWKOWSKI, PE - FL # 878750
 100% Employee Owned
 myTSHome.com

ATA **fhba** **GO** **BA**

MUNICIPAL STAMP AREA


SIGNATURE & SEAL
 10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 8th Edition. Engineer's signature and seal are only for the structural engineering portion of the drawing pages bearing engineer's signature and seal.


ADAMS HOMES
 FLORIDA CONTRACTORS LICENSE NO. CR1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502
 Division Location

LOT: 33
 Community: The Preserve at Laurel Lake
 Plan Name: 2508
 Project Address: Land Only
 Client No.:

Project No:
 Sheet No:
S-1
 ROOF PLAN

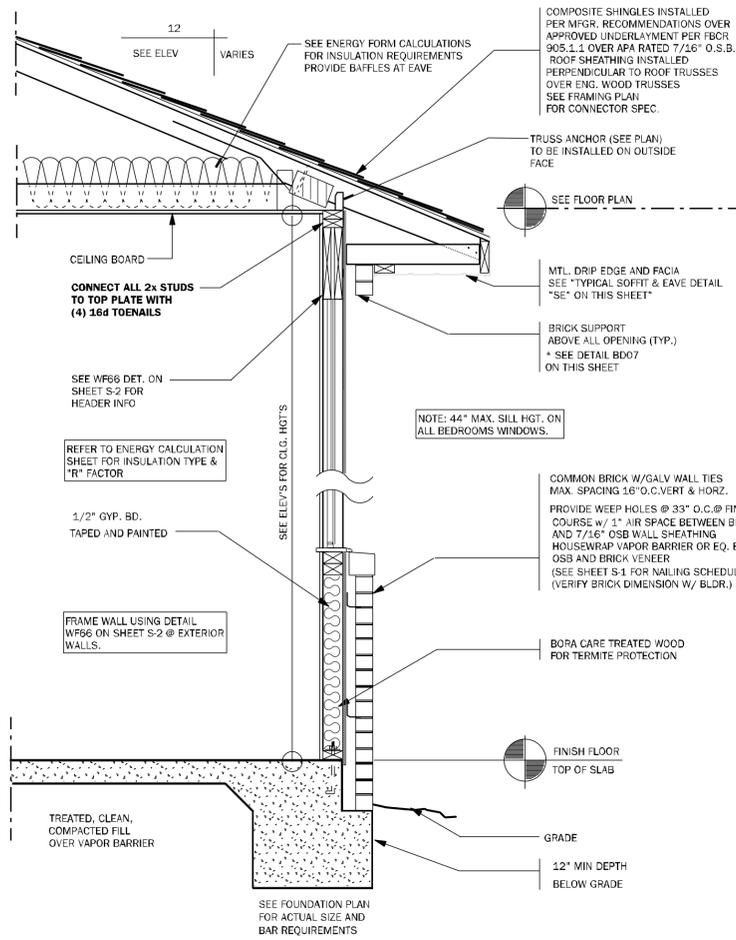


BD12 TYPICAL WALL SECTION 3/4" = 1'-0"

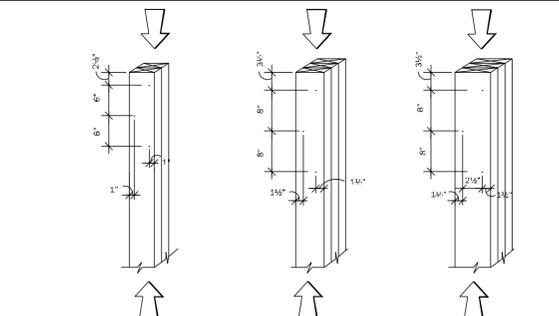

(2) 2 x 4 LAMINATIONS W/ (1) ROW OF STAGGERED 16d COMMON WIRE NAILS (D = 0.148", L = 3") OR EQUAL
 (3) 2 x 4 LAMINATIONS W/ (2) ROWS OF STAGGERED 16d COMMON WIRE NAILS (ONE INTO EACH OUTSIDE FACE) (D = 0.162", L = 3-1/2") OR EQUAL
 (3) 2 x 6 LAMINATIONS W/ (2) ROWS OF STAGGERED 16d COMMON WIRE NAILS (ONE INTO EACH OUTSIDE FACE) (D = 0.162", L = 3-1/2") OR EQUAL

NOTES:
 1) ADJACENT NAILS ARE DRIVEN FROM OPPOSITE SIDES OF THE COLUMN.
 2) ALL NAILS PENETRATE AT LEAST 3/4" OF THE THICKNESS OF THE LAST LAMINATION.
 3) FOR 4-PLY, PROVIDE 1/4" DIA. x 5 1/2" LAG SCREWS OR EQUAL (SPACE AS SHOWN FOR 3-PLY)
 4) REFER TO NDS SECTION 15.3 FOR ADDITIONAL INFO.

WF37 TYPICAL COLUMNS DETAILS N.T.S.

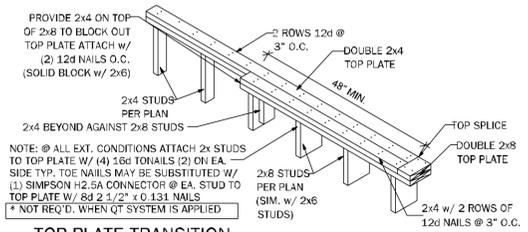

PROVIDE 2x4 ON TOP OF 2x8 TO BLOCK OUT TOP PLATE ATTACH W/ (2) 12d NAILS O.C. (SOLID BLOCK W/ 2x8)

2x4 STUDS PER PLAN
 2x4 BEYOND AGAINST 2x8 STUDS


NOTE: @ ALL EXT. CONDITIONS ATTACH 2x STUDS TO TOP PLATE W/ (4) 16d TOENAILS (2) ON EA. SIDE TYP. TOE NAILS MAY BE SUBSTITUTED W/ (1) SIMPSON H2.5A CONNECTOR @ EA. STUD TO TOP PLATE W/ 8d 2 1/2" x 0.131 NAILS
 * NOT REQ'D. WHEN QT SYSTEM IS APPLIED

TOP PLATE TRANSITION


PIPE OR DUCT W/ PENETRATION THRU TOP PLATE W/ MORE THAN 50% OF TOP PLATE WIDTH INSTALL SIMPSON P5PN16Z W/ (2) 16d NAILS TYP. TOP & BOT.

NOTE: @ ALL EXT. CONDITIONS ATTACH 2x STUDS TO TOP PLATE W/ (4) 16d TOENAILS (2) ON EA. SIDE TYP. TOE NAILS MAY BE SUBSTITUTED W/ (1) SIMPSON H2.5A CONNECTOR @ EA. STUD TO TOP PLATE W/ 8d 2 1/2" x 0.131 NAILS
 * NOT REQ'D. WHEN QT SYSTEM IS APPLIED


WF17 TOP PLATE SPLICE DETAIL 3/4" = 1'-0"

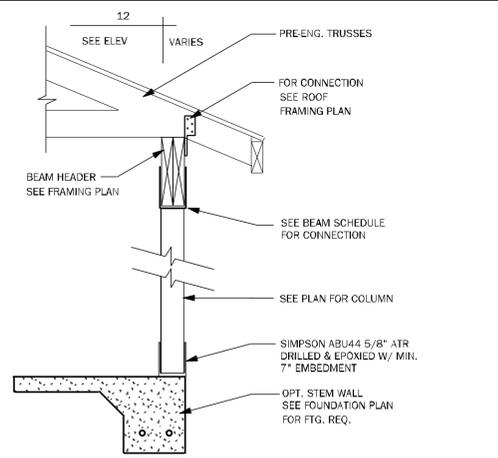


CD24 POST & BEAM DETAIL 1/2" = 1'-0"

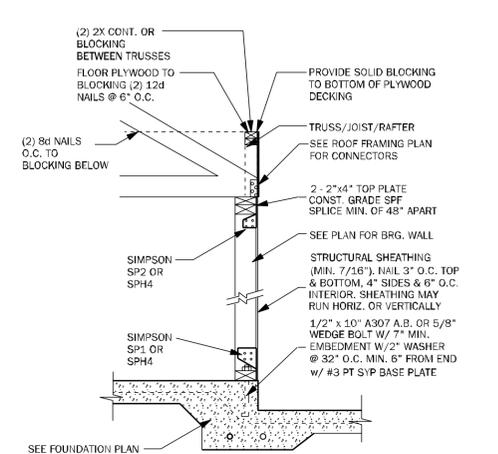


SW01 INTERIOR BEARING SHEARWALL w/UPLIFT N.T.S.

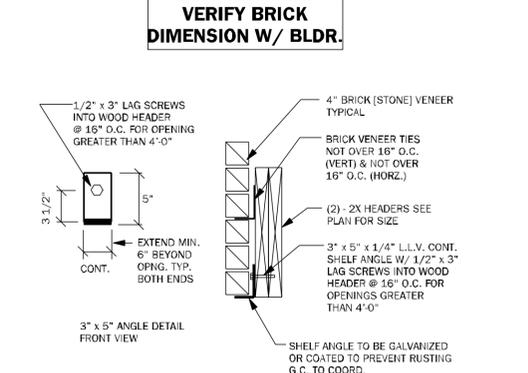


BD07 BRICK SHELF DETAIL N.T.S.

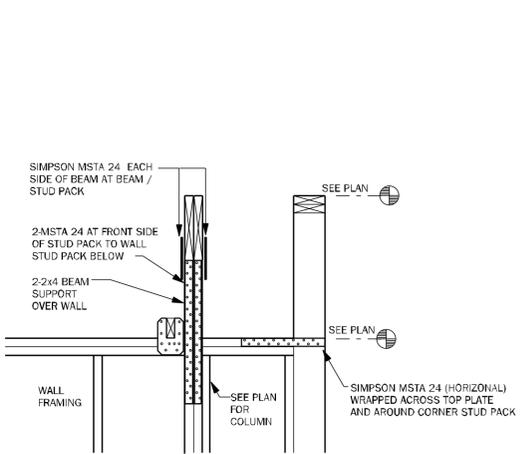


WC08 STEP UP @ CORNER & RAISED BEAM N.T.S.

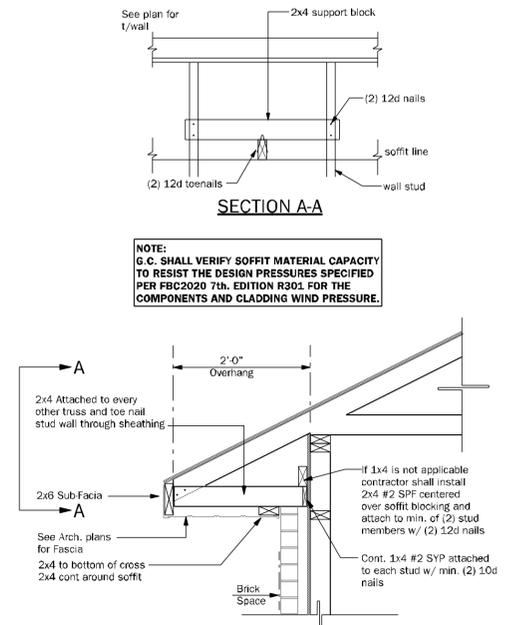


SE TYPICAL SOFFIT AND EAVE DETAIL 3/4" = 1'-0"

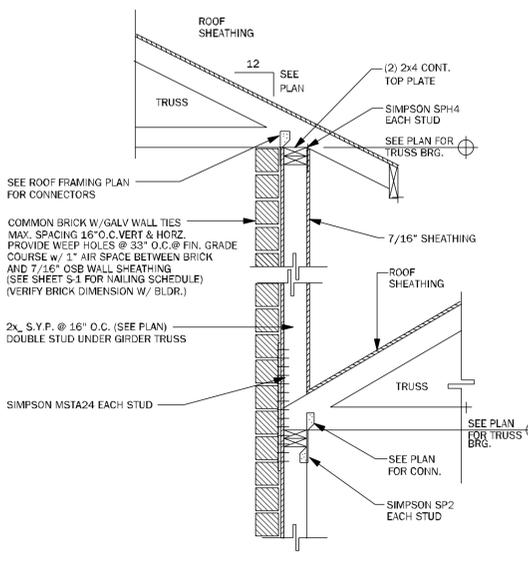

WF63 SECTION AT DOUBLE BEARING N.T.S.

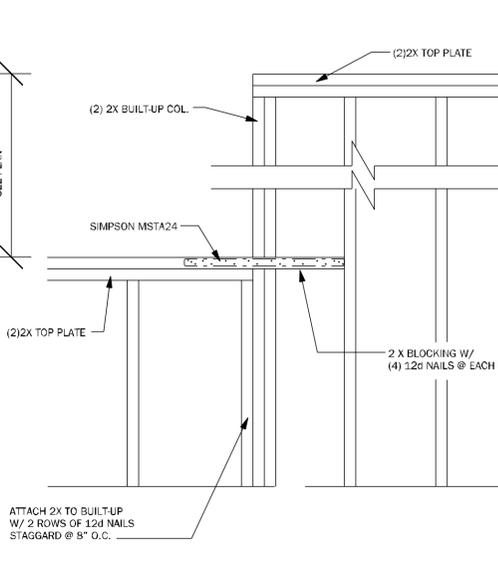

WC07 STEP UP @ CORNER & RAISED BEAM 1/2" = 1'-0"

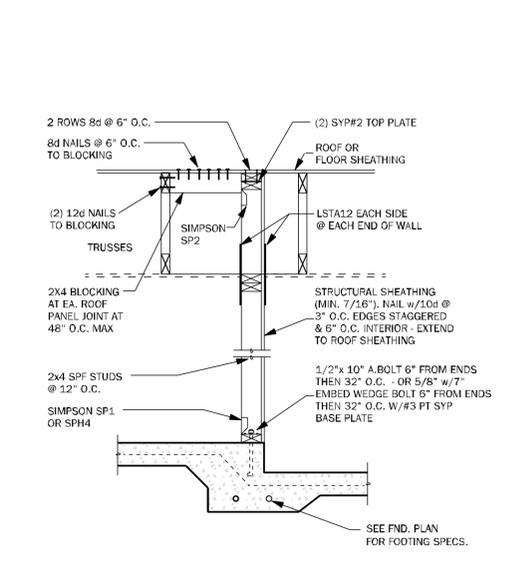

SW04 INTERIOR SHEARWALL @ TRUSSES 3/4" = 1'-0"

TSG
 CA REG. # 101 A-0600315
 Making Dreams Come True

TOTAL SOLUTIONS GROUP
 258 Southhall Lane, Suite 200
 Maitland, Florida, 32751
 (407) 800-2333
 CARL A. BROWN, PE - FL # 56126
 SCOTT LEVKOWSKI, PE - FL # 78750

100% Employee Owned
 myTSGhome.com

ATA **fhba** **GO**
BD **BA**

MUNICIPAL STAMP AREA

SIGNATURE & SEAL
 10/21/2025


To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 6th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signatures and seal.

This document and/or the design concepts represented herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright of intellectual property are reserved. The reproductions, copying, or use of this document or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and international law.


DAMS HOMES
 FLORIDA CONTRACTORS LICENSE NO. CRC1330146
100 WEST GARDEN STREET
LAKE CITY FL 32502
 Division Location:

LOT: 33
 UNIT:
 BK:
 Community: **The Preserve at Laurel Lake**
 Plan Name: **2508**
 Project Address: **Lake City**
 Client No.:

Project No:
 Sheet No:
S-3
 TYPICAL WALL DETAILS

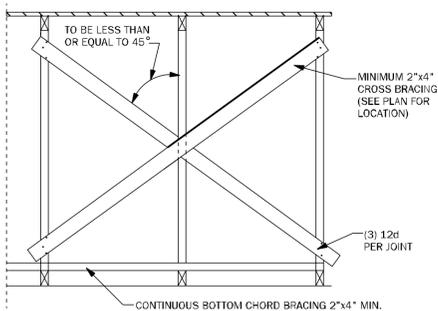


TB01 TYPICAL CROSS BRACING DETAIL N.T.S.

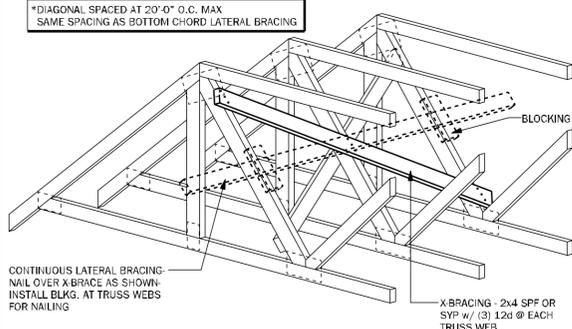


TB02 TYPICAL CROSS BRACING DETAIL N.T.S.

THE HEIGHT OF THE CHIMNEY SHOULD EXTEND 2' ABOVE THE POINT WHERE THE CHIMNEY IS 10' FROM THE NEAREST BUILDING SURFACE.

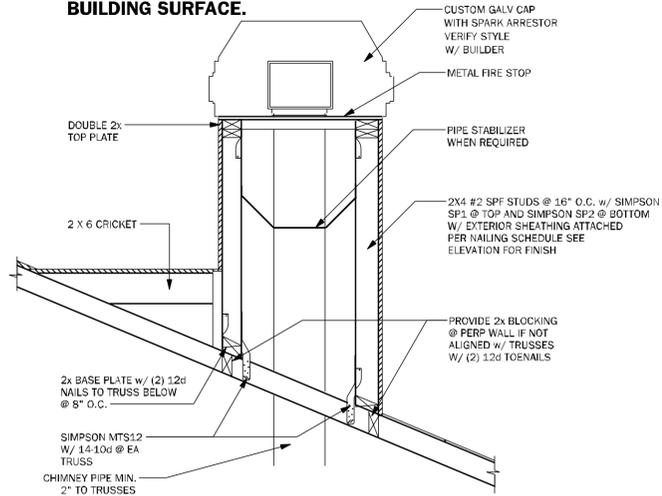


CH01 TYPICAL CHIMNEY FRAME DETAIL 3/4" = 1'-0"


RAFTER SIZE	
0'-8" SPAN -	2"x6" W/4-12d EACH END
8'-12" SPAN -	2"x8" W/4-12d EACH END
12'-15" SPAN -	2"x10" W/ SIMPSON A 34 @ EA. END
15'-18" SPAN -	2"x12" W/ SIMPSON A 34 @ EA. END

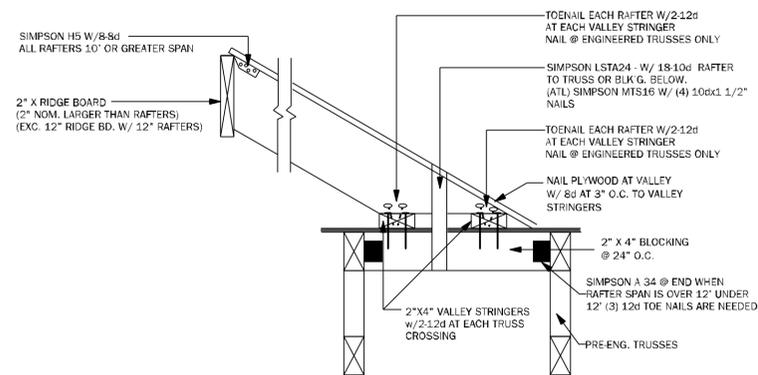


TB17 CONV. FRAMING & VALLEY FRAMING N.T.S.

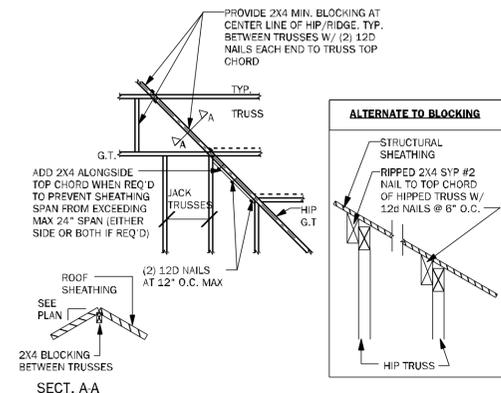


TB03 HIP / RIDGE BLOCKING DETAIL N.T.S.

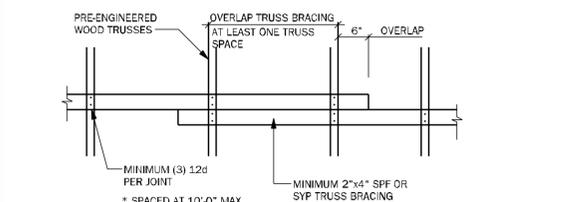

TB04 TRUSS BRACING OVERLAP DETAIL (TYP) N.T.S.

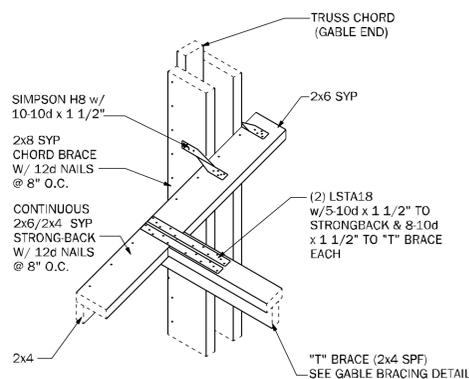




GE04 "T" BRACE CONNECTION @ GABLE END W/ VOLUME CEILING 3/4" = 1'-0"

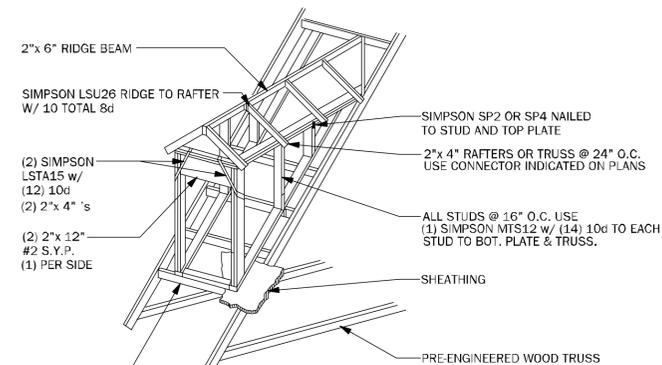


WF05 DORMER FRAMING DETAIL N.T.S.

TRUSS NOTES:

- WOOD TRUSS ERECTOR SHALL PROVIDE BRACING ACCORDING TO ANSI/TP1-2014 (TRUSS PLATE INSTITUTE) NOTE THAT THE COMBINED WIND AREA IS GREATER BEFORE THE ROOF SHEATHING IS APPLIED, AND BRACING SHALL THEREFORE BE INSTALLED AS THE TRUSSES ARE ERECTED. INADEQUATE BRACING IS THE MOST COMMON CAUSE OF ACCIDENT IN WOOD TRUSS CONSTRUCTION. FULL BUNDLES OF SHEATHING SHALL NOT BE PLACED ON TRUSSES. THE CONSTRUCTION LOAD SHOULD BE LIMITED TO 8 SHEETS OF SHEATHING ON ANY PAIR OF TRUSSES & SHALL BE LOCATED ADJACENT TO THE SUPPORTS. NO EXCESS CONCENTRATION OF ANY CONSTRUCTION MATERIAL (SUCH AS GRAVEL OR SHIMMERS) SHALL BE PLACED ON THE TRUSSES IN ANY ONE AREA THEY SHALL BE SPREAD OUT EVENLY OVER A LARGE AREA SO AS TO AVOID OVERLOADING ANY ONE TRUSS.
- ALL BRACING (DB OR BB) SHOWN ABOVE SHALL BE IN ADDITION TO CONTINUOUS LATERAL BRACING SPECIFIED BY THE TRUSS MANUFACTURER. ALL LATERAL BRACING SPECIFIED BY TRUSS MANUF. SHALL HAVE ADDITIONAL DIAGONAL BRACES AT 20'-0" O.C. MAXIMUM.
- ALL BRACES SHALL BE 2x4 NOMINAL DIMENSION LUMBER & SHALL BE ATTACHED W/ (3) 12d NAILS AT EACH TRUSS INTERSECTION.
- ADDITIONAL BOTTOM CHORD BRACING SHALL BE INSTALLED AS REQUIRED BY TRUSS DESIGN WHEREVER ADEQUATE STRUCTURAL CEILING ARE NOT ATTACHED DIRECTLY TO THE BOTTOM CHORD OF THE TRUSS.
- PROVIDE TRUSS BLOCKING AT ALL TRUSS BEARING SUPPORTS WHERE TRUSS DEPTH EXCEEDS STANDARD HEEL HEIGHT. SEE TYP. TRUSS BLOCKING DETAILS.

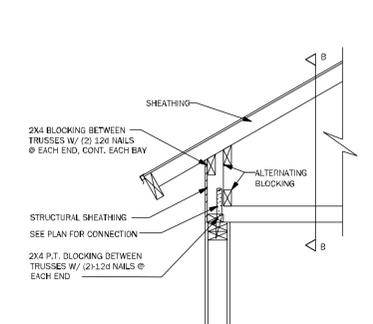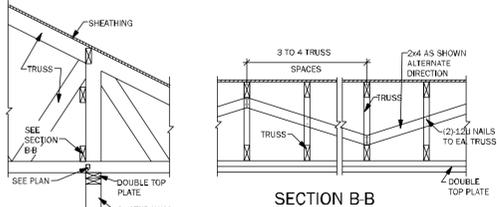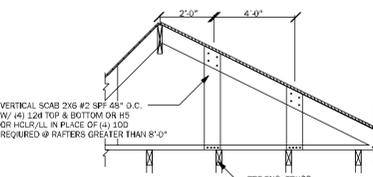

TYP. WOOD TRUSS BLOCKING @ RAISED HEEL DETAIL

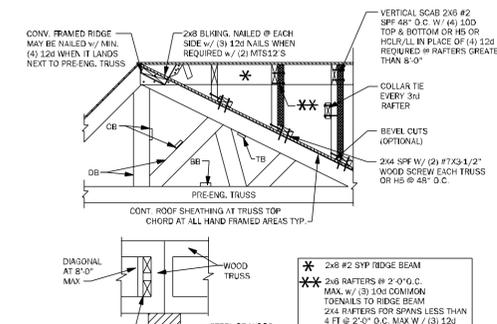

A-A ALTERNATE BLOCKING DETAIL @ INTERIOR BEARING

TB06 BLOCKING AND CONVENTIONAL FRAME DETAILS 3/4" = 1'-0"



TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL # 78750

100% Employee Owned
myTSGhome.com

MUNICIPAL STAMP AREA


SIGNATURE & SEAL
10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 6th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.


This document and/or the design concepts expressed herein are the property of TSG Total Solutions Group and all rights of ownership, including copyright of intellectual property are reserved. The reproductions, copying, or use of the documents and/or the design concept without the written consent of TSG Total Solutions Group is strictly prohibited and protected by United States and International law.

ADAMS HOMES
Builder:
FLORIDA CONTRACTORS LICENSE NO. CRCL330146
100 WEST GARDEN STREET
PENSACOLA FL 32502
Division Location:
LOT: 33
UNIT:
Community: The Preserve at Laurel Lake
Plan Name: 2508
Project Address: Lake City
Client No.:


Project No.:
Sheet No.:
S-4
ROOF FRAMING AND BRACING DETAILS

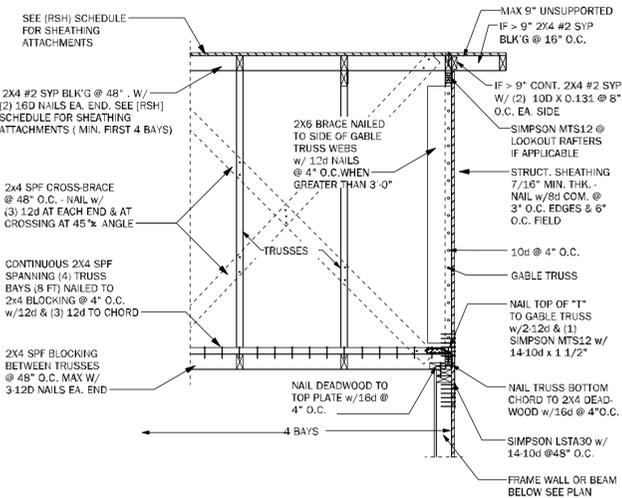


GE05 GABLE END BRACING - FRAME WALL N.T.S.

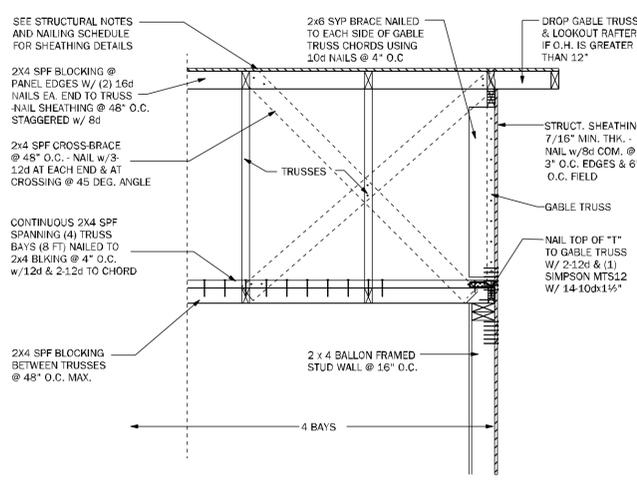


GE22 GABLE END BRACING w/ VOL CEILING 1/2"=1'-0"

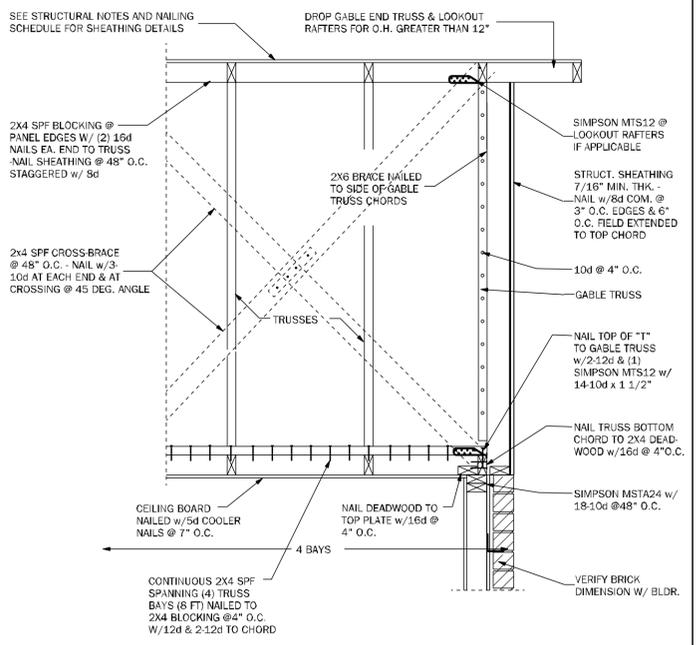


GE23 GABLE END BRACING w/o VOLUME CEILING 1/2"=1'-0"

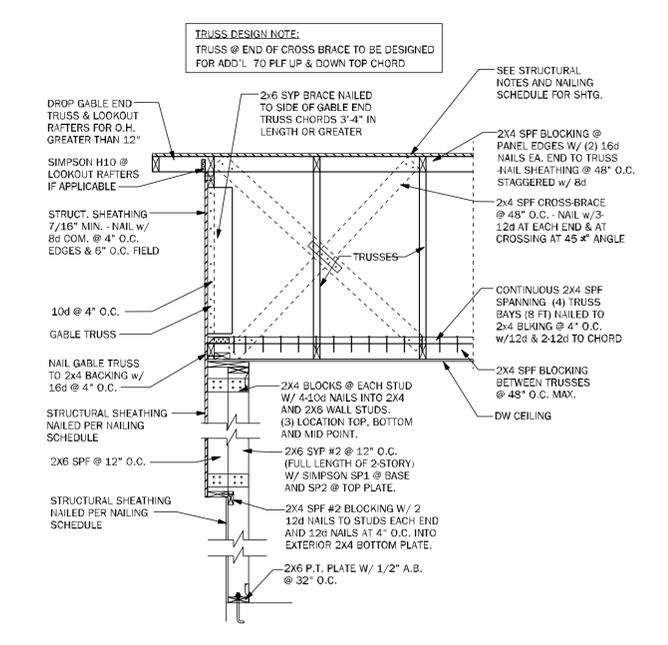


GE24 GABLE @ VAULT N.T.S.

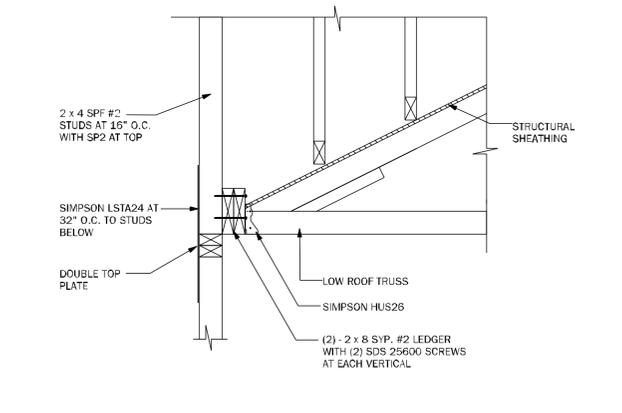


WF72 LEDGER N.T.S.

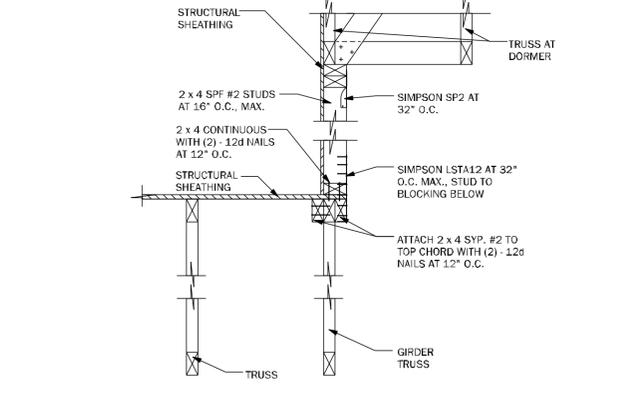


WF73 KNEEWALL @ DORMER N.T.S.

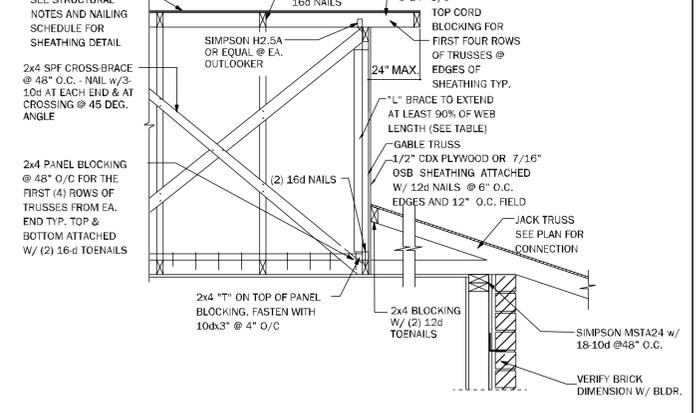


GE21 SECTION @ DUTCH GABLE 3/4"=1'-0"

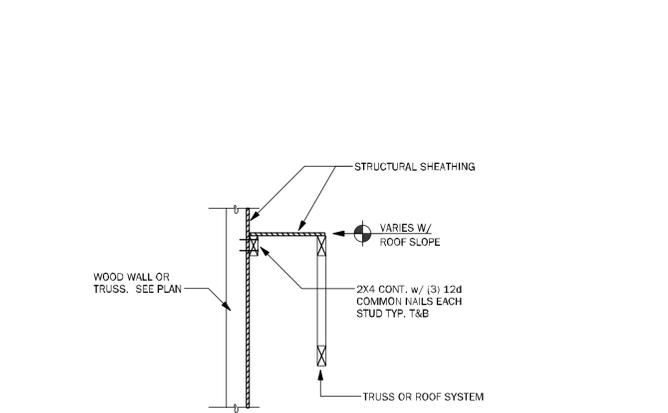

LD02 SHEAR TRANSFER EXTERIOR WALL N.T.S.

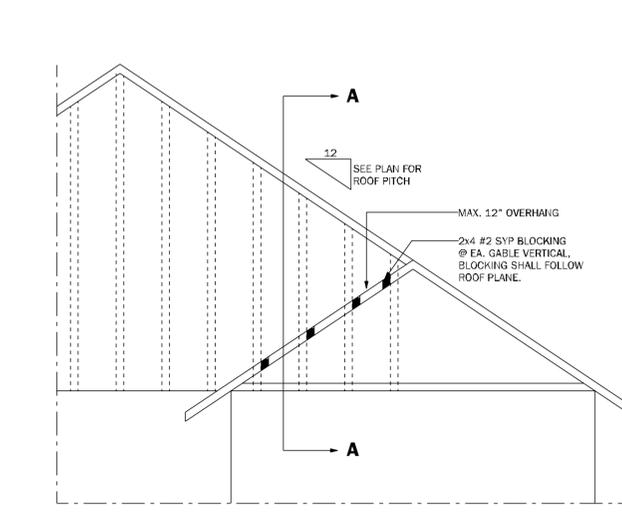

GE23.1 GABLE END OVERHANG 1/2"=1'-0"

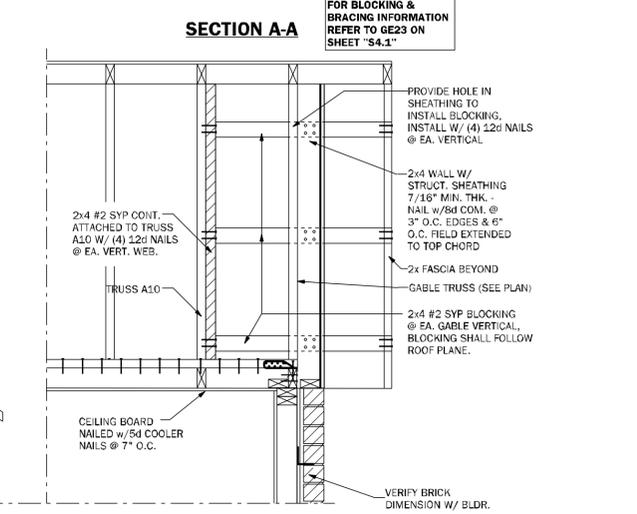

SR01 SECTION AT SHED ROOF 3/4"=1'-0"

TSG
TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
SCOTT LEWKOWSKI, PE - FL #58126
CARL A. BROWN, PE - FL #58126
myTSGhome.com

100% Employee Owned
myTSGhome.com

MUNICIPAL STAMP AREA


SIGNATURE & SEAL
10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 6th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing paper bearing engineer's signature and seal.


ADAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC13301146
100 WEST GARDEN STREET
PENSACOLA FL 32502

LOT: 33
Community: The Preserve at Laurel Lake
Plan Name: 2508
Project Address: Lake City
Client No.:


Project No.:
Sheet No.:
S-4.1
ROOF FRAMING
AND BRACING DETAILS

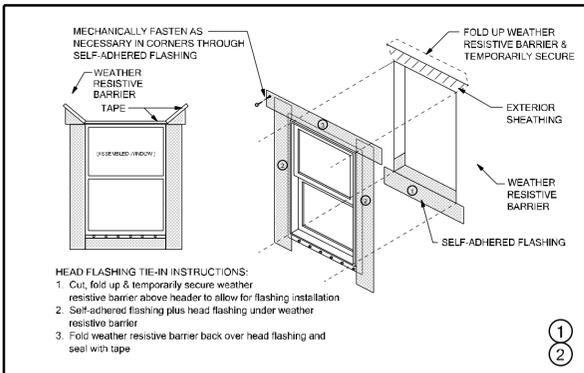


Scale: NTS
WP01

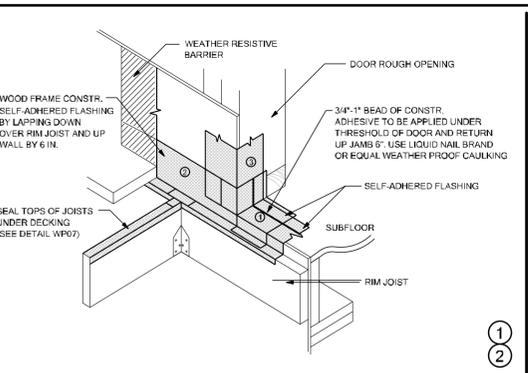


WP02

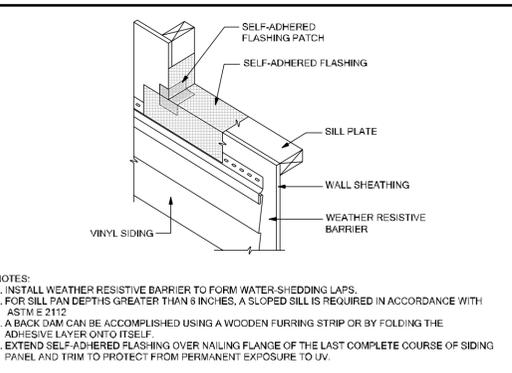


WP03

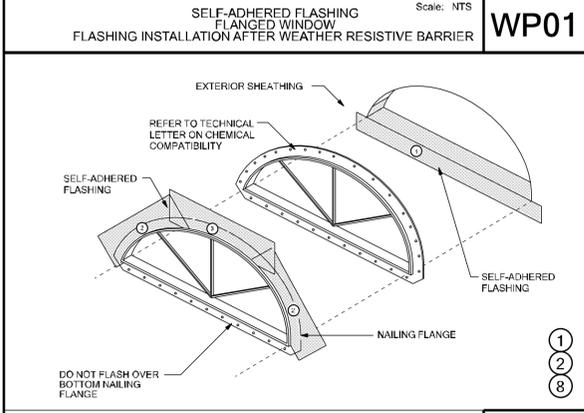


WP04

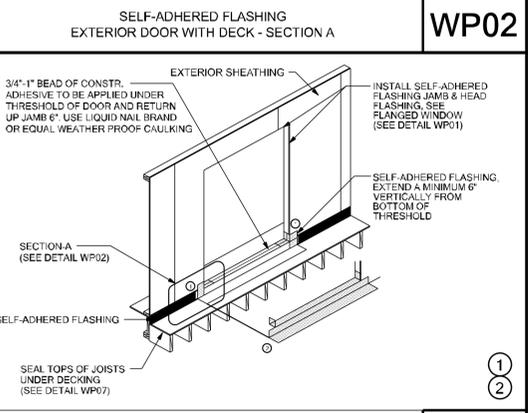


WP05

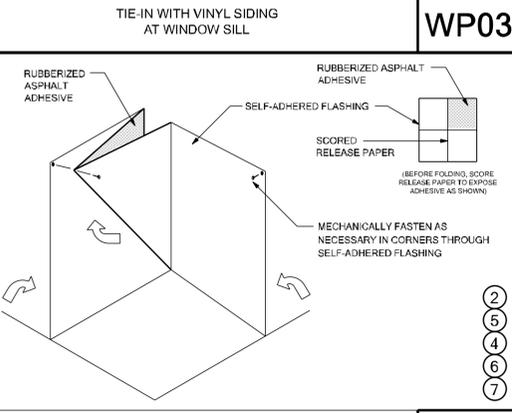


WP06

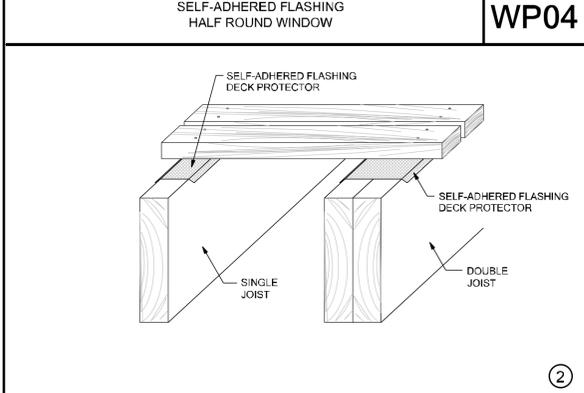


WP07

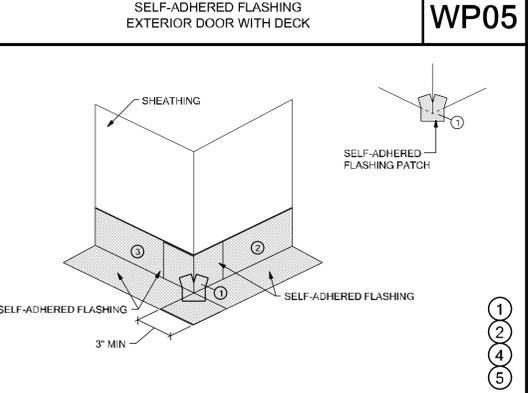


WP08

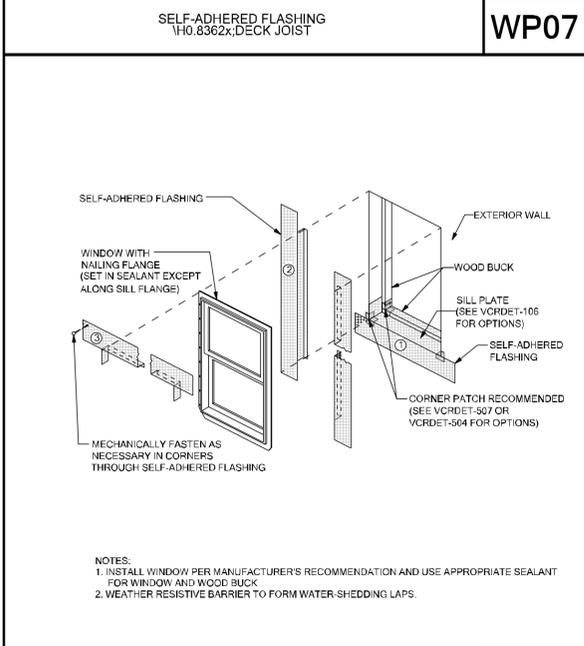

WP10

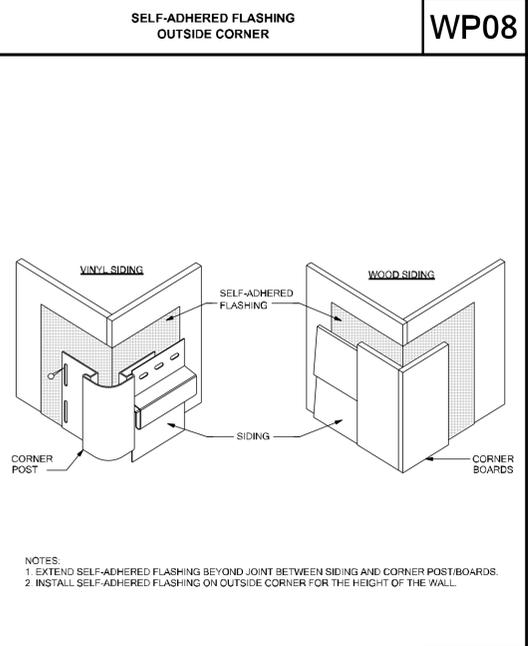

WP11

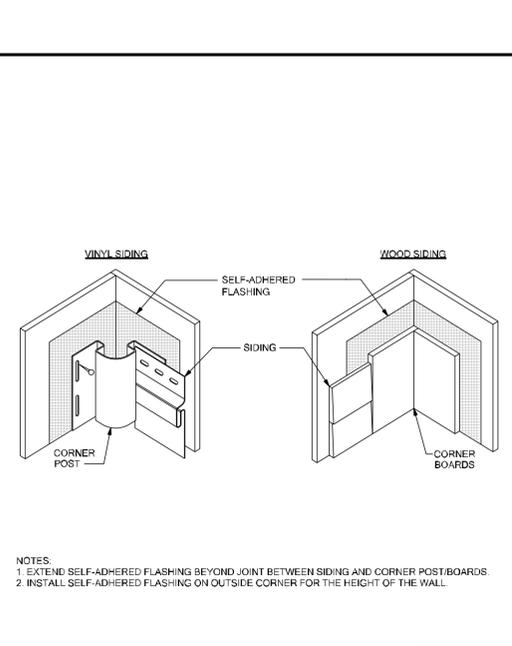

WP12

SELF-ADHERED FLASHING PRODUCTS DETAILS

WATER RESISTIVE BARRIERS ARE REQUIRED BEHIND STUCCO PER FBCR (CURRENT EDITION)

DETAIL INSTRUCTIONS

REFER TO THE NUMBER MARKED AS (Ⓜ) IN EACH DETAIL THAT CORRESPONDS TO THE NUMBERED ITEMS IN THE LIST OF INSTRUCTIONS BELOW:

1. INSTALL SELF-ADHERED FLASHING IN ORDER AS SHOWN BY NUMBERS.
2. INSTALL FLASHING AND WEATHER RESISTIVE BARRIER TO FORM WATER-SHEDDING LAPS.
3. SELF-ADHERED FLASHING CAN BE SUBSTITUTED FOR BUILDING PAPER.
4. SPLIT THE RELEASE PAPER USING THE RIPCORD (SPLIT RELEASE ON DEMAND, EMBEDDED IN THE ADHESIVE LAYER) - FOR EASE OF INSTALLATION AND TO MINIMIZE SCORING CUTS.
5. REMOVE ALL RELEASE PAPER PER STANDARD INSTALLATION INSTRUCTIONS AND ADHERE TO SUBSTRATE USING A SQUARE PIECE OF FLASHING MATERIAL (6" X 6" MINIMUM).
6. FOLD AS SHOWN BY ARROWS.
7. ANGLE OF CORNER MAY VARY, ADJUST FOLDING OF THE FLASHING ACCORDINGLY TO FIT TIGHT TO CORNER.
8. MECHANICALLY FASTEN AS NECESSARY.

FLASHING REQUIREMENTS

R703.1 GENERAL. EXTERIOR WALLS SHALL PROVIDE THE BUILDING WITH A WEATHER-RESISTANT EXTERIOR WALL ENVELOPE. THE EXTERIOR WALL ENVELOPE SHALL INCLUDE FLASHING AS DESCRIBED IN SECTION R703.4.

R703.1.1 WATER RESISTANCE. THE EXTERIOR WALL ENVELOPE SHALL BE DESIGNED AND CONSTRUCTED IN A MANNER THAT PREVENTS THE ACCUMULATION OF WATER WITHIN THE WALL ASSEMBLY BY PROVIDING A WATER-RESISTANT BARRIER BEHIND THE EXTERIOR CLADDING AS REQUIRED BY SECTION R703.2 AND A MEANS OF DRAINING TO THE EXTERIOR WATER THAT PENETRATES THE EXTERIOR CLADDING.

R703.2 WATER-RESISTIVE BARRIER. NOT FEWER THAN ONE LAYER OF WATER-RESISTIVE BARRIER SHALL BE APPLIED OVER STUDS OR SHEATHING OF ALL EXTERIOR WALLS WITH FLASHING AS INDICATED IN SECTION R703.4, IN SUCH A MANNER AS TO PROVIDE A CONTINUOUS WATER-RESISTIVE BARRIER BEHIND THE EXTERIOR WALL. THE WATER-RESISTIVE BARRIER MATERIAL SHALL BE CONTINUOUS TO THE TOP OF WALLS AND TERMINATED AT PENETRATIONS AND BUILDING APPENDAGES IN A MANNER TO MEET THE REQUIREMENTS OF THE EXTERIOR WALL ENVELOPE AS DESCRIBED IN SECTION R703.1. WATER-RESISTIVE BARRIER MATERIALS SHALL COMPLY WITH ONE OF THE FOLLOWING:

1. NO. 15 FELT COMPLYING WITH ASTM D226, TYPE 1.
2. ASTM E2658, TYPE 1 OR 2.
3. ASTM E331 IN ACCORDANCE WITH SECTION R703.1.1.
4. OTHER APPROVED MATERIALS IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

R703.2.1 WATER-RESISTIVE BARRIER. THE WATER-RESISTIVE BARRIER SHALL BE APPLIED HORIZONTALLY, WITH THE UPPER LAYER LAPPED OVER THE LOWER LAYER NOT LESS THAN 2 INCHES (51MM), AND WHERE JOINTS OCCUR, SHALL BE LAPPED NOT LESS THAN 6 INCHES (152 MM).

R703.3 WATER-RESISTIVE BARRIERS WATER-RESISTIVE BARRIERS SHALL BE INSTALLED AS REQUIRED IN SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR-PERMEABLE BARRIER WITH A PERFORMANCE AT LEAST EQUIVALENT TO TWO LAYERS OF GRADE D PAPER. THE INDIVIDUAL LAYERS SHALL BE INSTALLED INDEPENDENTLY SUCH THAT EACH LAYER PROVIDES A SEPARATE CONTINUOUS PLANE AND ANY FLASHING (INSTALLED IN ACCORDANCE WITH SECTION R703.4) INTENDED TO DRAIN TO THE WATER-RESISTIVE BARRIER IS DIRECTED BETWEEN THE LAYERS.

EXCEPTION: WHERE THE WATER-RESISTIVE BARRIER THAT IS APPLIED OVER WOOD-BASED SHEATHING HAS A WATER RESISTANCE EQUAL TO OR GREATER THAN THAT OF 60-MINUTE GRADE D PAPER AND IS SEPARATED FROM THE STUCCO BY AN INTERVENING, SUBSTANTIALLY NONWATER-ABSORBING LAYER OR DESIGNED DRAINAGE SPACE.

R703.4 FLASHING. APPROVED METAL FLASHING, VINYL FLASHING, SELF-ADHERED MEMBRANES AND MECHANICALLY ATTACHED FLEXIBLE FLASHING SHALL BE APPLIED SHINGLE FASHION OR IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. METAL FLASHING SHALL BE CORROSION RESISTANT. FLUID-APPLIED MEMBRANES USED AS FLASHING SHALL BE APPLIED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. ALL FLASHING SHALL BE APPLIED IN A MANNER TO PREVENT THE ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS. SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH AAMA 711. ALL EXTERIOR PENETRATION PRODUCTS SHALL BE SEALED AT THE JUNCTURE WITH THE BUILDING WALL WITH A SEALANT COMPLYING WITH AAMA 800 OR ASTM C920 CLASS 25 GRADE NS OR GREATER FOR PROPER JOINT EXPANSION AND CONTRACTION. ASTM C1281, AAMA 912, OR OTHER APPROVED STANDARD AS APPROPRIATE FOR THE TYPE OF SEALANT. FLUID-APPLIED MEMBRANES USED AS FLASHING IN EXTERIOR WALLS SHALL COMPLY WITH AAMA 714. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED FLASHINGS SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS:

1. EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER COMPLYING WITH SECTION R703.2 FOR SUBSEQUENT DRAINAGE. MECHANICALLY ATTACHED FLEXIBLE FLASHINGS SHALL COMPLY WITH AAMA 712. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL BE INSTALLED IN ACCORDANCE WITH ONE OR MORE OF THE FOLLOWING:
 - 1.1 THE PENETRATION MANUFACTURER'S INSTALLATION AND FLASHING INSTRUCTIONS, OR FOR APPLICATIONS NOT ADDRESSED IN THE PENETRATION MANUFACTURER'S INSTRUCTIONS, IN ACCORDANCE WITH THE FLASHING OR WATER-RESISTIVE BARRIER MANUFACTURER'S INSTRUCTIONS. WHERE FLASHING INSTRUCTIONS OR DETAILS ARE NOT PROVIDED, PAN FLASHING SHALL BE INSTALLED AT THE SILL OF EXTERIOR WINDOW AND DOOR OPENINGS. PAN FLASHING SHALL BE SEALED OR SLOPED IN SUCH A MANNER AS TO DIRECT WATER TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE. OPENINGS USING PAN FLASHING SHALL INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES.
 - 1.2 IN ACCORDANCE WITH THE FLASHING DESIGN OR METHOD OF A REGISTERED DESIGN PROFESSIONAL.
 - 1.3 IN ACCORDANCE WITH OTHER APPROVED METHODS.
 - 1.4 IN ACCORDANCE WITH FMA/AAMA 100, FMA/AAMA 200, FMA/WDMA 250, FMA/AAMA/WDMA 300 OR FMA/AAMA/WDMA 400 OR FMA/AAMA/WDMA 2710.
2. AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
3. UNDER AND AT THE ENDS OF MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES.
4. CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
5. WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
6. AT WALL AND ROOF INTERSECTIONS.
7. AT BUILT-IN GUTTERS.

FIGURE 1: FLASHING INSTALLATION

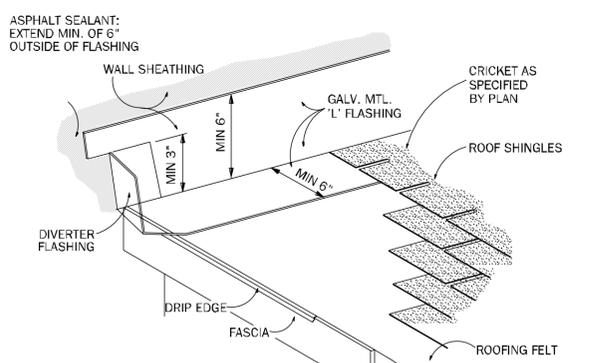


FIGURE 2: WALL FINISH


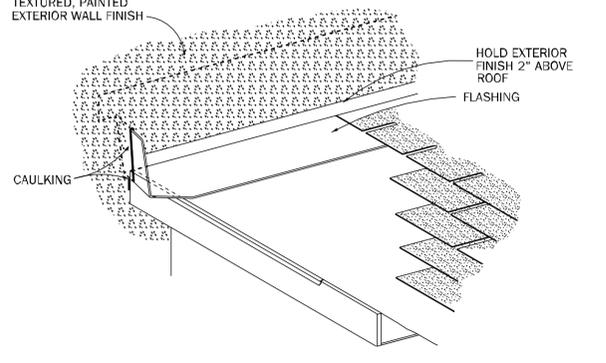


FIGURE 3: CORNER DETAIL

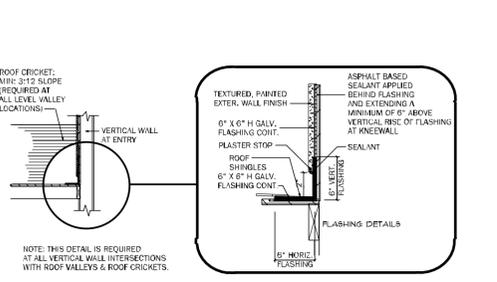

FLASHING INSTALLATION WHERE ROOF MEETS VERTICAL WALL

FLASHING DETAIL AT CRICKET / KNEEWALL INTERSECTION

TSG
TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
SCOTT A. BROWN, PE - FL # 58126
CARL LEWKOWSKI, PE - FL # 87850

100% Employee Owned
myTSGhome.com

MUNICIPAL STAMP AREA

SIGNATURE & SEAL
10/21/2025

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code - Residential 8th Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing Engineer's signature and seal.

This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright of intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concepts without the written consent of TSG (Total Solutions Group) is strictly prohibited and is protected by United States and International Law.

ADAMS HOMES
FLORIDA CONTRACTORS LICENSE NO. CRC1330146
100 WEST GARDEN STREET
PENSACOLA FL 32502
Division Location

Community: The Preserve at Laurel Lake
Plan Name: 2508
Project Address: Lake City
Client No.:
LOT: 33
BLK:
UNIT:
Project No.:
Sheet No.: **WP**
WATER PROOF DETAILS