

Project Name: Lot 1 Mayfair Unit 5 Street: City, State, Zip: Lake City, FL, 32025 Owner: Design Location: FL, Gainesville	Builder Name: Permit Office: Columbia County Permit Number: Jurisdiction: County: Columbia(Florida Climate Zone 2)
--	---

<table style="width: 100%;"> <tr> <td style="width: 40%;">1. New construction or existing</td> <td style="width: 60%;">New (From Plans)</td> </tr> <tr> <td>2. Single family or multiple family</td> <td>Detached</td> </tr> <tr> <td>3. Number of units, if multiple family</td> <td>1</td> </tr> <tr> <td>4. Number of Bedrooms</td> <td>3</td> </tr> <tr> <td>5. Is this a worst case?</td> <td>No</td> </tr> <tr> <td>6. Conditioned floor area above grade (ft²)</td> <td>1311</td> </tr> <tr> <td>Conditioned floor area below grade (ft²)</td> <td>0</td> </tr> <tr> <td>7. Windows(113.0 sqft.)</td> <td>Description Area</td> </tr> <tr> <td>a. U-Factor:</td> <td>Dbl, U=0.36 113.00 ft²</td> </tr> <tr> <td>SHGC:</td> <td>SHGC=0.25</td> </tr> <tr> <td>b. U-Factor:</td> <td>N/A ft²</td> </tr> <tr> <td>SHGC:</td> <td></td> </tr> <tr> <td>c. U-Factor:</td> <td>N/A ft²</td> </tr> <tr> <td>SHGC:</td> <td></td> </tr> <tr> <td colspan="2">Area Weighted Average Overhang Depth: 4.686 ft</td> </tr> <tr> <td colspan="2">Area Weighted Average SHGC: 0.250</td> </tr> <tr> <td>8. Skylights</td> <td>Description Area</td> </tr> <tr> <td>U-Factor:(AVG)</td> <td>N/A N/A ft²</td> </tr> <tr> <td>SHGC(AVG):</td> <td>N/A</td> </tr> <tr> <td>9. Floor Types</td> <td>Insulation Area</td> </tr> <tr> <td>a. Slab-On-Grade Edge Insulation</td> <td>R= 0.0 1311.00 ft²</td> </tr> <tr> <td>b. N/A</td> <td>R= ft²</td> </tr> <tr> <td>c. N/A</td> <td>R= ft²</td> </tr> </table>	1. New construction or existing	New (From Plans)	2. Single family or multiple family	Detached	3. Number of units, if multiple family	1	4. Number of Bedrooms	3	5. Is this a worst case?	No	6. Conditioned floor area above grade (ft ²)	1311	Conditioned floor area below grade (ft ²)	0	7. Windows(113.0 sqft.)	Description Area	a. U-Factor:	Dbl, U=0.36 113.00 ft ²	SHGC:	SHGC=0.25	b. U-Factor:	N/A ft ²	SHGC:		c. U-Factor:	N/A ft ²	SHGC:		Area Weighted Average Overhang Depth: 4.686 ft		Area Weighted Average SHGC: 0.250		8. Skylights	Description Area	U-Factor:(AVG)	N/A N/A ft ²	SHGC(AVG):	N/A	9. Floor Types	Insulation Area	a. Slab-On-Grade Edge Insulation	R= 0.0 1311.00 ft ²	b. N/A	R= ft ²	c. N/A	R= ft ²	<table style="width: 100%;"> <tr> <td style="width: 40%;">10. Wall Types(1192.0 sqft.)</td> <td style="width: 60%;">Insulation Area</td> </tr> <tr> <td>a. Frame - Wood, Exterior</td> <td>R=13.0 1192.00 ft²</td> </tr> <tr> <td>b. N/A</td> <td></td> </tr> <tr> <td>c. N/A</td> <td></td> </tr> <tr> <td>d. N/A</td> <td></td> </tr> <tr> <td>11. Ceiling Types(1376.0 sqft.)</td> <td>Insulation Area</td> </tr> <tr> <td>a. Flat ceiling under att (Vented)</td> <td>R=38.0 1376.00 ft²</td> </tr> <tr> <td>b. N/A</td> <td></td> </tr> <tr> <td>c. N/A</td> <td></td> </tr> <tr> <td>12. Roof(Comp. Shingles, Vented)</td> <td>Deck R=0.0 1466 ft²</td> </tr> <tr> <td>13. Ducts, location & insulation level</td> <td>R ft²</td> </tr> <tr> <td>a. Sup: Attic, Ret: Attic, AH: Main</td> <td>6 328</td> </tr> <tr> <td>b.</td> <td></td> </tr> <tr> <td>c.</td> <td></td> </tr> <tr> <td>14. Cooling Systems</td> <td>kBtu/hr Efficiency</td> </tr> <tr> <td>a. Central Unit</td> <td>16.9 SEER2:15.00</td> </tr> <tr> <td>15. Heating Systems</td> <td>kBtu/hr Efficiency</td> </tr> <tr> <td>a. Electric Heat Pump</td> <td>19.6 HSPF2:8.80</td> </tr> <tr> <td>16. Hot Water Systems</td> <td></td> </tr> <tr> <td>a. Electric</td> <td>Cap: 40 gallons</td> </tr> <tr> <td></td> <td>EF: 0.920</td> </tr> <tr> <td>b. Conservation features</td> <td></td> </tr> <tr> <td></td> <td>None</td> </tr> <tr> <td>17. Credits</td> <td>CV, Pstat</td> </tr> </table>	10. Wall Types(1192.0 sqft.)	Insulation Area	a. Frame - Wood, Exterior	R=13.0 1192.00 ft ²	b. N/A		c. N/A		d. N/A		11. Ceiling Types(1376.0 sqft.)	Insulation Area	a. Flat ceiling under att (Vented)	R=38.0 1376.00 ft ²	b. N/A		c. N/A		12. Roof(Comp. Shingles, Vented)	Deck R=0.0 1466 ft ²	13. Ducts, location & insulation level	R ft ²	a. Sup: Attic, Ret: Attic, AH: Main	6 328	b.		c.		14. Cooling Systems	kBtu/hr Efficiency	a. Central Unit	16.9 SEER2:15.00	15. Heating Systems	kBtu/hr Efficiency	a. Electric Heat Pump	19.6 HSPF2:8.80	16. Hot Water Systems		a. Electric	Cap: 40 gallons		EF: 0.920	b. Conservation features			None	17. Credits	CV, Pstat
1. New construction or existing	New (From Plans)																																																																																														
2. Single family or multiple family	Detached																																																																																														
3. Number of units, if multiple family	1																																																																																														
4. Number of Bedrooms	3																																																																																														
5. Is this a worst case?	No																																																																																														
6. Conditioned floor area above grade (ft ²)	1311																																																																																														
Conditioned floor area below grade (ft ²)	0																																																																																														
7. Windows(113.0 sqft.)	Description Area																																																																																														
a. U-Factor:	Dbl, U=0.36 113.00 ft ²																																																																																														
SHGC:	SHGC=0.25																																																																																														
b. U-Factor:	N/A ft ²																																																																																														
SHGC:																																																																																															
c. U-Factor:	N/A ft ²																																																																																														
SHGC:																																																																																															
Area Weighted Average Overhang Depth: 4.686 ft																																																																																															
Area Weighted Average SHGC: 0.250																																																																																															
8. Skylights	Description Area																																																																																														
U-Factor:(AVG)	N/A N/A ft ²																																																																																														
SHGC(AVG):	N/A																																																																																														
9. Floor Types	Insulation Area																																																																																														
a. Slab-On-Grade Edge Insulation	R= 0.0 1311.00 ft ²																																																																																														
b. N/A	R= ft ²																																																																																														
c. N/A	R= ft ²																																																																																														
10. Wall Types(1192.0 sqft.)	Insulation Area																																																																																														
a. Frame - Wood, Exterior	R=13.0 1192.00 ft ²																																																																																														
b. N/A																																																																																															
c. N/A																																																																																															
d. N/A																																																																																															
11. Ceiling Types(1376.0 sqft.)	Insulation Area																																																																																														
a. Flat ceiling under att (Vented)	R=38.0 1376.00 ft ²																																																																																														
b. N/A																																																																																															
c. N/A																																																																																															
12. Roof(Comp. Shingles, Vented)	Deck R=0.0 1466 ft ²																																																																																														
13. Ducts, location & insulation level	R ft ²																																																																																														
a. Sup: Attic, Ret: Attic, AH: Main	6 328																																																																																														
b.																																																																																															
c.																																																																																															
14. Cooling Systems	kBtu/hr Efficiency																																																																																														
a. Central Unit	16.9 SEER2:15.00																																																																																														
15. Heating Systems	kBtu/hr Efficiency																																																																																														
a. Electric Heat Pump	19.6 HSPF2:8.80																																																																																														
16. Hot Water Systems																																																																																															
a. Electric	Cap: 40 gallons																																																																																														
	EF: 0.920																																																																																														
b. Conservation features																																																																																															
	None																																																																																														
17. Credits	CV, Pstat																																																																																														

Glass/Floor Area:0.086	Total Proposed Modified Loads: 31.96	PASS
	Total Baseline Loads: 35.88	

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code. <div style="text-align: center;"> PREPARED BY: _____ DATE: 10 / 23 / 2023 </div> I hereby certify that this building, as designed, is in compliance with the Florida Energy Code. OWNER/AGENT: _____ DATE: _____	Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes. <div style="text-align: center;"> BUILDING OFFICIAL: _____ DATE: _____ </div>
---	--

- 10/23/2023 3:35:48 PM EnergyGauge® USA 7.0.00 - FlaRes2020 FBC 7th Edition (2020) Compliant Software Page 1

INPUT SUMMARY CHECKLIST REPORT

PROJECT														
Title:	Lot 1 Mayfair Unit 5				Address type:	Lot								
Building Type:	User				Bedrooms:	3				Lot #:	1			
Owner:					Conditioned Area:	1311				Block/SubDivision:	Mayfair SD V			
Builder Home ID:					Total Stories:	1				PlatBook:				
Builder Name:					Worst Case:	No				Street:				
Permit Office:	Columbia County				Rotate Angle:	0				County:	Columbia			
Jurisdiction:					Cross Ventilation:	Yes				City, State, Zip:	Lake City, FL, 32025			
Family Type:	Detached				Whole House Fan:	No								
New/Existing:	New (From Plans)				Terrain:	Suburban								
Year Construct:	2023				Shielding:	Suburban								
Comment:														

CLIMATE													
✓	Design Location	Tmy Site	Design Temp		97.5%	2.5%	Int Design Temp		Winter	Summer	Heating Degree Days	Design Moisture	Daily temp Range
___	FL, Gainesville	FL_GAINESVILLE_REGIONA	32	92	70	75	1305.5	51	Medium				

BLOCKS				
✓	Number	Name	Area	Volume
___	1	Block1	1311	10488 cu ft

SPACES										
✓	Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Finished	Cooled	Heated
___	1	Main	1311	10488	Yes	6	3	Yes	Yes	Yes

FLOORS (Total Exposed Area = 1311 sq.ft.)											
✓	#	Floor Type	Space	Exposed Perim	Perimeter R-Value	Area	U-Factor	Joist R-Value	Tile	Wood	Carpet
___	1	Slab-On-Grade Edge Ins	Main	149	0	1311 ft	0.304	---	0.00	0.00	1.00

ROOF													
✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
___	1	Gable or shed	Composition shingles	1466 ft²	328 ft²	Medium	Y	0.96	No	0.9	No	0	26.57

ATTIC							
✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
___	1	Full attic	Vented	300	1311 ft²	Y	N

CEILING (Total Exposed Area = 1376 sq.ft.)									
✓	#	Ceiling Type	Space	R-Value	Ins. Type	Area	U-Factor	Framing Frac.	Truss Type
___	1	Flat ceiling under attic(Vented)	Main	38.0	Double Batt	1376.0ft²	0.024	0.11	Wood

INPUT SUMMARY CHECKLIST REPORT

WALLS (Total Exposed Area = 1192 sq.ft.)																
✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area sq.ft.	U-Factor	Sheath R-Value	Frm. Frac.	Solar Absor.	Below Grade	
___ 1	S	Exterior	Frame - Wood	Main	13.0	14.0	0	8.0	0	112.0	0.084		0.23	0.75	0 %	
___ 2	S	Exterior	Frame - Wood	Main	13.0	18.0	0	8.0	0	144.0	0.084		0.23	0.75	0 %	
___ 3	S	Exterior	Frame - Wood	Main	13.0	14.0	0	8.0	0	112.0	0.084		0.23	0.75	0 %	
___ 4	E	Exterior	Frame - Wood	Main	13.0	28.0	6	8.0	0	228.0	0.084		0.23	0.75	0 %	
___ 5	N	Exterior	Frame - Wood	Main	13.0	46.0	0	8.0	0	368.0	0.084		0.23	0.75	0 %	
___ 6	W	Exterior	Frame - Wood	Main	13.0	28.0	6	8.0	0	228.0	0.084		0.23	0.75	0 %	

DOORS (Total Exposed Area = 40 sq.ft.)												
✓ #	Ornt	Adjacent To	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area	
___ 1	S	Exterior	Insulated	Main	None	0.46	3.00	0	6.00	8	20.0ft²	
___ 2	S	Exterior	Insulated	Main	None	0.46	3.00	0	6.00	8	20.0ft²	

WINDOWS (Total Exposed Area = 113 sq.ft.)																	
✓ #	Ornt	Wall ID	Frame	Panes	NFRC U-Factor	SHGC	Imp	Storm	Total Area (ft²)	Same Units	Width (ft)	Height (ft)	--Overhang-- Depth (ft)	Sep. (ft)	Interior Shade	Screen	
___ 1	S	1	Vinyl	Low-E Double	Y	0.36	0.25	N	N	15.0	1	3.00	5.00	7.5	0.5	None	None
___ 2	S	2	Vinyl	Low-E Double	Y	0.36	0.25	N	N	30.0	2	3.00	5.00	7.5	0.5	None	None
___ 3	S	3	Vinyl	Low-E Double	Y	0.36	0.25	N	N	15.0	1	3.00	5.00	7.5	0.5	None	None
___ 4	N	5	Vinyl	Low-E Double	Y	0.36	0.25	N	N	15.0	1	3.00	5.00	1.5	0.5	None	None
___ 5	N	5	TIM	Low-E Double	Y	0.36	0.25	N	N	20.0	1	3.00	6.67	1.5	0.5	None	None
___ 6	N	5	Vinyl	Low-E Double	Y	0.36	0.25	N	N	18.0	2	3.00	3.00	1.5	0.5	None	None

INFILTRATION										
✓ #	Scope	Method	SLA	CFM50	ELA	EqLA	ACH	ACH50	Space(s)	Infiltration Test Volume
___ 1	Wholehouse	Proposed ACH(50)	0.00025	874	47.95	90.02	0.0980	5.0	All	10488 cu ft

MASS					
✓ #	Mass Type	Area	Thickness	Furniture Fraction	Space
___ 1	Default(8 lbs/sq.ft.)	0 ft²	0 ft	0.30	Main

HEATING SYSTEM										
✓ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	----Geothermal Entry	HeatPump Power	-----	Ducts Volt	Block Current
___ 1	Electric Heat Pump	None/Single		HSPF2: 8.80	19.6		0.00	0.00	0.00	sys#1 1

COOLING SYSTEM									
✓ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	Air Flow cfm	SHR	Duct	Block
___ 1	Central Unit	None/Single		SEER2:15.0	16.9	510	0.75	sys#1	1

INPUT SUMMARY CHECKLIST REPORT

HOT WATER SYSTEM

✓ #	System Type	Subtype	Location	EF(UEF)	Cap	Use	SetPnt	Fixture Flow	Pipe Ins.	Pipe length
___ 1	Electric	None	Main	0.92 (0.92)	40.00 gal	40 gal	120 deg	Standard	None	12
	Recirculation System	Recirc Control Type	Loop length	Branch length	Pump power	DWHR	Facilities Connected	Equal Flow	DWHR Eff	Other Credits
___ 1	No		NA	NA	NA	No	NA	NA	NA	None

DUCTS

✓ Duct #	-----Supply----- Location R-Value Area	-----Return----- Location R-Value Area	Leakage Type	Air Handler	CFM 25 TOT	CFM 25 OUT	QN	RLF	HVAC # Heat Cool
___ 1 Attic	6.0 328 ft²	Attic 6.0 66 ft²	Default Leakage	Main	(Default)	(Default)			1 1

TEMPERATURES

Programable Thermostat: Y				Ceiling Fans: N										
Cooling	<input type="checkbox"/> Jan	<input type="checkbox"/> Feb	<input type="checkbox"/> Mar	<input type="checkbox"/> Apr	<input type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input type="checkbox"/> Oct	<input type="checkbox"/> Nov	<input type="checkbox"/> Dec		
Heating	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input type="checkbox"/> Apr	<input type="checkbox"/> May	<input type="checkbox"/> Jun	<input type="checkbox"/> Jul	<input type="checkbox"/> Aug	<input type="checkbox"/> Sep	<input type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec		
Venting	<input type="checkbox"/> Jan	<input type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input type="checkbox"/> May	<input type="checkbox"/> Jun	<input type="checkbox"/> Jul	<input type="checkbox"/> Aug	<input type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input type="checkbox"/> Dec		
✓ Thermostat Schedule:	HERS 2006 Reference													
Schedule Type		1	2	3	4	5	6	Hours 7	8	9	10	11	12	
___ Cooling (WD)	AM PM	78 80	78 80	78 78	78 78	78 78	78 78	78 78	78 78	80 78	80 78	80 78	80 78	
___ Cooling (WEH)	AM PM	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	
___ Heating (WD)	AM PM	66 68	66 68	66 68	66 68	66 68	68 68	68 68	68 68	68 68	68 68	68 66	68 66	
___ Heating (WEH)	AM PM	66 68	66 68	66 68	66 68	66 68	68 68	68 68	68 68	68 68	68 68	68 66	68 66	

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 89

The lower the EnergyPerformance Index, the more efficient the home.

,Lake City,FL,32025

1. New construction or existing	New (From Plans)	10. Wall Types(1192.0 sqft.)	Insulation	Area
2. Single family or multiple family	Detached	a. Frame - Wood, Exterior	R=13.0	1192.00 ft ²
3. Number of units, if multiple family	1	b. N/A		
4. Number of Bedrooms	3	c. N/A		
5. Is this a worst case?	No	d. N/A		
6. Conditioned floor area above grade (ft ²)	1311	11. Ceiling Types(1376.0 sqft.)	Insulation	Area
Conditioned floor area below grade (ft ²)	0	a. Flat ceiling under att (Vented)	R=38.0	1376.00 ft ²
7. Windows**	Description	b. N/A		
a. U-Factor:	Dbl, U=0.36	c. N/A		
SHGC:	SHGC=0.25	12. Roof(Comp. Shingles, Vented) Deck	R=0.0	1466 ft ²
b. U-Factor:	N/A	13. Ducts, location & insulation level	R	ft ²
SHGC:		a. Sup: Attic, Ret: Attic, AH: Main	6	328
c. U-Factor:	N/A	b.		
SHGC:		c.		
Area Weighted Average Overhang Depth:	4.686 ft	14. Cooling Systems	kBtu/hr	Efficiency
Area Weighted Average SHGC:	0.250	a. Central Unit	16.9	SEER2:15.00
8. Skylights	Description	15. Heating Systems	kBtu/hr	Efficiency
U-Factor:(AVG)	N/A	a. Electric Heat Pump	19.6	HSPF2:8.80
SHGC(AVG):	N/A	16. Hot Water Systems		
9. Floor Types	Insulation	a. Electric	Cap: 40 gallons	
a. Slab-On-Grade Edge Insulation	R= 0.0		EF: 0.920	
b. N/A	R=	b. Conservation features		
c. N/A	R=			
		17. Credits	None	
			CV, Pstat	

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: Lake City,FL,32025



*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida Energy Rating. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

**Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.

Envelope Leakage Test Report (Blower Door Test)
Residential Prescriptive, Performance or ERI Method Compliance
2020 Florida Building Code, Energy Conservation, 7th Edition

Jurisdiction:	Permit #:	
Job Information		
Builder:	Community:	Lot: 1
Address:		
City: Lake City	State: FL	Zip: 32025
Air Leakage Test Results <i>Passing results must meet either the Performance, Prescriptive, or ERI Method</i>		
<div style="border: 1px solid black; padding: 5px; margin-bottom: 5px;"><input type="radio"/> PRESCRIPTIVE METHOD-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.</div> <div style="border: 1px solid black; padding: 5px;"><input checked="" type="radio"/> PERFORMANCE or ERI METHOD-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2020 (Performance) or R406-2020 (ERI), section labeled as infiltration, sub-section ACH50. ACH(50) specified on Form R405-2020-Energy Calc (Performance) or R406-2020 (ERI): 5.000</div>		
<div style="display: flex; justify-content: space-between;"><div style="width: 60%;">$\frac{\text{CFM}(50) \times 60}{\text{Building Volume}} = \text{ACH}(50)$<div style="border: 1px solid black; width: 40px; height: 40px; display: flex; align-items: center; justify-content: center; margin: 10px auto;">PASS</div><div style="margin-top: 10px;"><input type="checkbox"/> When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.</div></div><div style="width: 35%;"><p>Method for calculating building volume:</p><div style="margin-bottom: 5px;"><input type="radio"/> Retrieved from architectural plans</div><div style="margin-bottom: 5px;"><input checked="" type="radio"/> Code software calculated</div><div style="margin-bottom: 5px;"><input type="radio"/> Field measured and calculated</div></div></div>		
<p>R402.4.1.2 Testing. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or <i>(7) Florida Statutes</i> or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the <i>code official</i>. Testing shall be performed at any time after creation of all penetrations of the <i>building thermal envelope</i>.</p> <p>During testing:</p> <ol style="list-style-type: none">1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.3. Interior doors, if installed at the time of the test, shall be open.4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.5. Heating and cooling systems, if installed at the time of the test, shall be turned off.6. Supply and return registers, if installed at the time of the test, shall be fully open.		
Testing Company		
<p>Company Name: _____ Phone: _____</p> <p>I hereby verify that the above Air Leakage results are in accordance with the 2020 7th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.</p> <p>Signature of Tester: _____ Date of Test: _____</p> <p>Printed Name of Tester: _____</p> <p>License/Certification #: _____ Issuing Authority: _____</p>		

Residential System Sizing Calculation

Summary

Project Title:
Lot 1 Mayfair Unit 5

Lake City, FL 32025


10/23/2023

Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M)			
Humidity data: Interior RH (50%) Outdoor wet bulb (79F) Humidity difference(54gr.)			
Winter design temperature(MJ8 99%/Cu)33 F		Summer design temperature(MJ8 99%/Cu)99 F	
Winter setpoint 70 F		Summer setpoint 75 F	
Winter temperature difference 37 F		Summer temperature difference 24 F	
Total heating load calculation	18215 Btuh	Total cooling load calculation	18346 Btuh
Submitted heating capacity % of calc Btuh		Submitted cooling capacity % of calc Btuh	
Total (Electric Heat Pump) 107.4 19565		Sensible (SHR = 0.75) 82.7 12659	
Heat Pump + Auxiliary(0.0kW) 107.4 19565		Latent 139.3 4220	
		Total (Electric Heat Pump) 92.0 16879	

WINTER CALCULATIONS

Winter Heating Load (for 1311 sqft)


Load component		Load	
Window total	113 sqft	1505	Btuh
Wall total	1039 sqft	3412	Btuh
Door total	40 sqft	681	Btuh
Ceiling total	1376 sqft	1292	Btuh
Floor total	1311 sqft	6505	Btuh
Infiltration	27 cfm	1110	Btuh
Duct loss		3710	Btuh
Subtotal		18215	Btuh
Ventilation Ex:0 cfm; Sup:0 cfm		0	Btuh
TOTAL HEAT LOSS		18215	Btuh

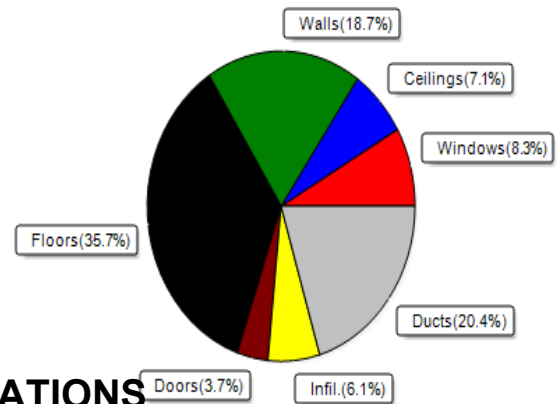

SUMMER CALCULATIONS

Summer Cooling Load (for 1311 sqft)

Load component		Load	
Window total	113 sqft	1571	Btuh
Wall total	1039 sqft	2813	Btuh
Door total	40 sqft	644	Btuh
Ceiling total	1376 sqft	1711	Btuh
Floor total		0	Btuh
Infiltration	21 cfm	540	Btuh
Internal gain		3780	Btuh
Duct gain		4258	Btuh
Sens.Ventilation Ex:0 cfm; Sup:0 cfm		0	Btuh
Blower Load		0	Btuh
Total sensible gain		15317	Btuh
Latent gain(ducts)		1078	Btuh
Latent gain(infiltration)		751	Btuh
Latent gain(ventilation)		0	Btuh
Latent gain(internal/occupants/other)		1200	Btuh
Total latent gain		3030	Btuh
TOTAL HEAT GAIN		18346	Btuh

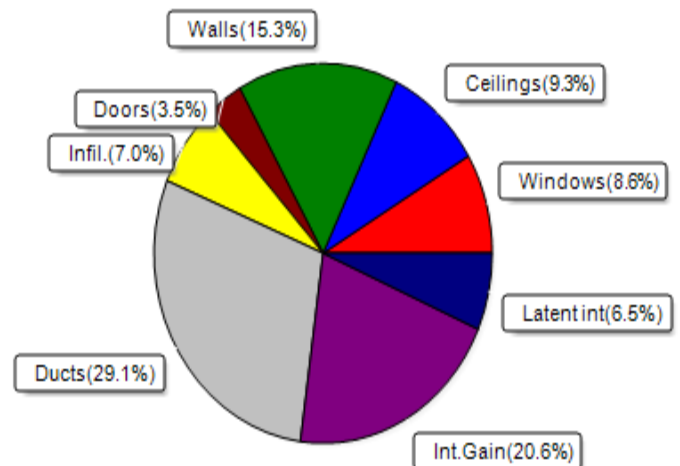

8th Edition

EnergyGauge® System Sizing

PREPARED BY: _____

DATE: 10 / 23 / 2023

System Sizing Calculations - Winter

Residential Load - Whole House Component Details

Lake City, FL 32025

Project Title:
Lot 1 Mayfair Unit 5
Building Type: User

10/23/2023

Reference City: Gainesville, FL (Defaults) Winter Temperature Difference: 37.0 °F (MJ8 99%/Cu)
Winter Setpoint: 70 °F (Required Manual J default)

Component Loads for Whole House

Window	Panes/Type	Frame	U	Orientation	Area(sqft)	X	HTM=	Load
1	2, NFRC 0.25	Vinyl	0.36	S	15.0		13.3	200 Btuh
2	2, NFRC 0.25	Vinyl	0.36	S	30.0		13.3	400 Btuh
3	2, NFRC 0.25	Vinyl	0.36	S	15.0		13.3	200 Btuh
4	2, NFRC 0.25	Vinyl	0.36	N	15.0		13.3	200 Btuh
5	2, NFRC 0.25	TIM	0.36	N	20.0		13.3	266 Btuh
6	2, NFRC 0.25	Vinyl	0.36	N	18.0		13.3	240 Btuh
Window Total					113.0(sqft)			1505 Btuh
Walls	Type	Ornt.	Ueff.	R-Value (Cav/Sh)	Area	X	HTM=	Load
1	Frame - Wood	- Ext	(0.089)	13.0/0.0	77		3.28	253 Btuh
2	Frame - Wood	- Ext	(0.089)	13.0/0.0	94		3.28	309 Btuh
3	Frame - Wood	- Ext	(0.089)	13.0/0.0	97		3.28	319 Btuh
4	Frame - Wood	- Ext	(0.089)	13.0/0.0	228		3.28	749 Btuh
5	Frame - Wood	- Ext	(0.089)	13.0/0.0	315		3.28	1034 Btuh
6	Frame - Wood	- Ext	(0.089)	13.0/0.0	228		3.28	749 Btuh
Wall Total					1039(sqft)			3412 Btuh
Doors	Type	Storm	Ueff.		Area	X	HTM=	Load
1	Insulated - Exterior, n		(0.460)		20		17.0	340 Btuh
2	Insulated - Exterior, n		(0.460)		20		17.0	340 Btuh
Door Total					40(sqft)			681Btuh
Ceilings	Type/Color/Surface		Ueff.	R-Value	Area	X	HTM=	Load
1	Flat ceil/M/Shing		(0.025)	38.0/0.0	1376		0.94	1292 Btuh
Ceiling Total					1376(sqft)			1292Btuh
Floors	Type		Ueff.	R-Value	Size	X	HTM=	Load
1	Slab On Grade		(1.180)	0.0	149.0 ft(perim.)		43.7	6505 Btuh
Floor Total					1311 sqft			6505 Btuh
Envelope Subtotal:								13396 Btuh
Infiltration	Type	Wholehouse	ACH	Volume(cuft)	Wall Ratio	CFM=		Load
	Natural		0.16	10488	1.00	27.4		1110 Btuh
Duct load	Average sealed, R6.0, Supply(Att), Return(Att) (DLM of 0.256)							3710 Btuh
All Zones	Sensible Subtotal All Zones							18215 Btuh

Manual J Winter Calculations

Residential Load - Component Details (continued)

Lake City, FL 32025

Project Title:
Lot 1 Mayfair Unit 5
Building Type: User

10/23/2023

WHOLE HOUSE TOTALS

Totals for Heating	Subtotal Sensible Heat Loss	18215 Btuh
	Ventilation Sens. Heat Loss (Ex:0 cfm; Sup:0 cfm)	0 Btuh
	Total Heat Loss	18215 Btuh

EQUIPMENT

1. Electric Heat Pump	#	19565 Btuh
-----------------------	---	------------

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)

U - (Window U-Factor)

HTM - (ManualJ Heat Transfer Multiplier)



Version 8

System Sizing Calculations - Summer

Residential Load - Whole House Component Details

Project Title:
Lot 1 Mayfair Unit 5

Lake City, FL 32025

10/23/2023

Reference City: Gainesville, FL (Defaults)
Humidity difference: 54gr.

Temperature Difference: 24.0F(MJ8 99%/Cu)
Summer Setpoint: 75 °F (Required Manual J default)

Component Loads for Whole House

Window	Type*						Overhang		Window Area(sqft)			HTM		Load		
	Panes	SHGC	U	InSh	IS	Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded			
1	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	0.5ft.	15.0	15.0	0.0	14	16	208	Btuh	
2	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	0.5ft.	30.0	30.0	0.0	14	16	417	Btuh	
3	2 NFRC	0.25, 0.36	No	No	S		7.5ft.	0.5ft.	15.0	15.0	0.0	14	16	208	Btuh	
4	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	0.5ft.	15.0	0.0	15.0	14	14	208	Btuh	
5	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	0.5ft.	20.0	0.0	20.0	14	14	278	Btuh	
6	2 NFRC	0.25, 0.36	No	No	N		1.5ft.	0.5ft.	18.0	0.0	18.0	14	14	250	Btuh	
	Window Total								113 (sqft)					1571 Btuh		
Walls	Type						U-Value		R-Value		Area(sqft)		HTM		Load	
									Cav/Sheath							
1	Frame - Wood - Ext						0.09		13.0/0.0		77.0		2.7		208 Btuh	
2	Frame - Wood - Ext						0.09		13.0/0.0		94.0		2.7		254 Btuh	
3	Frame - Wood - Ext						0.09		13.0/0.0		97.0		2.7		263 Btuh	
4	Frame - Wood - Ext						0.09		13.0/0.0		228.0		2.7		617 Btuh	
5	Frame - Wood - Ext						0.09		13.0/0.0		315.0		2.7		853 Btuh	
6	Frame - Wood - Ext						0.09		13.0/0.0		228.0		2.7		617 Btuh	
	Wall Total										1039 (sqft)				2813 Btuh	
Doors	Type										Area (sqft)		HTM		Load	
1	Insulated - Exterior										20.0		16.1		322 Btuh	
2	Insulated - Exterior										20.0		16.1		322 Btuh	
	Door Total										40 (sqft)				644 Btuh	
Ceilings	Type/Color/Surface						U-Value		R-Value		Area(sqft)		HTM		Load	
1	Vented Attic/Med/Shingle/RB						0.025		38.0/0.0		1376.0		1.24		1711 Btuh	
	Ceiling Total										1376 (sqft)				1711 Btuh	
Floors	Type								R-Value		Size		HTM		Load	
1	Slab On Grade								0.0		1311 (ft-perimeter)		0.0		0 Btuh	
	Floor Total										1311.0 (sqft)				0 Btuh	
	Envelope Subtotal:													6739 Btuh		
Infiltration	Type						Average ACH		Volume(cuft)		Wall Ratio		CFM=		Load	
	Natural						0.12		10488		1		20.6		540 Btuh	
Internal gain							Occupants		Btuh/occupant		Appliance				Load	
							6		X 230		+		2400 <td colspan="2">3780 Btuh</td>		3780 Btuh	
	Sensible Envelope Load:													11058 Btuh		
Duct load	Average sealed,Supply(R6.0-Attic), Return(R6.0-Attic)										(DGM of 0.385)			4258 Btuh		
	Sensible Load All Zones													15317 Btuh		

Manual J Summer Calculations

Residential Load - Component Details (continued)

Project Title: Climate:FL_GAINESVILLE_REGIONAL_A
Lot 1 Mayfair Unit 5

Lake City, FL 32025

10/23/2023


WHOLE HOUSE TOTALS

Whole House Totals for Cooling	Sensible Envelope Load All Zones	11058 Btuh
	Sensible Duct Load	4258 Btuh
	Total Sensible Zone Loads	15317 Btuh
	Sensible ventilation (Ex:0 cfm; Sup:0 cfm)	0 Btuh
	Blower	0 Btuh
	Total sensible gain	15317 Btuh
	Latent infiltration gain (for 54 gr. humidity difference)	751 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	1078 Btuh
	Latent occupant gain (6.0 people @ 200 Btuh per person)	1200 Btuh
	Latent other gain	0 Btuh
	Latent total gain	3030 Btuh
	TOTAL GAIN	18346 Btuh

EQUIPMENT

1. Central Unit	#	16879 Btuh
-----------------	---	------------

*Key: Window types (Panels - Number and type of panes of glass)
(SHGC - Shading coefficient of glass as SHGC numerical value)
(U - Window U-Factor)
(InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))
- For Blinds: Assume medium color, half closed
For Draperies: Assume medium weave, half closed
For Roller shades: Assume translucent, half closed
(IS - Insect screen: none(N), Full(F) or Half(½))
(Ornt - compass orientation)



Version 8