



Cal-Tech Testing, Inc.


P.O. Box 1625 • Lake City, FL 32056-1625 • Tel(386)755-3633 • Fax(386)752-5456
2907 Spring Glen Road Jacksonville, FL 32207 • Tel(904)381-8901 • Fax(904) 381-8902

• Engineering
• Geotechnical
Laboratories

REPORT OF LABORATORY COMPACTION TEST

Client: Stanley Crawford Construction, Inc. 1482 SW Commercial Glen Lake City, FL 32025
Project Name: 377 S.E. Deerwood Glen
Project Location: Lake City, FL
Contractor: Stanley Crawford Construction, Inc.

File No: 24-00496-01
Date: 10/14/2024
Lab No: 24941

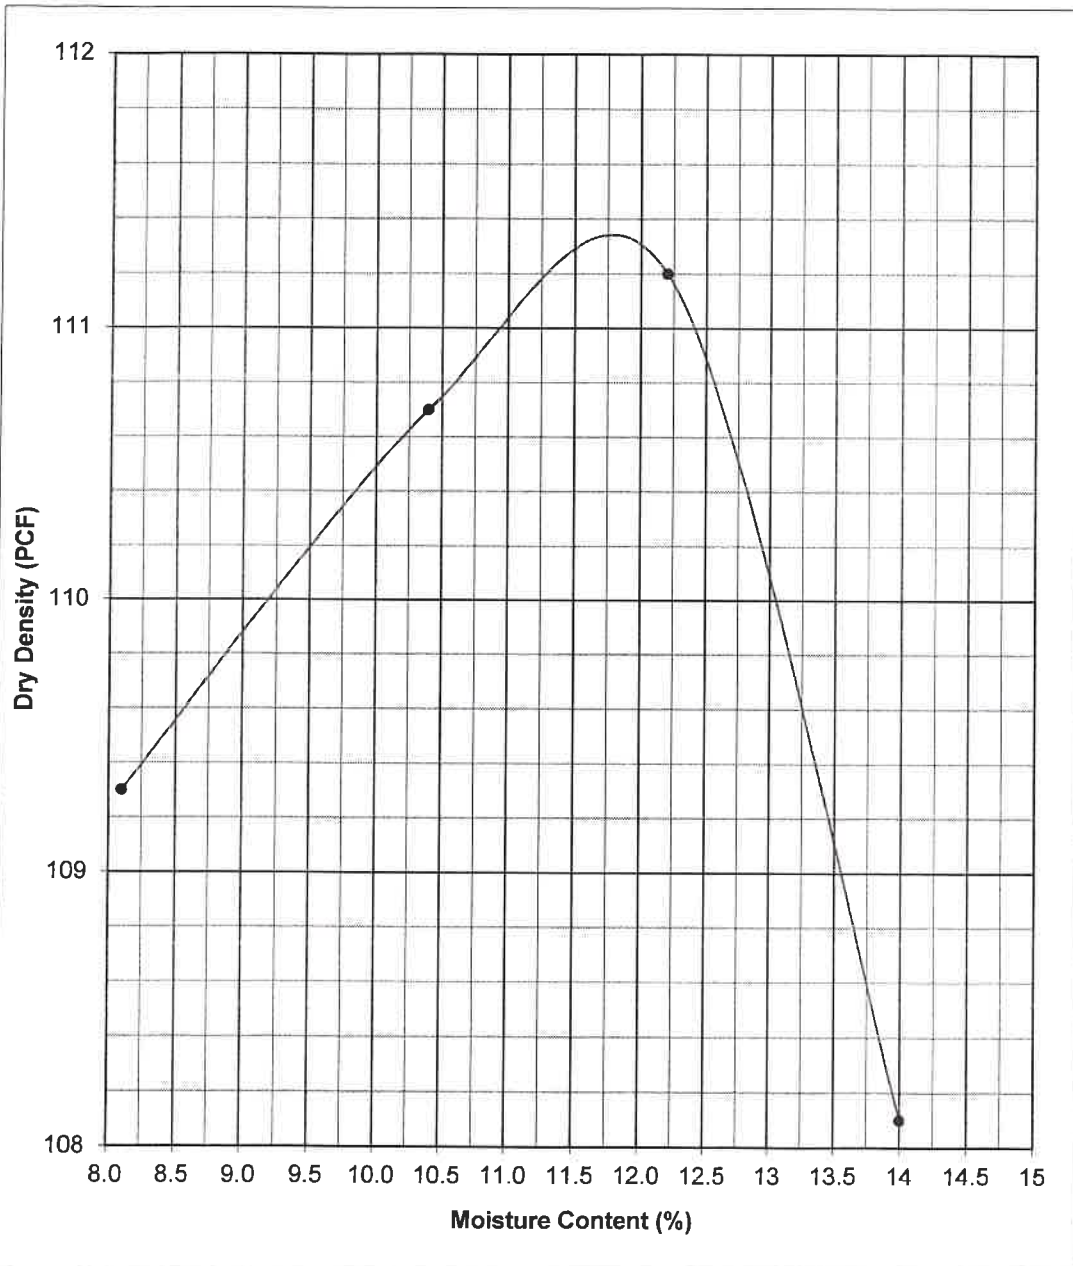

PROCTOR DATA

Proctor No.: 1

Modified Proctor ☒
(ASTM D-1557)

Standard Proctor ☐
(ASTM D-698)

Maximum Dry
Dens. Pcf: 111.3


Optimum Moisture
Percent: 11.8

Total -200 (%): 14

LL: NA

PI: NP

The test results presented in this report are specific only to the samples tested at the time of testing. The tests were performed in accordance with generally accepted methods and standards. Since material conditions can vary between test locations and change with time, sound judgement should be exercised with regard to the use and interpretation of the data. This report shall not be reproduced without prior approval of the author.

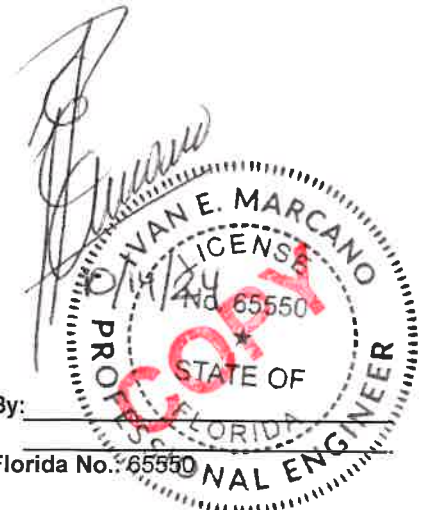

Sample Description: Light Gray Silty Sand (SM)
Sample Location: Onsite/Existing
Proposed Use: Fill
Sampled By: J. Green Date: 10/1/2024
Tested By: A. Gaylard Date: 10/14/2024
Remarks: 1cc: Client
1cc: File

Reviewed By:
Date:
Licensed, Florida No. 65550