




Revision Schedule		
Revision Number	Revision Description	Revision Date
0	ISSUED FOR CONSTRUCTION	6/15/22

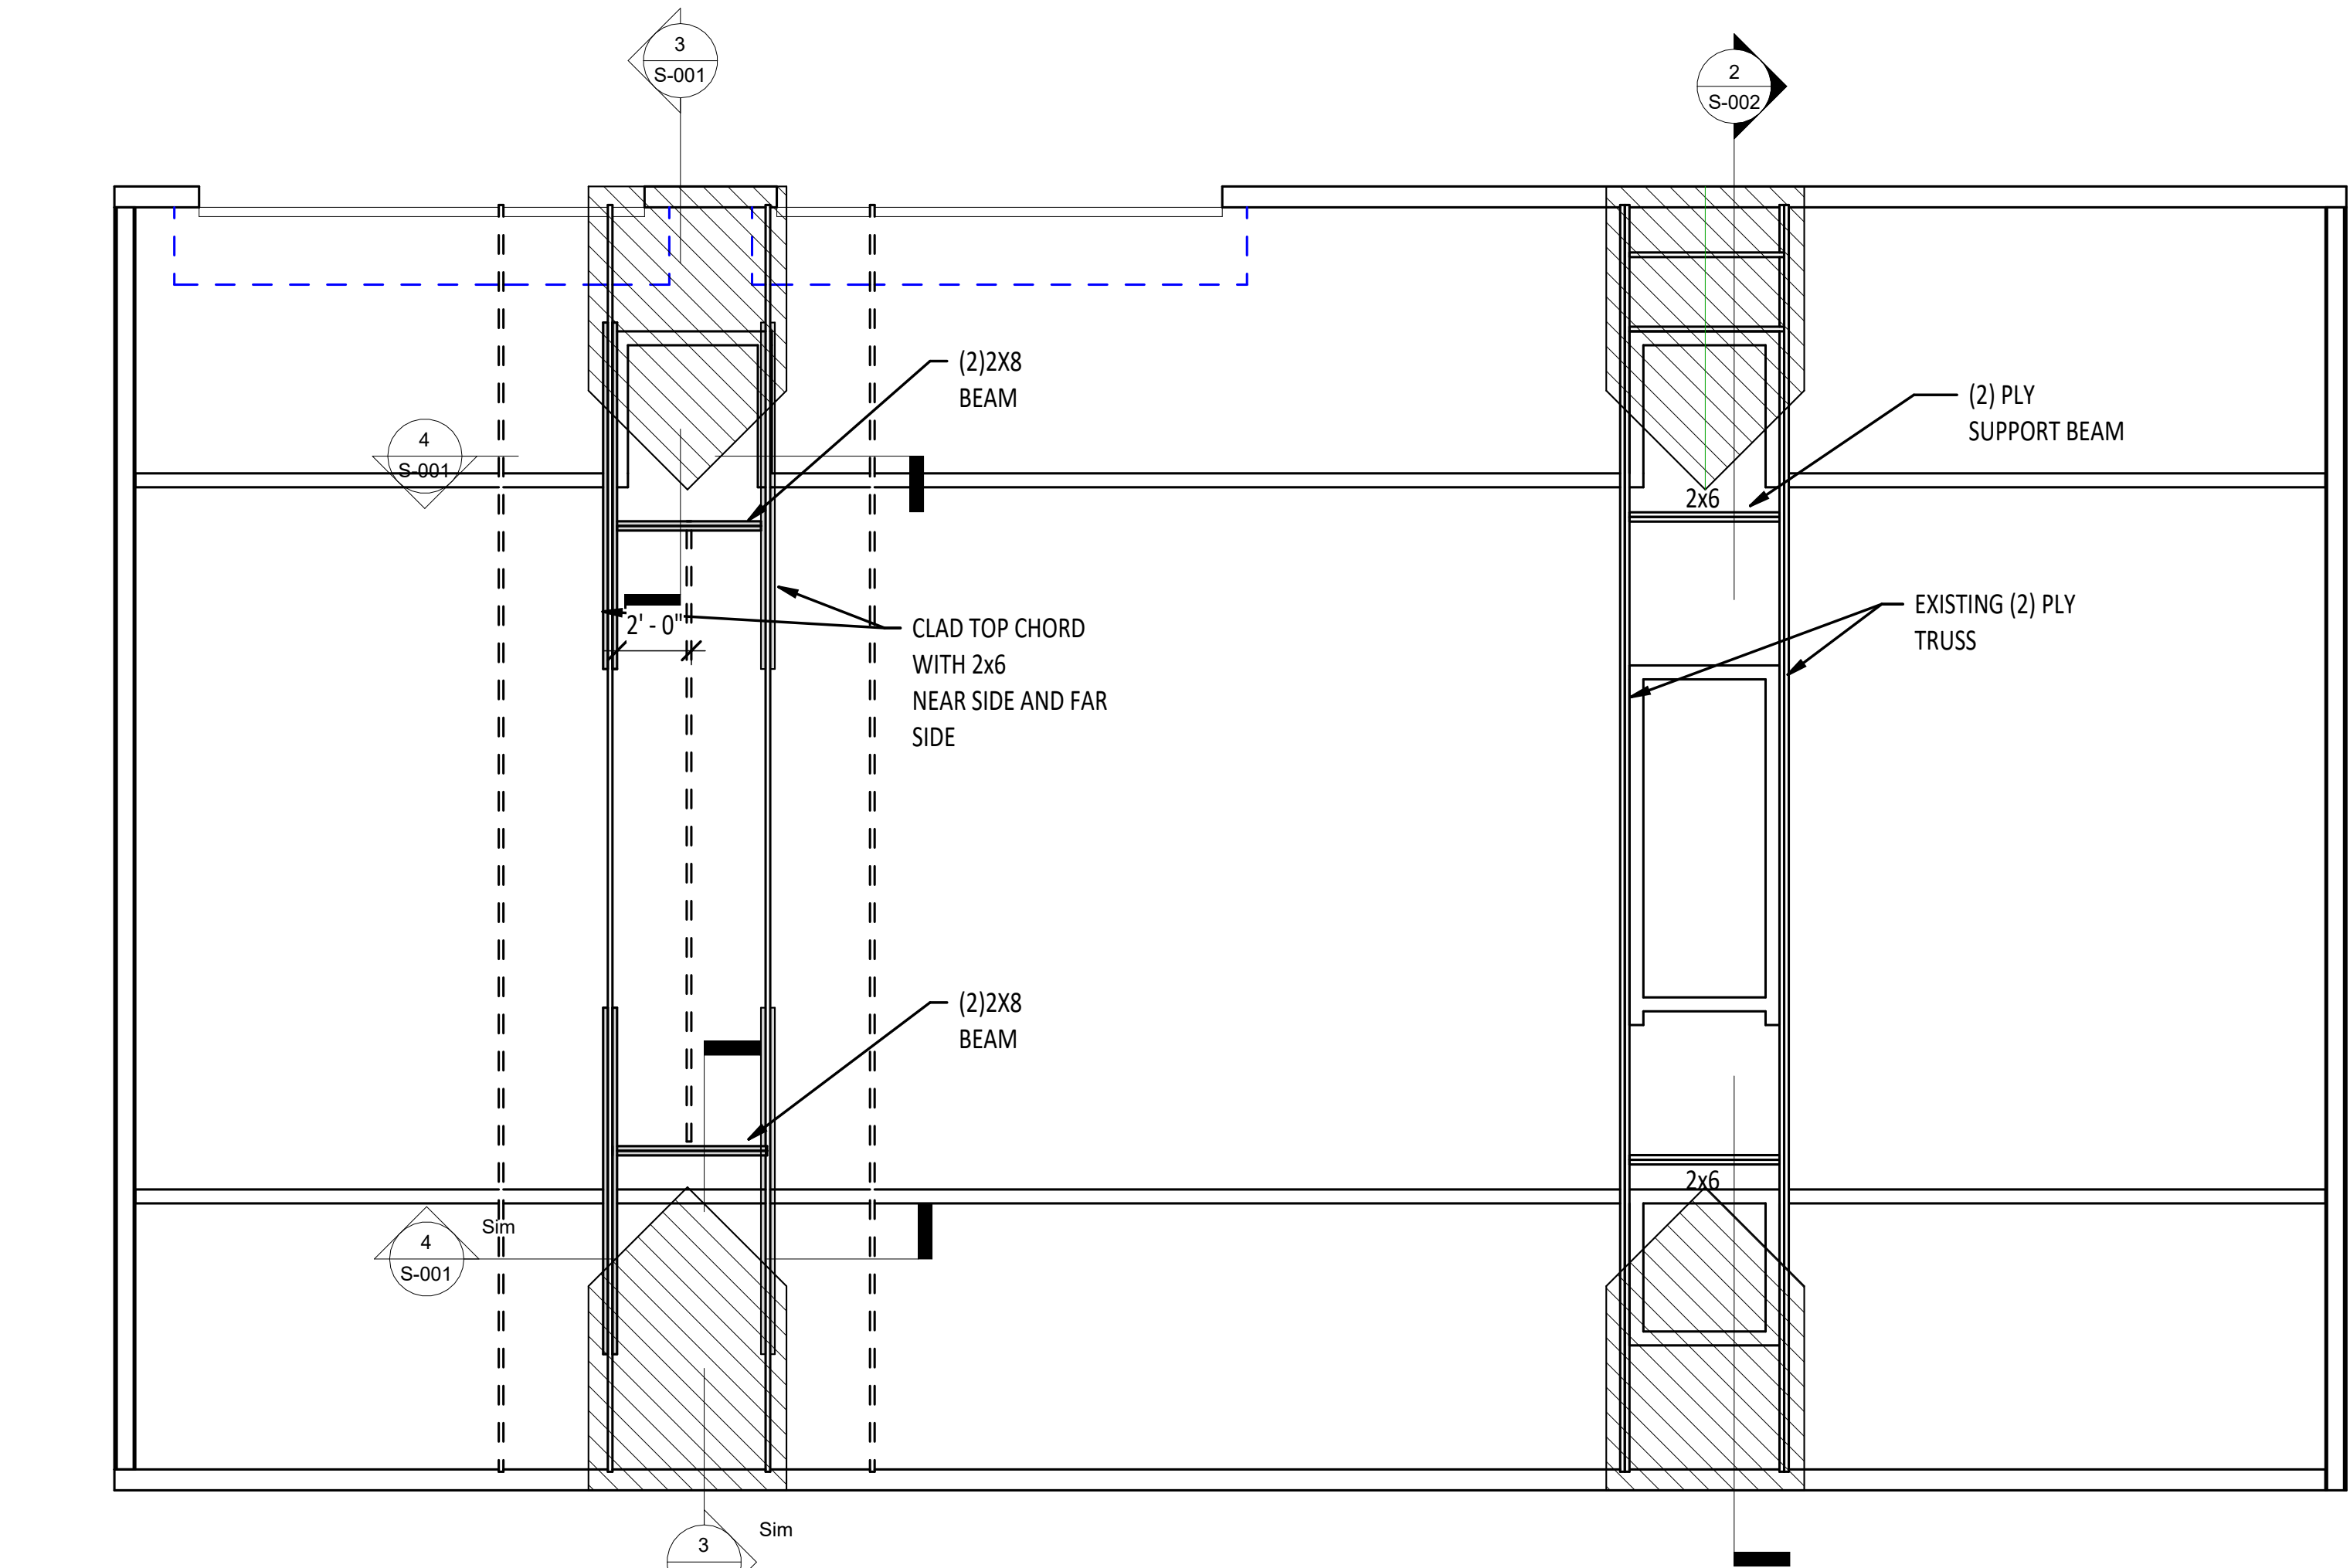

1 TOP CHORD TRUSS FRAMING
1/4" = 1'-0"

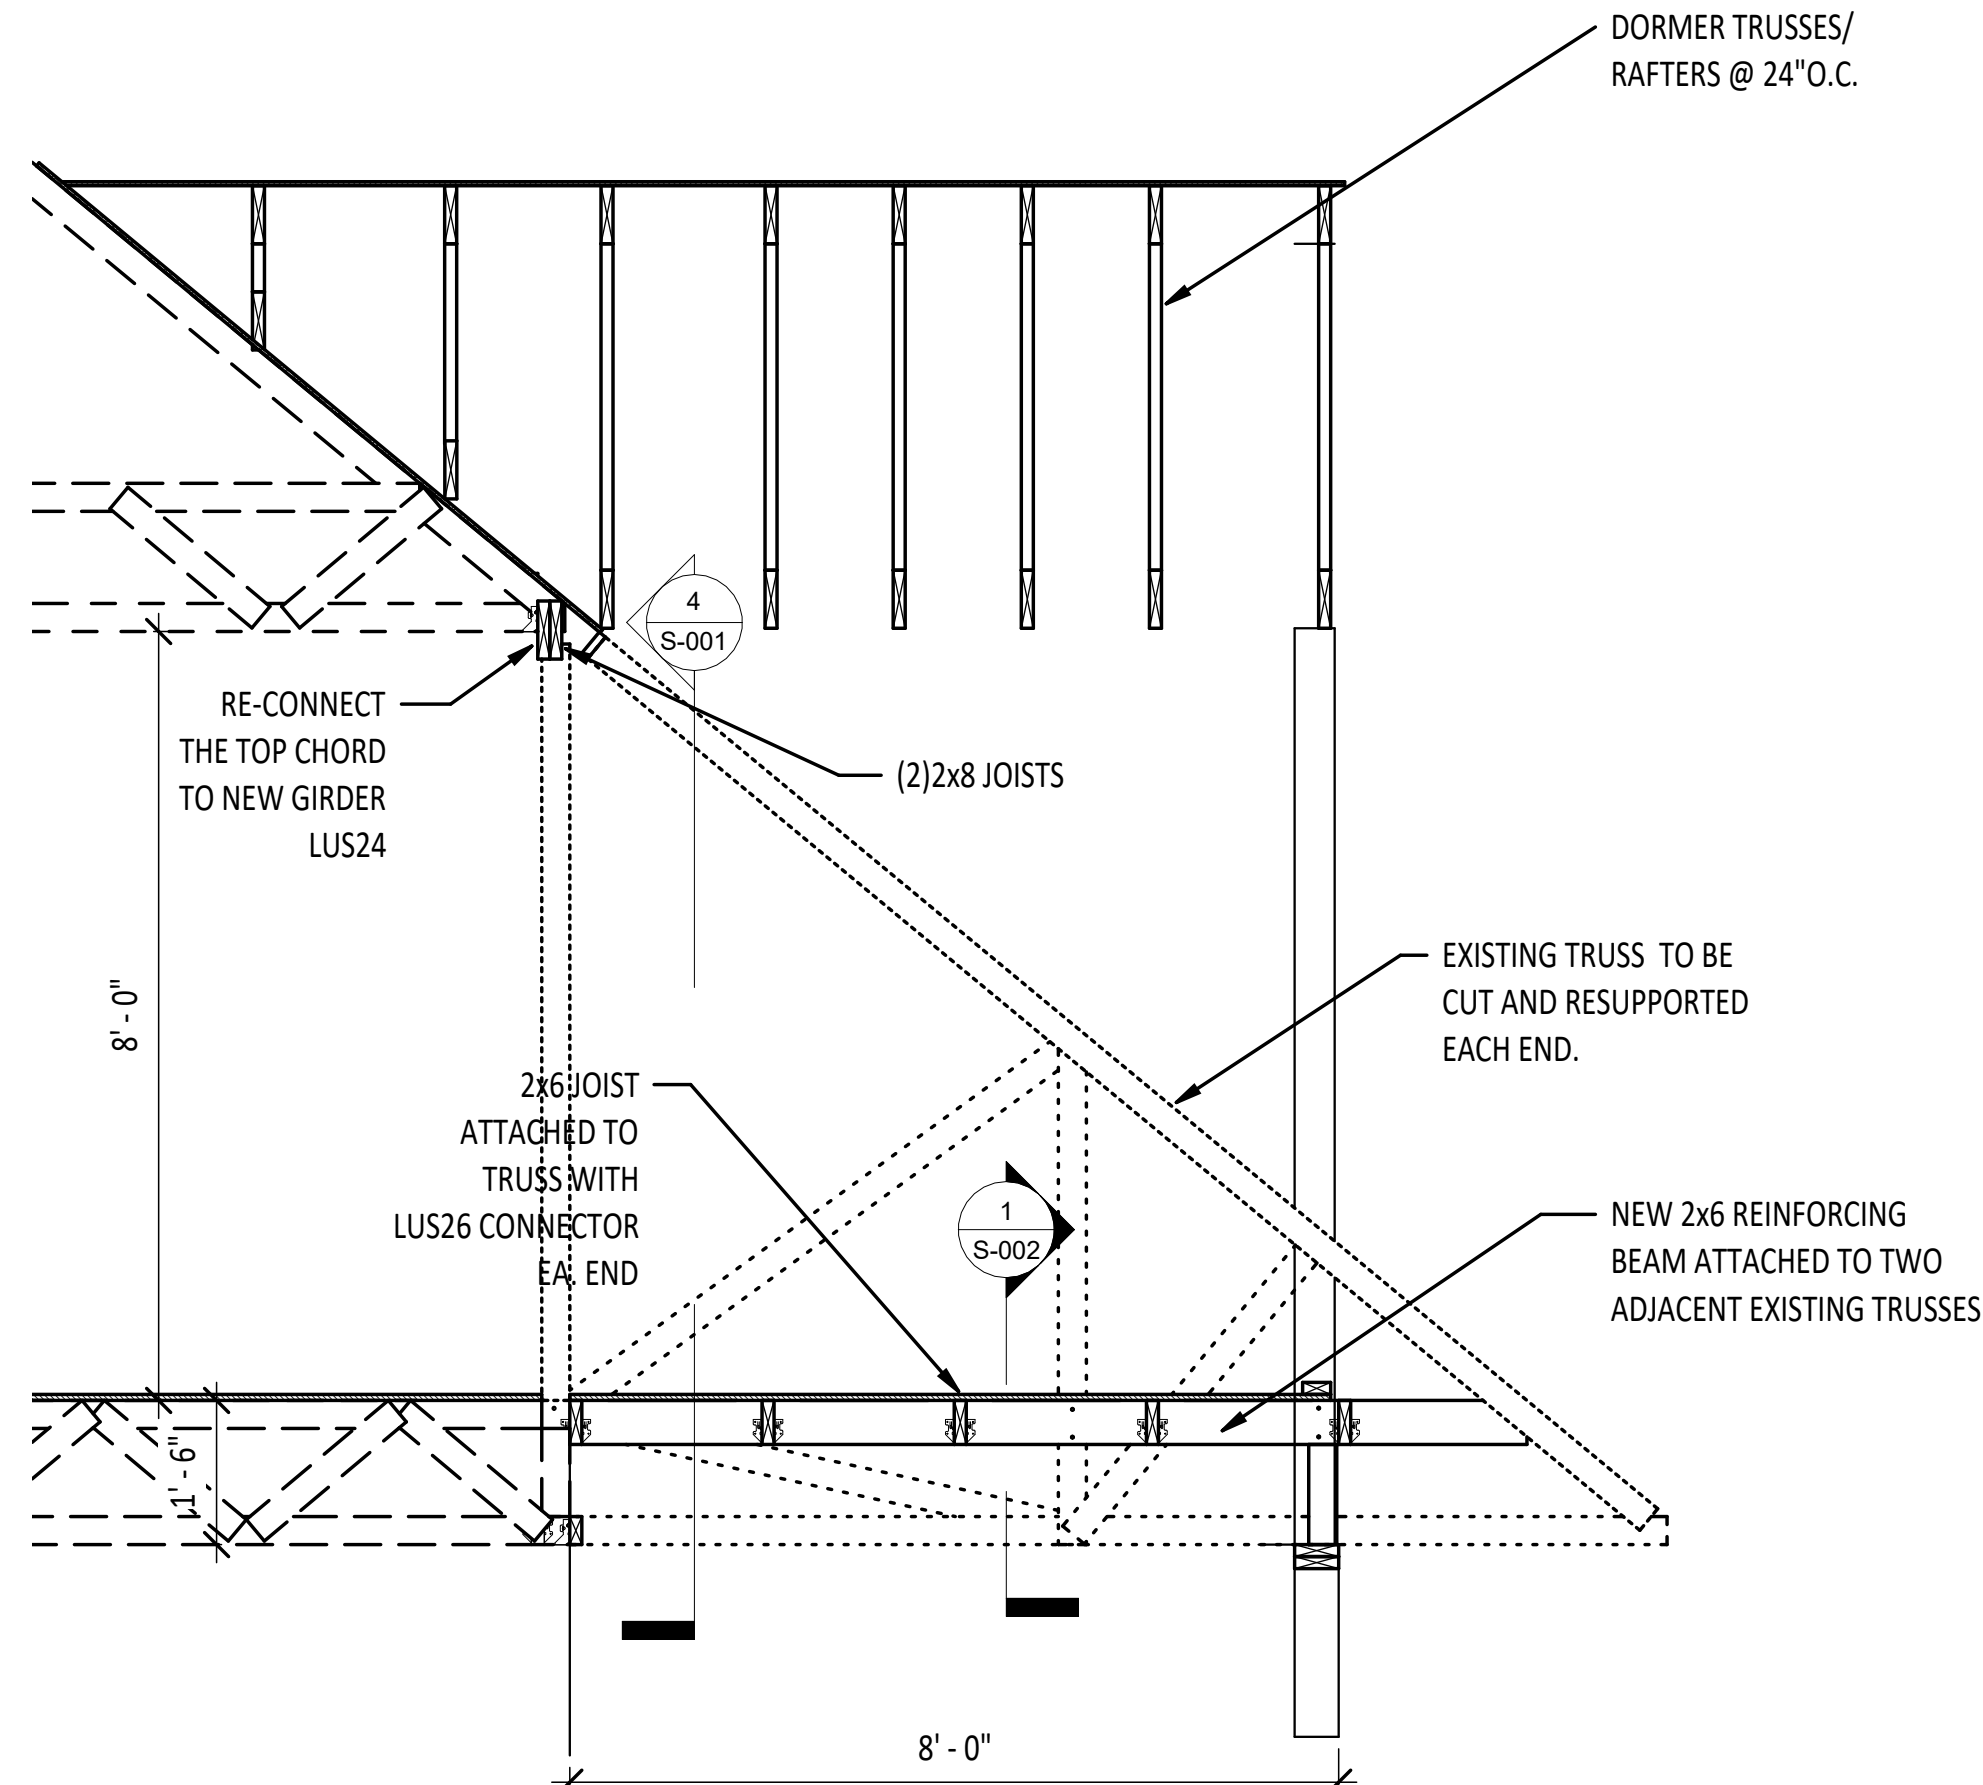


3 TRUSS MODIFICATION SECTION 1
1/2" = 1'-0"

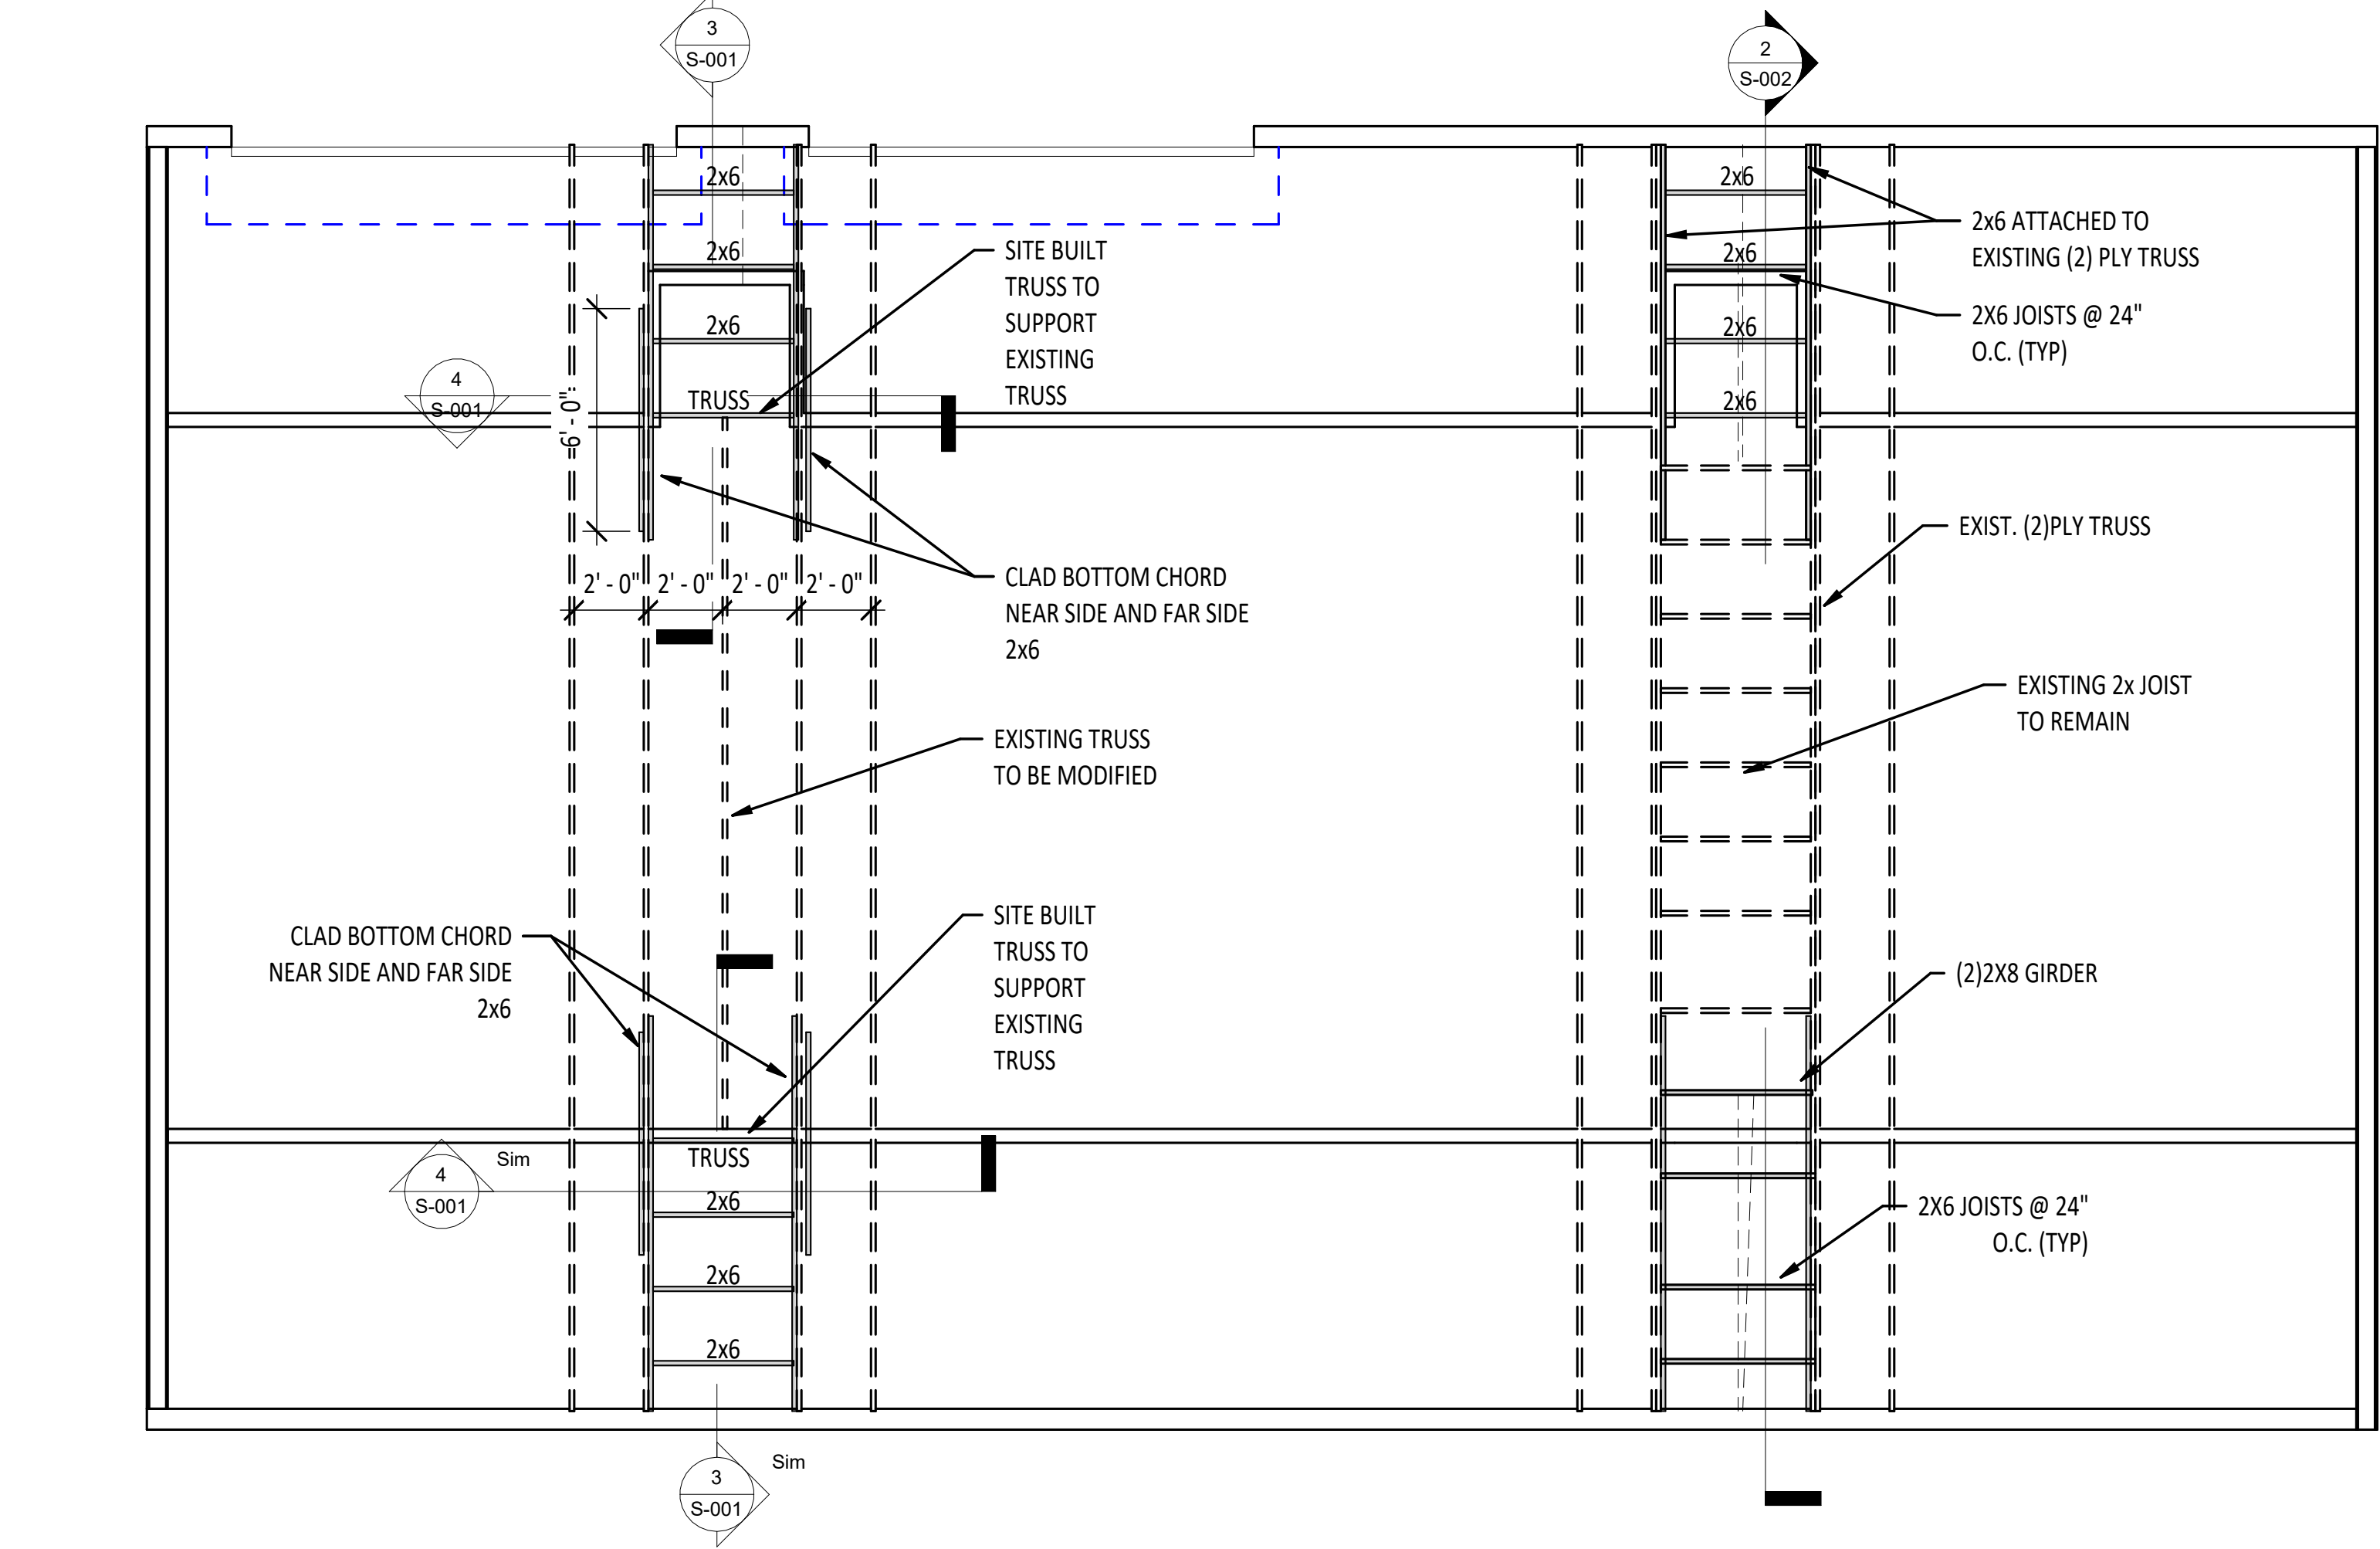

2 BOTTOM CHORD TRUSS FRAMING
1/4" = 1'-0"

SHEET SCHEDULE				
SHEET NUMBER	SHEET NAME	REVISION	REVISION DATE	DESCRIPTION
S-001	ROOF FRAMING PLAN	0	6/15/22	ISSUED FOR CONSTRUCTION
S-002	SECTION VIEWS	0	6/15/22	ISSUED FOR CONSTRUCTION

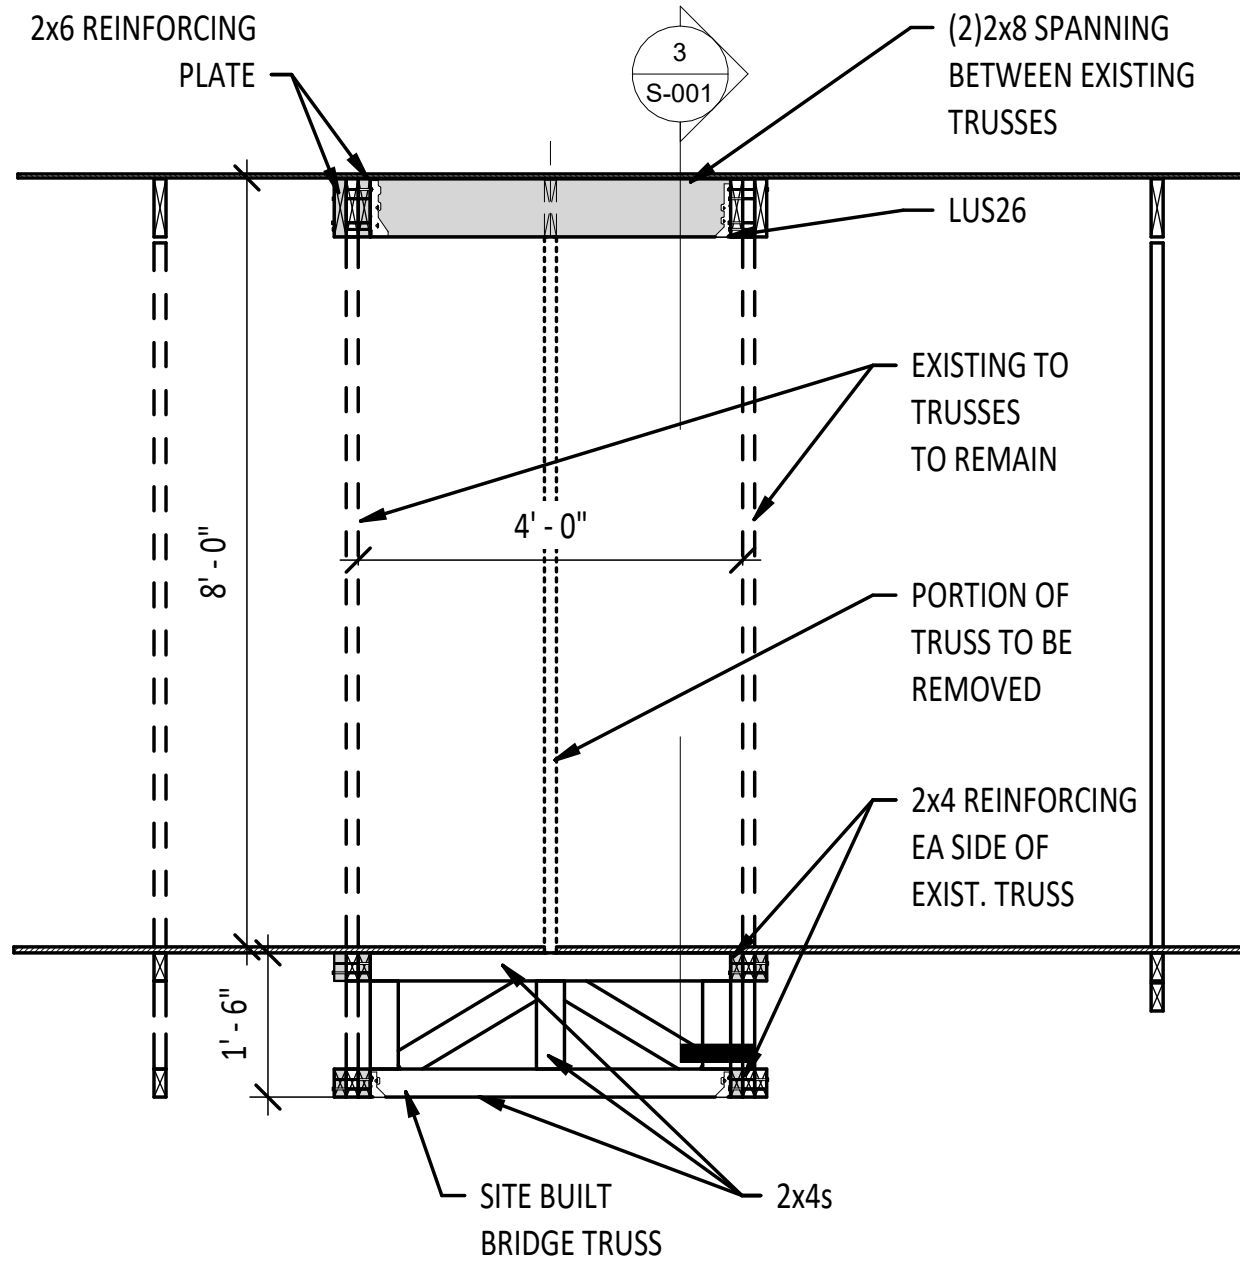

4 TRUSS MODIFICATION SECTION 2
1/2" = 1'-0"

PRINTED COPIES OF THE DOCUMENT
ARE NOT CONSIDERED SIGNED AND SEALED
AND THE SIGNATURE MUST BE VERIFY ON
ANY ELECTRONIC COPIES

Gary Gill
2022.06.15 10:50:45 -0400
2022.001.20117





NEAL - DORMER ADDITION
COLUMBIA COUNTY, FL

BLAKE CONSTRUCTION		GILL ENGINEERING SERVICES, INC	
DRAWN BY:	GG	AUTH #	30824
CHKD BY:	GG	GARY GILL PE #	51942
APPRD BY:	GG	426 SW COMMERCE DR	130-M
		LAKE CITY, FL 32025	386-590-1242

ROOF FRAMING PLAN

PROJECT #: 2213-015	DWG #: S-001	REV #: 0
------------------------	-----------------	-------------

6/15/2022 10:49:02 AM
email: ggil@gillengineering.com

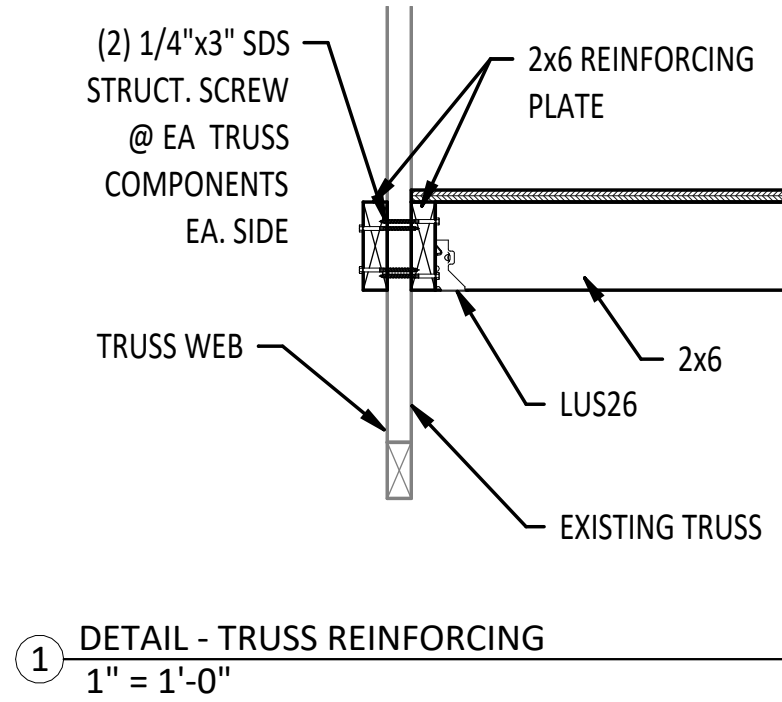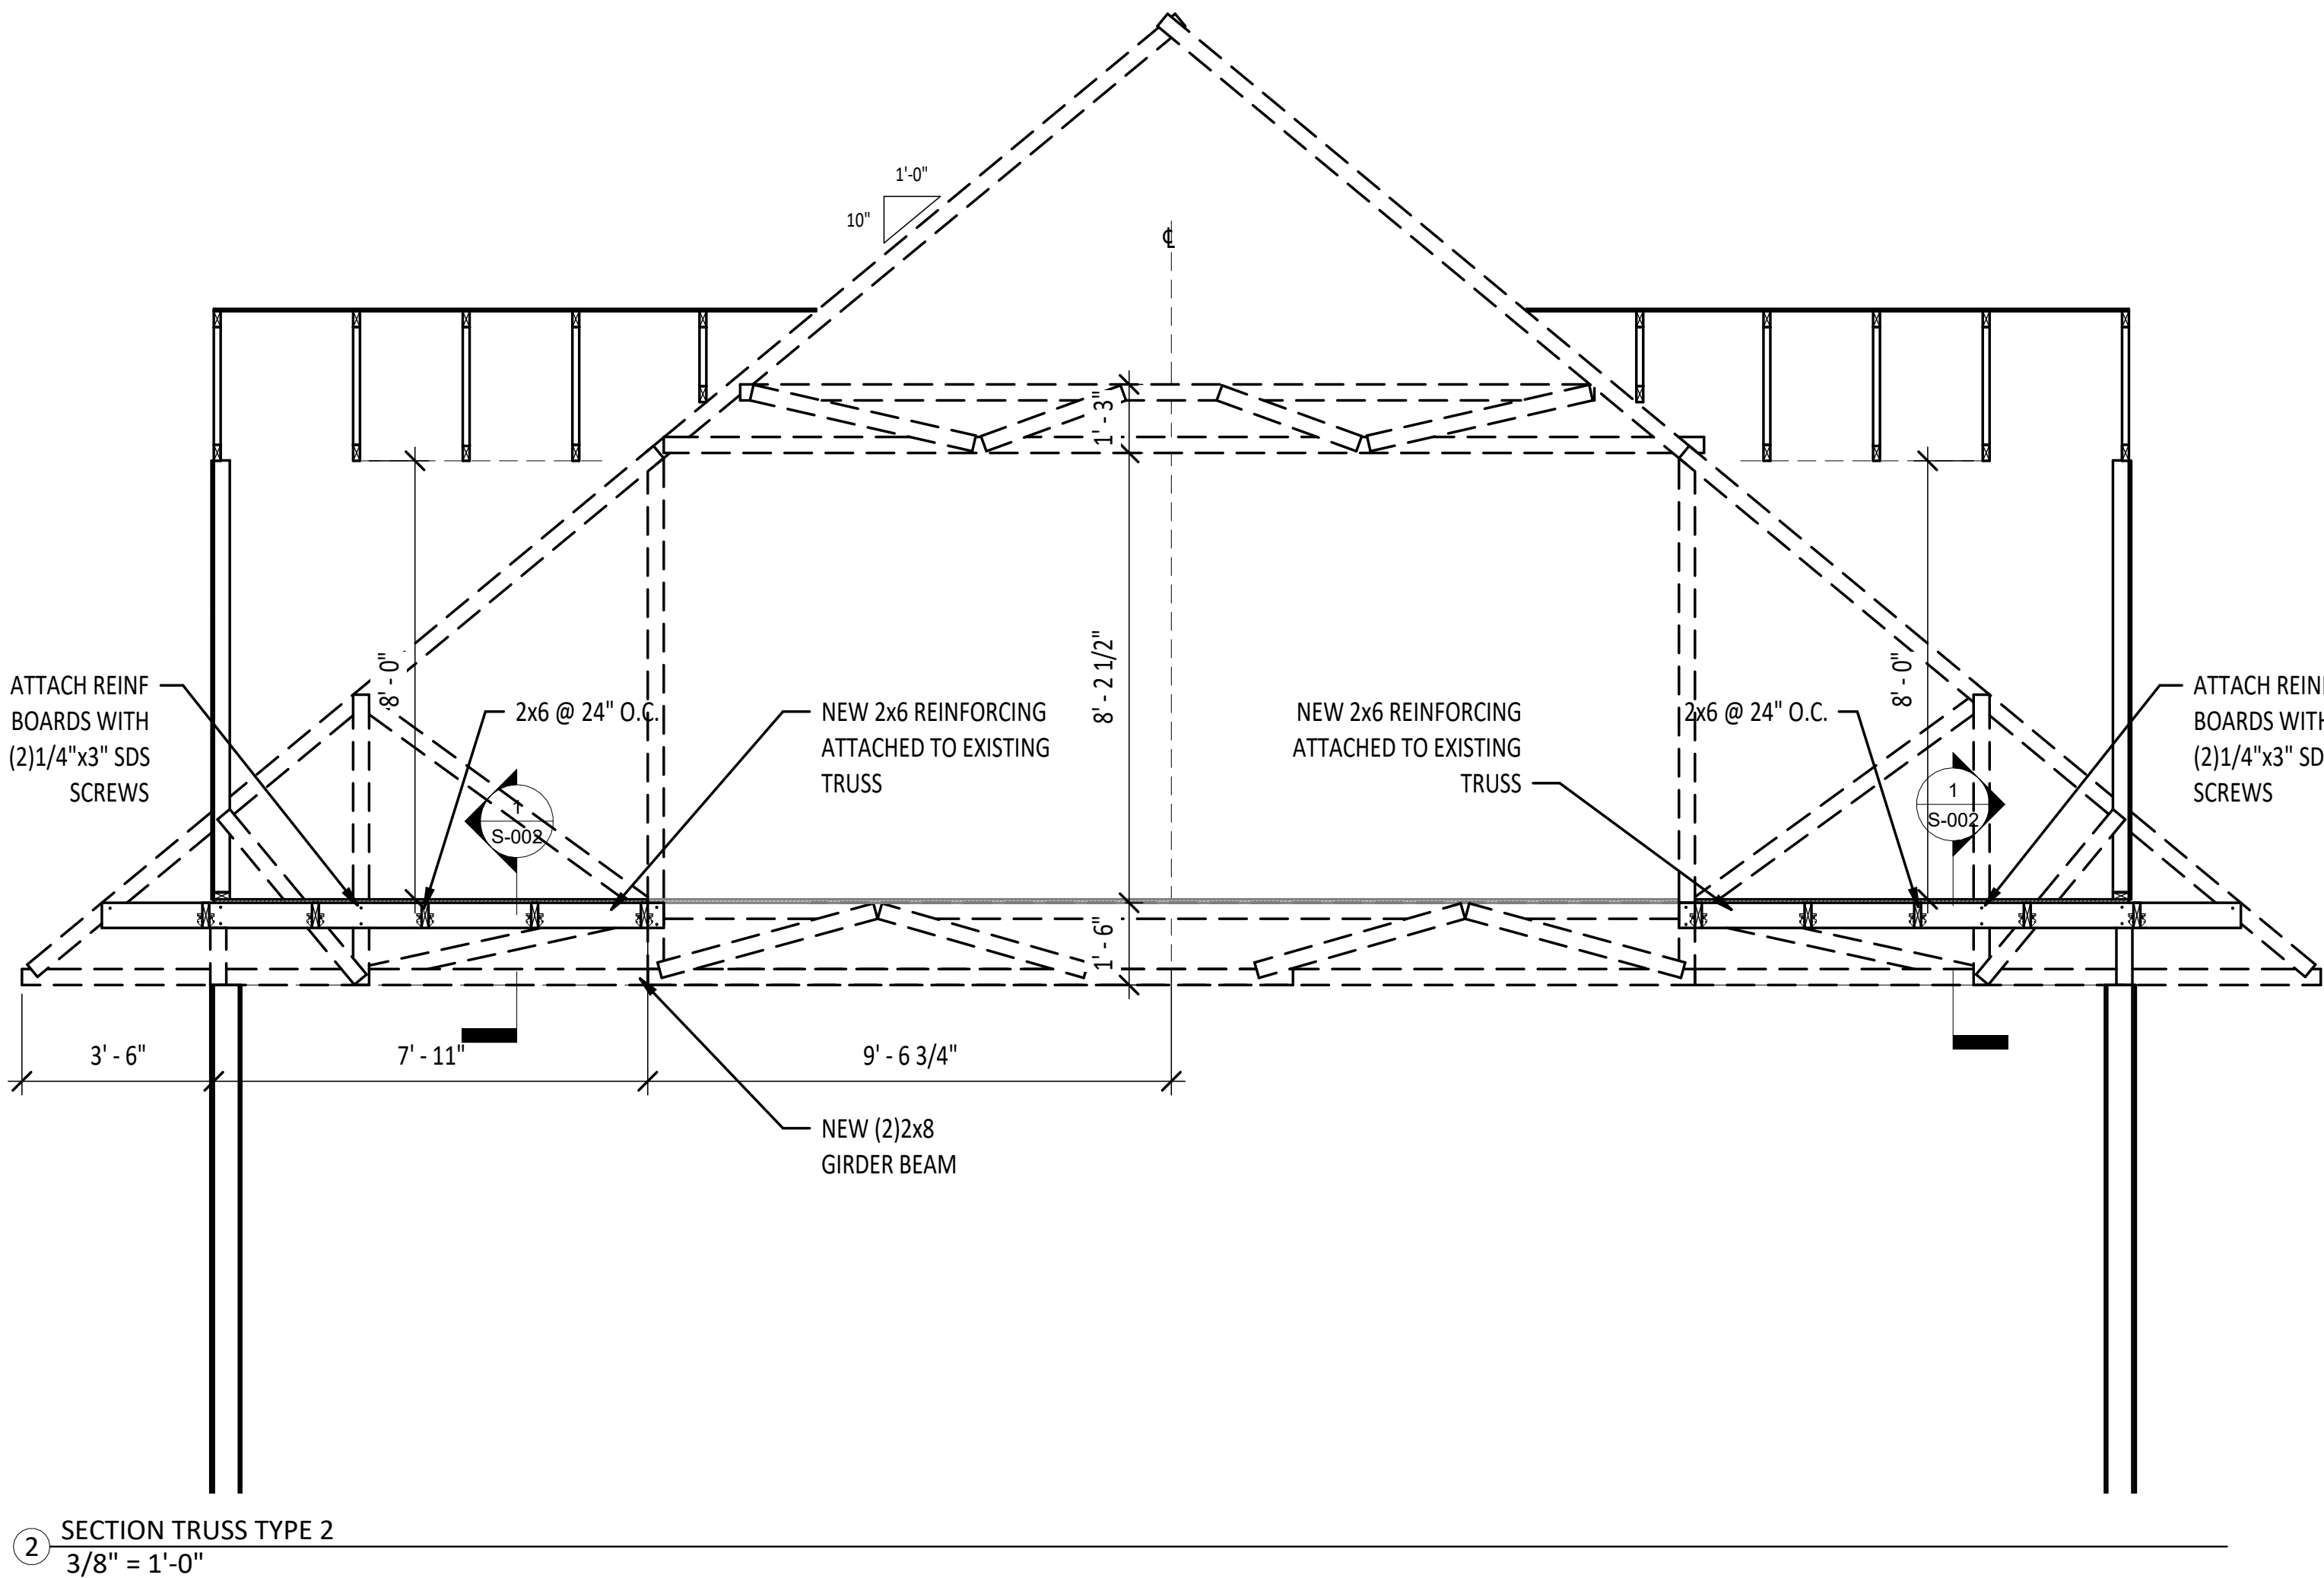

GENERAL NOTES:

- ALL CONSTRUCTION AND DESIGN SHALL CONFORM TO THE 2020 FBC (7TH ED)
- THE STRUCTURAL DRAWINGS SHALL BE UTILIZED IN CONJUNCTION WITH OTHER CONSULTANTS' DRAWINGS.
- THE STRUCTURAL DRAWINGS ARE INTENDED FOR THE STRUCTURE TO ACT AS WHOLE ONCE CONSTRUCTION IS COMPLETE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE SAFETY AND STABILITY (I,E, TEMPORARY BRACING IF REQUIRED) DURING CONSTRUCTION AS A RESULT OF CONSTRUCTIONS METHODS AND SEQUENCES.
- THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING STRUCTURES, THE ENGINEER SHALL BE NOTIFIED ON ANY DISCREPANCY BETWEEN THE EXISTING CONDITIONS AND CONSTRUCTION DOCUMENTS.
- DESIGN CRITERIA

- A. CODE: 2020 FBC (7TH ED)
B. LOADS AND DESIGN CRITERIA: THE FOLLOWING LOADS AND CRITERIA WERE USED IN ADDITION T THE DEAD LOAD OF THE STRUCTURE.

LIVE LOADS:

ROOF 20 PSF

SOIL CRITERIA:

ALLOWABLE SOIL BEARING 1500 PSF
PASSIVE PRESSURE 150 PCF
FRICTION COEFFICIENT 0.35

WIND CRITERIA:

WIND SPEED: 130 MPH (3-SECOND GUST)
CATEGORY: II
EXPOSURE: C
INTERNAL PRESSURES: +/- 0.18
COMPONENTS AND CLADDING:

ZONE 1: 18.52 / -33.26 PSF
ZONE 2: 18.52 / -45.89 PSF
ZONE 3: 18.52 / -45.89 PSF
ZONE 4: 24.84 / -26.95 PSF
ZONE 5: 24.84 / -33.26 PSF

GENERAL WOOD NOTES:

DIMENSIONAL LUMBER

- DIMENSIONAL LUMBER USED AS STRUCTURAL FRAMING (i.e. JOISTS, RAFTERS,HEADERS) SHALL BE SOUTHERN YELLOW PINE NO.2 OR EQUAL.
- DIMENSIONAL LUMBER USED FOR STUDS WALLS SHALL BE STUD GRADE UNLESS NOTED OTHERWISE. STUDS SHALL HAVE BE SPACES AT 16" MIN WITH A DOUBLE TOP PLATE. SPLICES IN THE DOUBLE TOP WALLS SHALL BE ALTERNATE TOP AND BOTTOM. IN NO CASE SHALL 2x4 BEARING WALLS SUPPORT MORE THAN TWO FLOORS OF FRAMING IN ADDITION TO ROOF AND CEILING
- ROUGH CUT TIMBER USED AS STRUCTURAL FRAMING SHALL BE AS SPECIFIED IN THE CONSTRUCTION DOCUMENTS
- ALL LUMBER IN CONTACT WITH THE GROUND, CONCRETE SHALL BE PRESSURED-TREATED. CONTRACTOR MAY SUBMIT FOR APPROVAL A MOISTURE BARRIER IN-LIEU OF THE PRESSURE TREATED WOOD.
- FASTENERS FOR PRESERVATIVE-TREATED AND FIRE-RETARDANT TREATED WOOD SHALL BE OF HOT-DIPPED ZINC COATED GALVANIZED STEEL OR STAINLESS STEEL AND SHALL FOLLOW CURRENT SIMPSON GUIDELINES BASED ON WEATHER EXPOSURE WHERE STAINLESS STEEL CONNECTORS OR HOT DIPPED CONNECTORS ARE SPECIFIED IN THE DRAWINGS, STAINLESS STEEL OR HOT DIPPED GALVANIZED FASTENERS SHALL BE USED TO MATCH THE CONNECTORS TYPE.
- ALL NAILS FOR STRUCTURAL WORK SHALL BE COMMON WIRE NAILS UNLESS NOTED OR DETAILED OTHERWISE MEETING ASTM F1667. HOLES SHALL BE PRE-DRILLED WHERE NECESSARY TO PREVENT SPLITTING. NAILS SHALL HAVE THE MINIMUM PROPERTIES SPECIFIED IN THE TABLE BELOW:

NAIL TYPE	SHANK DIAMETER- INCHES	MINIMUM PENETRATION - INCHES
6d	0.113	1.13
8d	0.131	1.31
10d	0.148	1.48
12d	0.148	1.48
16d	0.162	1.63

NAILING SCHEDULE NOTES:

- ALL OTHER NAILING REQUIREMENTS NOTE SHOWN ON DRAWINGS OR IN SCHEDULE ABOVE SHALL BE IN ACCORDANCE WITH 2020 FBC.
- POWER DRIVEN OR PNEUMATIC NAILS OTHER THAN COMMON NAILS MAY BE USED IF DATA IS SUBMITTED TO THE ENGINEER FOR APPROVAL PRIOR TO USE.
- MINIMUM NAIL LENGTHS SHALL BE SUFFICIENT TO ACHIEVE MINIMUM PENETRATION INTO MAIN MEMBER AS NOTED IN SCHEDULE ON NOTE ABOVE.

Revision Schedule		
Revision Number	Revision Description	Revision Date
0	ISSUED FOR CONSTRUCTION	6/15/22

6/15/2022 10:49:02 AM
email: ggil@gillengineeringervices.com



NEAL - DORMER ADDITION

COLUMBIA COUNTY, FL

BLAKE CONSTRUCTION

DRAWN BY:	GG	
CHKD BY:	GG	
APPRD BY:	GG	

GILL ENGINEERING SERVICES, INC
AUTH # 30824
GARY GILL PE #51942
426 SW COMMERCE DR 130-M
LAKE CITY, FL 32025 386-590-1242

SECTION VIEWS

PROJECT #:	DWG #:	REV #:
2213-015	S-002	0