



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 6243111 - 1755-D-14x10 Lanai

MiTek, Inc.

16023 Swingley Ridge Rd.

Chesterfield, MO 63017

Model: 1755-D-14x10 Lanai

Site Information:

Customer Info: Adams Homes-Gainesville

Project Name: The Preserve at Laurel Lake, 094

Lot/Block: 094

Subdivision: The Preserve at Laurel Lake

Address: 742 SW Rosemary Dr.,

City: Lake City

State: fl

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name:

License #:

Address:

City:

State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014

Design Program: MiTek 20/20 8.7

Wind Code: ASCE 7-22

Wind Speed: 130 mph

Roof Load: 40.0 psf

Floor Load: N/A psf

This package includes 44 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T35970793	A01	1/7/25	23	T35970815	C3C	1/7/25
2	T35970794	A02	1/7/25	24	T35970816	C3L	1/7/25
3	T35970795	A03	1/7/25	25	T35970817	C5	1/7/25
4	T35970796	A04	1/7/25	26	T35970818	C5B	1/7/25
5	T35970797	A05	1/7/25	27	T35970819	C5C	
6	T35970798	A06	1/7/25	28	T35970820	E5L	
7	T35970799	A07	1/7/25	29	T35970821	E7	
8	T35970800	A08	1/7/25	30	T35970822	G01	
9	T35970801	A09	1/7/25	31	T35970823	G02	
10	T35970802	A10	1/7/25	32	T35970824	G03	
11	T35970803	A11	1/7/25	33	T35970825	G04	
12	T35970804	A12	1/7/25	34	T35970826	H5L	
13	T35970805	A13	1/7/25	35	T35970827	H6C	
14	T35970806	A14	1/7/25	36	T35970828	H7	
15	T35970807	A15	1/7/25	37	T35970829	L01	
16	T35970808	A16	1/7/25	38	T35970830	L02	
17	T35970809	A17	1/7/25	39	T35970831	LV1	
18	T35970810	A18	1/7/25	40	T35970832	LV2	
19	T35970811	C1	1/7/25	41	T35970833	LV3	
20	T35970812	C1L	1/7/25	42	T35970834	M1	
21	T35970813	C3	1/7/25	43	T35970835	M2	
22	T35970814	C3B	1/7/25	44	T35970836	M3	




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Tibbetts Lumber Co., LLC.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2025.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

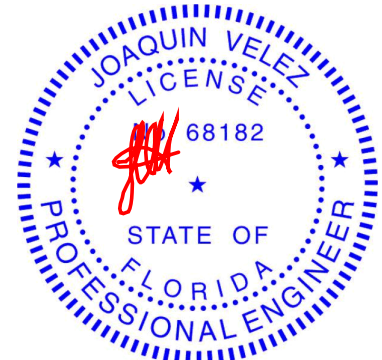

Joaquin Velez PE No. 68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970793
6243111	A01	HIP GIRDER	1	2	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:05 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHym-dSmjc1MytneXgrl354LTTw6bAos66T1CZCh6ovzy5Ji
-2-0-0 7-0-0 11-6-14 16-0-0 20-5-2 25-0-0 32-0-0
2-0-0 7-0-0 4-6-14 4-5-2 4-5-2 4-6-14 7-0-0
Scale = 1:57.0

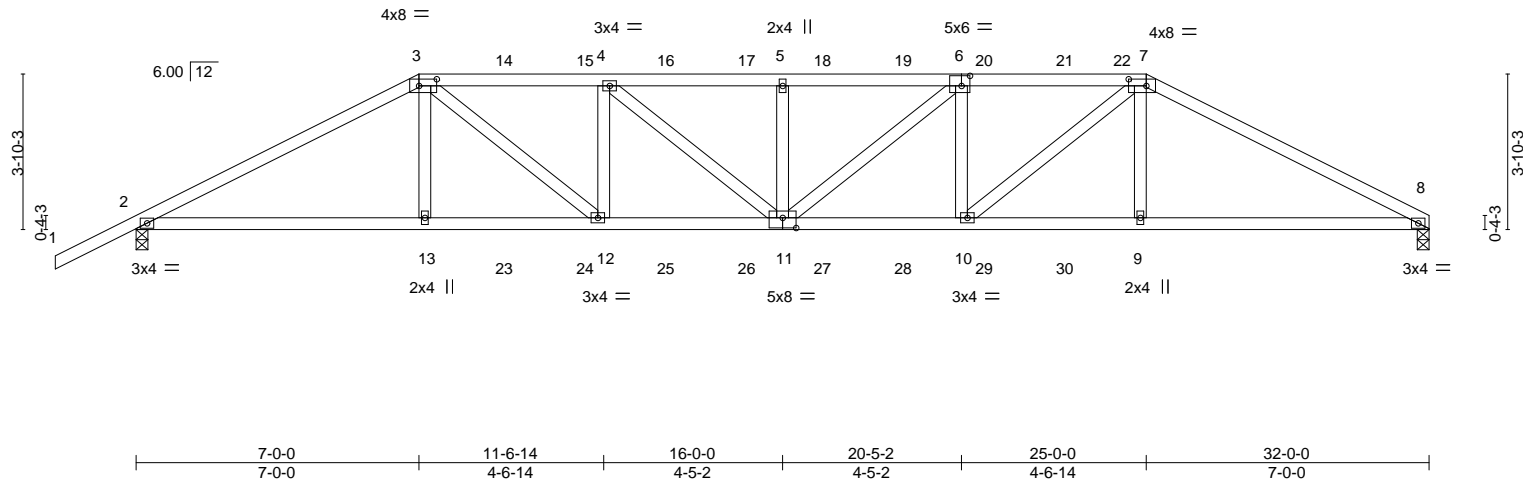



Plate Offsets (X,Y)-- [3:0-5-4,0-2-0], [6:0-2-8,0-3-0], [7:0-5-4,0-2-0], [11:0-4-0,0-3-0]						
LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	PLATES
TCLL	20.0	Plate Grip DOL	1.25	TC 0.88	in (loc) l/defl L/d	GRIP
TCDL	10.0	Lumber DOL	1.25	BC 0.72	Vert(LL) -0.19 11 >999 360	MT20 244/190
BCLL	0.0 *	Rep Stress Incr	NO	WB 0.22	Vert(CT) -0.39 10-11 >984 240	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S	Horz(CT) 0.12 8 n/a n/a	
					Wind(LL) 0.12 11 >999 240	Weight: 314 lb FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 8=0-3-8, 2=0-3-8
Max Horz 2=71(LC 7)
Max Uplift 8=103(LC 8), 2=153(LC 8)
Max Grav 8=2399(LC 1), 2=2491(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-4655/164, 3-4=-5516/297, 4-5=-5998/338, 5-6=-5998/338, 6-7=-5568/318, 7-8=-4779/214
BOT CHORD 2-13=-88/4047, 12-13=-80/4065, 11-12=-212/5516, 10-11=-233/5568, 9-10=-129/4183, 8-9=-137/4165
WEBS 3-13=0/634, 3-12=-167/1907, 4-12=-981/215, 4-11=-53/646, 5-11=-533/170, 6-11=-26/572, 6-10=-933/194, 7-10=-132/1827, 7-9=0/641

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 103 lb uplift at joint 8 and 153 lb uplift at joint 2.

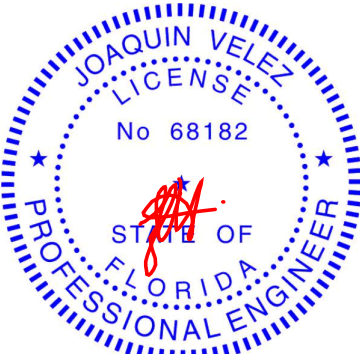

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970793
6243111	A01	HIP GIRDER	1	2	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:06 2025 Page 2
ID:nV5ZFUJaGJLKOI1jrAiSDcyHym-5fK5pNNae4mOI?tFfosi07fmvCCLrwHLosQfKMzy5Jh

NOTES-

10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 142 lb down and 86 lb up at 7-0-0, 123 lb down and 83 lb up at 9-0-12, 123 lb down and 83 lb up at 11-0-12, 123 lb down and 83 lb up at 13-0-12, 123 lb down and 83 lb up at 15-0-12, 123 lb down and 83 lb up at 16-11-4, 123 lb down and 83 lb up at 18-11-4, 123 lb down and 83 lb up at 20-11-4, and 123 lb down and 83 lb up at 22-11-4, and 251 lb down and 170 lb up at 25-0-0 on top chord, and 311 lb down at 7-0-0, 96 lb down at 9-0-12, 96 lb down at 11-0-12, 96 lb down at 13-0-12, 96 lb down at 15-0-12, 96 lb down at 16-11-4, 96 lb down at 18-11-4, 96 lb down at 20-11-4, and 96 lb down at 22-11-4, and 311 lb down at 24-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-60, 3-7=-60, 7-8=-60, 2-8=-20
Concentrated Loads (lb)
Vert: 3=-123(F) 7=-204(F) 13=-264(F) 9=-264(F) 14=-123(F) 15=-123(F) 16=-123(F) 17=-123(F) 18=-123(F) 19=-123(F) 20=-123(F) 21=-123(F) 23=-48(F) 24=-48(F) 25=-48(F) 26=-48(F) 27=-48(F) 28=-48(F) 29=-48(F) 30=-48(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970794
6243111	A02	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:06 2025 Page 1
ID:nV5ZFUJaGJLK0I1jrAiSDcyHym-5fK5pNNae4mOI?tfFosi07fnyCD3rxvLosQfKMzy5Jh

Scale = 1:57.0

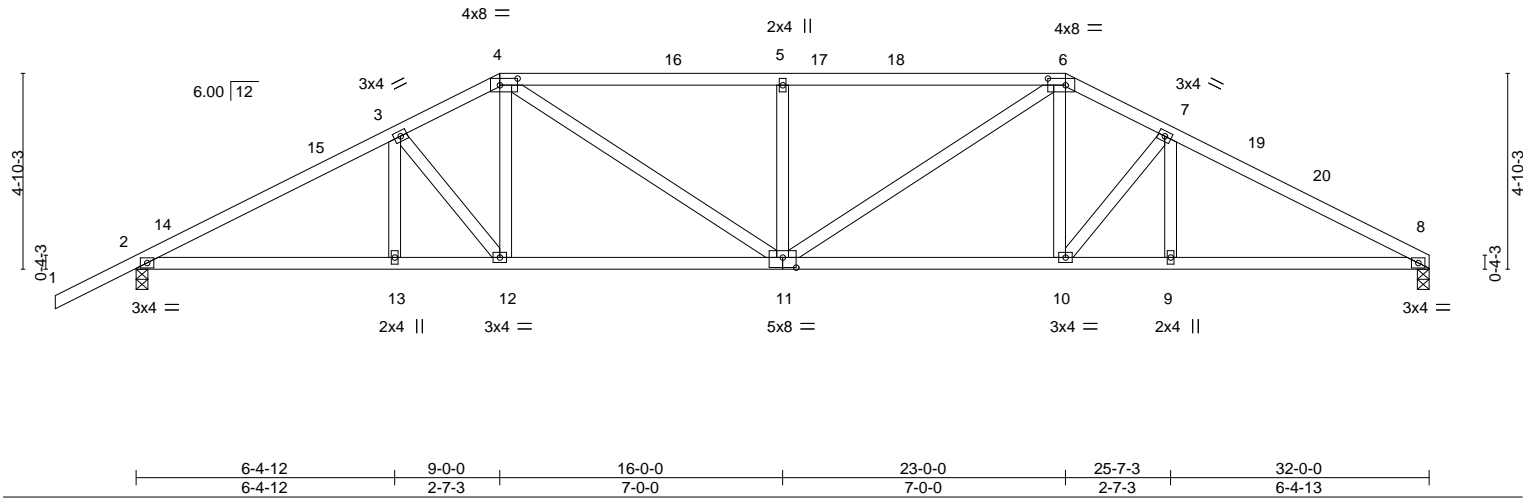


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.81	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.67	Vert(LL) -0.14 11 >999 360		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.18	Vert(CT) -0.30 10-11 >999 240		
BCDL 10.0	Code FBC2023/TP12014	Matrix-S	Horz(CT) 0.10 8 n/a n/a		
			Wind(LL) 0.08 11 >999 240	Weight: 165 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS.	(size) 8=0-3-8, 2=0-3-8
	Max Horz 2=87(LC 11)
	Max Uplift 8=53(LC 12), 2=118(LC 12)
	Max Grav 8=1264(LC 1), 2=1401(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2324/185, 3-4=-2035/203, 4-5=-2278/231, 5-6=-2278/231, 6-7=-2054/211, 7-8=-2342/193
BOT CHORD	2-13=-115/1986, 12-13=-115/1986, 11-12=-69/1789, 10-11=-72/1802, 9-10=-117/2027, 8-9=-117/2027
WEBS	3-12=-324/71, 4-12=-1/370, 4-11=-53/667, 5-11=-481/141, 6-11=-45/657, 6-10=-10/378, 7-10=-369/83


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 23-0-0, Zone2 23-0-0 to 27-2-15, Zone1 27-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 8 and 118 lb uplift at joint 2.

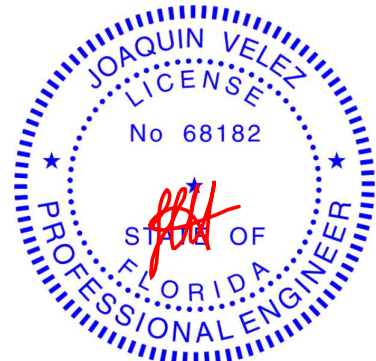

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:07 2025 Page 1
ID:nV5ZFUJaGJLK0I1jrAiSDcyHyrn-ZrtT1jOCPOuEv8SRDvNxZLBzgcc9aM1V1WADsozy5Jg
-2-0-0 6-4-12 11-0-0 16-0-0 21-0-0 25-7-4 32-0-0
2-0-0 6-4-12 4-7-4 5-0-0 5-0-0 4-7-4 6-4-12
Scale = 1:57.0

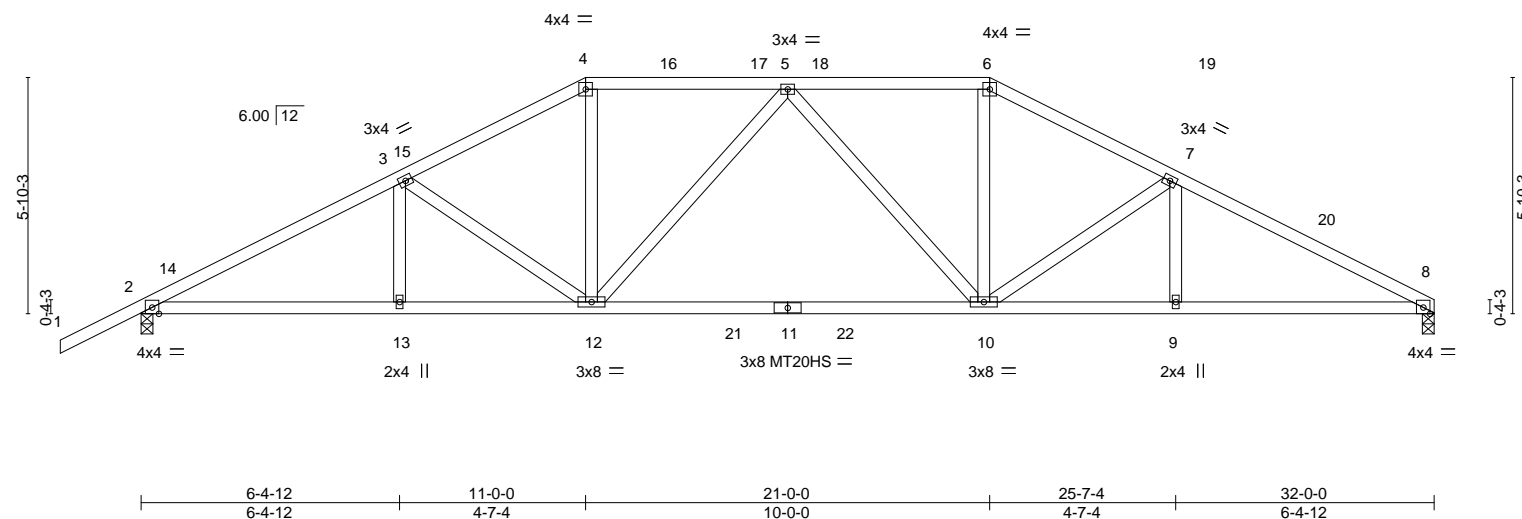

LOADING	(psf)	SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.75	Vert(LL)	-0.29	10-12	>999	360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.54	10-12	>706	240	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.31	Horz(CT)	0.08	8	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.06	10-12	>999	240	Weight: 164 lb	FT = 20%

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP M 31 or 2x4 SP SS
WEBS 2x4 SP No.2

TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

(size) 8=0-3-8, 2=0-3-8
 Max Horz 2=104(LC 11)
 Max Uplift 8=-53(LC 12), 2=-118(LC 12)
 Max Grav 8=1405(LC 18), 2=1525(LC 17)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=2550/191, 3-4=2108/188, 4-5=1853/190, 5-6=1861/188, 6-7=2119/192,
7-8=2569/198

BOT CHORD 2-13=122/2263, 12-13=122/2263, 10-12=88/1987, 9-10=123/2230, 8-9=123/2230

WEBS 3-12=476/93, 4-12=5/704, 5-12=327/75, 5-10=320/70, 6-10=87/12, 7-10=511/104

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl.; GCp=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 11-0-0, Zone2 11-0-0 to 15-2-15, Zone1 15-2-15 to 21-0-0, Zone2 21-0-0 to 25-2-15, Zone1 25-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 8 and 118 lb uplift at joint 2.

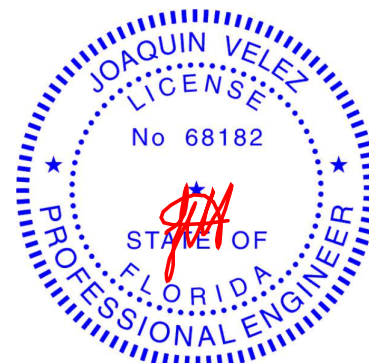

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970796
6243111	A04	Hip	1	1		

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:08 2025 Page 1

ID:nV5ZFUJaGJLKOI1jrAiSDcyHym-11RrE3OqAi05Xl1emDuA5Yk50?v6JmTeFAvmPEzy5Jf

Job Reference (optional)



Scale = 1:58.4

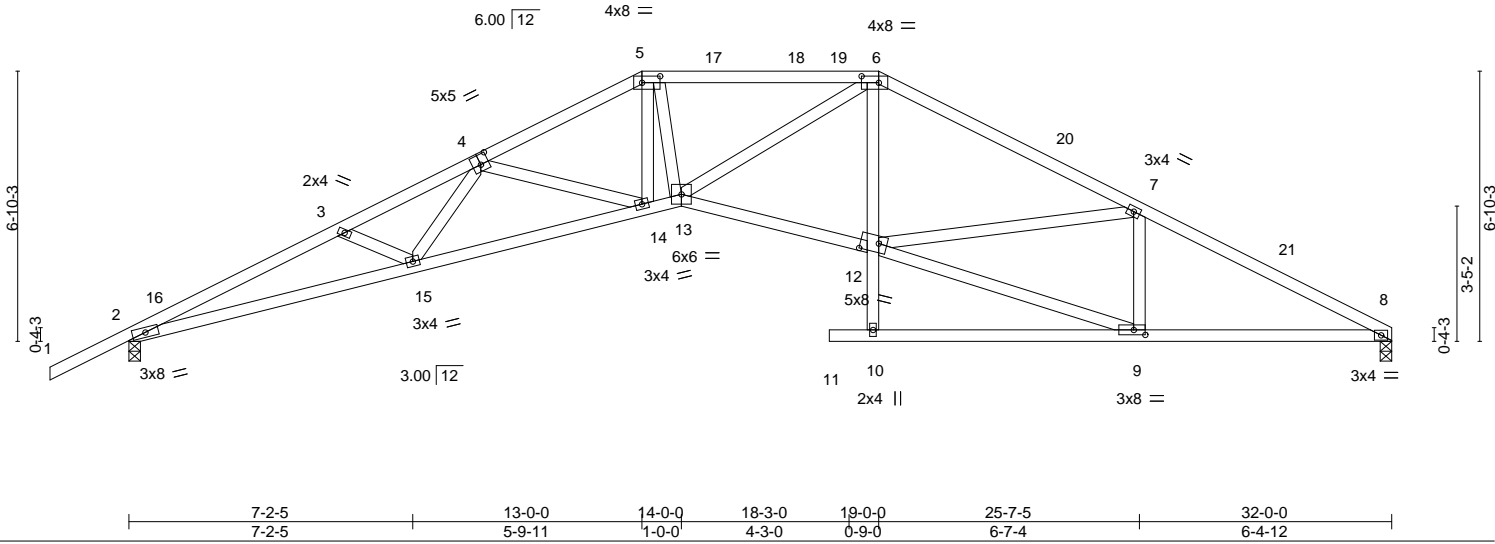


Plate Offsets (X,Y)--	[4:0-2-8,0-3-0], [5:0-5-8,0-2-0], [6:0-5-4,0-2-0], [9:0-3-8,0-1-8], [12:0-5-8,0-2-12]
-----------------------	---


LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.90	Vert(LL)	-0.29 14-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25		BC 0.70	Vert(CT)	-0.60 14-15	>631	240		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.49	Horz(CT)	0.37 8	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.17 14-15	>999	240	Weight: 170 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
2-13: 2x4 SP M 31 or 2x4 SP SS	
WEBS 2x4 SP No.2	

REACTIONS.	(size) 8=0-3-8, 2=0-3-8
	Max Horz 2=120(LC 11)
	Max Uplift 8=45(LC 12), 2=113(LC 12)
	Max Grav 8=1277(LC 1), 2=1411(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=4301/297, 3-4=4072/254, 4-5=3311/220, 5-6=3168/215, 6-7=2632/198, 7-8=2404/176
BOT CHORD	2-15=237/3860, 14-15=168/3569, 13-14=55/3006, 12-13=38/2361, 8-9=106/2088
WEBS	4-15=0/379, 4-14=566/107, 5-14=15/416, 5-13=0/788, 6-13=15/1043, 9-12=111/2179, 6-12=0/312, 7-12=1/334, 7-9=521/125

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 13-0-0, Zone2 13-0-0 to 17-2-15, Zone1 17-2-15 to 19-0-0, Zone2 19-0-0 to 23-2-15, Zone1 23-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 8 and 113 lb uplift at joint 2.

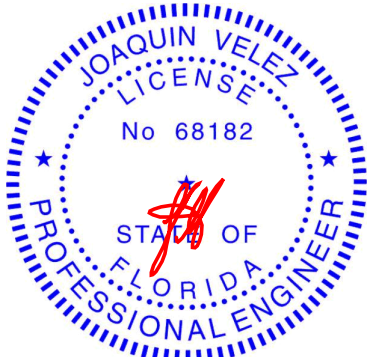

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970797
6243111	A05	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:08 2025 Page 1

ID:nV5ZFUJaGJLK0l1jrAiSDcyHym-11RrE3OqAi05Xl1emDuA5Yk5y?vYJmfeFAvmPEzy5Jf



Scale = 1:57.5


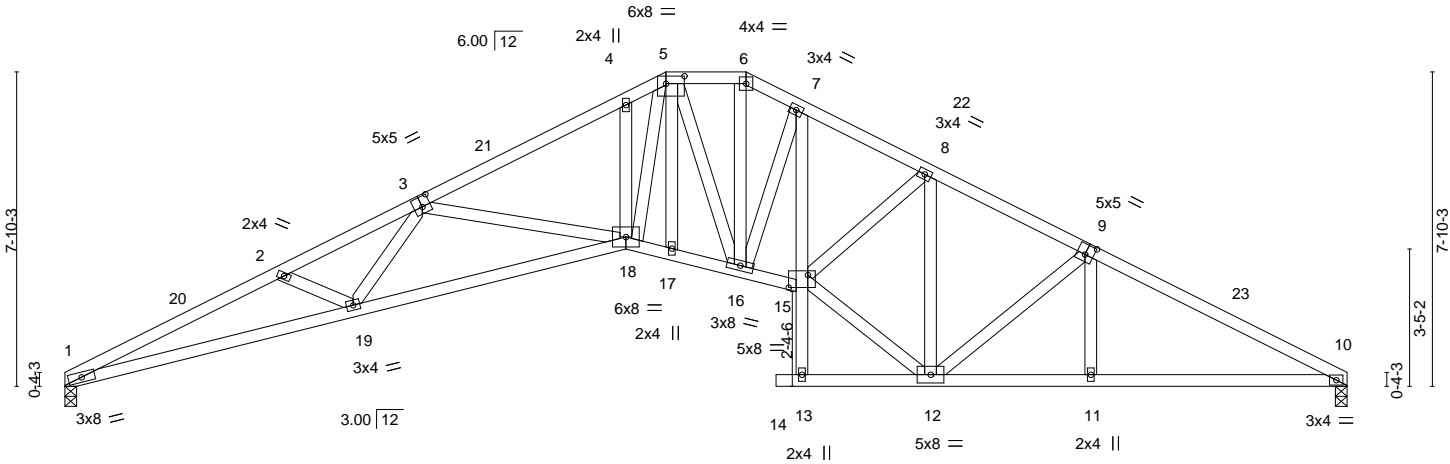



Plate Offsets (X,Y)--		[3:0-2-8,0-3-0], [5:0-5-8,0-2-4], [9:0-2-8,0-3-0], [15:0-5-12,0-3-12]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.91
TCDL 10.0	Lumber DOL	1.25	BC 0.67
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.48
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.30 18-19 >999 360
			Vert(CT) -0.64 18-19 >590 240
			Horz(CT) 0.37 10 n/a n/a
			Wind(LL) 0.18 18-19 >999 240
			PLATES
			MT20
			GRIP
			244/190
			Weight: 195 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
1-18: 2x4 SP M 31 or 2x4 SP SS	10-0-0 oc bracing: 13-15
WEBS 2x4 SP No.2	

REACTIONS. (size) 1=0-3-8, 10=0-3-8
Max Horz 1=125(LC 11)
Max Uplift 1=52(LC 12), 10=51(LC 12)
Max Grav 1=1274(LC 1), 10=1276(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-4376/307, 2-3=-4153/254, 3-4=-3189/208, 4-5=-3179/277, 5-6=-2110/192,
6-7=-2335/208, 7-8=-2624/206, 8-9=-1973/193, 9-10=-2372/176
BOT CHORD 1-19=-245/3957, 18-19=-171/3612, 17-18=0/2389, 16-17=-6/2389, 15-16=-26/2324,
7-15=-25/591, 11-12=-103/2050, 10-11=-102/2054
WEBS 3-19=0/429, 3-18=-731/120, 4-18=-286/144, 5-16=-611/18, 6-16=-62/903, 7-16=-634/92,
12-15=-67/2126, 8-15=0/788, 8-12=-985/38, 9-12=-462/75, 5-18=-148/2005

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 15-0-0, Zone3 15-0-0 to 17-0-0, Zone2 17-0-0 to 21-2-15, Zone1 21-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 1 and 51 lb uplift at joint 10.

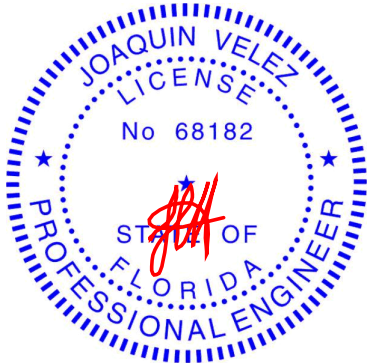

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:09 2025 Page 1

ID:nV5ZFUJaGJLKO1jrAISDcyHyrn-VE?DSPPTx?8y9ScqKwQPemHGkPEW2BRoUqfkhxzy5Je

5-5-9	8-11-0	14-0-0	16-0-0	18-3-0	25-7-5	32-0-0
5-5-9	3-5-7	5-1-0	2-0-0	2-3-0	7-4-5	6-4-11

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
	1-16: 2x4 SP M 31 or 2x4 SP SS		10-0-0 oc bracing: 12-14
WEBS	2x4 SP No.2		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=4378/367, 2-4=4152/303, 4-5=3185/231, 5-6=2273/231, 6-7=2290/229,
7-9=2649/227, 9-10=-2402/209

BOT CHORD 1-17=288/3959, 16-17=182/3601, 15-16=52/2870, 14-15=59/2333, 7-14=0/310,
10-11=-122/2087

WEBS 4-17=0/439, 4-16=725/123, 5-16=24/1775, 5-15=1796/152, 6-15=196/1942,
7-15=546/131, 11-14=145/2138, 9-14=12/266, 9-11=531/133

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCFL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 16-0-0, Zone2 16-0-0 to 20-2-15, Zone1 20-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 1 and 51 lb uplift at joint 10.

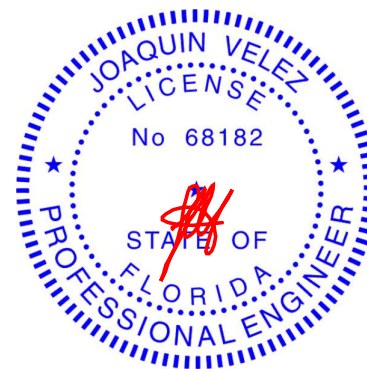

January 7, 2025




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970799
6243111	A07	Roof Special	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:10 2025 Page 1
ID:nV5ZFUJaGJLKOl1jrAiSDcyHyrn-zQZcfIQ5iJGpmcB0udxeAzpRRpaxnefxjUOtT7zy5Jd
5-5-9 8-11-0 14-0-0 16-0-0 19-0-2 25-7-4 32-0-0
5-5-9 3-5-7 5-1-0 2-0-0 3-0-2 6-7-2 6-4-12

Scale = 1:57.8

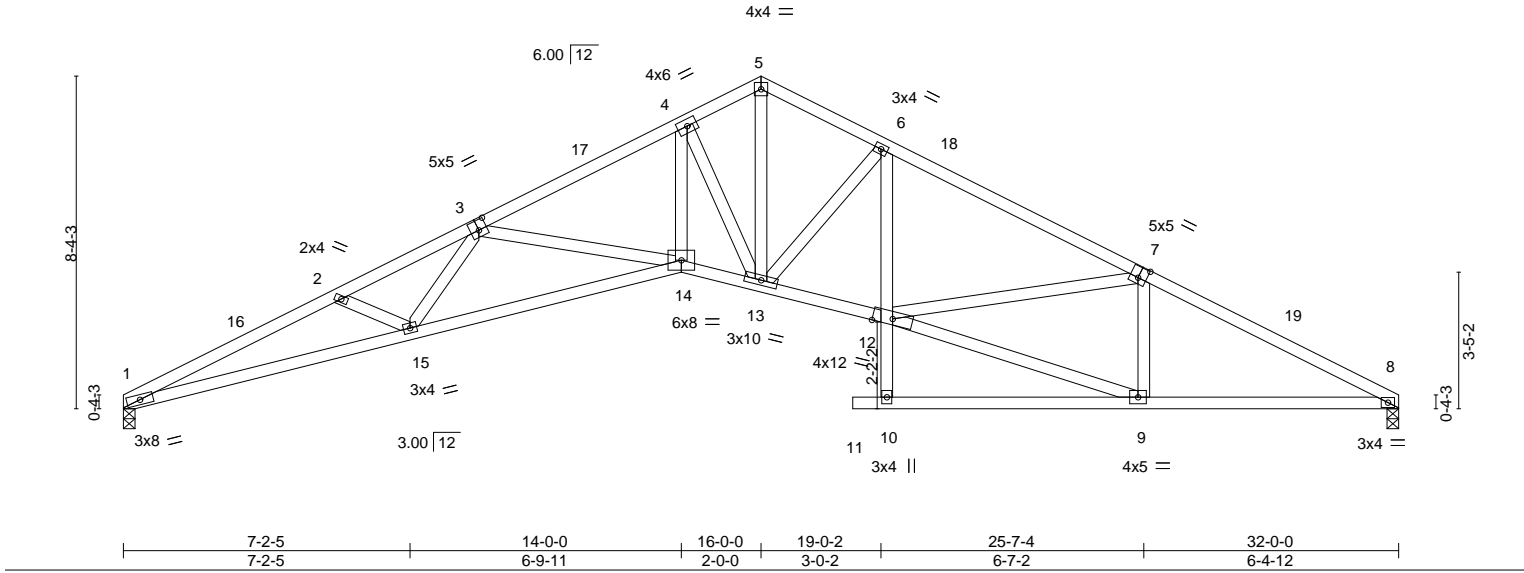

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:10 2025 Page 1
 ID:nV5ZFUJaGJLK01jrAiSDcyHym-zQZcfQ5iGpmcB0udxeAzpRTpZPnrxjUOtT7zy5Jd
 5-5-9 8-11-0 14-0-0 16-0-0 21-0-2 25-7-5 32-0-0
 5-5-9 3-5-7 5-1-0 2-0-0 5-0-2 4-7-3 6-4-11

[illegible]

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
	1-14: 2x4 SP M 31 or 2x4 SP SS		10-0-0 oc bracing; 10-12
WEBS	2x4 SP No.2		


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-4379/366, 2-3=-4154/302, 3-4=-3185/230, 4-5=-2275/225, 5-6=-2323/206,
6-7=-2788/232, 7-8=-2739/203

BOT CHORD 1-15=-286/3960, 14-15=-182/3603, 13-14=-54/2868, 12-13=-100/2541, 8-9=-113/2060

WEBS 3-15=0/439, 3-14=-726/125, 4-14=-36/1770, 4-13=-1765/149, 5-13=-132/1802,
6-13=-545/114, 9-12=-115/2160, 7-12=0/376, 7-9=-647/109

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl.; GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 16-0-0, Zone2 16-0-0 to 20-2-15, Zone1 20-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 1 and 49 lb uplift at joint 8.

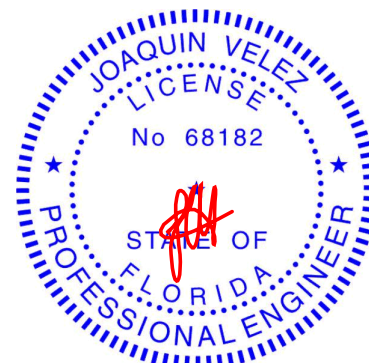

January 7, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:11 2025 Page 1
 ID:nV5ZFUJaGJLKOl1rAISDcyHym-Sc7_t5RjTdOgOmmDSLstjBMCDrYW6t5x88Q?Zzy5Jc
 5-5-9 8-11-0 14-0-0 16-0-0 23-0-2 23-7-7 28-0-0
 5-5-9 3-5-7 5-1-0 2-0-0 7-0-2 0-7-5 4-4-9



LUMBER-		BRACING-
TOP CHORD	2x4 SP No.2	TOP CHORD
BOT CHORD	2x4 SP No.2	BOT CHORD
WEBS	2x4 SP No.2	Structural wood sheathing directly applied, except end verticals. Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 1-12.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 16-0-0, Zone2 16-0-0 to 20-2-15, Zone1 20-2-15 to 27-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 1, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 46 lb uplift at joint 1 and 50 lb uplift at joint 8.



January 7, 2025

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970802
6243111	A10	Roof Special	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:11 2025 Page 1

ID:nV5ZFUJaGJLKO1j1rAiSDcyHyrm-Sc7_t5RjTdOgOmmDSLStjBMc_DrYW6s5x88Q?Zzy5Jc



Scale = 1:53.5

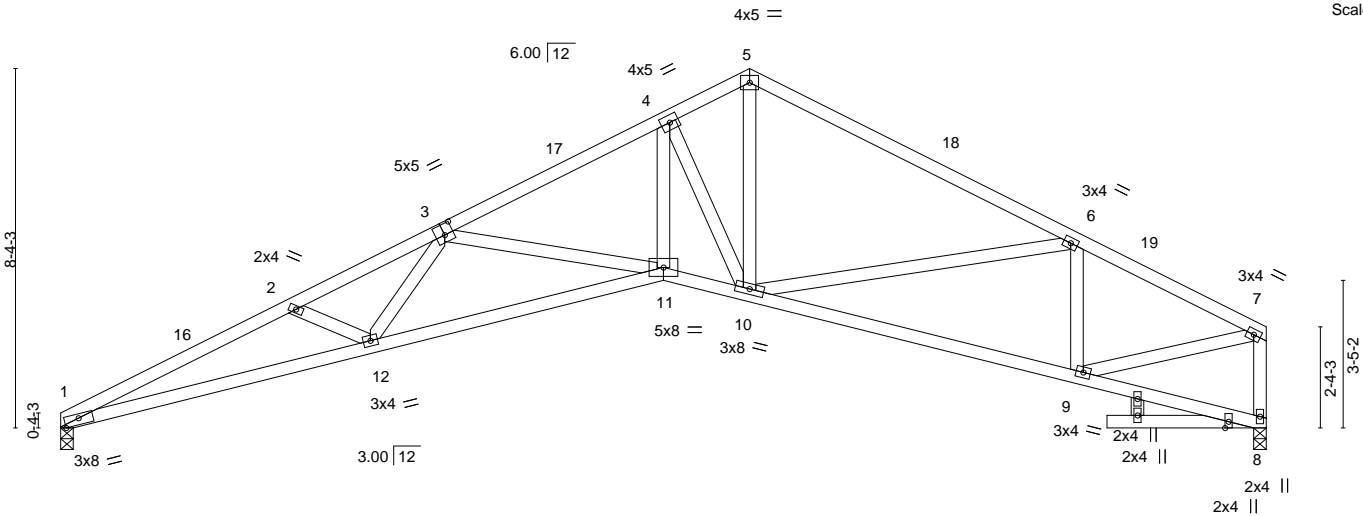


Plate Offsets (X,Y)-- [1:0-4-0,Edge], [3:0-2-8,0-3-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.92	Vert(LL)	-0.24 11-12	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25		BC 0.97	Vert(CT)	-0.53 11-12	>627	240		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.51	Horz(CT)	0.32 8	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.15 11-12	>999	240	Weight: 153 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
2-2-0 oc bracing: 1-12.

REACTIONS.


(size) 1=0-3-8, 8=0-3-8
Max Horz 1=115(LC 11)
Max Uplift 1=46(LC 12), 8=50(LC 12)
Max Grav 1=1108(LC 1), 8=1108(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3719/376, 2-3=-3482/313, 3-4=-2476/248, 4-5=-1707/220, 5-6=-1805/201,
6-7=-1525/170, 7-8=-1081/145
BOT CHORD 1-12=-349/3360, 11-12=-256/2977, 10-11=-130/2212, 9-10=-128/1409
WEBS 3-12=0/455, 3-11=-745/127, 4-11=-83/1445, 4-10=-1448/179, 5-10=-99/1210,
6-10=-14/277, 6-9=-547/141, 7-9=-118/1383

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 16-0-0, Zone2 16-0-0 to 20-2-15, Zone1 20-2-15 to 27-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 1, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 46 lb uplift at joint 1 and 50 lb uplift at joint 8.

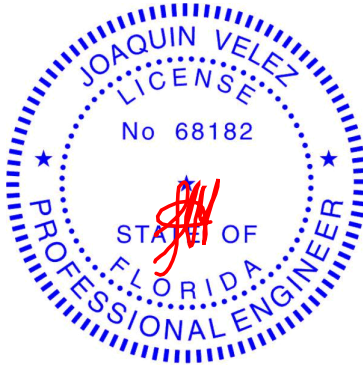

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970803
6243111	A11	Scissor	1	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:12 2025 Page 1

ID:nV5ZFUJaGJLK01jrAiSDcyHyrrn-wphM4RRLEwWX0wLP?2z6FOvnhdBnFZ6EAot_Y?zy5Jb



Scale = 1:53.5

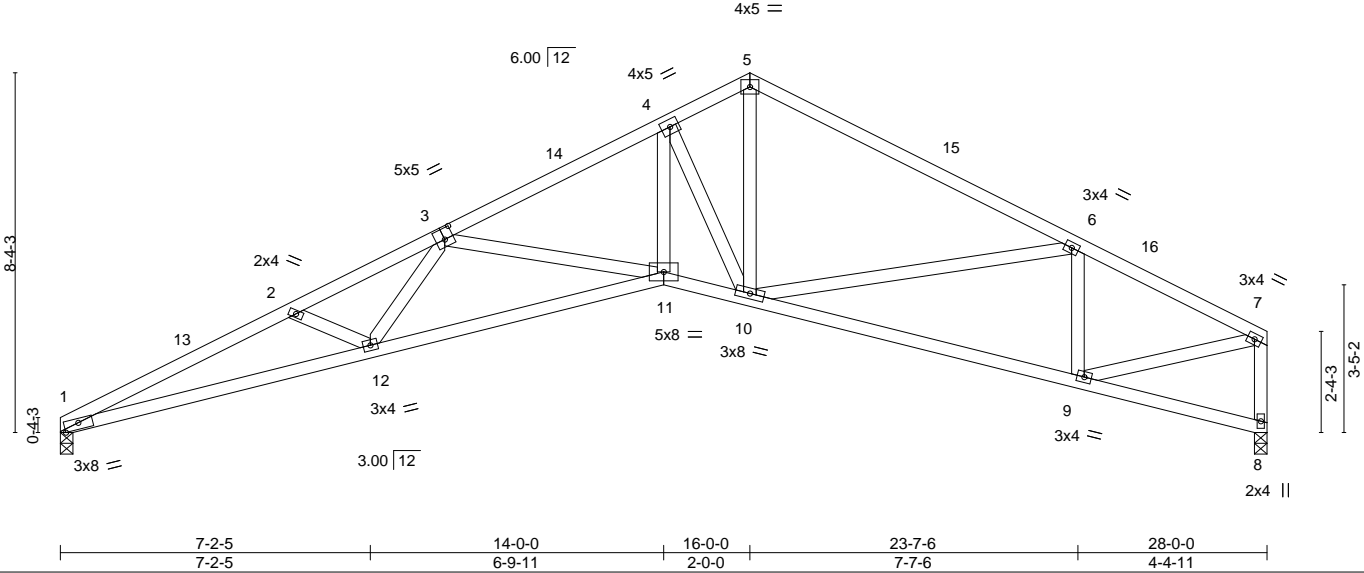


LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.93	Vert(LL)	-0.24 11-12 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.97	Vert(CT)	-0.53 11-12 >627 240				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.51	Horz(CT)	0.32 8 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		Wind(LL)	0.15 11-12 >999 240				
								Weight: 148 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.2		2-2-0 oc bracing: 1-12.

REACTIONS. (size) 1=0-3-8, 8=0-3-8
Max Horz 1=115(LC 11)
Max Uplift 1=46(LC 12), 8=50(LC 12)
Max Grav 1=1108(LC 1), 8=1108(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-3719/376, 2-3=-3482/313, 3-4=-2476/248, 4-5=-1707/220, 5-6=-1806/201, 6-7=-1524/170, 7-8=-1081/145
BOT CHORD 1-12=-349/3360, 11-12=-256/2977, 10-11=-130/2212, 9-10=-128/1408
WEBS 3-12=0/455, 3-11=-745/127, 4-11=-84/1445, 4-10=-1448/179, 5-10=-99/1210, 6-10=-13/278, 6-9=-548/141, 7-9=-118/1382

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 16-0-0, Zone2 16-0-0 to 20-2-15, Zone1 20-2-15 to 27-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 1, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 46 lb uplift at joint 1 and 50 lb uplift at joint 8.

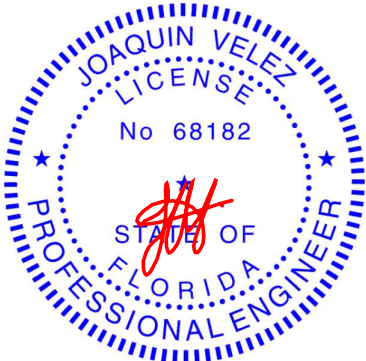

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970804
6243111	A12	Scissor	2	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:12 2025 Page 1

ID:nV5ZFUJaGJLKO1jrAIsDcyHyrn-wphM4RRLEwWX0wLP?2z6FOvndCnFaCEAot_Y?zy5Jb



Scale = 1:53.8

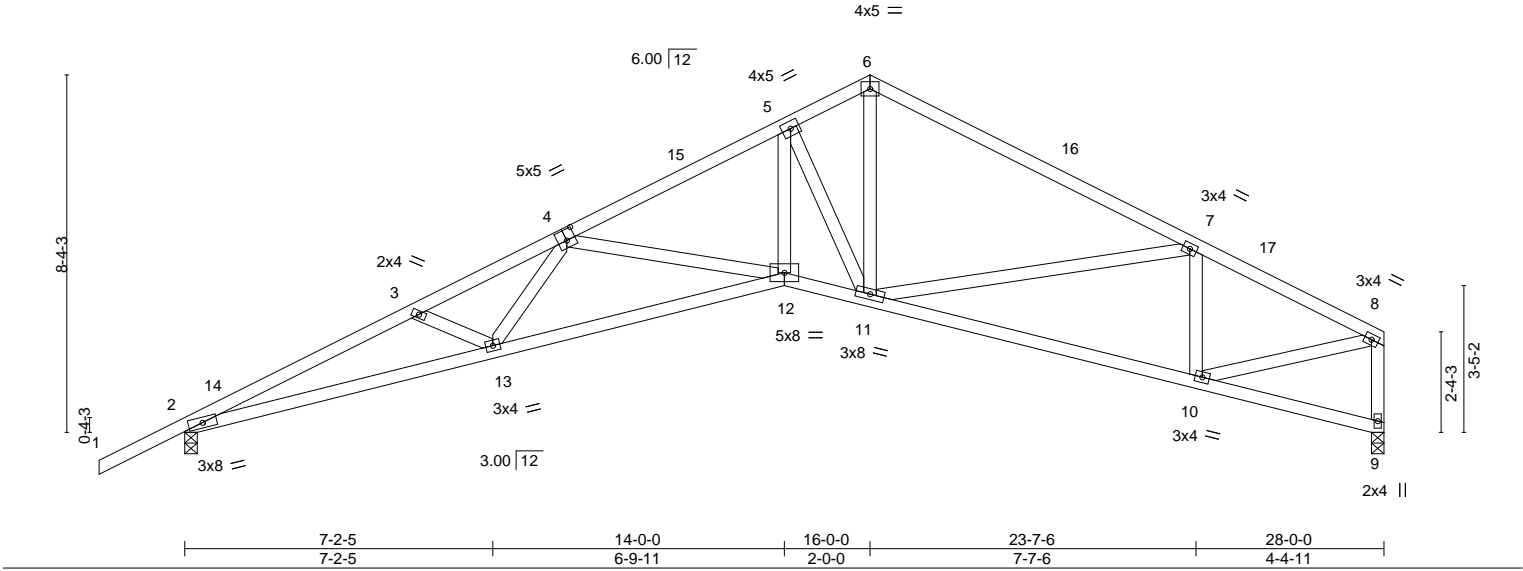


LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.92	Vert(LL)	-0.24 12-13 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.91	Vert(CT)	-0.53 12-13 >632 240				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.51	Horz(CT)	0.31 9 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		Wind(LL)	0.15 12-13 >999 240				
								Weight: 151 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 2=0-3-8, 9=0-3-8
Max Horz 2=127(LC 11)
Max Uplift 2=110(LC 12), 9=47(LC 12)
Max Grav 2=1242(LC 1), 9=1103(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3637/310, 3-4=-3407/271, 4-5=-2455/242, 5-6=-1693/216, 6-7=-1793/198,
7-8=-1517/168, 8-9=-1076/143
BOT CHORD 2-13=-298/3259, 12-13=-246/2936, 11-12=-125/2192, 10-11=-127/1401
WEBS 4-13=0/441, 4-12=-723/115, 5-12=-79/1428, 5-11=-1430/174, 6-11=-95/1197,
7-11=-15/273, 7-10=-545/138, 8-10=-109/1376

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 16-0-0, Zone2 16-0-0 to 20-2-15, Zone1 20-2-15 to 27-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 2, 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 110 lb uplift at joint 2 and 47 lb uplift at joint 9.

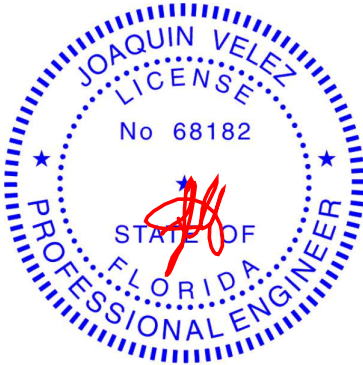

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970805
6243111	A13	Roof Special	2	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:13 2025 Page 1

ID:nV5ZFUJaGJLKO1jrAiSDcyHym-O?FkImSz_EeOd3vbZmULocR0i0cf_WNPSdX4Szy5Ja



Scale = 1:59.2

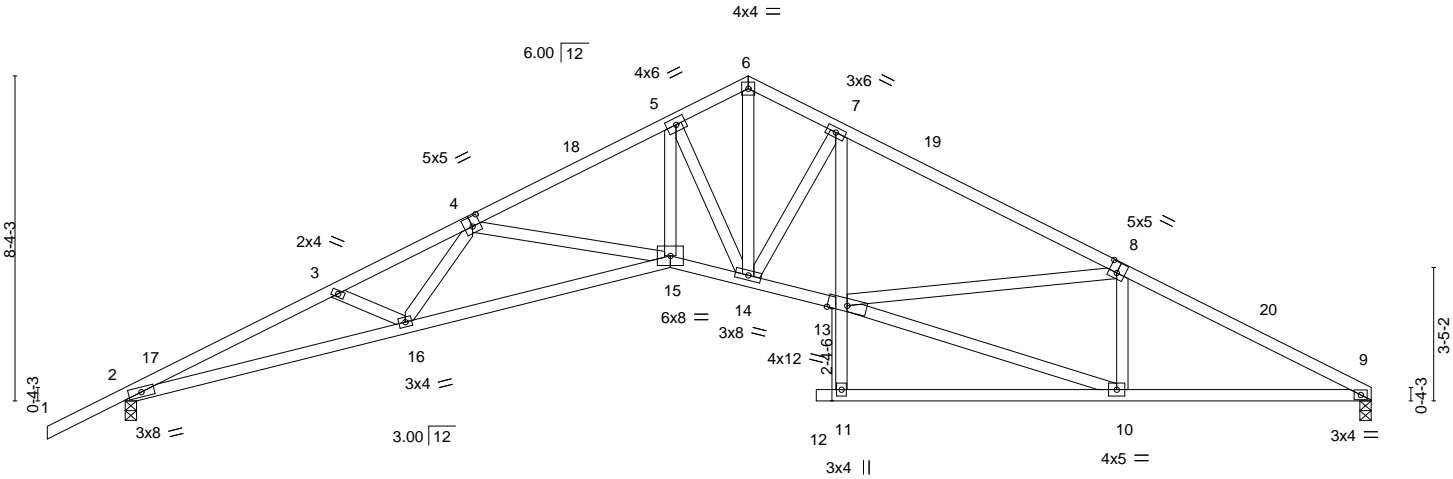

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:14 2025 Page 1
 ID:nV5ZFUJaGJLKO1jrAiSDcyHym-sBp6V6TbYmFFDUn7T?alP_7NQyijUmXe6M5cuzy5JZ
 2-0-0 5-5-9 8-11-0 15-0-0 17-0-0 22-6-0 25-7-4 32-0-0
 2-0-0 5-5-9 3-5-7 6-1-0 2-0-0 5-6-0 3-1-4 6-4-12


The diagram illustrates a roof truss system with the following dimensions and member labels:

- Overall Dimensions:**
 - Left vertical height: 7'-10"-3"
 - Right vertical height: 7'-10"-3"
 - Bottom horizontal span: 32'-0"-0"
 - Bottom horizontal segments: 7'-2'-5", 14'-0'-0", 15'-0'-0", 17'-0'-0", 22'-6'-0", 25'-7'-4", 32'-0'-0"
 - Bottom horizontal sub-segments: 7'-2'-5", 6'-9'-11", 1'-0'-0", 2'-0'-0", 5'-6'-0", 3'-1'-4", 6'-4'-12"
- Member Labels and Specifications:**
 - 1: 5x6 =
 - 2: 3x8 =
 - 3: 2x4 =
 - 4: 5x5 =
 - 5: 5x6 =
 - 6: 4x8 =
 - 7: 3x8 =
 - 8: 5x5 =
 - 9: 3x4 =
 - 10: 3x8 =
 - 11: 2x4 =
 - 12: 5x8
 - 13: 1'-3"-0"
 - 14: 3x4 =
 - 15: 6x6 =
 - 16: 3x4 =
 - 17: 3x4 =
 - 18: 3x8 =
 - 19: 5x5 =
 - 20: 3x8 =
 - 21: 5x5 =
- Other Labels:**
 - 6.00' | 12"
 - 3.00' | 12"
 - 0'-4'-3"
 - 3'-5'-2"


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
	2-16: 2x4 SP M 31 or 2x4 SP SS		10-0-0 oc bracing: 11-13
WEBS	2x4 SP No.2		

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl. GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 15-0-0, Zone3 15-0-0 to 17-0-0, Zone2 17-0-0 to 21-2-15, Zone1 21-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 116 lb uplift at joint 2 and 47 lb uplift at joint 9.

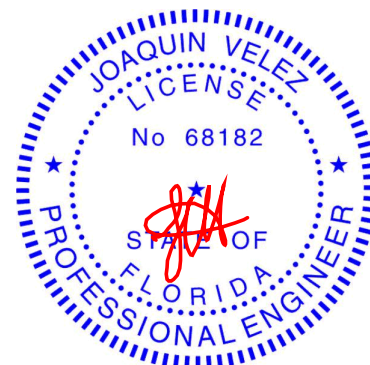

January 7, 2025




MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:14 2025 Page 1
ID:nV5ZFUJaGJLK01jrAiSDcyHym-sBp6V6TbYmFFDUn7T?alp_7SQy_jUrXe6M5scuzy5JZ
2-0-0 5-5-9 8-11-0 13-0-0 19-0-0 22-6-0 25-7-4 32-0-0
2-0-0 5-5-9 3-5-7 4-1-0 6-0-0 3-6-0 3-1-4 6-4-12

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
	2-15: 2x4 SP M 31 or 2x4 SP SS		10-0-0 oc bracing: 11-13
WEBS	2x4 SP No.2		

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl. GCp1=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 13-0-0, Zone2 13-0-0 to 17-2-15, Zone1 17-2-15 to 19-0-0, Zone2 19-0-0 to 23-2-15, Zone1 23-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 2 considers parallel to grain value using ANS/TP1 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 47 lb uplift at joint 9 and 116 lb uplift at joint 2.

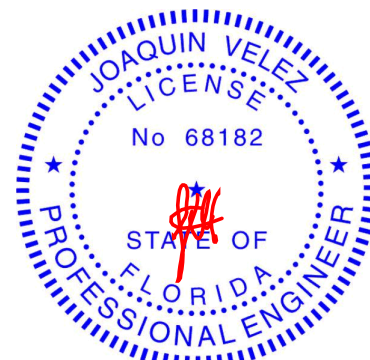

January 7, 2025




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970808
6243111	A16	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:15 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHym-KNMViSUDWru6tN3_hBWpt0XLfqK1S_0gsm6e8Kzy5JY

Scale = 1:57.0

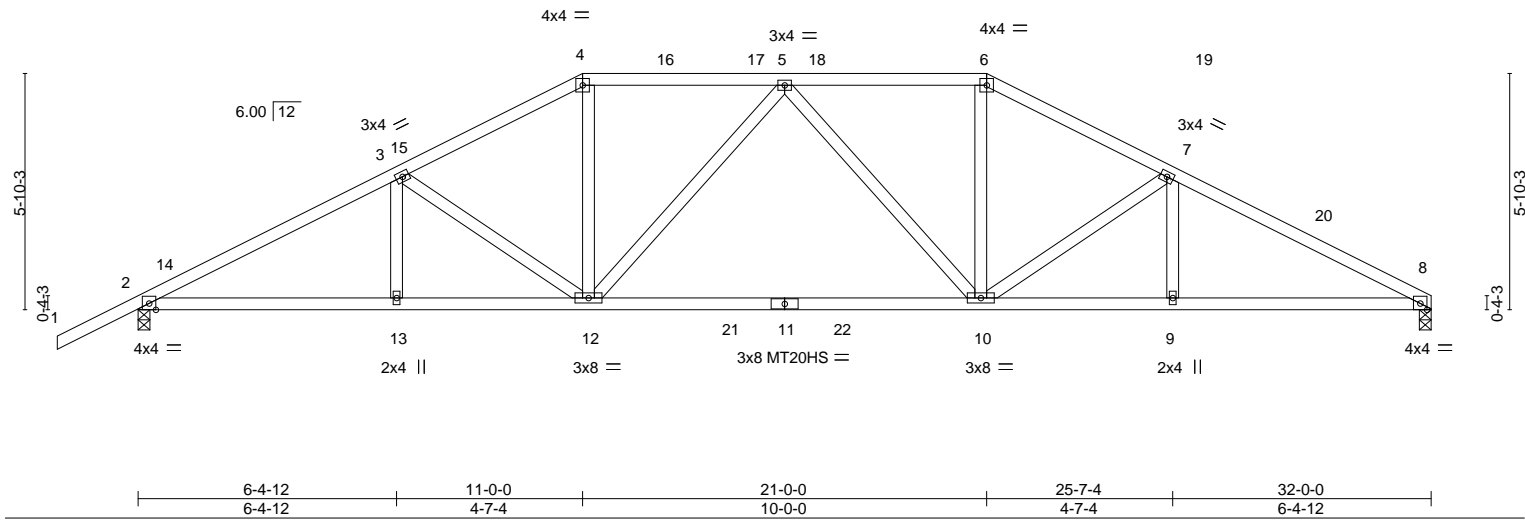


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.75	Vert(LL)	-0.29 10-12	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.49	Vert(CT)	-0.54 10-12	>706	240	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.25	WB 0.31	Horz(CT)	0.08 8	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.06 10-12	>999	240		
	Code FBC2023/TPI2014						Weight: 164 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x4 SP M 31 or 2x4 SP SS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 8=0-3-8, 2=0-3-8
Max Horz 2=104(LC 11)
Max Uplift 8=53(LC 12), 2=118(LC 12)
Max Grav 8=1405(LC 18), 2=1525(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2550/191, 3-4=-2108/188, 4-5=-1853/190, 5-6=-1861/188, 6-7=-2119/192, 7-8=-2569/198
BOT CHORD 2-13=-122/2263, 12-13=-122/2263, 10-12=-88/1987, 9-10=-123/2230, 8-9=-123/2230
WEBS 3-12=-476/93, 4-12=-5/704, 5-12=-327/75, 5-10=-320/70, 6-10=-8/712, 7-10=-511/104

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 11-0-0, Zone2 11-0-0 to 15-2-15, Zone1 15-2-15 to 21-0-0, Zone2 21-0-0 to 25-2-15, Zone1 25-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 8 and 118 lb uplift at joint 2.

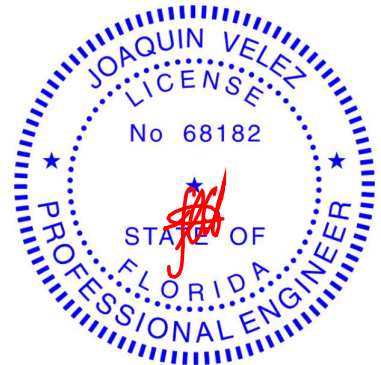

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:15 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHym-KNMVtSUDWru6tN3_hBWpt0XHqyGdSu4gsm6e8Kzy5JY
-2-0-0 | 6-4-13 | 9-0-0 | 16-8-9 | 24-3-7 | 32-0-0 |
2-0-0 | 6-4-13 | 2-7-4 | 7-8-9 | 7-6-13 | 7-8-9 |
Scale = 1:57.2

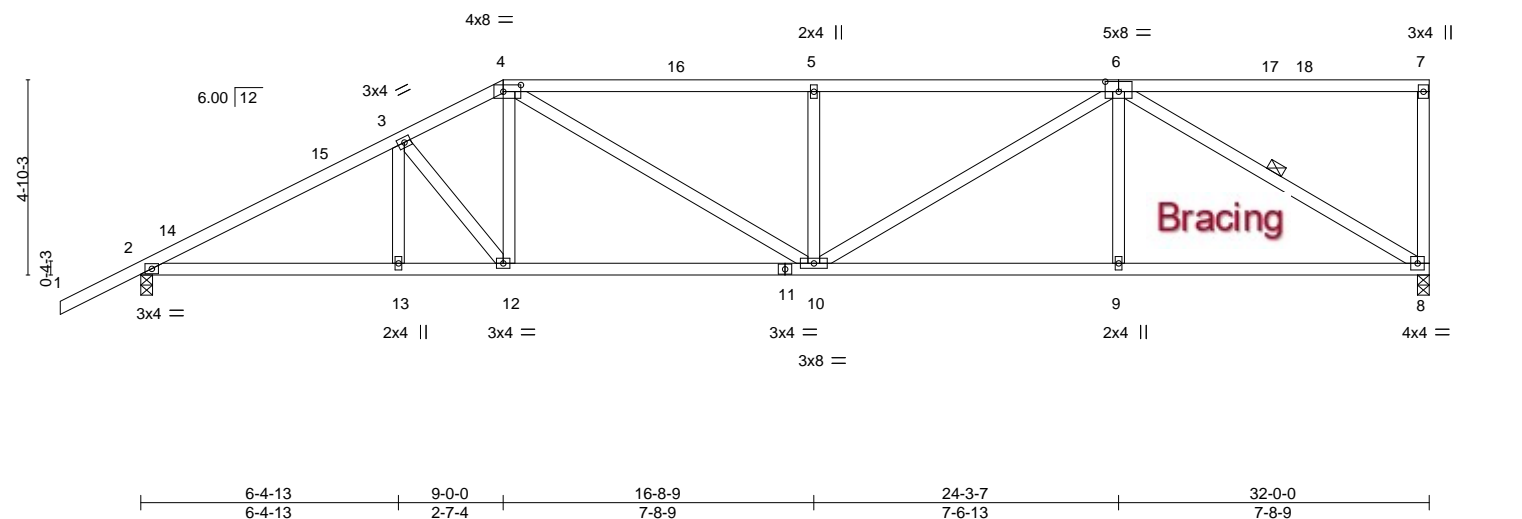


Plate Offsets (X,Y)-- [4:0-5-4,0-2-0], [6:0-4-0,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.99	Vert(LL)	-0.13 10 >999 360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.71	Vert(CT)	-0.31 10-12 >999 240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.09 8 n/a n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.08 10 >999 240	Weight: 173 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2	WEBS	1 Row at midbt 6-8

REACTIONS. (size) 8=0-3-8, 2=0-3-8
 Max Horz 2=144(LC 12)
 Max Uplift 8=-61(LC 12), 2=-110(LC 12)
 Max Grav 8=1264(LC 1), 2=1401(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=2321/150, 3-4=2041/166, 4-5=2277/171, 5-6=2277/171
BOT CHORD	2-13=205/1984, 12-13=205/1984, 10-12=159/1801, 9-10=118/1687, 8-9=118/1687
WEBS	3-12=304/71, 4-12=0/389, 4-10=25/553, 5-10=482/139, 6-10=67/688, 6-9=0/324, 6-8=1929/134

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 31-10-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 8 and 110 lb uplift at joint 2.



Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025



WARNING – verify design parameters and READ NOTES on this and INCLUDED MITER REFERENCE PLATE MP1473 (rev. 1/2/2025) BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and D5S-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbscomponents.com).

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970810
6243111	A18	HALF HIP GIRDER	1	2	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:17 2025 Page 1
ID:nV5ZFUJaGJLKOl1jrAISDcyHym-GmUF78VU2T8q6hDMobZHyRckPe?BwrTzK4bIDDzy5JW
-2-0-0 7-0-0 13-3-14 19-6-0 25-8-2 32-0-0
2-0-0 7-0-0 6-3-14 6-2-2 6-2-2 6-3-14

Scale = 1:57.2

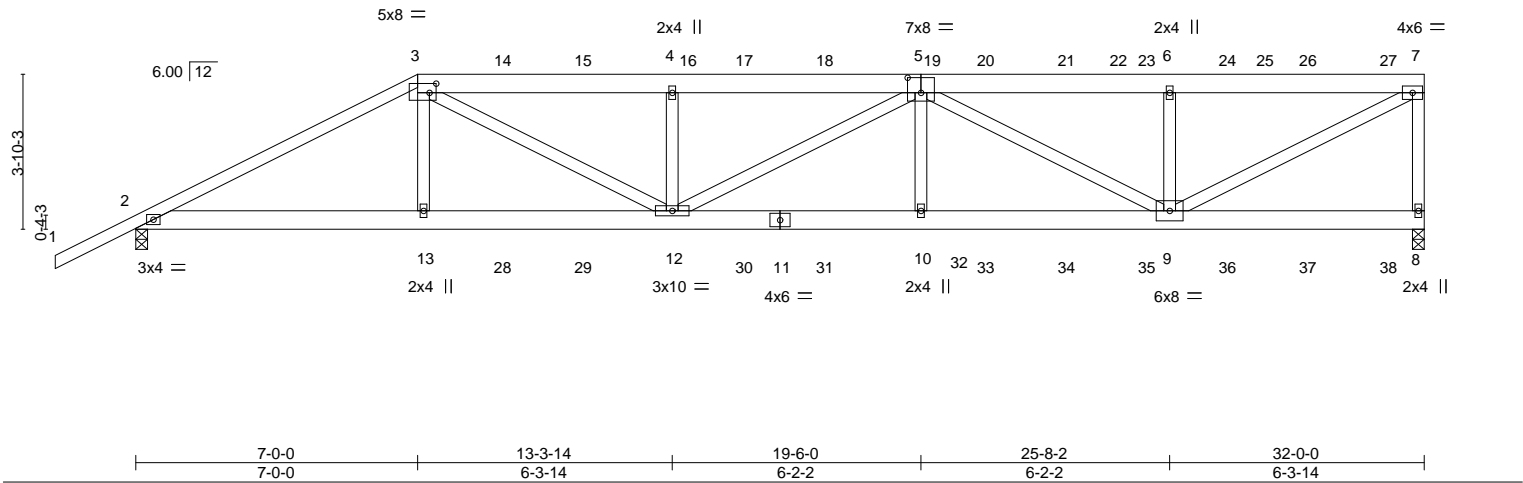

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.48	Vert(LL)	-0.15 10-12 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.57	Vert(CT)	-0.31 10-12 >999 240				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.51	Horz(CT)	0.07 8 n/a n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.10 10-12 >999 240				
								Weight: 419 lb		FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.2 *Except* 1-3: 2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-3-2 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 8=0-3-8, 2=0-3-8
Max Horz 2=119(LC 8)
Max Uplift 8=183(LC 8), 2=161(LC 8)
Max Grav 8=2649(LC 1), 2=2468(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-4736/182, 3-4=-6067/369, 4-5=-6065/368, 5-6=-3984/268, 6-7=-3984/268, 7-8=-2504/251
BOT CHORD 2-13=-188/4150, 12-13=-179/4170, 10-12=-385/5930, 9-10=-385/5930
WEBS 3-13=0/698, 3-12=-214/2238, 4-12=-850/263, 5-10=0/529, 5-9=-2220/133, 6-9=-815/272, 7-9=-301/4477

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (directional); cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 183 lb uplift at joint 8 and 161 lb uplift at joint 2.

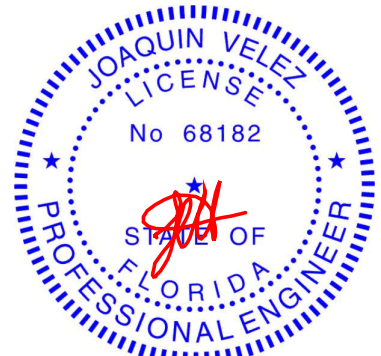

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai
6243111	A18	HALF HIP GIRDER	1	2	T35970810

Tibbetts Lumber Co., LLC (Ocala, FL),Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:17 2025 Page 2

ID:nV5ZFUJaGJLKOl1jrAISDcyHyrrn-GmUF78VU2T8q6hDMobZHyRckPe?BwrTzK4blDDzy5JW

NOTES-

10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 142 lb down and 86 lb up at 7-0-0, 123 lb down and 83 lb up at 9-0-12, 123 lb down and 83 lb up at 11-0-12, 123 lb down and 83 lb up at 13-0-12, 123 lb down and 83 lb up at 15-0-12, 123 lb down and 83 lb up at 17-0-12, 123 lb down and 83 lb up at 19-0-12, 123 lb down and 83 lb up at 21-0-12, 123 lb down and 83 lb up at 23-0-12, 123 lb down and 83 lb up at 25-0-12, 123 lb down and 83 lb up at 27-0-12, and 123 lb down and 83 lb up at 29-0-12, and 130 lb down and 81 lb up at 31-0-12 on top chord, and 311 lb down at 7-0-0, 96 lb down at 9-0-12, 96 lb down at 11-0-12, 96 lb down at 13-0-12, 96 lb down at 15-0-12, 96 lb down at 17-0-12, 96 lb down at 19-0-12, 96 lb down at 21-0-12, 96 lb down at 23-0-12, 96 lb down at 25-0-12, 96 lb down at 27-0-12, and 96 lb down at 29-0-12, and 100 lb down at 31-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-60, 3-7=-60, 2-8=-20

Concentrated Loads (lb)

Vert: 3=-123(B) 13=-264(B) 12=-48(B) 14=-123(B) 15=-123(B) 16=-123(B) 17=-123(B) 18=-123(B) 19=-123(B) 20=-123(B) 21=-123(B) 23=-123(B) 24=-123(B) 26=-123(B) 27=-130(B) 28=-48(B) 29=-48(B) 30=-48(B) 31=-48(B) 32=-48(B) 33=-48(B) 34=-48(B) 35=-48(B) 36=-48(B) 37=-48(B) 38=-50(B)


 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970811
6243111	C1	Corner Jack	10	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:17 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHyrrn-GmUF78VU2T8q6hDMobZHyRcnRe7_wyMzK4bIDDzy5JW

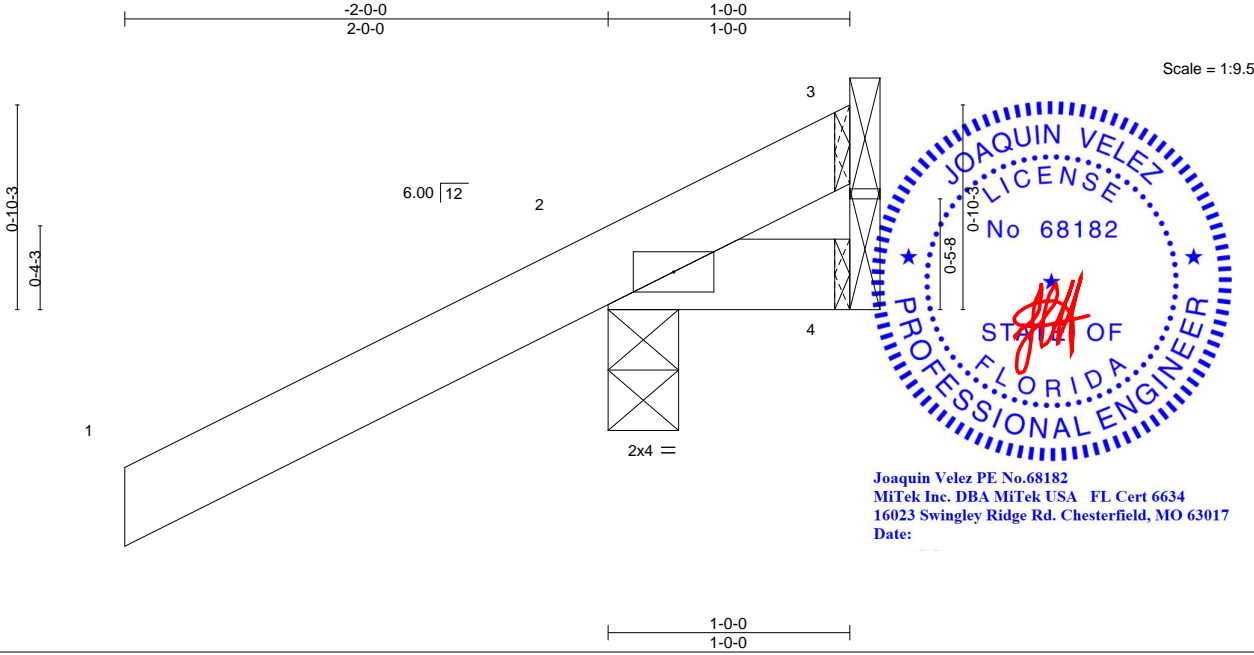

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.28	Vert(LL) -0.00 2	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.01	Vert(CT) -0.00 2	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P	Wind(LL) 0.00 2	****	240	Weight: 7 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=48(LC 12)
Max Uplift 3=100(LC 1), 2=133(LC 12)
Max Grav 3=67(LC 12), 2=289(LC 1), 4=19(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 3 and 133 lb uplift at joint 2.

January 7, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970812
6243111	C1L	Corner Jack	4	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:17 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHyrrn-GmUF78VU2T8q6hDMobZHyRcnRe7_wyMzK4bIDDzy5JW

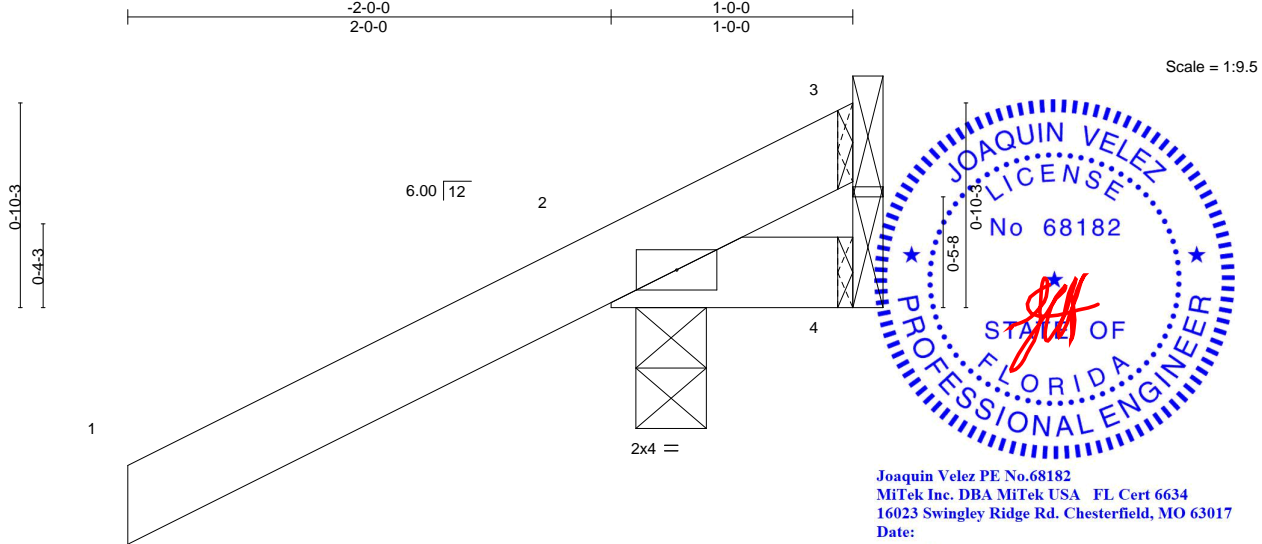

LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.28	Vert(LL)	-0.00 2 >999 360	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.01	Vert(CT)	-0.00 2 >999 240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00 3 n/a n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-P		Wind(LL)	0.00 2 >999 240	Weight: 7 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 2=0-3-8
Max Horz 2=48(LC 12)
Max Uplift 3=100(LC 1), 4=-2(LC 8), 2=-142(LC 12)
Max Grav 3=67(LC 12), 4=19(LC 3), 2=289(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 3, 2 lb uplift at joint 4 and 142 lb uplift at joint 2.

January 7,2025

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970813
6243111	C3	Corner Jack	9	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:18 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHyrm-ky2dLUW6pmGhkroZMJ4WVf9xV1S_fPc7YkKlIfzy5JV

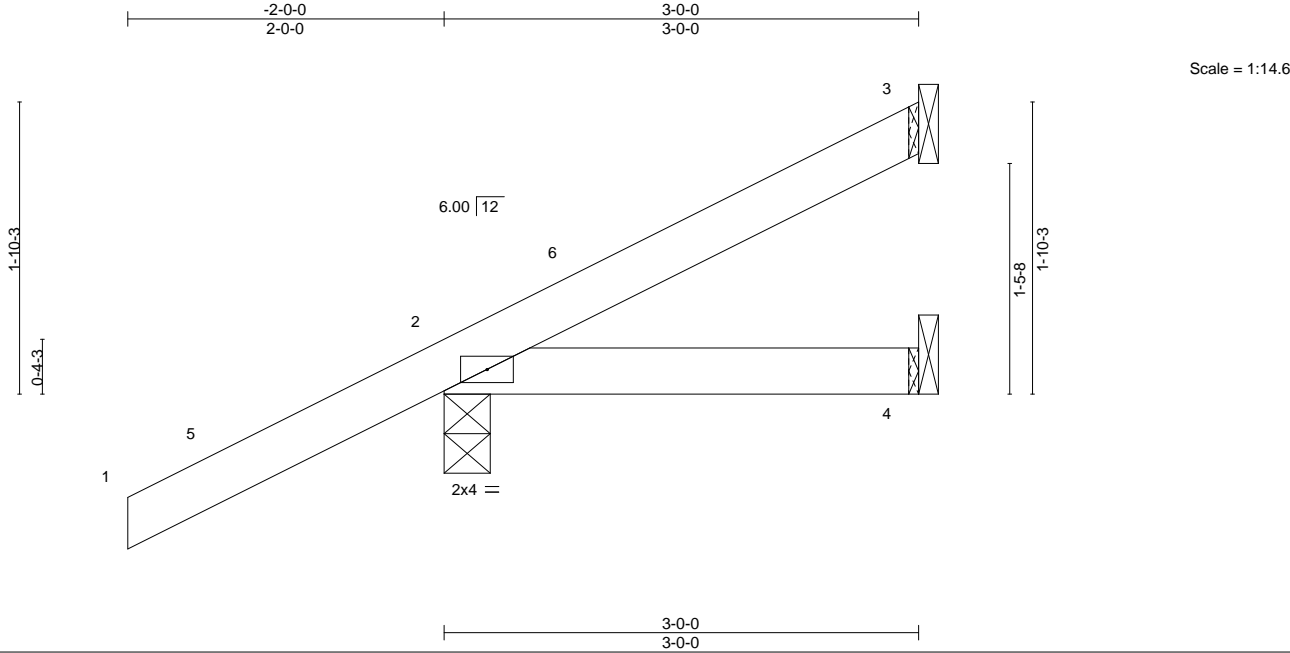

LOADING (psf)	SPACING-		CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.33		Vert(LL)	-0.00	2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09		Vert(CT)	-0.01	2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00		Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P		Wind(LL)	0.00	2	****	240	Weight: 13 lb	FT = 20%


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=71(LC 12)
Max Uplift 3=-14(LC 9), 2=-85(LC 12)
Max Grav 3=37(LC 17), 2=290(LC 1), 4=56(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 2-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 3 and 85 lb uplift at joint 2.

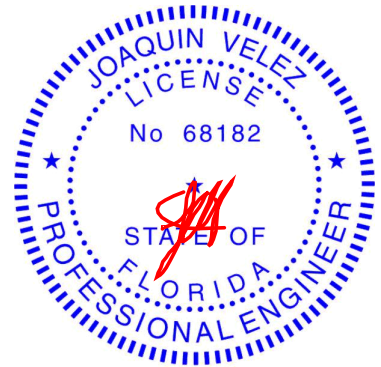

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970814
6243111	C3B	Corner Jack	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:18 2025 Page 1
ID:nV5ZFUJaGJLKOl1jrAiSDcyHyrrn-ky2dLUW6pmGhkroZMJ4WVf9_c1S_fPc7YkKlIfzy5JV

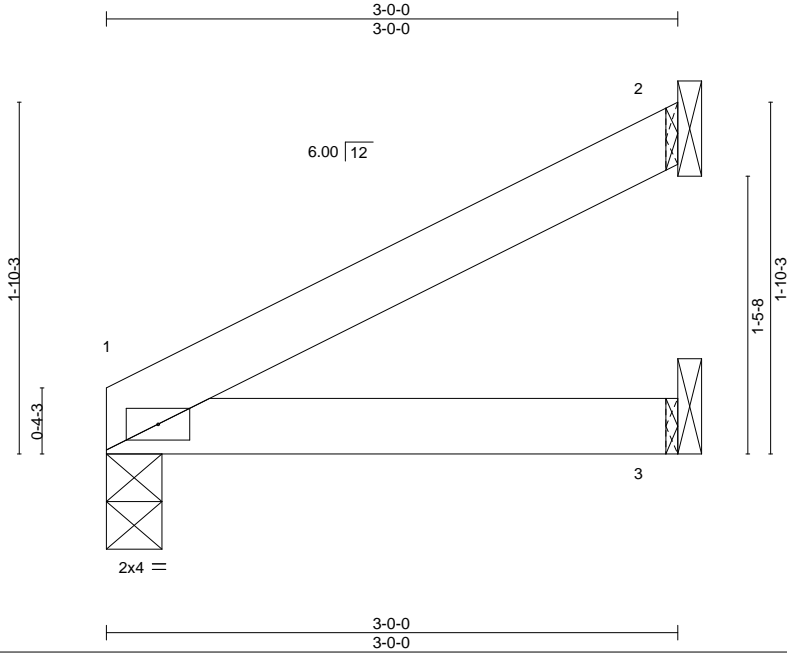

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.13	Vert(LL)	-0.00	1-3	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.09	Vert(CT)	-0.01	1-3	>999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	-0.00	2	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P	Wind(LL)	0.00	1	****	Weight: 10 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8, 2=Mechanical, 3=Mechanical
Max Horz 1=36(LC 12)
Max Uplift 2=-31(LC 12)
Max Grav 1=112(LC 1), 2=84(LC 1), 3=56(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 2.

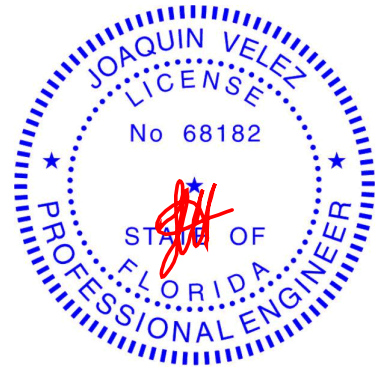

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970815
6243111	C3C	Corner Jack	2	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:19 2025 Page 1

ID:nV5ZFUJaGJLKO1jrAiSDcyHym-D9c?YqXka4OXL_Nlw0bl2sh6fRoDOrsGnO4rH6zy5JU


-2-0-0

2-0-0

3-0-0

3-0-0

Scale = 1:9.9

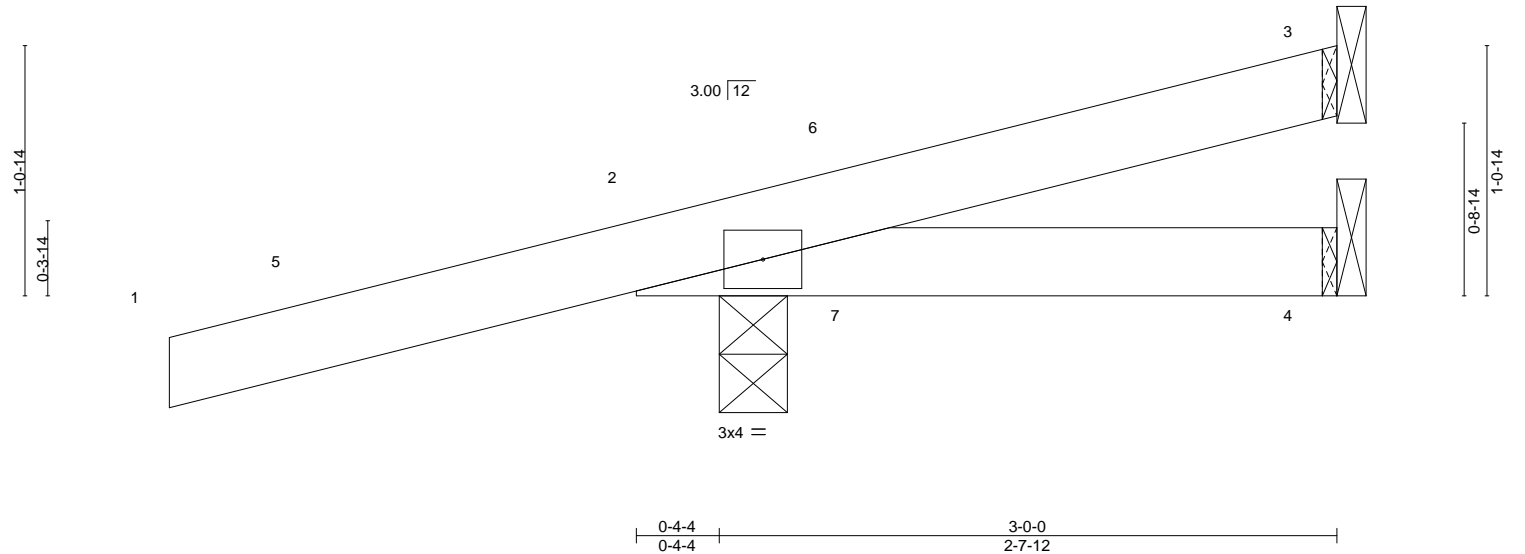


LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.37	Vert(LL)	-0.00	2-4	>999	360	MT20		244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.09	Vert(CT)	-0.01	2-4	>999	240			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	3	n/a	n/a			
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-P		Wind(LL)	0.00	2-4	>999	240			
											Weight: 12 lb		FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 2=0-3-8
Max Horz 2=35(LC 12)
Max Uplift 3=-9(LC 9), 4=-7(LC 8), 2=-111(LC 12)
Max Grav 3=34(LC 1), 4=56(LC 3), 2=290(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 2-11-4 zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 9 lb uplift at joint 3, 7 lb uplift at joint 4 and 111 lb uplift at joint 2.

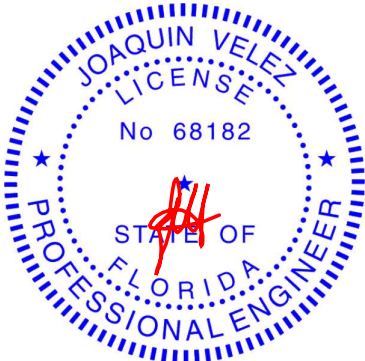

Joaquin Velez PE No.68182

MiTek Inc. DBA MiTek USA FL Cert 6634

16023 Swingley Ridge Rd. Chesterfield, MO 63017

Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd. Chesterfield, MO 63017 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970816
6243111	C3L	Corner Jack	4	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:19 2025 Page 1
ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-D9c?YqXka4OXL_Nlw0bl2sh6ERoDOrsGnO4rH6zy5JU

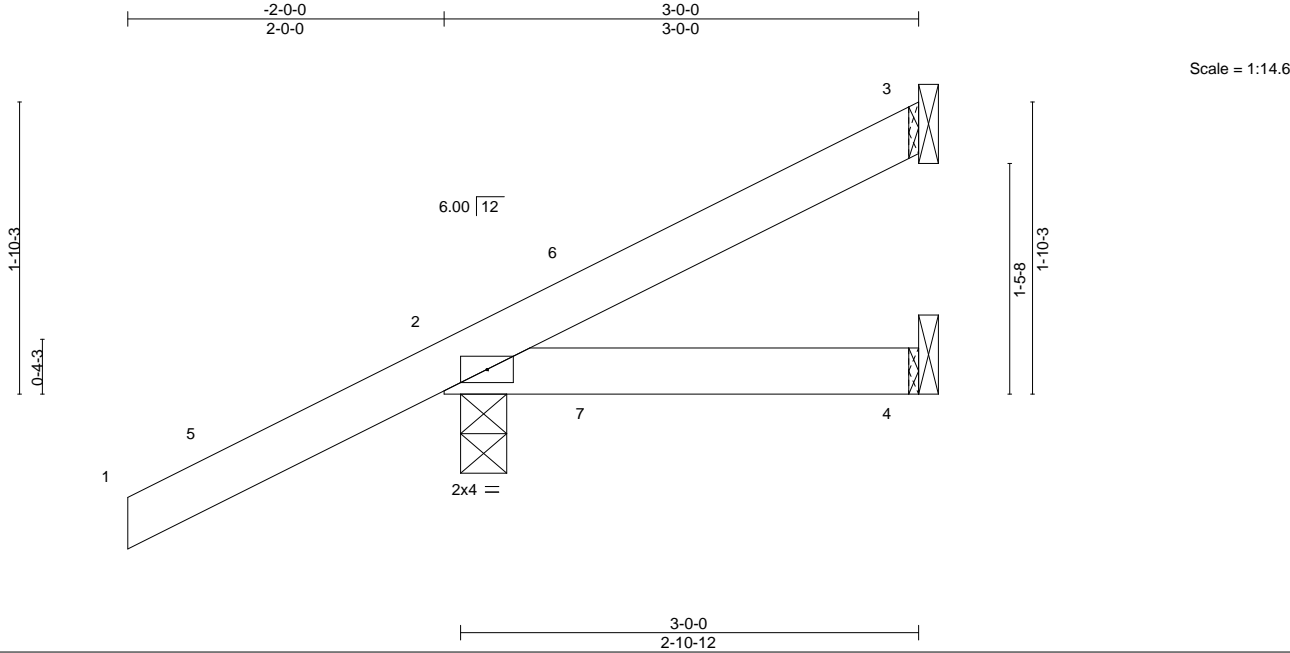


LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.33	Vert(LL)	-0.00	2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	-0.01	2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.00	2-4	>999	240	Weight: 13 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.	(size) 3=Mechanical, 4=Mechanical, 2=0-3-8
	Max Horz 2=71(LC 12)
	Max Uplift 3=14(LC 9), 4=7(LC 8), 2=109(LC 12)
	Max Grav 3=37(LC 17), 4=56(LC 3), 2=290(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 2-11-4 zone; cantilever left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 3, 7 lb uplift at joint 4 and 109 lb uplift at joint 2.

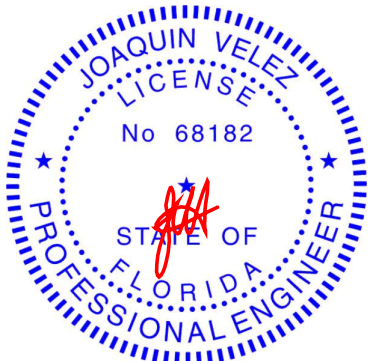

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970817
6243111	C5	Corner Jack	9	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:20 2025 Page 1
ID:nV5ZFUJaGJLK01jrAiSDcyHyrm-hLANmAYMLOXOz8yxTk6_a4EIDr5P7I6P02pPqYzy5JT

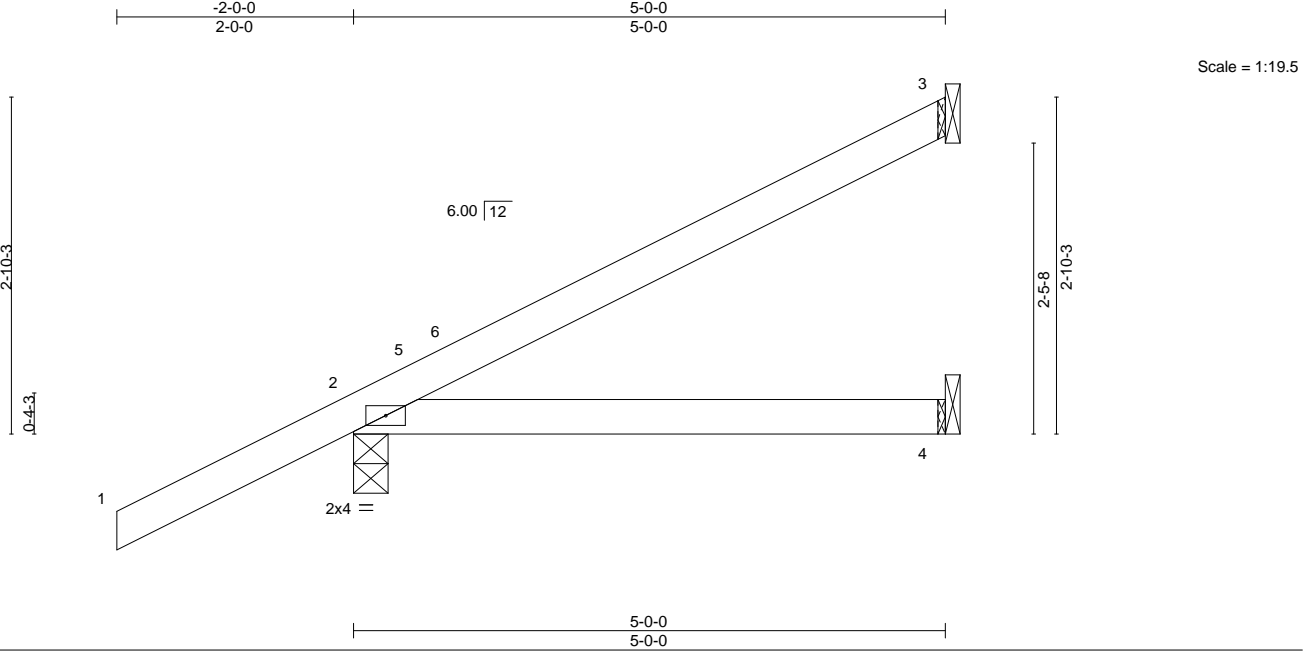


LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.31	Vert(LL) -0.03 2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.28	Vert(CT) -0.06 2-4	>909	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P	Wind(LL) 0.00 2	****	240	Weight: 19 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=95(LC 12)
Max Uplift 3=-36(LC 12), 2=-70(LC 12)
Max Grav 3=115(LC 1), 2=349(LC 1), 4=96(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 3 and 70 lb uplift at joint 2.

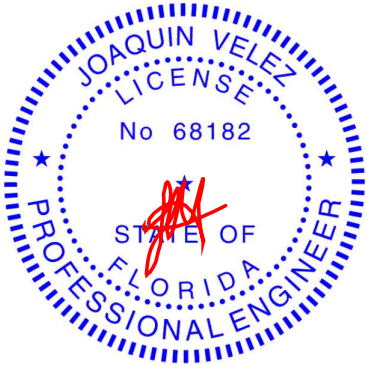

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970818
6243111	C5B	Corner Jack	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:20 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHyrn-hLANmAYMLOXOz8yxTk6_a4EGdr5P7I6P02pPqYzy5JT

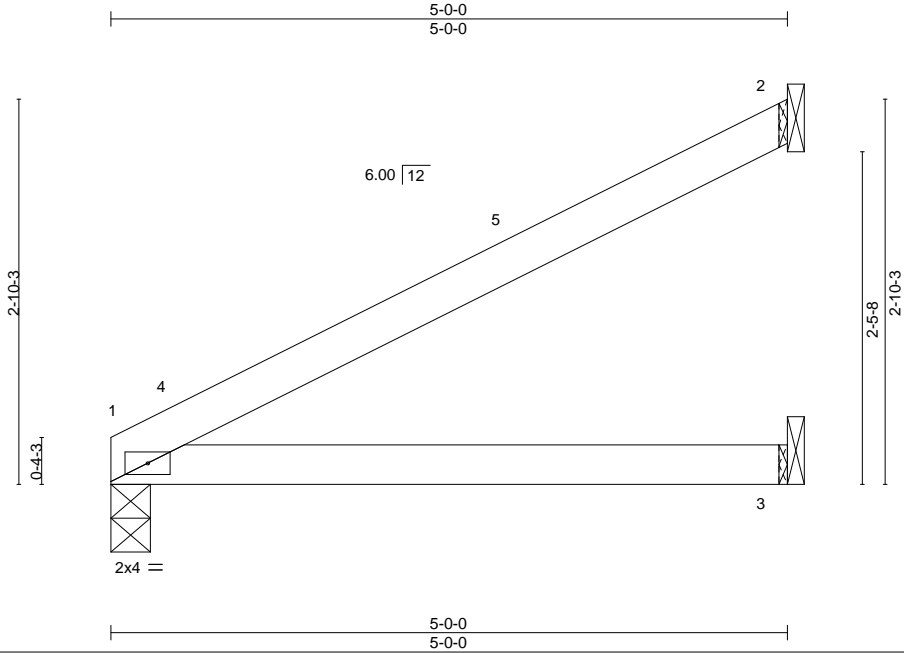


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.42	Vert(LL) -0.03	1-3	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.28	Vert(CT) -0.06	1-3	>909	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00	2	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P	Wind(LL) 0.00	1	****	240	Weight: 16 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8, 2=Mechanical, 3=Mechanical
Max Horz 1=60(LC 12)
Max Uplift 2=-53(LC 12)
Max Grav 1=192(LC 1), 2=144(LC 1), 3=96(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 4-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 2.

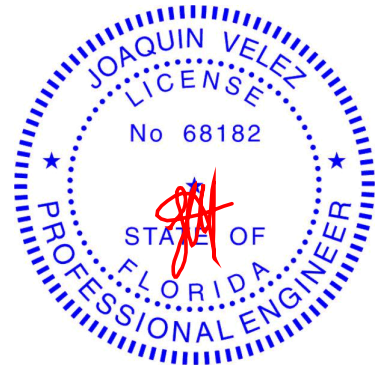

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970819
6243111	C5C	Corner Jack	2	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),
Ocala, FL - 34472,
8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:21 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHym-9XkmzVY_6hfFbIX81RdD7HmQ5FResIMZFizyM_zy5JS



Scale = 1:13.6

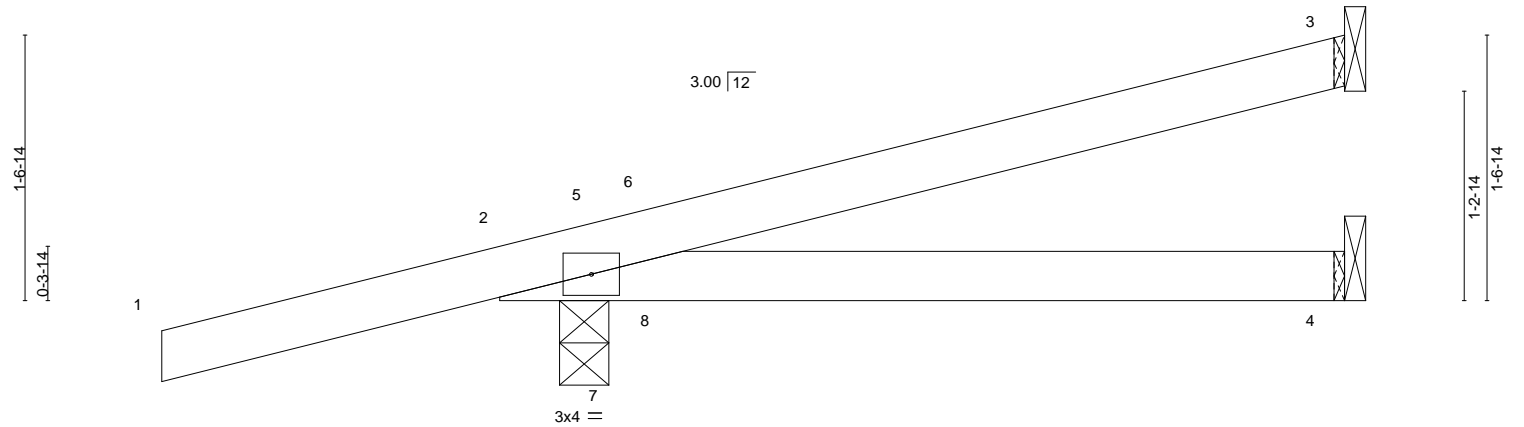


			0-4-4	5-0-0						
			0-4-4	4-7-12						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.50	Vert(LL)	-0.03	2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.28	Vert(CT)	-0.06	2-4	>909	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P	Wind(LL)	0.03	2-4	>999	240	Weight: 18 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 2=0-3-8
Max Horz 2=47(LC 12)
Max Uplift 3=-27(LC 12), 4=-12(LC 8), 2=-120(LC 12)
Max Grav 3=115(LC 1), 4=96(LC 3), 2=349(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-11-4 zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 3, 12 lb uplift at joint 4 and 120 lb uplift at joint 2.

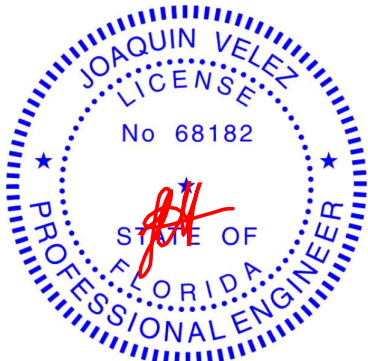

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970820
6243111	E5L	Jack-Open	3	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:21 2025 Page 1


ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-9XkmzVY_6hfFbIX81RdD7HmTzFResIMZFizM_zy5JS

2-0-0

2-0-0

5-0-0

5-0-0

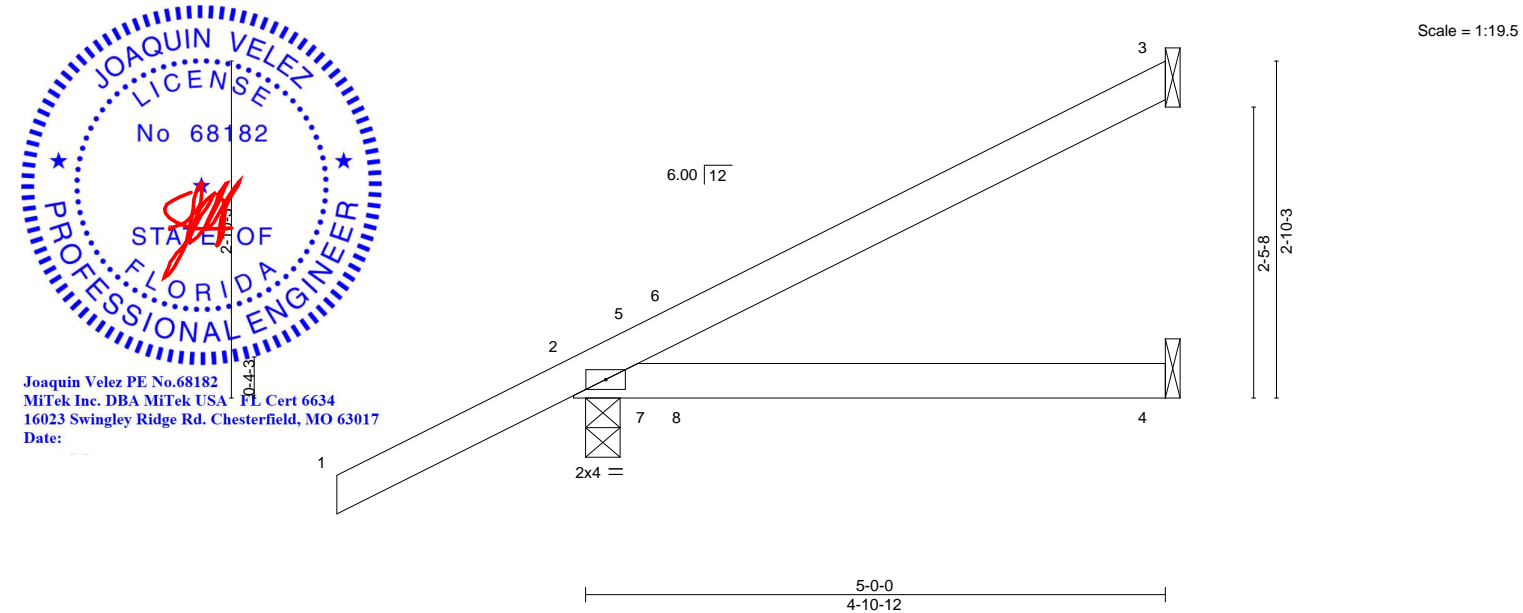

LOADING (psf)	SPACING-		CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.31		Vert(LL)	-0.03	2-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.28		Vert(CT)	-0.06	2-4	>909	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00		Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P		Wind(LL)	0.03	2-4	>999	240	Weight: 19 lb	FT = 20%

LUMBER-		BRACING-
TOP CHORD 2x4 SP No.2		TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD 2x4 SP No.2		BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 2=0-3-8

Max Horz 2=95(LC 12)

Max Uplift 3=-36(LC 12), 4=-12(LC 8), 2=-111(LC 12)

Max Grav 3=115(LC 1), 4=96(LC 3), 2=349(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-

1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 4-11-4 zone; cantilever left and right exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.

3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.


5) Refer to girder(s) for truss to truss connections.

6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 3, 12 lb uplift at joint 4 and 111 lb uplift at joint 2.

January 7,2025

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970821
6243111	E7	Jack-Open	27	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:21 2025 Page 1
ID:nV5ZFUJaGJLK01jrAiSDcyHyrrn-9XkmzVY_6hfFblX81RdD7HmMgFMdsIMZFizyM_zy5JS

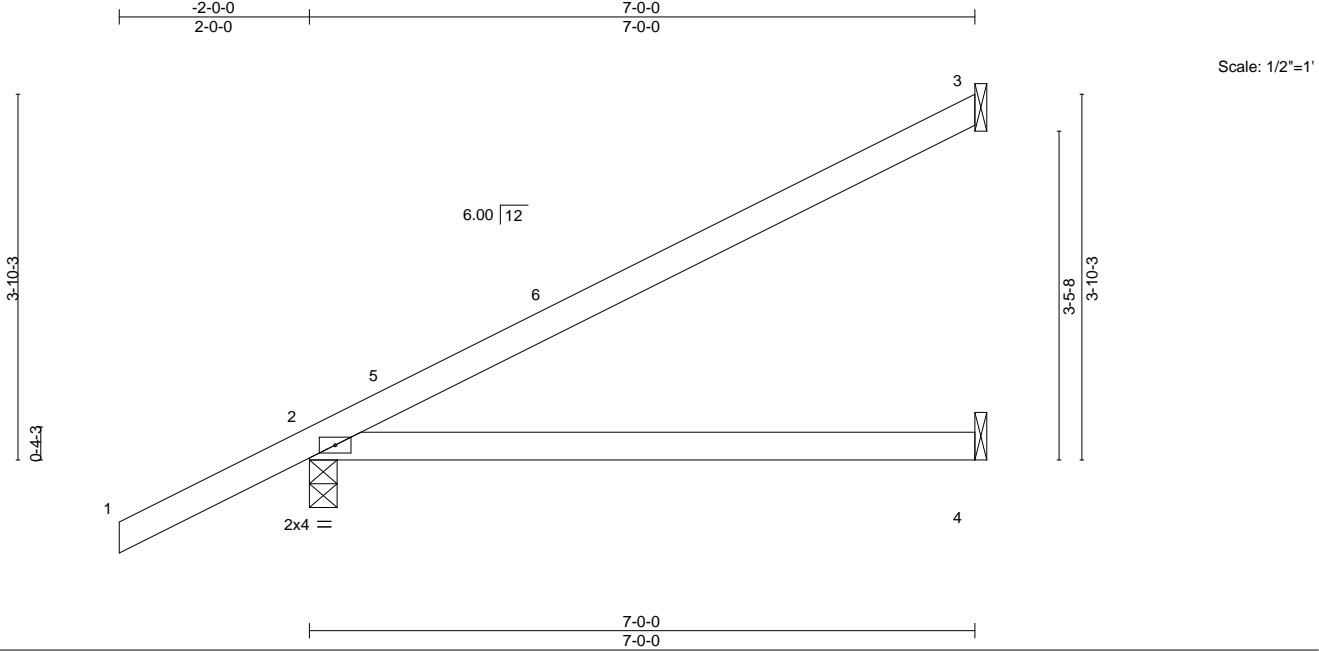


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.72	Vert(LL) -0.13	2-4	>639	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.60	Vert(CT) -0.26	2-4	>319	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P	Wind(LL) 0.00	2	****	240	Weight: 26 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.	(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=119(LC 12)	
Max Uplift 3=-62(LC 12), 2=-63(LC 12)	
Max Grav 3=183(LC 1), 2=421(LC 1), 4=136(LC 3)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
---------	--

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 6-11-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 3 and 63 lb uplift at joint 2.

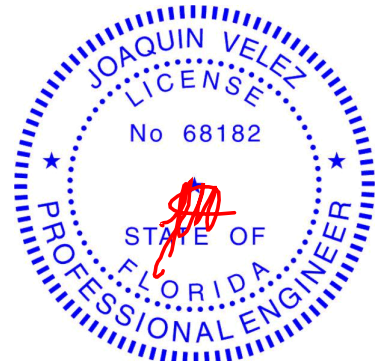

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970822
6243111	G01	Hip Girder	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:22 2025 Page 1
ID:nV5ZFUJaGJLKO1jraAiSDcyHyrm-dkH8ArZct?n6CS5Kb99SFVJZhfeYbATITMIWuQzy5JR
-2-0-0 7-0-0 10-0-0 13-0-0 20-0-0 22-0-0
2-0-0 7-0-0 3-0-0 3-0-0 7-0-0 2-0-0

Scale = 1:39.1

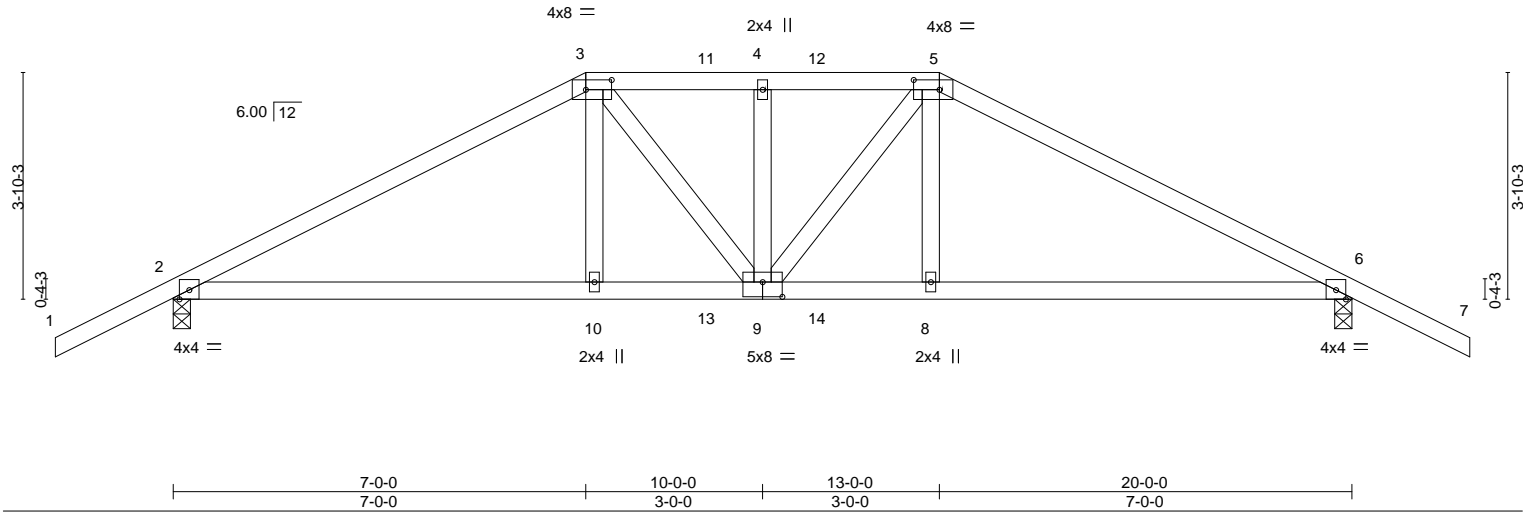

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.64	Vert(LL)	-0.09 6-8 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.82	Vert(CT)	-0.20 6-8 >999 240				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.14	Horz(CT)	0.07 6 n/a n/a				
BCDL	10.0	Code FBC2023/TP12014		Matrix-S		Wind(LL)	0.04 9 >999 240				
								Weight: 96 lb		FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP M 31 or 2x4 SP SS *Except* 3-5: 2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-5-8 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=-74(LC 6)
Max Uplift 2=-79(LC 8), 6=-88(LC 8)
Max Grav 2=1504(LC 1), 6=1528(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2507/5, 3-4=-2333/57, 4-5=-2333/57, 5-6=-2559/24
BOT CHORD 2-10=0/2139, 9-10=0/2157, 8-9=0/2204, 6-8=0/2186
WEBS 3-10=0/611, 3-9=-128/362, 4-9=-337/120, 5-9=-59/277, 5-8=0/611

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 79 lb uplift at joint 2 and 88 lb uplift at joint 6.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 142 lb down and 86 lb up at 7-0-0, 123 lb down and 83 lb up at 9-0-12, and 123 lb down and 83 lb up at 10-11-4, and 251 lb down and 170 lb up at 13-0-0 on top chord, and 311 lb down at 7-0-0, 96 lb down at 9-0-12, and 96 lb down at 10-11-4, and 311 lb down at 12-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-60, 3-5=-60, 5-7=-60, 2-6=-20
Concentrated Loads (lb)
Vert: 3=-123(F) 5=-204(F) 10=-264(F) 8=-264(F) 11=-123(F) 12=-123(F) 13=-48(F) 14=-48(F)

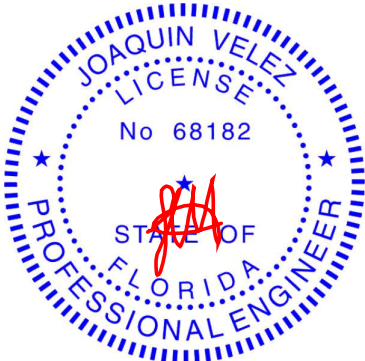

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970823
6243111	G02	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:23 2025 Page 1
ID:nV5ZFJJJaGJLKO1jrAiSDcyHym-5wrWOBaFeJvzqcgW9sghCiskL21pKdGsi023Rtzy5JQ



Scale = 1:39.1

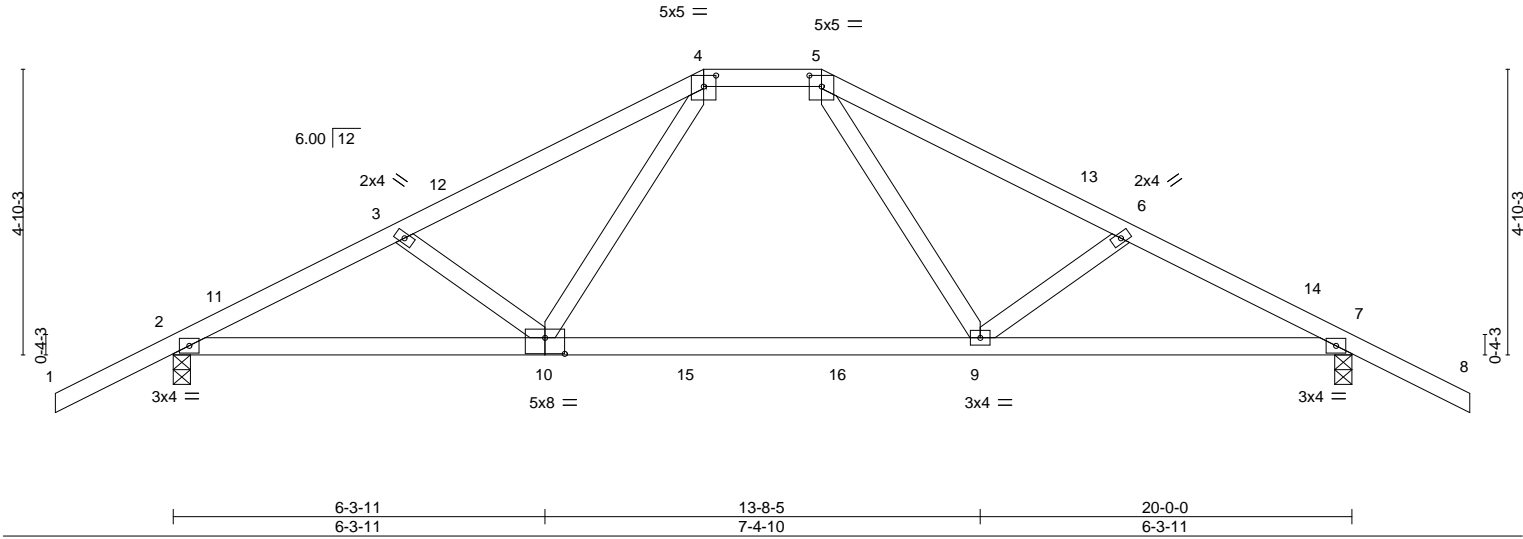

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.58	Vert(LL)	-0.10 9-10 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.62	Vert(CT)	-0.41 9-10 >578 240				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.17	Horz(CT)	0.04 7 n/a n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	-0.03 10 >999 240				
								Weight: 94 lb		FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-10-14 oc purlins.
BOT CHORD	2x4 SP M 31 or 2x4 SP SS	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 2=0-3-8, 7=0-3-8
Max Horz 2=-91(LC 10)
Max Grav 2=1217(LC 17), 7=1217(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2052/0, 3-4=-1875/0, 4-5=-1246/0, 5-6=-1875/0, 6-7=-2053/0
BOT CHORD 2-10=0/1834, 9-10=0/1277, 7-9=0/1767
WEBS 4-10=0/759, 5-9=0/759

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-0-0, Zone3 9-0-0 to 11-0-0, Zone2 11-0-0 to 15-2-15, Zone1 15-2-15 to 22-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified.
Building designer must review loads to verify that they are correct for the intended use of this truss.

- LOAD CASE(S)** Standard
- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 4-5=-60, 5-8=-60, 2-10=-20, 9-10=-80, 7-9=-20
 - Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-50, 4-5=-50, 5-8=-50, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35
 - Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 5-8=-20, 2-10=-40, 9-10=-100, 7-9=-40

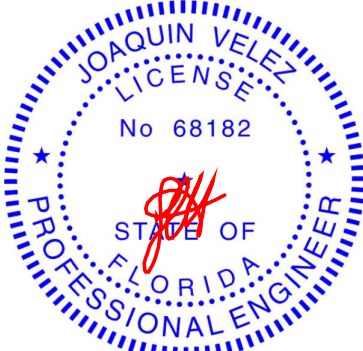

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970823
6243111	G02	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:23 2025 Page 2
ID:nV5ZFUJaGJLKO1JrAiSDcyHym-5wrWOBaFeJvzqcgW9sghCiskL21pKdGsi023Rtzy5JQ

LOAD CASE(S) Standard

- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=37, 2-11=21, 4-11=16, 4-5=21, 5-13=21, 7-13=16, 7-8=12, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-46, 2-11=-30, 4-11=-25, 5-13=30, 7-13=25, 7-8=20
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=12, 2-12=16, 4-12=21, 4-5=21, 5-14=16, 7-14=21, 7-8=37, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-20, 2-12=-25, 4-12=-30, 5-14=25, 7-14=30, 7-8=46
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-4=-32, 4-5=-32, 5-7=-32, 7-8=-28, 2-10=-20, 9-10=-80, 7-9=-20
Horz: 1-2=-13, 2-4=12, 5-7=-12, 7-8=-8
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-28, 2-4=-32, 4-5=-32, 5-7=-32, 7-8=-7, 2-10=-20, 9-10=-80, 7-9=-20
Horz: 1-2=8, 2-4=12, 5-7=-12, 7-8=13
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-4=3, 4-5=14, 5-7=9, 7-8=4, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-24, 2-4=-11, 5-7=17, 7-8=13
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=4, 2-4=9, 4-5=14, 5-7=3, 7-8=15, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-13, 2-4=-17, 5-7=11, 7-8=24
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-24, 2-4=-28, 4-5=-21, 5-7=-12, 7-8=-7, 2-10=-20, 9-10=-80, 7-9=-20
Horz: 1-2=4, 2-4=8, 5-7=8, 7-8=13
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-4=-12, 4-5=-21, 5-7=-28, 7-8=-24, 2-10=-20, 9-10=-80, 7-9=-20
Horz: 1-2=-13, 2-4=-8, 5-7=-8, 7-8=-4
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=28, 2-4=15, 4-5=15, 5-7=15, 7-8=28, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-37, 2-4=-24, 5-7=24, 7-8=37
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-4=3, 4-5=3, 5-7=3, 7-8=15, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-24, 2-4=-11, 5-7=11, 7-8=24
- 14) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-16, 2-4=-21, 4-5=-21, 5-7=-21, 7-8=-16, 2-10=-20, 9-10=-80, 7-9=-20
Horz: 1-2=-4, 2-4=1, 5-7=-1, 7-8=4
- 15) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-16, 2-4=-21, 4-5=-21, 5-7=-21, 7-8=-16, 2-10=-20, 9-10=-80, 7-9=-20
Horz: 1-2=-4, 2-4=1, 5-7=-1, 7-8=4
- 16) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-20, 5-8=-20, 2-10=-40, 10-15=-100, 15-16=-120, 9-16=-100, 7-9=-40
- 17) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-53, 2-4=-56, 4-5=-51, 5-7=-44, 7-8=-40, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35
Horz: 1-2=3, 2-4=6, 5-7=6, 7-8=10
- 18) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-4=-44, 4-5=-51, 5-7=-56, 7-8=-53, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35
Horz: 1-2=-10, 2-4=-6, 5-7=-6, 7-8=-3
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-47, 2-4=-51, 4-5=-51, 5-7=-51, 7-8=-47, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35
Horz: 1-2=-3, 2-4=1, 5-7=-1, 7-8=3
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-47, 2-4=-51, 4-5=-51, 5-7=-51, 7-8=-47, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35
Horz: 1-2=-3, 2-4=1, 5-7=-1, 7-8=3
- 21) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-4=-25, 4-5=-25, 5-8=-25, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-2=-16, 2-4=16, 5-8=-16

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970823
6243111	G02	Hip	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:23 2025 Page 3
ID:nV5ZFUJaGJLKOI1jrAiSDcyHym-5wrWOBaFeJvzqcgW9sghCiskL21pKdGsi023Rtzy5JQ

- LOAD CASE(S)** Standard
- 22) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=8, 4-5=8, 5-8=8, 2-10=-12, 9-10=-72, 7-9=-12
Horz: 1-4=-16, 5-8=16
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 4-5=-60, 5-8=-20, 2-10=-20, 9-10=-80, 7-9=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-60, 5-8=-60, 2-10=-20, 9-10=-80, 7-9=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-50, 4-5=-50, 5-8=-20, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-5=-50, 5-8=-50, 2-10=-35, 10-15=-95, 15-16=-110, 9-16=-95, 7-9=-35

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970824
6243111	G03	Common	2	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:23 2025 Page 1
ID:nV5ZFUJaGJLK0H1jrAiSDcyHym-5wrWOBaFeJvzqcgW9sghCisi521aKdCsi023Rtzy5JQ



Scale = 1:38.5

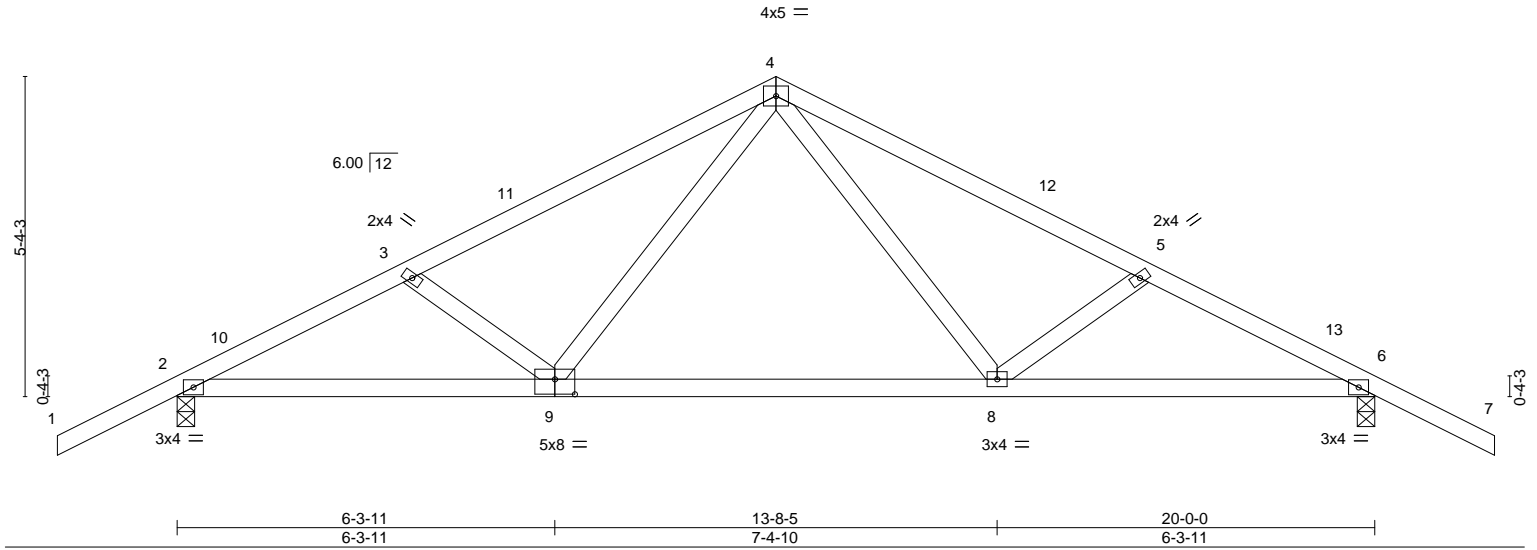

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.72	Vert(LL)	-0.05 8-9 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.64	Vert(CT)	-0.36 8-9 >648 240				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.17	Horz(CT)	0.04 6 n/a n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Wind(LL)	0.03 8-9 >999 240				
								Weight: 97 lb		FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-5-15 oc purlins.
BOT CHORD	2x4 SP M 31 or 2x4 SP SS	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 2=0-3-8, 6=0-3-8
Max Horz 2=99(LC 11)
Max Grav 2=1139(LC 1), 6=1139(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1927/0, 3-4=-1718/0, 4-5=-1718/0, 5-6=-1927/0
BOT CHORD 2-9=0/1659, 8-9=0/1062, 6-8=0/1659
WEBS 4-8=0/719, 5-8=-268/183, 4-9=0/719, 3-9=-268/183

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 10-0-0, Zone2 10-0-0 to 14-2-15, Zone1 14-2-15 to 22-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

- LOAD CASE(S)** Standard
- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 4-7=-60, 2-9=-20, 8-9=-80, 6-8=-20
 - Dead + 0.75 Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-50, 4-7=-50, 2-9=-20, 8-9=-80, 6-8=-20
 - Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-20, 2-9=-40, 8-9=-100, 6-8=-40
 - Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60

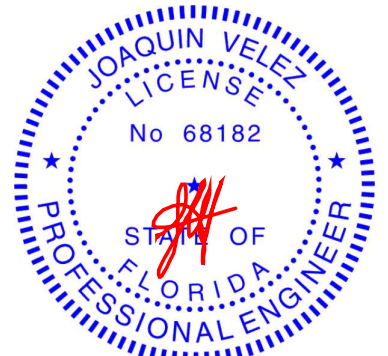

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970824
6243111	G03	Common	2	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:23 2025 Page 2
ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-5wrWOBaFeJvzcqgW9sgHCisi521aKdCsi023Rtzy5JQ

LOAD CASE(S) Standard

- Uniform Loads (plf)
- Vert: 1-2=47, 2-10=32, 4-10=19, 4-12=26, 6-12=19, 6-7=14, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-56, 2-10=-40, 4-10=-27, 4-12=35, 6-12=27, 6-7=23
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=14, 2-11=19, 4-11=26, 4-13=19, 6-13=32, 6-7=47, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-23, 2-11=-27, 4-11=-35, 4-13=27, 6-13=40, 6-7=56
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-8, 2-4=-33, 4-6=-33, 6-7=-29, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-12, 2-4=13, 4-6=-13, 6-7=-9
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-29, 2-4=-33, 4-6=-33, 6-7=-8, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=9, 2-4=13, 4-6=-13, 6-7=12
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=15, 2-4=3, 4-6=9, 6-7=4, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-24, 2-4=-11, 4-6=17, 6-7=13
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=4, 2-4=9, 4-6=3, 6-7=15, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-13, 2-4=-17, 4-6=11, 6-7=24
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-24, 2-4=-28, 4-6=-12, 6-7=-7, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=4, 2-4=8, 4-6=8, 6-7=13
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-7, 2-4=-12, 4-6=-28, 6-7=-24, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-13, 2-4=-8, 4-6=-8, 6-7=-4
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=28, 2-4=15, 4-6=15, 6-7=28, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-37, 2-4=-24, 4-6=24, 6-7=37
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=15, 2-4=3, 4-6=3, 6-7=15, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-24, 2-4=-11, 4-6=11, 6-7=24
- 14) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-16, 2-4=-21, 4-6=-21, 6-7=-16, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-4, 2-4=1, 4-6=-1, 6-7=4
- 15) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-16, 2-4=-21, 4-6=-21, 6-7=-16, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-4, 2-4=1, 4-6=-1, 6-7=4
- 16) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
- Uniform Loads (plf)
- Vert: 1-4=-20, 4-7=-20, 2-9=-20, 8-9=-80, 6-8=-20
- 17) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-53, 2-4=-56, 4-6=-44, 6-7=-40, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=3, 2-4=6, 4-6=6, 6-7=10
- 18) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-40, 2-4=-44, 4-6=-56, 6-7=-53, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-10, 2-4=-6, 4-6=-6, 6-7=-3
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-47, 2-4=-51, 4-6=-51, 6-7=-47, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-3, 2-4=1, 4-6=-1, 6-7=3
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=-47, 2-4=-51, 4-6=-51, 6-7=-47, 2-9=-20, 8-9=-80, 6-8=-20
- Horz: 1-2=-3, 2-4=1, 4-6=-1, 6-7=3
- 21) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-2=8, 2-4=-25, 4-7=-25, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-2=-16, 2-4=16, 4-7=-16
- 22) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60
- Uniform Loads (plf)
- Vert: 1-4=8, 4-7=8, 2-9=-12, 8-9=-72, 6-8=-12
- Horz: 1-4=-16, 4-7=16
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970824
6243111	G03	Common	2	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:23 2025 Page 3
ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-5wrWOBaFeJvzqcgW9sghCisi521aKdCsi023Rtzy5JQ

- LOAD CASE(S)** Standard
- Uniform Loads (plf)
Vert: 1-4=-60, 4-7=-20, 2-9=-20, 8-9=-80, 6-8=-20
 - 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-60, 2-9=-20, 8-9=-80, 6-8=-20
 - 25) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-50, 4-7=-20, 2-9=-20, 8-9=-80, 6-8=-20
 - 26) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-50, 2-9=-20, 8-9=-80, 6-8=-20

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970825
6243111	G04	Common	3	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:24 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHym-Z6PubXbtPc1qSmFiiaBwIwOtlSNq34O?xgnczJzy5JP

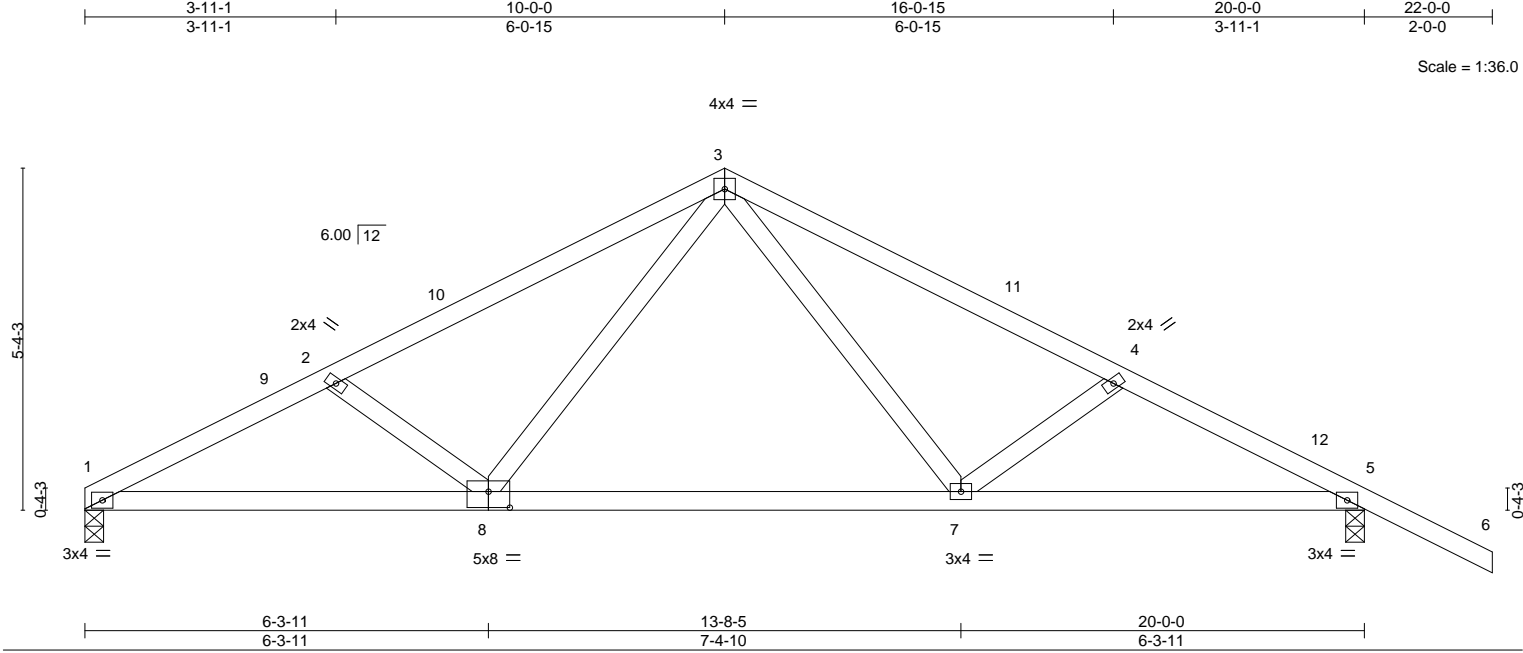


Plate Offsets (X,Y)-- [8:0-4-0-0-3-0]									
LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.73	Vert(LL)	-0.05	7-8	>999	360	MT20 244/190
TCDL 10.0	Lumber DOL 1.25		BC 0.64	Vert(CT)	-0.36	7-8	>649	240	
BCLL 0.0 *	Rep Stress Incr NO		WB 0.17	Horz(CT)	0.04	5	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S	Wind(LL)	0.03	7-8	>999	240	Weight: 94 lb FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-5-8 oc purlins.
BOT CHORD 2x4 SP M 31 or 2x4 SP SS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS.	(size)
Max Horz 1=0-3-8, 5=0-3-8	
Max Grav 1=95(LC 10)	
Max Grav 1=1003(LC 1), 5=1146(LC 1)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-1982/0, 2-3=-1759/0, 3-4=-1732/0, 4-5=-1942/0
BOT CHORD	1-8=0/1721, 7-8=0/1075, 5-7=0/1672
WEBS	3-7=0/718, 4-7=-268/183, 3-8=0/732, 2-8=-301/191

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 10-0-0, Zone2 10-0-0 to 14-2-15, Zone1 14-2-15 to 22-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25 Uniform Loads (plf) Vert: 1-3=-60, 3-6=-60, 1-8=-20, 7-8=-80, 5-7=-20
2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25 Uniform Loads (plf) Vert: 1-3=-50, 3-6=-50, 1-8=-20, 7-8=-80, 5-7=-20
3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25 Uniform Loads (plf) Vert: 1-3=-20, 3-6=-20, 1-8=-40, 7-8=-100, 5-7=-40
4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60

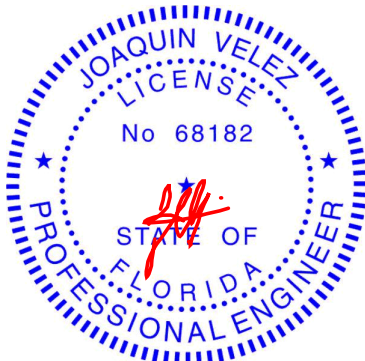

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970825
6243111	G04	Common	3	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:24 2025 Page 2
ID:nV5ZFUJaGJLKO1JrAiSDcyHym-Z6PubXbtPc1qSmFiiaBwIwOtlSNq34O?xgnczJzy5JP

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-9=32, 3-9=19, 3-11=26, 5-11=19, 5-6=14, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-9=-40, 3-9=-27, 3-11=35, 5-11=27, 5-6=23
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-10=19, 3-10=26, 3-12=19, 5-12=32, 5-6=47, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-10=-27, 3-10=-35, 3-12=27, 5-12=40, 5-6=56
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-33, 3-5=-33, 5-6=-29, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=13, 3-5=-13, 5-6=-9
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-33, 3-5=-33, 5-6=-8, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=13, 3-5=-13, 5-6=12
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=3, 3-5=9, 5-6=4, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-3=-11, 3-5=17, 5-6=13
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=9, 3-5=3, 5-6=15, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-3=-17, 3-5=11, 5-6=24
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-28, 3-5=-12, 5-6=-7, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=8, 3-5=8, 5-6=13
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-12, 3-5=-28, 5-6=-24, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=-8, 3-5=-8, 5-6=-4
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=15, 3-5=15, 5-6=28, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-3=-24, 3-5=24, 5-6=37
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=3, 3-5=3, 5-6=15, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-3=-11, 3-5=11, 5-6=24
- 14) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-21, 3-5=-21, 5-6=-16, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=1, 3-5=-1, 5-6=4
- 15) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-21, 3-5=-21, 5-6=-16, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=1, 3-5=-1, 5-6=4
- 16) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-3=-20, 3-6=-20, 1-8=-20, 7-8=-80, 5-7=-20
- 17) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-56, 3-5=-44, 5-6=-40, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=6, 3-5=6, 5-6=10
- 18) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-44, 3-5=-56, 5-6=-53, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=-6, 3-5=-6, 5-6=3
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-51, 3-5=-51, 5-6=-47, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=1, 3-5=-1, 5-6=3
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-51, 3-5=-51, 5-6=-47, 1-8=-20, 7-8=-80, 5-7=-20
Horz: 1-3=1, 3-5=-1, 5-6=3
- 21) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=-25, 3-6=-25, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-3=16, 3-6=16
- 22) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-3=8, 3-6=8, 1-8=-12, 7-8=-72, 5-7=-12
Horz: 1-3=-16, 3-6=16
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970825
6243111	G04	Common	3	1	Job Reference (optional)	

- LOAD CASE(S)** Standard
- Uniform Loads (plf)
Vert: 1-3=-60, 3-6=-20, 1-8=-20, 7-8=-80, 5-7=-20
 - 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-20, 3-6=-60, 1-8=-20, 7-8=-80, 5-7=-20
 - 25) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-50, 3-6=-20, 1-8=-20, 7-8=-80, 5-7=-20
 - 26) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-20, 3-6=-50, 1-8=-20, 7-8=-80, 5-7=-20


 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970826
6243111	H5L	Diagonal Hip Girder	2	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:24 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHyrn-Z6PubXbtPc1qSmFiaBwlwOqvSTx367?xgnczJzy5JP

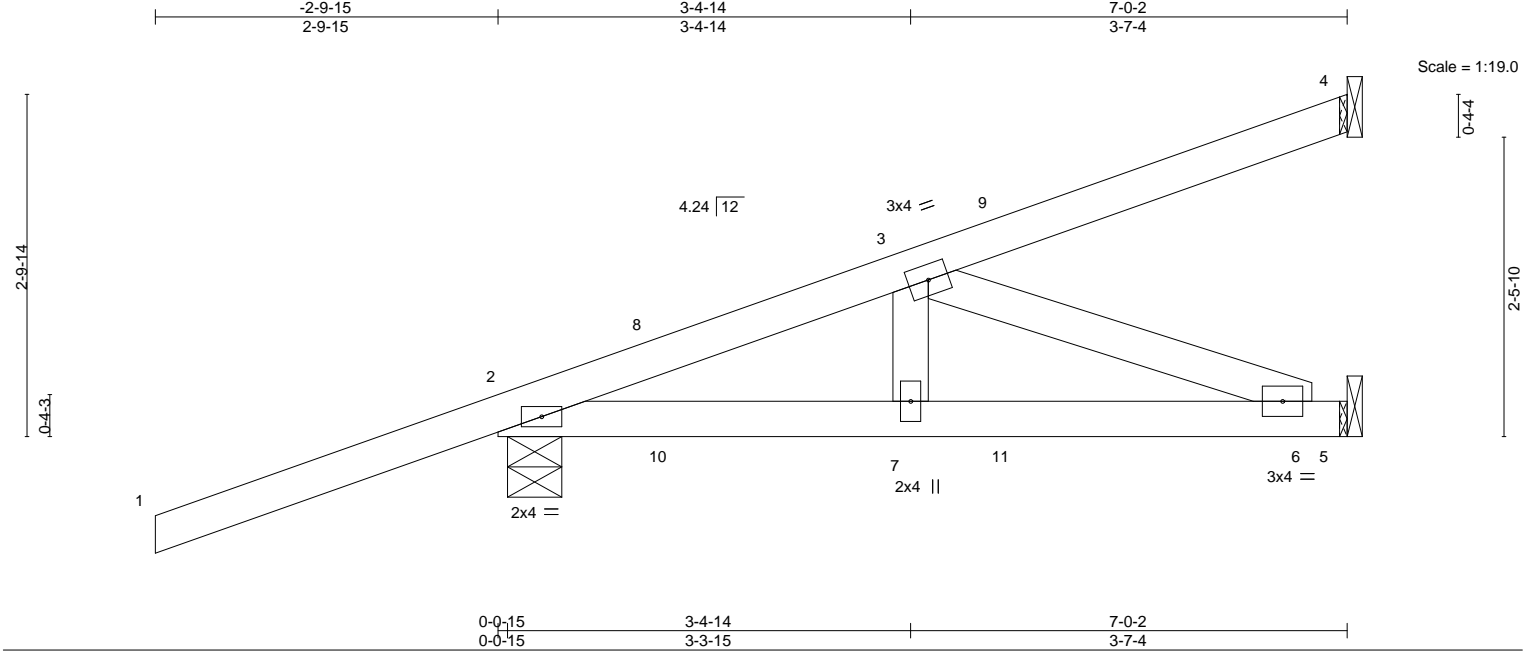

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.91	Vert(LL)	-0.01	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.25	Vert(CT)	-0.02				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.06	Horz(CT)	0.00				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-P		Wind(LL)	0.01				
								Weight: 33 lb		FT = 20%	


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 4=Mechanical, 5=Mechanical, 2=0-5-6
Max Horz 2=95(LC 27)
Max Uplift 4=-31(LC 8), 5=-53(LC 5), 2=-229(LC 8)
Max Grav 4=127(LC 19), 5=122(LC 3), 2=417(LC 31)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-346/120
BOT CHORD 2-7=-129/256, 6-7=-129/256
WEBS 3-6=-274/138

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 4, 53 lb uplift at joint 5 and 229 lb uplift at joint 2.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 87 lb down and 185 lb up at 1-4-15, 87 lb down and 185 lb up at 1-4-15, and 54 lb down and 23 lb up at 4-2-15, and 54 lb down and 23 lb up at 4-2-15 on top chord, and 8 lb up at 1-4-15, 8 lb up at 1-4-15, and 11 lb down and 24 lb up at 4-2-15, and 11 lb down and 24 lb up at 4-2-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 2-5=-20
Concentrated Loads (lb)
Vert: 8=123(F=62, B=62)

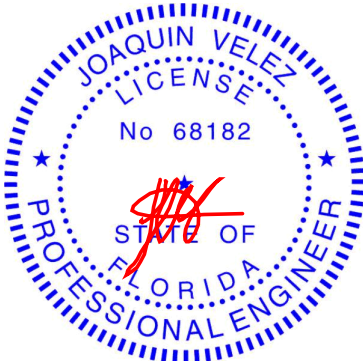

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970827
6243111	H6C	Roof Special Girder	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:25 2025 Page 1
ID:nV5ZFUJaGJLKO1JrAiSDcyHym-1JzGptbVAw9h4vqvGHi9H7x1rsmCoY289JXAVIzy5JO

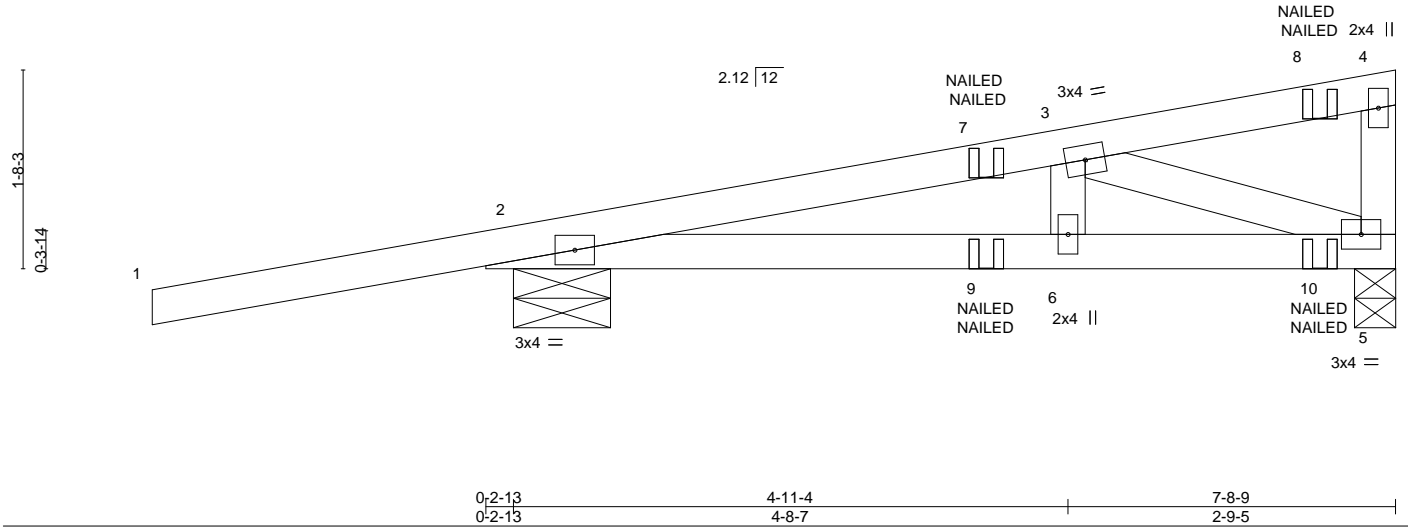

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.77	Vert(LL) -0.02	2-6	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.44	Vert(CT) -0.05	2-6	>999	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.08	Horz(CT) 0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P	Wind(LL) 0.02	2-6	>999	240	Weight: 34 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	


REACTIONS. (size) 5=0-4-3, 2=0-9-14
Max Horz 2=54(LC 4)
Max Uplift 5=97(LC 4), 2=199(LC 4)
Max Grav 5=409(LC 1), 2=532(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-558/89
BOT CHORD 2-6=-102/510, 5-6=-102/510
WEBS 3-5=-539/107

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left exposed; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 97 lb uplift at joint 5 and 199 lb uplift at joint 2.
 - 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 2-5=-20
Concentrated Loads (lb)
Vert: 8=-115(F=-58, B=-58) 10=-58(F=-29, B=-29)

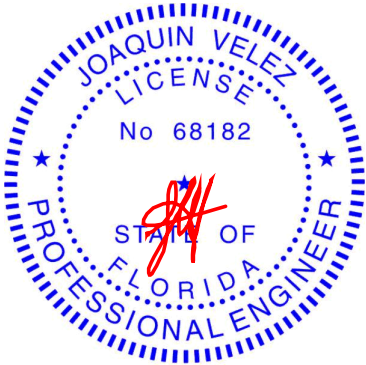

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970828
6243111	H7	Diagonal Hip Girder	5	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:26 2025 Page 1
ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-VVXf0Dc7xEHYh3P5q_DOqLUCIG2tXxGI0zGj1Czy5JN

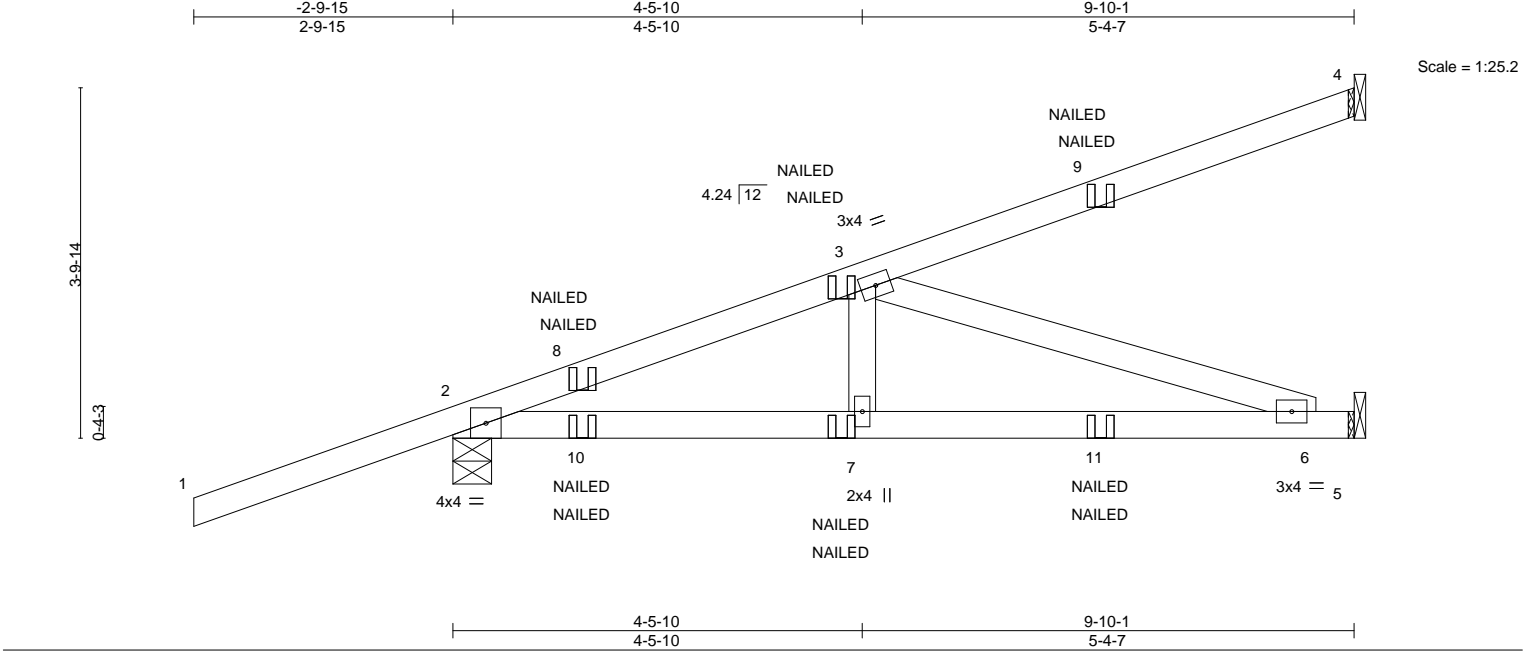

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.82	Vert(LL) -0.06	6-7	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.66	Vert(CT) -0.14	6-7	>840	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.34	Horz(CT) 0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-S	Wind(LL) -0.03	2-7	>999	240	Weight: 44 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-8 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	


REACTIONS. (size) 4=Mechanical, 2=0-5-1, 5=Mechanical
Max Horz 2=119(LC 27)
Max Uplift 4=-51(LC 8), 2=-170(LC 8)
Max Grav 4=165(LC 1), 2=582(LC 31), 5=272(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-788/23
BOT CHORD 2-7=-55/670, 6-7=-55/670
WEBS 3-7=0/288, 3-6=-705/58

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 51 lb uplift at joint 4 and 170 lb uplift at joint 2.
 - 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 2-5=-20
Concentrated Loads (lb)
Vert: 8=123(F=62, B=62) 9=-60(F=-30, B=-30) 11=-39(F=-20, B=-20)

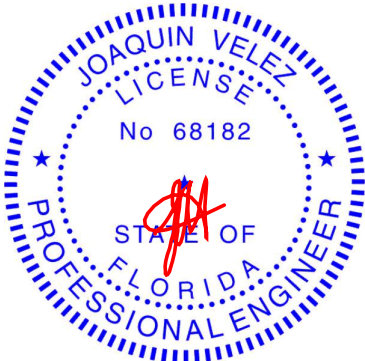

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970829
6243111	L01	Hip Girder	1	1	Job Reference (optional)	


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:27 2025 Page 1

ID:nV5ZFUJaGJLKOI1jrAisDcyHym-_h51EZdlhXPPJD_HOikdMY0TOgSVGSgRdd0Haezy5JM



Scale = 1:29.3

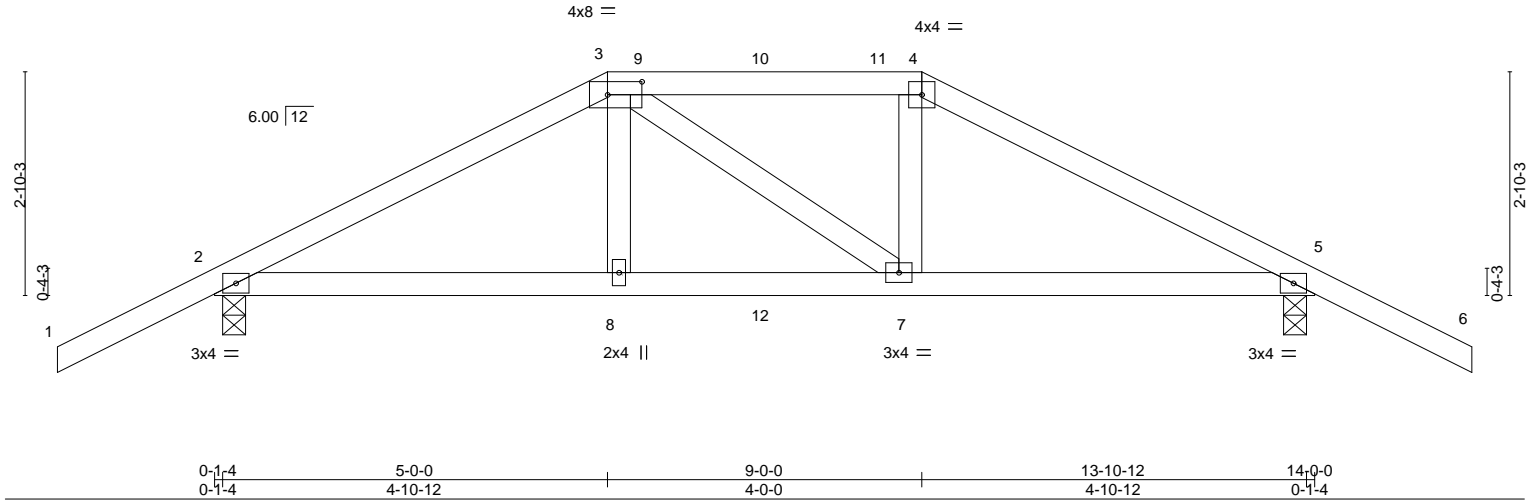

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.45	Vert(LL)	-0.03	7-8	>999	360	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.45	Vert(CT)	-0.06	7-8	>999	240	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.08	Horz(CT)	0.02	5	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		Wind(LL)	0.03	2-8	>999	240	
										Weight: 63 lb	FT = 20%


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-10-7 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS. (size) 2=0-3-8, 5=0-3-8
Max Horz 2=-58(LC 25)
Max Uplift 2=-216(LC 8), 5=-216(LC 8)
Max Grav 2=913(LC 1), 5=913(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1320/213, 3-4=-1116/205, 4-5=-1321/212
BOT CHORD 2-8=-146/1104, 7-8=-146/1116, 5-7=-141/1104
WEBS 3-8=0/333, 4-7=0/334

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 216 lb uplift at joint 2 and 216 lb uplift at joint 5.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 151 lb down and 120 lb up at 5-0-0, and 76 lb down and 53 lb up at 7-0-0, and 151 lb down and 120 lb up at 9-0-0 on top chord, and 208 lb down at 5-0-0, and 56 lb down at 7-0-0, and 208 lb down at 8-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-60, 3-4=-60, 4-6=-60, 2-5=-20
Concentrated Loads (lb)
Vert: 3=-95(B) 4=-95(B) 8=-99(B) 7=-99(B) 10=-55(B) 12=-28(B)

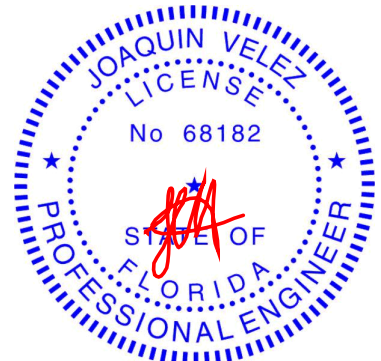

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:27 2025 Page 1
 ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-h51EZdlhXPPJD_HoikdMY0QzgQMGSrRdd0Haeyz5JM
 2-0-0 7-0-0 14-0-0 16-0-0
 2-0-0 7-0-0 7-0-0 2-0-0

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-7-6 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-737/313, 3-4=-737/313
BOT CHORD	2-6=-161/570, 4-6=-161/570
WEBS	3-6=-88/328

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl. C, Gcpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 7-0-0, Zone2 7-0-0 to 11-2-15, Zone1 11-2-15 to 16-0-0 zone; cantilever left and right exposed ; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 202 lb uplift at joint 2 and 202 lb uplift at joint 4.

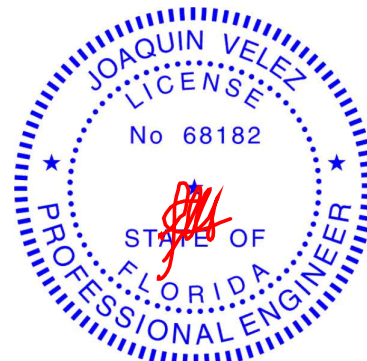

January 7, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970831
6243111	LV1	Valley	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL),

Ocala, FL - 34472,

8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:28 2025 Page 1

ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-SufPRveNSrXGxNZUxPFsvmZfP3pS?wObsHlq64zy5JL


5-10-8

5-10-8

11-9-0

5-10-8

Scale = 1:20.7

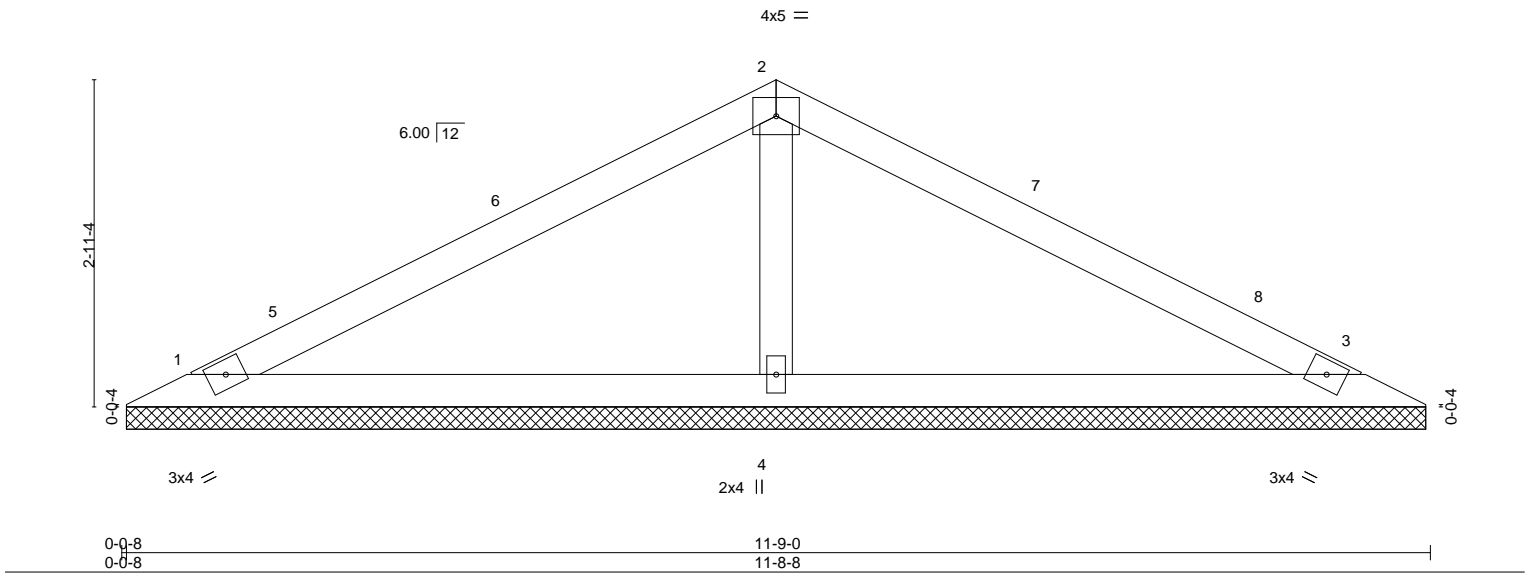


LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.36	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S						Weight: 38 lb	FT = 20%

LUMBER-				BRACING-	
TOP CHORD	2x4 SP No.2			TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2			BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.2				

REACTIONS. (size) 1=11-8-0, 3=11-8-0, 4=11-8-0
Max Horz 1=43(LC 11)
Max Uplift 1=-18(LC 12), 3=-18(LC 12)
Max Grav 1=193(LC 23), 3=193(LC 24), 4=459(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-305/152

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 0-7-9 to 3-7-9, Zone1 3-7-9 to 5-10-8, Zone2 5-10-8 to 10-1-7, Zone1 10-1-7 to 11-1-7 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1 and 18 lb uplift at joint 3.

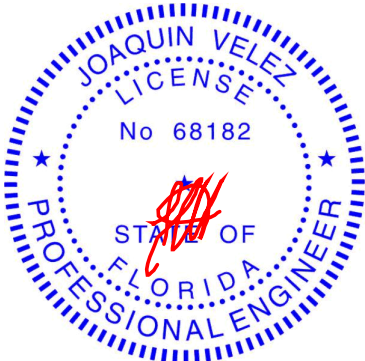

Joaquin Velez PE No.68182


MiTek Inc. DBA MiTek USA FL Cert 6634

16023 Swingley Ridge Rd. Chesterfield, MO 63017

Date:

January 7,2025

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:28 2025 Page 1
ID:nV5ZFUJaGJLKOI1rJrASDcyHym-SufPRveNSrXGxNZUxPFsvmZiA3s2?wgbsHlq64zy5JL

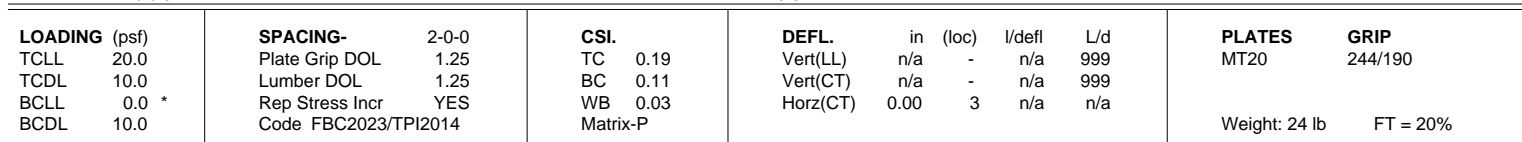


REACTIONS. (size) 1=7-8-0, 3=7-8-0, 4=7-8-0
 Max Horz 1=-27(LC 10)
 Max Uplift 1=-17(LC 12), 3=-17(LC 12)
 Max Grav 1=131(LC 1), 3=131(LC 1), 4=257(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 1 and 17 lb uplift at joint 3.



January 7, 2025


 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbscomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970833
6243111	LV3	Valley	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:29 2025 Page 1
ID:nV5ZFUJaGJLKO1jrAiSDcyHym-w4DneFf?D9f7YX8gV7n5Sz6vBTCokNLk4xVNeWzy5JK

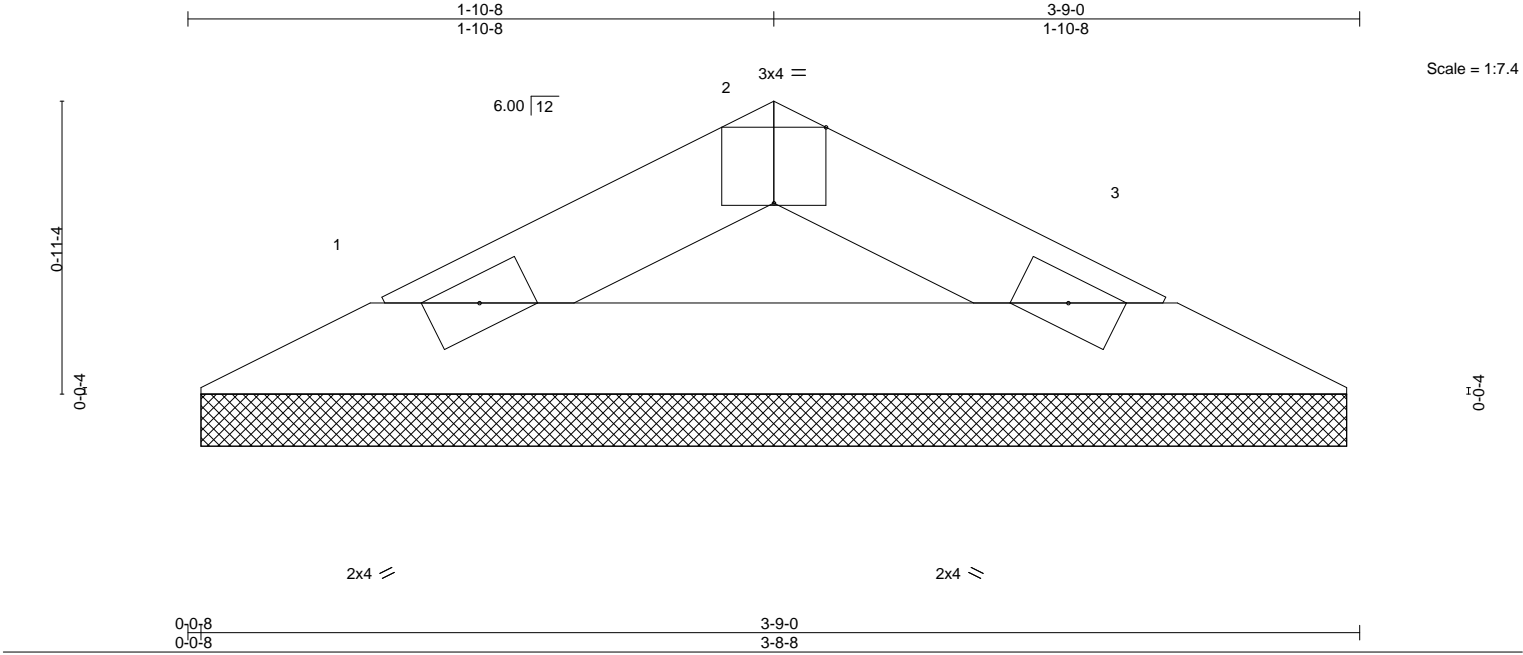


LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.04	Vert(LL)	n/a	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.07	Vert(CT)	n/a				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-P							
								Weight: 10 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-9-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.	
(size)	1=3-8-0, 3=3-8-0
Max Horz	1=-10(LC 10)
Max Uplift	1=-4(LC 12), 3=-4(LC 12)
Max Grav	1=100(LC 1), 3=100(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 1 and 4 lb uplift at joint 3.

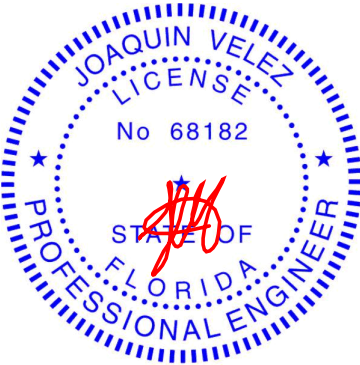

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:29 2025 Page 1
 ID:nV5ZFUJaGJLKOl1jrAiSDcyHyrn-w4DneFf?D9f7YX8gV7n5Sz6p1tXkNlK4xVNeWzy5JK
 -2-0-0 5-6-8
 2-0-0 5-6-8


LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-6-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2		
WEBS	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER	Left 2x4 SP No.2 2-1-12		

REACTIONS. (size) 5=0-3-8, 2=0-3-8
 Max Horz 2=50(LC 12)
 Max Uplift 5=-45(LC 12), 2=-123(LC 12)
 Max Grav 5=184(LC 1), 2=365(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 5-4-12 zone; cantilever left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 5 and 123 lb uplift at joint 2.
- 

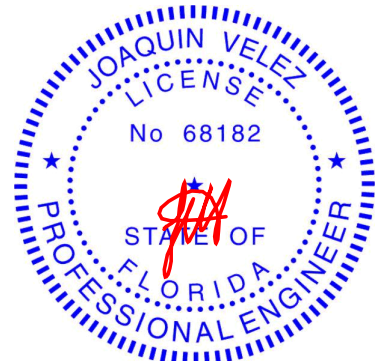

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MH-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinstitute.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®
 16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970835
6243111	M2	Monopitch Structural Gable	1	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:30 2025 Page 1
ID:nV5ZFUJaGJLK01jrAiSDcyHym-OGm9safe_Sn_Ahjs3qlK_Be?RtWRTPzUJbExAzy5JJ

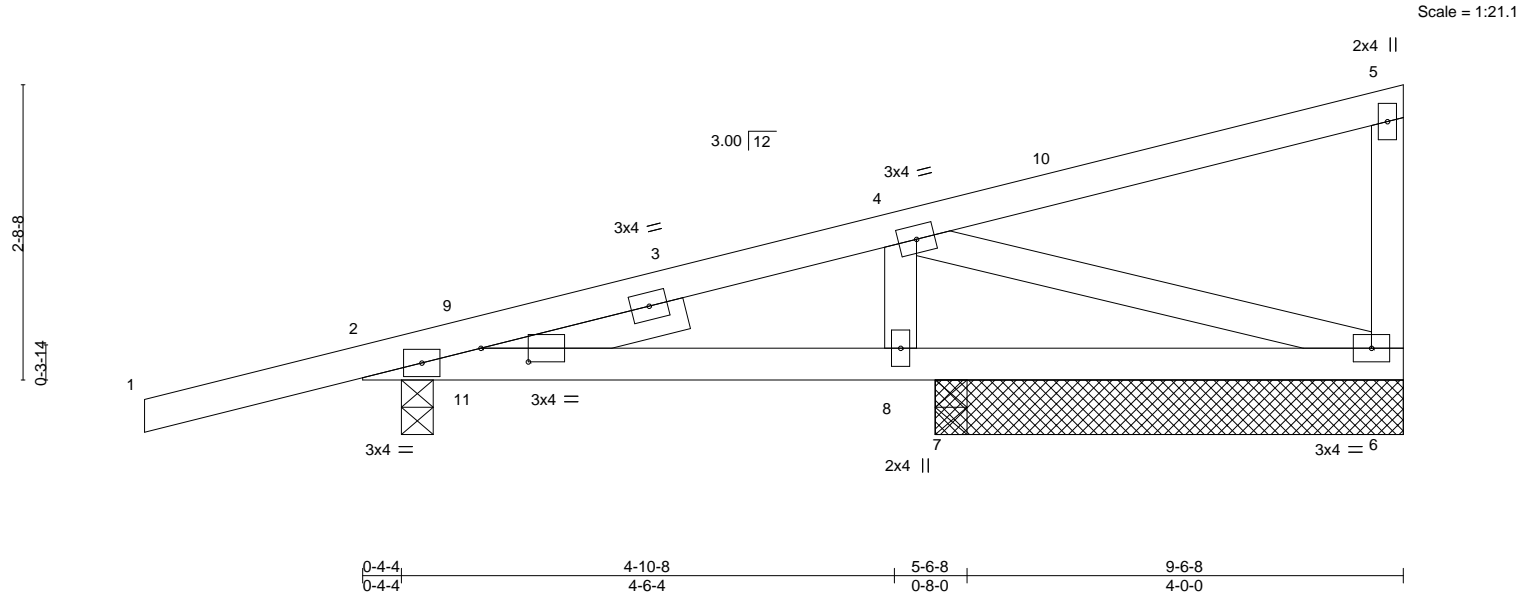



Plate Offsets (X,Y)--		[2:0-5-3,0-1-8]											
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.33	Vert(LL)	-0.02	2-8	>999	360	MT20	244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.24	Vert(CT)	-0.04	2-8	>999	240			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	6	n/a	n/a			
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		Wind(LL)	0.03	2-8	>999	240			
												Weight: 46 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.2		
SLIDER	Left 2x4 SP No.2 1-10-14		

REACTIONS. (size) 6=4-3-8, 2=0-3-8, 7=0-3-8
Max Horz 2=74(LC 12)
Max Uplift 6=28(LC 12), 2=131(LC 12), 7=25(LC 12)
Max Grav 6=178(LC 1), 2=379(LC 1), 7=312(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-4-12 zone; cantilever left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 6, 131 lb uplift at joint 2 and 25 lb uplift at joint 7.

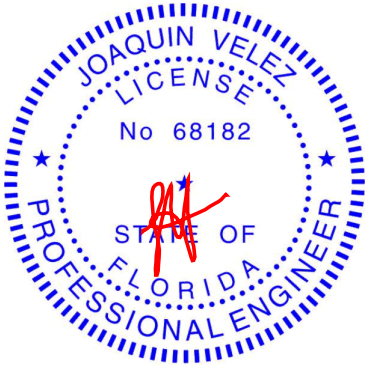

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	1755-D-14x10 Lanai	T35970836
6243111	M3	Monopitch	4	1	Job Reference (optional)	

Tibbetts Lumber Co., LLC (Ocala, FL), Ocala, FL - 34472, 8.730 s Dec 5 2024 MiTek Industries, Inc. Mon Jan 6 11:17:30 2025 Page 1
ID:nV5ZFUJaGJLKOl1jrAiSDcyHym-OGm9safe_Sn_Ahjs3qIK_Be?RtV0TmVuJbExAzy5JJ

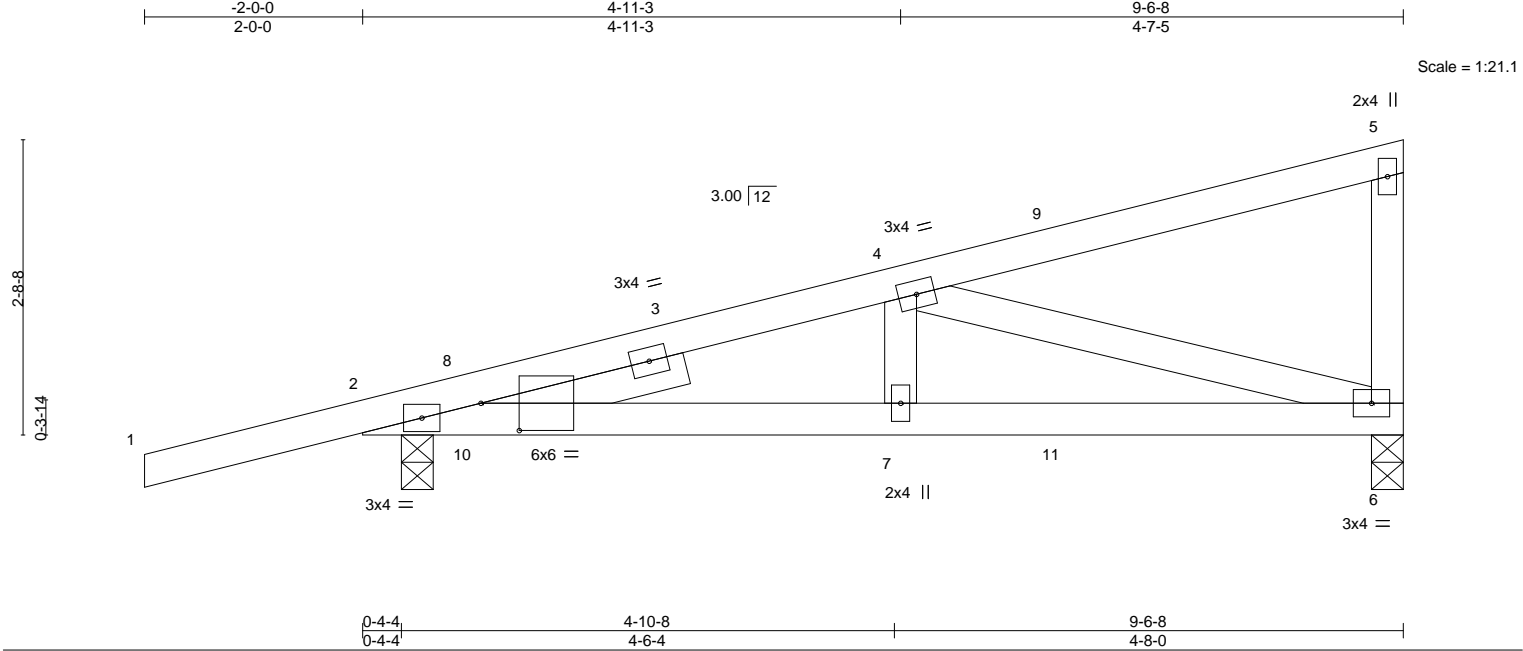



Plate Offsets (X,Y)--		[2:0-4-3,0-3-0]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.33	Vert(LL)	-0.02 7 >999 360	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.27	Vert(CT)	-0.04 2-7 >999 240				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.26	Horz(CT)	0.01 6 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		Wind(LL)	0.03 2-7 >999 240				
								Weight: 46 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 8-2-11 oc bracing.
WEBS	2x4 SP No.2		
SLIDER	Left 2x4 SP No.2 1-10-14		

REACTIONS. (size) 6=0-3-8, 2=0-3-8
Max Horz 2=74(LC 12)
Max Uplift 6=95(LC 12), 2=156(LC 12)
Max Grav 6=355(LC 1), 2=514(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-772/433
BOT CHORD 2-7=-512/708, 6-7=-512/708
WEBS 4-6=-707/504

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Zone3 -2-0-0 to 1-0-0, Zone1 1-0-0 to 9-4-12 zone; cantilever left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 95 lb uplift at joint 6 and 156 lb uplift at joint 2.

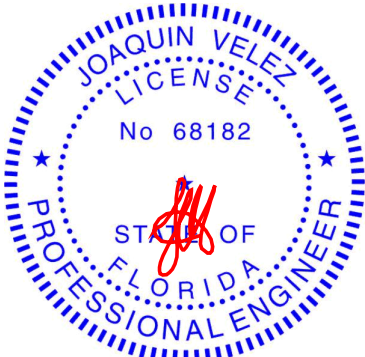

Joaquin Velez PE No.68182
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

January 7,2025



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

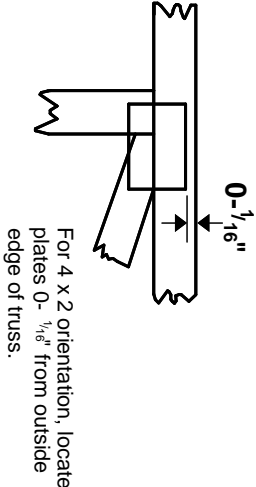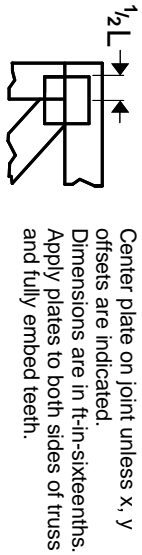

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.


4 X 4

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

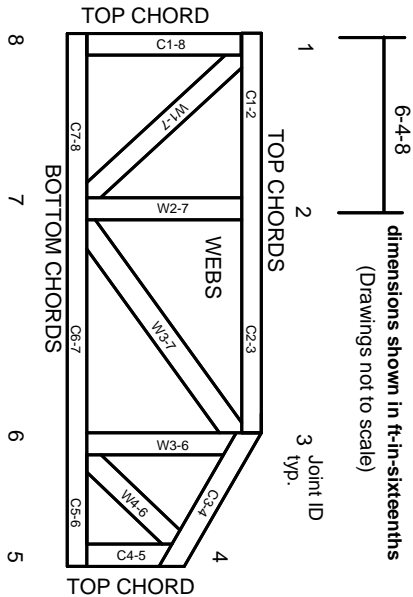

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes


Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.



Floor: Load: 55# psf; 40 TCLL, 10 TCDL, 00 BCLL, 05 BCDL; Dur.: 1.00
Design checked for 10 psf non-concurrent LL on BC.

Roof: Load: 40# psf; 20 TCLL, 10 TCDL, 00 BCLL, 10 BCDL; Dur.: 1.25
Design checked for 10 psf non-concurrent LL on BC

Installation shall be per connector manufacturer's guidelines. All connectors and tie downs other than truss to girder truss connectors are to be specified and supplied by others.							
UPLIFT SUMMARY	1		11		21		
	2		12		22		
	3		13		23		
	4		14		24		
	5		15		25		
	6		16		26		
	7		17		27		
	8		18		28		
	9		19		29		
	10		20		30		

NOTES	N1	.
	N2	.
	N3	.
	N4	.
	N5	.
	N6	.
	N7	.
	N8	.
	N9	.

Client Info	Client:	Adams Homes
	Project:	Model:1755-D-Frame
	Address:	Lot# 094 The Preserve at Laurel Lake
		Lake City , Florida




















Rev						
Date	:	1/06/25	Scale	:	1/4" = 1'-0"	D= 1/4
Revised	:	.	Drawn By	:	Steve R.	
Sheet #	:	1 of 1	Job #	:	6243111	

Please Print	Name	Employed By	Approval Date
--------------	------	-------------	---------------

 <p>TIBBETTS LUMBER CO. <small>Since 1949</small> WWW.TIBBETTSLUMBER.COM</p>	<h2 style="margin: 0;">Tibbetts Lumber Ocala</h2> <p style="margin: 5px 0;">6100 SE 68th St Ocala, FL 34472 Phone: 352-347-7661 www.tibbettslumber.com</p>	<h3 style="margin: 0;">Reaction Summary</h3> <p>Job Number: 6243111-R</p> <p>Quoted On:</p> <p>Ordered On: 11/4/2024</p> <p>Scheduled Delivery On:</p> <p>Product: Roof</p>

<p>Customer Information</p> <p>Adams Homes of NW FL - Gainesville</p> <p>Address & Phone</p> <p>Phone:</p>	<p>Job Information</p> <p>The Preserve at Laurel Lake 094</p> <p>Address</p> <p>742 SW Rosemary Dr Lake City 32024</p>																		
<p>Contact</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;">Lot</td> <td style="width: 33%;">Sub-Division</td> <td style="width: 34%;"></td> </tr> <tr> <td>094</td> <td>The Preserve at Laurel Lake</td> <td></td> </tr> <tr> <td>Sales Person</td> <td colspan="2">Customer P.O. No.</td> </tr> <tr> <td>Chris Adam</td> <td colspan="2"></td> </tr> <tr> <td>Estimator</td> <td colspan="2">Designer</td> </tr> <tr> <td>Steven Roberts</td> <td colspan="2">Steven Roberts</td> </tr> </table>	Lot	Sub-Division		094	The Preserve at Laurel Lake		Sales Person	Customer P.O. No.		Chris Adam			Estimator	Designer		Steven Roberts	Steven Roberts	
Lot	Sub-Division																		
094	The Preserve at Laurel Lake																		
Sales Person	Customer P.O. No.																		
Chris Adam																			
Estimator	Designer																		
Steven Roberts	Steven Roberts																		

Loading				Building Code	Wind Design Method	Velocity	Exp Cat	Wind Max	
TCLL	TCDL	BCLL	BCDL				Occ Cat	TCDL	BCDL
20	10	0	10	FBC2023/TPI2014	MWFRS (Directional)/C-C hybrid Wind ASCE 7-22	130 mph	B II	4.2	6

Roof Trusses									
Label	Profile	Qty Ply	Span Height	TC Pitch BC Pitch	TC BC	Reactions			
A01		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 8		
		2-ply	4-09-15		2 x 4	2491 -153	2399 -103		
A02		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 8		
		1-ply	5-09-15		2 x 4	1401 -118	1264 -53		
A03		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 8		
		1-ply	6-09-15		2 x 4	1525 -118	1405 -53		
A04		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 8		
		1-ply	7-09-15	3 /12	2 x 4	1411 -113	1277 -45		
A05		1	32-00-00	6 /12	2 x 4	Joint 1	Joint 10		
		1-ply	7-10-03	3 /12	2 x 4	1274 -52	1276 -51		
A06		2	32-00-00	6 /12	2 x 4	Joint 1	Joint 10		
		1-ply	8-04-03	3 /12	2 x 4	1274 -52	1276 -51		
A07		1	32-00-00	6 /12	2 x 4	Joint 1	Joint 8		
		1-ply	8-04-03	3 /12	2 x 4	1275 -51	1278 -49		
A08		1	32-00-00	6 /12	2 x 4	Joint 1	Joint 8		
		1-ply	8-04-03	3 /12	2 x 4	1274 -52	1279 -49		
A09		1	28-00-00	6 /12	2 x 4	Joint 1	Joint 8		
		1-ply	8-04-03	3 /12	2 x 4	1108 -46	1108 -50		
A10		1	28-00-00	6 /12	2 x 4	Joint 1	Joint 8		
		1-ply	8-04-03	3 /12	2 x 4	1108 -46	1108 -50		
A11		1	28-00-00	6 /12	2 x 4	Joint 1	Joint 8		
		1-ply	8-04-03	3 /12	2 x 4	1108 -46	1108 -50		
A12		2	28-00-00	6 /12	2 x 4	Joint 2	Joint 9		
		1-ply	9-03-15	3 /12	2 x 4	1242 -110	1103 -47		
A13		2	32-00-00	6 /12	2 x 4	Joint 2	Joint 9		
		1-ply	9-03-15	3 /12	2 x 4	1407 -115	1271 -48		
A14		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 9		
		1-ply	8-09-15	3 /12	2 x 4	1405 -116	1273 -47		
A15		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 9		
		1-ply	7-09-15	3 /12	2 x 4	1405 -116	1273 -47		
A16		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 8		
		1-ply	6-09-15		2 x 4	1525 -118	1405 -53		
A17		1	32-00-00	6 /12	2 x 4	Joint 2	Joint 8		
		1-ply	5-09-15		2 x 4	1401 -110	1264 -61		
A18		1	32-00-00	6 /12	2 x 6	Joint 2	Joint 8		
		2-ply	4-09-15		2 x 6	2468 -161	2649 -183		
C1		10	1-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4	
		1-ply	1-09-15		2 x 4	289 -133	67 -100	19 6	

Roof Trusses

Label	Profile	Qty	Span	TC Pitch	TC	Reactions		
		Ply	Height	BC Pitch	BC			
C1L		4	1-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	1-09-15		2 x 4	289 -142	67 -100	19 -2
C3		9	3-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	2-09-15		2 x 4	290 -85	37 -14	56 17
C3B		1	3-00-00	6 /12	2 x 4	Joint 1	Joint 2	Joint 3
		1-ply	1-10-03		2 x 4	112 5	84 -31	56 17
C3C		2	3-00-00	3 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	1-06-10		2 x 4	290 -111	34 -9	56 -7
C3L		4	3-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	2-09-15		2 x 4	290 -109	37 -14	56 -7
C5		9	5-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	3-09-15		2 x 4	349 -70	115 -36	96 29
C5B		1	5-00-00	6 /12	2 x 4	Joint 1	Joint 2	Joint 3
		1-ply	2-10-03		2 x 4	192 7	144 -53	96 29
C5C		2	5-00-00	3 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	2-00-10		2 x 4	349 -120	115 -27	96 -12
E5L		3	5-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	3-09-15		2 x 4	349 -111	115 -36	96 -12
E7		27	7-00-00	6 /12	2 x 4	Joint 2	Joint 3	Joint 4
		1-ply	4-09-15		2 x 4	421 -63	183 -62	136 41
G01		1	20-00-00	6 /12	2 x 4	Joint 2	Joint 6	
		1-ply	4-09-15		2 x 4	1504 -79	1528 -88	
G02		1	20-00-00	6 /12	2 x 4	Joint 2	Joint 7	
		1-ply	5-09-15		2 x 4	1217 127	1217 127	
G03		2	20-00-00	6 /12	2 x 4	Joint 2	Joint 6	
		1-ply	6-03-15		2 x 4	1139 127	1139 127	
G04		3	20-00-00	6 /12	2 x 4	Joint 1	Joint 5	
		1-ply	6-03-15		2 x 4	1003 191	1146 123	
H5L		2	7-00-02	4.24 /12	2 x 4	Joint 2	Joint 4	Joint 5
		1-ply	3-09-07		2 x 4	417 -229	127 -31	122 -53
H6C		1	7-08-09	2.12 /12	2 x 4	Joint 2	Joint 5	
		1-ply	2-01-15		2 x 4	532 -199	409 -97	
H7		5	9-10-01	4.24 /12	2 x 4	Joint 2	Joint 4	Joint 5
		1-ply	4-09-07		2 x 4	582 -170	165 -51	272 18
L01		1	14-00-00	6 /12	2 x 4	Joint 2	Joint 5	
		1-ply	3-09-15		2 x 4	913 -216	913 -216	
L02		2	14-00-00	6 /12	2 x 4	Joint 2	Joint 4	
		1-ply	4-09-15		2 x 4	677 -202	677 -202	
LV1		1	11-09-00	6 /12	2 x 4	Joint 1	Joint 3	Joint 4
		1-ply	2-11-04		2 x 4	193 -18	193 -18	459 0
LV2		1	7-09-00	6 /12	2 x 4	Joint 1	Joint 3	Joint 4
		1-ply	1-11-04		2 x 4	131 -17	131 -17	257 11
LV3		1	3-09-00	6 /12	2 x 4	Joint 1	Joint 3	
		1-ply	11-04		2 x 4	100 -4	100 -4	
M1		8	5-06-08	3 /12	2 x 4	Joint 2	Joint 5	
		1-ply	2-02-04		2 x 4	365 -123	184 -45	
M2		1	9-06-08	3 /12	2 x 4	Joint 2	Joint 6	Joint 7
		1-ply	3-02-04		2 x 4	379 -131	178 -28	312 -25
M3		4	9-06-08	3 /12	2 x 4	Joint 2	Joint 6	
		1-ply	3-02-04		2 x 4	514 -156	355 -95	