



[DBPR HOME](#) | [ABOUT DBPR](#) | [DBPR DIVISIONS](#) | [CONTACT DBPR](#)

[BCIS Home](#) | [Log In](#) | [User Registration](#) | [Hot Topics](#) | [Submit Surcharge](#) | [Stats & Facts](#) | [Publications](#) | [Contact Us](#) | [BCIS Site Map](#) | [Links](#) | [Search](#)



**Product Approval**  
USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

OFFICE OF THE SECRETARY

FL #	FL15216-R14	
Application Type	Revision	
Code Version	2023	
Application Status	Approved	
Comments		
Archived	<input type="checkbox"/>	
Product Manufacturer	Owens Corning Roofing and Asphalt, LLC	
Address/Phone/Email	One Owens Corning Parkway Toledo, OH 43645 (740) 321-6345 Greg.Keeler@owenscorning.com	
Authorized Signature	Keeler Greg Greg.Keeler@owenscorning.com	
Technical Representative	Greg Keeler	
Address/Phone/Email	2790 Columbus Road Granville, OH 43023 (740) 321-6345 greg.keeler@owenscorning.com	
Quality Assurance Representative		
Address/Phone/Email		
Category	Roofing	
Subcategory	Underlayments	
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer	
	<input type="checkbox"/> Evaluation Report - Hardcopy Received	
Florida Engineer or Architect Name who developed the Evaluation Report	Robert Nieminen	
Florida License	PE-59166	
Quality Assurance Entity	PRI Construction Materials Technologies, LLC	
Quality Assurance Contract Expiration Date	12/31/2099	
Validated By	John W. Knezevich, PE	
	<input checked="" type="checkbox"/> Validation Checklist - Hardcopy Received	
Certificate of Independence	<a href="#">FL15216_R14_COI_2024_07_COI_NIEMINEN.pdf</a>	
Referenced Standard and Year (of Standard)	<b>Standard</b> ASTM D8257	<b>Year</b> 2020
Equivalence of Product Standards Certified By		
Sections from the Code		

Product Approval Method

Method 1 Option D

Date Submitted

12/18/2024

Date Validated

12/18/2024

Date Pending FBC Approval

12/20/2024

Date Approved

02/11/2025

**Summary of Products**

FL #	Model, Number or Name	Description
15216.1	RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments (HVHZ)	Synthetic roof underlayments for use in FBC HVHZ jurisdictions.
<b>Limits of Use</b> <b>Approved for use in HVHZ:</b> Yes <b>Approved for use outside HVHZ:</b> No <b>Impact Resistant:</b> N/A <b>Design Pressure:</b> N/A <b>Other:</b> Refer to PEER Section 5 for Limits of Use.		<b>Installation Instructions</b> <a href="#">FL15216_R14_II_2024_12_18_FINAL_PEER-OC-003.B_HVHZ_FL15216-R14.pdf</a> Verified By: Robert Nieminen PE-59166 Created by Independent Third Party: Yes <b>Evaluation Reports</b> <a href="#">FL15216_R14_AE_2024_12_18_FINAL_PEER-OC-003.B_HVHZ_FL15216-R14.pdf</a> Created by Independent Third Party: Yes
15216.2	RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments (NON-HVHZ)	Synthetic roof underlayments for use in FBC non-HVHZ jurisdictions.
<b>Limits of Use</b> <b>Approved for use in HVHZ:</b> No <b>Approved for use outside HVHZ:</b> Yes <b>Impact Resistant:</b> N/A <b>Design Pressure:</b> N/A <b>Other:</b> Refer to PEER Section 5 for Limits of Use.		<b>Installation Instructions</b> <a href="#">FL15216_R14_II_2024_12_18_FINAL_PEER-OC-003.A_NON-HVHZ_FL15216-R14.pdf</a> Verified By: Robert Nieminen PE-59166 Created by Independent Third Party: Yes <b>Evaluation Reports</b> <a href="#">FL15216_R14_AE_2024_12_18_FINAL_PEER-OC-003.A_NON-HVHZ_FL15216-R14.pdf</a> Created by Independent Third Party: Yes

[Back](#) [Next](#)

Contact Us :: [2601 Blair Stone Road, Tallahassee FL 32399](#) Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida.](#) :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. \*Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

**Product Approval Accepts:**





**NEMO|etc.**

Certificate of Authorization #32455  
353 Christian Street, Unit #13  
Oxford, CT 06478  
(203) 262-9245

ENGINEER

TEST

CONSULT

**P.E. EVALUATION REPORT (PEER)**

**Owens Corning Roofing and Asphalt, LLC**

One Owens Corning Parkway  
Toledo, OH 43659  
**(740) 321-6345**

**PEER-OC-003.B**

**FL15216-R14 (HVHZ)**

**Date of Issuance: 12/18/2024**

**SCOPE:**

This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The products described herein have been evaluated for compliance with the **8<sup>th</sup> Edition (2023) Florida Building Code, High Velocity Hurricane Zone sections noted herein.**

**DESCRIPTION: RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments (HVHZ)**

**LABELING:** Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein and **FBC HVHZ 1518.2.**

**CONTINUED COMPLIANCE:** This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance, or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

**ADVERTISEMENT:** "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be in its entirety.


**INSPECTION:** Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 4.

**Prepared by:**

**Digitally signed by  
Robert Nieminen  
Date: 2024.12.18  
'13:18:03 -05'00**

This item has been digitally signed and sealed by Robert Nieminen, P.E. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies. Robert Nieminen, Florida P.E. 59166, FBC ANE1983 NEMO ETC, LLC, Florida CA #32455

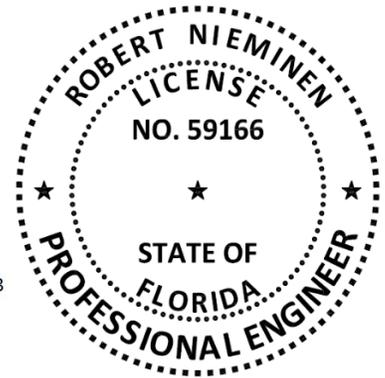

**CERTIFICATION OF INDEPENDENCE:**

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

**ROOFING COMPONENT EVALUATION:**

**1. SCOPE:**

**Product Category:** Roofing  
**Sub-Category:** Underlayment  
**Product Approval Method:** Method 1, Option D – Codified Material, Evaluation by Engineer  
**Compliance Statement:** RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments, as produced by Owens Corning Roofing and Asphalt, LLC, have demonstrated compliance with the following sections of the 8<sup>th</sup> Edition (2023) Florida Building Code, High Velocity Hurricane Zone through testing in accordance with applicable sections of the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

**2. STANDARDS:**

SECTION	PROPERTIES	STANDARD
1518.2	Material standard	ASTM D8257

**3. REFERENCES:**

ENTITY	EXAMINATION	REFERENCE	DATE
PRI (TST5878)	ASTM D8257-20	1378T0138	02/25/2021
PRI (TST5878)	ASTM D8257-20	1378T0141	05/18/2021
PRI (TST5878)	ASTM D8257-20	1378T0273	10/25/2022
PRI (QUA9110)	Quality Control	PRI Validation Program	Current

**4. PRODUCT DESCRIPTION:**

TABLE 1: EVALUATED UNDERLAYMENTS			
PRODUCT	SPECIFICATION	PLANT(S)	DESCRIPTION
RhinoRoof U10	ASTM D8257 <sup>1</sup>	Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment
RhinoRoof U20	ASTM D8257 <sup>1</sup>	Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment
ABC Pro Guard 20	ASTM D8257 <sup>1</sup>	Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment
SRS TopShield TS20	ASTM D8257 <sup>1</sup>	Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment

**5. LIMITATIONS:**

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is exclusively for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC HVHZ 1516** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.

<sup>1</sup> Agreement between purchaser and seller, as set forth in Section 4.3, Note 1 of ASTM D8257-20, should be established as to slip resistance.

5.5 **RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this evaluation combined with supporting data for the prepared roof covering.

5.6 **Allowable roof covers:**

TABLE 2: ROOF COVER OPTIONS					
<i>FBC HVHZ:</i>	<i>RAS 115, 1518.2.1</i>	<i>RAS 118, 119 &amp; 120</i>	<i>RAS 133, 1518.2.1</i>	<i>1518.2.1</i>	<i>RAS 130, 1518.10</i>
UNDERLAYMENT	ASPHALT SHINGLES	ROOF TILE	METAL	SLATE OR SLATE-TYPE SHINGLES	WOOD SHINGLES AND SHAKES
RhinoRoof U10	Yes	No	Yes	No	Yes
RhinoRoof U20	Yes	No	Yes	No	Yes
ABC Pro Guard 20	Yes	No	Yes	No	Yes
SRS TopShield TS20	Yes	No	Yes	No	Yes

5.7 **Exposure Limitations:**

TABLE 3: EXPOSURE LIMITATIONS		
UNDERLAYMENT	PREPARED ROOF COVER INSTALLATION TYPE	MAXIMUM EXPOSURE (DAYS)
RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 or SRS TopShield TS20	Mechanically attached	90

**6. INSTALLATION:**

6.1 **RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments** shall be installed in accordance with the manufacturer’s published installation instructions subject to the [Limitations of Use](#) herein and the specifics noted below.

6.2 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application.

6.3 Underlayment Assemblies with Prescriptive Minimum Attachment for use in NON-TILE applications:

6.3.1 **CODE REFERENCE:** **1518.2.1, Option 2:** Self-adhering strips to deck-joints followed by underlayment mechanically attached to deck

DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction
SECONDARY WATER BARRIER:	Min. 3 ¼-inch wide strips of <b>Titanium PSU30</b> or <b>Titanium FR (NOA 23-1102.02)</b> or other FBC HVHZ Approved self-adhering joint-strip product over joints of the roof deck prior to installation of subsequent layer(s) in accordance with FBC Section 1507.1.1.1(2) or R905.1.1.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.
UNDERLAYMENT:	<b>RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 or SRS TopShield TS20</b> in accordance with FBC HVHZ Table 1518.2.1, with a minimum 4-inch side lap and 6-inch end lap, mechanically fastened to deck.
FASTENING:	FBC HVHZ Approved nails and tin caps ( <a href="#">FBC HVHZ 1517.5</a> ), grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC HVHZ Table 1518.2.1.
SURFACING:	FBC HVHZ Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles or wood shakes or shingles subject to the allowable roof covers in <a href="#">Table 2</a> herein.

6.3.2	<b>CODE REFERENCE:</b>	<b>1518.2.1, Option 3:</b> Two-layer underlayment mechanically fastened to deck
	DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction
	UNDERLAYMENT:	Two (2) layers of <b>RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 or SRS TopShield TS20</b> in accordance with FBC HVHZ 1518.2.1(3).
	FASTENING:	FBC HVHZ Approved nails and tin caps ( <a href="#">FBC HVHZ 1517.5</a> ) in accordance with FBC HVHZ 1518.2.1(3).
	SURFACING:	FBC HVHZ Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles or wood shakes or shingles subject to the allowable roof covers in <a href="#">Table 2</a> herein.

**7. BUILDING PERMIT REQUIREMENTS:**

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

**8. MANUFACTURING PLANTS:**

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

**9. QUALITY ASSURANCE ENTITY:**

[PRI Construction Materials Technologies, LLC](#) – (QUA9110); (813) 621-5777; [chris.moskal@pri-group.com](mailto:chris.moskal@pri-group.com)

- END OF PEER -

