




#### F9 STEM WALL FOOTING S-2 SCALE: 1/2" = 1'-0"

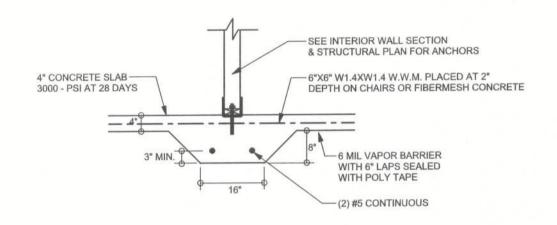


## F2 INTERIOR BEARING FOOTING S-2 SCALE: 1/2" = 1'-0"

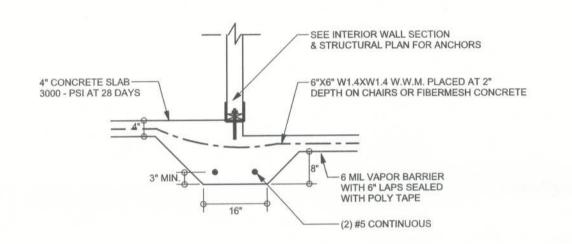


## F3 INTERIOR BEARING STEP FOOTING S-2 SCALE: 1/2" = 1'-0"

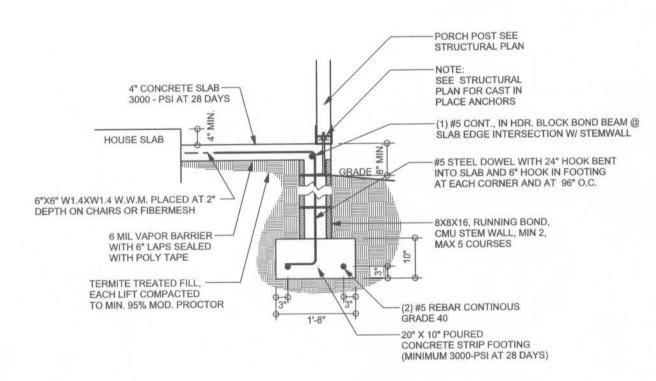


# F12 ALT. STEM WALL PORCH FOOTING S-2 SCALE: 1/2" = 1'-0"

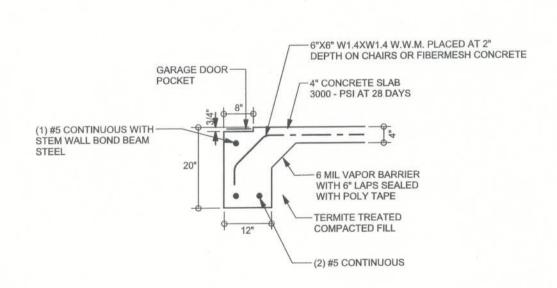


F13 ALT. STEM WALL GARAGE DOOR FOOTING
S-2 SCALE: 1/2" = 1'-0"

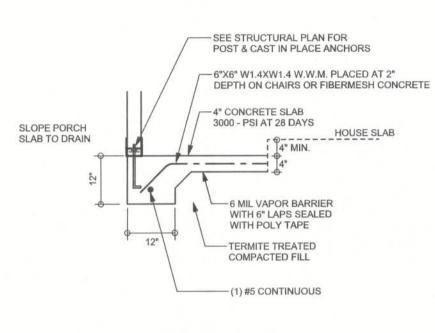

## F5 PORCH FOOTING S-2 SCALE: 1/2" = 1'-0"

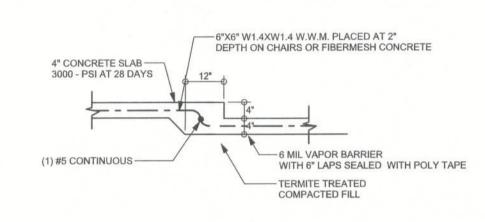

## F6 TYPICAL NON - BEARING STEP FOOTING S-2 SCALE: 1/2" = 1'-0"

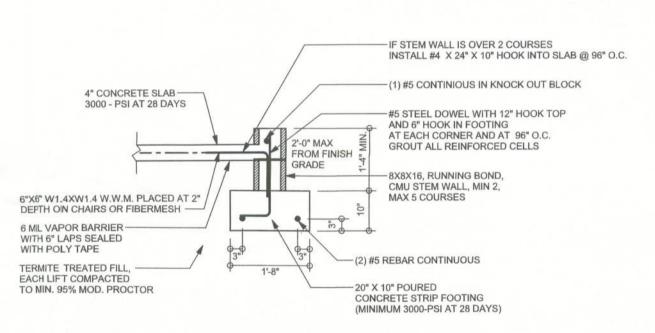


F18 STEM WALL CURB FOOTING
S-2 SCALE: 1/2" = 1'-0"

#### TALL STEM WALL TABLE

The table assumes 60 ksi reinforcing bars with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16"OC vertically or a horizontal bond beam with 1#5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.

STEMWALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEMWALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEMWALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

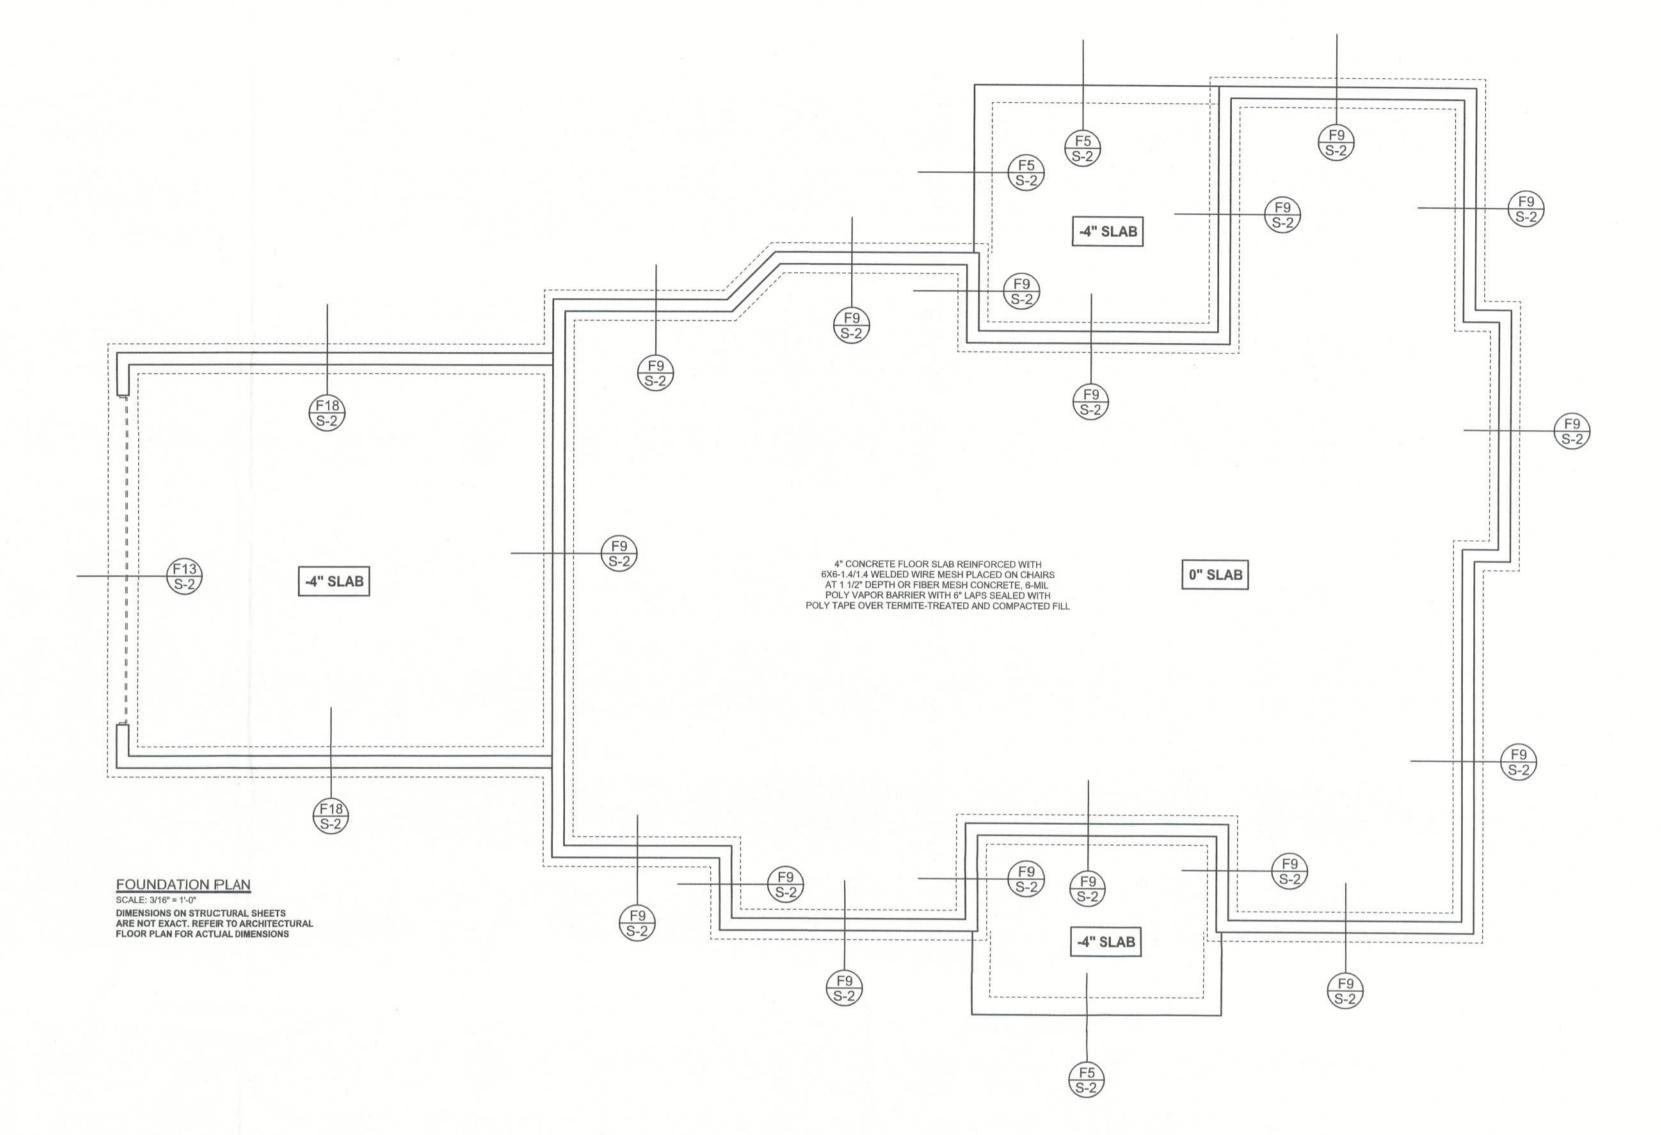

**REVISIONS** 

SOFTPIAN ARCHITECTURAL DESIGN SOFTWARE

WINDLOAD ENGINEER: Mark Disosway, PE No.53915, POB 868, Lake City, FL 32056, 386-754-5419

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have
examined this plan, and that the applicable

portions of the plan, relating to wind engineering comply with section 1606, florida building code 2001, to the best of my knowledge.

LIMITATION: This design is valid for one

LIMITATION: This design is valid for o building, at specified location.

MARK DISOSWAY
P.E. 53915

DON REED
CONSTRUCTION

Daugherty Residence

ADDRESS: Columbia County, Florida

Mark Disosway P.E. P.O. Box 868 Lake City, Florida 32056 Phone: (386) 754 - 5419 Fax: (386) 269 - 4871

PRINTED DATE:
September 30, 2005

DRAWN BY: CHECKED BY
David Disosway

FINALS DATE: 30 / Sep / 05

JOB NUMBER: 509307

S-2

OF 3 SHEETS