

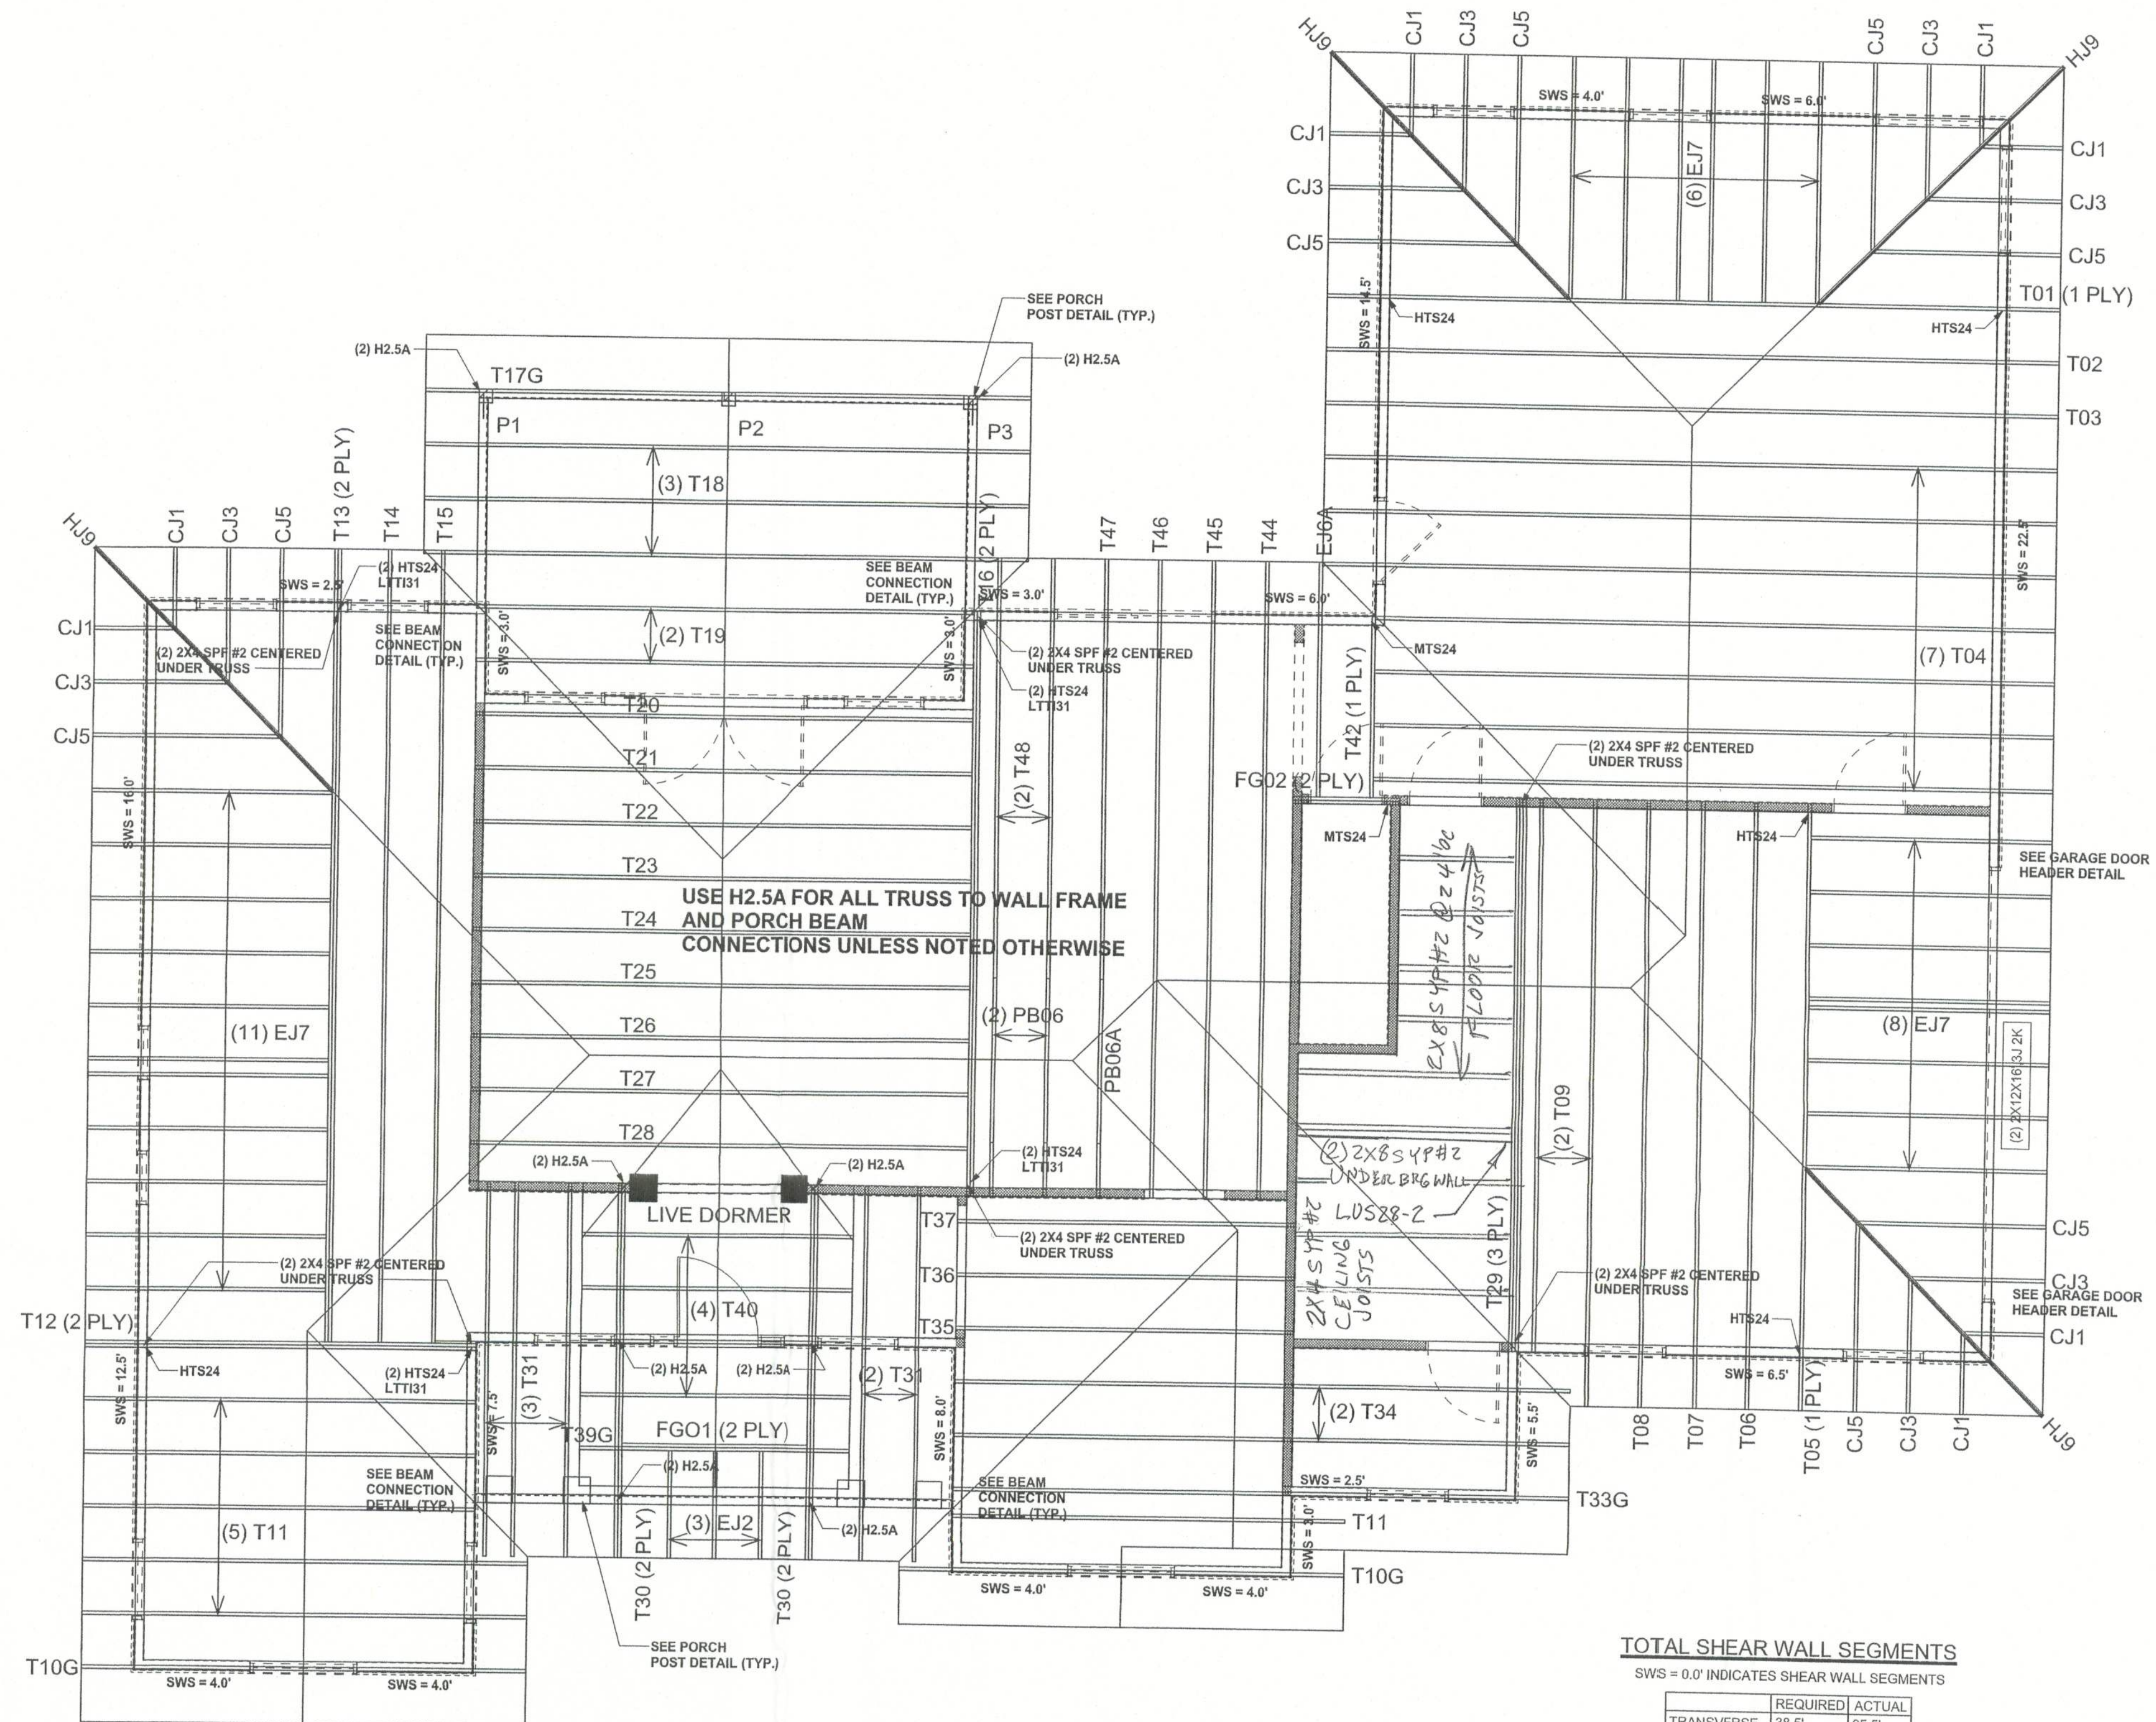
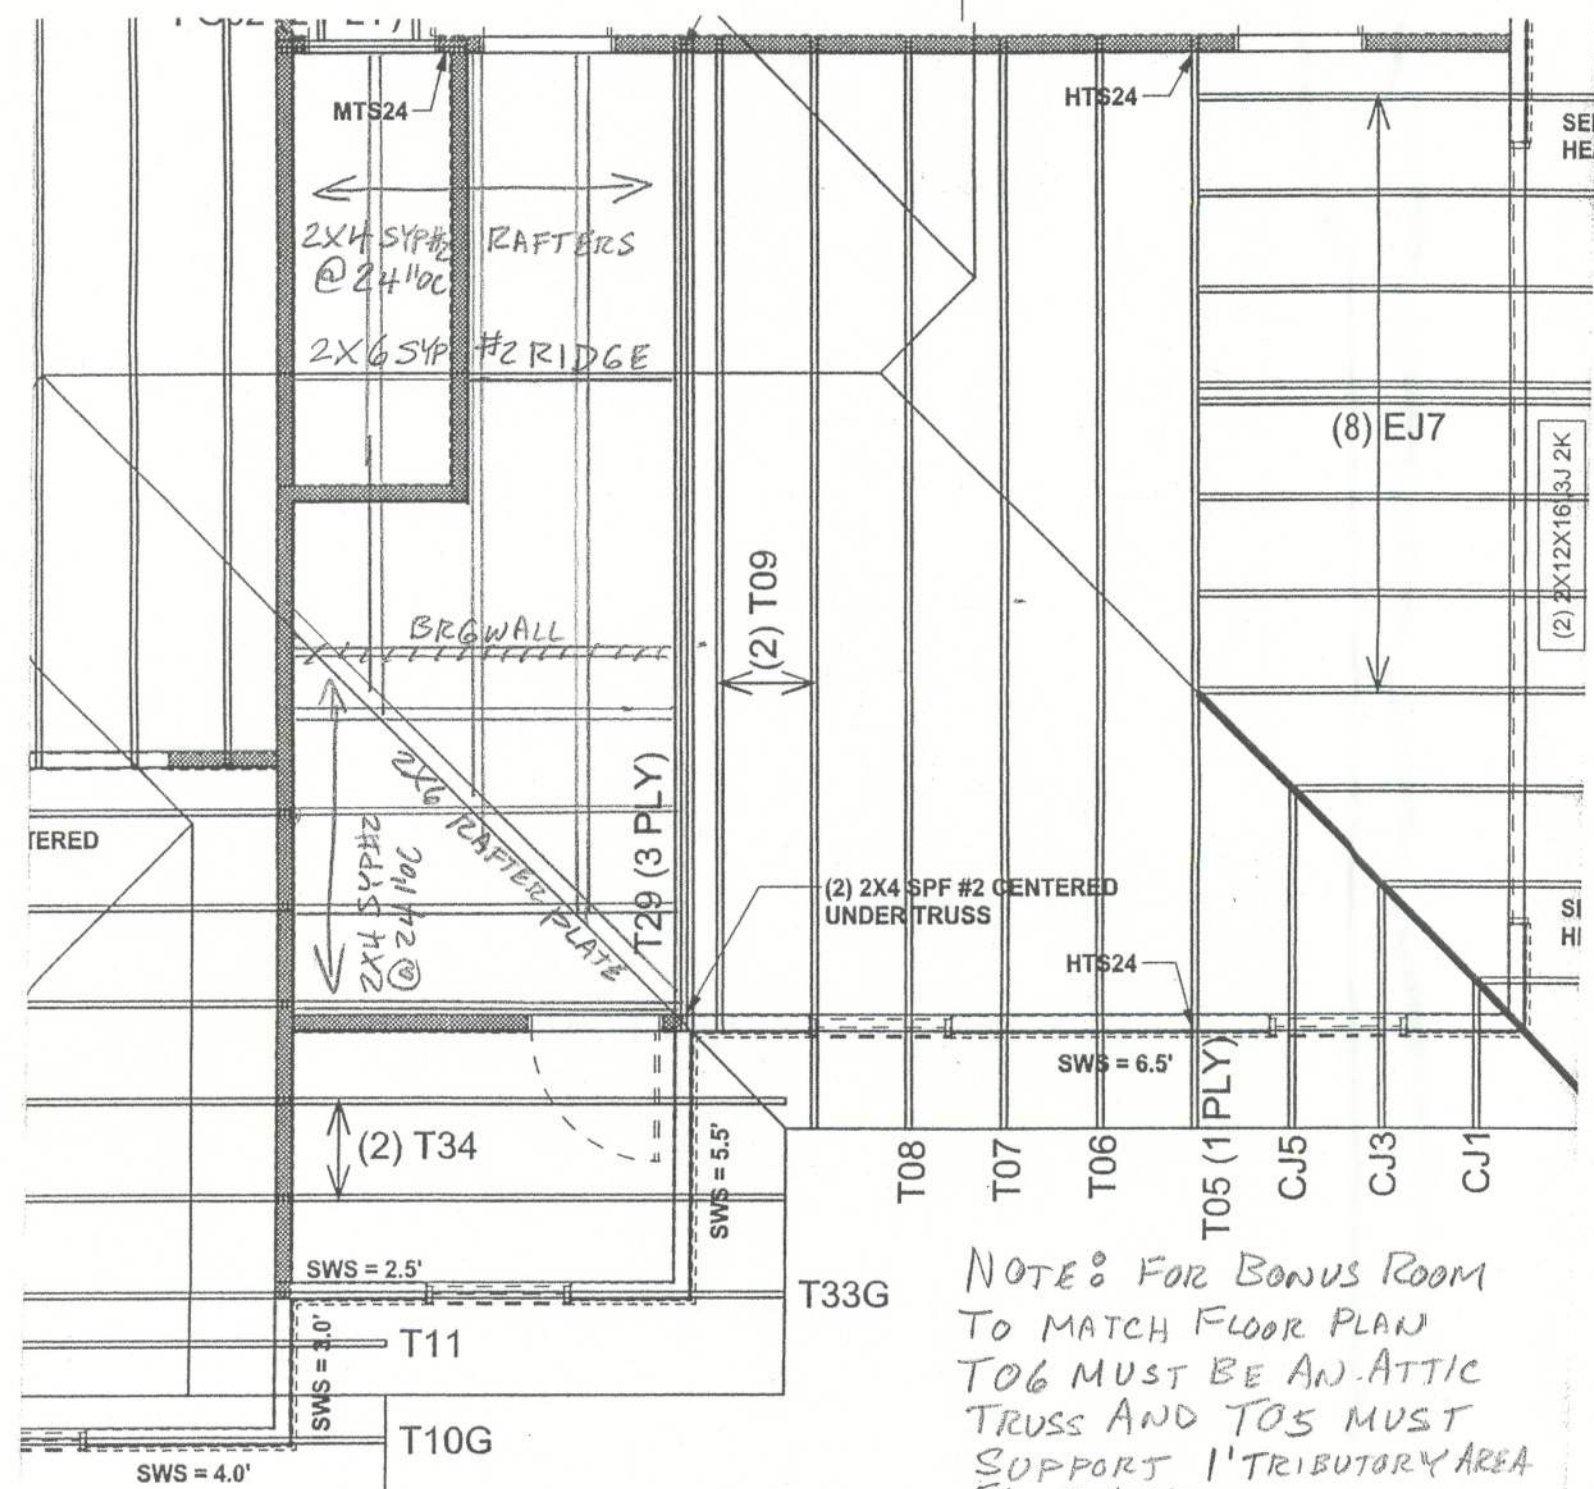
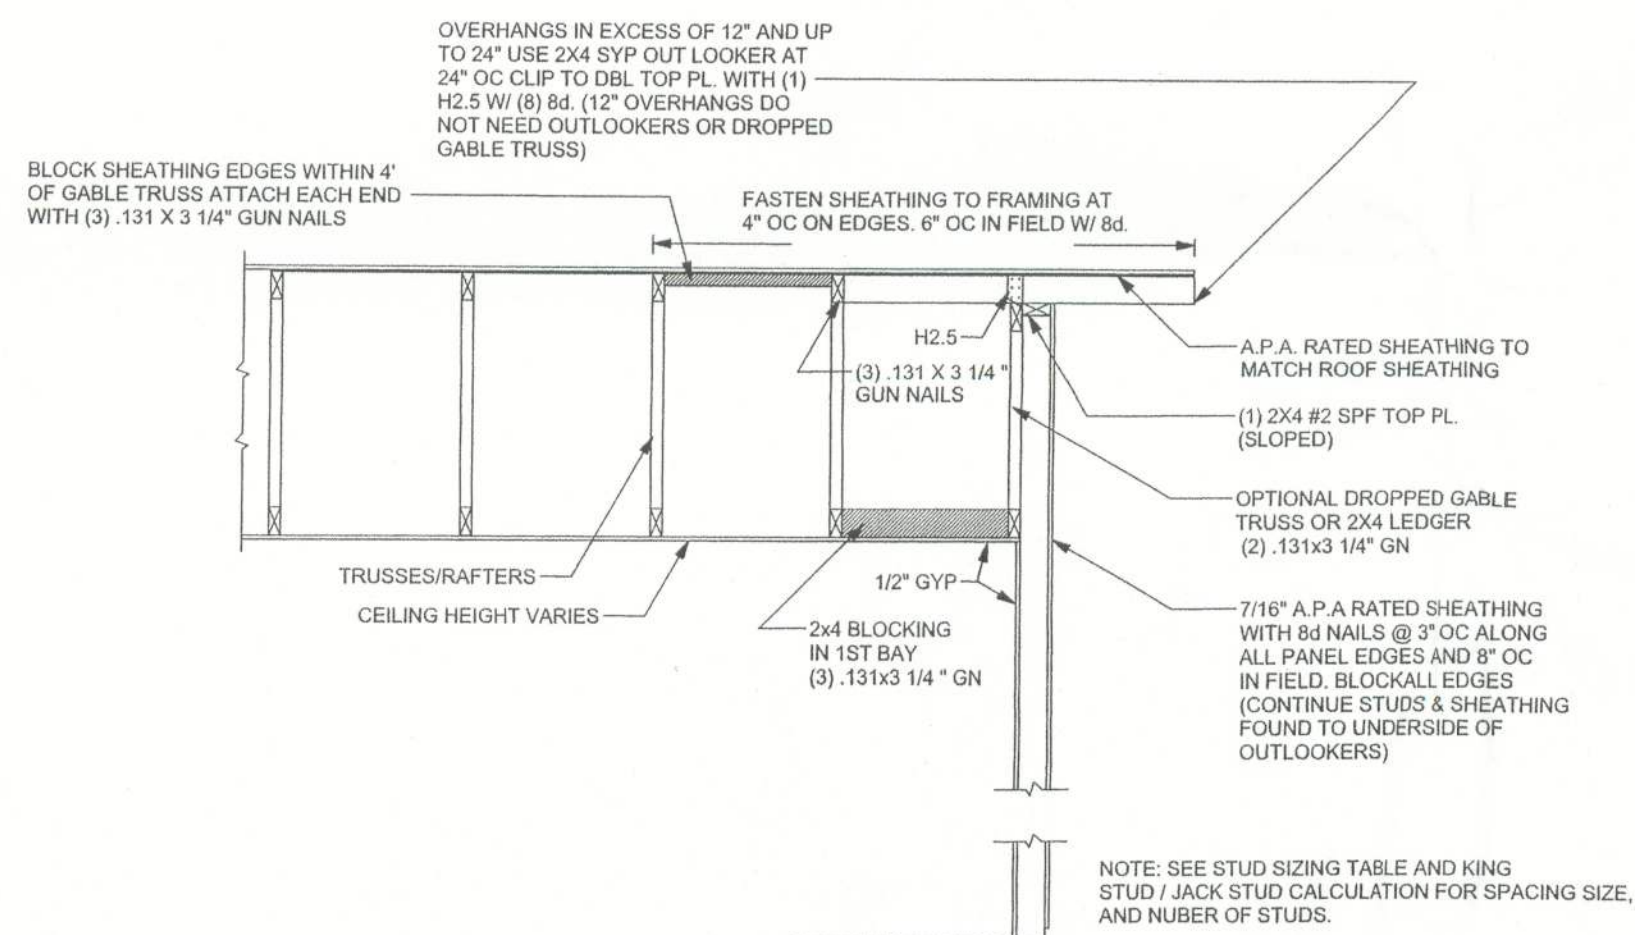


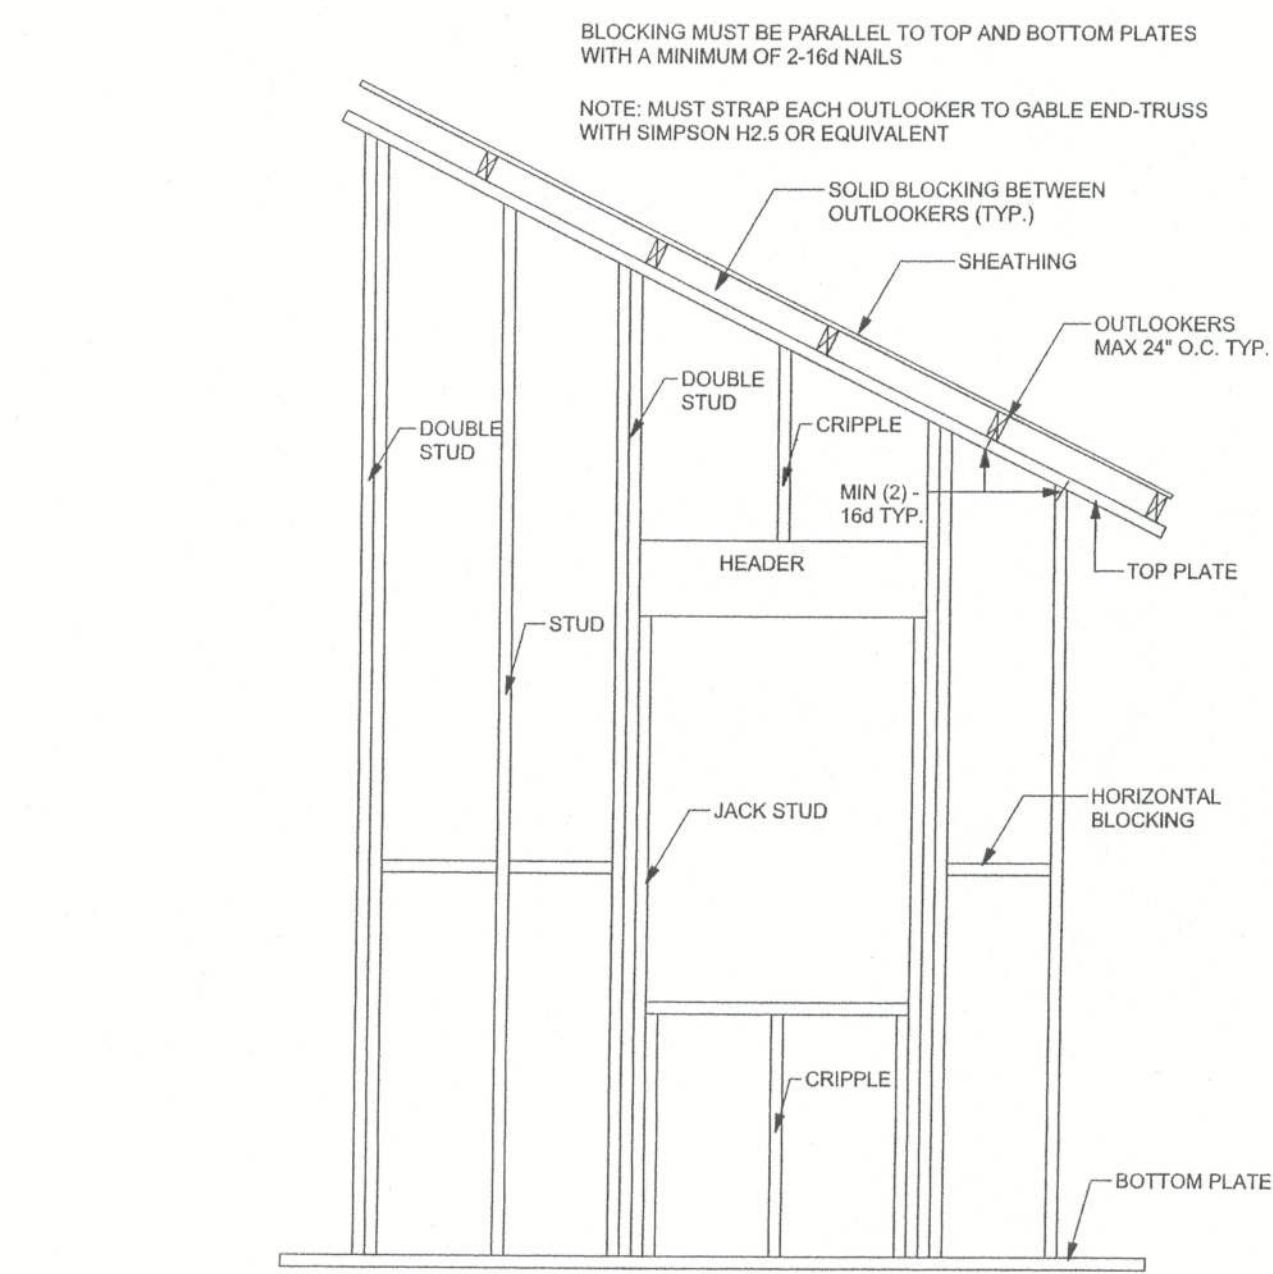

|      |                                                                                                                                                                                                                                                                         |
|------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| SN-1 | ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X10 SYP#2 (U.N.O.)                                                                                                                                                                               |
| SN-2 | ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)                                                                                                                                                                         |
| SN-3 | DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS                                                                                                                                                                  |
| SN-4 | PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI#1-03, BCSI#1, BCSI#2, & BCSI#3. BCSI#1, BCSI#2, & BCSI#3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE |

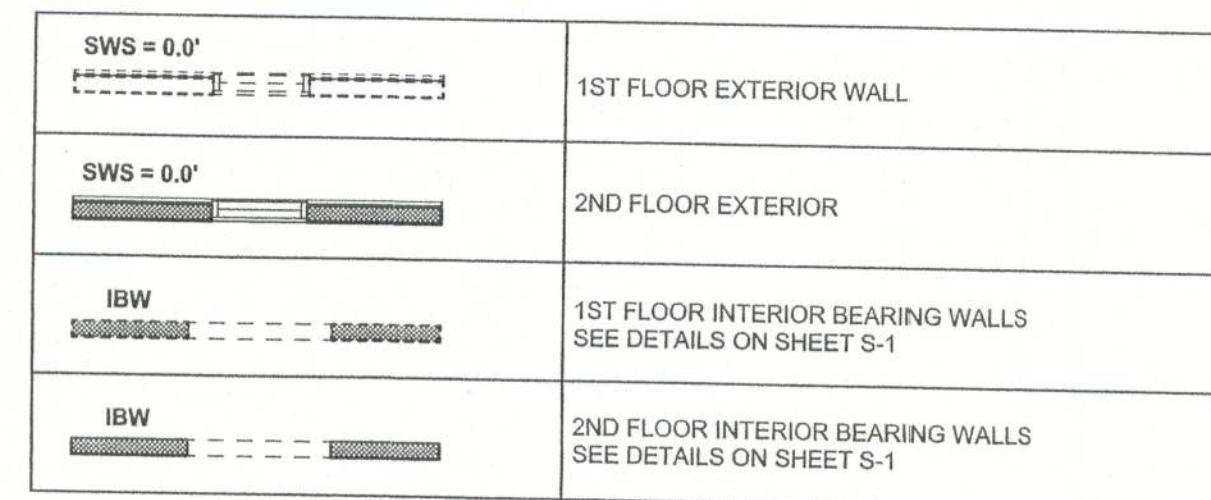

**TOTAL SHEAR WALL SEGMENTS**

SWS = 0.0' INDICATES SHEAR WALL SEGMENTS

|              | REQUIRED | ACTUAL |
|--------------|----------|--------|
| TRANSVERSE   | 38.5'    | 95.5'  |
| LONGITUDINAL | 32.5'    | 46.5'  |

CONNECTIONS, WALL, & HEADER DESIGN IS BASED  
ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING  
FURNISHED BY BUILDER. BUILDERS FIRST SOURCE  
(JOB #L121456)

**INDOOL ENGINEER:** Mark Disoway,  
No. 53917, P.O. Box 898, Lake City,  
Tennessee, 38674-7514

**DIMENSIONS:** Indicated dimensions suppose scaled  
dimensions. Refer all questions to  
ark Disoway, P.E. for resolution.  
Do not proceed without clarification.

**COPYRIGHTS AND PROPERTY RIGHTS:**  
ark Disoway, P.E. hereby expressly reserves  
all copyright and property right in  
these instruments. No part of this document is  
to be reproduced, altered or copied in any  
manner without first the express written  
permission and consent of Mark Disoway.

**CERTIFICATION:** I hereby certify that I have  
examined this plan, and that the applicable  
provisions of the Florida Building Code  
comply with section 1606, Florida building code  
1, to the best of my knowledge.

**EXPIRATION:** This design is valid for one  
building, at specified location.

ARK DISOSWAY  
P.F. 53915

ADDRESS:  
Columbia County, Florida  
Mark Disosway P.E.  
P.O. Box 868  
City, Florida 32056  
e: (386) 754 - 5419  
(386) 269 - 4871

|                                     |                                  |
|-------------------------------------|----------------------------------|
| PRINTED DATE:<br>September 30, 2005 |                                  |
| DRAWN BY:<br>David Disosway         | STRUCTURAL BY:<br>David Disosway |

|                                             |  |
|---------------------------------------------|--|
| ISSUALS DATE:<br>5 / Aug / 05               |  |
| JOB NUMBER:<br>506032                       |  |
| DRAWING NUMBER<br><b>S-3</b><br>OF 6 SHEETS |  |