



REVISIONS	

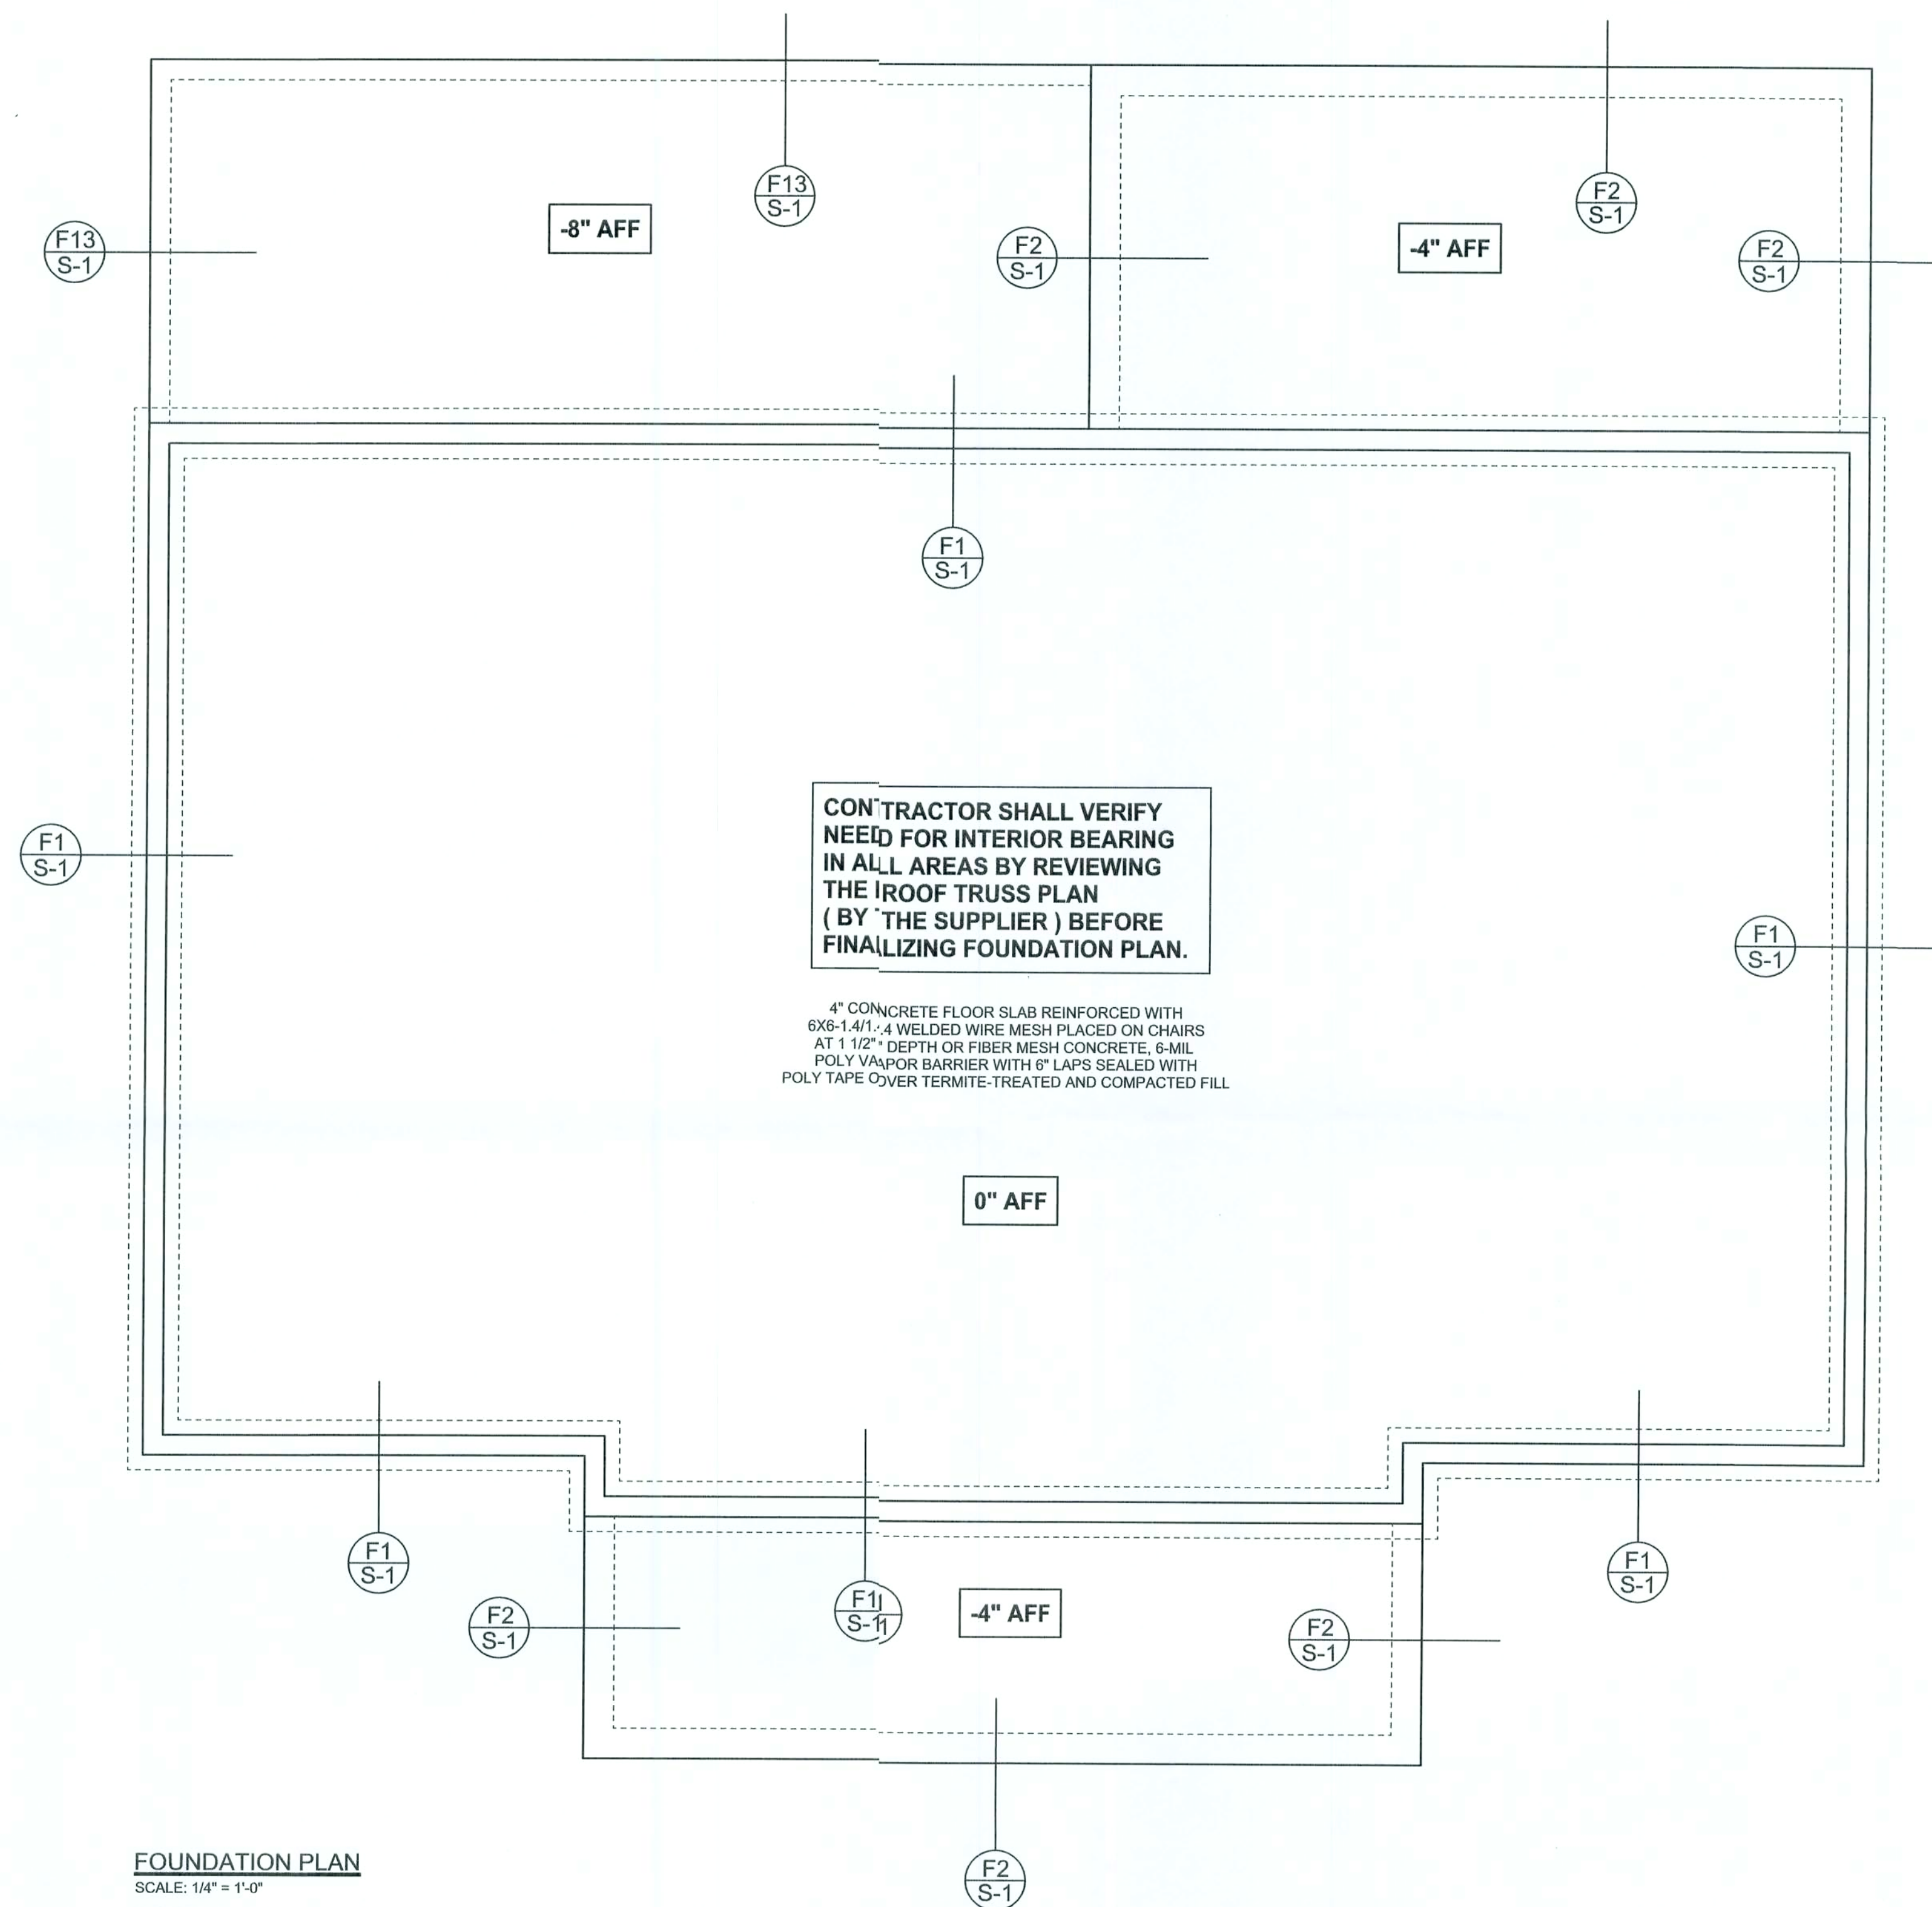

FOUNDATION PLAN
SCALE: 1/4" = 1'-0"
DIMENSIONS ON STRUCTURAL SHEETS
ARE NOT EXACT. REFER TO ARCHITECTURAL
FLOOR PLAN FOR ACTUAL DIMENSIONS

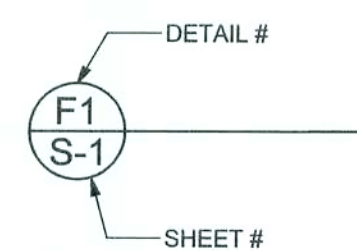

WINDLOAD ENGINEER: Mark Disosway,
PE No. 53915, PCB 868, Lake City, FL
32056, 386-754-5419

DIMENSIONS:
Stated dimensions supersede scaled
dimensions. Refer all questions to
Mark Disosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Disosway.

CERTIFICATION: These plans and
"Windload Engineering", Sheet S-1, attached,
comply with Florida Building Code 2004,
Section 109 wind loads, to the best of my
knowledge.

LIMITATION: This design is valid for one
building a specified location. In case of conflict,
structural requirements, scope of work, and
builder responsibilities on sheet S-1 control.

MARK DISOSWAY
P.E. 53915
Mark Disosway
11/11/06
SEAL

Cedric & Shellie
May Residence

ADDRESS:
Lot 5 Hollingsworth Estates S/D
Ft. White, Florida

Mark Disosway P.E.
P.O. Box 868
Lake City, Florida 32056
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871

PRINTED DATE:
April 11, 2006

DRAWN BY: David Disosway CHECKED BY:

FINAL DATE:
11 / Apr / 06

JOB NUMBER:
508221

DRAWING NUMBER
S-2
OF 2 SHEETS



* RIGHT SIDE ELEVATION *

SCALE : 1/4" = 1'-0"



* LEFT SIDE ELEVATION *

SCALE : 1/4" = 1'-0"



* FRONT ELEVATION *

SCALE : 1/4" = 1'-0"



* REAR ELEVATION *

SCALE : 1/4" = 1'-0"

REVISIONS	
JULY 26 2005	
JULY 27 2005	
JULY 28 2005	
AUG 23 2005	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

RESIDENCE
for
CEDRIC & SHELLIE
MAY
IN
UNION CO., FLORIDA

Teresa M. Ruffo
251 NW Hall of Fame Dr.
Lake City, Florida 32055
Phone: (386) 755 - 9933
Cell: (386) 867 - 1191
Email: ead@teresa-ruffo.com

PRINTED DATE:
August 29, 2005

DRAWN BY: CHECKED BY:
Teresa M. Ruffo

BUILDING CONTRACTOR:
J. J. CEMBRUCH


FINALS DATE:
AUGUST 2005

JOB NUMBER:

DRAWING NUMBER

4-2

OF 3 SHEETS

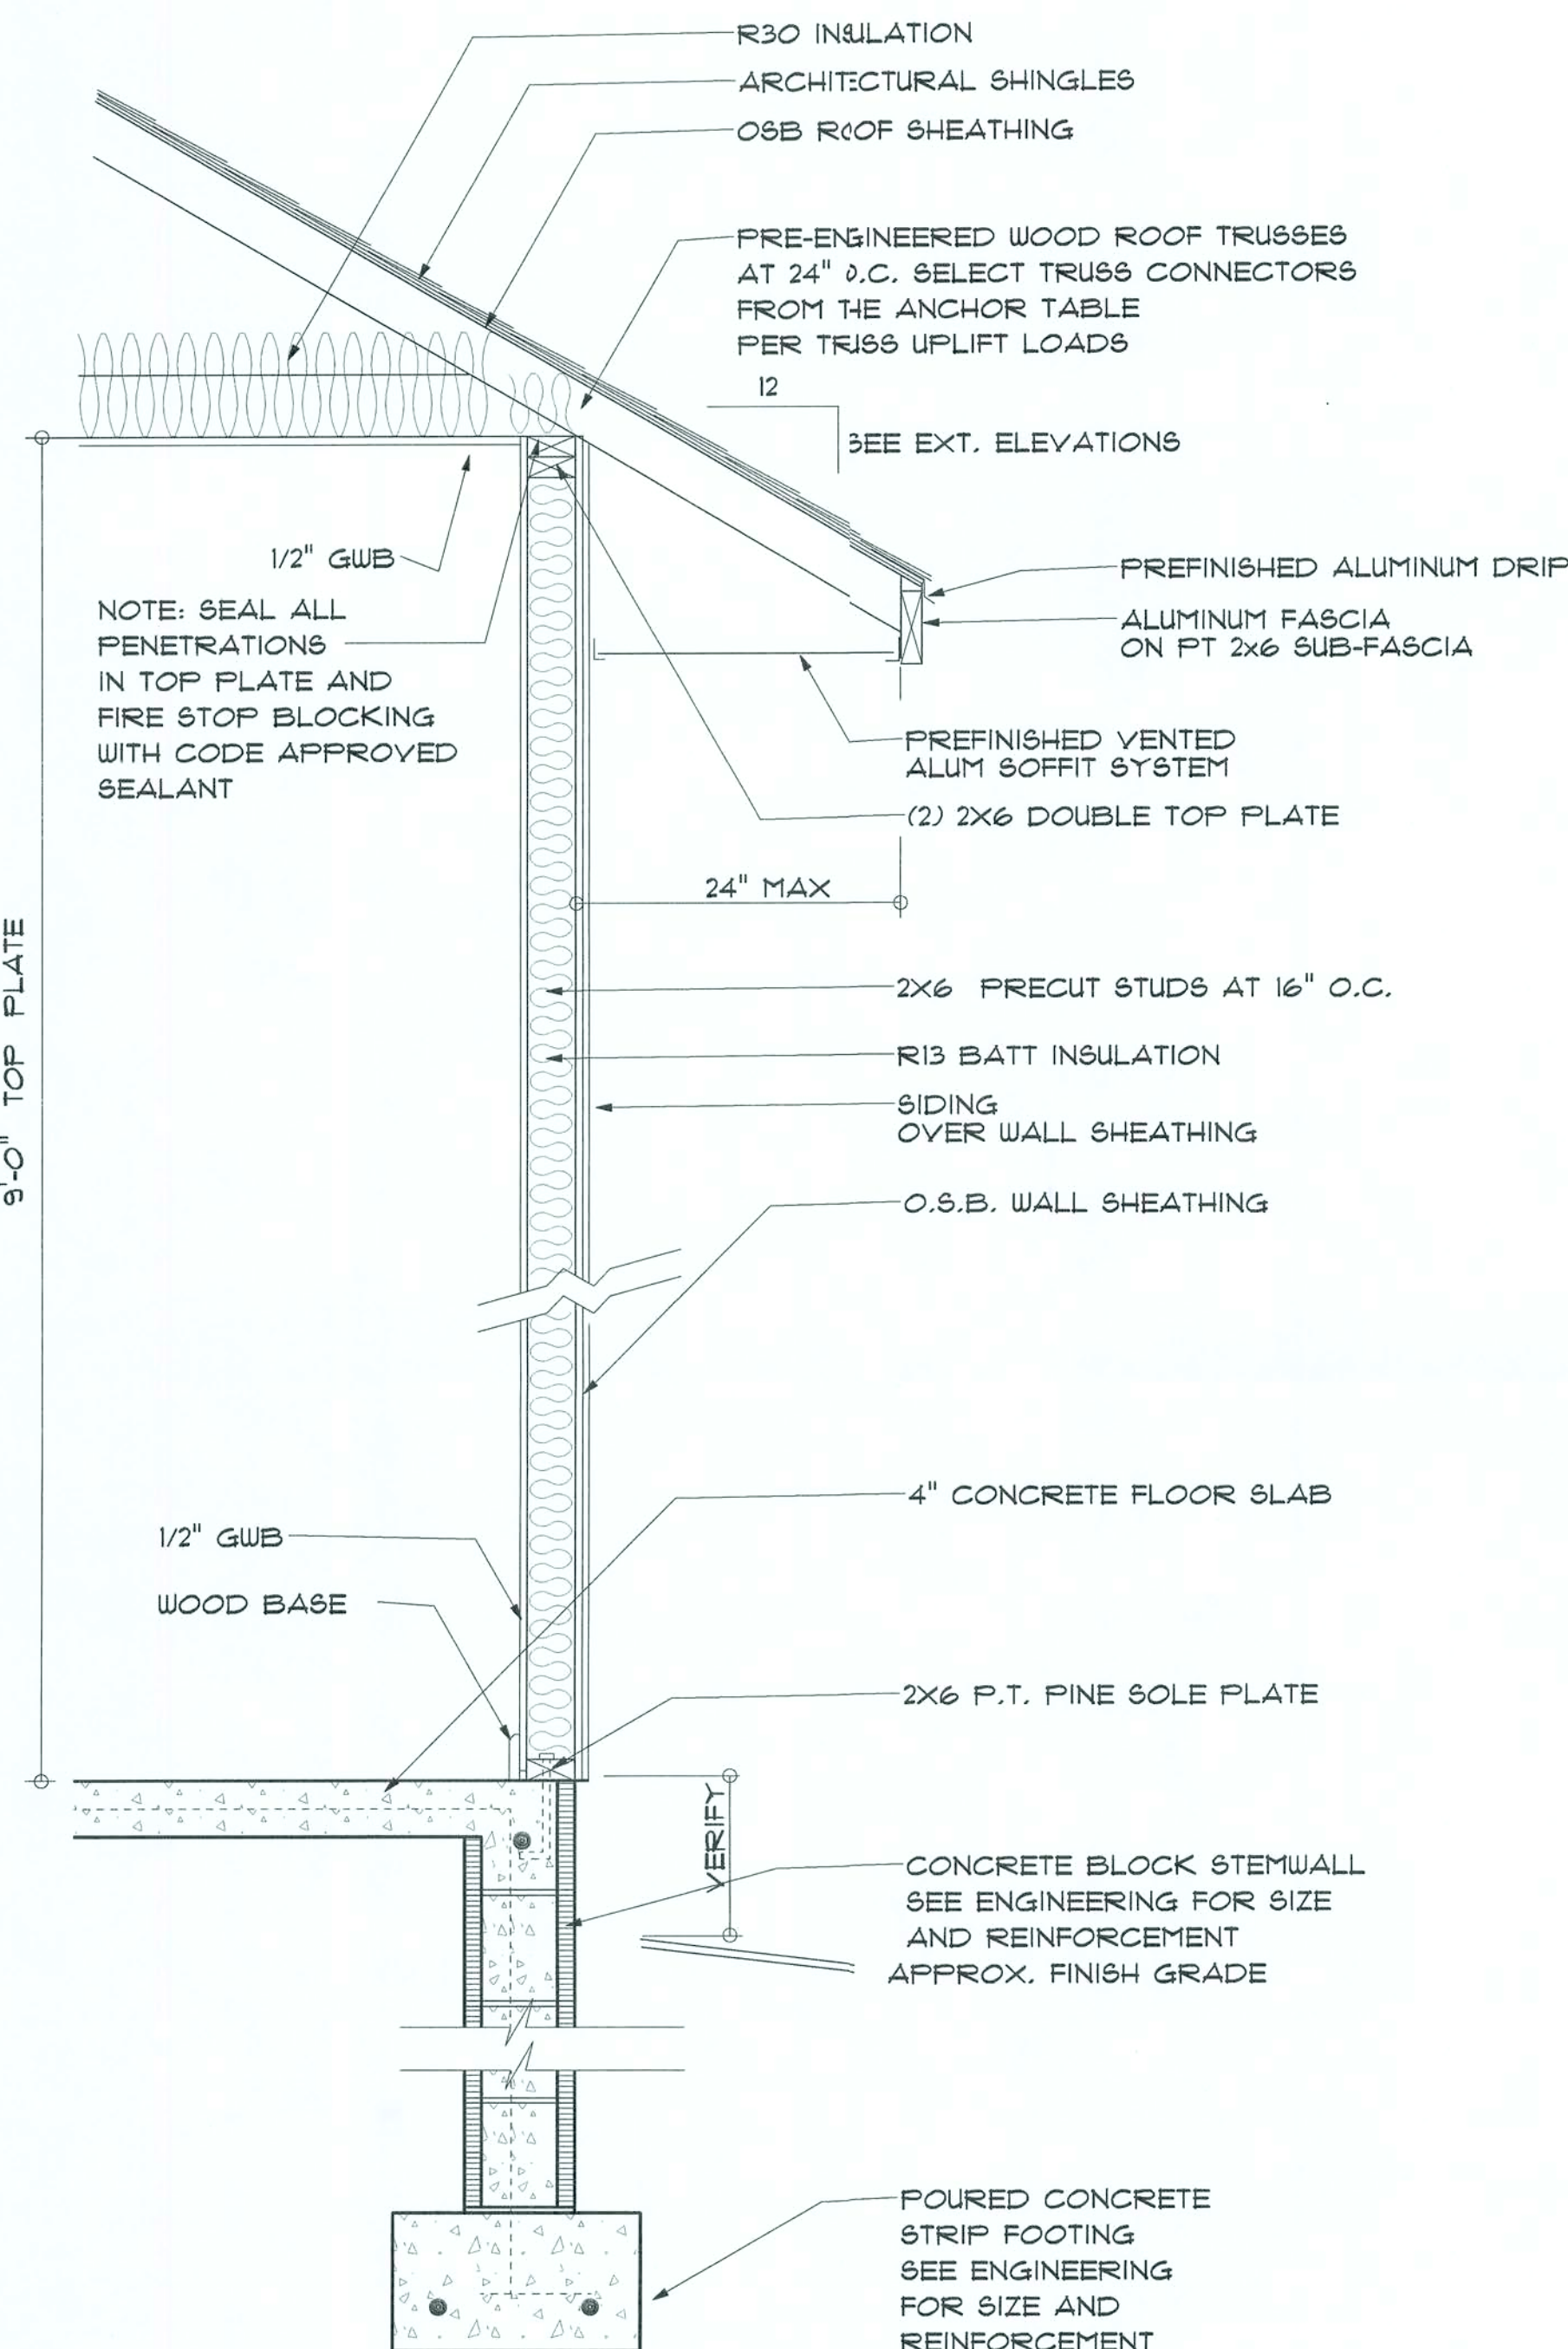

TYPICAL DESIGN WALL SECTION
NON - STRUCTURAL DATA


NOT TO SCALE

ELECTRICAL PLAN NOTES

- E-1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUFACTURERS SPECIFICATIONS.
- E-2 CONSULT THE OWNER FOR THE NUMBER OF SEPARATE TELEPHONE LINES TO BE INSTALLED.
- E-4 ALL INSTALLATIONS SHALL BE PER NATIONAL ELECTRIC CODE.
- E-3 ALL SMOKE DETECTORS SHALL BE 120V W/BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE, AND NEAR ALL BEDROOMS.
- E-5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNERS DIRECTION AND IN ACCORDANCE WITH APPLICABLE SECTIONS OF NATIONAL ELCT. CODE LATEST EDITION.
- E-6 ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- E-7 ENTRY OF SERVICE UNDERGROUND OR OVERHEAD IS TO BE DETERMINED BY THE POWER COMPANY.
- E-8 ALL BEDROOM RECEPTALS ARE TO BE AFCI (ARC FAULT CIRCUIT INTERRUPT.)

* ELECTRICAL PLAN *

SCALE : 1/4" = 1'-0"

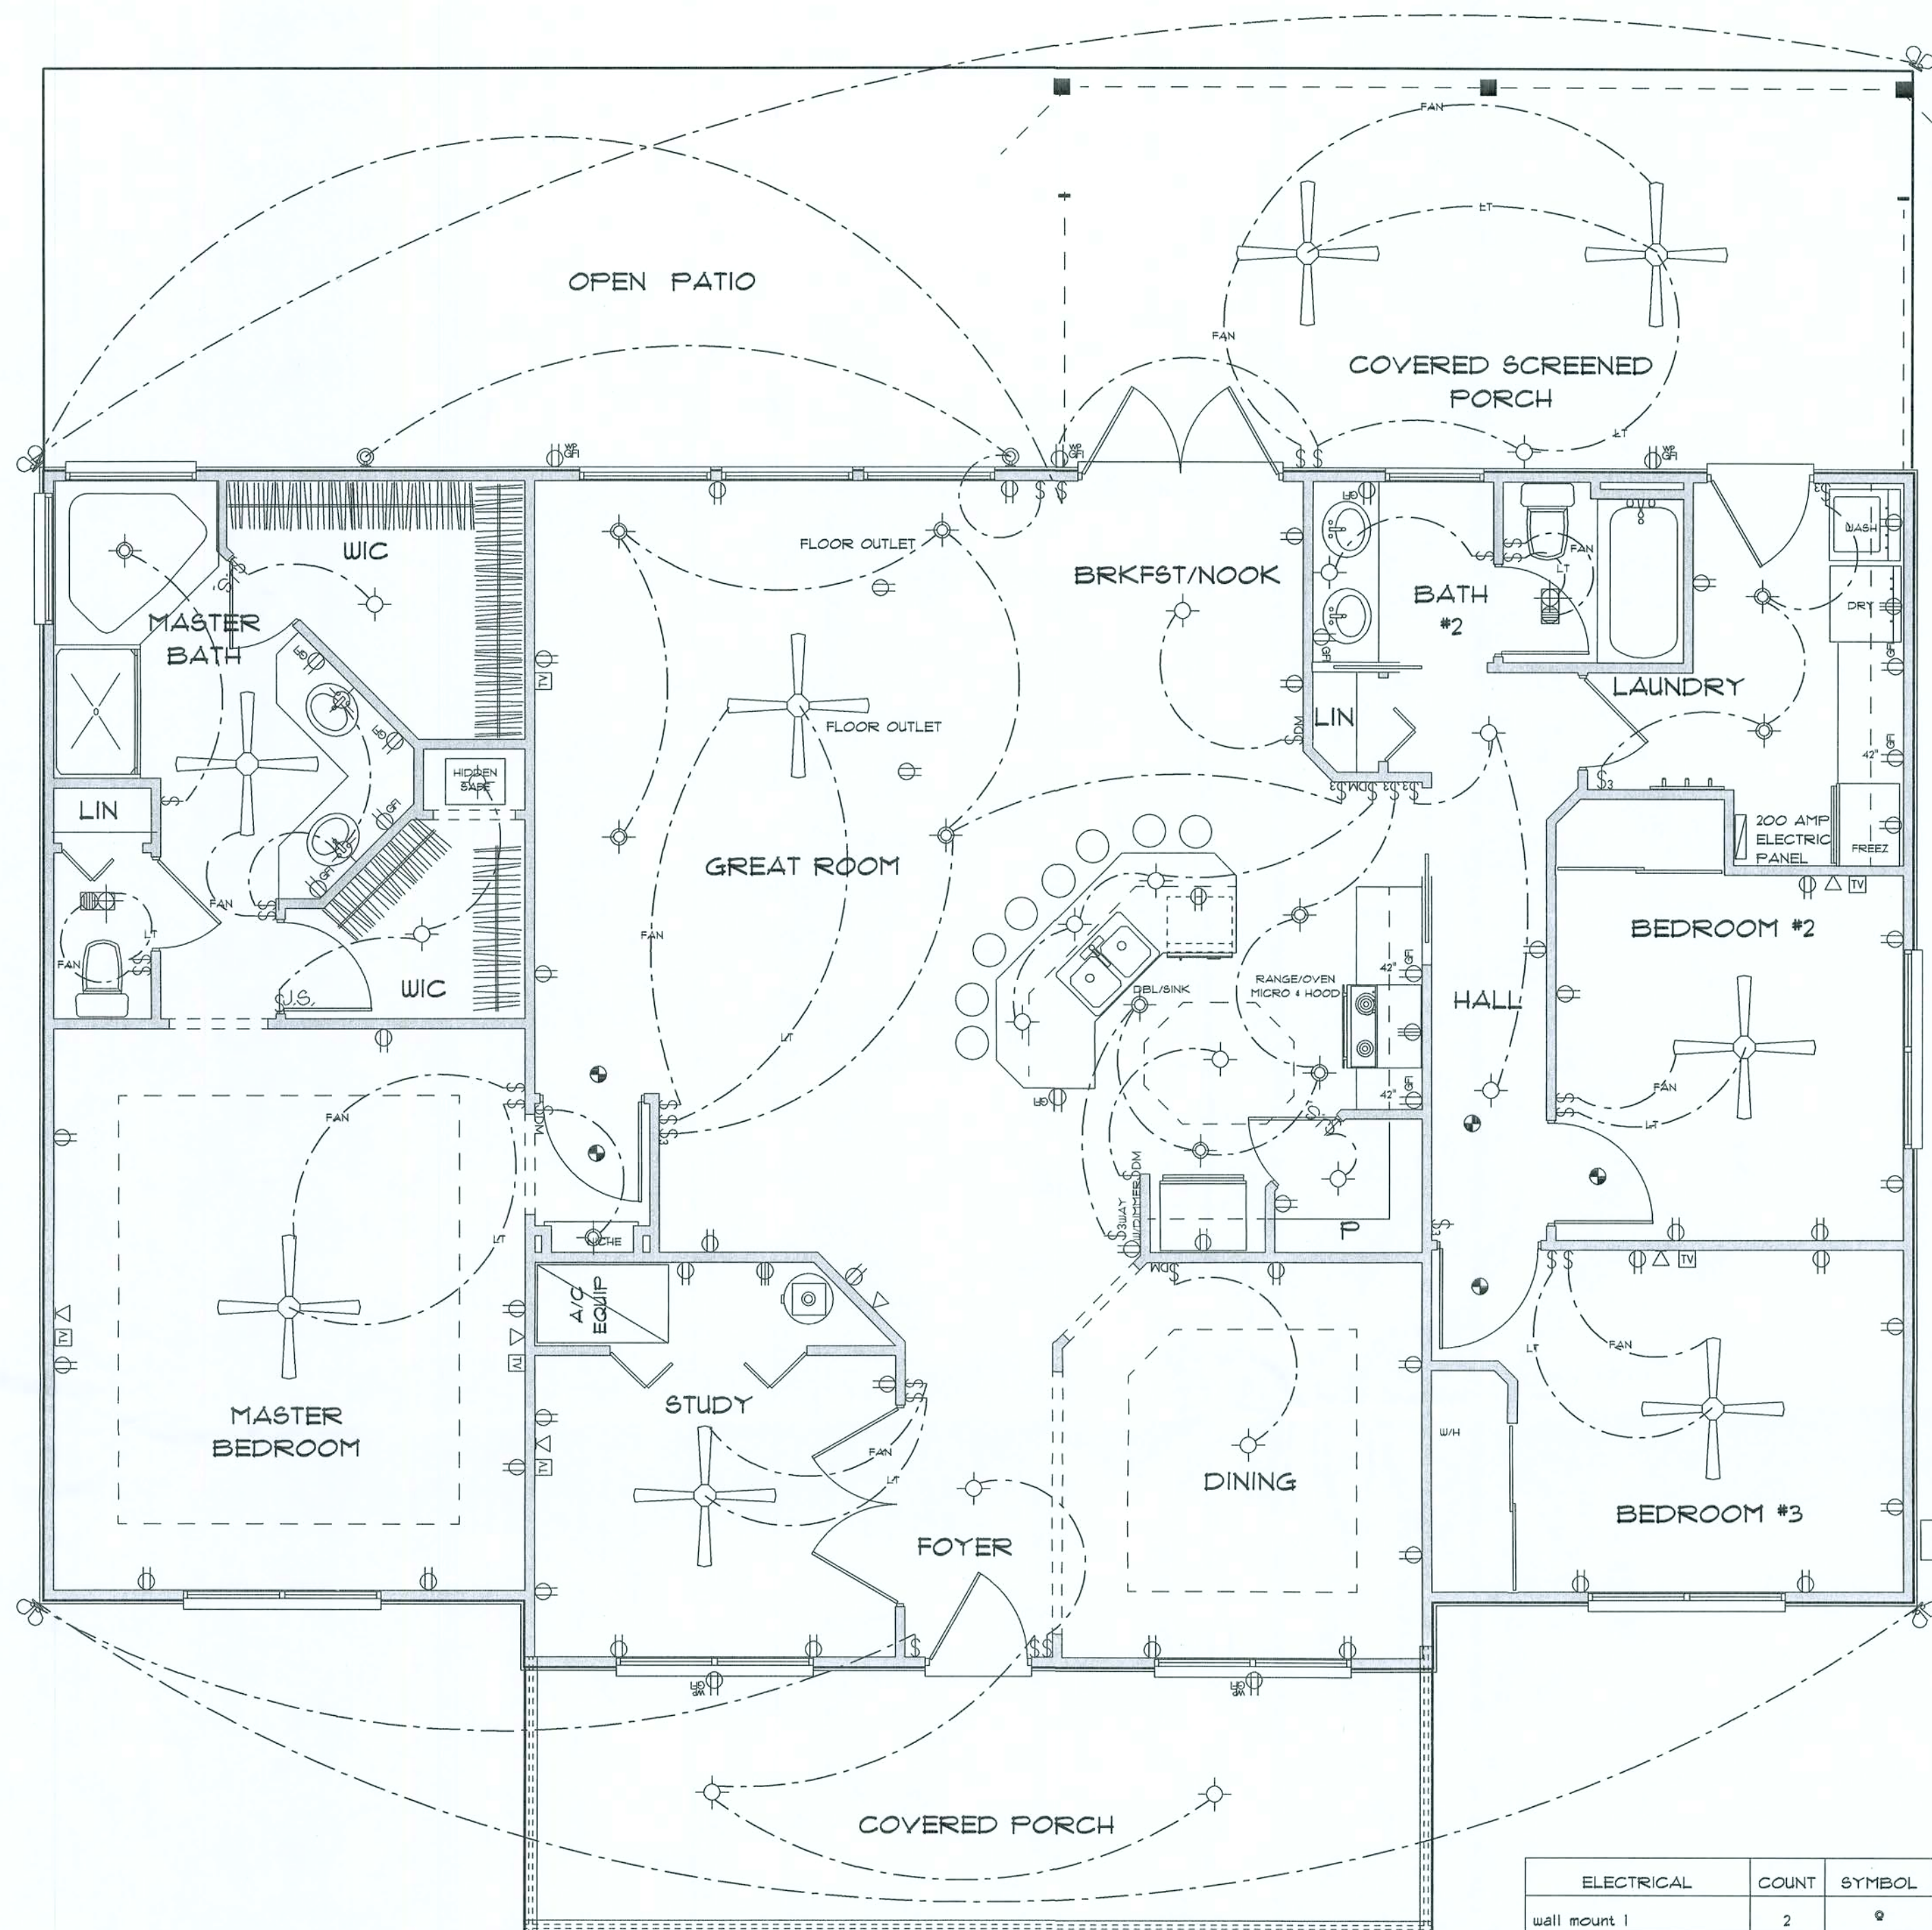

ELECTRICAL	COUNT	SYMBOL
wall mount 1	2	⊙
200 amp service panel	1	⊠
3 way switch with dimmer	1	⊕
cable tv outlet	6	⊞
ceiling fan	8	⊕
able flood lights	4	⊙
dimmer switch	5	⊕
electric meter	1	⊠
floor outlet	2	⊞
gfi waterproof outlet	5	⊞
jamb switch	3	⊕
light	19	⊕
outlet	46	⊞
outlet 220v	3	⊞
outlet gfi	11	⊞
recessed can light	12	⊕
smoke detector	5	⊕
switch	25	⊕
switch 3 way	7	⊕
telephone	6	⊞
vent light combo	2	⊞

REVISIONS

JULY 26 2005
JULY 27 2005
JULY 28 2005
AUG 23 2005

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

RESIDENCE
for
CEDRIC & SHELLIE
MAY
IN
UNION CO., FLORIDA

Teresa M. Ruffo
251 NW Hill of Fame Dr.
Lake City, Florida 32055
Phone: (386) 755 - 9993
Cell: (386) 867 - 1191
Email: tsgruffo@att.net

PRINTED DATE:
August 29, 2005

DRAWN BY: J. J. CEMBRUCH
CHECKED BY:

BUILDING CONTRACTOR
J. J. CEMBRUCH


FINALS DATE:
AUGUST 2005

JOB NUMBER:

DRAWING NUMBER


A-3

OF 3 SHEETS

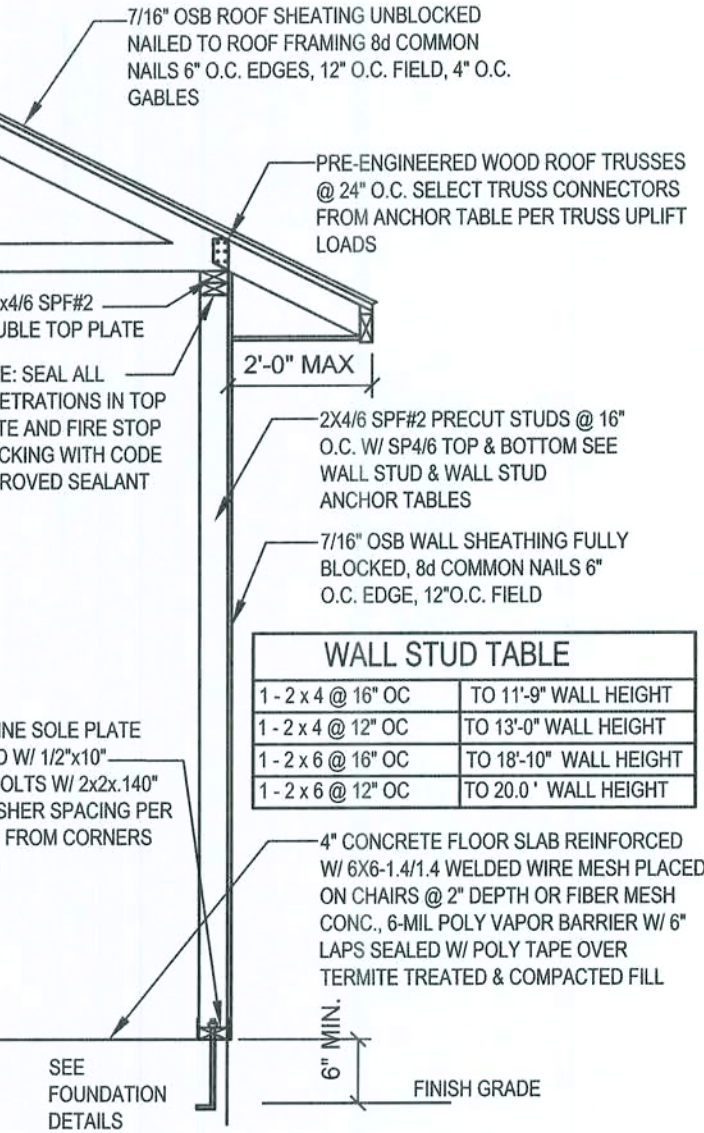


STUD ANCHOR TABLE			
TYPICAL TRUSS UPLIFT & MAX 1/2\"	ANCHOR BOLT SPACING	SP4/SP5 SPACING	ALTERNATE SPACING
770 LB	48\"	48\"	NA
850 LB	48\"	32\"	NA
1270 LB	32\"	16\"	32\"
1500 LB	24\"	16\"	16\"
2200 LB	12\"	8\"	12\"


W1 - SINGLE STORY EXT. WALL SECTION
SCALE: 1/2\"/>

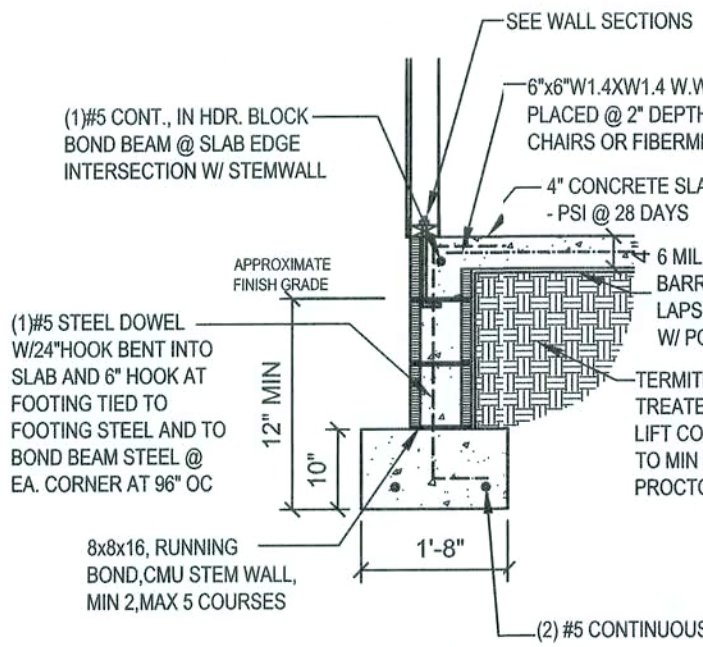


F1 - STEM WALL FOUNDATION
SCALE: 1/2\"/>

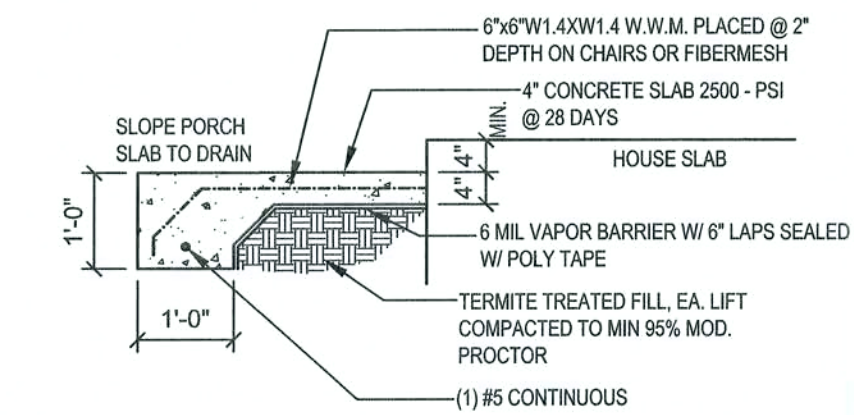


F2 - PORCH SLAB
SCALE: 1/2\"/>

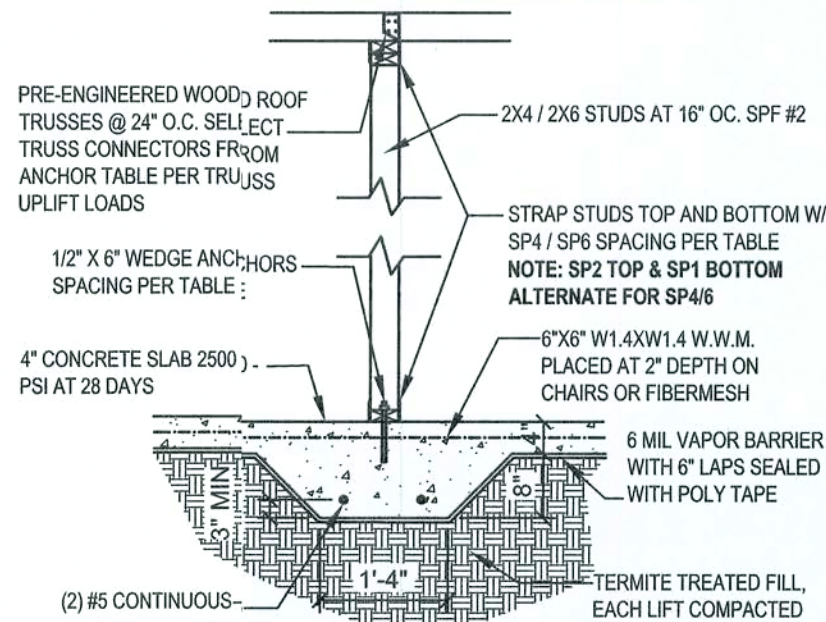


F4 - INTERIOR BEARING FOOTING
SCALE: 1/2\"/>

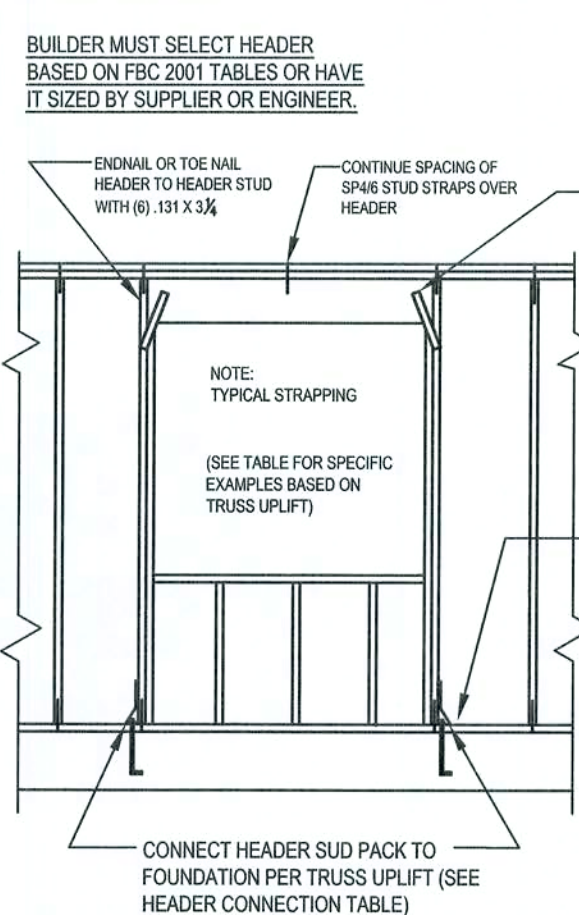


W3 - TYPICAL HEADER SIZING & STRAPPING DETAIL
SCALE: N.T.S. REV-22-AUG-03

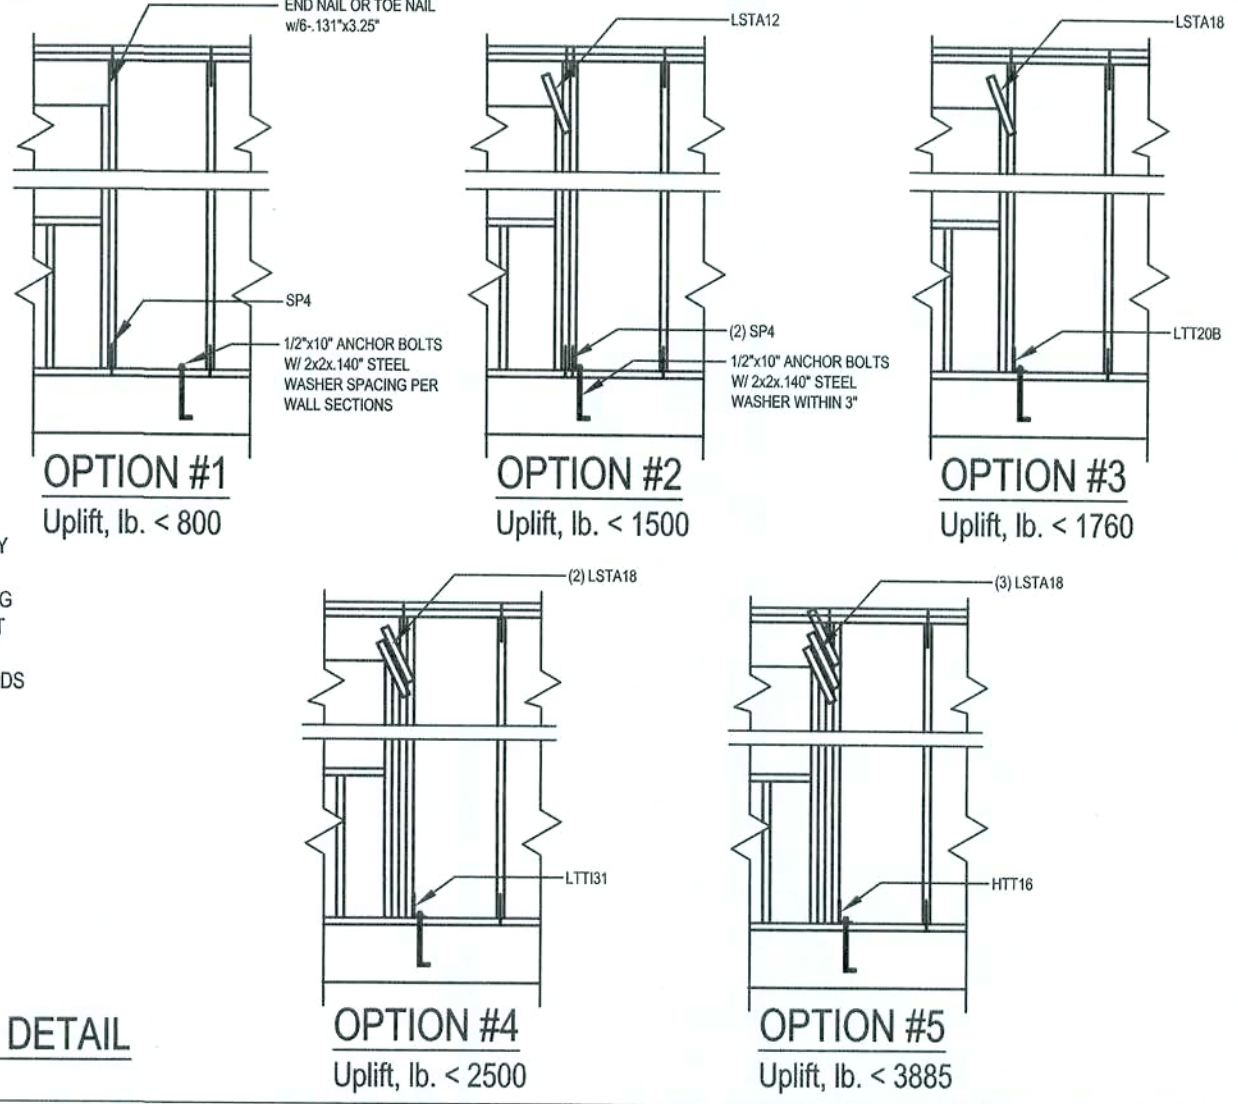


Header Spans For Exterior Bearing Walls Supporting Roof/Ceiling (20psf+20psf)			
Option #	Uplift, lb.	Top Connector	Bottom Connector
#1	< 800	End nail or tie nail w/6-13\"	SA, 6-10x1\"
#2	< 1500	LSTA12, 10-10x4	755 (2 SP4, 6-10x1\"
#3	< 1750	LSTA18, 14-10x4	1055 (2 SP4, 10-16x\"
#4	< 2500	LSTA18, 14-10x4	1710 (2 SP4, 10-16x\"
#5	< 3885	LSTA18, 14-10x4	1480 HTT6, 16-16x\"

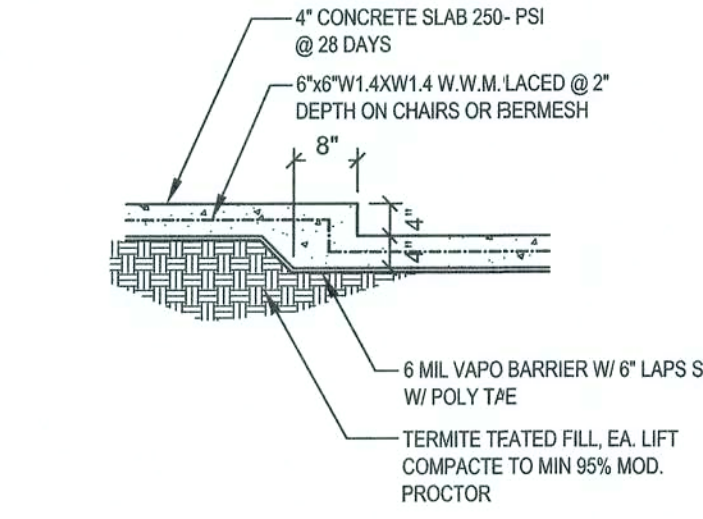


F12 - NON-BEARING STEP FOOTING
SCALE: 1/2\"/>

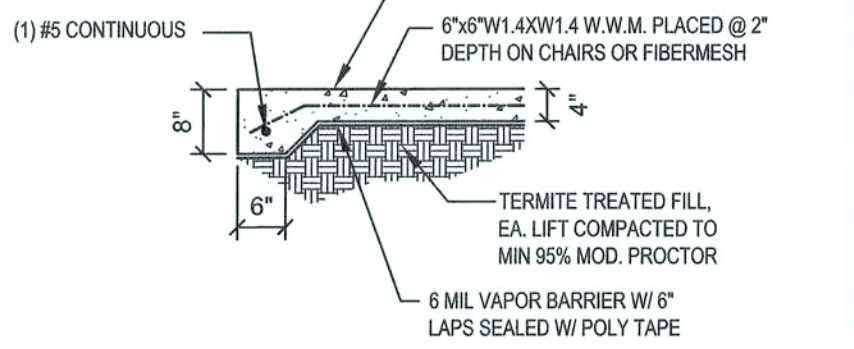

F13 - NON-BEARING THICKENED SLAB EDGE
SCALE: 1/2\"/>

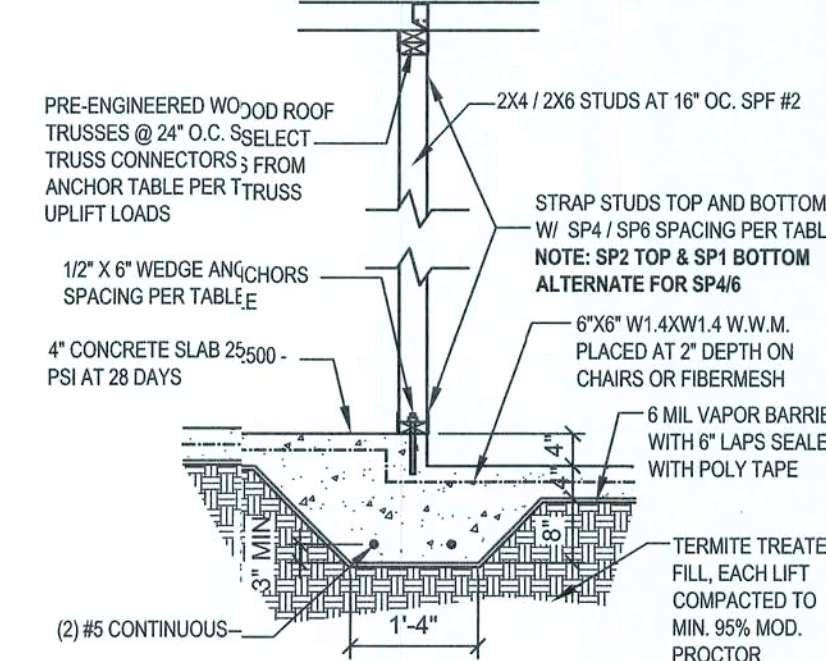


F5 - INTERIOR BEARING STEP FOOTING
SCALE: 1/2\"/>

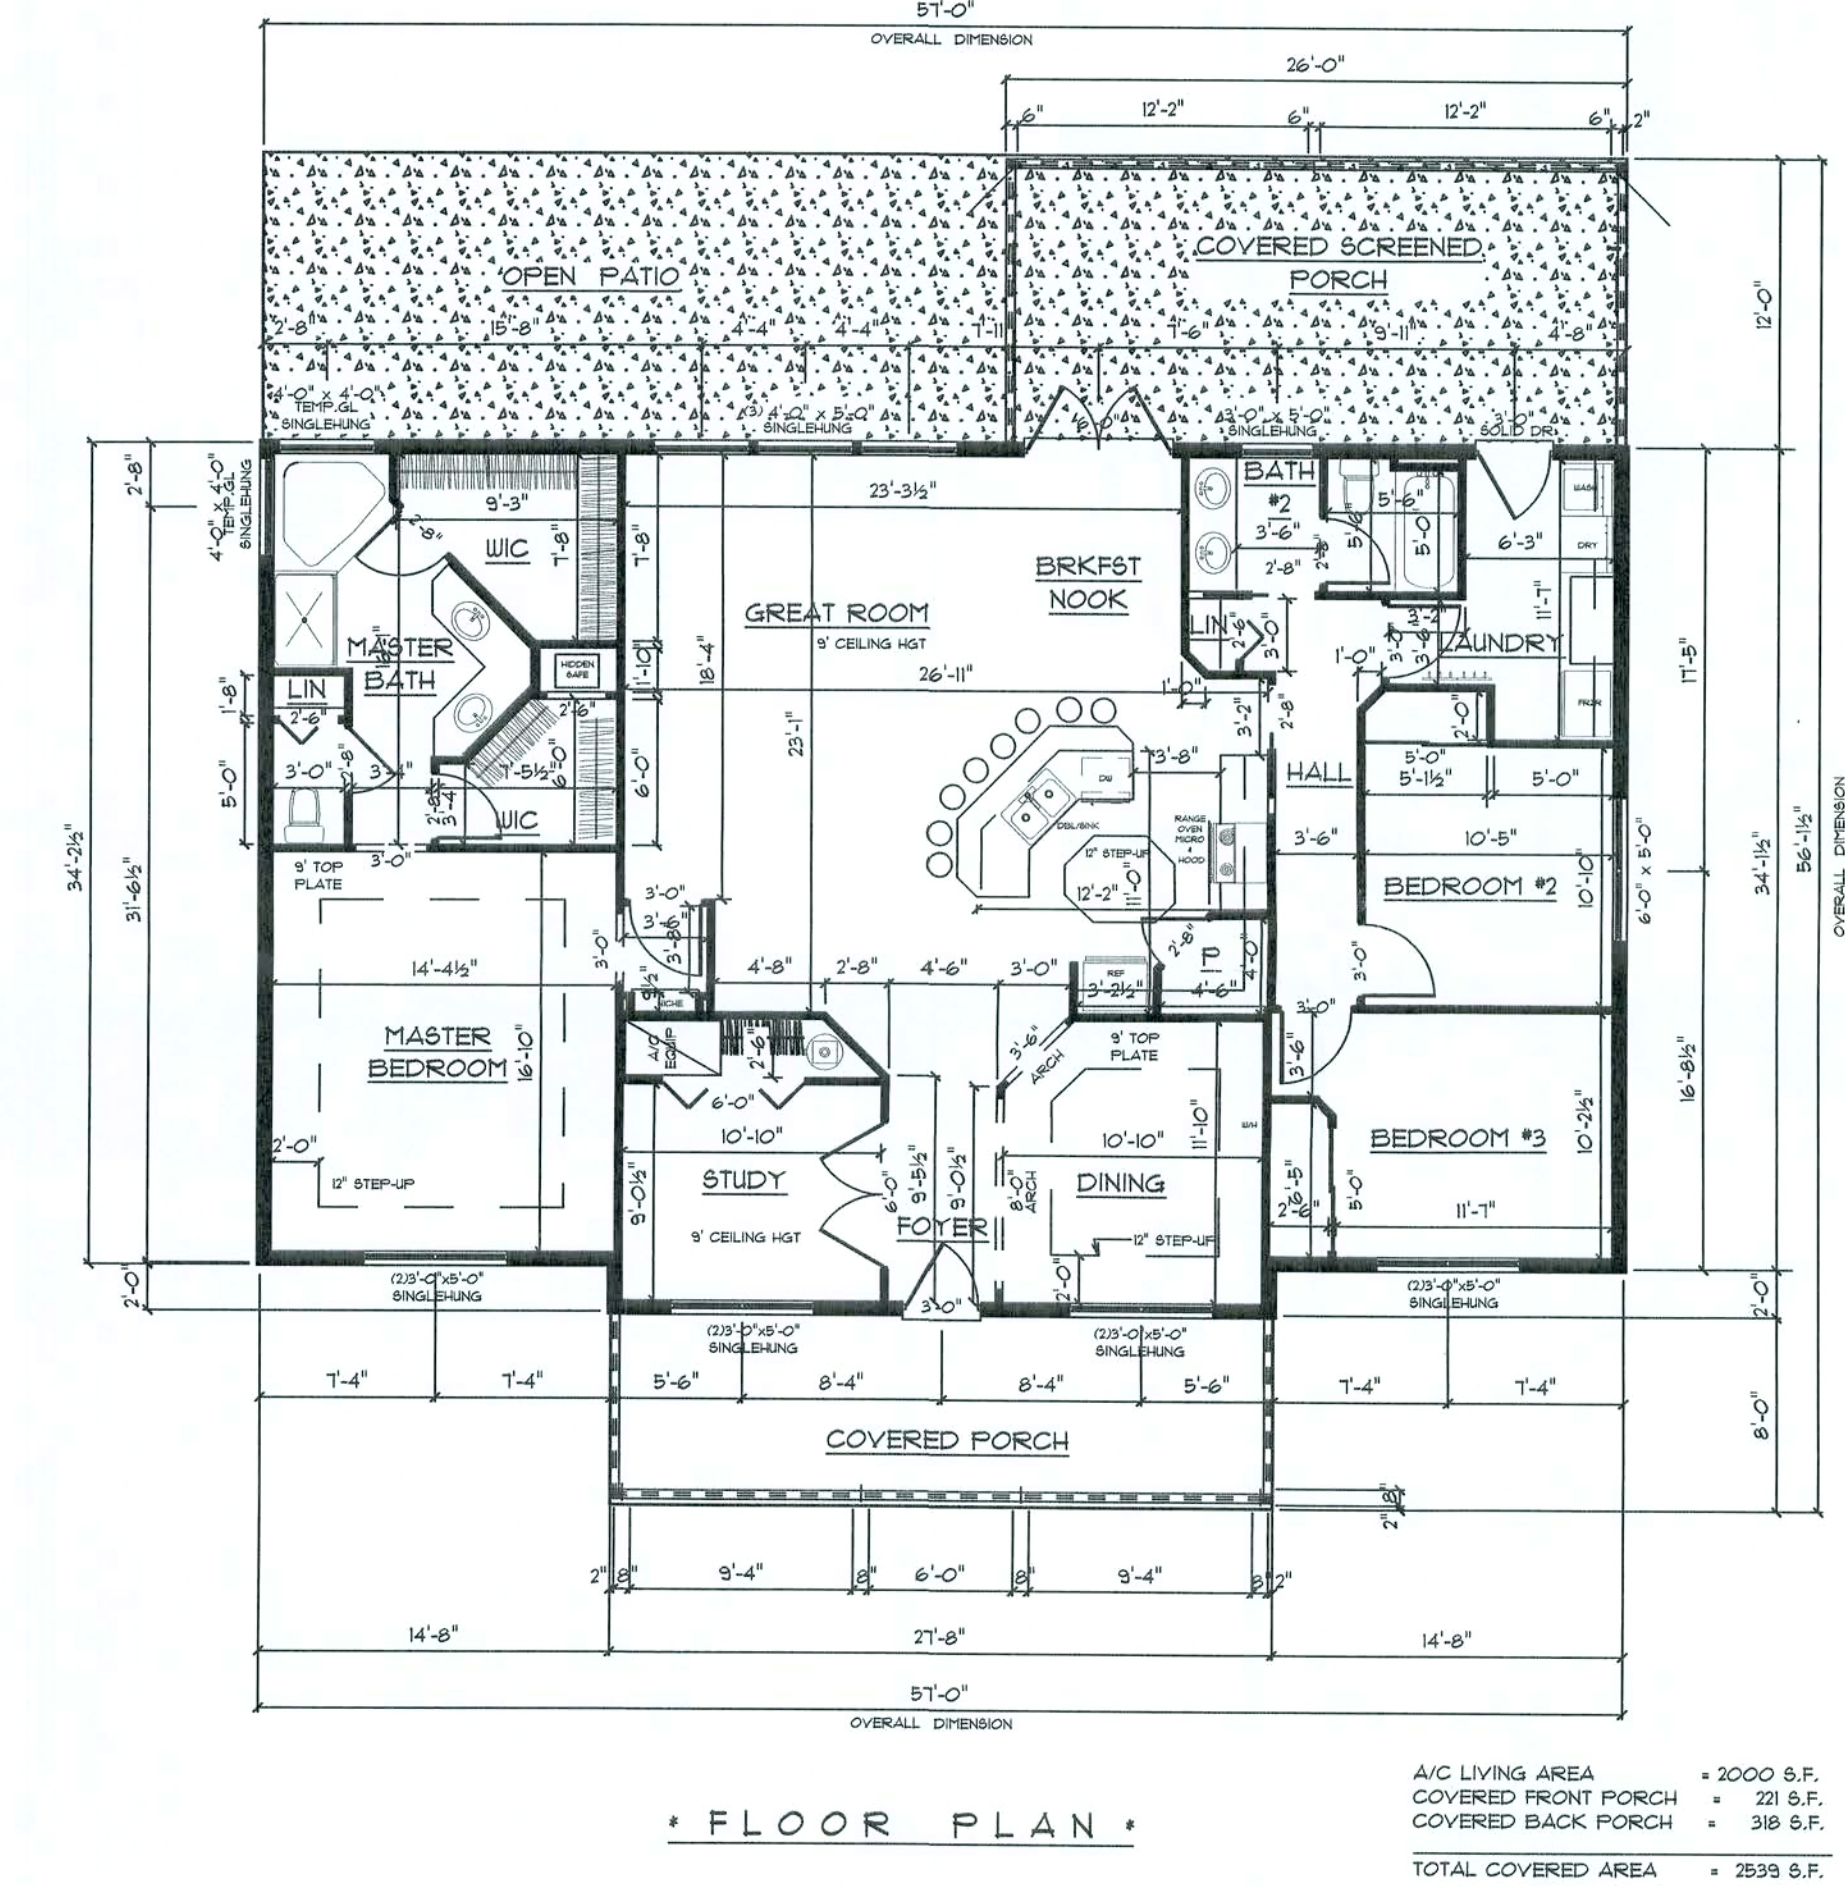


N2-GENERAL NOTES:

FOUNDATION: FOR POINT LOADS GRATER THAN 5000 LB OR REPETITIVE TRUSS LOADS GRATER THAN 2000 LB PER TRUSS PROVIDE A THICKENED SLAB OR PAD FOOTING 1'-0\"/>

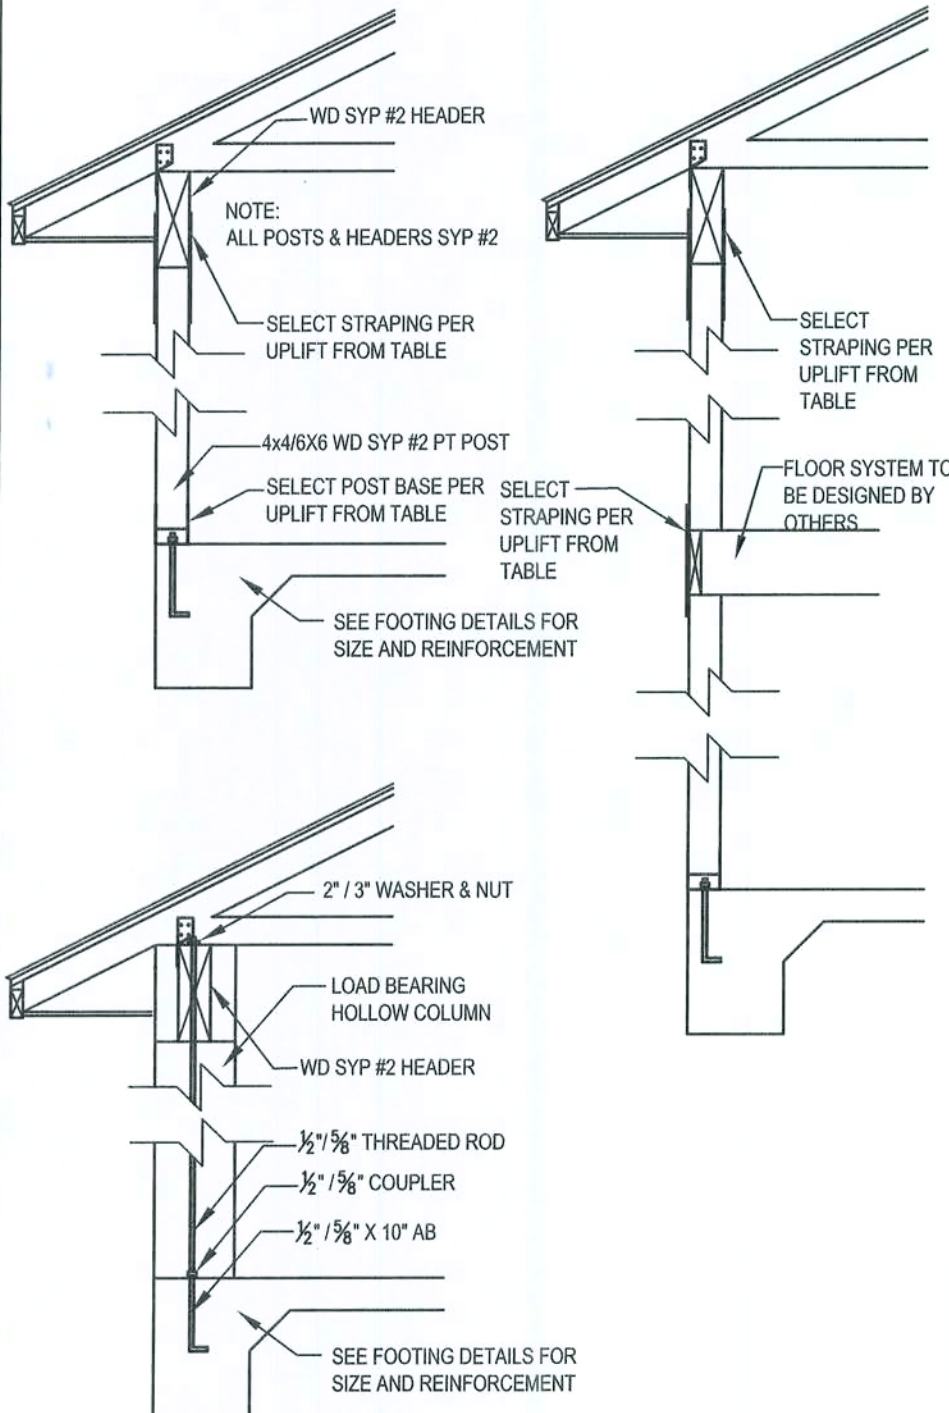


W2 - PORCH CEILING DIAPHRAGM ANCHORS
SCALE: N.T.S. REV-18-JUL-03

V10 - TYPICAL GABLE END (X-BRACING)
SCALE: 1/2\"/>

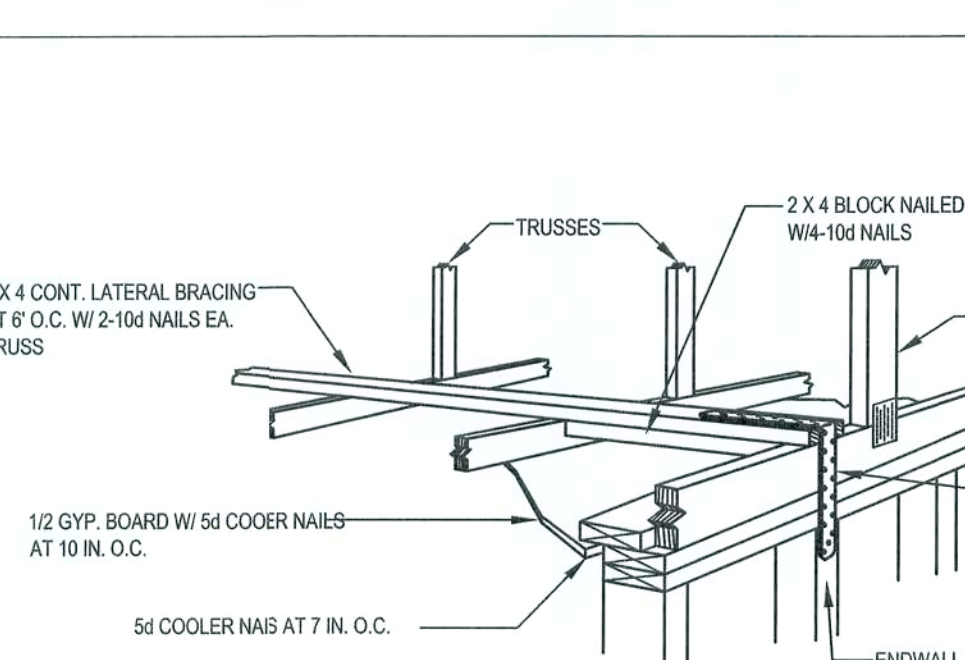

ALTERNATIVE TO BALLOON RACING IS GYPSUM CEILING DIAPHRAGM AS SPECIFIED IN THE "WOOD FRAME CONSTRUCTION MANUAL" (WFCM). SEE WFC TABLE 3.13 AND FIGURE 3.6a. SHOWN ABOVE, PROTECT GYPSUM FROM MOISTURE TO PRESERVE STRENGTH OF DIAPHRAGM.

W23 - GYPSUM CEILING DIAPHRAGM OPTION - GABLE END WALL
SCALE: N.T.S.

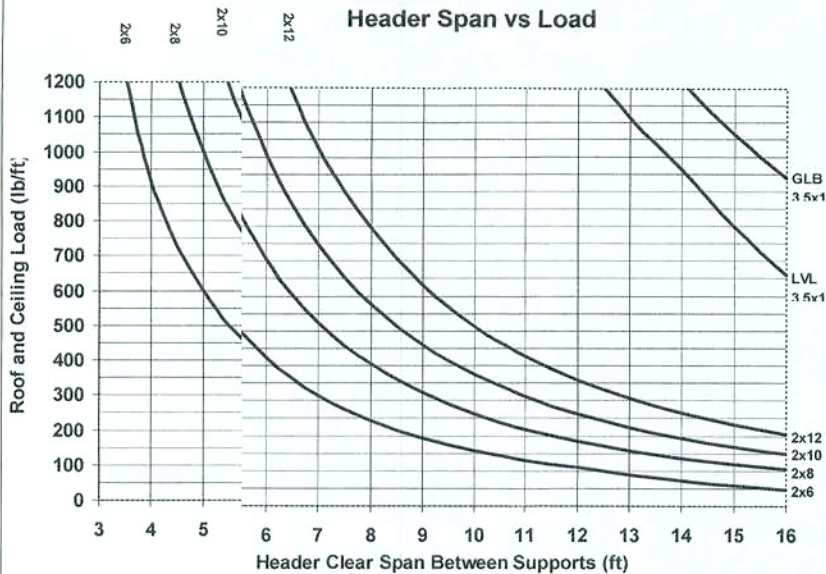

W71 - HEADER SPANS FOR ROOF/CeILING LOAD

N5 - TRUSS UPLIFT CONNECTOR TABLE			
Uplift SPF	Uplift SYP	Truss Connector	To Plate / To Truss / Rafter
320	455	H3	4-8d
245	350	H5A	3-8d
535	600	H2.5A	5-8d
620	720	H10	6-10d1 1/2"
850	990	LTS142	8-8d1 1/2"
1245	1450	HTS200	10-10d or 12-10d1 1/2"
1265	1470	H16.1 H16-2	10-10d1 1/2"
1785	2050	LGT22	2-10d1 1/2"
3555	4200	MS1	14-10d Sinker
SPF	Strap	Strap Connector	3/4" Thd. Rod
780	885	SP4	To One Member
865	1005	CS20	To One Member
1085	1265	LSTA18-24	To One Member
1170	1360	SPH4	To One Member
420	455	SSP	To One Member
800	825	DSP	To One Member
1420	1650	CS18	To One Member
SPF	SYP	Column Anchor	To Foundation
1180	1350	LTT150	To Foundation
1985	2310	LTT151	To Foundation
2385	2775	HD24	To Foundation
3590	4175	HTT16	To Foundation
1975	2300	ABU80	To Foundation

N4-WIND LOAD DESIGN DATA			
(Wind loads are per FBC 2001, Section 1606.2 for enclosed simple diaphragm buildings with mean roof height less than 50' or the least horizontal dimension; not sited on the upper half of an unobstructed 60' high hill with >10% slope.)	Basic Wind Speed	110 MPH	
	Wind Exposure	B	
	Wind Importance Factor	1.0	
	Building Category	II	
	Internal pressure Coefficient	N/A (Enclosed)	
	Building not in the high velocity hurricane zone		
	Building not in the wind-borne debris region		
	Mean Roof Height	< 30 ft	
	Roof Angle	10-45 degrees	
	Components And Cladding Wind Pressures (FBC Table 1606.6 & 6.6C)		
	Zone	Effective Wind Area (ft2)	
	4	21.8	23.6
	5	21.8	29.1
	6	21.8	18.5
	7	21.8	22.6
	Total Shear Wall Segments		
	Required	38.5'	32.5'
	Actual	57.0'	57.0'
	Minimum	38.5'	32.5'
	Maximum	57.0'	57.0'
	Actual Shear Wall Length	57.0'	57.0'
	Minimum Shear Wall Length	38.5'	32.5'
	Maximum Shear Wall Length	57.0'	57.0'
	Minimum Shear Wall Length	38.5'	32.5'
	Maximum Shear Wall Length	57.0'	57.0'

NS-WINDLOAD ENGINEER'S SCOPE OF WORK: The wind load engineer is engineer of record for compliance of the structure to wind load requirements of FBC 2001, Section 1606. If trusses are used, the wind load engineer is not engineer of record for the trusses and did not design the trusses or delegate to the truss designer.

BUILDER'S RESPONSIBILITY: The builder and owner are responsible for the following, which are specifically not part of the wind load engineer's scope of work:

- * Confirm that the foundation design & site conditions meet gravity load requirements (assume 1000 PSF bearing capacity unless visual observation or soils test proves otherwise)
- * Provide materials and construction techniques, which comply with FBC 2001 requirements for the stated wind velocity and design pressures.
- * Provide a continuous load path from roof to foundation. If you believe the plan omits a continuous load path connection, call the wind load engineer immediately.
- * Verify the truss engineering includes truss design, placement plans, temporary and permanent bracing details, truss-to-truss connections, and load reactions for all bearing locations.
- * Select uplift connectors, walls, columns, and footings based on truss engineering bearing locations and reactions; including interior bearing walls.
- * Size headers for gravity loads; headers sized by the builder for gravity loads will also satisfy wind loads.

DOCUMENT CONTROL AND PRIORITY: Structural requirements on S-1 control unless the building code or architectural sheets have more stringent requirements. Non-structural requirements on architectural sheets control. Specific requirements take precedence over general requirements. Revision control is by the latest signature date and is the responsibility of the builder.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

WINDLOAD ENGINEER: Mark Disoway, PE No.53915

CERTIFICATION: The attached plans and "Windload Engineering", sheet S-1, comply with FBC 2001, Section 1606 wind loads, to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location. This drawing is not valid for construction unless raised seal is affixed.

WINDLOAD ENGINEERING

"EVERYTHING YOU NEED FOR YOUR BUILDING PERMIT"

Mark Disoway P.E.

POB 868, Lake City, FL 32056 Phone: (866) 754-5419

Fax: (386) 269-4871 Email: windloadengineer@bellsouth.net

Location: Lot 5 Hollingsworth Estates S/D Ft. White, Florida

Cedric & Shellie May Residence

Builder:

Designer:

Approved: PLEP#53915

Revisions:

Sheet S-1 of 1 Sheet

Windload Engineering

Job # 508221