




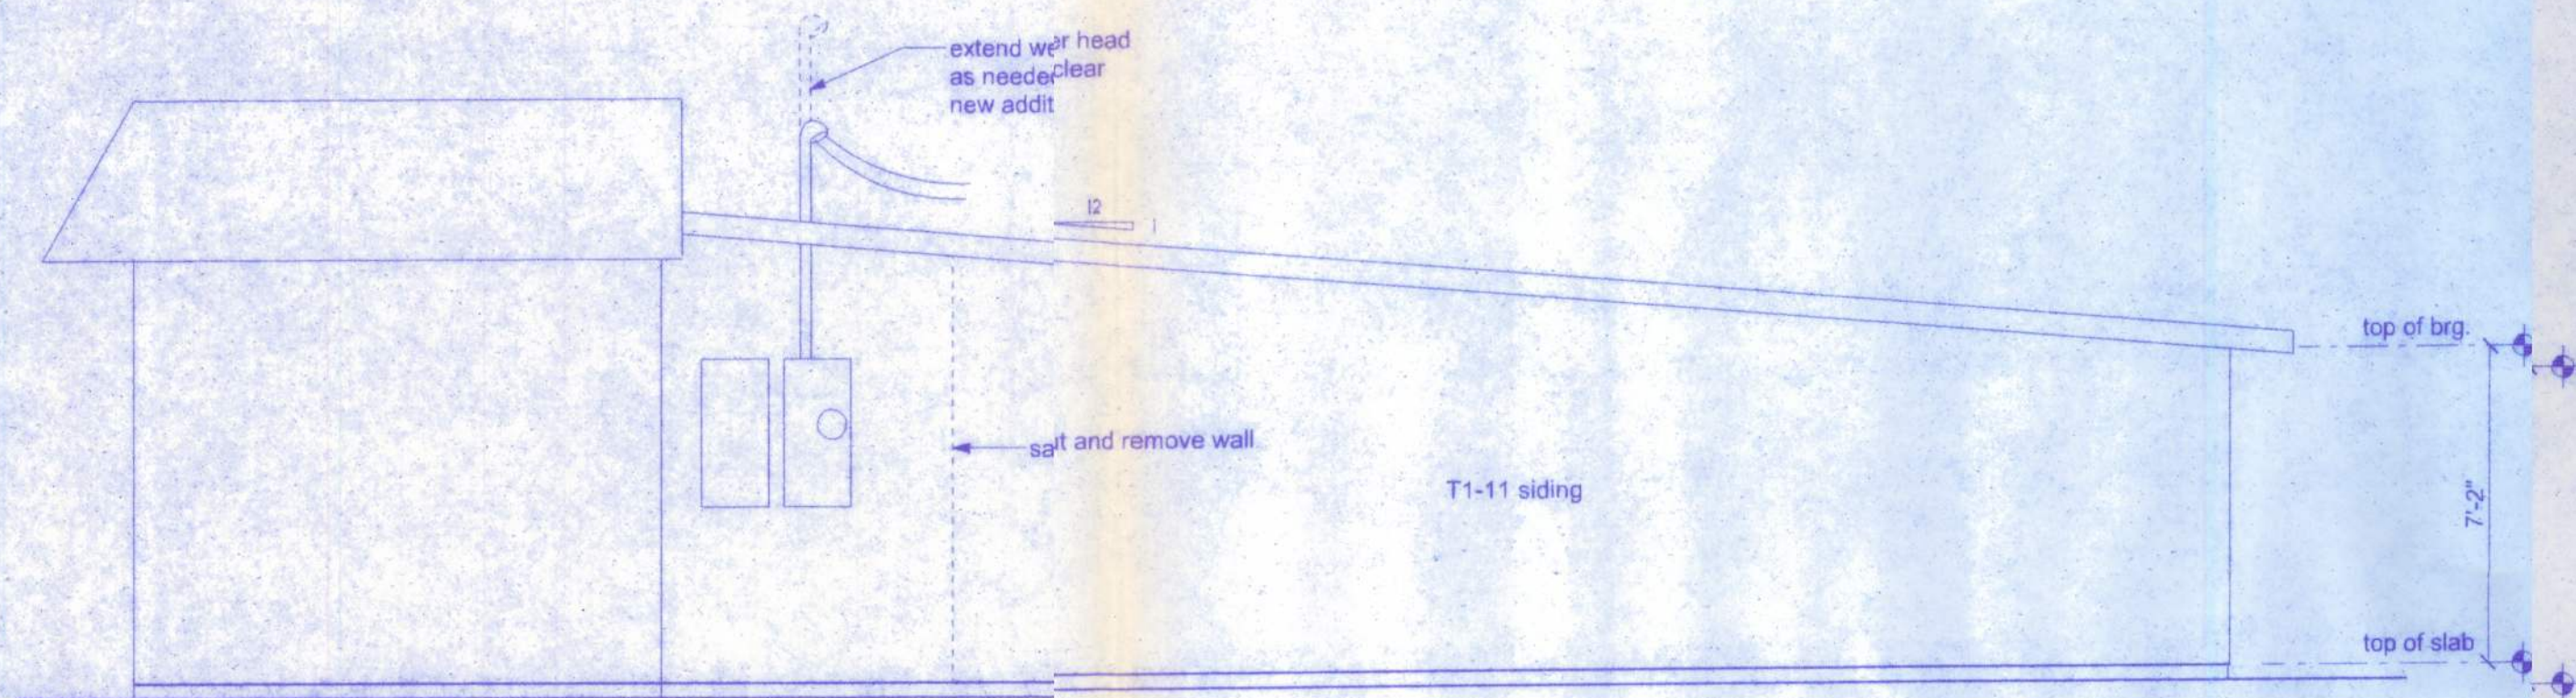


EXISTING ELEVATION
SCALE: 1/4" = 1'-0"

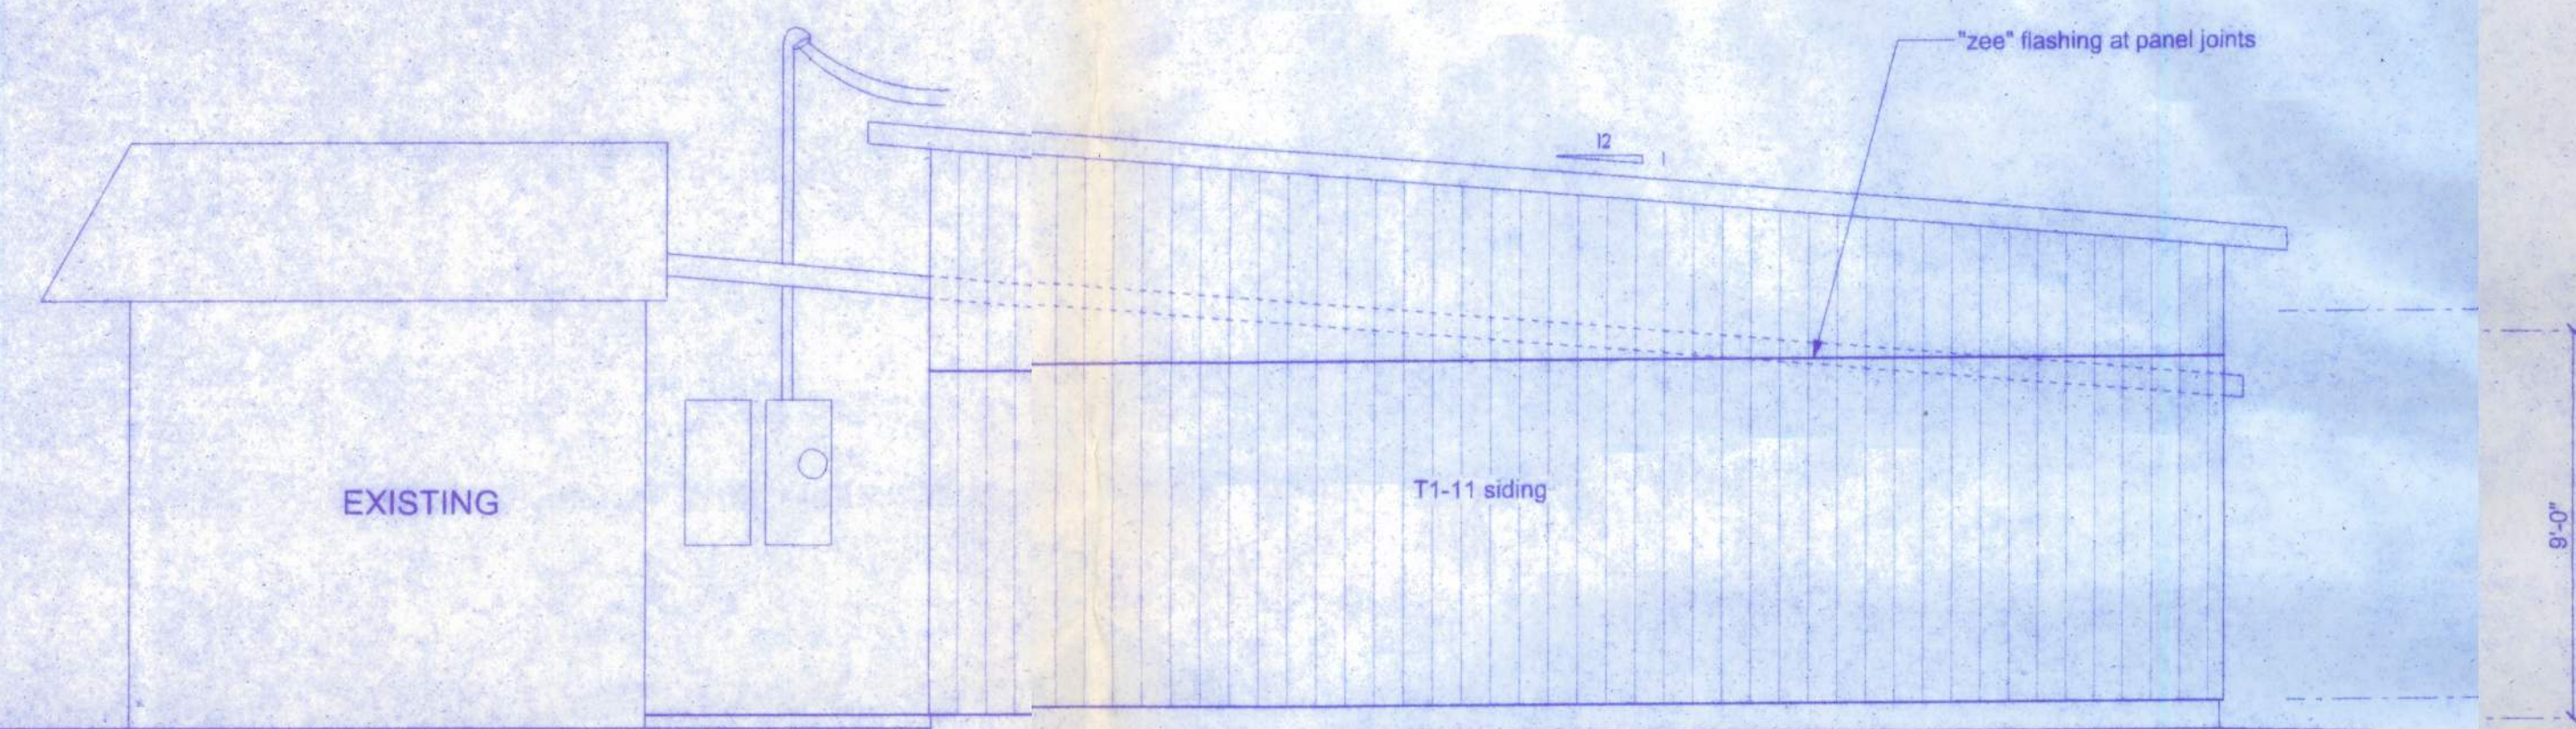


PROPOSED EAST ELEVATION
SCALE: 1/4" = 1'-0"

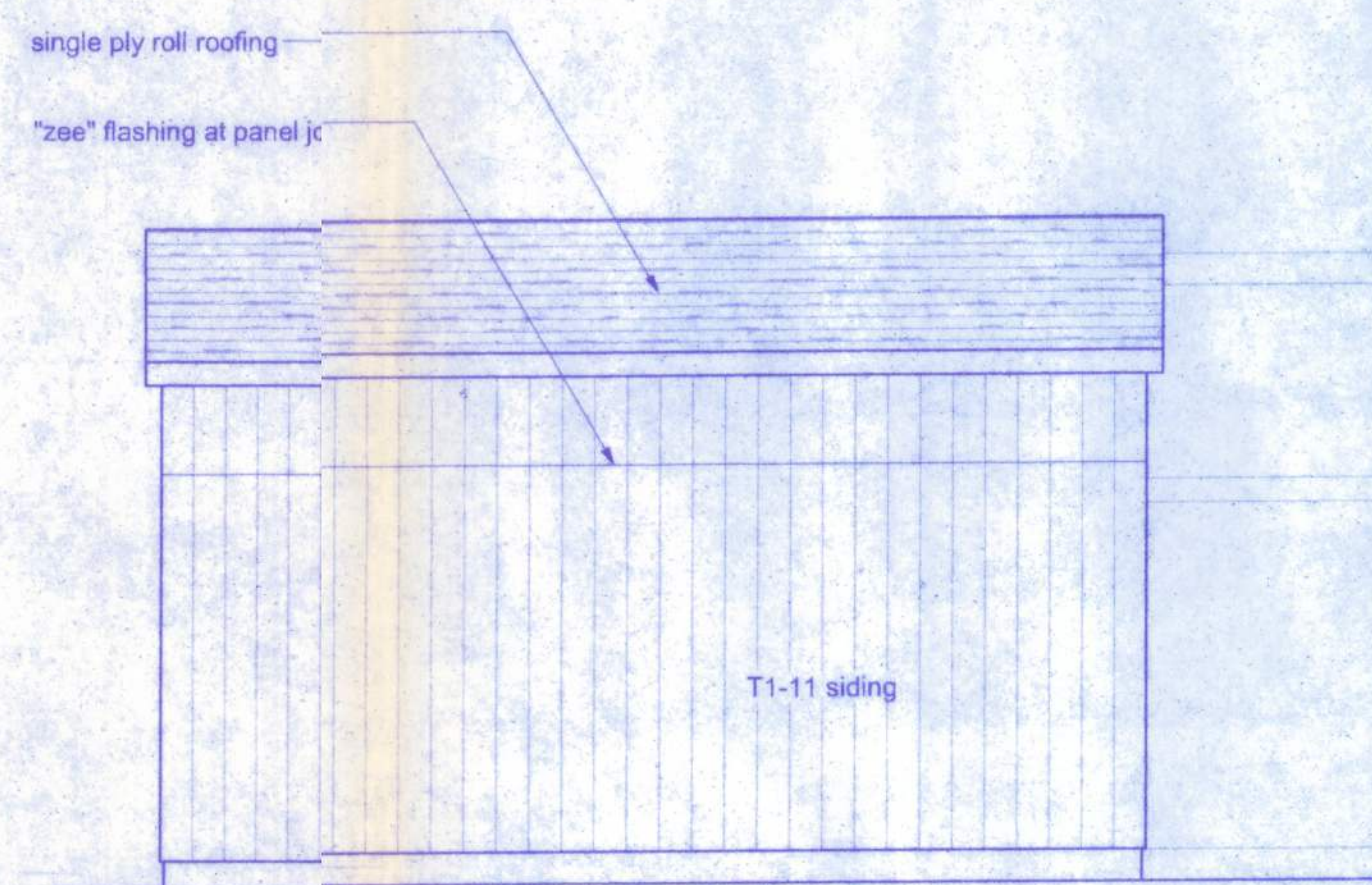

PROPOSED NORTH ELEVATION
SCALE: 1/4" = 1'-0"

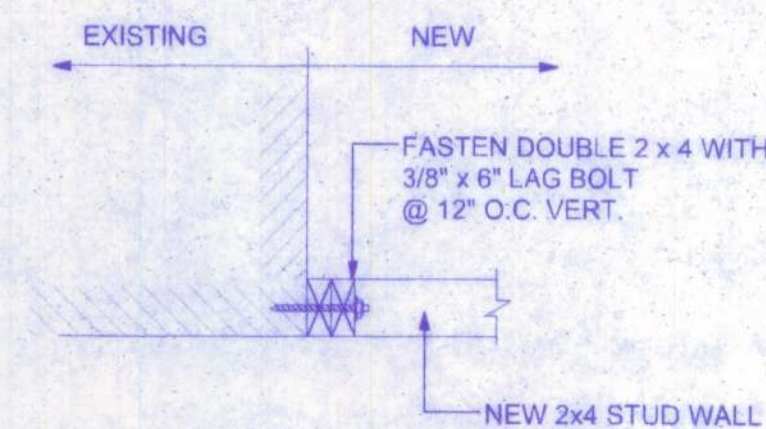

NEW TO EXISTING
SCALE: 1" = 1'-0"

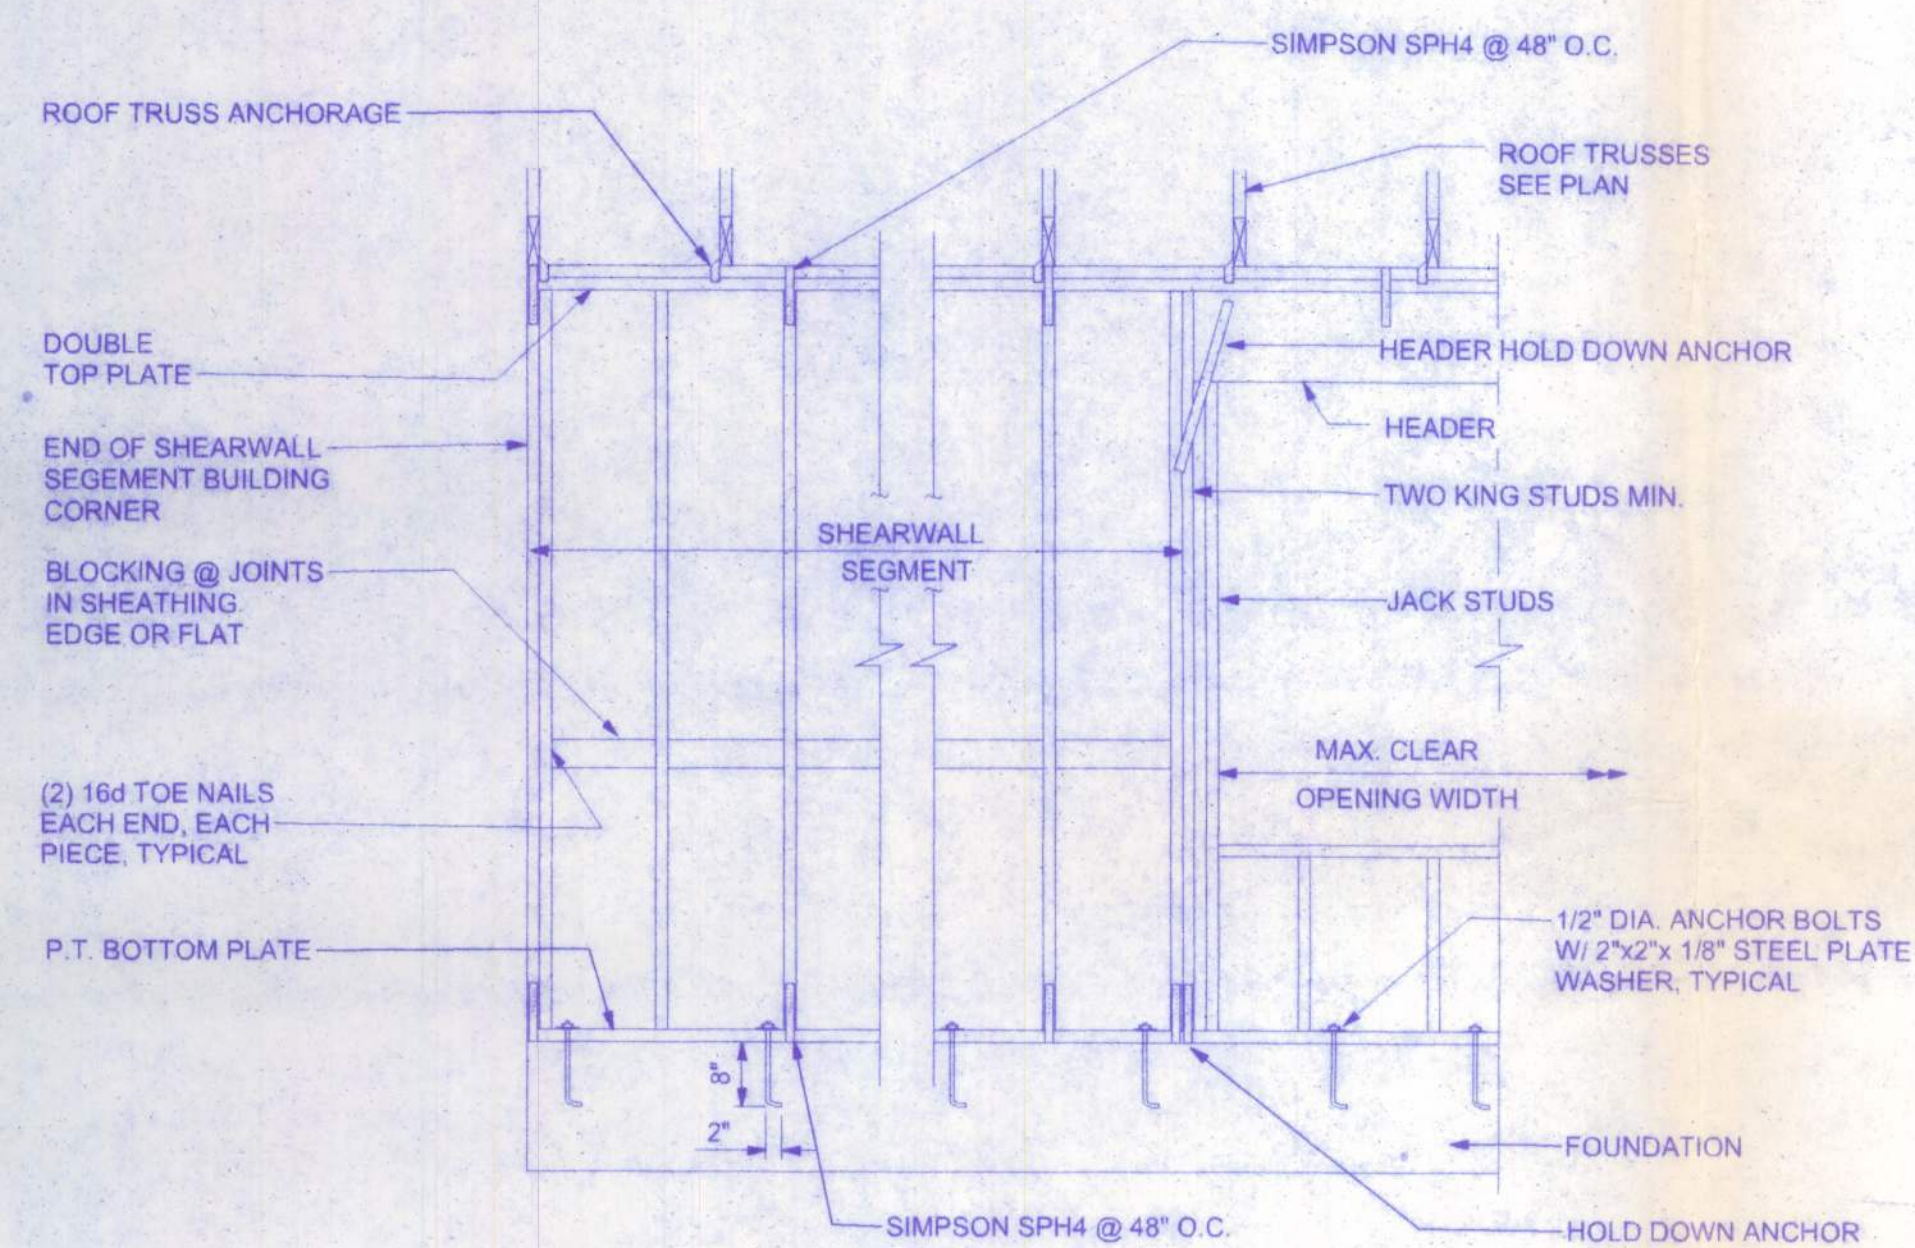


SHEARWALL DETAILS
SCALE: 1/2" = 1'-0"

SHEARWALL NOTES:

1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-89 305.4.3.
2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
4. NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD.
5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 i.e. FOR 8'-0" WALLS - (2'-3").

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

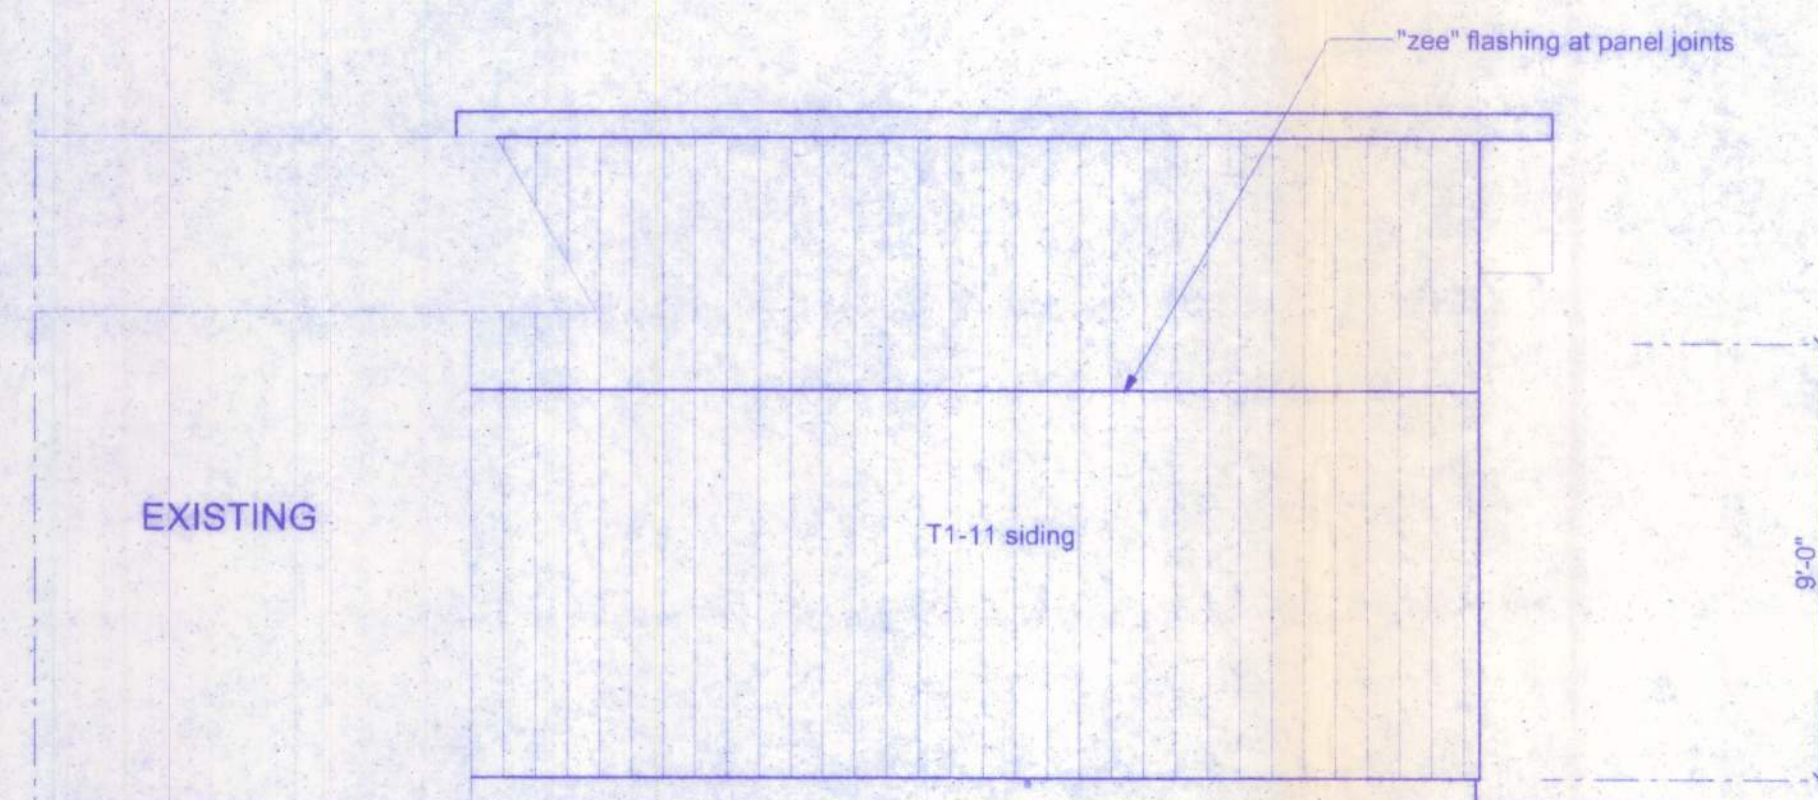


PROPOSED SOUTH ELEVATION
SCALE: 1/4" = 1'-0"

W. H. F.
2/16/11
P.E. # 55001

**MUNCHIES FOOD STORE
COOLER ADDITION
HWY 90 EAST, LAKE CITY - FL.**

128 SW NASSAU STREET
LAKE CITY, FL 32025
(386) 758-4209



**Froeman
Design Group Inc.**

DRAWN BY
W.H.F.
DAE
2/16/11
APPROVED
W.H.F.

REVISIONS

SHEET A-3

OF 6

PROJECT NO.
11.C004

CERTIFICATE OF AUTHORIZATION # 00008701