

W.B. Howland Truss Co.
P.O. Box 700
Live Oak, FL 32064
(386)362-1235
(386)362-7124 (fax)

ROOF PITCH: 7/12
CLG PITCH: 4/12
OVERHANG: 1'6"
LOADING: 40
WIND LOAD: 130
EXPOSURE: C
FBC 2020 RESIDENTIAL
EXT. WALLS: 2x4 FRAMING
REVISED: 2/10/23

NOTES:

- INTERIOR GARAGE WALL USED AS INTERIOR BEARING POINTS.
- ALL VALLEYS FRAMED WITH TRUSS DESIGN.
- ALL GABLE END TRUSSES HAVE A DROPPED TOP CHORD FOR 2x4 OUTLOOKERS.


TRUSS TO TRUSS CONNECTIONS:

3 - HUS26
5 - HUS28

HUS26:
D01 TO C03
D02 TO C03
D03 TO C03

HUS28:
D12 TO G02
D13 TO G02
D14 TO G02
D15 TO G02
D16 TO G02

Roof Plane Sheathing Area = 2859 sq. ft
Gable Sheathing Area = 155 sq. ft
Total Sheathing Area = 3014 sq. ft
Fascia Material = 231 linear ft
Valley Flashing Material = 78 linear ft
Ridge Cap Material = 78 linear ft
Hip Ridge Material = 106 linear ft

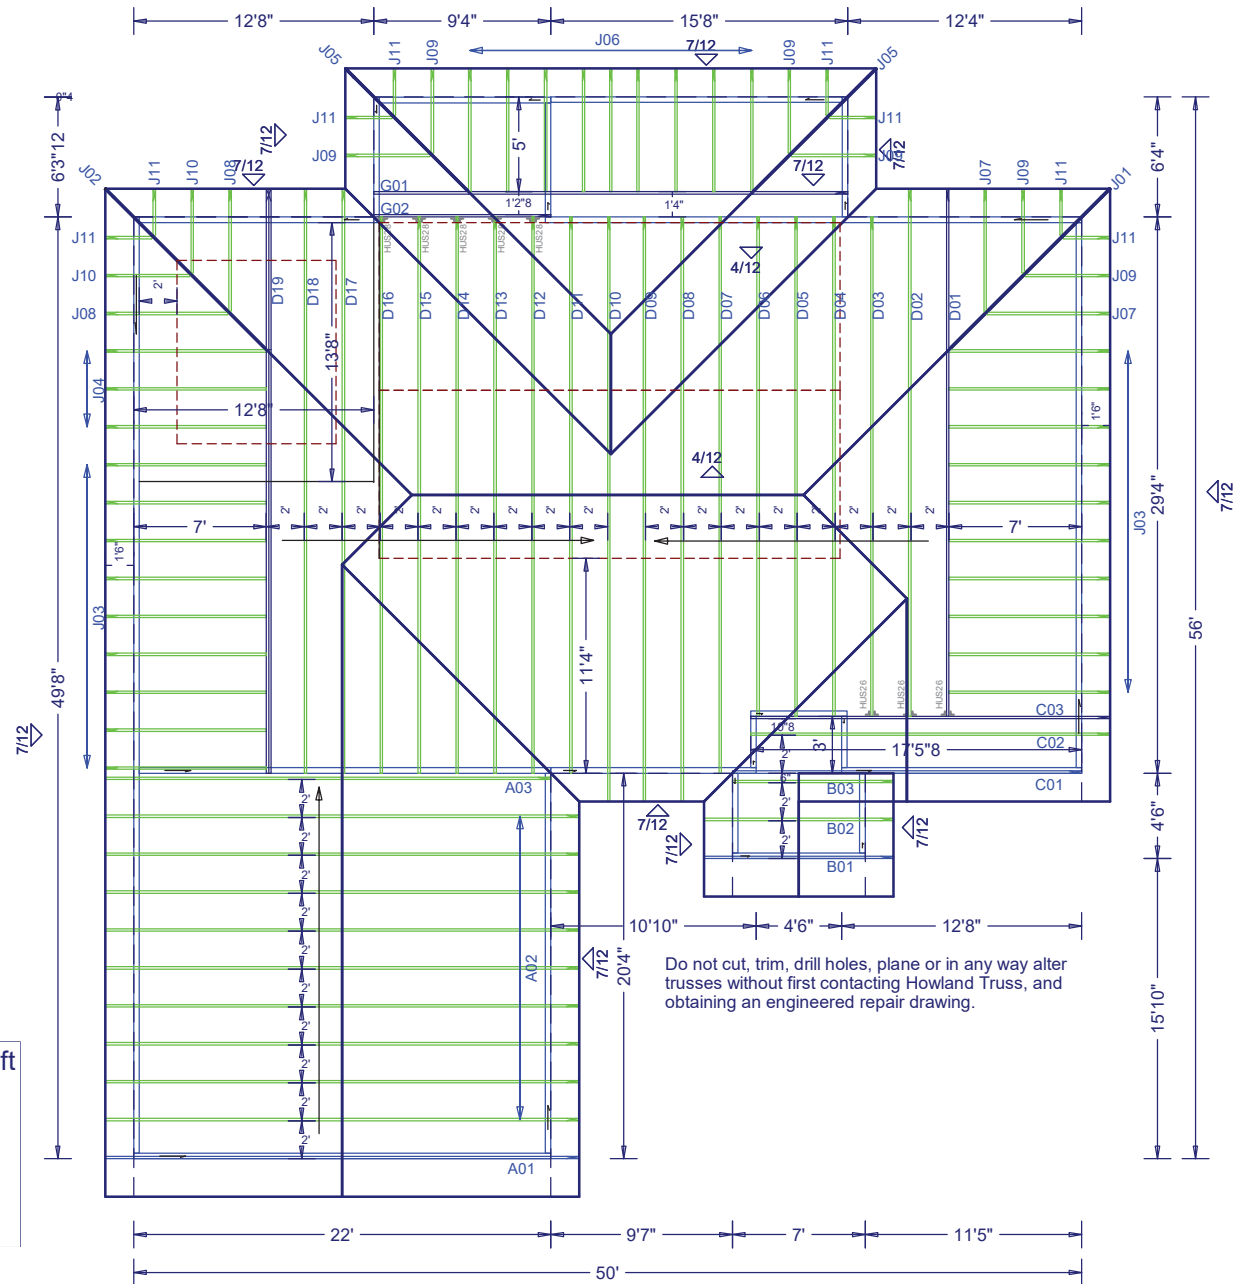

JOB #: 23-8926

Job Name: Sunset 7
Customer: BRADLEY FRANKS
Designer: Chris
ADDRESS: 143 NW Germium Ct
SALESMAN: DB
: <Not Found>

JOB NO:
23-8926

PAGE NO:
1 OF 1



COA #0 278

Florida Certificate of Product Approval #FL 1999
02/10/2023



Alpine, an ITW Company
155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025
Phone: (800)755-6001
www.alpineitw.com



Site Information:		Page 1:
Customer:	W. B. Howland Company, Inc.	Job Number: 23-8926
Job Description:	Sunset 7	
Address:	143 NW Germium Ct, Lake City, FL 32055	

Job Engineering Criteria:	
Design Code:	FBC 7th Ed. 2020 Res.
Wind Standard:	ASCE 7-16
Building Type:	Closed
Wind Speed (mph):	130
Design Loading (psf):	40.00
Intell/VIEW Version:	21.01.01A through 21.02.01
JRef #:	1XN32150003

This package contains general notes pages, 41 truss drawing(s) and 6 detail(s).

Item	Drawing Number	Truss	Item	Drawing Number	Truss
1	041.23.0913.09137	A01	2	041.23.0912.21088	A02
3	041.23.0912.19222	A03	4	041.23.0913.12993	B01
5	041.23.0912.21341	B02	6	041.23.0912.20768	B03
7	041.23.0912.21648	C01	8	041.23.0912.22217	C02
9	041.23.0912.20297	C03	10	041.23.0912.22043	D01
11	041.23.0912.21281	D02	12	041.23.0912.19322	D03
13	041.23.0912.19924	D04	14	041.23.0912.19333	D05
15	041.23.0912.20682	D06	16	041.23.0912.22420	D07
17	041.23.0912.20164	D08	18	041.23.0912.20625	D09
19	041.23.0912.19446	D10	20	041.23.0912.22028	D11
21	041.23.0912.20380	D12	22	041.23.0912.19088	D13
23	041.23.0912.19498	D14	24	041.23.0912.20654	D15
25	041.23.0912.21666	D16	26	041.23.0912.20046	D17
27	041.23.0912.22164	D18	28	041.23.0912.21350	D19
29	041.23.0912.19090	G01	30	041.23.0912.20396	G02
31	041.23.0912.19176	J01	32	041.23.0912.21795	J02
33	041.23.0912.20622	J03	34	041.23.0912.20964	J04
35	041.23.0912.20107	J05	36	041.23.0912.22298	J06
37	041.23.0912.21529	J07	38	041.23.0912.20824	J08
39	041.23.0912.21512	J09	40	041.23.0912.22465	J10
41	041.23.0912.21614	J11	42	A14015ENC160118	
43	BRCLBSUB0119		44	CNNAILSP1014	
45	DEFLCAMB1014		46	GBLETTIN0118	
47	S14015ENC160118				

General Notes

Truss Design Engineer Scope of Work, Design Assumptions and Design Responsibilities:

The design responsibilities assumed in the preparation of these design drawings are those specified in ANSI/TPI 1, Chapter 2; and the National Design Standard for Metal Plate Connected Wood Truss Construction, by the Truss Plate Institute. The truss component designs conform to the applicable provisions of ANSI/TPI 1 and NDS, the National Design Specification for Wood Construction by AWC. The truss component designs are based on the specified loading and dimension information furnished by others to the Truss Design Engineer. The Truss Design Engineer has no duty to independently verify the accuracy or completeness of the information provided by others and may rely on that information without liability. The responsibility for verification of that information remains with others neither employed nor controlled by the Truss Design Engineer. The Truss Design Engineer's seal and signature on the attached drawings, or cover page listing these drawings, indicates acceptance of professional engineering responsibility solely for the truss component designs and not for the technical information furnished by others which technical information and consequences thereof remain their sole responsibility.

The suitability and use of these drawings for any particular structure is the responsibility of the Building Designer in accordance with ANSI/TPI 1 Chapter 2. The Building Designer is responsible for determining that the dimensions and loads for each truss component match those required by the plans and by the actual use of the individual component, and for ascertaining that the loads shown on the drawings meet or exceed applicable building code requirements and any additional factors required in the particular application. Truss components using metal connector plates with integral teeth shall not be placed in environments that will cause the moisture content of the wood in which plates are embedded to exceed 19% and/or cause corrosion of connector plates and other metal fasteners.

The Truss Design Engineer shall not be responsible for items beyond the specific scope of the agreed contracted work set forth herein, including but not limited to: verifying the dimensions of the truss component, calculation of any of the truss component design loads, inspection of the truss components before or after installation, the design of temporary or permanent bracing and their attachment required in the roof and/or floor systems, the design of diaphragms or shear walls, the design of load transfer connections to and from diaphragms and shear walls, the design of load transfer to the foundation, the design of connections for truss components to their bearing supports, the design of the bearing supports, installation of the truss components, observation of the truss component installation process, review of truss assembly procedures, sequencing of the truss component installation, construction means and methods, site and/or worker safety in the installation of the truss components and/or its connections.

This document may be a high quality facsimile of the original engineering document which is a digitally signed electronic file with third party authentication. A wet or embossed seal copy of this engineering document is available upon request.

Temporary Lateral Restraint and Bracing:

Temporary lateral restraint and diagonal bracing shall be installed according to the provisions of BCSI chapters B1, B2, B7 and/or B10 (Building Component Safety Information, by TPI and SBCA), or as specified by the Building Designer or other Registered Design Professional. The required locations for lateral restraint and/or bracing depicted on these drawings are only for the permanent lateral support of the truss members to reduce buckling lengths, and do not apply to and may not be relied upon for the temporary stability of the truss components during their installation.

Permanent Lateral Restraint and Bracing:

The required locations for lateral restraint or bracing depicted on these drawings are for the permanent lateral support of the truss members to reduce buckling lengths. Permanent lateral support shall be installed according to the provisions of BCSI chapters B3, B7 and/or B10, or as specified by the Building Designer or other Registered Design Professional. These drawings do not depict or specify installation/erection bracing, wind bracing, portal bracing or similar building stability bracing which are parts of the overall building design to be specified, designed and detailed by the Building Designer.

Connector Plate Information:

Alpine connector plates are made of ASTM A653 or ASTM A1063 galvanized steel with the following designations, gauges and grades: W=Wave, 20ga, grade 40; H=High Strength, 20ga, grade 60; S=Super Strength, 18ga, grade 60. Information on model code compliance is contained in the ICC Evaluation Service report ESR-1118, available on-line at www.icc-es.org.

Fire Retardant Treated Lumber:

Fire retardant treated lumber must be properly re-dried and maintained below 19% or less moisture level through all stages of construction and usage. Fire retardant treated lumber may be more brittle than untreated lumber. Special handling care must be taken to prevent breakage during all handling activities.

General Notes (continued)

Key to Terms:

Information provided on drawings reflects a summary of the pertinent information required for the truss design. Detailed information on load cases, reactions, member lengths, forces and members requiring permanent lateral support may be found in calculation sheets available upon written request.

BCDL = Bottom Chord standard design Dead Load in pounds per square foot.
BCLL = Bottom Chord standard design Live Load in pounds per square foot.
CL = Certified lumber.
Des Ld = total of TCLL, TC DL, BCLL and BCDL Design Load in pounds per square foot.
FRT = Fire Retardant Treated lumber.
FRT-DB = D-Blaze Fire Retardant Treated lumber.
FRT-DC = Dricon Fire Retardant Treated lumber.
FRT-FP = FirePRO Fire Retardant Treated lumber.
FRT-FL = FlamePRO Fire Retardant Treated lumber.
FRT-FT = FlameTech Fire Retardant Treated lumber.
FRT-PG = PYRO-GUARD Fire Retardant Treated lumber.
g = green lumber.
HORZ(LL) = maximum Horizontal panel point deflection due to Live Load, in inches.
HORZ(TL) = maximum Horizontal panel point long term deflection in inches, due to Total Load, including creep adjustment.
HPL = additional Horizontal Load added to a truss Piece in pounds per linear foot or pounds.
lc = Incised lumber.
FJ = Finger Jointed lumber.
L/# = user specified divisor for limiting span/deflection ratio for evaluation of actual L/defl value.
L/defl = ratio of Length between bearings, in inches, divided by the vertical Deflection due to creep, in inches, at the referenced panel point. Reported as 999 if greater than or equal to 999.
Loc = Location, starting location of left end of bearing or panel point (joint) location of deflection.
Max BC CSI = Maximum bending and axial Combined Stress Index for Bottom Chords for of all load cases.
Max TC CSI = Maximum bending and axial Combined Stress Index for Top Chords for of all load cases.
Max Web CSI = Maximum bending and axial Combined Stress Index for Webs for of all load cases.
NCBCLL = Non-Concurrent Bottom Chord design Live Load in pounds per square foot.
PL = additional Load applied at a user specified angle on a truss Piece in pounds per linear foot or pounds.
PLB = additional vertical load added to a Bottom chord Piece of a truss in pounds per linear foot or pounds
PLT = additional vertical load added to a Top chord Piece of a truss in pounds per linear foot or pounds.
PP = Panel Point.
R = maximum downward design Reaction, in pounds, from all specified gravity load cases, at the indicated location (Loc).
-R = maximum upward design Reaction, in pounds, from all specified gravity load cases, at the identified location (Loc).
Rh = maximum horizontal design Reaction in either direction, in pounds, from all specified gravity load cases, at the indicated location (Loc).
RL = maximum horizontal design Reaction in either direction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).
Rw = maximum downward design Reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the identified location (Loc).
TCDL = Top Chord standard design Dead Load in pounds per square foot.
TCLL = Top Chord standard design Live Load in pounds per square foot.
U = maximum Upward design reaction, in pounds, from all specified non-gravity (wind or seismic) load cases, at the indicated location (Loc).
VERT(CL) = maximum Vertical panel point deflection in inches due to Live Load and Creep Component of Dead Load in inches.
VERT(CTL) = maximum Vertical panel point deflection ratios due to Live Load and Creep Component of Dead Load, and maximum long term Vertical panel point deflection in inches due to Total load, including creep adjustment.
VERT(LL) = maximum Vertical panel point deflection in inches due to Live Load.
VERT(TL) = maximum Vertical panel point long term deflection in inches due to Total load, including creep adjustment.
W = Width of non-hanger bearing, in inches.


Refer to ASCE-7 for Wind and Seismic abbreviations.

Uppercase Acronyms not explained above are as defined in TPI 1.

References:

1. AWC: American Wood Council; 222 Catoclin Circle SE, Suite 201; Leesburg, VA 20175; www.awc.org.
2. ICC: International Code Council; www.iccsafe.org.
3. Alpine, a division of ITW Building Components Group Inc.: 155 Harlem Ave, North Building, 4th Floor, Glenview, IL 60025; www.alpineitw.com.
4. TPI: Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601; www.tpinst.org.
5. SBCA: Wood Truss Council of America, 6300 Enterprise Lane, Madison, WI 53719; www.sbcacomponents.com.

SECON: 450705	GABL	Ply: 1	Job Number: 23-8926	Cust: R 215	JRef: 1XN32150003	T16
FROM: CDM		Qty: 1	Sunset 7	DwnNo: 041.23.0913.09137		
			Truss Label: A01	SSB / WHK	02/10/2023	

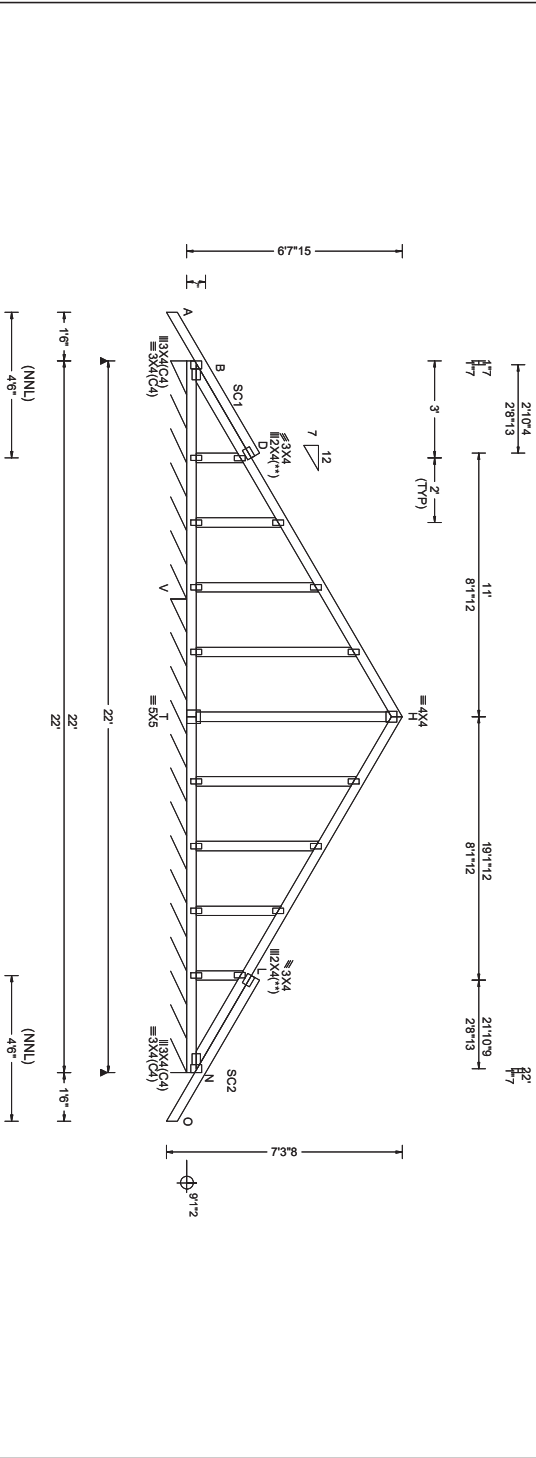

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg/Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs), or * = PLF
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: No FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.001 B 999 240 VERT(CL): 0.002 B 999 180 HORZ(LL): 0.002 K - - HORZ(TL): 0.003 K - - Creep Factor: 2.0 Max TC CSI: 0.207 Max BC CSI: 0.031 Max Web CSI: 0.087	Loc R+ / R- / Rh / Rw / U / RL B* 103 /- /- /67 /23 /28 V* 87 /- /- /52 /12 /- Wind reactions based on MWFRS B Big Wld = 88.3 Min Req = - V Big Wld = 175 Min Req = - Bearings B & V are a rigid surface. Members not listed have forces less than 375#
			VIEW Ver: 21.02.01.1214.12	

Lumber

Top chord: 2x4 SP M-31;
 Bot chord: 2x4 SP M-31;
 Webs: 2x4 SP #3;
 Stack Chord: SC1 2x4 SP #2;
 Stack Chord: SC2 2x4 SP #2;

Plating Notes


All plates are 2X4 except as noted.
 (**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Purlins

In lieu of structural panels use purlins to brace TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.
 Wind loading based on both gable and hip roof types.

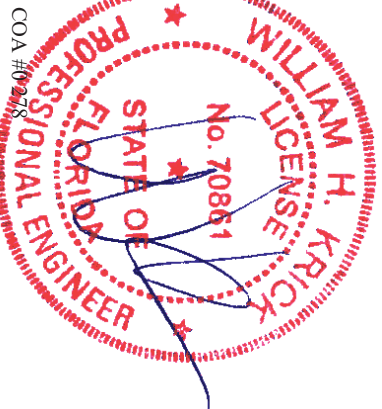

Florida State of Product Approval #FL 1999


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety) Information, by TPI and SBCCA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec. 2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCCA: sbccacomponents.com; ICC: iccsafe.org; AWC: awc.org

SECTN: 409467 /	COMN	Ply: 1	Job Number: 23-8926	Cust: R 215	JRef: 1XN32150003	T31
FROM: CDM		Qty: 1	Sunset 7			
			Truss Label: A03	DwnDwg: 04/1.23.0912.19222	/ WHK	02/10/2023

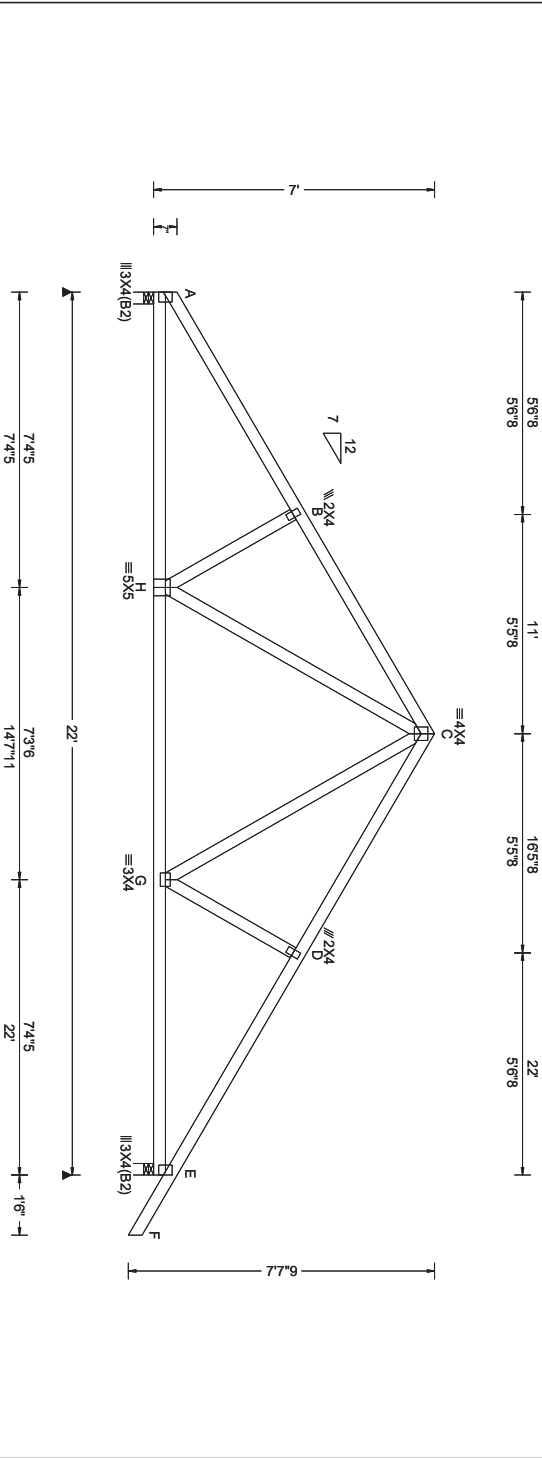

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg/Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.038 G 999 240 VERT(CL): 0.077 G 999 180 HORZ(LL): 0.019 E - - HORZ(TL): 0.039 E - - Creep Factor: 2.0 Max TC CSI: 0.187 Max BC CSI: 0.210 Max Web CSI: 0.059	Gravity Loc R+ /R- /Rh /Rw /U /RL A 911 /- /- /524 /10 /193 E 1020 /- /- /610 /17 /- Wind reactions based on MWFRS A Big Wld = 3.5 Min Req = 1.5 A Big Wld = 3.5 Min Req = 1.5 Bearings A & E are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	A - B 281 -1371 C - D 312 -1194 B - C 318 -1206 D - E 275 -1359 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - H 1105 -142 G - E 1090 -135 H - G 754 -4 Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. H - C 444 -100 C - G 428 -90

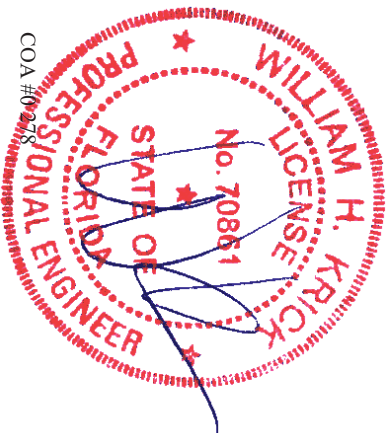

COA #00278
 Florida State Board of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org

SEC.N: 450701	GABL	Ply: 1	Job Number: 23-8926 Sunset 7 Truss Label: B01	Cust: R 215	JRef: 1XN32150003	T20
FROM: CDM	Qty: 1			DrawNo: 041.23.0913.12993	SSB / WHK	02/10/2023

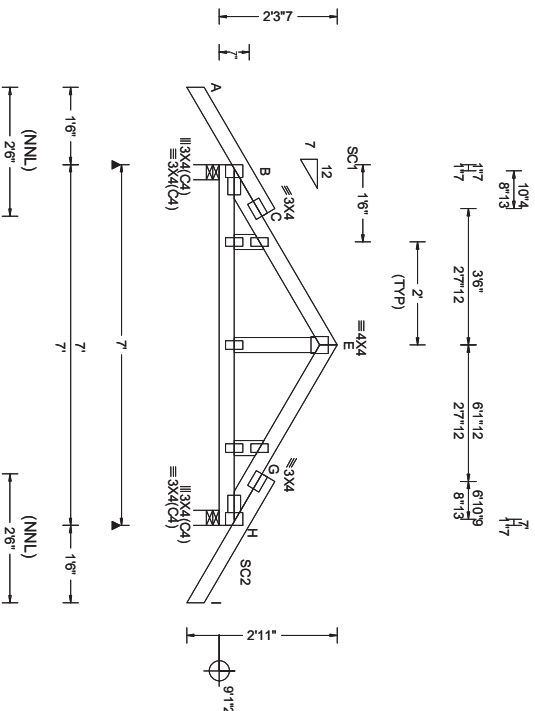[illegible]

Additional Notes

See DWGS A14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

Plating Notes
All plates are 2X4 except as noted.
Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;
Webs: 2x4 SP #3;
Stack Chord: SC1 2x4 SP #2;
Stack Chord: SC2 2x4 SP #2;

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.


Purlins

In lieu of structural panels use purlins to brace TC @ 24" oc.

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

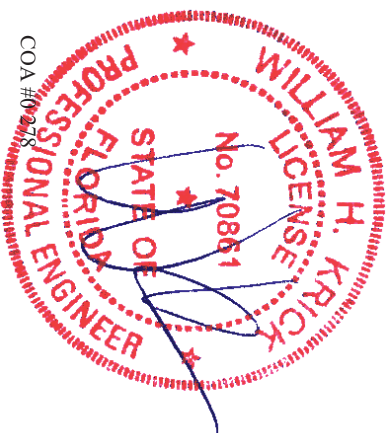


Florida Certificate of Product Approval #FL 1999-02-10-2023

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!

Tusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety) information, by TPI and SBCA, for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, no chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of tuss and position as shown above and on the Joint Details. Unless noted otherwise, Refer to drawings 160A-7 for standard plate positions. Refer to Job's General Notes page for additional information.

Able, a division of B Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build in compliance with AISC/AISI 1 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per AISC/AISI 1 Sec. 2.

SECN: 409470 / FROM: CDM	COMN	Ply: 1 Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: B03	Cust: R 215 JRef: 1XN32150003 T1 / DwnNo: 041.23.0912.20768 / YK 02/10/2023
-----------------------------	------	------------------	---	---

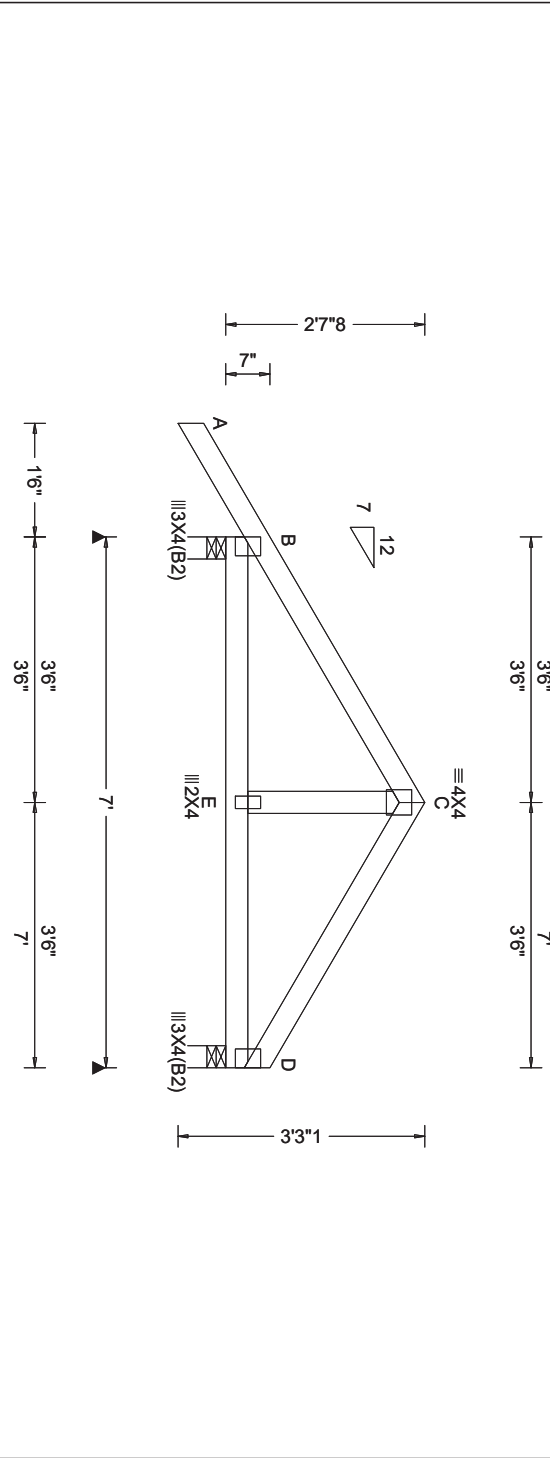

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Softt: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(L): 0.003 E 999 240 VERT(CL): 0.006 E 999 180 HORZ(L): 0.001 D - - HORZ(T/L): 0.003 D - - Creep Factor: 2.0 Max TC CSI: 0.077 Max BC CSI: 0.048 Max Web CSI: 0.013	Loc R+ / R- / Rh / Rw / U / RL B 404 /- /- /258 /75 /80 D 279 /- /- /165 /42 /- Wind reactions based on MWFRS B Big Wld = 3.5 Min Req = 1.5 D Big Wld = 3.5 Min Req = 1.5 Bearings B & D are a rigid surface. Members not listed have forces less than 375#
			VIEW Ver: 21.01.01A.0521.20	


Lumber

Top chord: 2x4 SP M-31;
 Bot chord: 2x4 SP M-31;
 Webs: 2x4 SP M-31;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

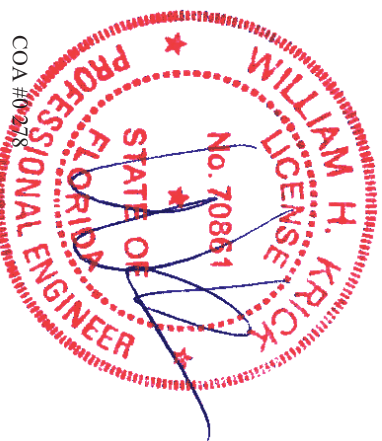

COA #0218
 Florida State Seal of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec. 2.

For more information see these web sites: Alpine: alpineitw.com, TPI: tpiinst.org, SBCCA: sbccacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECTN: 409471 /	GABL	Ply: 1	Job Number: 23-8926	Cust: R 215	JRef: 1XN32150003	T3 /
FROM: CDM		Qty: 1	Sunset 7		DwnNo: 041.23.0912.21648	
			Truss Label: C01		/ YK	02/10/2023

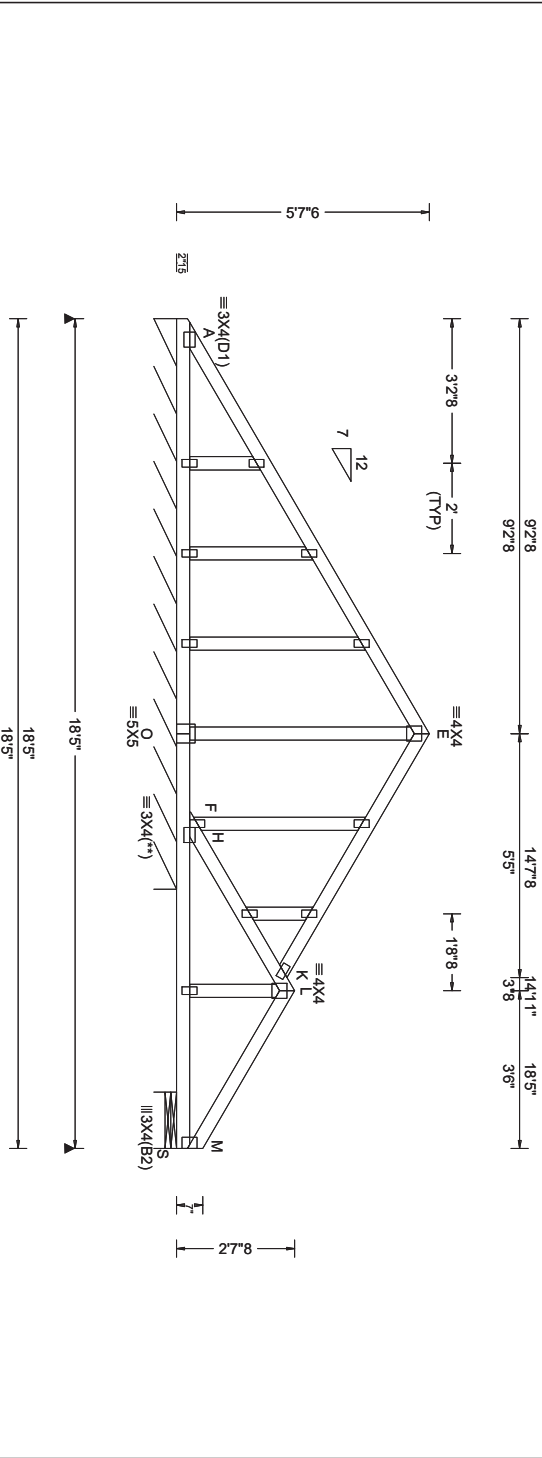

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs), or * = PLF
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: Any GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.003 I 999 240 VERT(CL): 0.007 I 999 180 HORZ(L): 0.002 J - - HORZ(TL): 0.003 J - - Creep Factor: 2.0 Max TC CSI: 0.047 Max BC CSI: 0.029 Max Web CSI: 0.042	Loc R+ /R- /Rh /Rw /U /RL A* 99 /- /- /54 /16 /11 S 267 /- /- /162 /37 /- Wind reactions based on MWFRS A Big Wld = 151 Min Req = - S Big Wld = 15.0 Min Req = 1.5 Bearings A & S are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. F - K 337 - 383
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	

Plating Notes

All plates are 2X4 except as noted.
 (***) 1 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Loading

Gable end supports 8" max rake overhang. Top chord must not be cut or notched.


Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

Additional Notes

See DWGS S14015ENC160118 & GBLLETIN0118 for gable wind bracing and other requirements.

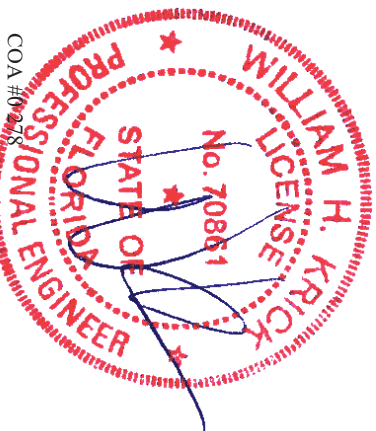

COA #0218
 Florida Seal of Product Approval #FL 1999


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 1 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.


For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECTN: 409472 / FROM: CDM	COMN Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: C02	Cust R 215 JRef: 1XN32150003 T2 / DwnNo: 041.23.0912.222217 / YK 02/10/2023
------------------------------	----------------	---	---

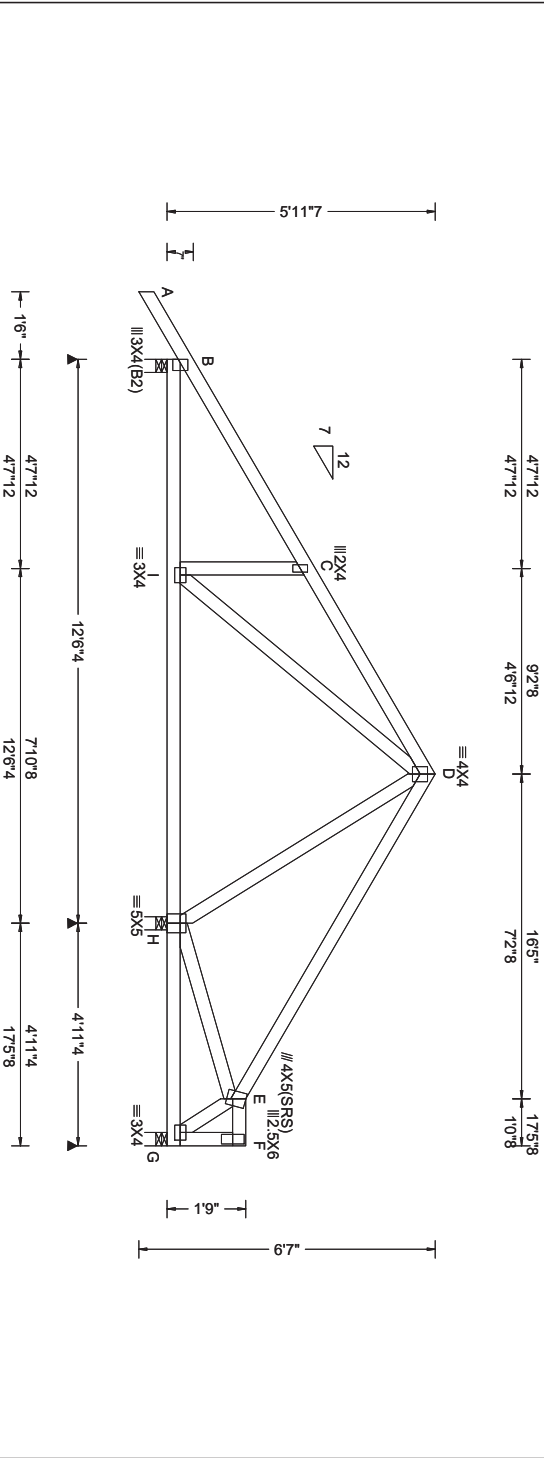

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg Pf in PSF)	DeficSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(L): 0.012 C 999 240 VERT(CL): 0.025 C 999 180 HORZ(L): 0.004 C - - HORZ(TL): 0.007 C - - Creep Factor: 2.0 Max TC CSI: 0.290 Max BC CSI: 0.148 Max Web CSI: 0.303	Loc R+ /R- /Rh /Rw /U /RL B 575 /- /- /360 /104 /155 H 912 /- /- /521 /140 /- G 123 /-35 /- /51 /40 /- Wind reactions based on MWFRS B Big Wid = 3.5 Min Req = 1.5 H Big Wid = 3.5 Min Req = 1.5 G Big Wid = 3.5 Min Req = 1.5 Bearings B, H, & G are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.


Lumber Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;	Purlins In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	Wind Wind loads based on MWFRS with additional C&C member design. Right end vertical not exposed to wind pressure. Wind loading based on both gable and hip roof types.	Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp.	Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp.
			B - C 110 - 613 C - D 221 - 598	I - D 523 - 147 H - E 273 - 462 D - H 173 - 696

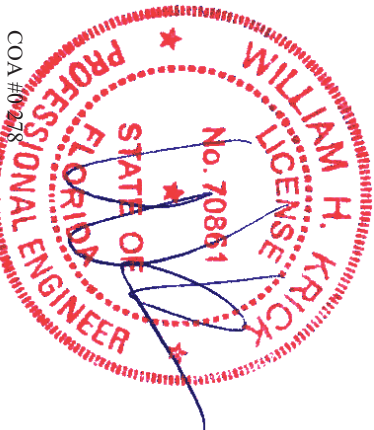


COA #0218
 06/24/2023
 Florida Seal of Product Approval #FL 1999

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****WARNING**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety) Information, by TPI and SBCEA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECON: 409474 / FROM: CDM	SPEC Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: D03	Cust: R 215 JRef: 1XN32150003 T34 / DwnNo: 041.23.0912.19322 / YK 02/10/2023
------------------------------	----------------	---	--

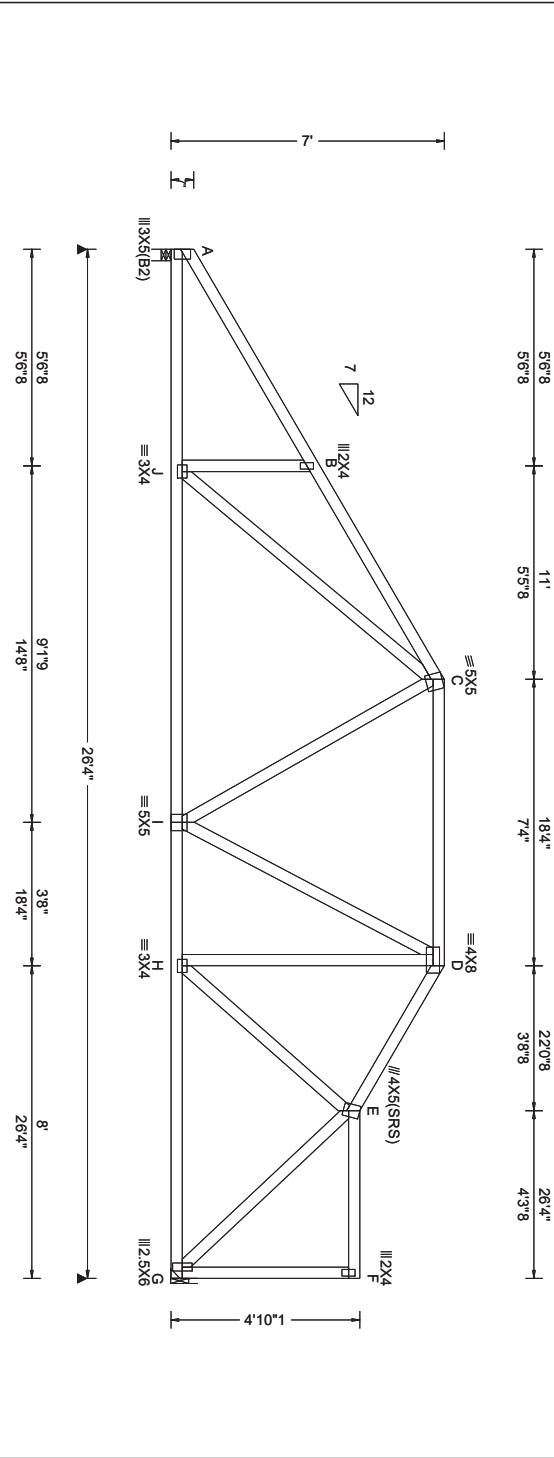


SECTN: 409475 /	SPEC	Ply: 1	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T38 /
FROM: CDM		Qty: 1	Sunset 7			
			Truss Label: D04		DwnNo: 041.23.0912.19924	
					/ YK	02/10/2023

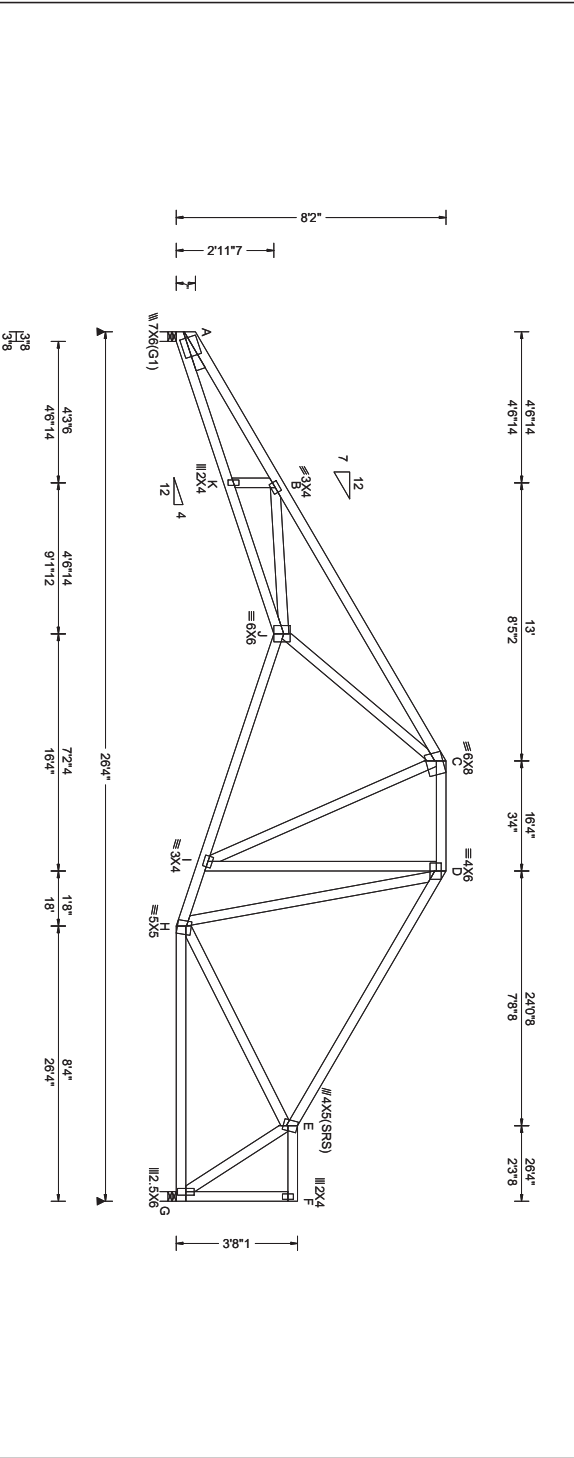

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.135 J 999 240 VERT(CL): 0.283 J 999 180 HORZ(L): 0.092 G - - HORZ(TL): 0.192 G - - Creep Factor: 2.0 Max TC CSI: 0.540 Max BC CSI: 0.430 Max Web CSI: 0.338	Loc R+ /R- /Rh /Rw /U /RL Gravity Non-Gravity A 1108 /- /- /651 /171 /195 G 1102 /- /- /577 /191 /- Wind reactions based on MWFRS A Big Wld = 3.5 Min Req = 1.5 G Big Wld = 3.5 Min Req = 1.5 Bearings A & G are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31; Lt Stud Wedge: 2x4 SP M-31;			A - B 917 -3438 C - D 411 -1000 B - C 785 -2911 D - E 367 -1183

Purlins In lieu of structural panels use purlins to brace all flat TC @ 24" oc. Wind Wind loads based on MWFRS with additional C&C member design. Right end vertical not exposed to wind pressure. Wind loading based on both gable and hip roof types.	Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp. A - K 3009 -890 I - H 1030 -261 K - J 3063 -907 H - G 730 -256 J - I 1296 -346 Maximum Web Forces Per Ply (lbs) Webs Tens.Comp. Webs Tens. Comp. B - J 288 -482 I - D 500 -106 J - C 1928 -428 E - G 463 -1283 C - I 183 -542
--	--

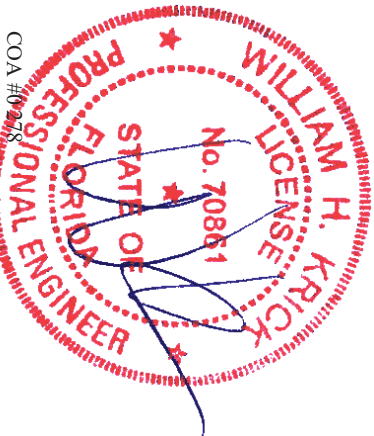


COA #0218
 Florida State of Product Approval #FL 1999

****IMPORTANT**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****WARNING**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety) Information, by TPI and SBCCA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/TFP 1 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/TFP 1 Sec.2.
 For more information see these web sites: Alpine: alpinetw.com, TPI: tpinst.org, SBCCA: sbccacomponents.com, ICC: iccsafe.org, AWC: awc.org



SECN: 409478 / FROM: CDM	SPEC	Ply: 1 Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: D07	Cust R 215 JRef: 1XN32150003 T12 / DmNo: 041.23.0912.22420 / YK 02/10/2023
-----------------------------	------	------------------	---	--

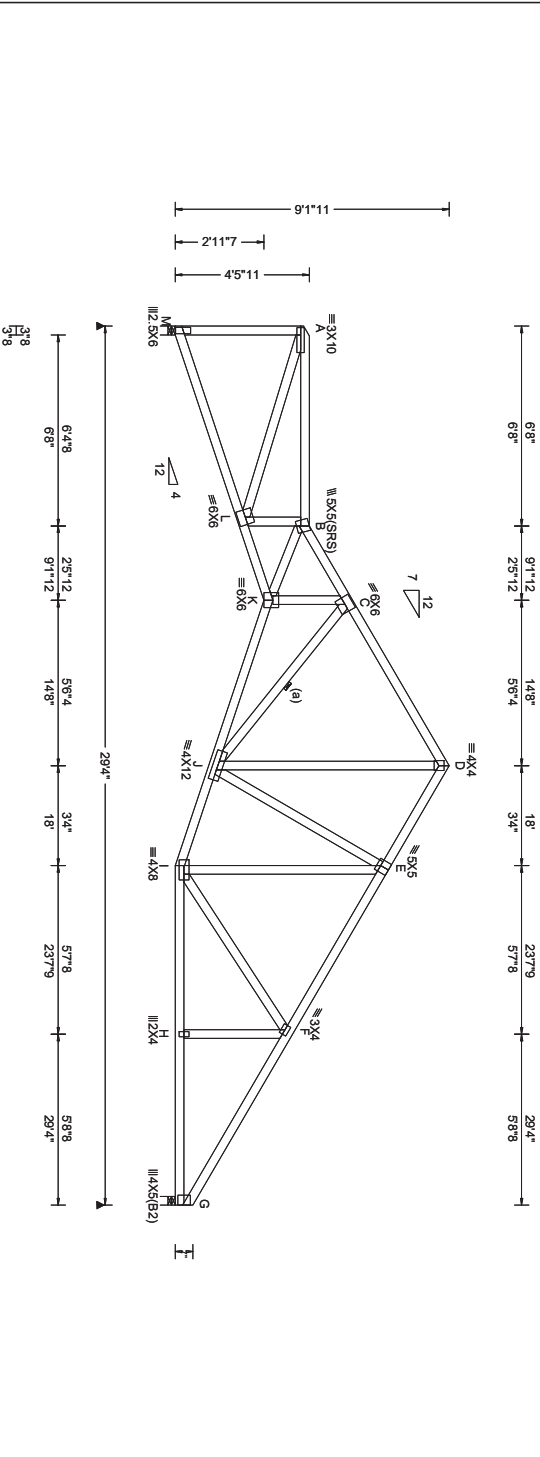


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg/Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.164 K 999 240 VERT(CL): 0.344 K 999 180 HORZ(L): 0.105 G - - HORZ(T/L): 0.220 G - - Creep Factor: 2.0 Max TC CSI: 0.455 Max BC CSI: 0.333 Max Web CSI: 0.323	Gravity / Rh / Rw / U / RL Loc R+ / R- M 1230 /- /- /637 /72 /220 G 1227 /- /- /717 /8 /- Wind reactions based on MWFRS M Big Wld = 3.5 Min Req = 1.5 G Big Wld = 3.5 Min Req = 1.5 Bearings M & G are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	A - B 699 -2970 D - E 401 -1430 B - C 723 -3455 E - F 385 -1551 C - D 384 -1468 F - G 385 -1943 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Bracing
(a) Continuous lateral restraint equally spaced on member.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
Wind loads based on MWFRS with additional C&C member design.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.


Deflection
Max JT VERT DEFL: LL: 0.16" DL: 0.18" See detail DEF/CAMB/014 for camber recommendations.
Provide for adequate drainage of roof.

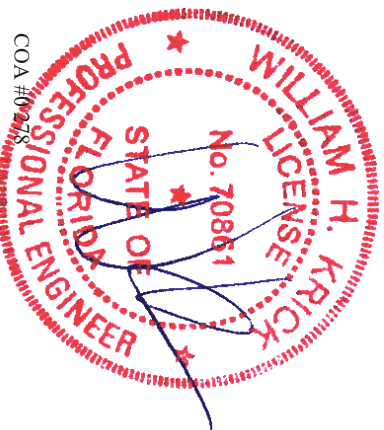

COA #00278
Florida State Seal of Product Approval #FL 1999

Maximum Web Forces Per Ply (lbs)	Maximum Bot Chord Forces Per Ply (lbs)
Webs Tens.Comp. Webs Tens. Comp.	Chords Tens.Comp. Chords Tens. Comp.
M - A 385 -1176 C - J 461 -2198	L - K 3368 -661 I - H 1588 -262
A - L 3109 -729 J - D 1088 -266	K - J 3054 -451 H - G 1590 -260
L - B 553 -1938 I - F 154 -390	J - I 1342 -145
K - C 2199 -405	

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org

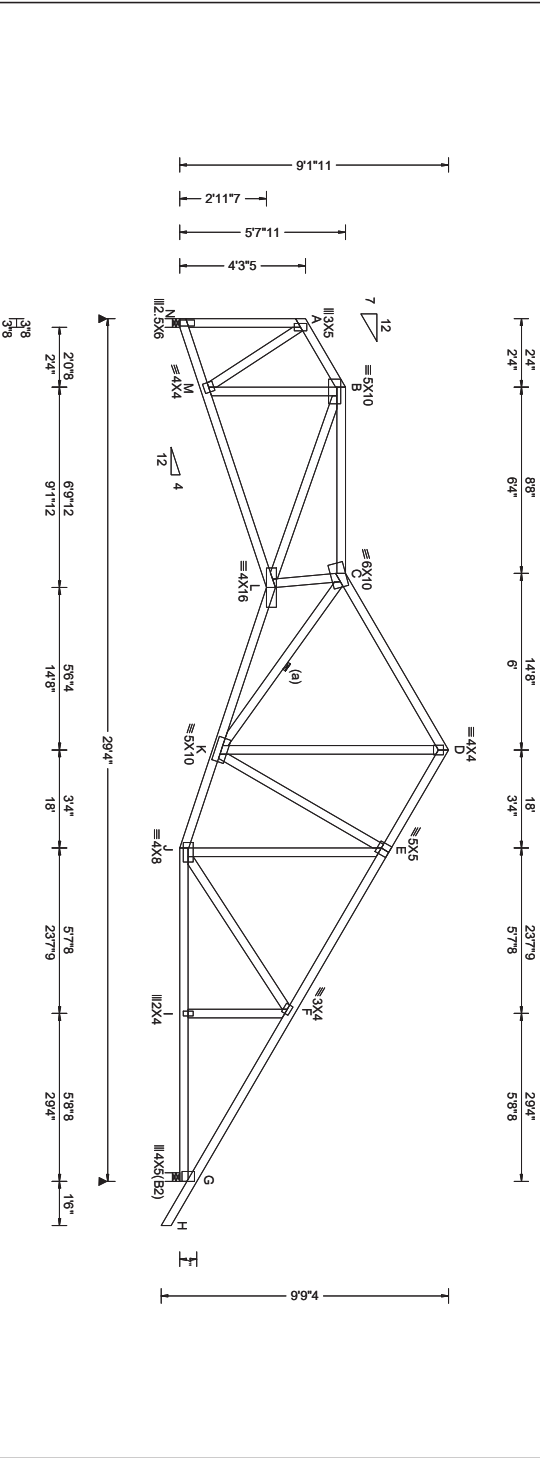


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCDL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCRCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCDL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.168 L 999 240 VERT(CL): 0.349 L 999 180 HORZ(L): 0.108 G - - HORZ(TL): 0.225 G - - Creep Factor: 2.0 Max TC CSI: 0.309 Max BC CSI: 0.372 Max Web CSI: 0.410	Loc R+ / R- / Rh / Rw / U / RL N 1229 /- /- /638 /61 /237 G 1332 /- /- /806 /30 /- Wind reactions based on MWFRS N Big Wld = 3.5 Min Req = 1.5 G Big Wld = 3.5 Min Req = 1.5 Bearings N & G are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;	VIEW Ver: 21.01.01A.0521.20		

Bracing
(a) Continuous lateral restraint equally spaced on member.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind
Wind loads based on MWFRS with additional C&C member design.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

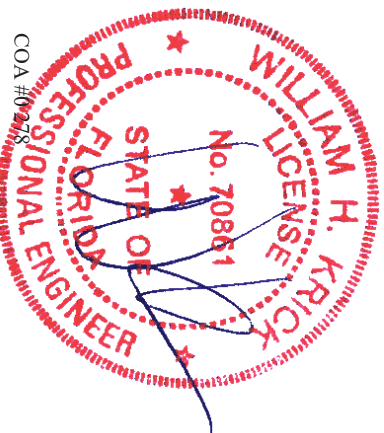

COA #00278
Florida State Seal of Product Approval #FL 1999

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
For more information see these web sites: Alpine: alpinetw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org


SECN: 409480 / FROM: CDM	SPEC	Ply: 1 Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: D09	Cust R 215 JRef: 1XN32150003 T14 DwnNo: 041.23.0912.20625 / WHK 02/10/2023
-----------------------------	------	------------------	---	--

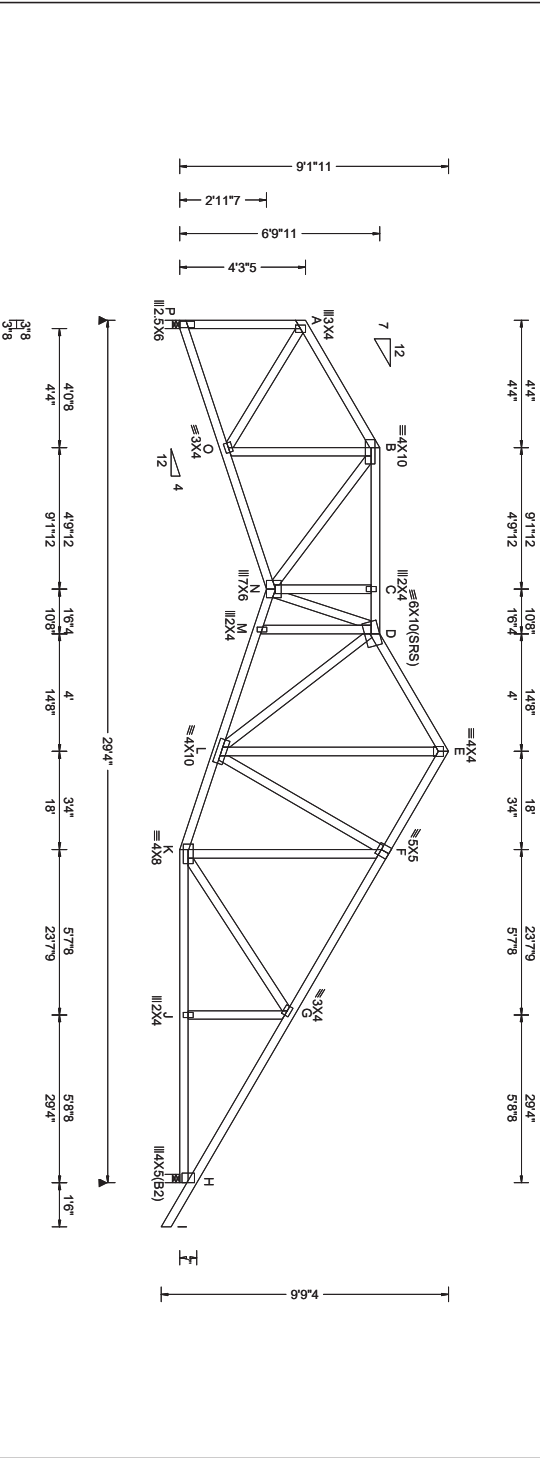

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Softt: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.083 D 999 240 VERT(CL): 0.173 D 999 180 HORZ(L): 0.058 H - - HORZ(TL): 0.121 H - - Creep Factor: 2.0 Max TC CSI: 0.249 Max BC CSI: 0.351 Max Web CSI: 0.653	Loc R+ /R- /Rh /Rw /U /RL P 1229 /- /- /639 /51 /237 H 1332 /- /- /810 /40 /- Wind reactions based on MWFRS P Big Wld = 3.5 Min Req = 1.5 H Big Wld = 3.5 Min Req = 1.5 Bearings P & H are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;	Purlins In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	WAVE	VIEW Ver: 21.01.01A.0521.20	A - B 332 -1123 E - F 460 -1421 B - C 633 -2189 F - G 437 -1543 C - D 633 -2188 G - H 430 -1921 D - E 451 -1424 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Wind
Wind loads based on MWFRS with additional C&C member design.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

Maximum Web Forces Per Ply (lbs)	Maximum Bot Chord Forces Per Ply (lbs)
Chords Tens.Comp. Webs Tens. Comp.	Chords Tens. Comp.
A - P 340 -1195 B - N 1581 -378 A - O 1071 -279 D - L 432 -1479 B - O 276 -730 L - E 1138 -367	O - N 976 -145 L - K 1334 -160 N - M 2176 -376 K - J 1564 -265 M - L 2182 -382 J - H 1565 -263

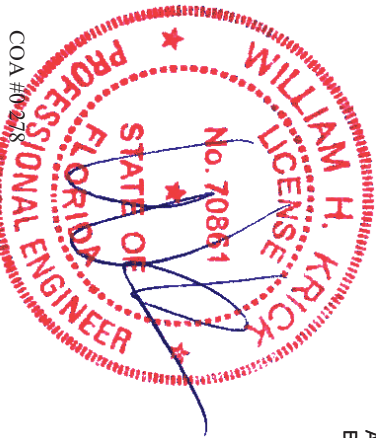


COA #0218
Florida Seal of Product Approval #FL 1999

****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org




SECTN: 409482 / FROM: CDM	SPEC	Ply: 1 Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: D11	Cust R 215 JRef: 1XN32150003 T24 DwnNo: 041.23.0912.22028 / WHK 02/10/2023
------------------------------	------	------------------	---	--

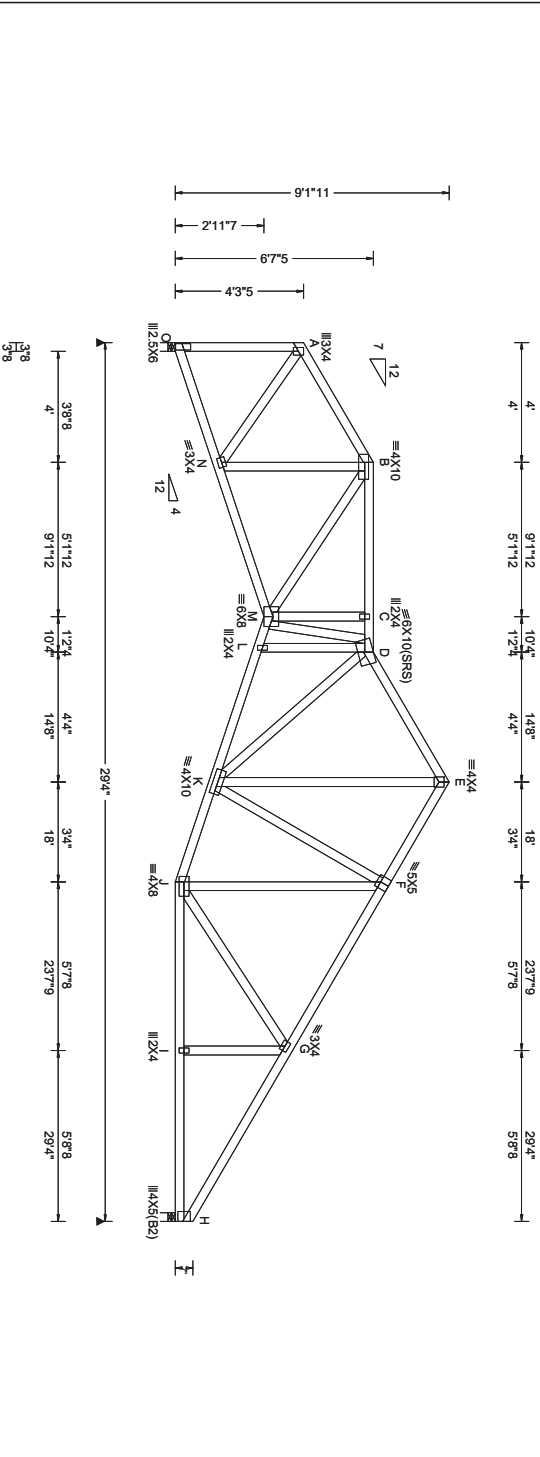

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf MWFERS Parallel Dist: h to 2h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.087 D 999 240 VERT(CL): 0.183 D 999 180 HORZ(L): 0.060 H - - HORZ(TL): 0.126 H - - Creep Factor: 2.0 Max TC CSI: 0.210 Max BC CSI: 0.334 Max Web CSI: 0.718	Gravity / R- / Rh / Rw / U / RL Loc R+ / R- / Rh / Rw / U / RL O 1232 /- /- /639 /53 /220 H 1227 /- /- /725 /27 /- Wind reactions based on MWFERS O Big Wld = 3.5 Min Req = 1.5 H Big Wld = 3.5 Min Req = 1.5 Bearings O & H are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	▲ Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens.

Purlins
In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind
Wind loads based on MWFERS with additional C&C member design.
Left end vertical not exposed to wind pressure.
Wind loading based on both gable and hip roof types.

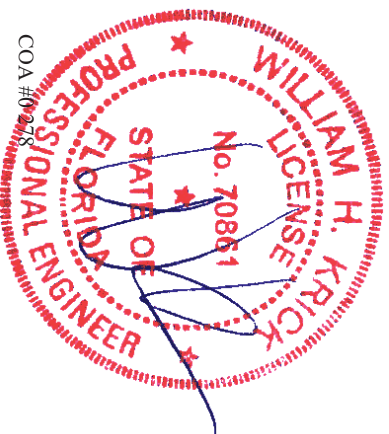

Florida State Seal of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 1 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec. 2.
 For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECTN: 409485 /	SPEC	Ply: 1	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T39
FROM: CDM		Qty: 1	Sunset 7		Dwnbnc: 041.23.0912.19498	
			Truss Label: D14		/ WHK	02/10/2023

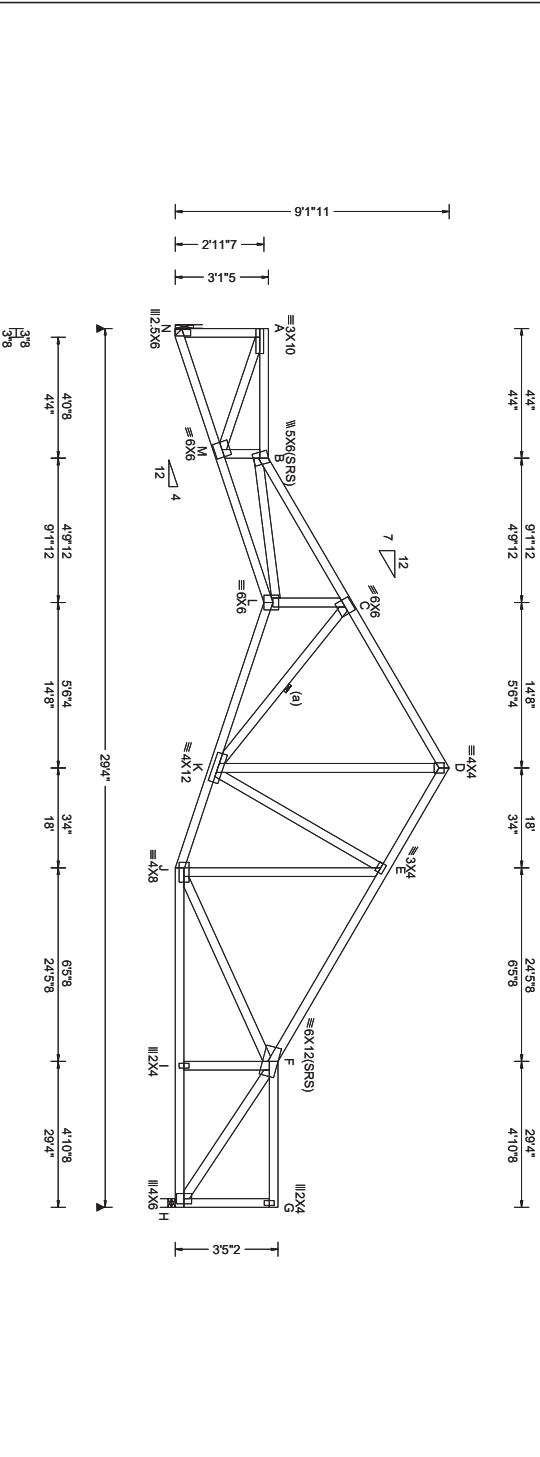

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCLL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Sofft: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.22 ft TCCL: 5.0 psf BCLL: 5.0 psf C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.161 L 999 240 VERT(CL): 0.338 L 999 180 HORZ(L): 0.106 H - - HORZ(T/L): 0.222 H - - Creep Factor: 2.0 Max TC CSI: 0.189 Max BC CSI: 0.356 Max Web CSI: 0.592	Gravity / R- / Rh / Rw / U / RL Loc R+ / R- / Rh / Rw / U / RL N 1233 /- /- /652 /29 /155 H 1226 /- /- /643 /43 /- Wind reactions based on MWFRS N Big Wld = - Min Req = - H Big Wld = 3.5 Bearing H is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Wind	VIEW	Ver: 21.01.01A.0521.20	

Bracing
 (a) Continuous lateral restraint equally spaced on member.

Hangers / Ties
 Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.
 Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.
 Bearing at location x=0 uses the following support conditions: 0'
 Bearing N (0', 9'1"2) HUS28
 Supporting Member: (1)2x8 SP #2
 (22) 0.148"x3" nails into supporting member.
 (4) 0.148"x3" nails into supported member.


Purlins
 In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
 IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpinetw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org



COA #0928
 Florida Certificate of Product Approval #FL 1999

SECTN: 409486 /	SPEC	Ply: 1	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T40
FROM: CDM		Qty: 1	Sunset 7		Dwnbnc: 041.23.0912.20654	
			Truss Label: D15		/ WHK	02/10/2023

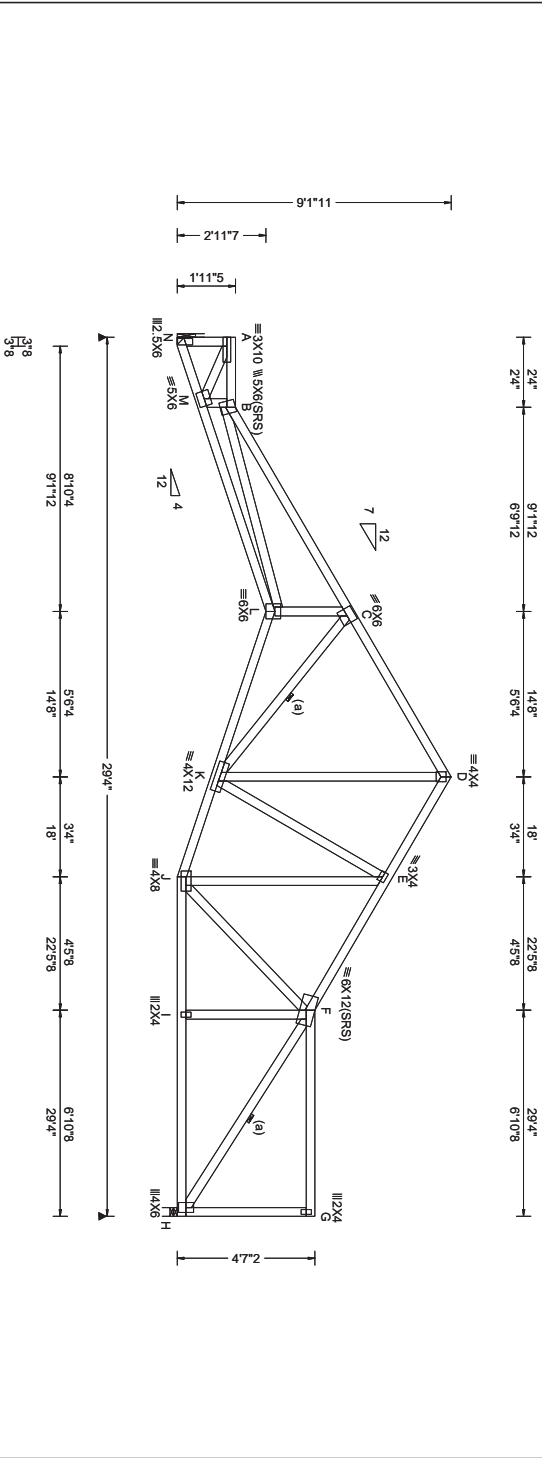

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.158 L 999 240 VERT(CL): 0.330 L 999 180 HORZ(L): 0.107 H - - HORZ(T/L): 0.224 H - - Creep Factor: 2.0 Max TC CSI: 0.383 Max BC CSI: 0.372 Max Web CSI: 0.330	Gravity / R- / Rh / Rw / U / RL Loc R+ /- /- /684 /9 /185 N 1233 /- /- /643 /84 /- H 1226 /- /- /643 /84 /- Wind reactions based on MWFRS N Big Wld = - Min Req = - H Big Wld = 3.5 Bearing H is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;	Wind	Wind loads based on MWFRS with additional C&C member design. End verticals not exposed to wind pressure. Wind loading based on both gable and hip roof types. Deflection Max JT VERT DEFL: L.L. 0.16" D.L. 0.17". See detail DEFLCAMB1014 for camber recommendations. Provide for adequate drainage of roof.	A - B 580 -2398 D - E 427 -1422 B - C 829 -3597 E - F 427 -1537 C - D 425 -1482

Bracing

(a) Continuous lateral restraint equally spaced on member.

Hangers / Ties


Simpson Construction Hardware is specified based on the most current information provided by Simpson Strong-Tie. Please refer to the most recent Simpson Strong-Tie catalog for additional information.

Recommended hanger connections are based on manufacturer tested capacities and calculations. Conditions may exist that require different connections than indicated. Refer to manufacturer publication for additional information.

Bearing at location x=0" uses the following support conditions: 0'
 Bearing N (0', 9'1"2) HUS28
 Supporting Member: (1)2x8 SP #2
 (22) 0.148"x3" nails into supporting member.
 (4) 0.148"x3" nails into supported member.

Purlins

In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

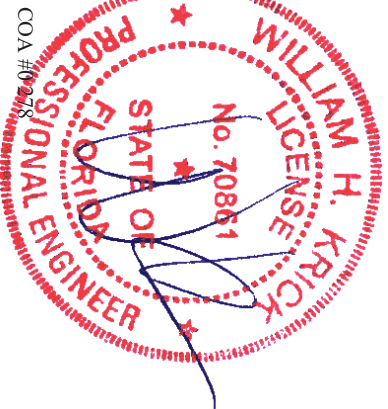

Florida State of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.


For more information see these web sites: Alpine: alpinetw.com, TPI: tpist.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECTN: 409487 / FROM: CDM	SPEC Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: D16	Cust R 215 JRef: 1XN32150003 T28 Dwnbrc: 041.23.0912.2 1666 / WHK 02/10/2023
------------------------------	----------------	---	--

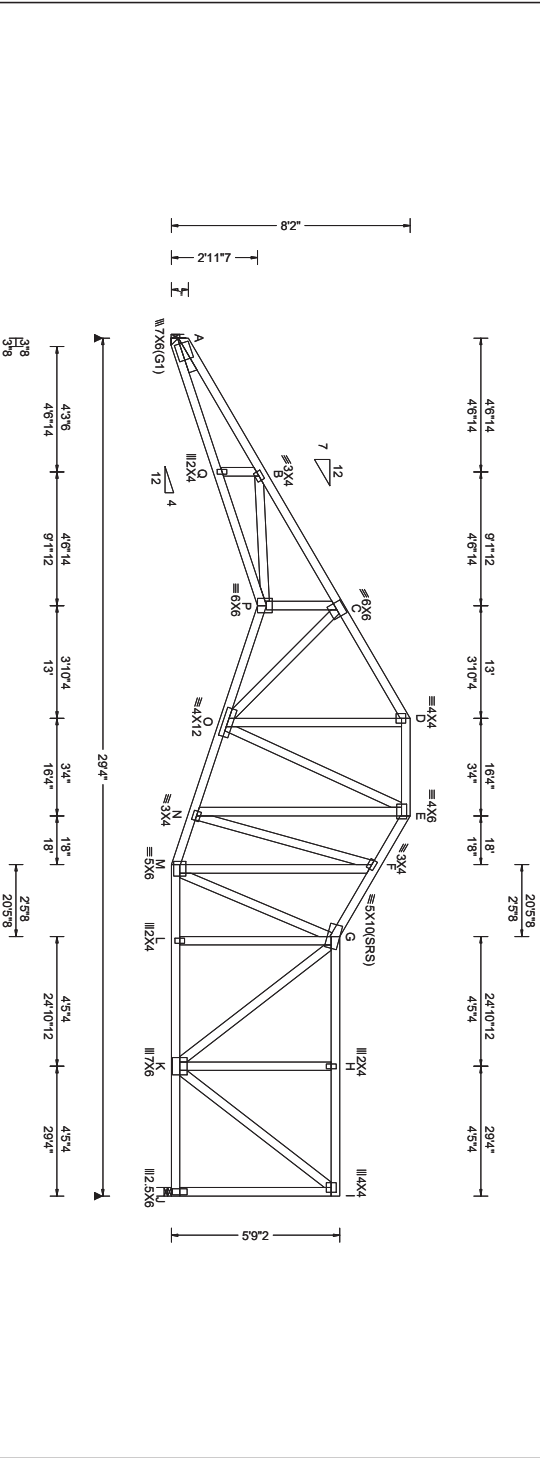

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg,Pf in PSF)		Def/CSI Criteria	▲ Maximum Reactions (lbs)			
		Pg: NA Pf: NA Lu: NA Snow Duration: NA	Ct NA CAT: NA Ce: NA Cs: NA		Gravity / Rh	Non-Gravity / Rw / U / RL		
TCLL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60			PP Deflection in loc L/def L/# VERT(LL): 0.163 P 999 240 VERT(CL): 0.341 P 999 180 HORZ(LL): 0.106 K - - HORZ(TL): 0.222 K - - Creep Factor: 2.0 Max TC CSI: 0.228 Max BC CSI: 0.426 Max Web CSI: 0.651	Loc R+ / R- A 1233 /- /- /728 /183 /195 J 1226 /- /- /647 /231 /- Wind reactions based on MWFRS A Big Wind = - Min Req = - J Big Wind = 3.5 Bearing J is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp.			
		Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):		VIEW Ver: 21.01.01A.0521.20				
		WAVE			A - B 1112 - 3759 E - F 583 - 1444 P - C 1124 2409 E - C 589 1495			

Maximum Bot Chord Forces Per Ply (lbs)			
Chords	Tens.Comp.	Chords	Tens. Comp.
A - Q	3269 -1129	N - M	1321 -482
Q - P	3317 -1147	M - L	1402 -541
P - O	3071 -1054	L - K	1404 -540
O - N	1305 -465		
Maximum Web Forces Per Ply (lbs)			
Webs	Tens.Comp.	Webs	Tens. Comp.
P - C	2110 -652	M - G	211 -377
C - O	715 -2104	G - K	263 -836
D - O	615 -171	K - I	1390 -593
O - E	484 -137	I - J	562 -1189

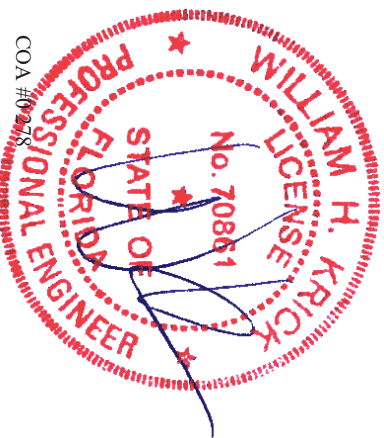


Florida State of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org




SECON: 409488 /	SPEC	Ply: 1	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T41
FROM: CDM		Qty: 1	Sunset 7			
			Truss Label: D17			
				DwnNo: 041.23.0912.20046		
				/ WHK	02/10/2023	

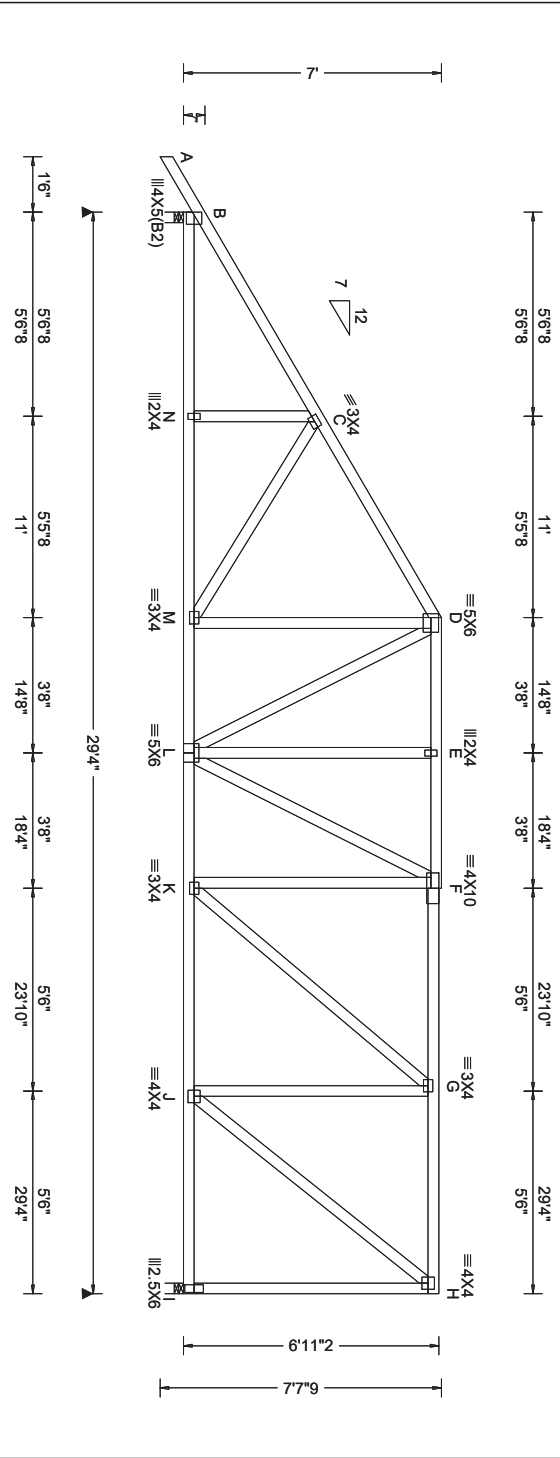

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: h/2 to h C&C Dist a: 3.00 ft Loc. from endwall: not in 9.00 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.056 M 999 240 VERT(CL): 0.119 M 999 180 HORZ(L): 0.021 J - - HORZ(T/L): 0.044 J - - Creep Factor: 2.0 Max TC CSI: 0.246 Max BC CSI: 0.351 Max Web CSI: 0.522	Gravity / R- / Rh / Rw / U / RL Loc R+ / R- / Rh / Rw / U / RL B 1326 /- /- /813 /137 /251 I 1215 /- /- /631 /- /- Wind reactions based on MWFRS B Big Wid = 3.5 Min Req = 1.5 I Big Wid = 3.5 Min Req = 1.5 Bearings B & I are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	B - C 528 -1910 E - F 568 -1333 C - D 549 -1552 F - G 510 -1268 D - E 557 -1333 G - H 362 -833 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Purlins	In lieu of structural panels use purlins to brace all flat TC @ 24" oc.	
Wind	Wind loads based on MWFRS with additional C&C member design. Right end vertical not exposed to wind pressure. Wind loading based on both gable and hip roof types.	
Maximum Web Forces Per Ply (lbs)		
Webs Tens.Comp. Webs Tens. Comp. F - K 336 -362 J - H 1326 -577 K - G 628 -372 H - I 583 -1173 G - J 514 -907		

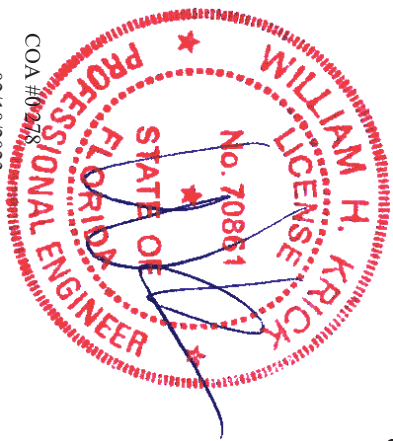

COA #00278
 Florida State of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**


Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.

For more information see these web sites: Alpine: alpinetw.com, TPI: tpinst.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org



SECTN: 409489 /	HIPM	Ply: 1	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T7
FROM: CDM		Qty: 1	Sunset 7	DwnNo: 041.23.091222164		
			Truss Label: D18	/ WHK	02/10/2023	

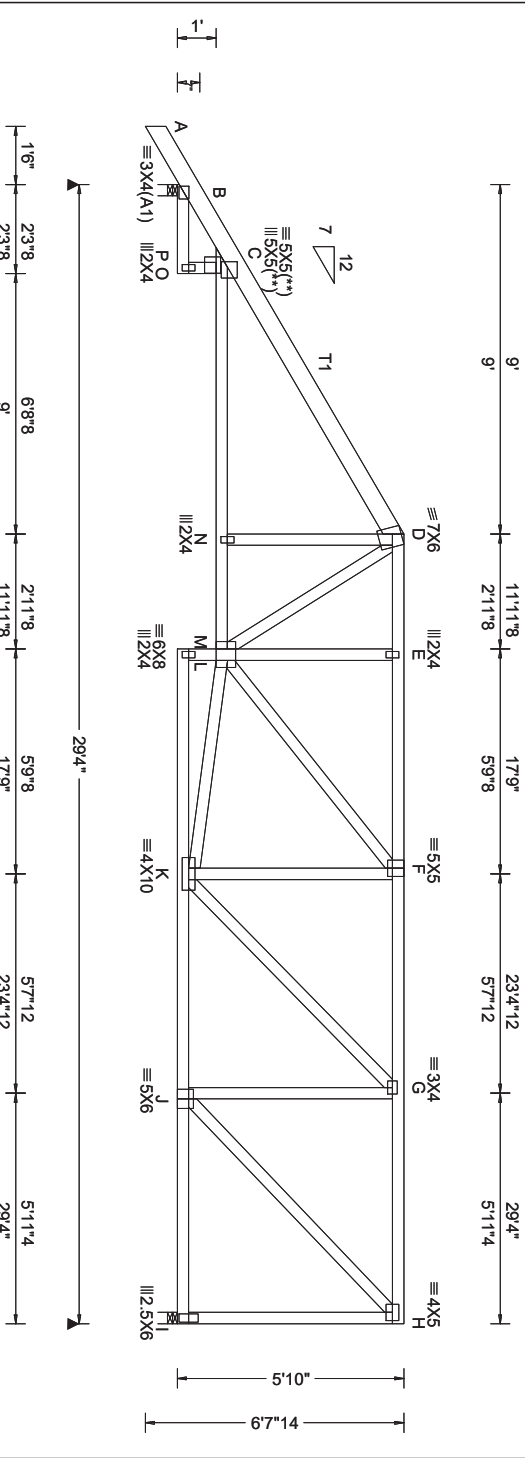

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _r in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Exposure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(L): 0.216 O 999 240 VERT(CL): 0.444 O 788 180 HORZ(L): 0.163 J - - HORZ(TL): 0.336 J - - Creep Factor: 2.0 Max TC CSI: 0.604 Max BC CSI: 0.300 Max Web CSI: 0.487	Loc R+ / R- / Rh / Rw / U / RL B 1331 /- /- /800 /220 /209 I 1210 /- /- /623 /240 /- Wind reactions based on MWFRS B Big Wld = 3.5 Min Req = 1.5 I Big Wld = 3.5 Min Req = 1.5 Bearings B & I are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x4 SP M-31; T1 2x6 SP 2400F-2.0E; Bot chord: 2x4 SP M-31; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	B - C 218 -847 E - F 1014 -1939 C - D 865 2019 F - G 818 -1558 D - E 1021 -1952 G - H 560 -1053 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Plating Notes
 (***) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Purlins
 In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind
 Wind loads based on MWFRS with additional C&C member design.
 Right end vertical not exposed to wind pressure.
 Wind loading based on both gable and hip roof types.

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
 FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.


Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com, TPI: tpinst.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org

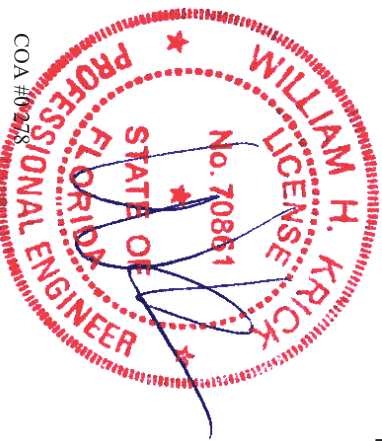

SECTN: 409503 /	HIPM	Ply: 2	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T8
FROM: CDM		Qty: 1	Sunset 7		DwnNo: 041.23.0912.21350	
			Truss Label: D19		/ WHK	02/10/2023

2 Complete Trusses Required

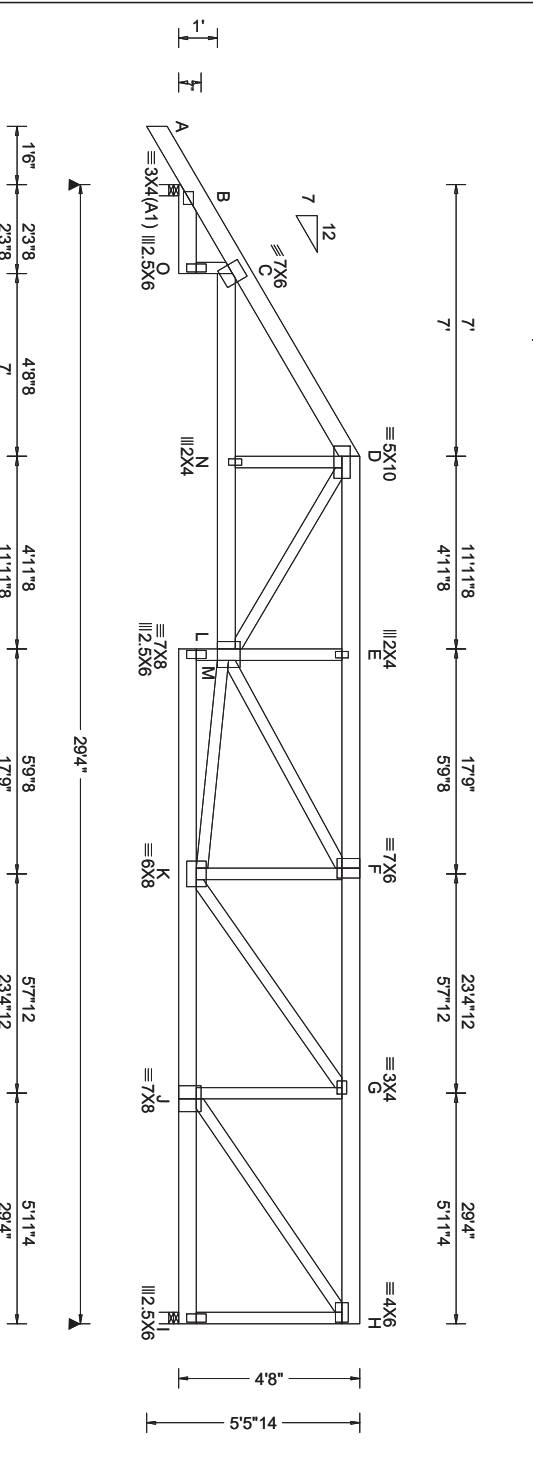


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg/Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 11.28 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: NA GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: No FT/RT:20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.226 N 999 240 VERT(CL): 0.472 N 741 180 HORZ(L): 0.172 J - - HORZ(TL): 0.359 J - - Creep Factor: 2.0 Max TC CSI: 0.935 Max BC CSI: 0.264 Max Web CSI: 0.209	Gravity / Rh / Rw / U / RL Loc R+ /R- /Rh /Rw /U /RL B 2504 /- /- /- /424 /- I 2605 /- /- /- /416 /- Wind reactions based on MWFRS B Big Wld = 3.5 Min Req = 1.5 I Big Wld = 3.5 Min Req = 1.5 Bearings B & I are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Top chord: 2x6 SP 2400F-2.0E; Bot chord: 2x6 SP 2400F-2.0E; Webs: 2x4 SP M-31;		VIEW Ver: 21.01.01A.0521.20	B - C 112 - 681 E - F 490 - 3019 C - D 421 - 2595 F - G 364 - 2229 D - E 493 - 3042 G - H 237 - 1490 Maximum Bot Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.

Nailnote
 Nail Schedule: 0.131"x3", min. nails
 Top Chord: 1 Row @12.00" o.c.
 Bot Chord: 1 Row @12.00" o.c.
 Webs : 1 Row @ 4" o.c.
 Use equal spacing between rows and stagger nails in each row to avoid splitting.

Loading
 #1 hip supports 7-0-0 jacks W/2 panel TC and no end vert.

Purlins
 In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind
 Wind loads and reactions based on MWFRS.
 Right end vertical not exposed to wind pressure.
 Wind loading based on both gable and hip roof types.

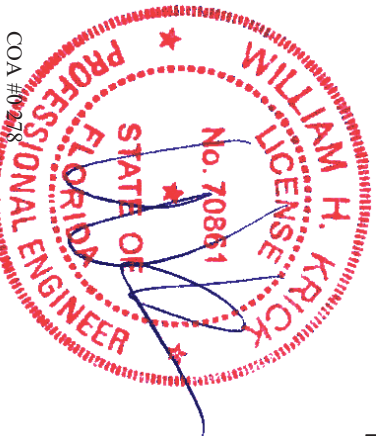

COA #0278
 Date of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpinetw.com, TPI: tpinst.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECTN: 409504 /	HIPS	Ply: 1	Job Number: 23-8926	Cust R 215	JRef: 1XN32150003	T23
FROM: CDM		Qty: 1	Sunset 7		DwnNo: 041.23.0912.19090	
			Truss Label: G01		/ WHK	02/10/2023

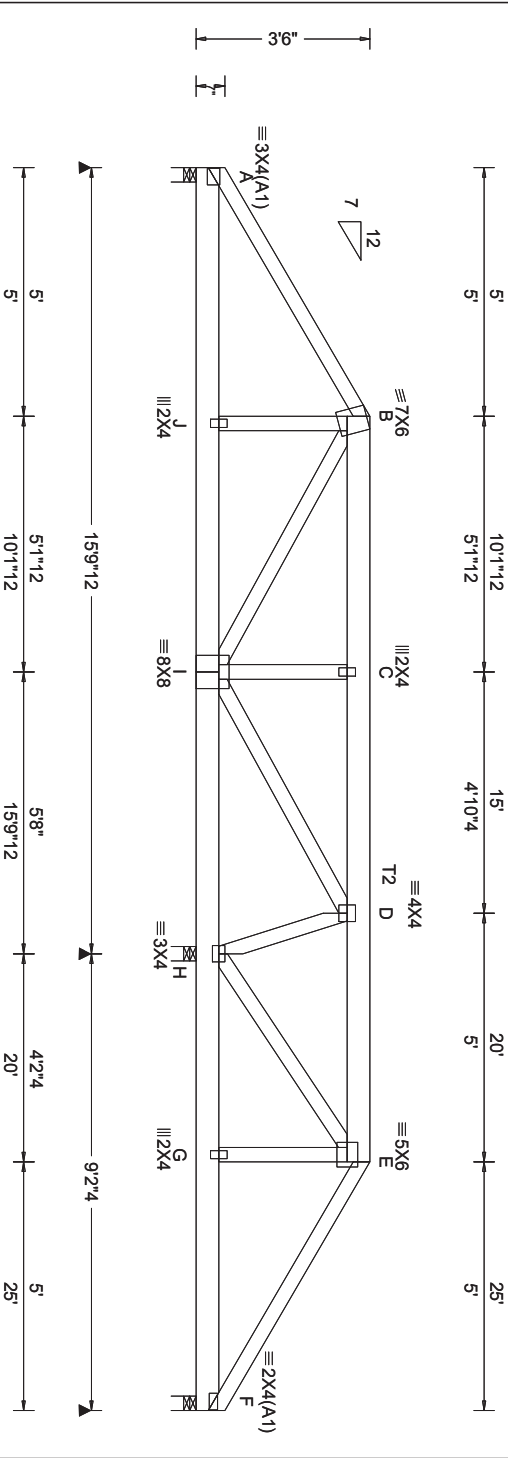


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCRCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 11.14 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: NA GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: No FT/RT:20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(LL): 0.017 C 999 240 VERT(CL): 0.036 C 999 180 HORZ(LL): 0.004 B - - HORZ(TL): 0.009 B - - Creep Factor: 2.0 Max TC CSI: 0.147 Max BC CSI: 0.115 Max Web CSI: 0.228	Loc R+ / R- / Rh / Rw / U / RL A 879 -/- /- /- /143 -/ H 2022 -/- /- /- /304 -/ F 341 -/- /- /- /83 -/ Wind reactions based on MWFRS A Big Wld = 3.5 Min Req = 1.5 H Big Wld = 3.5 Min Req = 1.5 F Big Wld = 3.5 Min Req = 1.5 Bearings A, H, & F are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens Comp. Chords Tens. Comp.

Lumber
 Top chord: 2x4 SP M-31; T2 2x6 SP 2400F-2.0E;
 Bot chord: 2x6 SP 2400F-2.0E;
 Webs: 2x4 SP M-31;

Loading
 #1 hip supports 5-0-0 jacks with no webs.
 Left side jacks have 5-0-0 setback with 0-0-0 cant and 1-6-0 overhang. End jacks have 5-0-0 setback with 0-0-0 cant and 1-6-0 overhang. Right side jacks have 5-0-0 setback with 0-0-0 cant and 0-0-0 overhang.

Purlins
 In lieu of structural panels use purlins to brace all flat TC @ 24" oc.


Wind
 Wind loads and reactions based on MWFRS.
 Wind loading based on both gable and hip roof types.

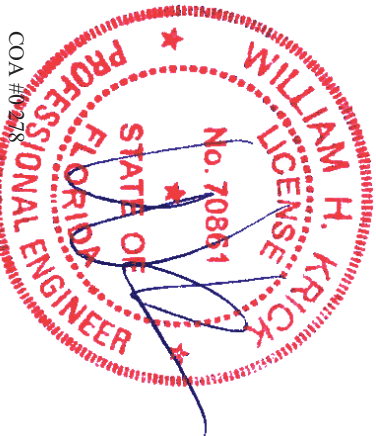

COA #02478
 State of Florida
 Seal of Professional Engineer
 Date of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECTN: 409498 / FROM: CDM	HIPM Qty: 1	Job Number: 23-8926 Sunset 7 Truss Label: G02	Cust R 215 JRef: 1XN32150003 T27 DwnbNo: 041.23.0912.20396 / WHK 02/10/2023
------------------------------	----------------	---	---

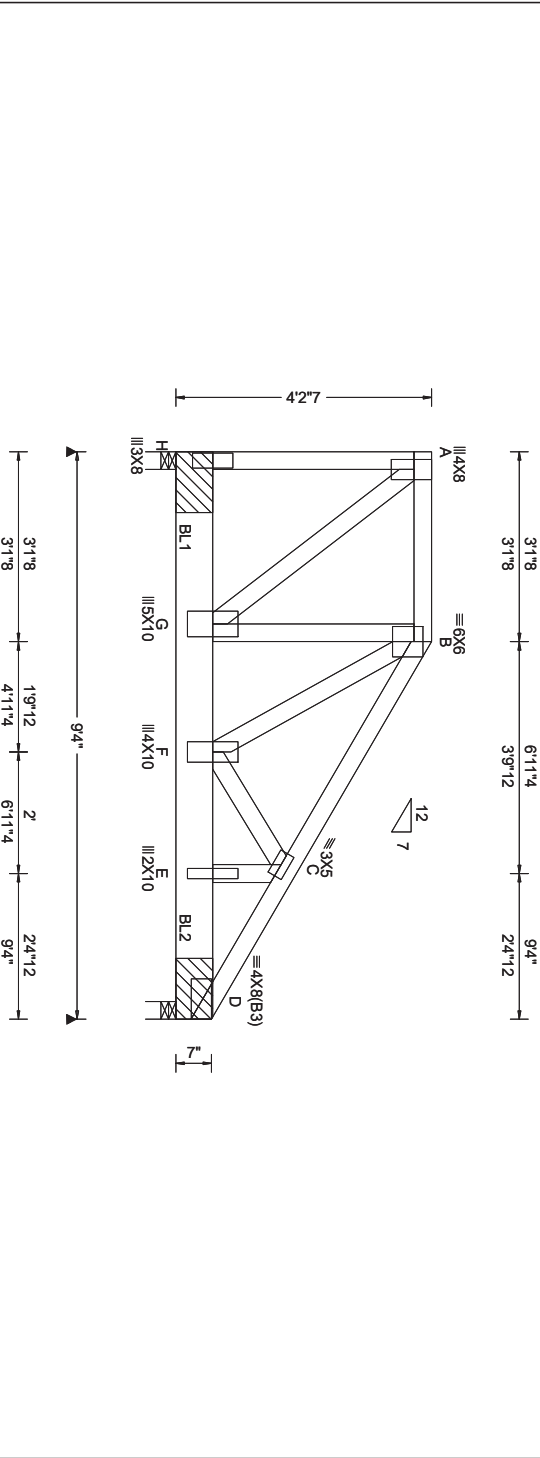

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCLL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCBCLL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpl: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Varies by Ld Case FT/RT: 20(0)/10(0) Plate Type(s): WAVE	PP Deflection in loc L/def L/# VERT(L): 0.033 F 999 240 VERT(CL): 0.066 F 999 180 HORZ(L): 0.011 A - - HORZ(TL): 0.021 A - - Creep Factor: 2.0 Max TC CSI: 0.137 Max BC CSI: 0.726 Max Web CSI: 0.269	Gravity / Rh / Rw / U / RL Loc R+ / R- / Rh / Rw / U / RL H 3132 /- /- /- /192 /- D 3594 /- /- /- /294 /- Wind reactions based on MWFRS H Big Wid = 3.5 Min Req = - D Big Wid = 3.5 Min Req = - Bearings H & D are a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp. Chords Tens. Comp.
Lumber	Wind Duration: 1.60	VIEW Ver: 21.01.01A.0521.20		A - B 96 -1710 C - D 190 -3839 B - C 150 -3017

Lumber
 Top chord: 2x4 SP M-31;
 Bot chord: 2x8 SP #2;
 Webs: 2x4 SP M-31;

Special Loads
 ——(Lumber Dur.Fac.=1.25 / Plate Dur.Fac.=1.25)
 TC: From 63 pif at 0.00 to 63 pif at 3.12
 TC: From 32 pif at 3.12 to 32 pif at 6.94
 TC: From 63 pif at 6.94 to 63 pif at 9.33
 BC: From 10 pif at 0.00 to 10 pif at 9.33
 BC: 1232 lb Conc. Load at 0.94
 BC: 1233 lb Conc. Load at 2.94, 4.94, 6.94, 8.94

Purlins
 In lieu of structural panels use purlins to brace all flat TC @ 24" oc.

Wind
 Wind loads and reactions based on MWFRS.
 Left end vertical not exposed to wind pressure.
 Wind loading based on both gable and hip roof types.


Bearing Blocks(s)
 Big blocks: 0.131"x3", min. nails
 1 0.000' #blocks length/blk #nails/bk wall plate
 1 0.000' 1 12" 4 Rigid Surface
 2 9.041' 1 12" 5 Rigid Surface
 Big block to be same size and species as chord.
 Refer to drawing CNAALSP1014 for more information.



COA #0218
 Florida State Seal of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/TFP 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/TFP 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org

SECN: 409499 /	HIP -	Ply: 1	Job Number: 23-8926	Cust: R 215	JRef: 1XN32150003	T21
FROM: CDM		Qty: 1	Sunset 7	DwnNo: 041.23.0912.19176		
			Truss Label: 101	/ WHK	02/10/2023	

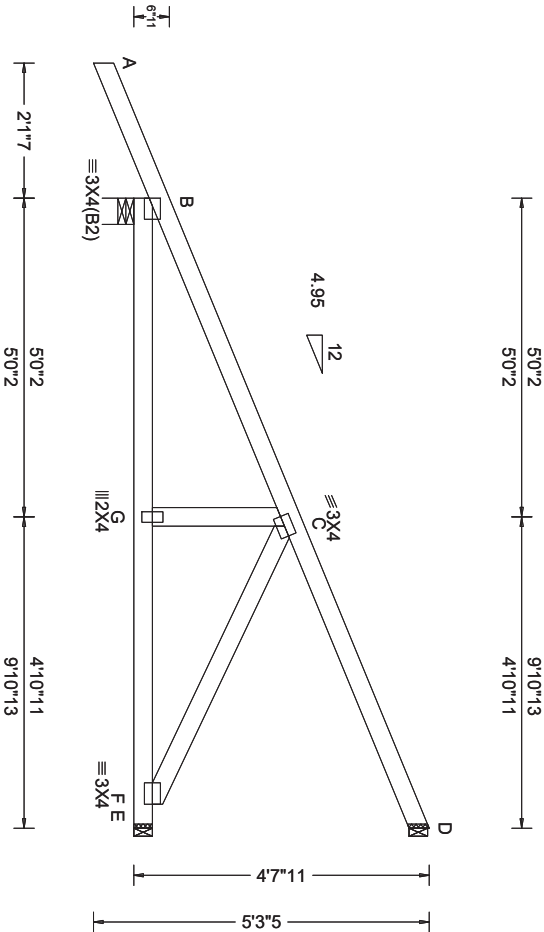

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg Pf in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCLL: 0.00 BCDL: 10.00 Des Ld: 40.00 NCRCLL: 0.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 0.00 ft TCCL: 5.0 psf BCDL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: NA GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: No FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): 0.021 G 999 240 VERT(CL): 0.043 G 999 180 HORZ(L): -0.006 D - - HORZ(TL): 0.013 D - - Creep Factor: 2.0 Max TC CSI: 0.281 Max BC CSI: 0.227 Max Web CSI: 0.166	Loc R+ / R- / Rh / Rw / U / RL B 462 - / - / - / - / 93 - / - E 359 - / - / - / - / 3 - / - D 272 - / - / - / - / 100 - / - Wind reactions based on MWFRS B Brg Wid = 4.9 Min Req = 1.5 E Brg Wid = 1.5 D Brg Wid = 1.5 Bearing B is a rigid surface. Members not listed have forces less than 375# Maximum Top Chord Forces Per Ply (lbs) Chords Tens.Comp.
Lumber	Wind Duration: 1.60	WAVE	VIEW Ver: 21.01.01A.0521.20	

Top chord: 2x4 SP M-31;
 Bot chord: 2x4 SP M-31;
 Webs: 2x4 SP M-31;

Loading


Hipjack supports 7'-0"-0 setback jacks with no webs.

Wind

Wind loads and reactions based on MWFRS.

Wind loading based on both gable and hip roof types.

B - C	101	- 629	Maximum Bot Chord Forces Per Ply (lbs)	Chords Tens.Comp.	Chords Tens. Comp.
B - G	553	- 86	G - F	548	- 89
Maximum Web Forces Per Ply (lbs)	Webs Tens.Comp.				
C - F	100	- 621			

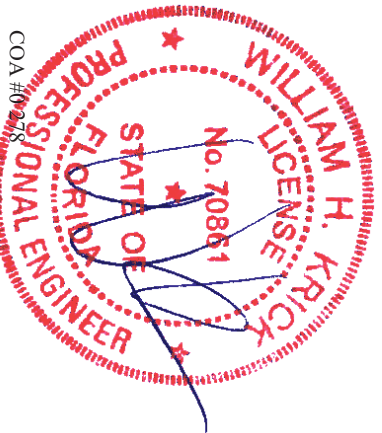


COA #0218
 Florida Seal of Product Approval #FL 1999

****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCEA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
 For more information see these web sites: Alpine: alpinetw.com, TPI: tpinst.org, SBCEA: sbceacomponents.com, ICC: iccsafe.org, AWC: awc.org



SECN: 409490 /	EJAC	Ply: 1	Job Number: 23-8926	Cust: R 215	JRef: 1XN32150003	T9
FROM: CDM		Qty: 19	Sunset 7 Truss Label: J03	DwnNo: 041.23.0912.20622	/ WHK	02/10/2023

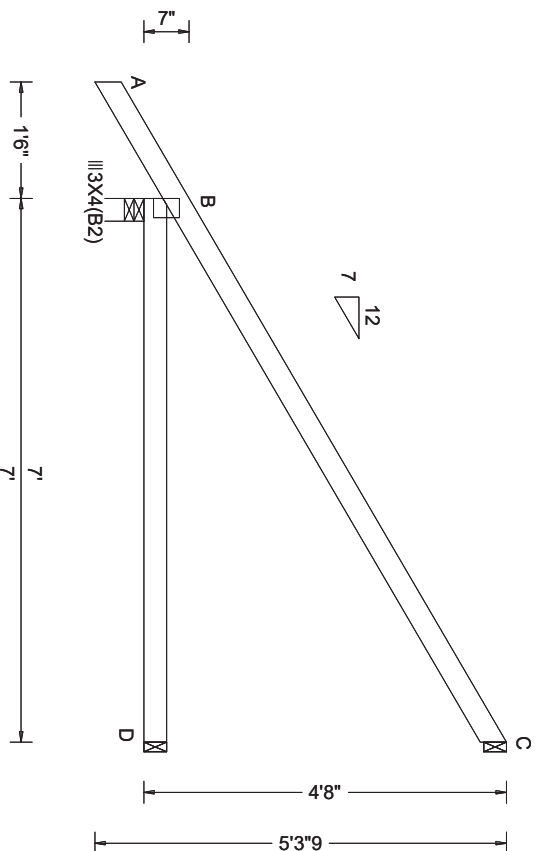


Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT: 20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(LL): NA VERT(CL): NA HORZ(LL): 0.009 B - - HORZ(TL): 0.018 B - - Creep Factor: 2.0 Max TC CSI: 0.314 Max BC CSI: 0.216 Max Web CSI: 0.000	Loc R+ /R- /Rh /Rw /U /RL B 406 /- /- /273 /30 /168 D 135 /- /- /73 /- /- C 200 /- /- /130 /113 /- Wind reactions based on MWFRS B Brg Wld = 3.5 Min Req = 1.5 D Brg Wld = 1.5 C Brg Wld = 1.5 Bearing B is a rigid surface. Members not listed have forces less than 375#
Lumber	Wind Duration: 1.60	WAVE	VIEW Ver: 21.01.01A.0521.20	

Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

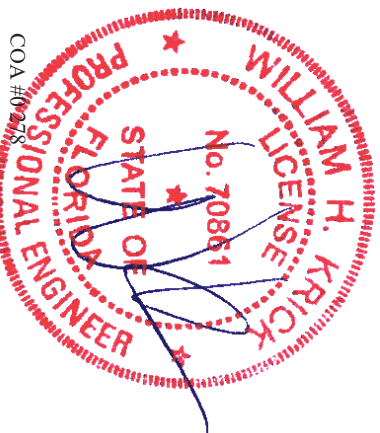


COA #09278
Florida Certificate of Product Approval #FL 1999

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING!

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering liability solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpinst.org; SBCCA: sbccacomponents.com; ICC: iccsafe.org; AWC: awc.org

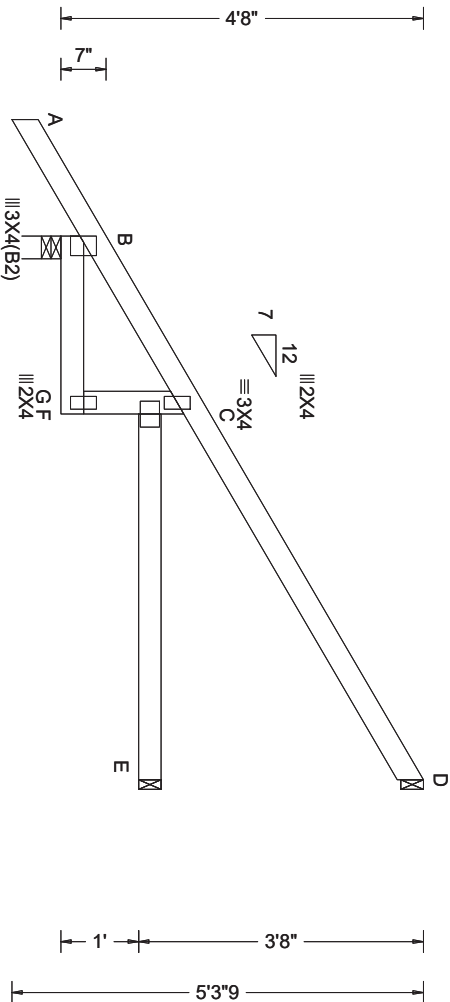

Loading Criteria (psf)		Snow Criteria (Pg P _f in PSF)		Def/CSI Criteria		▲ Maximum Reactions (lbs)			
TCCL:	20.00	Wind Std: ASCE 7-16	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/def L/#	Loc	R+ / R-	Gravity / Rh / Rw / U / RL
TCDL:	10.00	Speed: 130 mph	Pf: NA	Ce: NA		VERT(L): 0.140 F 596 240	B 406	- / -	- / - / 274 / 31 / 169
BCLL:	0.00	Enclosure: Closed	Lu: NA	Cs: NA		HORZ(L): 0.093 C - -	E 107	- / -	- / - / 61 / - / -
BCDL:	10.00	Risk Category: II	Snow Duration: NA			HORZ(TL): 0.186 C - -	D 210	- / -	- / - / 142 / 104 / -
Des Ld:	40.00	EXP: C Kzt: NA				Creep Factor: 2.0	Wind reactions based on MWFRS		
NCRCLL:	10.00	TCCL: 5.0 psf	Building Code: FBC 7th Ed. 2020 Res.			Max TC CSI: 0.373	B	Brig Wid = 3.5	Min Req = 1.5
Softt:	2.00	BCDL: 5.0 psf	TPI Std: 2014			Max BC CSI: 0.136	E	Brig Wid = 1.5	
Load Duration: 1.25		MWFRS Parallel Dist: h/2 to h	Rep Fac: Yes			Max Web CSI: 0.067	D	Brig Wid = 1.5	
Spacing: 24.0 "		C&C Dist a: 3.00 ft	FT/RT: 20(0)/10(0)				Bearing B is a rigid surface.		
		Loc. from endwall: not in 4.50 ft	Plate Type(s):				Members not listed have forces less than 375#		
		GCpl: 0.18							
		Wind Duration: 1.60	WAVE			VIEW Ver: 21.01.01A.0521.20			


Lumber

Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;
Webs: 2x4 SP M-31;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

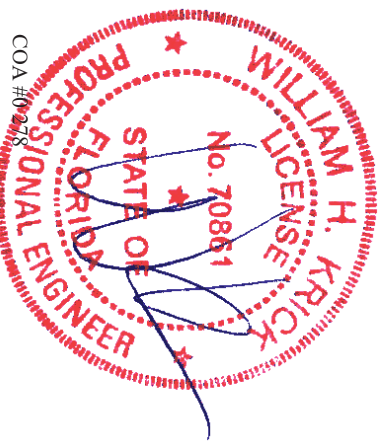


Florida State Seal of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec. 2.

For more information see these web sites: Alpine: alpineitw.com; TPI: tpist.org; SBCCA: sbccacomponents.com; ICC: iccsafe.org; AWC: awc.org

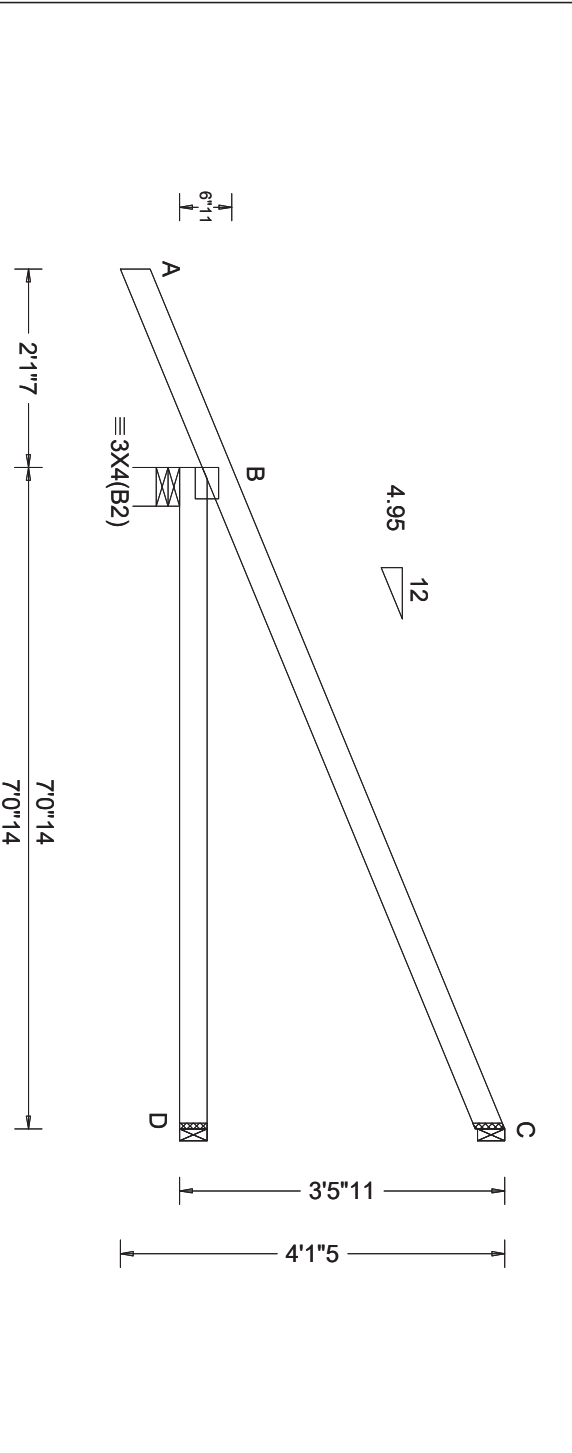


Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg P _f in PSF)			Def/CSI Criteria		▲ Maximum Reactions (lbs)				
TCLL: 20.00	Wind Std: ASCE 7-16	Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/def L/#	VERT(L): NA	Loc	R +	R -	Rh	Rw	U	RL
TCDL: 10.00	Speed: 130 mph	Pf: NA	Ce: NA		VERT(CL): NA	VERT(L): NA	B	307	-	-	-	-	-
BCLL: 0.00	Enclosure: Closed	Lu: NA	Cs: NA		HORZ(L): 0.004 B	-	D	80	-	-	34	-	-
BCDL: 10.00	Risk Category: II	Snow Duration: NA			HORZ(TL): 0.008 B	-	C	220	-	-	-	81	-
Des Ld: 40.00	EXP: C Kzt: NA				Creep Factor: 2.0		Wind reactions based on MWFRS						
NBCLL: 0.00	Mean Height: 0.00 ft				FBC 7th Ed. 2020 Res.		B	Wind Wld = 4.9 Min Req = 1.5					
Soffit: 2.00	TCDL: 5.0 psf				TPI Std: 2014		D	Big Wld = 1.5					
Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2				Rep Fac: No		C	Big Wld = 1.5					
Spacing: 24.0 "	C&C Dist a: 3.00 ft				FT/RT: 20(0)/10(0)		Bearing B is a rigid surface.						
	Loc. from endwall: NA				Plate Type(s):		Members not listed have forces less than 375#						
	GCpl: 0.18				VIEW Ver: 21.01.01A.0521.20								
	Wind Duration: 1.60	WAVE											

Lumber
Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;


Loading
Hipjack supports 5-0-0 setback jacks with no webs.

Wind
Wind loads and reactions based on MWFRS.
Wind loading based on both gable and hip roof types.

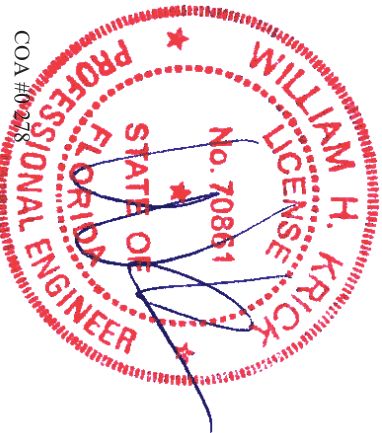

Florida State of Product Approval #FL 1999


****IMPORTANT**** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS
****WARNING**** READ AND FOLLOW ALL NOTES ON THIS DRAWING!
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.
Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.
For more information see these web sites: Alpine: alpinetw.com, TPI: tpinst.org, SBCA: sbccomponents.com, ICC: iccsafe.org, AWC: awc.org

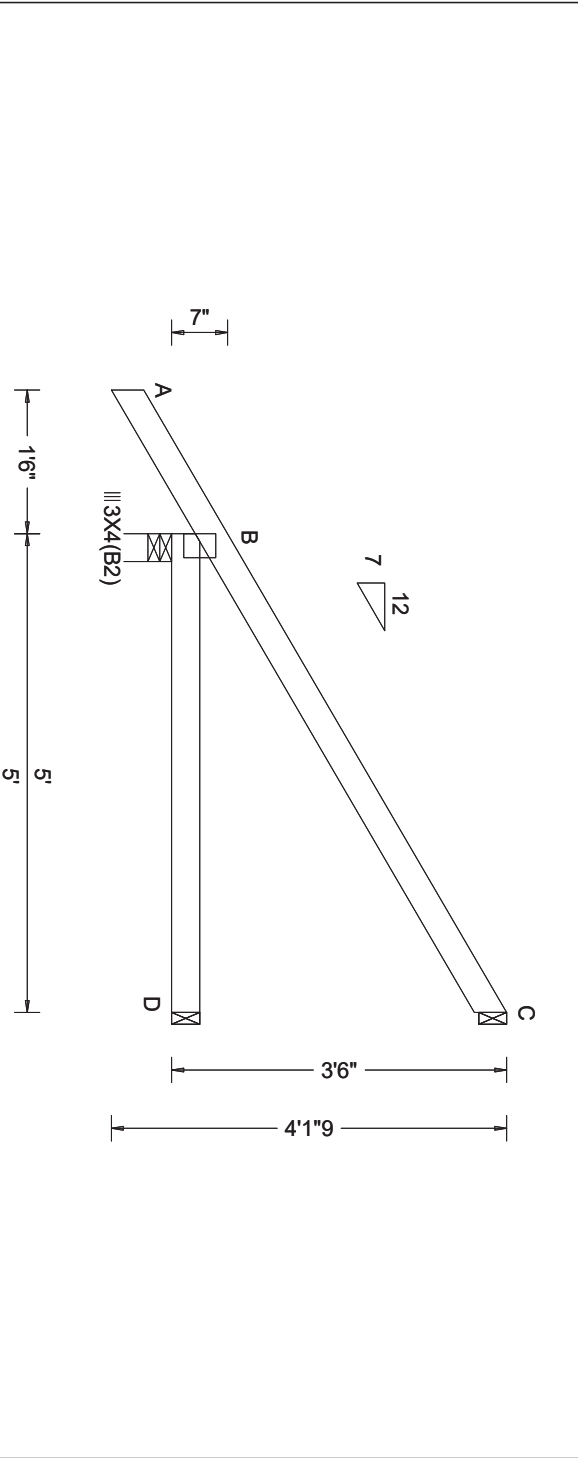


Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,Pf in PSF)			Def/CSI Criteria		▲ Maximum Reactions (lbs)							
TCCL: 20.00	Wind Std: ASCE 7-16	Wind Std: ASCE 7-16		Pg: NA	Ct: NA	CAT: NA	PP Deflection in loc L/def L/#		Loc	R+	R-	Gravity	Rh	Rw	U	RL
TCCL: 10.00	Speed: 130 mph	Speed: 130 mph		Pf: NA		Ce: NA	VERT(LL): NA		B	327	-	-	/225	/29	/127	
BCCL: 0.00	Enclosure: Closed	Enclosure: Closed		Lu: NA	Cs: NA		VERT(CL): NA		D	95	-	-	/51	-	-	
BCDL: 10.00	Risk Category: II	Risk Category: II					HORZ(TL): 0.005 B		C	138	-	-	/89	/81	-	
	EXP: C Kzt: NA	EXP: C Kzt: NA					-		Wind reactions based on MWFRS							
	Mean Height: 15.00 ft	Mean Height: 15.00 ft					-		B Brg Wid = 3.5 Min Req = 1.5							
NCBCCL: 10.00	TCCL: 5.0 psf	TCCL: 5.0 psf							D Brg Wid = 1.5							
Soffit: 2.00	BCDL: 5.0 psf	BCDL: 5.0 psf							C Brg Wid = 1.5							
Load Duration: 1.25	MWFRS Parallel Dist: 0 to h/2	MWFRS Parallel Dist: 0 to h/2							Bearing B is a rigid surface.							
Spacing: 24.0 "	C&C Dist a: 3.00 ft	C&C Dist a: 3.00 ft							Members not listed have forces less than 375#							
	Loc. from endwall: not in 4.50 ft	Loc. from endwall: not in 4.50 ft														
	GCpl: 0.18	GCpl: 0.18														
	Wind Duration: 1.60	Wind Duration: 1.60														

Lumber
Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;

Wind
Wind loads based on MWFRS with additional C&C member design.
Wind loading based on both gable and hip roof types.

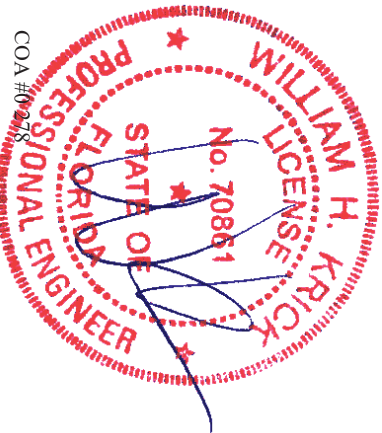

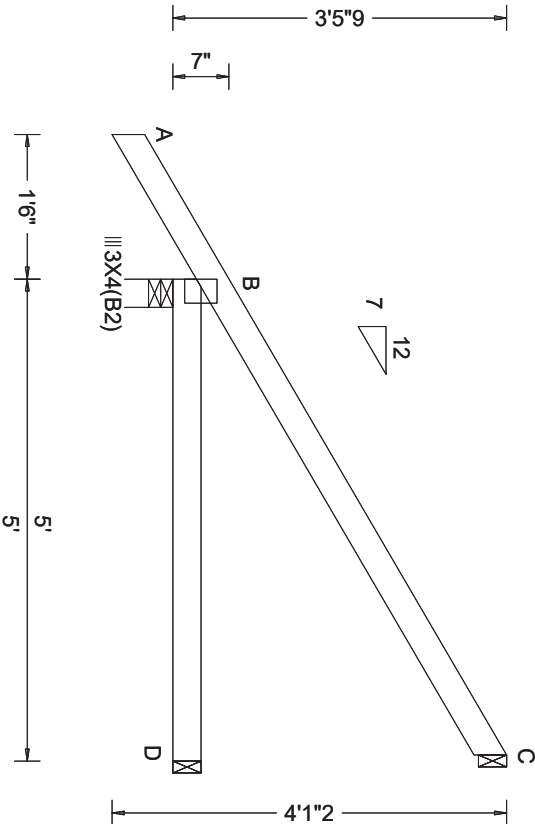

Loading Criteria (psf)		Wind Criteria	Snow Criteria (Pg,Pf in PSF)		Def/CSI Criteria		▲ Maximum Reactions (lbs)				
TCCL: 20.00		Wind Std: ASCE 7-16	Pg: NA	Ct: NA	PP Deflection in loc L/def L/#		Loc	Gravly	Non-Gravly		
TCDL: 10.00		Speed: 130 mph	Ce: NA	CAT: NA			R+	/R-	/Rh	/Rw /U /RL	
BCLL: 0.00		Enclosure: Closed	Lu: NA	Cs: NA	VERT(LL): NA		B	326	/-	/-	/225 /29 /126
BCDL: 10.00		Risk Category: II	Snow Duration: NA		VERT(CL): NA		C	136	/-	/-	/87 /80 /-
Des Ld: 40.00		EXP: C Kzt: NA			HORZ(TL): 0.005 B	-	D	95	/-	/-	/51 /-
NCBCLL: 10.00		Mean Height: 15.00 ft				-	Wind reactions based on MWFRS				
Sofft: 2.00		TCDL: 5.0 psf			Building Code: FBC 7th Ed. 2020 Res.		B Brg Wld = 3.5 Min Req = 1.5				
Load Duration: 1.25		BCDL: 5.0 psf			TPI Std: 2014		C Brg Wld = 1.5				
Spacing: 24.0 "		MWFRS Parallel Dist: 0 to h/2			Rep Fac: Yes		D Brg Wld = 1.5				
		C&C Dist a: 3.00 ft			FT/RT:20(0)/10(0)		Bearing B is a rigid surface.				
		Loc. from endwall: not in 4.50 ft			Plate Type(s):		Members not listed have forces less than 375#				
		GCpf: 0.18					VIEW Ver: 21.01.01A.0521.20				
		Wind Duration: 1.60	WAVE								


Lumber

Top chord: 2x4 SP M-31;
Bot chord: 2x4 SP M-31;

Wind

Wind loads based on MWFRS with additional C&C member design.

Wind loading based on both gable and hip roof types.

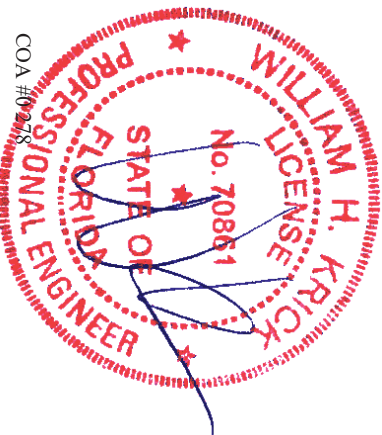

COA #0278
Florida License State of Product Approval #FL 1999


****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**

****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/TFP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/TFP 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com, TPI: tpist.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org


SECN: 409495 / FROM: CDM	JACK	Ply: 1 Qty: 6	Job Number: 23-8926 Sunset 7 Truss Label: J09	Cust: R 215 JRef: 1XN32150003 T17 DwnNo: 041.23.0912.21512 / WHK 02/10/2023
-----------------------------	------	------------------	---	---

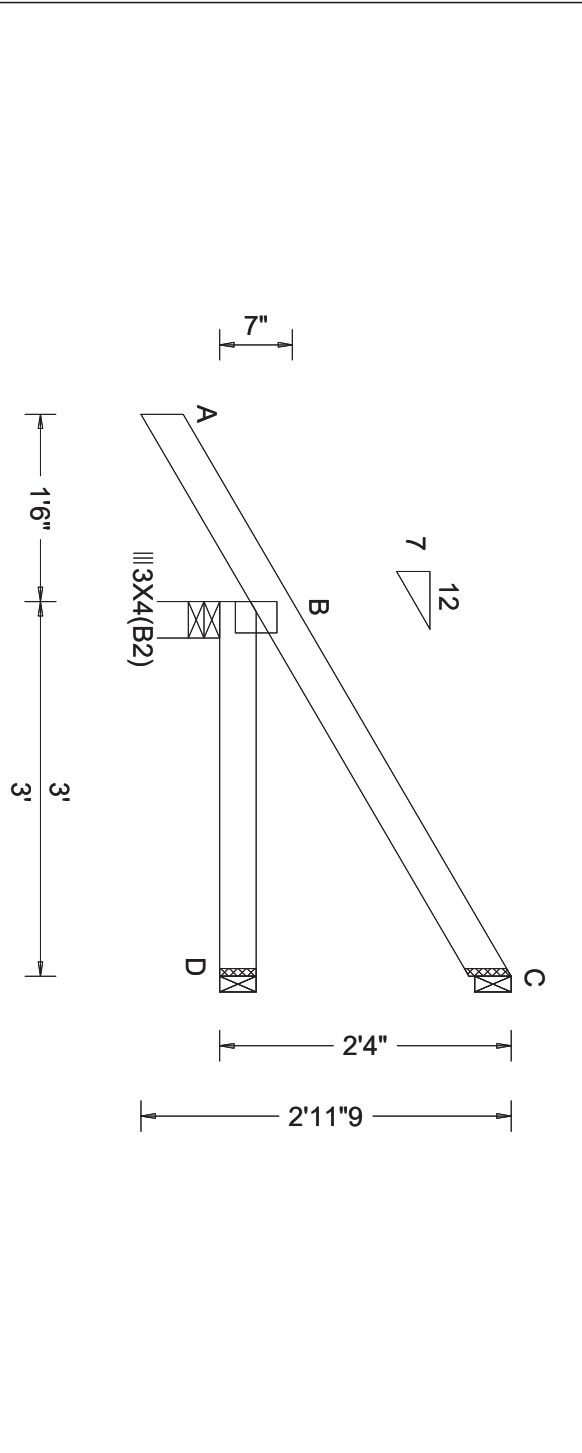

Loading Criteria (psf)	Wind Criteria	Snow Criteria (Pg P _f in PSF)	Def/CSI Criteria	▲ Maximum Reactions (lbs)
TCCL: 20.00 TCCL: 10.00 BCCL: 0.00 BCCL: 10.00 Des Ld: 40.00 NCBCCL: 10.00 Soffit: 2.00 Load Duration: 1.25 Spacing: 24.0 "	Wind Std: ASCE 7-16 Speed: 130 mph Enclosure: Closed Risk Category: II EXP: C Kzt: NA Mean Height: 15.00 ft TCCL: 5.0 psf BCCL: 5.0 psf MWFRS Parallel Dist: 0 to h/2 C&C Dist a: 3.00 ft Loc. from endwall: not in 4.50 ft GCpf: 0.18 Wind Duration: 1.60	Pg: NA Ct: NA CAT: NA Pf: NA Ce: NA Lu: NA Cs: NA Snow Duration: NA Building Code: FBC 7th Ed. 2020 Res. TPI Std: 2014 Rep Fac: Yes FT/RT:20(0)/10(0) Plate Type(s):	PP Deflection in loc L/def L/# VERT(L): NA VERT(CL): NA HORZ(L): -0.001 C - - HORZ(TL): 0.001 C - - Creep Factor: 2.0 Max TC CSI: 0.072 Max BC CSI: 0.033 Max Web CSI: 0.000 VIEW Ver: 21.01.01A.0521.20	Gravity / Rh / Rw / U / RL Loc R+ / R- B 255 /- /- /184 /31 /86 D 56 /- /- /31 /- /- C 69 /- /- /42 /46 /- Wind reactions based on MWFRS B Big Wid = 3.5 Min Req = 1.5 D Big Wid = 1.5 C Big Wid = 1.5 Bearing B is a rigid surface. Members not listed have forces less than 375#

Lumber
 Top chord: 2x4 SP M-31;
 Bot chord: 2x4 SP M-31;

Wind
 Wind loads based on MWFRS with additional C&C member design.
 Wind loading based on both gable and hip roof types.

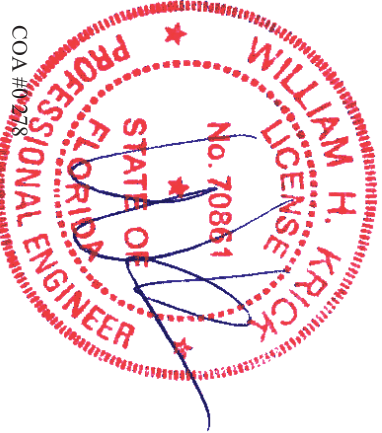

COA #09278
 Certificate of Product Approval #FL 1999

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**


****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-2 for standard plate positions. Refer to Job's General Notes page for additional information.

Alpine, a division of ITW Building Components Group Inc, shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANS/ITP 11 or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANS/ITP 1 Sec.2.

For more information see these web sites: Alpine: alpineitw.com, TPI: tpinst.org, SBCA: sbcacomponents.com, ICC: iccsafe.org, AWC: awc.org



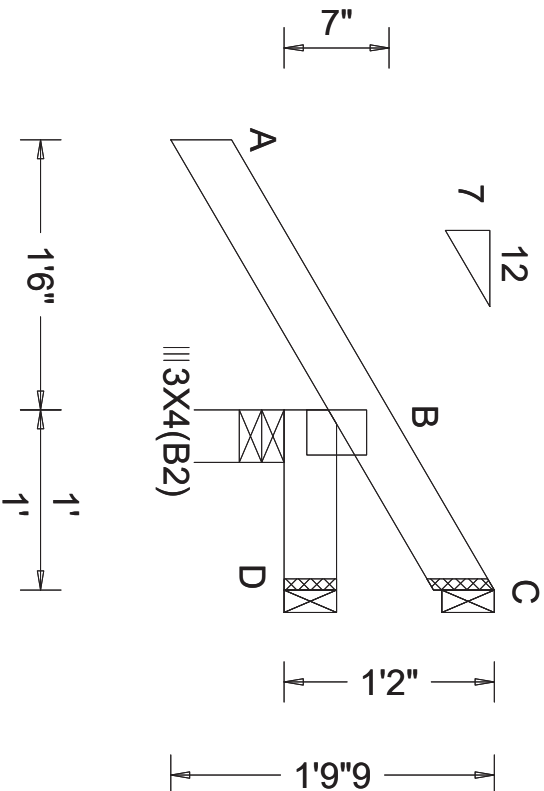

Loading Criteria (psf)		Wind Criteria		Snow Criteria (Pg,P _f in PSF)		Def/CSI Criteria		▲ Maximum Reactions (lbs)				
TCLL:	20.00	Wind Std:	ASCE 7-16	Pg: NA	Ct: NA	CAT: NA	PP Deflection in	Loc R+ / Rh	Gravity / Rh	Non-Gravity / Rw	Gravity / RL	
TCDL:	10.00	Speed:	130 mph	Lu: NA	Cs: NA	Ce: NA	VERT(L):	NA	VERT(CL):	NA	VERT(UL):	NA
BCLL:	0.00	Enclosure:	Closed	EXP: C	Kzt: NA		HORZ(L):	-0.001	C	-		
BCDL:	10.00	Risk Category:	II	Mean Height:	15.00 ft		HORZ(TL):	0.001	C	-		
Des Ld:	40.00			Building Code:			Creep Factor:	2.0				
NCBCLL:	10.00			FBC 7th Ed. 2020 Res.			Max TC CSI:	0.093				
Soffit:	2.00	BCDL:	5.0 psf	TPI Std:	2014		Max BC CSI:	0.010				
Load Duration:	1.25	MWFRS Parallel Dist:	0 to h/2	Rep Fac:	Yes		Max Web CSI:	0.000				
Spacing: 24.0 "		C&C Dist at:	3.00 ft	FT/RT:20(0)/10(0)								
		Loc. from endwall:	Any	Plate Type(s):								
		GCpl:	0.18									
		Wind Duration:	1.60									
				WAVE								
												</

Gable Stud Reinforcement Detail

ASCE 7-16: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00

Or: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Max Gable Vertical Length	2x4 Gable Vertical		Brace Grade	No Braces	(1) 1x4 "L" Brace *		(1) 2x4 "L" Brace *		(2) 2x4 "L" Brace **		(1) 2x6 "L" Brace *		(2) 2x6 "L" Brace **	
	Spacing	Species			Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B
24" O.C.	SPF	#1 / #2	#1	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"
			#3	4' 1"	6' 7"	7' 1"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"
			Stud	4' 1"	6' 7"	7' 0"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"
		Standard	#1	4' 6"	5' 8"	6' 0"	7' 7"	8' 1"	10' 1"	10' 6"	11' 10"	12' 8"	14' 0"	14' 0"
			#2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"
			#3	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"
	SP DFL	Stud	#1	4' 2"	6' 0"	6' 4"	7' 11"	8' 6"	10' 2"	10' 7"	12' 5"	13' 4"	14' 0"	14' 0"
			#2	4' 0"	5' 3"	5' 7"	7' 0"	7' 6"	10' 2"	10' 7"	11' 10"	14' 0"	14' 0"	14' 0"
			Standard	4' 0"	5' 3"	5' 7"	7' 0"	7' 6"	10' 2"	10' 7"	11' 10"	14' 0"	14' 0"	14' 0"
		#1 / #2	#1	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	4' 8"	8' 1"	8' 8"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	4' 8"	8' 1"	8' 6"	9' 8"	10' 1"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
16" O.C.	SPF	#1 / #2	#1	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	4' 8"	6' 11"	7' 5"	9' 3"	9' 11"	11' 7"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	#1	5' 1"	8' 5"	8' 9"	9' 11"	10' 4"	11' 10"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	4' 11"	8' 4"	8' 8"	9' 10"	10' 3"	11' 8"	12' 2"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
	SP DFL	Stud	#1	4' 9"	7' 4"	7' 9"	9' 9"	10' 2"	11' 8"	12' 1"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	4' 8"	6' 5"	6' 10"	8' 7"	9' 2"	11' 7"	12' 1"	13' 6"	14' 0"	14' 0"	14' 0"
			Standard	4' 8"	6' 5"	6' 10"	8' 7"	9' 2"	11' 7"	12' 1"	13' 6"	14' 0"	14' 0"	14' 0"
	SPF	#1 / #2	#1	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	11' 8"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 1"	9' 0"	9' 4"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	#1	#1	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Standard	5' 1"	8' 0"	8' 6"	10' 8"	11' 1"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
12" O.C.	SPF	#1 / #2	#1	5' 8"	9' 3"	9' 8"	10' 11"	11' 4"	13' 0"	13' 6"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 5"	9' 2"	9' 6"	10' 10"	11' 3"	12' 11"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
		Stud	#1	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
			Standard	5' 3"	8' 5"	9' 0"	10' 9"	11' 2"	12' 10"	13' 4"	14' 0"	14' 0"	14' 0"	14' 0"
	SP DFL	#1 / #2	#1	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#3	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Stud	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
		Standard	#1	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			#2	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"
			Standard	5' 1"	7' 5"	7' 11"	9' 11"	10' 7"	12' 9"	13' 3"	14' 0"	14' 0"	14' 0"	14' 0"

Bracing Group Species and Grades:

Group A:			
Spruce-Pine-Fir		Hem-Fir	
#1 / #2	Standard	#2	Stud
#3	Stud	#3	Standard
Douglas Fir-Larch		Southern Pine***	
#3		#3	
Stud		Stud	
Standard		Standard	

Group B:			
Hem-Fir			
#1 & Btr		#1	
Douglas Fir-Larch			
#1		#1	
#2		#2	

1x4 Braces shall be SRB (Stress-Rated Board).

***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:

Wind Load deflection criterion is L/240.

Provide uplift connections for 55 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach "L" braces with 10d (0.128"x3.0" min) nails.

* For (1) "L" brace: space nails at 2' o.c.

in 18' end zones and 4' o.c. between zones.

** For (2) "L" braces: space nails at 3' o.c. in 18' end zones and 6' o.c. between zones.

"L" bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes

Vertical Length	No Splice
Less than 4' 0"	1X4 or 2X3
Greater than 4' 0"	3X4


+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.


Diagonal brace option: vertical length may be doubled when diagonal brace is used. Connect diagonal brace for 450# at each end. Max web total length is 14'.

Vertical length shown in table above.

Connect diagonal at midpoint of vertical web.

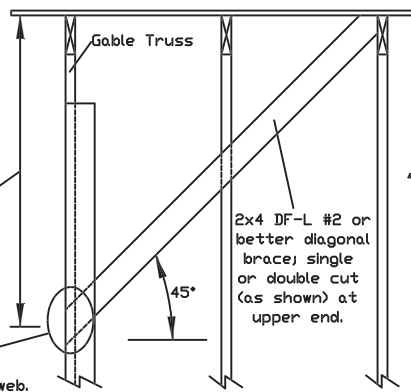

"L" Brace End Zones, typ.

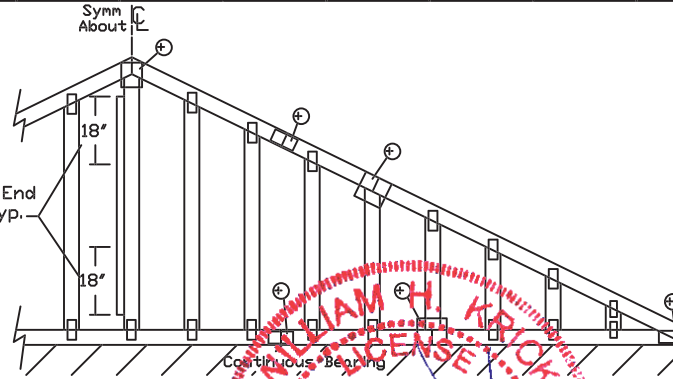

Refer to chart above for max gable vertical length.

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to any follow the latest edition of BCSI (Building Component Safety) Information, by TPI and SBCA for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcacomponents.com ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY

155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

No. 70861

STATE OF

FLORIDA

PROFESSIONAL ENGINEER

CO. #0-278-02/10/2023

Florida Certificate of Product Approval #1999

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCE7-16-GAB14015

DATE 01/26/2018

DRWG A14015ENC160118

CLR Reinforcing Member Substitution

This detail is to be used when a Continuous Lateral Restraint (CLR) is specified on a truss design but an alternative web reinforcement method is desired.

Notes:

This detail is only applicable for changing the specified CLR shown on single ply sealed designs to T-reinforcement or L-reinforcement or scab reinforcement.

Alternative reinforcement specified in chart below may be conservative. For minimum alternative reinforcement, re-run design with appropriate reinforcement type.

Use scabs instead of L- or T- reinforcement on webs with intersecting truss joints, such as K-web joints, that may interfere with proper application along the narrow face of the web.


Web Member Size	Specified CLR Restraint	Alternative Reinforcement T- or L- Reinf.	Scab Reinf.
2x3 or 2x4	1 row	2x4	1-2x4
2x3 or 2x4	2 rows	2x6	2-2x4
2x6	1 row	2x4	1-2x6
2x6	2 rows	2x6	2-2x4(⊗)
2x8	1 row	2x6	1-2x8
2x8	2 rows	2x6	2-2x6(⊗)

T-reinforcement, L-reinforcement, or scab reinforcement to be same species and grade or better than web member unless specified otherwise on Engineer's sealed design.

(⊗) Center scab on wide face of web. Apply (1) scab to each face of web.


T-Reinforcement or L-Reinforcement:

Apply to either side of web narrow face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

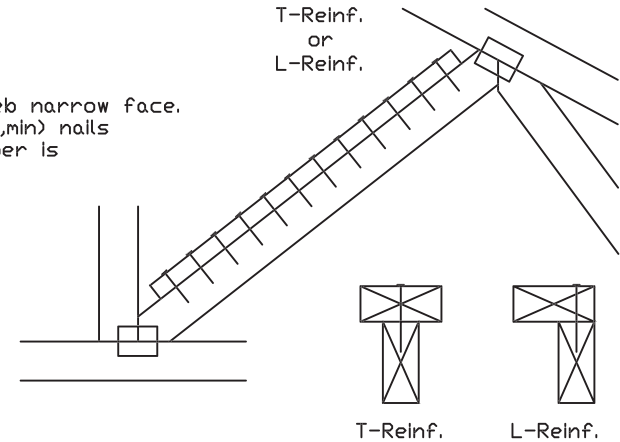


Scab Reinforcement:

Apply scab(s) to wide face of web. No more than (1) scab per face. Attach with 10d (0.128"x3.0",min) nails at 6" o.c. Reinforcing member is a minimum 80% of web member length.

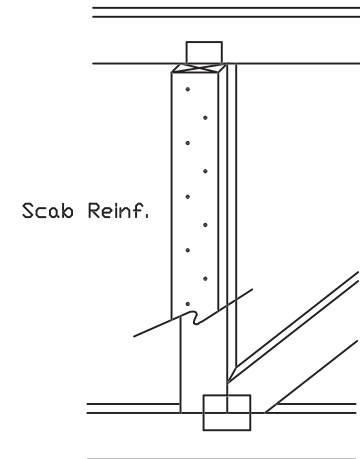

155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.
Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.
A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

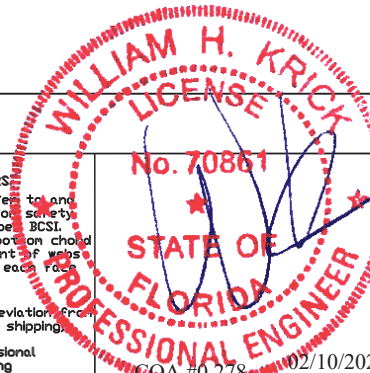

COA #0278 02/10/2023
Florida Certificate of Product Approval #EL 1999

TE LL	PSF	REF CLR Subst.
TC DL	PSF	DATE 01/02/19
BC DL	PSF	DRWG BRCLBSUB0119
BC LL	PSF	
TOT. LD.	PSF	
DUR. FAC.		
SPACING		

NAIL SPACING DETAIL

MINIMUM SPACING FOR SINGLE BLOCK IS SHOWN. DOUBLE NAIL SPACINGS AND STAGGER NAILING FOR TWO BLOCKS. GREATER SPACING MAY BE REQUIRED TO AVOID SPLITTING.

BLOCK LOCATION, SIZE, LENGTH, GRADE AND TOTAL NUMBER AND TYPE OF NAILS ARE TO BE SPECIFIED ON SEALED DESIGN REFERENCING THIS DETAIL.

LOAD PERPENDICULAR TO GRAIN

A - EDGE DISTANCE AND SPACING BETWEEN STAGGERED ROWS OF NAILS (6 NAIL DIAMETERS)

B - SPACING OF NAILS IN A ROW (12 NAIL DIAMETERS)

C - END DISTANCE (15 NAIL DIAMETERS)

LOAD PARALLEL TO GRAIN

A - EDGE DISTANCE (6 NAIL DIAMETERS)


C - SPACING OF NAILS IN A ROW AND END DISTANCE (15 NAIL DIAMETERS)

D - SPACING BETWEEN STAGGERED ROWS OF NAILS (7 1/2 NAIL DIAMETERS)

IF NAIL HOLES ARE PREBORED, SOME SPACING MAY BE REDUCED BY THE AMOUNTS GIVEN BELOW:

* SPACING MAY BE REDUCED BY 50%

** SPACING MAY BE REDUCED BY 33%

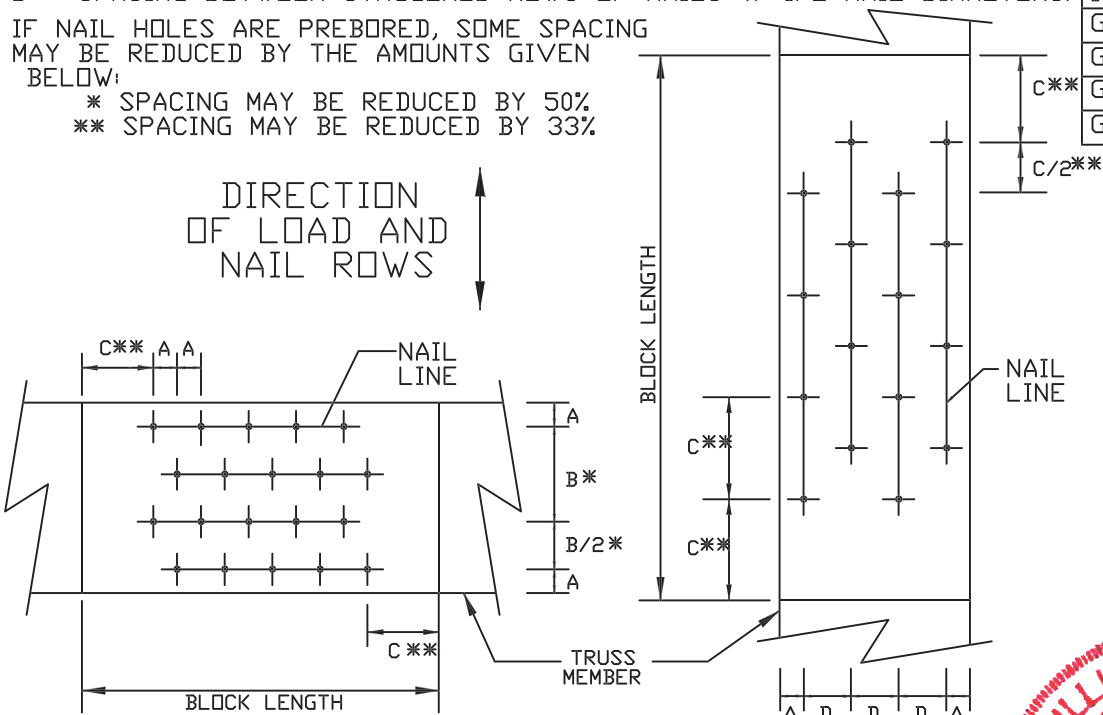

LOAD APPLIED PERPENDICULAR TO GRAIN

LOAD APPLIED PARALLEL TO GRAIN

MINIMUM NAIL SPACING DISTANCES

NAIL TYPE	DISTANCES			
	A	B*	C**	D
8d BOX (0.113"X 2.5",MIN)	3/4"	1 3/8"	1 3/4"	7/8"
10d BOX (0.128"X 3",MIN)	7/8"	1 5/8"	2"	1"
12d BOX (0.128"X 3.25",MIN)	7/8"	1 5/8"	2"	1"
16d BOX (0.135"X 3.5",MIN)	7/8"	1 5/8"	2 1/8"	1 1/8"
20d BOX (0.148"X 4",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
8d COMMON (0.131"X 2.5",MIN)	7/8"	1 5/8"	2"	1"
10d COMMON (0.148"X 3",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
12d COMMON (0.148"X 3.25",MIN)	1"	1 7/8"	2 1/4"	1 1/8"
16d COMMON (0.162"X 3.5",MIN)	1"	2"	2 1/2"	1 1/4"
GUN (0.120"X 2.5",MIN)	3/4"	1 1/2"	1 7/8"	1"
GUN (0.131"X 2.5",MIN)	7/8"	1 5/8"	2"	1"
GUN (0.120"X 3",MIN)	3/4"	1 1/2"	1 7/8"	1"
GUN (0.131"X 3",MIN)	7/8"	1 5/8"	2"	1"



155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025


WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpneitw.com TPI: www.tpinet.org SBCA: www.sbcacomponents.com ICC: www.iccsafe.org

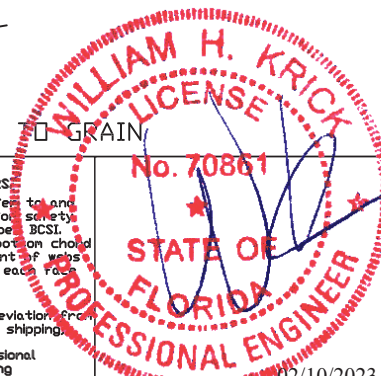

COA #0078 02/10/2023

Florida Certificate of Product Approval #FL 1999

REF NAIL SPACE
DATE 10/01/14
DRWG CNNAILSP1014

Commentary: Deflection and Camber

Camber may be built into trusses to compensate for the vertical deflection that results from the application of loads. Providing camber has the following advantages:

- Helps to ensure level ceilings and floors after dead loads are applied.
- Facilitates drainage to avoid ponding on flat or low slope roofs.
- Compensates for different deflection characteristics between adjacent trusses.
- Improves appearance of garage door headers and other long spans that can appear to "sag."
- Avoids "dips" in roof ridgelines at the transition from the gable to adjacent clear span trusses.

In accordance with ANSI/TPI 1 the Building Designer, through the Construction Documents, shall provide the location, direction, and magnitude of all loads attributable to ponding that may occur due to the design of the roof drainage system. The Building Designer shall also specify any dead load, live load, and in-service creep deflection criteria for flat or low-slope roofs subject to ponding loads.

The amount of camber is dependent on the truss type, span, loading, application, etceteras.

More restrictive limits for allowable deflection and slenderness ratio (L/D) may be required to help control vibration.

The following tables are provided as guidelines for limiting deflection and estimating camber. Conditions or codes may exist that require exceeding these recommendations, or past experience may warrant using more stringent limitations.

L = Span of Truss (Inches)
D = Depth of Truss at Deflection Point (Inches)

Recommended Truss Deflection Limits

Truss Type	L/D	Deflection Limits	
		Live Load	Total Load
Pitched Roof Trusses	24	L/240 (vertical)	L/180 (vertical)
Floor of Room-In-Attic Trusses	24	L/360 (vertical)	L/240 (vertical)
Flat or Shallow Pitched Roof Trusses	24	L/360 (vertical)	L/240 (vertical)
Residential Floor Trusses	24	L/360 (vertical)	L/240 (vertical)
Commercial Floor Trusses	20	L/480 (vertical)	L/240 (vertical)
Scissors Trusses	24	0.75" (horizontal)	1.25" (horizontal)

Truss Type	Recommended Camber
Pitched Trusses	1.00 x Deflection from Actual Dead Load
Sloping Parallel Chord Trusses	1.5 x Vertical Deflection from Actual Dead Load
Floor Trusses	(0.25 x Deflection from Live Load) + Actual Dead Load
Flat Roof Trusses	(0.25 x Deflection from Live Load) + (1.5 x Design Dead Load Deflection)

Note: The actual dead load may be considerably less than the design dead load.

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.


A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:

ALPINE: www.alpineitw.com TPI: www.tpinet.org SBCA: www.sbcacomponents.com ICC: www.iccsafe.org




155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

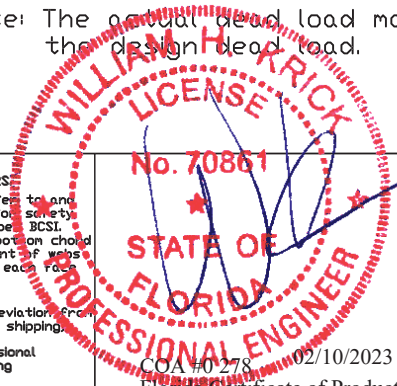

Florida Certificate of Product Approval #FL 1999

REF	DEFLEC/CAMB
DATE	10/01/14
DRWG	DEFLCAMB1014

Gable Detail For Let-in Verticals

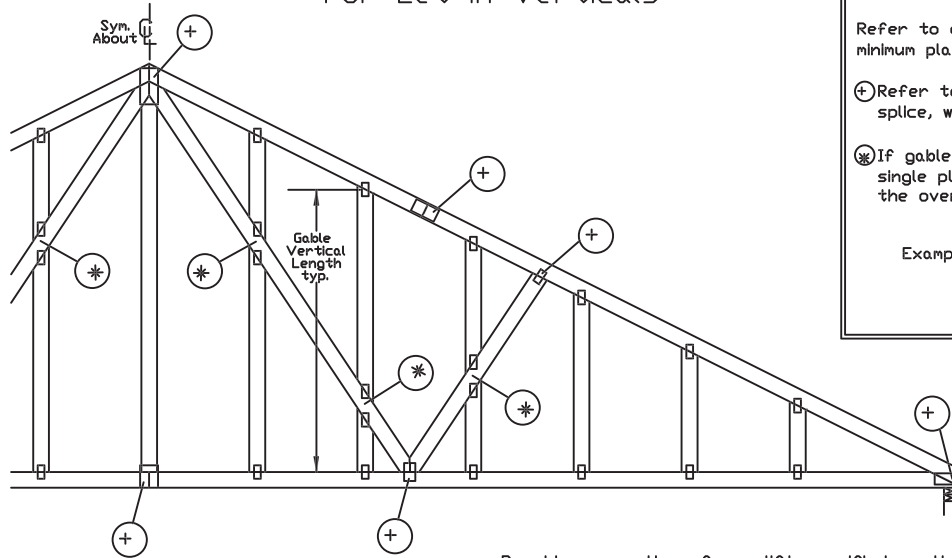


Gable Truss Plate Sizes

Refer to appropriate Alpine gable detail for minimum plate sizes for vertical studs.


① Refer to Engineered truss design for peak, splice, web, and heel plates.

⊗ If gable vertical plates overlap, use a single plate that covers the total area of the overlapped plates to span the web.

Example:



"T" Reinforcement Attachment Detail

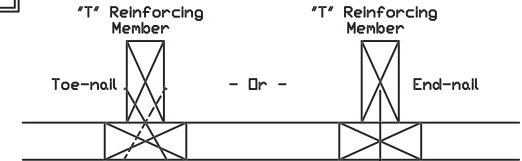

To convert from "L" to "T" reinforcing members, multiply "T" increase by length (based on appropriate Alpine gable detail).

Maximum allowable "T" reinforced gable vertical length is 14' from top to bottom chord.

"T" reinforcing member material must match size, specie, and grade of the "L" reinforcing member.

Web Length Increase w/ "T" Brace

"T" Reinf. Mbr. Size	"T" Increase
2x4	30 %
2x6	20 %

Example:

ASCE 7-10 Wind Speed = 120 mph

Mean Roof Height = 30 ft, Kzt = 1.00

Gable Vertical = 24' o.c. SP #3

"T" Reinforcing Member Size = 2x4

"T" Brace Increase (From Above) = 30% = 1.30

(1) 2x4 "L" Brace Length = 8' 7"

Maximum "T" Reinforced Gable Vertical Length
1.30 x 8' 7" = 11' 2"

Provide connections for uplift specified on the engineered truss design.

Attach each "T" reinforcing member with

End Driven Nails:

10d Common (0.148"x3",min) Nails at 4' o.c. plus
(4) nails in the top and bottom chords.

Toenailed Nails:

10d Common (0.148"x3",min) Toenails at 4' o.c. plus
(4) toenails in the top and bottom chords.

This detail to be used with the appropriate Alpine gable detail for ASCE wind load.


ASCE 7-05 Gable Detail Drawings

A13015051014, A12015051014, A11015051014, A10015051014, A14015051014,
A13030051014, A12030051014, A11030051014, A10030051014, A14030051014

ASCE 7-10 & ASCE 7-16 Gable Detail Drawings

A11515ENC100118, A12015ENC100118, A14015ENC100118, A16015ENC100118,
A18015ENC100118, A20015ENC100118, A20015END100118, A20015PED100118,
A11530ENC100118, A12030ENC100118, A14030ENC100118, A16030ENC100118,
A18030ENC100118, A20030ENC100118, A20030END100118, A20030PED100118,
S11515ENC100118, S12015ENC100118, S14015ENC100118, S16015ENC100118,
S18015ENC100118, S20015ENC100118, S20015END100118, S20015PED100118,
S11530ENC100118, S12030ENC100118, S14030ENC100118, S16030ENC100118,
S18030ENC100118, S20030ENC100118, S20030END100118, S20030PED100118

See appropriate Alpine gable detail for maximum allowable gable vertical length.

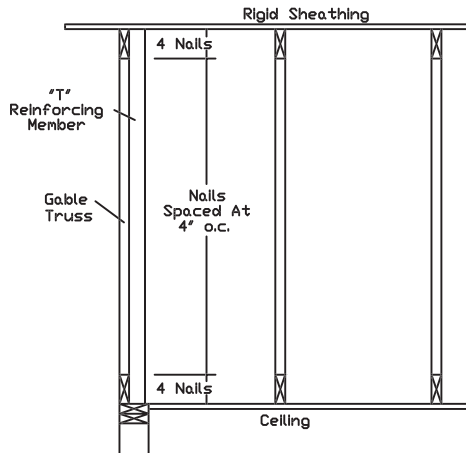

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to any follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this Job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinet.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY

155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

No. 70861

STATE OF

FLORIDA

PROFESSIONAL ENGINEER

COA #0 278

02/10/2023

Florida Certificate of Product

REF LET-IN VERT

DATE 01/02/2018

DRWG GBLLETIN0118

MAX. TOT. LD. 60 PSF

DUR. FAC. ANY

Approval #FL 1999

MAX. SPACING 24.0"

Gable Stud Reinforcement Detail for Stucco Cladding

ASCE 7-16: 140 mph Wind Speed, 15' Mean Height, Enclosed, Exposure C, Kzt = 1.00

Or: 120 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure C, Kzt = 1.00
 Or: 120 mph Wind Speed, 15' Mean Height, Enclosed, Exposure D, Kzt = 1.00
 Or: 100 mph Wind Speed, 15' Mean Height, Partially Enclosed, Exposure D, Kzt = 1.00

Max Gable Vertical Length	2x4 Gable Vertical		Brace Grade	No Braces	(1) 1x4 "L" Brace *		(1) 2x4 "L" Brace *		(2) 2x4 "L" Brace **		(1) 2x6 "L" Brace *		(2) 2x6 "L" Brace **	
	Spacing	Species			Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B	Group A	Group B
24" O.C.	SPF	#1 / #2	3' 9"	6' 4"	6' 7"	7' 6"	7' 10"	8' 11"	9' 4"	11' 9"	12' 3"	14' 0"	14' 0"	
		#3	3' 7"	6' 3"	6' 6"	7' 5"	7' 8"	8' 10"	9' 2"	11' 7"	12' 1"	13' 10"	14' 0"	
		Stud	3' 7"	6' 3"	6' 6"	7' 5"	7' 8"	8' 10"	9' 2"	11' 7"	12' 1"	13' 10"	14' 0"	
		Standard	3' 7"	5' 8"	6' 0"	7' 5"	7' 8"	8' 10"	9' 2"	11' 7"	12' 1"	13' 10"	14' 0"	
	SP	#1	3' 11"	6' 5"	6' 8"	7' 7"	7' 11"	9' 0"	9' 5"	11' 11"	12' 4"	14' 0"	14' 0"	
		#2	3' 9"	6' 4"	6' 7"	7' 6"	7' 10"	8' 11"	9' 4"	11' 9"	12' 3"	14' 0"	14' 0"	
		#3	3' 8"	6' 0"	6' 4"	7' 5"	7' 9"	8' 11"	9' 3"	11' 8"	12' 2"	13' 11"	14' 0"	
		Stud	3' 8"	6' 0"	6' 4"	7' 5"	7' 9"	8' 11"	9' 3"	11' 8"	12' 2"	13' 11"	14' 0"	
	DFL	Standard	3' 7"	5' 3"	5' 7"	7' 0"	7' 6"	8' 10"	9' 2"	11' 0"	11' 10"	13' 10"	14' 0"	
		#1 / #2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"	
		#3	4' 1"	7' 2"	7' 7"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	
		Stud	4' 1"	7' 2"	7' 5"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	
16" O.C.	SPF	Standard	4' 1"	6' 11"	7' 5"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	
		#1	4' 6"	7' 4"	7' 8"	8' 8"	9' 0"	10' 4"	10' 9"	13' 8"	14' 0"	14' 0"	14' 0"	
		#2	4' 3"	7' 3"	7' 7"	8' 7"	8' 11"	10' 3"	10' 8"	13' 6"	14' 0"	14' 0"	14' 0"	
		#3	4' 2"	7' 3"	7' 6"	8' 6"	8' 10"	10' 2"	10' 7"	13' 5"	13' 11"	14' 0"	14' 0"	
	SP	Stud	4' 2"	7' 3"	7' 6"	8' 6"	8' 10"	10' 2"	10' 7"	13' 5"	13' 11"	14' 0"	14' 0"	
		Standard	4' 1"	6' 5"	6' 10"	8' 6"	8' 10"	10' 1"	10' 6"	13' 4"	13' 10"	14' 0"	14' 0"	
		#1 / #2	4' 8"	8' 0"	8' 4"	9' 5"	9' 10"	10' 3"	11' 9"	14' 0"	14' 0"	14' 0"	14' 0"	
		#3	4' 6"	7' 11"	8' 2"	9' 4"	9' 8"	11' 1"	11' 7"	14' 0"	14' 0"	14' 0"	14' 0"	
	DFL	Stud	4' 6"	7' 11"	8' 2"	9' 4"	9' 8"	11' 1"	11' 7"	14' 0"	14' 0"	14' 0"	14' 0"	
		Standard	4' 6"	7' 11"	8' 2"	9' 4"	9' 8"	11' 1"	11' 7"	14' 0"	14' 0"	14' 0"	14' 0"	
		#1	4' 11"	8' 1"	8' 5"	9' 7"	9' 11"	11' 4"	11' 10"	14' 0"	14' 0"	14' 0"	14' 0"	
		#2	4' 8"	8' 0"	8' 4"	9' 5"	9' 10"	11' 3"	11' 9"	14' 0"	14' 0"	14' 0"	14' 0"	
SP	#3	4' 7"	7' 11"	8' 3"	9' 5"	9' 9"	11' 2"	11' 8"	14' 0"	14' 0"	14' 0"	14' 0"		
	Stud	4' 7"	7' 11"	8' 3"	9' 5"	9' 9"	11' 2"	11' 8"	14' 0"	14' 0"	14' 0"	14' 0"		
	Standard	4' 6"	7' 5"	7' 11"	9' 4"	9' 8"	11' 1"	11' 7"	14' 0"	14' 0"	14' 0"	14' 0"		

Bracing Group Species and Grades:

Group A:			
Spruce-Pine-Fir		Hem-Fir	
#1 / #2	Standard	#2	Stud
#3	Stud	#3	Standard
Douglas Fir-Larch		Southern Pine***	
#3		#3	
Stud		Stud	
Standard		Standard	

Group B:			
Hem-Fir			
#1 & Btr			
#1			
Douglas Fir-Larch		Southern Pine***	
#1		#1	
#2		#2	

1x4 Braces shall be SRB (Stress-Rated Board).
 ***For 1x4 So. Pine use only Industrial 55 or Industrial 45 Stress-Rated Boards. Group B values may be used with these grades.

Gable Truss Detail Notes:

Wind Load deflection criterion is L/360.

Provide uplift connections for 55 plf over continuous bearing (5 psf TC Dead Load).

Gable end supports load from 4' 0" outlookers with 2' 0" overhang, or 12' plywood overhang.

Attach "L" braces with 10d (0.128"x3.0" min) nails.



* For (1) "L" brace: space nails at 2' o.c. in 18" end zones and 4' o.c. between zones.
 ** For (2) "L" braces: space nails at 3' o.c. in 18" end zones and 6' o.c. between zones.

"L" bracing must be a minimum of 80% of web member length.

Gable Vertical Plate Sizes	
Vertical Length	No Splice
Less than 4' 0"	1X4 or 2X3
Greater than 4' 0"	3X4

+ Refer to common truss design for peak, splice, and heel plates.

Refer to the Building Designer for conditions not addressed by this detail.

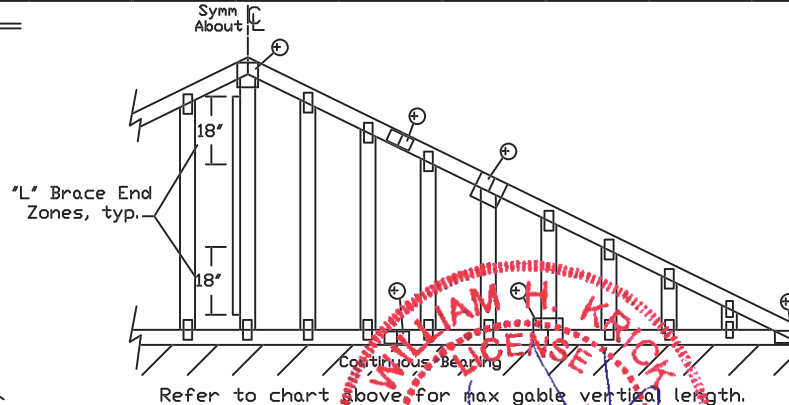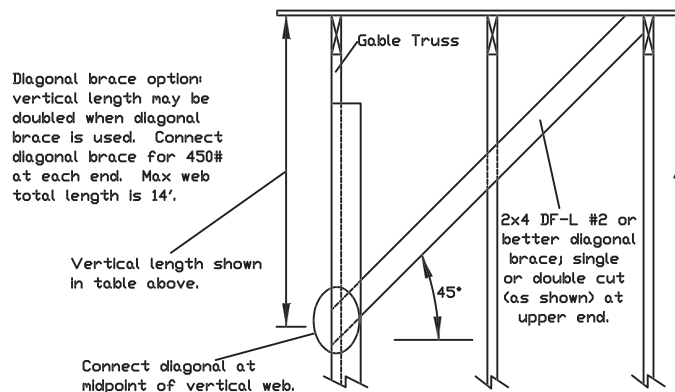

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
 IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to any follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
 ALPINE: www.alpneitw.com; TPI: www.tpinet.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org



155 Harlem Ave
 North Building, 4th Floor
 Glenview, IL 60025

No. 70861

STATE OF FLORIDA

PROFESSIONAL ENGINEER

00A #0278

02/10/2023

Florida Certificate of Product Approval #01-1000

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCE7-16-GAB14015

DATE 01/26/2018

DRWG S14015ENC160118